

FIRE PROTECTION GENERAL NOTES:

- 1. ALL DIMENSIONS ARE IN INCHES UNLESS OTHERWISE STATED.
- 2. THE FIRE SUPPRESSION SYSTEM FOR THE PROJECT SHALL BE DESIGNED WITH AN AUTOMATIC WET PIPE SYSTEM DESIGNED AND INSTALLED IN ACCORDANCE WITH NFPA 13-2019. THE MINIMUM DISCHARGE DENSITY SHALL BE IN ACCORDANCE WITH LIGHT HAZARD 2 CLASSIFICATION UNLESS SHOWN OR STATED ON THE DRAWINGS.
- 3. ALL MATERIALS SHALL BE IN ACCORDANCE WITH THE REQUIREMENTS OF THE APPLICABLE NFPA FIRE CODES INCLUDING NFPA 13-2019 AND SHALL CONFORM TO THE APPROPRIATE STANDARDS LISTED IN THE MOST CURRENT PUBLISHED NATIONAL BUILDING CODE OF CANADA (NBC), NATIONAL FIRE CODE OF CANADA (NFC), AND THE REQUIREMENTS AND STANDARDS REQUIRED BY THE AUTHORITY HAVING JURISDICTION.
- 4. ONLY EXPERIENCED FIRE PROTECTION CONTRACTORS WILL BE CONSIDERED FOR THIS WORK. THE FIRE PROTECTION CONTRACTOR MUST BE ABLE TO SHOW EVIDENCE OF HAVING PERFORMED WORK OF SIMILAR TYPE AND SIZE.
- 5. THE FIRE PROTECTION CONTRACTOR SHALL PREPARE AND SUBMIT SHOP DRAWINGS OF THE FIRE PROTECTION SYSTEMS INCLUDING EQUIPMENT AND MATERIAL FOR REVIEW BY THE ENGINEER AND INSPECTING AUTHORITIES.
- 6. THE FIRE PROTECTION CONTRACTOR SHALL BE SOLELY RESPONSIBLE FOR OBTAINING APPROVALS FROM THE AUTHORITY HAVING JURISDICTION FOR THE COMPLETE FIRE PROTECTION SYSTEM.
- 7. ALL APPLICABLE CODES SHALL BE IN ACCORDANCE WITH THE LATEST EDITION.
- 8. ALL EXPOSED SPRINKLER PIPING IS TO BE PAINTED AND COLOR SELECTION BY ARCHITECTS.
- 9. AFTER THE FIRE PROTECTION SYSTEM HAS BEEN COMPLETED, THE CONTRACTOR WILL RECERTIFY THE MODIFIED ZONES.

#KEYNOTES

- 1. CONNECT NEW FIRE PROTECTION PIPE TO EXISTING.
- 2. SUPPLY AND INSTALL NEW SPRINKLER BRANCHES, DROPPERS, HEADS ETC. IN THIS AREA TO MEET THE NFPA 13 REQUIREMENTS AND TO SUIT ARCHITECTURAL LAYOUT. REFER TO ARCHITECTURAL DRAWINGS AND COORDINATE WITH STRUCTURAL, ELECTRICAL AND HVAC LAYOUT. SPRINKLER HEADS SHALL BE CONCEALED COMPLETE WITH COVER AND TO MATCH CEILING FINISHES.




Stantec Consulting Ltd.
Suite 500, 311 Portage Avenue
Winnipeg MB Canada R3B 2B9
Tel. 204.489.5900 Fax. 204.453.9012
www.stantec.com

Copyright Reserved

The Contractor shall verify and be responsible for all dimensions. DO NOT scale the drawing - any errors or omissions shall be reported to Stantec without delay. The Copyrights to all designs and drawings are the property of Stantec. Reproduction or use for any purpose other than that authorized by Stantec is forbidden.

Consultants

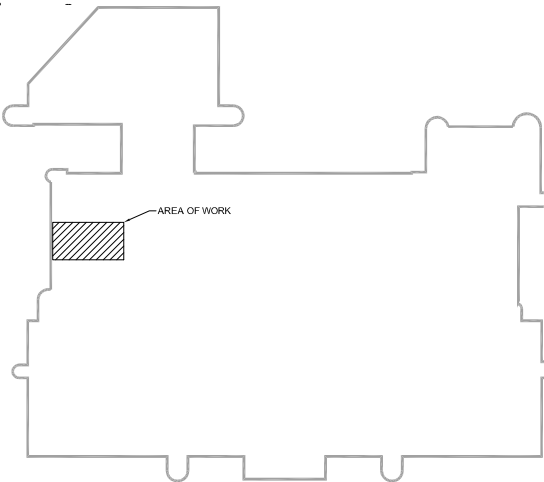

Legend

Revision	By	Appd.	YY.MM.DD
0	ISSUED FOR CONSTRUCTION	MA	BH 25.06.04
Issued	By	Appd.	YY.MM.DD

File Name:	21006-M	GS	WD	MA	25.03.28
		Dwn.	Chkd.	Dsgn.	YY.MM.DD

Permit-Seal

Certificate of Authorization
Stantec Consulting Ltd.
No. 1301



Client/Project



WINNIPEG TRANSIT MAINTENANCE FACILITY
OFFICE REDEVELOPMENT

421 OSBORNE ST. SOUTH, WINNIPEG, MB

Title

FIRE PROTECTION RENOVATION LAYOUT -
PARTIAL PLAN B

Project No.	Scale	
115421006	As indicated	
Drawing No.	Sheet	Revision
M-122	11 of 16	0

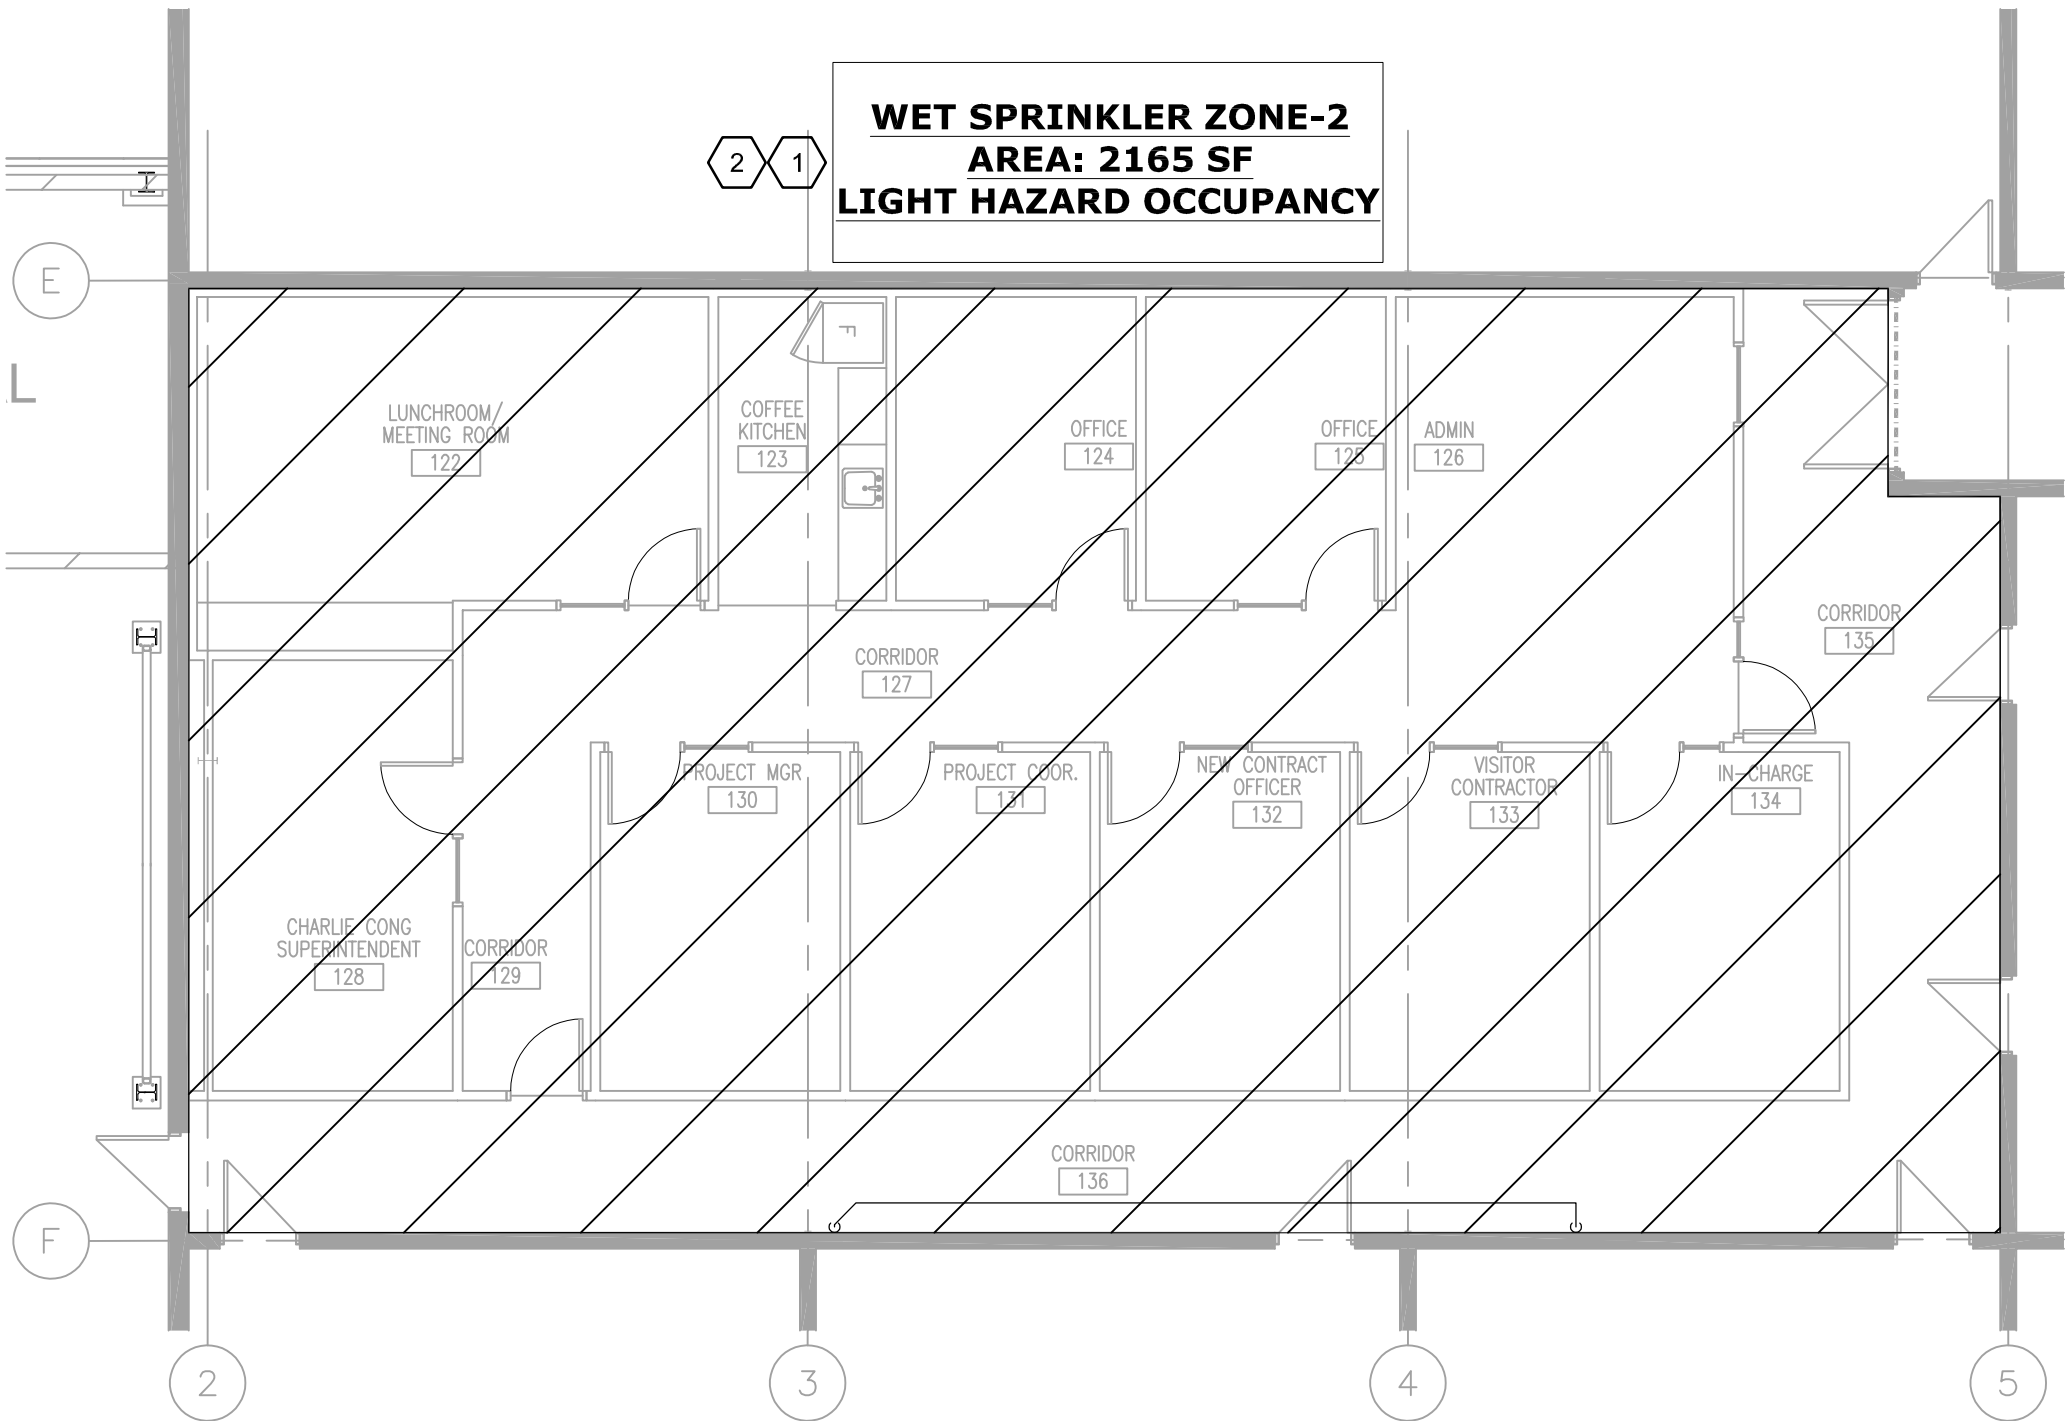

1
M-122

MAIN FLOOR PLAN - FIRE PROTECTION RENOVATION - AREA B
SCALE: 1/8"=1'-0"