
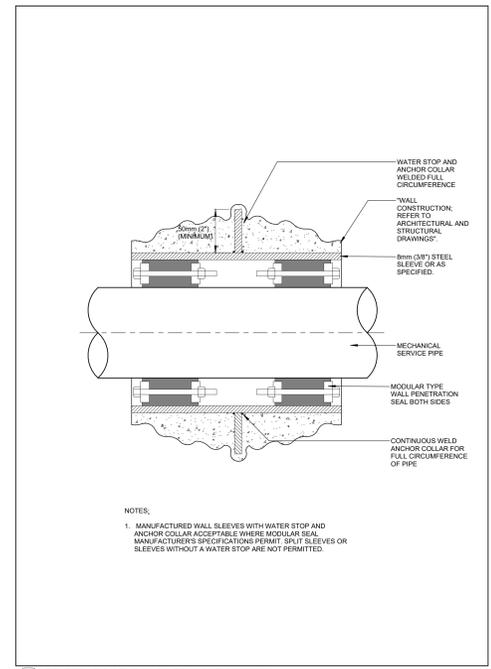
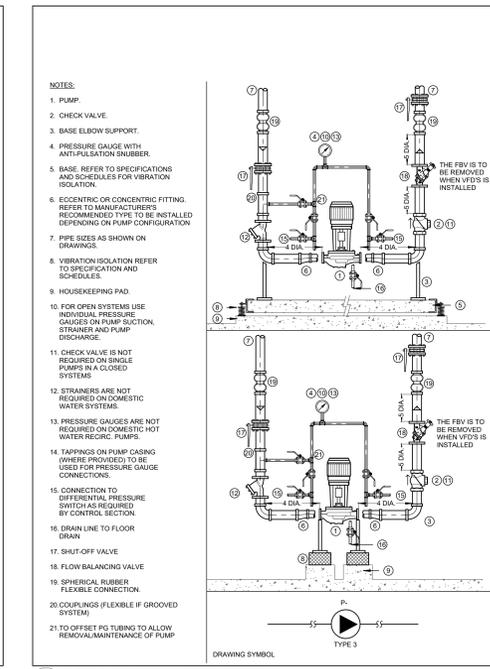
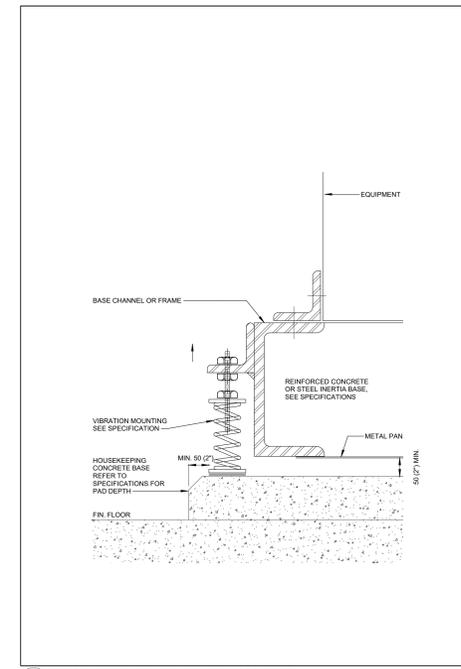
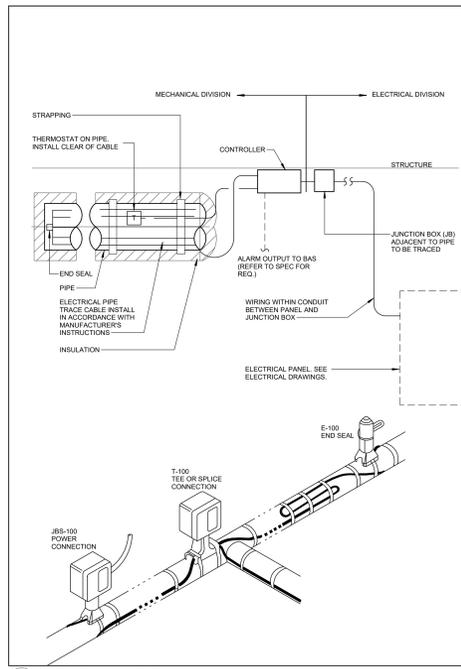


Issue

No.	Date	Description
1	2025.12.11	Contract Documents
2	2025.01.28	Appendix 4

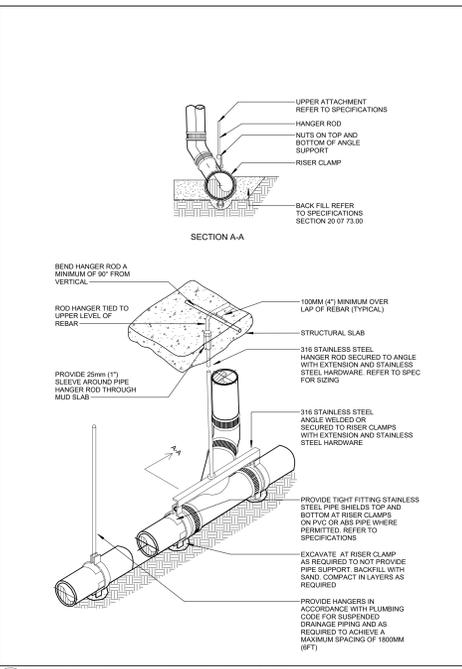

13 BURIED DRAINAGE PIPE BELOW STRUCTURAL SLAB
(410.03)

TYPE	A	B	C	D	HT	AIR GAP	SLOPE
FIRE PROTECTION	75 (3")	150 (6")	100 (4")	50 (2")	1200 (4'0")	100x150 (4"x6")	1%
GENERAL SERVICE	0-38 (0-1-1/2")	75 (3")	75 (3")	38 (1-1/2")	600 (2'0")	50x75 (2"x3")	2%
	50 (2")	100 (4")	100 (4")	50 (2")	600 (2'0")	75x100 (3"x4")	2%

14 INDIRECT STANDING WASTE
(410.04)

1/4" INDIRECT DRAIN
TRANSITION TO SUIT
AIR GAP FITTING
VENT AS REQUIRED BY LOCAL PLUMBING CODE
STRAP SECURED TO WALL
8" O STANDING WASTE
SPACER AT WALL
EXTEND SLEEVE 50mm (2") ABOVE FINISHED FLOOR
TRAP SEAL PRIMER
SLOPE DOWN
1/2" SANITARY DRAIN

