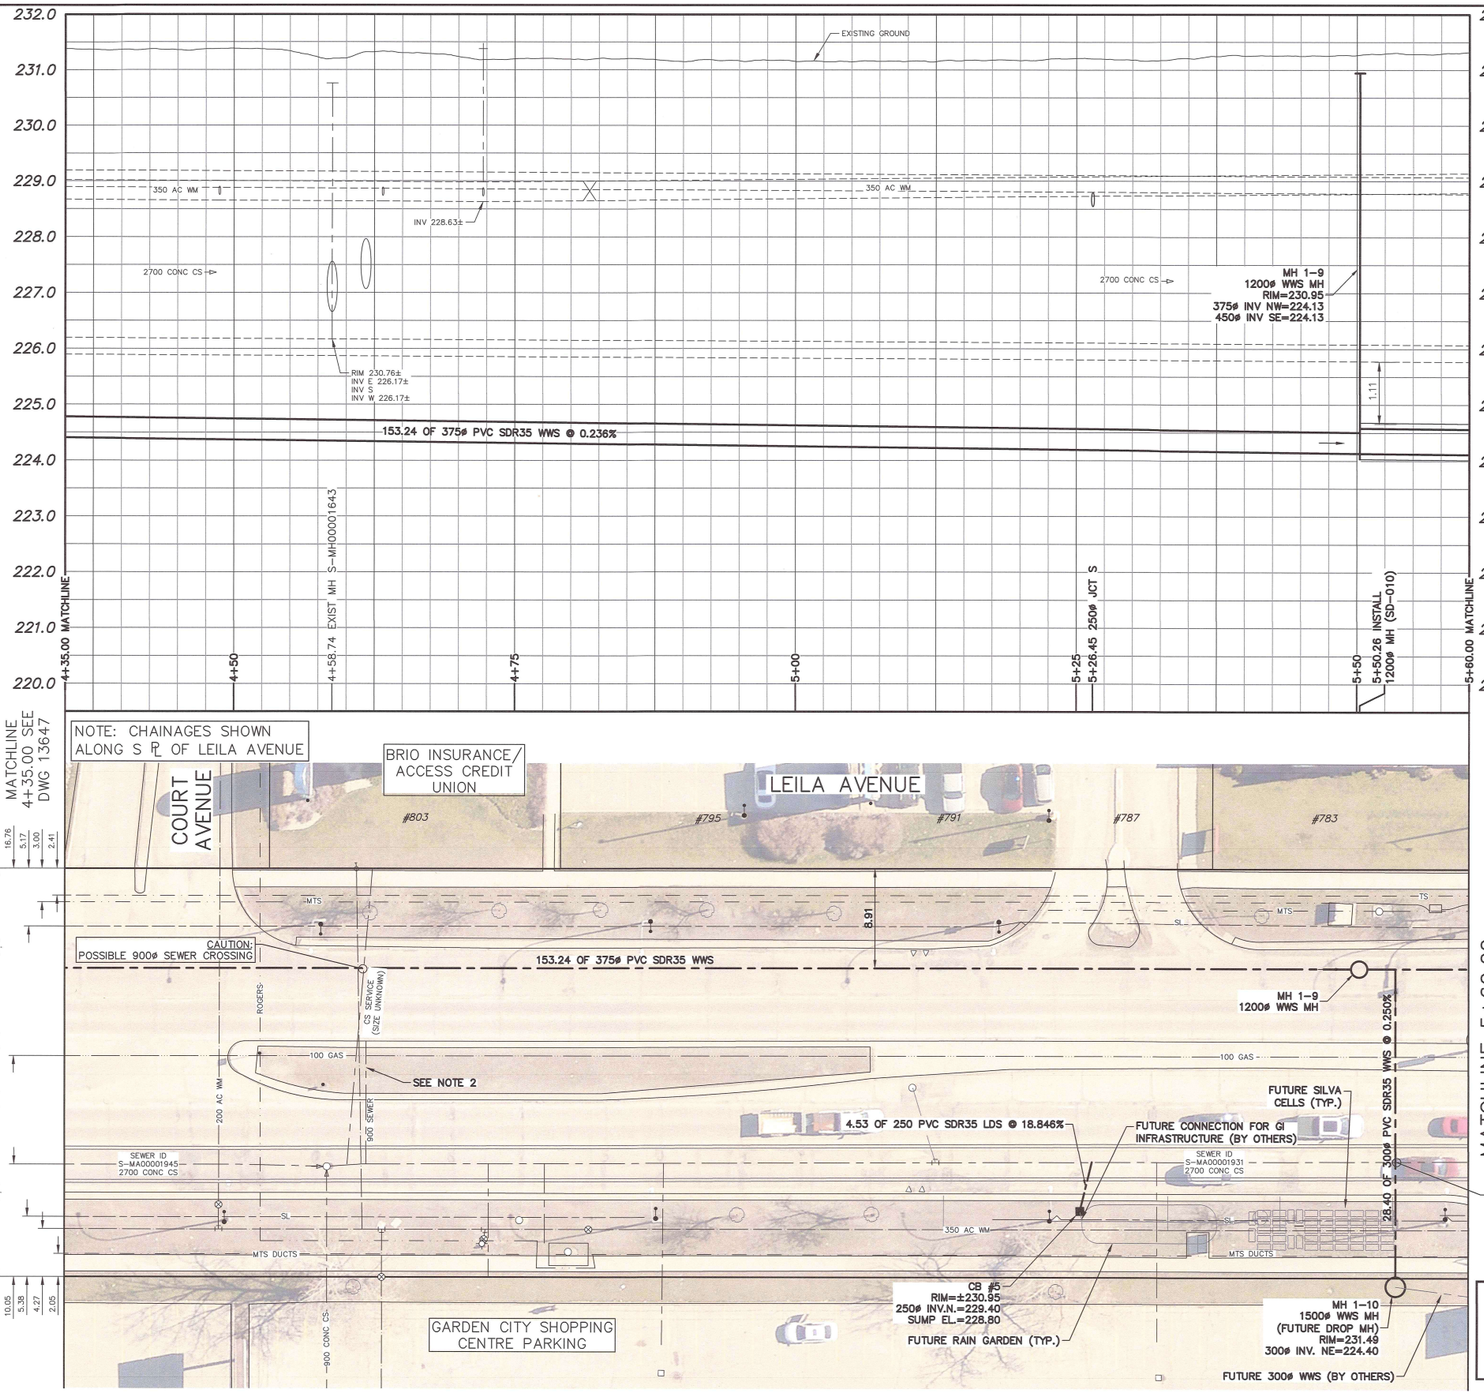

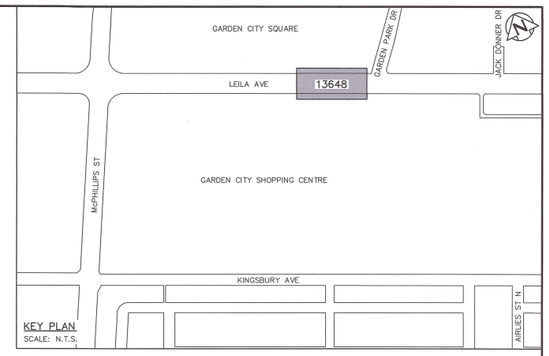

NOTES:

1. WHEN INSTALLING PROPOSED WASTEWATER SEWERS ON LEILA AVE TAKE CAUTION WHEN CROSSING EXISTING RESIDENTIAL WATER SERVICES.
2. THERE ARE NO RECORDS OF THE 900ø CONC SEWER IN THE CITY GIS DATA. IN THE LATEST 2022 CCTV INSPECTION THE SEWER DOES NOT APPEAR ABANDONED. CONTRACTOR TO PERFORM FURTHER INVESTIGATION TO DETERMINE STATUS OF PIPE AND NOTIFY ENGINEER.

SEWER JUNCTION INFORMATION FROM SEWER VIDEO INSPECTION		
SEWER ID S-MA00001931		
DISTANCE FROM MH ID S-MH00001643		
DISTANCE	DIAMETER	CLOCK
0.3	900	4
1.7	250	10
3.5	900	9
14.4	150	2
19.4	150	1
30.0	150	4
54.2	250	11
73.9	150	4

SEWER SERVICE INFORMATION					
ADDRESS	STATUS	SIZE (mm) MATERIAL	COORDINATES AT JUNCTION	COORDINATES AT PROPERTY	REMARKS
–	ABAND	250 UNKNOWN	N=5534907.35 E=633267.51	UNKNOWN	NONE
#803 LEILA AVE	ACTIVE	900 UNKNOWN	N=5534928.71 E=633221.53	UNKNOWN	NONE
#803 LEILA AVE	ACTIVE	250 UNKNOWN	N=5534929.43 E=633220.00	N=5534952.44 E=633233.26	NONE
–	ACTIVE	100 UNKNOWN	N=5534922.01 E=633235.95	UNKNOWN	MTS CHAMBER DRAIN?
–	ACTIVE	150 UNKNOWN	N=5534917.55 E=633245.57	UNKNOWN	CB LEAD?
#870 LEILA AVE	ACTIVE	150 UNKNOWN	N=5534924.12 E=633231.42	UNKNOWN	NONE
#870 LEILA AVE	ACTIVE	150 UNKNOWN	N=5534899.05 E=633285.38	UNKNOWN	CB LEAD?

FOR INDEX PAGE SEE DWG 13643

METRIC
WHOLE NUMBERS INDICATE MILLIMETRES
DECIMALIZED NUMBERS INDICATE METRES

0.0 5.0 10.0 15.0 20.0 25.0
SCALE 1:250 (A1)

WARNING

IF POWER EQUIPMENT OR EXPLOSIVES ARE TO BE USED FOR EXCAVATION ON THIS PROJECT THE CONTRACTOR MUST:

1) NOTIFY THE GAS COMPANY OF THE PROPOSED LOCATION OF EXCAVATION.

2) TAKE PRECAUTION TO AVOID DAMAGE TO GAS COMPANY INSTALLATIONS.

SEE PROVINCIAL REGULATION 210/72 FOR DETAILS

LOCATION APPROVED
UNDERGROUND STRUCTURES

SUPV. U/G STRUCTURES COMMITTEE — DATE

NOTE:
LOCATION OF UNDERGROUND STRUCTURES AS SHOWN ARE BASED ON THE BEST INFORMATION AVAILABLE BUT NO GUARANTEE IS GIVEN THAT ALL EXISTING UTILITIES ARE SHOWN OR THAT THE GIVEN LOCATIONS ARE EXACT. CONFIRMATION OF EXISTENCE AND EXACT LOCATION OF ALL SERVICES MUST BE OBTAINED FROM THE INDIVIDUAL UTILITIES BEFORE PROCEEDING WITH CONSTRUCTION.

VERTICAL DATUM: CGVD28 (HT2.0 Geoid)
HORIZONTAL DATUM: NAD83 (June 1990), Zone 14

NO.	REVISIONS	DATE (YYYY/MM/DD)	BY
0	ISSUED FOR CONSTRUCTION	2026/03/10	MID

KGS GROUP

DESIGNED BY	MID	CHECKED BY	TLE
DRAWN BY	GEL	APPROVED BY	RBO
SCALE: HORIZONTAL	1:250	RELEASED FOR CONSTRUCTION	Duane Baker
VERTICAL	1:50	DATE	March 12th, 2026

PLOT DATE:

ENGINEERS GEOSCIENTISTS MANITOBA
Certificate of Authorization
KGS Group
No. 245

ENGINEER'S SEAL
PROVINCE OF MANITOBA — MARKOVA-DEDOVA — Member 31615 — PROFESSIONAL ENGINEER
2026/03/12

CONSULTANT DRAWING NUMBER
C1-07

BID OPP: 839-2025
CONTRACT NUMBER: 1

Winnipeg

THE CITY OF WINNIPEG
WATER AND WASTE DEPARTMENT
ENGINEERING SERVICES DIVISION

ARMSTRONG SEWER RELIEF WORKS
CONTRACT 1
LEILA AVENUE
132.7 W OF GARDEN PARK DRIVE
TO 7.7 W OF GARDEN PARK DRIVE

SHEET 7 OF 46
CITY DRAWING NUMBER
13648

FILE PATH: \\kgs-file\r-data\Projects\2025\25-0107-002\Dwg\Mun\C1 Sheets\
FILE NAME: 25-0107-002_C1_Keyplan Plan&Profiles.dwg