B SIZE – 279mm x 432mm

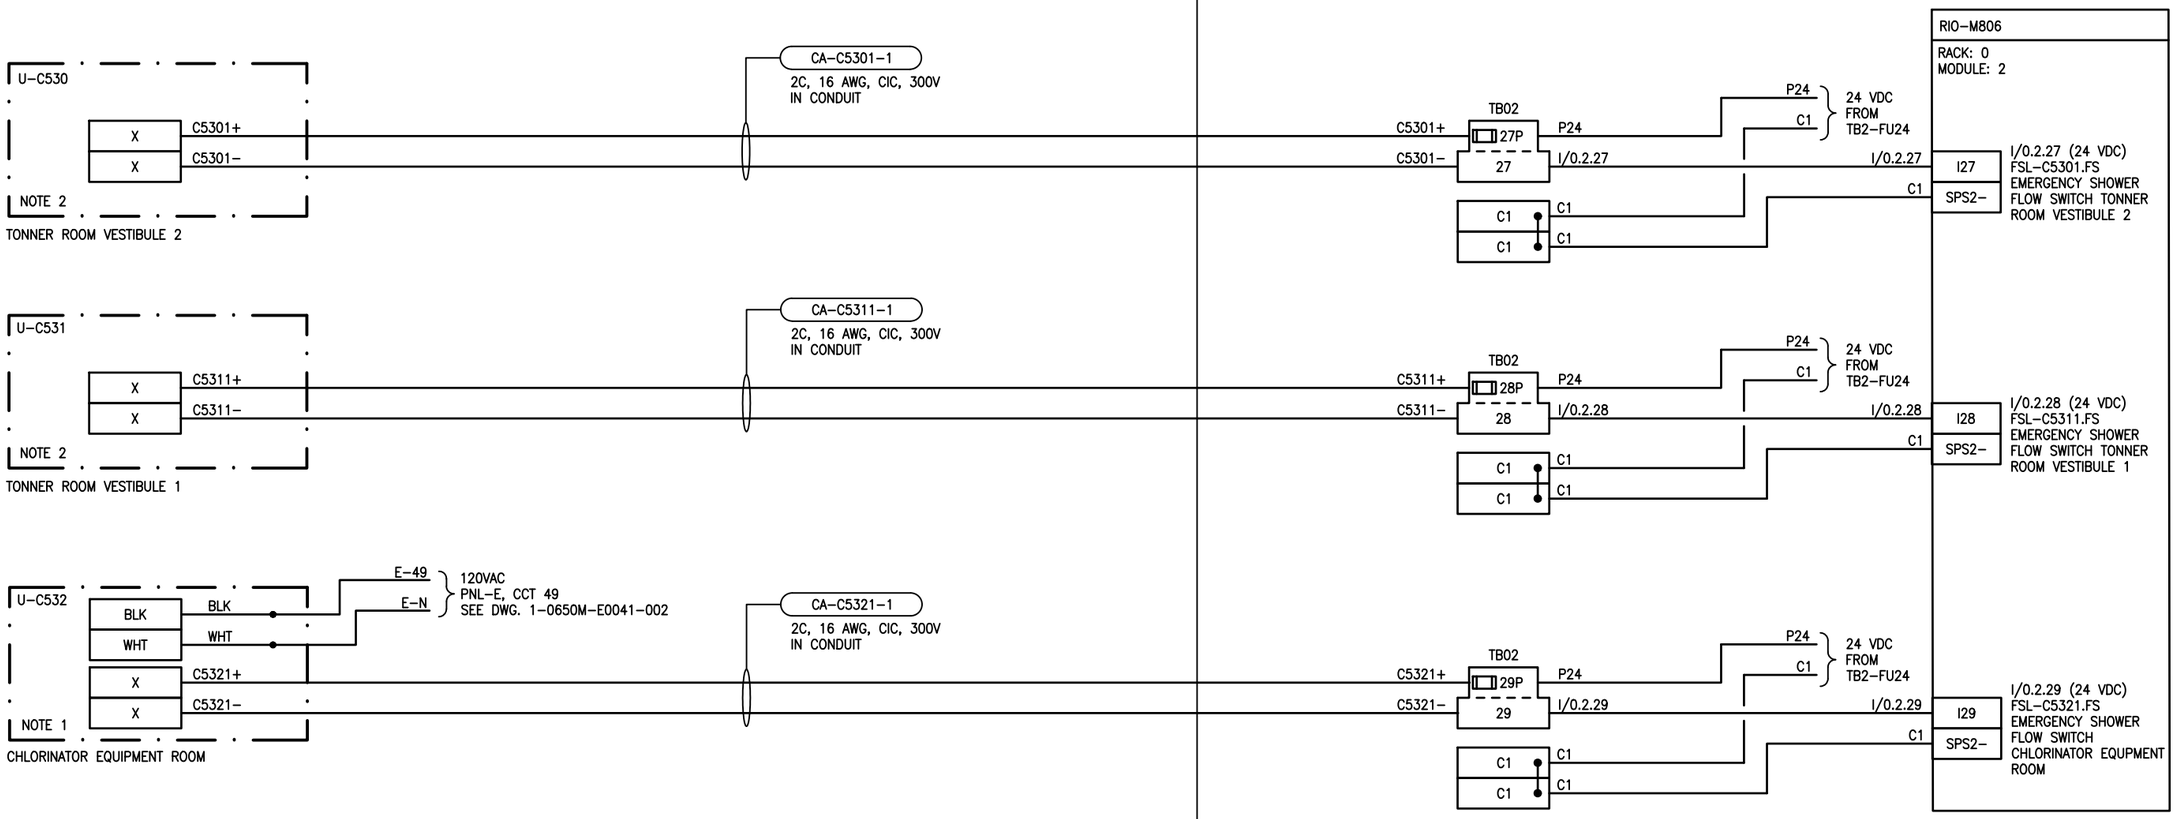

NOTES

1. PROVIDE NEW FLOW SWITCH ON EXISTING EMERGENCY SHOWER. PART NUMBER IS ENCON #02100000. CONTRACTOR TO PROVIDE ALL NEW CONDUIT AND CABLING FROM ESSENTIAL POWER PNL–E TO FLOW SWITCH RELAY.
2. COORDINATE WIRING WITH PACKAGE FROM SYSTEM VENDOR. PROVIDE AS–BUILT MARKUPS BASED ON VENDOR SHOP DRAWINGS.

ASSOCIATED REFERENCE DRAWINGS:
1–0650M–E0045
1–0650M–A0062

ENGINEERS GEOSCIENTISTS MANITOBA
Certificate of Authorization
AtkinsRéalis Canada Inc.
No. 4489

AtkinsRéalis
148 Nature Park Way
Winnipeg, Manitoba Canada R3P 0X7
204-786-8080

NO.	REVISIONS	DATE	DESIGN	CHECK
00	ISSUED FOR TENDER AND CONSTRUCTION	2025/04/30	VE	VE

DESIGNED BY: B. WILKS	CHECKED BY: V. ELIMBAN
DRAWN BY: B. WILKS	APPROVED BY: V. ELIMBAN
SCALE: NTS	DATE: 2023/06/11
ISSUED FOR CONSTRUCTION BY: M. SKINNER	DATE: 2025/04/30
CONSULTANT NO.:	

ENGINEER'S SEAL
PROVINCE OF MANITOBA
V.V. ELIMBAN
Member 34636
REGISTERED PROFESSIONAL ENGINEER
2025-05-02

Winnipeg

THE CITY OF WINNIPEG
WATER AND WASTE DEPARTMENT

HURST PUMPING STATION
CHLORINE SYSTEM UPGRADES
LOOP DIAGRAM
FSL–C5301, FSL–C5311, AND FSL–C5321
EMERGENCY SHOWER FLOW SWITCHES

CITY DRAWING NUMBER	SHEET	REV.	SIZE
1–0650M–A0068	001	00	B