


B SIZE - 279mm x 432mm

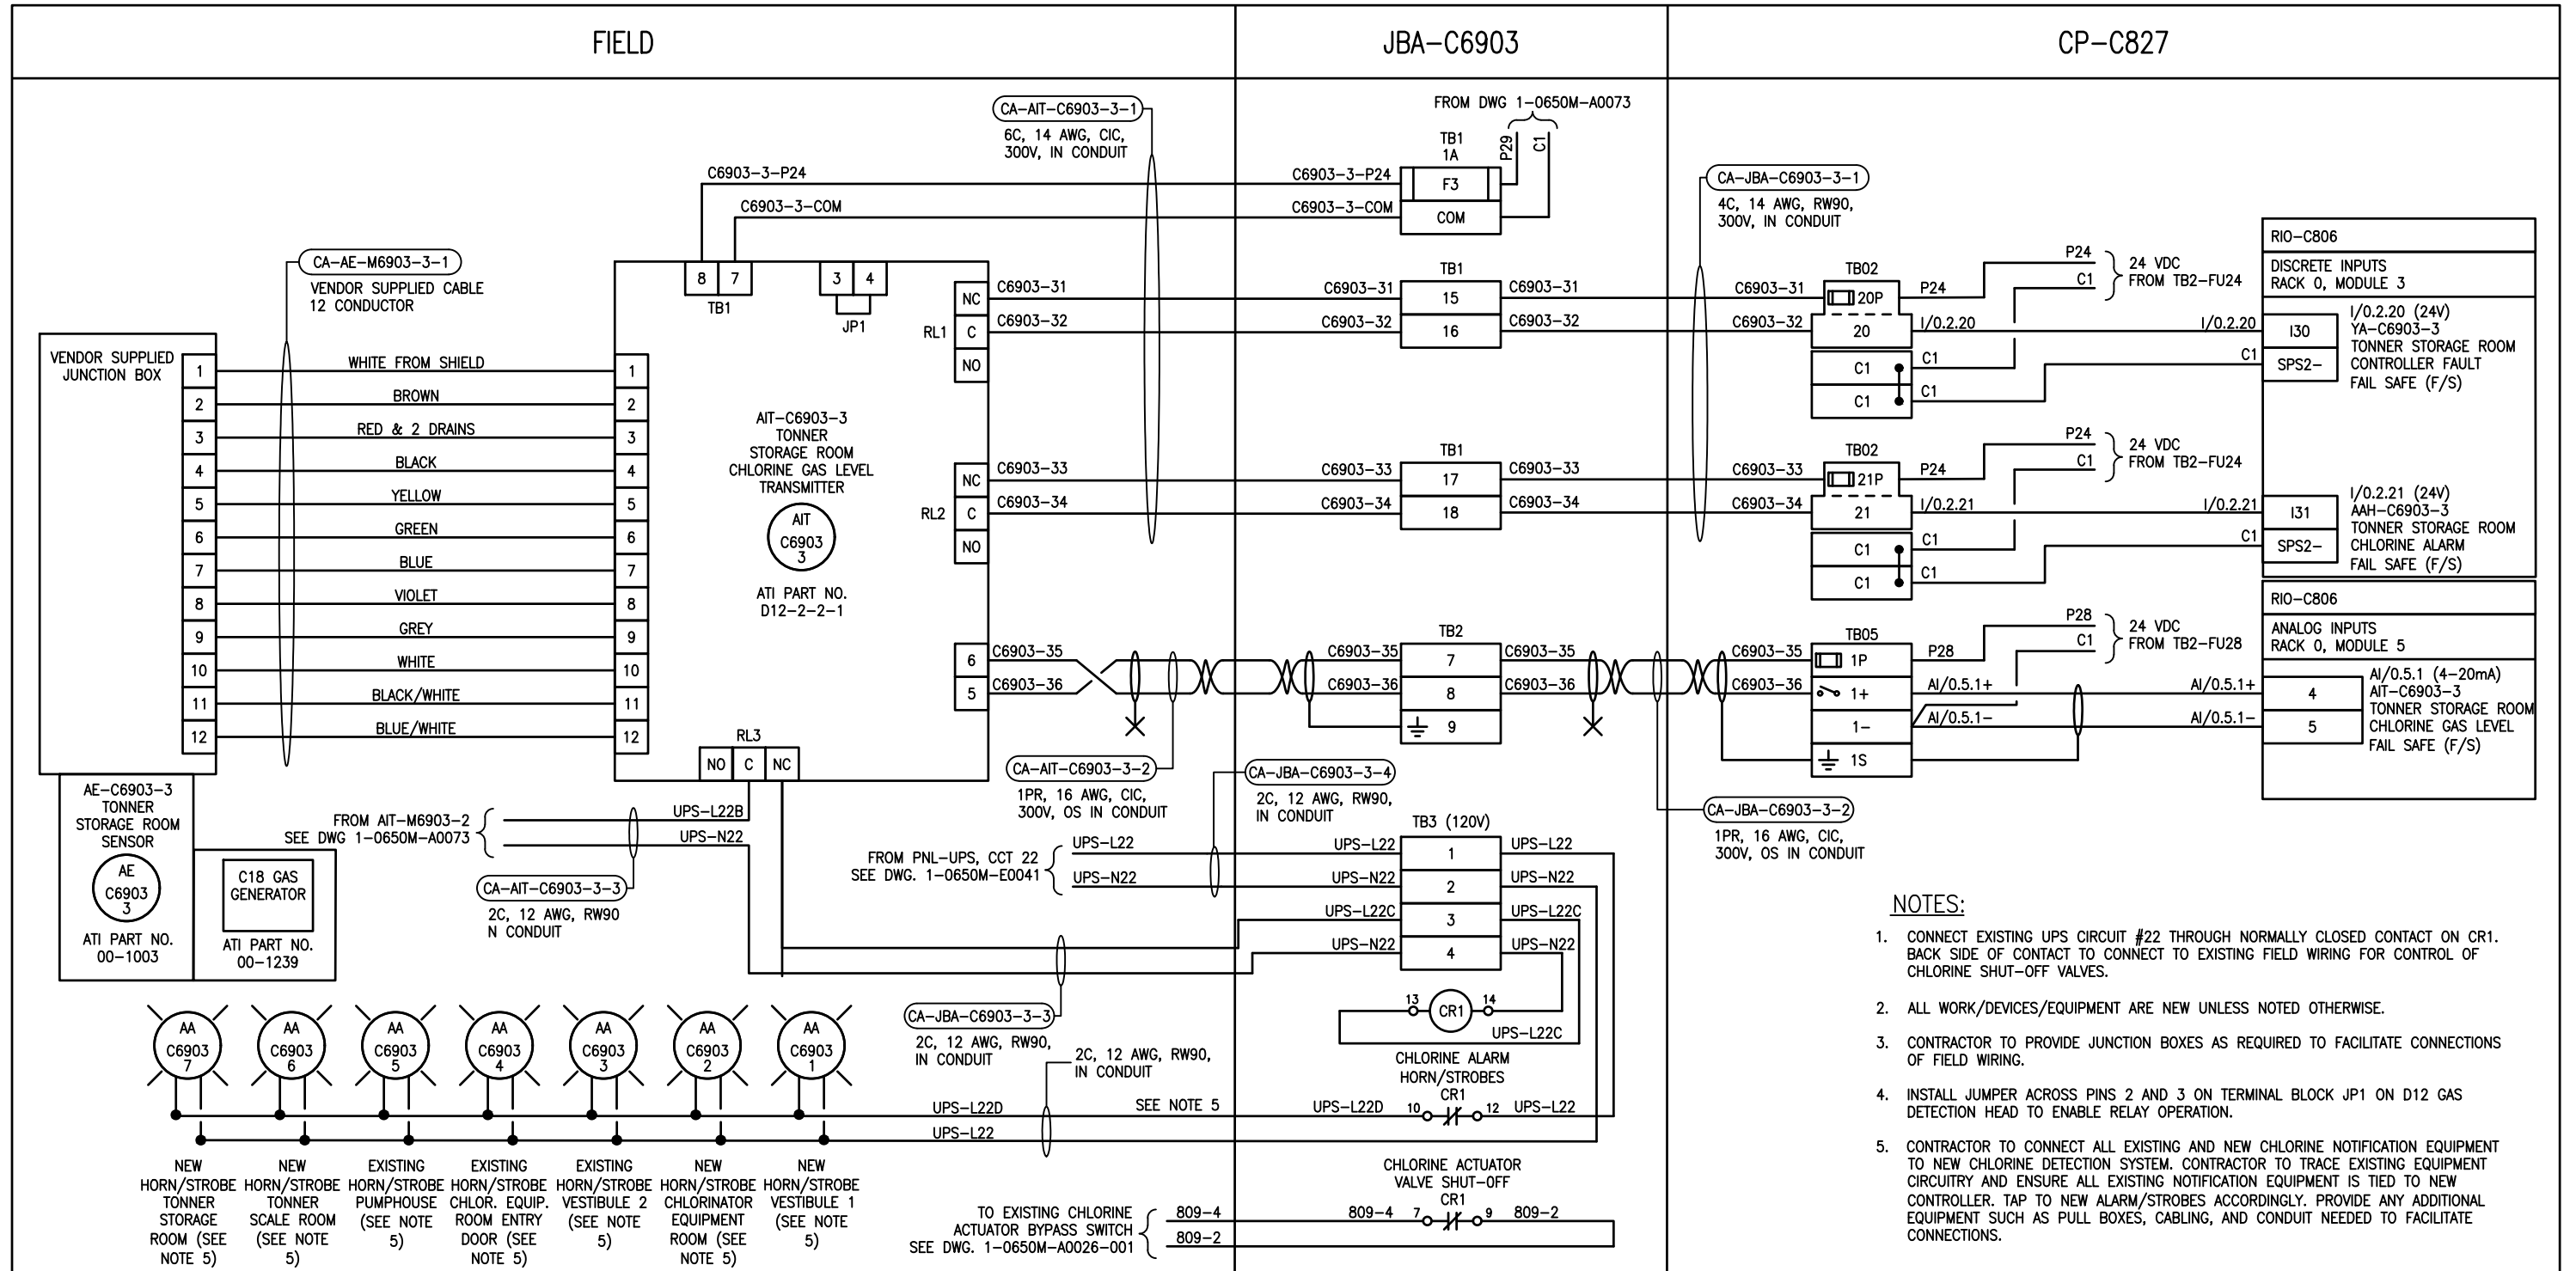

NOTES (CONTINUATION)

8. REFER TO MANUFACTURER'S SHOP DRAWINGS FOR COMPLETE WIRING DETAILS. VERIFY ALL WIRING DETAILS WITH MANUFACTURER.
9. ELECTRICAL CONTRACTOR TO PROVIDE ANY ADDITIONAL DEVICES NEEDED TO COMPLETE SYSTEM DESIGN.
10. CHLORINE CONTROLLER TO ISSUE AN ALARM AT 1PPM.
11. CONTRACTOR TO CALIBRATE DEVICE. DEVICE IS 0-200PPM. CALIBRATE DEVICE ON SITE TO 0-50PPM

ASSOCIATED REFERENCE DRAWINGS:
1-0650M-E0045
1-0650M-A0063
1-0650M-A0065



148 Nature Park Way
Winnipeg, Manitoba Canada R3P 0X7
204-786-8080

				 AtkinsRéalis		148 Nature Park Way Winnipeg, Manitoba Canada R3P 0X7 204-786-8080	
						DESIGNED BY: B. WILKS	CHECKED BY: V. ELIMBAN
						DRAWN BY: B. WILKS	APPROVED BY: V. ELIMBAN
						SCALE: N.T.S.	DATE: 2023/06/11
						ISSUED FOR CONSTRUCTION	
						BY: M. SKINNER	DATE: 2025/04/30
00	ISSUED FOR TENDER AND CONSTRUCTION			2025/04/30	VE	VE	CONSULTANT NO.:
NO.	REVISIONS			DATE	DESIGN	CHECK	

ENGINEER'S SEAL



THE CITY OF WINNIPEG
WATER AND WASTE DEPARTMENT

HURST PUMPING STATION
CHLORINE SYSTEM UPGRADES
LOOP DIAGRAM
CHLORINE DETECTION
AIT-C6903-3

CITY DRAWING NUMBER	SHEET	REV.	SIZE
1-0650M-A0074	003	00	B