B SIZE - 279mm x 432mm

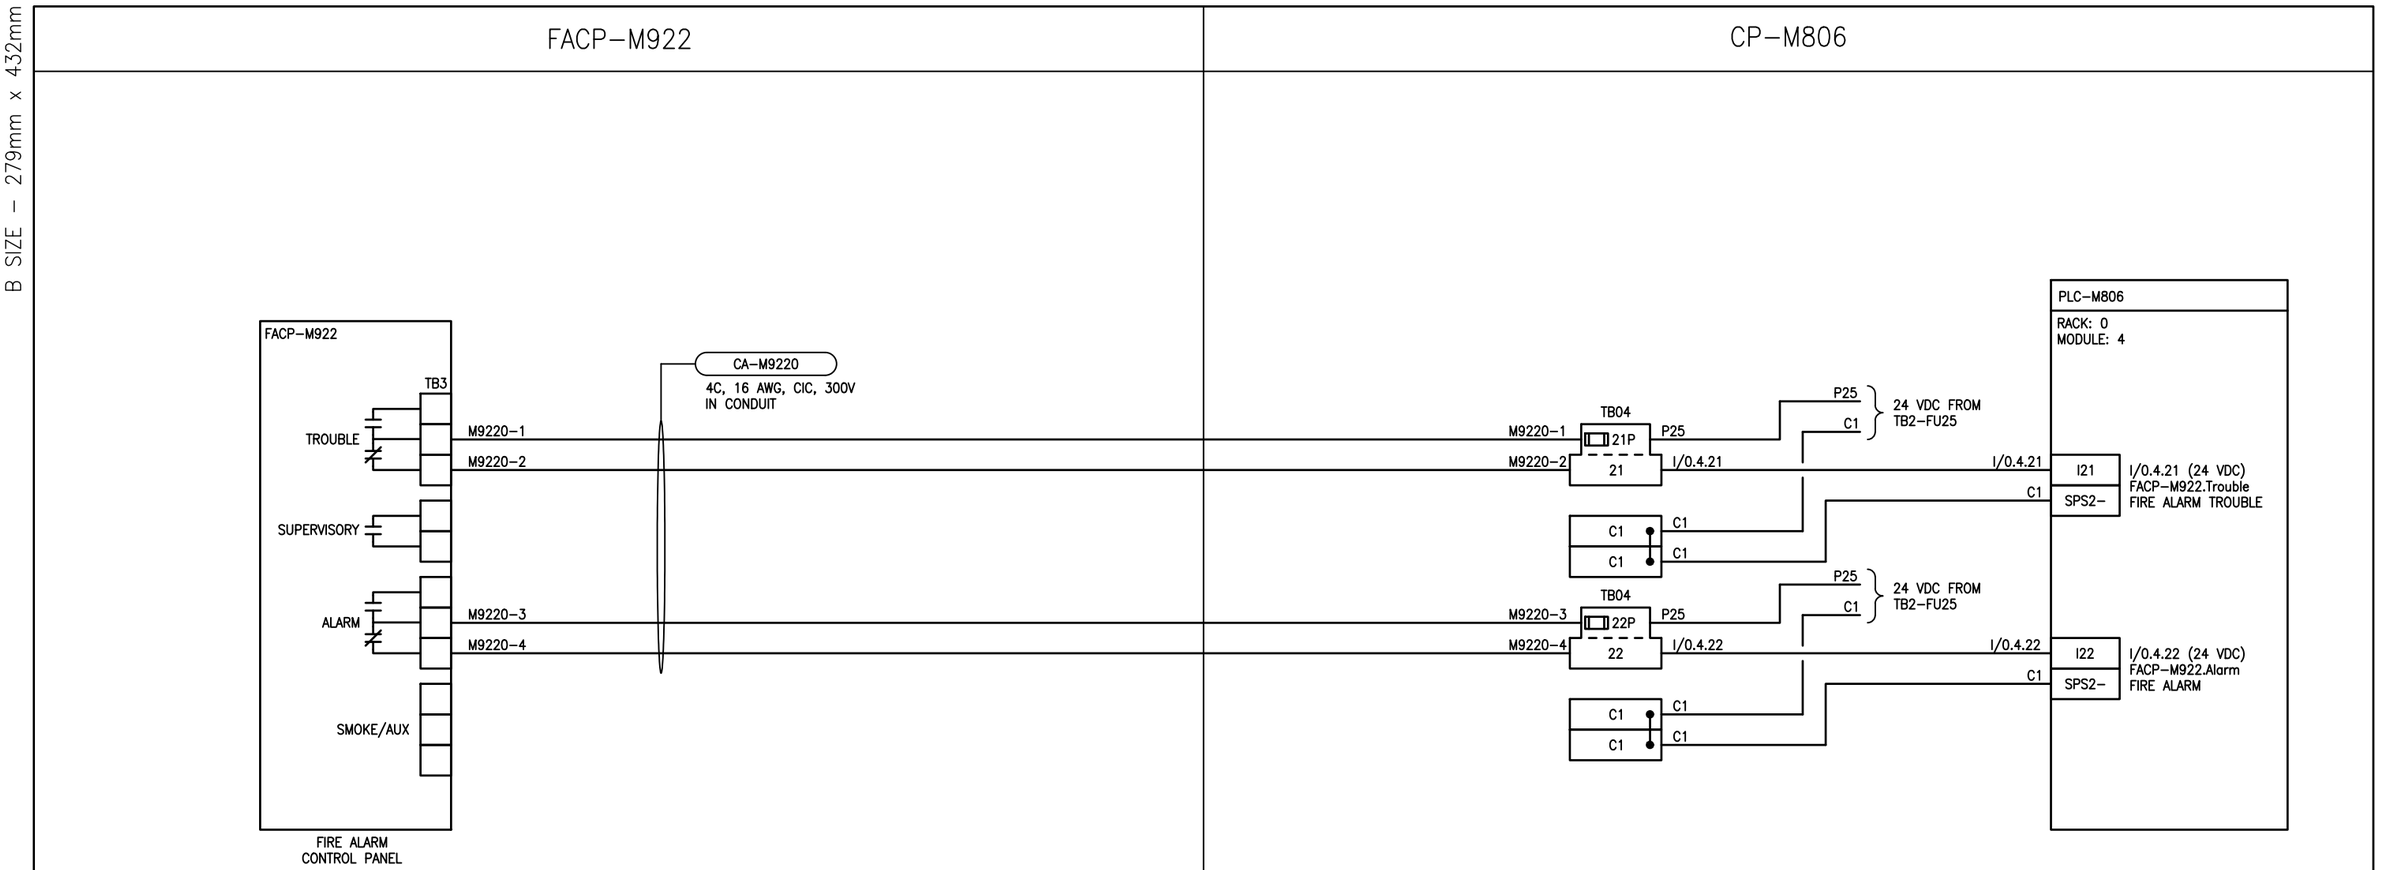


NOTES:
1. FIRE ALARM MONITORING SIGNALS SHALL BE WIRED TO HVAC PLC CONTROL PANEL CP-M826 LOCATED IN CONTROL ROOM

ASSOCIATED REFERENCE DRAWINGS:
1-0650M-E0045
1-0650M-A0064

ENGINEERS GEOSCIENTISTS MANITOBA
Certificate of Authorization
AtkinsRéalis Canada Inc.
No. 4489

| NO. | REVISIONS | DATE | DESIGN | CHECK |
|---|---|---|---|---|
| 00 | ISSUED FOR TENDER AND CONSTRUCTION | 2025/04/30 | VE | VE |


AtkinsRéalis
148 Nature Park Way
Winnipeg, Manitoba Canada R3P 0X7
204-786-8080


| | |
|---|---|
| DESIGNED BY: B. WILKS | CHECKED BY: V. ELIMBAN |
| DRAWN BY: B. WILKS | APPROVED BY: V. ELIMBAN |
| SCALE: NTS | DATE: 2023/07/21 |
| ISSUED FOR CONSTRUCTION BY: M. SKINNER | DATE: 2025/04/30 |
| CONSULTANT NO.: | |

ENGINEER'S SEAL

2025-05-02

Winnipeg

THE CITY OF WINNIPEG
WATER AND WASTE DEPARTMENT

HURST PUMPING STATION

LOOP DIAGRAM
FIRE ALARM CONTROL PANEL FACP-M922

| CITY DRAWING NUMBER | SHEET | REV. | SIZE |
|---|---|---|---|
| 1-0650M-A0083 | 001 | 00 | B |