



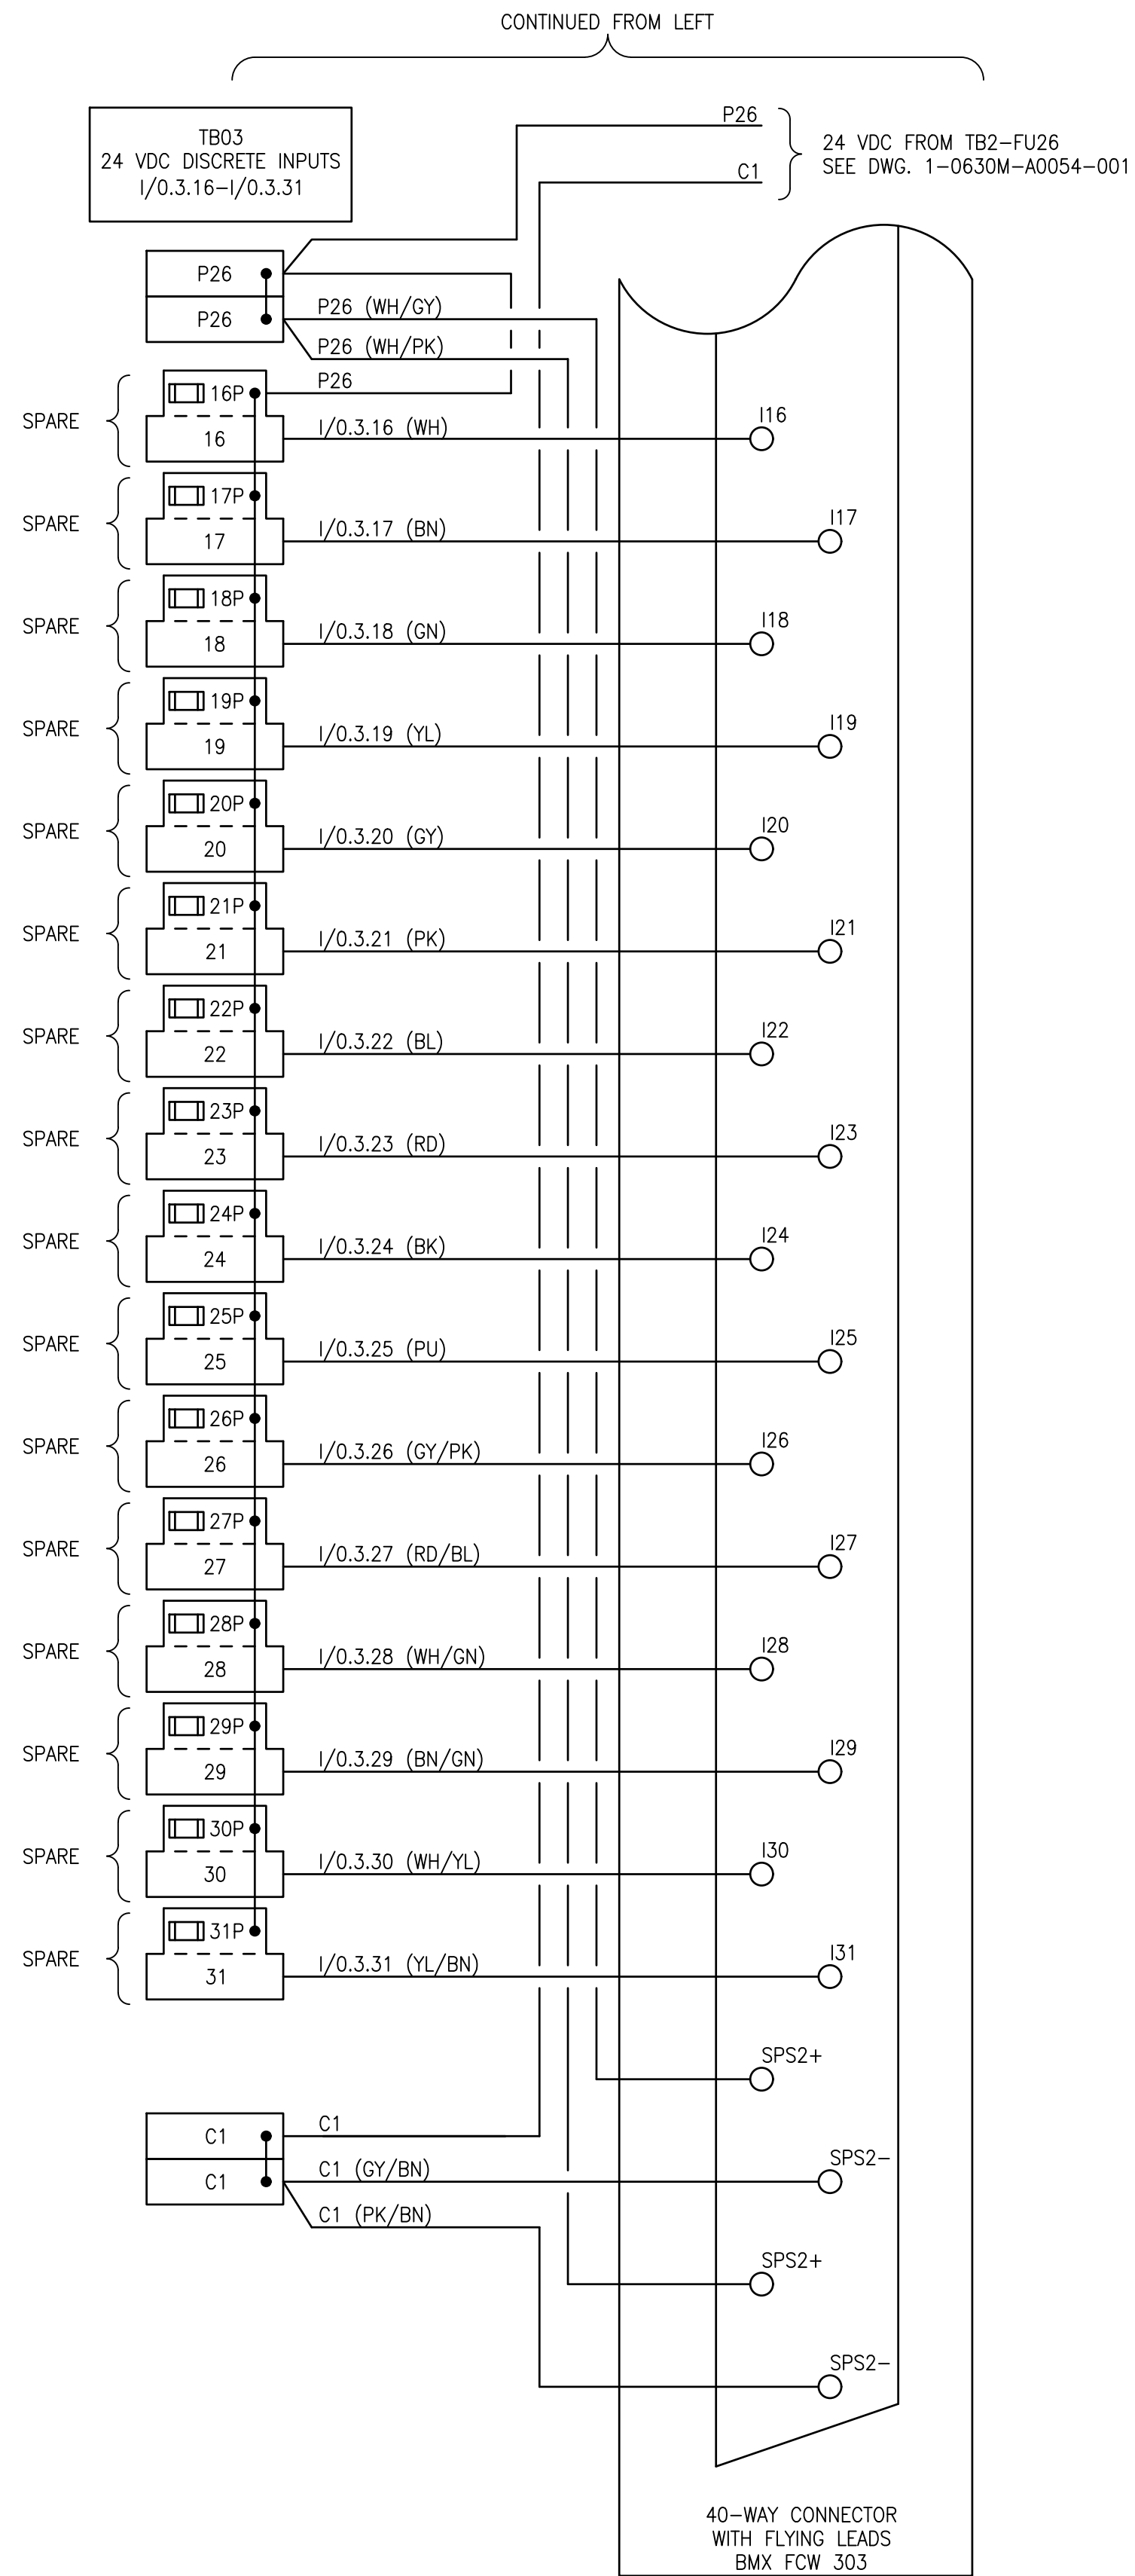

FUSE SCHEDULE				
TB	IDENTIFIER	SIZE	RATED CURRENT (A)	FA
TB4	0P	5x20mm	0.5	
	1P	5x20mm	0.5	
	2P	5x20mm	0.5	
	3P	5x20mm	0.5	
	4P	5x20mm	0.5	
	5P	5x20mm	0.5	
	6P	5x20mm	0.5	
	7P	5x20mm	0.5	
	8P	5x20mm	0.5	
	9P	5x20mm	0.5	
	10P	5x20mm	0.5	
	11P	5x20mm	0.5	
	12P	5x20mm	0.5	
	13P	5x20mm	0.5	
	14P	5x20mm	0.5	
	15P	5x20mm	0.5	
	16P	5x20mm	0.5	
	17P	5x20mm	0.5	
	18P	5x20mm	0.5	
	19P	5x20mm	0.5	
	20P	5x20mm	0.5	
	21P	5x20mm	0.5	
	22P	5x20mm	0.5	
	23P	5x20mm	0.5	
	24P	5x20mm	0.5	
	25P	5x20mm	0.5	
	26P	5x20mm	0.5	
	27P	5x20mm	0.5	
	28P	5x20mm	0.5	
	29P	5x20mm	0.5	
	30P	5x20mm	0.5	
	31P	5x20mm	0.5	

1-0630M-A0053	PANEL LAYOUT, HVAC CONTROL PANEL CP-M826
DRAWING NUMBER	REFERENCE DRAWINGS

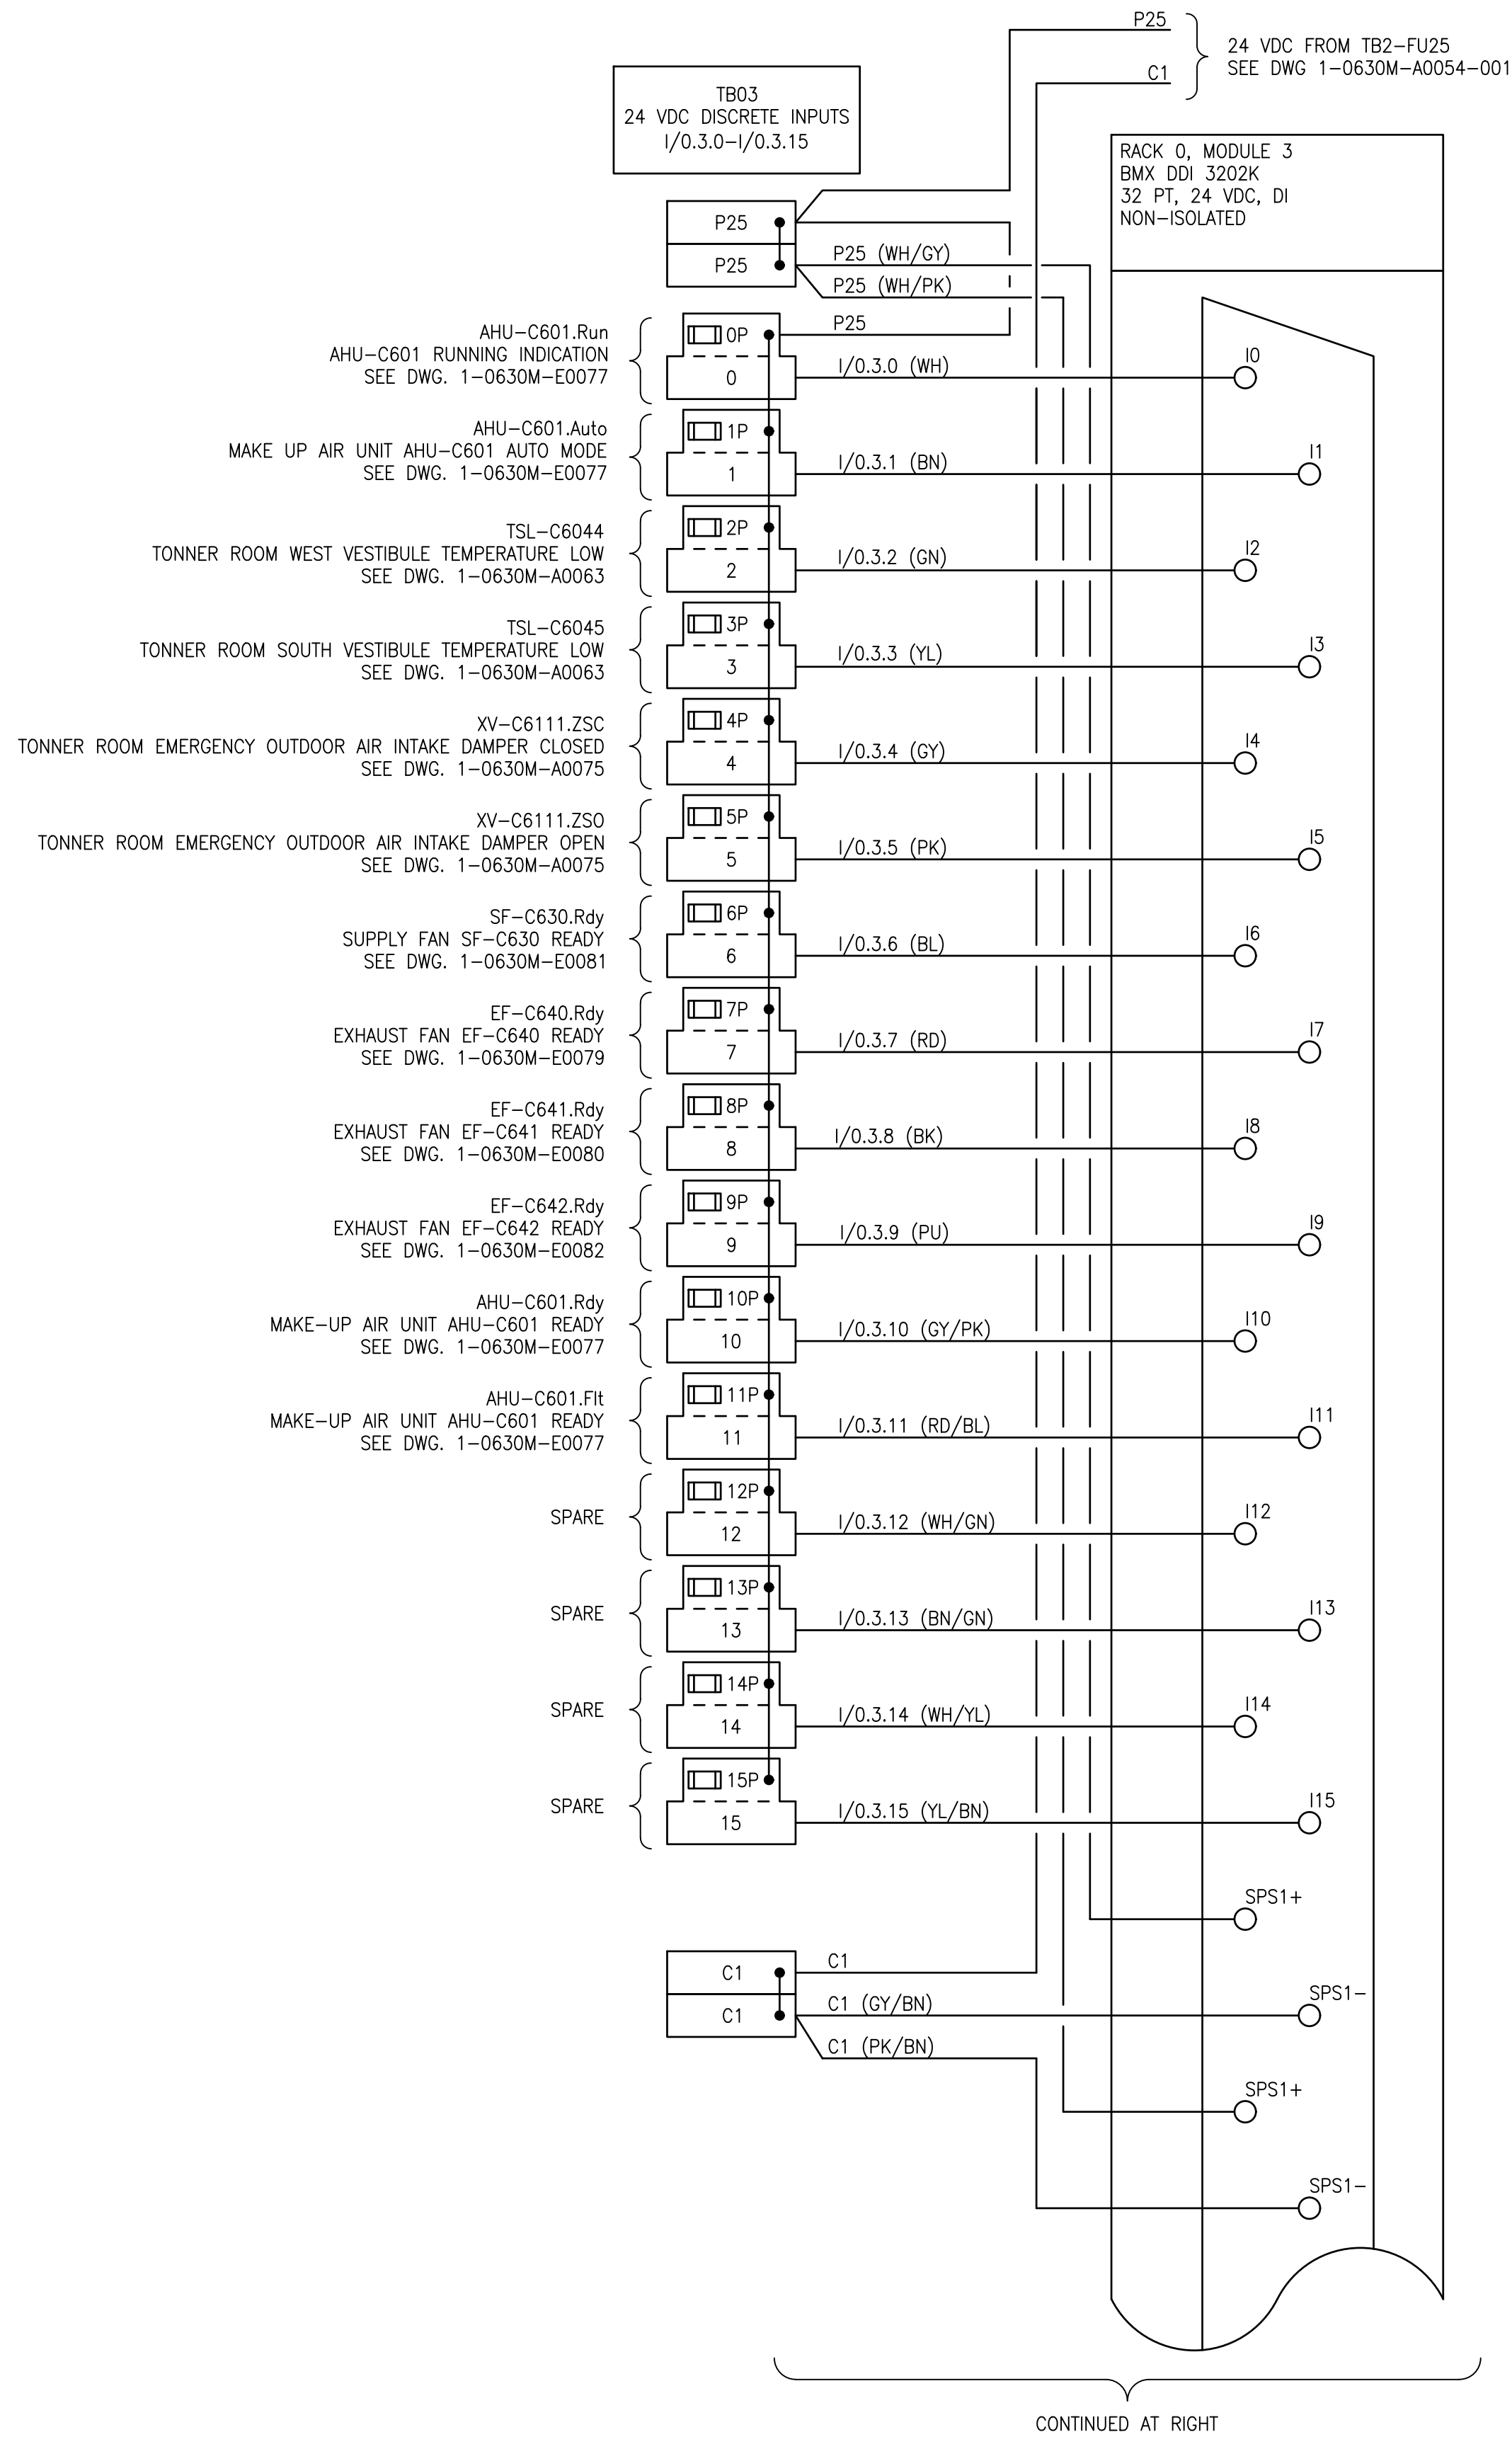

DESIGNED BY: B. WILKS				CHECKED BY: V. ELIMBAN			
DRAWN BY: B. WILKS				APPROVED BY: V. ELIMBAN			
SCALE: NTS				ISSUED FOR CONSTRUCTION BY: M. SKINNER			
DATE: 2023/08/23				DATE: 2025/04/30			
CONSULTANT NO.:							
00	ISSUED FOR TENDER AND CONSTRUCTION	2025/04/30	VE	VE			
NO.	REVISIONS	DATE	DESIGN	CHECK			

ENGINEER'S SEAL				THE CITY OF WINNIPEG WATER AND WASTE DEPARTMENT			
				MACLEAN PUMPING STATION CHLORINE SYSTEM UPGRADE AUTOMATION - WIRING DIAGRAM HVAC CONTROL PANEL CP-M826 DISCRETE INPUTS RACK 0, MODULE 3			
CITY DRAWING NUMBER				SHEET	REV.	SIZE	
1-0630M-A0056				001	00	A1	