


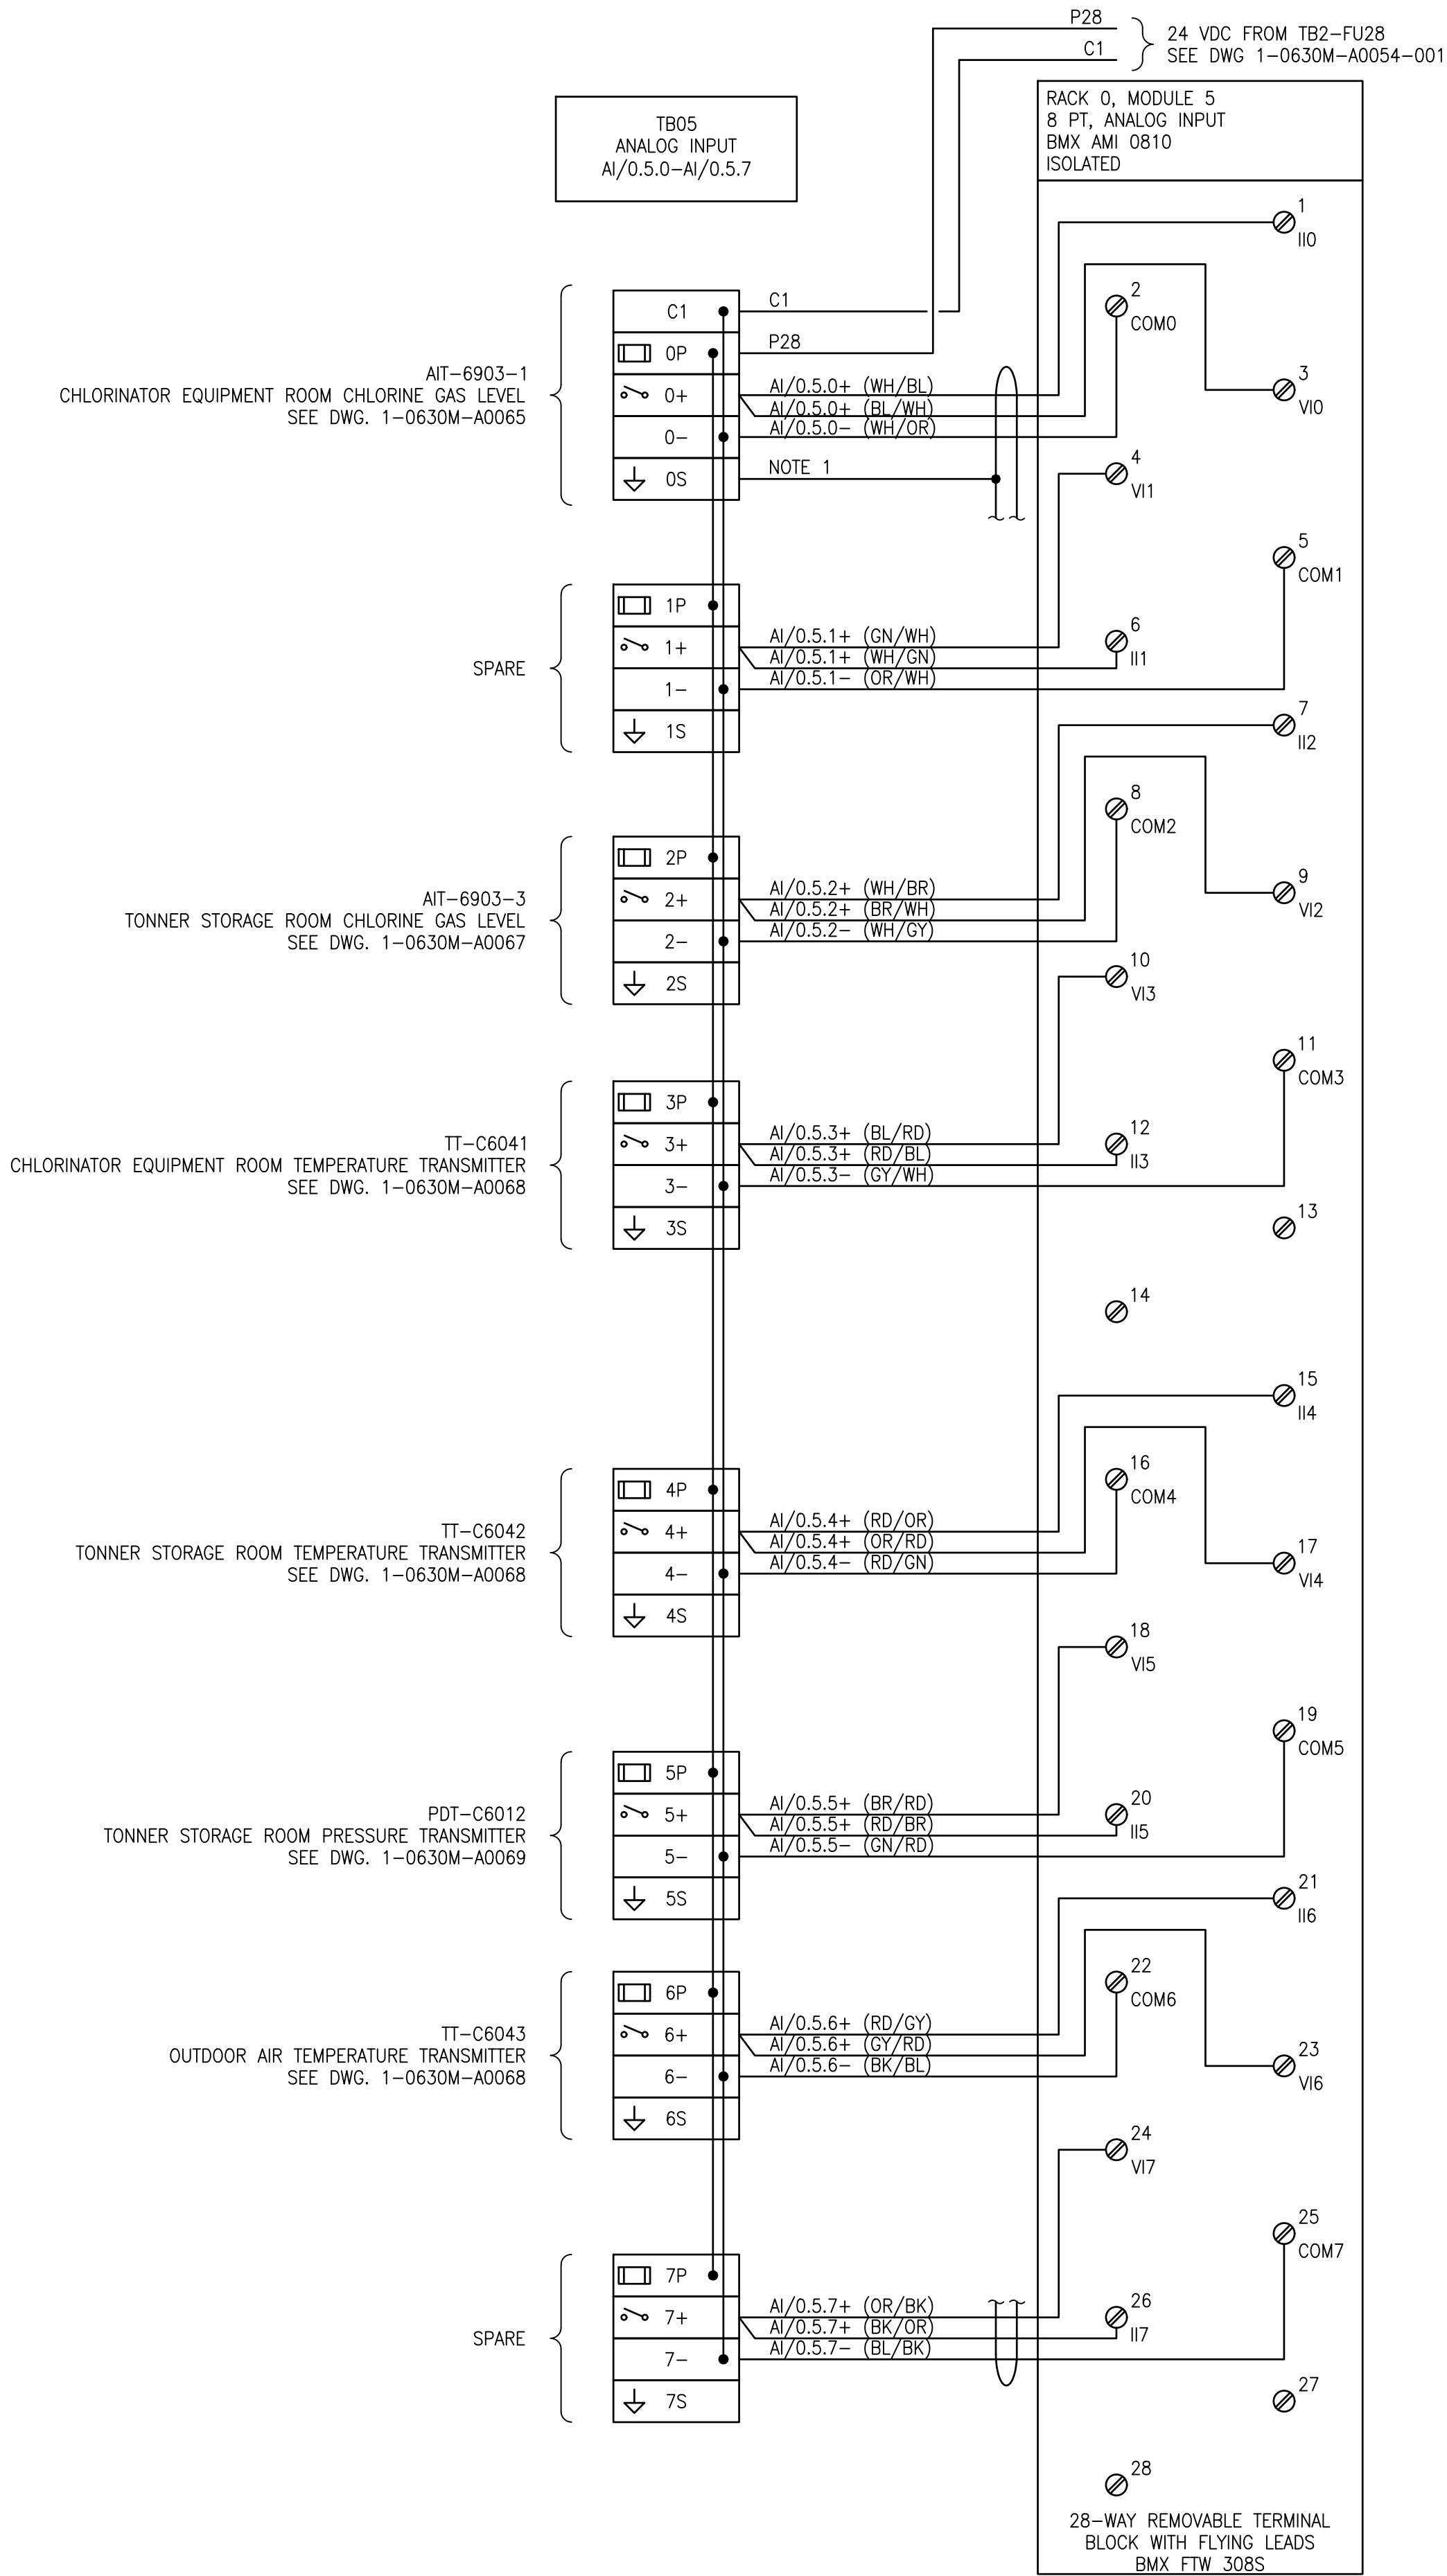

FUSE SCHEDULE			
TB	IDENTIFIER	SIZE	RATED CURRENT (A) FA
TB6	0	5x20mm	1.0
	1	5x20mm	1.0
	2	5x20mm	1.0
	3	5x20mm	1.0
	4	5x20mm	1.0
	5	5x20mm	1.0
	6	5x20mm	1.0
	7	5x20mm	1.0
	8	5x20mm	1.0
	9	5x20mm	1.0
	10	5x20mm	1.0
	11	5x20mm	1.0
	12	5x20mm	1.0
	13	5x20mm	1.0
	14	5x20mm	1.0
	15	5x20mm	1.0

NOTES:

1. CONNECT FLYING LEADS CABLE OVERALL SHIELD TO TERMINAL 0S.

1-0630M-A0054	PANEL LAYOUT, HVAC CONTROL PANEL CP-M826
DRAWING NUMBER	REFERENCE DRAWINGS

**ENGINEERS
GEOSCIENTISTS
MANITOBA**
Certificate of Authorization
AtkinsRéalis Canada Inc.
No. 4489

148 Nature Park Way, Winnipeg, Manitoba Canada R3P 0X7 204-786-8080				ENGINEER'S SEAL		THE CITY OF WINNIPEG WATER AND WASTE DEPARTMENT				
DESIGNED BY: J. GRACASIN				CHECKED BY: V. ELIMBAN		MACLEAN PUMPING STATION CHLORINE SYSTEM UPGRADE AUTOMATION - WIRING DIAGRAM HVAC CONTROL PANEL CP-M826 ANALOG INPUTS RACK 0, MODULE 5				
DRAWN BY: J. GRACASIN				APPROVED BY: V. ELIMBAN						
SCALE: NTS				ISSUED FOR CONSTRUCTION BY: M. SKINNER DATE: 2025/04/30						
DATE: 2020/08/22				CONSULTANT NO.:						
00	ISSUED FOR TENDER AND CONSTRUCTION	2025/04/30	VE	VE	CITY DRAWING NUMBER 1-0630M-A0058			SHEET 001	REV. 00	SIZE A1
NO.	REVISIONS	DATE	DESIGN	CHECK						