


B SIZE - 279mm x 432mm

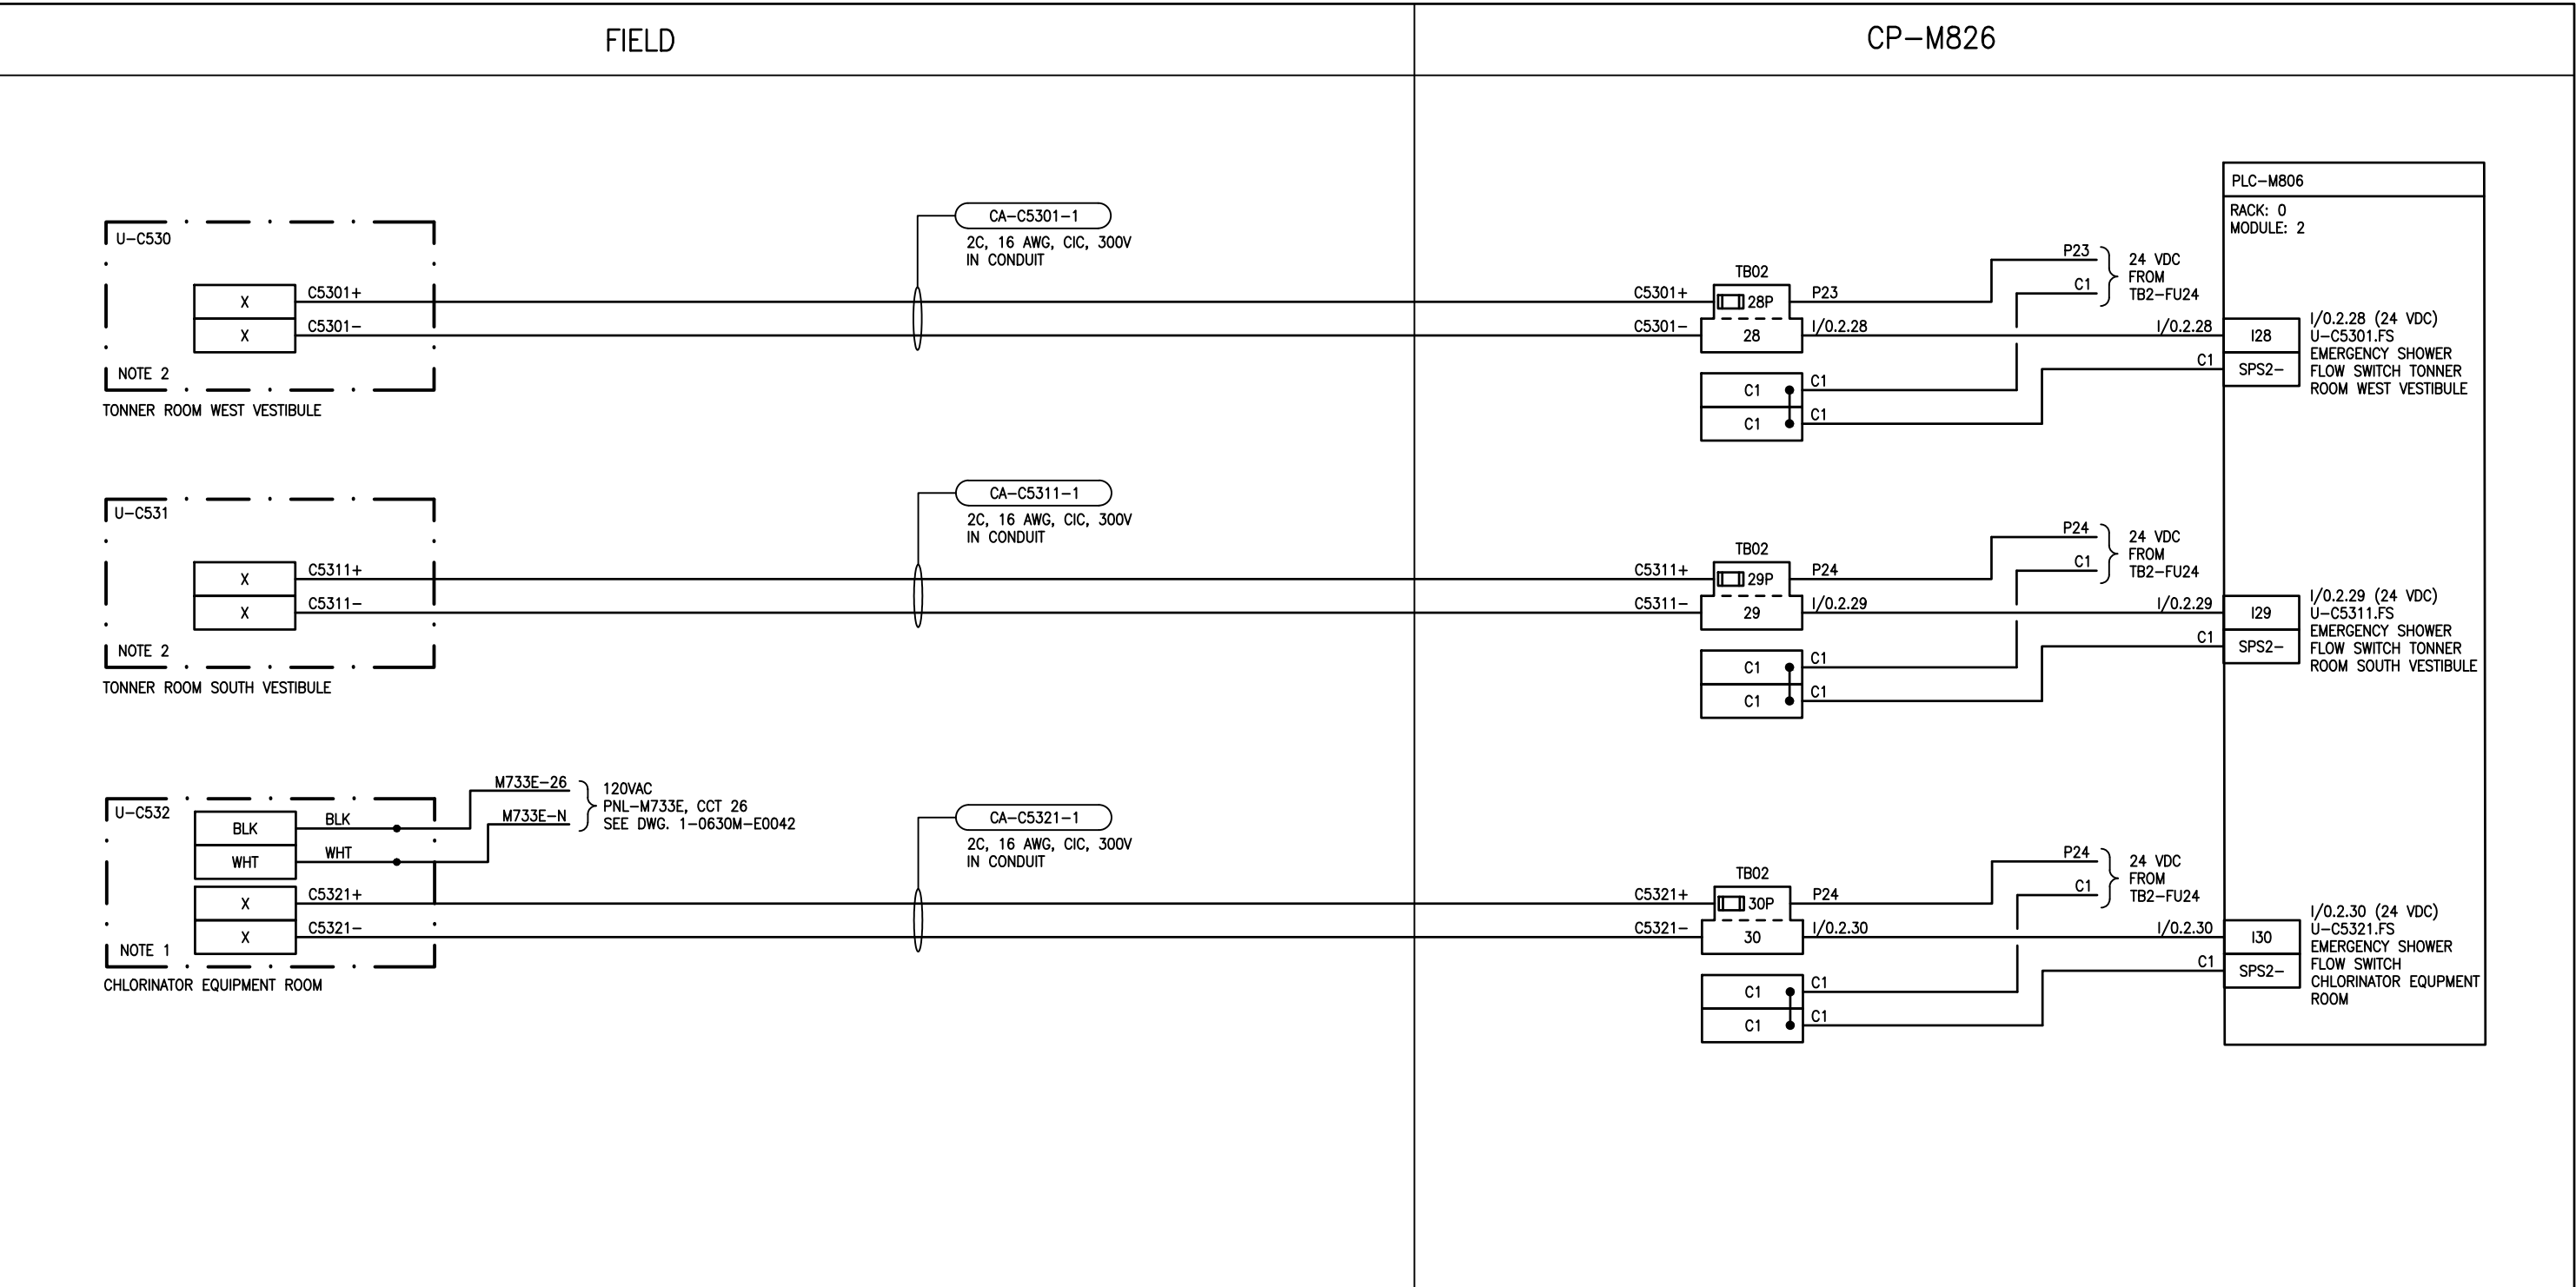

NOTES

1. PROVIDE NEW FLOW SWITCH ON EXISTING EMERGENCY SHOWER. PART NUMBER IS ENCON #02100000. CONTRACTOR TO PROVIDE ALL NEW CONDUIT AND CABLING FROM ESSENTIAL POWER PNL-M733E TO POWER FLOW SWITCH RELAY.

2. COORDINATE WIRING WITH PACKAGE FROM SYSTEM VENDOR. PROVIDE AS-BUILT MARKUPS BASED ON VENDOR SHOP DRAWINGS.

ASSOCIATED REFERENCE DRAWINGS:
1-0630M-E0073
1-0630M-A0055

ENGINEERS
GEOSCIENTISTS
MANITOBA

Certificate of Authorization

AtkinsRéalisis Canada Inc.

No. 4489

AtkinsRéalisis

148 Nature Park Way
Winnipeg, Manitoba Canada R3P 0X7
204-786-8080

DESIGNED BY: B. WILKS	CHECKED BY: V. ELIMBAN
DRAWN BY: B. WILKS	APPROVED BY: V. ELIMBAN
SCALE: NTS	DATE: 2023/06/11
ISSUED FOR CONSTRUCTION	
BY: M. SKINNER	DATE: 2025/04/30
CONSULTANT NO.:	

ENGINEER'S SEAL

THE CITY OF WINNIPEG

WATER AND WASTE DEPARTMENT

MACLEAN PUMPING STATION
CHLORINE SYSTEM UPGRADES
LOOP DIAGRAM
FSL-C5301, FSL-C5311, AND FSL-C5321
EMERGENCY SHOWER FLOW SWITCHES

CITY DRAWING NUMBER 1-0630M-A0061	SHEET 001	REV. 00	SIZE B
--------------------------------------	--------------	------------	-----------