


B SIZE - 279mm x 432mm

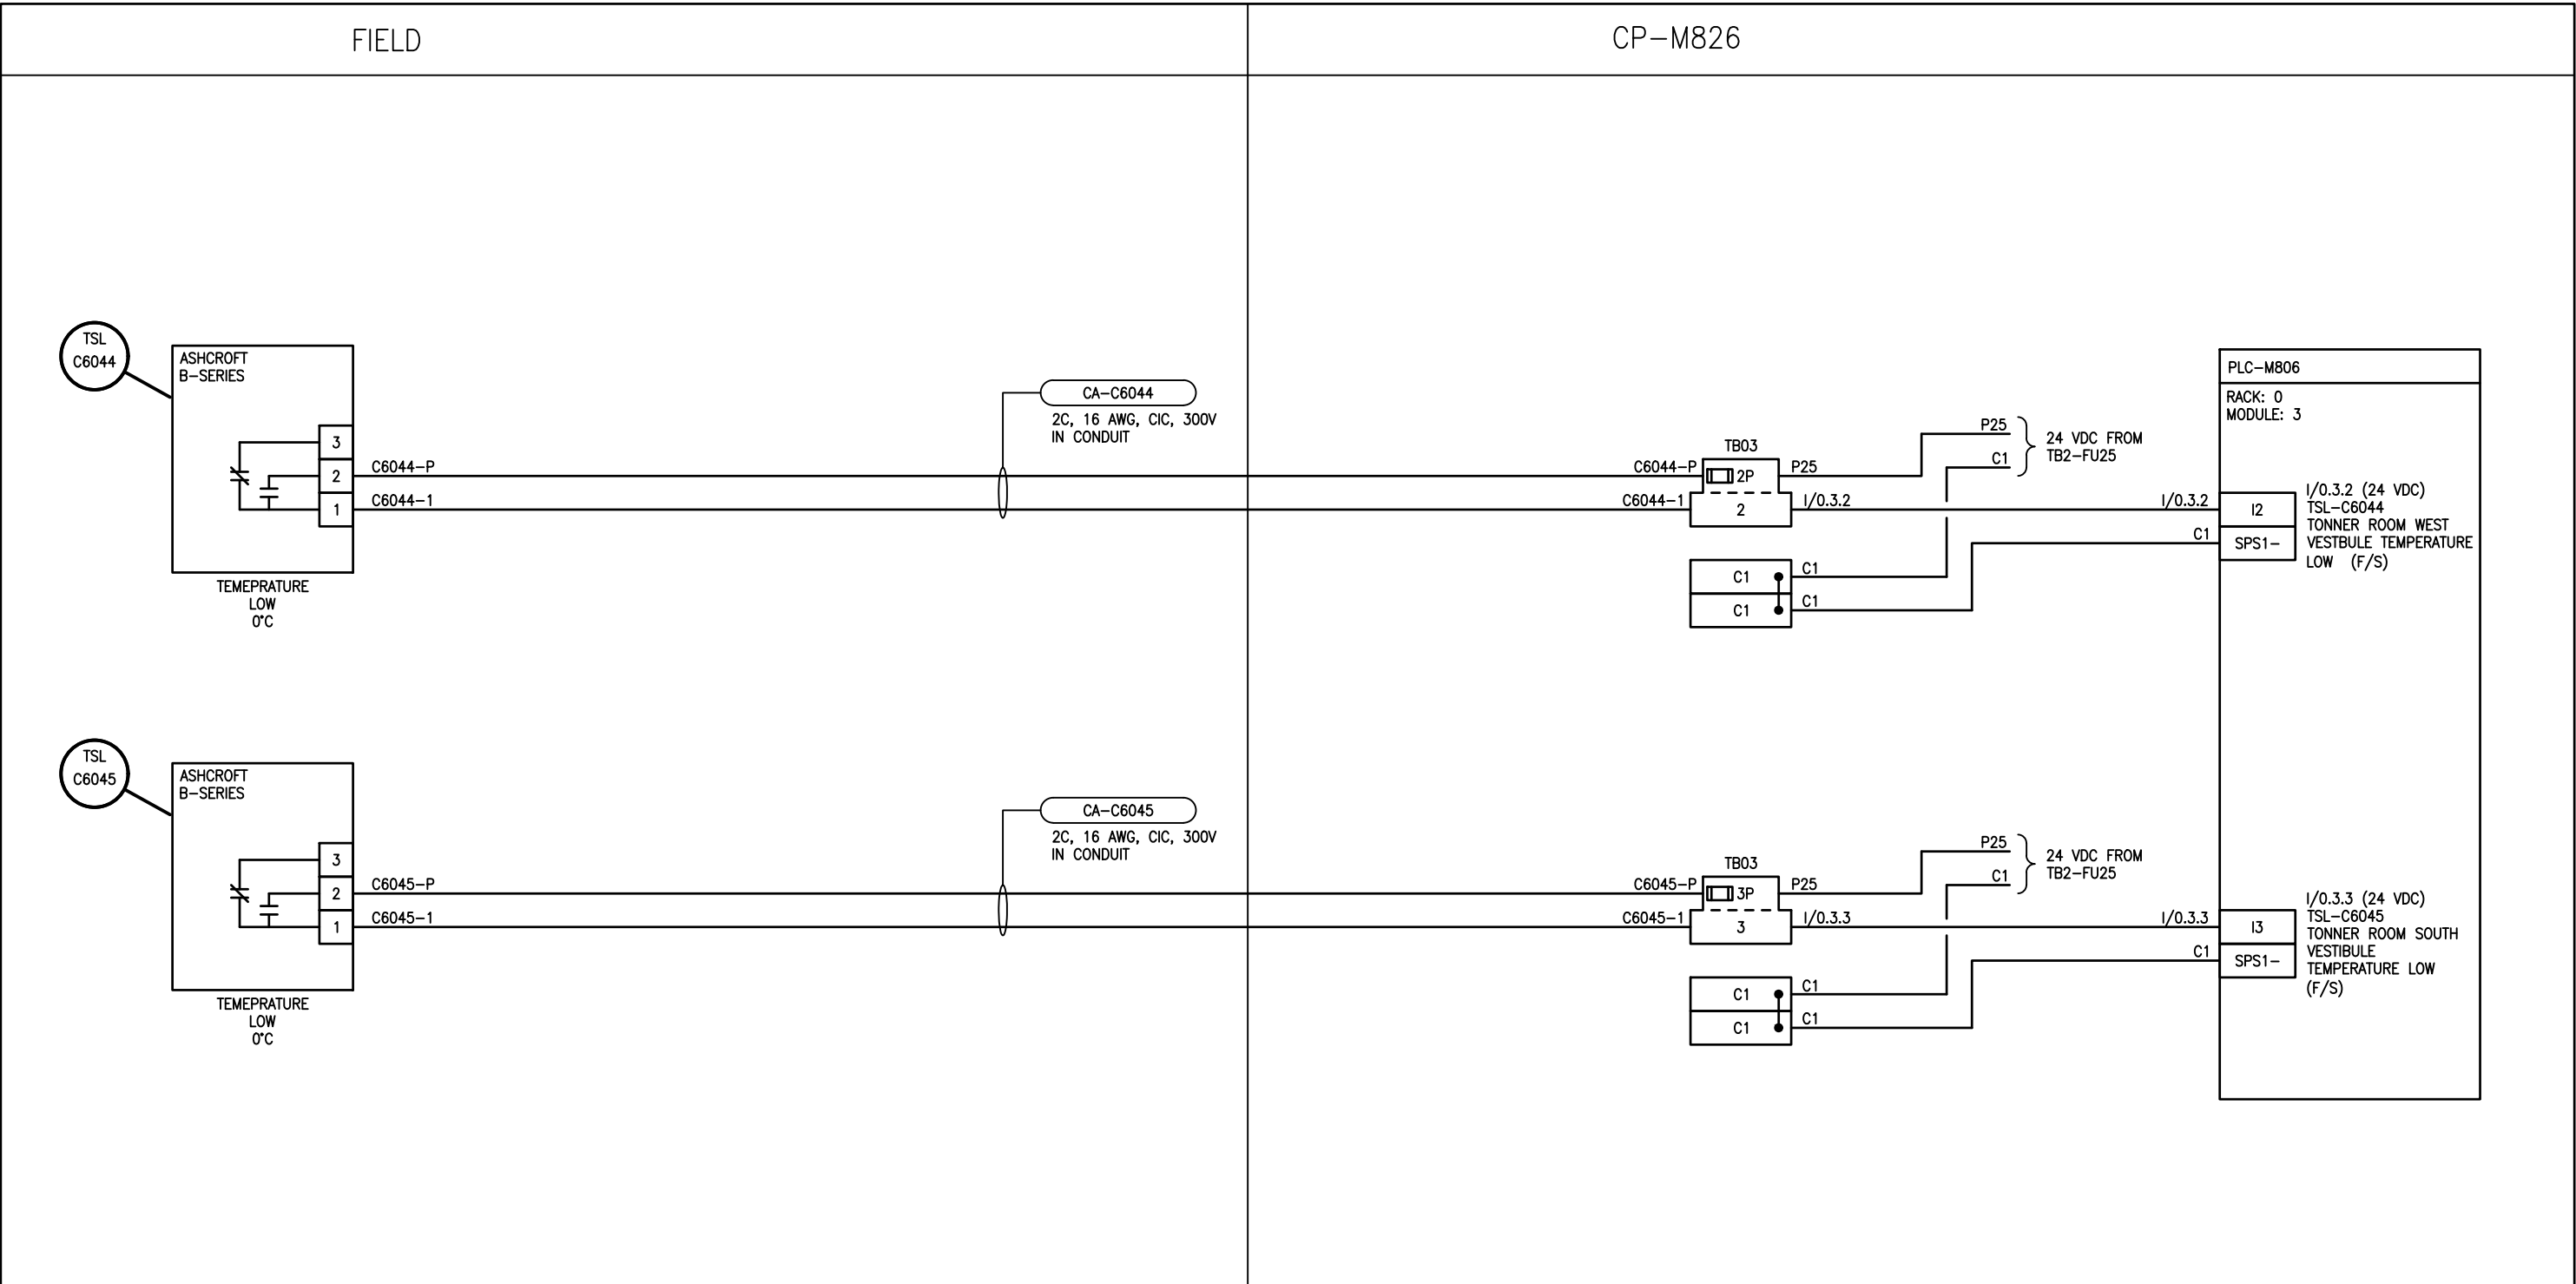

NOTES

1. PROVIDE NEW TEMPERATURE SWITCHES IN THE TONNER ROOM VESTIBULE TO SEND ALARM WHEN TEMPERATURE IS BELOW FREEZING TO PREVENT SAFETY SHOWER STATION FROM FREEZING.

ASSOCIATED REFERENCE DRAWINGS:
1-0630M-E0073
1-0630M-A0056



148 Nature Park Way
Winnipeg, Manitoba Canada R3P 0X7
204-786-8080

DESIGNED BY: V. ELIMBAN	CHECKED BY: V. ELIMBAN
DRAWN BY: B. WILKS	APPROVED BY: V. ELIMBAN
SCALE: NTS	DATE: 2023-09-30
ISSUED FOR CONSTRUCTION	
BY: M. SKINNER	DATE: 2025/04/30
CONSULTANT NO.:	

ENGINEER'S SEAL



THE CITY OF WINNIPEG
WATER AND WASTE DEPARTMENT

MACLEAN PUMPING STATION

LOOP DIAGRAM
TSL-C6044, TSL-C6045
TONNER ROOM VESTIBULES TEMPERATURE SWITCHES

CITY DRAWING NUMBER 1-0630M-A0063	SHEET 001	REV. 00	SIZE B
--------------------------------------	--------------	------------	-----------

00	ISSUED FOR TENDER AND CONSTRUCTION	2025/04/30	VE	VE
NO.	REVISIONS	DATE	DESIGN	CHECK