


B SIZE - 279mm x 432mm

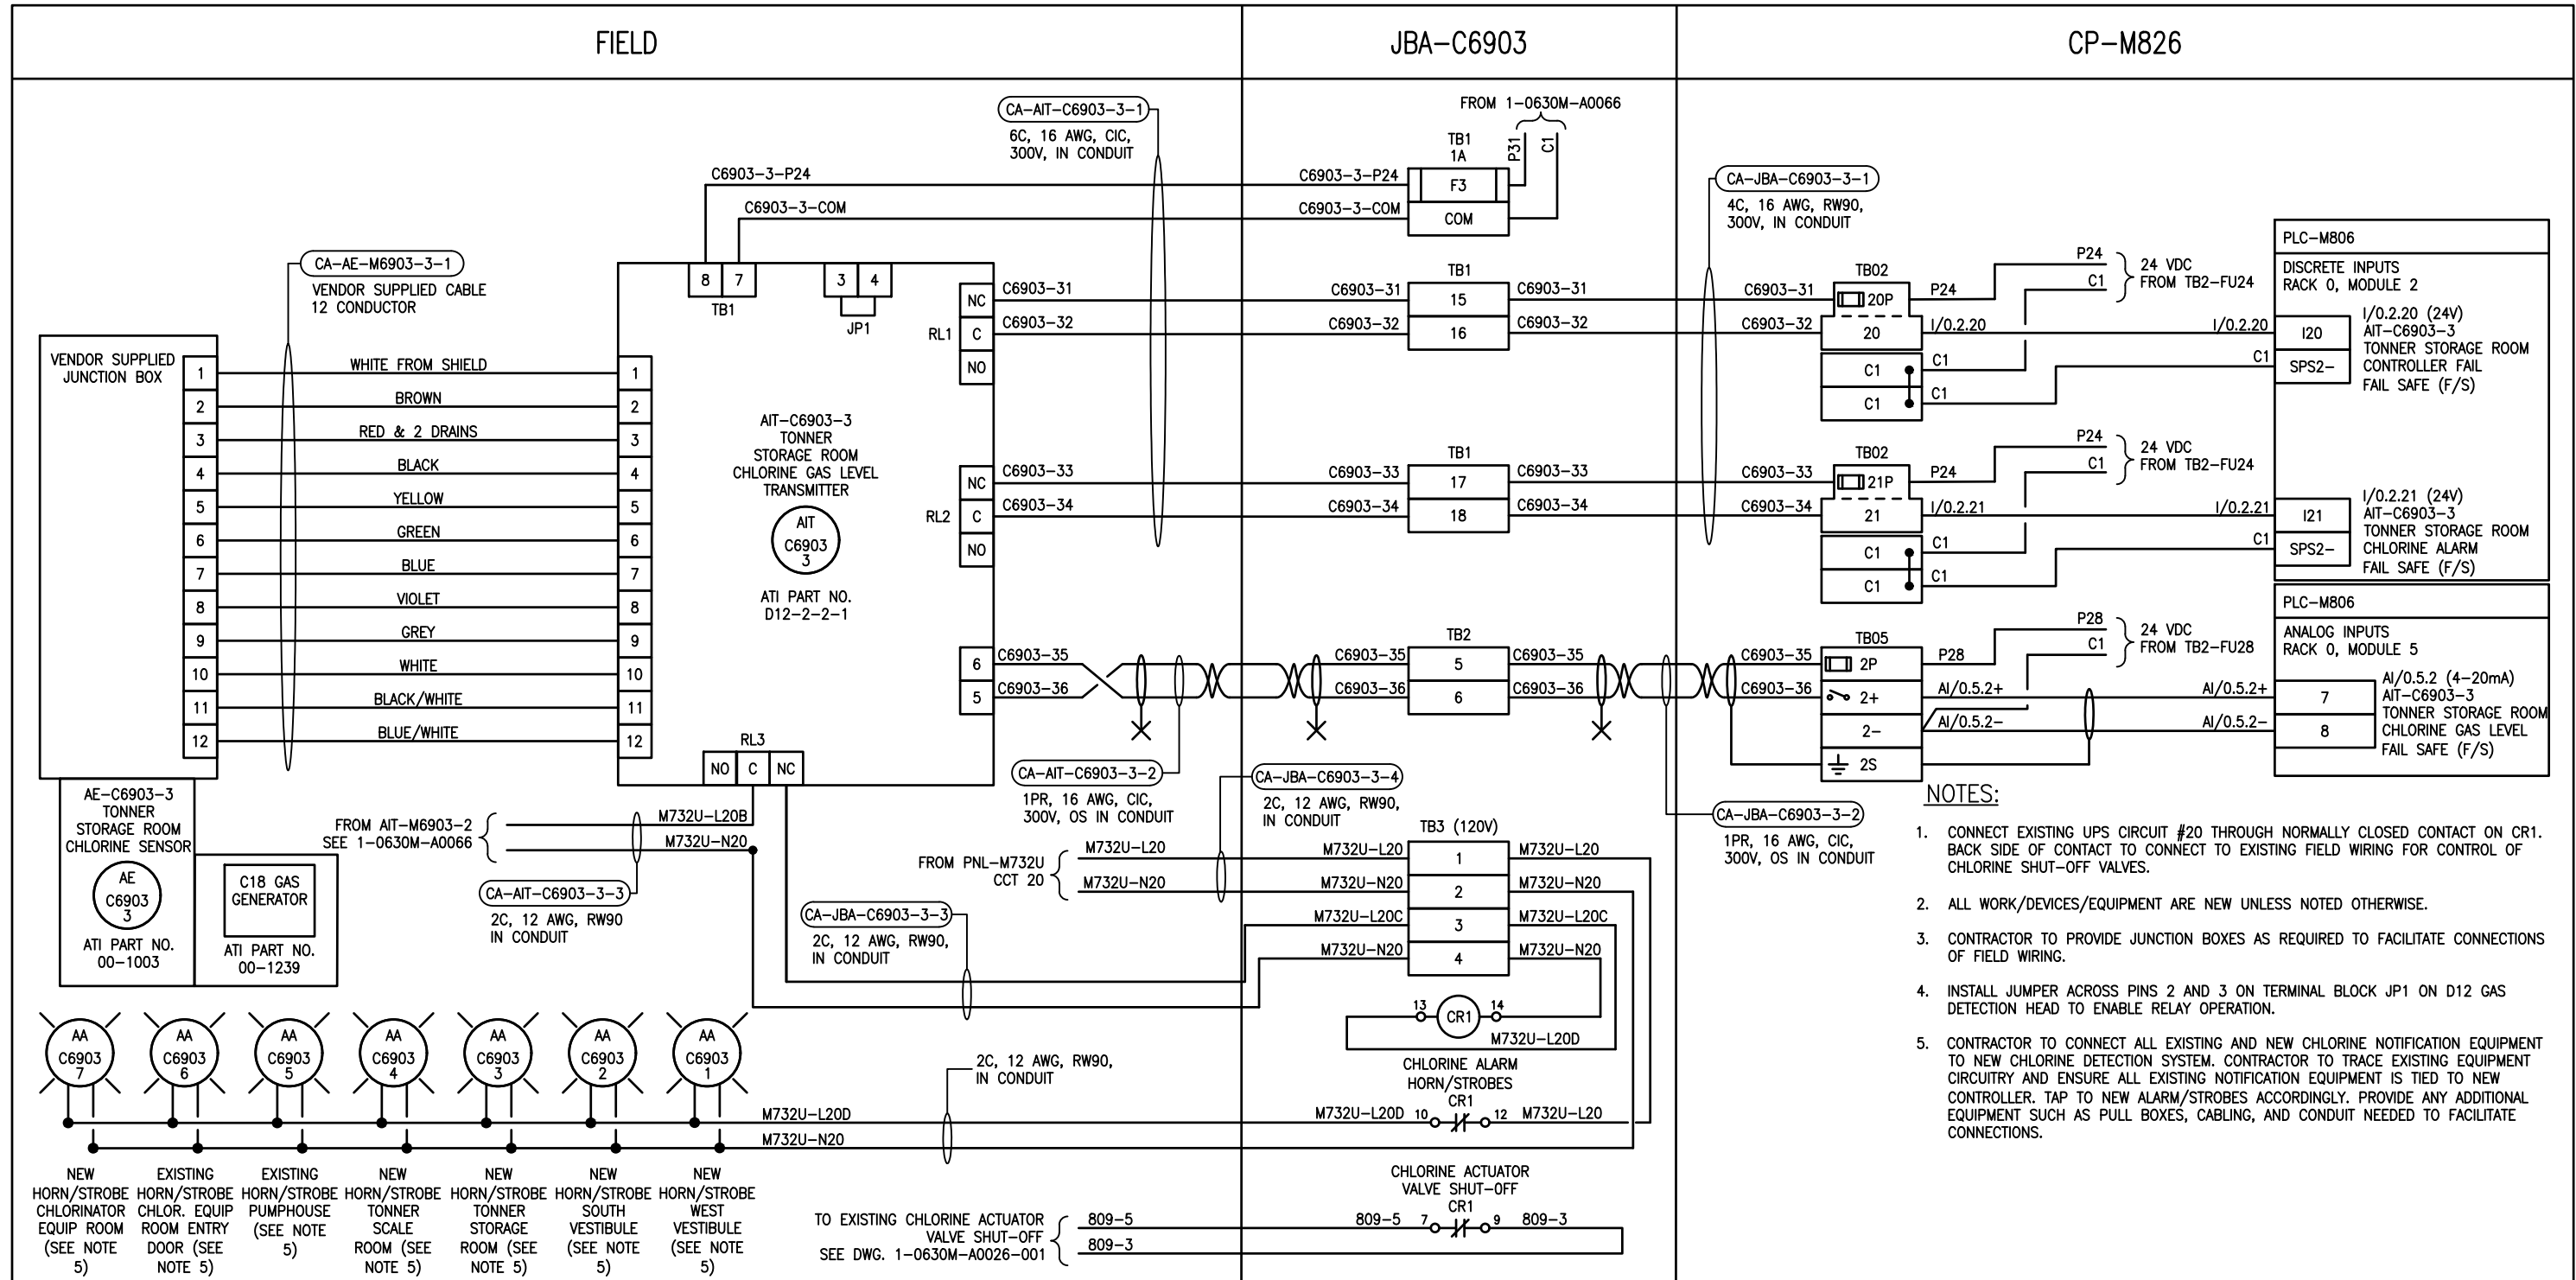

NOTES (CONTINUATION)

- REFER TO MANUFACTURER'S SHOP DRAWINGS FOR COMPLETE WIRING DETAILS. VERIFY ALL WIRING DETAILS WITH MANUFACTURER.
- ELECTRICAL CONTRACTOR TO PROVIDE ANY ADDITIONAL DEVICES NEEDED TO COMPLETE SYSTEM DESIGN.
- CHLORINE CONTROLLER TO ISSUE AN ALARM AT 1PPM.
- CONTRACTOR TO CALIBRATE DEVICE. DEVICE IS 0-200PM. CALIBRATE DEVICE ON SITE TO 0-50PPM

ASSOCIATED REFERENCE DRAWINGS:
1-0630M-E0073
1-0630M-A0055
1-0630M-A0058

**ENGINEERS
GEOSCIENTISTS
MANITOBA**
Certificate of Authorization
AtkinsRéalis Canada Inc.
No. 4489

AtkinsRéalis

148 Nature Park Way
Winnipeg, Manitoba Canada R3P 0X7
204-786-8080

ENGINEER'S SEAL



THE CITY OF WINNIPEG
WATER AND WASTE DEPARTMENT

MACLEAN PUMPING STATION
CHLORINE SYSTEM UPGRADES
LOOP DIAGRAM
CHLORINE DETECTION
AIT-C6903-3

CITY DRAWING NUMBER	SHEET	REV.	SIZE
1-0630M-A0067	001	00	B

DESIGNED BY: B. WILKS				CHECKED BY: V. ELIMBAN			
DRAWN BY: B. WILKS				APPROVED BY: V. ELIMBAN			
SCALE: N.T.S.				DATE: 2023/06/11			
ISSUED FOR CONSTRUCTION				DATE: 2025/04/30			
BY: M. SKINNER				DATE: 2025/04/30			
CONSULTANT NO.:							
00	ISSUED FOR TENDER AND CONSTRUCTION			2025/04/30	VE	VE	
NO.	REVISIONS	DATE	DESIGN	CHECK			