


B SIZE - 279mm x 432mm

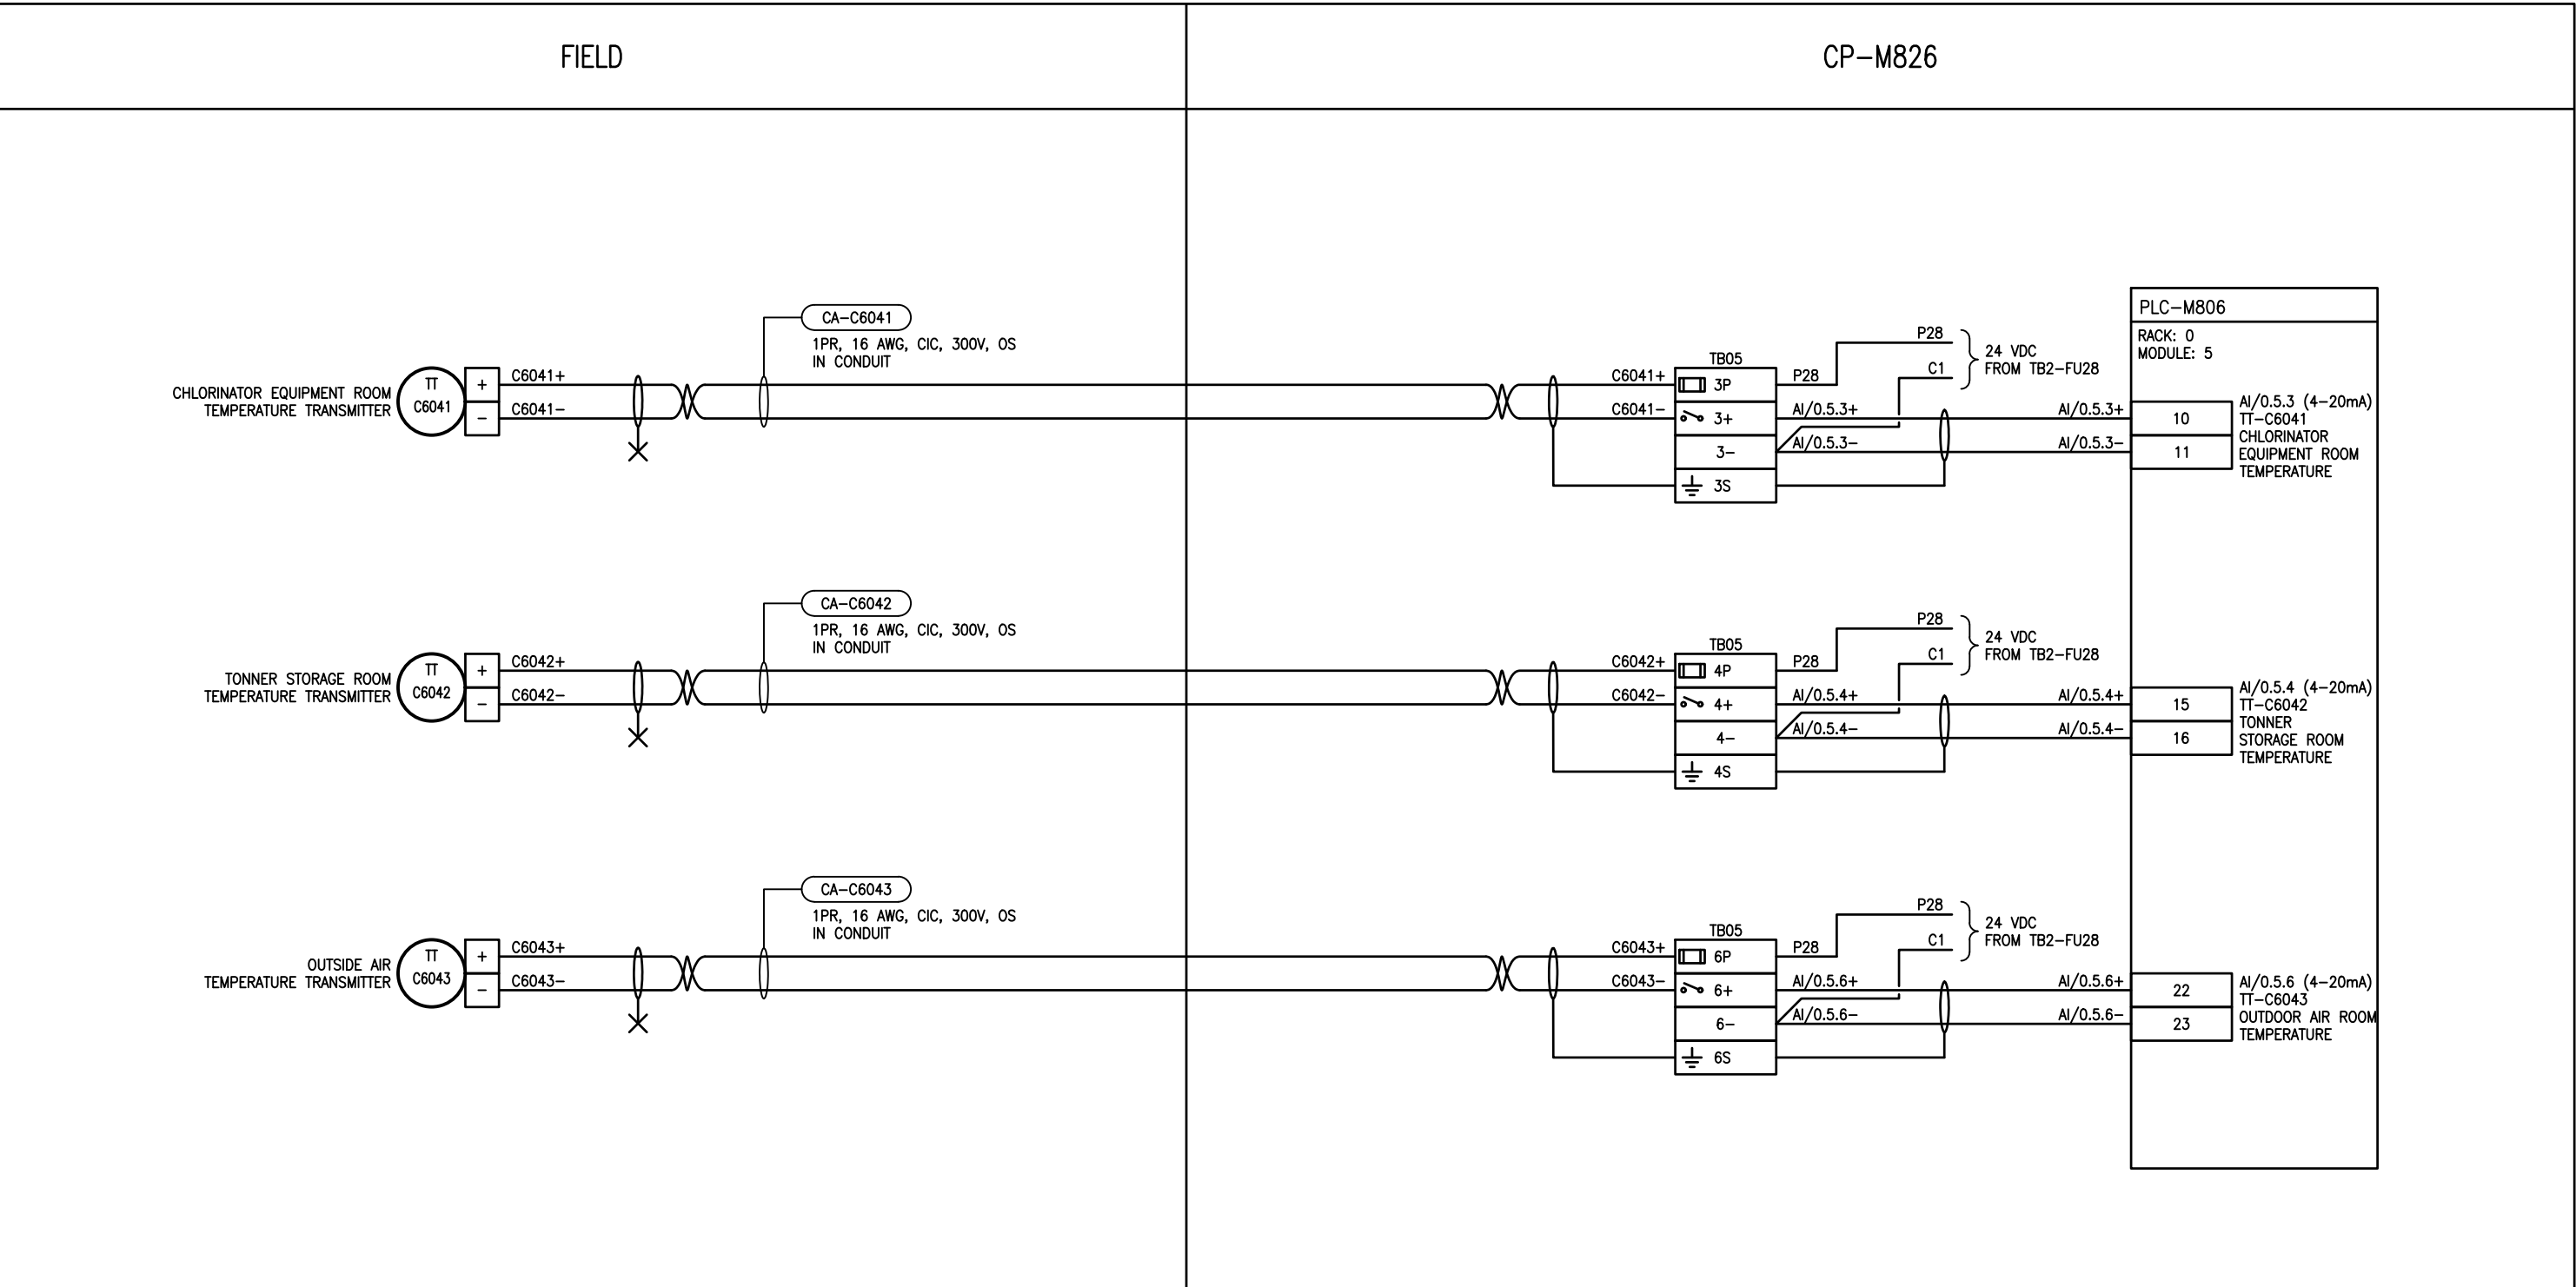

NOTES

1. GROUNDED TERMINALS CONNECTED TO ISOLATED GROUND THROUGH DIN RAIL.
2. CONTRACTOR RESPONSIBLE TO CALIBRATE DEVICES. 4-20ma SIGNAL SHALL EQUATE TO 0-100°C FOR INDOOR TEMP TRANSMITTER, -40°C-40°C FOR OUTDOOR TRANSMITTER.

ASSOCIATED REFERENCE DRAWINGS:
1-0630M-E0073
1-0630M-A0058



148 Nature Park Way
Winnipeg, Manitoba Canada R3P 0X7
204-786-8080

ENGINEER'S SEAL



THE CITY OF WINNIPEG
WATER AND WASTE DEPARTMENT

MACLEAN PUMPING STATION
CHLORINE SYSTEM UPGRADE
LOOP DIAGRAM
TT-C6041, TT-C6042, AND TT-C6043
TEMPERATURE TRANSMITTERS

CITY DRAWING NUMBER	SHEET	REV.	SIZE
1-0630M-A0068	001	00	B

DESIGNED BY:	J. GRAGASIN	CHECKED BY:	V. ELIMBAN
DRAWN BY:	J. GRAGASIN	APPROVED BY:	V. ELIMBAN
SCALE:	NTS	DATE:	2023/06/11
ISSUED FOR CONSTRUCTION			
BY:	M. SKINNER	DATE:	2025/04/30
CONSULTANT NO.:			
00	ISSUED FOR TENDER AND CONSTRUCTION	2025/04/30	VE VE
NO.	REVISIONS	DATE	DESIGN CHECK