


B SIZE - 279mm x 432mm

FIELD

CP-M826

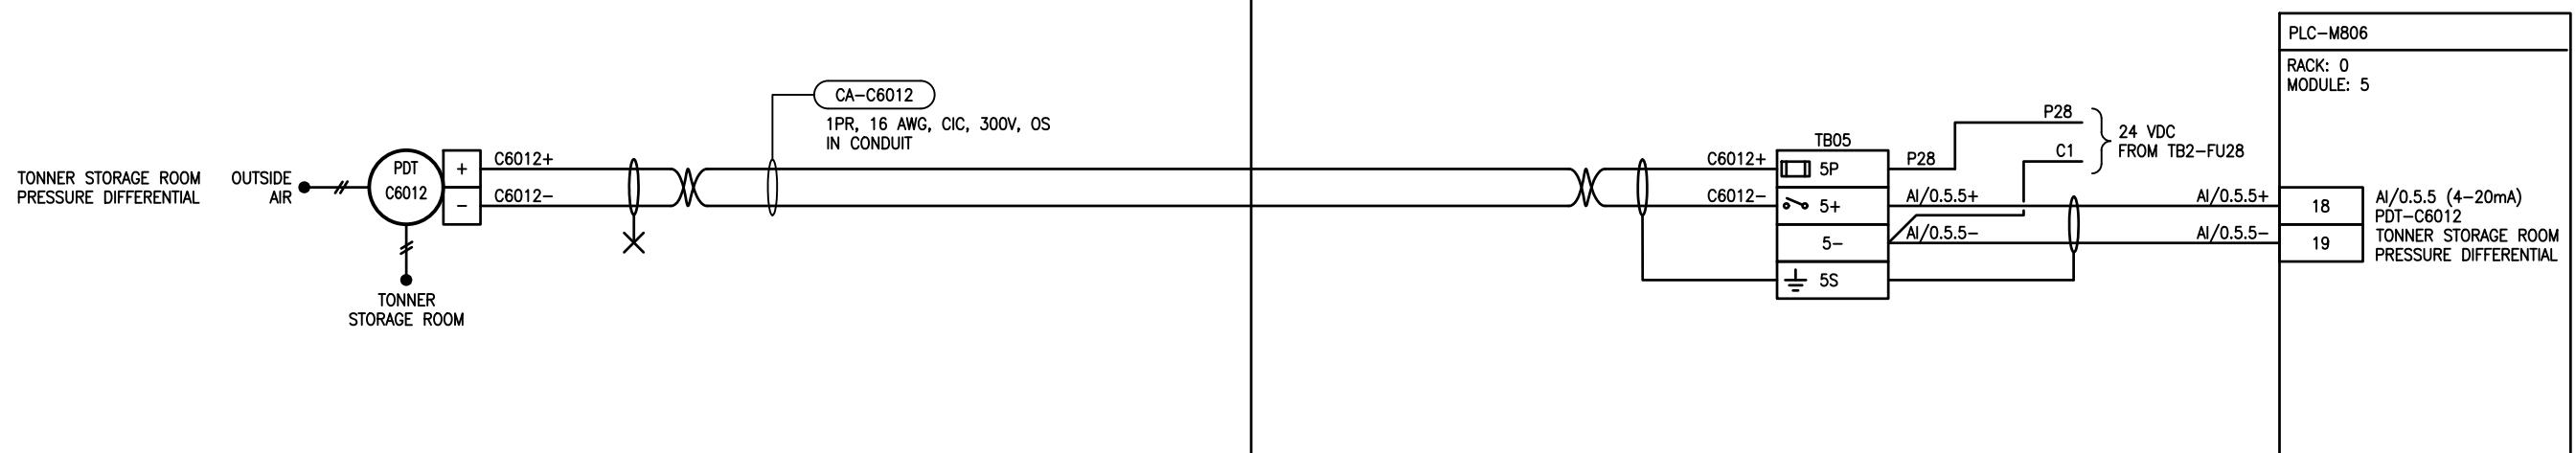

NOTES

1. CONTRACTOR RESPONSIBLE FOR CALIBRATING DEVICE.
4-20mA SIGNAL SHALL EQUATE TO -250PA TO 250PA.

ASSOCIATED REFERENCE DRAWINGS



AtkinsRéalis

148 Nature Park Way
Winnipeg, Manitoba Canada R3P 0X7
204-786-8080

00	ISSUED FOR TENDER AND CONSTRUCTION	2025/04/30	VE
NO.	REVISIONS	DATE	DESIGN

ENGINEER'S SIGNATURE



THE CITY OF WINNIPEG

WATER AND WASTE DEPARTMENT

MACLEAN PUMPING STATION CHLORINE SYSTEM UPGRADES

1 LOOP DIAGRAM

T-C6012

TONNER ROOM PRESSURE DIFFERENTIAL

CITY DRAWING NUMBER	1-0630M-A0069	SHEET	001	REV.	00	SIZE	B
---------------------	---------------	-------	-----	------	----	------	---