
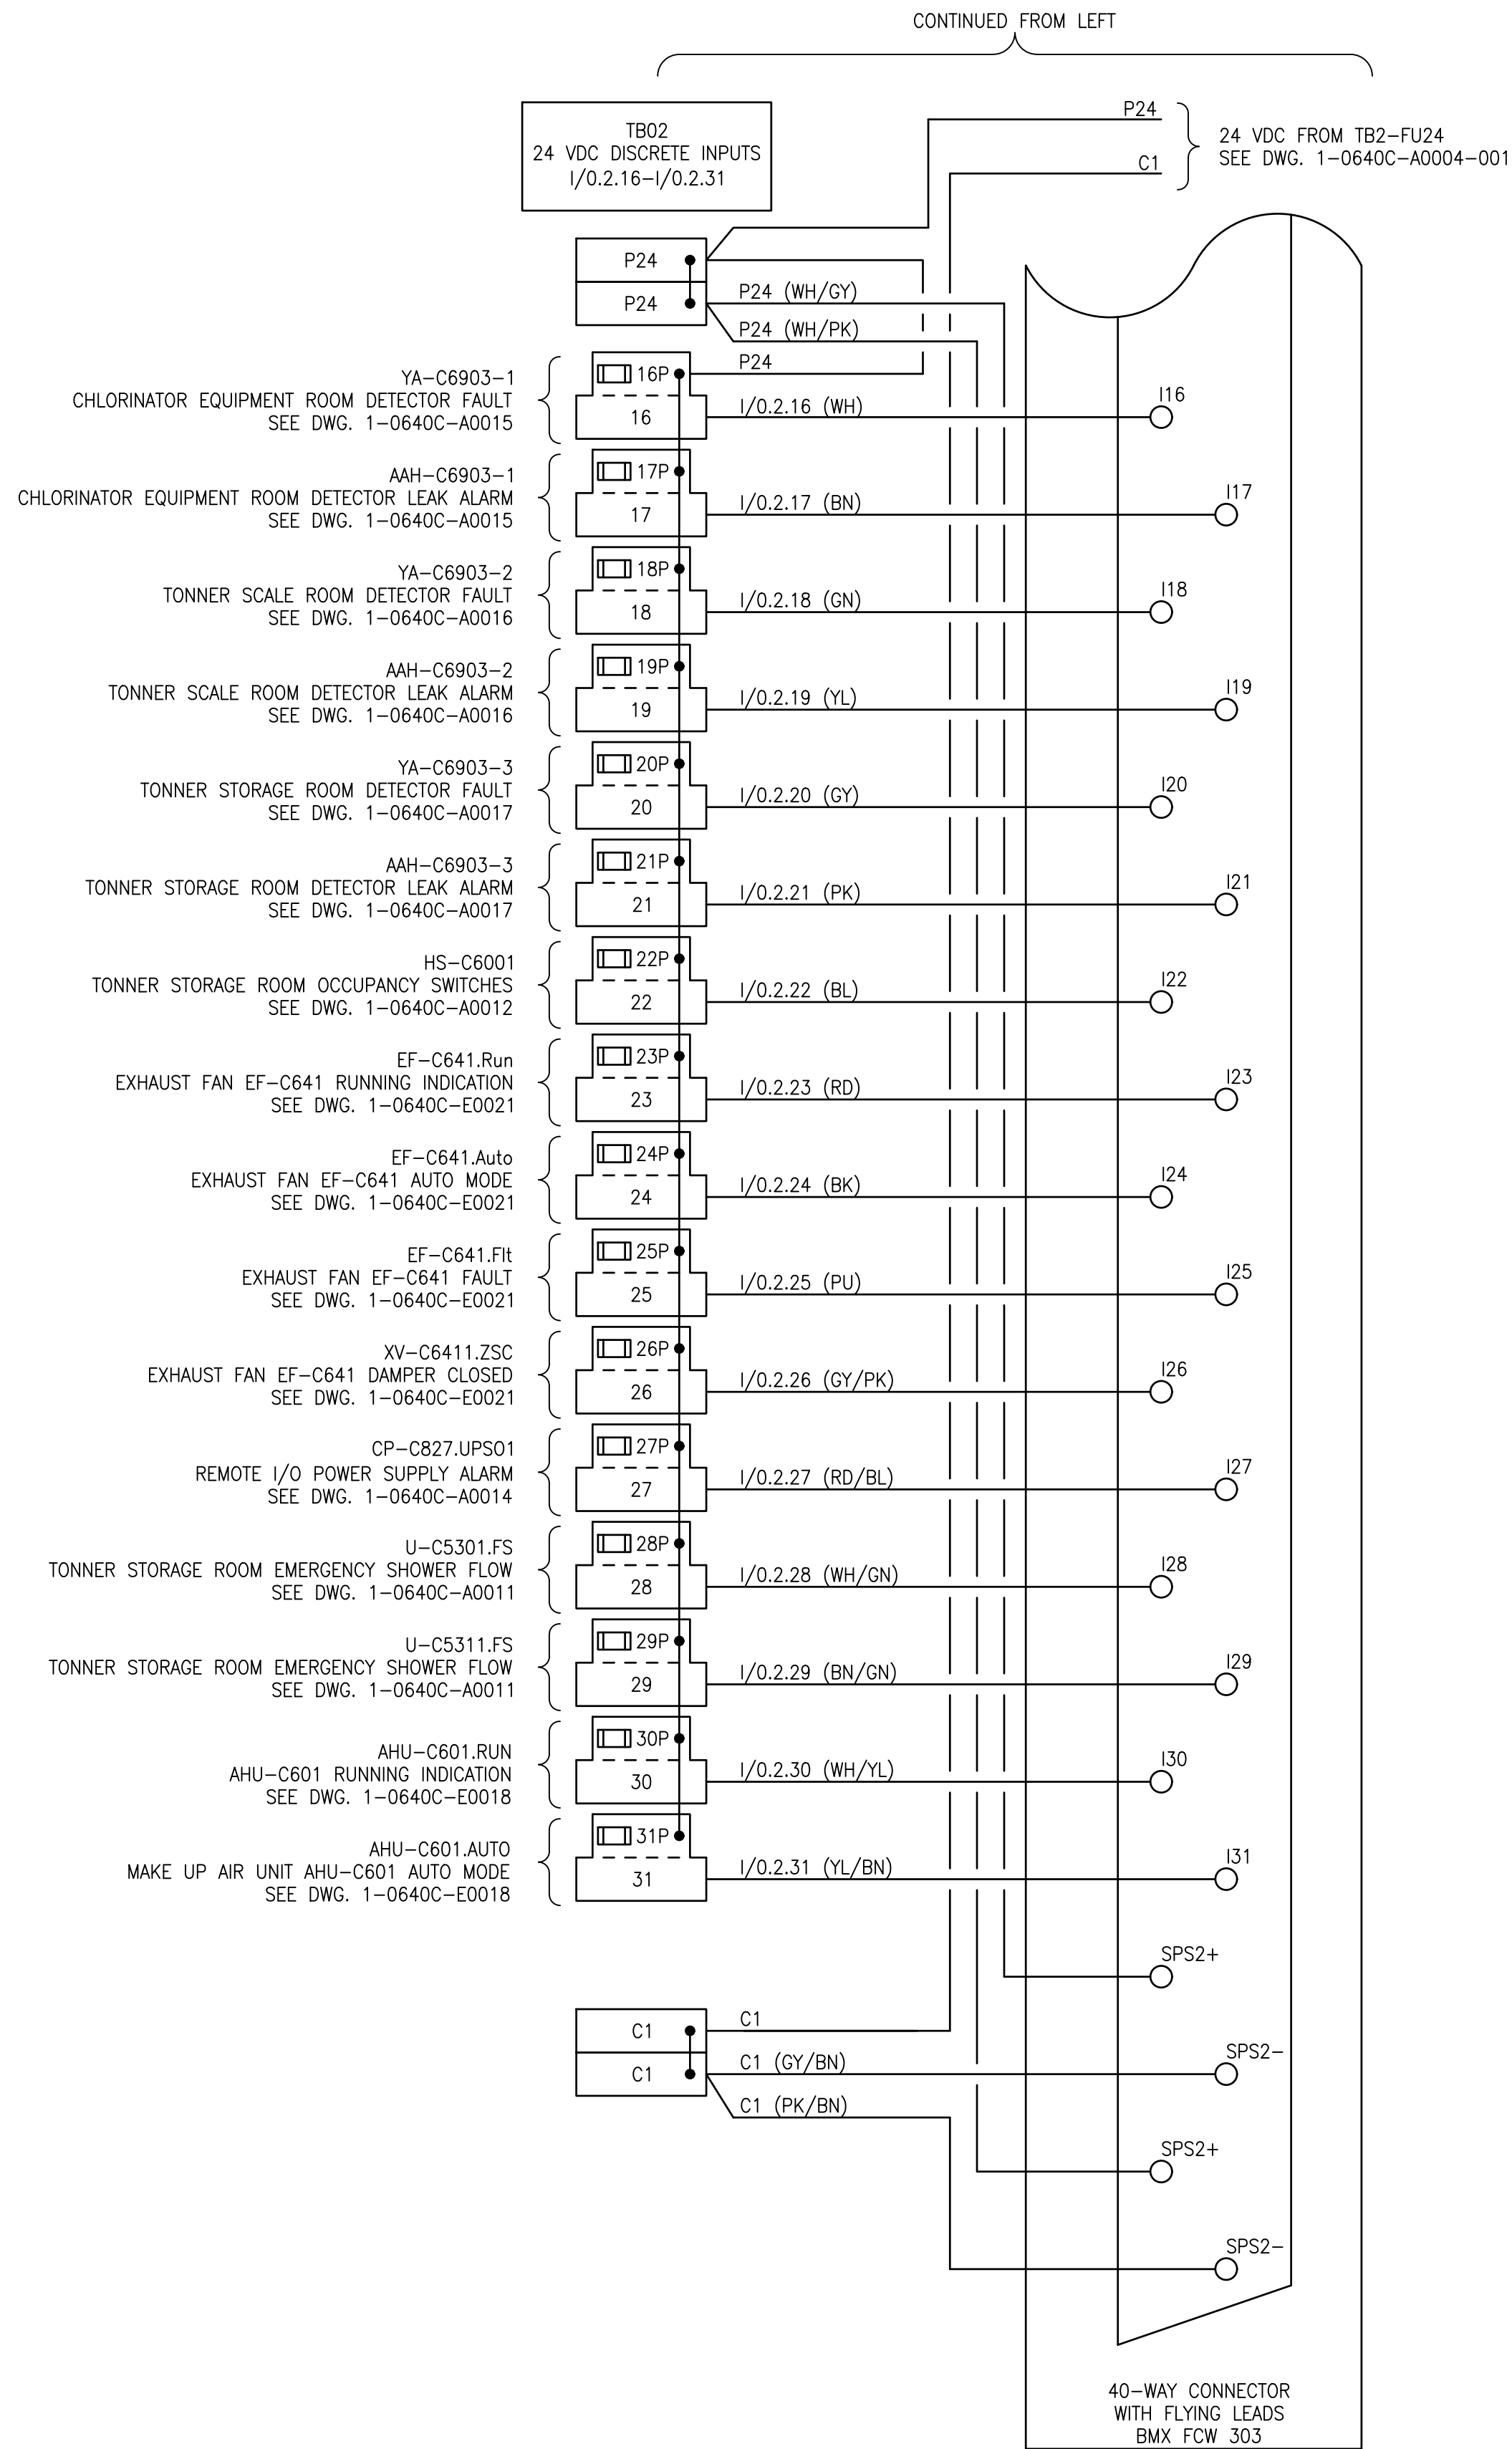


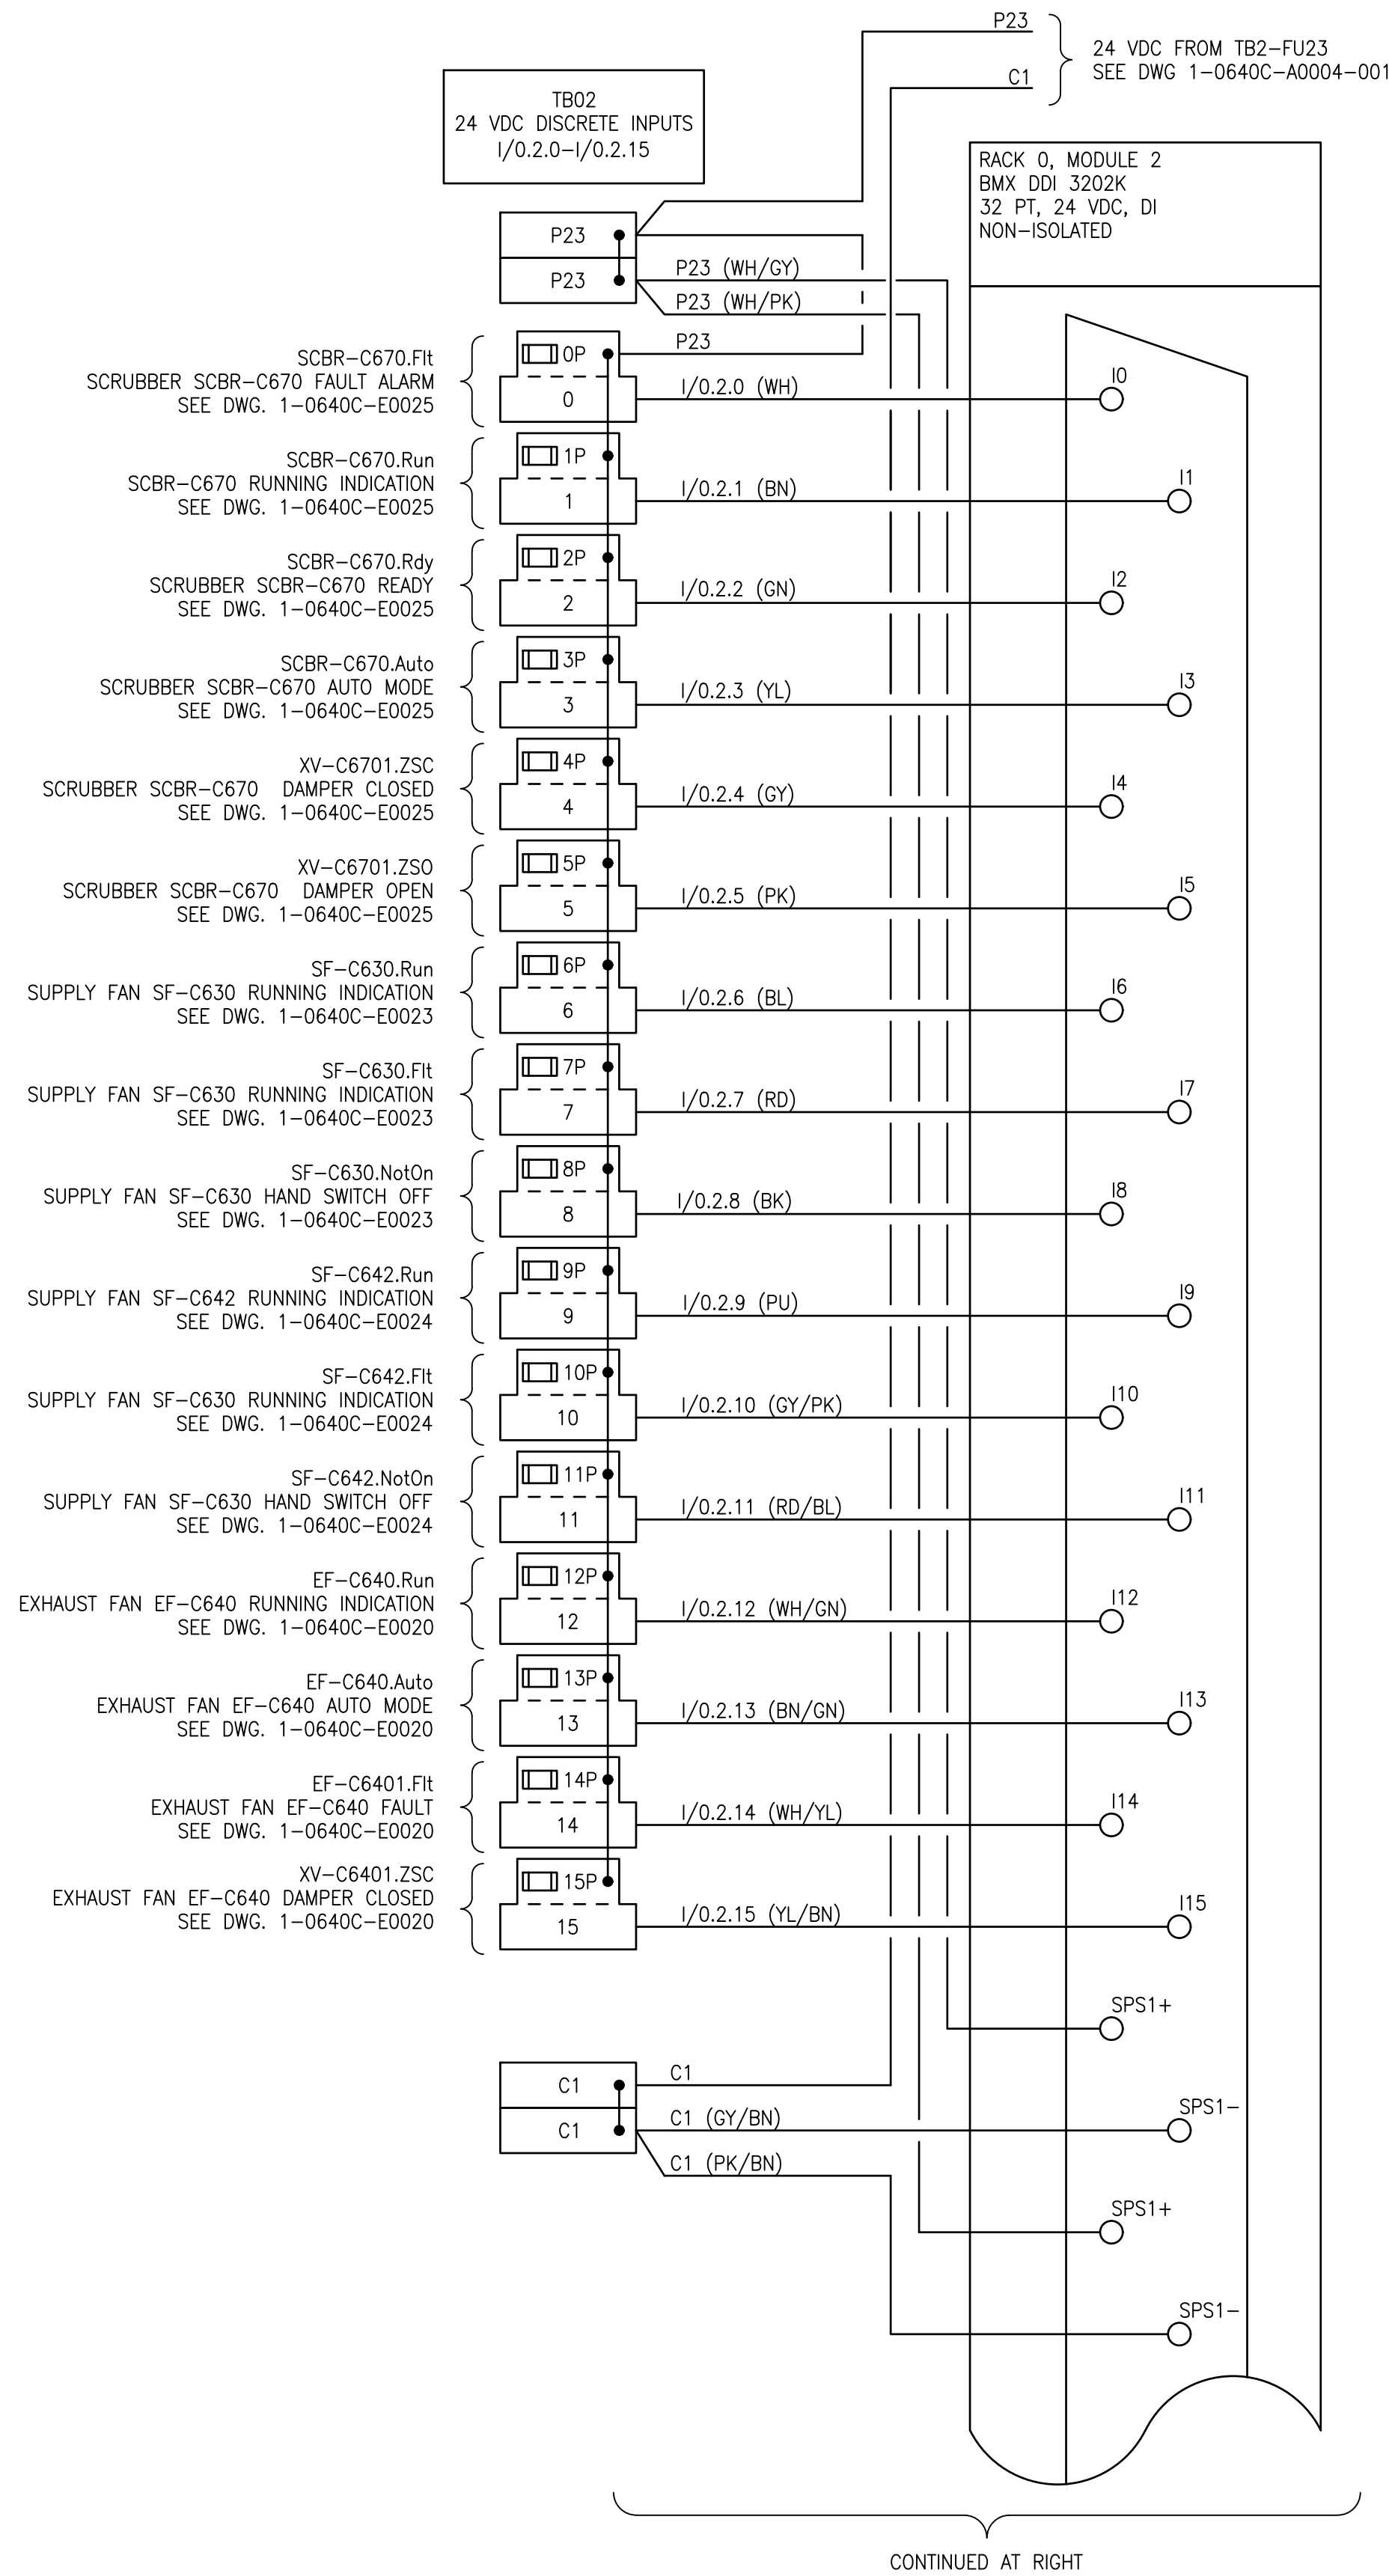

FUSE SCHEDULE				
TB	IDENTIFIER	SIZE	RATED CURRENT (A)	FA
TB4	0P	5x20mm	0.5	
	1P	5x20mm	0.5	
	2P	5x20mm	0.5	
	3P	5x20mm	0.5	
	4P	5x20mm	0.5	
	5P	5x20mm	0.5	
	6P	5x20mm	0.5	
	7P	5x20mm	0.5	
	8P	5x20mm	0.5	
	9P	5x20mm	0.5	
	10P	5x20mm	0.5	
	11P	5x20mm	0.5	
	12P	5x20mm	0.5	
	13P	5x20mm	0.5	
	14P	5x20mm	0.5	
	15P	5x20mm	0.5	
	16P	5x20mm	0.5	
	17P	5x20mm	0.5	
	18P	5x20mm	0.5	
	19P	5x20mm	0.5	
	20P	5x20mm	0.5	
	21P	5x20mm	0.5	
	22P	5x20mm	0.5	
	23P	5x20mm	0.5	
	24P	5x20mm	0.5	
	25P	5x20mm	0.5	
	26P	5x20mm	0.5	
	27P	5x20mm	0.5	
	28P	5x20mm	0.5	
	29P	5x20mm	0.5	
	30P	5x20mm	0.5	
	31P	5x20mm	0.5	

1-0640C-A0003	REMOTE I/O PANEL LAYOUT, CONTROL PANEL CP-C827
DRAWING NUMBER	REFERENCE DRAWINGS

**ENGINEERS
GEOSCIENTISTS
MANITOBA**
Certificate of Authorization
AtkinsRéalis Canada Inc.
No. 4489

DESIGNED BY: J. GRAGASIN				CHECKED BY: V. ELIMBAN			
DRAWN BY: J. GRAGASIN				APPROVED BY: V. ELIMBAN			
SCALE: NTS				ISSUED FOR CONSTRUCTION BY: M. SKINNER			
DATE: 2023/05/16				DATE: 2025/04/30			
ISSUED FOR TENDER AND CONSTRUCTION				CONSULTANT NO.:			
NO. REVISIONS				DATE DESIGN CHECK			

**THE CITY OF WINNIPEG**
WATER AND WASTE DEPARTMENT

MCPHILLPS PUMPING STATION
CHLORINE SYSTEM UPGRADE
AUTOMATION - WIRING DIAGRAM
REMOTE I/O CONTROL PANEL CP-C827
DISCRETE INPUTS RACK 0, MODULE 2

CITY DRAWING NUMBER	SHEET	REV.	SIZE
1-0640C-A0005	001	00	A1