A1 SIZE – 594mm x 841mm

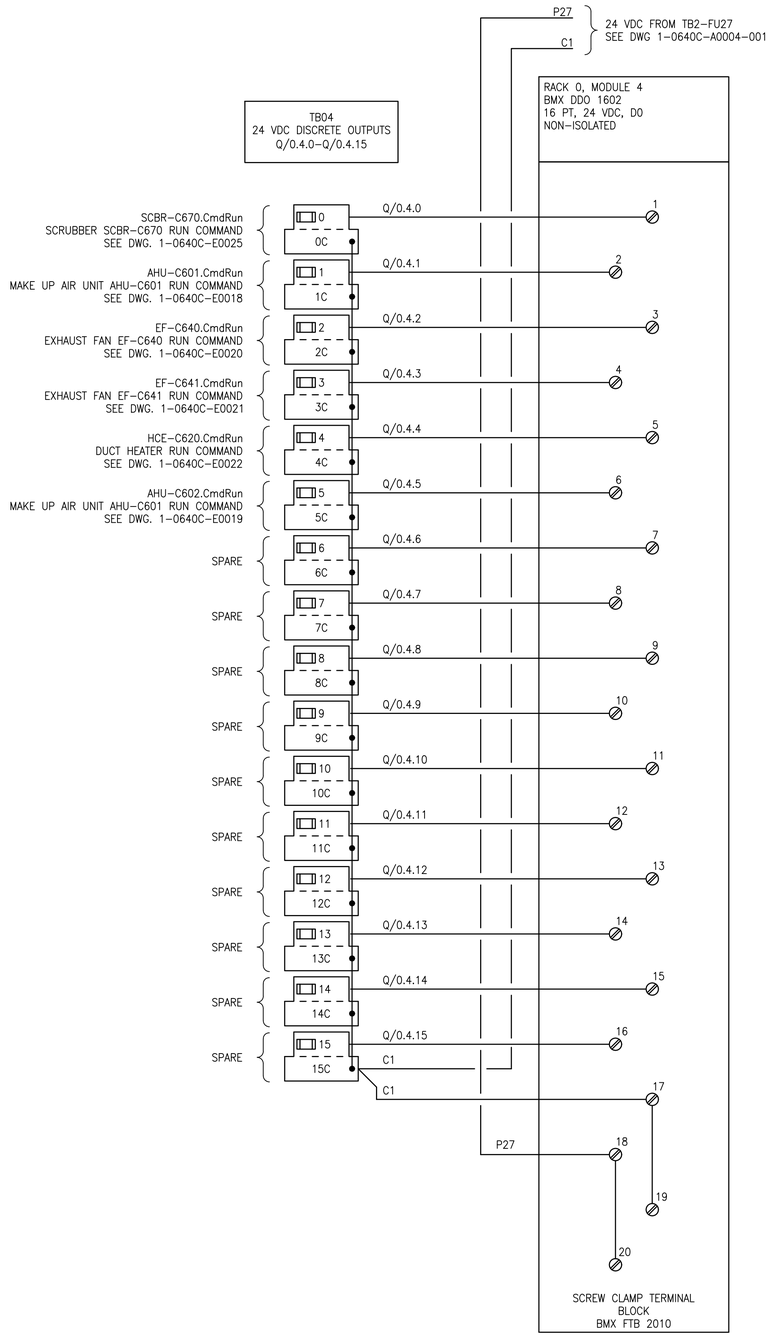

FUSE SCHEDULE

TB	IDENTIFIER	SIZE	RATED CURRENT (A) FA
TB5	0	5x20mm	1.0
	1	5x20mm	1.0
	2	5x20mm	1.0
	3	5x20mm	1.0
	4	5x20mm	1.0
	5	5x20mm	1.0
	6	5x20mm	1.0
	7	5x20mm	1.0
	8	5x20mm	1.0
	9	5x20mm	1.0
	10	5x20mm	1.0
	11	5x20mm	1.0
	12	5x20mm	1.0
	13	5x20mm	1.0
	14	5x20mm	1.0
	15	5x20mm	1.0

DRAWING NUMBER	REFERENCE DRAWINGS
1–0640C–A0003	REMOTE I/O PANEL LAYOUT, CONTROL PANEL CP–C827

ENGINEERS GEOSCIENTISTS MANITOBA
Certificate of Authorization
AtkinsRéalis Canada Inc.
No. 4489

NO.	REVISIONS	DATE	DESIGN	CHECK
00	ISSUED FOR TENDER AND CONSTRUCTION	2025/04/30	VE	VE

AtkinsRéalis
148 Nature Park Way, Winnipeg, Manitoba
Canada R3P 0X7 204-786-8080

DESIGNED BY: J. GRAGASIN	CHECKED BY: V. ELIMBAN
DRAWN BY: J. GRAGASIN	APPROVED BY: V. ELIMBAN
SCALE: NTS	ISSUED FOR CONSTRUCTION BY: M. SKINNER
DATE: 2023/06/14	DATE: 2025/04/30
CONSULTANT NO.:	

ENGINEER'S SEAL
PROVINCE OF MANITOBA
V. V. ELIMBAN
Member
34636
REGISTERED PROFESSIONAL ENGINEER
2025-05-02

Winnipeg
THE CITY OF WINNIPEG
WATER AND WASTE DEPARTMENT

MCPHILLIPS PUMPING STATION
CHLORINE SYSTEM UPGRADE
AUTOMATION – WIRING DIAGRAM
REMOTE I/O CONTROL PANEL CP–C827
DISCRETE OUTPUTS RACK 0, MODULE 4

CITY DRAWING NUMBER	SHEET	REV.	SIZE
1–0640C–A0007	001	00	A1