


B SIZE - 279mm x 432mm

FIELD

CP-C827

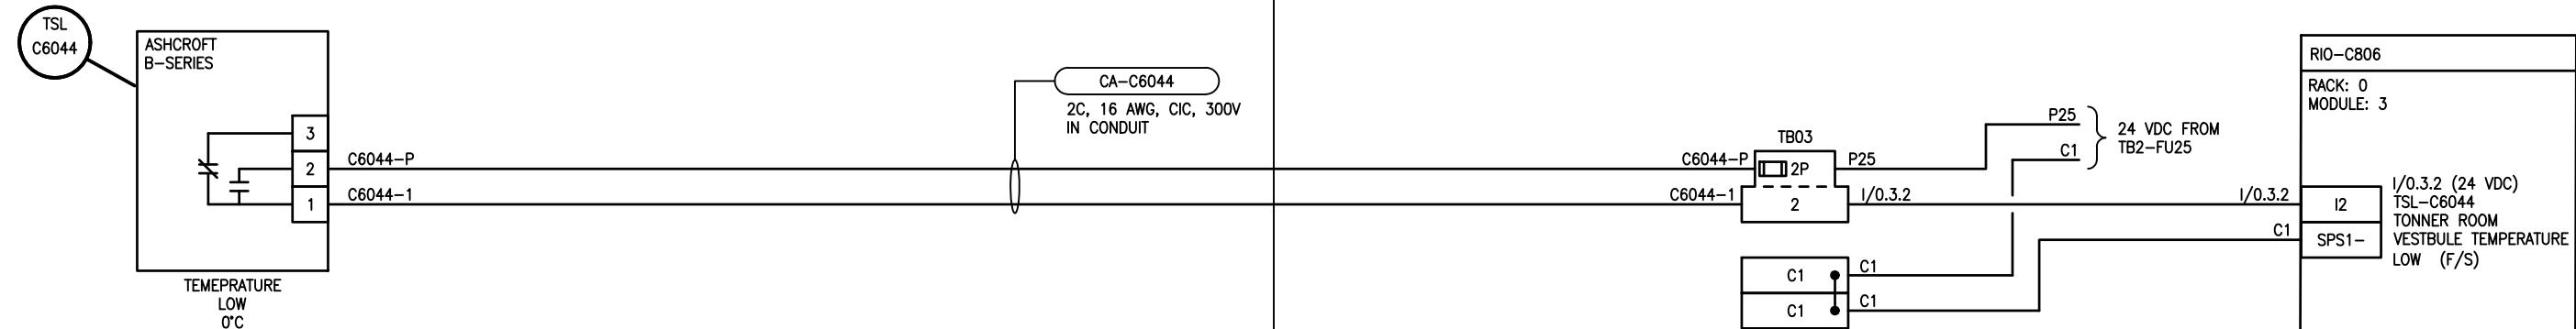

## NOTES

1. PROVIDE NEW TEMPERATURE SWITCH IN THE TONNER ROOM VESTIBULE TO SEND ALARM WHEN TEMPERATURE IS BELOW FREEZING TO PREVENT SAFETY SHOWER STATION FROM FREEZING.

ASSOCIATED REFERENCE DRAWINGS  
1-0640C-E0015  
1-0640C-A0006



AtkinsRéalis

148 Nature Park Way  
Winnipeg, Manitoba Canada R3P 0X7  
204-786-8080

					DESIGN
					DRAWING
					SCALE
					BY:
					CONTRACT
00	ISSUED FOR TENDER AND CONSTRUCTION	2025/04/30	VE	VE	
NO.	REVISIONS	DATE	DESIGN	CHECK	

ENGINEER'S SEA



## THE CITY OF WINNIPEG

## WATER AND WASTE DEPARTMENT

MCPHILLIPS PUMPING STATION

OP DIAGRAM  
SL-C6044

## TONNER ROOM VESTIBULES TEMPERATURE SWITCHES

## TURNER ROOM VESTIBULES TEMPERATURE SWITCHES

CITY DRAWING NUMBER	SHEET	REV.	SIZE
1-0640C-A0013	001	00	B