


B SIZE - 279mm x 432mm

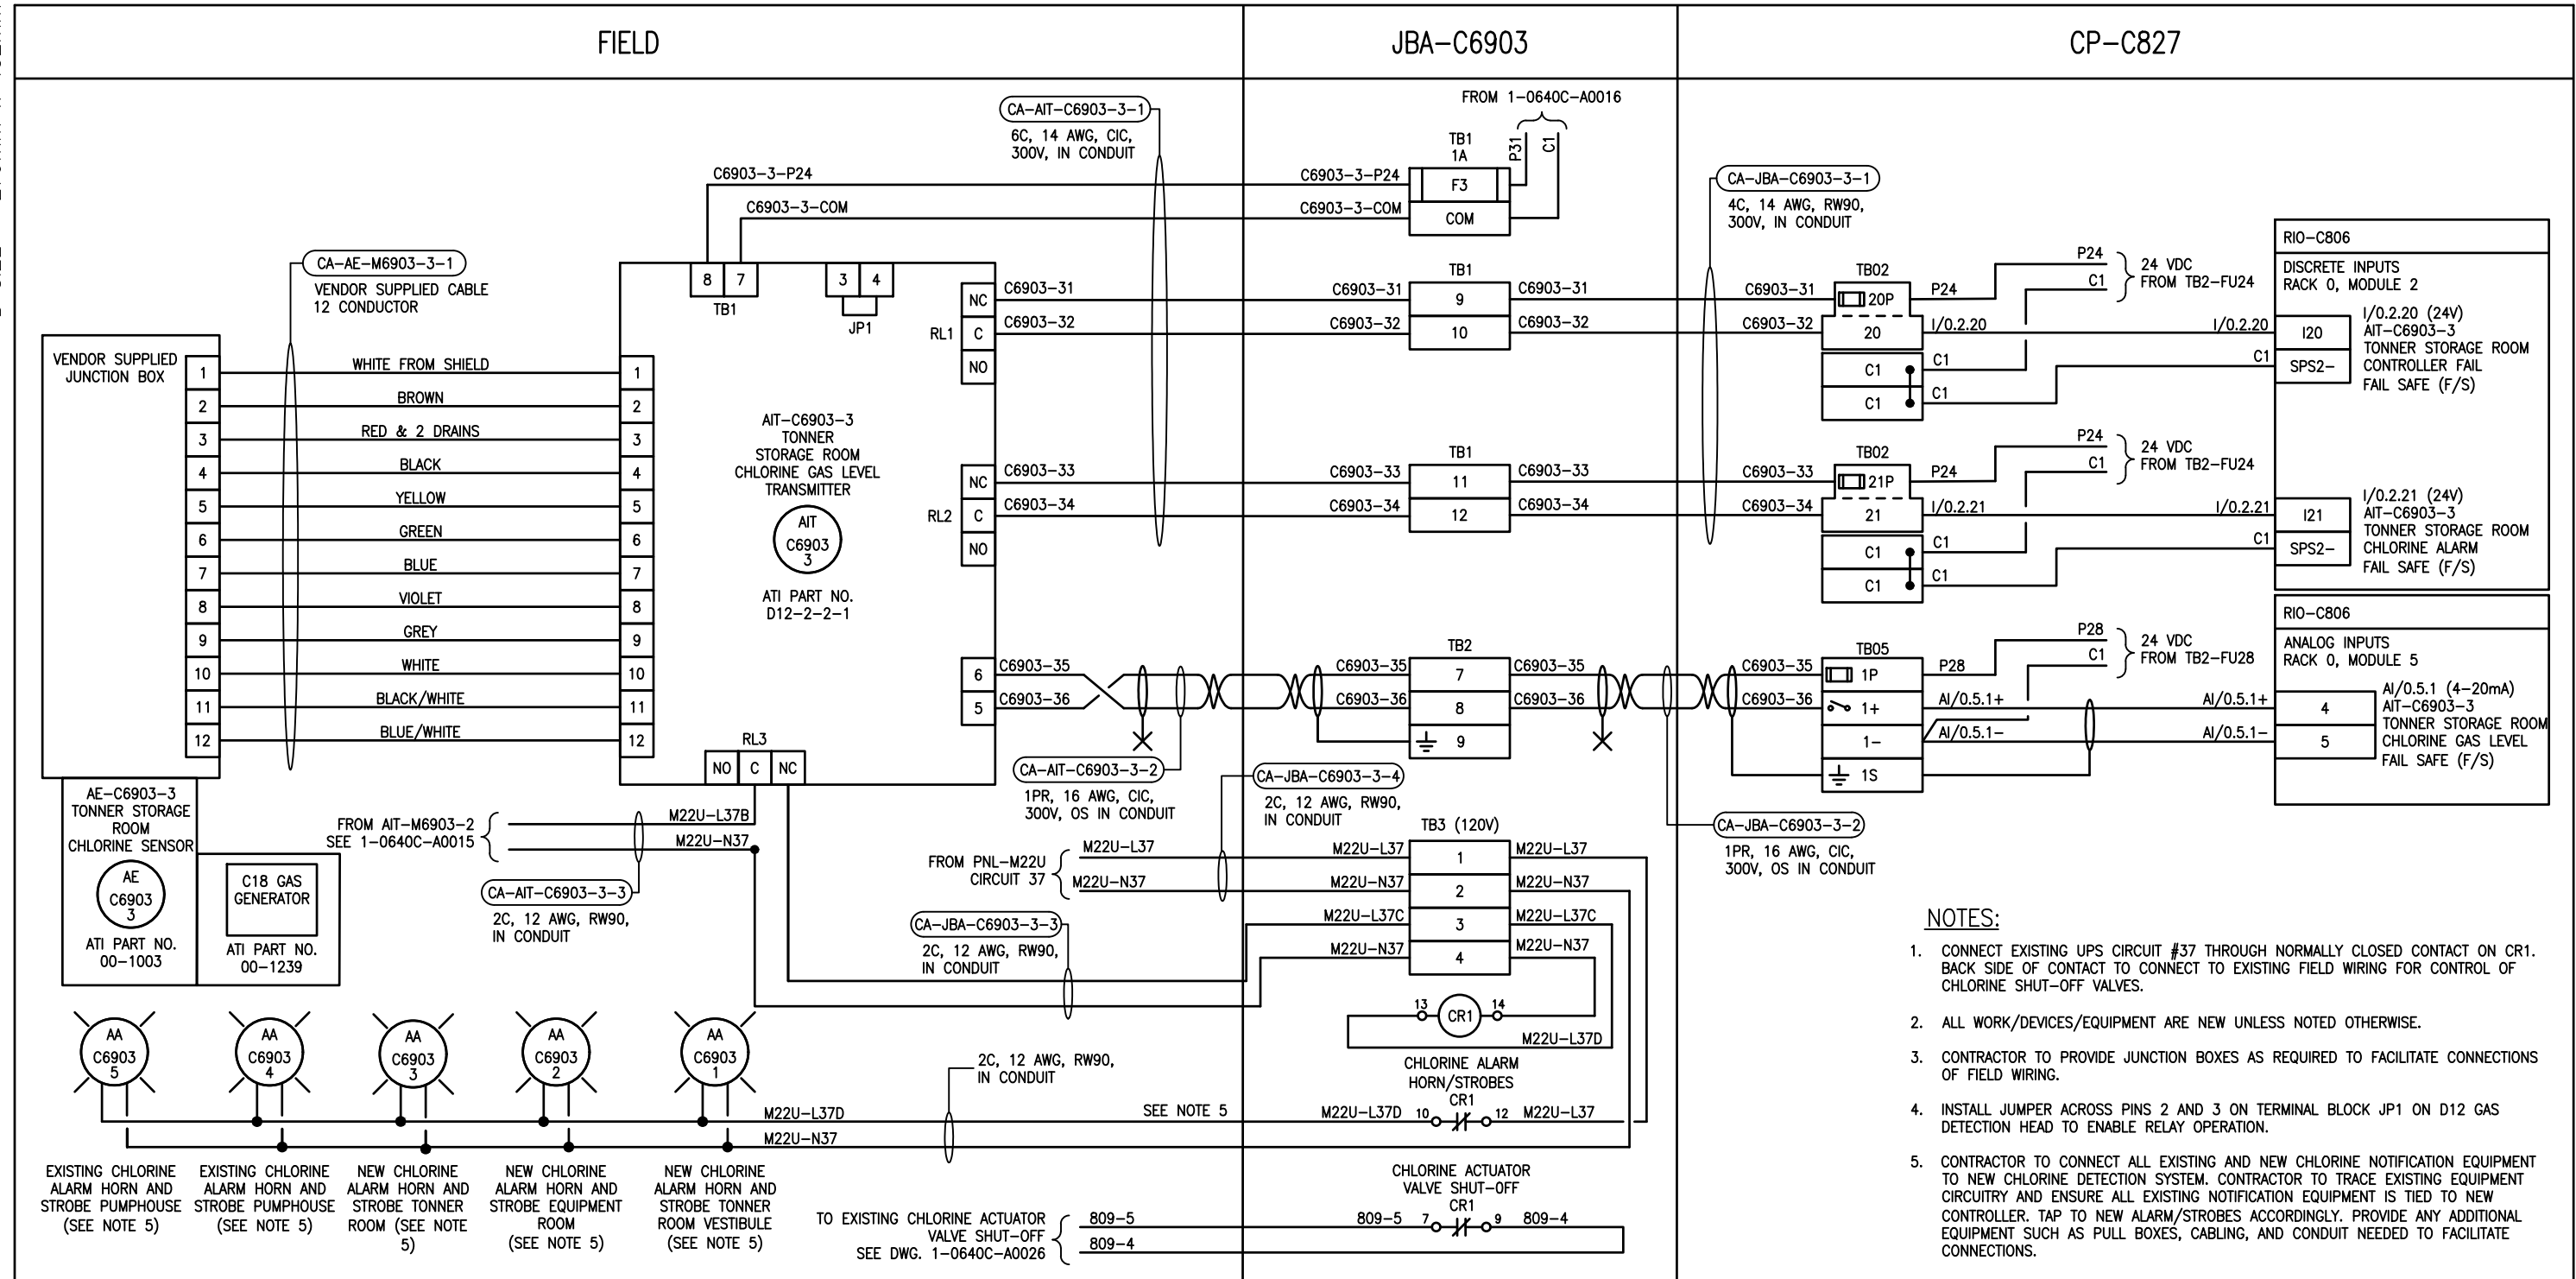

NOTES (CONTINUATION)

- REFER TO MANUFACTURER'S SHOP DRAWINGS FOR COMPLETE WIRING DETAILS. VERIFY ALL WIRING DETAILS WITH MANUFACTURER.
- ELECTRICAL CONTRACTOR TO PROVIDE ANY ADDITIONAL DEVICES NEEDED TO COMPLETE SYSTEM DESIGN.
- CHLORINE CONTROLLER TO ISSUE AN ALARM AT 1PPM.
- CONTRACTOR TO CALIBRATE DEVICE. DEVICE IS 0-200PPM. CALIBRATE DEVICE ON SITE TO 0-50PPM

ASSOCIATED REFERENCE DRAWINGS:

ASSOCIATED REFERENCE DRAWINGS:
1-0640C-E0015
1-0640C-A0005
1-0640C-A0008



148 Nature Park Way
Winnipeg, Manitoba Canada R3P 0X7
204-786-8080

DESIGNED BY: B. WILKS	CHECKED BY: V. ELIMBAN
DRAWN BY: B. WILKS	APPROVED BY: V. ELIMBAN
SCALE: N.T.S.	DATE: 2023/06/23
ISSUED FOR CONSTRUCTION	
BY: M. SKINNER	DATE: 2025/04/30
CONSULTANT NO.:	

NO.	REVISIONS	DATE	DESIGN	CHECK
00	ISSUED FOR TENDER AND CONSTRUCTION	2025/04/30	VE	VE

ENGINEER'S SEAL



THE CITY OF WINNIPEG
WATER AND WASTE DEPARTMENT

MCPHILLIPS PUMPING STATION
CHLORINE SYSTEM UPGRADES
LOOP DIAGRAM
CHLORINE DETECTION
AIT-C6903-3

CITY DRAWING NUMBER	SHEET	REV.	SIZE
1-0640C-A0017	001	00	B