


B SIZE - 279mm x 432mm

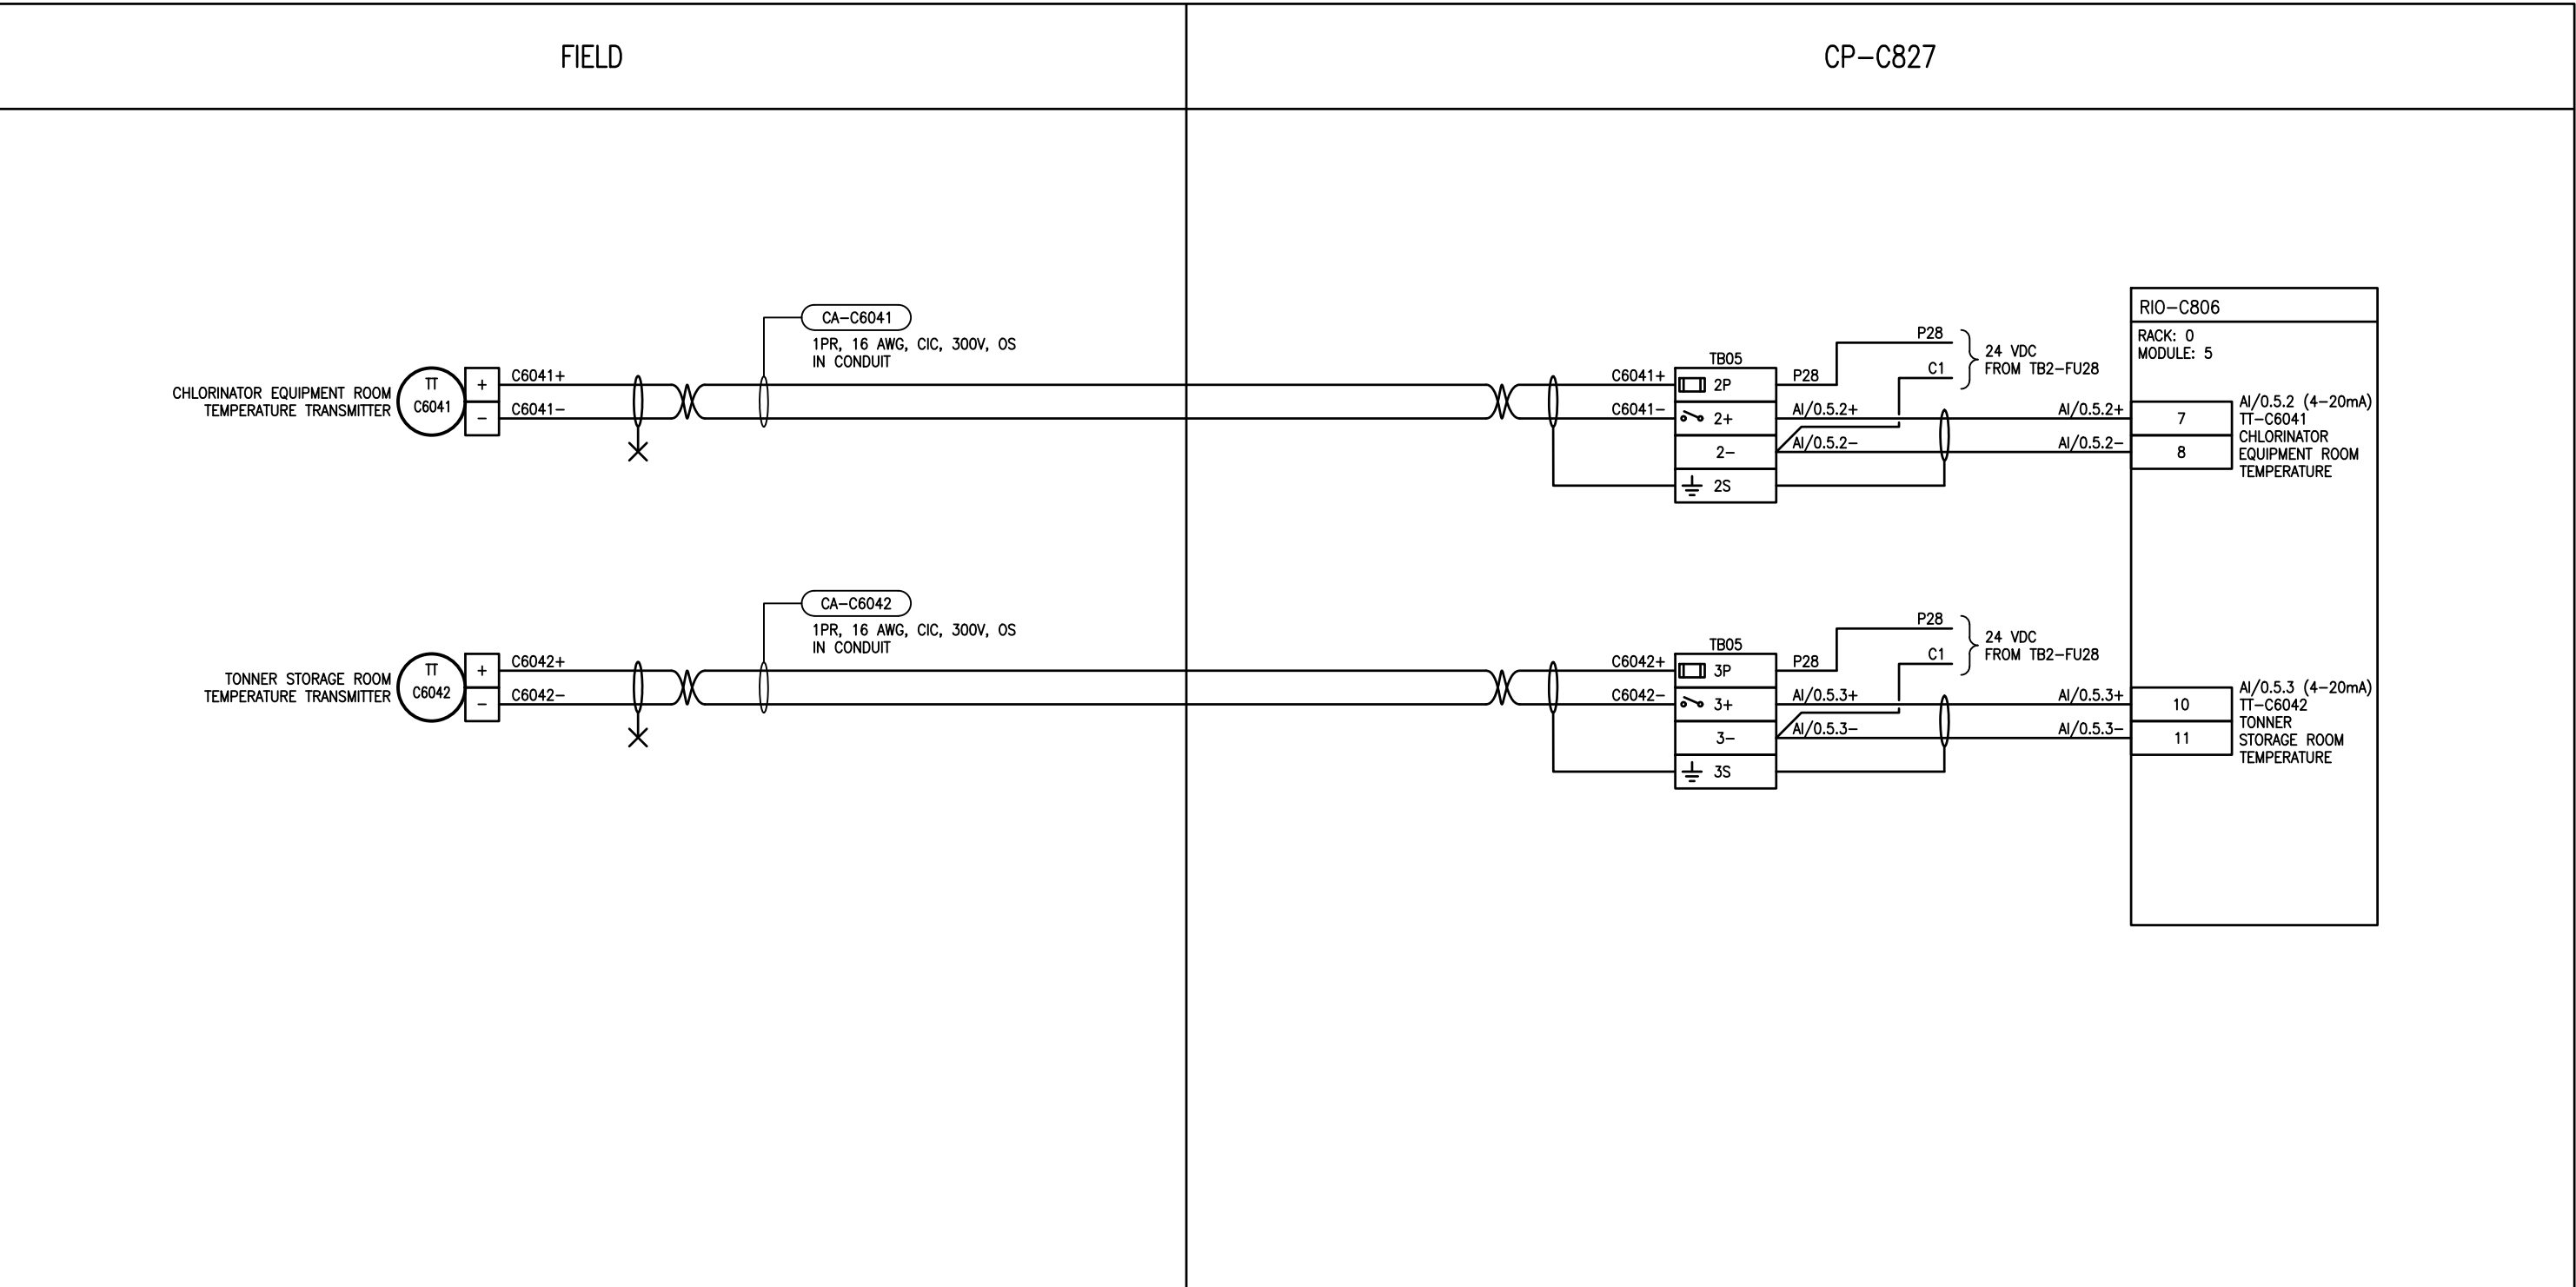

NOTES

1.

GROUNDING TERMINALS CONNECTED TO ISOLATED GROUND THROUGH DIN RAIL.
2.

CONTRACTOR RESPONSIBLE TO CALIBRATE DEVICE. 4-20mA SIGNAL SHALL EQUATE TO 0-100°C ON TEMPERATURE TRANSMITTER
3.

TEMPERATURE TRANSMITTER TO BE NEMA 4X RATED

ASSOCIATED REFERENCE DRAWINGS:
1-0640C-E0015
1-0640C-A0008



148 Nature Park Way
Winnipeg, Manitoba Canada R3P 0X7
204-786-8080

DESIGNED BY:	CHECKED BY:
J. GRAGASIN	V. ELIMBAN
DRAWN BY:	APPROVED BY:
J. GRAGASIN	V. ELIMBAN
SCALE:	DATE:
NTS	2023/06/23
ISSUED FOR CONSTRUCTION	
BY:	DATE:
M. SKINNER	2025/04/30
CONSULTANT NO.:	

00	ISSUED FOR TENDER AND CONSTRUCTION	2025/04/30	VE	VE
NO.	REVISIONS	DATE	DESIGN	CHECK

ENGINEER'S SEAL



THE CITY OF WINNIPEG
WATER AND WASTE DEPARTMENT

MCPHILLIPS PUMPING STATION
CHLORINE SYSTEM UPGRADE
LOOP DIAGRAM
TT-C6041 AND TT-C6042
TEMPERATURE TRANSMITTERS

CITY DRAWING NUMBER	SHEET	REV.	SIZE
1-0640C-A0018	001	00	B