


B SIZE – 279mm x 432mm

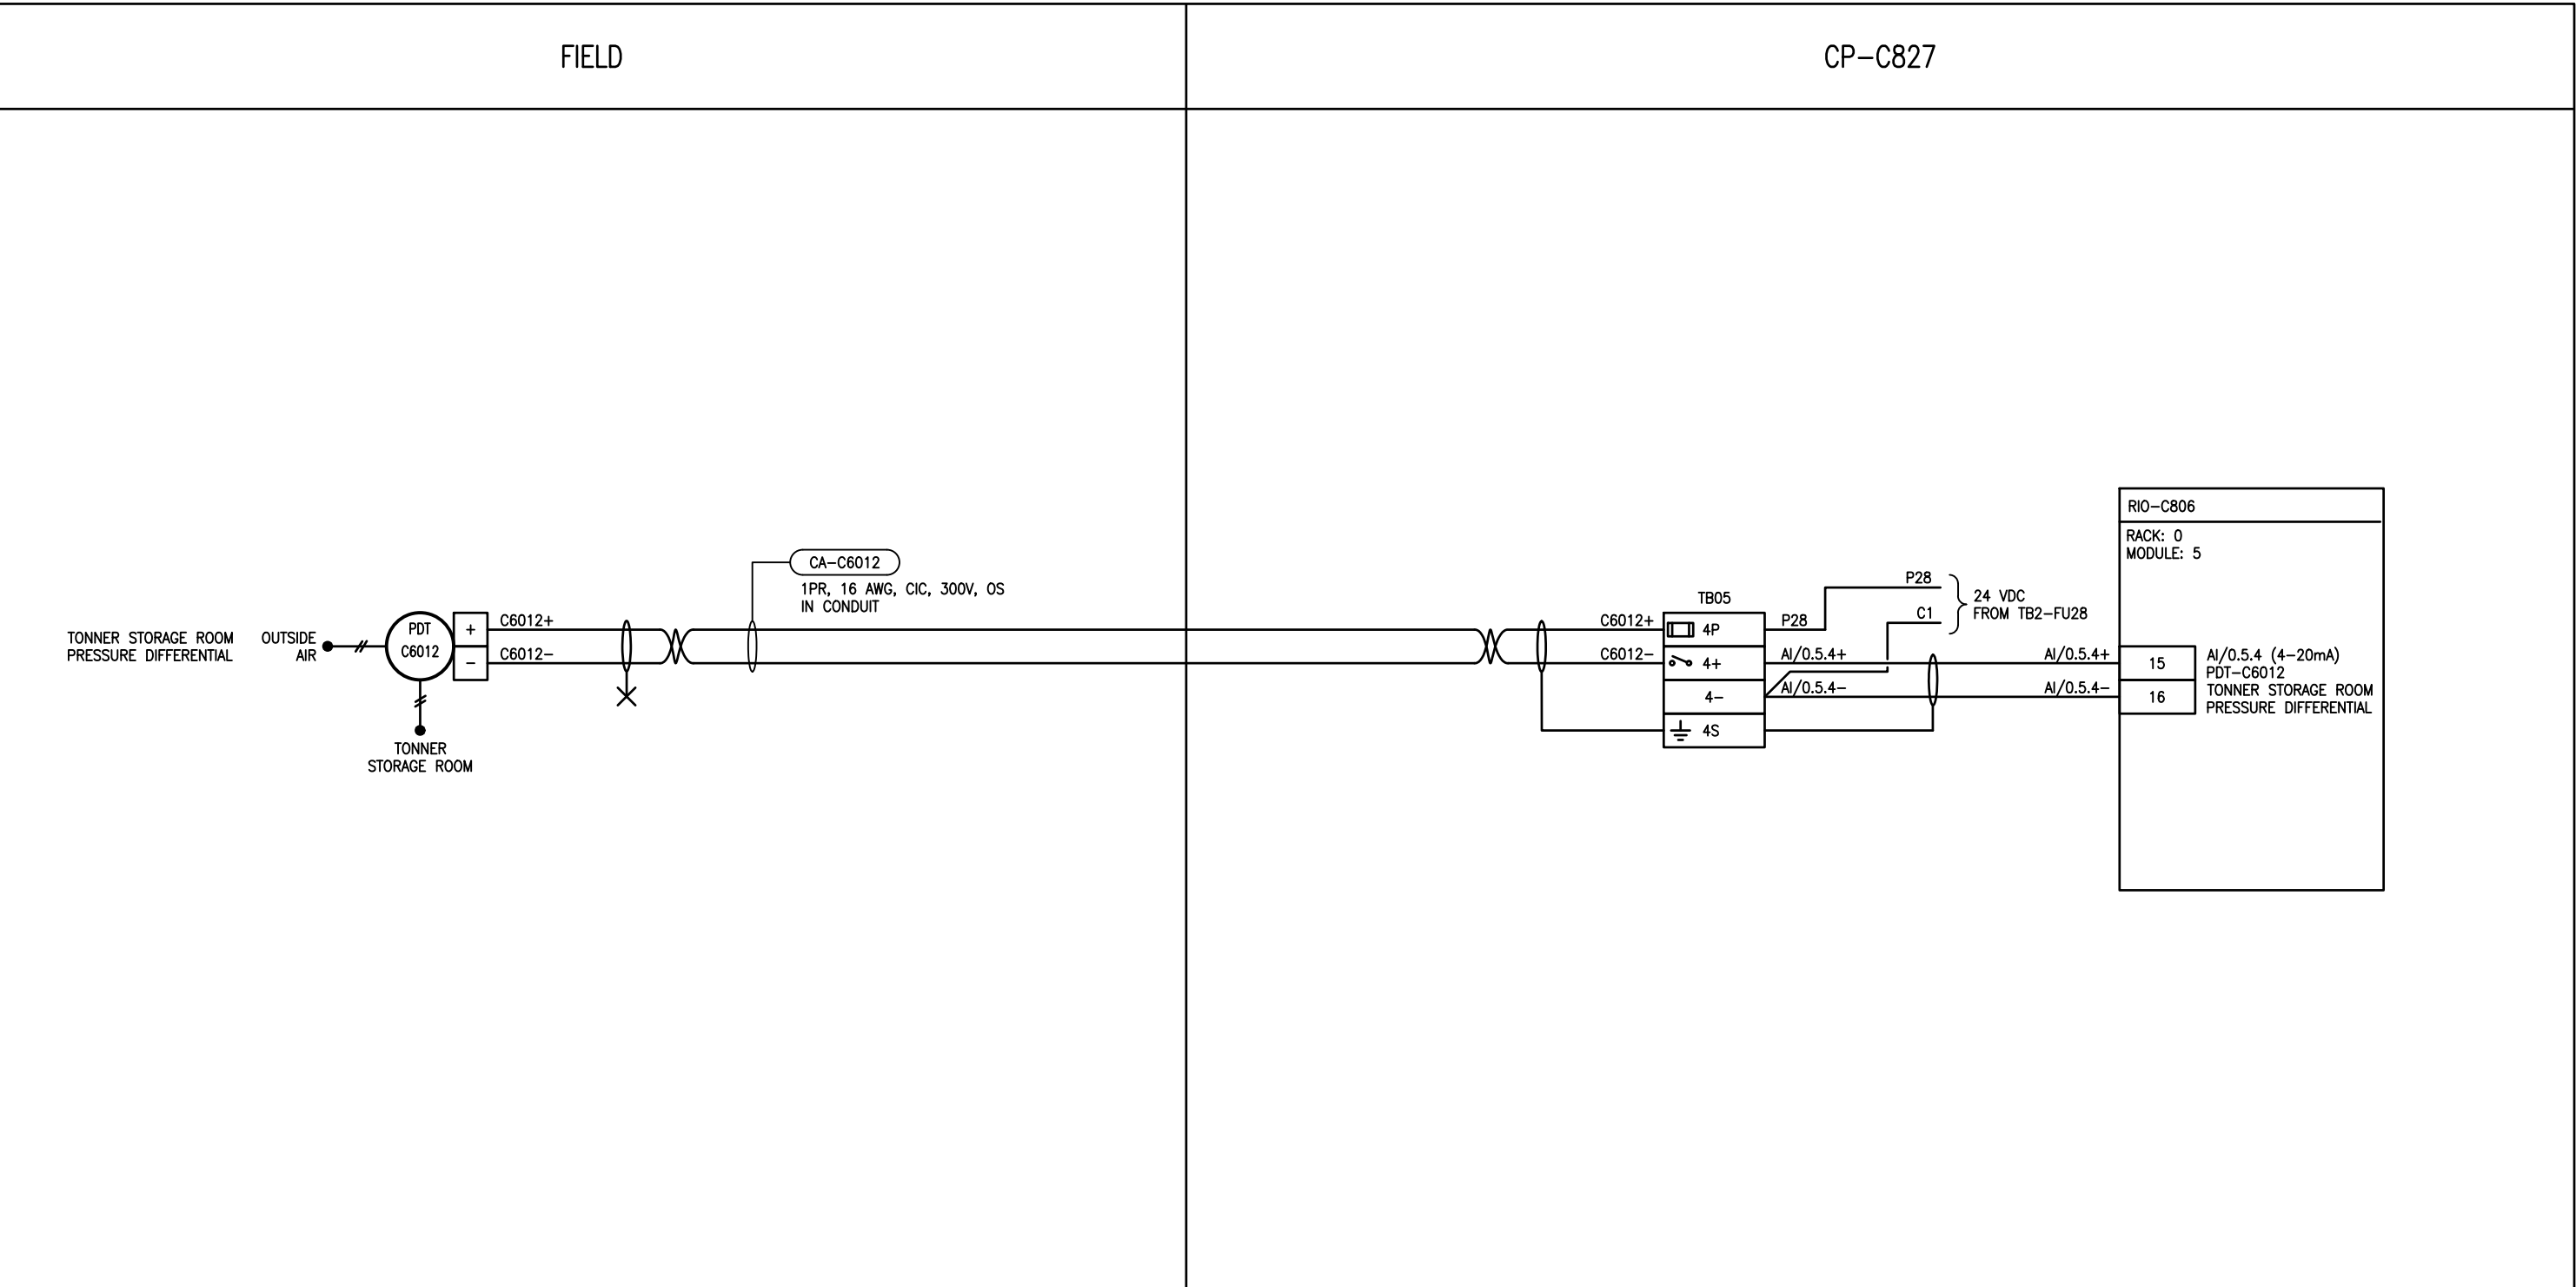

NOTES

1. CONTRACTOR RESPONSIBLE FOR CALIBRATING DEVICE. 4-20MA SIGNAL SHALL EQUATE TO -250PA-250PA.

2. DIFFERENTIAL PRESSURE TRANSMITTER SHALL BE NEMA 4X. RATED.

ASSOCIATED REFERENCE DRAWINGS:

1-0640C-E0015

1-0640C-A0008

ENGINEERS
GEOSCIENTISTS
MANITOBA

Certificate of Authorization

AtkinsRéalis Canada Inc.

No. 4489

AtkinsRéalis

148 Nature Park Way
Winnipeg, Manitoba Canada R3P 0X7
204-786-8080

ENGINEER'S SEAL

DESIGNED BY:
B. WILKS

CHECKED BY:
V. ELIMBAN

DRAWN BY:
B. WILKS

APPROVED BY:
V. ELIMBAN

SCALE:
NTS

DATE:
2023/06/23

ISSUED FOR CONSTRUCTION

BY:
M. SKINNER

DATE:
2025/04/30

CONSULTANT NO.:

THE CITY OF WINNIPEG

WATER AND WASTE DEPARTMENT

MCPHILLIPS PUMPING STATION

CHLORINE SYSTEM UPGRADES

LOOP DIAGRAM

PDT-C6012

TONNER STORAGE ROOM PRESSURE DIFFERENTIAL

CITY DRAWING NUMBER

1-0640C-A0019

SHEET

001

REV.

00

SIZE

B