


ADDRESS	SIZE (mm) MATERIAL (STREET)	SIZE (mm) MATERIAL (PROP.)	SHORT & LONG MEASUREMENT	CORP LOCATION	REMARK
155 ASHFORD DR RESIDENTIAL	20 PE	20 CU	3.96 LR 131.90 EEL NUTLEY	7.5 E OF HYD @ 158	RECONNECT SERVICE
158 ASHFORD DR RESIDENTIAL	20 PE	20 CU	4.26 LR 20.30 WWL ASHFORD	5.5 W OF HYD @ 158	RECONNECT SERVICE
159 ASHFORD DR RESIDENTIAL	20 PE	20 CU	1.82 LR 119.90 EEL NUTLEY	5.0 W OF HYD @ 158	RECONNECT SERVICE
162 ASHFORD DR RESIDENTIAL	20 PE	20 CU	2.74 LR 33.60 WWL ASHFORD	14.0 W OF HYD @ 158	RECONNECT SERVICE
163 ASHFORD DR RESIDENTIAL	20 PE	20 CU	1.52 EW 108.20 EEL NUTLEY	13.5 W OF HYD @ 158	RECONNECT SERVICE
166 ASHFORD DR RESIDENTIAL	20 PE	20 CU	2.89 LR 46.40 WWL ASHFORD	31.0 W OF HYD @ 158	RECONNECT SERVICE
167 ASHFORD DR RESIDENTIAL	20 PE	20 CU	0.91 LR 96.40 EEL NUTLEY	30.0 W OF HYD @ 158	RECONNECT SERVICE
170 ASHFORD DR RESIDENTIAL	20 PE	20 CU	36.57 W/HDYDRANT 58.50 WWL ASHFORD	43.2 W OF HYD @ 158	RECONNECT SERVICE
171 ASHFORD DR RESIDENTIAL	20 CU	20 CU	2.43 LR 85.90 EEL NUTLEY	0.5 N OF S/C	RECONNECT SERVICE
174 ASHFORD DR RESIDENTIAL	20 CU	20 CU	6.70 WEBL 7.10 WELL	47.5 E OF HYD @ 190	RECONNECT SERVICE
175 ASHFORD DR RESIDENTIAL	20 CU	20 CU	4.90 EWLL -	1.1 E OF S/C	RECONNECT SERVICE
178 ASHFORD DR RESIDENTIAL	20 CU	20 CU	1.70 WEBL 6.60 WELL	1.0 E OF S/C	RECONNECT SERVICE
179 ASHFORD DR RESIDENTIAL	20 CU	20 CU	5.80 EWBL 8.10 EWLL	48.0 E OF HYD @ 190	RECONNECT SERVICE
182 ASHFORD DR RESIDENTIAL	20 PE	20 CU	4.87 LR 98.20 WWL ASHFORD	22.0 E OF HYD @ 190	RECONNECT SERVICE
183 ASHFORD DR RESIDENTIAL	20 CU	20 CU	1.30 EWBL 5.40 EWLL	-	RECONNECT SERVICE
186 ASHFORD DR RESIDENTIAL	20 PE	20 CU	2.13 LR 111.70 WWL ASHFORD	9.0 E OF HYD @ 190	RECONNECT SERVICE
187 ASHFORD DR RESIDENTIAL	20 PE	20 CU	0.91 EWBL 41.20 EEL NUTLEY	22.5 E OF HYD @ 190	RECONNECT SERVICE
190 ASHFORD DR RESIDENTIAL	20 PE	20 CU	2.13 LR 123.80 WWL ASHFORD	4.0 W OF HYD @ 190	RECONNECT SERVICE

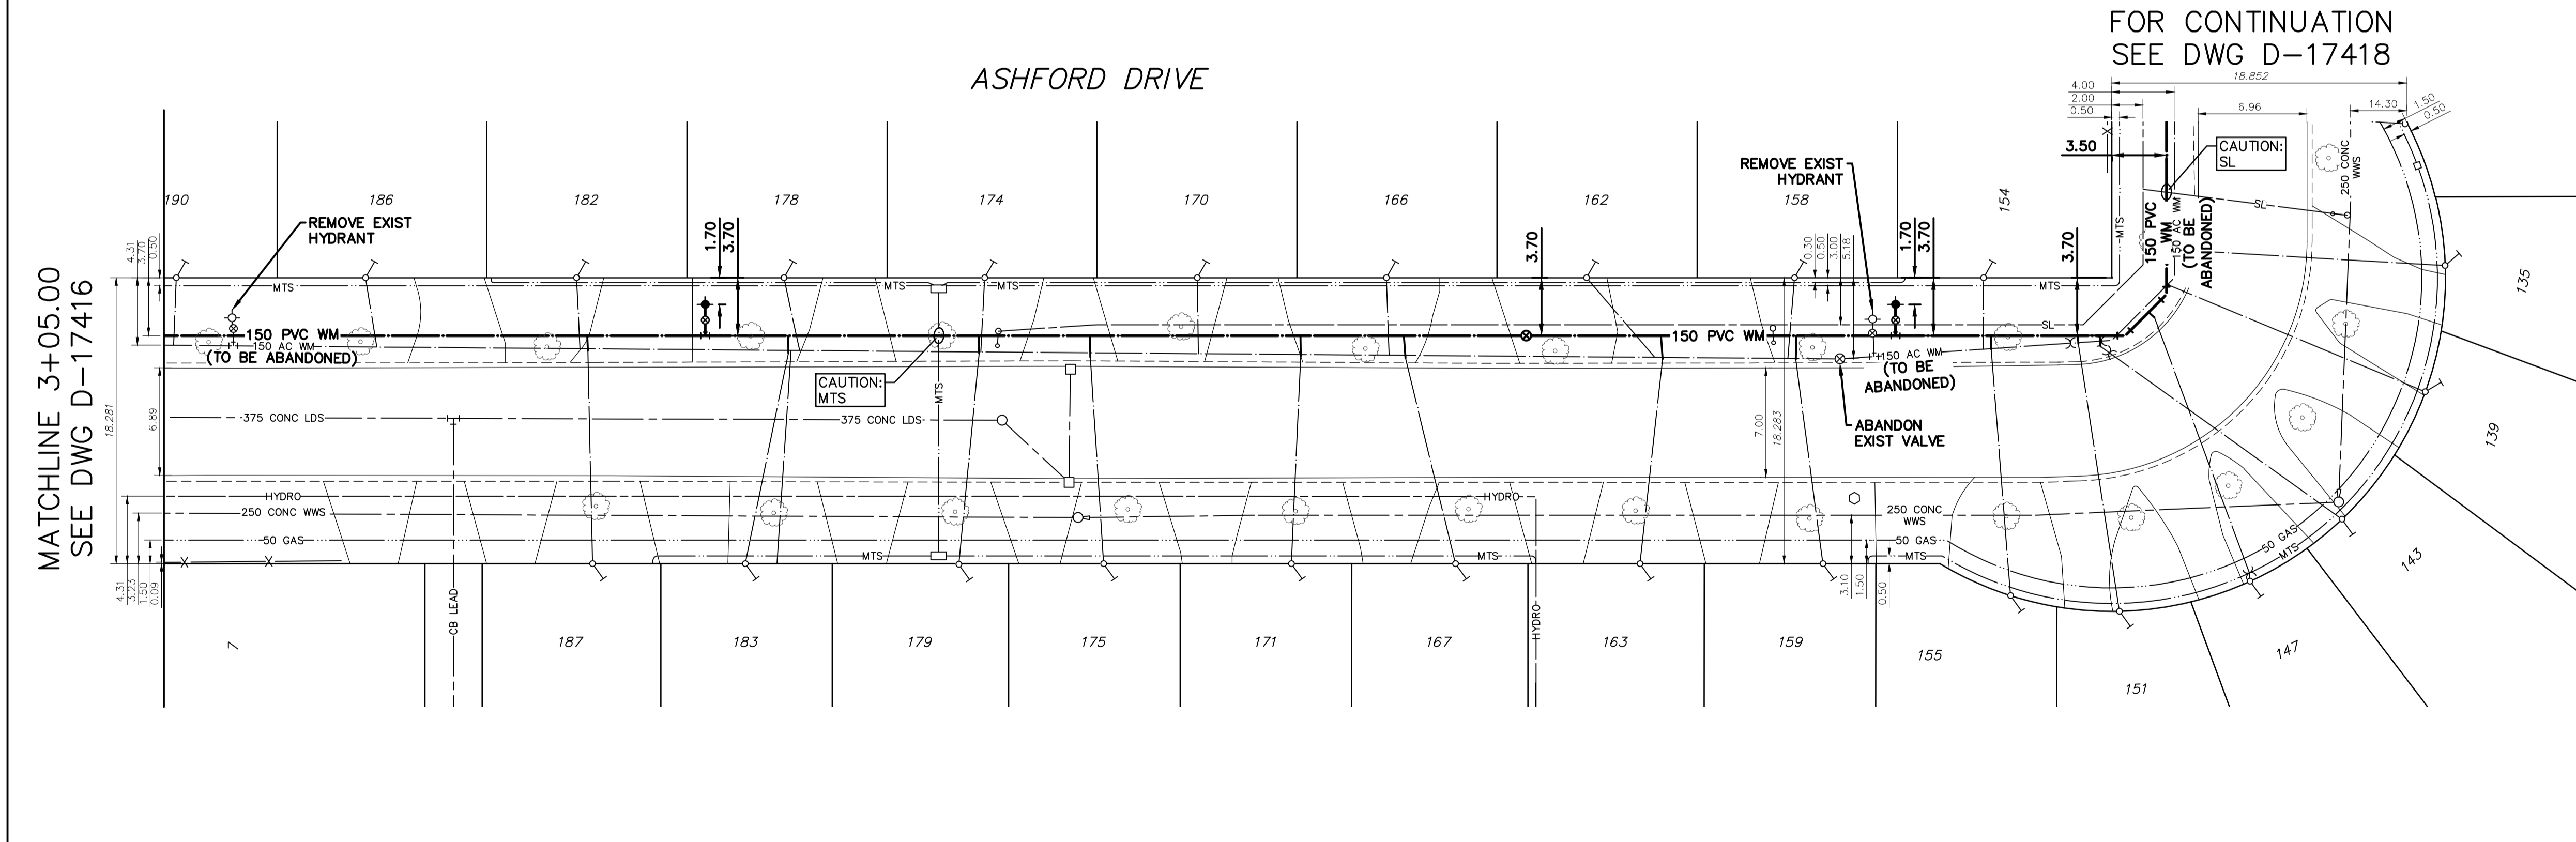

FOR CONTINUATION  
SEE DWG D-17418

NOTE: CHAINAGES SHOWN ARE ALONG N P/L OF ASHFORD DRIVE

NOTE: VALVES TO BE INSTALLED CLOCKWISE TO CLOSE

FOR INDEX SEE D-17414

**ENGINEERS GEOSCIENTISTS MANITOBA**  
Certificate of Authorization  
Stantec Consulting Ltd.  
No. 1301

METRIC  
WHOLE NUMBERS INDICATE MILLIMETRES  
DECIMALIZED NUMBERS INDICATE METRES

0.0 5.0 10.0 15.0 20.0 25.0

LOCATION APPROVED UNDERGROUND STRUCTURES		VERTICAL DATUM:	
SUPV. U/G STRUCTURES COMMITTEE		HORIZONTAL DATUM:	
DATE			
NOTE: LOCATION OF UNDERGROUND STRUCTURES AS SHOWN ARE BASED ON THE BEST INFORMATION AVAILABLE BUT NO GUARANTEE IS GIVEN THAT ALL EXISTING UTILITIES ARE SHOWN OR THAT THE GIVEN LOCATIONS ARE EXACT. CONFIRMATION OF EXISTENCE AND EXACT LOCATION OF ALL SERVICES MUST BE OBTAINED FROM THE INDIVIDUAL UTILITIES BEFORE PROCEEDING WITH CONSTRUCTION.			
NO.	ISSUED FOR TENDER	DATE	BY
00	ISSUED FOR TENDER	2026.03.16	RS
	REVISIONS	DATE	BY

**Stantec**

DESIGNED BY: RS  
CHECKED BY: RS

DRAWN BY: MR  
APPROVED BY: RS

SCALE:  
HORIZONTAL: 1:250  
VERTICAL: 1:50

DATE: 2026.01.21  
DATE: 2026.03.13

RELEASED FOR CONSTRUCTION  
S. COURNOYER

ENGINEER'S SEAL

CONSULTANT DRAWING NUMBER  
**C-203**

**THE CITY OF WINNIPEG**  
WATER AND WASTE DEPARTMENT  
ENGINEERING DIVISION

2026 WATER MAIN RENEWALS  
CONTRACT 2  
ASHFORD DRIVE  
15 E OF NUTLEY CIRCLE TO  
130 E OF NUTLEY CIRCLE

SHEET 5 OF 19  
CITY DRAWING NUMBER  
**D-17417**