



Thaler Stackjack SJ-37 & 38

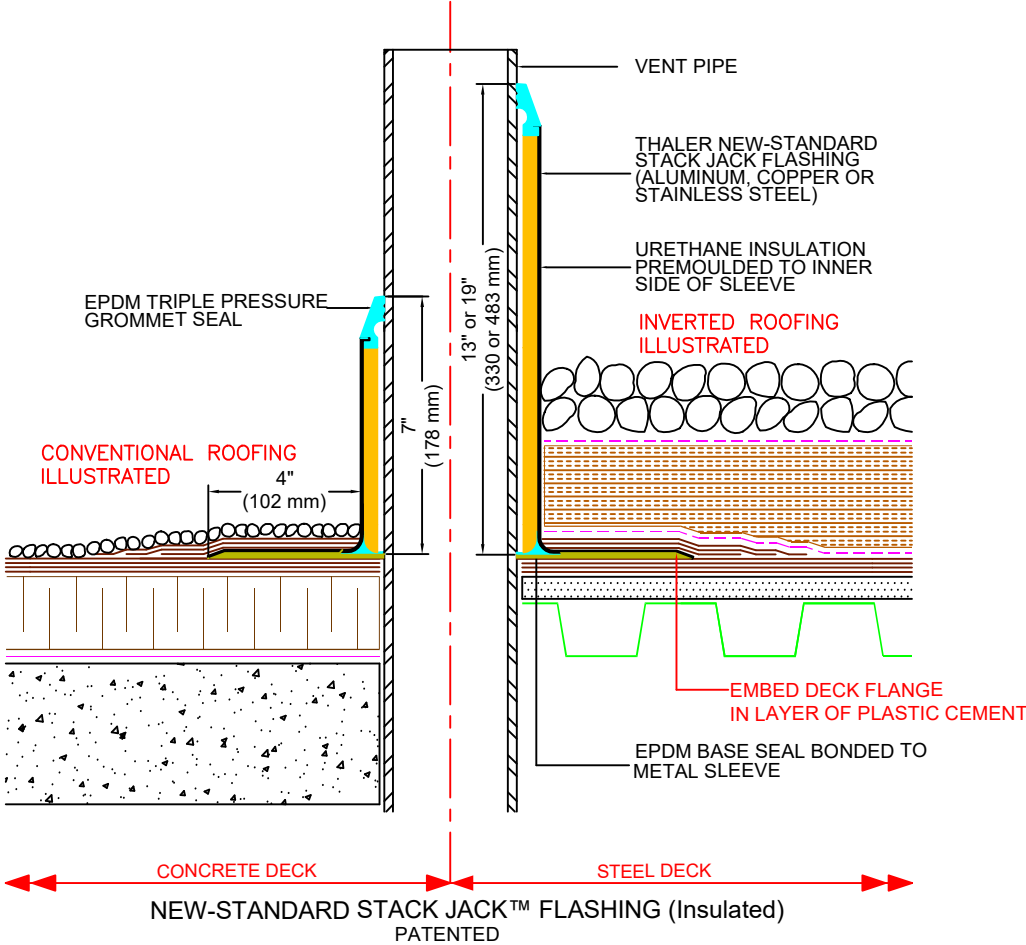

26 Gauge counter flashing complete with approx. 1/2" 45 degree bottom kick out is to be installed over all membrane stripping. Terminate flashing about 1" above top of new roofing. Do not install any fasteners behind the cap flashing and use only lap joints. This is to allow easy removal for future repairs.


A continuous 18 gauge galvanized cleat is to be installed to insure outside face of parapet cap flashing is firmly attached to outside face whenever outside face of flashing exceeds 3". No fasteners will be accepted on the outside face.

Curb Top Penetration

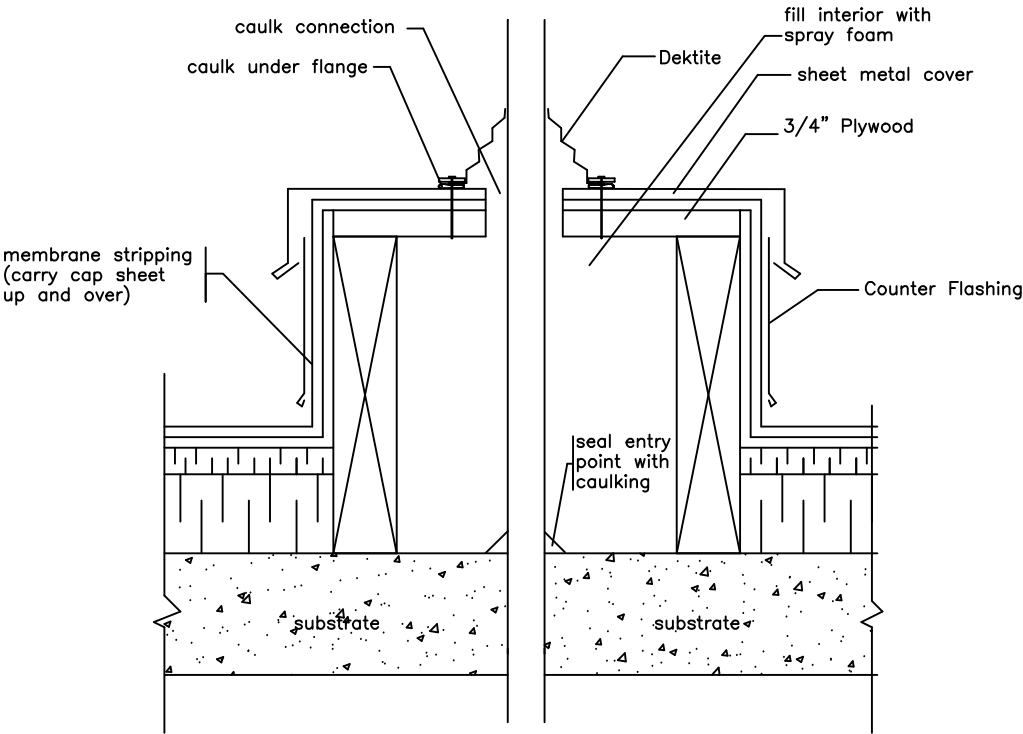

Note: Curb height is to be a minimum of 8" above new roofing. Vapor barrier is to be carried under curb and sealed to projection.

Drain Sump

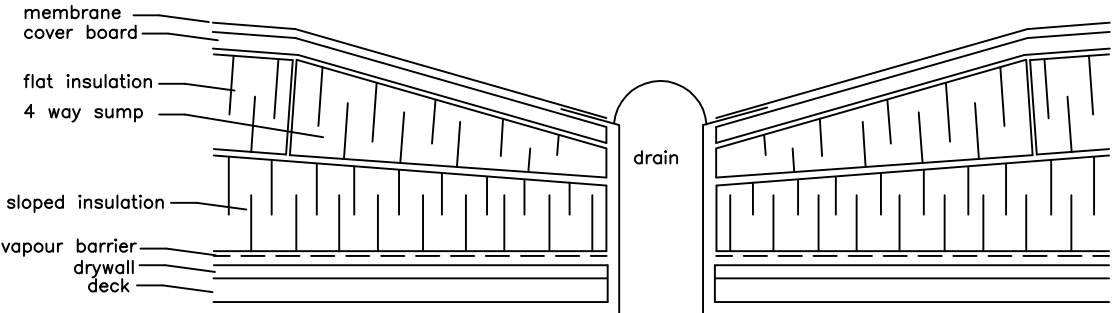

Agassiz Consulting Group Ltd.
Box 41, Warren, Manitoba R0C 3E0
Office Phone: (204) 383-5538

Project: **Public Works Building**
1155 Pacific
Winnipeg, MB

Date: **May 14, 2026**

Drawing No. **D-1**

File no: **5206-26**

Scale: **NTS**