


NOTES:

D	d
UP TO 1500	100 MINIMUM
1650 AND UP	150 MINIMUM

Bd = MAXIMUM TRENCH WIDTH FROM UNDERSIDE OF BEDDING OR FOUNDATION TO 600 MILLIMETRES ABOVE TOP OF PIPE
 = GREATER OF 1200 MILLIMETRES OR PIPE OD + 750 MILLIMETRES

**CLASS A BEDDING
(CONCRETE PIPE ONLY)**

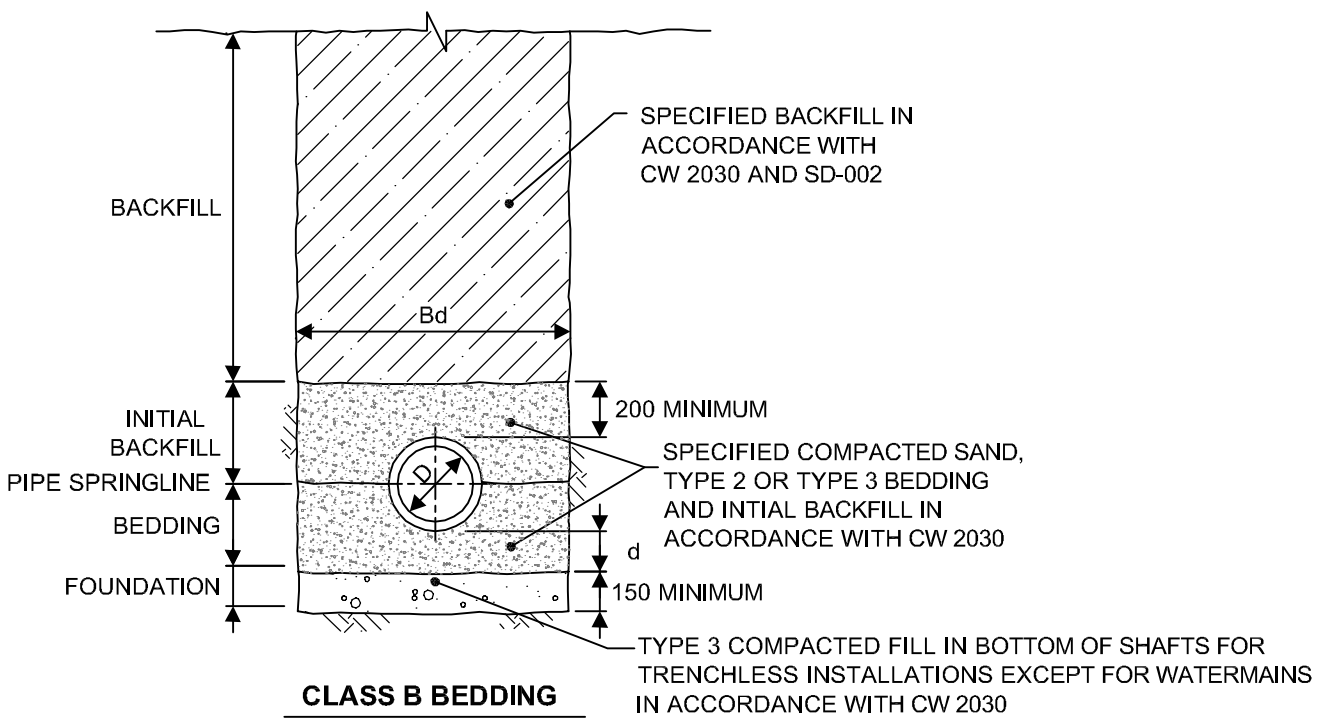

CLASS B BEDDING

DIMENSIONS IN MILLIMETERS

 **THE CITY OF WINNIPEG**
WATER & WASTE DEPARTMENT

Reference Spec. No.
 CW 2030 CW 2160

STANDARD PIPE
 BEDDING CLASSES

Designed By:
 TW

Checked By:
 TW

Approved:
 UNDERGROUND WORKS COMMITTEE

Drawn By:
 BH

Date: 07-03-01
 Revision: 2

Scale:
 N.T.S.

Drawing No.
 SD-001