


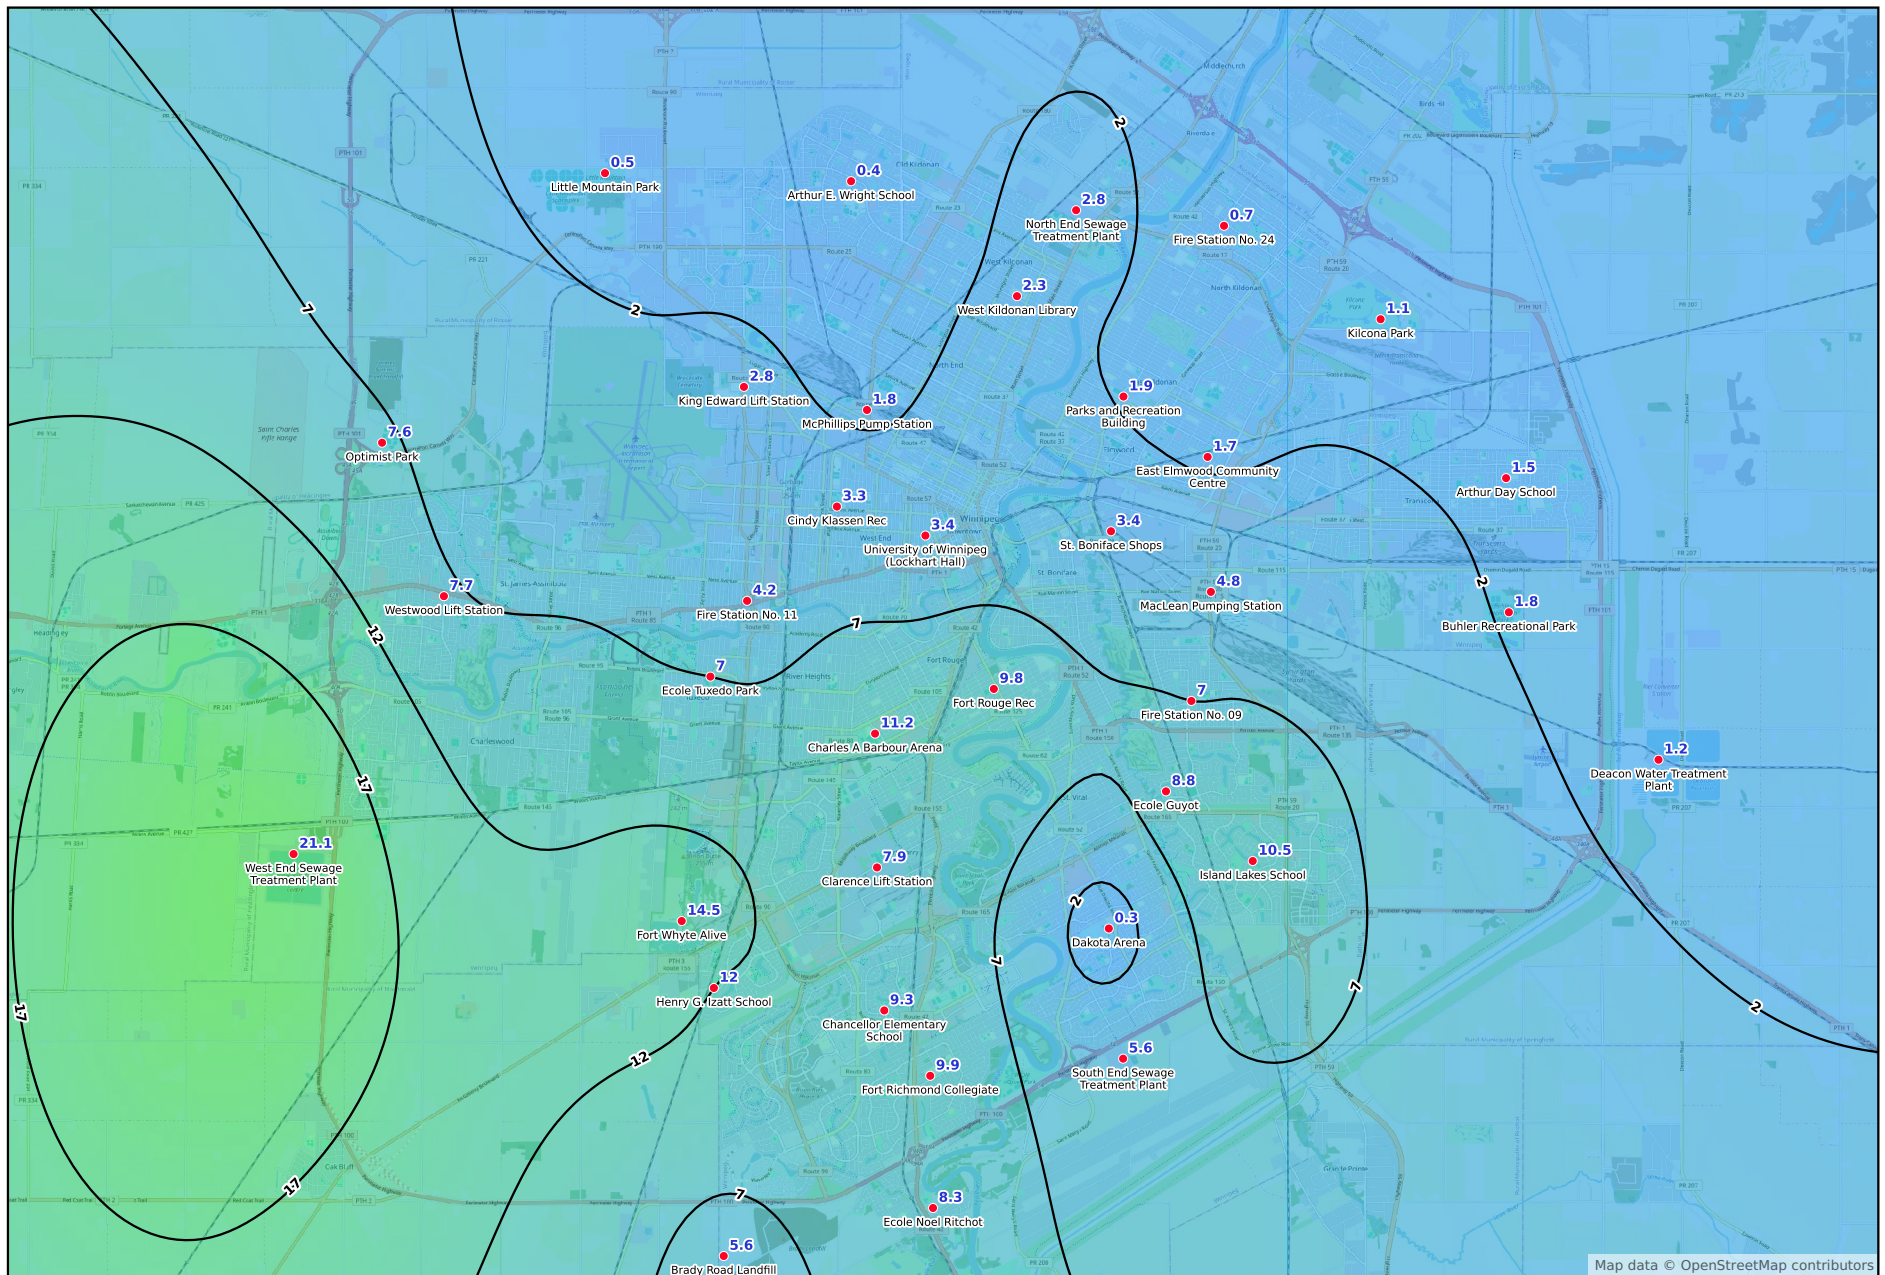

● Rainfall Gauge Station —8— Isohyetal Line (mm) Accumulation Gradient (mm) <table border="1"> <tr> <td>0.0</td><td>13</td><td>25</td><td>38</td><td>50</td><td>63</td><td>75</td><td>88</td><td>100</td> </tr> </table>	0.0	13	25	38	50	63	75	88	100	Accumulation (mm) Low 0.3 High 21.1 ALL MEASUREMENTS ARE METRIC IT IS HEREBY EXPRESSLY UNDERSTOOD that any calculation, or information provided to the private property owners, their agents and contractors with respect to the information provided shall be accepted by such persons at their own risk, and the CITY shall assume no responsibility for the information contained therein. The records of the CITY will be supplied on the basis that they are the best knowledge of the CITY and that persons requesting such information must interpret the same for their own needs and/or requirements.	 THE CITY OF WINNIPEG	Water and Waste Department Thursday, July 30, 2026 Rainfall Accumulation with Isohyetal for: 2026-07-29 22:45 to 2026-07-30 01:15
0.0	13	25	38	50	63	75	88	100				