
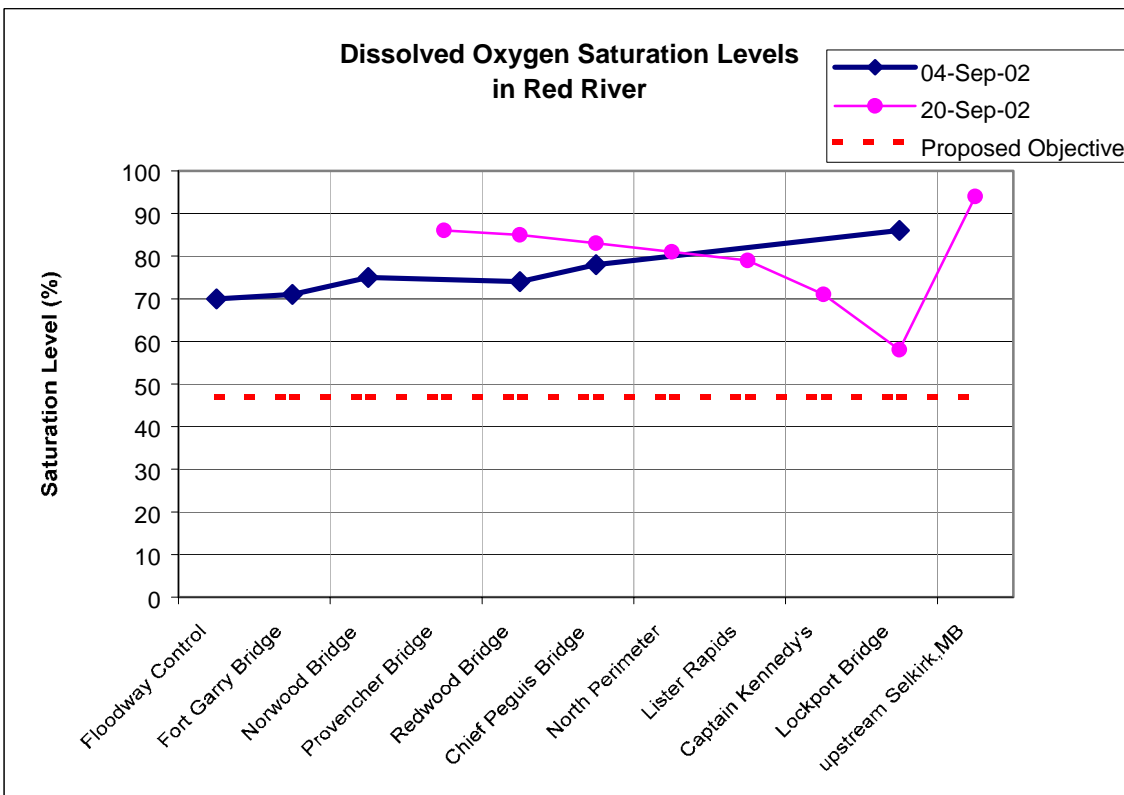


Red River Water Quality NEWPCC Shutdown, September 16 - 19, 2002

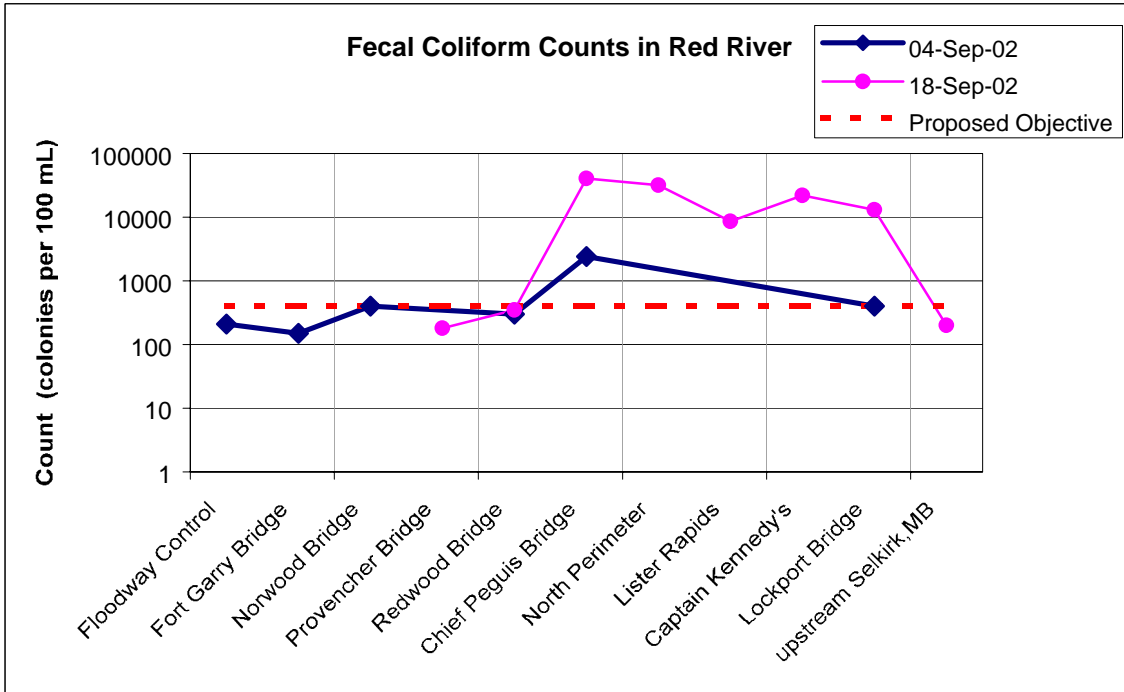

- September 4 Represents the last regularly scheduled river water quality test results before the plant shut down.
- September 18 Represents the highest fecal coliform count as a result of the plant shut down.
- September 20 Represents the lowest dissolved oxygen value as a result of the plant shut down.