Appendix A

- RTCR Review

A1 Summary of Recommendations

Appendix A.1 - Summary of Recommendations

Recommendation	Corrective Action	Timeline for Completion
General		
Periodic reviews of the entire water system should be considered.	An annual review focussing on system water quality vulnerability is recommended. This review should be performed by City staff involving a cross-section of appropriate employees most familiar with the processes as performed in the field, along with managers and supervisors.	Annual
Operations and Maintenance (O&M) and Standard Operating Procedures (SOP)		
The City's operational procedures generally follow good industry practice.	Periodic evaluation of the water system SOPs must be continually conducted in order to reflect current standards and best practices.	Annual
Periodic evaluation of operation and maintenance records that could be associated with a water system vulnerability.	Assessment of hydrant operation and repair activities.	Annual
	Assessment of feedermain/watermain maintenance and repair activities.	Annual
	Assessment of environmental conditions (e.g. extreme temperatures, significant precipitation, high river levels).	As required
	Assessment of air relief valve and valve pit conditions.	Annual
	Assessment of reservoir access, operation and water levels.	Annual
	Assessment of distribution pressure monitoring and control.	Annual
	Assessment of high risk cross connections.	Annual
	Assessment of general security of water system assets.	Annual
Facility Vulnerability Assessments		
[redacted]	[redacted]	Sept 1, 2015
		Sept 1, 2015
		Dec 31, 2015
		Sept 1, 2015
		May 1, 2016
Water Sampling Locations		
A periodic review of vulnerabilities to the sampling points could be considered to ensure changes to plumbing are not affecting tested water quality. Such a review could be conducted as part of an annual assessment, and would likely require its own Standard Operating Procedure. The following sampling conditions should be	Check for (and replace as needed) sampling taps that don't meet recommended characteristics, such as taps with non-removable aerators, swivel handles, and point-of-use attachments.	Sept 1, 2015
	Check for (and replace as needed) sampling taps on plumbing lines that do not contain backflow preventers or any form of service isolation.	Sept 1, 2015

Recommendation	Corrective Action	Timeline for Completion
avoided or remedied where possible:	Check for (and replace as needed) sampling taps on plumbing lines that contain backflow preventers that are non-inspectable and/or are not regularly inspected.	Sept 1, 2015
	Check for (and replace as needed) sampling tap on plumbing lines that contain in-line filters will no associated maintenance records and/or contain dormant piping.	Sept 1, 2015
	Check for (and replace as needed) sampling locations with conflicting uses, such as bathrooms and custodial closets.	Sept 1, 2015
	Check for (and replace as needed) sample bottles that are not kept in a sanitary environment.	Sept 1, 2015
	Check for (and replace as needed) the use of backflow preventers, including air-gap preventers that are not regularly monitored/ tested.	Sept 1, 2015
	Check for (and replace as needed) sampling points located in areas such as bathrooms, where a potential for bacterial cross-contamination with fecal coliform bacteria is greater than it needs to be.	Sept 1, 2015
	Check for (and replace as needed) sampling locations that are located far from the service connection within a given establishment.	Sept 1, 2015
The recorded time increment between sample collections on January 26, 2015 appeared to be inconsistent for some locations, given travel time between locations and flushing times required prior to sampling. Labelling of water samples should be conducted in a manner such that they are reflective of the time and location samples.	Given the time constraints that may be placed on operations staff, automated labelling/timestamps may be used to provide more accurate data. SOP should be revised.	Sept 1, 2015
Water sample volume required for each sampling location should be identified and noted on a collection sheet.	Water flushing prior to sample collection can be conducted using water volume flushed or by time of flushing. Parameters such as temperature can be used to inform appropriate flushing volumes/times.	Sept 1, 2015
Review of proper sampling protocols should be periodically conducted with operations staff to reduce the chance of operator error.	Conduct periodic reviews with a set timeline. Such reviews would need to include backup staff as well.	Annual
City Quality Control Procedures		
An evaluation of the City's quality control (QC) process may be conducted to improve sample collection, start to finish. This may include:	Receipt and storage of sample bottles away from potential contaminant sources.	Sept 1, 2015
	Assigning an order or analysis of water samples (cleanest to dirtiest) and scheduling field samples.	Sept 1, 2015
	Documentation of sampling and analytical processes as they are currently being performed.	Sept 1, 2015

Recommendation	Corrective Action	Timeline for Completion
	Development of a rigorous sample collection protocol (including flushing time and temperature, order of field analysis, handling the lid, documentation).	Sept 1, 2015
	At a minimum, annual updates and reviews of sampling and analytical processes, focusing on deviations from established procedures, changes in procedures, and new or previously undiscovered vulnerabilities.	Annual
	Consideration for collecting/analyzing samples more days of the week (e.g. 4 days with 10 samples per day would likely be better/more protective than one day with 40 samples), and at key points from source into the distribution system daily. The sampling schedule would require amendment of to the Water Treatment Plant Operating Licence.	Dec 31, 2015
	Re-evaluation of sample locations (representative of distribution system, cleanliness, availability for recheck). Consideration may be given to using City facilities as sample collection points.	Sept 1, 2015
	Disinfection of sample taps; consider the best method for sample tap being used (dip-disinfection may be better for taps with aerators on, swab/spray may be better for aerators off).	Sept 1, 2015
	Defining transit protocols for water samples (e.g. types of coolers, types of vehicles, time of day for sampling).	Sept 1, 2015
	Defining storage protocols for water samples (e.g. types of coolers, plus anomalies for overnight storage prior to analysis).	Sept 1, 2015
Development of an in-house general testing facility within the City's facilities. Most bacteriological samples are negative, and QuantiTray at contract lab provides quantification of any positive samples. The City should consider setting up a QC activity that initially involves presence/absence (P/A) testing of some or all bacteriological samples. This would not need to be certified (bacteriological samples come from contract lab), but should be operated according to certification standards to the extent possible.	Requirements are modest: approximately 4 feet of clean countertop for 30 minutes per day, analyst time less approximately 30 minutes per day, in a relatively clean room (sterility not required, but limited airborne dust and clean conditions are important).	May 1, 2016, for completion of business case
	Non-regulatory testing could be moved to this facility.	May 1, 2016, for completion of business case
External Laboratory Procedures		
Working with the third party analytical laboratory conducting water quality testing may aid in reducing possibility of contamination. This may include:	Modifying sample receipt procedures; perhaps isolating bacteriological samples from all others.	Sept 1, 2015
	Sample labeling, documentation and order of analysis, including technique used in sample prep for analysis and Chain-of-Custody sign-off between analysis (such as decant vs pour-off).	Sept 1, 2015

Recommendation	Corrective Action	Timeline for Completion
	Improved volume adjustment protocol (consider combining volume adjustment with the HPC prep step, using sterile 10 mL pipette to bring volume down to 100 mL, and using this same extracted volume for the HPC plate (1 mL HPC volume recommended over 0.1 mL). This reduces the number of times the sample bottle is opened after sampling from 3 to 2, reduces the number of steps in TC prep from 2 to 1 requires no additional apparatus (only a fresh sterile disposable pipette is used for HPC extraction and volume adjustment).	Sept 1, 2015
	Pour-off volume adjustment for TC analysis is not recommended, as this step can increase potential for contamination from sink splash.	Sept 1, 2015
	Consider increasing sample volume for HPC to 1 mL (currently set at 0.1 mL).	Sept 1, 2015

A2 Facilities Review Sheets (RTCR Guidance Forms)

City of Winnipeg Revised Total Coliform Rule Level 2 Assessment Form

System Name: **City of Winnipeg Public Water System**	Source Water: **Shoal Lake**
System Type: **Public Water System**	Population Served (in 2013): **699,346**
City, Province: **Winnipeg, Manitoba**	
Country: **Canada**	
Assessment Submission Final Report Due Date: April **30, 2015**	

	Questions	Reviewed? (Check if completed or type N/A)	Reviewer	Issue(s) Found? (Yes/No)	Issue Description	Corrective Action Taken (Including Date)
1	**EVALUATE SAMPLE SITE - NE-01** *Completed by COW Cross Connections/BFP Inspector - MZ & AK and Analytical Services Laboratory Technicians -*					
a.	What is the condition of the tap? (Provide comments)	Faucet is tight; aerator doesn't come off; taps don't leak.				
b.	What is the location of the tap? (Provide comments)					
c.	What is the regular use of the connection? (Provide comments)					
d.	Have there been any plumbing changes or construction? If yes, when and what was the repair or change?	✓	COW (MZ, AK, KW, AV)	No		
e.	Have there been any plumbing breaks or failure? If yes when?	✓	COW (MZ, AK KW AV)	No		
f.	List any identified cross connections after the service connection or in premise plumbing. (Provide comments)	Work order sent to install backflow preventer after the water meter; hose bibb tap at eye wash to be cut and capped.				
g.	Were all of the backflow prevention operational and maintained?	✓	COW (MZ, AK, KW, AV)	Yes		Work order was sent to owner on Feb. 3, 2015 to have all outstanding items corrected.
h.	Were there any low pressure events or changes in water pressure after the service connection or in the premise plumbing? If yes when?	✓	COW (MZ, AK, KW, AV)	No		
i.	Are there any treatment devices after the service connection or in premise? (Circle response, if applicable)	Point of Entry (POE)	COW (MZ, AK, KW, AV)	Point of Use (POU)		
j.	Other comments on sample site?					
2	**EVALUATE SAMPLE SITE - NE-06** Completed by COW Cross Connections/BFP Inspector - MZ & AK and Analytical Services Laboratory Technicians -					
a.	What is the condition of the tap? (Provide comments)	Aerator comes off; taps don't drip; faucet and taps are tight.				
b.	What is the location of the tap? (Provide comments)					
c.	What is the regular use of the connection? (Provide comments)					
d.	Have there been any plumbing changes or construction? If yes, when and what was the repair or change?	✓	COW (MZ, AK, KW, AV)	No	No plumbing changes in 7 months.	

City of Winnipeg Revised Total Coliform Rule Level 2 Assessment Form

	Questions	Reviewed? (Check if completed or type N/A)	Reviewer	Issue(s) Found? (Yes/No)	Issue Description	Corrective Action Taken (Including Date)
e.	Have there been any plumbing breaks or failure? If yes, when?	✓	COW (MZ, AK, KW, AV)	Yes	One clogged drain.	Drain has been unclogged. Issue was resolved on Jan.12, 2015.
f.	List any identified cross connections after the service connection or in premise plumbing. (Provide comments)	As of March 5/2015, based on all visual piping - none				
g.	Were all of the backflow prevention operational and maintained?	✓	COW (MZ, AK, KW, AV)	No	None on site as of Mar. 5, 2015.	No testable backflow prevention devices on site. Non required at this time (March 5, 2015). Non testable devices in place and visually OK.
h.	Were there any low pressure events or changes in water pressure after the service connection or in the premise plumbing? If yes when?	✓	COW (MZ, AK, KW, AV)	No		
i.	Are there any treatment devices after the service connection or in premise? (Circle response, if applicable)	Point of Entry (POE)	COW (MZ, AK, KW, AV)	Point of Use (POU)		
j.	Other comments on sample site?					
3	**EVALUATE SAMPLE SITE - NE-07** - Completed by COW Cross Connections/BFP Inspector - MZ & AK and Analytical Services Laboratory Technicians -					
a.	What is the condition of the tap? (Provide comments)	Taps don't drip; faucet is very loose; aerator doesn't come off.				
b.	What is the location of the tap? (Provide comments)					
c.	What is the regular use of the connection? (Provide comments)					
d.	Have there been any plumbing changes or construction? If yes, when and what was the repair or change?	✓	COW (MZ, AK, KW, AV)	No		
e.	Have there been any plumbing breaks or failure? If yes when?	✓	COW (MZ, AK KW AV)	No		
f.	List any identified cross connections after the service connection or in premise plumbing. (Provide comments)					
g.	Were all of the backflow prevention operational and maintained?	✓	COW (MZ, AK, KW, AV)	Yes	Refer to answer in 3. f).	Letter sent to owner on Feb. 2, 2015 to have backflow preventers tested. Work completed on Feb. 27, 2015.
h.	Were there any low pressure events or changes in water pressure after the service connection or in the premise plumbing? If yes when?	No				
i.	Are there any treatment devices after the service connection or in premise? (Circle response, if applicable)	Point of Entry (POE)	COW (MZ, AK, KW, AV)	Point of Use (POU)		
j.	Other comments on sample site?					
4	**EVALUATE SAMPLE SITE - SE-03** *- Completed by COW Cross Connections/BFP Inspector - MZ & AK and Analytical Services Laboratory Technicians -*					

City of Winnipeg Revised Total Coliform Rule Level 2 Assessment Form

	Questions	Reviewed? (Check if completed or type N/A)	Reviewer	Issue(s) Found? (Yes/No)	Issue Description	Corrective Action Taken (Including Date)
a.	What is the condition of the tap? (Provide comments)	Taps don't drip; faucet is tight.				
b.	What is the location of the tap? (Provide comments)					
c.	What is the regular use of the connection? (Provide comments)					
d.	Have there been any plumbing changes or construction? If yes, when and what was the repair or change?	✓	COW (MZ, AK, KW, AV)	No		
e.	Have there been any plumbing breaks or failure? If yes when?	✓	COW (MZ, AK KW AV)	Yes		Plumber was hired and fixed it.
f.	List any identified cross connections after the service connection or in premise plumbing. (Provide comments)					
g.	Were all of the backflow prevention operational and maintained?	✓	COW (MZ, AK, KW, AV)	No	Non testable devices look okay.	
h.	Were there any low pressure events or changes in water pressure after the service connection or in the premise plumbing? If yes when?	No				
i.	Are there any treatment devices after the service connection or in premise? (Circle response, if applicable)	Point of Entry (POE)	COW (MZ, AK, KW, AV)	Point of Use (POU)	.	
j.	Other comments on sample site?					
5	**EVALUATE SAMPLE SITE - SE-04**	*Completed by COW Cross Connections/BFP Inspector - MZ & AK and Analytical Services Laboratory Technicians*				
a.	What is the condition of the tap? (Provide comments)	Aerator doesn't come off; taps don't drip; faucet assembly is tight.				
b.	What is the location of the tap? (Provide comments)					
c.	What is the regular use of the connection? (Provide comments)					
d.	Have there been any plumbing changes or construction? If yes, when and what was the repair or change?	✓	COW (MZ, AK, KW, AV)	No		
e.	Have there been any plumbing breaks or failure? If yes, when?	✓	COW (MZ, AK, KW, AV)	No		
f.	List any identified cross connections after the service connection or in premise plumbing. (Provide comments)					
g.	Were all of the backflow prevention operational and maintained?	✓	COW (MZ, AK, KW, AV)	No	No testable devices on site, non testable devices visually look ok.	
h.	Were there any low pressure events or changes in water pressure after the service connection or in the premise plumbing? If yes when?	✓	COW (MZ, AK, KW, AV)	No	Nothing brought to owner's attention.	

City of Winnipeg Revised Total Coliform Rule Level 2 Assessment Form

	Questions	Reviewed? (Check if completed or type N/A)	Reviewer	Issue(s) Found? (Yes/No)	Issue Description	Corrective Action Taken (Including Date)
i.	Are there any treatment devices after the service connection or in premise? (Circle response, if applicable)	Point of Entry (POE)	COW (MZ, AK, KW, AV)	Point of Use (POU)	.	
j.	Other comments on sample site?					
6	**EVALUATE SAMPLE SITE - SE-07** *Completed by COW Cross Connections/BFP Inspector - MZ & AK and Analytical Services Laboratory Technicians -*					
a.	What is the condition of the tap? (Provide comments)					
b.	What is the location of the tap? (Provide comments)					
c.	What is the regular use of the connection? (Provide comments)					
d.	Have there been any plumbing changes or construction? If yes, when and what was the repair or change?	✓	COW (MZ, AK, KW, AV)	No	Changed hot water tank recently.	
e.	Have there been any plumbing breaks or failure? If yes when?	✓	COW (MZ, AK KW AV)	Yes		
f.	List any identified cross connections after the service connection or in premise plumbing. (Provide comments)	No premise isolation; non testable devices are in place;				
g.	Were all of the backflow prevention operational and maintained?	✓	COW (MZ, AK, KW, AV)	Yes		
h.	Were there any low pressure events or changes in water pressure after the service connection or in the premise plumbing? If yes when?	No				
i.	Are there any treatment devices after the service connection or in premise? (Circle response, if applicable)	Point of Entry (POE)	COW (MZ, AK, KW, AV)	Point of Use (POU)		
j.	Other comments on sample site?					
7	**EVALUATE SAMPLE SITE - SE-08** *- Completed by COW Cross Connections/BFP Inspector - MZ & AK and Analytical Services Laboratory Technicians -*					
a.	What is the condition of the tap? (Provide comments)	Taps don't drip; faucet is tight; faucet doesn't swivel; aerator doesn't come off.				
b.	What is the location of the tap? (Provide comments)					
c.	What is the regular use of the connection? (Provide comments)	.				
d.	Have there been any plumbing changes or construction? If yes, when and what was the repair or change?	✓	COW (MZ, AK, KW, AV)	Yes		
e.	Have there been any plumbing breaks or failure? If yes, when?	✓	COW (MZ, AK, KW, AV)	Yes		Maintenance Department reviewed and determined that small drip not a concern.

City of Winnipeg Revised Total Coliform Rule Level 2 Assessment Form

	Questions	Reviewed? (Check if completed or type N/A)	Reviewer	Issue(s) Found? (Yes/No)	Issue Description	Corrective Action Taken (Including Date)
f.	List any identified cross connections after the service connection or in premise plumbing. (Provide comments)					
g.	Were all of the backflow prevention operational and maintained?	✓	COW (MZ, AK, KW, AV)	No	All testable devices are in compliance.	
h.	Were there any low pressure events or changes in water pressure after the service connection or in the premise plumbing? If yes when?	Not before meter. After meter, hot water pump wasn't working so they had to shut water off to fix pump. Likely occurred before January.				
i.	Are there any treatment devices after the service connection or in premise? (Circle response, if applicable)	Point of Entry (POE)	COW (MZ, AK, KW, AV)	Point of Use (POU)		
j.	Other comments on sample site?					
8	**EVALUATE SAMPLE SITE - SW-07** *- Completed by COW Cross Connections/BFP Inspector - MZ & AK and Analytical Services Laboratory Technicians -*					
a.	What is the condition of the tap? (Provide comments)					
b.	What is the location of the tap? (Provide comments)					
c.	What is the regular use of the connection? (Provide comments)					
d.	Have there been any plumbing changes or construction? If yes, when and what was the repair or change?	✓	COW (MZ, AK, KW, AV, GV)	No		
e.	Have there been any plumbing breaks or failure? If yes, when?	✓	COW (MZ, AK, KW, AV, GV)	No		
f.	List any identified cross connections after the service connection or in premise plumbing. (Provide comments)					
g.	Were all of the backflow prevention operational and maintained?	✓	COW (MZ, AK, KW, AV, GV)	No		
h.	Were there any low pressure events or changes in water pressure after the service connection or in the premise plumbing? If yes, when?	No				
i.	Are there any treatment devices after the service connection or in premise? (Circle response, if applicable)	Point of Entry (POE)	COW (MZ, AK, KW, AV, GV)	Point of Use (POU)		
j.	Other comments on sample site?	Accessible				
9	**EVALUATE SAMPLE SITE - SW-12 (** *- Completed by COW Cross Connections/BFP Inspector - MZ & AK and Analytical Services Laboratory Technicians -*					
a.	What is the condition of the tap? (Provide comments)	No drips; faucet is tight; aerator comes off.				

City of Winnipeg Revised Total Coliform Rule Level 2 Assessment Form

	Questions	Reviewed? (Check if completed or type N/A)	Reviewer	Issue(s) Found? (Yes/No)	Issue Description	Corrective Action Taken (Including Date)
b.	What is the location of the tap? (Provide comments)					
c.	What is the regular use of the connection? (Provide comments)					
d.	Have there been any plumbing changes or construction? If yes, when and what was the repair or change?	✓	COW (MZ, AK, KW, AV)	No	Added Filter system in January, 2015	
e.	Have there been any plumbing breaks or failure? If yes, when?	✓	COW (MZ, AK, KW, AV)	No		
f.	List any identified cross connections after the service connection or in premise plumbing. (Provide comments)	As of Mar. 5, 2015, based on all visual piping - none				
g.	Were all of the backflow prevention operational and maintained?	✓	COW (MZ, AK, KW, AV)	No	As of Mar. 5, 2015 - none on site	Moderate hazard building does not have any testable devices. Non testable devices visibly look okay.
h.	Were there any low pressure events or changes in water pressure after the service connection or in the premise plumbing? If yes when?	No				
i.	Are there any treatment devices after the service connection or in premise? (Circle response, if applicable)	Point of Entry (POE)	COW (MZ, AK, KW, AV)	Point of Use (POU)		
j.	Other comments on sample site?					
10	**EVALUATE SAMPLE SITE - SE-05 (** Completed by COW Cross Connections/BFP Inspector - MZ & AK and Analytical Services Laboratory Technicians -					
a.	What is the condition of the tap? (Provide comments)	Aerator comes off; faucet and taps are tight; separate hot and cold.				
b.	What is the location of the tap? (Provide comments)					
c.	What is the regular use of the connection? (Provide comments)					
d.	Have there been any plumbing changes or construction? If yes, when and what was the repair or change?	✓	COW (MZ, AK, KW)	No	None recently.	
e.	Have there been any plumbing breaks or failure? If yes, when?	✓	COW (MZ, AK, KW)	No		
f.	List any identified cross connections after the service connection or in premise plumbing. (Provide comments)	None				
g.	Were all of the backflow prevention operational and maintained?	✓	COW (MZ, AK, KW)	No	No testable devices on site; moderate hazard building; non testable visually look okay.	
h.	Were there any low pressure events or changes in water pressure after the service connection or in the premise plumbing? If yes when?	None				
i.	Are there any treatment devices after the service connection or in premise? (Circle response, if applicable)	Point of Entry (POE)	COW (MZ, AK, KW)	Point of Use (POU)	Filter system for product use downstream of sampling sink.	

City of Winnipeg Revised Total Coliform Rule Level 2 Assessment Form

	Questions	Reviewed? (Check if completed or type N/A)	Reviewer	Issue(s) Found? (Yes/No)	Issue Description	Corrective Action Taken (Including Date)
j.	Other comments on sample site?					
11	**SAMPLE PROTOCOL FOLLOWED AND REVIEWED**					
a.	Sample protocol followed and reviewed	✓	SH	Potential	See Report Section 4.8 for details, and Lipinsky report in Appendix B.2.	
b.	Flush tap, remove aerator, no swivel, fresh sample bottles, sample storage acceptable	✓	SH	Potential	See Report Section 4.8 for details, and W. Lipinsky report in Appendix B.2.	
12	**PUMPING STATION - MACLEAN** - *Inspected by AECOM, form filled in by AECOM/City of Winnipeg. Note, Mcphillips Pumping Station and Reservoir was not included in this assessment as hydraulically it could not have played a role in the positive samples that were obtained.*					
a.	Are there any sanitary defects in the pump station?	✓	AECOM (CN)	Potential		
b.	Are pump(s) operable?	✓	AECOM (CN)	No		
c.	Last pump maintenance/service date.	✓	COW (MH)	No		
13	**PUMPING STATION - W. D. HURST** - *Inspected by AECOM, form filled in by AECOM/City of Winnipeg*					
a.	Are there any sanitary defects in the pump station?	✓	AECOM (CN)	Potential	Located feed off of main distribution line, was unable to confirm whether piping had BFPV.	All of the tie-ins for the backflow devices that service the gensets are located in the subbasement. The station meets all backflow requirements. (KWr)
b.	Are pump(s) operable?	✓	AECOM (CN)	No		
c.	Last pump maintenance/service date. (Respond if applicable)	✓	COW (MH)	No		
14	**STORAGE FACILITIES - MACLEAN RESERVOIR** - *Inspected by AECOM, form filled in by AECOM/City of Winnipeg*					
a.	Are the overflow and vents properly screened?	✓	AECOM (CN)	No		

City of Winnipeg Revised Total Coliform Rule Level 2 Assessment Form

	Questions	Reviewed? (Check if completed or type N/A)	Reviewer	Issue(s) Found? (Yes/No)	Issue Description	Corrective Action Taken (Including Date)
d.	Could the physical condition of tank be a source contamination?	✓	AECOM (CN)	No	Visible Inspection of the interior not possible as both reservoirs filled with water	
e.	Is the Vent turned down and maintain an approved air gap at the termination point?	✓	AECOM (CN)	No		
f.	Does the Drain/overflow line terminate a minimum of 12" air gap?	✓	AECOM (CN)	No		
g.	If present, Is the Pressure tank maintaining an appropriate minimum pressure?	N/A	N/A	N/A		
h.	Is proper O&M being performed?	✓	COW (DM)	No		
i.	Was there any observed physical deterioration of tank?	✓	AECOM (CN)	No		
j.	Were there any observed leaks?	✓	AECOM (CN)	No		
k.	Is there any evidence of intentional contamination at the storage tank?	✓	AECOM (CN)	No		
l.	Have there been any facility maintenance? painting/coating) If yes, when?	✓	COW (DM)	No		
m.	Is facility maintenance occuring per appropriate schedule?	✓	COW (DM)	No		
n.	Does the tank "float" on the distribution system or are there separate inlet and outlet lines?	✓	AECOM (CN)	No	Separate Inlet/Outlet	
o.	What is the measured chlorine residual (total/free) of the water exiting the storage tank today?	✓	COW (CD)	No	Chlorine Residual as of March 16 2015: Free = 1.17 mg/L Total = 1.34 mg/L	
q.	Other comments on the storage system					

City of Winnipeg Revised Total Coliform Rule Level 2 Assessment Form

	Questions	Reviewed? (Check if completed or type N/A)	Reviewer	Issue(s) Found? (Yes/No)	Issue Description	Corrective Action Taken (Including Date)
15	**STORAGE FACILITIES - WILKES RESERVOIR** - *Inspected by AECOM, form filled in by AECOM/City of Winnipeg*					
a.	Are the overflow and vents properly screened?	✓	AECOM (CN)	No		
b.						
c.						
d.	Could the physical condition of tank be a source contamination?	✓	AECOM (CN)	No	Visible Inspection of the interior not possible as all reservoirs filled with water	
e.	Is the Vent turned down and maintain an approved air gap at the termination point?	✓	AECOM (CN)	No		
f.	Does the Drain/overflow line terminate a minimum of 12" air gap?	✓	AECOM (CN)	No		
g.	If present, Is the Pressure tank maintaining an appropriate minimum pressure?	N/A	N/A	N/A		
h.	Is proper O&M being performed?	✓	COW (DM)	No	Inspection of Wilkes West and East reservoir structure and roof has resulted in a capital project on both reservoirs for deficiencies	
i.	Was there any observed physical deterioration of tank?	✓	AECOM (CN)	No		
j.	Were there any observed leaks?	✓	AECOM (CN)	No		
k.	Is there any evidence of intentional contamination at the storage tank?	✓	AECOM (CN)	No		
l.	Have there been any facility maintenance? painting/coating) If yes, when?	✓	COW (DM)	No	October 2011 repairs to Wilkes East Reservoir leaks on the floor level with gasketed plates	
m.	Is facility maintenance occurring per appropriate schedule?	✓	COW (DM)	No		
n.	Does the tank "float" on the distribution system or are there separate inlet and outlet lines?	✓	AECOM (CN)	No	Separate Inlet/Outlet	
o.	What is the measured chlorine residual (total/free) of the water exiting the storage tank today?	✓	COW (CD)	No	Chlorine Residual as of March 16, 2015: Free = 1.10 mg/L Total = 1.25 mg/L	

City of Winnipeg Revised Total Coliform Rule Level 2 Assessment Form

	Questions	Reviewed? (Check if completed or type N/A)	Reviewer	Issue(s) Found? (Yes/No)	Issue Description	Corrective Action Taken (Including Date)
16	**DISTRIBUTION SYSTEM** - Completed by City of Winnipeg					
a.	List any identified cross connections in the vacinity of of the positive TC sample site.	✓	COW (LM/MZ)	Potential	The locations that had positive bacteriological samples along with four other locations that were deemed to be high risk and have potential to create a bacteriological cross contamination were examined.	The results of this investigation along with the corrective actions can be found in Appendix C1.
b.	Air relief valves: Is the valve vault subject to flooding ?		COW (LM)	Potential	14 air chambers or valve pits that were previously identified as having water and that were in the vicinity of the positive bacteriological sample sites from the January 27, 2015 and October 8, 2013 boil water advisories were inspected.	The results of this investigation along with the corrective actions can be found in Appendix C2.
c.	Is the distribution system secured to prevent unauthorized access?	✓	COW (ZB)	No	Access to the distribution sytem is controlled and regulated as per industry standards.	
d.	Are the backflow prevention devices within a 500m radius of the positive sample site operational and maintained?	✓	COW (LM/MZ)	Potential	The locations that had positive bacteriological samples along with two other locations that did not were investigated. For each sample point, the backflow records were inspected for establishments that were located within a 500 m radius of the sample point.	The results of this investigation along with the corrective actions can be found in Appendix C1.
e.	Are there any ground wells in the City limits?	✓	COW (LM/JMc)	No	There are 99 non domestic licensed ground wells in the City of Winnipeg. In order for a cross connection to occur, an illegal connection from the well to the City of Winnipeg watermain system would be required. Of those 99 wells, over two thirds (71 wells) are located on the west side of the Red River. With respect to the 10 sample locations that tested positive that are under investigation, there are 9 wells located in the upstream vicinity of SW-07, there are 2 wells in the combined upstream location of SW-05, SW-07, and SW-08, and there is one well in the vicinity of NE-04. There are several wells that are in the upstream location of other sampling points that did not test positive, both on the east and west sides of the Red River. This information is neutral. The location of the wells neither supports nor refutes the contamination of the distribution system by ground wells. See Appendix D1.	

	Questions	Reviewed? (Check if completed or type N/A)	Reviewer	Issue(s) Found? (Yes/No)	Issue Description	Corrective Action Taken (Including Date)
f.	What are the pipe properties of the areas upstream of the positive samples?	✓	COW (LM/JMc)	No	Refer to Appendix D1. **NE-01:** Predominately asbestos cement pipes (75%) and PVC pipes (17%). Approximately 70% of the pipes are 1970 vintage, remaining are from 1980's-1990's. **SE-03:** Predominately PVC pipes (79%) and asbestos cement pipes (17%). Approximately 65% are 1980's vintage and approximately 35% are 1990's vintage. **SE-04:** 93% of pipes are PCV, remainder are mostly copper. ~50% are 1980's vintage, ~20% are 1990's vintage and ~30% are ~2000's vintage. **SE-05, SE-07 and SE-08:** Predominately PVC pipes (57%), asbestos cement pipes (29%) and unknown (10%). Mostly 1970-1980's vintage with areas from the 1990's. SE-07 had one pipe in the upstream area that was abandoned in 2014 as it was installed prior to development and was no longer needed. **SW-07**: Predominately PVC (75%) and asbestos cement (17%). Approximately half of the pipes are of 1970 vintage and half are less than 25 years old. **SW-12:**Predominately PVC (52%) with some areas of cast iron (27%), and asbestos cement (16%). PVC pipe is 1980 - 1990 vintage, cast iron is 1960 vintage and asbestos cement is predominately 1960's vintage. SW-12 has one pipe in the upstream area that will be renewed in 2015 due to the number of breaks and the fact that Public Works was renewing the pavement. **NE-06, NE-07**: sites are next to feedermain offtakes. Feedermains are concrete. Feedermain at NE-06 was installed in 1962 and feedermain at NE-07 was installed in 1977	
17	**HAVE ANY OF THE FOLLOWING OCCURRED AT RELEVANT FACILITIES PRIOR TO THE COLLECTION OF TC SAMPLES ON OCTOBER 7, 2013? SPECIFICALLY DURING THE 2 WEEKS FROM SEPTEMBER 23, 2013 - OCTOBER 7, 2013, UNLESS OTHERWISE STATED** - *Completed by City of Winnipeg*					
a.	Were there any operation and maintenance activities that could have introduced total coliforms? (valve work and misc. daily work)	✓	COW (ZB)	No	Valve work and miscellaneous daily work for two weeks preceding the October 7, 2013 event were plotted on a map of the City. There were 10 work operations during this time, randomly spread throughout the system. There were no incidents where work was performed in the upstream vicinity of the positive bacteriological samples. See Appendix D1.	
b.	Have there been any interruptions in the treatment process?	✓	COW (DM)	No		
c.	Has the system lost pressure to less than 5 psi?	✓	COW (JMc)	No	See Appendix D8	

City of Winnipeg Revised Total Coliform Rule Level 2 Assessment Form

	Questions	Reviewed? (Check if completed or type N/A)	Reviewer	Issue(s) Found? (Yes/No)	Issue Description	Corrective Action Taken (Including Date)
d.	Have there been any vandalism and/or unauthorized access to facilities?	✓	COW (ZB)	No		
e.	During the 2013 incident, have there been any analytical results or any additional samples collected, including source samples which were positive (not for compliance)?	✓	COW (CD)	Potential	The only other positives during the two (2) weeks before and the week of the incident were in samples collected at Pre-WTP locations.	No re-sampling occurred as this is typical of raw surface water. Samples collected in the WTP process and after WTP (DBPS 1&2) were all negative for bacteria.
f.	Have there been any community illness suspected of being waterborne (e.g., Does the community public health official indicate that an outbreak has occurred)	✓	COW (JMc)	No	See Winnipeg Regional Health Authority Medical Officer of Health Letter in Appendix B4	
g.	Did the water system have any Corrective Action Reports (CAR) for Total Coliforms in the Distribution System in the past 12 months? If yes, when.	✓	COW (CD)	Potential	In the past 12 months of this incident there were 17 CAR for Coliforms in the distribution system. Four (4) of the CAR's were Total Coliforms greater than 10.	Each CAR was corrected based on the non-compliance requirements which included re-sampled the postive site until all re-samples were negative. The corrective action was addressed in each situation within 3 days of the incident depending on the type of non-compliance incident.
h.	What was the most recent date on which satisfactory total coliform samples were taken?	✓	COW (CD)	No	3 of the 4 sampling sites that tested positive on Oct. 7, 2013 have had satisfactory total coliform samples since Oct. 8, 2013. SW07 had satisfactory total coliform results from Oct. 8 2013 to Jan 26 2015.	
i.	Have there been any hydrant operations including firefighting events, flushing, metered operation, sheared hydrant, etc.	✓	COW (ZB)	Potential	Hydrant operations including firefighting events, flushing, metered operation, and sheared hydrants for two weeks preceding the October 7, 2013 event were plotted on a map of the City. There were 11 hydrant operations during this time, randomly spread throughout the system. There were no incidents where hydrant operations were performed in the upstream vicinity of the positive bacteriological samples. See Appendix D1.	
j.	Other comments on records and maintenance?					
18	**HAVE THERE BEEN ANY RECENT TREATMENT OR OPERATIONAL CHANGES PRIOR TO THE COLLECTION OF TC SAMPLES ON OCTOBER 7, 2013? SPECIFICALLY DURING THE 2 WEEKS FROM SEPTEMBER 23, 2013 - OCTOBER 7, 2013** - *Completed by City of Winnipeg*					
a.	Have any inactive sources recently been introduced into the system (e.g., auxiliary systems)?	✓	COW (DM)	No		
b.	Have there been any new sources introduced into the system?	✓	COW (DM)	No		

	Questions	Reviewed? (Check if completed or type N/A)	Reviewer	Issue(s) Found? (Yes/No)	Issue Description	Corrective Action Taken (Including Date)
c.	Is there empirical evidence of any potential sources of contamination (high turbidity, loss of disinfection)?	✓	COW (CD)	No	Turbidity and chlorine data for both compliance and non-compliance samples for two weeks preceding the October 7, 2013 event were reviewed. The highest turbidity level of 1.54 NTU was observed on September 23, 2013 at sample location SW05. The lowest free chlorine level of 0.24mg/L was observed on September 23, 2013 at sample location NE09. See Appendix D6.	
19	**HAVE ANY OF THE FOLLOWING OCCURRED TO THE DISTRIBUTION SYSTEM PRIOR TO THE COLLECTION OF TC SAMPLES ON OCTOBER 7, 2013? SPECIFICALLY DURING THE 2 WEEKS FROM SEPTEMBER 23, 2013 - OCTOBER 7, 2013, UNLESS OTHERWISE STATED** - *Completed by City of Winnipeg*					
a.	System pressure: Is there evidence that the system experienced low or negative pressure? If yes, when?	✓	COW (JMc)	No		
b.	Have there been any water main breaks or repairs? If yes, when?	✓	COW (ZB)	No	Water main breaks and repairs for two weeks preceding the October 7, 2013 event were plotted on a map of the City. There were 44 water main breaks and repairs during this time, randomly spread throughout the system. There were three incidents where water main breaks and repairs were performed in the upstream vicinity of the positive bacteriological sample sites, all in the upstream location of sample sites SE-05, SE-07, SE-08. Sample sites SE-05, SE-07, SE-08 are not hydraulically connected to the remaining positive bacteriological sample site SW-07. See Appendix D1.	In 2014, the Standard Operating Proceedure for watermain repairs was amended to include disinfection of tools.
c.	Was there any scheduled flushing of the distribution system? If yes, when?	✓	COW (ZB)	No	The City's 2013 watermain flushing program finished on August 9, 2013 and therefore was unlikely to cause an issue. See Appendix D4.	
d.	Is there any evidence of intentional contamination in the distribution system?	✓	COW (ZB)	No		
e.	Could the use of river water for irrigation have contributed to the event?	✓	COW (LM/JMc)	No	In order for a cross connection to occur, an illegal connection to the City of Winnipeg watermain system would be required. For the October 7, 2013 event, the likelihood of people using water for irrigation greatly diminishes. In addition to this the October 7, 2013 event had positive sample locations that were hydraulically disconnected from each other. There would have had to be 2 separate sources of contamination that contributed to the event. This is highly unlikely.	
20	**HAVE ANY OF THE FOLLOWING ENVIRONMENTAL EVENTS OCCURRED PRIOR TO THE COLLECTION OF TC SAMPLES ON OCTOBER 7, 2013? SPECIFICALLY DURING THE 2 WEEKS FROM SEPTEMBER 23, 2013 - OCTOBER 7, 2013** - *Completed by City of Winnipeg*					
a.	Has there been heavy rainfall?	✓	COW (JMc)	No	Notable rainfall: Sept. 28, 2013 a total of 26.6mm of rainfall within 12 hours (well below a 2 year event rainstorm). This is typical for this time of year. See Appendix D9.	

	Questions	Reviewed? (Check if completed or type N/A)	Reviewer	Issue(s) Found? (Yes/No)	Issue Description	Corrective Action Taken (Including Date)
b.	Has there been any rapid snow melt or flooding?	✓	COW (JMc)	No	See Appendix D10.	
c.	Have there been changes in avaliable source water (e.g., significant drop in water table, well levels, reservoir capacity, etc.)	✓	COW (JMc)	No		
d.	Have there been any Interruptions to electrical power?	✓	COW (JMc)	No		
e.	Have there been any extremes in heat or cold?	✓	COW (JMc)	No	See Appendix D11.	
21	**HAVE ANY OF THE FOLLOWING OCCURRED AT RELEVANT FACILITIES PRIOR TO THE COLLECTION OF TC SAMPLES ON MAY 26, 2014? SPECIFICALLY DURING THE 2 WEEKS FROM MAY 12, 2014 - MAY 26, 2014, UNLESS OTHERWISE STATED** - *Completed by City of Winnipeg*					
a.	Were there any operation and maintenance activities that could have introduced total coliforms? (valve work and misc. daily work)	✓	COW (ZB)	No	Valve work and miscellaneous daily work for two weeks preceding the May 26, 2014 event were plotted on a map of the City. There were 65 work operations during this time, randomly spread throughout the system. There were no incidents where work was performed in the upstream vicinity of the positive bacteriological samples. See Appendix D1.	
b.	Have there been any interruptions in the treatment process?	✓	COW (DM)	No		
c.	Has the system lost pressure to less than 5 psi?	✓	COW (JMc)	No	See Appendix D2.	
d.	Have there been any vandalism and/or unauthorized access to facilities?	✓	COW (ZB)	No		
e.	During the 2014 incident, have there been any analytical results or any additional samples collected, including source samples which were positive (not for compliance)?	✓	COW (CD)	Potential	There were three positive samples during the two (2) weeks preceding May 26, 2014 incident. These positive samples were collected at Pre-WTP locations on May 12, 2014, May 19, 2014, and May 26, 2014.	No re-sampling occurred as this is typical of raw surface water. Samples collected in the WTP process and after WTP (DBPS 1&2) were all negative for bacteria.
f.	Have there been any community illness suspected of being waterborne (e.g., Does the community public health official indicate that an outbreak has occurred.)	✓	COW (JMc)	No	See Winnipeg Regional Health Authority Medical Officer of Health Letter in Appendix B4.	
g.	Did the water system have any Corrective Action Reports (CAR) for Total Coliforms or E. Coli in the Distribution System in the past 12 months? If yes, when.	✓	COW (CD)	Potential	In the past 12 months of this incident there were 18 CAR for Coliforms in the distribution system. Four (4) of the CAR's included TC greater than 10 and 2 CAR included the presence of EC.	Each CAR was corrected based on the non-compliance requirements which included re-sampled the postive site until all re-samples were negative. The corrective action was addressed in each situation with in 3 days of the incident depending on the type of non-compliance incident.
h.	What was the most recent date on which satisfactory total coliform samples were taken?	✓	COW (CD)	No	Date: May 27, 2014 - Present. SW-12 has had satisfactory total coliform samples since May 27, 2014.	

	Questions	Reviewed? (Check if completed or type N/A)	Reviewer	Issue(s) Found? (Yes/No)	Issue Description	Corrective Action Taken (Including Date)
i.	Have there been any hydrant operations including firefighting events, flushing, metered operation, sheared hydrant, etc.	✓	COW (ZB)	Potential	Hydrant operations including firefighting events, flushing, metered operation, and sheared hydrants for two weeks preceding the May 26, 2014 event were plotted on a map of the City. There were 11 hydrant operations during this time, randomly spread throughout the system. There were no incidents where hydrant operations were performed in the upstream vicinity of the positive bacteriological samples. See Appendix D1.	
k.	Other comments on records and maintenance?					
22	**HAVE THERE BEEN ANY RECENT TREATMENT OR OPERATIONAL CHANGES PRIOR TO THE COLLECTION OF TC SAMPLES ON MAY 26, 2014? SPECIFICALLY DURING THE 2 WEEKS FROM MAY 12, 2014 - MAY 26, 2014** - *Completed by City of Winnipeg*					
a.	Have any inactive sources recently been introduced into the system (e.g., auxiliary systems)?	✓	COW (DM)	No		
b.	Have there been any new sources introduced into the system?	✓	COW (DM)	No		
c.	Is there empirical evidence of any potential sources of contamination (high turbidity, loss of disinfection)?	✓	COW (CD)	No	Turbidity and chlorine data for both compliance and non-compliance samples for two weeks preceding the May 26, 2014 event were reviewed. The highest turbidity level of 2.49 NTU was observed on May 20, 2014 at sample location SW10. The lowest free chlorine level of 0.15 mg/L was observed on May 13, 2014 at sample location SE10. See Appendix D6.	
23	**HAVE ANY OF THE FOLLOWING OCCURRED TO THE DISTRIBUTION SYSTEM PRIOR TO THE COLLECTION OF TC SAMPLES ON MAY 26, 2014? SPECIFICALLY DURING THE 2 WEEKS FROM MAY 12, 2014 - MAY 26, 2014, UNLESS OTHERWISE STATED** - *Completed by City of Winnipeg*					
a.	System pressure: Is there evidence that the system experienced low or negative pressure? If yes, when?	✓	COW (JMc)	No	See Appendix D2.	
b.	Have there been any water main breaks or repairs? If yes, when?	✓	COW (ZB)	No	Water main breaks and repairs for two weeks preceding the May 26, 2014 event were plotted on a map of the City. There were 57 water main breaks and repairs during this time, randomly spread throughout the system. There were no incidents where water main breaks and repairs were performed in the upstream vicinity of the positive bacteriological samples site. See Appendix D1.	
c.	Was there any scheduled flushing of the distribution system? If yes, when?	✓	COW (ZB)	No	The City's 2014 watermain flushing program started on July 5, 2014 and therefore was unlikely to cause an issue. See Appendix D4.	
d.	Is there any evidence of intentional contamination in the distribution system?	✓	COW (ZB)	No		

	Questions	Reviewed? (Check if completed or type N/A)	Reviewer	Issue(s) Found? (Yes/No)	Issue Description	Corrective Action Taken (Including Date)
e.	Could the use of river water for irrigation have contributed to the event?	✓	COW (LM/JMc)	No	In order for a cross connection to occur, an illegal connection to the City of Winnipeg watermain system would be required. For the May 26, 2014 event, the sample location that tested positive is in close proximity to the Red River. There were some abnormally hot days leading up to the incident (32.7°C on May 24, 2014) however, there was 8mm of rain on May 25, 2014, the day prior to the positive sample being taken.	
24	**HAVE ANY OF THE FOLLOWING ENVIRONMENTAL EVENTS OCCURRED PRIOR TO THE COLLECTION OF TC SAMPLES ON MAY 26, 2014? SPECIFICALLY DURING THE 2 WEEKS FROM MAY 12, 2014 - MAY 26, 2014** - *Completed by City of Winnipeg*					
a.	Has there been heavy rainfall?	✓	COW (JMc)	No	Notable Rainfall Events: May 19-20, 2014 - 41.3mm in 48hrs. Approx. 5-yr event. May 25, 2014 - less than 1 yr event. This amount of rainfall is typical for this time of year. See Appendix D9.	
b.	Has there been any rapid snow melt or flooding?	✓	COW (JMc)	Potential	On May 12 the River was at James 15.3 ft and on May 26 the river was at James 13.1 ft. This is typical for this time of year. See Appendix D10	
c.	Have there been changes in avaliable source water (e.g., significant drop in water table, well levels, reservoir capacity, etc.)	✓	COW (JMc)	No		
d.	Have there been any Interruptions to electrical power?	✓	COW (JMc)	No		
e.	Have there been any extremes in heat or cold?	✓	COW (JMc)	Potential	May 24, 2014 had high of +32.7°C. See Appendix D11.	
25	**HAVE ANY OF THE FOLLOWING OCCURRED AT RELEVANT FACILITIES PRIOR TO THE COLLECTION OF TC SAMPLES ON JANUARY 26, 2015? SPECIFICALLY DURING THE 2 WEEKS FROM JANUARY 12, 2015 - JANUARY 26, 2015, UNLESS OTHERWISE STATED** - *Completed by City of Winnipeg*					
a.	Were there any operation and maintenance activities that could have introduced total coliforms? (valve work and misc. daily work)	✓	COW (ZB)	No	Valve work and miscellaneous daily work for two weeks preceding the January 26, 2015 event were plotted on a map of the City. There were 63 work operations during this time, randomly spread throughout the system. There was one incident where work was performed in the upstream vicinity of the positive bacteriological samples, sample point SE-04. SE-04 is not hydraulically connected to the six other positive bacteriological samples. See Appendix D1.	
b.	Have there been any interruptions in the treatment process?	✓	COW (DM)	No		
c.	Has the system lost pressure to less than 5 psi?	✓	COW (JMc)	No	See Appendix D2.	

City of Winnipeg Revised Total Coliform Rule Level 2 Assessment Form

	Questions	Reviewed? (Check if completed or type N/A)	Reviewer	Issue(s) Found? (Yes/No)	Issue Description	Corrective Action Taken (Including Date)
d.	Have there been any vandalism and/or unauthorized access to facilities?	✓	COW (ZB)	No		
e.	During the 2015 incident, have there been any analytical results or any additional samples collected, including source samples which were positive (not for compliance)?	✓	COW (CD)	Potential	There were three positive samples during the two (2) weeks preceding January 26, 2015 incident. These positive samples were collected at Pre-WTP locations on January 12, 2015, January 19, 2015, and January 26, 2015.	No re-sampling occurred as this is typical of raw surface water. Samples collected in the WTP process and after WTP (DBPS 1&2) were all negative for bacteria.
f.	Have there been any community illness suspected of being waterborne (e.g., Does the community public health official indicate that an outbreak has occurred)	✓	COW (JMc)	No	See Winnipeg Regional Health Authority Medical Officer of Health Letter in Appendix B4.	
g.	Did the water system have any Corrective Action Reports (CAR) for Total Coliforms or E. Coli in the Distribution System in the past 12 months? If yes, when.	✓	COW (CD)	Potential	In the past 12 months of this incident there were 3 CAR for Coliforms in the distribution system. One (1) of the CAR's included TC greater than 10 and 1 CAR included the presents of EC.	Each CAR was corrected based on the non-compliance requirements which included re-sampled the postive site until all re-samples were negative. The corrective action was addressed in each situation within 3 days of the incident depending on the type of non-compliance incident.
h.	What was the most recent date on which satisfactory total coliform samples were taken?	✓	COW (CD)	No	Date: Jan. 27, 2015 - Present. SW-12 has had satisfactory total coliform samples since May 27, 2014.	
i.	Have there been any hydrant operations including firefighting events, flushing, metered operation, sheared hydrant, etc.	✓	COW (ZB)	No	Hydrant operations including firefighting events, flushing, metered operation, and sheared hydrants for two weeks preceding the January 26, 2015 event were plotted on a map of the City. There were 16 hydrant operations during this time, randomly spread throughout the system. There was one incident where a hydrant operation was performed in the upstream vicinity of the positive bacteriological samples, smaple point NE-01. NE-01 is not hydraulically connected to the five other positive bacteriological samples. See Appendix D1	
j.	Other comments on records and maintenance?					
26	**HAVE THERE BEEN ANY RECENT TREATMENT OR OPERATIONAL CHANGES PRIOR TO THE COLLECTION OF TC SAMPLES ON JANUARY 26, 2015? SPECIFICALLY DURING THE 2 WEEKS FROM JANUARY 12, 2015 - JANUARY 26, 2015** - *Completed by City of Winnipeg*					
a.	Have any inactive sources recently been introduced into the system (e.g., auxiliary systems)?	✓	COW (DM)	No		
b.	Have there been any new sources introduced into the system?	✓	COW (DM)	No		

	Questions	Reviewed? (Check if completed or type N/A)	Reviewer	Issue(s) Found? (Yes/No)	Issue Description	Corrective Action Taken (Including Date)
c.	Is there empirical evidence of any potential sources of contamination (high turbidity, loss of disinfection)?	✓	COW (CD)	No	Turbidity and chlorine data for both compliance and non-compliance samples for two weeks preceding the January 26, 2015 event were reviewed. The highest turbidity level of 0.90 NTU was observed on January 19, 2015 at sample location NW06. The lowest free chlorine level of 0.16 mg/L was observed on January 13, 2015 at sample location SW02. See Appendix D6.	
27	**HAVE ANY OF THE FOLLOWING OCCURRED TO THE DISTRIBUTION SYSTEM PRIOR TO THE COLLECTION OF TC SAMPLES ON JANUARY 26, 2015? SPECIFICALLY DURING THE 2 WEEKS FROM JANUARY 12, 2015 - JANUARY 26, 2015, UNLESS OTHERWISE STATED** - *Completed by City of Winnipeg*					
a.	System pressure: Is there evidence that the system experienced low or negative pressure? If yes, when?	✓	COW (ZB)	Potential	On Jan. 18, 2015 the [redacted] distribution monitoring stations recorded minimum pressures of 41.59 psi and 47.13 psi respectively. These stations are in proximity of the Birds Hill Feedermain and the pressure drop is attributed to the closure of the Feedermain. See Appendix D2.	
b.	Have there been any water main breaks or repairs? If yes, when?	✓	COW (ZB)	No	Water main breaks and repairs for two weeks preceding the January 26, 2015 event were plotted on a map of the City. There were 16 water main breaks and repairs during this time, randomly spread throughout the system. There was one incident where a water main break or repair was performed in the upstream vicinity of a positive bacteriological sample, sample site SW-07. Sample site SW-07 is not hydraulically connected to the remaining five positive bacteriological sample sites. See Appendix D1.	
c.	Was there any scheduled flushing of the distribution system? If yes, when?	✓	COW (ZB)	No	The City's 2015 watermain flushing program has not started yet and therefore did not cause an issue. See Appendix D4.	
d.	Is there any evidence of intentional contamination in the distribution system?	✓	COW (ZB)	No		
e.	Could the use of river water for irrigation have contributed to the event?	✓	COW (LM/JMc)	No	In order for a cross connection to occur, an illegal connection to the City of Winnipeg watermain system would be required. For the January 26, 2015 event all of the rivers were frozen over. This information eliminates the possibility of this mode of contamination for this event.	
28	**HAVE ANY OF THE FOLLOWING ENVIRONMENTAL EVENTS OCCURRED PRIOR TO THE COLLECTION OF TC SAMPLES ON JANUARY 26, 2015? SPECIFICALLY DURING THE 2 WEEKS FROM JANUARY 12, 2015 - JANUARY 26, 2015** - *Completed by City of Winnipeg*					
a.	Has there been heavy rainfall?	✓	COW (JMc)	No	See Appendix D9.	
b.	Has there been any rapid snow melt or flooding?	✓	COW (JMc)	No	See Appendix D10.	
c.	Have there been changes in avaliable source water (e.g., significant drop in water table, well levels, reservoir capacity, etc.)	✓	COW (JMc)	No		

City of Winnipeg Revised Total Coliform Rule Level 2 Assessment Form

Questions		Reviewed? (Check if completed or type N/A)	Reviewer	Issue(s) Found? (Yes/No)	Issue Description	Corrective Action Taken (Including Date)
d.	Have there been any Interruptions to electrical power?	✓	COW (JMc)	No	McPhillips Pumping Station had a power failure on Jan. 16, 2015. However, The gas engines were still able to run and the minimum pressure at the station during this event was 65.75 psi, therefore this was unlikely to cause an issue.	
e.	Have there been any extremes in heat or cold?	✓	COW (JMc)	No	-27.1°C on Jan 12, 2015 was the coldest temperature during this time period. The next coldest was -21.6°C on Jan 13, 2015. Both of these temperatures are typical for January. See Appendix D11.	

The Following Individuals are the Reviewers who Contributed to this Assessment:

Initials	Reviewer	Title
SH	Stephen Hubbs P.E.	Technical Expert, Former Head of Water Quality and Production for the Louisville Water Company
CN	Chad Neiser, P. Eng.	Project Engineer, Manitoba Water Business Line, AECOM
ZB	Zeljko Bodiroga, P. Eng.	Water Distribution Engineer, City of Winnipeg
DM	David Minor, P. Eng.	Water Treatment Operations Engineer, City of Winnipeg
LM	Linda McCusker, P. Eng.	Water Planning and Projects Delivery Branch Head, City of Winnipeg
JMc	Jessica McCombe P. Eng.	Project Engineer, Water Planning and Project Delivery Branch, City of Winnipeg
MH	Mark Hoeppner	Water Services Supervisor of Facilities Maintenance, City of Winnipeg
CD	Courtney Diduck	Analytical Services Branch Head, City of Winnipeg
MZ	Mike Zilinski	Senior Cross Connections/BFP Inspector, City of Winnipeg
AK	Allan Karsin	Cross Connections/BFP Inspector, City of Winnipeg
DS	Dave Sinclair	Cross Connections/BFP Inspector, City of Winnipeg
		Senior Laboratory Technician, City of Winnipeg
		Laboratory Technician, City of Winnipeg
		Laboratory Technician, City of Winnipeg
KWr	Kris Wright	Maintenance Pumber, City of Winnipeg

Appendix B

- Sampling and Laboratory Assessment Reference Documents

B1 BWA Timeline Point Form

BWA Timeline - Sampling Assessment – Laboratory Assessment

March 17, 2014- SOP 18 Bacteriological Monitoring & Sampling Program was updated

Updated sampling SOP 18 for Bacteriological Monitoring & Sampling Program was approved by the Supervisor of Analytical Services. The follow items were updated and changed and were implemented by staff as a result of 2013 BWA.

- Routine Sampling Procedure (added the following)
  - Step 2, "Remove aerator…"
  - Step 12, "Invert and mix the sample at least three times."
  - Step 13, Rinse the aerator before reattaching.
- Routine Requirements
  - Table1, No.4, "10% of the treated or distributed water" & respond "immediately".
- Corrective Action Plan, Response Priority 2,
  - Change corrective action response (from as soon as possible) too immediately.
- Re-sampling Procedure, (added);
  - Step 10, "Clean, disinfect and rinse the removed aerator …"

January 27, 2015-

Courtney Diduck, Analytical Services Branch Head verbally spoke to the sampling technician that performed the sampling on January 26, 2015 in which positive bacteria results were found. A discussion was done to determine if anything was abnormal that day or if technician remembers doing something different before any of the sites that were positive during their route. Nothing unusual at the sites was reported.

January 28, 2015-

Courtney Diduck, Analytical Services Branch Head meets again with technician who took all of the positive samples and reviews sampling procedures. Some deviations from procedures were noted.

February 2, 2015-

Courtney Diduck, Analytical Service Branch Head met with all City of Winnipeg water sampling technicians and reviewed the sample procedures and protocols.

February 3, 2015 at ALS with Health, ODW, Cadham Labs -City - Courtney Diduck, Gerry Levesque, Renee Grosselle

Walk through tour of the process once samples reach the lab, including initial receipt of samples, QA/QC checks on bottles; receipt of samples on Monday Jan. 26, 2015, processing of samples – analytical method, lab tracking and control, process/flow through. Cadham Labs requests taking our samples to proceed with genotyping of E.coli.

February 11, 2015 – City of Winnipeg Sampling Audit – W. Lipinsky (CALA certified Assessor)

Reviewed sampling procedures with technician in the field. Inspection of the laboratory's area related to sampling supplies and preparation and interview with sampling technicians and supervisory staff.

February 13, 2015 – City of Winnipeg Sampling Audit – Debrief W. Lipinsky and City

W. Lipinsky provided a review of the audit and explained the recommendations and requested feedback for final report.

February 17, 2015 - ALS visit by M. Brodsky (CALA certified Assessor)

Audited contract laboratory and reviewed and observed sample handling and preparation from receipt log-in to analysis. Conducted a detailed review of and observed the contract lab's method SOPs and analytical procedures for bacteriological analysis, including sample receipt and handling of samples to the final reporting of the results. Observed the performance of and interviewed all the analysts who were actually responsible for processing these samples on January 26 and 27, 2015.

February 20, 2015 – QA Training Session/Meeting was held with all of ASB

Meeting to discuss the sampling audit finding was discussed. A determination on how to move forward with the recommendation and action items was discussed. Decisions were made on some of the items.

February 23 – March 13, 2015 – Review of Backflow devices located within 500 m of positive locations

Backflow and cross-connection inspectors reviewed a list of facilities located within 500 m of the positive locations with backflow devices. Locations with devices that were past due for inspection were issued enforcement documents/work orders.

February 25, 2015 – Sampling review and ALS visit – Steve Hubbs and Courtney Diduck

S. Hubbs conducted a field inspection and followed samples from sample collection, transfer to the contract laboratory, through the analytical process, and into the incubator. A few deficiencies and non-standard technique identified.

March 2-16, 2015 – Inspected and reviewed 9 sampling sites - City (Technician and Cross Connection Inspectors)

Inspected and reviewed sampling sites for things such as conditions of the tap and location. Identified any issues or areas for improvement. Inspected for cross connections and backflow prevention devices and identified any corrective actions if deficiencies were found.

March 2-6, 2015 – Inspected 4 high risk facilities

Inspected 4 high risk facilities in the area of concern. Inspected premise devices for backflow prevention at the facilities, issued work orders for any violations observed.

March 4-5, 2015– Technician inspected all drinking water sampling locations for aerators

Inspected all compliance and non-compliance drinking water sampling locations for the presence of aerators. Recorded if aerators were present and if they could be removed.

March 13-27, 2015- Study of Potential Contamination in Sampling was performed

Different scenarios and sampling conditions were created to study of potential for bacteriological contamination and ruggedness of bacteriological sampling procedure. The investigation found in situations where contamination was most likely to occur positive results were not achieved. Further studies will be conducted to help determine sources in the sampling procedure for contamination.

March 25-27, 2015- PT Bacteriological samples were submitted

As recommended by the assessor (W. Lipinsky) PT (blind) samples were submitted to the contract laboratory. Further investigation on other PT samples that are more representative of Water Distribution system is being examined. This procedure will be implemented on a regular basis once an ideal PT sample is found.

April 1- 30, 2015- Revised SOP # 18 - Bacteriological Monitoring & Sampling Program

Based on the recommendations from the Sampling Assessment from February 11, 2015, the current SOP was reviewed and updated to include all action items and most of the recommended item that could be address over the short time frame. Revised SOP will be given to staff and staff will be re-trained on all revisions which will be completed by April 30, 2015.

B2 BWA Audit report Summaries

BWA - Sampling Assessment – Laboratory Assessment – Audit Reports

The City of Winnipeg engaged two external experts to conduct audits on the sampling protocols of the City of Winnipeg and analytical procedures of the contract laboratory (ALS). Consultants were selected based on their expertise and experience with CALA accreditation and auditing laboratories.

W. Lipinsky inspected the laboratory's area related to sampling supplies and preparation. W. Lipinsky was chief chemist at Manitoba Hydro in Selkirk with 33+ years of lab experience. He is a CALA certified assessor, and on the CALA advisor panel, with 15 years' experience as an assessor. M. Brodsky audited the contract laboratory. M. Brodsky is an Environmental Microbiologist for more than 42 years. He served the Chief of Environmental Microbiology for the Province of Ontario, Ministry of Health, and Laboratory Services Branch. He is also a lead auditor/assessor in microbiology for the Canadian Association for Laboratory Accreditation (CALA) and is Vice-chair of the CALA Board of Directors.

The third party report observations and findings are summarized below.

SAMPLING PROCEDURES

February 11, 2015 – City of Winnipeg Sampling Audit – W. Lipinsky

Reviewed the sampling procedures on February 11, which included:

- Water sampling procedures and related documents
- Staff training records
- Sampling supplies, procurement and storage
- Inspection of the laboratory's area related to sampling supplies and preparation
- Interview with sampling technicians and supervisory staff
- Sample registration, worksheet and label preparation, and data entry
- Observation of on-site sampling by the laboratory technician, at the six locations which had positive coliform results on January 26, 2015.
- Observation of sample bottle handling and transport to contract laboratory
- Review of coliform test records

The laboratory is accredited for its testing of drinking water and maintains an effective quality management system. W. Lipinsky observed that the laboratory has an excellent system of sample identification, together with labelling, worksheet generation and data entry. Sample integrity was maintained as per approved SOP's up to the point of delivery at the contract laboratory.

The laboratory has an approved documented sampling procedure, which instructs the technicians on how to correctly take water samples. Technicians with several years of testing and sampling experience were interviewed. They are fully aware of the significance of their work and the importance of proper sampling.

In addition to interviews with sampling staff and Supervisory staff, an interview was conducted with the technician who sampled all of the positive samples. The technician is a qualified and trained drinking water sampler and is aware of the procedures and importance of water testing. The technician was unable to identify anything that could have resulted in potential contamination on January 26, 2015 and indicated that it was another routine sampling day. The cleaning of the steering wheel was identified as a deficiency that was not always followed by the technician and other technicians using the shared vehicles.

On-site field sampling indicated that the water taps and sinks at the sampling sites appeared to be suitable and clean. However, they were in public places and the presence of coliforms in the sampling environment was unknown.

Mr. Lipinsky states that based on the observations during the assessment, there is a low probability that positive results would have occurred as a result of contamination at the time of sampling. The low probability is supported by the amount of testing done in 2014, by which samplers and historically based on current sampling procedures and protocols and low positive samples reported.

To ensure that the probability of contamination during sampling continues to be low, a number of continual improvement items have been recommended to the City of Winnipeg. Although a few documentation and quality system deficiencies were noted, the impact of these deficiencies for the potential of coliform contamination during sampling is minimal.

LABORATORY ASSESSEMENT

February 17, 2015 - ALS visit by M. Brodsky

- Audited the contract laboratory on February 17, focusing on the HPC by APHA 9215B, and E. coli and Total Coliform by Quanti-tray (IDEXX).
- Reviewed and observed sample handling and preparation from receipt log-in to analysis.
- Conducted a detailed review of and observed the contract lab's method SOPs and analytical procedures for bacteriological analysis, including sample receipt and handling of samples to the final reporting of the results.
- Included a trace of tests for the dates/samples in question.
- Observed the performance of and interviewed all the analysts who were actually responsible for processing these samples on January 26 and 27, 2015.

Mr. Brodsky noted that their analytical and QC records indicated that the laboratory followed sample handling, preparation and analytical protocols and procedures as per their Quality Management System. Historical records indicated all staff were adequately trained and competent to do the analyses. Methods were well documented and met all prescribed requirements and protocols were being followed at the time of the inspection.

Mr. Brodsky concludes that it is beyond the scope of the investigation to determine the source of this contamination, but based on the findings from the audit of the contract lab, the positive findings were validated and supported by ALS quality management system.

B3 Sample Collection and Laboratory Protocol-ORIGINAL

Sample Collection and Laboratory Protocol

Data considered above focuses on scenarios where the positive TC samples from January 26 originated from some form of contamination of the public water supply. Another consideration is that the positive samples resulted from a contamination event during the sampling or analysis processes. As an element of this assessment, the sampling and analytical protocol typical of that on January 26 was reviewed in detail. Findings during these reviews are provided below.

Sampling Protocol Review

On February 25, 2015, the consultant met with the sample collector at sample location NE-07 at approximately 10:00 am. This was an unannounced review, and the sample collector was met at the 4th of 14 sample stops. The consultant rode with the sample collector to the end of the route, and followed the samples into the laboratory for analysis.

The sample protocol followed was consistent, but there were several areas of improvement that were noted during the review:

- Many sample taps had aerators which could not be removed by the sample collector. This included "tamper proof" aerators which required a special tool for removal (which the sample collector did not have. Microbiological sampling from taps with aerators attached is not recommended.
- Inability to remove aerators affects the amount of water flowing from the faucet, and thus extends flushing time required to clear the service line back to the main. Temperature stability was used as an indication when the sample line had been adequately flushed. COW should considered a volumetric requirement for flushing at each sample location, with sample collectors checking flowrates at max flush volume to assure the flush time and volume is adequate to clear the sample line.

Laboratory Protocol Review

Samples were received at a common reception desk for all samples arriving at the laboratory. Samples from COW were labeled, arranged by sample ID number, analyzed for HPC, prepared for analysis by Colilert QuantiTray technique for TC and EC, placed into QuantiTrays, and incubated. After the samples were processed for HPC, the labels were stamped noting HPCs had been completed, and transferred to the Colilert prep bench. At this point, any excess water above the 100 ml mark on the sample bottle was decanted using a vacuum tube. Samples were then transferred to the bench where the Colilert media was added, and the QuantiTray was sealed. Sealed QuantiTrays were placed in an incubator.

The overall technique of the 4 lab personnel involved in the analytical process was methodical and clean. Areas for improvement were observed and are noted below:

- The order of analysis was the order provided by COW on the chain of custody sheet. The samples should be ordered from "cleanest" to "least clean", based on the source of the sample. Under this protocol, raw water samples and construction-related samples would be numbered to be at the end of the analytical protocol, reducing the possibility that the cleaner samples are contaminated by less clean samples.
- COW drinking water samples may be analyzed in a batch with samples from other sources. COW should request that their samples be run as a separate batch, isolated from any other samples of unknown source.
- The vacuum decantation step used to adjust the volume of sample in the sample bottle after HPC analysis and before EC/TC analysis is not standard protocol and should not be used on COW samples. This technique increases the risk of contamination between the HPC step and the TC/EC step in the analytical process.
- The chain of custody sheet (or similar formal documentation) should be initialed by the analyst at the end of each analytical step in the process to allow retrospective analysis of results.

AECOM

B4 Recommendations for Improvement - Hubbs 4-16-2015

RECOMMENDATIONS FOR IMPROVEMENT – Hubbs, 4-16-2015 (not prioritized)

SAMPLING and ANALYSIS

1. Evaluate sampling process for QC improvement, start to finish
    a. Receipt and storage of sample bottles (away from potential contaminant sources)
    b. Scheduling-sample field notes/sheets, COC, assigned order for analysis (cleanest to dirtiest)
    c. Consider collecting/analyzing samples more days of the week (4 days with 10 samples per day is better/more protective than one day with 40 samples)
    d. Transit: coolers, vehicle, time of day
    e. Sample locations: representative of DS, cleanliness, availability for recheck. Consider using City employee homes as sample collection points.
    f. Sample taps: routine use, representative of DS, potential for contamination, aerators
    g. Sample tap disinfection: consider best method for sample tap being used. (dip-disinfection may be better for taps with aerators on, swab/spray may be better for aerators off)
    h. Sample collection protocol (flushing time and temperature, order of field analysis, handling the lid, documentation)
    i. Storage after sampling (cooler, plus anomalies for overnight storage prior to analysis)
    j. Other suggestions (monitor DS more frequently – Monday to Thursday sampling (10 per day), and at key points from source into DS daily.)
2. Work with analytical lab to reduce possibility of contamination
    a. Receipt procedures-perhaps isolating TCR samples from all others
    b. Sample labeling, documentation and order of analysis, including technique used in sample prep for analysis and COC sign-off between analysis (such as decant vs pour-off)
    c. Improved volume adjustment protocol (consider combining volume adjustment with the HPC prep step, using sterile 10 ml pipette to bring volume down to 100ml, and using this same extracted volume for the HPC plate (1 ml HPC volume recommended over 0.1 ml). This reduces the number of times the sample bottle is opened after sampling from 3 to 2, reduces the number of steps in TC prep from 2 to 1 requires no additional apparatus (only a fresh sterile disposable pipette is used for HPC extraction and volume adjustment).
    d. Pour-off volume adjustment for TC analysis is not recommended, as this step can increase potential for contamination from sink splash.
    e. Consider increasing sample volume for HPC to 1ml (currently set at 0.1 ml).
3. QC testing at City facilities
    a. Most TCR samples are negative, and QuantiTray at contract lab provides quantification of any positive samples. The City should consider setting up a QC activity that initially involves presence/absence (P/A) testing of some or all TCR samples. This would not need to be certified (TCR samples come from contract lab), but should be operated according to certification standards to the extent possible. Requirements are modest: approximately 4 feet of clean countertop for 30 minutes per day, analyst time less approximately 30 minutes per day, in a relatively clean room (sterility not required, but limited airborne dust and clean conditions are important). Unit cost per analysis is approximately $2, and set-up costs can range from $500 to $5000.
    b. Non-regulatory testing could be moved to this facility (main breaks, flushing, etc.)
4. Other
    a. Potential contaminant exposure risk from flooded automatic air relief valves should be evaluated.

B5 Appendix on Sampling Audit - Recommendations and City Response

Appendix B.5: Lipinsky's Sampling Audit: Recommendations, Action Items, and City Response (From Lipinski Report on Sampling)

		Type
3	**Management Review** **Quality System** **Requirement** Top management ensures that the integrity of the management system is maintained when changes to the management system are planned and implemented **Observation/Recommendation** Impact of changes should be studied. These changes could include sampling method and other method revisions, and assignment of staff to multiple activities of which some may be incompatible. **Action taken/Implementation** This item is currently **already included in the City of Winnipeg's Quality Manual** and is **addressed yearly** in the Quality Manual. This will be discussed again in **October/November 2015** at yearly at Quality Management meeting as per CALA accreditation requirement.	**R**
4	**Management Review** **Sub-Contracting** **Requirement** Subcontractors are competent and maintain records of competent subcontractors used. **Observation/Recommendation** Besides reviewing the accreditation of a sub-contract laboratory, consider an on-site assessment and/or submission of blind proficiency check samples or splitting samples between laboratories. Of extreme importance in microbiological testing is the separation of drinking water samples from high bacteria level samples throughout the sample reception, storage and testing phases at the contract laboratory. **Action taken/Implementation** The ASB has already submitted control samples to the contract laboratory, and has incorporated this into the routine work. Do to the sensitivity of the samples; this will be done on a bi-weekly basis. Since these are submitted as blind samples, the contract lab will not be aware of what samples are controls. (Eight controls have already been submitted.). The control schedule as to when samples will be submitted is included in the revised SOP which will come into effect no later than April 30, 2015. Sample treatment requirement will be addressed in the upcoming contract to address how we require the contract lab to handle our samples as well as yearly on-site assessment will be conducted by City staff or delegate party. This will be in effect by June 30, 2015.	**R**

5	**Management Review** **Supplies** **Requirement** There are policies and procedures related to procurement of supplies and services, and reception and storage of supplies with associated records.	**A**

	Observation/Recommendation There are no records related to the reception of microbiological sample bottles from the contract laboratory, which should include a lot identification as well as traceability to cleanliness records. The sampling procedure also refers to keeping sample bottles in a box within a plastic bag. In practice, sample bottles were observed in a drawer.	
	Action taken/Implementation The laboratory has purchased the necessary supplies for "bagging" the clean sample bottles and have selected a procedure for documenting the "Lot ID" of the sample bottles. ALS has not submitted the COC with the sample bottles, so we will therefore download them ourselves. The Lot IDs will be included on the ALS Chain of Custody forms. The procedure for documenting this is included in the revised SOP which will come into effect no later than April 30, 2015.	
7	**Quality Management** **Internal Audits** **Requirement** Internal audits and method document reviews are periodically conducted to verify operations comply with all elements of the quality system and requirements of ISO/IEC 17025:2005; ensure that internal audits follow a predetermined schedule and procedure **Observation/Recommendation** The laboratory has focused on performing internal audits on in-house testing as well as other elements of their quality system. There were no records of an internal audit of the sampling method used to collect samples that are sent to a contract laboratory. An internal audit is required for all laboratory processes.	**A**
	Action taken/Implementation The assessor conducted the audit of the Sampling SOP so another audit is not required until the revision is complete and a timeline is determined for how often non-accredited methods require re-view or auditing. This item will be brought forward in our yearly Quality Management meeting to discuss how this item will be resolved and implemented. Implement is 1 to 3 years.	

9	**Technical Management** **Test Method** **Requirement** The laboratory selects test methods that are in latest international, regional or national standards (unless it is not appropriate or possible); the standard shall be supplemented with additional details to ensure consistent application. **Observation/Recommendation** The laboratory is following a sampling procedure based on Manitoba Government sampling requirements. It is recommended that the laboratory consider the procedure in Standard Methods 9060a as a continual improvement item. Standard Methods 9060a requires a cold water tap to be run for 2-3 minutes before sampling. If the tap cleanliness is unknown, the faucet has to be disinfected, both inside and outside, and then having the water run an additional 2-3 minutes after treatment. As well, if sampling from a mixing faucet, run hot water for 2 minutes and then cold water for 2-3 minutes before collecting a sample.	**R**
	Action taken/Implementation Based on our internal study, the hot water has no "positive" effect. Since hot water tanks are prone to bacterial contamination and growth (if the temperature is too low), running the hot water can introduce more HPC. The cold water flushing is most effective. We continue to clean the faucets with a disinfection technique based on standard method. Our method currently includes a 3 minute run; we also use the temperature to help us determine water stability and to help determine that the water is from the watermain. The procedure for instructing this is included in the revised SOP which will come into effect no later than April 30, 2015.	
10	**Technical Management** **Validation** **Requirement** Method validation includes records of validation, the procedure used, and a statement that the method is fit for the intended use. **Observation/Recommendation** Consider the use of replicate samples and field blanks for microbiological water sampling. As well, consider studying worse case scenarios involving no disinfection of faucets and hands or pre-sampling water flow.	**R**
	Action taken/Implementation We will be implementing more field duplicate sampling and also be adding additional Quality Control samples when doing retesting. Field blanks studies will also be examined and will be added if found to be effective different studies of environmental conditions that will be conducted. A study was conducted, on the worse case scenarios involving no disinfection and more information will need to be collected for more validation of the method. It was determined that in worst case simulations, positive samples were hard to come by. This will be evaluated further when discussions occur on auditing/reviewing as discussed under item 7. This is a continual improvement item that will always be on going with every review and audit.	
11	**Technical Management** **Method** Procedures for sampling are available at the location where required	**A**

	Observation/Recommendation Sampling method documentation was not available in the field.	
	Action taken/Implementation A short condensed version will be supplied to all technicians when sampling in the field. To be implemented by April 30th 2015. The addition of our new LIMS system and mobile technology will allow for more documents to be available for technician use in the field. This is in our 3 year plan.	
12	**Technical Management** **Handling Samples** **Requirement** For sample handling, verify that there are documented procedures specified to protect the integrity of the sample from time of sampling to sample processing (including pre and post analysis storage) including, but not limited to: use of sterile approved sample containers **Observation/Recommendation** Unused sample bottles are handled by a number of people without any special precautions (sanitized hands, clean gloves). They are removed from the shipment box, placed into drawers, and placed into coolers without any cleanliness precautions. The use of gloves, Zip-Lock type of bags or other measures should be considered to protect the cleanliness integrity of the bottles. Samplers should also not be engaged in any activities, prior to drinking water sampling, that might contaminate their person or clothing.	**R**
	Action taken/Implementation See item 3 and item 5 as to how this will be addressed.	

13	**Sampling Method Review** **Requirement** All necessary successive steps in the test procedure are adequately documented in the test method **Observation/Recommendation** The use of spray isopropyl disinfectant and paper towel wipe down is not specifically documented. The documented procedure requires that the sampling point be swabbed with an alcohol solution or sanitary wipes saturated with alcohol. This recently replaced the immersing of the faucet into a cup of methanol. Standard Methods 9060a requires that the faucet be disinfected both inside and out, which is achieved by immersing the faucet into a cup of alcohol.	**A**
	Action taken/Implementation This item has been addressed in the updated revised SOP in which the use of 70% isopropyl or ethanol will be used by immersing the faucet into a cup of this solution for a minimum of 10 second and no swabbing will be performed. This technique will allow for proper disinfection of both the inside and outside of the tap. The procedure for instructing this is included in the revised SOP which will come into effect no later than April 30, 2015.	
14	**Sampling Method Review** **Requirement** All necessary successive steps in the test procedure are adequately documented in the test method **Observation/Recommendation** The cleaning of coolers and ice packs is documented to be done regularly without a specific frequency. In practice, coolers are cleaned immediately before use in the field. Ice packs are not cleaned before use.	**A**
	Action taken/Implementation The laboratory will use zip-lock bags for the freezer packs, which creates a physical barrier and separation that is more effective than cleaning. Documentation and check list have been developed to implement these items above and are addressed in the revised SOP and related SWI which will come into effect no later than April 30, 2015.	
15	**Sampling Method Review** **Requirement** All necessary successive steps in the test procedure are adequately documented in the test method or supporting documentation. **Observation/Recommendation** Sampling sites, in terms of buildings, are documented. However, specific sinks at the sampling sites are not documented.	**A**
	Action taken/Implementation The sink inventory is being done and more information is being collected on the site and alternate sites. There will be a complete list of exact locations for sampling at each location. This is currently being collected and will be completed by December 2015.	
16	**Sampling Method Review** **Requirement** All necessary successive steps in the test procedure are adequately documented in the test method	**A**

	Observation/Recommendation Sampling site NE01 is identified in Appendix B as an [redacted] when in fact it is a [redacted] All locations should be reviewed for accuracy.	
	Action taken/Implementation Corrected in the updated revised SOP appendix that's in effect by no later than April 30, 2015.	
17	**Sampling Method Review** **Requirement** All necessary successive steps in the test procedure are adequately documented in the test method **Observation/Recommendation** Vehicle steering wheels are being cleaned with a sanitary wipe on each sampling trip. Vehicle seats are to also be free of contamination and cleaned regularly, however this does not appear to be done regularly. The phrase "Free of contamination' should be clarified and a cleaning log should be maintained.	**A**
	Action taken/Implementation The wording will be revised. The procedure is to wipe down the dust. The steering wheel is contaminated from normal use and has no effect on sample contamination when proper handling procedures are followed. **This item has been addressed in the revised SOP that comes into effect no later than April 30, 2015.**	

18	**Sampling Method Review** **Requirement** All necessary successive steps in the test procedure are adequately documented in the test method **Observation/Recommendation** It is recommended that the conditions of the sampling point (for example, the use of the sink) be noted if they had changed from the previous sampling. This could be addressed by the use of a checklist item, possibly supported with photographs. The cleanliness of the sampling area, including the tap and the sink also has to be assessed and recorded. Also include recording of other environmental conditions that could impact testing.	**R**
	Action taken/Implementation See item 15 as a picture of the **sinks** will be collected in collecting the information about the sample sinks. Effective **December 2015**. As for the **observation documentation**, what is expected to be documented has been noted in the revised SOP which will come into effect **no later than April 30, 2015.**	
19	**Sampling Method Review** **Requirement** All necessary successive steps in the test procedure are adequately documented in the test method **Observation/Recommendation** It is recommended that a check for hot water entering into the sample through the tap be performed.	**R**
	Action taken/Implementation **Covered by the Cross-connection section in Compliance Branch**. The establishments must follow the plumbing codes, (check valves, back-flow preventers, etc.), so there is very little chance of hot water entering the system. This can only be determined by a licensed plumber. **Sampling personnel check for a "leaking tap/faucet"**, which indicates that a valve isn't closing properly or that a seal is worn. If this is occurring, it is reported to the owner, and a different sink/tap is used and noted in the job or sample comment. Also a procedure is in place **when if a sink tap is found to be leaking and no other location is available**; the procedure and instructions for this is **included in the revised SOP which will come into effect no later than April 30, 2015**.	
20	**Sampling Method Review** **Requirement** All necessary successive steps in the test procedure are adequately documented in the test method **Observation/Recommendation** The sampling procedure states that fingers should not touch the inside of the sample bottle lid, but there is no mention of not touching the inside of the bottle neck which is a RTCR and Standard Methods 9060a requirement. In practice, the sampling technician was careful not to touch any internal surface.	**A**
	Action taken/Implementation This is noted in the revised SOP which will come into effect **no later than April 30, 2015**.	

21	**Sampling Method Review** **Requirement** All necessary successive steps in the test procedure are adequately documented in the test method **Observation/Recommendation** The recording into LIMS of the non-removal of the aerator has recently been put into effect but this requirement to record the non-removal is not documented in method. The non-removal is recorded on the worksheet as specified in the sampling method documentation.	**A**
	Action taken/Implementation The laboratory has purchased several tools to assist with the removal of the aerators. The new practice is to remove the aerator. There are only a few cases, where the owner has disallowed the removal or they have permanently glued it on. How to deal with these cases are stated in the revised SOP which will come into effect no later than April 30, 2015.	

22	**Sampling Method Review** **Requirement** The test procedure and all supporting work instructions are performed as documented **Observation/Recommendation** The sampling method states that hands should be being washed/sanitized prior to the handling of sampling equipment and testing equipment. In practice, a hand sanitizer is being applied in the vehicle before the start of the sampling route. It is recommended that hands should be cleaned after the chlorine test and just before water sample is taken at every sample point. The use of a clean pair of disposable gloves at each sample point would also be acceptable.	**R**
	Action taken/Implementation There is no requirement in the strict EPA guidelines or Standard Methods for sanitizing the hands at every location before sampling. Cleanliness is part of the GLP. Our studies, where the sample bottles were purposely contaminated with wastewater, all came back negative! The sampling personnel are highly educated and knowledgeable staff, some are microbiologists. It is expected of them that they wash their hands prior to sampling. All gloves are intended as safety protection for the person, and not to prevent contamination. This would only introduce another source for possible contamination in the field. This item will not be implemented as other disinfection and sanitation procedures are in the revised SOP which will come into effect no later than April 30, 2015.	
23	**Sampling Method Review** **Requirement** The test procedure and all supporting work instructions are performed as documented **Observation/Recommendation** A field log book is not used during sampling as indicated in the sampling method. Data is only recorded on LIMS worksheets.	**A**

	Action taken/Implementation There is no requirement to use a "logbook". The requirement is that "abnormal", unusual and non-conforming information is documented and included in the final report, via the LIMS. A logbook is one way of doing it, but not the only way. **Wording is been updated** in the revised SOP which will come into effect no later than **April 30, 2015**.	
24	**Sampling Method Review** **Requirement** The test procedure and all supporting work instructions are performed as documented **Observation/Recommendation** The sample hold time in the procedure, "Sample ID, Preservation and Holding Times, SWI# 17-03", for bacteriological testing is stated as 48 hours whereas the MB ODW Guideline has a required hold time of 24 hours. In practice samples are dropped off at the testing laboratory the same day.	**A**
	Action taken/Implementation **Clarification as to required hold times has been updated in the SOP and SWI** to indicate what is required under our procedure. Standard Methods is the required time that needs to be met which is 24hours for TC& EC and 30 hours for HPC. These times will be followed for sample integrity. The required time under MB ODW Guidelines will be followed as best as possible and is used as what we operate under. **This is in the revised SOP which will come into effect no later than April 30, 2015.**	

Section 2 - Management System Review Checklist

				Requirement Met			
	Section	**ISO 17025 Clause**	**Requirement**	**Yes**	**No**	**Comment**	**Action Items**
1	Organization	Place of Staff in Organization Objectives 4.1.5k	Verify that laboratory staff are aware of the relevance and importance of their activities and how they contribute to the achievement of the objectives of the management system	✓		Very knowledgeable, competent and dedicated staff	
2	Organization	Laboratory Supervision 4.1.5g	Verify that the laboratory provides adequate supervision of personnel for testing activities	✓			
3	Quality System	Planned Changes 4.2.7	Verify that top management ensures that the integrity of the management system is maintained when changes to the management system are planned and implemented	✓		The laboratory Quality Manual has a number of references to change management.	
4	Document Control	Availability 4.3.2	Verify that the current authorized test method and supporting work instructions are available	✓			
5	Document Control	Availability 4.3.2.2	Verify that all quality documentation (including instructions, standards, manuals and reference data) is available where required		✓	Sampling and testing procedures are not available in the field	Section 1 Item 11
6	Subcontracting of Tests	Competency 4.5.1,	Verify that that subcontractors are competent and maintain records of competent subcontractors used	✓		In addition to reviewing contract lab accreditation, consider submitting proficiency testing samples	
7	Supplies	Policies and Procedures 4.6.1	Document policies and procedures related to: • procurement of supplies and services • reception and storage of supplies • sufficient information to establish an audit trail		✓	There are no records related to the reception of sample bottles from the contract laboratory. The procedure also refers to keeping bottles in a box within a plastic bag. Bottles were observed in a drawer.	Section 1 Item 5 & 12
8	Control of Records	Technical Records4.13.2	Verify that the laboratory retains technical records of: • all original observations • sufficient information to establish an audit trail • personnel responsible for the sampling	✓		The laboratory has an excellent LIMS for tracking all data related to sampling and testing	
9	Control of Records	Recording 4.13.2.2	Verify that observations, data and calculations are recorded at the time they are made and be identifiable to the specific task	✓			
10	Internal Audits	Internal Audit Requirements 4.14	Verify that internal audits are periodically conducted to verify operations comply with all elements of the quality system and requirements of 17025:2005;		✓	There were no internal audit records for the sampling procedure	Section 1 Item 7

Section 3 - Technical System Review Checklist

				Requirement Met			
	Section	**ISO 17025 Clause**	**Requirement**	**Yes**	**No**	**Comment**	**Action**
11	Personnel	Qualifications 5.2.1	Verify that personnel performing specific tasks are qualified on the basis of education, training, experience and/or demonstrated skills.	✓			
12	Personnel	Employees 5.2.3	Verify that personnel are employed by the laboratory, and verify that personnel are supervised, competent and work in accordance with the quality system.	✓			
13	Personnel	Authorized Personnel 5.2.5	Verify that management has authorized specific personnel to perform specific sampling, testing and operate particular types of equipment	✓			
14	Personnel	Records 5.2.5	Verify that the laboratory maintains readily-available records for all technical personnel for: • competence, and date confirmed • educational and professional qualifications; • training, skills and experience.	✓			
15	Accommodation/ Environmental Conditions	Technical Requirements 5.3.1	Verify that technical requirements for accommodation and environmental conditions that can affect results are documented.	✓			
16	Accommodation/ Environmental Conditions	Facility 5.3.1	Verify that the laboratory or off-site facility accommodation and environmental conditions do not compromise the quality of results.	✓			
17	Accommodation/ Environmental Conditions	Monitoring 5.3.2	Verify that the laboratory monitors, controls and records environmental conditions, where applicable.	✓			
18	Accommodation/ Environmental Conditions	Incompatible Activities 5.3.3	Verify that there is effective separation between areas of incompatible activity, and that measures are taken to prevent cross-contamination	✓			
19	Accommodation/ Environmental Conditions	Storage	Verify that all supplies are stored under appropriate conditions and in a manner that satisfies requirements for safety, security, separation of incompatible materials, and ease of retrieval.	✓			

21	Methods and Validation	Method Selection 5.4.2	Verify that the laboratory selects methods that: • meet the needs of the customer • are appropriate for the test • are in latest international, regional or national standards (unless it is not appropriate or possible); the standard shall be supplemented with additional details to verify consistent application	✓		The laboratory is currently following the sampling procedures as specified by the Manitoba Government. As a continual improvement item, consider Standard Methods 9060a sampling procedure.	
22	Methods and Validation	Method Procedure	Verify that all necessary successive steps in the procedure are appropriate: • sample containers; • storage conditions; • holding time.	✓		The samples are collected in the appropriate sample bottle and are kept cool in a cooler with ice packs. The samples are dropped off at the contract laboratory upon the completion of sampling. The procedure should include the requirement not to touch the inside of the sample bottle. In practice, the samples were being taken correctly.	

23	Methods and Validation	Conduct of Testing 5.4.1	Verify that the test procedure and all supporting work instructions are performed as documented.		✓	The Manitoba Government sampling procedures are being followed, however, there are some inconsistencies in the documented method: - The use of spray isopropyl disinfectant and paper towel wipe down is not documented - Ice packs are not cleaned - specific sinks at a site are not identified - Site NE01 is not identified correctly - Vehicle cleaning is not done regularly - The recording of non-removal of the aerator into LIMS is not documented - A field logbook is no longer being used	Section 1- Item 13, 14, 15, 16, 17, 18, 21 ,23
24	Methods and Validation	Published Reference Methods (or Standard Methods) 5.4.2	For published reference methods (or standard methods), verify that the laboratory has: • confirmed that it can properly operate standard methods; • repeated the confirmation if the standard method changed.	✓		The laboratory is following the Manitoba Government sampling procedure.	

25	Methods and Validation	Method Validation 5.4.5	Verify that the method validation includes records of validation and the procedure used.	NA	NA	It is recommended that the robustness of the sampling be validated. This would involve determining the level of bacterial contamination in the sampling areas as well as determining the importance of the various sampling precautions to prevent contamination.	
26	Traceability	Calibration Program 5.6.1, 5.6.2	Verify that the testing laboratory has a calibration program for its measurement and test equipment	✓		Thermometer using in sampling has required traceability record.	
27	Sampling	Procedures and Plan5.7.1	Verify that procedures for sampling are available at the location where required, and include: • a sampling plan • factors to be controlled to verify the validity of the results • withdrawal and preparation of samples.	✓			
28	Sampling	Records 5.7.3	Verify that the laboratory has procedures for recording sampling data and operations; records to include: • sampling procedure • sampler identification • environmental conditions (if relevant) • sampling location;	✓			
29	Handling of Test Items	Procedures 5.8.1, 5.8.4	Document procedures for test item management: • transportation • receipt • handling and preparation • protection • storage	✓			
30	Handling of Test Items	Identification 5.8.2	Verify that the laboratory has a system for identifying test items	✓			
31	Handling of Test Items	Facilities 5.8.4	Verify that the laboratory has appropriate facilities to maintain item integrity, and the protection of secured items	✓			
32	Handling of Test Items	Environmental Conditions 5.8.4	Verify that required environmental conditions for items are maintained, monitored and recorded, as appropriate.	✓			
33	Handling of Test Items	Handling Instructions 5.8.4	Verify that any handling instructions provided with the test item are followed.	✓			

B.6 ATL Site
Inspection Feb 25, 2015

ATL visit, February 25, 2015: Steve Hubbs, Courtney Diduck

Noting that a potential scenario for the January 26 event included sample contamination between the HPC step and the TC QuantiTray step, the COW samples collected on February 25 were followed from sample collection through transfer to the contract laboratory (ATL), through the analytical process, and into the incubator. Each step from when the sample was delivered to ATL is described below:

1. We (Hubbs and Diduck) were met at the lab by supervisor 1, and introduced us to Linda Neimor (ATL National Quality Manager, Canada). We were briefly interviewed after the samples were received by the lab, and were asked to sign a confidentiality agreement (attached). We proceeded to the lab area, and were met with supervisor 2, who accompanied us on the visit. Supervisor 3, who was responsible for the microbiology section of the lab, was introduced briefly as she was leaving for the day.
2. Samples were placed on the counter at the reception desk and the Chain of Custody (COC) form was signed. These samples were then placed on a cart by the ATL staff #1 for logging into the ATL Laboratory Information Management System (LIMS). The cart also contained other samples, and the COW samples were isolated on the cart separately.
3. The COC form was taken by ATL staff #2 and labels were prepared based on information provided on the COC.
4. Labels were placed on the individual sample bottles by ATL staff #2 while bottles remained in the cart. The bottles were ordered in sequence according to the order provided on the COC form.
5. ATL staff #2 delivered the cart to HPC analysis bench where ATL staff #3 started the analysis for HPC.
   5.1. ATL staff #3 arranged HPC "pour plates" onto a freshly disinfected bench and double-checked the number of plates needed for the analysis, including the QC plates.
   5.2. Plates were numbered, after which the staff #3 applied disinfectant to gloved hands.
   5.3. The first sample bottle in the sequence was opened and a 0.1 ml aliquot was removed from the sample bottle and placed into the corner of each plate using a micropipette with disposable tips. The pipette tip was discarded, and the analyst repeated the process for each sample.
   5.4. QC plates were included at the start and end of the sequence, and duplicates were included from randomly selected samples.
   5.5. HPC media in a flask was removed from a nearby warm water bath, the exterior of the flask was dried with a paper towel, the mouth of the flask was flamed, and media was poured into a tilted plate away from the sample aliquot.
   5.6. The plate was swirled and left to sit on the bench until the media had solidified. The flask mouth was flamed and replaced in the warm water bath. (From this point on the HPC plates were no longer followed.)
   5.7. The sample bottle labels were each stamped to indicate that the HPC analysis on this sample had been completed, and each sample was placed back onto the cart and taken to an adjacent bench for TC QuantiTray preparation.
6. ATL staff #4 received the cart and aligned the samples for analysis by the IDEXX QuantiTray technique.

6.1. The lab bench was cleared and a disinfectant was applied to the surface, and the analyst applied disinfectant to gloved hands.

6.2. Sample bottles were placed in line parallel with the front of the bench and visually inspected for volume (compared against the 100 ml mark on the bottle). (See picture 5).

6.3. At this time, a step that I am not familiar with was executed. Any sample bottle that had been overfilled was decanted off to the 100 ml mark using an aspirator as follows:

6.3.1. A large Erlenmeyer flask (4 liter) was attached to a suction source at the upper horizontal port of the flask, with a drain line at the bottom. A length of flexible suction hose (estimated at about 1.5 meter in length and 1 cm outer diameter, long enough to reach each sample bottle in the sequence) was attached to the top opening through a rubber stopper (See picture 5). The flask contained approximately 700 ml (below the 1 liter mark) of discolored water.

6.3.2. For any sample bottle that was overfilled, the analyst would take a glass tube shaped to a tip (estimated at approximately 15 cm long and 0.5 cm diameter) from a glass beaker partially covered with aluminum foil, place the glass tip into the end of the suction hose, remove the lid from the sample container, suction out the excess water from the sample, replace the lid, and discard the tip into another beaker. This process was repeated for each sample that was overfilled. It is estimated that approximately half of the sample bottles required this step.

6.3.3. After each decantation, and after the glass tube was removed, the suction hose was placed on the bench. A small amount of water was observed "gurgling" in the hose and not reaching the Erlenmeyer flask. At one time the suction hose slipped off of the bench and hung vertically over the front of the bench (Indicated in picture 5. Uncropped picture more clearly shows this condition).

6.3.4. After this process was completed, the supervisors were asked if this was a standard technique. Both supervisors indicated that the analysts were allowed to use this technique, or to simply pour off the excess into a sink.

6.3.5. I advised the supervisors at this point that this was a process I was unfamiliar with, and that the process looked like a contamination risk. I also suggested that the suction hose should be discarded and the Flask cleaned.

6.3.6. NOTE: Estimating that less than 10% of sample was decanted (10 ml) from each sample containers, as many as 70 samples (of unknown source) had been decanted in a similar manner since the Erlenmeyer flask had been emptied. The suction hose was discolored with what appeared to be biological growth (biofilm) (see picture 5).

6.4. The samples from the decantation step were lined up on a bench immediately across from the preparation bench top. ATL staff #5 applied disinfectant to the bench top and to gloved hands.

6.4.1. QuantiTrays were removed from an upper shelf of the bench and counted. Additional trays were stored in a nearby case stocked with only QuantiTrays. (see picture 6).

6.4.2. The first sample bottle in the sequence was opened, the a tray was picked up, "squeezed" open by placing a thumb on the backing tab, and the sample was poured in. The tray was immediately placed into one of two sealers.

6.4.3. Step 6.4.2.was repeated until all trays were sealed. The trays were stacked in groups of about 10, and placed on the bench near the sealers.

6.4.4. When all samples were sealed, the trays were placed on the cart and moved to the incubator where they were placed on a shelf separate from other samples.

7. Exit interview. After the process was completed (roughly 50 minutes from reception desk to incubator), we met again with Linda Neimor. She asked for our observations, and I noted that the primary item I observed to be atypical was the decantation step between the HPC analysis and the QuantiTray TC/EC analysis. I showed her the pictures and a short video that I had taken during the visit. We agreed to amend the confidentiality agreement to include pictures and videos. She stated that the decantation step was not a standard procedure. Other minor issues were discussed (thumb on the QuantiTray tab). Discussing the overall event of January 26, Neimor noted that the contamination, containing several different genotypes of EC, had to come from somewhere, to which we all agreed.
8. On the drive between the ATL lab and the North Plant, I decided that we should ask ATL to run a QC check on the decantation /suction apparatus, specifically on the suction hose to which the glass tubes were attached. Upon reaching the North Plant, Courtney called the ATL lab, and was told the process was already under QC review.
9. In an email string over the next 14 hours, I recommended that any QC review should include the step of running sterile water through the vacuum tube to determine if the tube and the attached biofilm could have been the source of the contamination on January 26. Note that the time stamp on Hubbs emails below are logged as Eastern time zone (subtract 1 hour for Winnipeg time). The sequence below is chronologically correct.

-------- Original message --------
From: Steve Hubbs [redacted]
Date:02/25/2015 6:27 PM (GMT-05:00)
To: linda.neimor [redacted]
Cc:
Subject: Decant suction tube.
hi linda this is Steve Hhbbs. Regarding our discussion today, would you please run a TC and EC on a sterile sample of water run through the suction tube In the decant system for collect analysis system.

-------- Original message --------
From: Linda Neimor [redacted]
Date:02/25/2015 5:36 PM (GMT-06:00)
To: Steve Hubbs [redacted]>
Cc: Kayla Harold [redacted] Barb Bayer [redacted]
Subject: RE: Decant suction tube.
I have already asked for a series of blanks to be prepared by overfilling sample bottles with sterile water and then reducing the volume to 100 mLs using this apparatus.
That will be more indicative of sample treatment and possible impacts.
Regards,
Linda
Linda Neimor

-------- Original message --------
From: Steve Hubbs
Date:02/25/2015 9:58 PM (GMT-05:00)
To: Linda Neimor
Cc:
Subject: RE: Decant suction tube.
I was just thinking that the material in the tube should be checked to see if it is a possible source. The gurgling in the tube could be such that back flow might only happen only if the tube were extended vertically down as might happen if dropped...which might not occur except under unusual circumstances. If the tube is free of TC/EC this becomes an unlikely source. If present it might be a potential source.
Steve

-------- Original message --------
From: Linda Neimor
Date:02/26/2015 7:16 AM (GMT-05:00)
To: Steve Hubbs
Cc:
Subject: Re: Decant suction tube.
Yes, that's why I asked for the study. It's not so much what is in the tube, but if it in some way can contaminate the samples in the way it was being used.
Linda Neimor

-------- Original message --------
From: Steve Hubbs
Date:02/26/2015 8:52 AM (GMT-05:00)
To: Linda Neimor
Cc:
Subject: Re: Decant suction tube.
I still feel strongly that you should check what is in the tube. It is difficult to simulate all operating conditions that occur in the process of analyzing thousands of samples.

-------- Original message --------
From: Linda Neimor
Date:02/26/2015 9:13 AM (GMT-05:00)
To: "Steve Hubbs
Cc:
Subject: pictures
Hi Steve,
I only received the picture of the suction tube.
Can you resend the picture of opening the trays?
Thanks
Linda

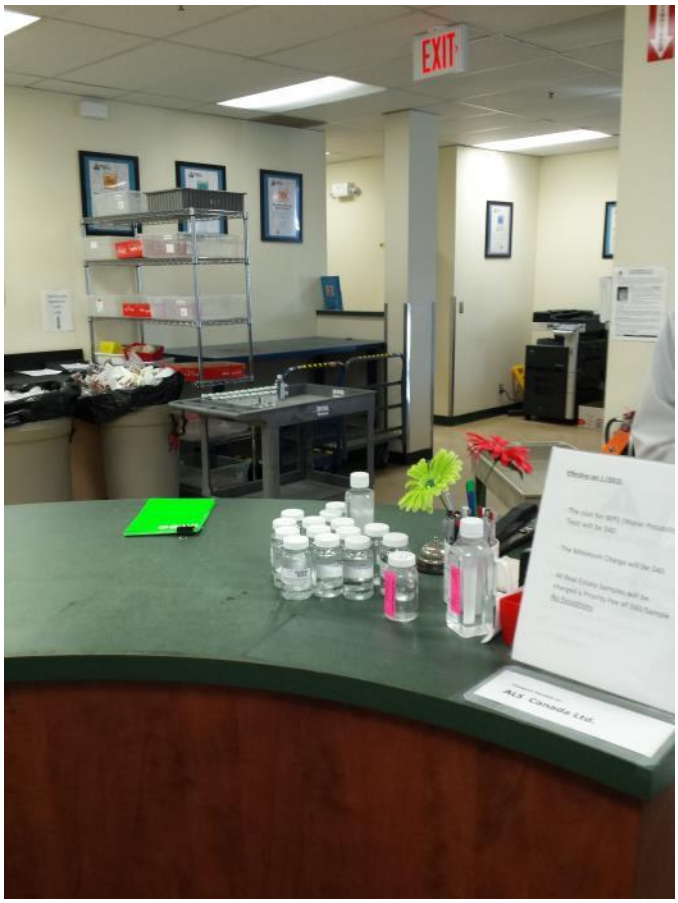

Picture 1 – Reception Area

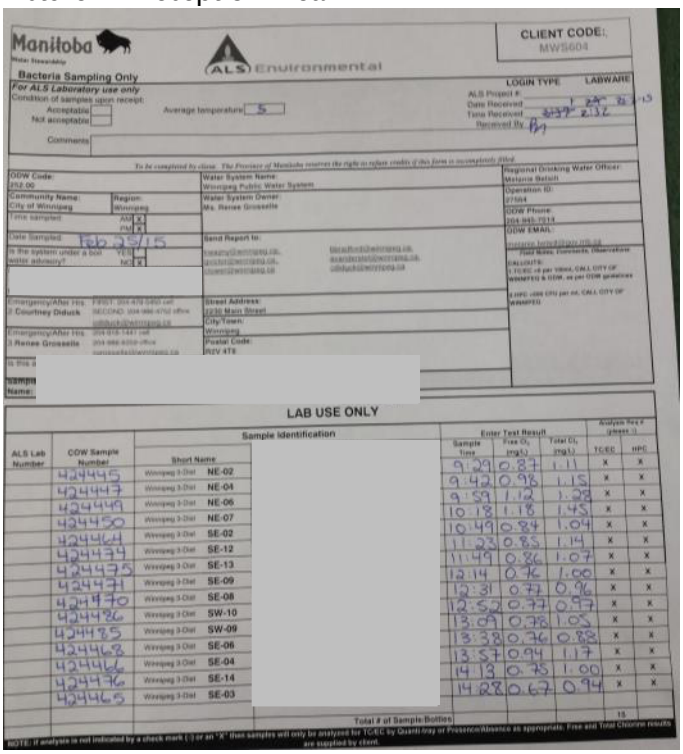

Picture 2 – Chain of Custody form

Picture 3 – Prep for HPC analysis

Picture 4 – HPC plates cooling prior to inverting

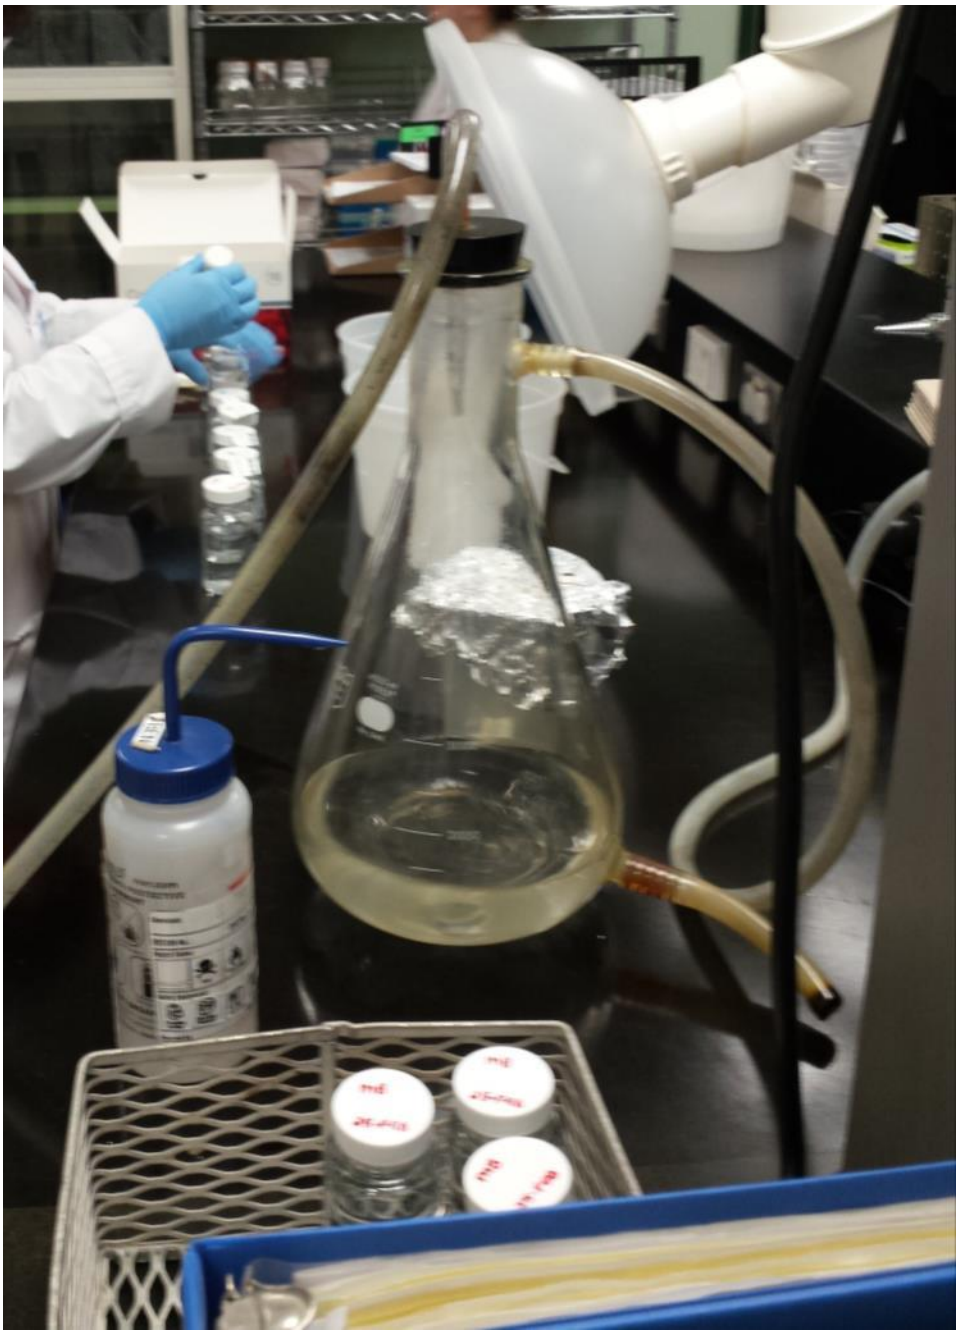

Picture 5 – Decanting step for QuantiTray analysis

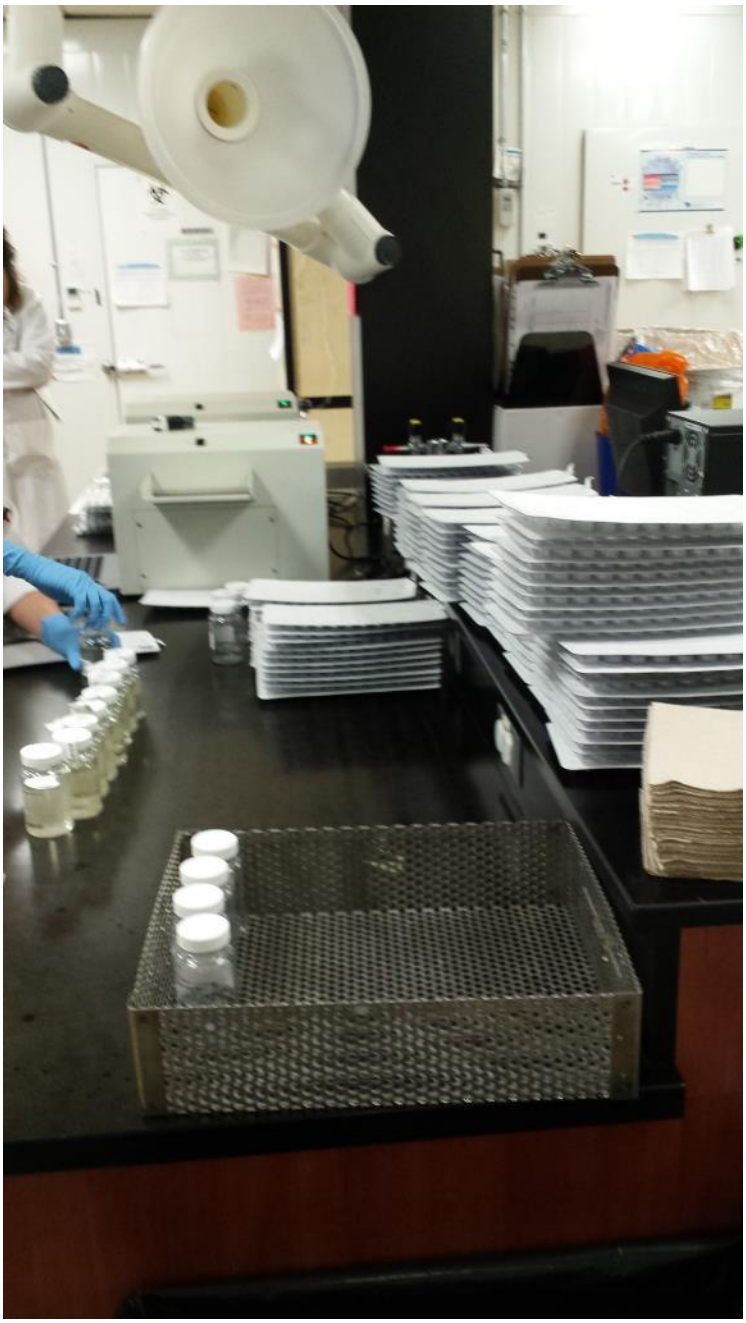

Picture 6 – Preparation for QuantiTray pouring

Picture 7 – Walk-in Incubator

AUDITOR CONFIDENTIALITY AGREEMENT

Dated: 25-Feb-15 (day-month-year)

Between: ALS Canada Ltd., Winnipeg location

Address: 12-1329 Niakwa Rd. East ("ALS"), and

Individual: Stephen A. Hubbs c/Courtney Diduck ("Auditor")

Representing: City of Winnipeg

Address: 2230 Main St. ("Auditing Company")

Audit Period: 25-Feb-15 to 25-Feb-15 (day-month-year, including preparation)

1. All information provided by ALS or accessed by the Auditor during his/her inspection of ALS facilities and premises at 12-1329 Niakwa Rd. East or communicated in any other way by ALS to the Auditor is confidential to ALS, may only be used in accordance with this agreement, and may not be disclosed by the Auditor to any person, except:

   a. To employees of the Auditing Company who have agreed to maintain the confidentiality of the information in accordance with this agreement; or

   b To employees of ALS; or

   c. With the written consent of ALS; or

   d. If the information is, at the date of this Agreement, lawfully in the possession of the Auditor through sources other than ALS; or

   e. If required by law; or

   f. If strictly and necessarily required in connection with legal proceedings relating to this agreement; or

   g. If the information is generally publically available other than as a result of breach of confidence by the Auditor.

2. This Agreement will be governed by and interpreted in accordance with the substantive laws of Canada, exclusive of any rules with respect to conflicts of laws, and the Parties submit to the exclusive jurisdiction of the courts of Canada for any dispute in relation with this Agreement.

3. The Auditor acknowledges that ALS has provided him/her with printed ( ) and/or electronic ( ) copies of the following documents in order to conduct this audit. The Auditor agrees to destroy all copies of these documents after the purpose of the audit has been completed.

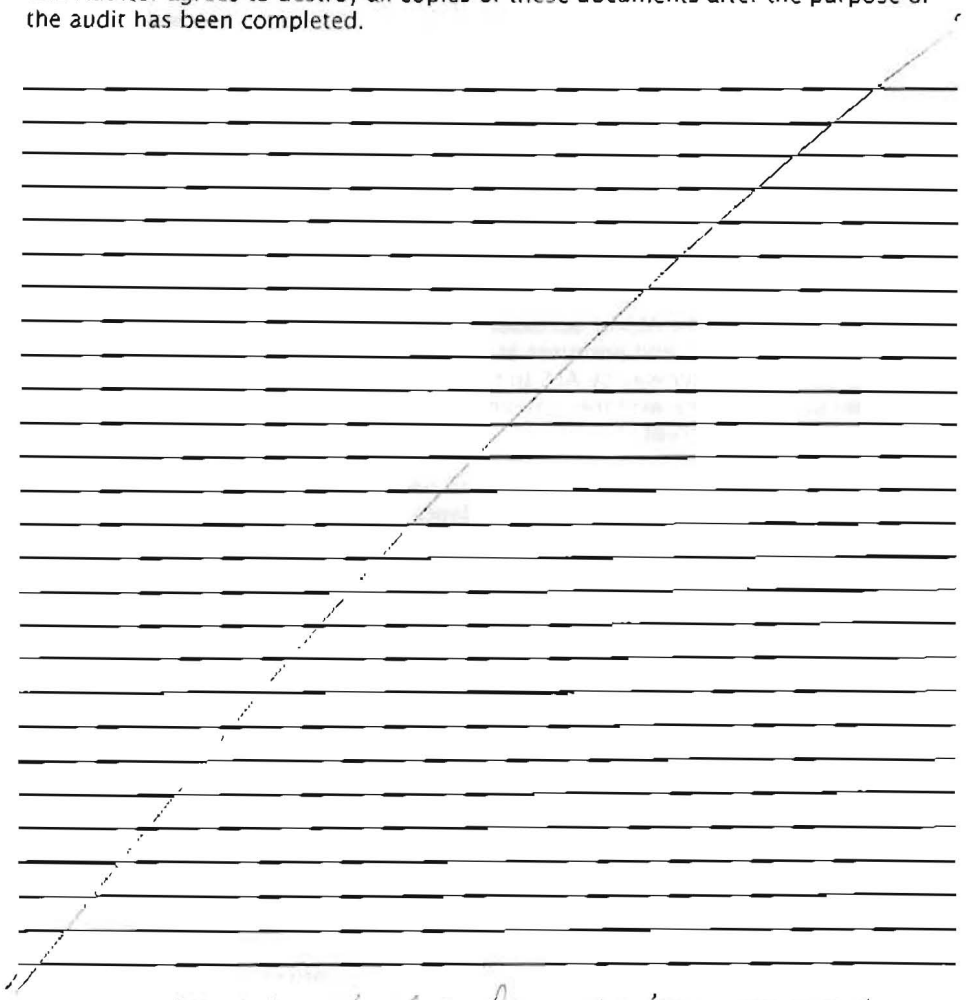

+ still photos and videos of samples being processed, plates and tags. 25-Feb-15 AH

SIGNED by or on behalf of the Auditor:

Signature of Auditor

Stephan Hobbs / Courtney Didock.
Name

Engineer
Title

SIGNED for and on behalf of ALS Canada Ltd.:

Signature of authorized person

Kayla Harold
Name

Quality Systems Coordinator.
Title

Appendix C

- External Reports

AECOM

C1 Dr. J. Bullard (Associate Medical Director, Cadham Provincial Laboratory)

Manitoba

Memorandum

Date: February 26, 2015

To: Shirley Dzogan
Laboratory and Special Contracts Negotiator,
Office of Drinking Water, Conservation and Water Stewardship

Lee-Ann Hemphill
Biology Manager,
ALS Life Sciences Division/Environmental

Dr. Lisa Richards
Medical Officer of Health,
Winnipeg Regional Health Authority

Renee Groselle
Manager of Environmental Standards,
City of Winnipeg

Courtney Diduck
Analytical Services Branch Head,
City of Winnipeg

From: Dr. Jared Bullard, MD FRCPC
Associate Medical Director,
Cadham Provincial Laboratory

Telephone: (204) 945-1306

Subject: **Final Report (Revised 2015/02/26)—City of Winnipeg Positive Water Samples Submitted for Bacterial Culture & Identification**

Six Colilert Quanti-trays, representing the six positive water samples from the City of Winnipeg (sampling date January 26th, 2015), were received at Cadham Provincial Laboratory on Thursday, February 5th, 2015 (L1570974-1, -4, -5, -9, -10, -17) for bacterial culture, identification, and genetic fingerprinting by pulsed field gel elcetrophoresis(PFGE – *E.coli* isolates only). Colilert Quanti-trays detect the presence of both coliforms and *E. coli* based on the biochemical detection of two enzymes – β-galactosidase (colorimetric test) and β-glucuronidase (fluorometric test). Coliforms will be positive for β-galactosidase only, whereas E. coli will be positive for both enzymes.

All wells flagged as Total Coliform (TC) positive and *Escherichia coli* (EC) positive had their contents aspirated, concentrated, planted to bacteriologic culture media, and organisms isolated were identified. A minimum of two negative wells per tray were also tested in the same manner. Additionally, a Quality Control (QC) tray (labelled Positive control 03Feb) was received on Wednesday, February 11th, 2015. The *E. coli* isolates

from the water samples, as well as the QC strain, were run by PFGE and compared against each other.

See attachments for tray mapping, CPL sampling results, and PFGE images.

Summary of CPL Results:

- There were no organisms recovered from any of the negative tray wells that were sampled.
- Total Coliforms – coliforms only were recovered from all wells in all six trays that flagged as positive for coliforms.
- *Escherichia coli*:
  - In four of the five trays positive for EC, *E. coli* was recovered from all wells that flagged as positive for *E. coli*.
  - In the fifth tray, although no *E. coli* was recovered from the single well that flagged as EC positive, two types of coliforms were recovered. Neither of the organisms are documented in literature to produce β-glucuronidase, thus should not have been able to cause the well to fluouresce. Biochemical tests on these organisms in the Microbiology Laboratory at CPL confirmed that both organisms were β-glucuronidase negative.
  - It is possible that any *E. coli* that may have been present had been overgrown by the coliforms present to the point where it was undetectable or that any *E. coli* originally present was no longer viable.
  - One tray had three different colonial morphotypes of *E. coli* isolated.
- Genetic fingerprinting using pulsed field gel electrophoresis (PFGE) was performed on all *E. coli* isolates (7) as well as the control strain (8 isolates tested in total)
- PFGE results indicate that all 8 isolates, 7 from water samples as well as the QC strain, were genetically different (PFGE image analysis confirmed by the National Microbiology Laboratory).

In Conclusion:

Testing at CPL confirmed, for all but one sample, the preliminary results reported by ALS Laboratories. Additionally, genetic fingerprinting of the *E. coli* isolates has demonstrated that all isolates are genetically different, both from each other and from the Quality Control strain used by ALS. The isolation of 7 different *E. coli* strains is inconsistent with a common source lab error or systematic lab contamination. The combination of one collector, positive samples from one side of the city and no other unexpected positive flagged trays that day, in addition to multiple genotypes of E. coli (likely suggesting multiple sources rather than a single source) suggests, on a balance of probabilities, a pre-analytical issue (including, but not exclusive to, collection, source sampling or handling) rather than an analytical or post-analytical issue. The inability to recover *E. coli* from one of the samples does not necessarily indicate that the original result was incorrect – while that is a possibility, it is also possible that the organism was present in very low numbers and overgrown by other organisms present, or that the organism was no longer viable by the time samples were received and processed at CPL.

Dr. Jared Bullard, MD FRCPC
Associate Medical Director,
Cadham Provincial Laboratory

Colilert Quanti-Tray Map

L1570974-1

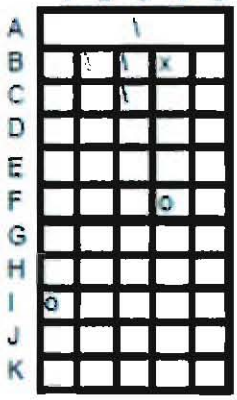

L1570974-9

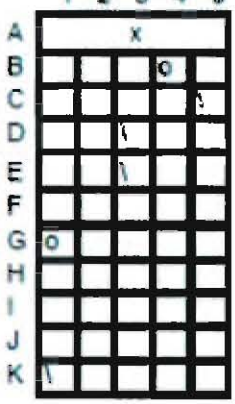

L1570974-4

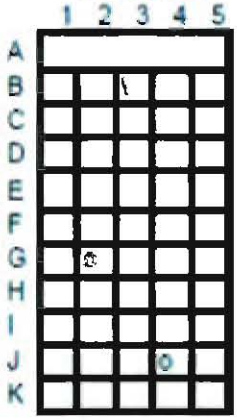

L1570974-10

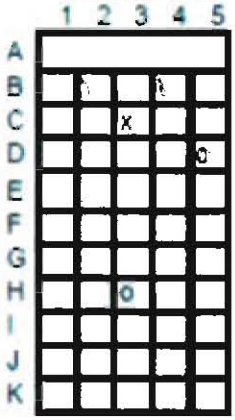

L1570974-5

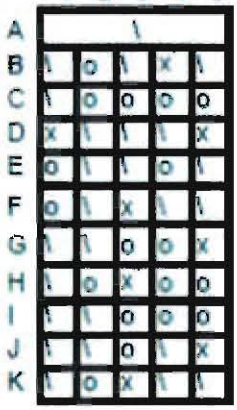

L1570974-17

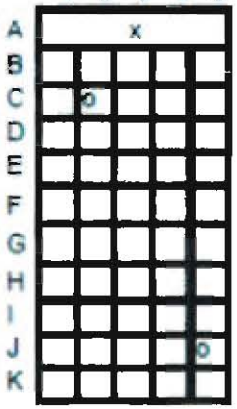

Legend: \ = coliform X = E coli O = negative well sampled

CPL Results

Tray	Well	Colilert Quanti-Tray Result	CPL Culture Result
L1570974-1	A-1	TC +	Coliforms x2
	B-2	TC +	Coliforms x3
	B-3	TC +	Coliforms x3
	B-4	EC +	Coliforms x2 (*Morganella, Klebsiella*) No *E. coli* recovered
	C-3	TC +	Coliforms x2
	F-4	Negative	No growth
	I-1	Negative	No growth
L1570974-4	B-3	TC +	Coliforms x3
	G-2	Negative	No growth
	J-4	Negative	No growth
L1570974-5	A-1	TC +	Coliforms x2
	B-1	TC +	Coliforms x2
	B-2	Negative	No growth
	B-3	TC +	Coliforms x2
	B-4	EC +	***E. coli* (hemolytic)**
	B-5	TC +	Coliform x1
	C-1	TC +	Coliform x1
	C-2	Negative	No growth
	C-3	Negative	No growth
	C-4	Negative	No growth
	C-5	Negative	No growth
	D-1	EC +	***E. coli* (flat)**, coliform x1
	D-2	TC +	Coliform x1
	D-3	TC +	Coliform x1
	D-4	TC +	Coliform x1
	D-5	EC +	*E. coli* (flat)
	E-1	Negative	No growth
	E-2	TC +	Coliforms x2
	E-3	TC +	Coliforms x2
	E-4	Negative	No growth
	E-5	TC +	Coliforms x2
	F-1	Negative	No growth
	F-2	TC +	Coliforms x2
	F-3	EC +	*E. coli* (flat)
	F-4	TC +	Coliform x1
	F-5	TC +	Coliforms x2
	G-1	TC +	Coliform x1
	G-2	TC +	Coliform x1
	G-3	Negative	No growth
	G-4	Negative	No growth
	G-5	EC +	*E. coli* (flat), coliform x1
	H-1	TC +	Coliforms x2
	H-2	Negative	No growth

	H-3	EC +	***E. coli* (mucoid)**, coliform x1
	H-4	Negative	No growth
	H-5	Negative	No growth
	I-1	TC +	Coliform x1
	I-2	TC +	Coliforms x2
	I-3	Negative	No growth
	I-4	Negative	No growth
	I-5	Negative	No growth
	J-1	TC +	Coliform x1
	J-2	TC +	Coliform x1
	J-3	Negative	No growth
	J-4	TC +	Coliform x1
	J-5	EC +	E. coli (flat)
	K-1	TC +	Coliforms x2
	K-2	Negative	No growth
	K-3	EC +	***E. coli* (flat)**, coliform x1
	K-4	TC +	Coliform x1
	K-5	TC +	Coliform x1
L1570974-9	A-3	EC +	***E. coli* (flat)**
	B-4	Negative	No growth
	C-5	TC +	Coliforms x2
	D-3	TC +	Coliform x1
	E-3	TC +	Coliform x1
	G-1	Negative	No growth
	K-1	TC +	Coliform x1
L1570974-10	B-2	TC +	Coliforms x2
	B-4	TC +	Coliforms x2
	C-3	EC +	***E. coli* (flat)**
	D-5	Negative	No growth
	H-3	Negative	No growth
L1570974-17	A-1	EC +	***E. coli* (flat)**, coliform x1
	C-2	Negative	No growth
	J-5	Negative	No growth
E. coli isolates in **bold** type were tested by PFGE.			

PFGE Image

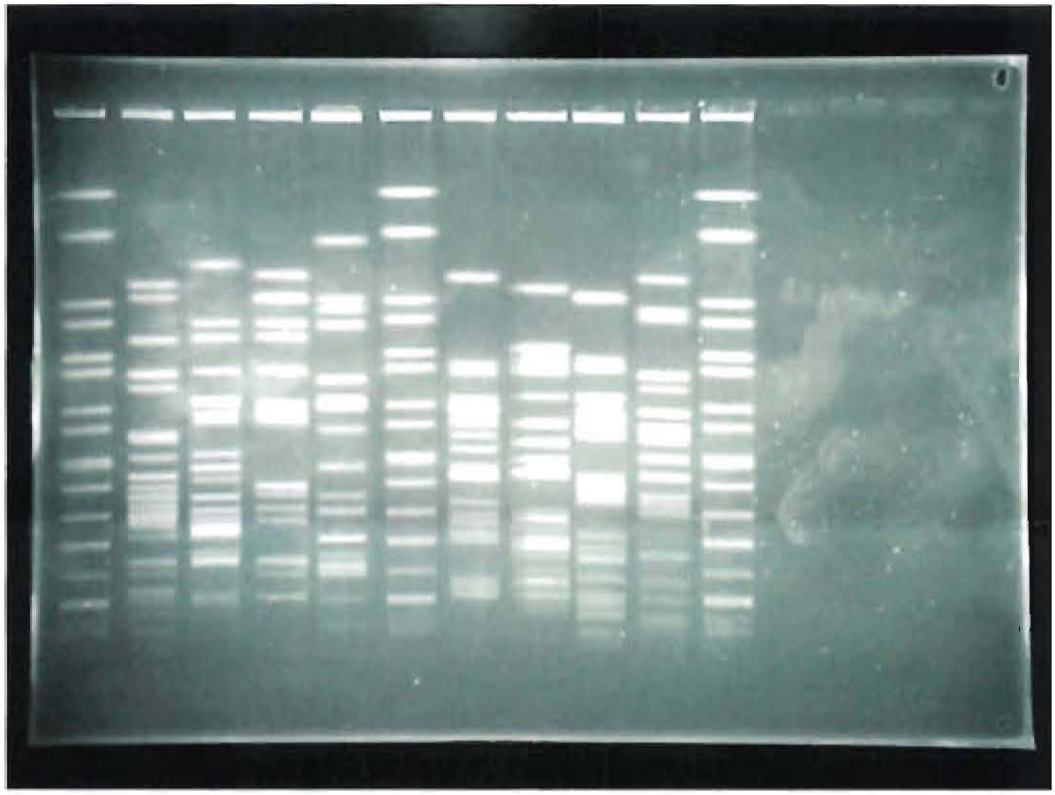

Sample Lanes (From Left to Right)

1. *Salmonella braenderup* (Control)
2. L1570974-5 B4 *E. coli*
3. L1570974-5 D1 *E. coli*
4. L1570974-5 H3 *E. coli*
5. L1570974-5 K3 *E. coli*
6. *Salmonella braenderup* (Control)
7. L1570974-10 C3 *E. coli*
8. L1570974-9 A1 *E. coli*
9. L1570974-17 A1 *E. coli*
10. *E. coli* ALS QC strain
11. *Salmonella braenderup* (Control)

AECOM

C2 W. Lipinsky, (Assessor, Canadian Association for Laboratory Accreditation)

AECOM

C2a Lipinsky Report

Assessment of City of Winnipeg
Drinking Water Sampling Activities
For Bacteriological Testing

Executive Summary
March 9, 2015

Introduction

The following report summarises the assessment of the City of Winnipeg's drinking water sampling program for bacteriological monitoring. W. Lipinsky, a CALA (Canadian Association for Laboratory Accreditation) assessor, reviewed the sampling procedure on February 11, 2015.

The assessment was carried out to determine compliance with the following standards and guidance documents related to water sampling:

- Manitoba Water Stewardship Office of Drinking Water and Office of the Chief Medical Officer of Health water sampling instructions for microbiological testing
- Standard Methods for the Examination of Water and Wastewater APHA/AWWA
- EPA Revised Total Coliform Rule Assessments (RTCR) Guidance Manual
- ISO 17025 General Requirements for the Competence of Testing Laboratories

Scope of Audit

The entire sampling process was reviewed and included the following areas:

- Water sampling procedure and related documents
- Staff training records
- Sampling supplies, procurement and storage
- Inspection of the laboratory's area related to sampling supplies and preparation
- Interview with sampling technicians and supervisory staff
- Sample registration, worksheet and label preparation, and data entry
- Observation of on-site sampling by the laboratory technician, at the six locations which had positive coliform results on January 26, 2015.
- Observation of sample bottle handling and transport to contract laboratory
- Review of coliform test records

Summary of Observations

The drinking water samplers are laboratory technicians with the City of Winnipeg Environmental Standards Division Laboratory. The laboratory is ISO 17025 accredited for its testing of drinking water and maintains an effective quality management system. There is an approved documented sampling procedure, which instructs the technicians on how to correctly take water samples.

It was observed, at the six sampling sites, that the technician sampled the drinking water in accordance with the requirements of Manitoba Water Stewardship Office of Drinking Water and the Office of the Chief Medical Officer of Health water sampling procedures. The technicians who were interviewed had chemical technology certificates with several years of testing and sampling experience. They were dedicated and aware of the significance of their work and the importance of proper sampling. The water taps and sinks at the sampling sites appeared to be suitable and clean. However, they were in public places and the presence of coliforms in the sampling environment was unknown.

The laboratory was observed to have an excellent system of sample identification, together with labelling, worksheet generation and data entry. Sample integrity was maintained up to the point of delivery at the contract laboratory.

A few documentation and quality system deficiencies were noted. The impact of these deficiencies for the potential of coliform contamination during sampling was quite small.

In 2014, there were 3,191 drinking water samples, which had been taken by laboratory sampling technicians. Only one of these samples tested positive for E. Coli.

Conclusion and Recommendations

Based on the observations during the assessment, there is a low probability that positive results would have occurred as a result of contamination at the time of sampling. The low probability of contamination during sampling is supported by test results noted during the 2014 collection of samples, in which there was only one positive E. Coli sample.

To ensure that the probability of contamination during sampling continues to be low, a number of continual improvement items have been recommended to the City of Winnipeg laboratory.

Assessment Report
Of
City of Winnipeg
Drinking Water Sampling Activities
For Bacteriological Testing

Assessor: Walter Lipinsky

Assessment Date: February 11, 2015

Report Version: April 20, 2015

This report is divided into four sections:

Section 1 – Assessment Findings and Recommendations Summary
Section 2 – Management System Review Checklist
Section 3 – Technical System Review Checklist
Section 4 – Laboratory Technician II [redacted] Interview

Section 1 – Assessment Findings and Recommendations Summary

Review Sections: ISO 17025 Management Review, Technical Review, Sampling Method Review
Finding Type: A-Action required **R**-Recommendation **C**-Comment

		Type
1	**Management Review** **Organization** **Requirement** The laboratory provides adequate supervision of personnel for sampling activities **Observation/Recommendation** Effective supervisory structure in place	**C**
2	**Management Review** **Organization** **Requirement** Laboratory staff is aware of the relevance and importance of their activities and how they contribute to the achievement of the objectives of the management system **Observation/Recommendation** Very knowledgeable, competent and dedicated staff	**C**
3	**Management Review** **Quality System** **Requirement** Top management ensures that the integrity of the management system is maintained when changes to the management system are planned and implemented **Observation/Recommendation** Impact of changes should be studied. These changes could include sampling method and other method revisions, and assignment of staff to multiple activities of which some may be incompatible.	**R**
4	**Management Review** **Sub-Contracting** **Requirement** Subcontractors are competent and maintain records of competent subcontractors used. **Observation/Recommendation** Besides reviewing the accreditation of a sub-contract laboratory, consider an on-site assessment and/or submission of blind proficiency check samples or splitting samples between laboratories. Of extreme importance in microbiological testing is the separation of drinking water samples from high bacteria level samples throughout the sample reception, storage and testing phases at the contract laboratory.	**R**

5	**Management Review** **Supplies** **Requirement** There are policies and procedures related to procurement of supplies and services, and reception and storage of supplies with associated records. **Observation/Recommendation** There are no records related to the reception of microbiological sample bottles from the contract laboratory, which should include a lot identification as well as traceability to cleanliness records. The sampling procedure also refers to keeping sample bottles in a box within a plastic bag. In practice, sample bottles were observed in a drawer.	**A**
6	**Management Review** **Records** **Requirement** The laboratory maintains procedures for data management. **Observation/Recommendation** The laboratory has an excellent implementation of a LIMS (Laboratory Information Management System) for registering samples, printing labels and worksheets, result entry and reporting.	**C**
7	**Quality Management** **Internal Audits** **Requirement** Internal audits and method document reviews are periodically conducted to verify operations comply with all elements of the quality system and requirements of ISO/IEC 17025:2005; ensure that internal audits follow a predetermined schedule and procedure **Observation/Recommendation** The laboratory has focused on performing internal audits on in-house testing as well as other elements of their quality system. There were no records of an internal audit of the sampling method used to collect samples that are sent to a contract laboratory. An internal audit is required for all laboratory processes.	**A**
8	**Technical Management** **Facilities** **Requirement** There is effective separation between areas of incompatible activity, and that measures are taken to prevent cross-contamination **Observation/Recommendation** Effective safeguards are in place to ensure that wastewater and drinking water testing activities are adequately separated to prevent contamination of drinking water samples.	**C**

9	**Technical Management** **Test Method** **Requirement** The laboratory selects test methods that are in latest international, regional or national standards (unless it is not appropriate or possible); the standard shall be supplemented with additional details to ensure consistent application. **Observation/Recommendation** The laboratory is following a sampling procedure based on Manitoba Government sampling requirements. It is recommended that the laboratory consider the procedure in Standard Methods 9060a as a continual improvement item. Standard Methods 9060a requires a cold water tap to be run for 2-3 minutes before sampling. If the tap cleanliness is unknown, the faucet has to be disinfected, both inside and outside, and then having the water run an additional 2-3 minutes after treatment. As well, if sampling from a mixing faucet, run hot water for 2 minutes and then cold water for 2-3 minutes before collecting a sample.	**R**
10	**Technical Management** **Validation** **Requirement** Method validation includes records of validation, the procedure used, and a statement that the method is fit for the intended use. **Observation/Recommendation** Consider the use of replicate samples and field blanks for microbiological water sampling. As well, consider studying worse case scenarios involving no disinfection of faucets and hands or pre-sampling water flow.	**R**
11	**Technical Management** **Method** Procedures for sampling are available at the location where required **Observation/Recommendation** Sampling method documentation was not available in the field.	**A**
12	**Technical Management** **Handling Samples** **Requirement** For sample handling, verify that there are documented procedures specified to protect the integrity of the sample from time of sampling to sample processing (including pre and post analysis storage) including, but not limited to: use of sterile approved sample containers **Observation/Recommendation** Unused sample bottles are handled by a number of people without any special precautions (sanitized hands, clean gloves). They are removed from the shipment box, placed into drawers, and placed into coolers without any cleanliness precautions. The use of gloves, Zip-Lock type of bags or other measures should be considered to protect the cleanliness integrity of the bottles. Samplers should also not be engaged in any activities, prior to drinking water sampling, that might contaminate their person or clothing.	**R**

13	**Sampling Method Review** **Requirement** All necessary successive steps in the test procedure are adequately documented in the test method **Observation/Recommendation** The use of spray isopropyl disinfectant and paper towel wipe down is not specifically documented. The documented procedure requires that the sampling point be swabbed with an alcohol solution or sanitary wipes saturated with alcohol. This recently replaced the immersing of the faucet into a cup of methanol. Standard Methods 9060a requires that the faucet be disinfected both inside and out, which is achieved by immersing the faucet into a cup of alcohol.	**A**
14	**Sampling Method Review** **Requirement** All necessary successive steps in the test procedure are adequately documented in the test method **Observation/Recommendation** The cleaning of coolers and ice packs is documented to be done regularly without a specific frequency. In practice, coolers are cleaned immediately before use in the field. Ice packs are not cleaned before use.	**A**
15	**Sampling Method Review** **Requirement** All necessary successive steps in the test procedure are adequately documented in the test method or supporting documentation. **Observation/Recommendation** Sampling sites, in terms of buildings, are documented. However, specific sinks at the sampling sites are not documented.	**A**
16	**Sampling Method Review** **Requirement** All necessary successive steps in the test procedure are adequately documented in the test method **Observation/Recommendation** Sampling site NE01 is identified in Appendix B as an [redacted] when in fact it is a [redacted]. All locations should be reviewed for accuracy.	**A**
17	**Sampling Method Review** **Requirement** All necessary successive steps in the test procedure are adequately documented in the test method **Observation/Recommendation** Vehicle steering wheels are being cleaned with a sanitary wipe on each sampling trip. Vehicle seats are to also be free of contamination and cleaned regularly, however this does not appear to be done regularly. The phrase "Free of contamination' should be clarified and a cleaning log should be maintained.	**A**

18	**Sampling Method Review** **Requirement** All necessary successive steps in the test procedure are adequately documented in the test method **Observation/Recommendation** It is recommended that the conditions of the sampling point (for example, the use of the sink) be noted if they had changed from the previous sampling. This could be addressed by the use of a checklist item, possibly supported with photographs. The cleanliness of the sampling area, including the tap and the sink also has to be assessed and recorded. Also include recording of other environmental conditions that could impact testing.	**R**
19	**Sampling Method Review** **Requirement** All necessary successive steps in the test procedure are adequately documented in the test method **Observation/Recommendation** It is recommended that a check for hot water entering into the sample through the tap be performed.	**R**
20	**Sampling Method Review** **Requirement** All necessary successive steps in the test procedure are adequately documented in the test method **Observation/Recommendation** The sampling procedure states that fingers should not touch the inside of the sample bottle lid, but there is no mention of not touching the inside of the bottle neck which is a RTCR and Standard Methods 9060a requirement. In practice, the sampling technician was careful not to touch any internal surface.	**A**
21	**Sampling Method Review** **Requirement** All necessary successive steps in the test procedure are adequately documented in the test method **Observation/Recommendation** The recording into LIMS of the non-removal of the aerator has recently been put into effect but this requirement to record the non-removal is not documented in method. The non-removal is recorded on the worksheet as specified in the sampling method documentation.	**A**

22	**Sampling Method Review** **Requirement** The test procedure and all supporting work instructions are performed as documented **Observation/Recommendation** The sampling method states that hands should be being washed/sanitized prior to the handling of sampling equipment and testing equipment. In practice, a hand sanitizer is being applied in the vehicle before the start of the sampling route. It is recommended that hands should be cleaned after the chlorine test and just before water sample is taken at every sample point. The use of a clean pair of disposable gloves at each sample point would also be acceptable.	**R**
23	**Sampling Method Review** **Requirement** The test procedure and all supporting work instructions are performed as documented **Observation/Recommendation** A field log book is not used during sampling as indicated in the sampling method. Data is only recorded on LIMS worksheets.	**A**
24	**Sampling Method Review** **Requirement** The test procedure and all supporting work instructions are performed as documented **Observation/Recommendation** The sample hold time in the procedure, "Sample ID, Preservation and Holding Times ,SWI# 17-03", for bacteriological testing is stated as 48 hours whereas the MB ODW Guideline has a required hold time of 24 hours. In practice samples are dropped off at the testing laboratory the same day.	**A**

Section 2 - Management System Review Checklist

				Requirement Met		
	Section	**ISO 17025 Clause**	**Requirement**	**Yes**	**No**	**Comment**
1	Organization	Place of Staff in Organization Objectives 4.1.5k	Verify that laboratory staff are aware of the relevance and importance of their activities and how they contribute to the achievement of the objectives of the management system	✓	V	ery knowledgeable, competent and dedicated staff
2	Org anization	Laboratory Supervision 4.1.5g	Verify that the laboratory provides adequate supervision of personnel for testing activities	✓		
3	Quality System	Planned Changes 4.2.7	Verify that top management ensures that the integrity of the management system is maintained when changes to the management system are planned and implemented	✓		The laboratory Quality Manual has a number of references to change management.
4	D ocument Control	Availability 4.3.2	Verify that the current authorized test method and supporting work instructions are available	✓		
5	D ocument Control	Availability 4.3.2.2	Verify that all quality documentation (including instructions, standards, manuals and reference data) is available where required		✓	Sampling and testing procedures are not available in the field
6	Sub contracting of Tests	Competency 4.5.1,	Verify that that subcontractors are competent and maintain records of competent subcontractors used	✓		In addition to reviewing contract lab accreditation, consider submitting proficiency testing samples
7	Sup plies	Policies and Procedures 4.6.1	Document policies and procedures related to: • procurement of supplies and services • reception and storage of supplies • sufficient information to establish an audit trail		✓	There are no records related to the reception of sample bottles from the contract laboratory. The procedure also refers to keeping bottles in a box within a plastic bag. Bottles were observed in a drawer.
8	C ontrol of Records	Technical Records4.13.2	Verify that the laboratory retains technical records of: • all original observations • sufficient information to establish an audit trail • personnel responsible for the sampling	✓		The laboratory has an excellent LIMS for tracking all data related to sampling and testing
9	C ontrol of Records	Recording 4.13.2.2	Verify that observations, data and calculations are recorded at the time they are made and be identifiable to the specific task	✓		
10	Internal Audits	Internal Audit Requirements 4.14	Verify that internal audits are periodically conducted to verify operations comply with all elements of the quality system and requirements of 17025:2005;		✓	There were no internal audit records for the sampling procedure

Section 3 - Technical System Review Checklist

				Requirement Met		
	Section	**ISO 17025 Clause**	**Requirement**	**Yes**	**No**	**Comment**
11	Personnel	Qualifications 5.2.1	Verify that personnel performing specific tasks are qualified on the basis of education, training, experience and/or demonstrated skills.	✓		
12	Personnel	Employees 5.2.3	Verify that personnel are employed by the laboratory, and verify that personnel are supervised, competent and work in accordance with the quality system.	✓		
13	Pers onnel	Authorized Personnel 5.2.5	Verify that management has authorized specific personnel to perform specific sampling, testing and operate particular types of equipment	✓		
14	Personnel	Records 5.2.5	Verify that the laboratory maintains readily-available records for all technical personnel for: • competence, and date confirmed • educational and professional qualifications; • training, skills and experience.	✓		
15	Accom modation /Environmental Conditions	Technical Requirements 5.3.1	Verify that technical requirements for accommodation and environmental conditions that can affect results are documented.	✓		
16	Accom modation /Environmental Conditions	Facility 5.3.1	Verify that the laboratory or off-site facility accommodation and environmental conditions do not compromise the quality of results.	✓		
17	Accom modation /Environmental Conditions	Monitoring 5.3.2	Verify that the laboratory monitors, controls and records environmental conditions, where applicable.	✓		
18	Accom modation /Environmental Conditions	Incompatible Activities 5.3.3	Verify that there is effective separation between areas of incompatible activity, and that measures are taken to prevent cross-contamination	✓		
19	Accom modation /Environmental Conditions	Storage	Verify that all supplies are stored under appropriate conditions and in a manner that satisfies requirements for safety, security, separation of incompatible materials, and ease of retrieval.	✓		

21	Meth ods and Validation	Method Selection 5.4.2	Verify that the laboratory selects methods that: • meet the needs of the customer • are appropriate for the test • are in latest international, regional or national standards (unless it is not appropriate or possible); the standard shall be supplemented with additional details to verify consistent application	✓		The laboratory is currently following the sampling procedures as specified by the Manitoba Government. As a continual improvement item, consider Standard Methods 9060a sampling procedure.
22	Meth ods and Validation	Method Procedure	Verify that all necessary successive steps in the procedure are appropriate: • sample containers; • storage conditions; • holding time.	✓		The samples are collected in the appropriate sample bottle and are kept cool in a cooler with ice packs. The samples are dropped off at the contract laboratory upon the completion of sampling. The procedure should include the requirement not to touch the inside of the sample bottle. In practice, the samples were being taken correctly.
23	Meth ods and Validation	Conduct of Testing 5.4.1	Verify that the test procedure and all supporting work instructions are performed as documented.		✓	The Manitoba Government sampling procedures are being followed, however, there are some inconsistencies in the documented method: - The use of spray isopropyl disinfectant and paper towel wipe down is not documented - Ice packs are not cleaned - specific sinks at a site are not identified - Site NE01 is not identified correctly - Vehicle cleaning is not done regularly - The recording of non-removal of the aerator into LIMS is not documented - A field logbook is no longer being used

24	Meth ods and Validation	Published Reference Methods (or Standard Methods) 5.4.2	For published reference methods (or standard methods), verify that the laboratory has: • confirmed that it can properly operate standard methods; • repeated the confirmation if the standard method changed.	✓		The laboratory is following the Manitoba Government sampling procedure.
25	Meth ods and Validation	Method Validation 5.4.5	Verify that the method validation includes records of validation and the procedure used.	NA NA		It is recommended that the robustness of the sampling be validated. This would involve determining the level of bacteria contamination in the sampling areas as well as determining the importance of the various sampling precautions to prevent contamination.
26	Traceability	Calibration Program 5.6.1, 5.6.2	Verify that the testing laboratory has a calibration program for its measurement and test equipment	✓	T	hermometer using in sampling has required traceability record.
27	Sam pling	Procedures and Plan5.7.1	Verify that procedures for sampling are available at the location where required, and include: • a sampling plan • factors to be controlled to verify the validity of the results • withdrawal and preparation of samples.	✓		
28	Sam pling	Records 5.7.3	Verify that the laboratory has procedures for recording sampling data and operations; records to include: • sampling procedure • sampler identification • environmental conditions (if relevant) • sampling location;	✓		
29	Han dling of Test Items	Procedures 5.8.1, 5.8.4	Document procedures for test item management: • transportation • receipt • handling and preparation • protection • storage	✓		
30	Han dling of Test Items	Identification 5.8.2	Verify that the laboratory has a system for identifying test items	✓		
31	Han dling of Test Items	Facilities 5.8.4	Verify that the laboratory has appropriate facilities to maintain item integrity, and the protection of secured items	✓		

32	Han dling of Test Items	Environmental Conditions 5.8.4	Verify that required environmental conditions for items are maintained, monitored and recorded, as appropriate.	✓		
33	Han dling of Test Items	Handling Instructions 5.8.4	Verify that any handling instructions provided with the test item are followed.	✓		

AECOM

C2b Lipinsky Report – Sampler Collector Interview

Section 4 – Laboratory Technician II [redacted] Interview

Laboratory Technician II [redacted] Interview	2015/02/11 by Walter Lipinsky

Interview Summary

The technician is an experienced drinking water sampler and laboratory technician. The technician is aware of the importance of taking drinking water samples correctly in order to prevent contamination. The technician was unable to identify anything that could have resulted in potential contamination on January 26, 2015. For all intents and purposes, it was another routine sampling day
The departures from the required sampling procedure included the cleaning of the steering wheel (when used) and the checking and cleaning of the vehicle to ensure that it is free of contamination. The technician cleaned the steering wheel, however, only when other staff that might have been exposed to coliforms in their activities used the vehicle. Other samplers are not doing the checking and cleaning of the vehicle as well.

Background Questions

How and by whom were you trained?	[redacted]
How long have you been sampling?	
Do you wear any special clothing that is reserved for sampling drinking water?	City of Winnipeg jacket
What was worn the day of sampling Jan 26, 2015?	City of Winnipeg jacket and jeans.
Was your clothing and your person exposed to any potential sources of coliform before taking drinking water samples that you are aware of?	No
Was there anything different on January 26, 2015 during the drinking water sampling activities?	No

Sampling Procedure Specific Questions Note: Sampling procedure in field not observed

	Yes	No	Comment
Preparation before leaving lab			
Steering wheel disinfected	✓	✓	The sampling procedure states that the steering wheel must be cleaned each time the vehicle is used. In practice, the steering wheel is only cleaned by the technician if the vehicle was previously used by other sewage treatment plant staff.
Seats and sample storage areas cleaned regularly		✓	Required in sampling procedure
Check to confirm vehicle free of contamination		✓	Required in sampling procedure
Clean cooler	✓		
Clean ice packs		✓	Ice packs are stored in freezer but are not cleaned before use as documented in the

			sampling procedure
Sample Site			
Visual inspection for cleanliness and suitability of the tap and sink. Check if there is anything incompatible in area	✓		
Were cleanliness findings recorded	✓		Senior Technician is notified if there are any issues
Check for conditions that may have changed at the sample site since the last sample collection,	✓		
Chlorine Test and Sampling Procedure			
Wash/sanitize hands prior to handling sampling and testing equipment	✓		Hands are sanitized in vehicle once at the beginning of the sampling route
Remove aerator, if present	✓		Some aerators can not be removed. Their non-removal is recorded on the worksheet
Swab the sample point with 70% alcohol or wipes		✓	The technician immersed the faucet end into a container of methanol instead of swabbing as directed in the sampling procedure.
Open the cold water valve and run for a min of 3 minutes	✓		
Check the water temperature until stable and record	✓		
Reduce water flow to reduce spilling and splashing	✓		
Perform chlorine test	✓		
Are hands washed/sanitized before water sampling?		✓	Hands are only sanitized at the beginning of the sampling route as per instructions in the sampling procedure
Is sample bottle seal checked	✓		
Is presence of sodium thiosulphate checked		✓	This is not a requirement in the sampling procedure
Fill sample bottle, cap and mix	✓		The technician was aware not to touch any of the internal surfaces of the bottle and cap
Attach sample label and update COC	✓		
Is sample properly identified on label and sampling form	✓		
Place sample into cooler	✓		

AECOM

C3 M. Brodsky (Assessor, Canadian Association for Laboratory Accreditation)

AECOM

C3a 1st Brodsky Report

Brodsky Consultants A DIVISION OF 468629 ONT. LTD.

73 DONNAMORA CRESCENT
THORNHILL, ONTARIO
L3T 4K6

PHONE: (416) 816-9837
FAX: (905) 889-2276
E-MAIL: mhbrodsky@rogers.com

February 17, 2015

Renée Grosselle
Manager of Environmental Standards
City of Winnipeg - Water and Waste Department
2230 Main Street,
Winnipeg, MB
R2V 4T8

Report on Internal Audit of ALS Laboratories

Introduction

On January 27, ALS Environmental Laboratory in Winnipeg reported the enumeration of Total coliforms and E.coli (using the IDEXX Quanti-tray method) from 6 widely distributed drinking water samples collected from the distribution system and submitted by the City of Winnipeg. A boil water advisory was issued, but subsequently rescinded when follow up samples indicated no further evidence of contamination. The question of the reliability of the results was raised and I was hired by the City of Winnipeg to investigate the laboratory to determine if ALS could have been complicit in erroneously issuing false positive results. ALS is accredited by the Canadian Association for Laboratory Accreditation for both their Quality Management System and many analytical methods including Heterotrophic Plate Count by APHA 9215B, and E. coli and Total Coliform by Quanti-tray (IDEXX).

I have been an Environmental Microbiologist for more than 42 years. I served as the Chief of Environmental Microbiology for the Province of Ontario, Ministry of Health, Laboratory Services Branch, from 1982-1999. I am a Past President of the Ontario Food Protection Association (OFPA), The International Association for Food Protection (IAFP) and AOAC International. I serve as Chair for the AOAC Expert Review Committee for Microbiology, as a scientific reviewer in Microbiology for the AOAC OMA and the AOAC Research Institute, as a reviewer for Standard Method for the Examination of Water and as a chapter editor on QA for the Compendium of Methods in Microbiology. I am also a lead auditor/assessor in microbiology for the Canadian Association for Laboratory Accreditation (CALA) and is Vice-chair of the CALA Board of Directors.

Executive Summary

Using CALA's A24 Microbiology Checklist as guide, I audited the laboratory on February 17, focusing my attention on the HPC by APHA 9215B, and E. coli and Total Coliform by Quanti-tray (IDEXX). I reviewed and observed sample handling and preparation from receipt log-in to analysis. I conducted a detailed review of and observed the contract lab's method SOPs and analytical procedures for bacteriological analysis, including sample receipt and handling of samples to the final reporting of the results. I also included a trace of tests for the dates/samples in question. I observed the performance of and interviewed all the analysts who were actually responsible for processing these samples on January 26 and 27, 2015. As indicated by the appended copy of the A24 checklist and the Trace of Tests, all records indicate that the ALS procedural protocols as required by their Quality System were followed and that the results of the samples tested were accurate.

Summary of Observations

As per A24, sample handling met all the requirements of ISO/IEC 17025:2005. Sample receipt and handling were thoroughly documented and the protocols followed adhered to ALS Quality Management System specifications. The method used was current and documentation was complete. The validated method had been performance-verified by ALS and historical PT results indicated no non-conformances. Media and method QC was thoroughly documented as defined by the method SOP and met all prescribed requirements. Stock cultures were appropriately maintained and controlled. QC of labware and supplies met all accreditation and lab-defined specifications and all materials were in sufficient quantities and appropriately stored. The data entry into and reports generated by the LIMS system was appropriately controlled and suitably verified.All protocols for sample preparation were followed meticulously as prescribed, by the staff who processed samples while I was observing. As attested by the Trace of Tests, historical records indicated all staff were adequately trained and competent to do the analyses. QC records for all related analytical activities, including monitoring for cross-contamination, were well documented.

Conclusion

My observations of their analytical and QC records indicated that the laboratory followed sample handling, preparation and analytical protocols and procedures as per their Quality Management System. The evidence I examined indicated that the samples in question were not contaminated with coliforms and E. coli by cross-contamination in the laboratory. It is beyond the scope of my investigation to determine the source of this contamination, but, in my opinion, based on the findings from this audit, ALS was justified in reporting their positive findings.

M. H. Brodsky

CALA TRACE OF TESTS REPORT

LABORATORY ALS Environmental DATES January 26, 2015

TEST REPORT ID/UNIQUE SAMPLE ID L1570974 (1-21) ASSESSOR INITIALS MHB

RECORDS RELATING TO:	A02-Rating Guide	Clause in ISO/IEC 17025	CHECKED
1. Field supplies provided to the client	B.06.03 Sampling Records	5.7.3	✓
2. Test Requisition Form including ○ transcribed sampling data ○ (e.g., sample type, sampling method, location, dates	B.07.02 Identification of Test &/or Calibration Items	5.8.2	✓
3. Sample reception including ○ documented sample deficiencies (e.g., as related to collection, preservation, container, temp. on arrival, damage in transit, time in transit, etc.) ○ special handling requirements (e.g., pre-treatment, storage, holding times, etc.) ○ unique sample ID	B.07.01 B.07.02 B.07.03 Handling of Test &/or Calibration Items 1.Procedures 2.Identification 3.Deficiencies	5.8.1 5.8.2 5.8.3	✓
4. Chain of Custody, if applicable	B.07.02	5.8.2	✓
5. Sample pre-treatment, if applicable (e.g., filtration, sieving, homogenization, subsampling, etc.)	B.07.05 Environmental Conditions	5.8.4	✓
6. Sample storage, if applicable	B.07.04 Facilities	5.8.4	✓
7. Original test data including all calculations and associated QC data (also analyst name, test method ID, sample ID, test organism lot no. date, equipment ID, etc.)	A.13 Control of Records	4.13.1 4.13.2	✓ Time read and verified Should be indicated
8. Data validation (includes checking transcription errors and comparison with expected ranges or relationships)	A.13 Control of Records	4.13.1 4.13.2	✓ Any changes should be justified
9.Test Report showing: ○ flags qualify results if data is absent or non-conforming (e.g., due to conduct of testing, sample history, method performance, interference, or data validation, or if original sample was diluted, etc.) ○ appropriate reporting of low level data ○ appropriate use of significant digits	B.09.01 B.09.02 Reporting the Results 1.Test Results 2.Interpretation	5.10.2 5.10.6 5.10.8 5.10.3	✓

○ other information, as per section 5.10 of ISO/IEC 17025			
10.Test Report Authorization	B.09.01	5.10.2j	✓
11. Sample disposal, if applicable	B.07.01	5.8.1	✓
12. Data storage and/or disposal, if applicable	A.13.01 Control of Records	4.13.1	✓
13. Training records of analyst(s) who performed test	B.01.07 Records of Technical Personnel	5.2.5	✓
14. PT only: CARs for any PT failures	Program Requirement	Program Requirement	✓

A24 – CALA Checklist for Microbiology
Revision 4.0 – April 7, 2014

Laboratory Name: ALS Environmental

Appendix Name: Colilert

Appendix Number: NA-TM-1300 V02

Assessor: Michael Brodsky

Date: January 26, 2015

CALA
Laboratory Accreditation

CALA CHECKLIST FOR MICROBIOLOGY

Item	ISO/IEC17025 Clause	Requirement	Observations Yes	No	Not applicable
01		**SAMPLING AND SAMPLE HANDLING**			
01.01	5.7, 5.8	Customers are informed of the sampling protocol and acceptance criteria, and there are written criteria for sample rejection (e.g., poor condition, physical deterioration, incorrect temperature, deficient labeling, etc.)	☑	☐	☐
01.02	5.7, 5.8	There are any special sampling and handling instructions depending on the matrix or reference method (where appropriate).	☑	☐	☐
01.03	5.7, 5.8	If the laboratory is responsible for sampling, ensure there are procedures for sampling available where sampling is done and they are, whenever reasonable, based on appropriate statistical methods.	☐	☐	☑
01.04	5.7, 5.8	For sample handling, verify that there are documented procedures specified to protect the integrity of the sample from time of sampling to sample processing (including pre and post analysis storage) including, but not limited to: • use of sterile approved sample containers; • collection of chlorinated samples in sterilized containers pretreated with sodium thiosulphate (where appropriate); • instruction to ensure that holding time and sample transport / storage meets method / regulatory requirements.	☑	☐	☐
01.05	5.7, 5.8	For sample preparation/testing, verify that the laboratory can demonstrate that the test portion is a representative sample of the product as much as possible (when relevant) and suitable for analysis.	☑	☐	☐
01.06	5.7, 5.8	For sample preparation/testing, verify that the laboratory can demonstrate that steps have been taken to prevent interference by environmental conditions that can invalidate the test result and that records are maintained (e.g., storage records).	☑	☐	☐
01.07	5.7, 5.8	Ensure that there is effective separation of incompatible activities (for example, this is especially important for PCR methods).	☑	☐	☐
02		**DOCUMENT CONTROL/TEST METHOD**			
02.01	4.2.1, 4.3, 5.4.1, 5.4.2	Verify that there is an approved, documented method and deviations from the reference method are documented. Confirm versions are the same as in the QMS and within the actual lab, and that it and any supporting work instructions are readily available to the analyst.	☑	☐	☐

Item	ISO/IEC17025 Clause	Requirement	Observations Yes	No	Not applicable
02.02	4.2.1, 4.3, 5.4.1, 5.4.2	Verify that all necessary successive steps in the test procedure are based on the latest valid edition of a published reference method (where appropriate and possible) and adequately documented. Steps to look for include, but are not limited to: • Sampling; • Details on reagent preparation, storage and shelf life; • Procedure for media preparation, including labeling, storage, quality control and safety procedures for handling of media; • Colony counting and reporting criteria; appropriate reporting of non-detects, taking dilution factors and sample volumes into consideration; • Equipment, supplies, etc	☑	☐	☐
03		**TEST METHOD VALIDATION/VERIFICATION**			
03.01	4.2.1	Verify that there is a documented procedure for method validation and /or verification as appropriate.	☑	☐	☐
03.02	5.4	Verify that there are method validation and / or verification records. If there are deviations from the reference method, ensure validation is adequate. (The level and rigour of validation will depend on the nature/extent of the modification(s)).	☑	☐	☐
03.03	5.4	Verify that the: • method meets performance characteristics • method meets customer requirements and • validation / verification records include a statement that the method is "Fit for the intended use" .	☑	☐	☐
03.04	5.4	Verify that verification for Quantitative tests is conducted appropriately and includes repeatability using a minimum of 10 replicates of a known positive sample or duplicate data collected over a period of time.	☑	☐	☐
03.05	5.4	Verify that the verification for qualitative tests is based upon reliability of detection using a minimum of 10 of known positive samples, performance history, or media QC.	☐	☐	☑
03.06	5.4	Verify that in-house developed methods, published methods without validation data or commercial test kits without validation data are appropriately validated to establish relevant performance characteristics.	☐	☐	☑
03.07	CALA Policy	Verify that the laboratory has successfully participated in PT as per P02-03 - Proficiency Testing Policy for Accreditation; if PT did not meet acceptance criteria, confirm that the laboratory has records of corrective action.	☑	☐	☐
03.08	5.4.6	Confirm that the laboratory has identified factors that affect measurement of uncertainty and has estimated measurement uncertainty for quantitative tests.	☑	☐	☐
04		**METHOD QUALITY CONTROL**			
04.01	4.2.1	Verify that method quality control is documented.	☑	☐	☐
04.02	5.9.1	Verify that resulting data is recorded in such a way to detect trends, and where practicable, statistical techniques are applied to review results.	☑	☐	☐

Item	ISO/IEC17025 Clause	Requirement	Observations Yes	No	Not applicable
04.03	5.9	Confirm that method/analytical QC includes, duplicates to monitor within-run precision for quantitative methods (where appropriate). For further guidance, refer to P07.	☑	☐	☐
04.04	5.9	Confirm that method/analytical QC includes method blanks (where appropriate).	☑	☐	☐
04.05	5.9	Confirm that method/analytical QC includes monthly inter-technician comparison readings to monitor precision. Generally applicable to any method where a result depends on the judgment of an analyst (e.g., colour reaction).	☑	☐	☐
04.06	5.9	Confirm that method/analytical QC includes monthly parallel analyses on at least one positive sample to monitor inter-technician method precision for quantitative tests.	☑	☐	☐
04.07	5.9	Confirm that method/analytical QC includes confirmation of isolates as necessary (applicable only to membrane filtration methods).	☐	☐	☑
05		**MEDIA / REAGENT HANDLING AND QUALITY CONTROL**			
05.01	4.2.1	Verify that media / reagent handling requirements and quality control are documented.	☑	☐	☐
05.02	4.13.2	Verify that media and / or reagents are appropriately labeled with material, concentration or purity (as required), date prepared and /or expiry date.	☑	☐	☐
05.03	4.6.2, 5.3	Verify that media/ and or reagents are stored under proper conditions, and storage times are met.	☑	☐	☐
05.04	4.13.2	Verify that records are kept for all media/ reagents prepared or received and include: • date of receipt; • date opened / first use; • date of preparation, and expiry date (if required); • lot number, as required; • shelf-life / expiry date of product; • storage conditions; • performance specifications; • for purchased / prepared media / reagents: records of manufacturer's QC and other information, including but not limited to positive and negative control(s), sterility and final pH; • for in-house prepared media: QC results and sufficient information to enable the test to be repeated under conditions as close as possible to the original.	☑	☐	☐
05.05	4.13.2	Confirm that the laboratory has QC records for each batch of in-house prepared or purchased media. NOTE: for guidance on defining a *batch*, refer to the Interpretation in P07. The type and nature of QC testing will depend on the method, but generally involves the items listed in 05.06 to 05.10 (below).	☑	☐	☐
05.06	5.9, 4.13.2	Media QC includes a sterility check.	☑	☐	☐
05.07	5.9, 4.13.2	Media QC includes a positive control culture (traceable to ATCC or equivalent) performed using the same technique as used for routine analysis. For example, if media is used for MF, then the positive control must be applied using MF.	☑	☐	☐

Item	ISO/IEC17025 Clause	Requirement	Observations Yes	No	Not applicable
05.08	5.9, 4.13.2	Media QC includes a comparison of positive control cultures on selective and non-selective media and comparison of recovery rates of the positive control culture (see P07 for further information; not applicable for MPN methods);	❑	❑	☑
05.09	5.9, 4.13.2	Media QC includes a negative control culture (traceable to ATCC or equivalent). N.B. For MF methods, the negative culture can be streaked on the media.	☑	❑	❑
05.10	5.9, 4.13.2	For quantitative methods using non-selective media only: compare recovery rates on an old/previous batch of media to a new batch, using the same technique to do test (e.g., MF or spread plate or pour plate).	❑	❑	☑
06		**STOCK CULTURES**			
06.01	4.2.1	Verify that documented procedures are in place for the maintenance of stock cultures.	☑	❑	❑
06.02	4.13.2	Confirm that all information required to properly identify organisms appear on their containers (i.e., name or number of organism, and date subcultured) including working cultures and those stored at lower temperatures (e.g. in refrigerators / freezers, where appropriate).	☑	❑	❑
06.03	4.6.2, 4.13.2	Confirm that purchased organisms have certificates with the organism name, plus ID confirmation by the laboratory using an acceptable identification method (e.g. API, Biolog, Vitek, etc.) or key reactions are demonstrated on selective medium.	☑	❑	❑
06.04	4.6.2, 4.13.2	Confirm that organisms isolated from the environment are properly characterized, and key reactions are demonstrated on selective medium as required.	❑	❑	☑
07		**SUPPLIES/LABWARE QC**			
07.01	4.6.2, 5.5.1, 5.7, 5.9	Verify that a minimum of 1 sample container from each lot of new, certified containers is checked for sterility or for influence on parameters.	☑	❑	❑
07.02	4.6.2, 5.5.1	For MF methods, hydrophobicity of filters is tested (e.g., "charcoal" test or confluent growth or other method) and inhibitory effects of filters is tested by comparison of recoveries on a membrane filter and a spread plate.	❑	❑	☑
07.03	4.6.2, 5.4.1, 5.4.2	There are procedures in place to ensure there is no carryover between membrane filtrations (e.g., UV boxes, hot water).	❑	❑	☑
07.04	5.6	Accuracy of funnel volumetric graduations is checked (see A61).	❑	❑	☑
07.05	4.6.2, 5.5.1	If producing water in house and it is used to dilute samples, or make media or reagents, check conductivity daily or as-used and have procedures in place, including sterility testing, to verify that the water is not having a negative impact on the conduct of the test (see P07).	☑	❑	❑
07.06	4.6.2, 5.5.1	If purchasing distilled water, and it is used to dilute samples or to make media or reagents, have procedures in place, including sterility testing, to verify that the water is not having a negative impact on the conduct of the test. A certificate shall be obtained from the supplier prior to use (see P07).	❑	❑	☑

Item	ISO/IEC17025 Clause	Requirement	Observations Yes	No	Not applicable
07.07	4.6.2, 5.5.1	Verify that all labware is adequate cleaned. When washing and re-using glassware that can impact the recovery of organisms, verify that there is a procedure in place to test for residual detergent. See P07 for more direction.	☑	☐	☐
08		**SUPPLIES – AVAILABILITY**			
08.01	4.6.2, 5.5.1	Verify that all supplies (e.g., test organisms, media, reagents, reference materials, commercial kits, etc.) required for the test procedure are in sufficient quantities to carry out the volume of work.	☑	☐	☐
08.02	4.6.2, 5.5.1	Verify that all supplies (e.g., test organisms, media, reagents, reference materials, commercial kits, etc.) required for the test procedure meet requirements and/or specifications.	☑	☐	☐
08.03	4.6.2, 5.5.1	Verify that all supplies (e.g., test organisms, media, reagents, reference materials, commercial kits, etc.) required for the test procedure are stored under appropriate conditions (as specified in reference method or by regulator, etc.) and in a manner which satisfies requirements for safety, security, separation of incompatible materials / activities, and ease of retrieval.	☑	☐	☐
08.04	4.6.2, 5.5.1	Verify the following are available: • sterile rinse buffer / distilled water; • disinfectants available and routinely used for cleaning bench areas; • records of reference standards (e.g. reference weights, pH standards, etc.) and reference materials certificates (e.g. ATCC strains).	☑	☐	☐
09		**OTHER WORK INSTRUCTIONS (Procedures)**			
09.01	4.2.1, 4.3	Verify that all necessary supporting work instructions are documented and readily available including (where appropriate). Examples of supporting work instructions are listed below, but this list is not exhaustive.	☑	☐	☐
09.02	4.2.1, 4.3	Confirm that requisite reference texts / methods are available.	☑	☐	☐
09.03	4.2.1, 4.3	Confirm that supporting test methods (e.g., pH) are authorized and available.	☑	☐	☐
09.04	4.2.1, 4.3	Confirm that equipment instruction manuals are available.	☑	☐	☐
09.05	4.2.1, 4.3	Confirm that computer software related procedures (including LIMS procedures, such as data entry and approval) are authorized and available.	☑	☐	☐
09.06	4.2.1, 4.3	Confirm that glassware cleaning procedures are authorized and available.	☐	☐	☑
09.07	4.2.1, 4.3	Confirm that there are procedures in place for reporting of adverse results to authorities having jurisdiction.	☑	☐	☐
09.08	4.2.1, 4.3	Confirm that sample disposal procedures are authorized and available, including but not limited to disinfection / sterilization, disposal of biohazardous material, spill procedures and any safety considerations.	☑	☐	☐

Item	ISO/IEC17025 Clause	Requirement	Observations Yes	No	Not applicable
10		**EQUIPMENT**			
10.01	5.5	Verify that all equipment required for the test procedure and equipment supporting the test is available, uniquely identified, appropriately monitored, functioning properly, and safeguarded from adjustments that would invalidate results. (Note to laboratories and assessors: the list of equipment was removed from this checklist; it is incumbent to review the reference method and/or laboratory test method and confirm that equipment required for the test is available).	☑	☐	☐
10.02	5.5	Verify that equipment that requires regular servicing or checks to ensure conformance is included in a maintenance program.	☑	☐	☐
10.03	5.5	Verify that there is availability of backup equipment or a back-up plan.	☑	☐	☐
10.04	5.5	Verify that equipment requiring calibration (i.e. semi-automated pipettes, balances and thermometers that are critical to the test result) are labeled to indicate the status, including the date last calibrated and expiry criteria or date when due. Note: labeling is not required for equipment verified daily or as-used; see P07.	☑	☐	☐
11		**CONDUCT OF TESTING**			
11.01	4.2.1, 5.4.1	Verify that the test procedure and all supporting work instructions are performed as documented.	☑	☐	☐
12		**RECORD KEEPING**			
12.01	4.13	Verify that technical records are complete with respect to the specific tests, are recorded at the time they are made and that there is sufficient information to establish an audit trail. For guidance on the type and nature of records that may be needed, please refer to the appropriate section of P07.	☑	☐	☐

C3b 2nd Brodsky Report

Brodsky Consultants A DIVISION OF 468629 ONT. LTD.

73 DONNAMORA CRESCENT
THORNHILL, ONTARIO
L3T 4K6

PHONE: (416) 816-9837
FAX: (905) 889-2276
E-MAIL: mhbrodsky@rogers.com

April 22, 2015

Kimberley A. Philip, M.Eng., P.Eng.,
Director, Office of Drinking Water
1007 Century Street,
Winnipeg, MB
R3H 0W4

Comment on Hubbs and Diduck ALS Site Assessment Report

Further to my own audit of ALS in Winnipeg on February 17, 2015, a subsequent assessment was conducted by Steve Hubbs, Courtney Diduck on February 25, although their report cited ATL as the contract laboratory, not ALS. Is this simply a typo? A copy of their report was provided to me for review and I was asked to comment, specifically on the process identified as non-standard, the risks associated with that process, the mitigating measures in place to address that risk, and whether I see this as a possible cause of the multiple positive samples from Jan 26th.

I understand that Steve Hubbs and Courtney Diduck are not microbiologists. I have been an Environmental Microbiologist for more than 43 years. I served as the Chief of Environmental Microbiology for the Province of Ontario, Ministry of Health, Laboratory Services Branch, from 1982-1999. I serve as Chair for the AOAC Expert Review Committee for Microbiology, as a scientific reviewer in Microbiology for the AOAC OMA and the AOAC Research Institute, as a reviewer for Standard Methods for the Examination of Water and Wastewater and as a chapter editor on QA for the Compendium of Methods in Microbiology. I have been a lead auditor and technical assessor in microbiology for the Canadian Association for Laboratory Accreditation (CALA) since 2000 and serve Vice-chair of the CALA Board of Directors. I believe that I am in a much better position to evaluate laboratory practices in water microbiology.

1) Use of a syphoning apparatus to reduce sample volume.

Although I did not observe this technique being used, the use of a siphoning apparatus to remove excess volume of water from sample bottles is both unusual and unnecessary. As part of my audit I conducted a "Trace of Tests" on the records of the samples in question from receipt through processing to disposal. I reviewed all of the analytical and quality control data and interviewed the analysts identified by their initials or signatures on the records and reports. The analysts who processed the samples indicated that they did not use the syphoning. Based on all this evidence I concluded that the syphoning technique was not used in the processing of the samples in question and therefore was a non-issue with respect to the possibility of cross-contamination of those

samples. In addition, if this was a high risk procedure, there would have been historical evidence of cross-contamination in blank sample controls whenever this procedure was used. There was no such evidence. This conclusion was supported by QC data recently provided on the syphoning equipment and technique that showed that it does not contribute to microbial contamination of the samples.

2) Sterilization of work area and gloves between handling each sample due to the outside of sample bottles not being sterile.

From a microbiological perspective, re-sterilization of the work area between samples is both an unnecessary and unrequired precaution. Disinfection of the work area before and after sample processing is what is expected. As I observed, the laboratory implements sufficient aseptic controls to minimize the possibility of cross-contamination and verifies the effectiveness of these precautions through appropriate QC procedures, including environmental monitoring and method blanks.

3) Analyst fingers close to the Quanti-tray opening.

The Quanti-Tray method is a single-use analytical system that is less prone to cross-contamination than other traditional procedures used in water microbiology. I saw no evidence of any mishandling of the trays by the analysts. This conclusion is corroborated by the continual absence of contamination of method blanks that are handled identically as if they were samples.

4) The pipette used to subsample for the HPC test risks contaminating the inside rim of sample bottles.

Aseptic protocols dictate no contact between the pipette and the bottle rim. During my audit, I observed these same precautions being taken. In addition, as evidenced in my Trace of Tests report, there was no QC evidence to indicate that pipetting could have contributed to a cross-contamination issue. Again, this conclusion is corroborated by the continual absence of contamination of method blanks that are handled identically as if they were samples.

It is my professional opinion that there is no evidence to indicate that the ALS results were inaccurate or false. This laboratory is accredited by the Canadian Association for Laboratory Accreditation, indicating that its Quality System meets all the requirements stipulated by ISO/IEC 17025:2005, both from a management perspective and technically. I believe that the samples in question were indeed contaminated with coliforms and *Escherichia coli* before being received by the laboratory. Based on the substantial supporting QC evidence and my own on-site observations during my audit, that there was no possibility of inadvertent contamination during sample processing in the laboratory.

Sincerely

Michael Brodsky

M. H. Brodsky

Appendix D

- City of Winnipeg Technical Memorandums

D1 Backflow and Cross Connections

D1a Review of Backflow Records

City of Winnipeg - Water and Waste Department

NE01 - [redacted]

Company	Address	Location	Device Status	Serial #	LastTest #	TestDue #	Notes/Comments
[redacted]	[redacted]	Parkade - Water Meter Stall 28	Active	ZE099	9/30/2013	9/30/2014	Notice of violation - fail to test annually letter sent February 2, 2015.
		Parkade Stall 22	Active	ZD868	9/30/2013	9/30/2014	
		Parkade above Stall 5	Active	ZI383	7/4/2014	7/4/2015	1/2 Okay - Moderate hazard building
		Parkade above Water Meter Stall 28	Active	ZE097	7/4/2014	7/4/2015	
		Parkade above Stall 28	Active	ZD932	7/4/2014	7/4/2015	
		Water Meter Room - Parkade	Active	ZD988	9/30/2013	9/30/2014	Notice of violation - fail to test annually letter sent February 2, 2015. Lorraine has hired Pyrene
		Water Meter Room - Parkade	Active	ZE123	9/30/2013	9/30/2014	to come in and test ASAP. (Premise) - Moderate hazard building
		Boiler Room	Active	350696	6/6/2011	6/6/2012	Notice of violation - fail to test annually letter sent June 9, 2014. Mike tried the phone number in our water billing program and it was out of service.204-334-0619 Mike also talked with
		Mechanical Room #7	Active	97297	8/18/2009	8/18/2010	Lorraine from Linden realestate and she said they do not have a property management company looking after the building. Moderate hazard building
		Water Meter Room	Active	B03560	11/29/2014	11/29/2015	Okay - Severe hazard building
		Water Meter Room (Lawn Irrigation)	Active	B13874	11/29/2014	11/29/2015	
		[redacted] Mechanical Room	Active	59	10/11/2013	10/11/2014	Notice of violation - 60 days without inspection sent February 3, 2015. Dave has a work order out for the building. - Severe hazard building
		Water Meter Room	Active	142766	8/25/2014	8/25/2015	Okay - Moderate hazard building
		Water Meter Room	Active	2332250	8/25/2014	8/25/2015	
		Water Meter Room	Active	Y01693	8/25/2014	8/25/2015	
		Meter Room	Active	DD849	9/22/2014	9/22/2015	Okay - Moderate Hazard building
		NE Parkade Storage Room	Active	175021	9/22/2014	9/22/2015	
		Parkade Stall 918	Active	FC978	9/22/2014	9/22/2015	
		Storage Room	Active	DY317	9/22/2014	9/22/2015	
		Front Entrance	Active	6027	12/11/2013	12/11/2014	Notice of violation - fail to test annually letter sent February 2, 2015. Mike spoke with Yozef about having the test sheets emailed to us immediately. Other test sheets sent in but this one. Mozard hazard building
		Mechanical Room	Active	401323	2/7/2015	2/7/2016	Okay - Moderate hazard building
		Mechanical Room B-04	Active	356700	2/7/2015	2/7/2016	
		Mechanical Room B-05	Active	310300	2/7/2015	2/7/2016	
		Mechanical Room B-05	Active	A174249	2/7/2015	2/7/2016	

[redacted] [redacted]

Mechanical Room B-05	Active	A50373	2/7/2015	2/7/2016	
[redacted] Water Mechanical Room	Active	162584	5/20/2014	5/20/2015	Okay - Severe hazard building
Water Mechanical Room	Active	162585	5/20/2014	5/20/2015	
Boiler Room	Active	EK684	8/12/2014	8/12/2015	Okay - Moderate hazard building

City of Winnipeg - Water and Waste Department

NE06 - [redacted]

Company	Address	Location	Device Status	Serial #	LastTest #	TestDue #	Notes/Comments
[redacted]	[redacted]	[redacted] Mechanical Room	Active	KF457	9/1/2011	9/1/2012	Notice of violation - fail to test annually letter sent February 5, 2015. Dave to inspect March 2, 2015. Inspector mnet with property manager. Backflow preventer being addressed immediately. Moderate hazard building.
		Electrical Room	Active	A01784	7/5/2013	7/5/2014	
		Electrical Room	Active	A01765	8/5/2013	8/5/2014	
		[redacted] Shipping/Receiving	Active	A02326	7/5/2013	7/5/2014	
		Meter Room	Active	ED645	6/28/2010	6/28/2011	Notice of violation - fail to test annually letter sent February 5, 2015. Moderate hazard building.
		Meter Room	Active	EH735	6/28/2010	6/28/2011	

City of Winnipeg - Water and Waste Department

NE07 - [redacted]

Company	Address	Location	Device Status	Serial #	LastTest #	TestDue #	Notes/Comments
[redacted]	[redacted]	Main Floor Water Meter Room	Active	114464	9/3/2014	9/3/2015	Okay - Moderate hazard building
		4th Floor Garbage Room	Active	362918	9/15/2014	9/15/2015	Okay - Moderate hazard building
		Mechanical/Water Meter Room	Active	KK1831	7/4/2014	7/4/2015	
		[redacted]	Active	447155	7/9/2014	7/9/2015	Okay - Moderate hazard building
			Active	415100	7/9/2014	7/9/2015	
			Active	434320	6/5/2014	6/5/2015	
			Active	434327	6/5/2014	6/5/2015	
		Sprinkler/Meter Room	Active	329881	6/5/2014	6/5/2015	
		Water Meter Room in Receiving	Active	1952A	8/19/2014	8/19/2015	
		Kitchen	Active	441808	9/15/2014	9/15/2015	Okay - Moderate hazard building
		Water Meter Room	Active	LC1501	5/15/2014	5/15/2015	
		Kitchen	Active	B02555	9/15/2014	9/15/2015	Okay - Moderate hazard building
		Water Meter Room	Active	JF0152	5/15/2014	5/15/2015	
		Water Meter Room	Active	A37313	9/16/2014	9/16/2015	
		East Building - [redacted] Water Meter	Active	LW944	4/8/2005	4/8/2006	30 day work order sent out. Severe hazard building. Work order has now been completed as of Feb.27, 2015.
		West Building Water Meter Room	Active	139721	4/8/2005	4/8/2006	
		[redacted]	Active	90783	11/20/2014	11/20/2015	Okay - Moderate hazard building
		Sprinkler/Electrical Room	Active	NK0544	4/21/2014	4/21/2015	
		Water Meter Room	Active	339688	11/20/2014	11/20/2015	

City of Winnipeg - Water and Waste Department

SE02 - [redacted]

Company	Address	Location	Device Status	Serial #	LastTest #	TestDue #	Notes/Comments
[redacted]	[redacted]	Boiler Room	Active	A30701	7/15/2014	7/15/2015	Okay - Moderate hazard building
		Boiler Room	Active	44209	7/7/2014	7/7/2015	Okay - Moderate hazard building
		Boiler Feed Line	Active	A76716	2/25/2013	2/25/2014	Fail to test annually letter sent out February 22, 2015
		Boiler Room	Active	123032	2/25/2013	2/25/2014	
		Boiler Room	Active	123027	2/25/2013	2/25/2014	
		Boiler Room	Active	A99048	11/19/2013	11/19/2014	Fail to test annually letter sent out March 11, 2015
		Crawl Space South Centre	Active	B4396	7/22/2014	7/22/2015	Okay - Moderate hazard building

City of Winnipeg - Water and Waste Department

SE03 - [redacted]

Company	Address	Location	Device Status	Serial #	LastTest #	TestDue #	Notes/Comments
[redacted]	[redacted]	Boiler Room	Active	392157	1/28/2015	1/28/2016	Okay - Severe hazard building
		[redacted]	Active	126246	1/23/2015	1/23/2016	
			Active	408558	2/10/2015	2/10/2016	
			Active	245581	1/23/2015	1/23/2016	
			Active	388375	1/23/2015	1/23/2016	
			Active	221208	1/23/2015	1/23/2016	
			Active	247161	1/23/2015	1/23/2016	
			Active	221226	1/28/2015	1/28/2016	
			Active	243708	1/23/2015	1/23/2016	
			Active	40965	1/23/2015	1/23/2016	
			Active	115501	1/23/2015	1/23/2016	
			Active	123311	1/23/2015	1/23/2016	
			Active	243701	1/23/2015	1/23/2016	
	[redacted]	South/Center of Building	Active	U11870	9/25/2014	9/25/2015	Okay - Moderate hazard building
		Unit D-Sprinkler Room South End	Active	JF0151	9/25/2014	9/25/2015	
		[redacted]	Active	617213	12/22/2014	12/22/2015	Okay - Severe hazard building (well water on site)
			Active	640985	12/22/2014	12/22/2015	
		Water Meter Room	Active	202725	12/22/2014	12/22/2015	
		Sprinkler Shed	Active	205175	5/24/2013	5/24/2014	Annual testing notice sent April 4, 2014. Will be tested in the spring. Unaccessible in the winter. Moderate hazard building.

City of Winnipeg - Water and Waste Department

SE04 - [redacted]

Company	Address	Location	Device Status	Serial #	LastTest	TestDue	Notes\Comments
[redacted]	[redacted]	Boiler Room	Active	499328	10/8/2014	10/8/2015	Okay - Moderate hazard building
		Boiler Room	Active	501521	10/8/2014	10/8/2015	

City of Winnipeg - Water and Waste Department

SE07 - [redacted]

Company	Address	Location	Device Status	Serial #	LastTest #	TestDue #	Notes/Comments
[redacted]	[redacted]	Crawl Space ([redacted]	Active	80993	39990	40355	Annual testing notice sent March 19, 2014. Spring testing. Unaccessible in winter. Moderate hazard device
		Garbage Room	Active	177354	4/15/2014	4/15/2015	1/2 Okay - Moderate hazard building
		Electrical room - lawn irrigation	Active	1353	5/31/2012	5/31/2013	Notice of violation - fail to test annually letter sent June 2, 2014. Spring testing. Unaccessible in winter. Moderate hazard device
		[redacted]	Active	361622	6/2/2014	6/2/2015	Okay - Moderate hazard building
			Active	361623	6/2/2014	6/2/2015	
		Water Meter Room	Active	176490	3/14/2014	3/14/2015	
		Lawn Sprinkler Pit	Active	B669	6/4/2014	6/4/2015	Okay - (Frozen) Unaccessible in winter. Moderate hazard device
		Mezzanine Mechanical Room	Active	AK4580	3/12/2014	3/12/2015	Okay - Moderate hazard building
		Boiler Room	Active	R066	10/6/2014	10/6/2015	Okay - Moderate hazard building

City of Winnipeg - Water and Waste Department

SE08 - [redacted]

Company	Address	Location	Device Status	Serial #	LastTest	TestDue	Notes\Comments
[redacted]	[redacted]	Boiler Room	Active	100704	12/22/2014	12/22/2015	Okay - Moderate hazard building
		Boiler Room	Active	134397	12/22/2014	12/22/2015	
		Boiler Room	Active	158513	12/22/2014	12/22/2015	
		Crawl Space [redacted]	Active	809291	12/22/2014	12/22/2015	
		Crawlspace	Active	232947	12/22/2014	12/22/2015	
		[redacted]	Active	WI680	12/22/2014	12/22/2015	
		Tunnel	Active	FP531	12/22/2014	12/22/2015	
		Main Floor Water Meter Room	Active	147763	7/11/2013	7/11/2014	Annual testing notice sent June 13, 2014. Fail to test annually letter sent March 3, 2015. Moderate hazard building
		Main Floor Water Meter Room	Active	145988	7/16/2013	7/16/2014	
		[redacted]	Active	ZR761	7/11/2013	7/11/2014	

City of Winnipeg - Water and Waste Department

SW04 - [redacted]

Company	Address	Location	Device Status	Serial #	LastTest #	TestDue #	Notes\Comments
[redacted]	[redacted]	[redacted]	Active	101102	1/8/2015	1/8/2016	Okay - Moderate hazard application
		Boiler Room	Active	190529	6/6/2007	6/6/2008	Fail to test annually letter sent March 11, 2015
		Boiler Room	Active	463955	12/22/2014	12/22/2015	Okay - Moderate hazard building
		Lower level - Mechanical room Sprinkler	Active	IL0118	12/22/2014	12/22/2015	
		Basement Building E Boiler Room	Active	287981	1/3/2015	1/3/2016	Okay - Moderate hazard building
		Bsmt Bldg G Boiler Room	Active	290762	1/3/2015	1/3/2016	
		Pump Room	Active	164630	6/13/2014	6/13/2015	Okay - Severe hazard building
		Mechanical Boiler - Condensate Tank	Active	A72422	10/1/2014	10/1/2015	Okay - Moderate hazard building

City of Winnipeg - Water and Waste Department

SW07 - [redacted]

Company	Address	Location	Device Status	Serial #	LastTest #	TestDue #	Notes\Comments
[redacted]	[redacted]	Boiler Room	Active	449300	5/30/2013	5/30/2014	Notice of violation - fail to test annually letter sent February 2, 2015. Severe hazard building
		Mechanical Room	Active	FT471	4/18/2011	4/18/2012	
		[redacted] Mechanical Room	Active	247076	10/28/2014	10/28/2015	Okay - Severe hazard building
		Mechanical Room	Active	51749	10/28/2014	10/28/2015	
		Boiler Room	Active	CY033	2/6/2015	2/6/2016	Okay - Moderate hazard building
		Basement Boiler Room	Active	230708	8/26/2014	8/26/2015	Okay - Moderate hazard building
		Portable	Active	441943	4/11/2014	4/11/2015	Okay - Severe hazard application
		Car Wash Water Meter	Active	KB640	3/17/2014	3/17/2015	Okay - Severe hazard building
		Car Wash Water Meter	Active	KR265	3/17/2014	3/17/2015	
		Mechanical Room	Active	51237	4/29/2014	4/29/2015	Okay - Moderate hazard building
		Mechanical Room	Active	16130	12/1/2014	12/1/2015	
		North Side Mop Sink Room	Active	360093	4/29/2014	4/29/2015	
		North Side Mop Sink Room	Active	75433	4/29/2014	4/29/2015	
		Mechanical Room Front of Store	Active	457341	10/7/2014	10/7/2015	Okay - Moderate hazard building
		Water Meter Room	Active	NH0105	12/16/2014	12/16/2015	
		[redacted]	Active	209432	10/7/2014	10/7/2015	Okay - Moderate hazard building
		Water Meter Room	Active	NH0643	12/16/2014	12/16/2015	Okay - Severe hazard building
		Mechanical Room	Active	22172	10/7/2014	10/7/2015	Okay - Moderate hazard building
		Water Meter Room	Active	NG1594	12/17/2014	12/17/2015	
		SW Sprinkler Room	Active	U17652	4/1/2014	4/1/2015	Okay - Moderate hazard building
		[redacted] Mechanical Room	Active	356582	10/9/2013	10/9/2014	Notice of violation - fail to test annually letter sent February 2, 2015. (Premise) - Severe hazard building
		Mechanical Room	Active	468666	10/9/2013	10/9/2014	

City of Winnipeg - Water and Waste Department

SW12 - [redacted]

Company	Address	Location	Device Status	Serial #	LastTest #	TestDue #	Notes\Comments
[redacted]	[redacted]	Boiler Room	Active	395184	7/14/2014	7/14/2015	Okay - Moderate hazard building
		Boiler Room	Active	NA355	5/15/2014	5/15/2015	Okay - Moderate hazard building
		Boiler room	Active	378547	3/10/2014	3/10/2015	Okay - Moderate hazard building
		[redacted]	Active	A203136	11/1/2012	11/1/2013	Notice of violation - fail to test annually letter sent October 30, 2014. Moderate hazard building
		Water Meter Room	Active	22650	11/21/2013	11/21/2014	Annual testing notice sent October 21, 2014. (Premise) Moderate hazard building
		Boiler Room	Active	463714	6/19/2014	6/19/2015	Okay - Moderate hazard building
		Water Meter Room	Active	25642	6/18/2014	6/18/2015	
		Water Meter Room	Active	25669	6/18/2014	6/18/2015	
		Boiler Rm/west wall (glycol)	Active	174811	11/17/2011	11/17/2012	Okay - Maintenance supervisor contacted and requested test sheet February 26, 2015. Moderate hazard building
		Boiler Room/west wall	Active	174763	11/17/2011	11/17/2012	
		Water Meter (Mechanical)	Active	HM216	11/18/2008	11/18/2009	Okay - Moderate hazard building
		Boiler Room	Active	381859	5/16/2013	5/16/2014	Notice of violation - fail to test annually letter sent February 25, 2015. (Premise) - Moderate hazard building
		SE Corner of Building	Active	J06100	1/22/2013	1/22/2014	
		Water meter	Active	14802	1/22/2013	1/22/2014	
		Boiler Room	Active	396260	9/17/2013	9/17/2014	Notice of violation - fail to test annually letter sent February 25, 2015. Moderate hazard building

D1b Severe Hazard Inspections

City of Winnipeg - Water and Waste Department
Severe Hazard Locations Close to Feedermain

Company	Address	Device Status	Serial #	LastTest #	TestDue #	Notes\Comments
		Active	09520	1/12/2015	1/12/2016	An inspection was completed for premise isolation March 3, 2015; All devices were in place and in compliance.
		Active	254172	5/4/2014	5/4/2015	An inspection was completed for premise isolation March 3, 2015; Backflow preventers have been tested and are in compliance; Room #74 had 2 connections upstream of the premises devices used by the City of Winnipeg to flow test the water meter; Room #74 Backflow prevention devices have a by-pass installed; By-pass valves are in the closed position; A Work order is being sent to remove the by-pass as it not allowed.
		Active	254295	6/12/2014	6/12/2015	An Inspection was completed for premise isolation March 5, 2015; 3 services were observed on the premises; 1- 6 inch fire/domestic service with a single check valve on the fire supply and a reduced pressure backflow preventer on the domestic supply. Domestic reduced pressure backflow preventer had been tested and is in comliance; 1- 2 inch service has been abandoned; 1- 1 inch service requires a premises isolation backflow preventer; A Work order was sent on March 9, 2015; All other backflow prevention devices on site are in compliance
		Active	120411	3/5/2015	3/5/2016	An Inspection was completed for premises isolation March 3, 2015; This building has 3 locations with incoming services; 1st location on the west side of building has 2 premises devices in compliance tested Feb.26,2015; 2nd location on the east side has 2 premises devices on the domestic water in compliance tested Feb.10, 2015. There were 4 premises devices on the fire protection system all in compliance tested Feb. 19 and 20, 2015; 3rd location Central Boiler Room has 2 premises devices and 1 fire protection device due for testings near the end of January of 2015; Tester who works for the full time is scheduled to test 3 premises devices the week of March 3, 2015; The 2 domestic water premise backflow preventers have been submitted and are in compliance. The fire system device requires repair. Parts are scheduled to be available the week of March 16,2015

D2 Underground Valve Chambers

D2a Valve Pit Inspection Reports from the 2013 "Feedermain Valve Chamber Condition Assessment" Report.

[redacted]

[redacted]	[redacted]	[redacted]	[redacted]
[redacted]	[redacted]	[redacted]	[redacted]
[redacted]	[redacted]	[redacted]	[redacted]
[redacted]	[redacted]	[redacted]	[redacted]
[redacted]	[redacted]	[redacted]	[redacted]
[redacted]	[redacted]	[redacted]	[redacted]
[redacted]	[redacted]	[redacted]	[redacted]
[redacted]	[redacted]	[redacted]	[redacted]

[redacted]

[redacted]

[redacted]

[redacted]

3.5 Rating System for Inspection Results

A condition rating system was created prior to the inspection survey. The rating system was used to rank the condition of elements and provide input into decision processes for future work. Each chamber was divided into seven major groups (Figure 16) with a number of more discrete elements contained within each group to more fully describe condition.

The individual elements are given a condition rating value from 1 to 5 with 1 being good condition and 5 being in extremely poor or failed condition. Ratings of 2 to through 4 are a gradation between these two extreme ends of the scale. For elements that are more functional rather than discrete (Cleanliness compared to a Roof Slab, for example), the rating system is boolean in nature with a Yes / No basis. Since numeric values are required to relate between element ratings only the values of 1 and 5 are used in the rating with 1 representing a positive and 5 representing a negative sense. The pairing of 1. to Yes / 5. to No or 1. to No / 5. to Yes will depend on the context of the element in question. For example, Infiltration uses 1. No / 5. Yes since it is a positive sense to not have infiltration and a value of 1 should be assigned to be compatible with the sense of the other ratings and resultant

calculations for the group. Conversely, Cleanliness uses 1. Yes / 5. No since a clean chamber is a positive as opposed to a negative implication.

In turn, the condition rating for the group is calculated based on the aggregated condition ratings from all elements within the group (Figure 16). The six groups are as follows.

1. Structural
2. Electrical
3. In-Chamber Piping
4. Overall Valve Rating
5. Overall Air Valve Rating
6. Overall Fitting Rating

A separate group entitled Chamber Operational Rating reflects the use of valve chambers as access points for both pipeline assessment tools and advanced rehabilitation technology. It was considered cost effective to review these types of related issues and retrofit requirements as part of the chamber inspection process. With this in mind, the rating system has included an assessment for accessibility issues, as they relate to the future deployment of current pipeline assessment, monitoring, and rehabilitation technologies.

Table 2 to Table 8 present the details of the rating system including the descriptions for each rating value as it relates to the specific element and some example pictures. For the groups related to valves and fittings (Groups 4, 5, and 6) a rating has been created for the overall condition of the group containing all the respective elements (as is the case for Groups 1, 2, 3, and 7) plus an additional rating for the individual valve. These additional valve-specific ratings are shown in green in Figure 16.

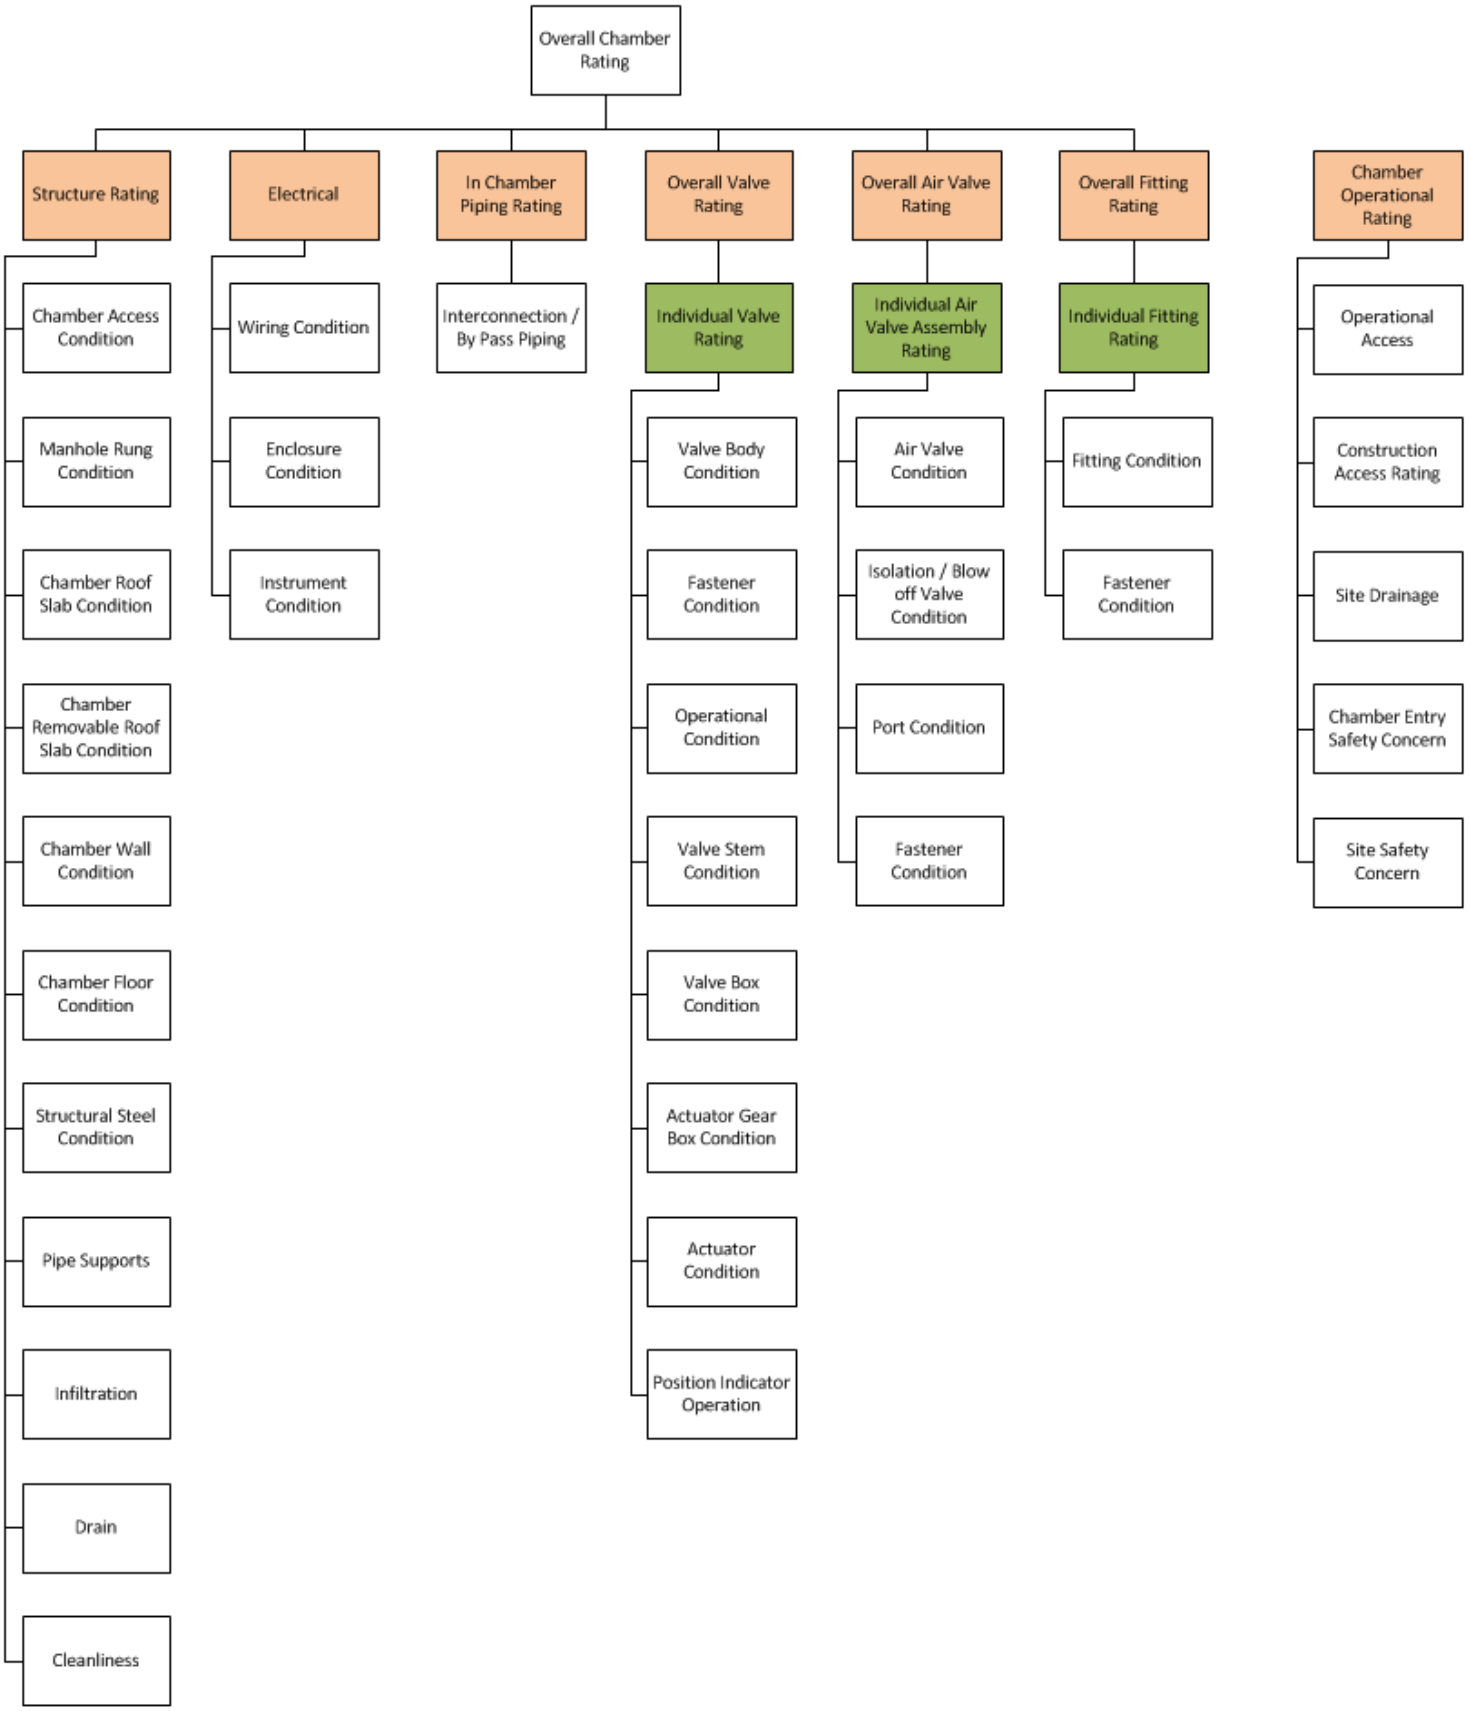

Figure 16: Elements of Inspection Survey

3.5.1 Structure Rating

The structural rating (Table 2) pertains to the condition of the chamber which is the buried structure that houses the pipeworks. This is the most external boundary where soil meets the structure. The elements are either the actual parts of the chamber such as walls and floor or those items that are attached to the chamber (manhole rungs) or facilitate the use of the chamber (drain). Most of the elements have a rating from 1 to 5 with the exception of the elements Infiltration, Drain, and Cleanliness where a boolean scale is used (i.e. a 1 or a 5).

Table 2: Chamber Structure Rating System

Chamber Element	Additional Element Description	Rating Value and Description (From 1 to 5)
Access Manhole	Extends from chamber roof to ground surface and includes risers, lid, cover and frame. Indicate whether or not manhole reducers exist and their condition.	1. L ke New 2. Evidence of Water Infiltration 3. Spalling Concrete 4. Missing Concrete / Bricks or Voiding 5. Severe Structural Distress
Manhole Rung	Grouped by type, material, and condition.	1. L ke New 2. Normal Wear 3. Moderate Corrosion / Wear 4. Heavy Corrosion / Wear 5. Missing / Unusable
Roof Slab	Based on the most prevalent material used.	1. No Structural Issues 2. Cracks Greater than 3mm and/or Rust Stains 3. Concrete Delamination and/or Spalls 4. Effflorescence and/or Water Infiltration 5. Evidence of Structural Distress
Removable Roof Slab	Based on the most prevalent material used.	1. No Structural Issues 2. Cracks Greater than 3mm and/or Rust Stains 3. Concrete Delamination and/or Spalls 4. Effflorescence and/or Water Infiltration 5. Evidence of Structural Distress
Wall	Based on the most prevalent material used.	1. No Structural Issues 2. Cracks Greater than 3mm and/or Rust Stains 3. Concrete Delamination and/or Spalls 4. Effflorescence and/or Water Infiltration 5. Evidence of Structural Distress
Floor	Based on the most prevalent material used.	1. No Structural Issues 2. Cracks Greater than 3mm and/or Rust Stains 3. Concrete Delamination and/or Spalls 4. Effflorescence and/or Water Infiltration 5. Evidence of Structural Distress
Structural Steel	I-beams and other structural steel sections that form part of the chamber structure. Pitting is measured where possible.	1. L ke New 2. Slight Coating Disbondment 3. Significant Coating Disbondment, Corrosion 4. Significant Corrosion 5. Structural Distress

Chamber Element	Additional Element Description	Rating Value and Description (From 1 to 5)
Pipe Supports	Based on material type including: • CIPC – cast-in-place concrete • PCC – precast concrete • Brick • Steel • Other	1. L ke New 2. Slight Deterioration 3. Moderate Deterioration 4. Severe Deterioration 5. Imminent Failure
Infiltration	Infiltration is present. Add comment related to location and cause specific to chamber access, roof, walls, and floor.	1. No 5. Yes
Drain	Drain is present. Add comment that drain works or not.	1. Yes 5. No
Cleanliness	Cleaning is required.	1. No 5. Yes

Figure 17: Example of Removable Roof Slab with Condition Rating of 4. Efflorescence and/or Water Infiltration

Figure 18: Example of Conditions for the Roof (4. Effloresence and/or Water Infiltration) and Rungs (2. Normal Wear)

3.5.2 Electrical Rating

The elements and ratings for electrical are presented in Table 3. General information was gathered from labels on the electrical equipment to record the phase, voltage, and amperage of the equipment. Circuit and wiring details were also inspected. Recommendations for replacement are based on these rated conditions.

Table 3: Electrical Rating System

Electrical Element	Additional Element Description	Rating Value and Description (From 1 to 5)
Wiring	Based on type including: • Teck • EMT - electrical metallic tubing • Steel • Aluminium	1. Good 2. Minor Corrosion 3. Corrosion and Damage 4. Severe Corrosion and Damage 5. Severe Damaged
Enclosure	Include tag numbers, descriptions, and NEMA rating (National Electrical Manufacturers Association).	1. Good 2. Minor Corrosion 3. Corrosion and Damage 4. Severe Corrosion and Damage 5. Severe Damaged
Instrument	Include tag numbers and descriptions.	1. Good 2. Minor Corrosion 3. Corrosion and Damage 4. Severe Corrosion and Damage 5. Severe Damaged

Figure 19: Example of Pressure Transmitter (QIB-599-PT) with Condition Rating 1. Good.

3.5.3 In-Chamber Pipe Rating

Pipes in the chamber consist of the feedermains and other branch pipes. Condition ratings are related to the material types as shown in (Table 4).

Table 4: In-Chamber Pipe Rating System

In-Chamber Pipe Element	Additional Element Description	Rating Value and Description (From 1 to 5)
Interconnection And By-Pass Pipes	Based on material type as follows with comments. • Welded steel • Cast iron • Ductile iron • PVC – polyvinyl chloride • Fabricated PVC • Other	1. Like New 2. Slight missing coating and corrosion of metal 3. Moderate missing coating and corrosion of metal 4. Severe missing coating and corrosion of metal 5. Imminent failure

3.5.4 Overall Valve Rating

The overall valve rating is calculated as an average of the individual valve ratings for each element. The element ratings are presented in (Table 5). An important aspect of the overall valve rating is the operability of each valve. Based on the WSD's preference this was not determined based on actual operation of the valve in all cases. Only 219 of the 544 main line valves were operated in this program. All other valves operational status was determined based on the operator's understanding of the valve's operational state.

Table 5: Overall Valve Rating System

Valve Element	Additional Element Description	Rating Value and Description (From 1 to 5)
Valve Body	Based on material type: • Cast iron • Brass • Ductile Iron • PVC • Steel • Other And coating type: • None • Paint • Enamel • Primer • Coal Tar • Epoxy • Asphalt • Other Fasteners located on the valve body holding components of the valve are included within the condition assessment.	1. Like New 2. Slight Missing Coating and Corrosion of Metal 3. Moderate Missing Coating and Corrosion of Metal 4. Severe Missing Coating and Corrosion of Metal 5. Imminent Failure
Fastener	Relates to fasteners connecting the valve to the pipe and not fasteners on the valve itself.	1. Like New 2. Slight Corrosion 3. Moderate Corrosion 4. Severe Corrosion 5. Imminent Failure
Operational[3]	Indicate handwheel presence, rotation direction, and number of turns to open valve.	1. Operates 5. Does not Operate
Valve Stem	Include joint and nut details, and also dimensions.	1. Like New 2. Slight Coating Disbondment 3. Significant Coating Disbondment, Corrosion 4. Significant Corrosion 5. Structural Distress
Valve Box	Include grade and alignment.	1. Good 3. Damaged 5. Destroyed / Missing
Actuator Gear Box	Include identification, ratio, and coating.	1. Like New 2. Slight Missing Coating and Corrosion of Metal 3. Moderate Missing Coating and Corrosion of Metal 4. Severe Missing Coating and Corrosion of Metal 5. Imminent Failure
Actuator	Actuator specification, electrical requirements and coating type are determined and condition assessed.	1. Like New 2. Slight Missing Coating and Corrosion of Metal 3. Moderate Missing Coating and Corrosion of Metal 4. Severe Missing Coating and Corrosion of Metal 5. Imminent Failure
Valve Opening Position Indicator	Indicator is present and working.	1. Yes 5. No

[3] *NOTE: Operational state of valve was based on valve operator's opinion/knowledge if not determined based on actual operation of valve. Basis for assessment is noted in database comments.*

Figure 20: Example of Gearbox Condition with Rating of 2. Slight Missing Coating and Corrosion of Metal

3.5.5 Overall Air Valve Rating

The overall valve rating is calculated as an average of the individual valve ratings for each element. The element ratings are presented in (Table 6).

Table 6: Overall Air Valve Rating System

Air Valve Element	Additional Element Description	Rating Value and Description (From 1 to 5)
Air Valve Body	Based on material type: • Cast iron • Brass • Ductile Iron • PVC • Steel • Other And coating type: • None • Paint • Enamel • Primer • Coal Tar • Epoxy • Asphalt • Other Fasteners located on the valve body holding components of the valve are included within the condition assessment.	1. Like New 2. Slight Missing Coating and Corrosion of Metal 3. Moderate Missing Coating and Corrosion of Metal 4. Severe Missing Coating and Corrosion of Metal 5. Imminent Failure

Air Valve Element	Additional Element Description	Rating Value and Description (From 1 to 5)
Isolation / Blow Off Valve	Identify manual valves present and assess based on material type: • Cast iron • Brass • Ductile Iron • PVC • Steel • Other And coating type: • None • Paint • Enamel • Primer • Coal Tar • Epoxy • Asphalt • Other Fasteners located on the valve body holding components of the valve are included within the condition assessment.	1. Like New 2. Slight Missing Coating and Corrosion of Metal 3. Moderate Missing Coating and Corrosion of Metal 4. Severe Missing Coating and Corrosion of Metal 5. Imminent Failure
Port	Identify type. Assess all elements between the valve and the pipeline.	1. Like New 2. Slight Missing Coating and Corrosion of Metal 3. Moderate Missing Coating and Corrosion of Metal 4. Severe Missing Coating and Corrosion of Metal 5. Imminent Failure
Fastener	Relates to fasteners connecting the air valve to the pipe and not fasteners on the air valve itself.	1. Like New 2. Slight Corrosion 3. Moderate Corrosion 4. Severe Corrosion 5. Imminent Failure

Figure 21: Example of Air Release Valve Body (2. Slight Missing Coating and Corrosion of Metal), Fastener (2. Slight Corrosion), and Port (3. Moderate Missing Coating and Corrosion of Metal)

3.5.6 Overall Fitting Rating

The overall fitting rating is calculated as an average of the individual fitting ratings for each element. The element ratings are presented in Table 7. Fitting types include, but are not limited to:

- Tee
- Double Tee
- Cross
- Reducer
- Increaser
- Spool Piece
- Blind Flange
- Reducing Tee
- Reducing Double Tee

Table 7: Overall Fitting Rating System

Overall Fitting Element	Additional Element Description	Rating Value and Description (From 1 to 5)
Fitting	Identify pitting of steel fittings and pit depths.	1. L ke New 2. Slight Missing Coating and Corrosion of Metal 3. Moderate Missing Coating and Corrosion of Metal 4. Severe Missing Coating and Corrosion of Metal 5. Imminent Failure
Fastener	Relates to fasteners connecting the fitting to the pipe and not fasteners on the valve itself.	1. L ke New 2. Slight Corrosion 3. Moderate Corrosion 4. Severe Corrosion 5. Imminent Failure

Figure 22: Fasteners, Condition Grade 2. Interconnecting Pipework Body Condition Grade 3

3.5.7 Chamber Operational Rating

The chamber operational rating (Table 8) builds upon site observations that can be used by the City to assist in planning for future operations, site construction, and inspection (robotic). Where a maximum rating value (5) exists entitled “Other”, this rating describes a current environment that poses a greater risk or condition that will involve significant operational issues. Further comment is also provided. Elements with this rating are not included in the cost model.

Table 8: Chamber Operational Rating System

Chamber Operational Element	Additional Element Description	Rating Value and Description (From 1 to 5)
Operational and Inspection Access	Imposed by site condition or location. Examples: • manhole located on busy street or at intersection • overgrown with trees and shrubs • buried beneath pavement	1. Full 2. Partially Blocked 3. Limited 4. Completely Blocked 5. Other
Construction Access	Imposed by site condition or location. Examples: • manhole located on busy street or at intersection • overgrown with trees and shrubs • buried beneath pavement	1. Full 2. Partially Blocked 3. Limited 4. Completely Blocked 5. Other
Site Drainage	Chamber access location relative to surrounding ground. Identify chamber flood risk.	1. Slopes away from Chamber 2. Flat 3. Slopes toward Chamber 4. Other
Chamber Entry Safety Concern	Indicate chamber type with check box. Provide dimensions. Descr be safety concerns.	1. Unchecked 5. Checked (with description)
Site Safety Concern	Extraordinary safety concerns. Examples: • chamber access in road intersection • manhole located 1.5m above ground level	1. Unchecked 5. Checked (with description)

W-AV70000003

City of Winnipeg Asset Name		**Observations:**
Feedermain Name	Plessis Road	
Address of Nearest Building		
Feedermain ID	FM013	
Easting Northing		
Type of chamber Access		**Actions:** mitigate infiltration, repair access, repair concrete structure
Depth of Chamber		
Primary FM Pipe Diameter	600	**General Comments:**
Smaller Diameter		
Branch Pipes		

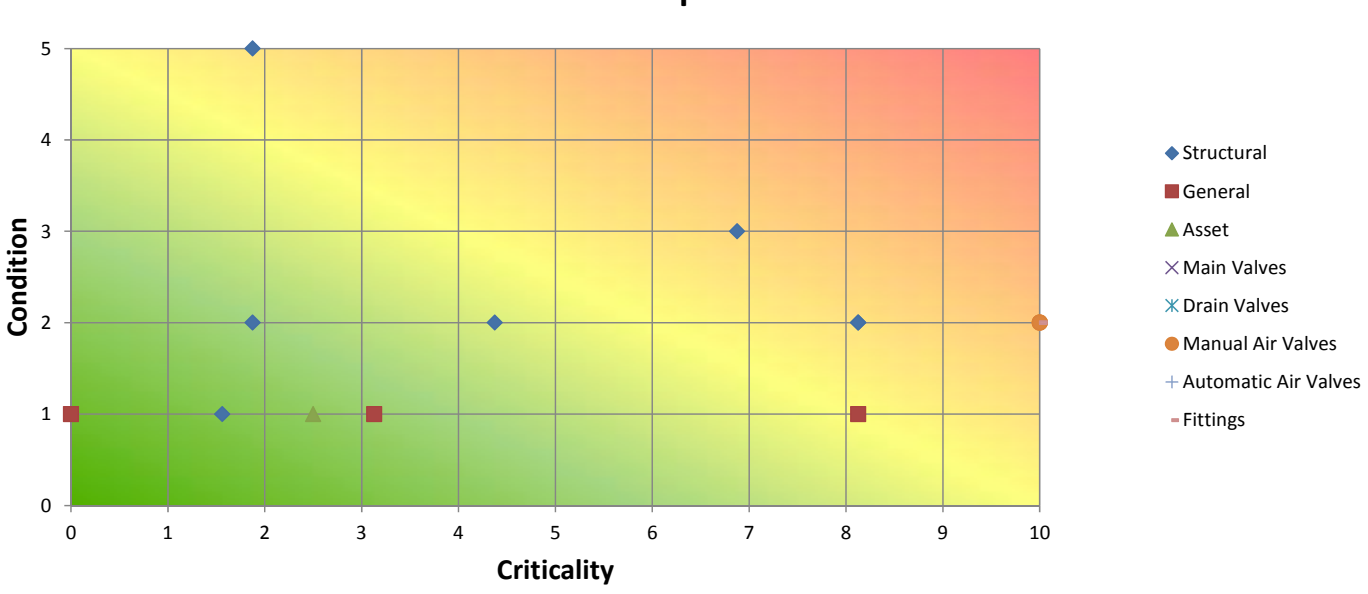

Chamber

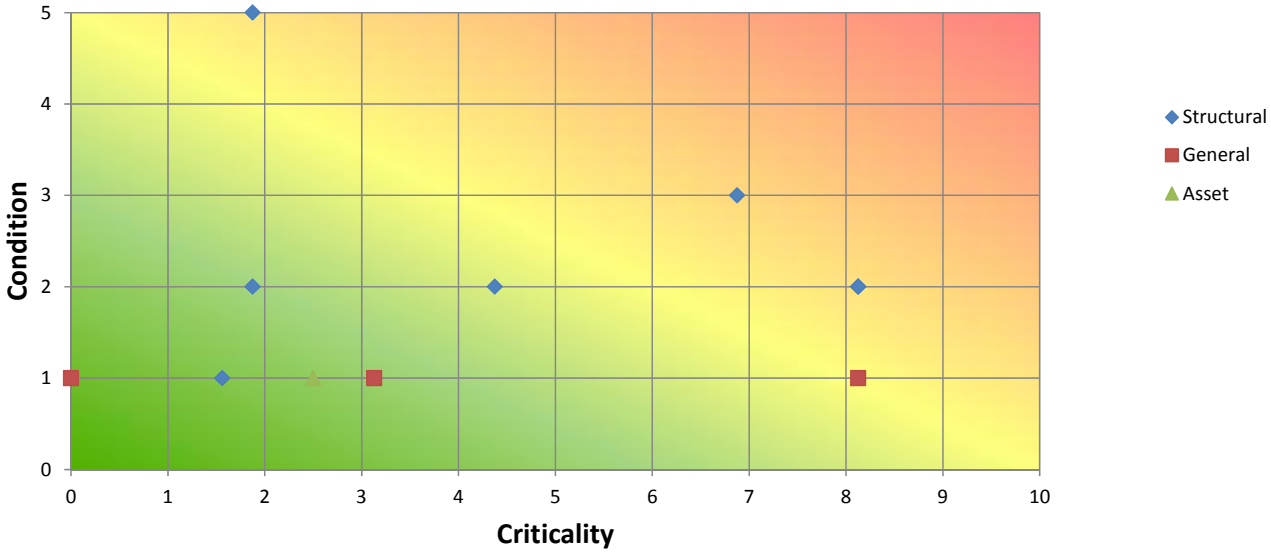

AirValves

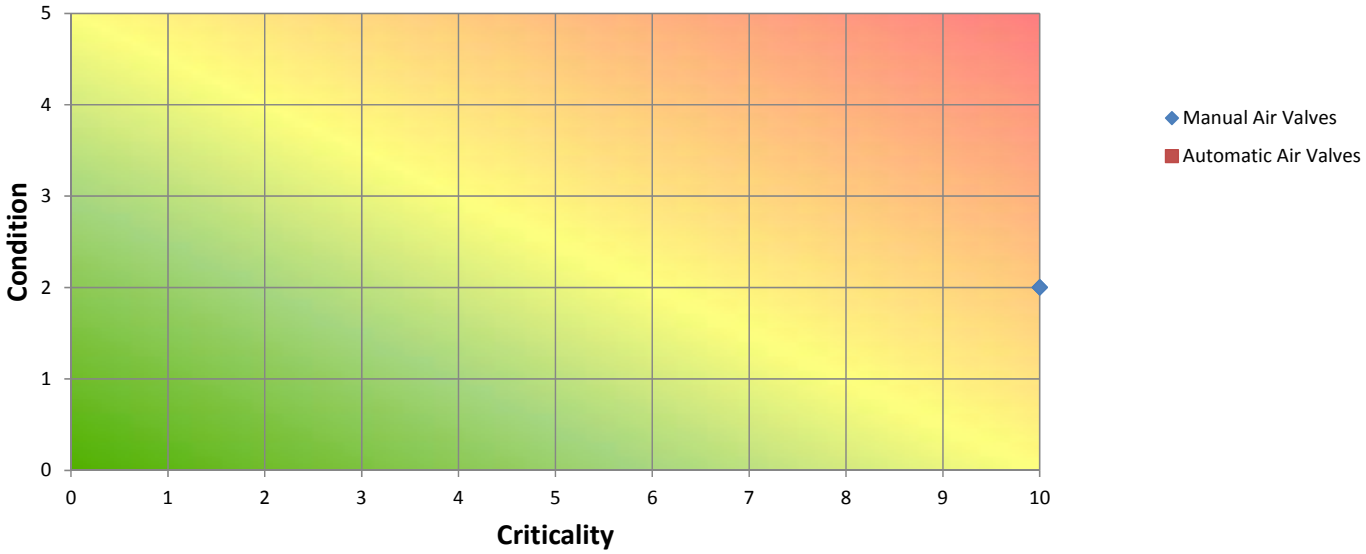

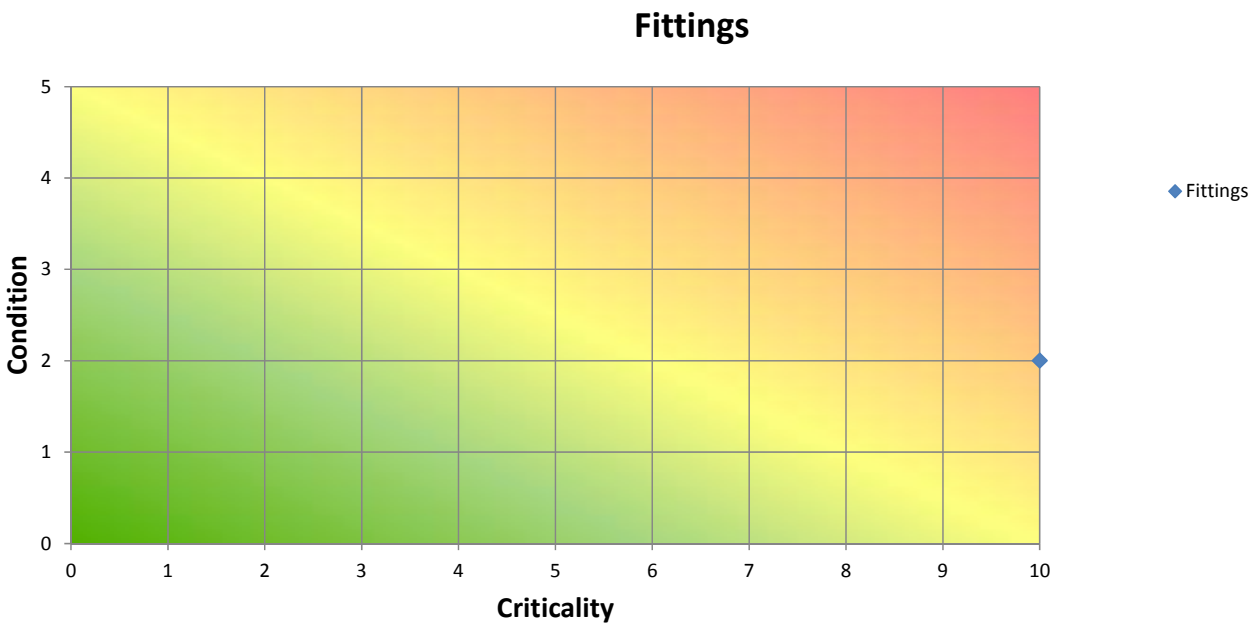
Fittings
Condition
Criticality
0
1
2
3
4
5
6
7
8
9
10
Fittings

W-AV70000043

City of Winnipeg Asset Name		**Observations:**
Feedermain Name	Dakota Extension	
Address of Nearest Building		
Feedermain ID	FM021	
Easting Northing		
Type of chamber Access		**Actions:** replace or refinish valve components, mitigate infiltration
Depth of Chamber		
Primary FM Pipe Diameter		**General Comments:**
Smaller Diameter		
Branch Pipes		

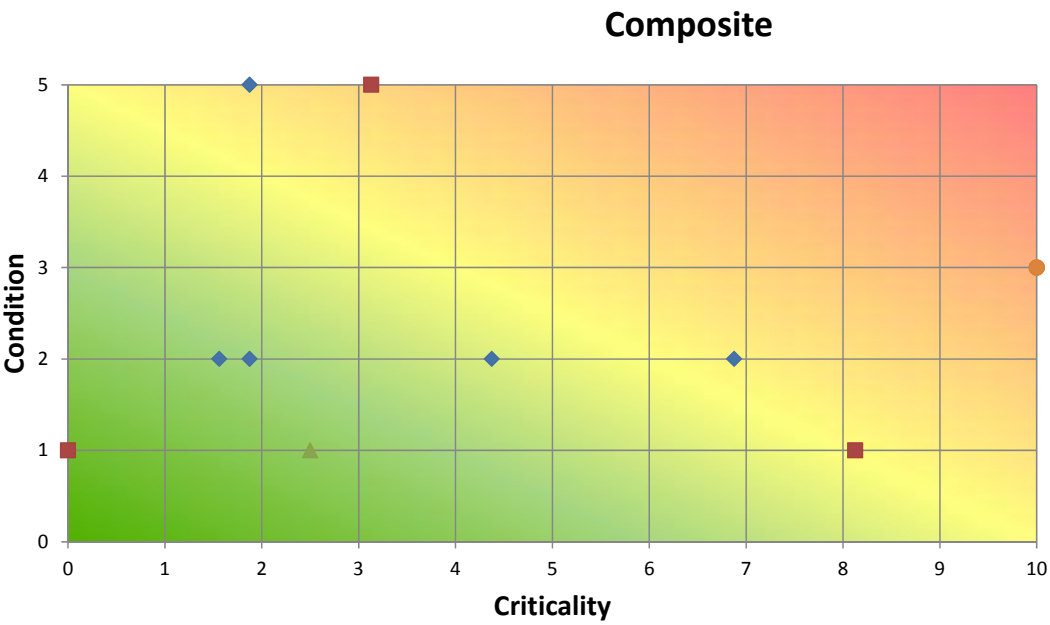

Chamber

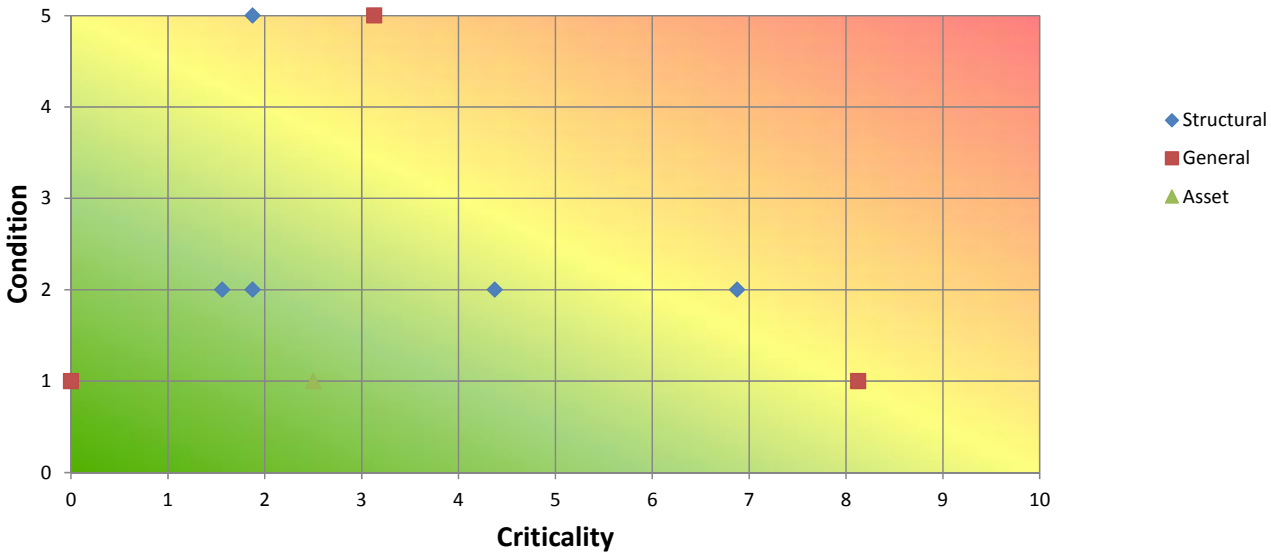

AirValves

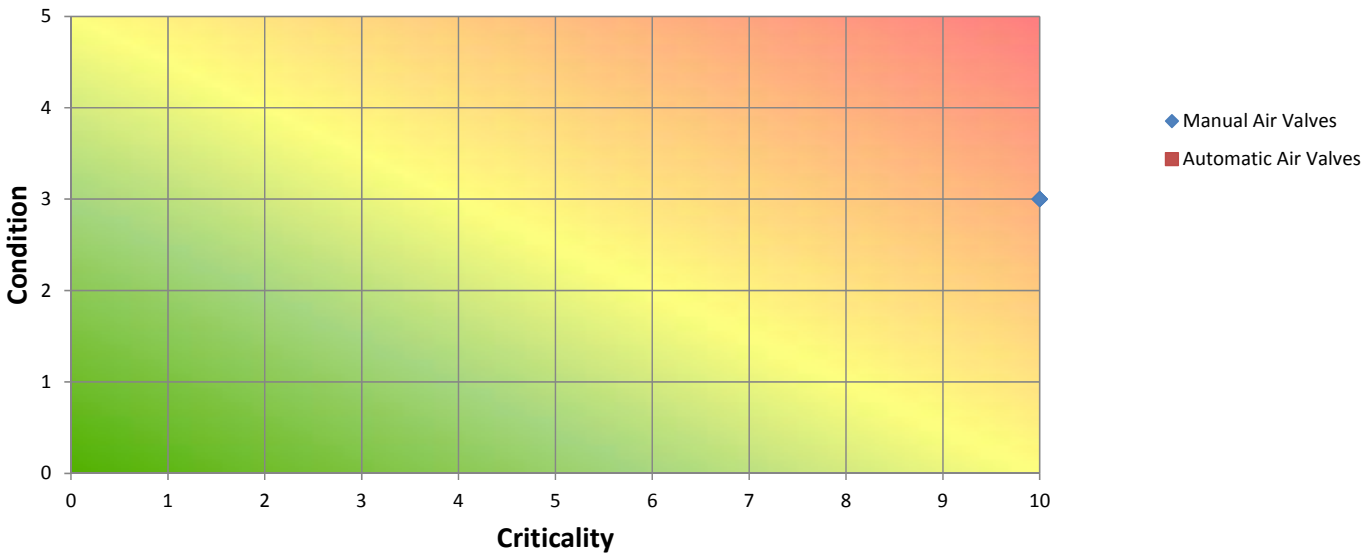

W-AV70000044

City of Winnipeg Asset Name		**Observations:**
Feedermain Name	Dakota Extension	
Address of Nearest Building		
Feedermain ID	FM021	
Easting Northing		
Type of chamber Access		**Actions:**
Depth of Chamber	525	replace or refinish valve components, mitigate infiltration
Primary FM Pipe Diameter	600	**General Comments:**
Smaller Diameter		
Branch Pipes		

Composite

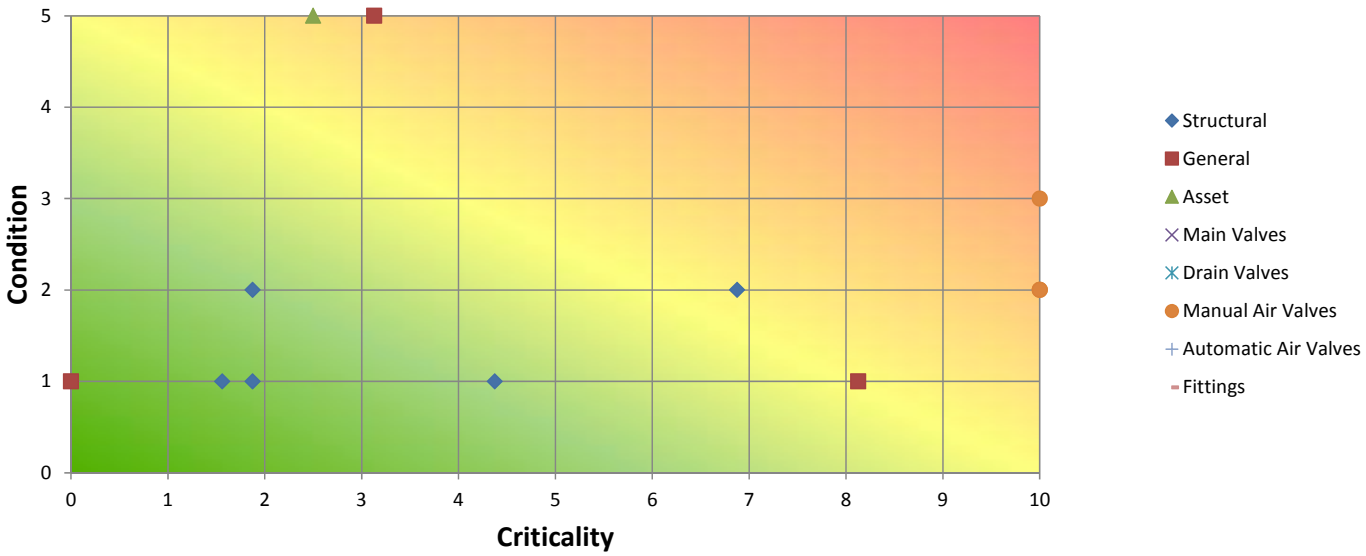

Chamber

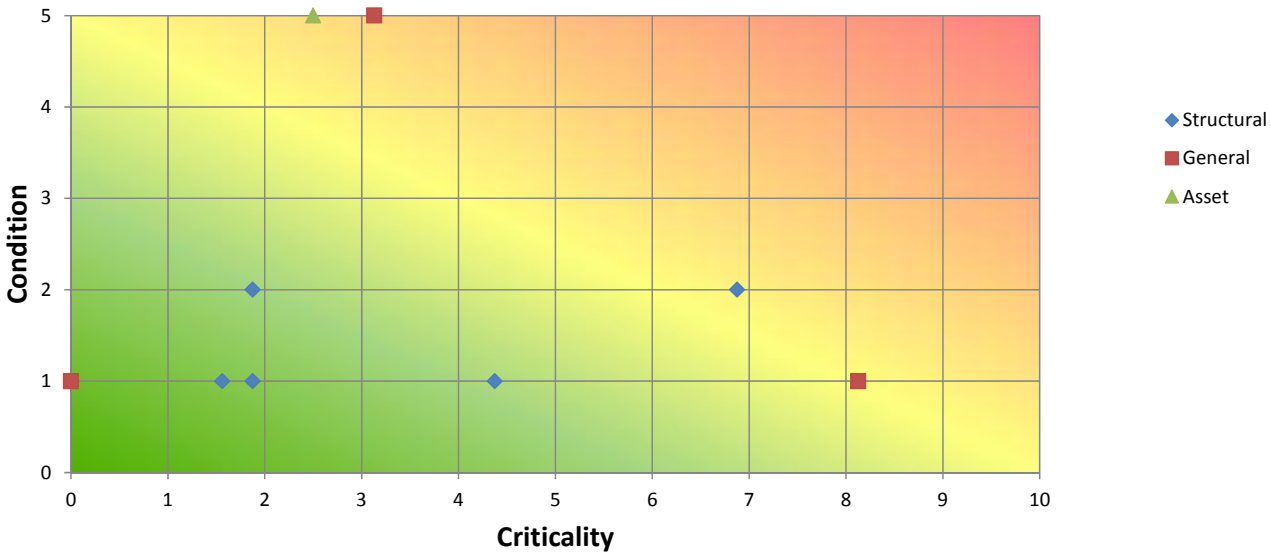

AirValves

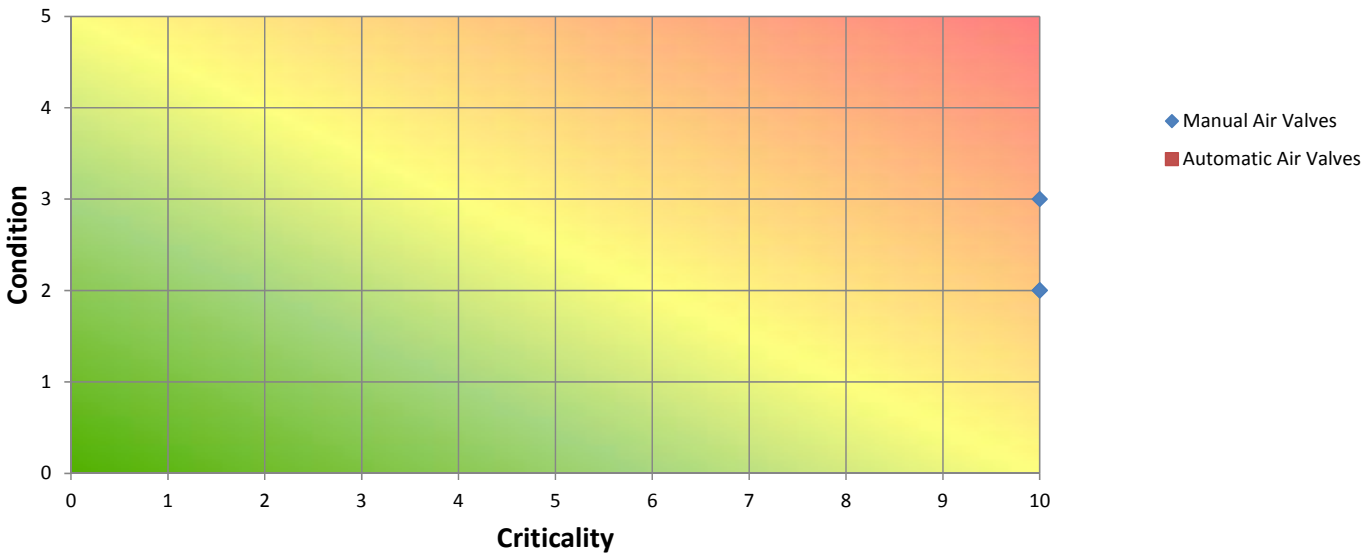

W-AV70000110

City of Winnipeg Asset Name		**Observations:**
Feedermain Name	Charleswood	
Address of Nearest Building		
Feedermain ID	FM005	
Easting Northing		
Type of chamber Access	frame offset from riser	**Actions:** none
Depth of Chamber	2390	
Primary FM Pipe Diameter	600	**General Comments:**
Smaller Diameter		
Branch Pipes		

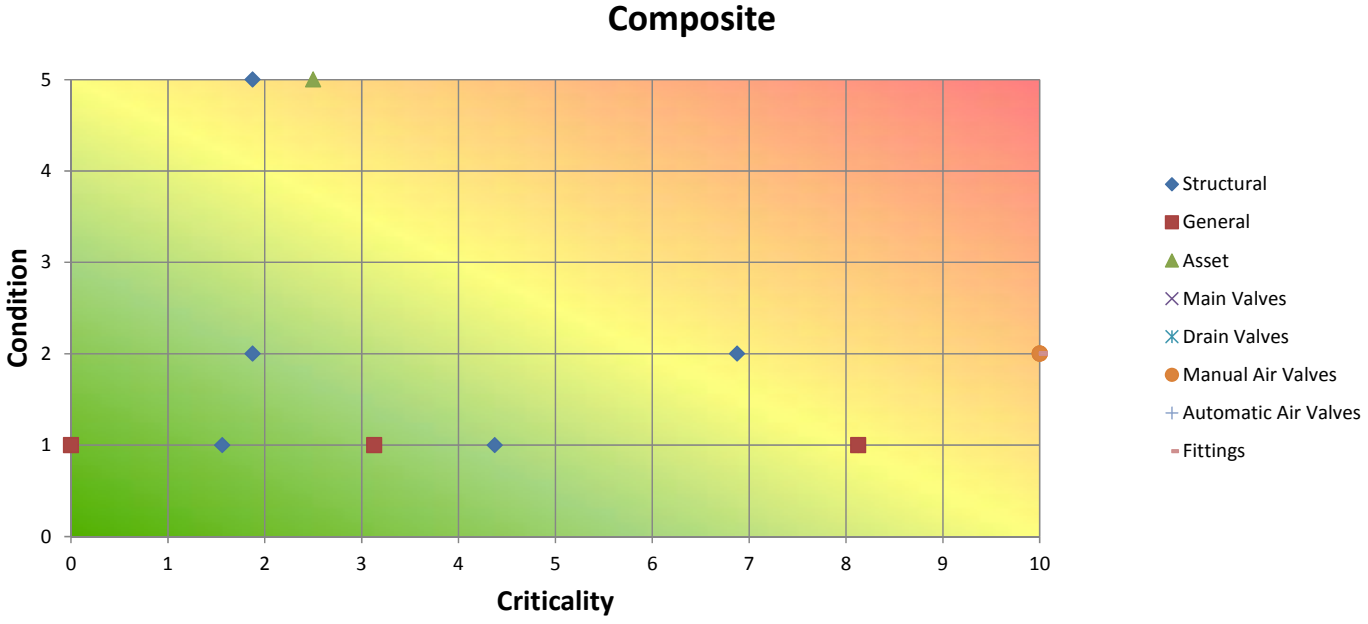

Chamber

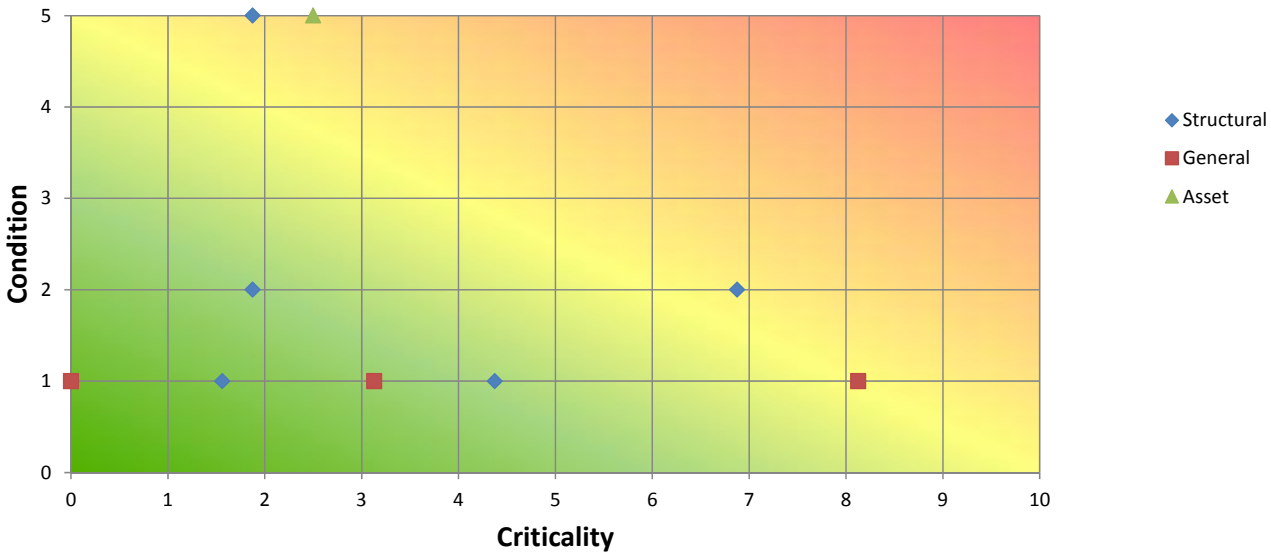

AirValves

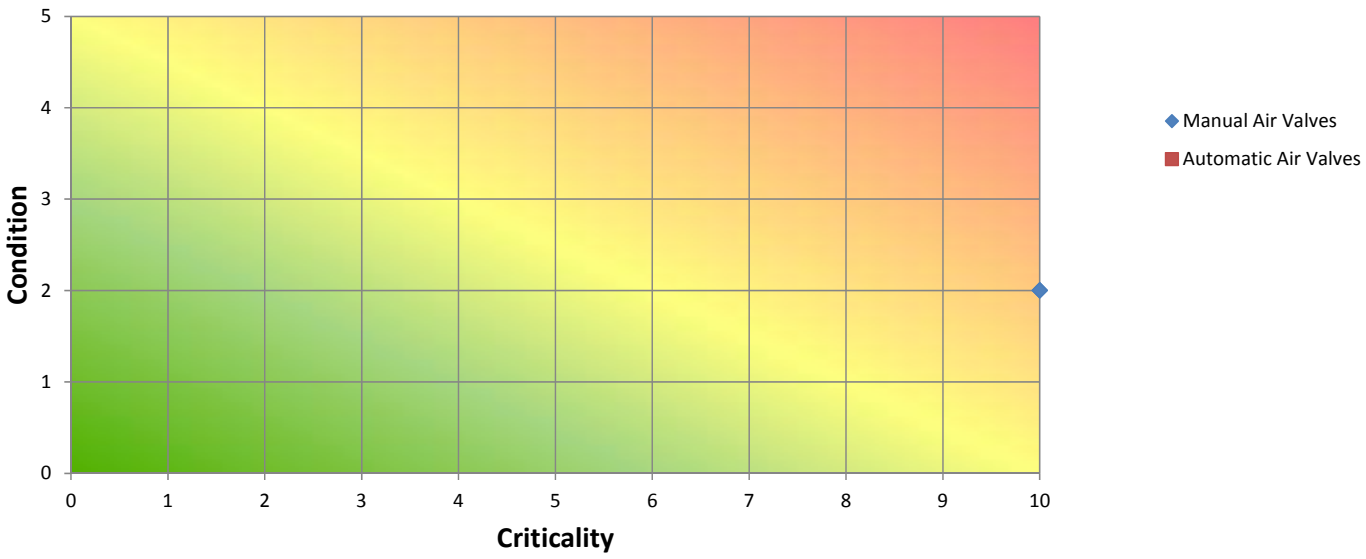

Fittings

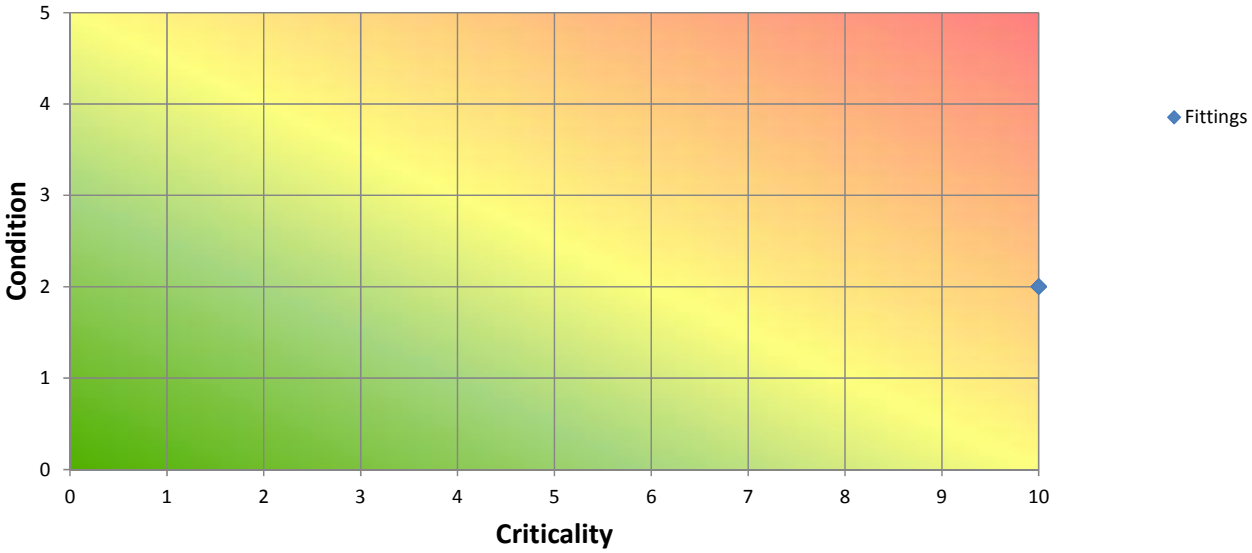

W-AV70000116

City of Winnipeg Asset Name		**Observations:**
Feedermain Name	South Transcona	
Address of Nearest Building		
Feedermain ID	FM019	
Easting Northing		
Type of chamber Access		**Actions:**
Depth of Chamber		none
Primary FM Pipe Diameter	750	**General Comments:**
Smaller Diameter		
Branch Pipes		

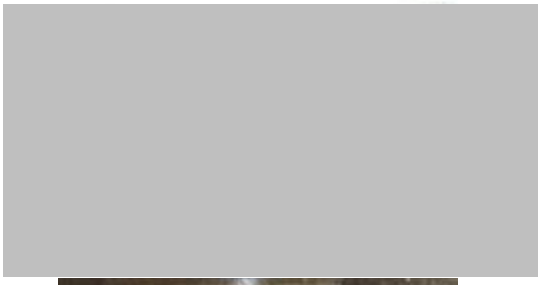

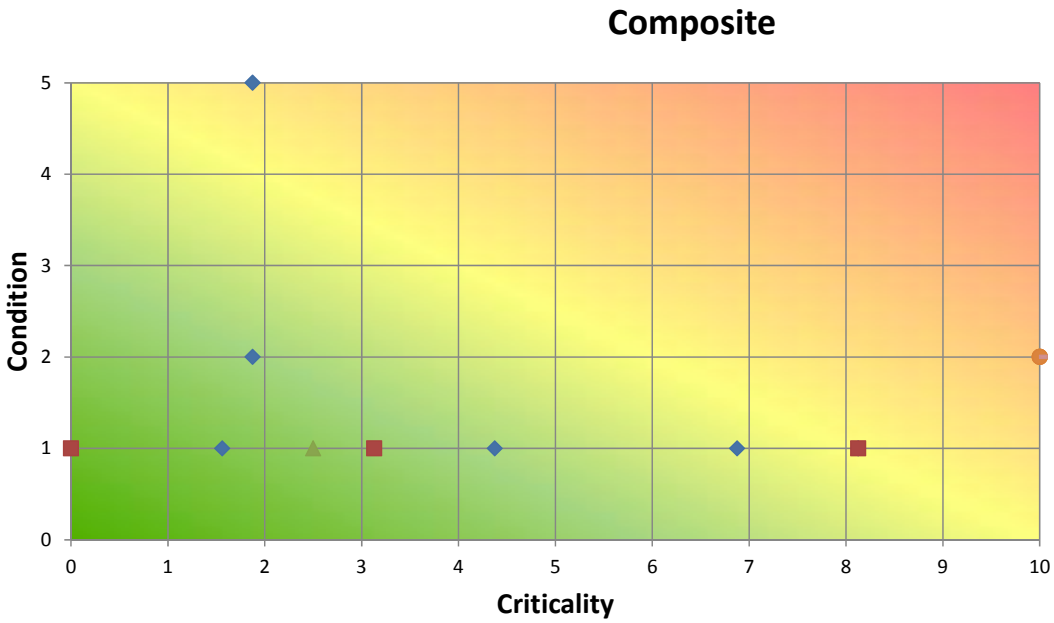

Chamber

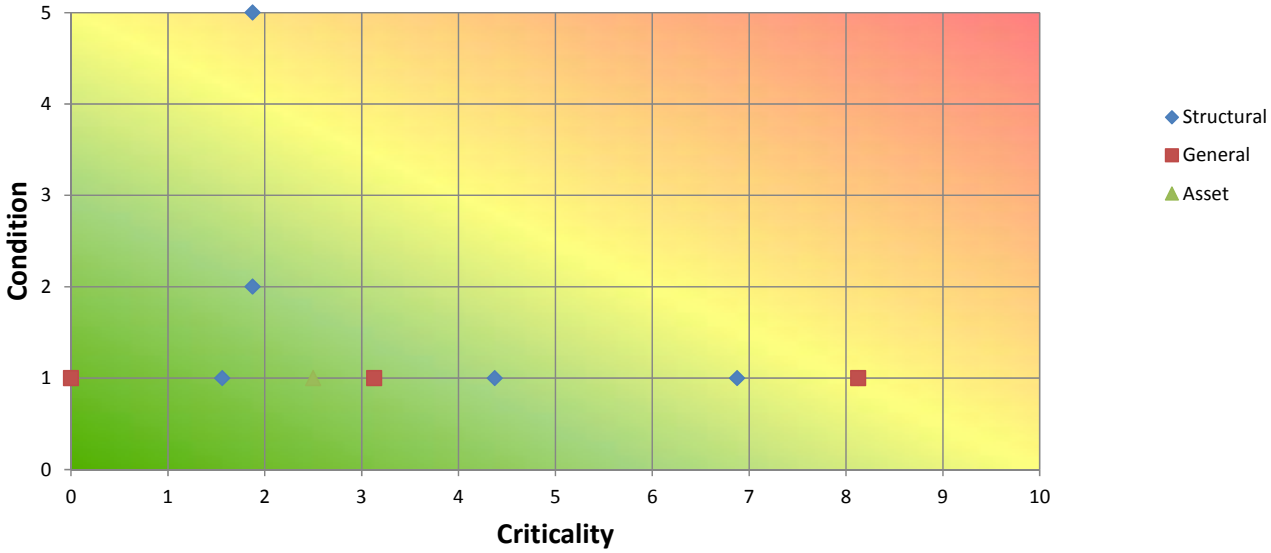

AirValves

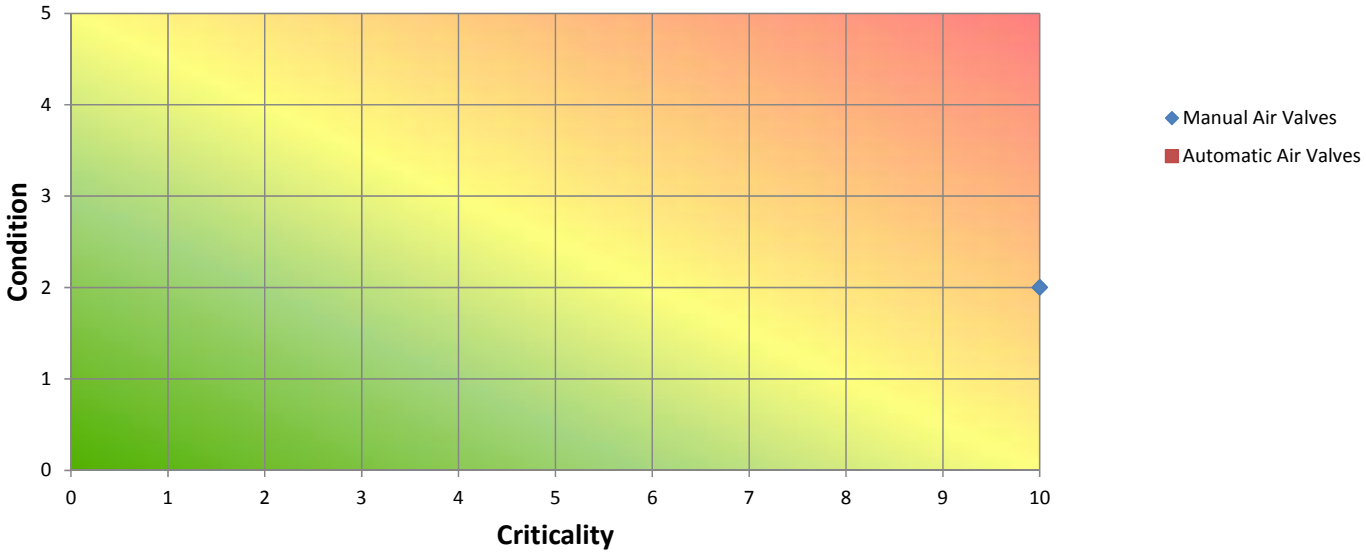

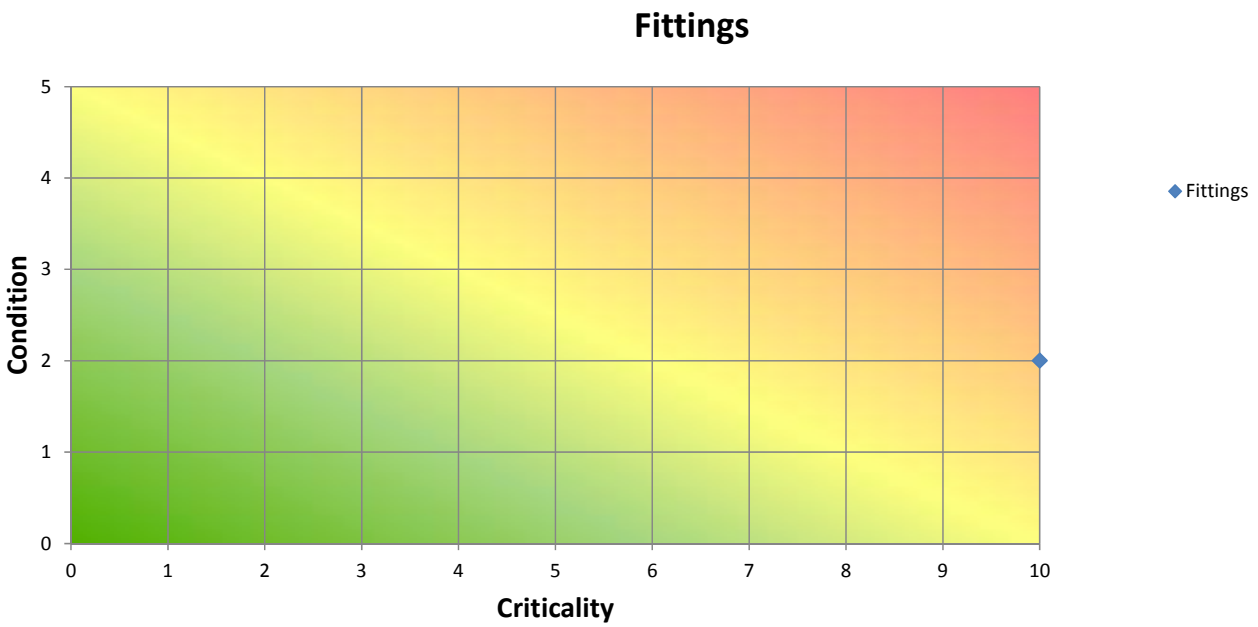
Fittings
Condition
Criticality
0
1
2
3
4
5
6
7
8
9
10
Fittings

W-AV70000293

City of Winnipeg **Asset Name**		**Observations:**
Feedermain **Name**	Charleswood	
Address of Nearest Building		
Feedermain ID	FM005	
Easting **Northing**		
Type of chamber Access		**Actions:**
Depth of Chamber	3590	none
Primary FM Pipe Diameter	600	**General Comments:**
Smaller Diameter		
Branch Pipes		

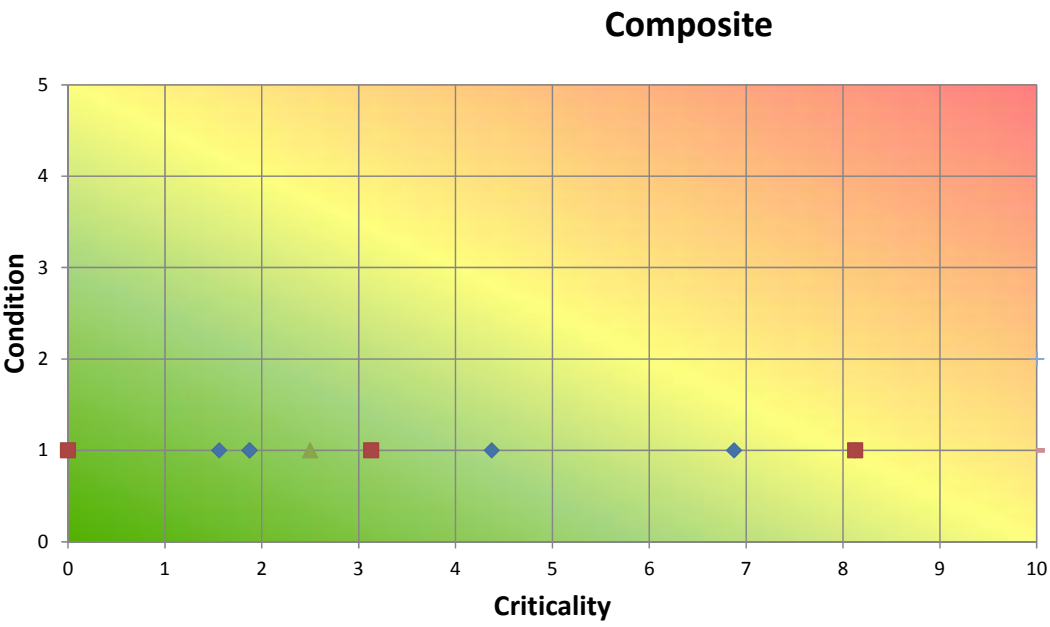

Chamber

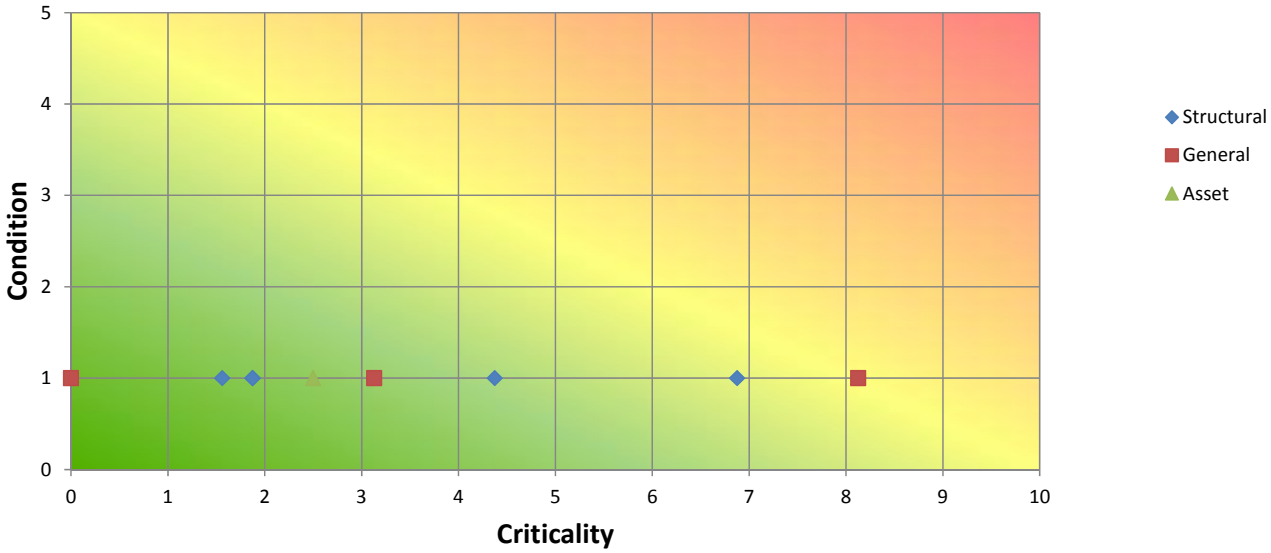

AirValves

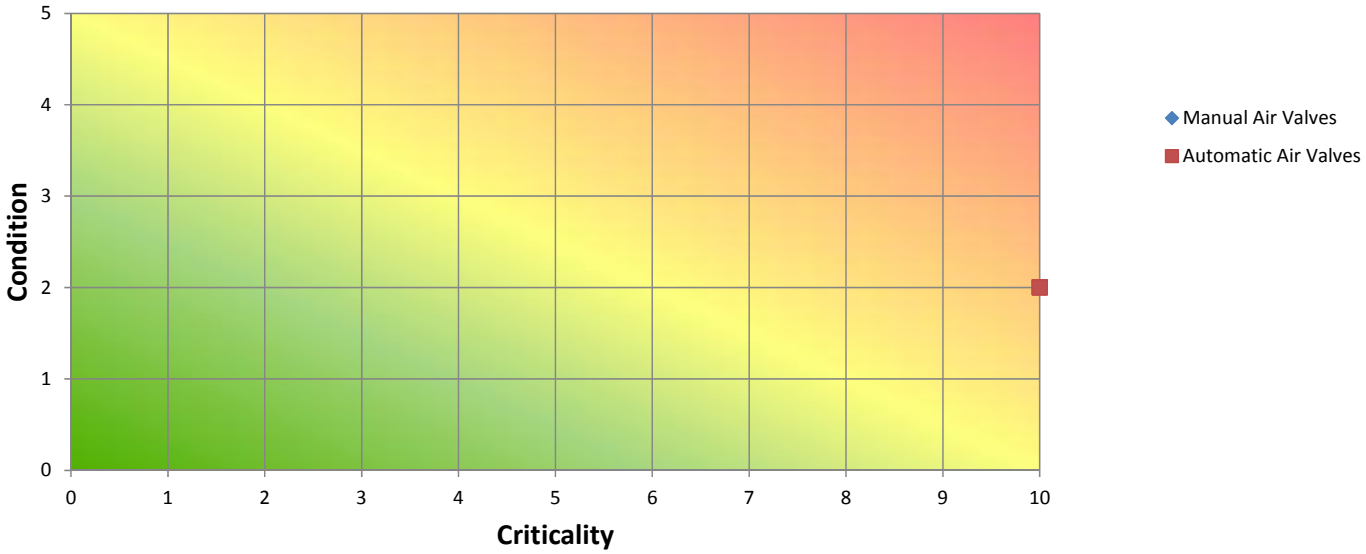

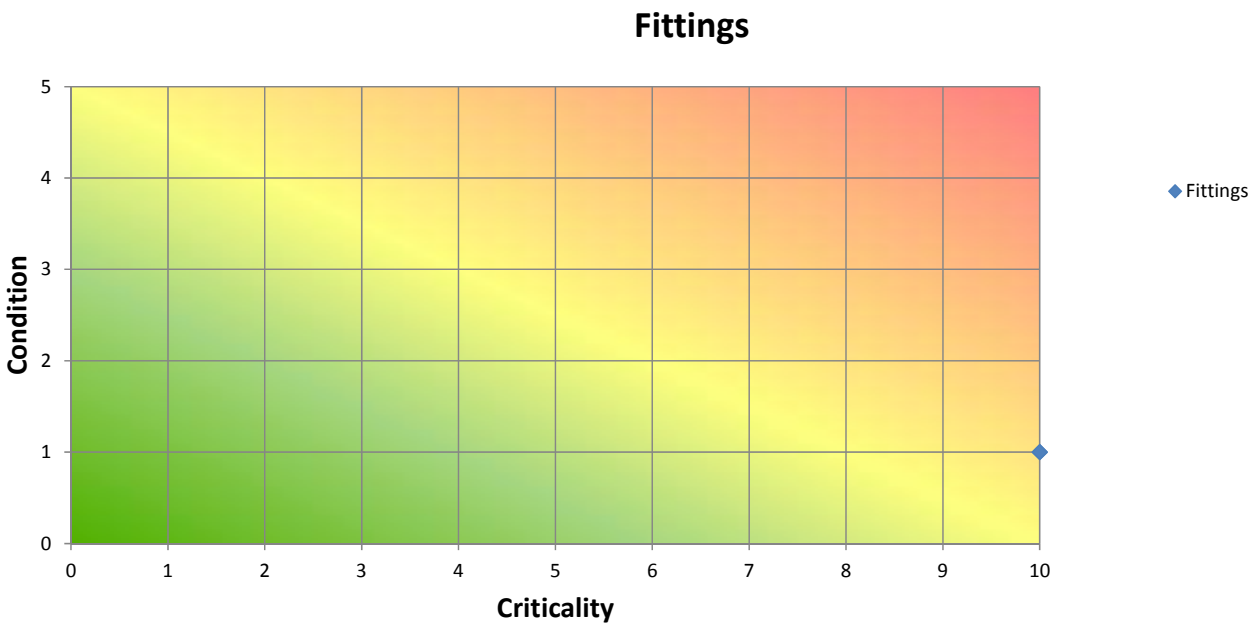
Fittings
Condition
Criticality
0
1
2
3
4
5
6
7
8
9
10
Fittings

W-AV70000312

City of Winnipeg Asset Name		**Observations:**
Feedermain Name	Wilkes	
Address of Nearest Building		
Feedermain ID	FM002	
Easting Northing		
Type of chamber Access		**Actions:**
Depth of Chamber	4350	mitigate infiltration
Primary FM Pipe Diameter	900	**General Comments:**
Smaller Diameter		
Branch Pipes		

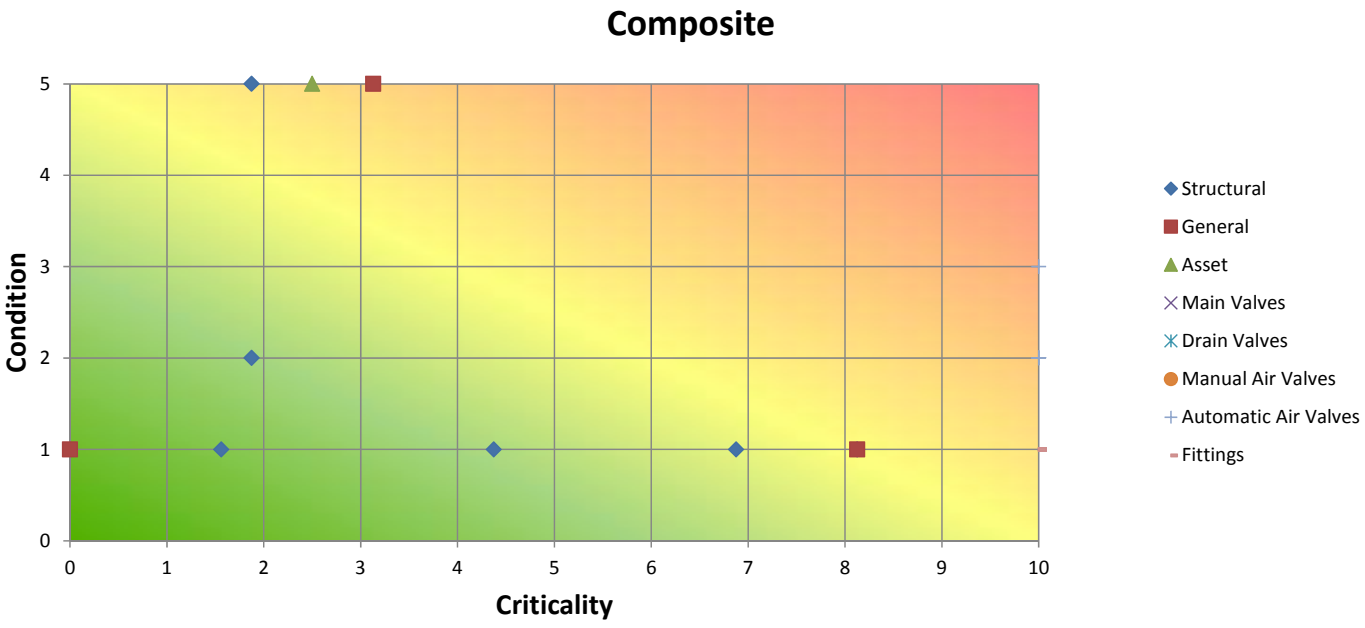

Chamber

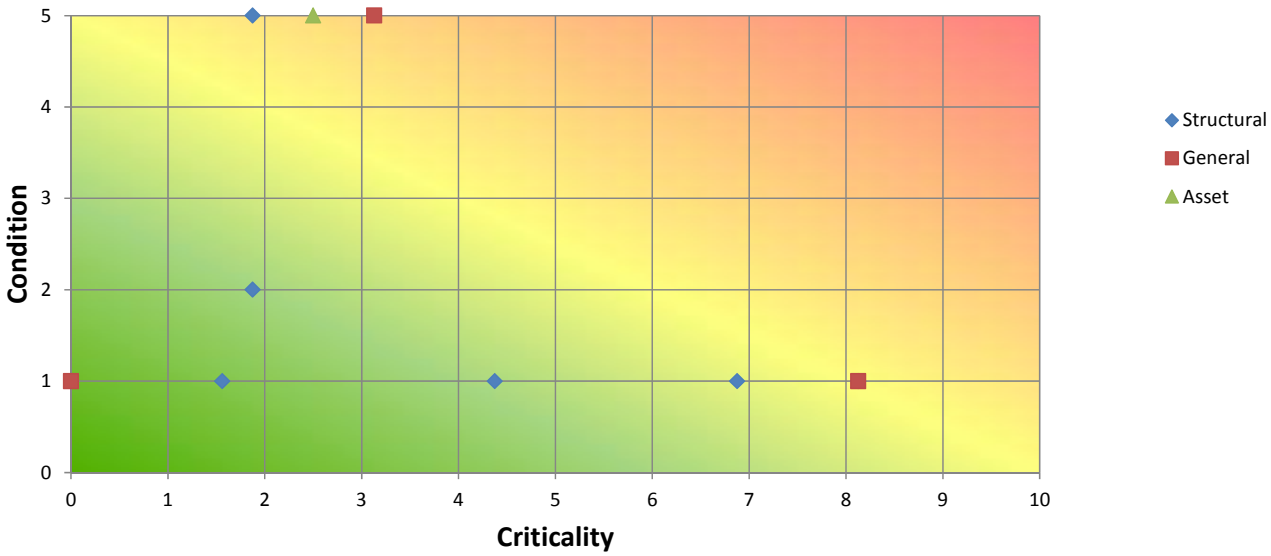

AirValves

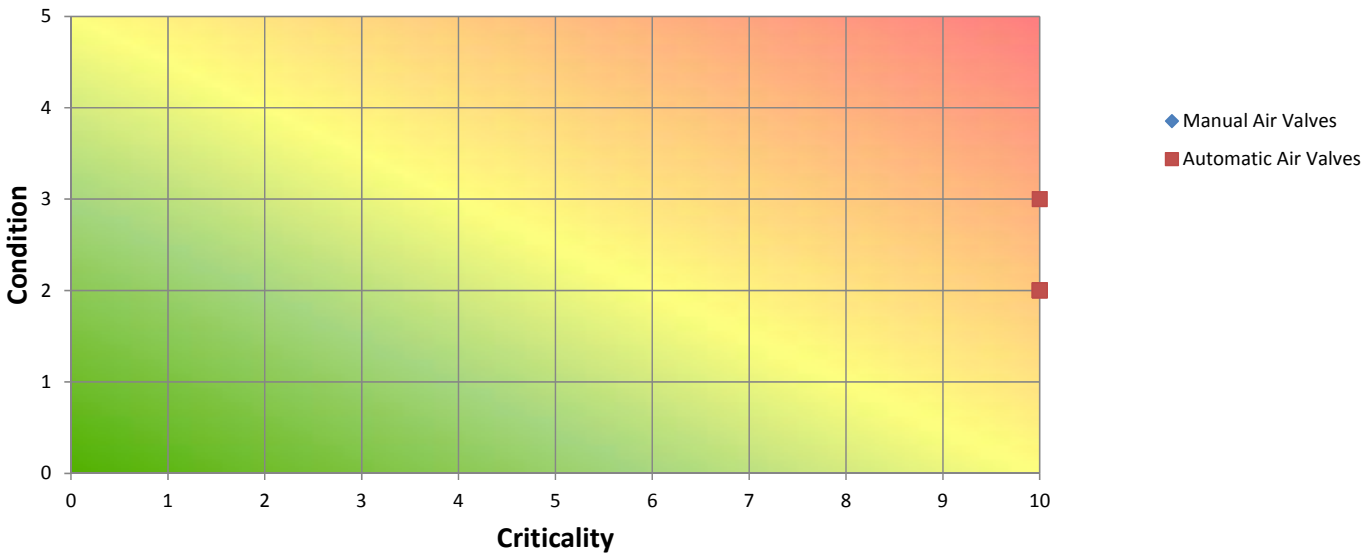

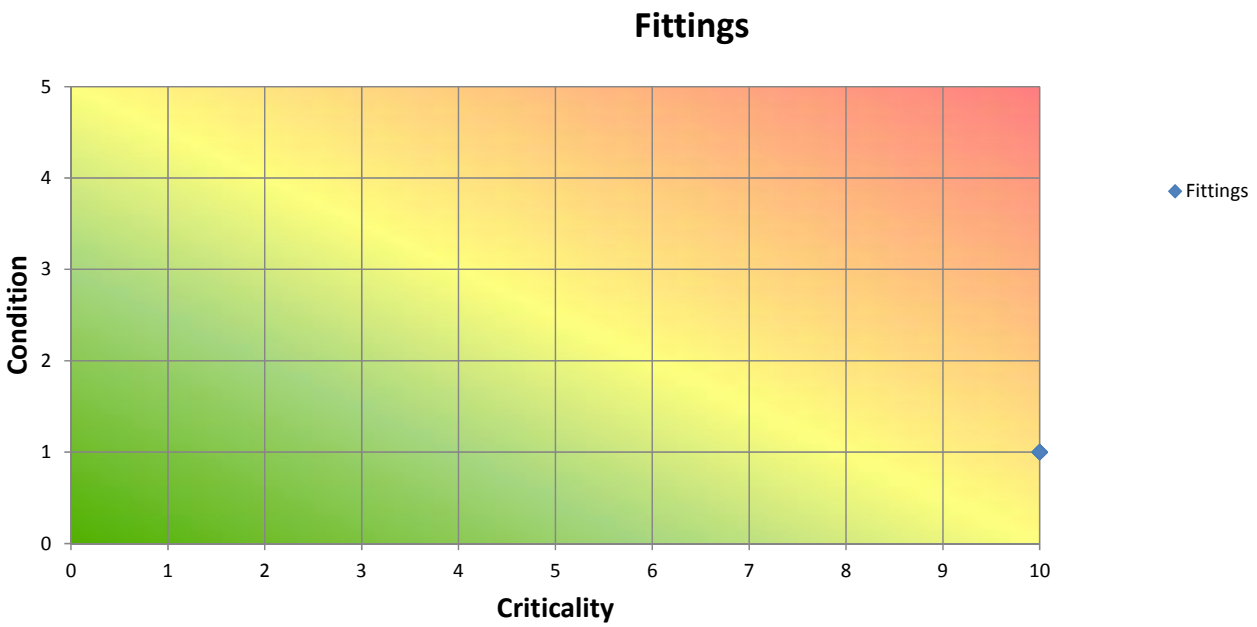
Fittings
Condition
Criticality
0
1
2
3
4
5
6
7
8
9
10
Fittings

W-VP00000103

City of Winnipeg Asset Name		**Observations:**
Feedermain Name	Spears Road	
Address of Nearest Building		
Feedermain ID	FM018	
Easting Northing		
Type of chamber Access		**Actions:** replace or refinish valve components, refinish or replace fittings and fasteners, repair concrete structure, mitigate infiltration
Depth of Chamber		
Primary FM Pipe Diameter	750	**General Comments:**
Smaller Diameter	400	
Branch Pipes	750 North	

Composite

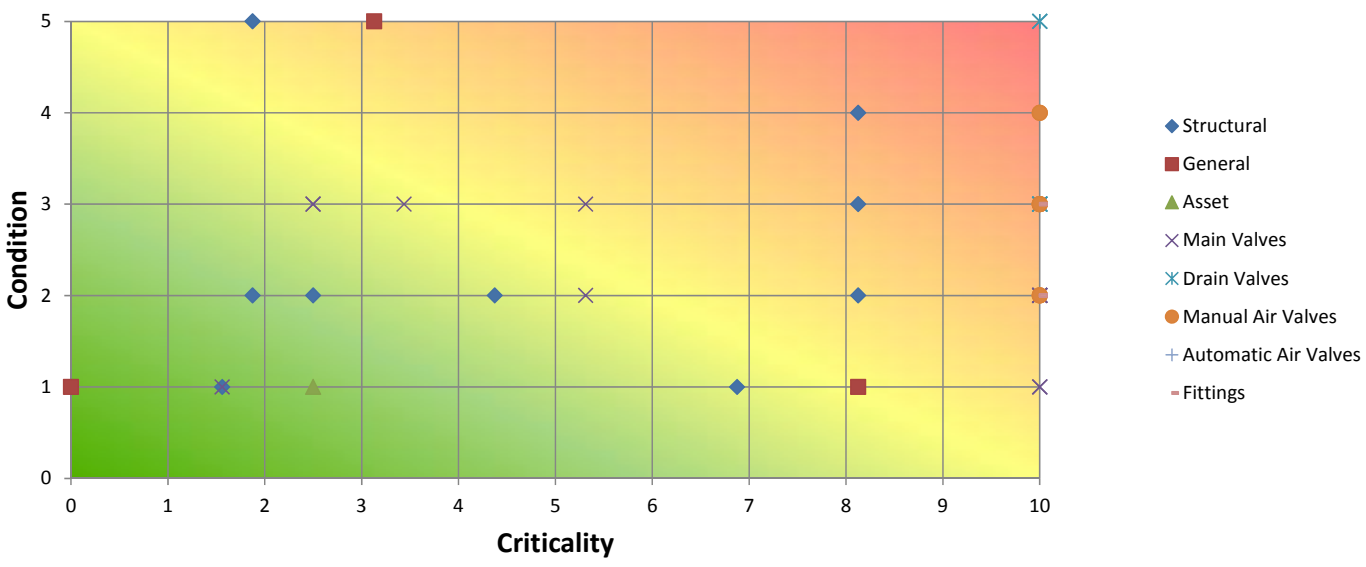

Chamber

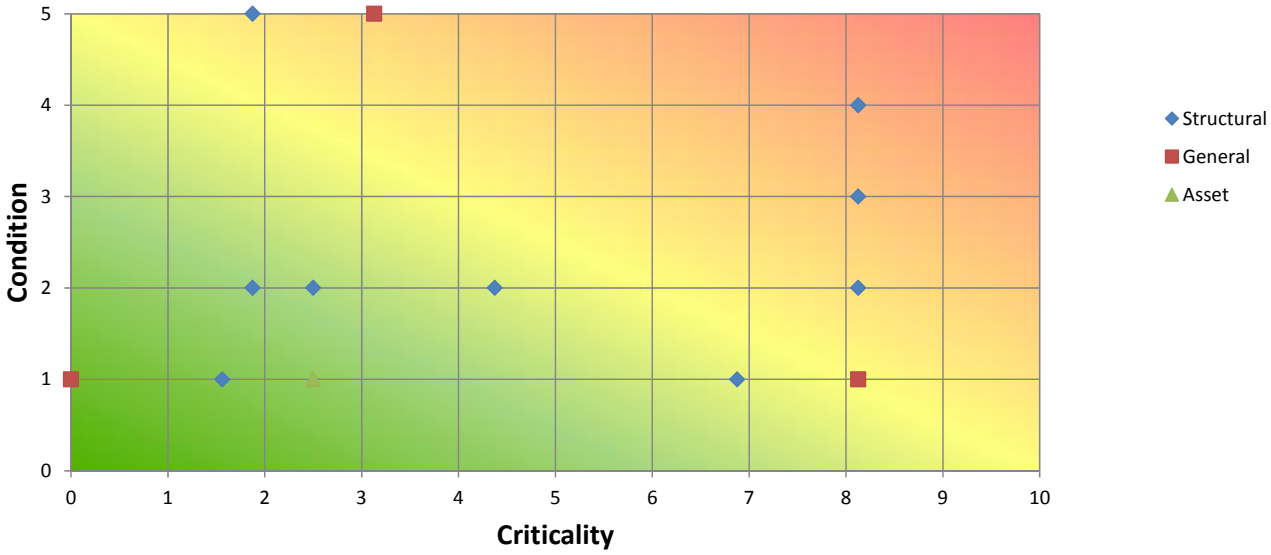

Valves

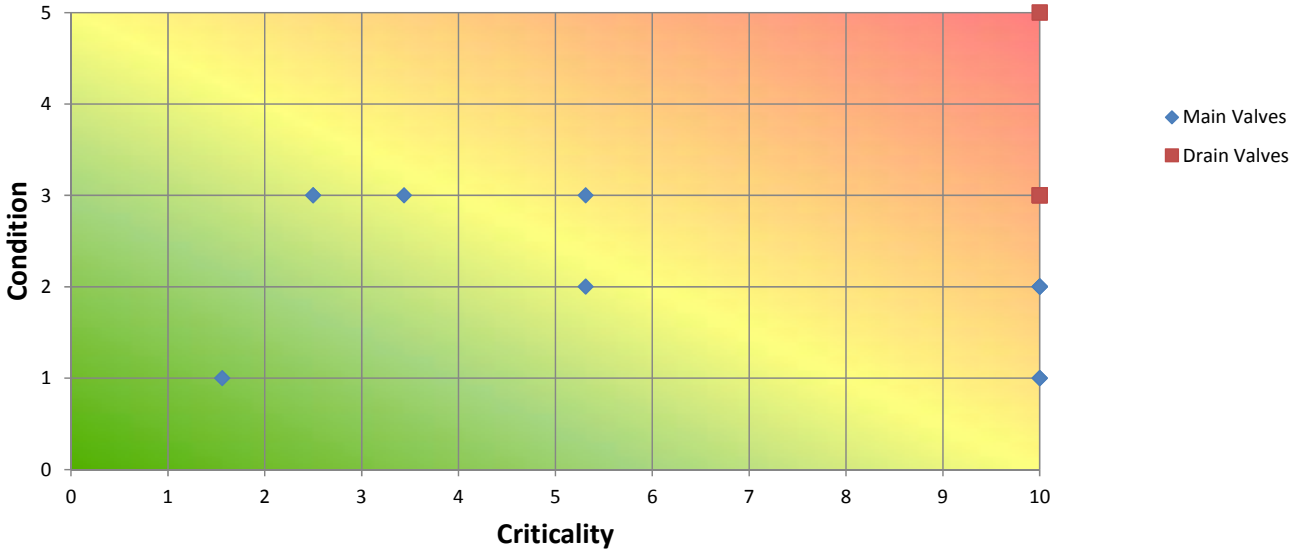

AirValves

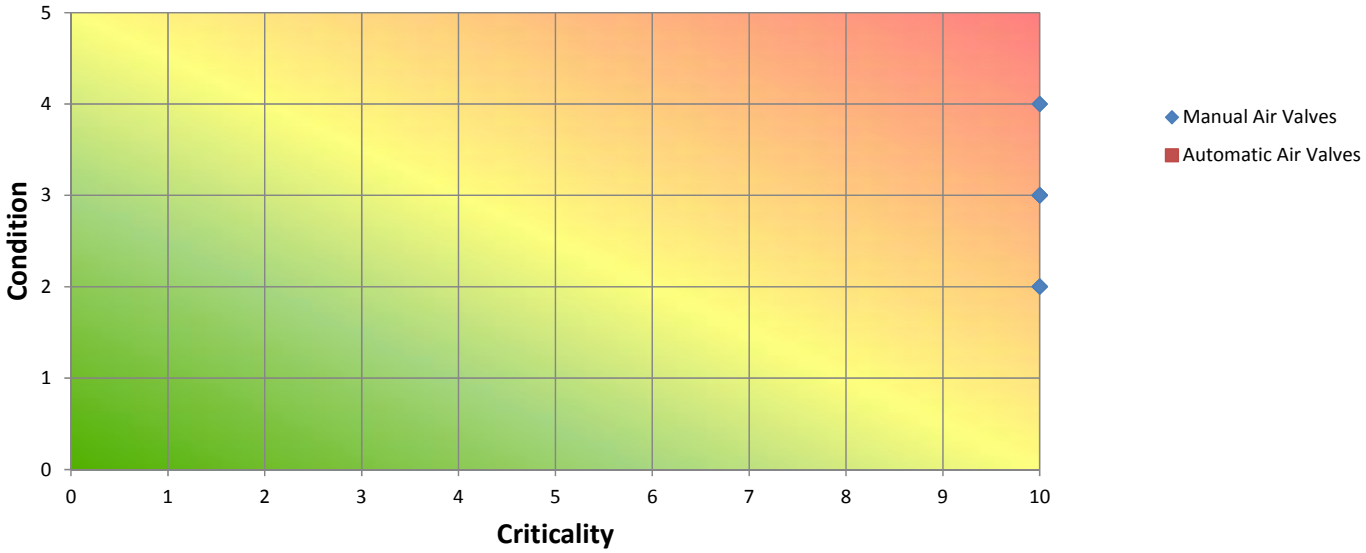

Fittings

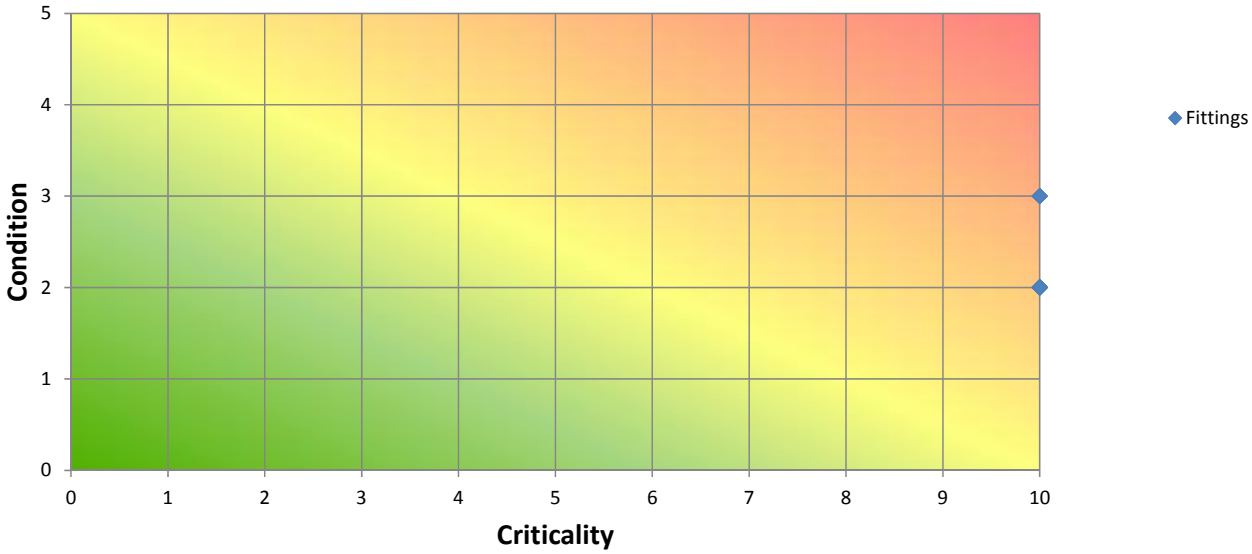

W-VP00000115

City of Winnipeg Asset Name		**Observations:**
Feedermain Name	Birds Hill	
Address of Nearest Building		
Feedermain ID	FM017	
Easting Northing		
Type of chamber Access	Rim Is Cracked and Needs To Be Replaced	**Actions:** replace manhole rim, repair access, mitigate infiltration, refinish or replace valve components
Depth of Chamber		
Primary FM Pipe Diameter	900	**General Comments:**
Smaller Diameter		
Branch Pipes		

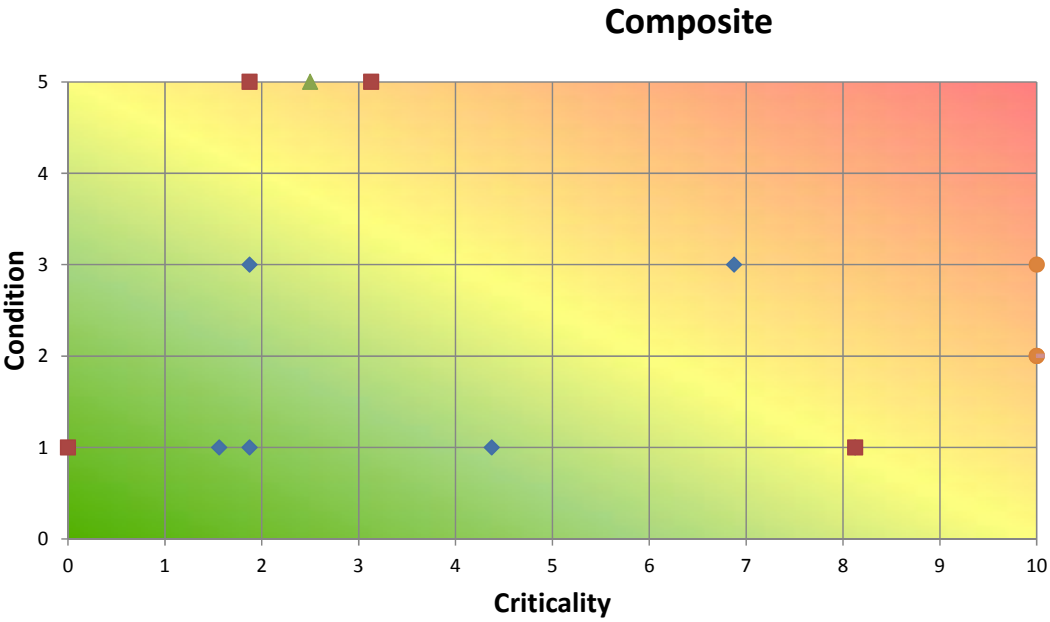

Chamber

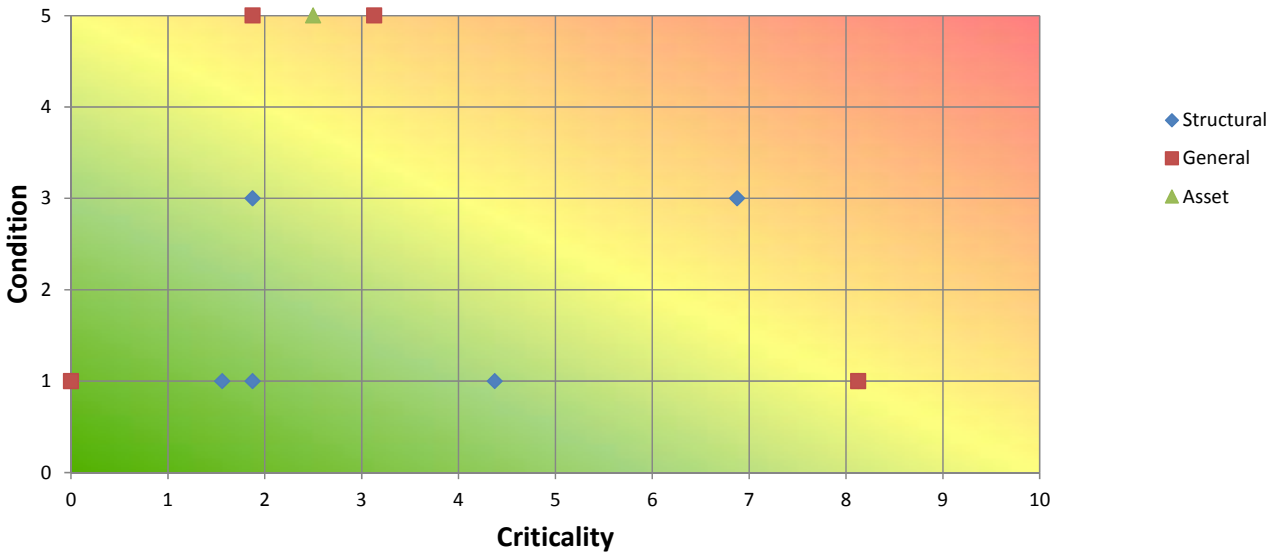

AirValves

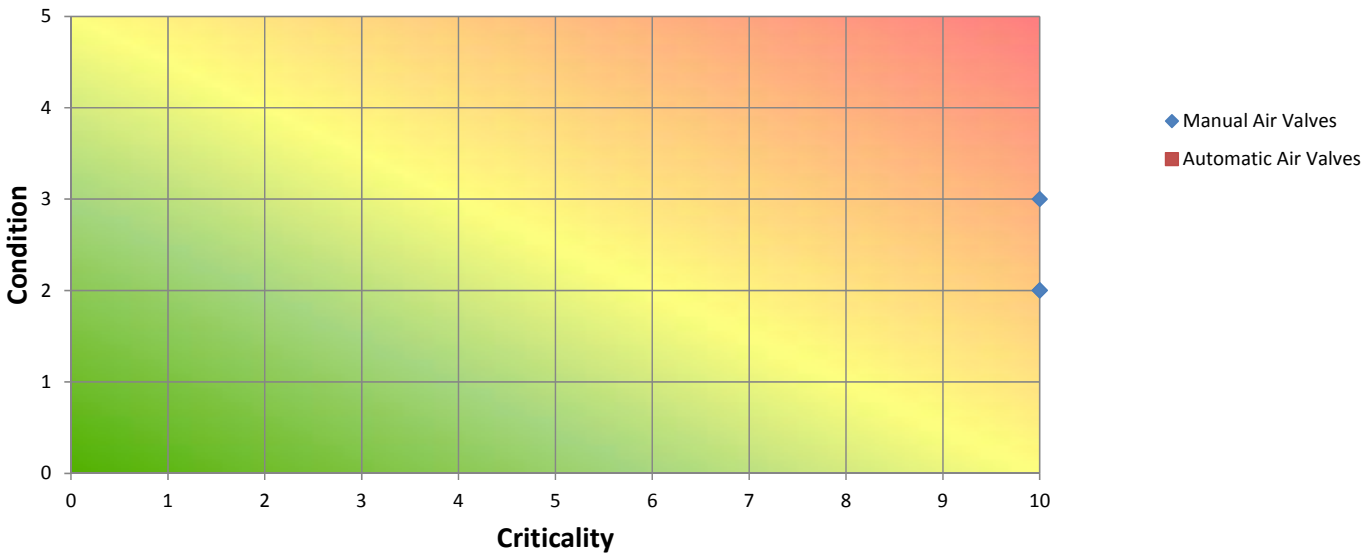

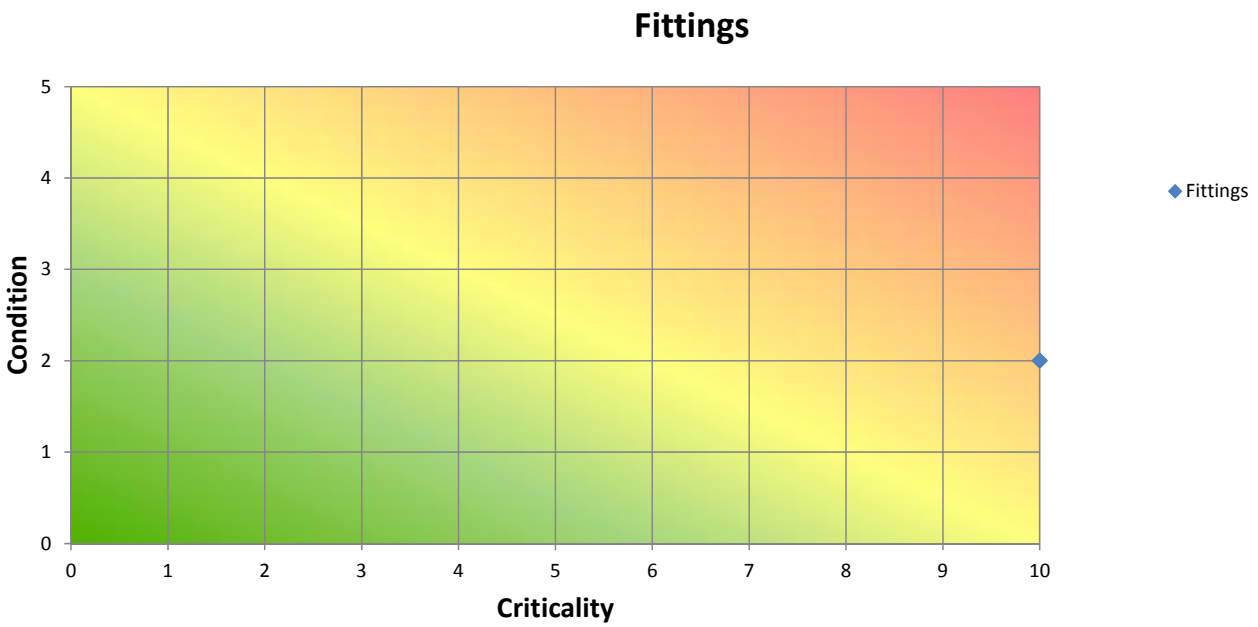
Fittings
Condition
Criticality
0
1
2
3
4
5
6
7
8
9
10
Fittings

W-VP00000125

City of Winnipeg Asset Name		**Observations:**
Feedermain Name	Spears Road	
Address of Nearest Building		
Feedermain ID	FM018	
Easting		
Northing		
Type of chamber Access		**Actions:** replace or refinish valve components, refinish or replace fittings and fasteners, refinish steel, repair access, mitigate infiltration
Depth of Chamber		
Primary FM Pipe Diameter	750	**General Comments:**
Smaller Diameter		
Branch Pipes	600 - West	

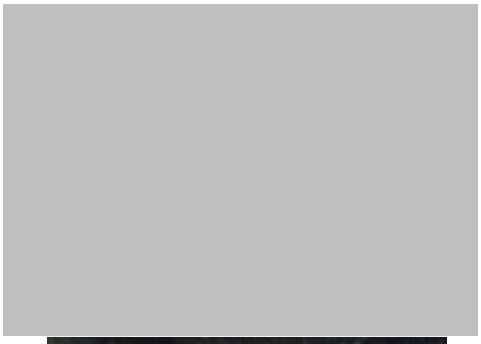

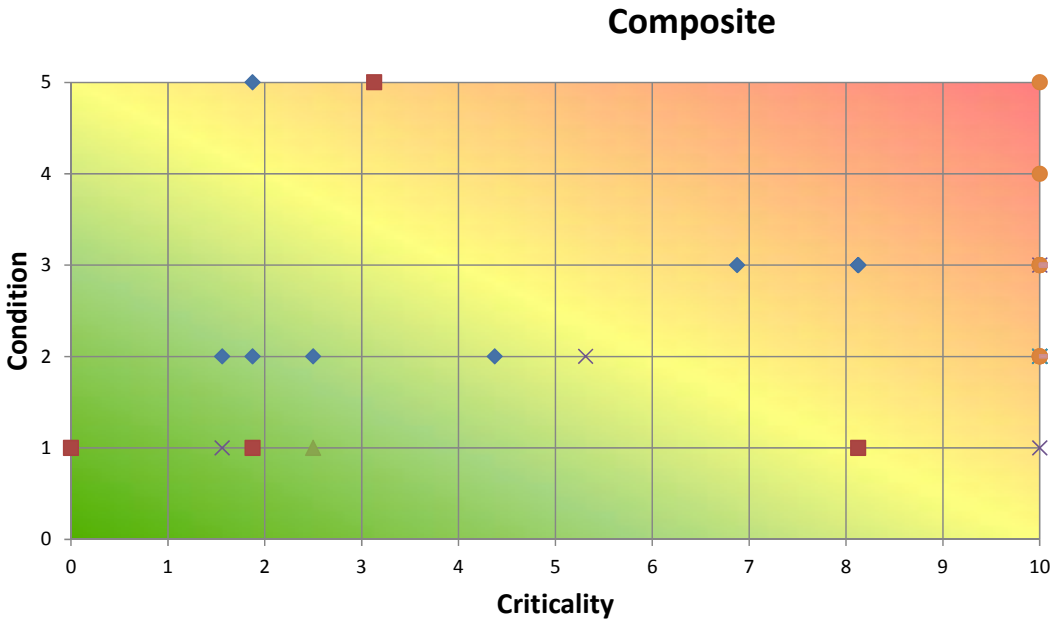

Chamber

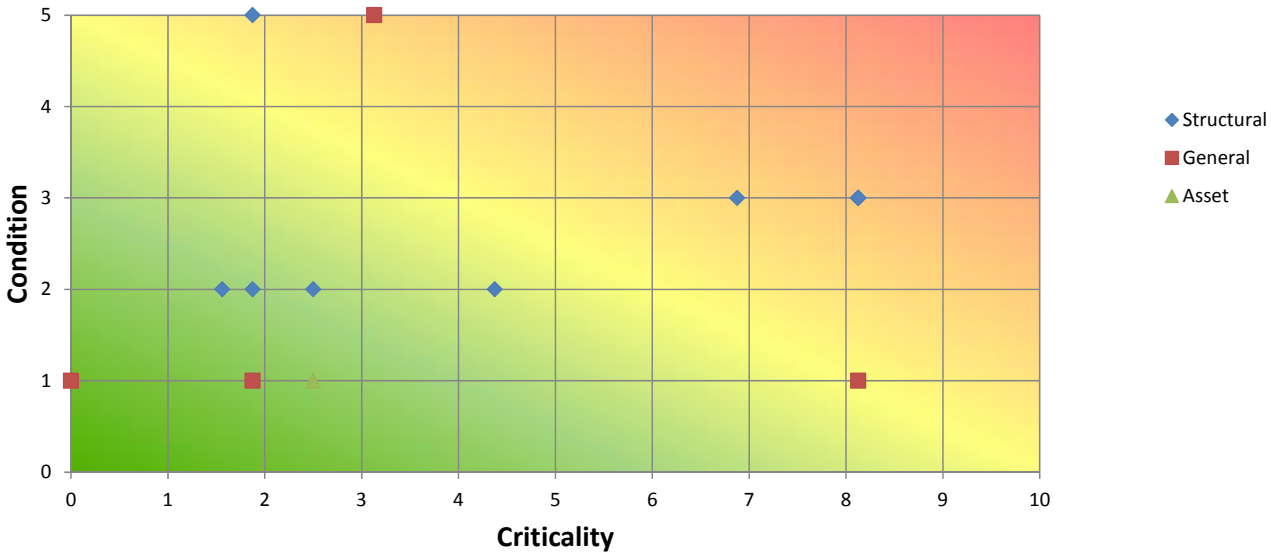

Valves

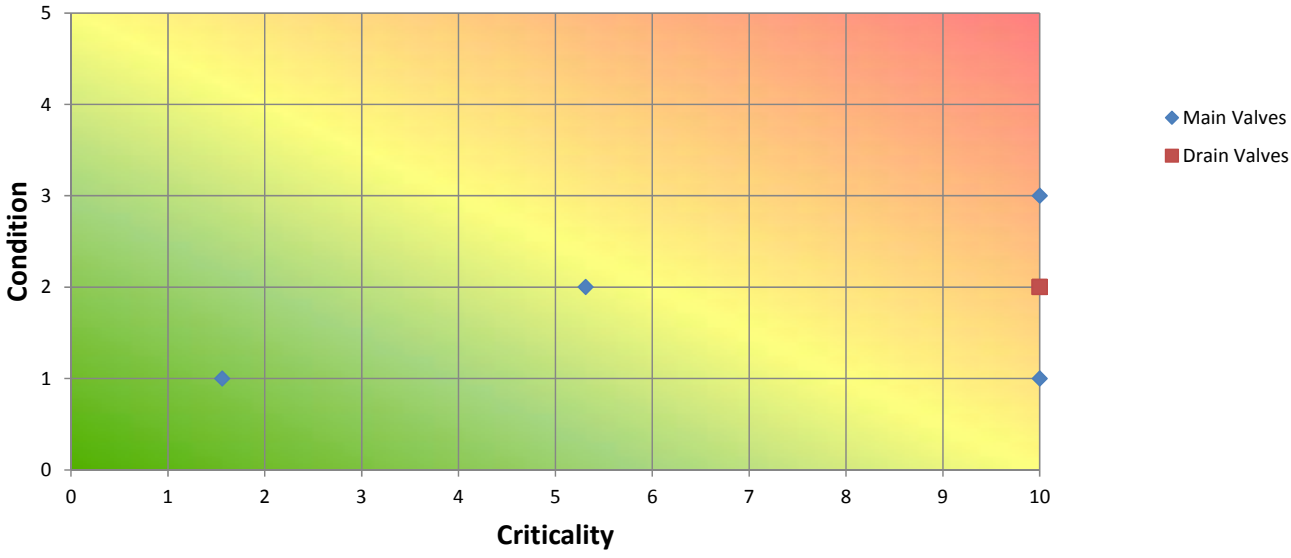

AirValves

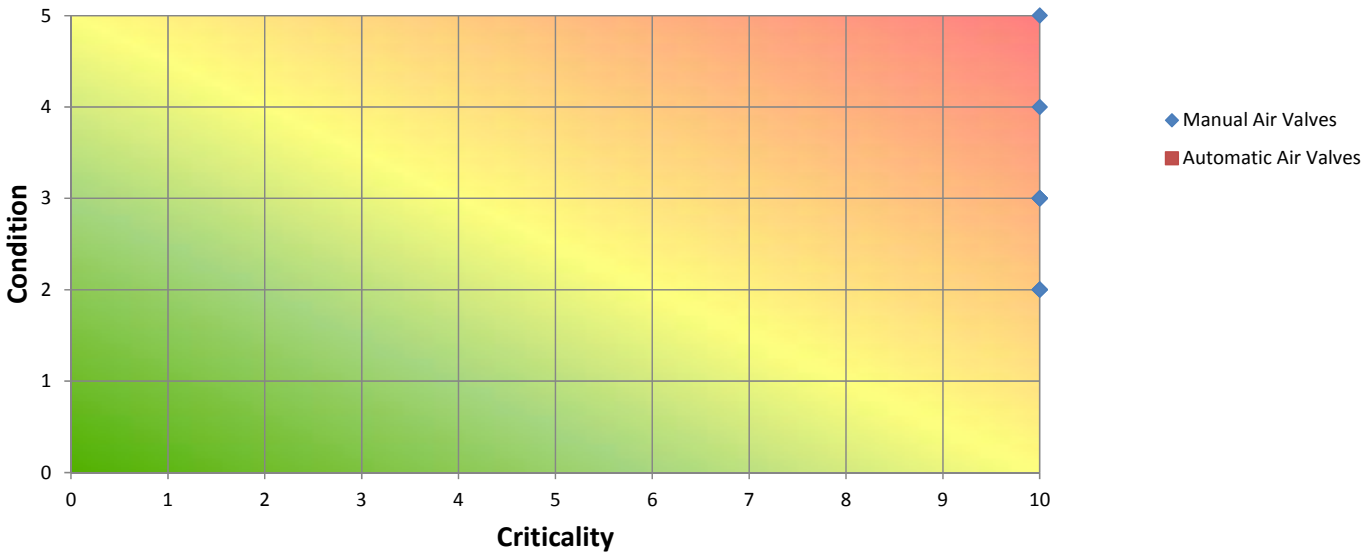

Fittings

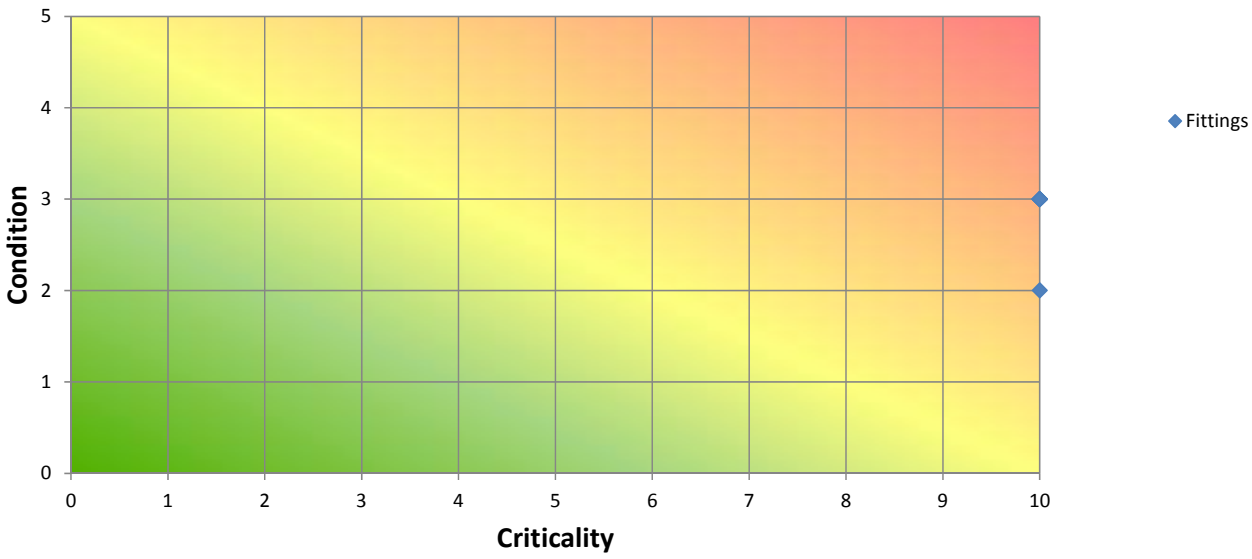

W-VP00000131

City of Winnipeg Asset Name	[redacted]	**Observations:** [redacted]
Feedermain Name	North Transcona	
Address of Nearest Building	[redacted]	
Feedermain ID	FM028	
Easting Northing	[redacted]	
Type of chamber Access		**Actions:** replace or refinish valve components, refinish or replace fittings and fasteners, repair access, repair concrete structure, mitigate infiltration, adjust or repair valve box
Depth of Chamber	2600	
Primary FM Pipe Diameter	600	**General Comments:**
Smaller Diameter		
Branch Pipes		

[redacted]

[redacted]

Composite

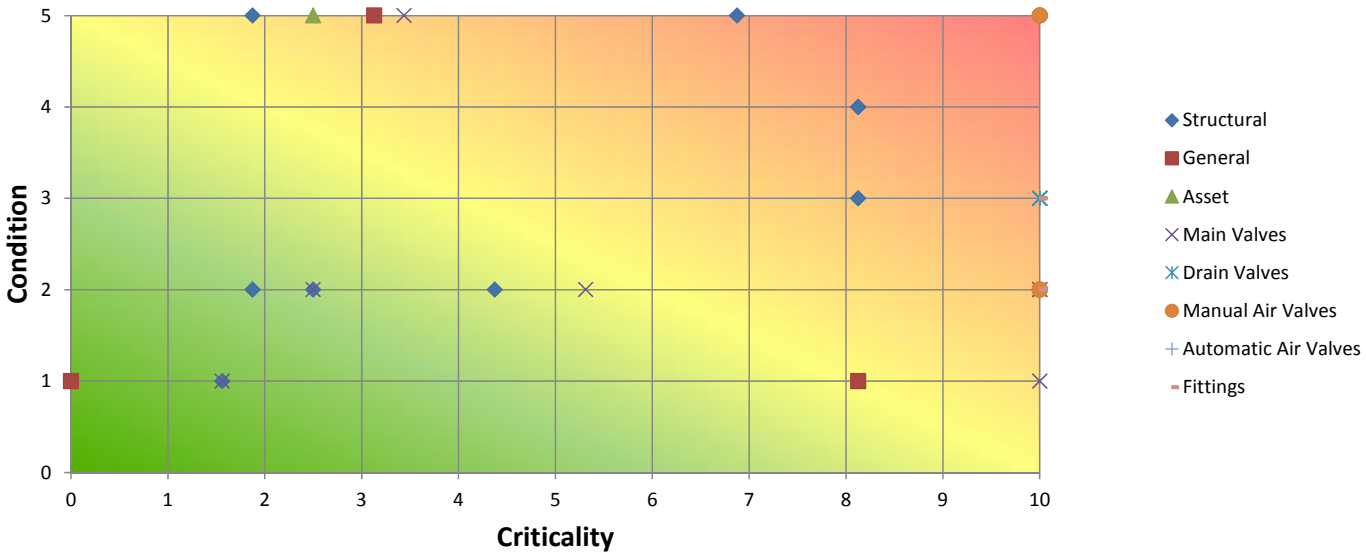

Chamber

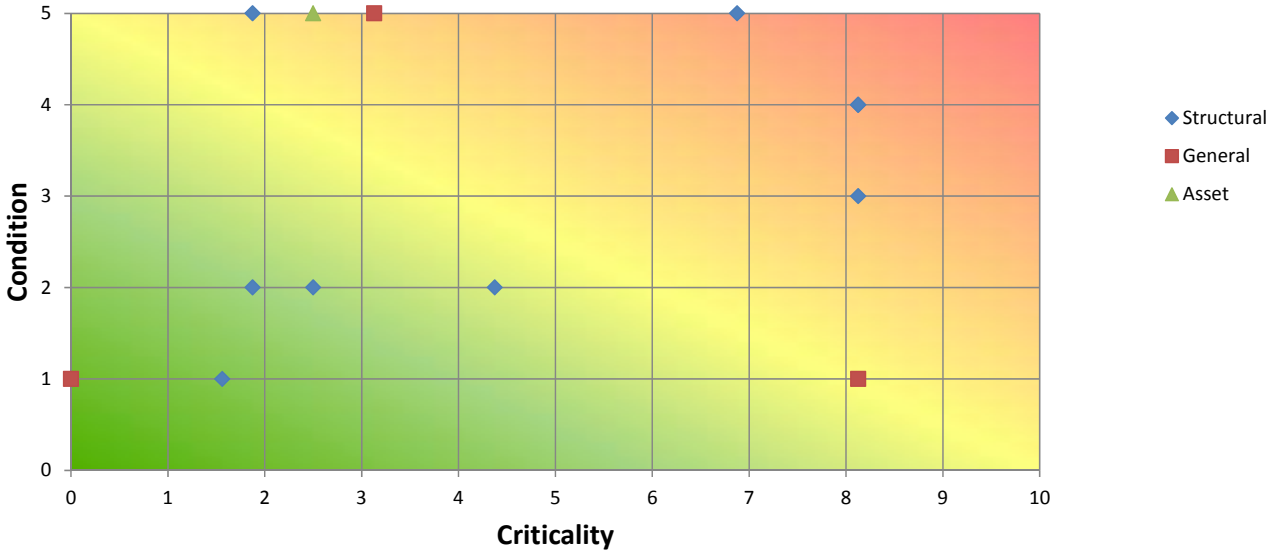

Valves

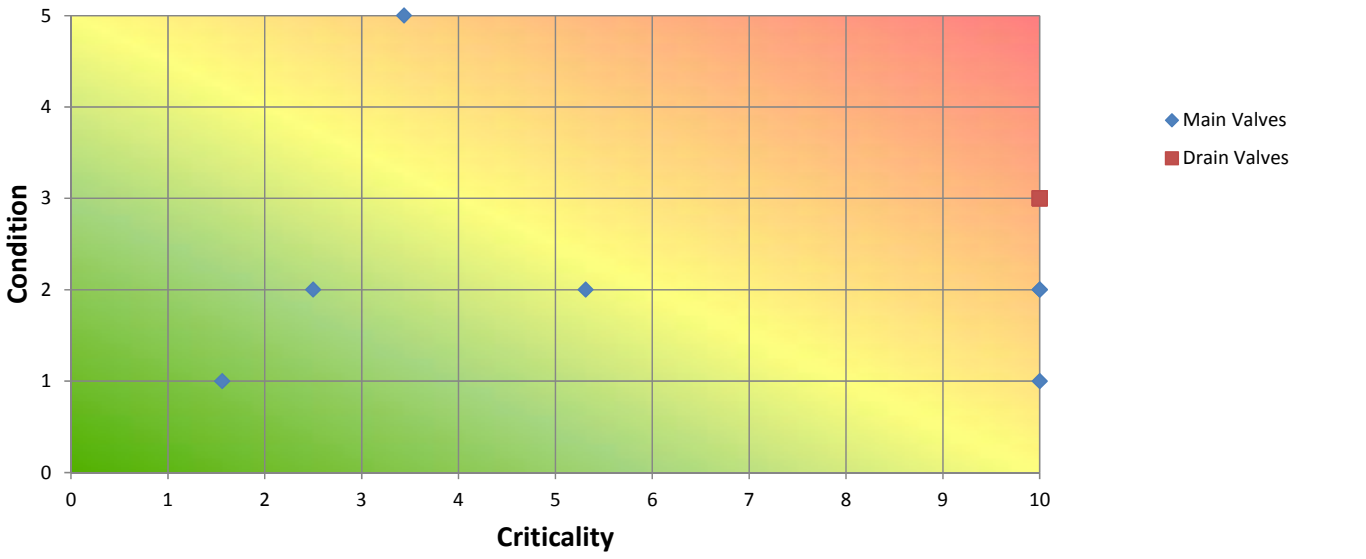

AirValves

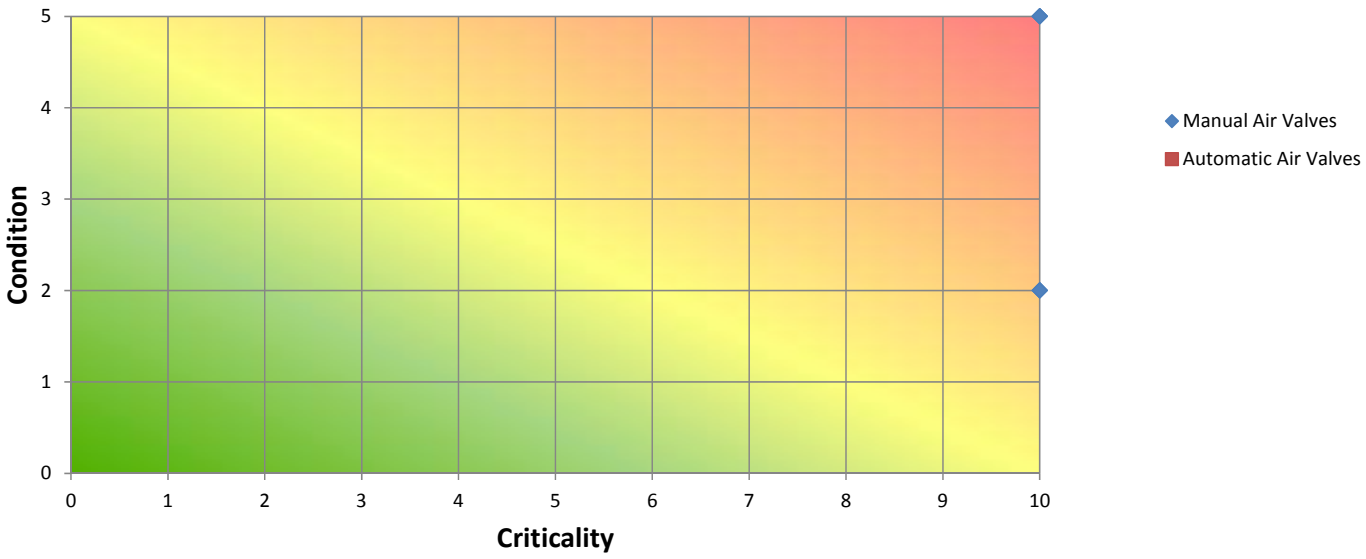

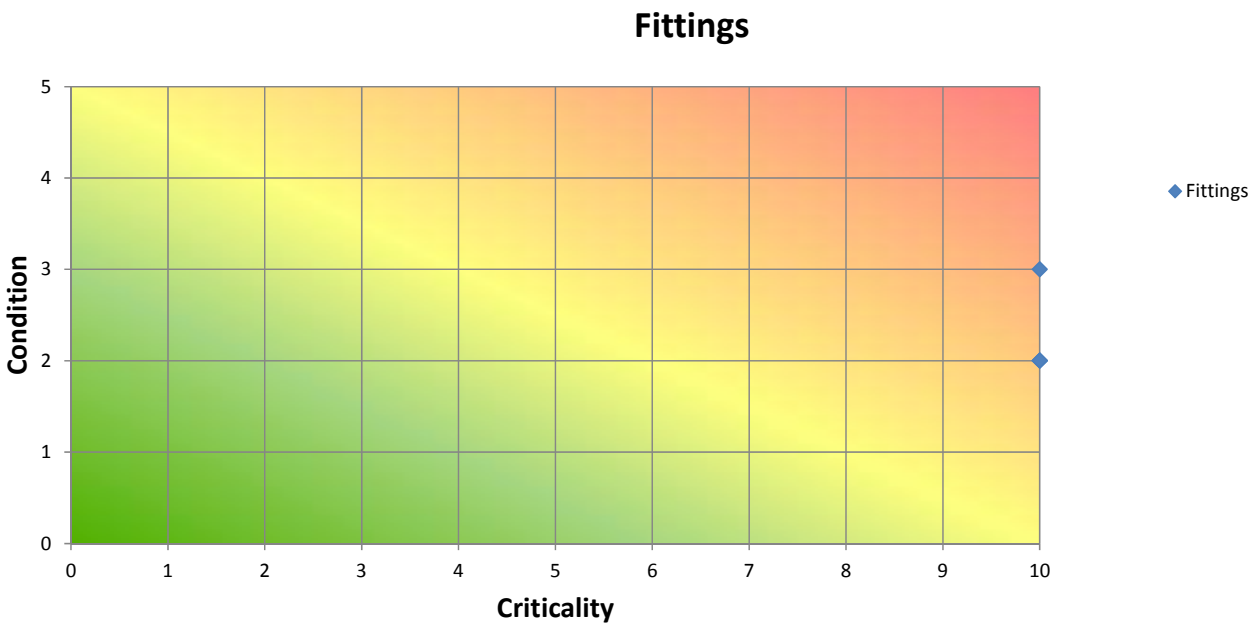
Fittings
Condition
Criticality
0
1
2
3
4
5
6
7
8
9
10
Fittings

W-VP00000177

City of Winnipeg Asset Name		**Observations:**
Feedermain Name	South Ft. Garry	
Address of Nearest Building		
Feedermain ID	FM024	
Easting Northing		
Type of chamber Access		**Actions:** replace or refinish valve components, refinish or replace fittings and fasteners, refinish steel beam, repair access, mitigate infiltration
Depth of Chamber	4130	
Primary FM Pipe Diameter	750	**General Comments:**
Smaller Diameter		
Branch Pipes	300 west	

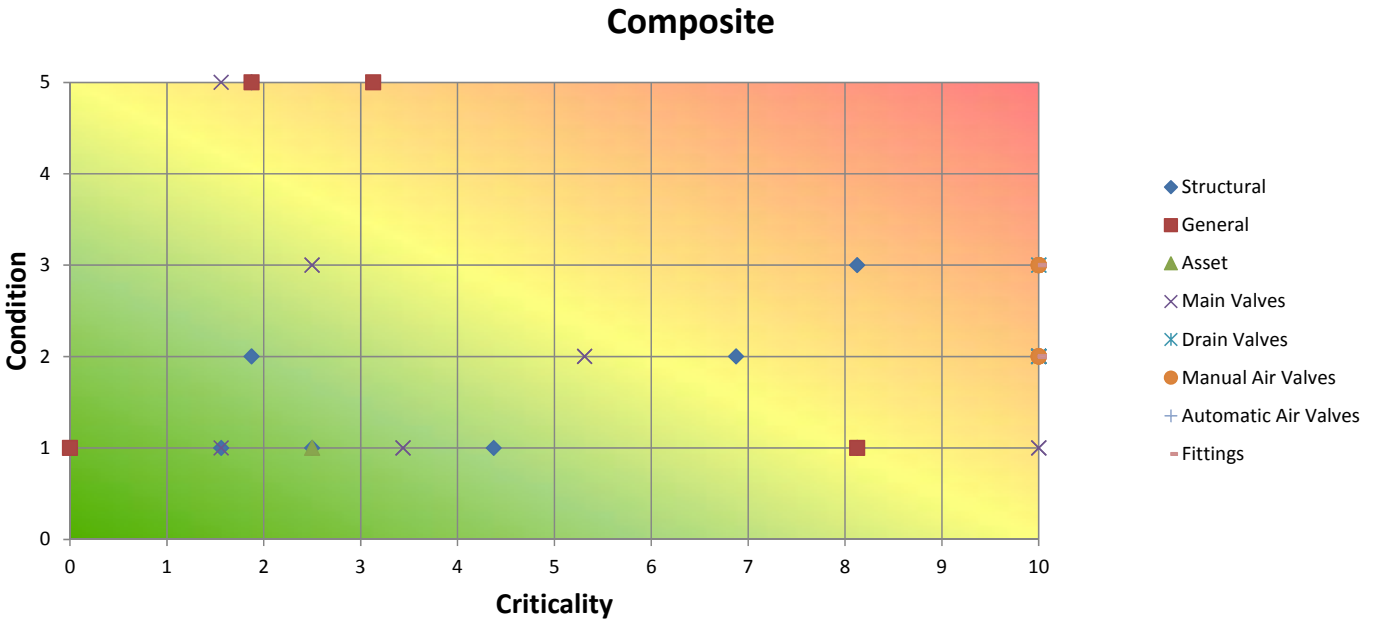

Chamber

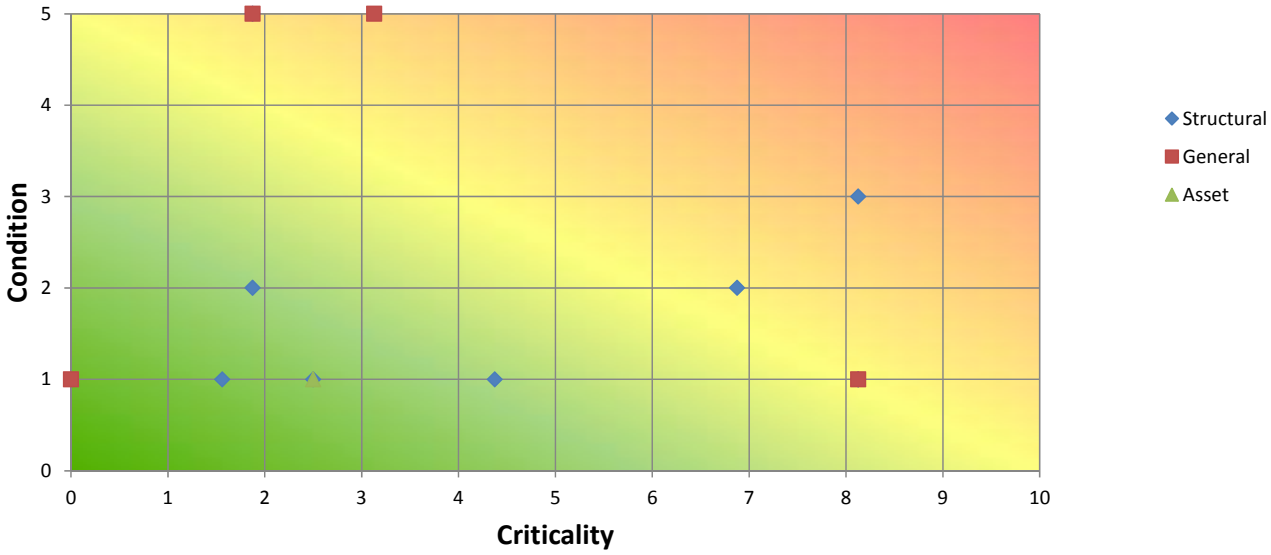

Valves

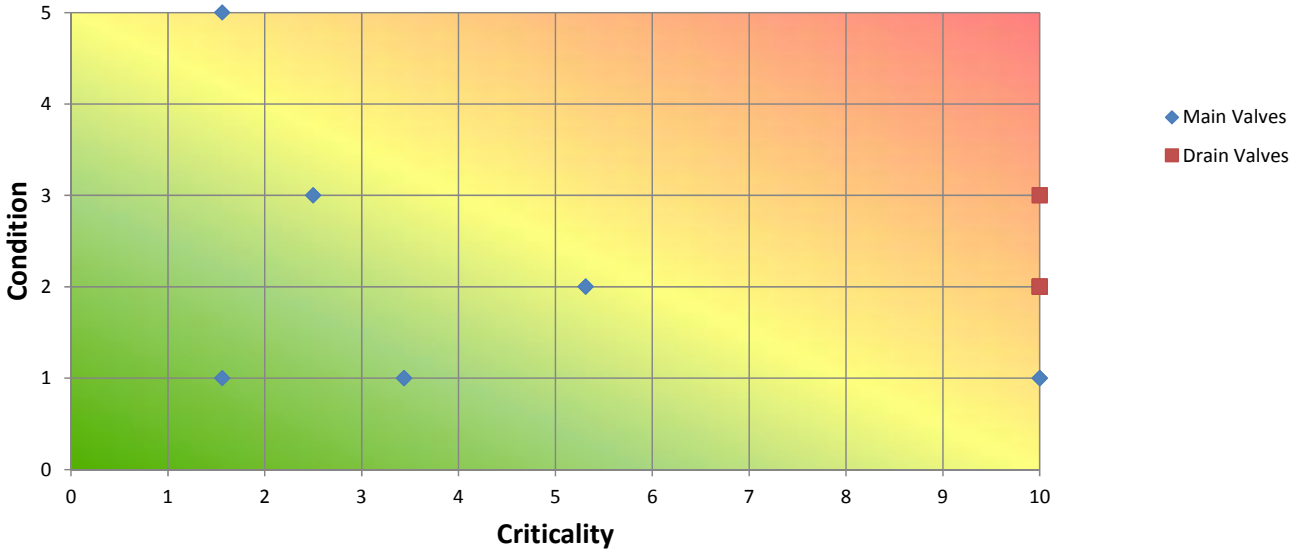

AirValves

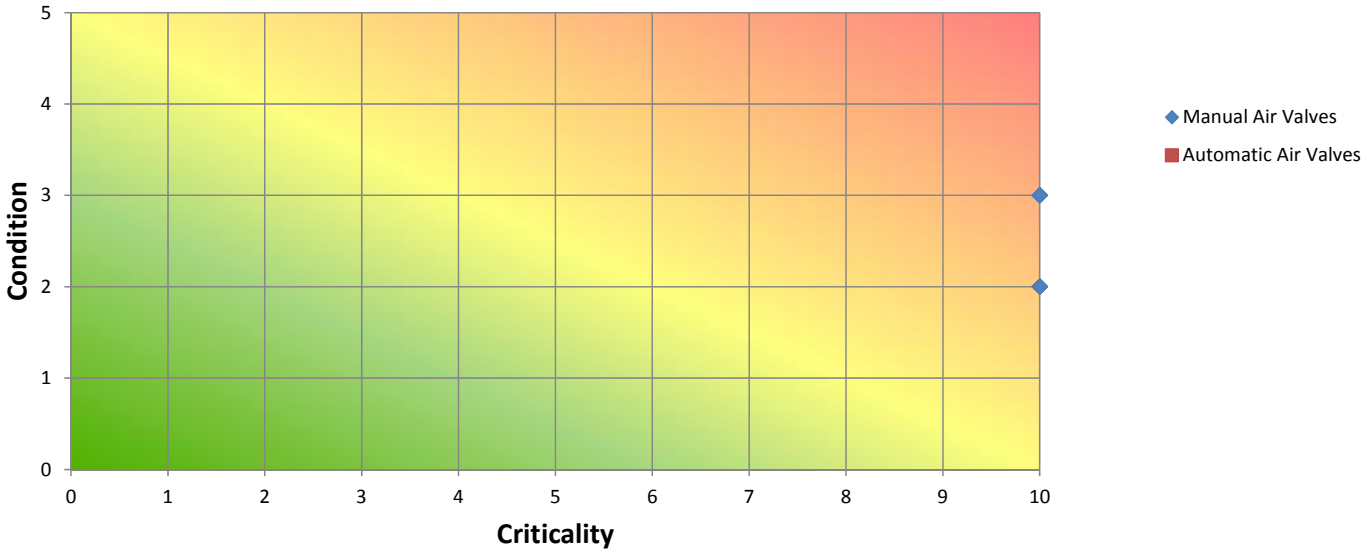

Fittings

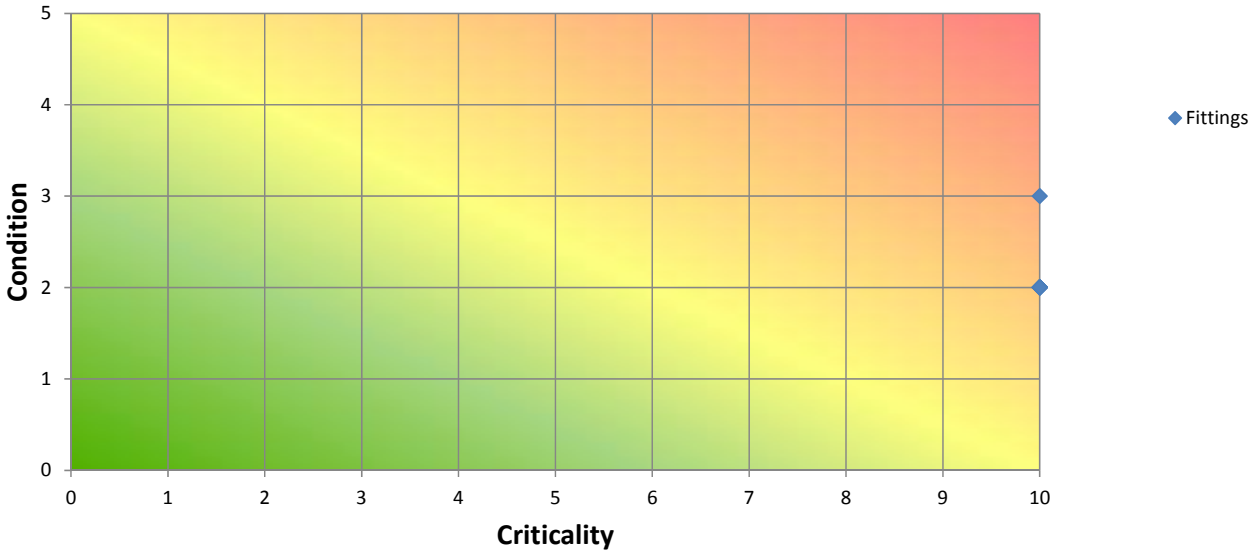

W-VP00000179

City of Winnipeg Asset Name		**Observations:**
Feedermain Name	Lagimodiere	
Address of Nearest Building		
Feedermain ID	FM020	
Easting Northing		
Type of chamber Access		**Actions:** replace or refinish valve components, refinish or replace fittings and fasteners, refinish steel, mitigate infiltration, inspect main line valve operational condition
Depth of Chamber	4800	
Primary FM Pipe Diameter	600	**General Comments:** Chamber includes pressure monitoring equipment.
Smaller Diameter		
Branch Pipes	400 East, 300 West	

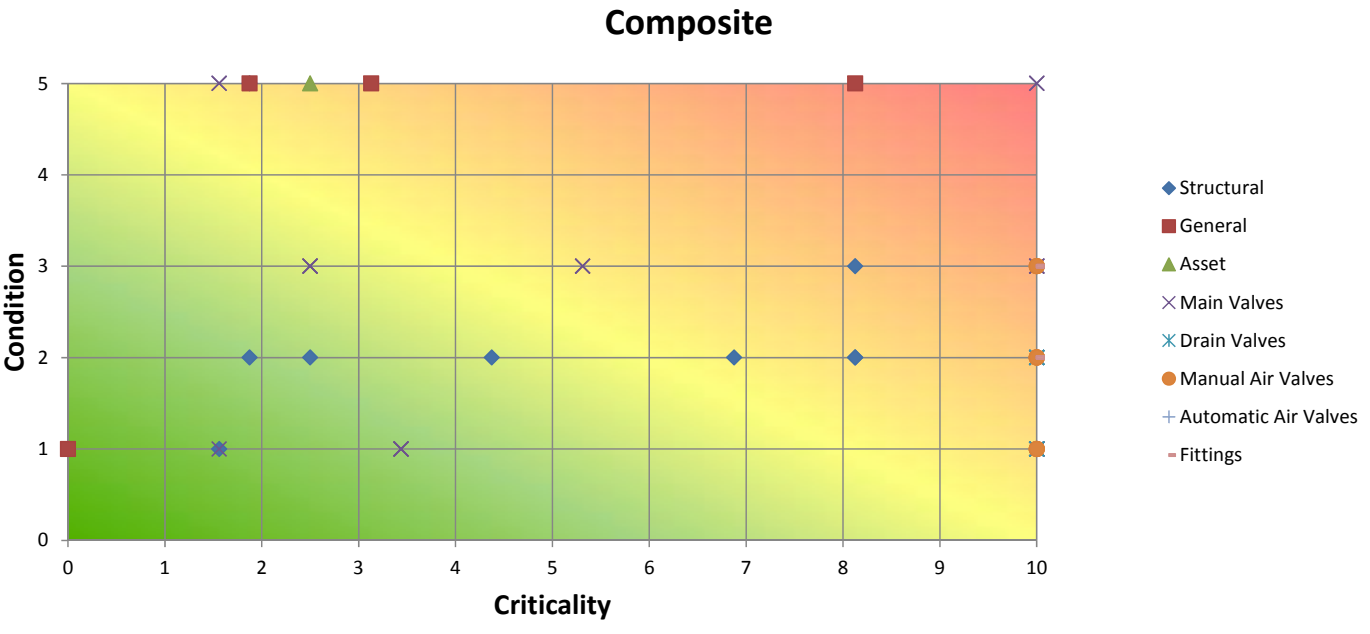

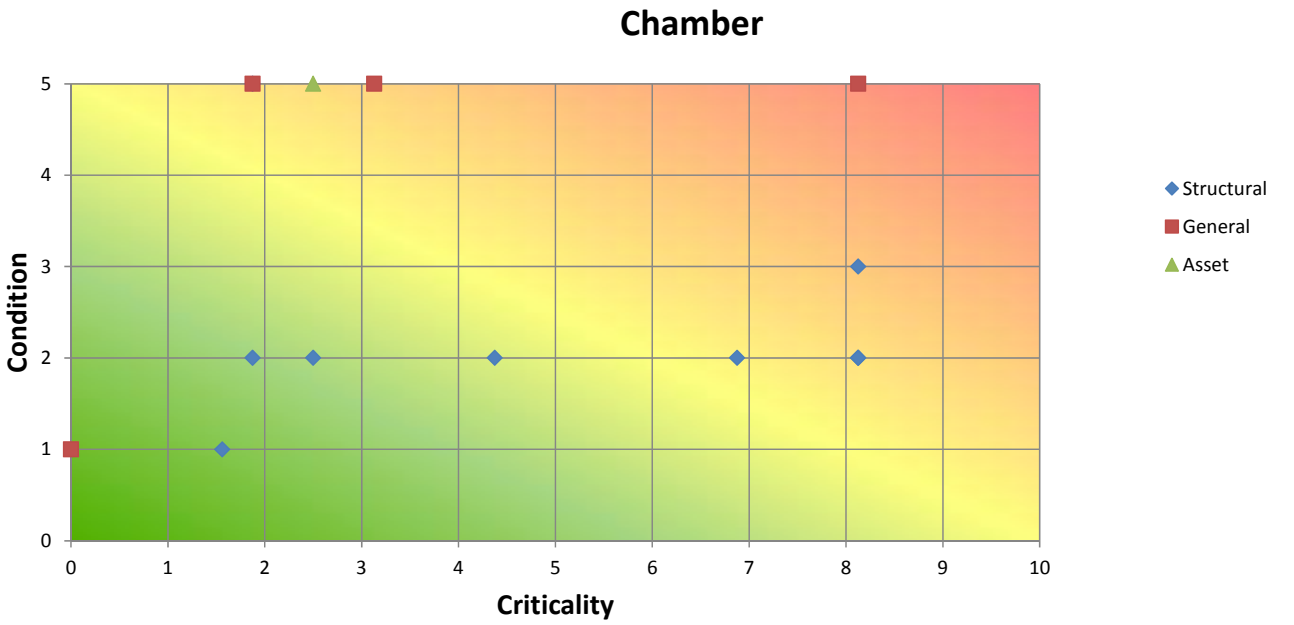
Chamber
Condition
Criticality
0
1
2
3
4
5
6
7
8
9
10
Structural
General
Asset

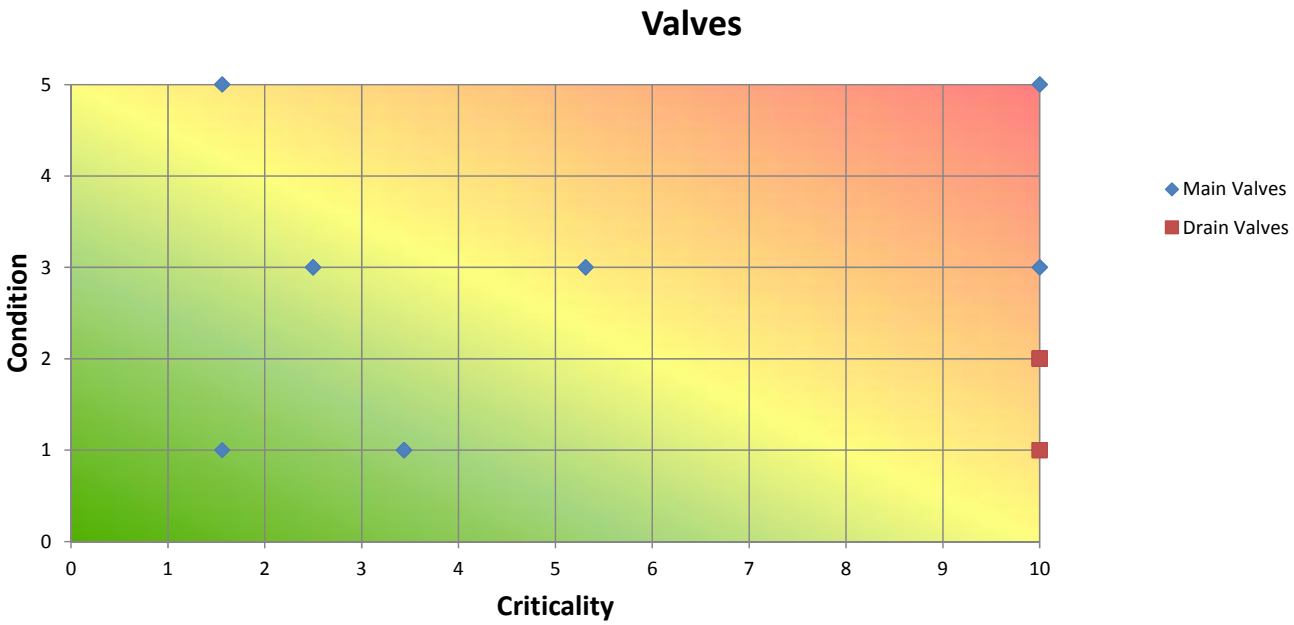
Valves
Condition
Criticality
0
1
2
3
4
5
6
7
8
9
10
Main Valves
Drain Valves

AirValves

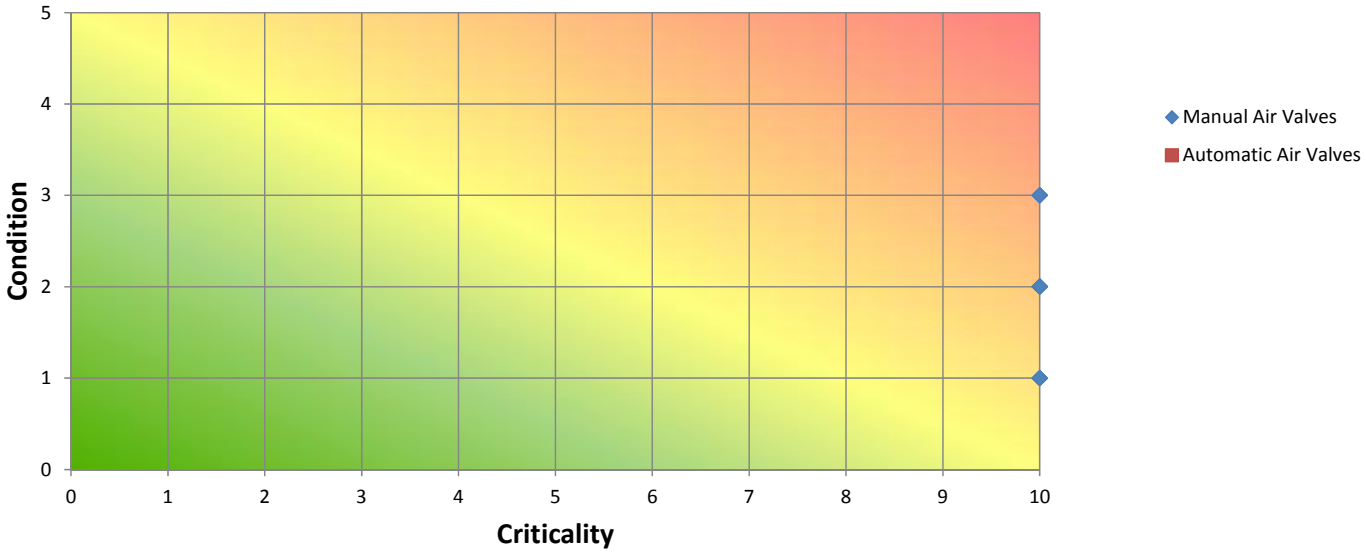

Fittings

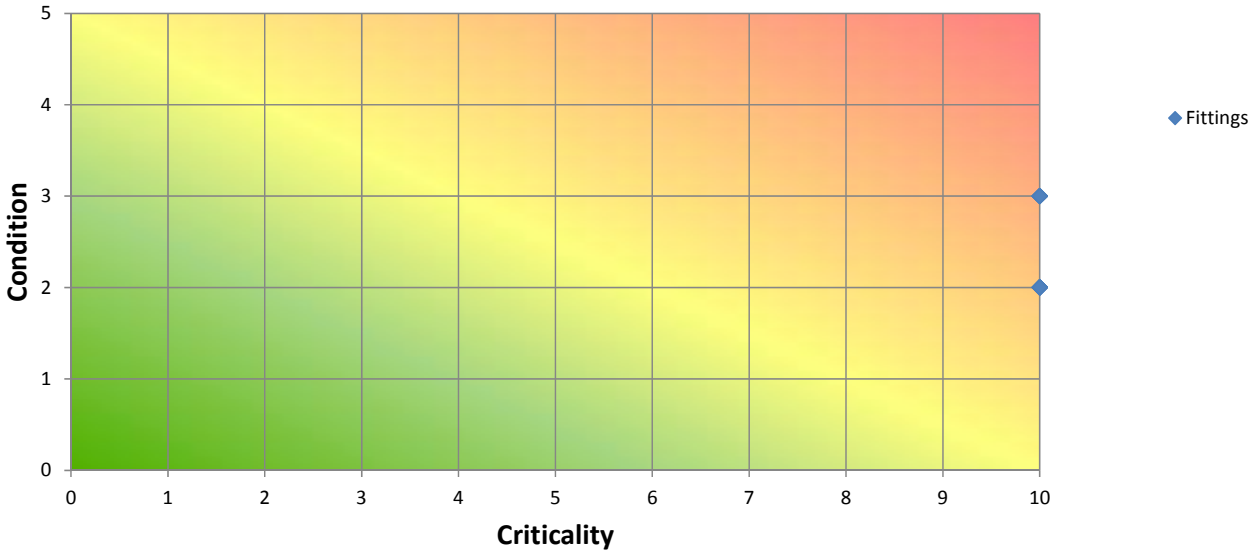

W-VP00000195

City of Winnipeg Asset Name		**Observations:**
Feedermain Name	North Kildonan	
Address of Nearest Building		
Feedermain ID	FM011	
Easting Northing		
Type of chamber Access		**Actions:** determine blow off pipe status, repair valve box
Depth of Chamber		
Primary FM Pipe Diameter		**General Comments:**
Smaller Diameter		
Branch Pipes		

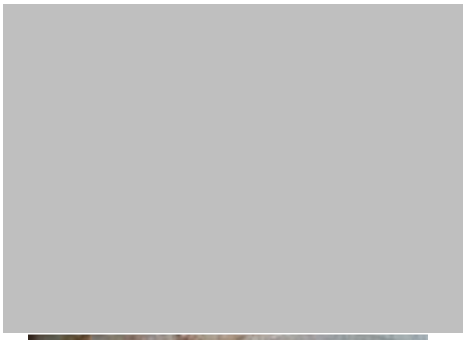

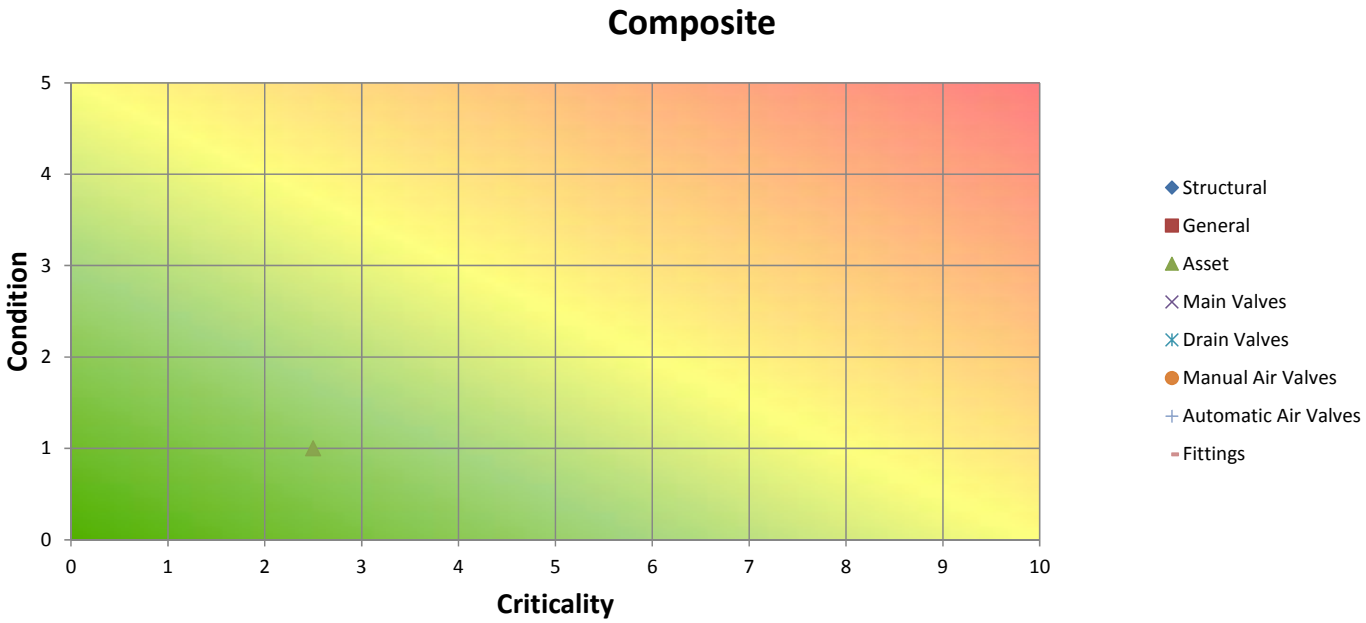

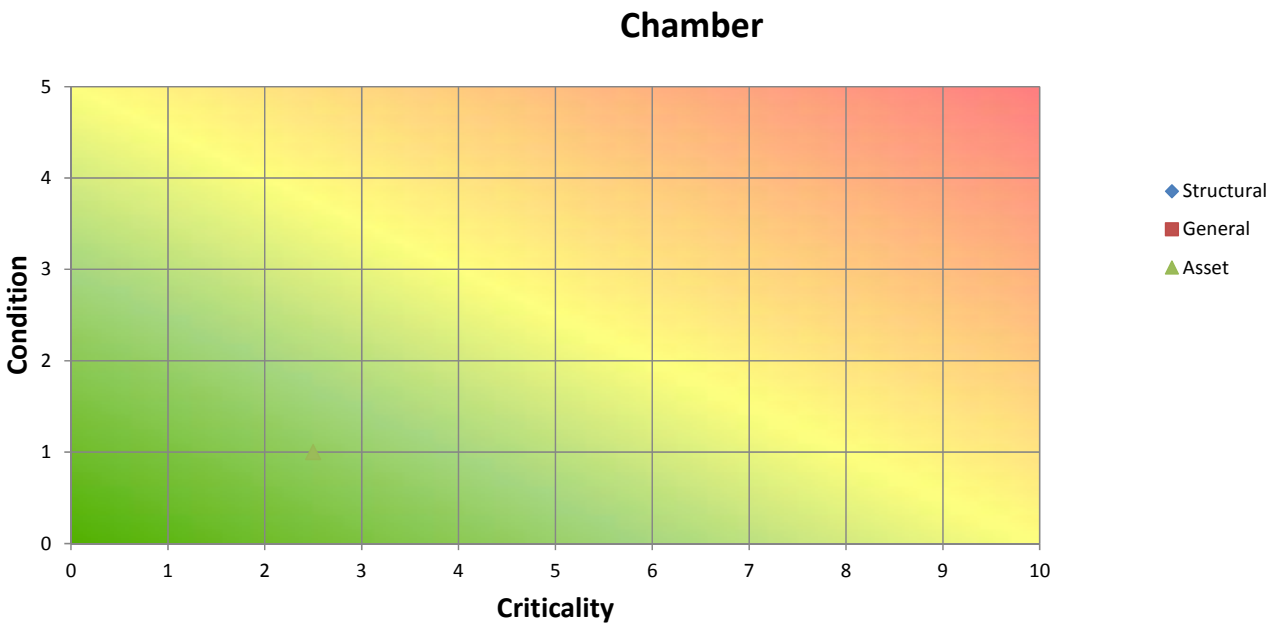
Chamber
Condition
Criticality
0
1
2
3
4
5
6
7
8
9
10
Structural
General
Asset

W-VP00000568

City of Winnipeg Asset Name		**Observations:**
Feedermain Name	Ft. Garry / St. Vital	
Address of Nearest Building		
Feedermain ID	FM023	
Easting Northing		
Type of chamber Access		**Actions:** replace or refinish valve components, refinish or replace fittings and fasteners, mitigate infiltration
Depth of Chamber	4400	
Primary FM Pipe Diameter	600	**General Comments:**
Smaller Diameter		
Branch Pipes	300 - North	

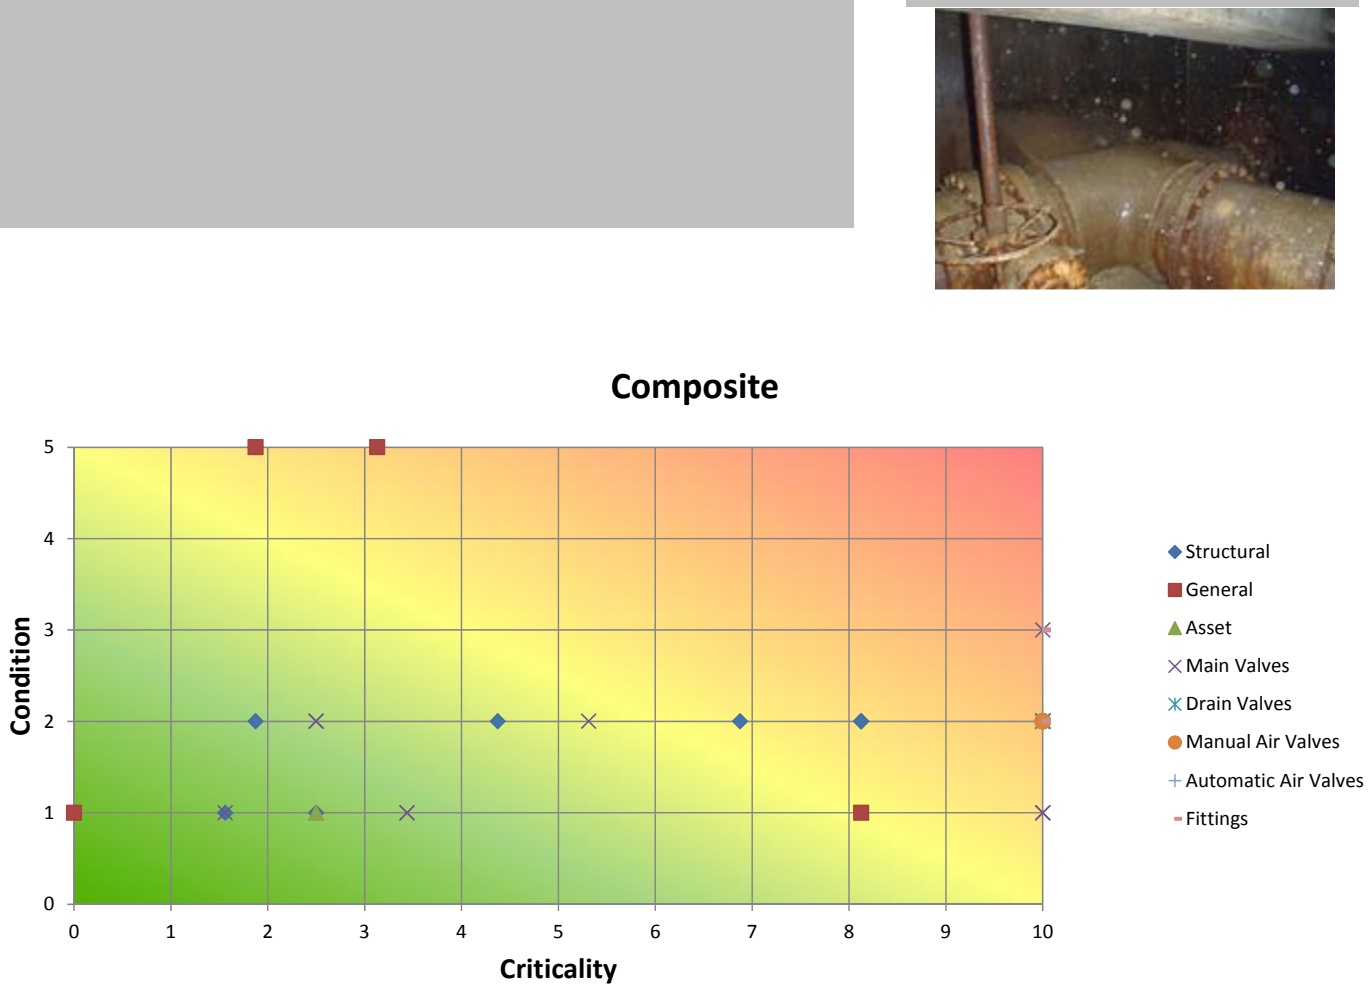

Chamber

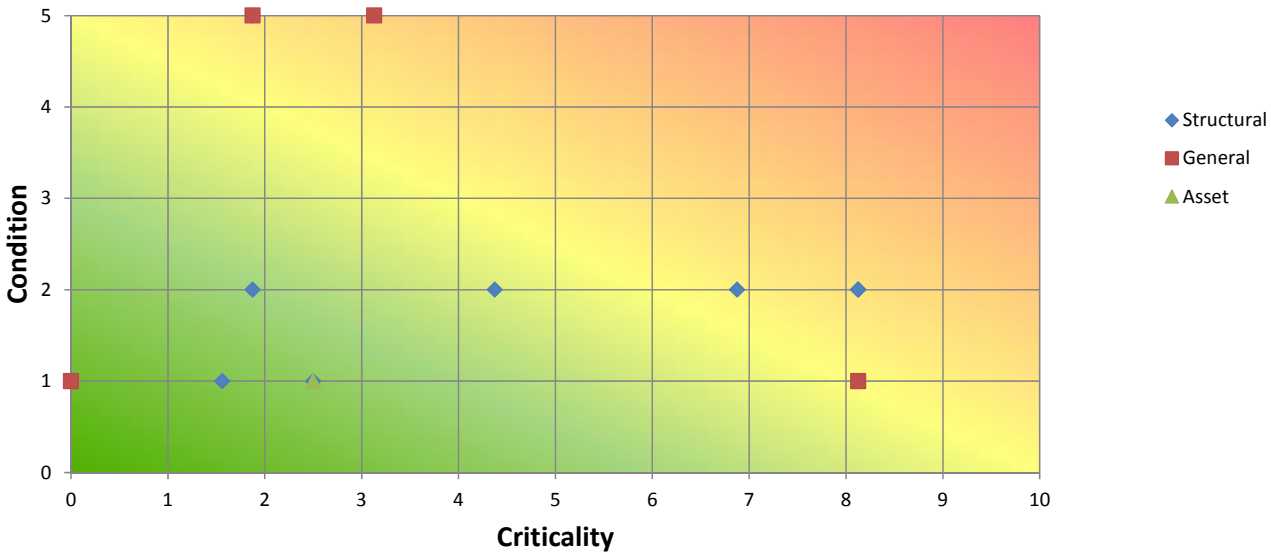

Valves

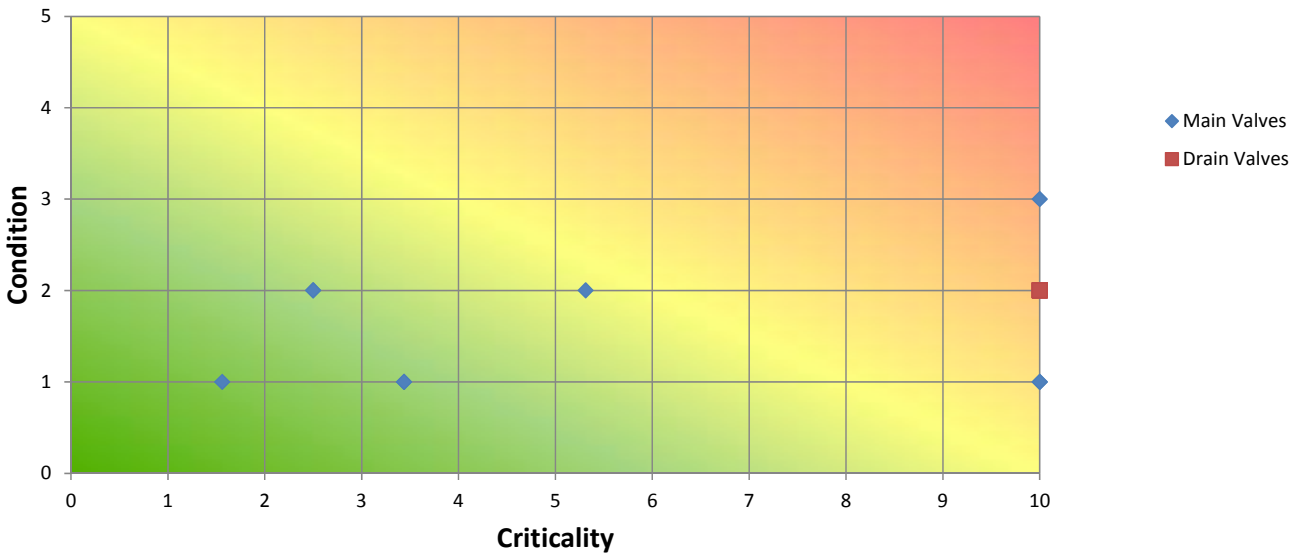

AirValves

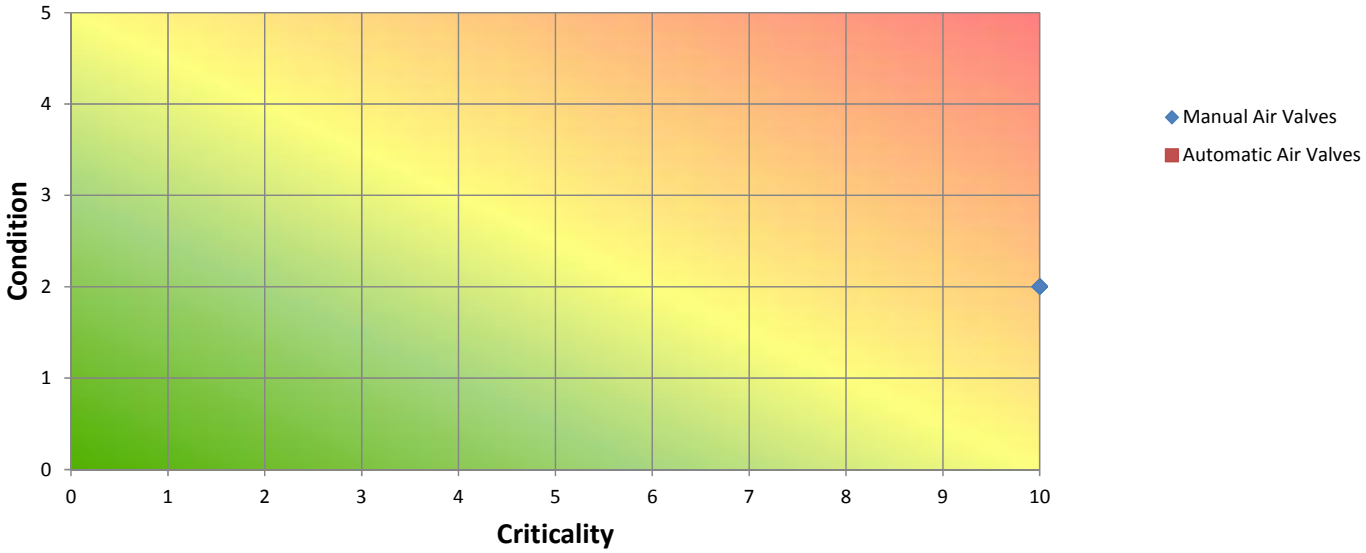

Fittings

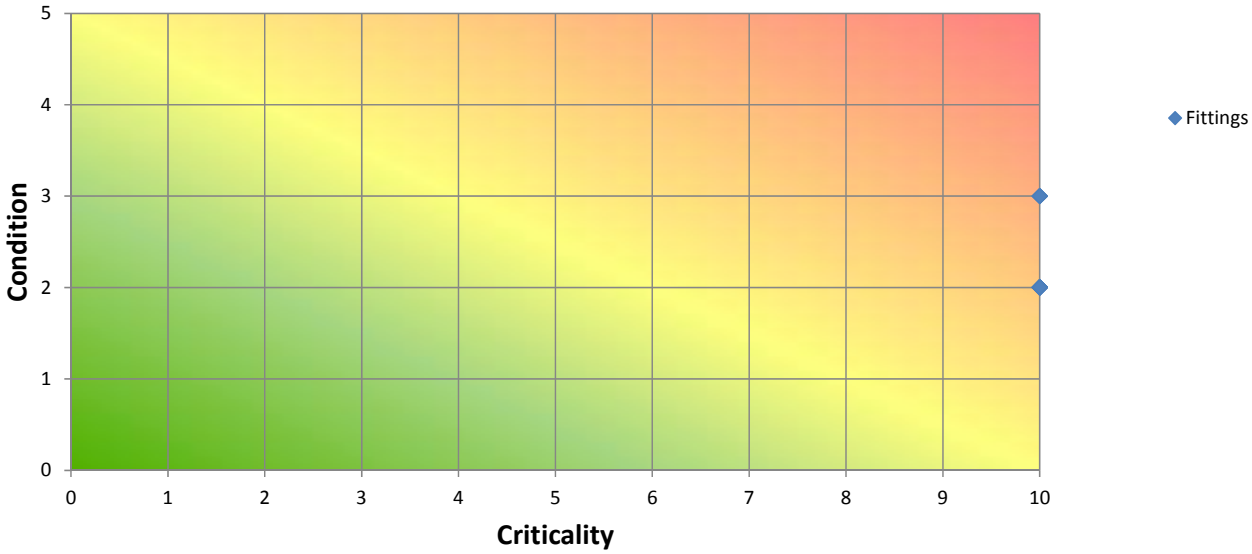

D2b Automatic Air Relief Valves 2015 03 04

Branch I Aqueduct Automatic Air Release Valves

Air Valve or Pressure MH#	Location	Remarks	Dated Checked	Checked By
#102 Air Realease Valve		- 33" Lid - 2"blowoff GV		
#103 Pressure MH		- 33" Lid - No blowoff		
#104 Pressure MH		- 33" Lid - No blowoff		
#105 Air Realease Valve		- 33" Lid - 2"blowoff GV		
#106 Pressure MH		- 33" Lid - No blowoff		
#107 Pressure MH		- 33" Lid - No blowoff		
#108 Air Realease Valve		- 33" Lid - 2"blowoff GV		
#109 Automatic Air Realease Valve		- 33" Lid -1-6" - 8 hole GV & Tee, -1-3"-4 hole GV		
TBV Pit Automatic Air Realease Valve		Info Required		
#114 Automatic Air Realease Valve		33" Lid 1-8" - 8 hole GV New Airvalve installed summer 2006 Loader to lift cover		

#116 Automatic Air Realease Valve		33" Lid 1-8" - 8 hole GV New Airvalve installed summer 2006 Loader to lift cover		
#118 Air Realease Valve		33" Lid 1-8" - 8 hole GV New Airvalve installed summer 2006 Loader to lift cover		
#125 Air Realease Valve		24" Lid 1-2" Blowoff GV 1-6" Blowoff GV		
#126 Air Realease Valve		2-2" BVBlowoff		
#127 Air Realease Valve		2-2" BVBlowoff		
#137 Automatic Air Realease Valve		33" Lid 1-8" - 8 hole GV New Airvalve installed summer 2006 Loader to lift cover		
#163 Automatic Air Realease Valve		New Automatic Air release valve chamber built 2006, Floodway expansion Project		
		New Automatic Air release valve chamber built 2006, Floodway expansion Project		
		New Automatic Air release valve chamber built 2006, Floodway expansion Project		
#157 Air Realease Valve		1-2"GV Blowoff Requires Crazy Wrench		

Branch II Aqueduct Automatic Air Release Valves

Valve #	Location	Dated Checked
1		
2		
3		
4		
5		
6		
7		
8		

Branch ii Aqueduct Air Blowoffs

Valve #	Location	
1		
2		

D2c Inoperable Valves List

Inoperable Values List

Service Request Status	Service Request No	Created Date	Problem Street Name	Problem Description
ACTIVE	1325423	1/25/2014 13:24		
ACTIVE	1324904	1/20/2014 11:45		
ACTIVE	1296185	6/25/2013 10:43		
ACTIVE	1294204	6/12/2013 12:03		
ACTIVE	1291811	5/28/2013 11:45		
ACTIVE	1291482	5/25/2013 16:08		
ACTIVE	1252152	6/19/2012 16:36		
ACTIVE	1248521	5/21/2012 14:37		
ACTIVE	1198816	2/16/2011 16:30		
ACTIVE	1136888	6/20/2009 16:05		

Inoperable Values List

Service Request Status	Service Request No	Created Date	Problem Street Name	Problem Description
ACTIVE	1123062	3/13/2009 17:01		
ACTIVE	933060	6/22/2007 8:59		
ACTIVE	717558	6/17/2005 8:41		

D3 Hydraulic Modeling of Distribution System

D3a Results from EPANET Model Trace Analysis for January 26, 2015 Sampling

This section has been intentionally removed.

D3b Results from EPANET Water Age Analysis for January 26, 2015 Sampling

This section has been intentionally removed.

D3c Discoloured Water 311 Calls from January 18, 2015

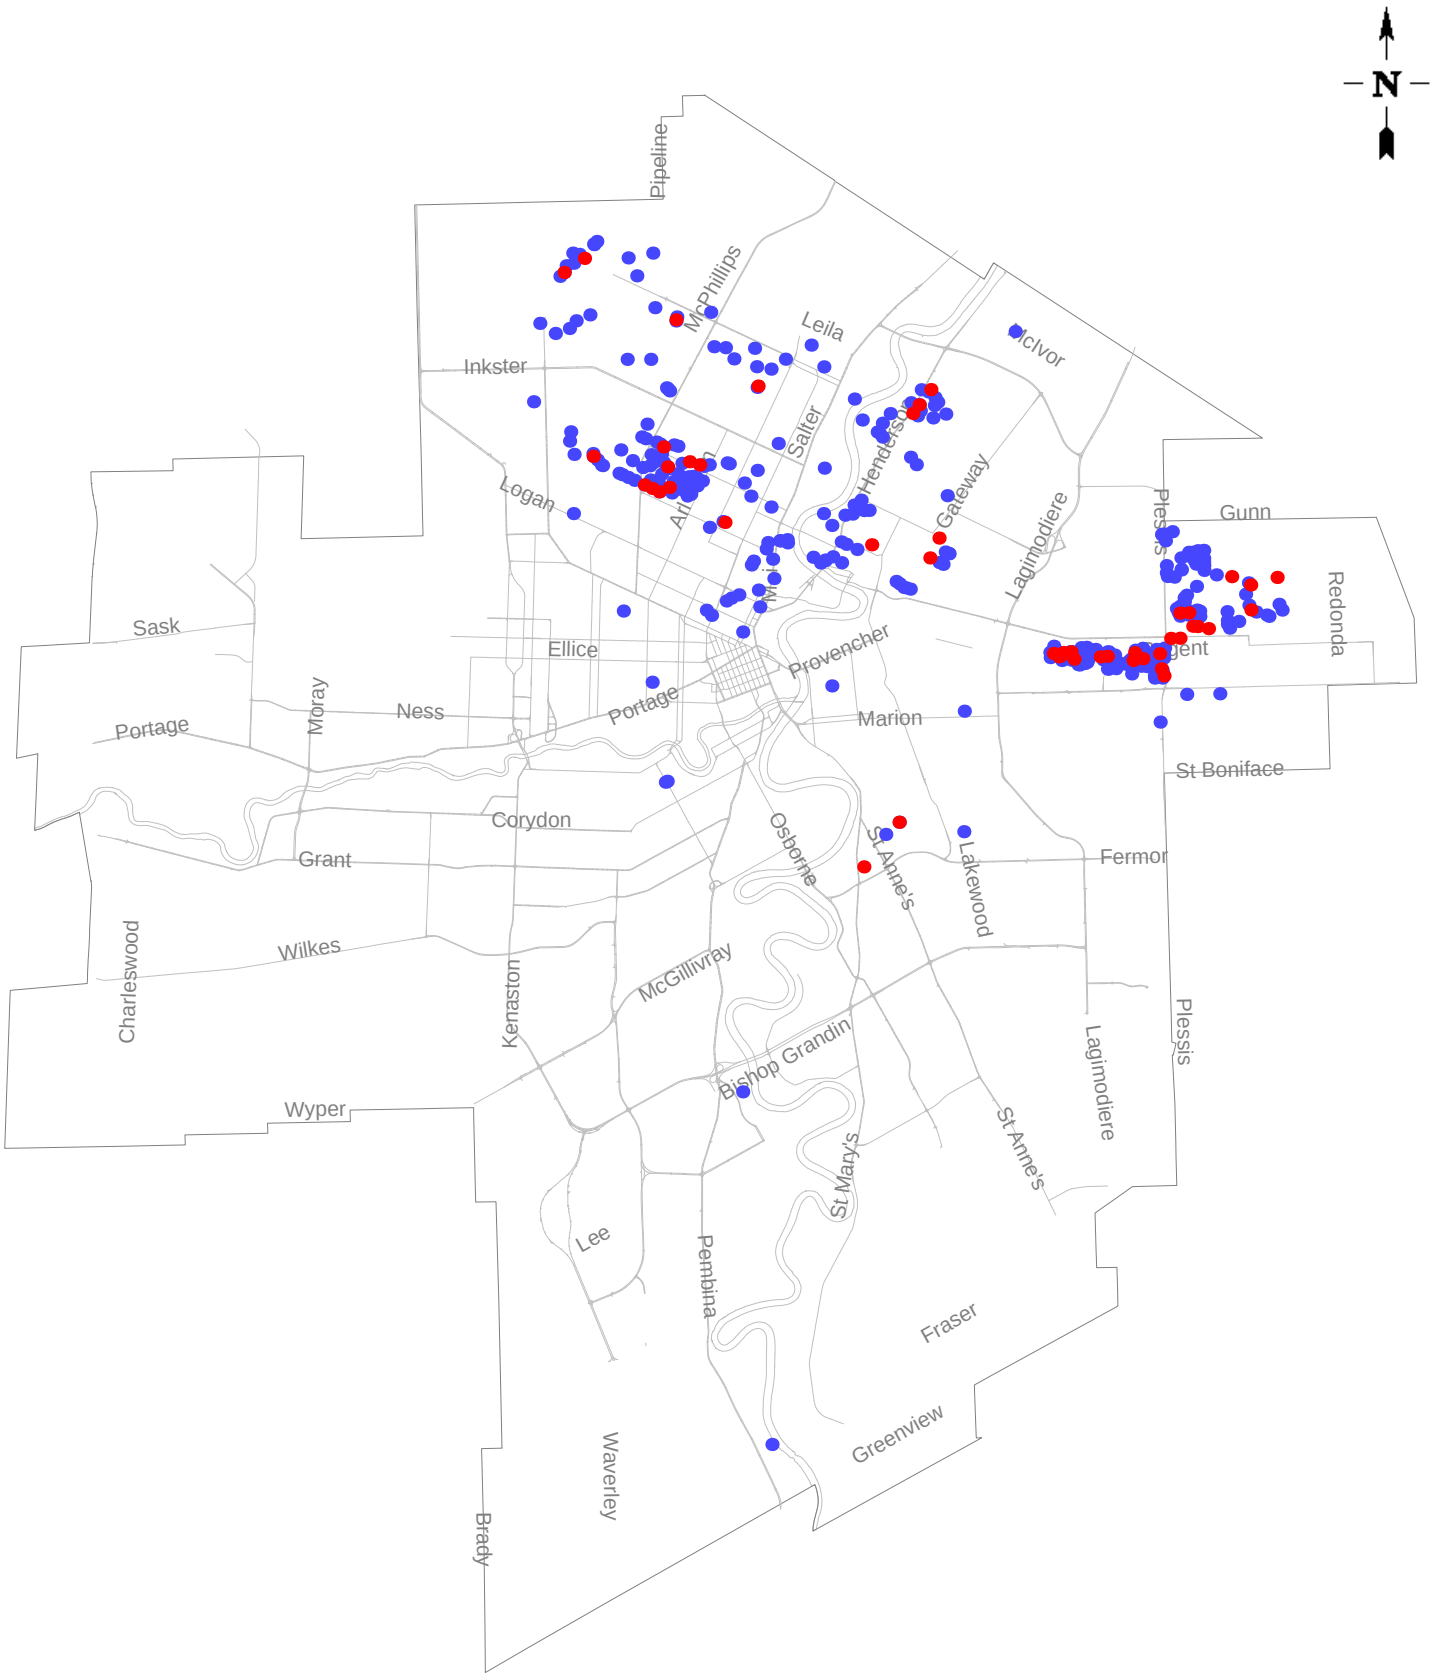

MAP LEGEND

- Service Requests (SRs)
- Information Requests (IRs)

Winnipeg

WATER AND WASTE DEPARTMENT
WATER SERVICES DIVISION

CREATED: Jan 22, 2015

SCALE: 1:150,000

Discoloured Water Calls
for January 18, 2015

D3d Hydraulic Model Analysis for October 7, 2013 Distribution Sampling

This section has been intentionally removed.

AECOM

D3e Hydraulic Model Analysis for May 26, 2014 Distribution Sampling

This section has been intentionally removed.

D4 Day-By Day Discoloured Water Call Maps Jan 12-Jan 26, 2015

DISCOLORED WATER CALLS

JANUARY 12, 2015

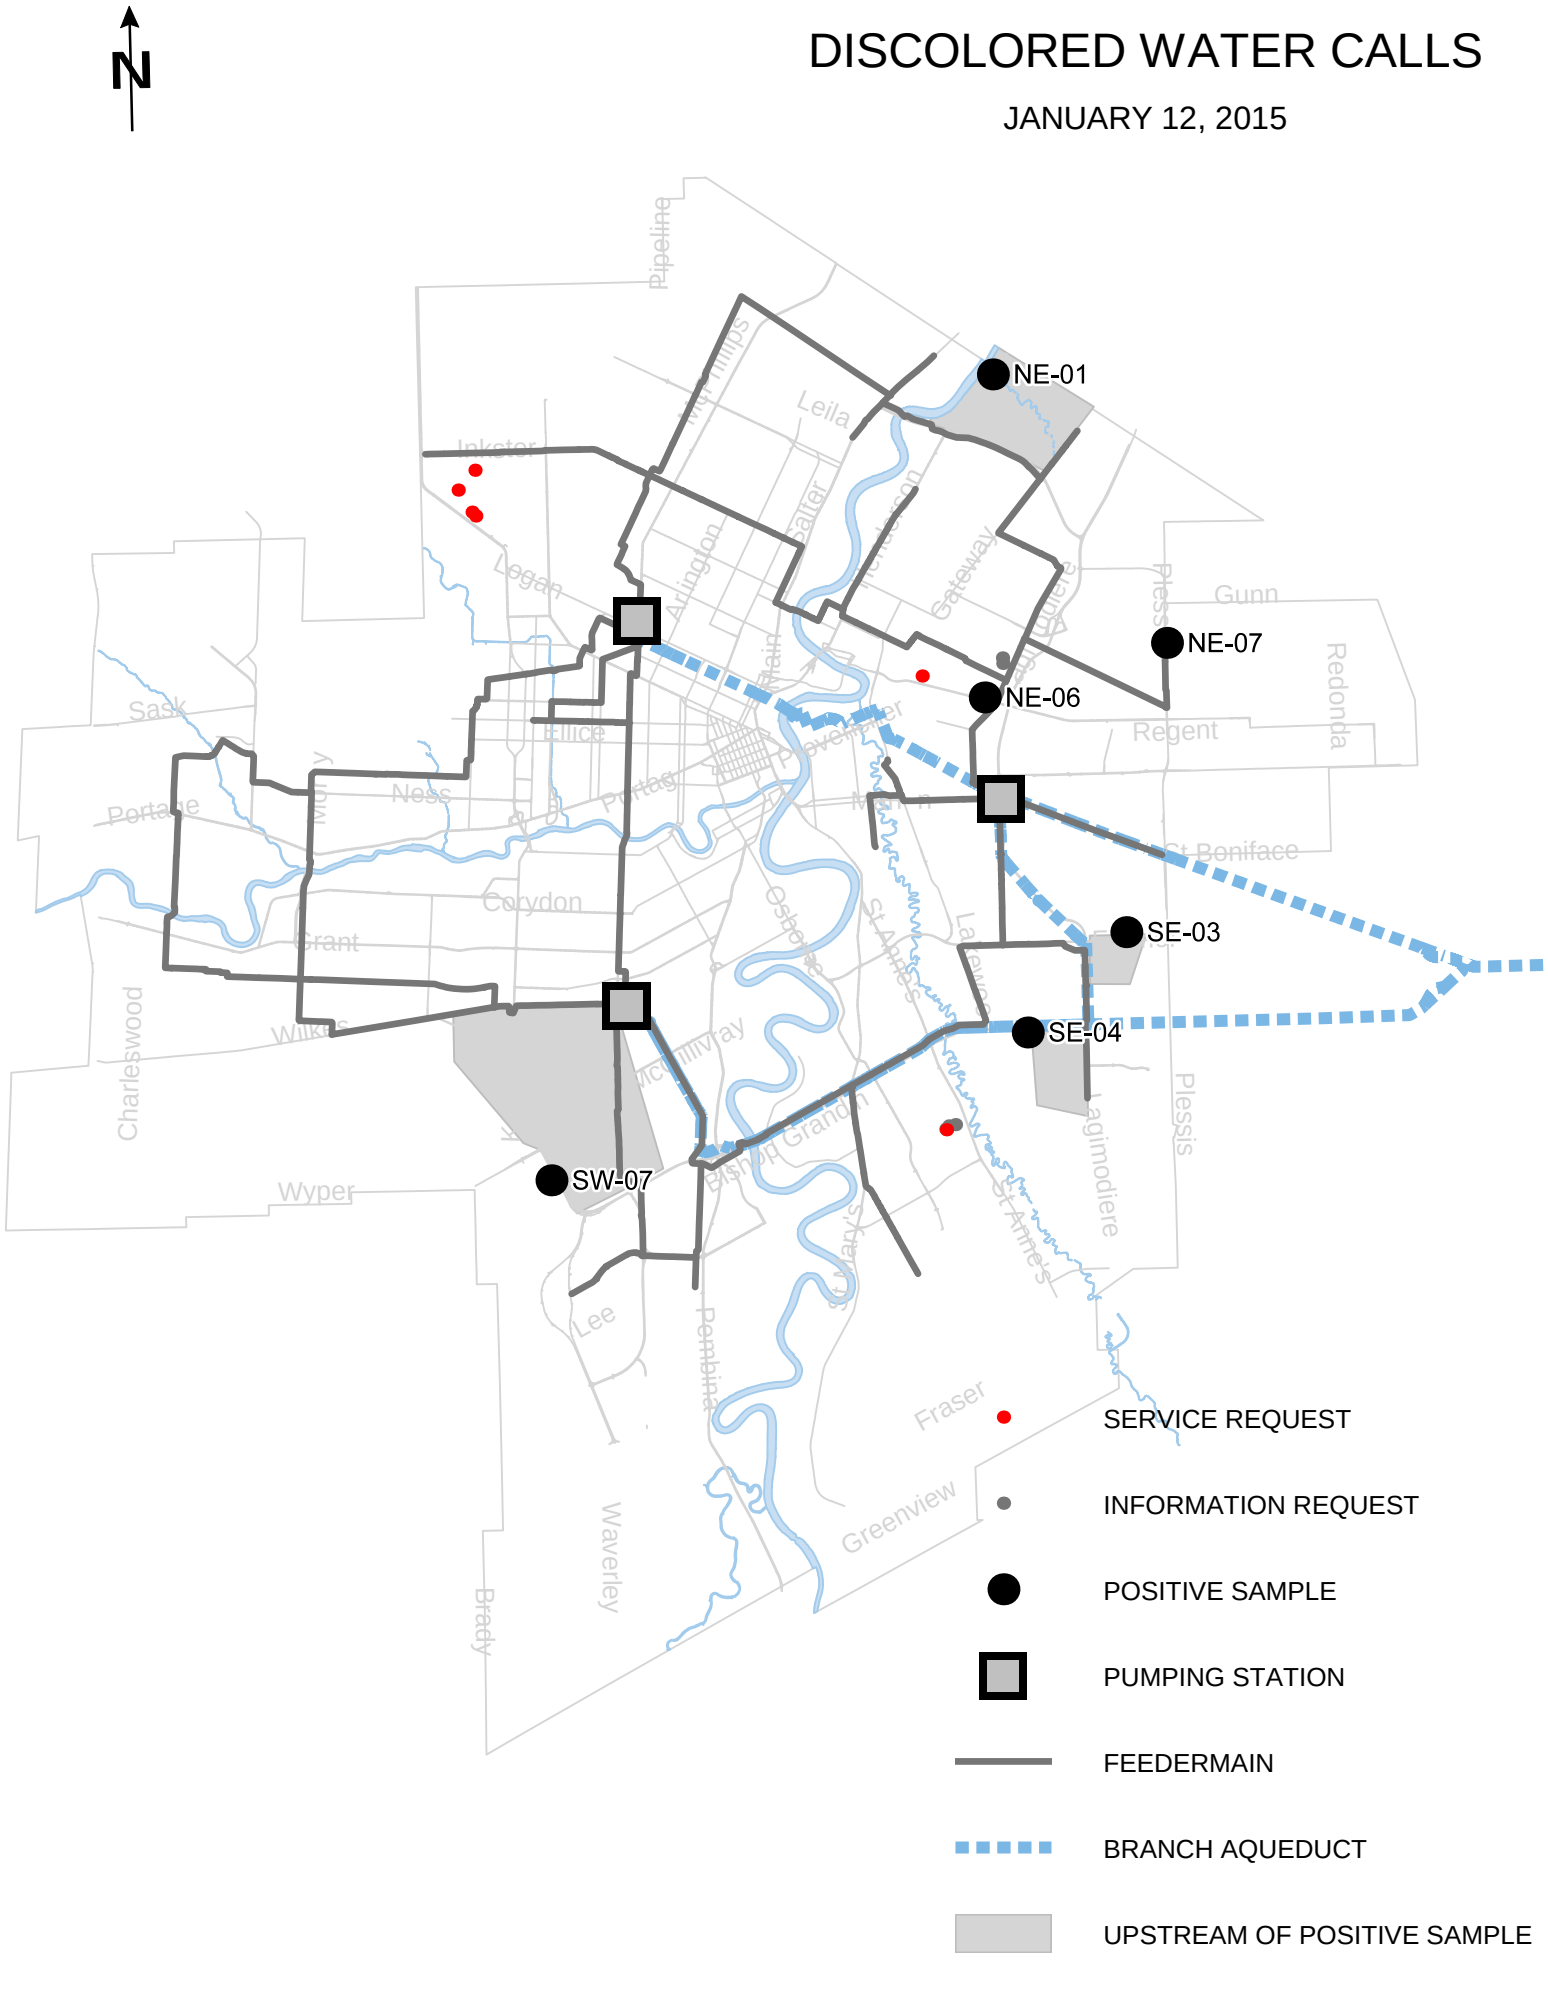

DISCOLORED WATER CALLS

JANUARY 13, 2015

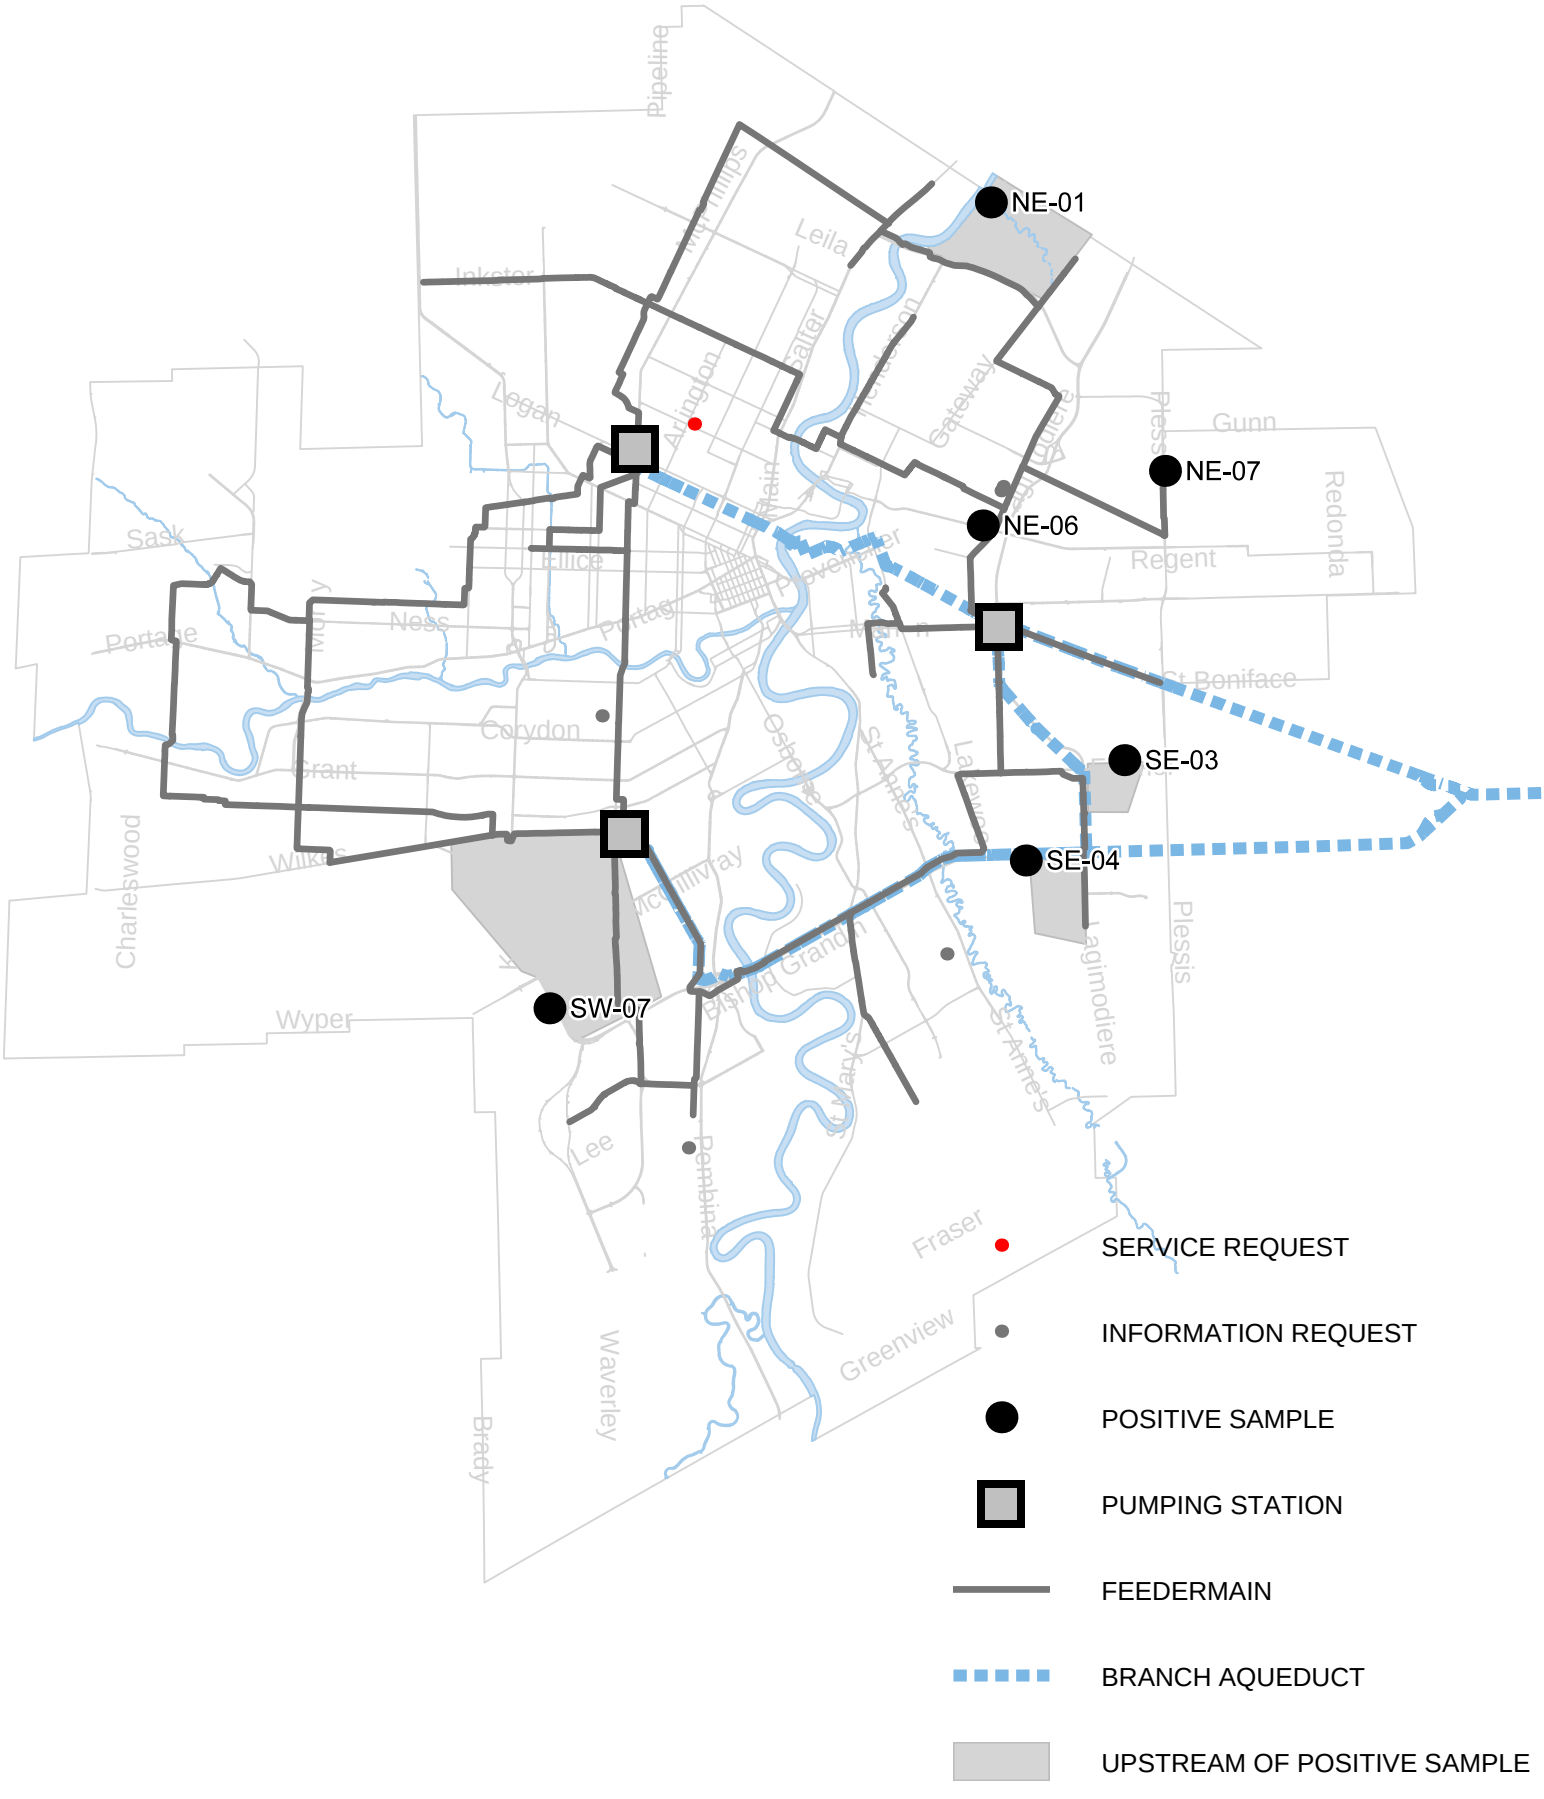

DISCOLORED WATER CALLS

JANUARY 14, 2015

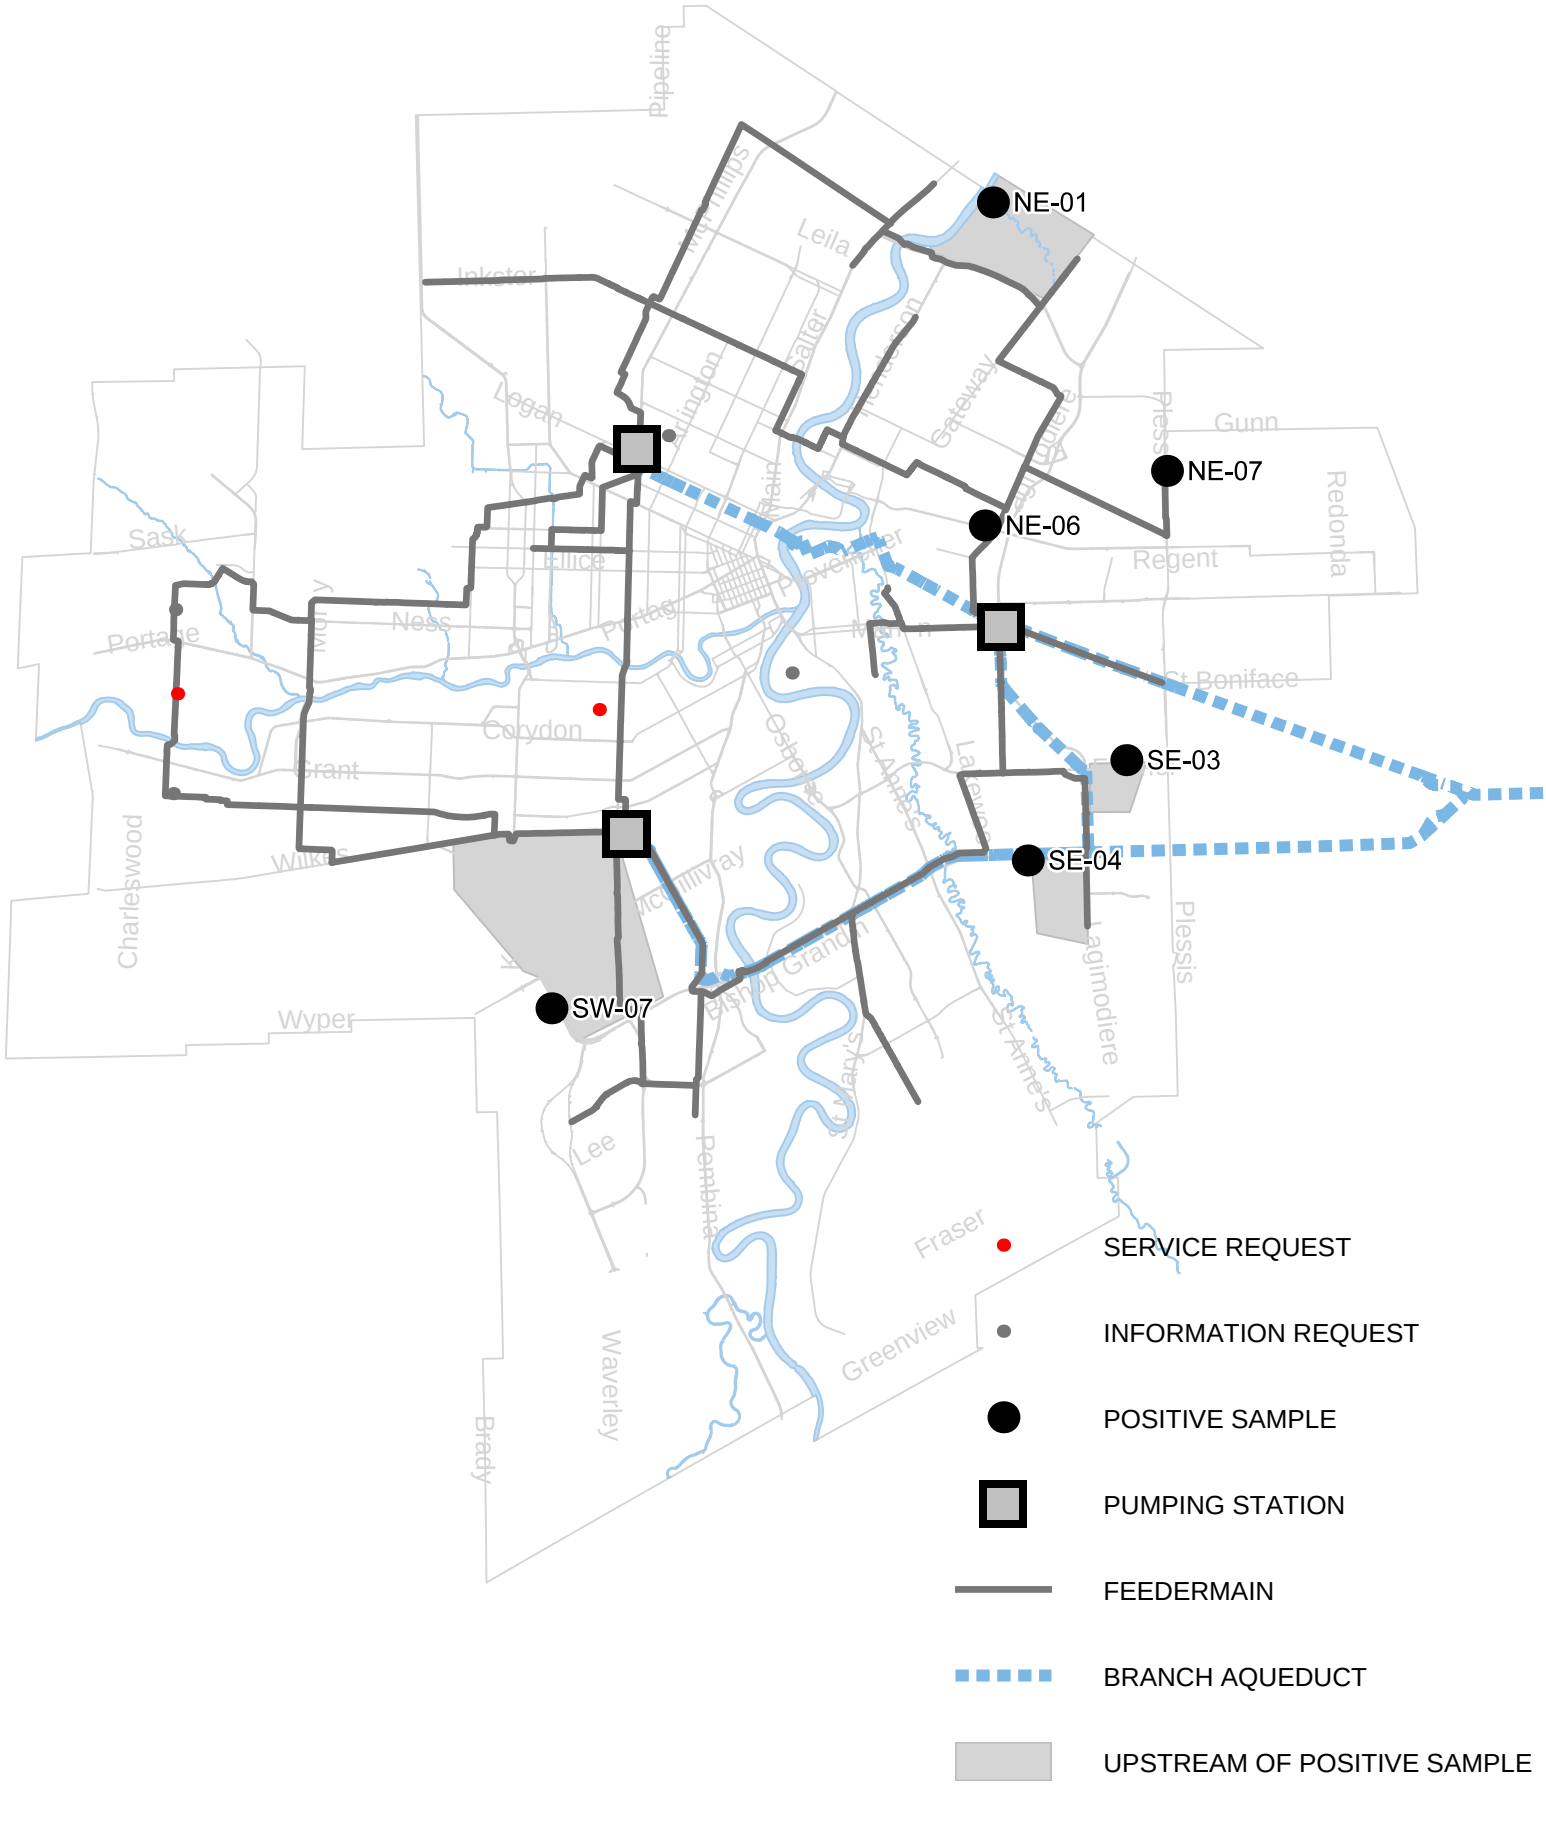

DISCOLORED WATER CALLS

JANUARY 15, 2015

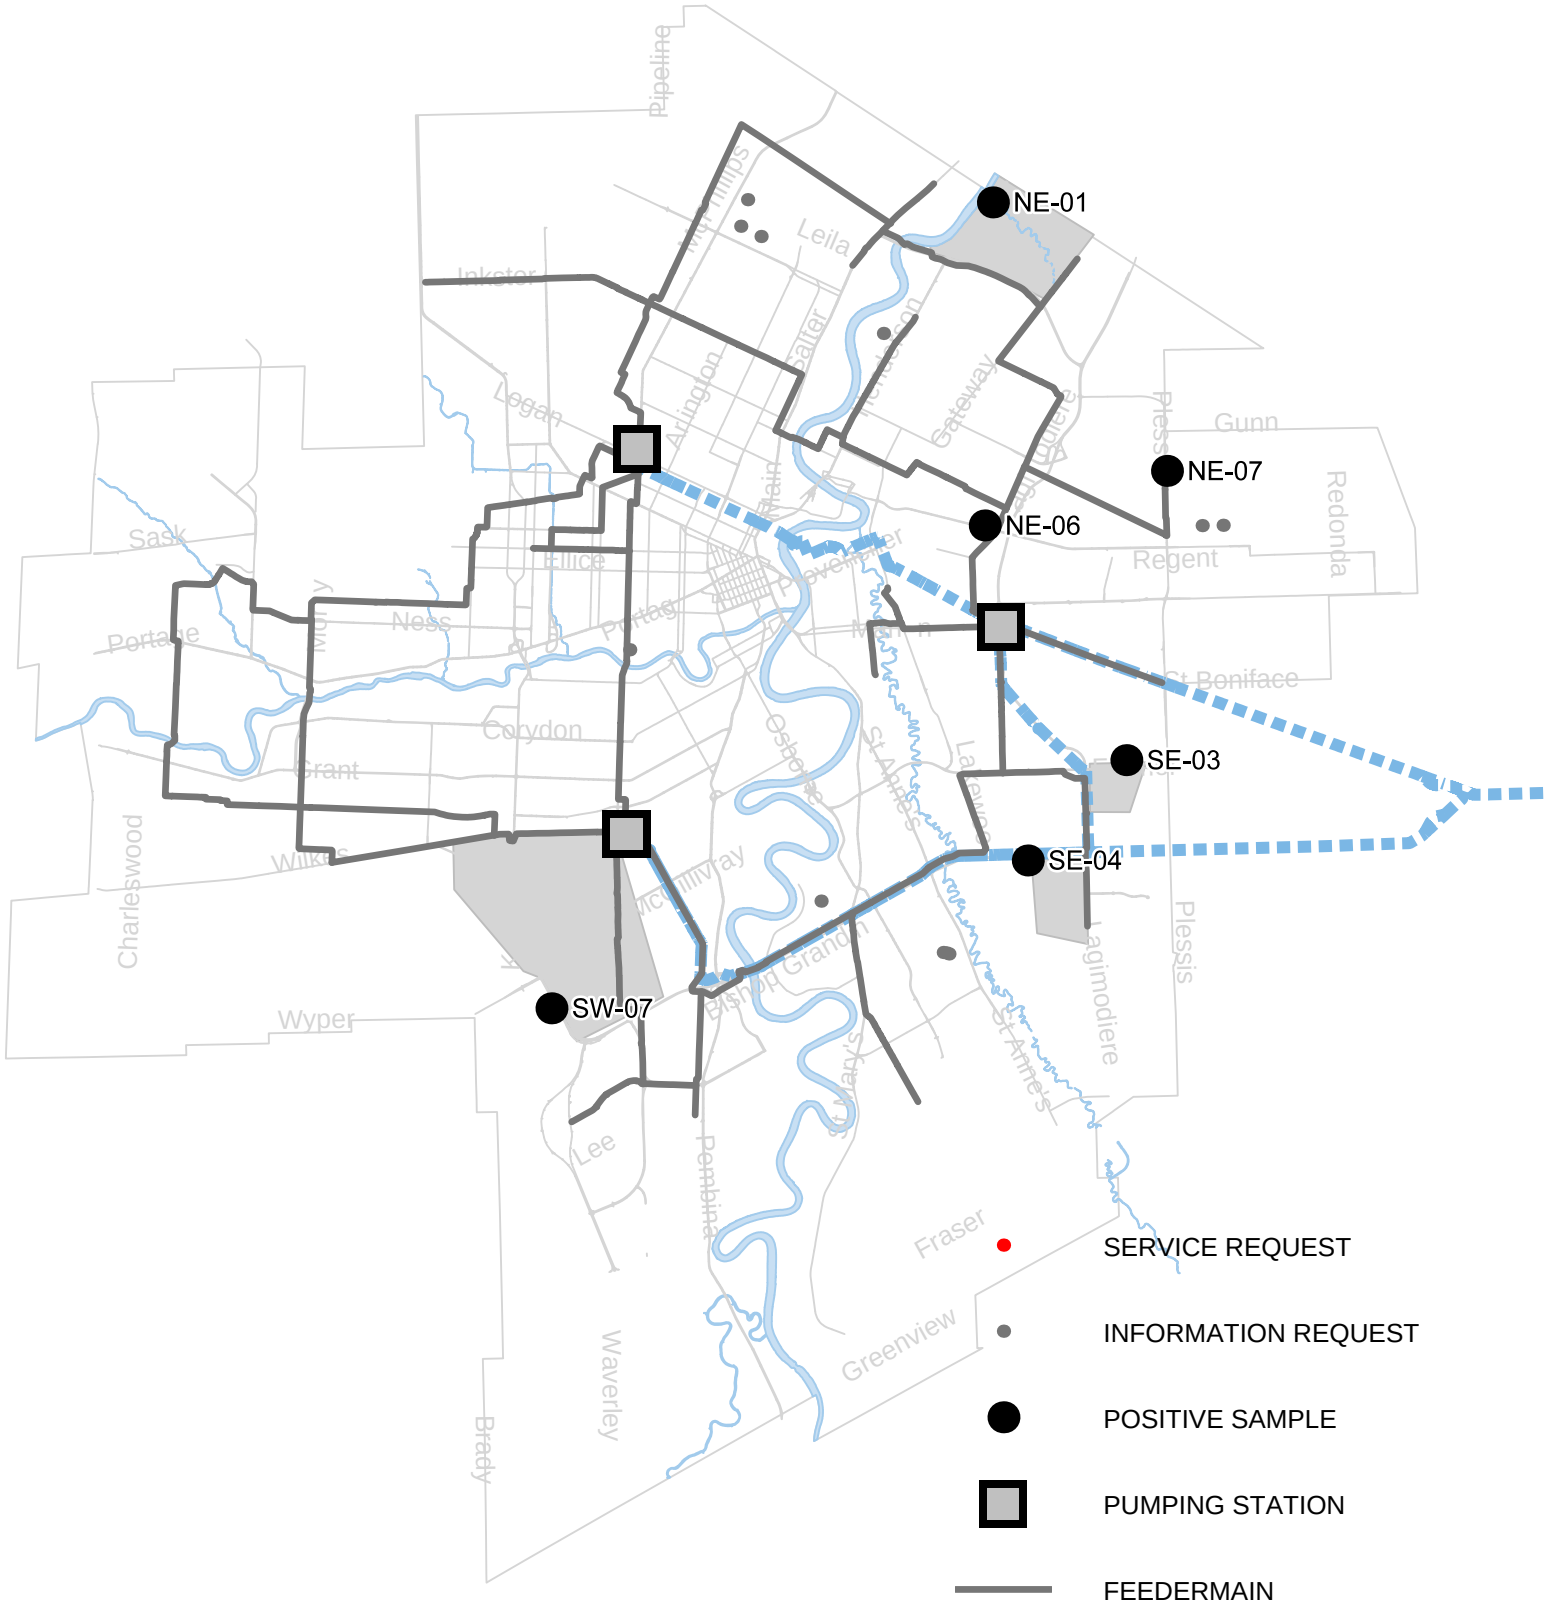

DISCOLORED WATER CALLS

JANUARY 16, 2015

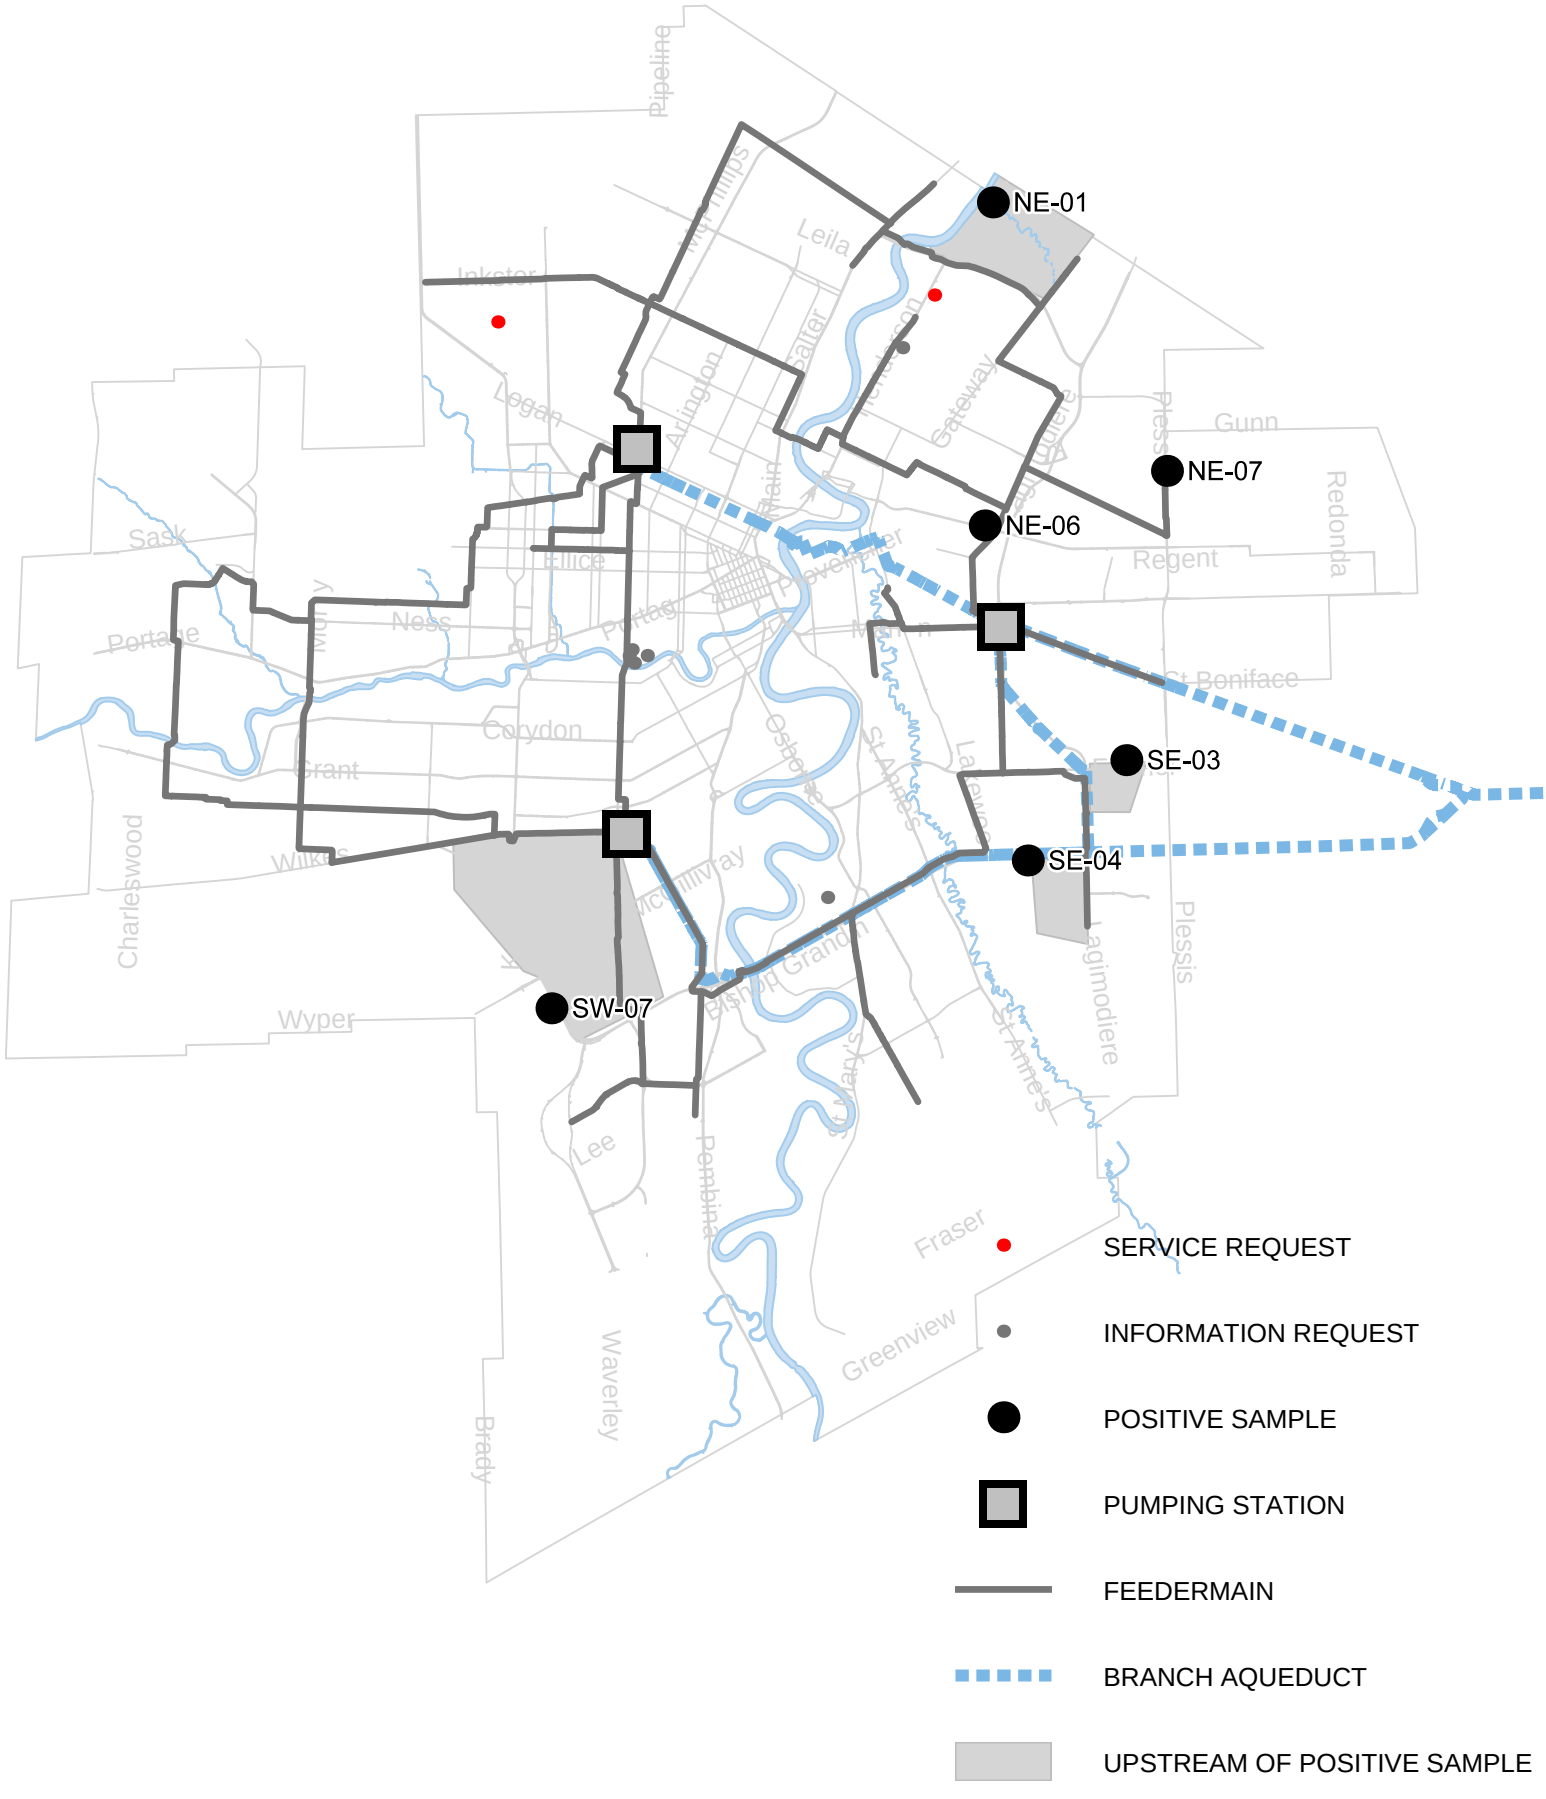

DISCOLORED WATER CALLS

JANUARY 17, 2015

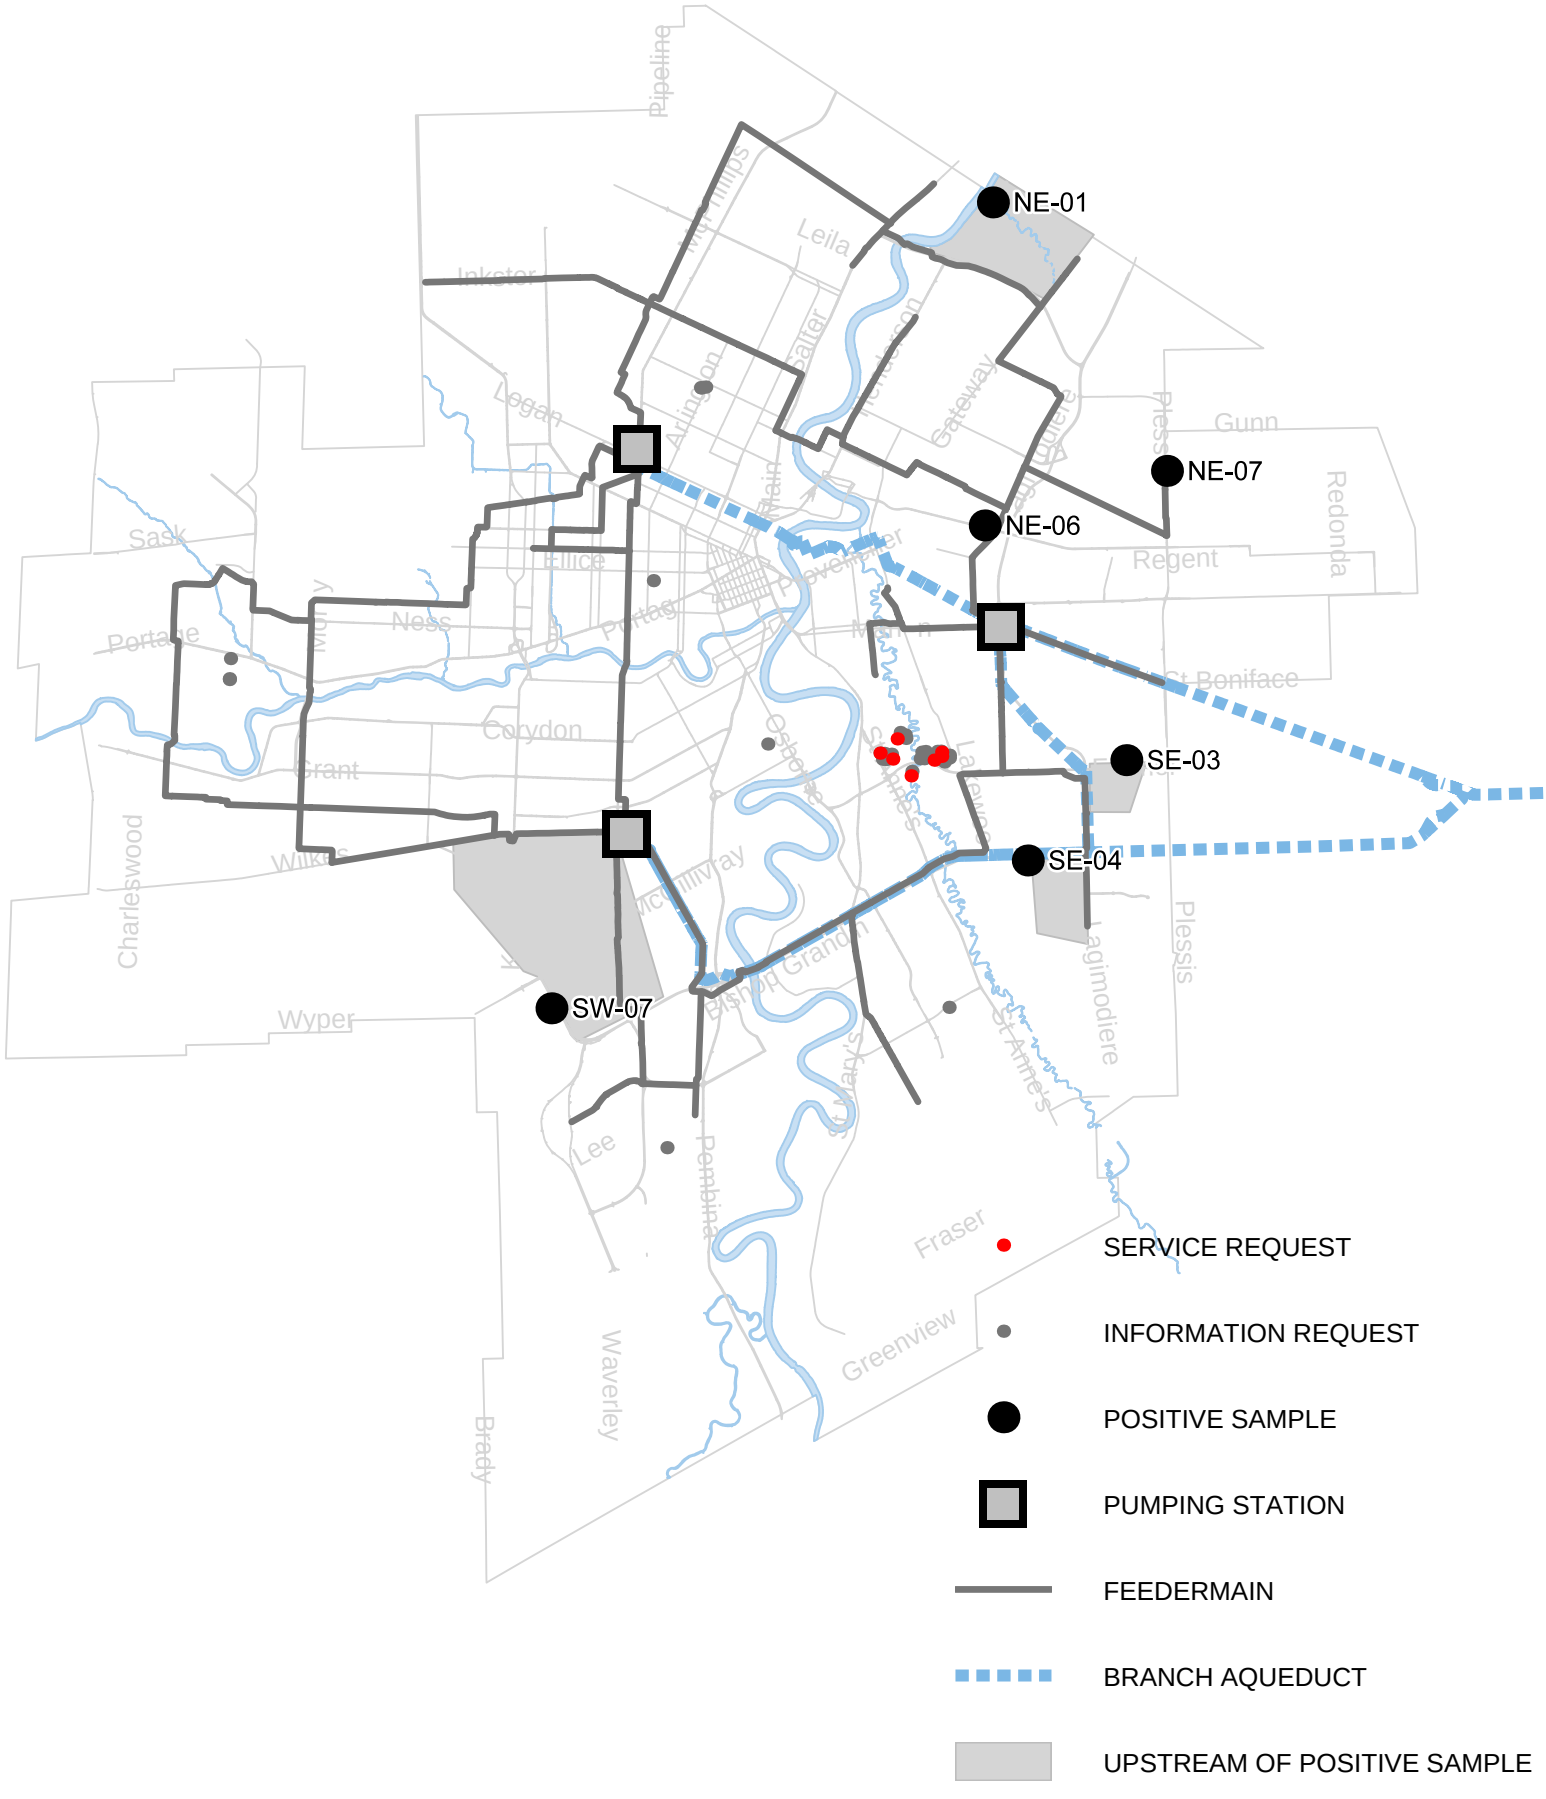

DISCOLORED WATER CALLS

JANUARY 18, 2015

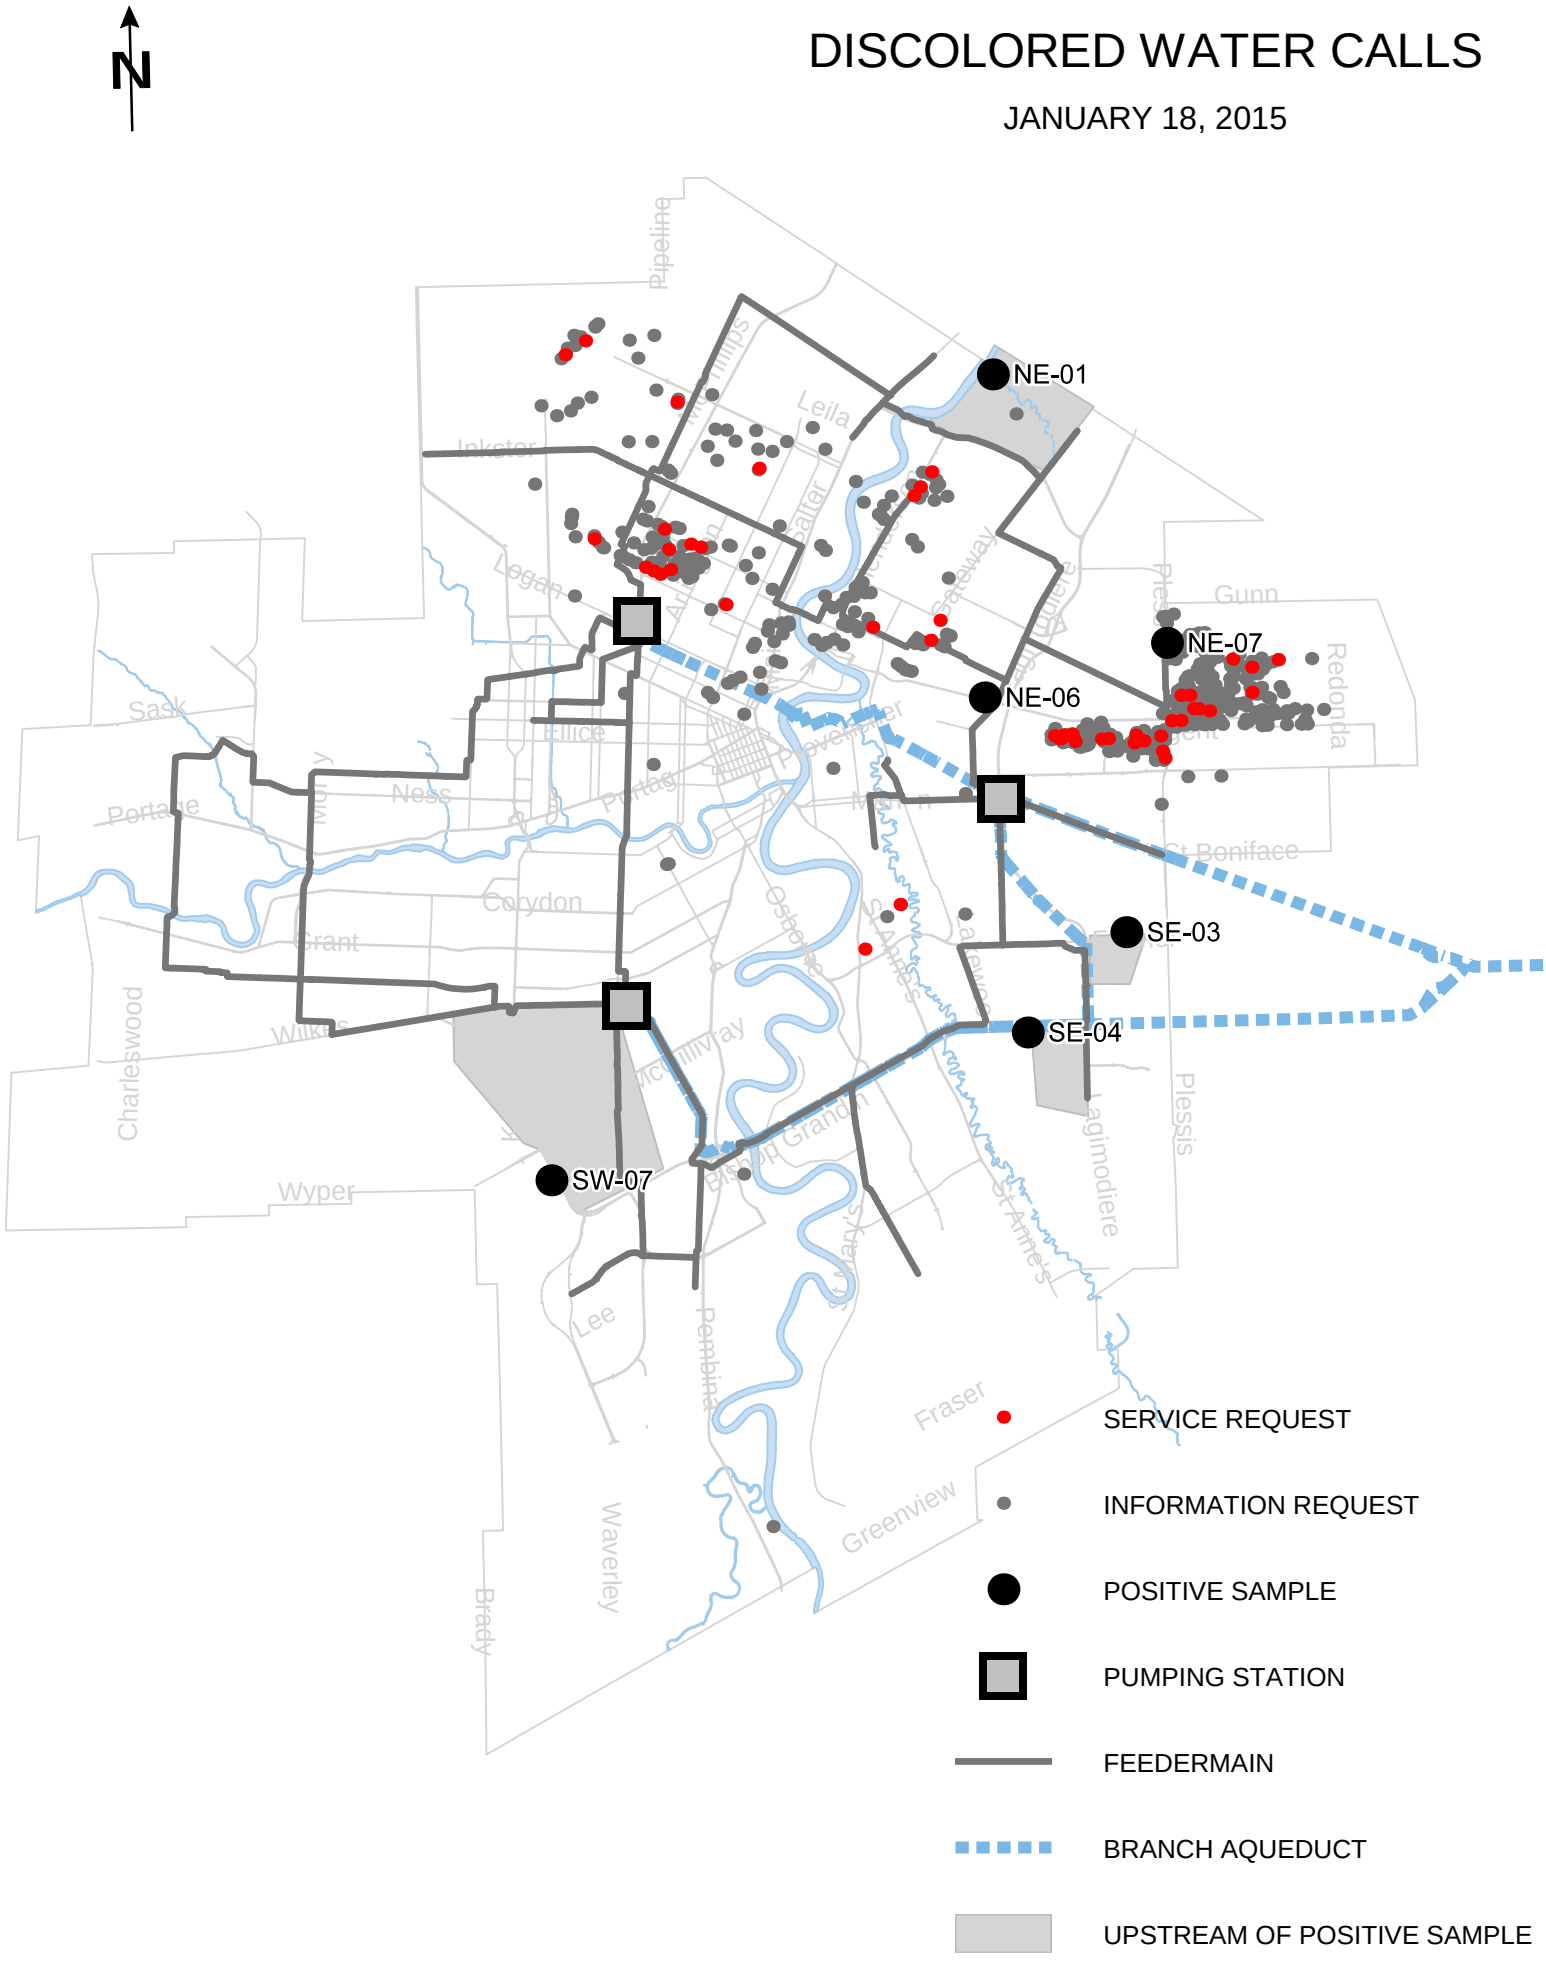

DISCOLORED WATER CALLS

JANUARY 19, 2015

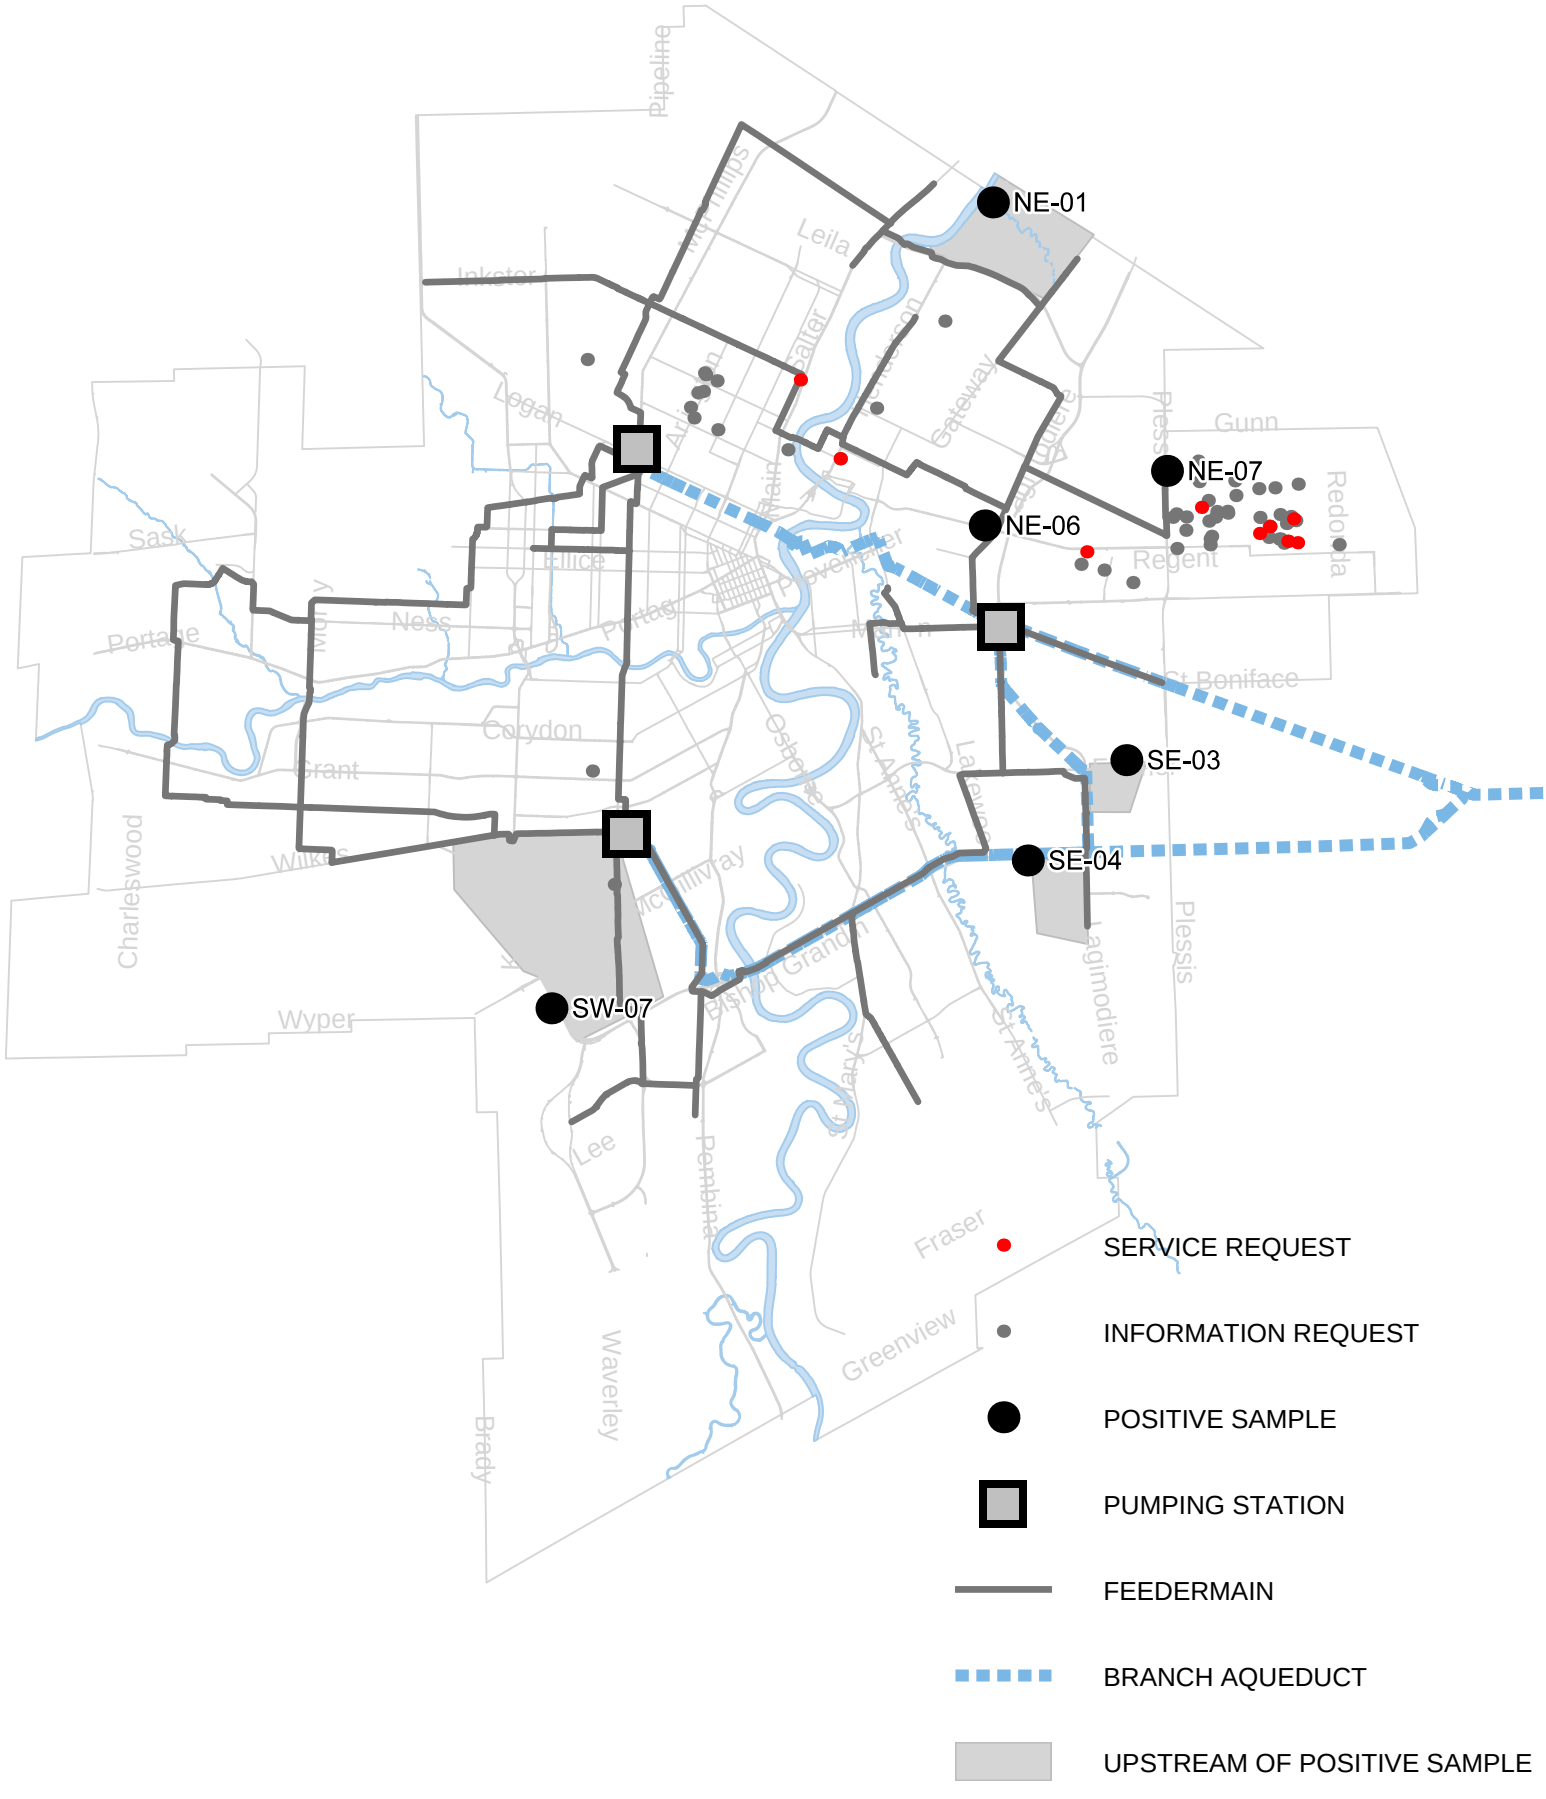

DISCOLORED WATER CALLS

JANUARY 20, 2015

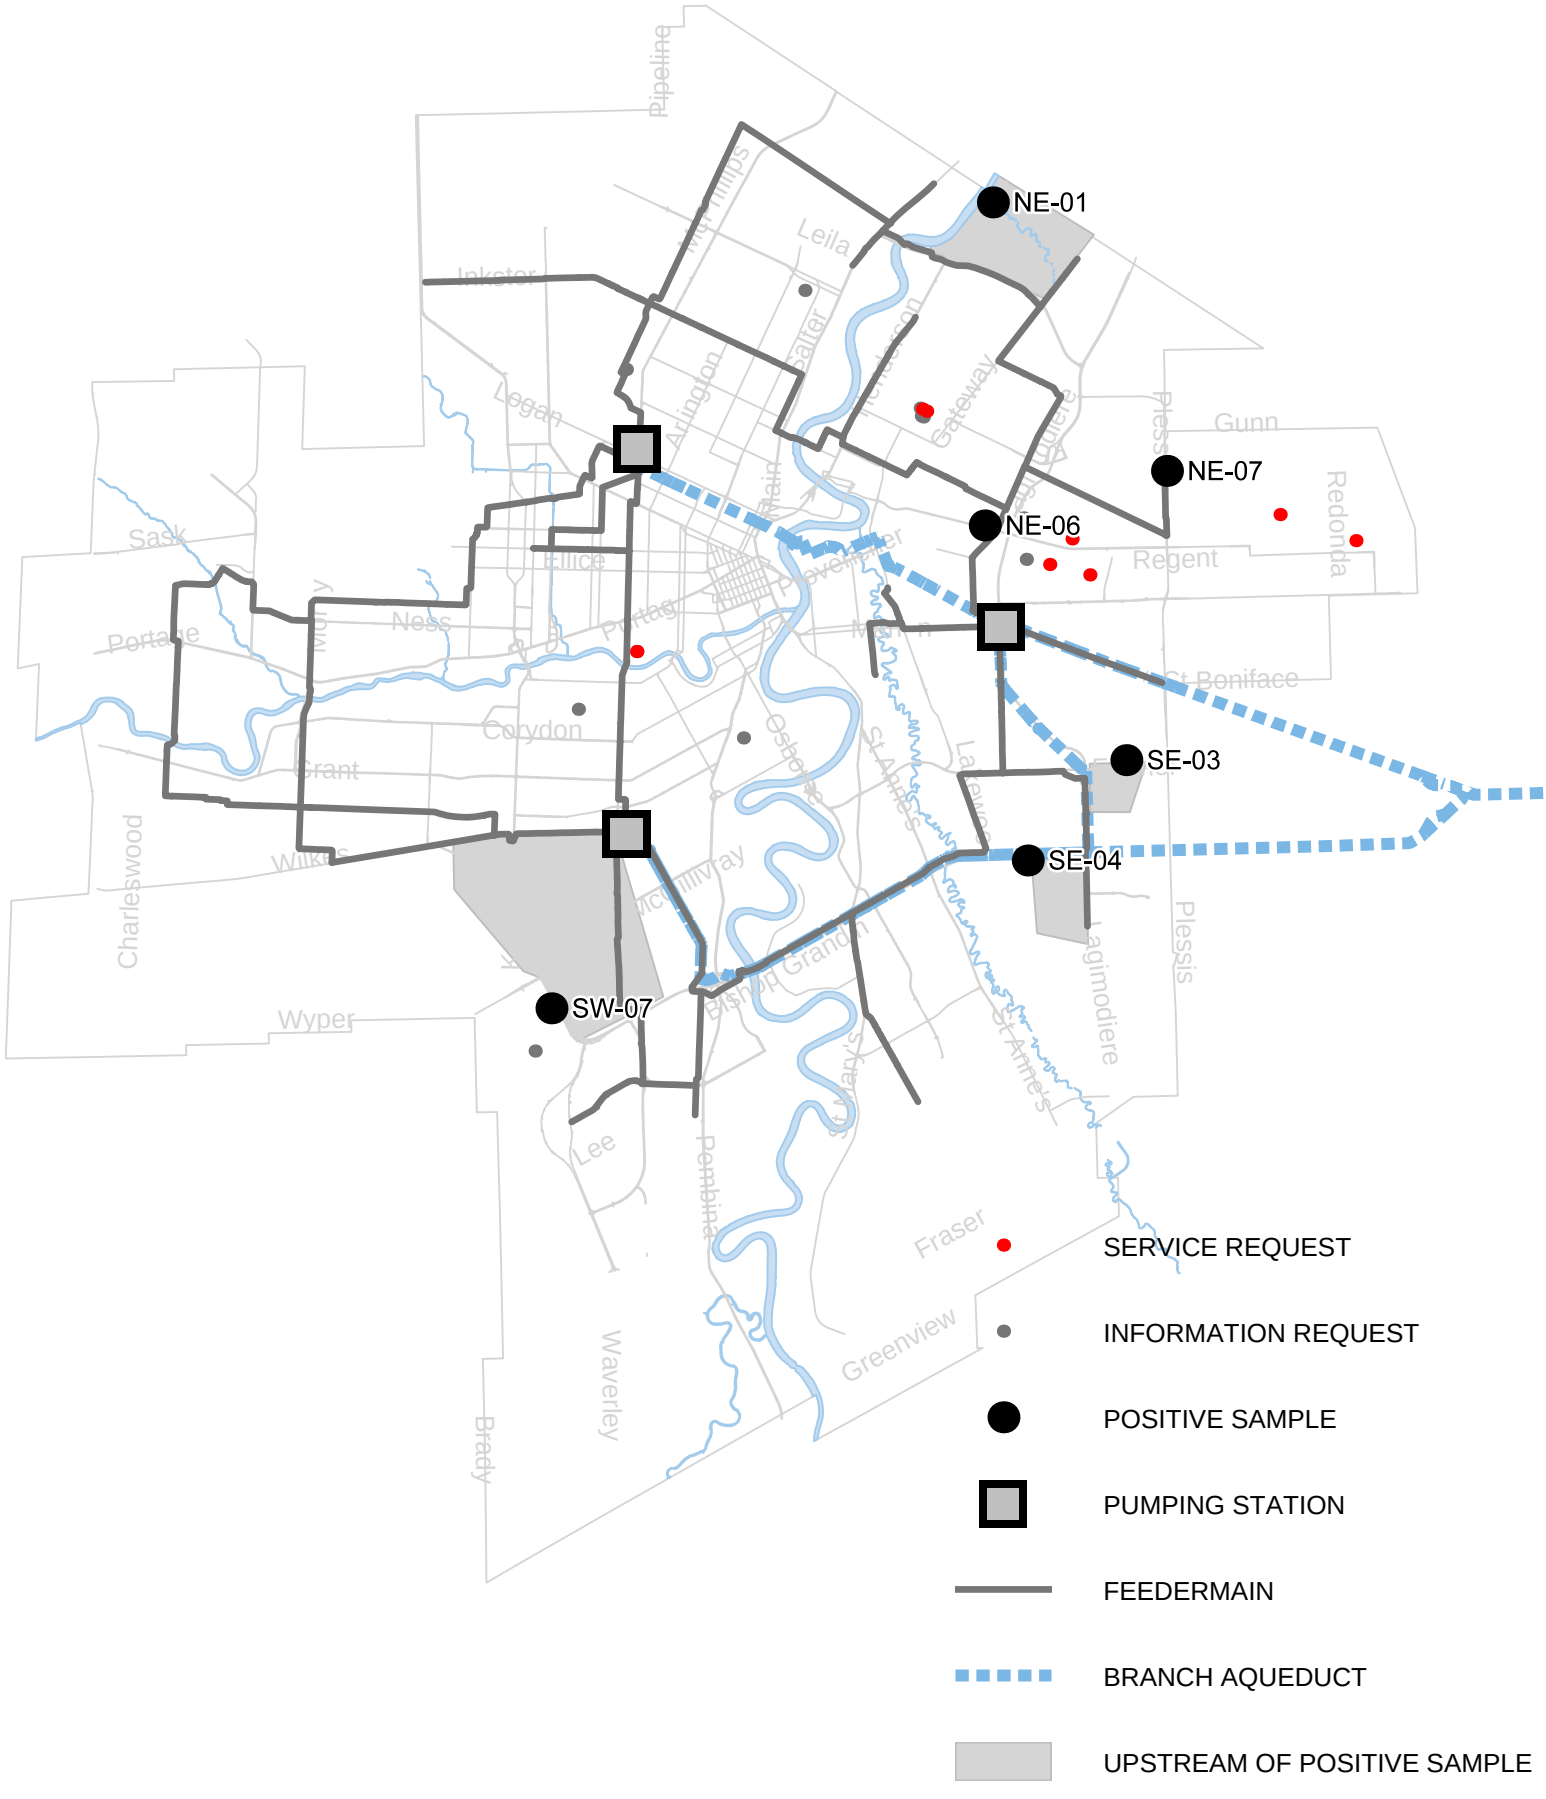

DISCOLORED WATER CALLS

JANUARY 21, 2015

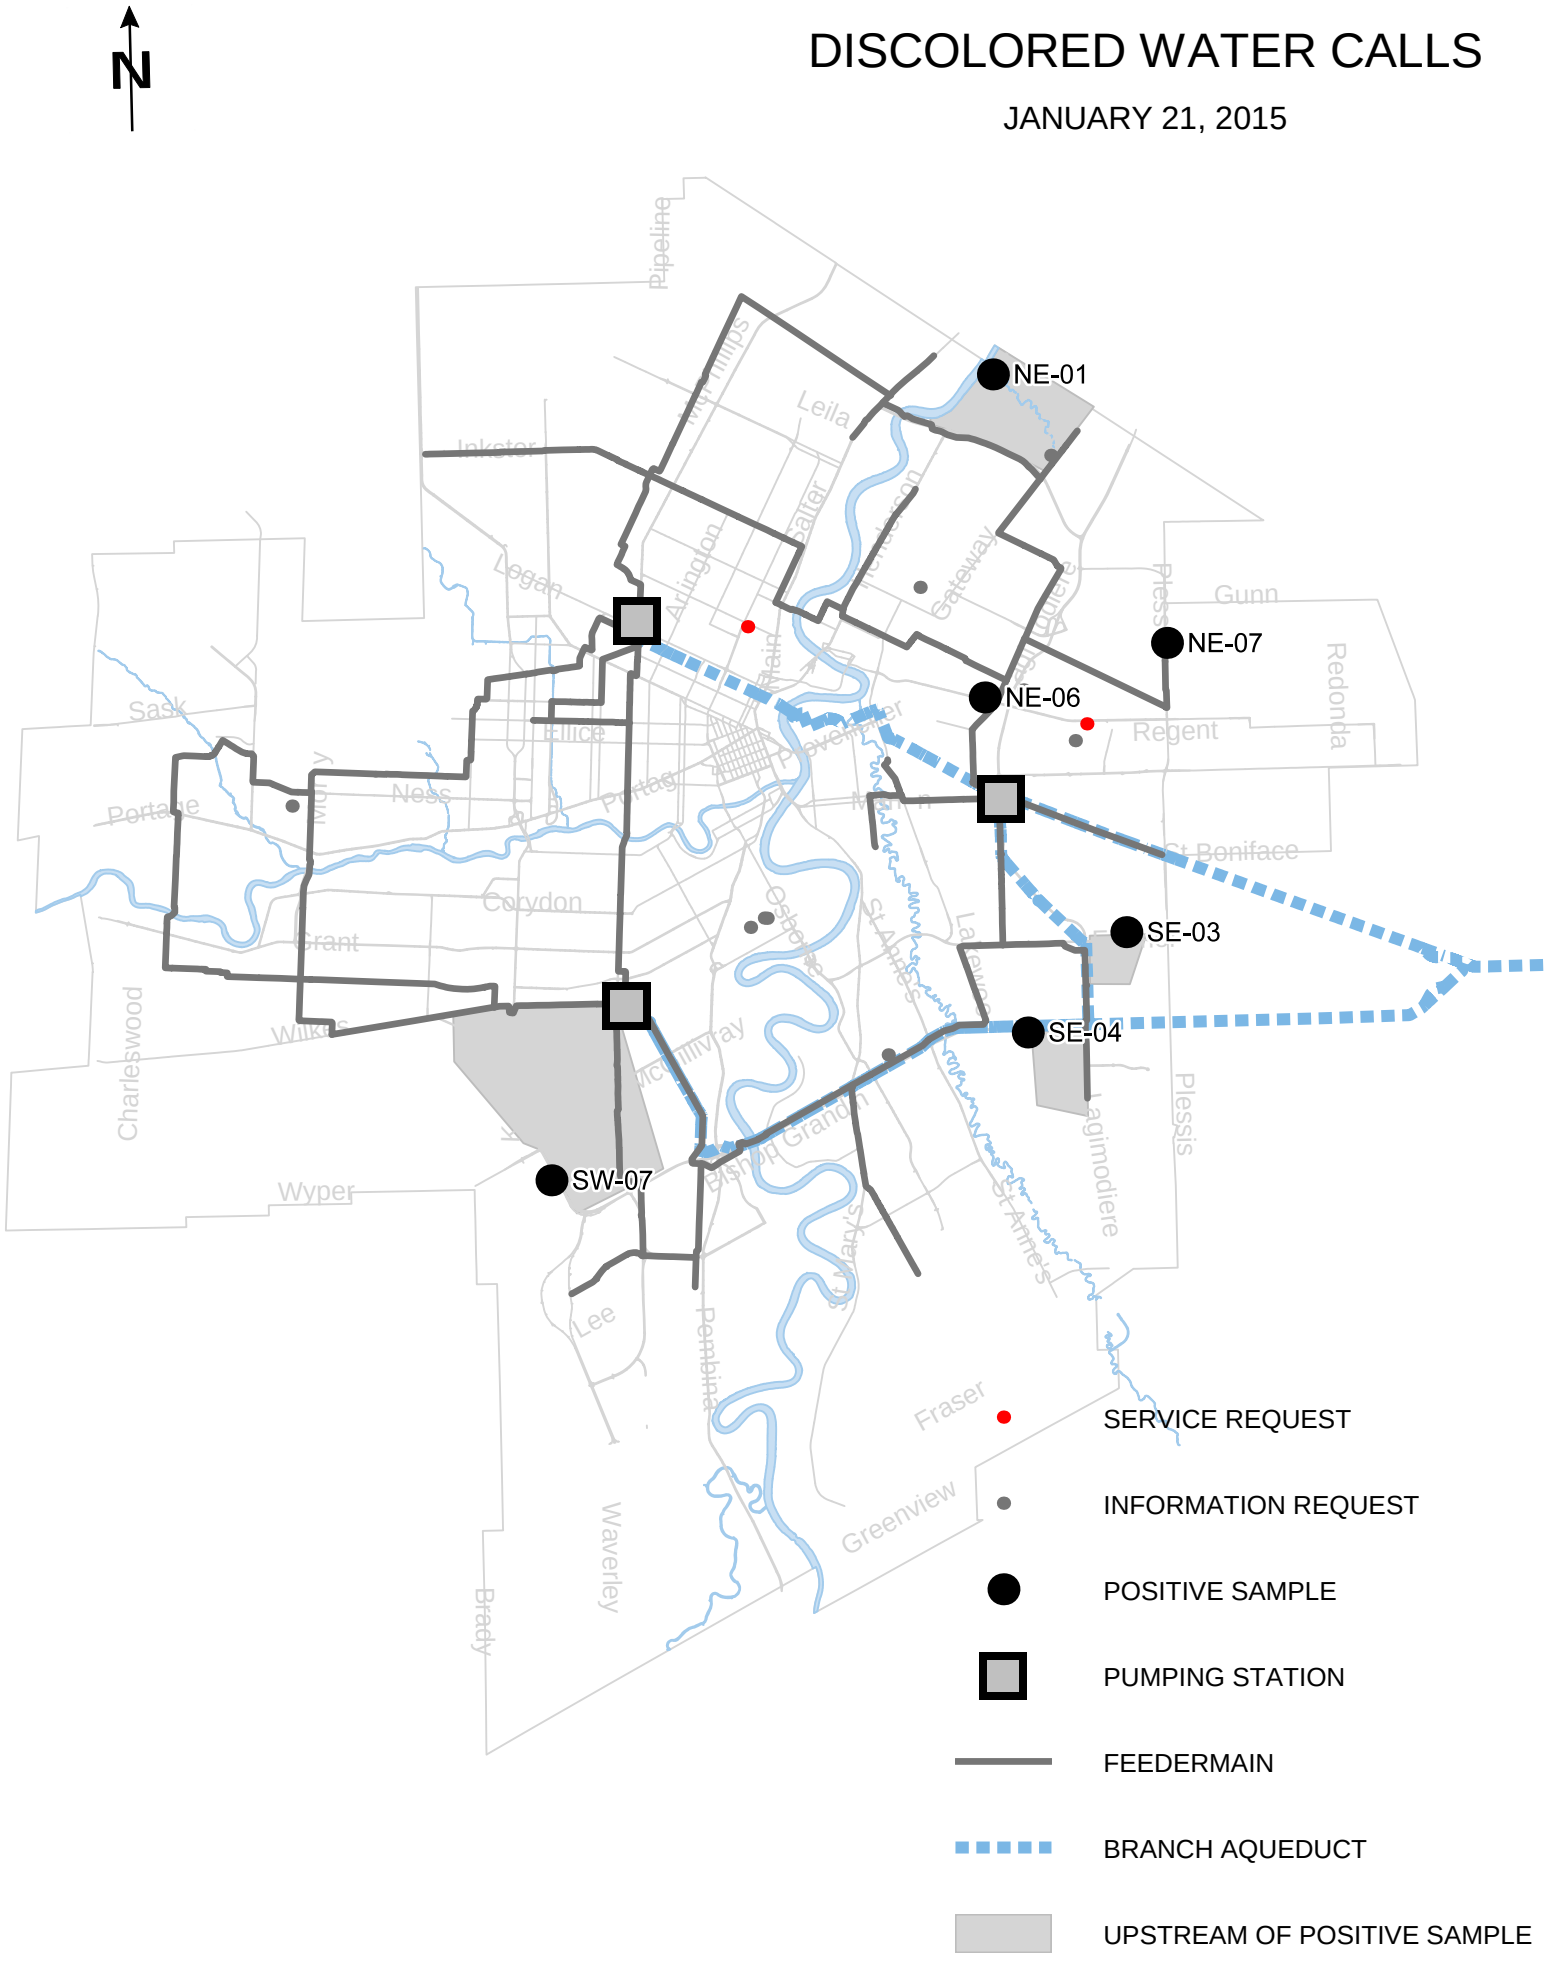

DISCOLORED WATER CALLS

JANUARY 22, 2015

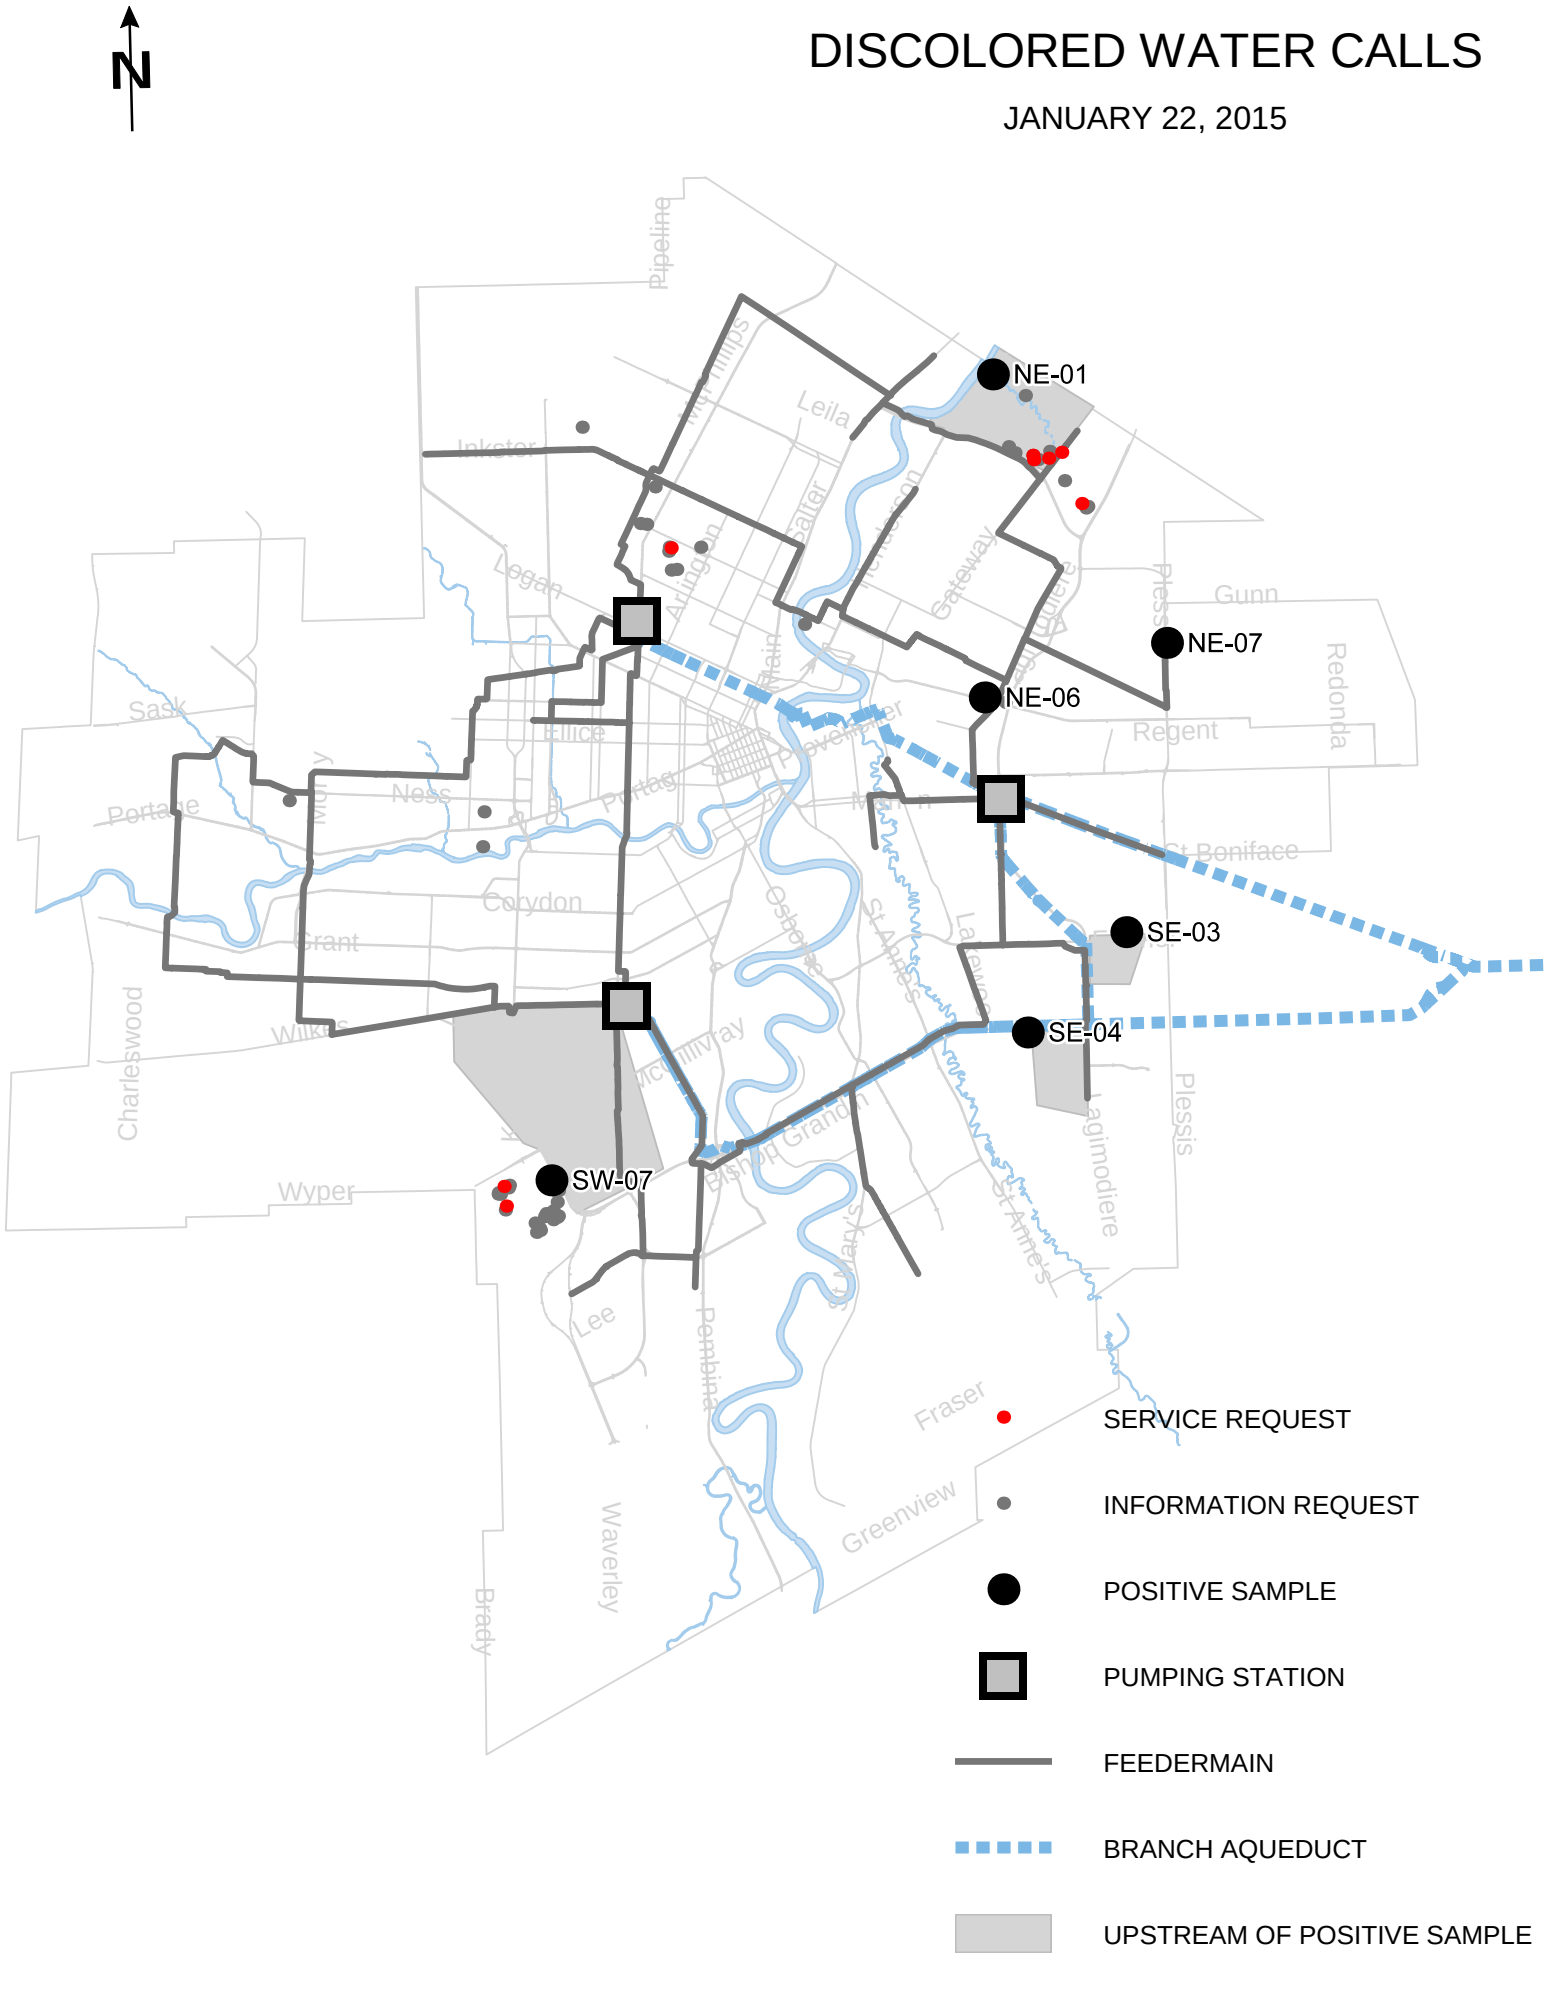

DISCOLORED WATER CALLS

JANUARY 23, 2015

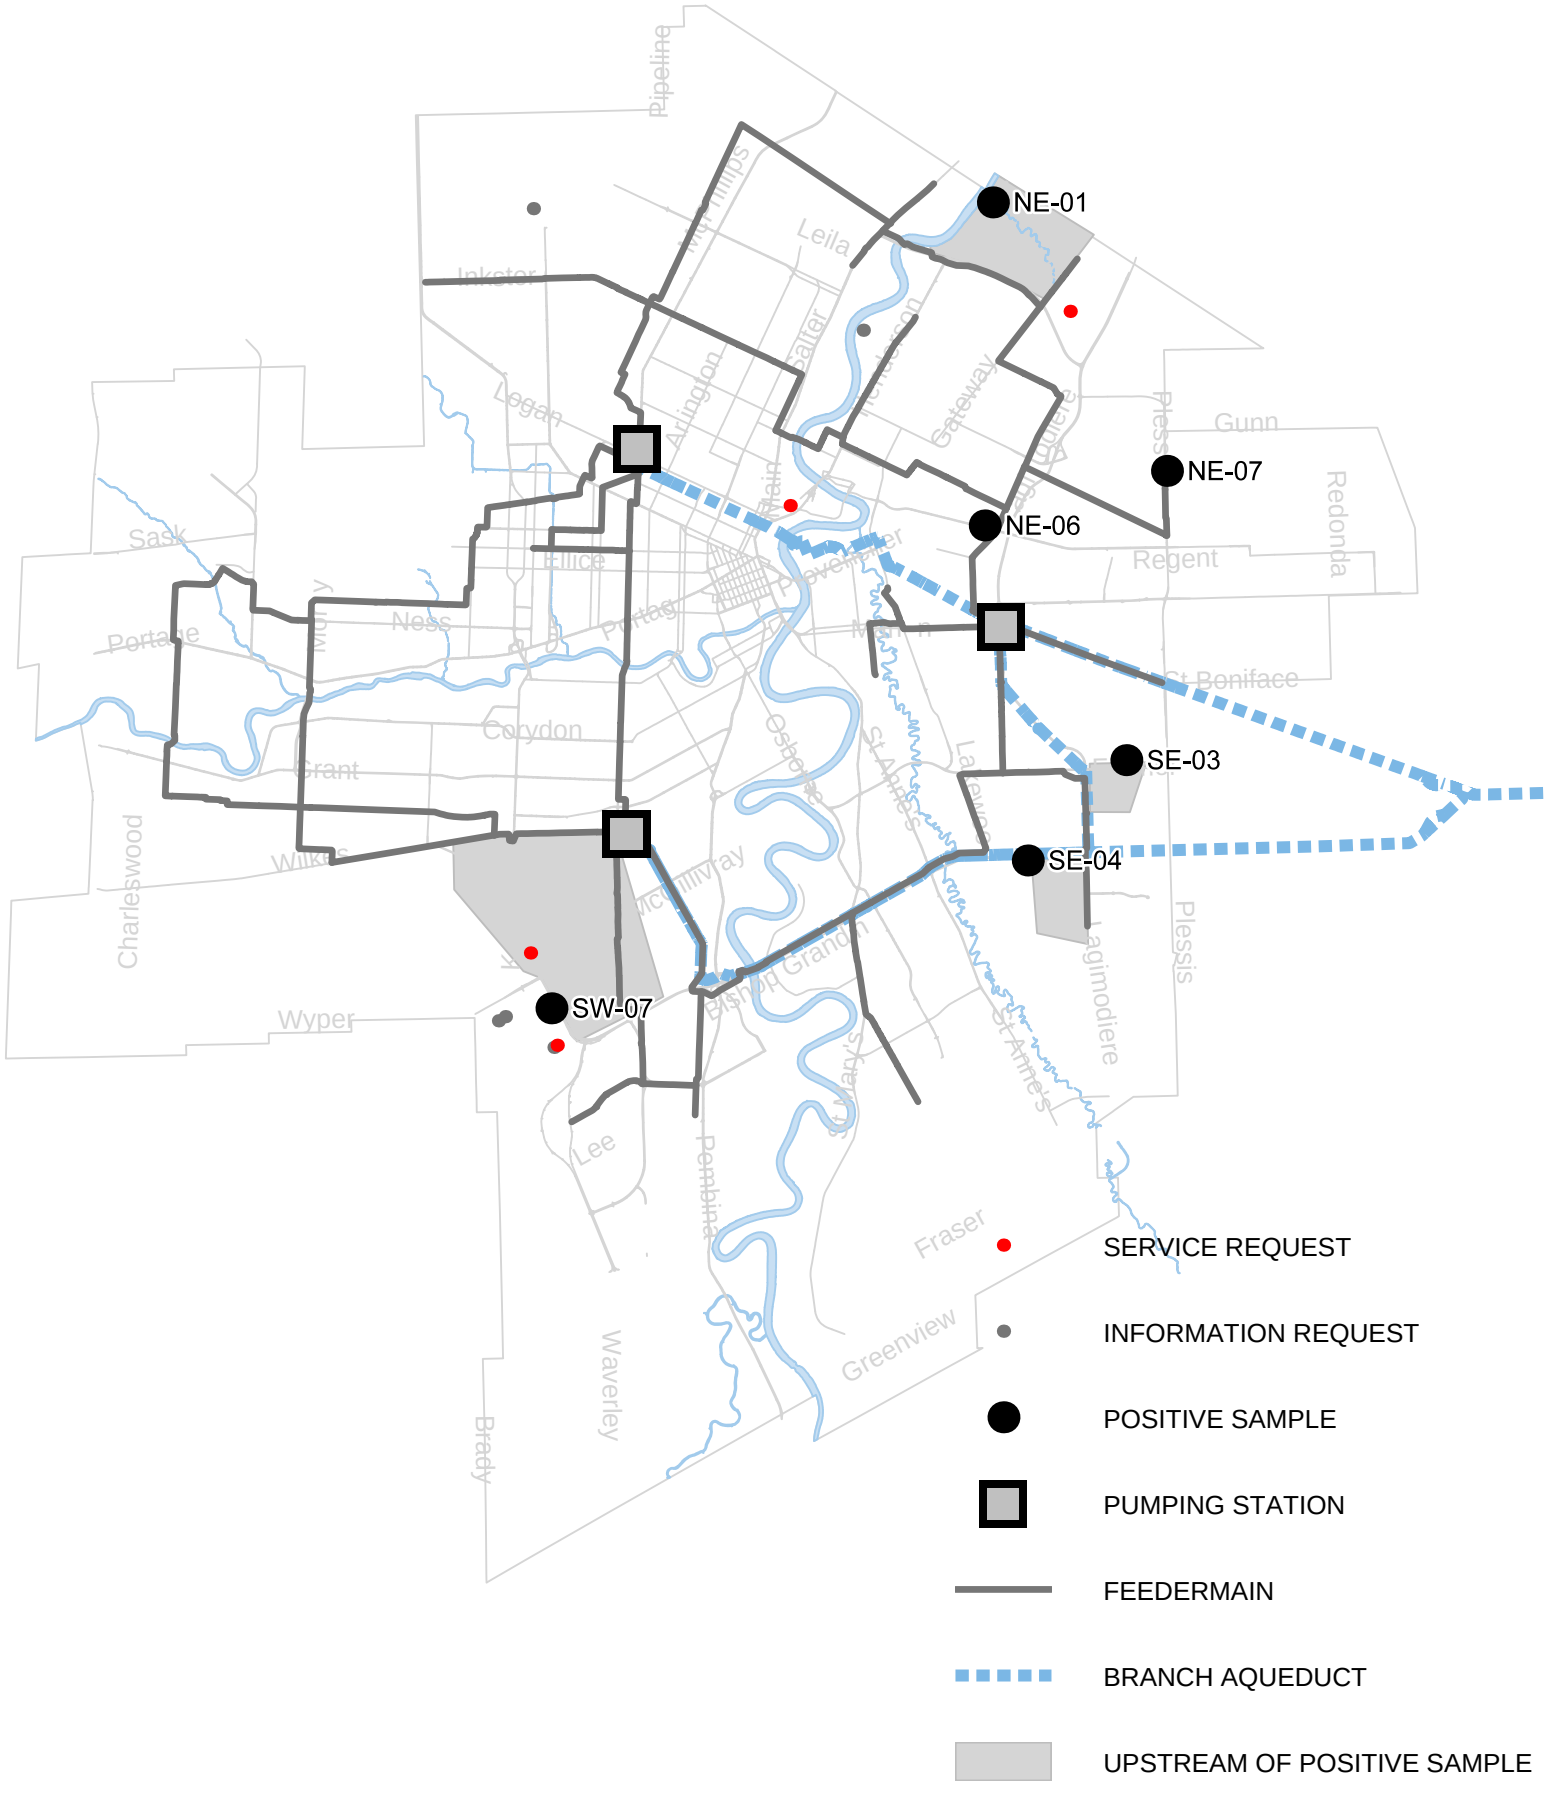

DISCOLORED WATER CALLS

JANUARY 24, 2015

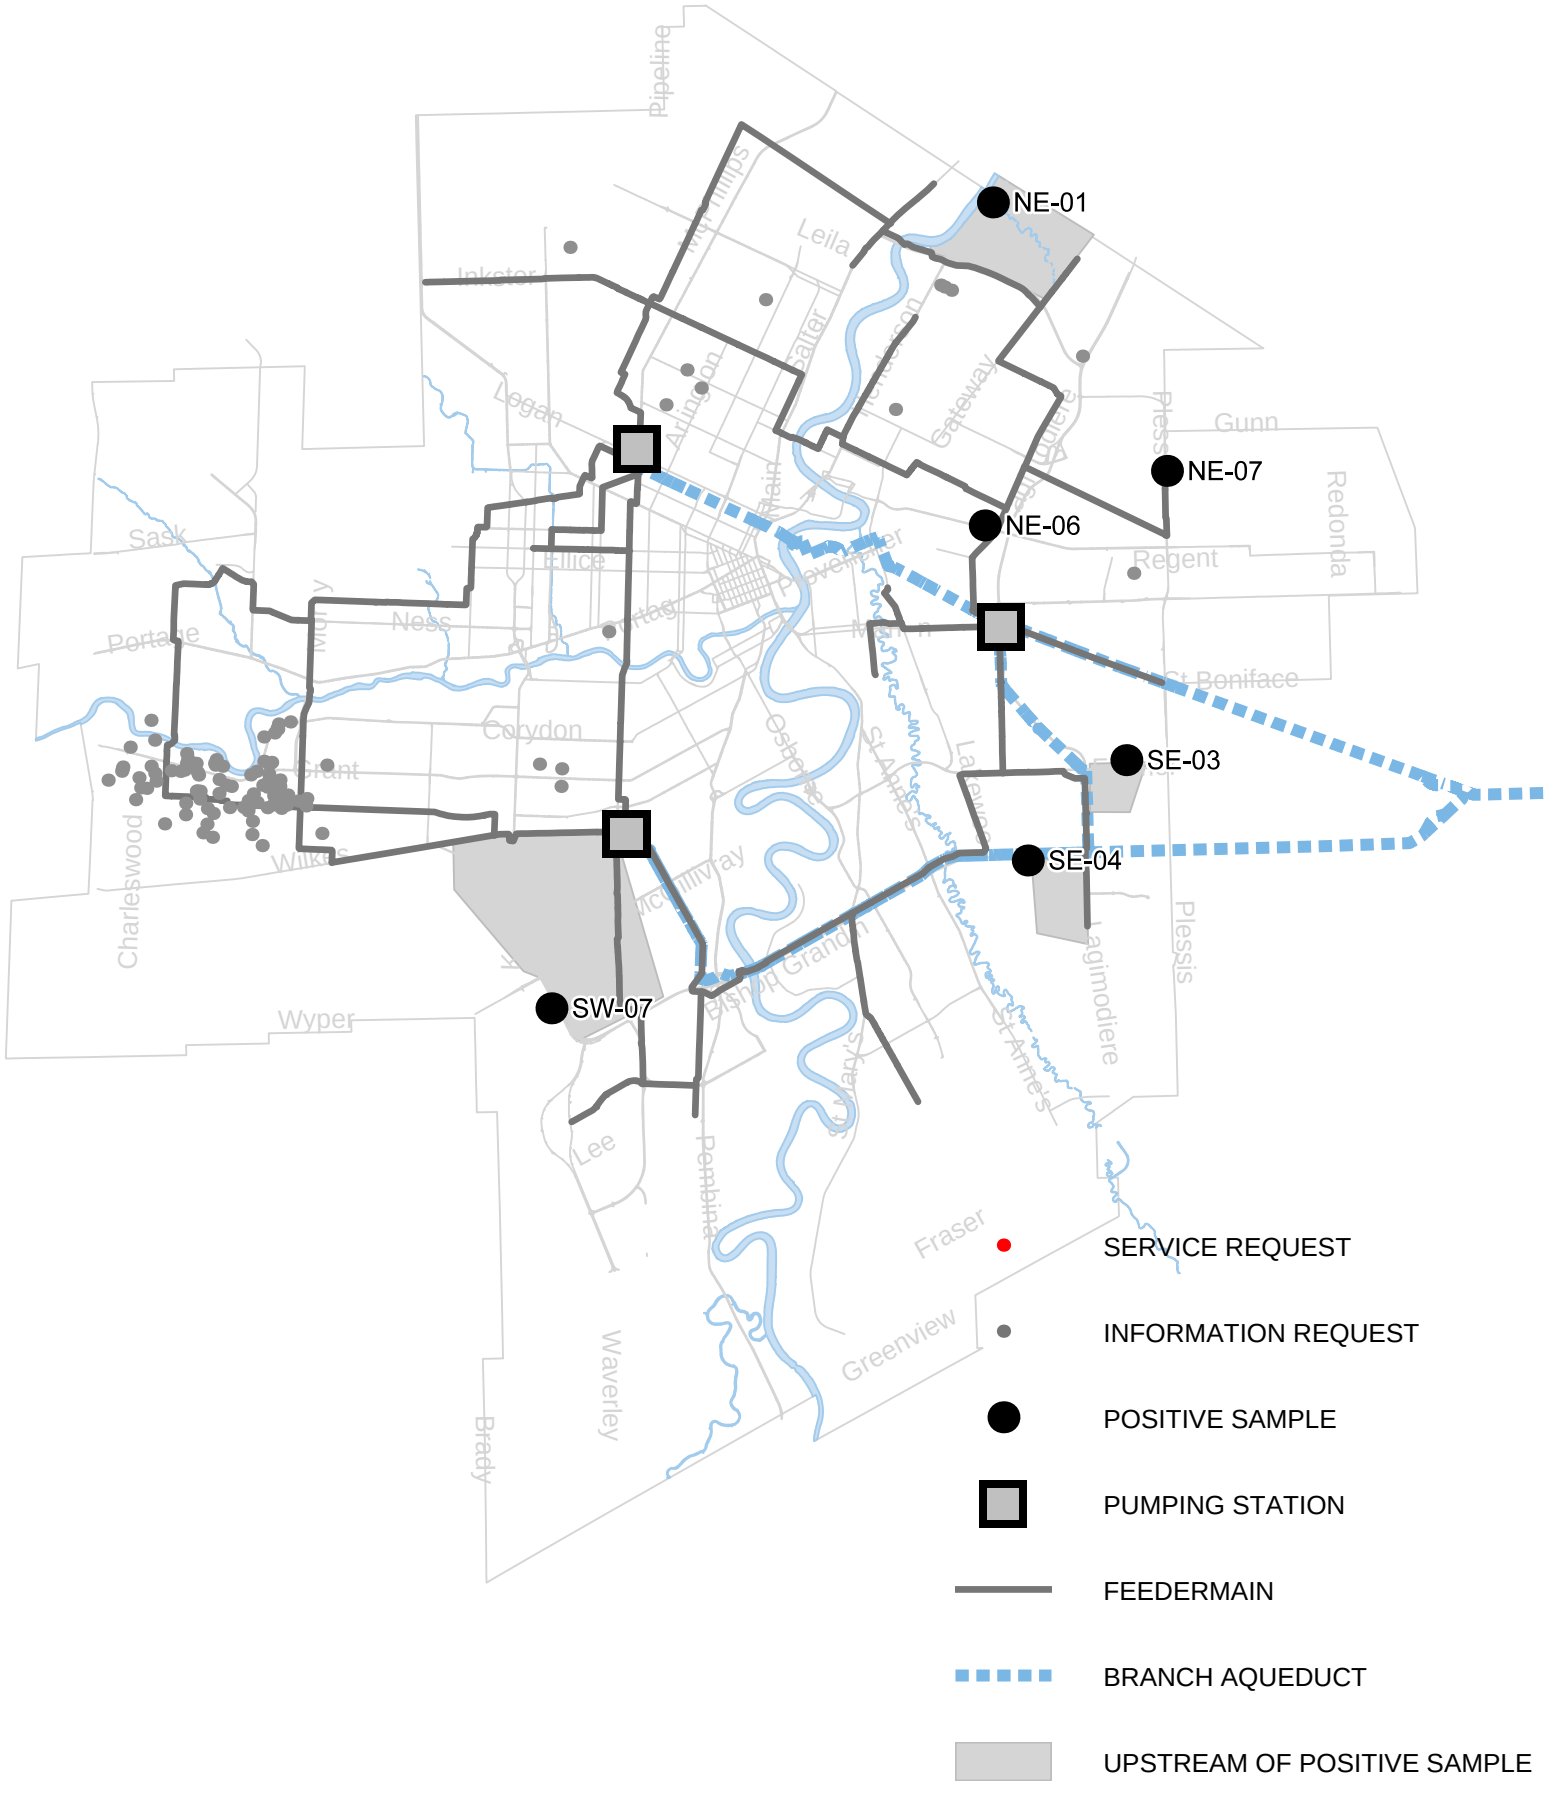

DISCOLORED WATER CALLS

JANUARY 25, 2015

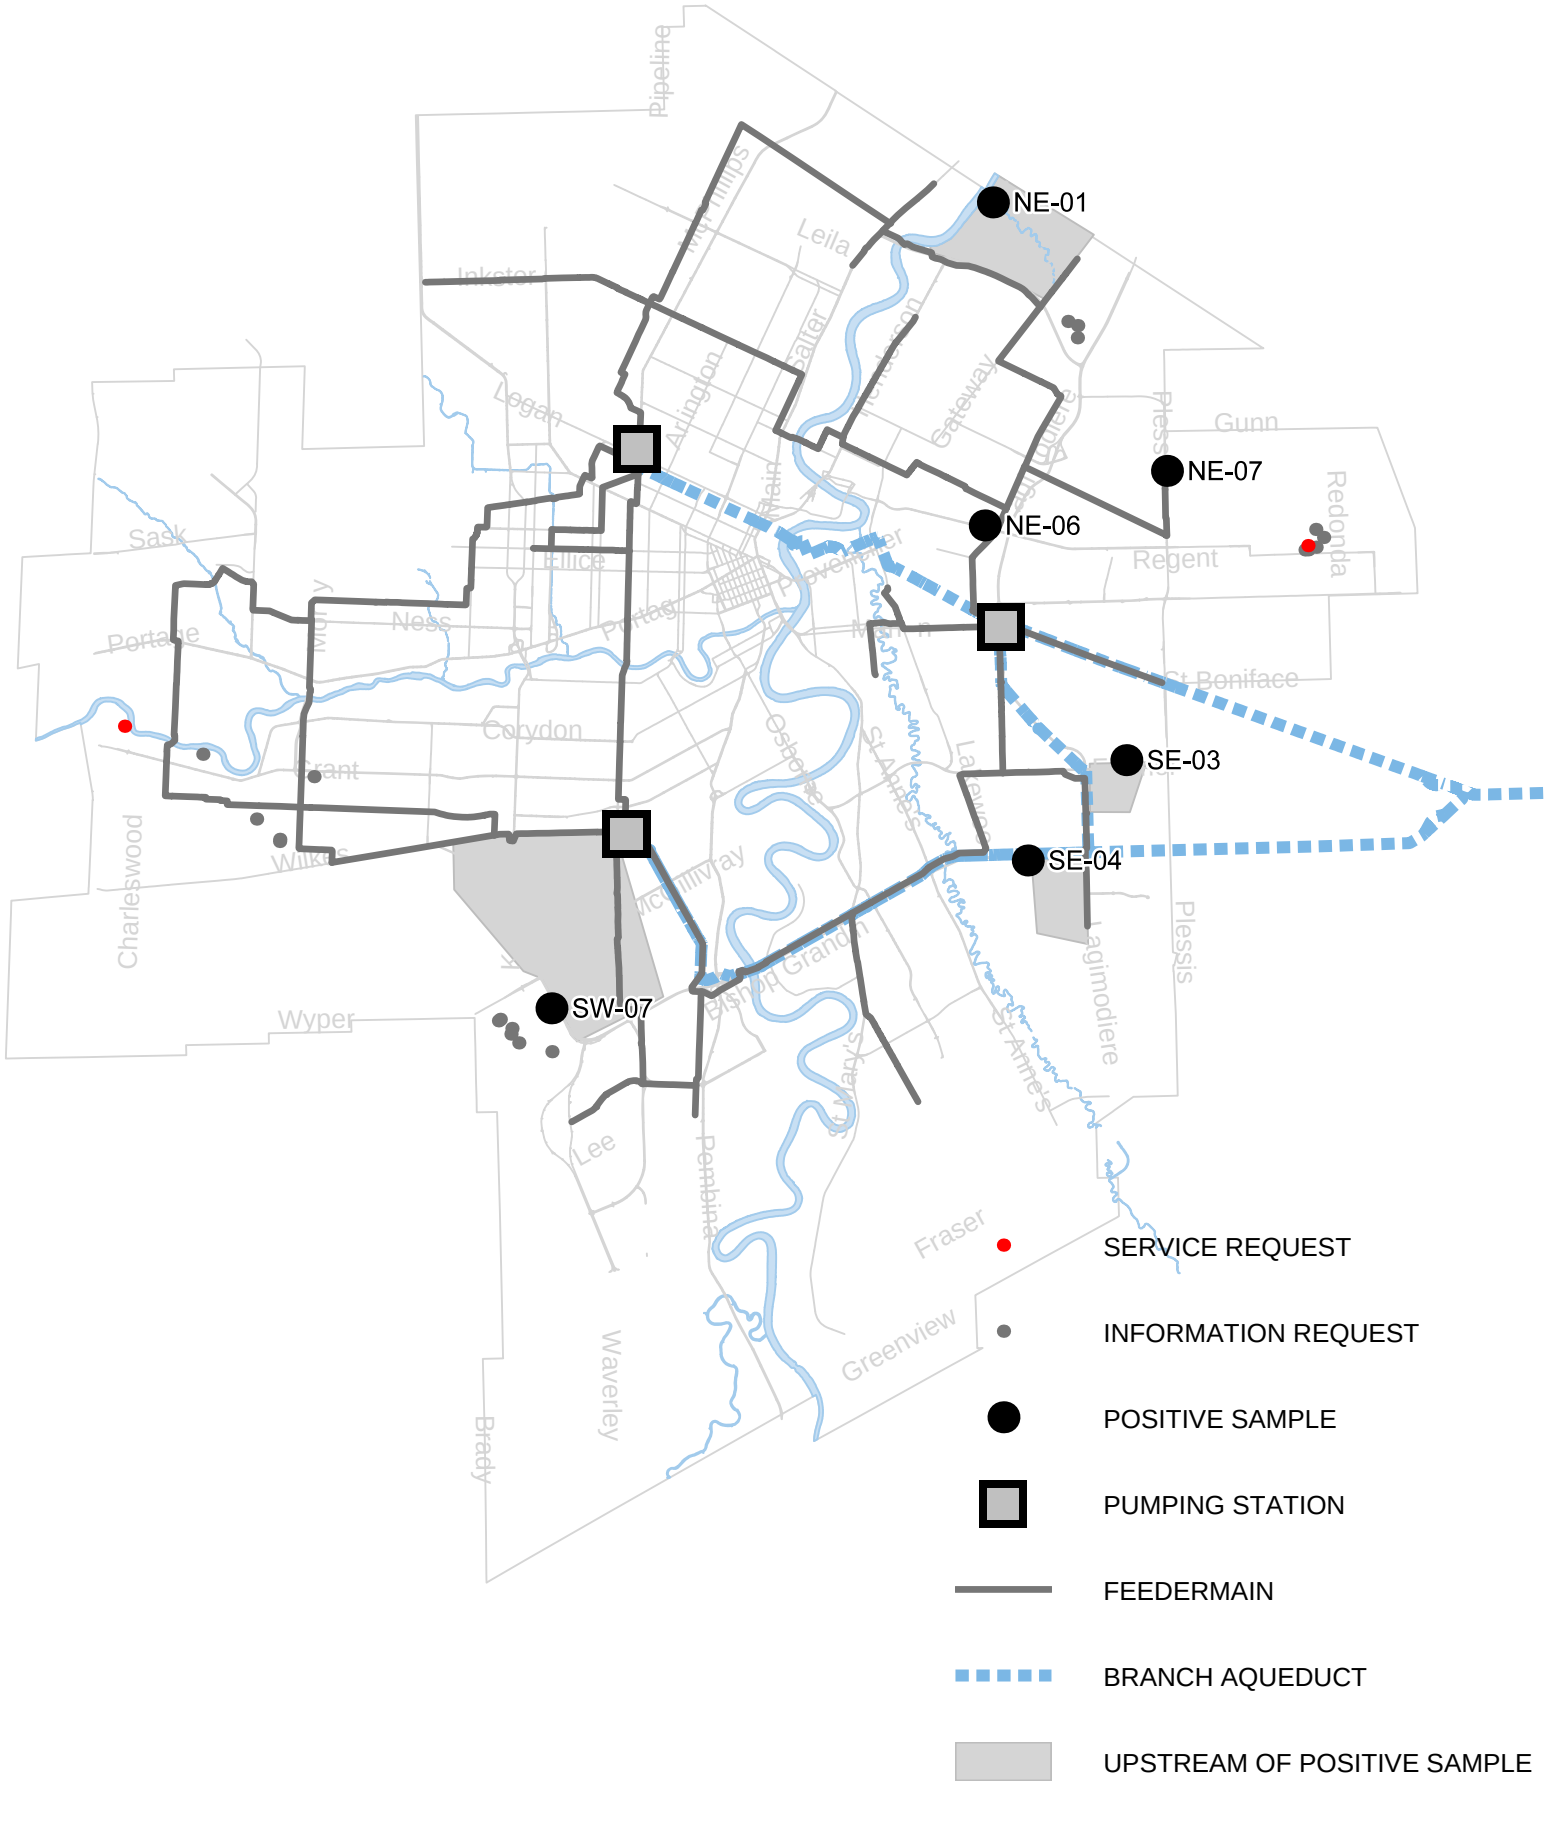

DISCOLORED WATER CALLS

JANUARY 26, 2015

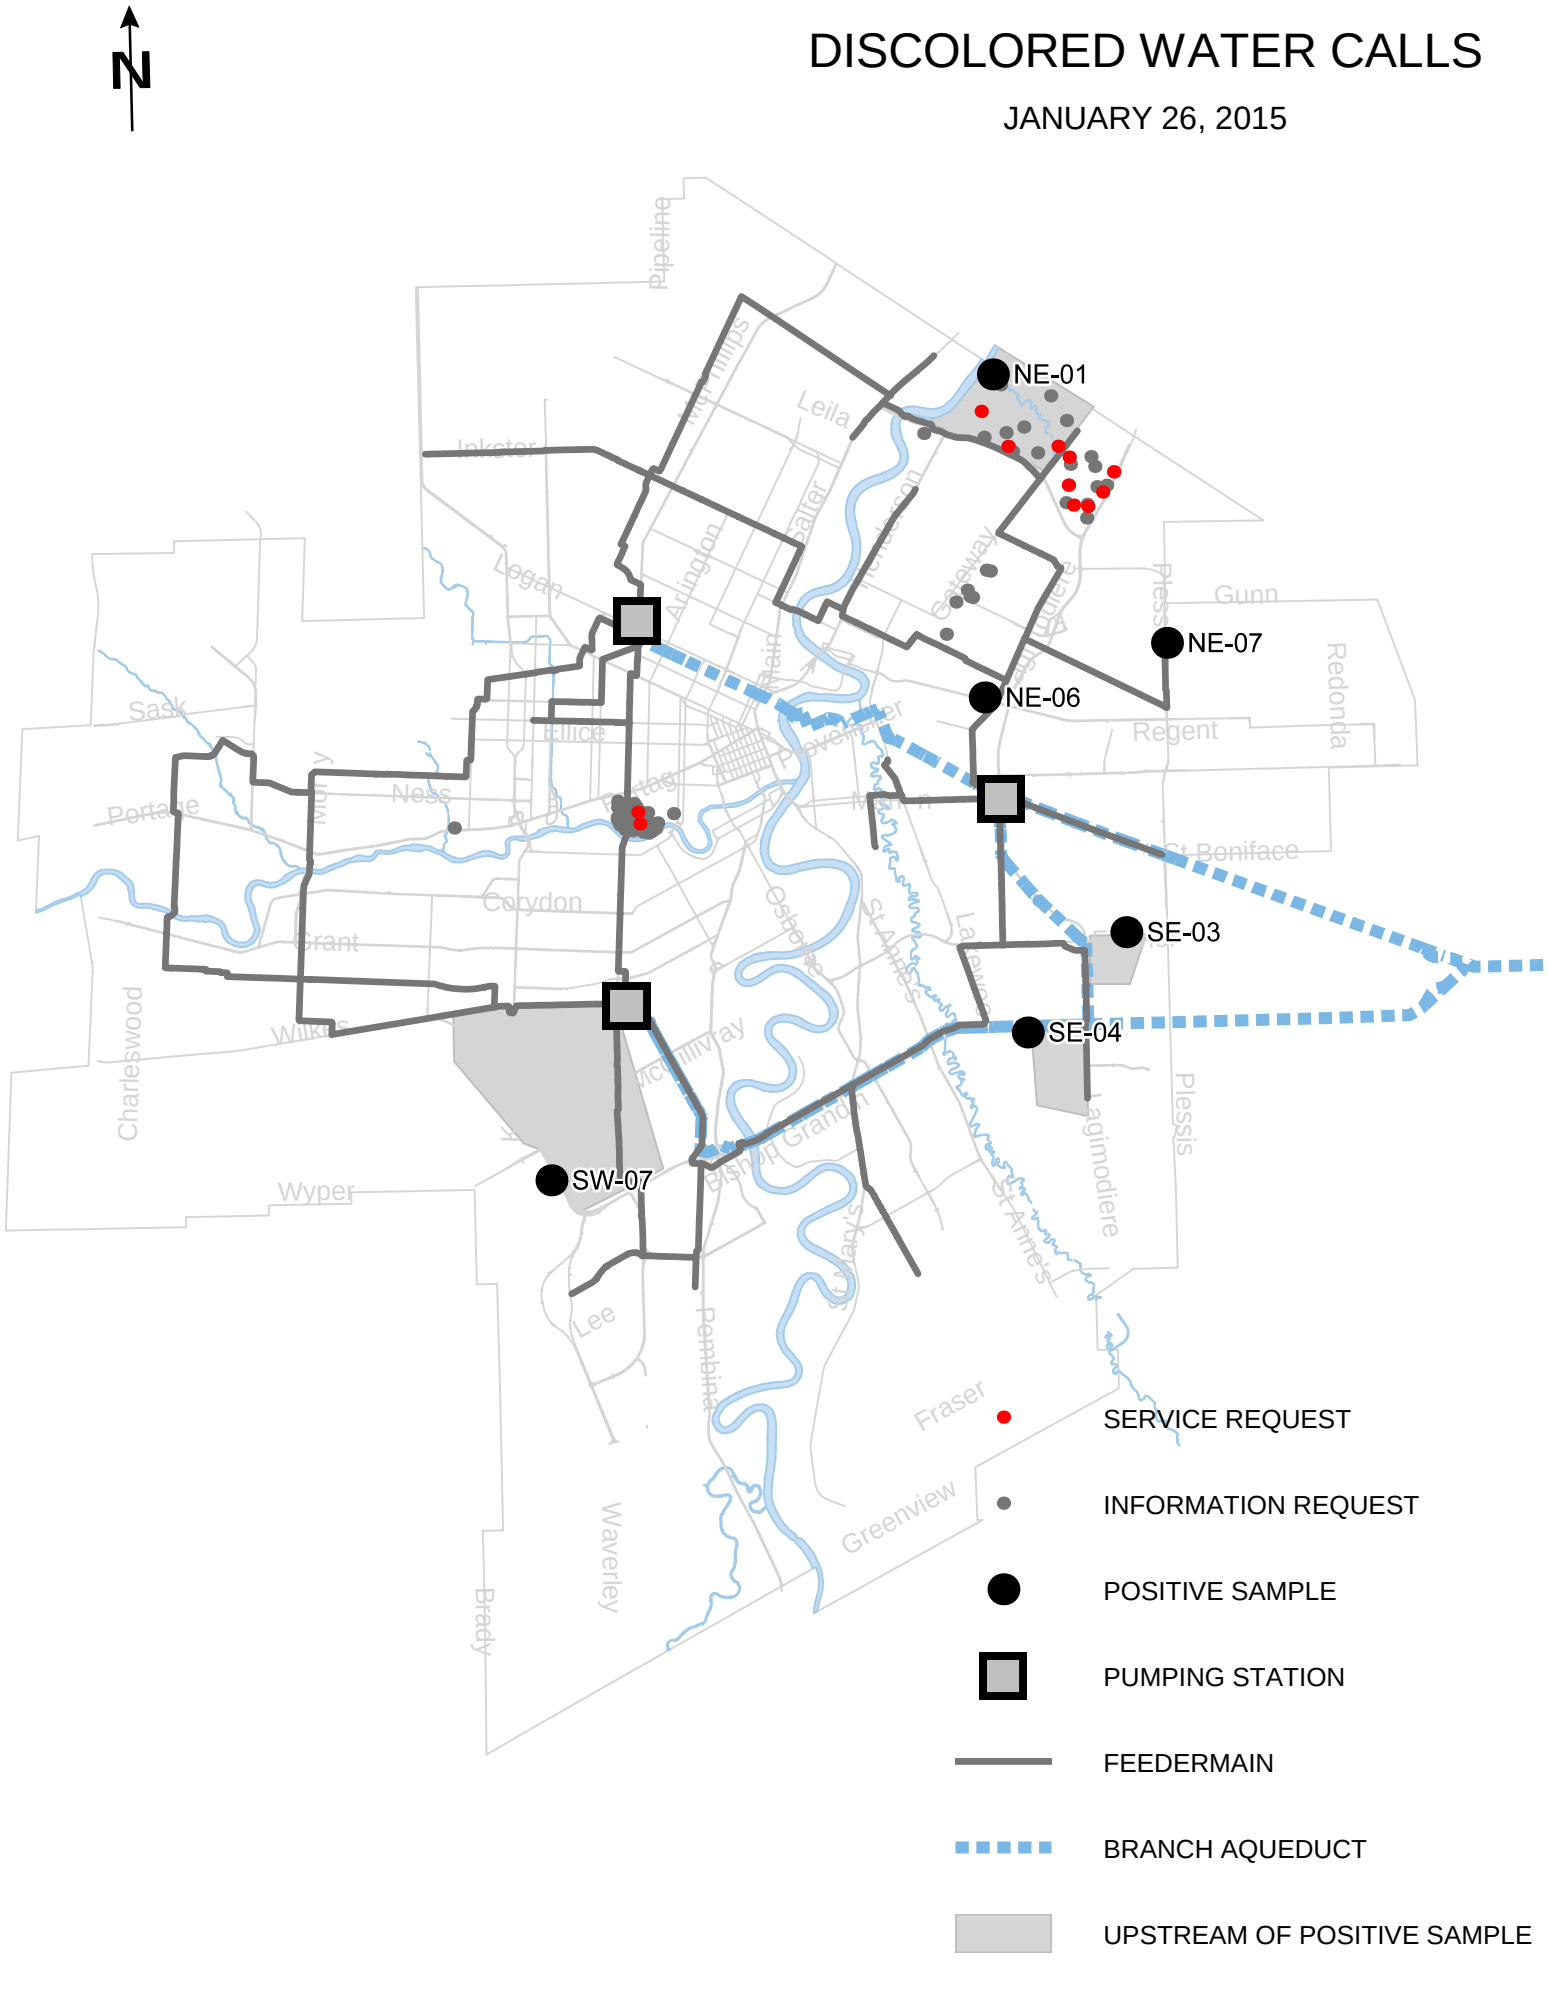

Appendix E

Operations and Maintenance Data (available in e-format upon request)

E1 Graphic Review of Collected Data

FEEDERMAIN FLOW DIRECTIONS

(with the North Kildonan Feeder Main closed
at the Red River Crossing)

JANUARY 26, 2015

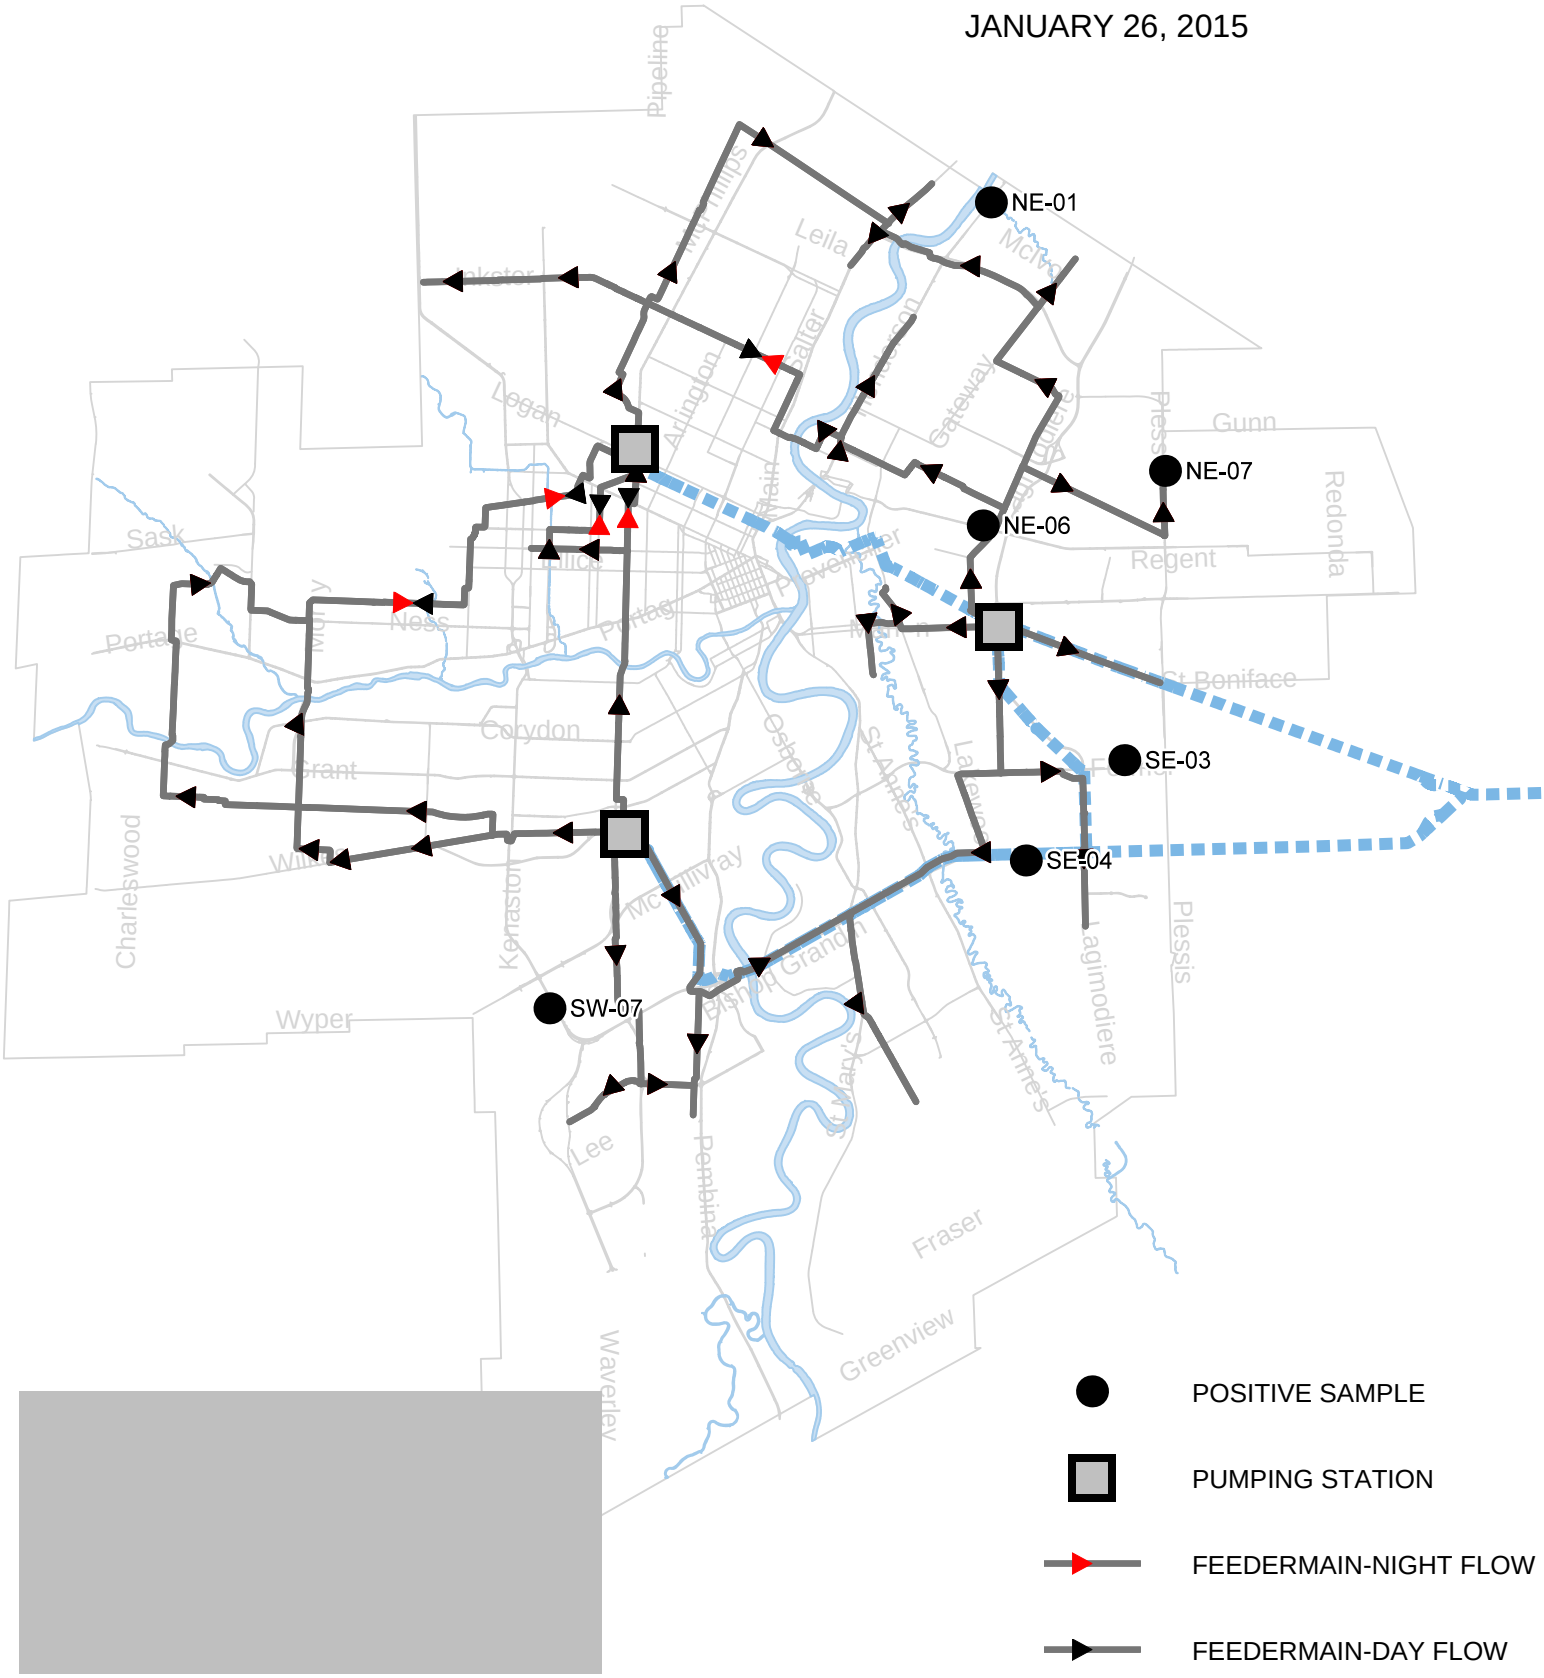

POSITIVE SAMPLE

PUMPING STATION

FEEDERMAIN-NIGHT FLOW

FEEDERMAIN-DAY FLOW

BRANCH AQUEDUCT

*Estimated water age measured
from MacLean Pumping Station

COMPLIANCE SAMPLE LOCATIONS

JANUARY 26, 2015

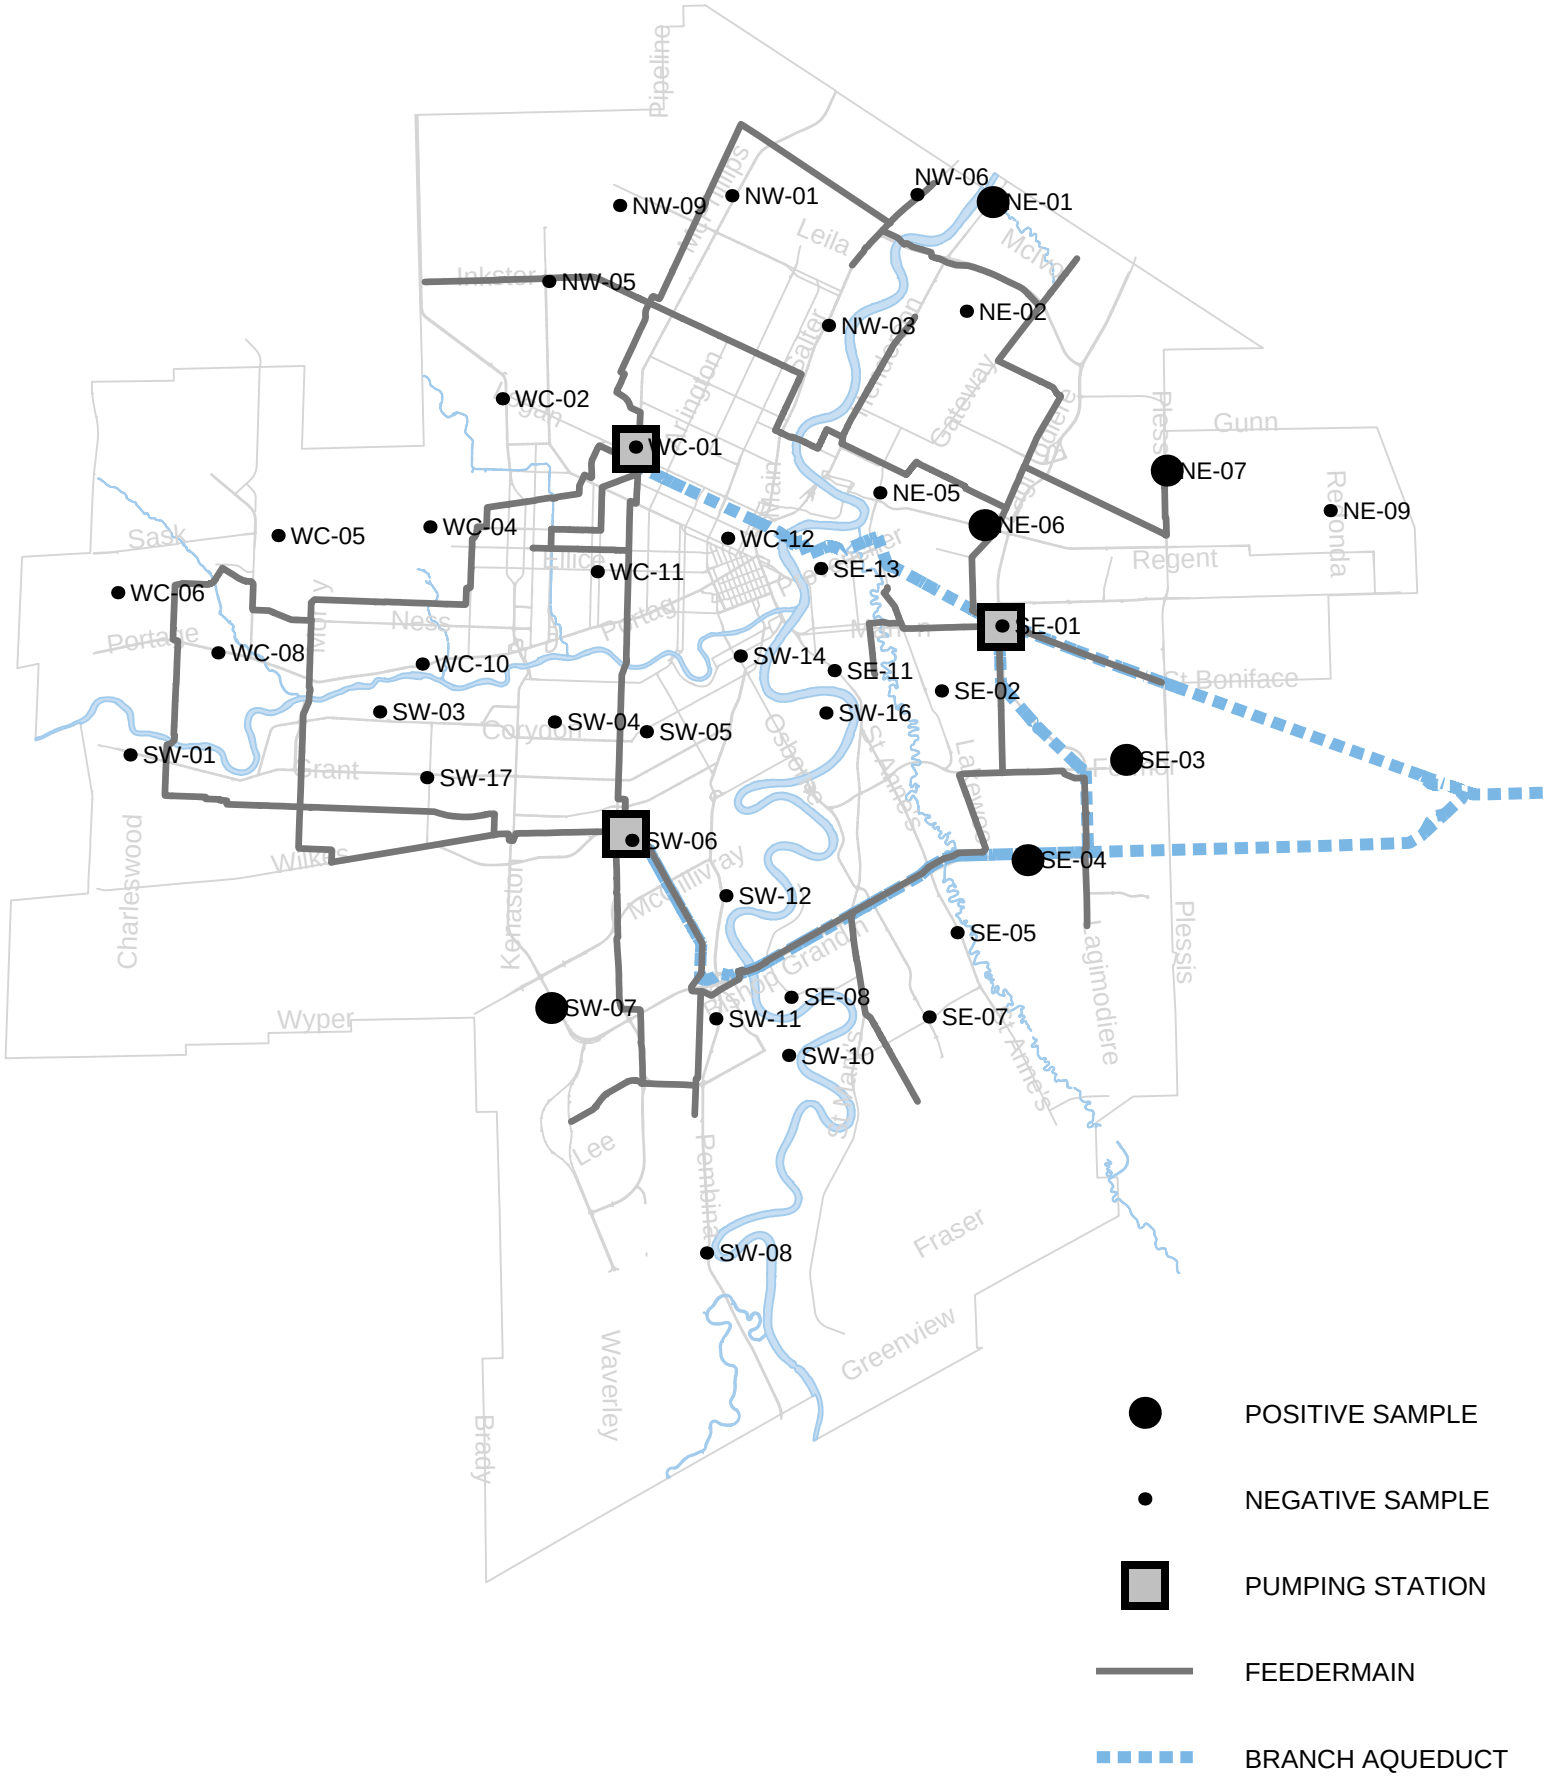

COMPLIANCE SAMPLE LOCATIONS

MAY 26, 2014

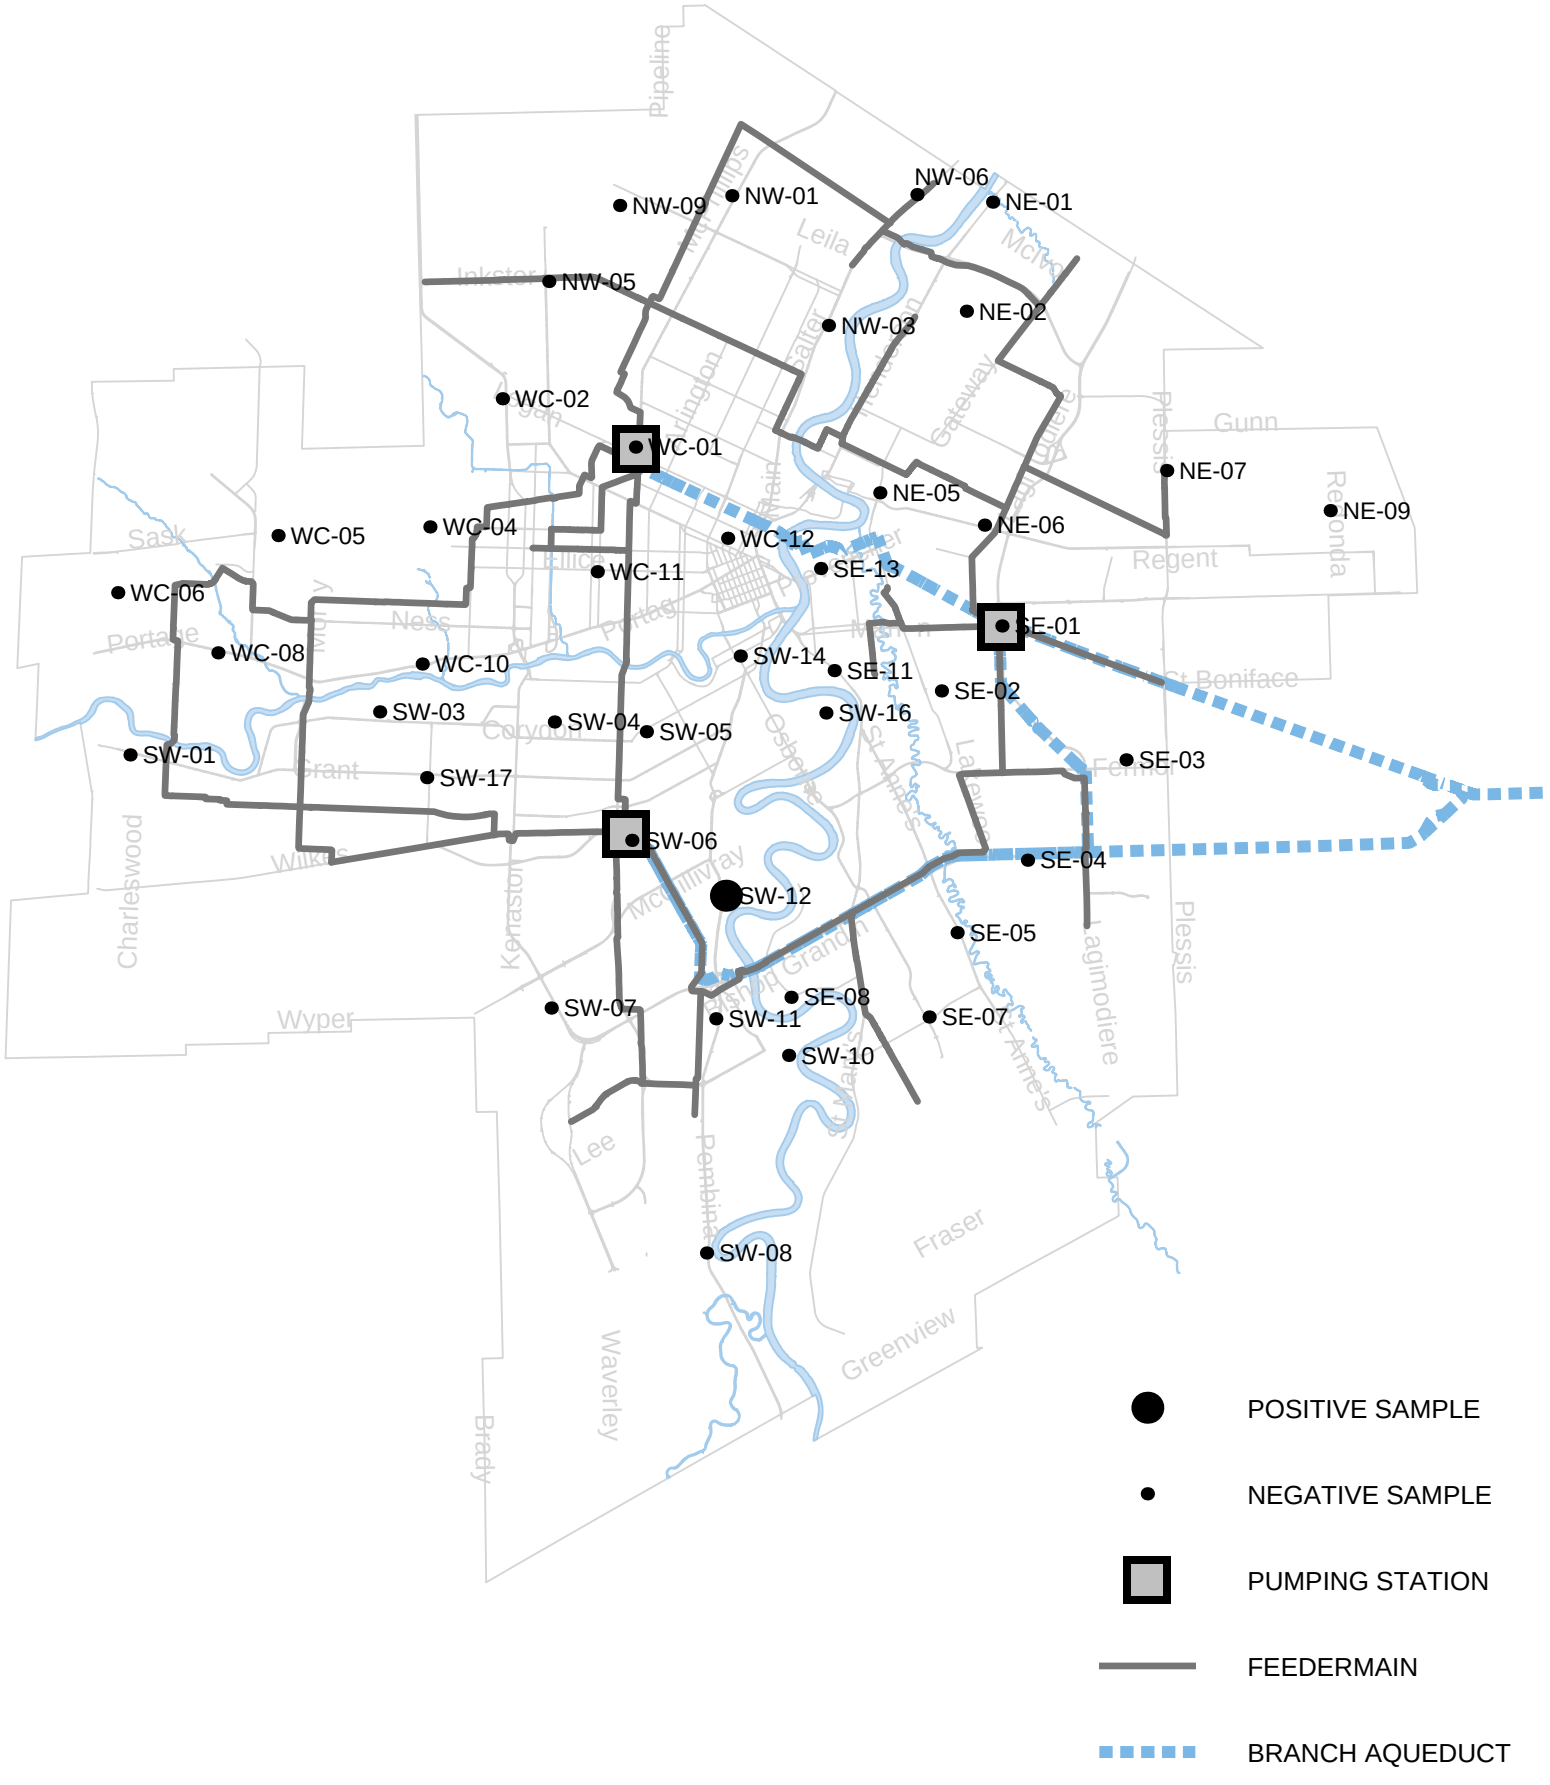

COMPLIANCE SAMPLE LOCATIONS

OCTOBER 7, 2013

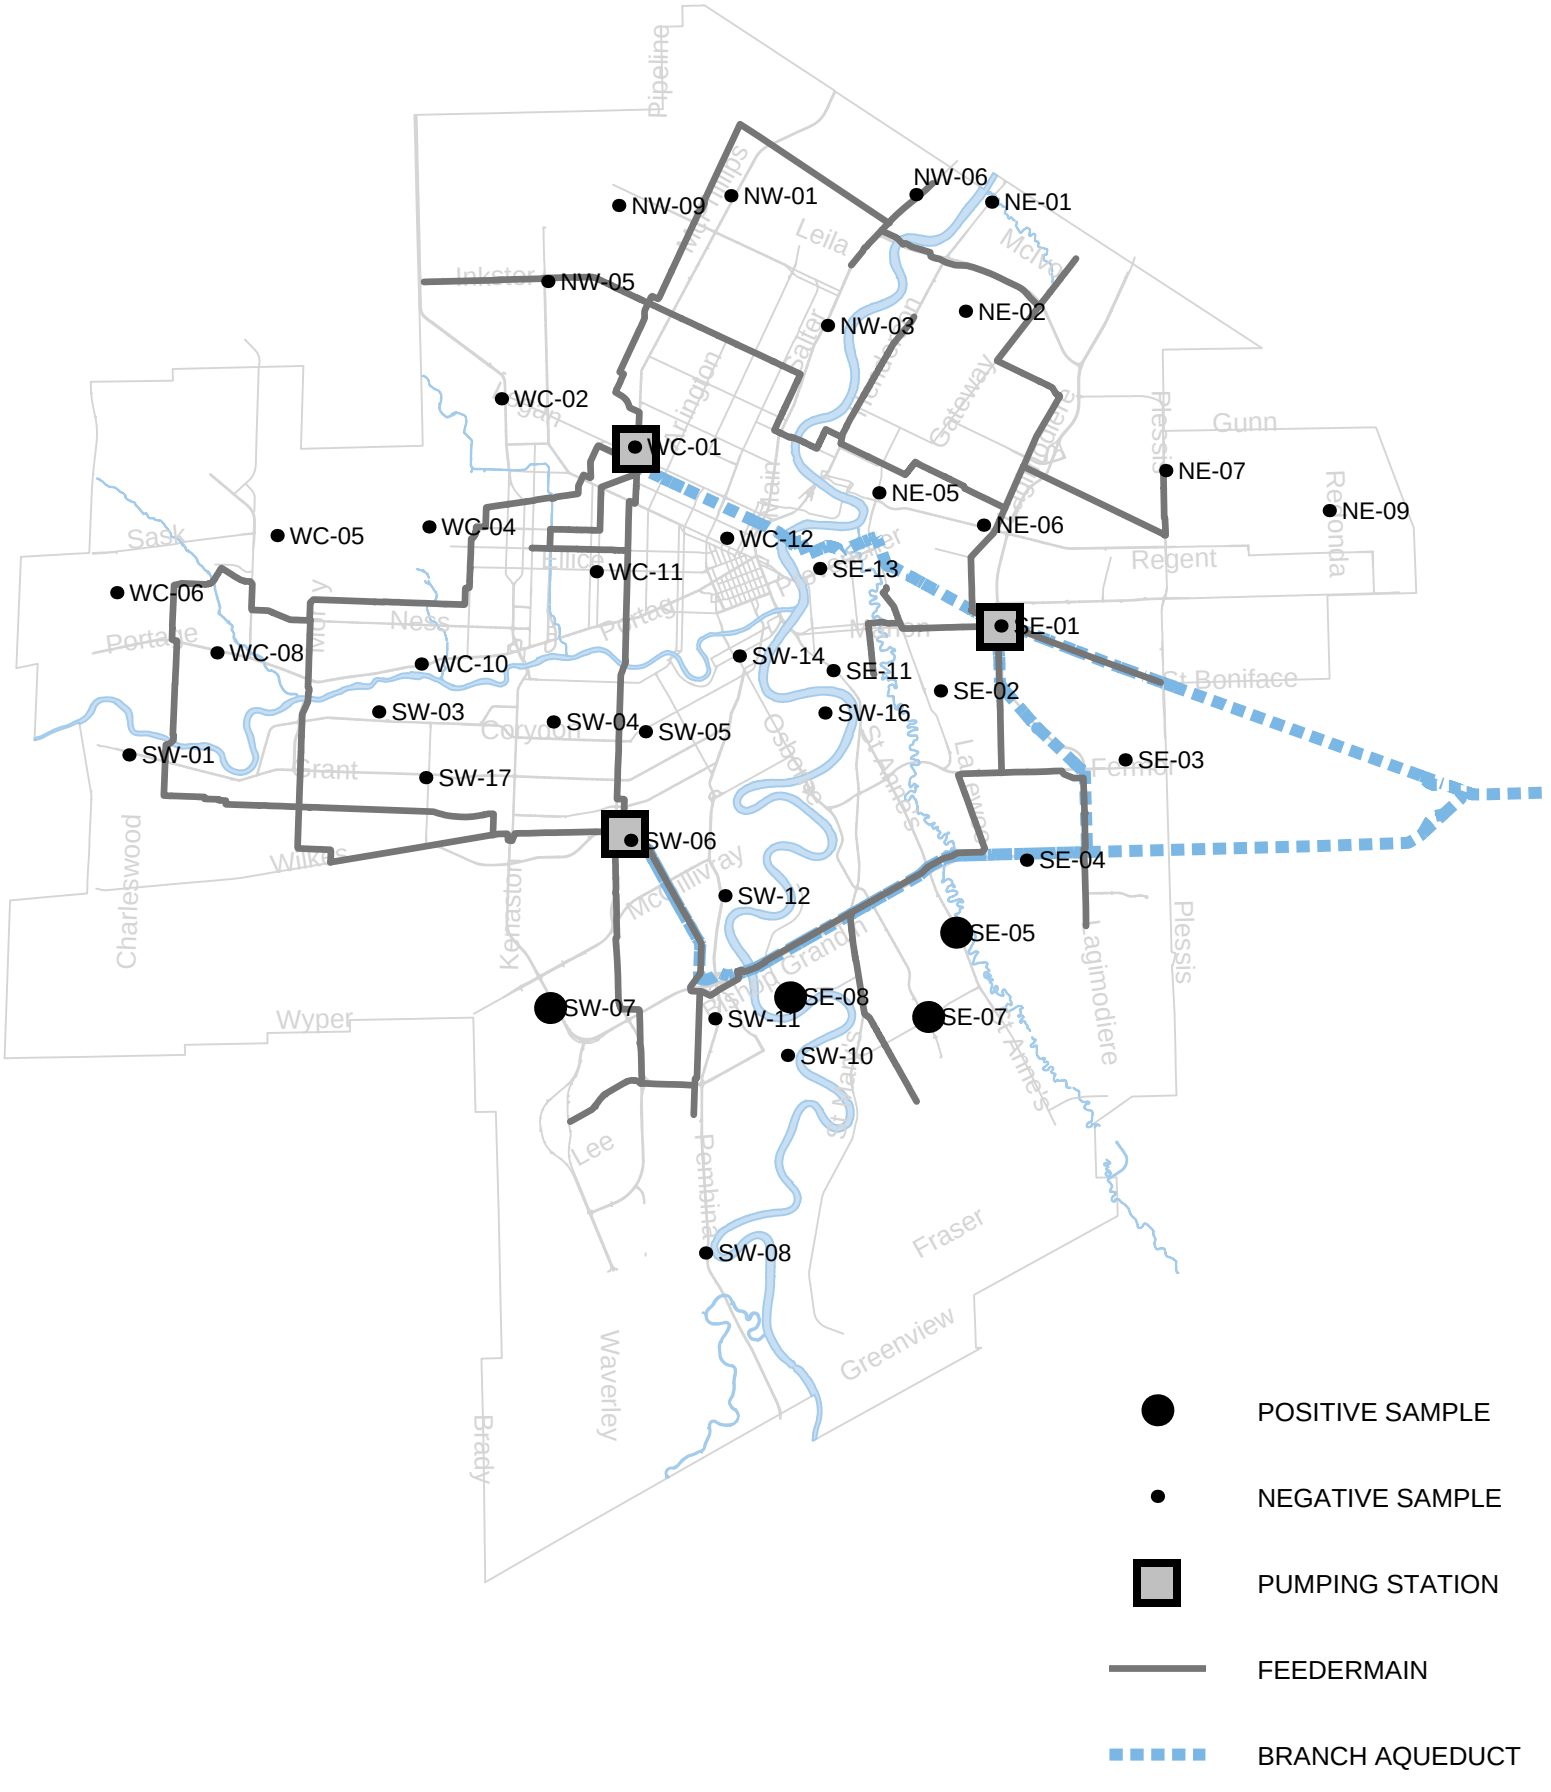

COMPLIANCE SAMPLE LOCATIONS

(BY SAMPLER)

JANUARY 26, 2015

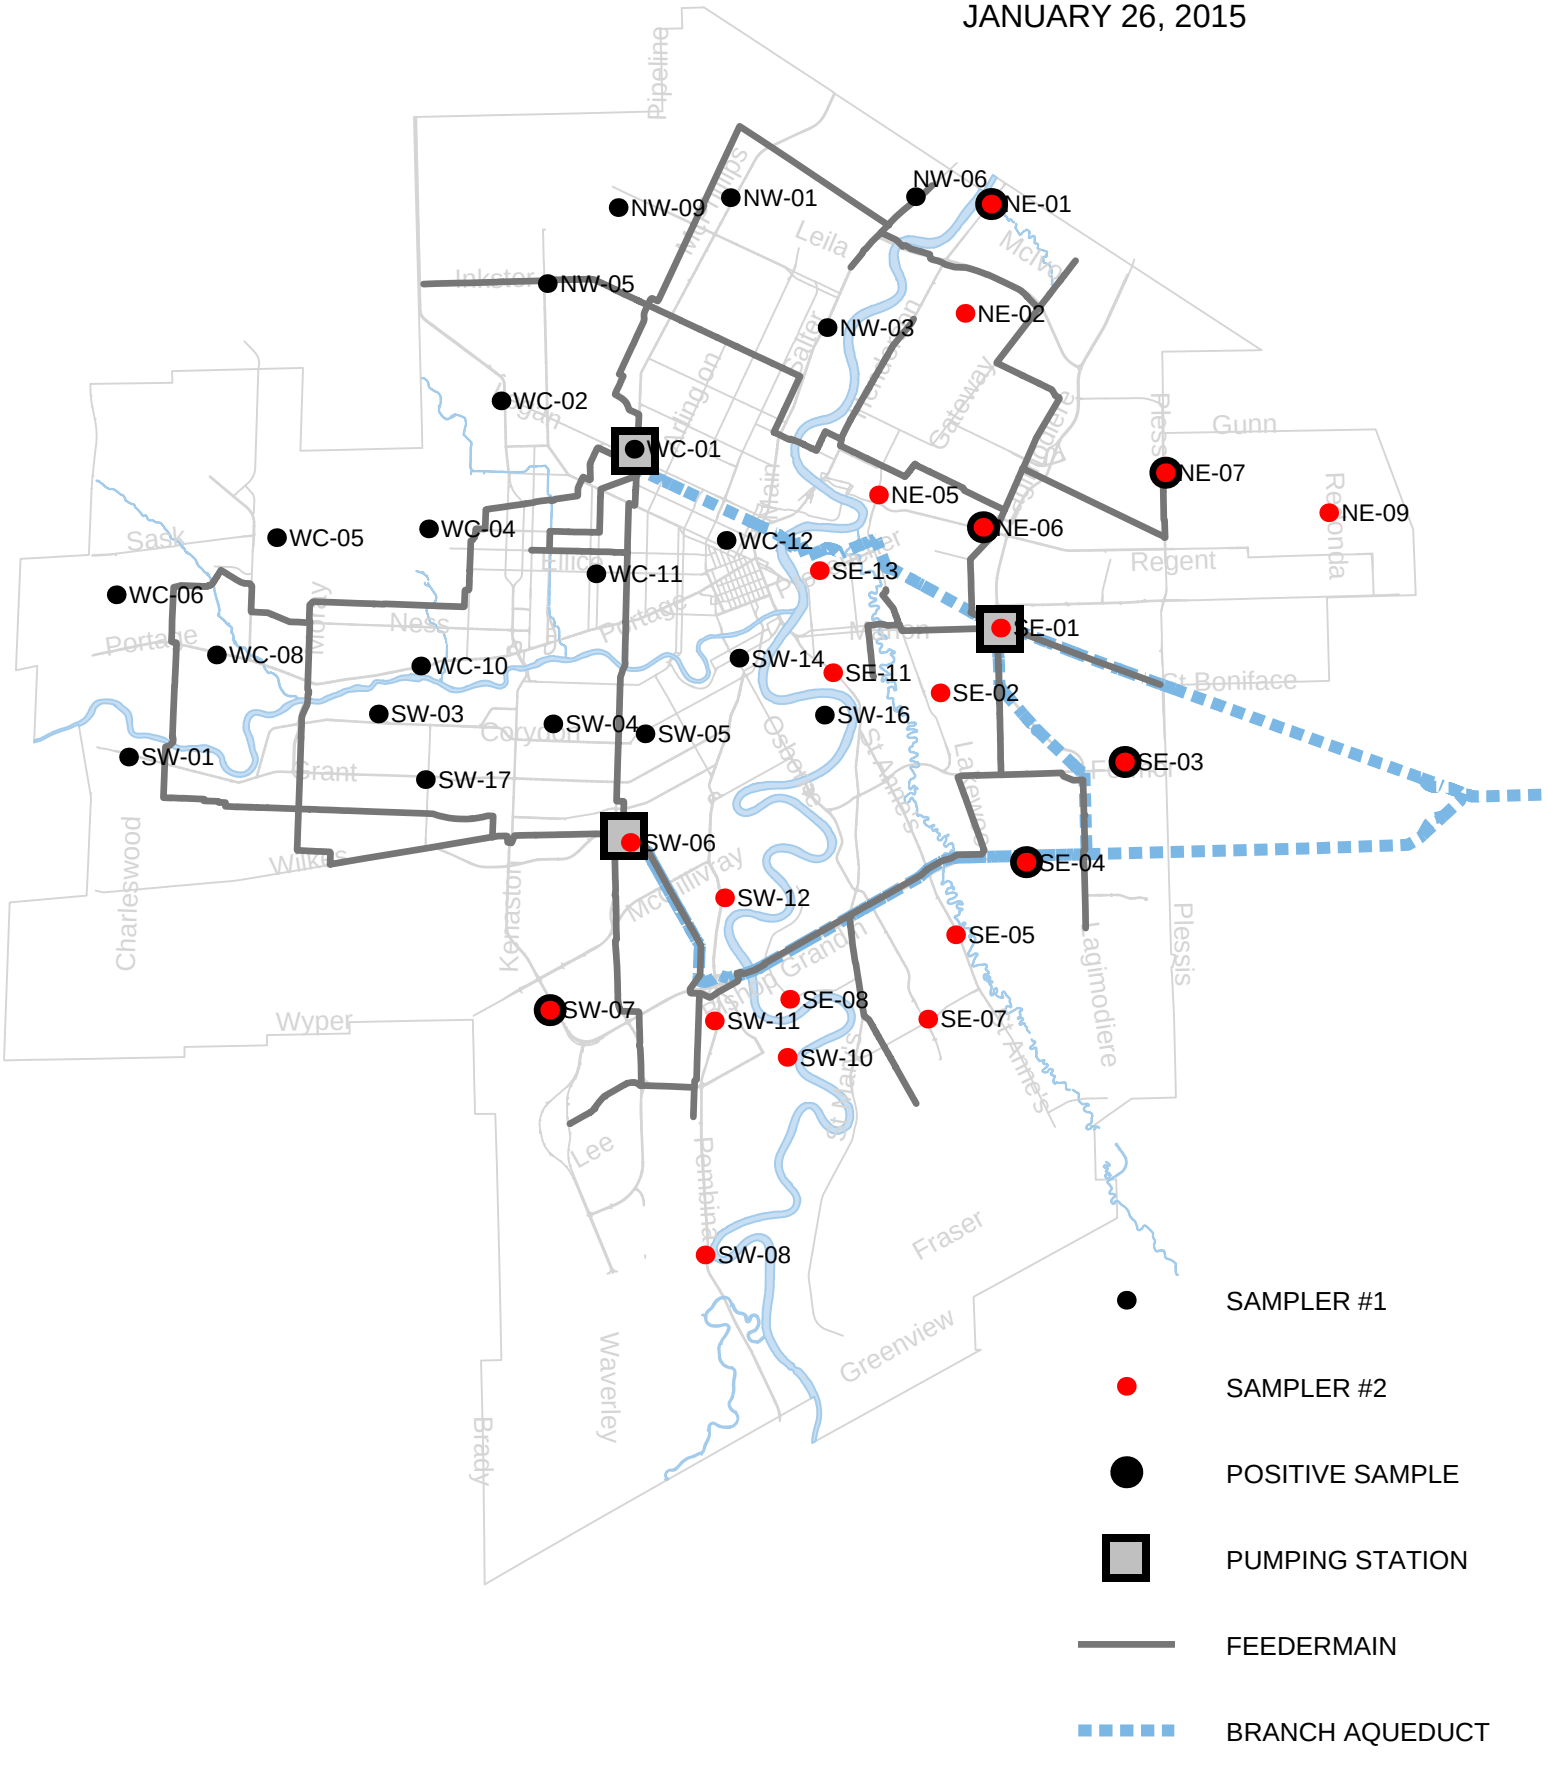

CAST IRON WATERMAINS

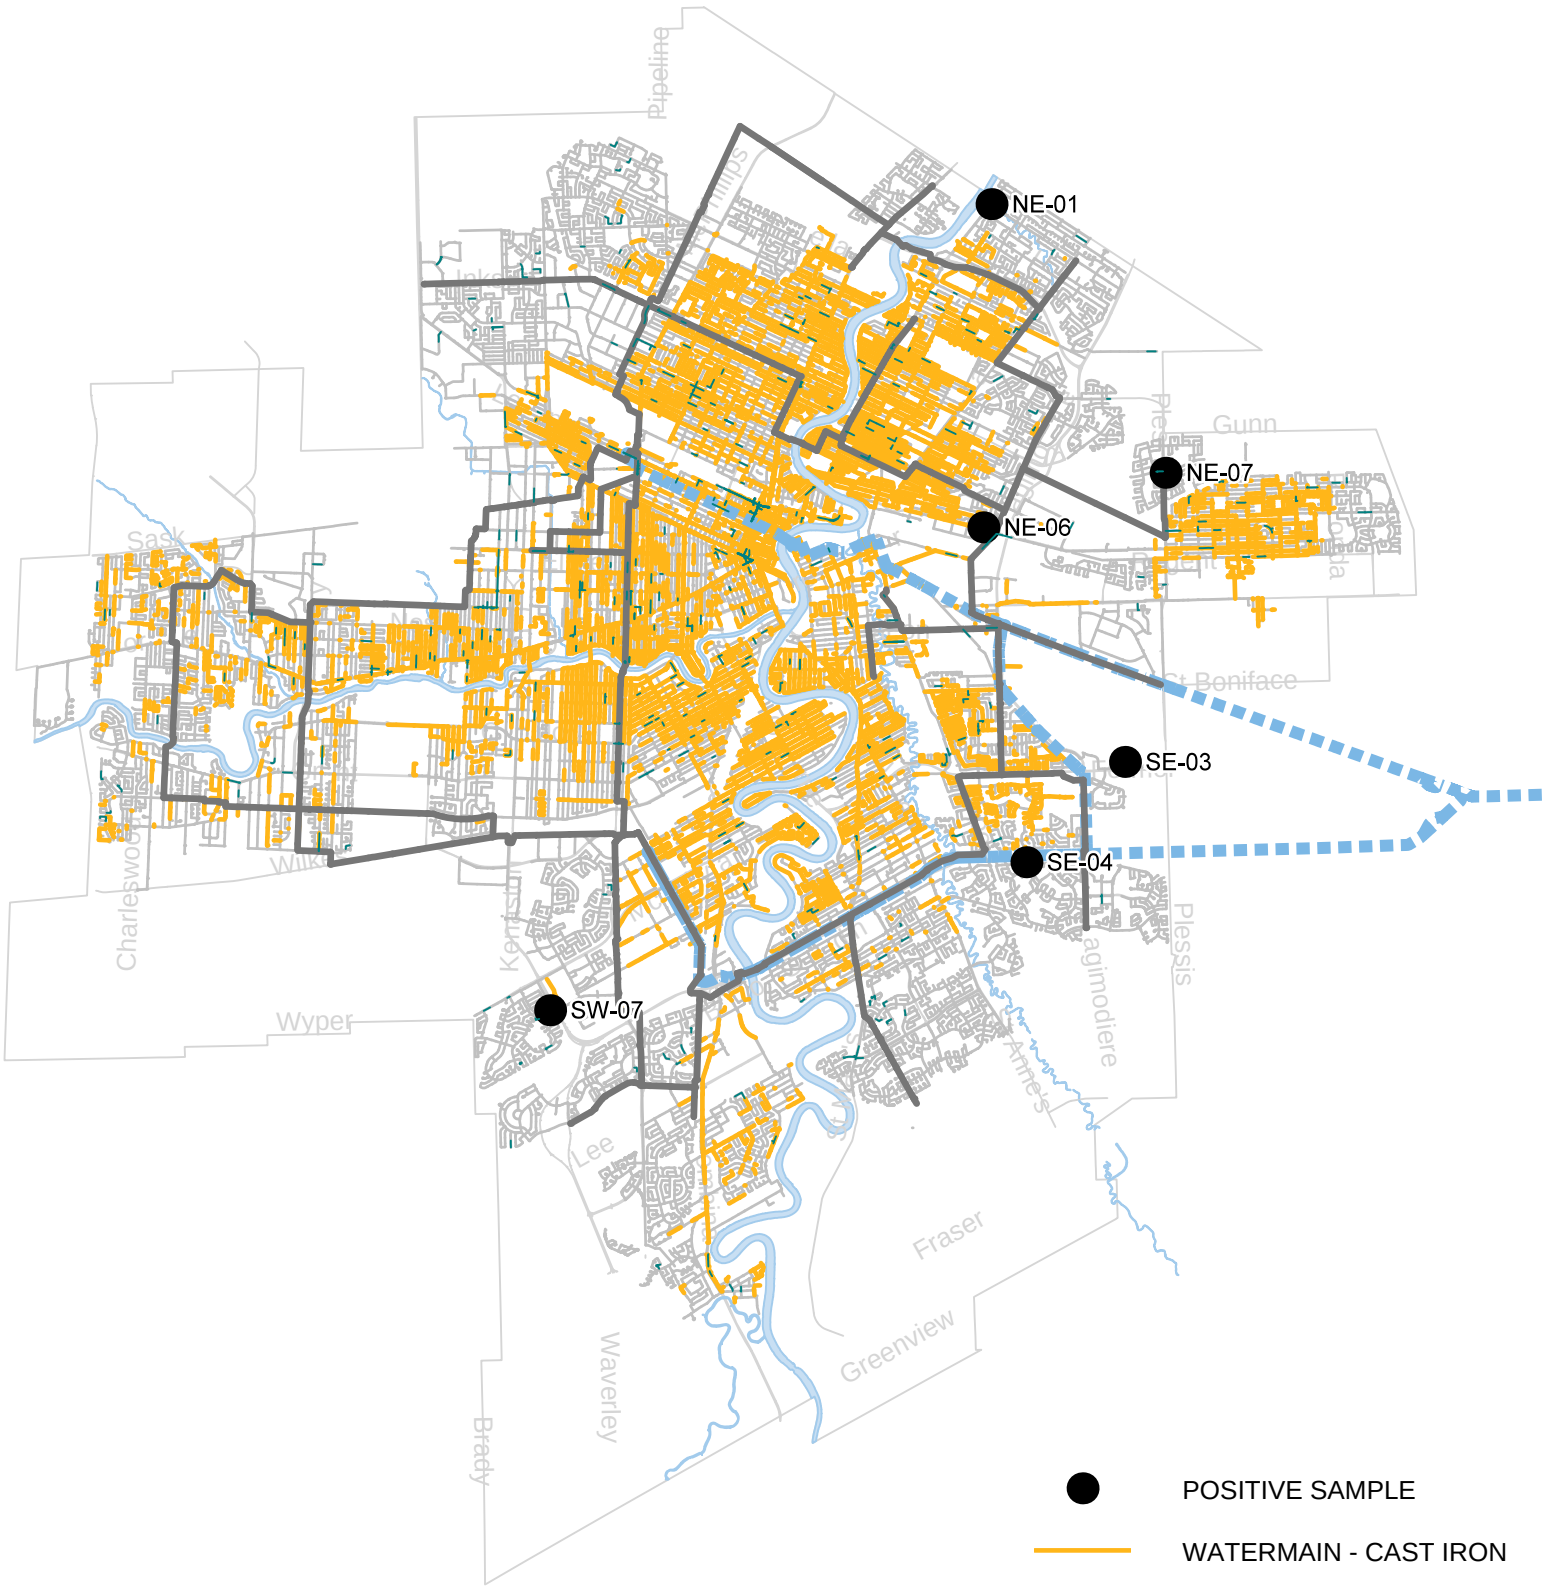

WATERMAIN REPAIRS

JANUARY 12 - 26, 2015

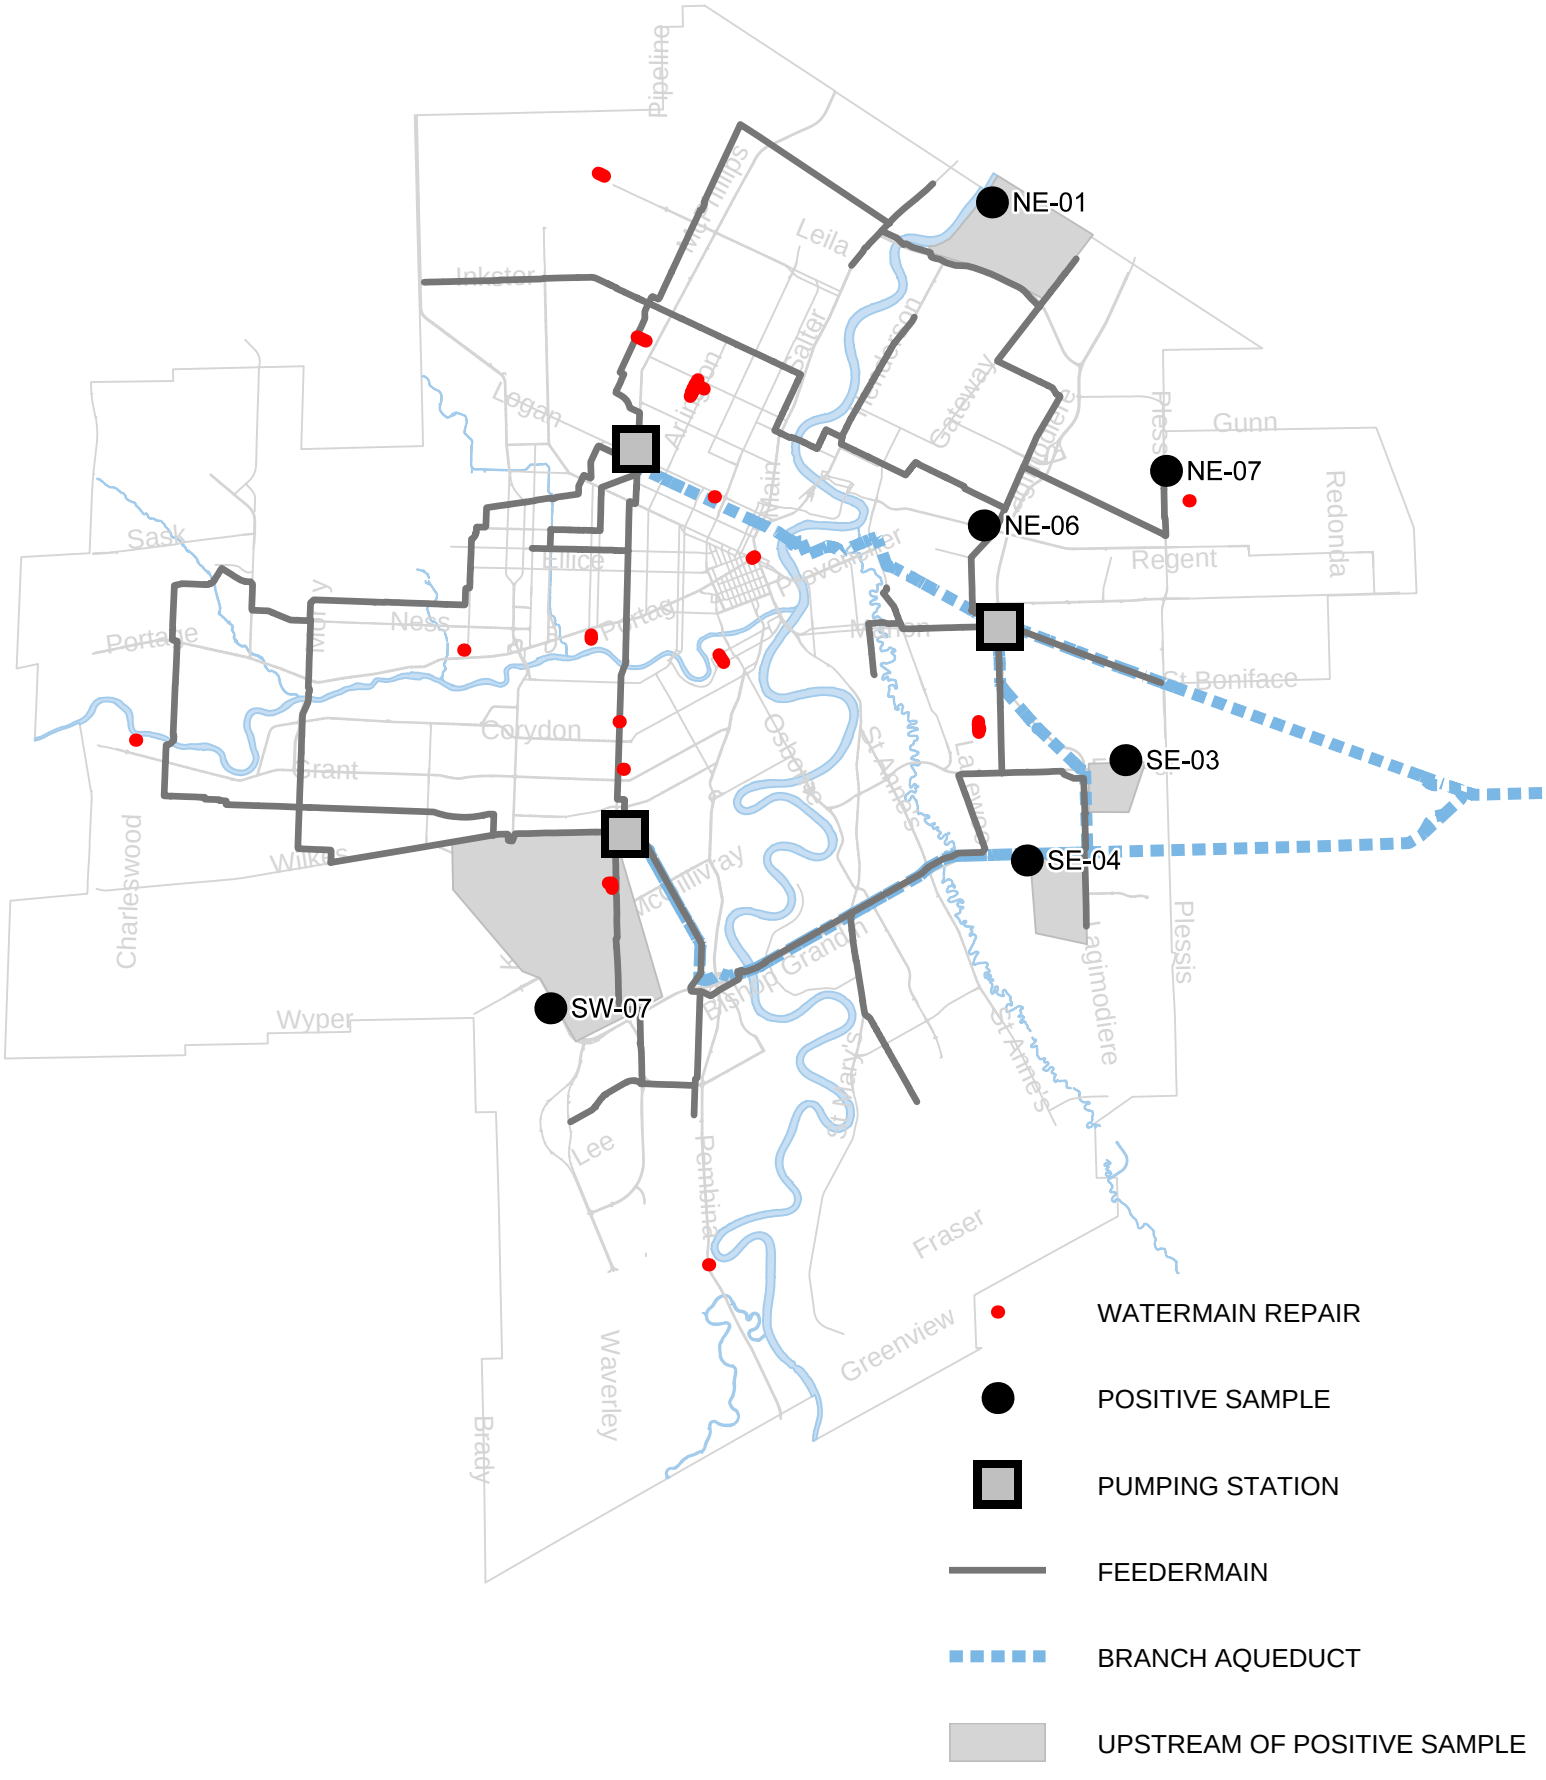

WATERMAIN REPAIRS

MAY 12- 26, 2014

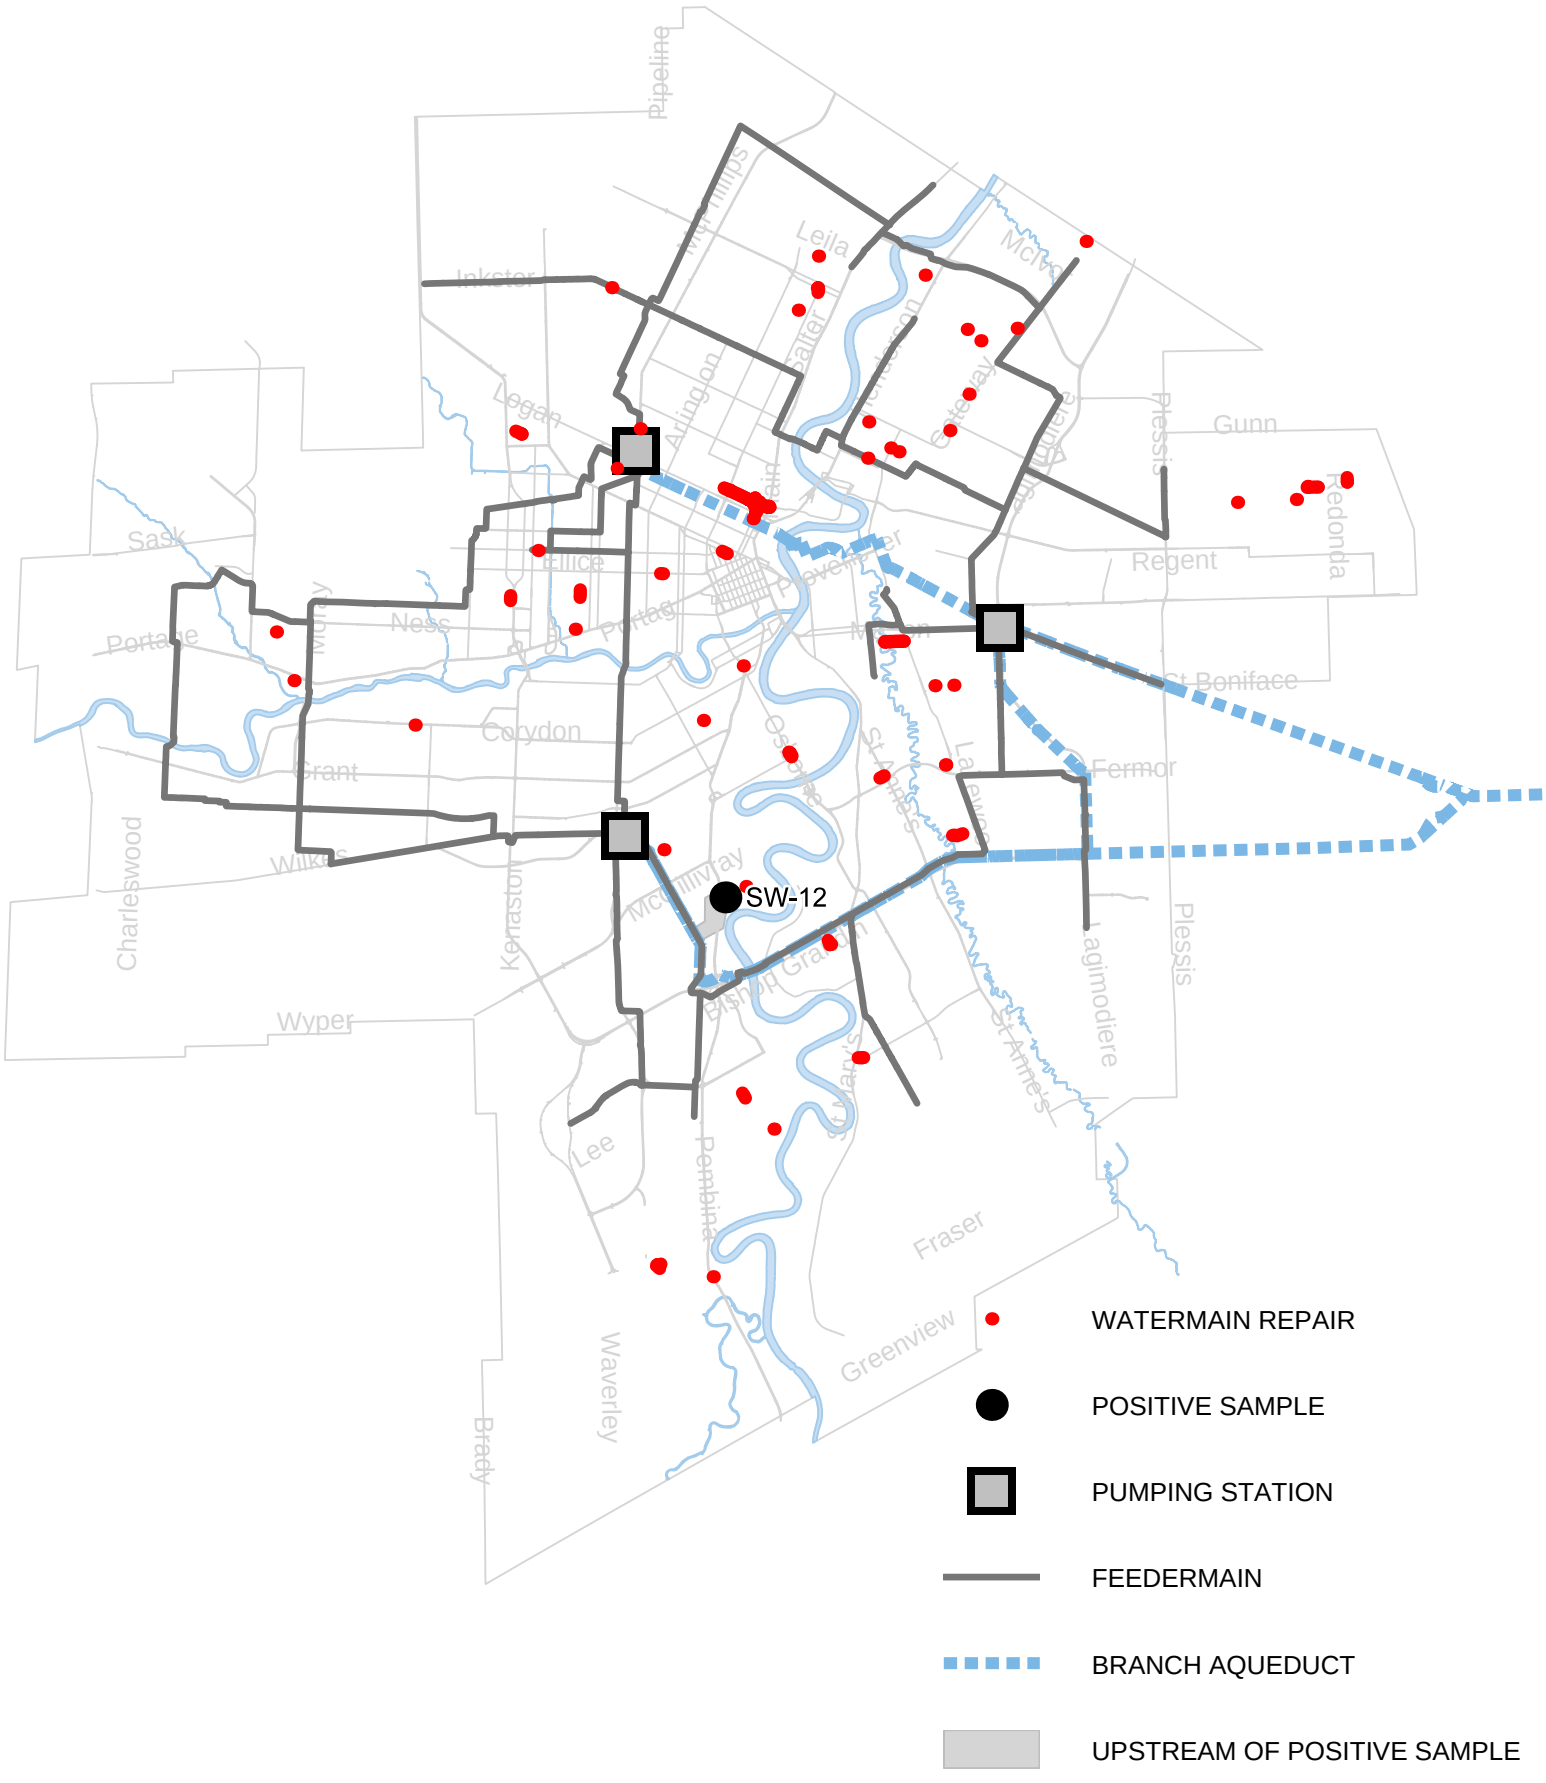

WATERMAIN REPAIRS

SEPTEMEBER 23 - OCTOBER 07, 2013

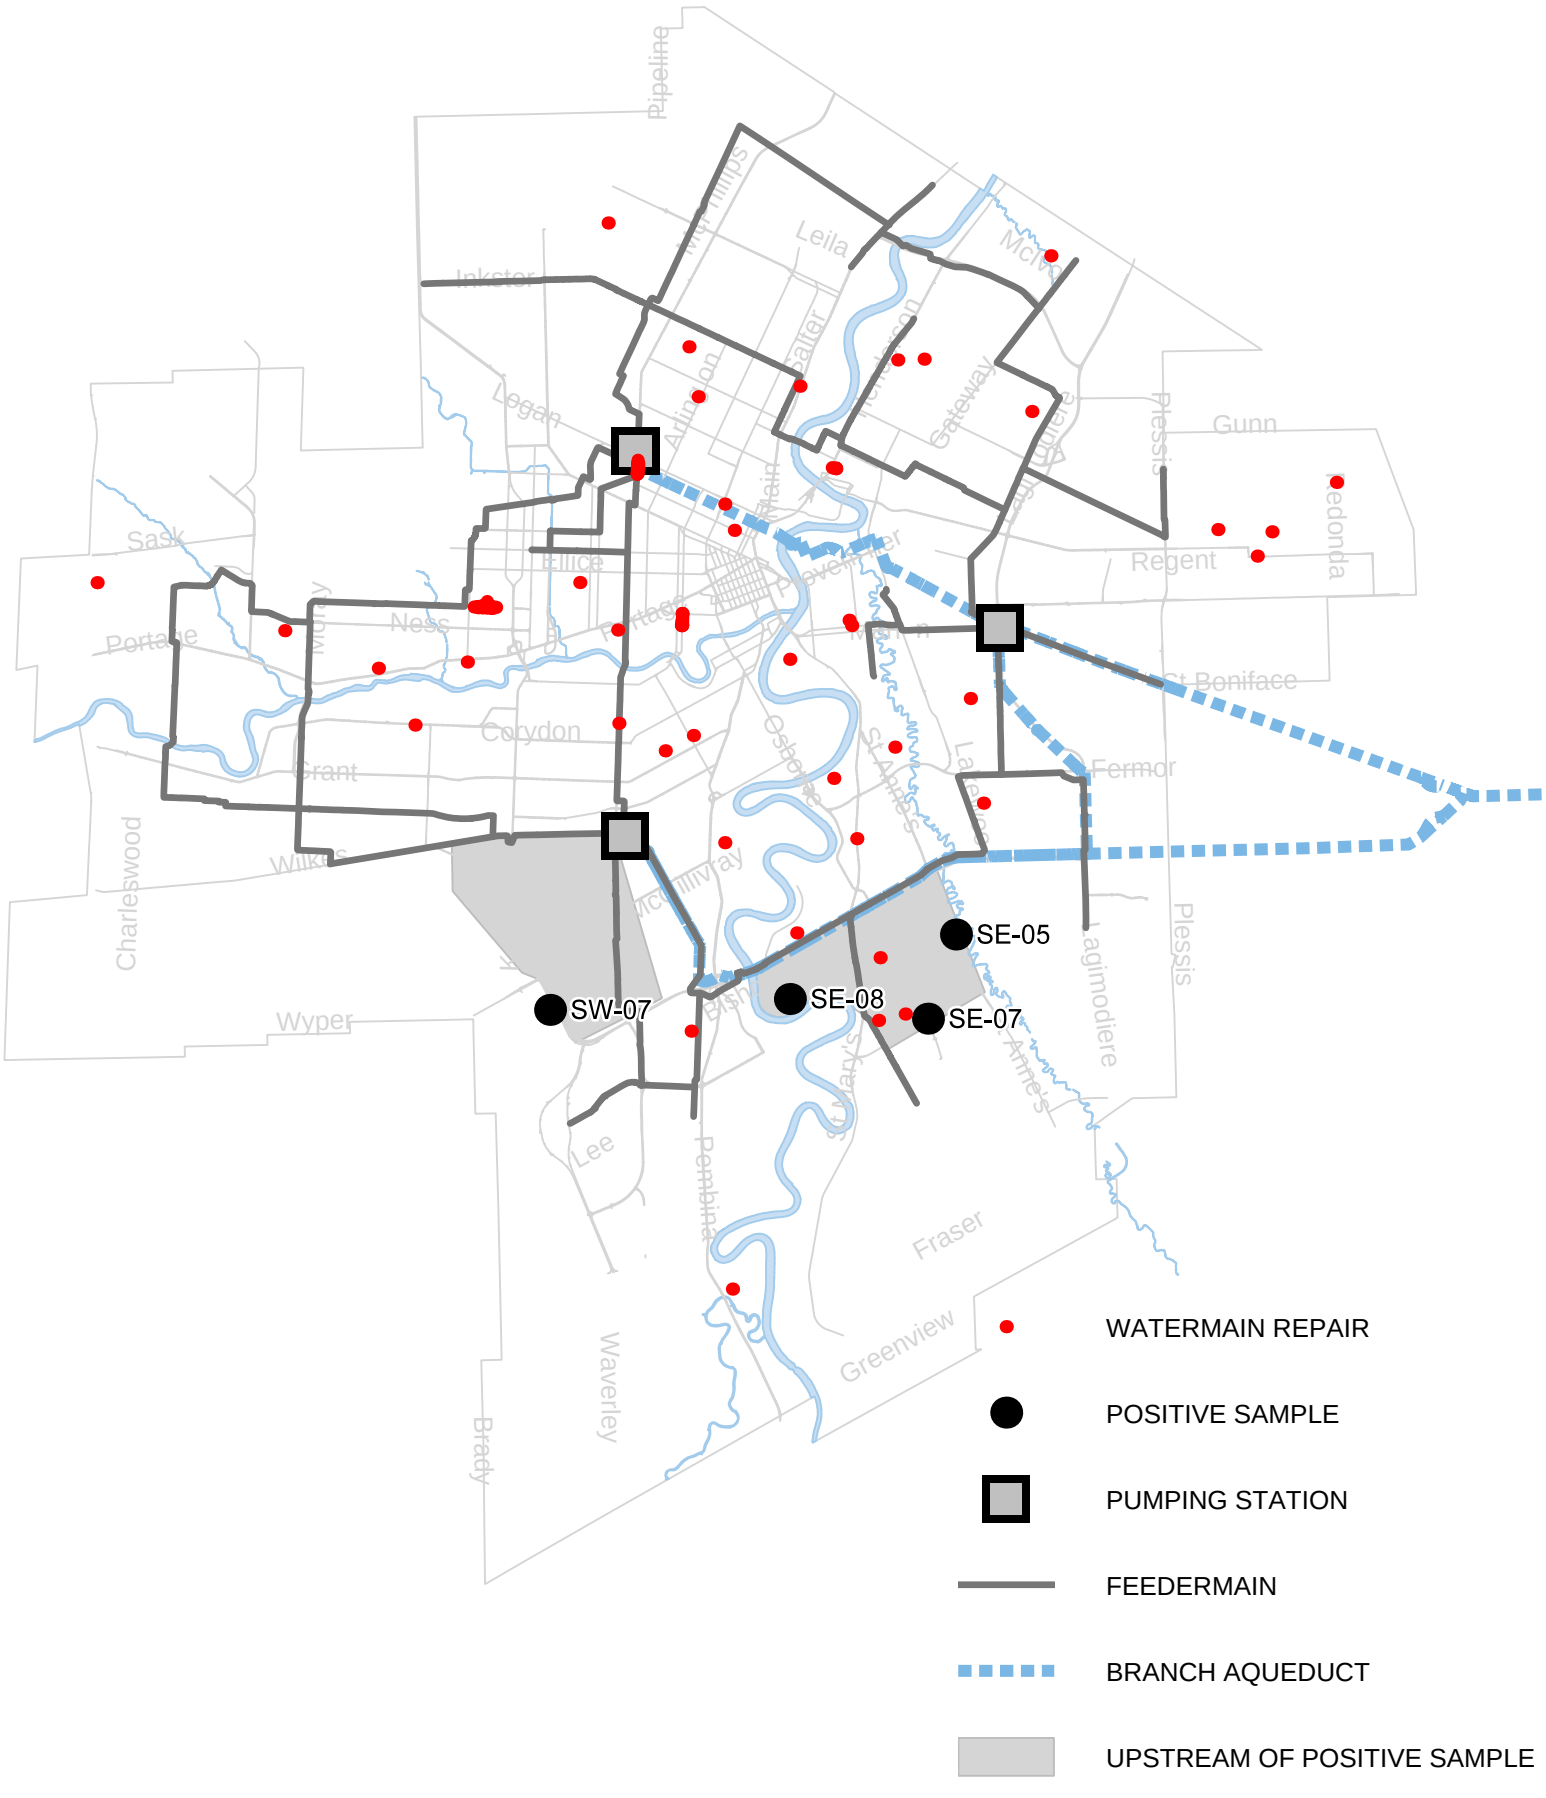

BACKFLOW DEVICES

(INSPECTED)

FEBRUARY 2015

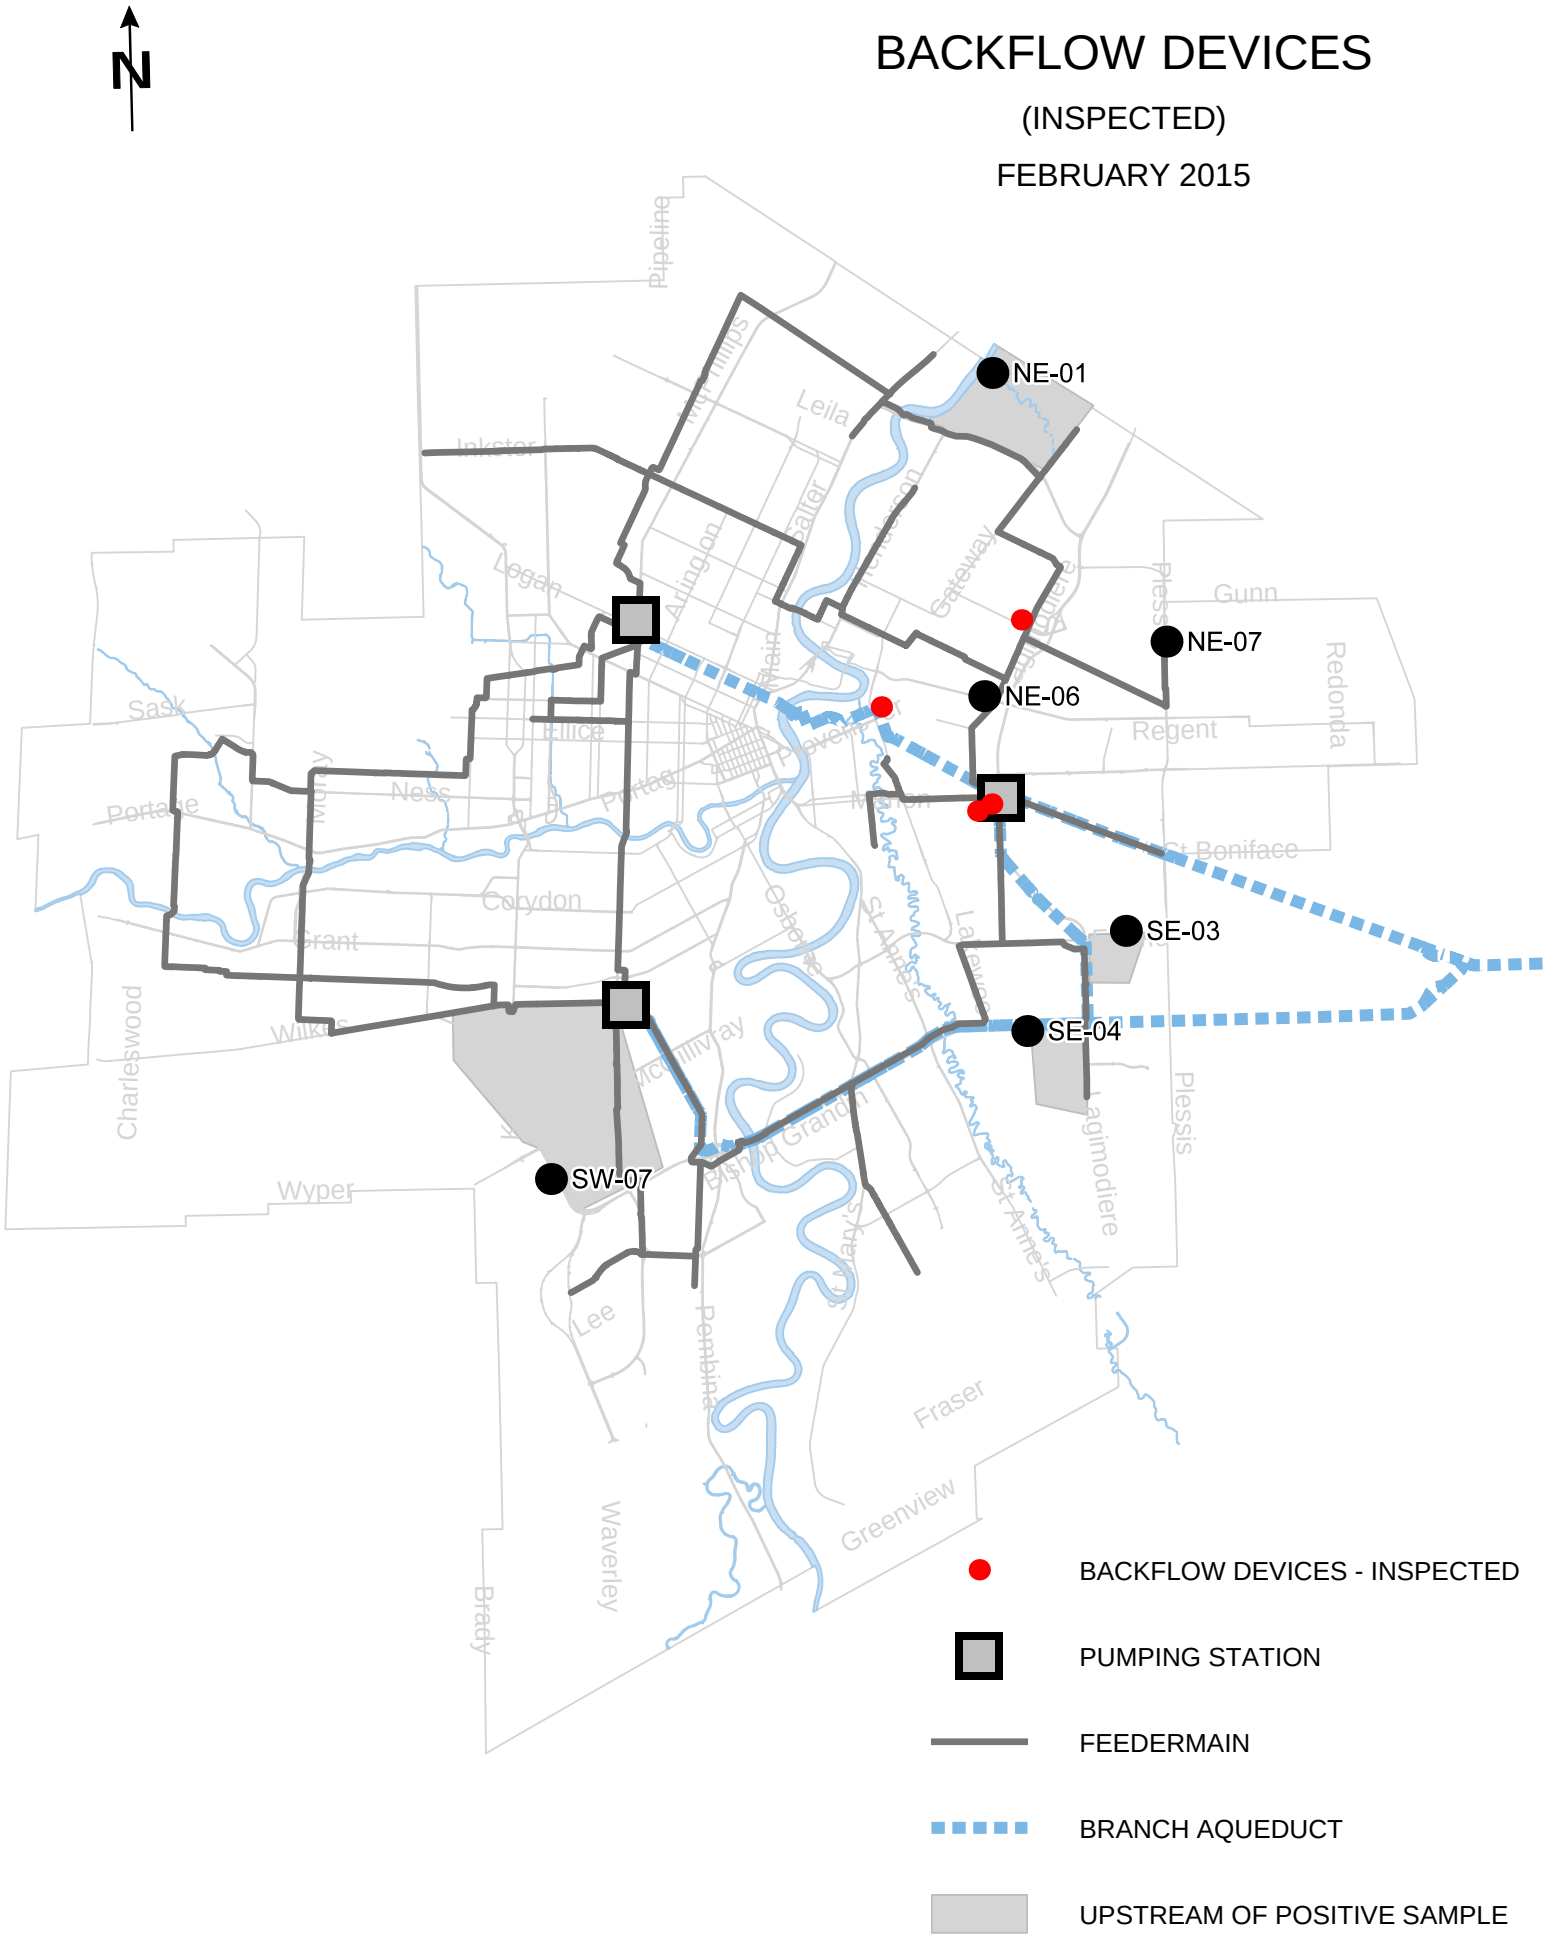

BACKFLOW DEVICES

AS OF FEBRUARY 2015

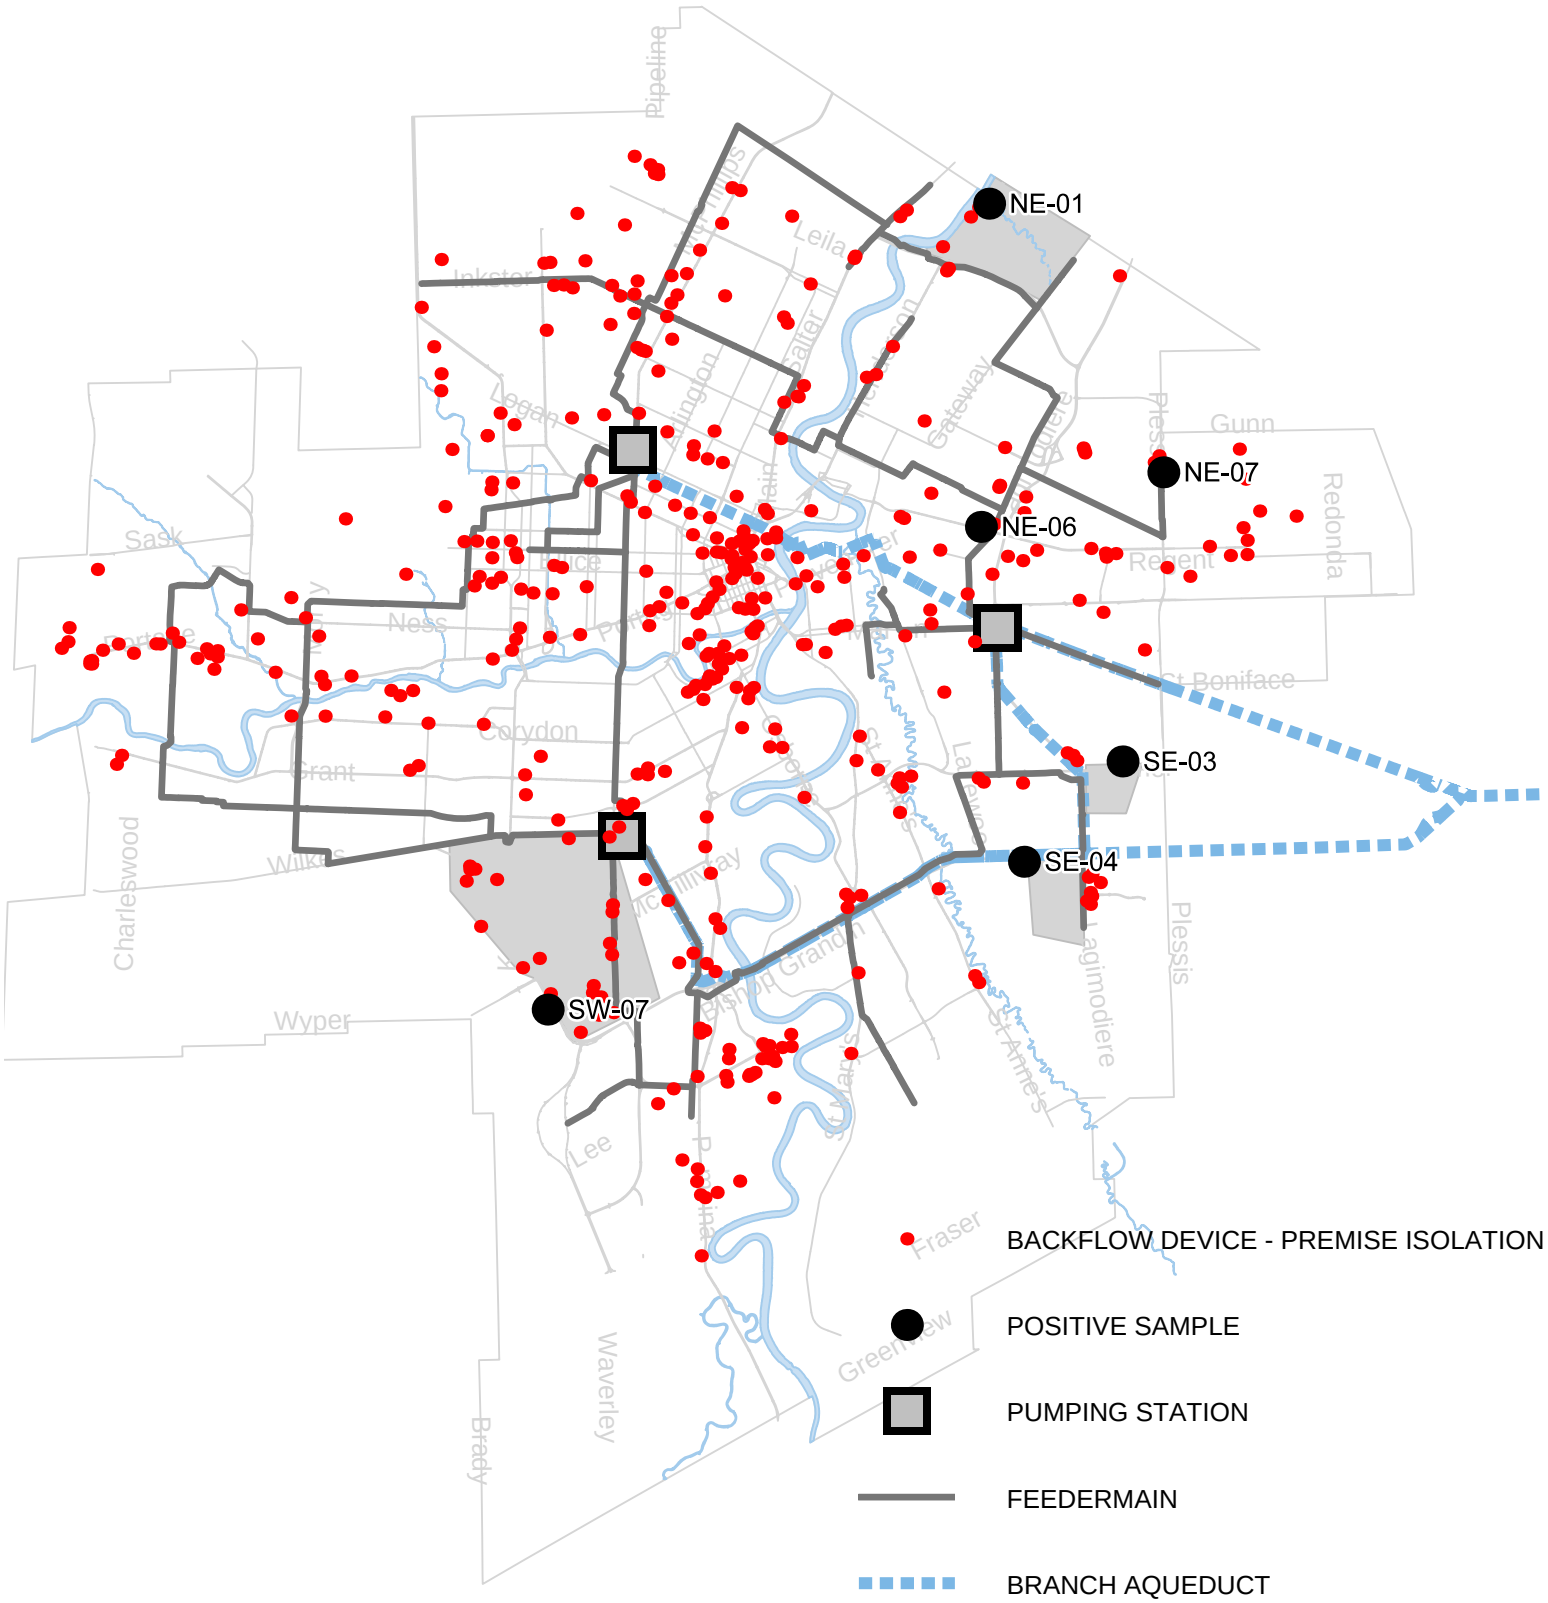

*PREMISE LOCATION= HIGH RISK

GROUND WELL LOCATIONS

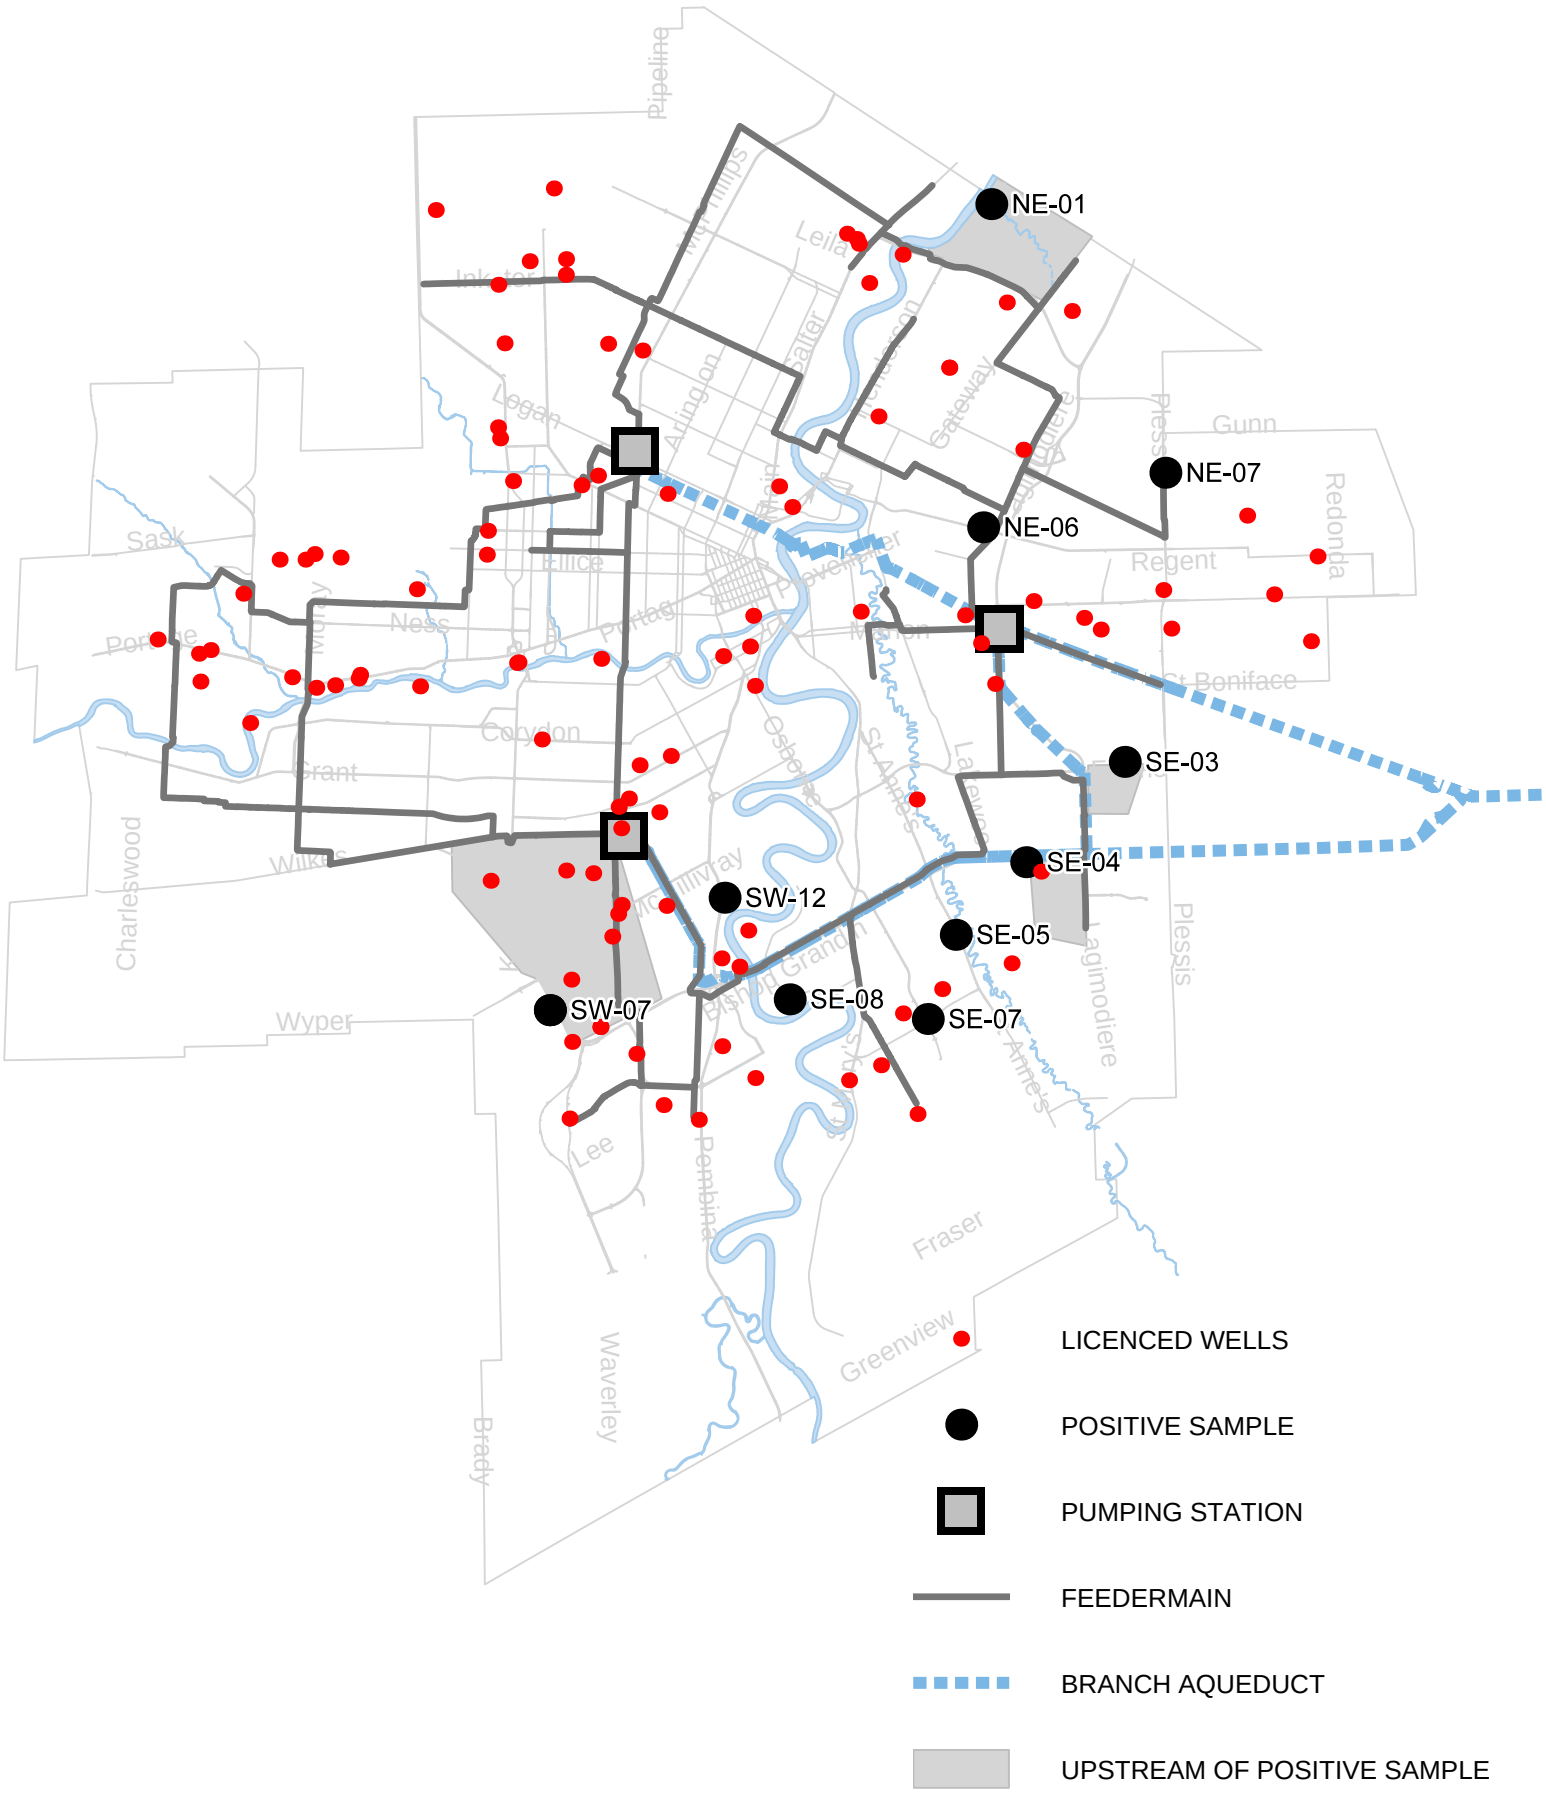

GROUND WELL LOCATIONS

JANUARY 12 - 26, 2015

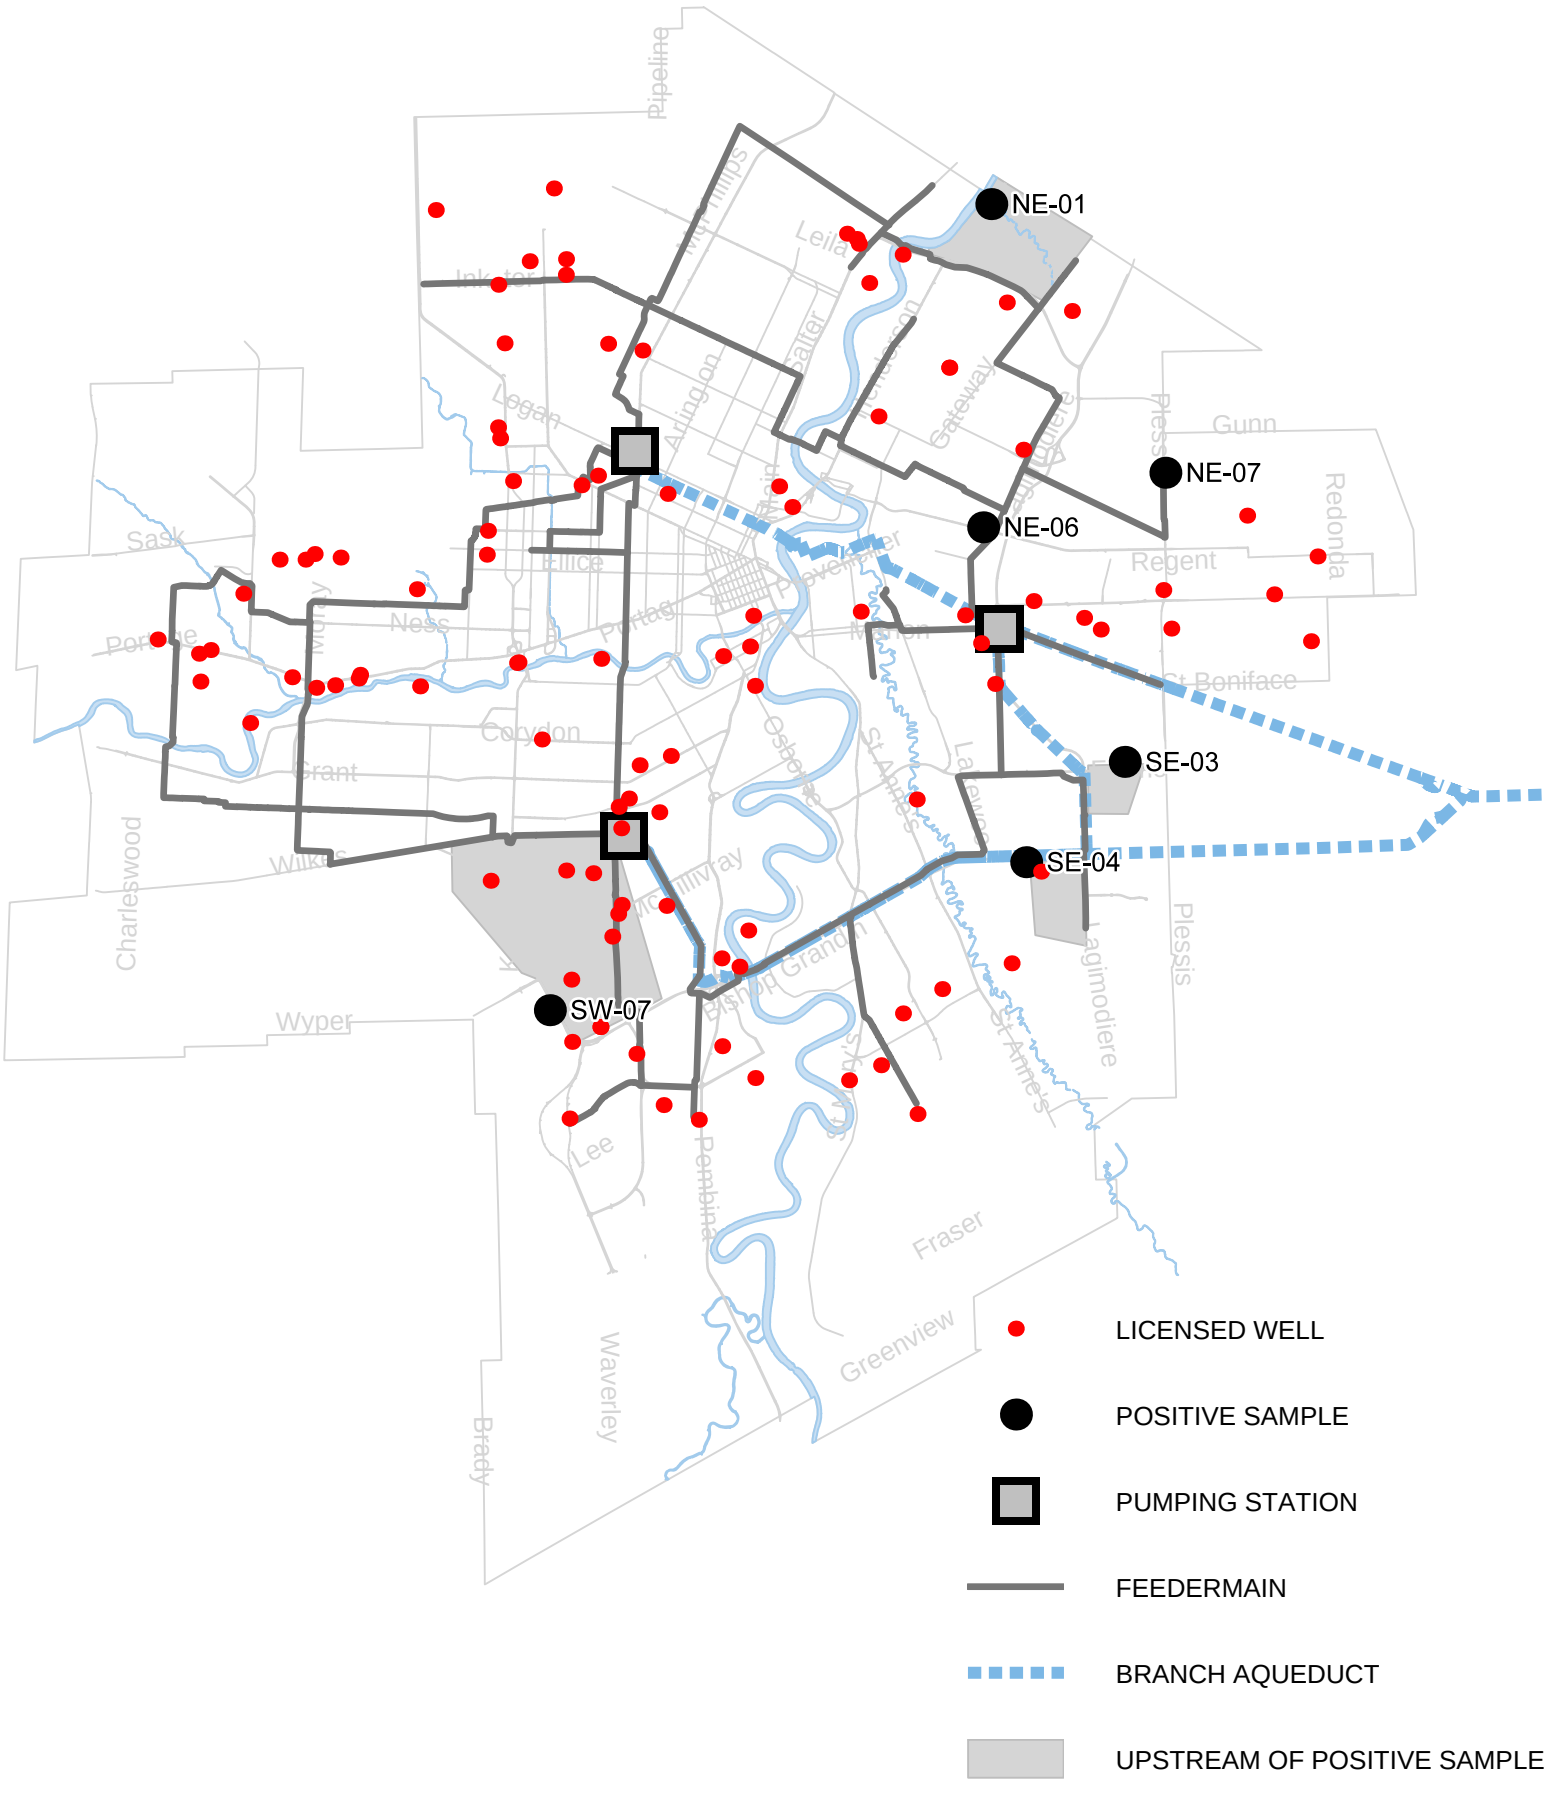

GROUND WELL LOCATIONS

MAY 12 - 26, 2014

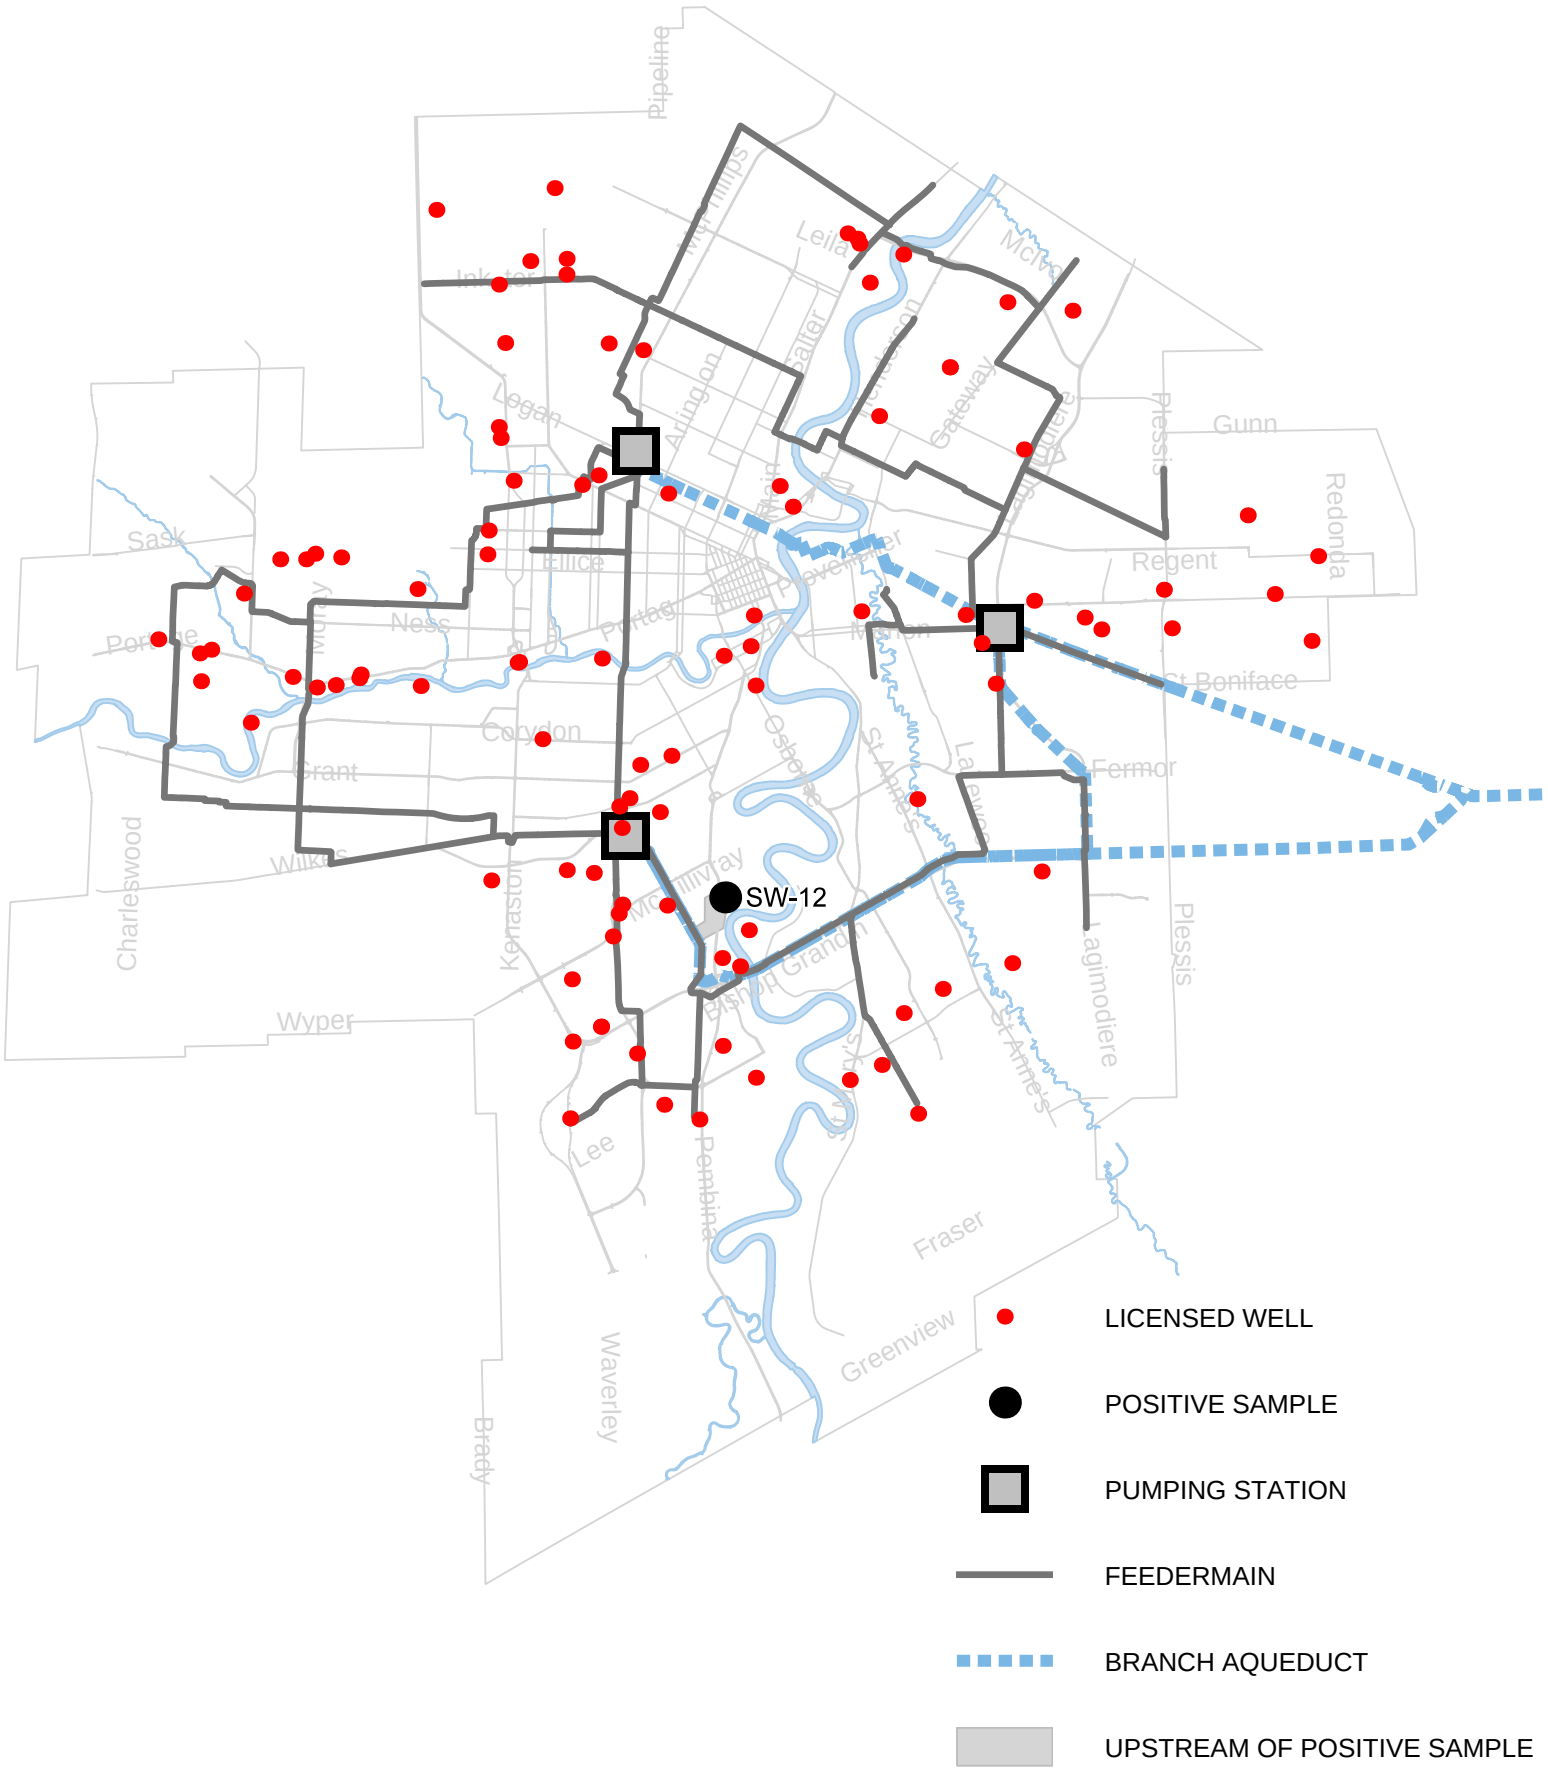

GROUND WELL LOCATIONS

SEPTEMBER 23 - OCTOBER 7, 2013

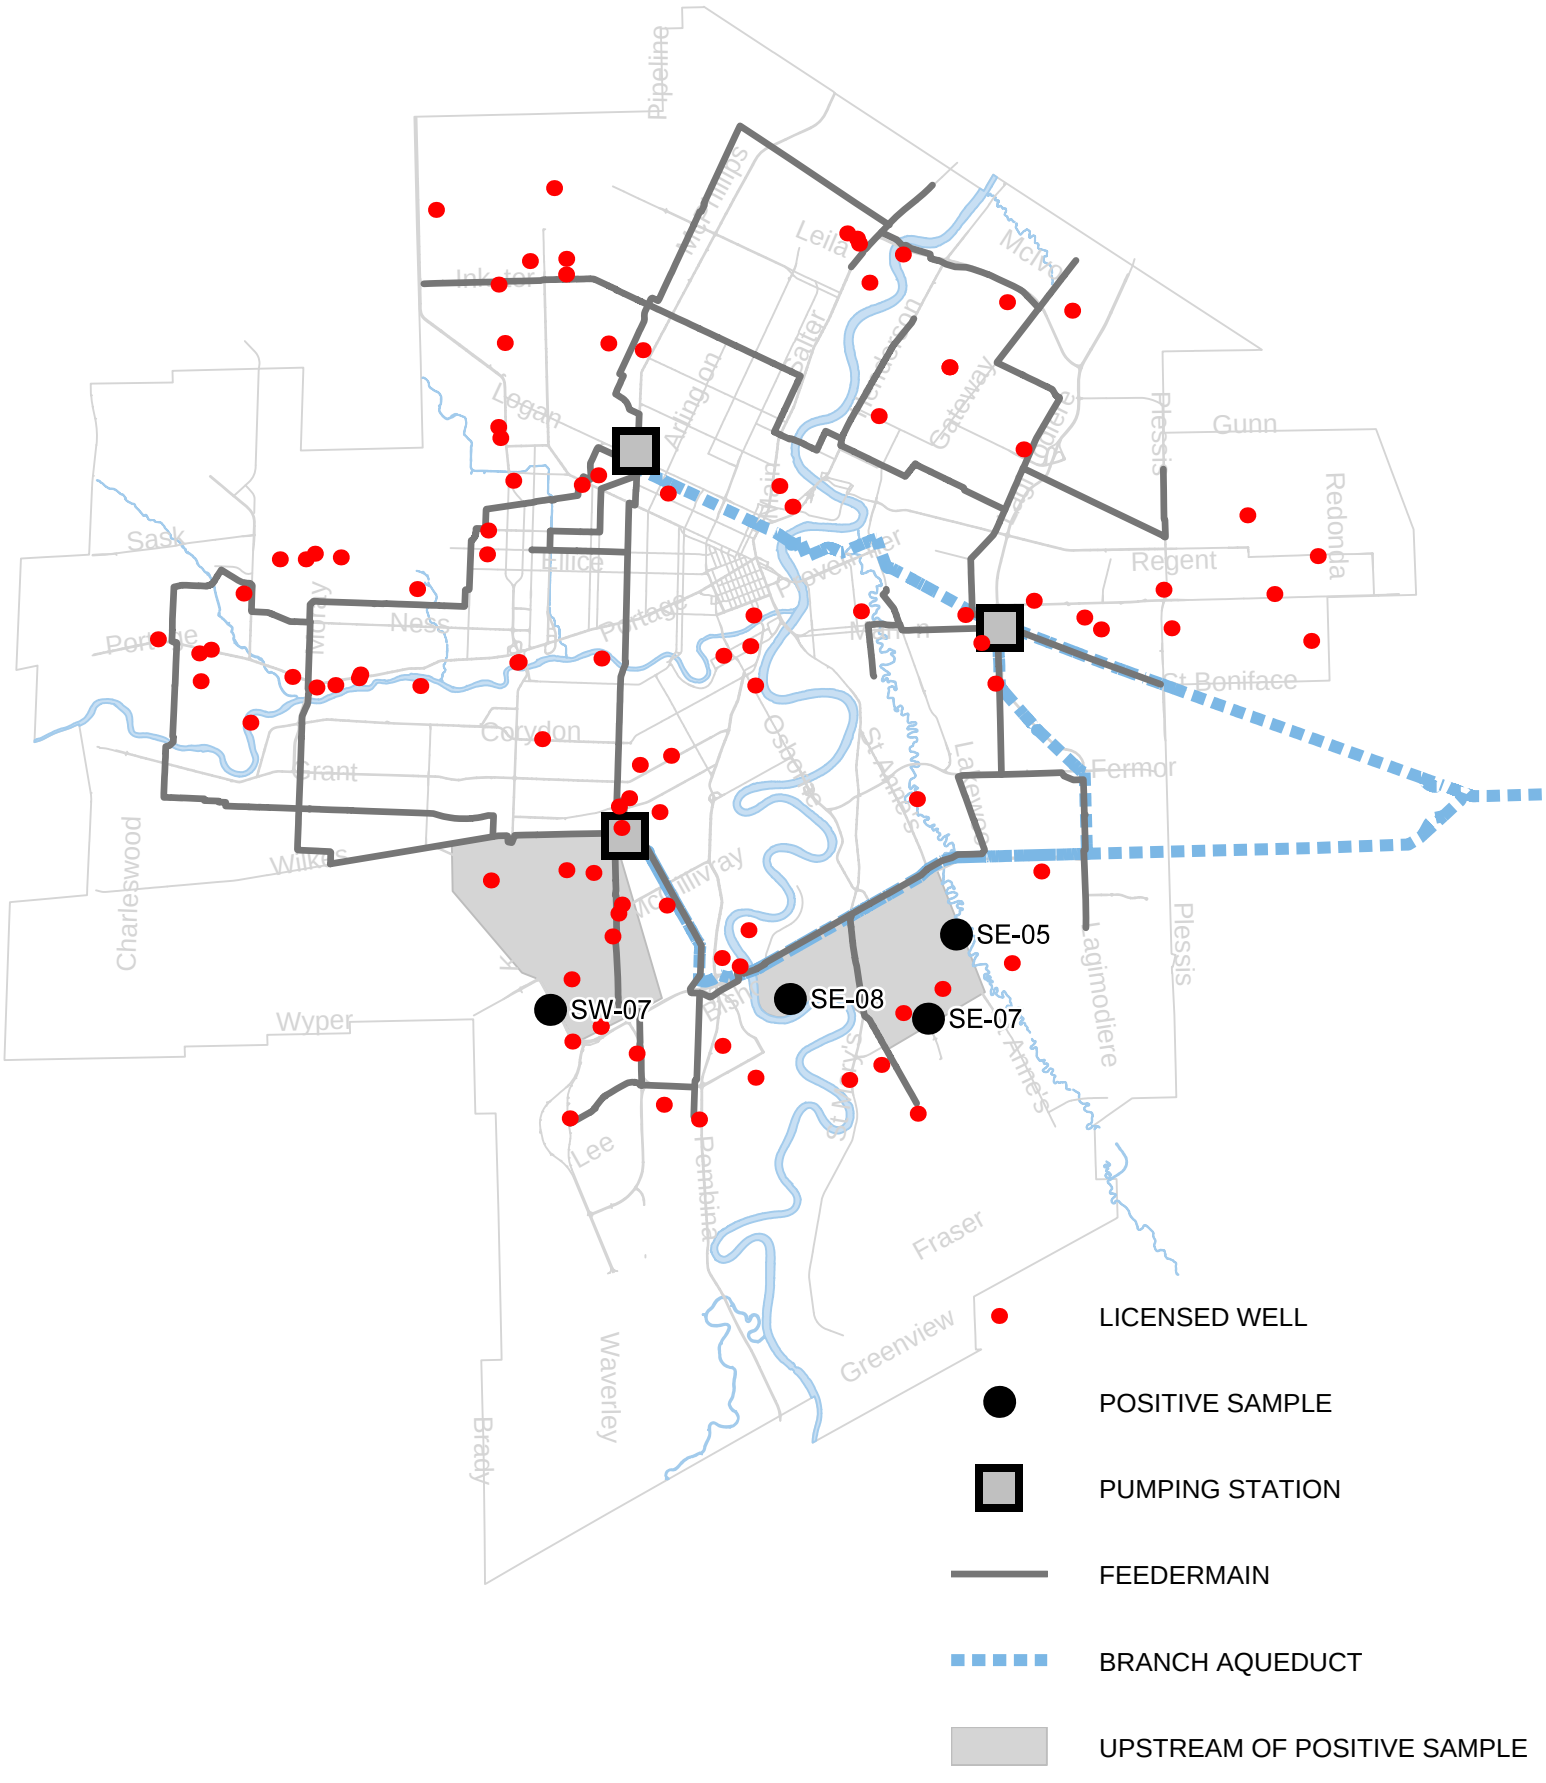

HYDRANT OPERATION

JANUARY 12 - 26, 2015

(firefighting, flushing, sheared, leak on branch)

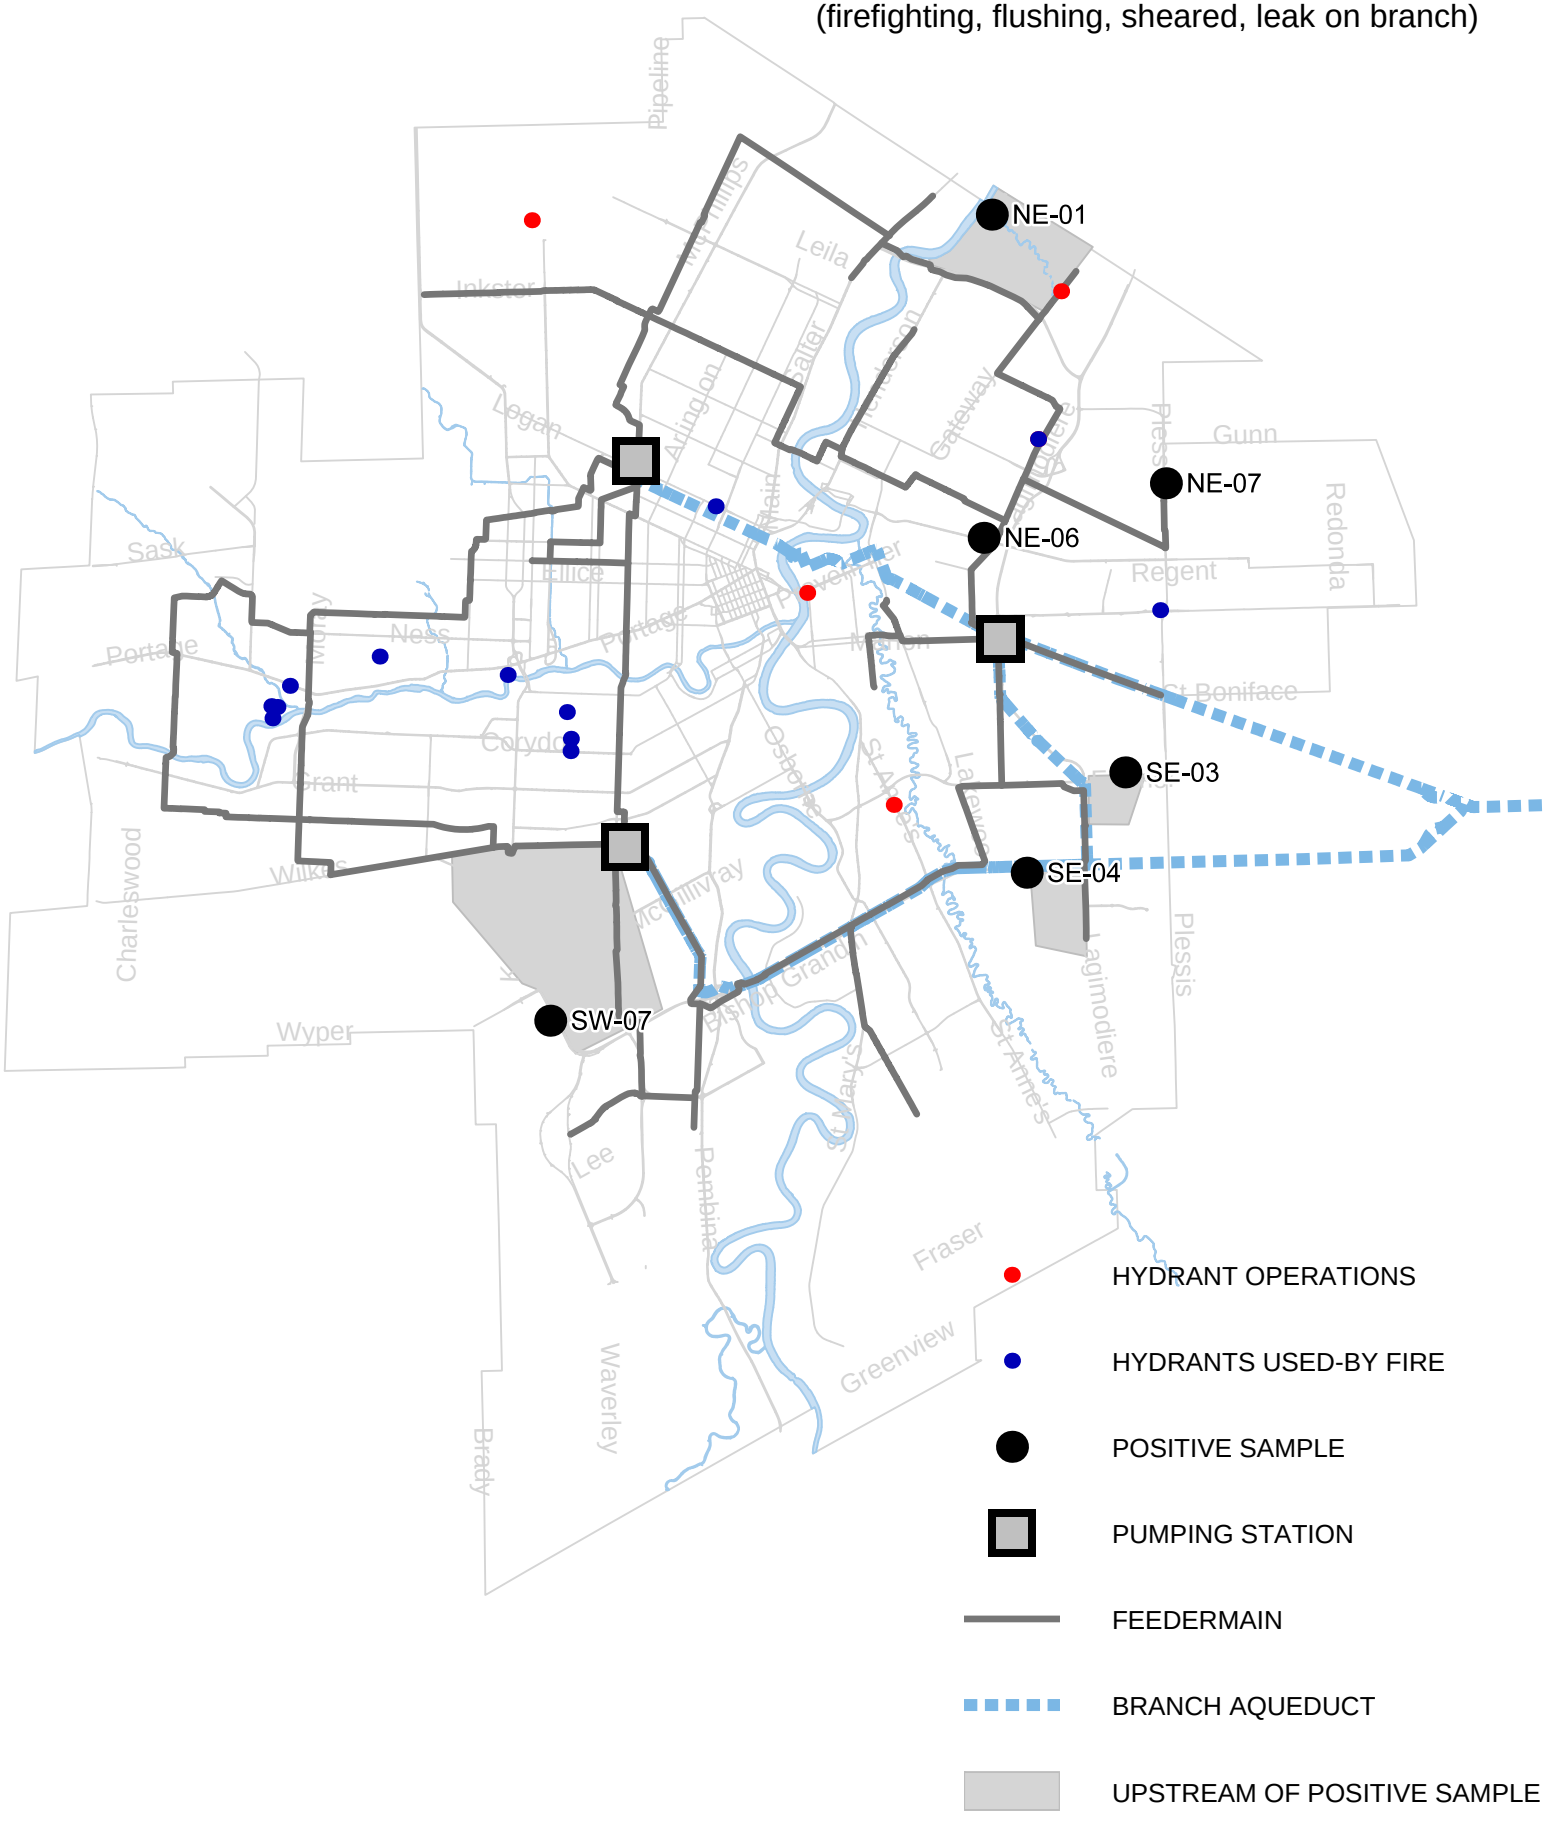

HYDRANT OPERATION

MAY 12 - 26, 2014

(firefighting, flushing, sheared, leak on branch)

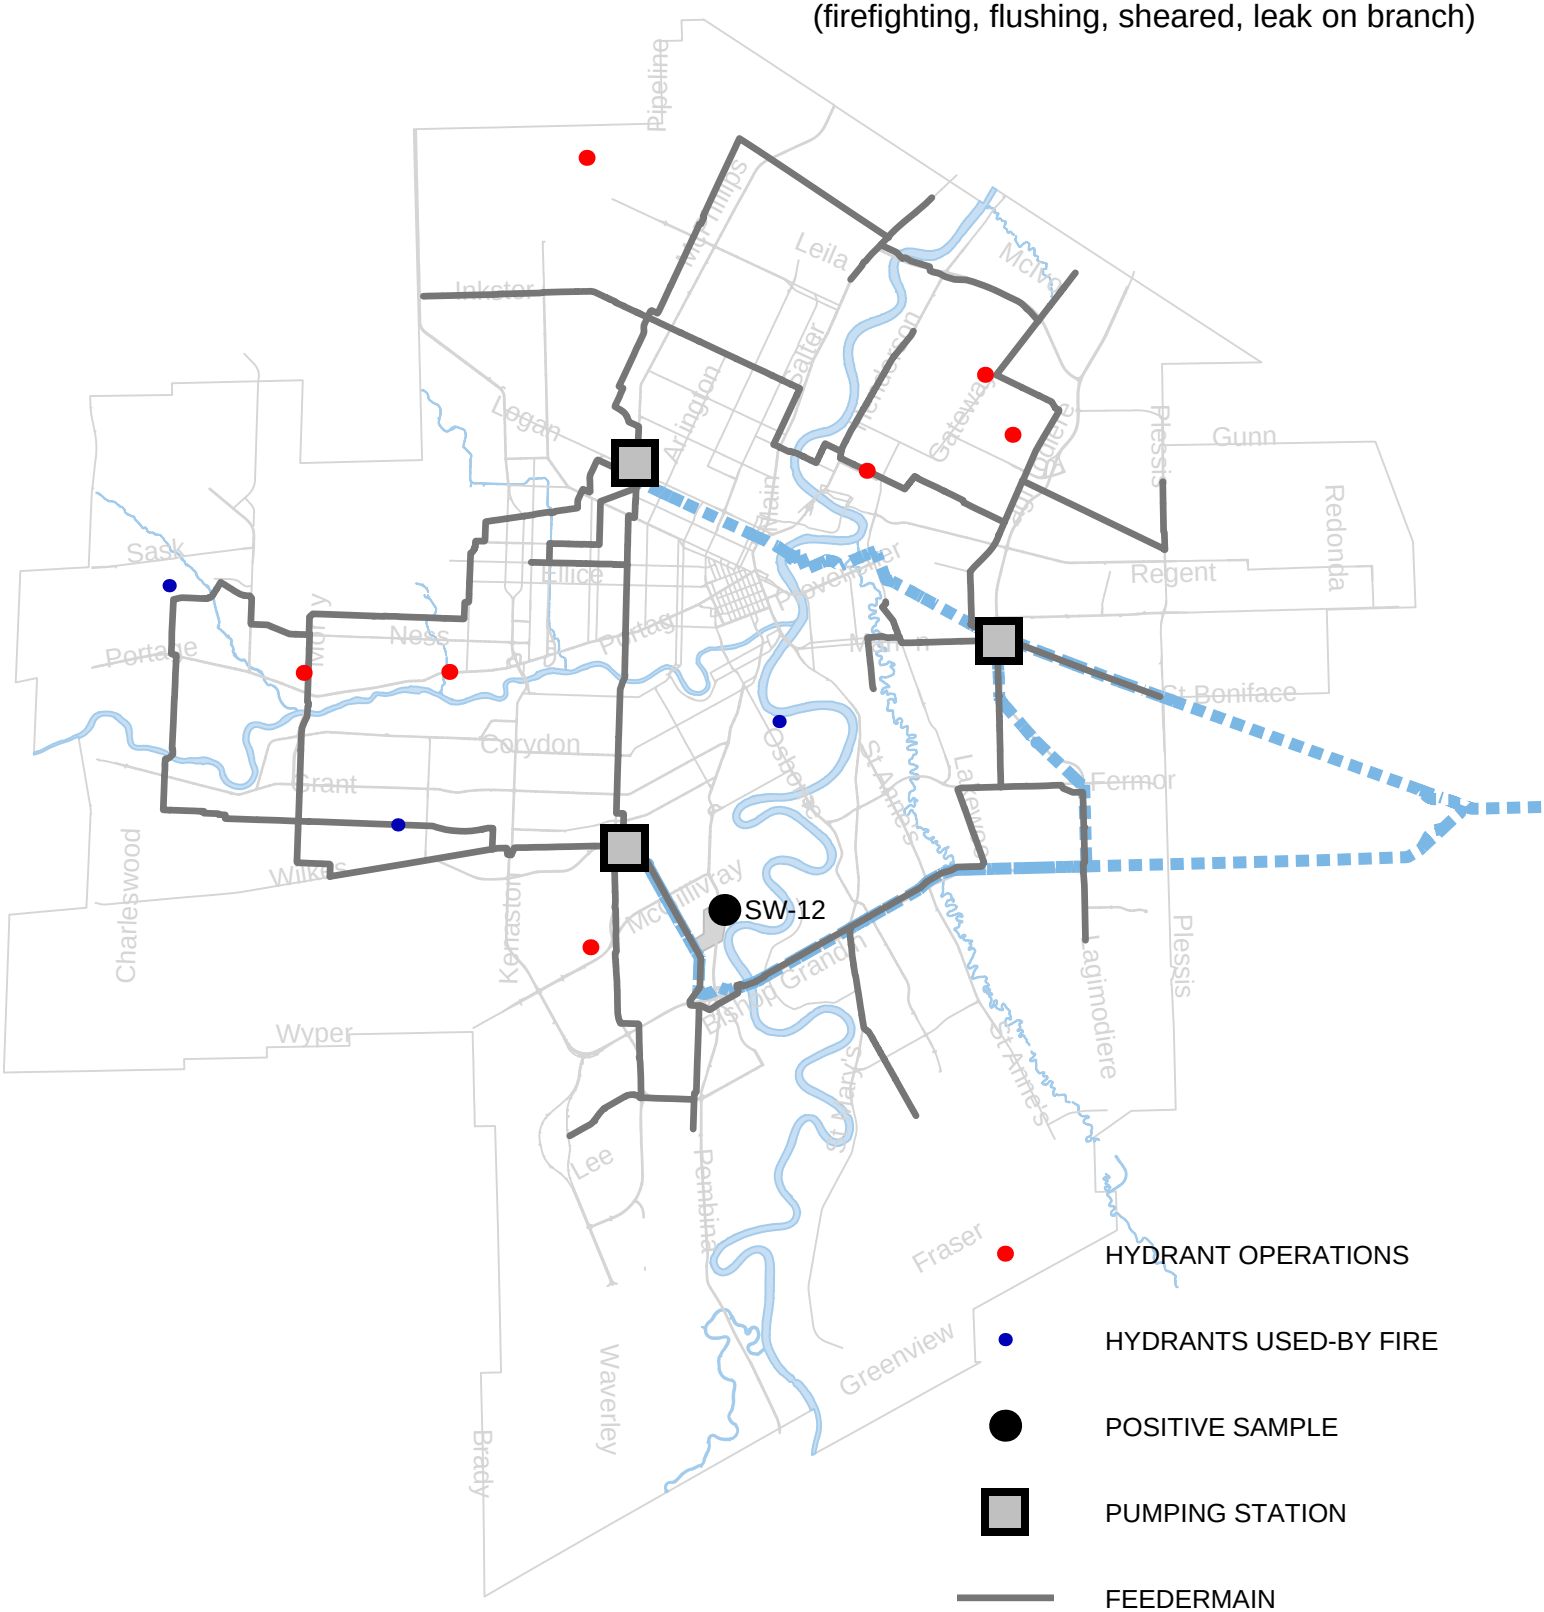

HYDRANT OPERATION

SEPTEMBER 23 - OCTOBER 7, 2013

(firefighting, flushing, sheared, leak on branch)

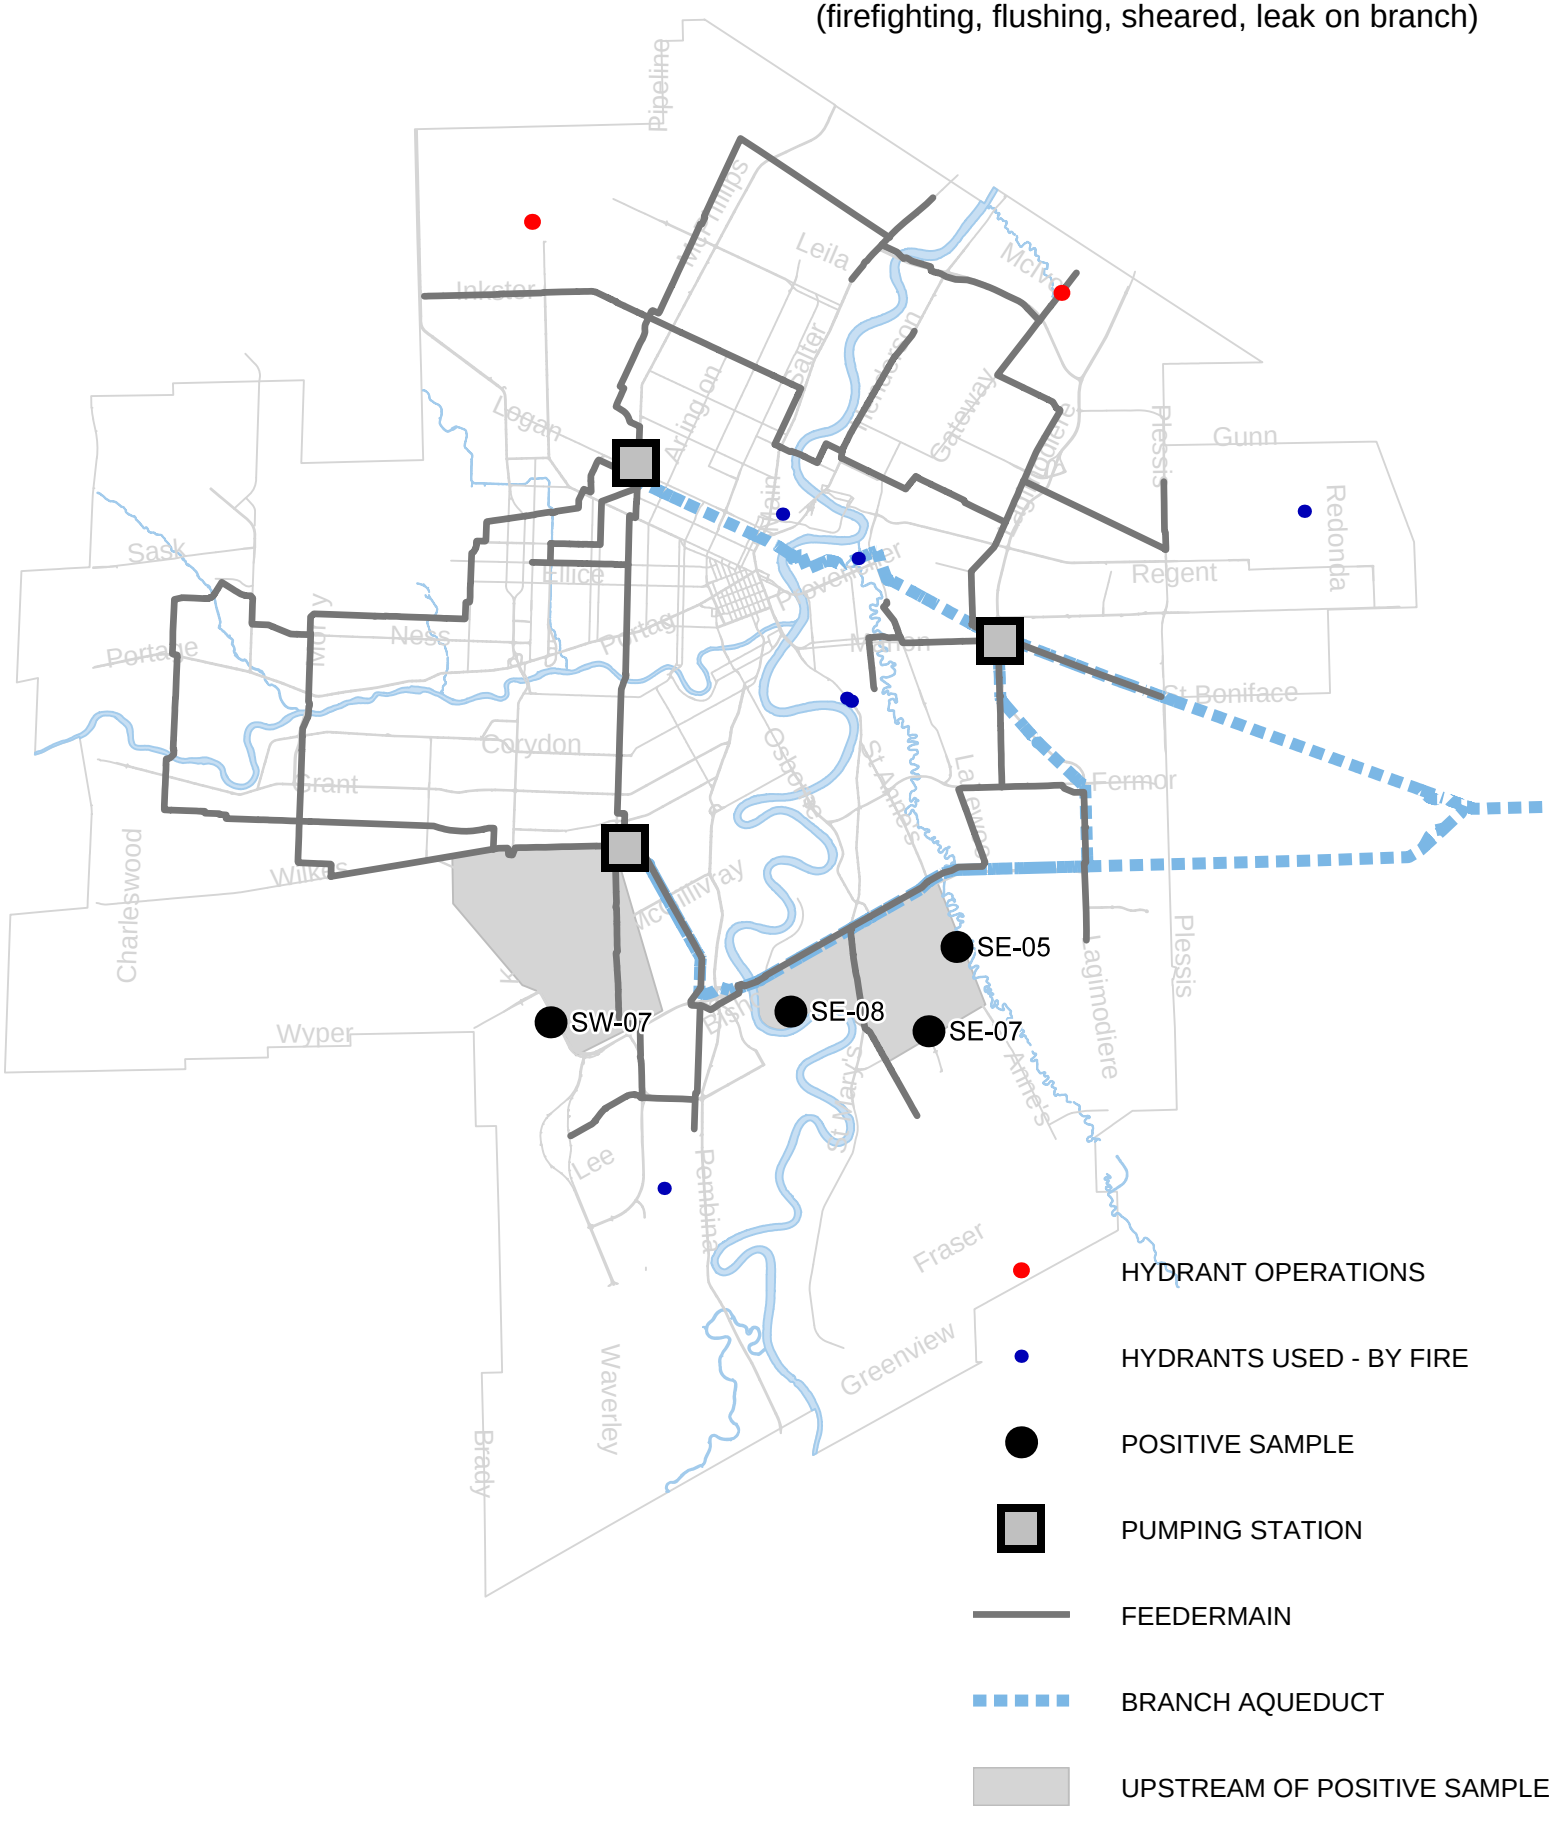

VALVE WORK

JANUARY 12 - 26, 2015

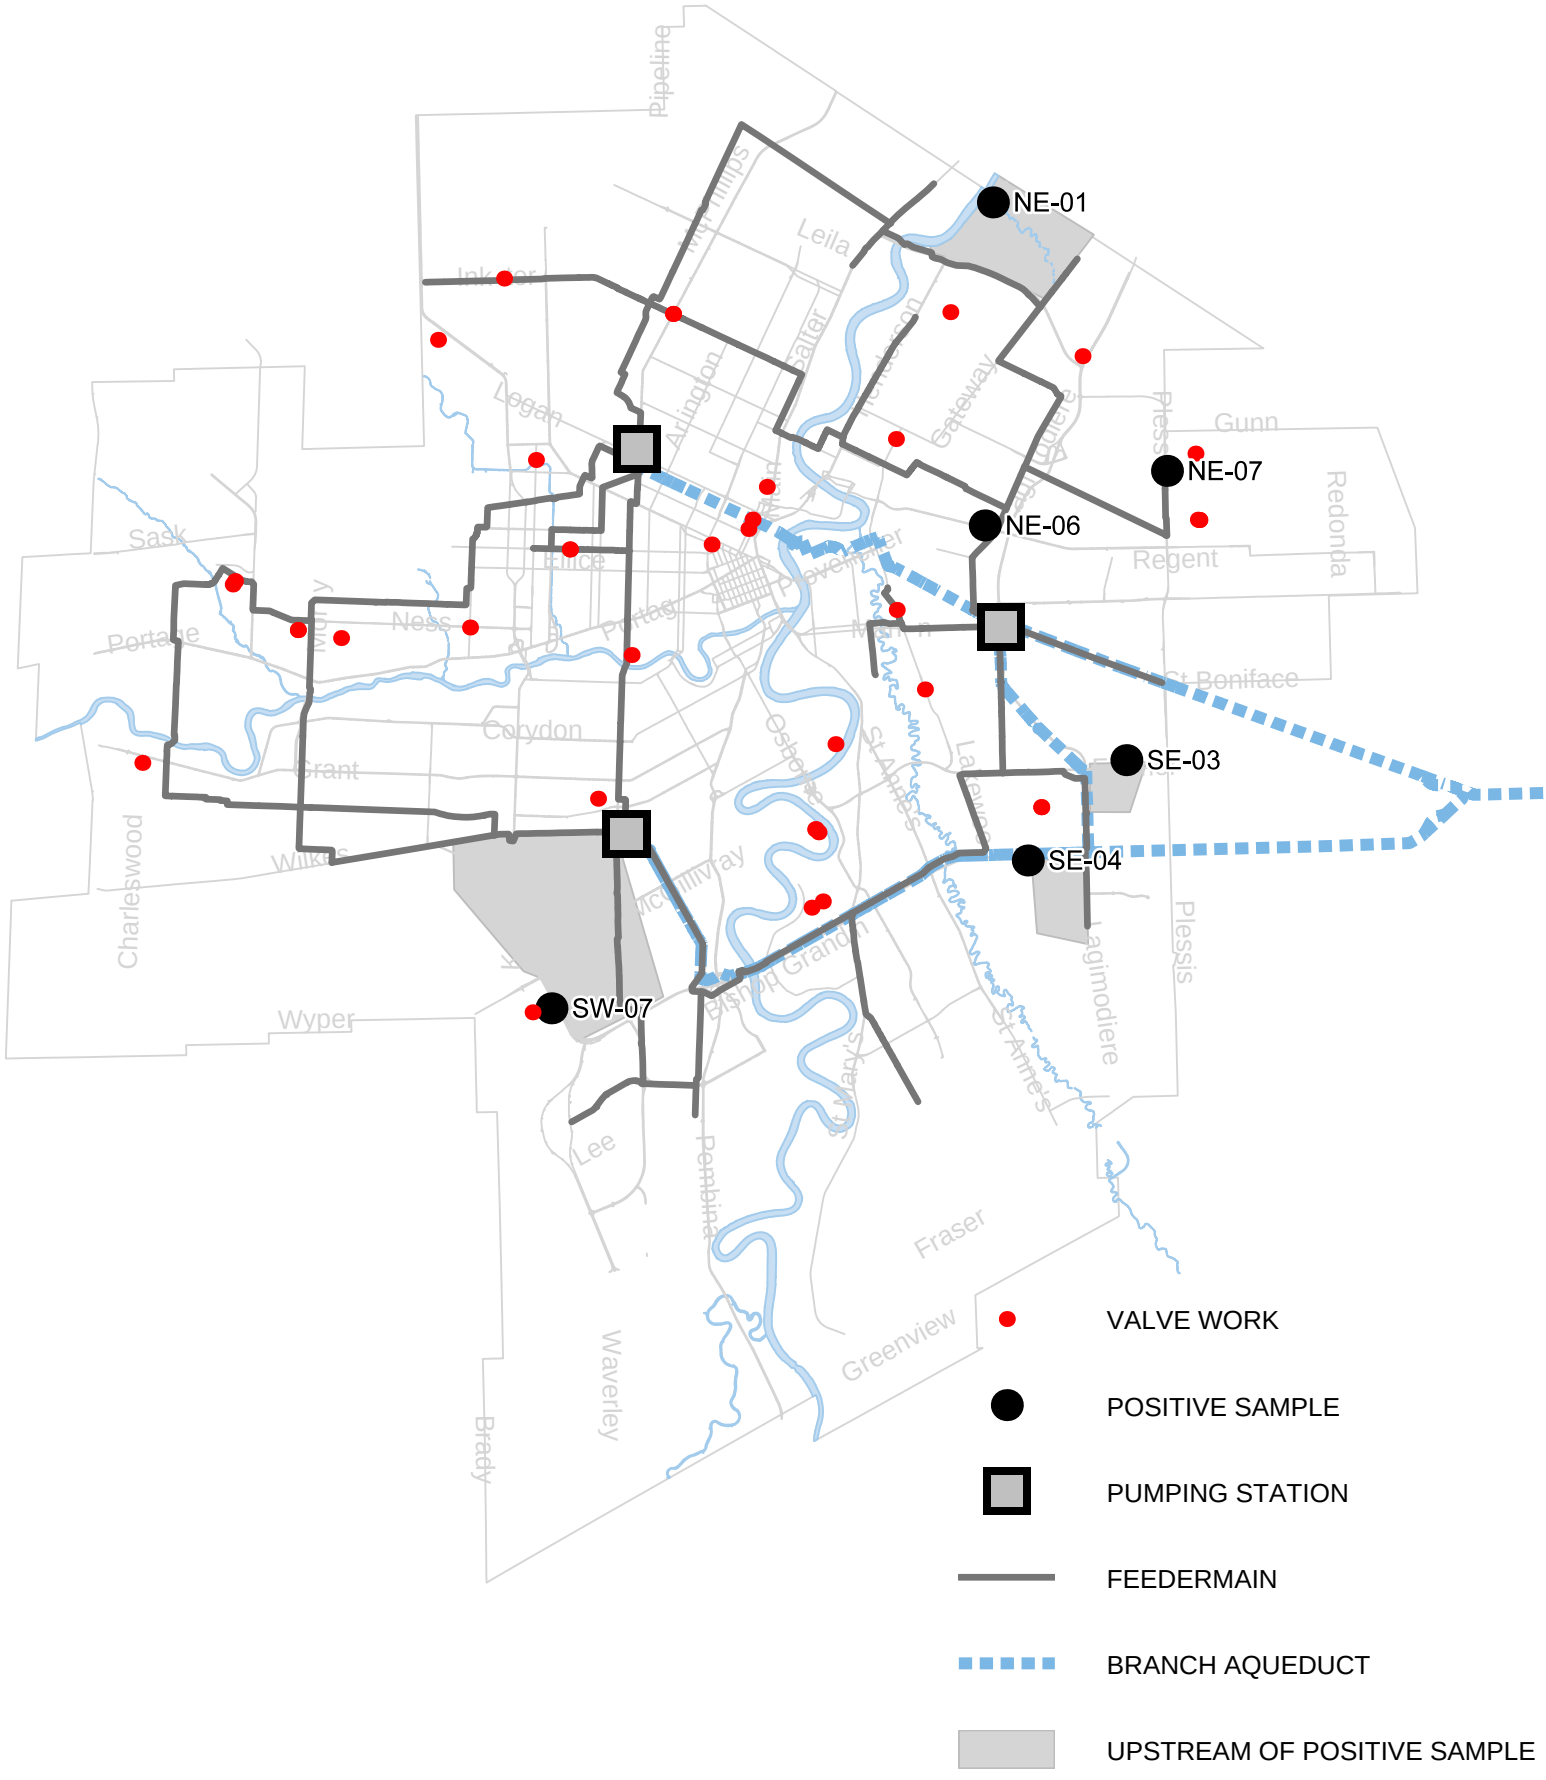

VALVE WORK

MAY 12 - 26, 2014

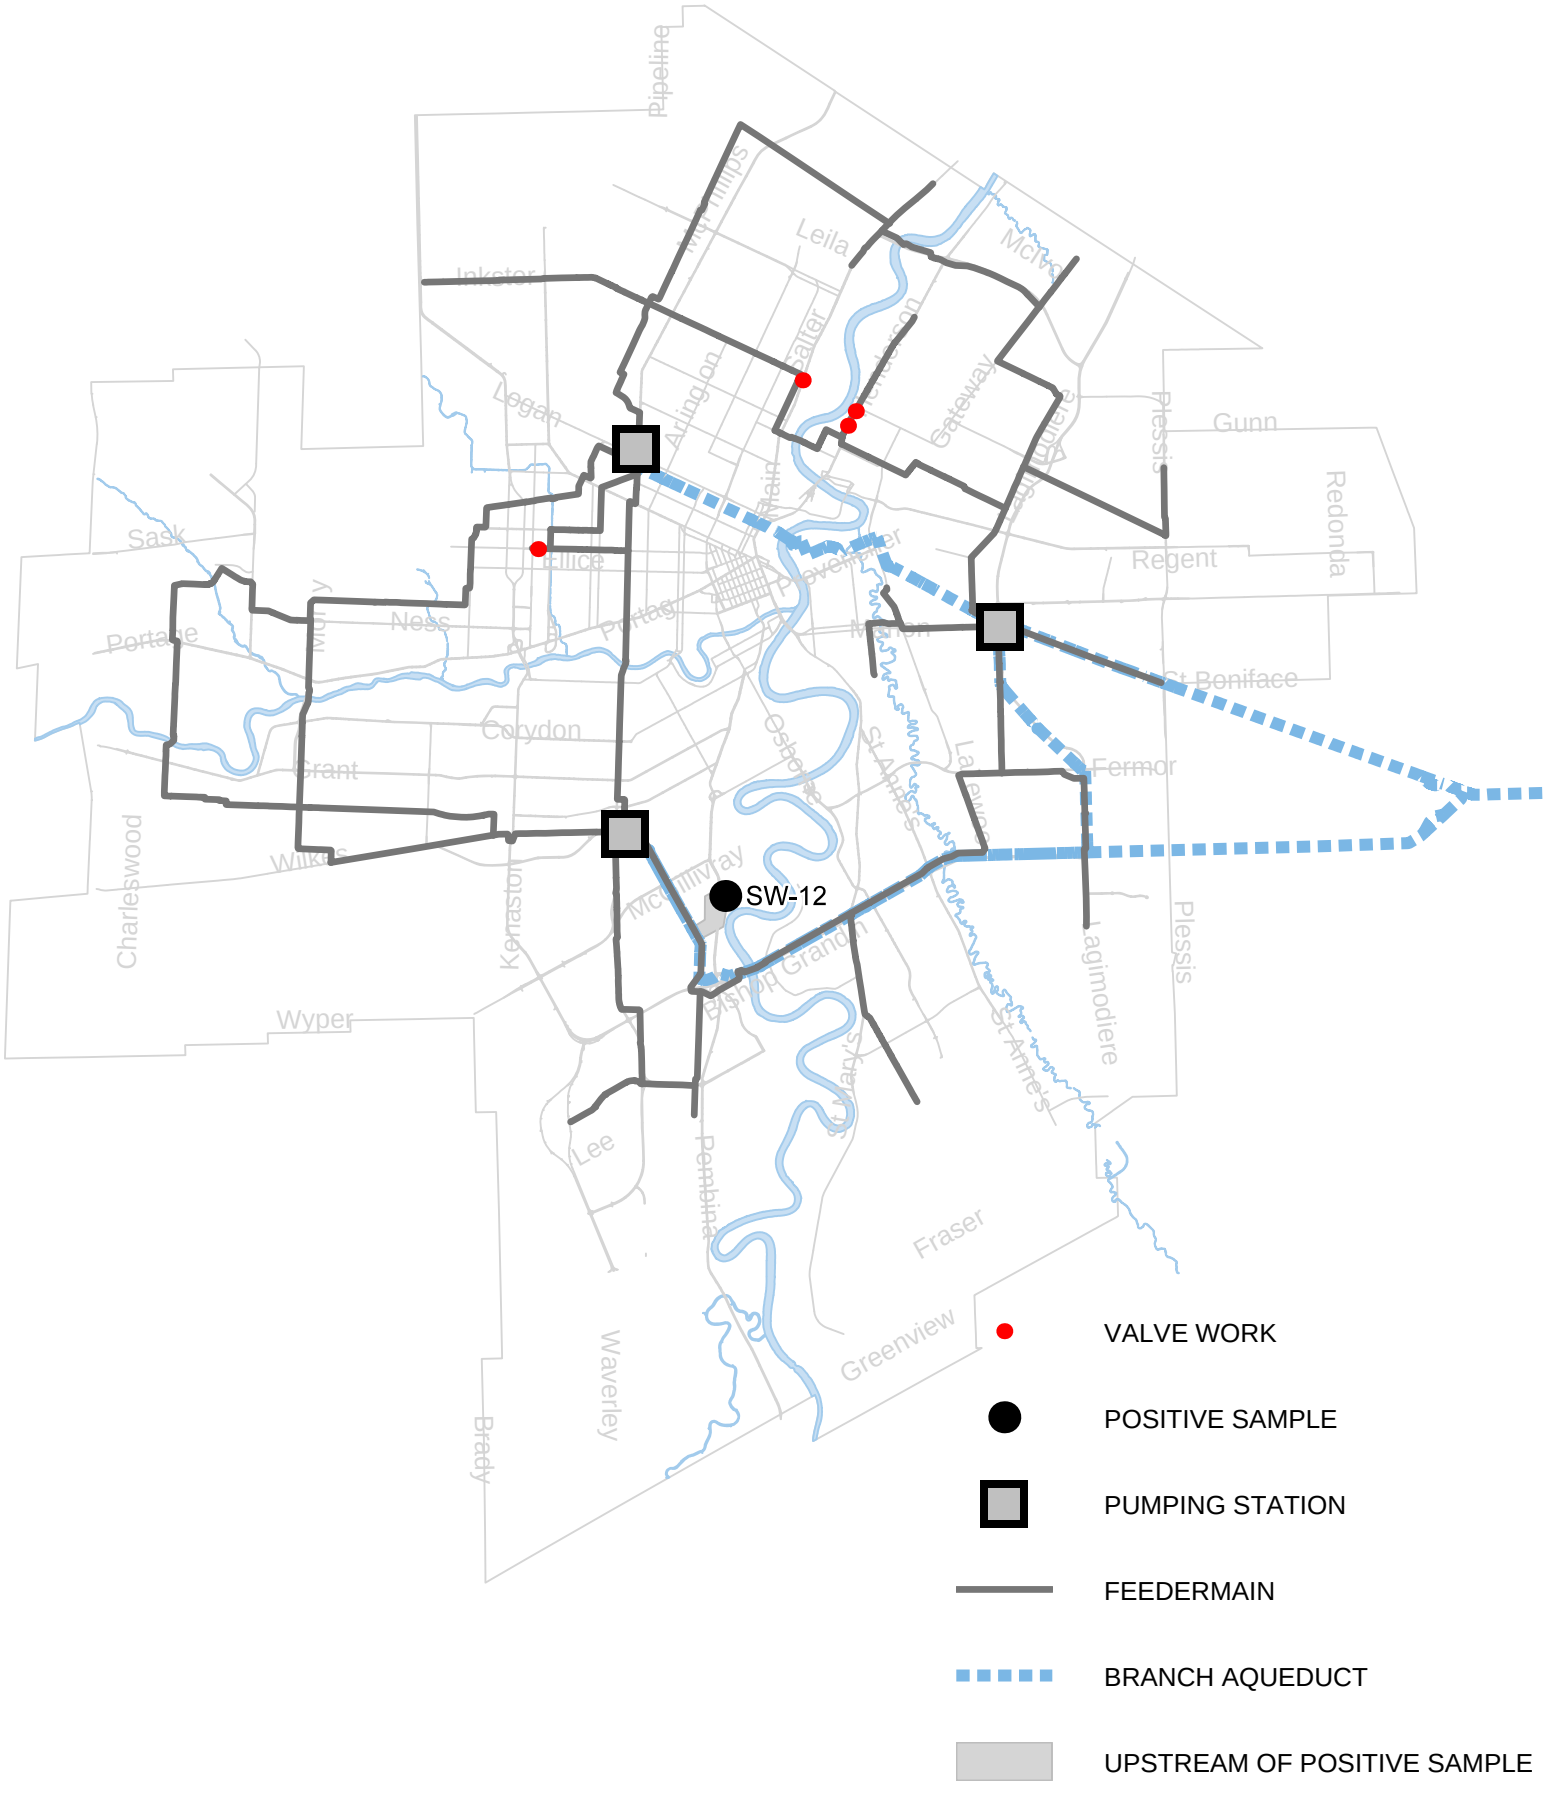

VALVE WORK

SEPTEMEBER 23 - OCTOBER 7, 2013

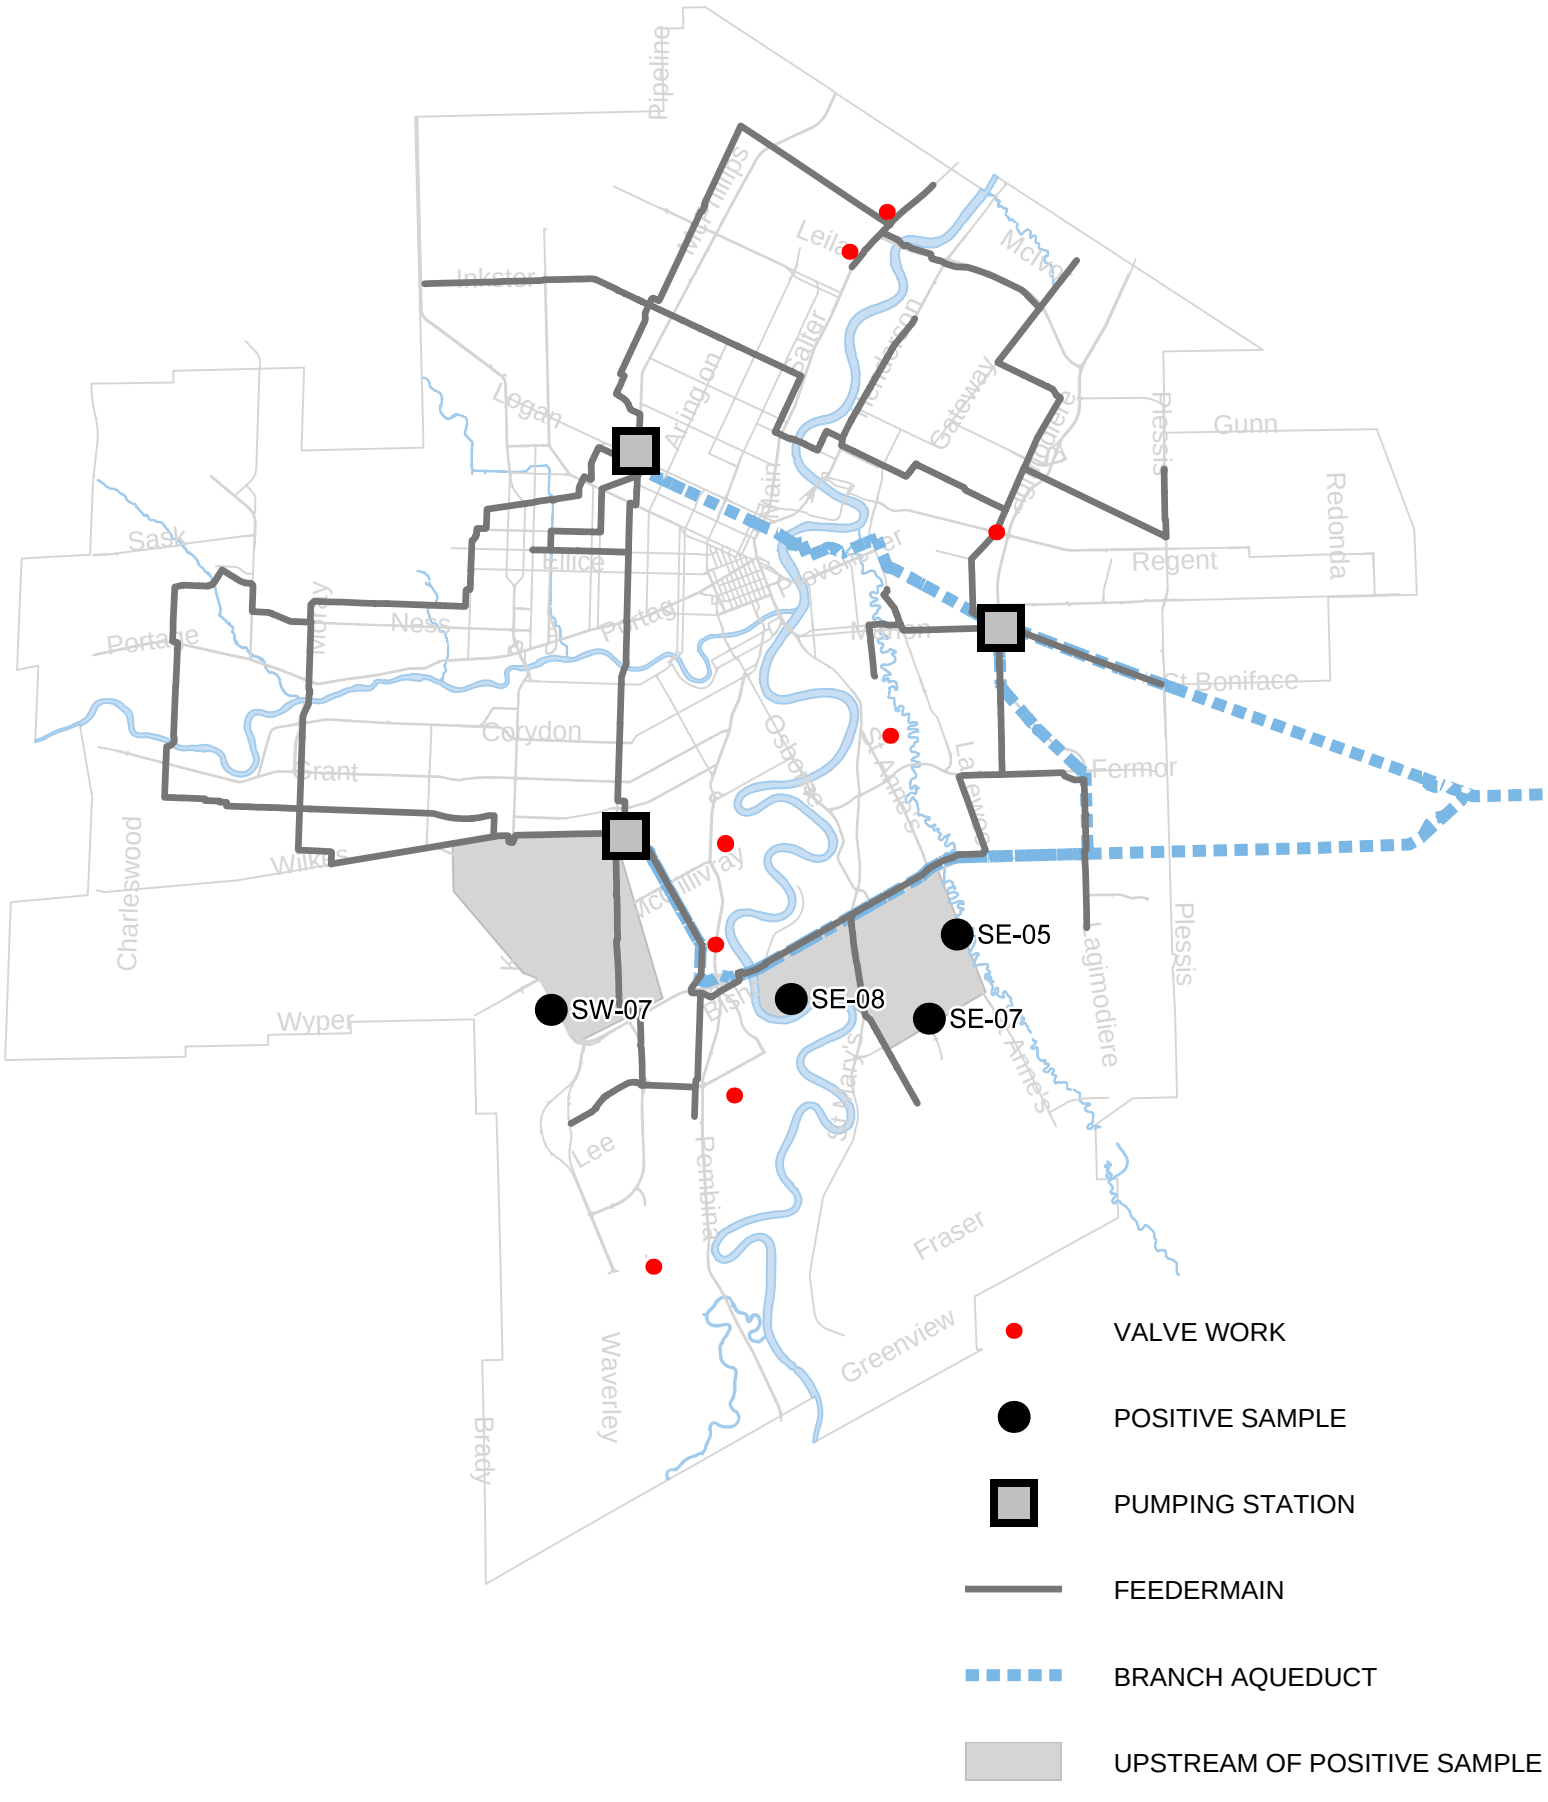

DISCOLORED WATER CALLS

JANUARY 12 - 26, 2015

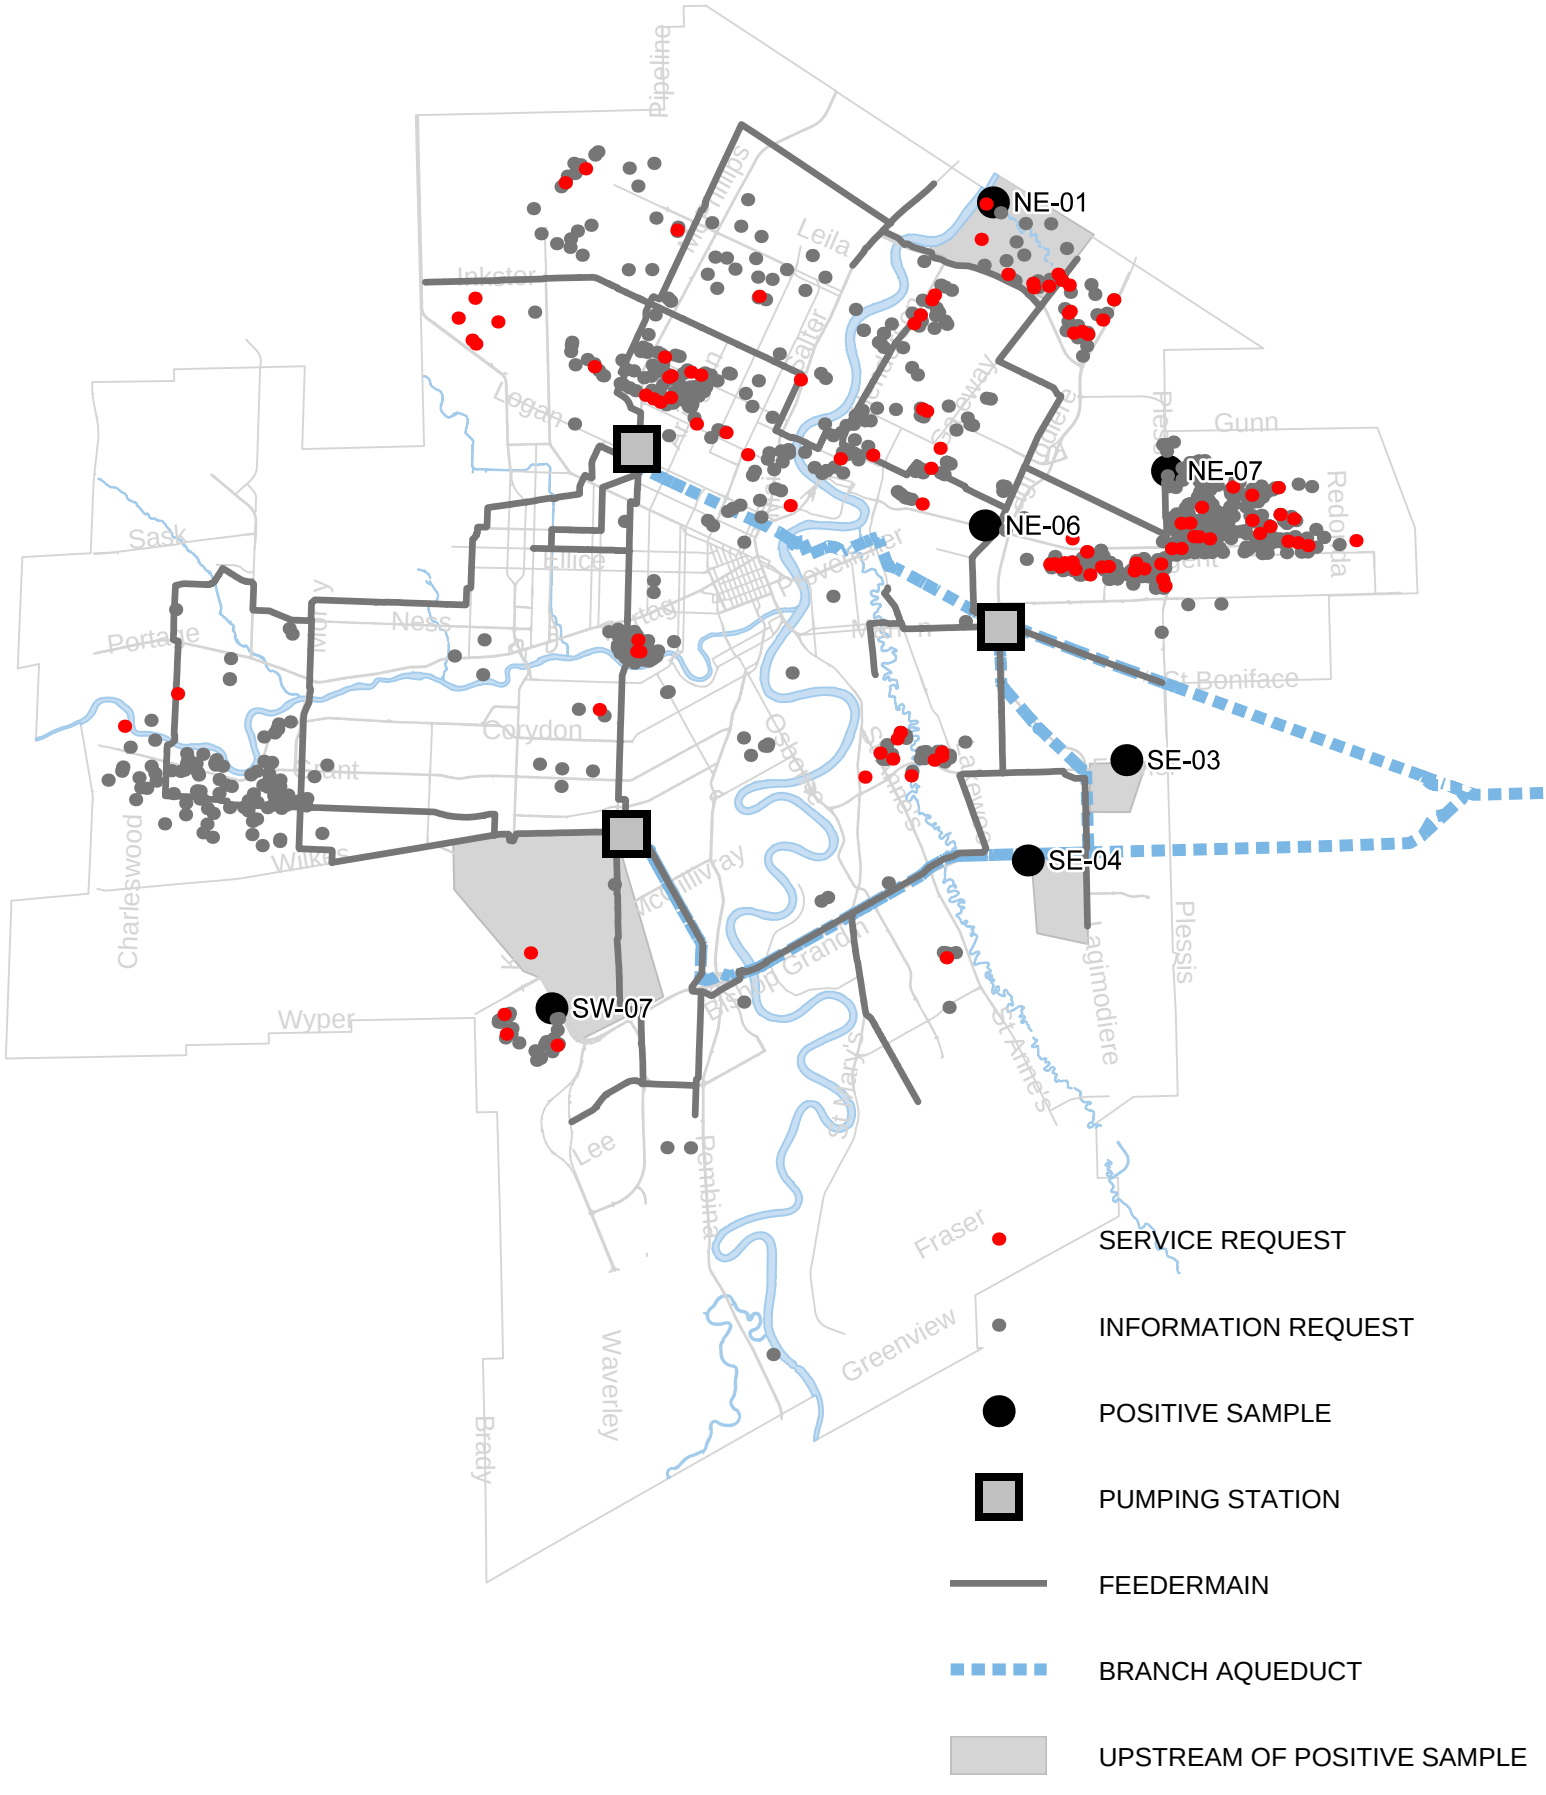

DISCOLORED WATER CALLS

MAY 12- MAY 26, 2014

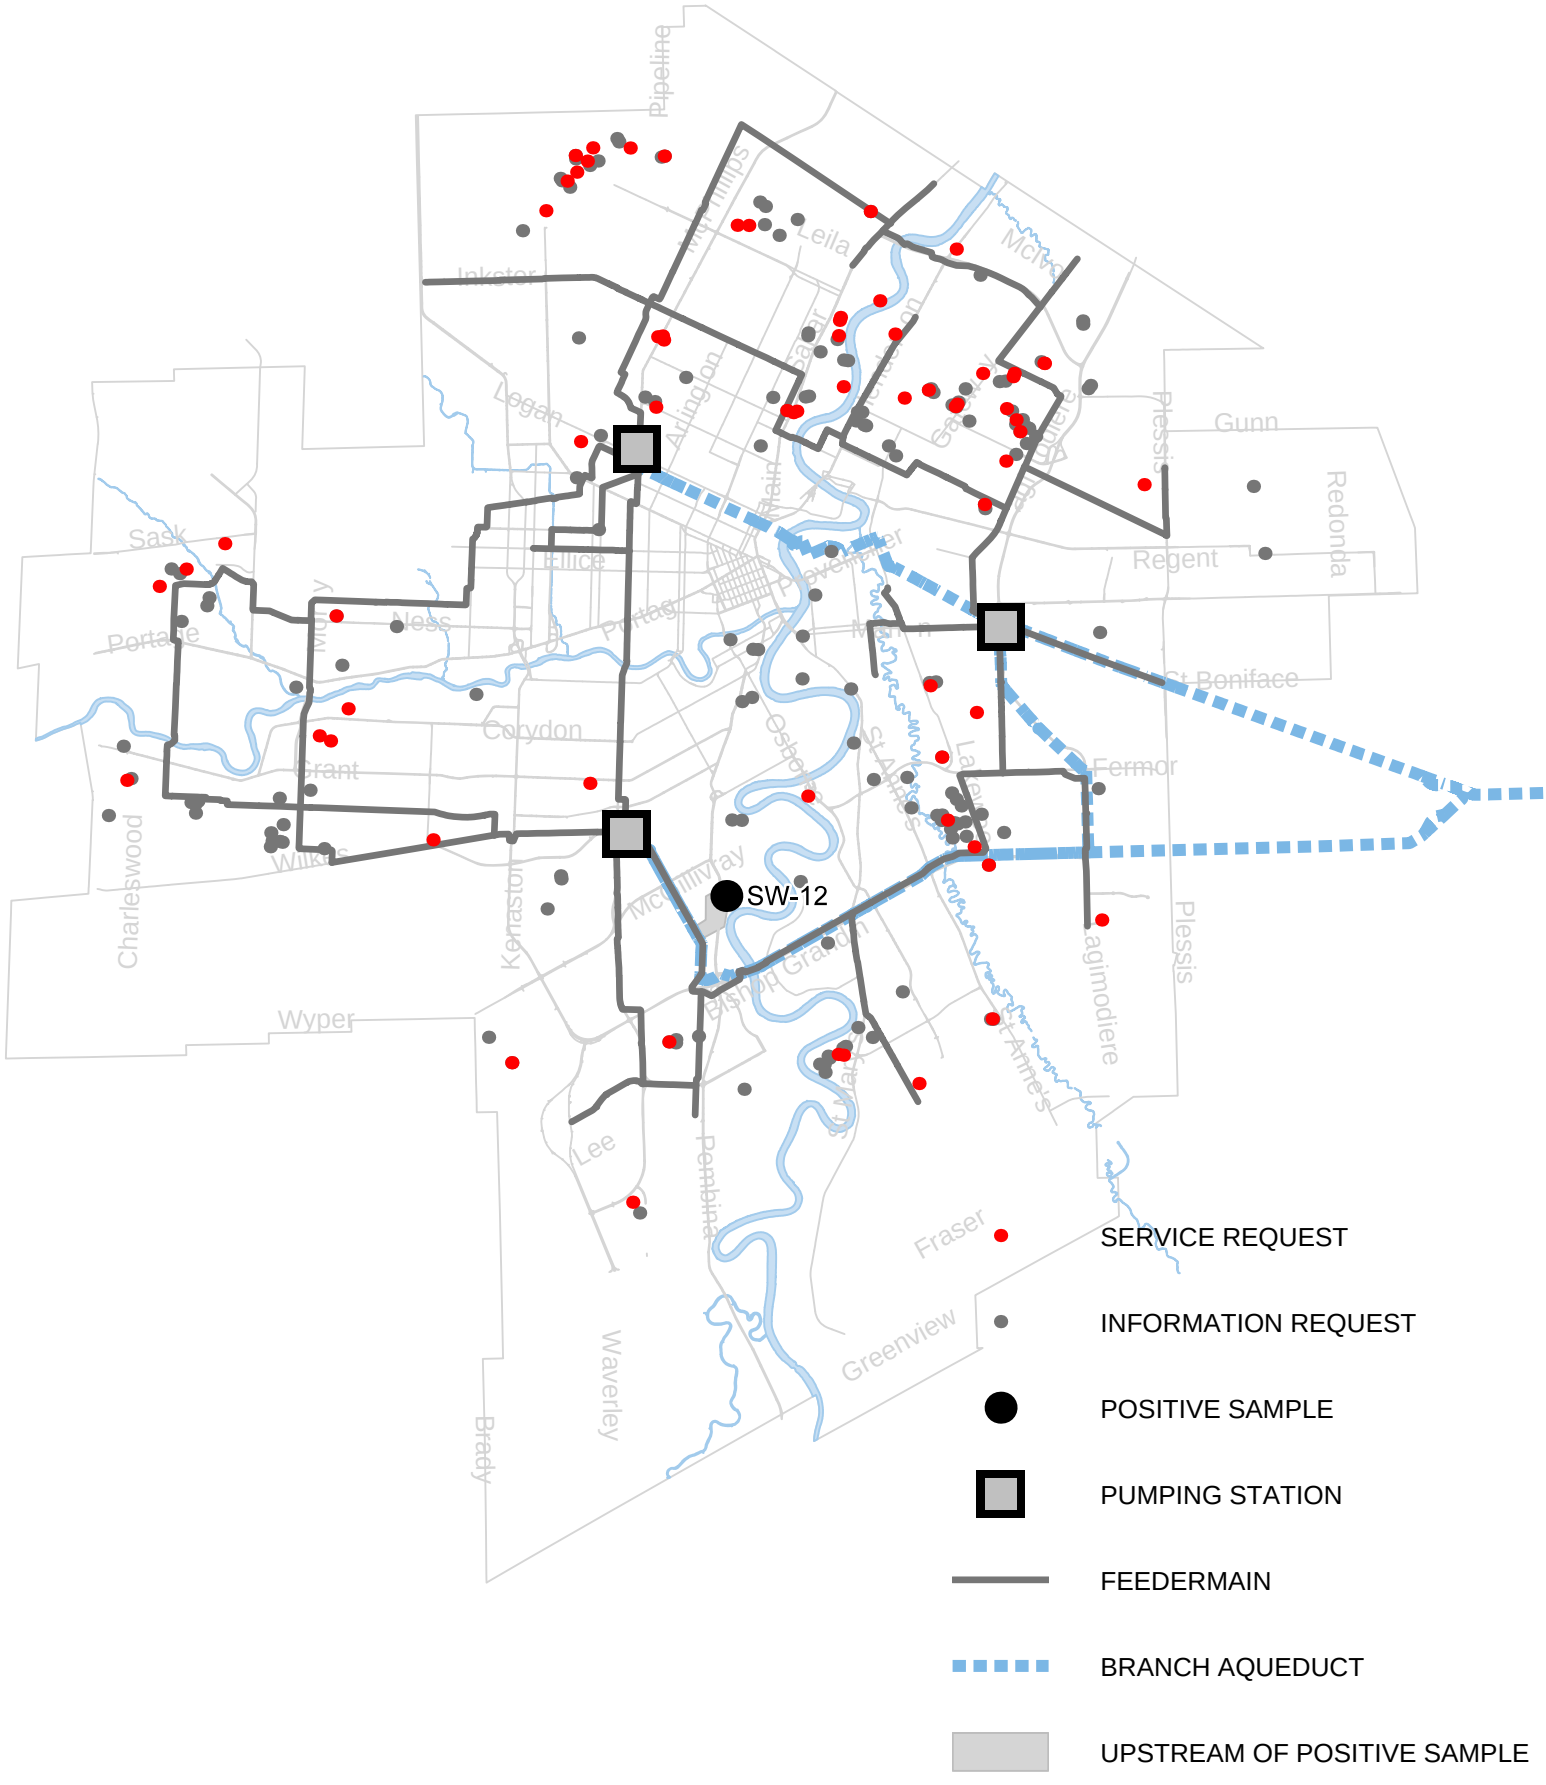

DISCOLORED WATER CALLS

SEPTEMBER 23- OCTOBER 7, 2013

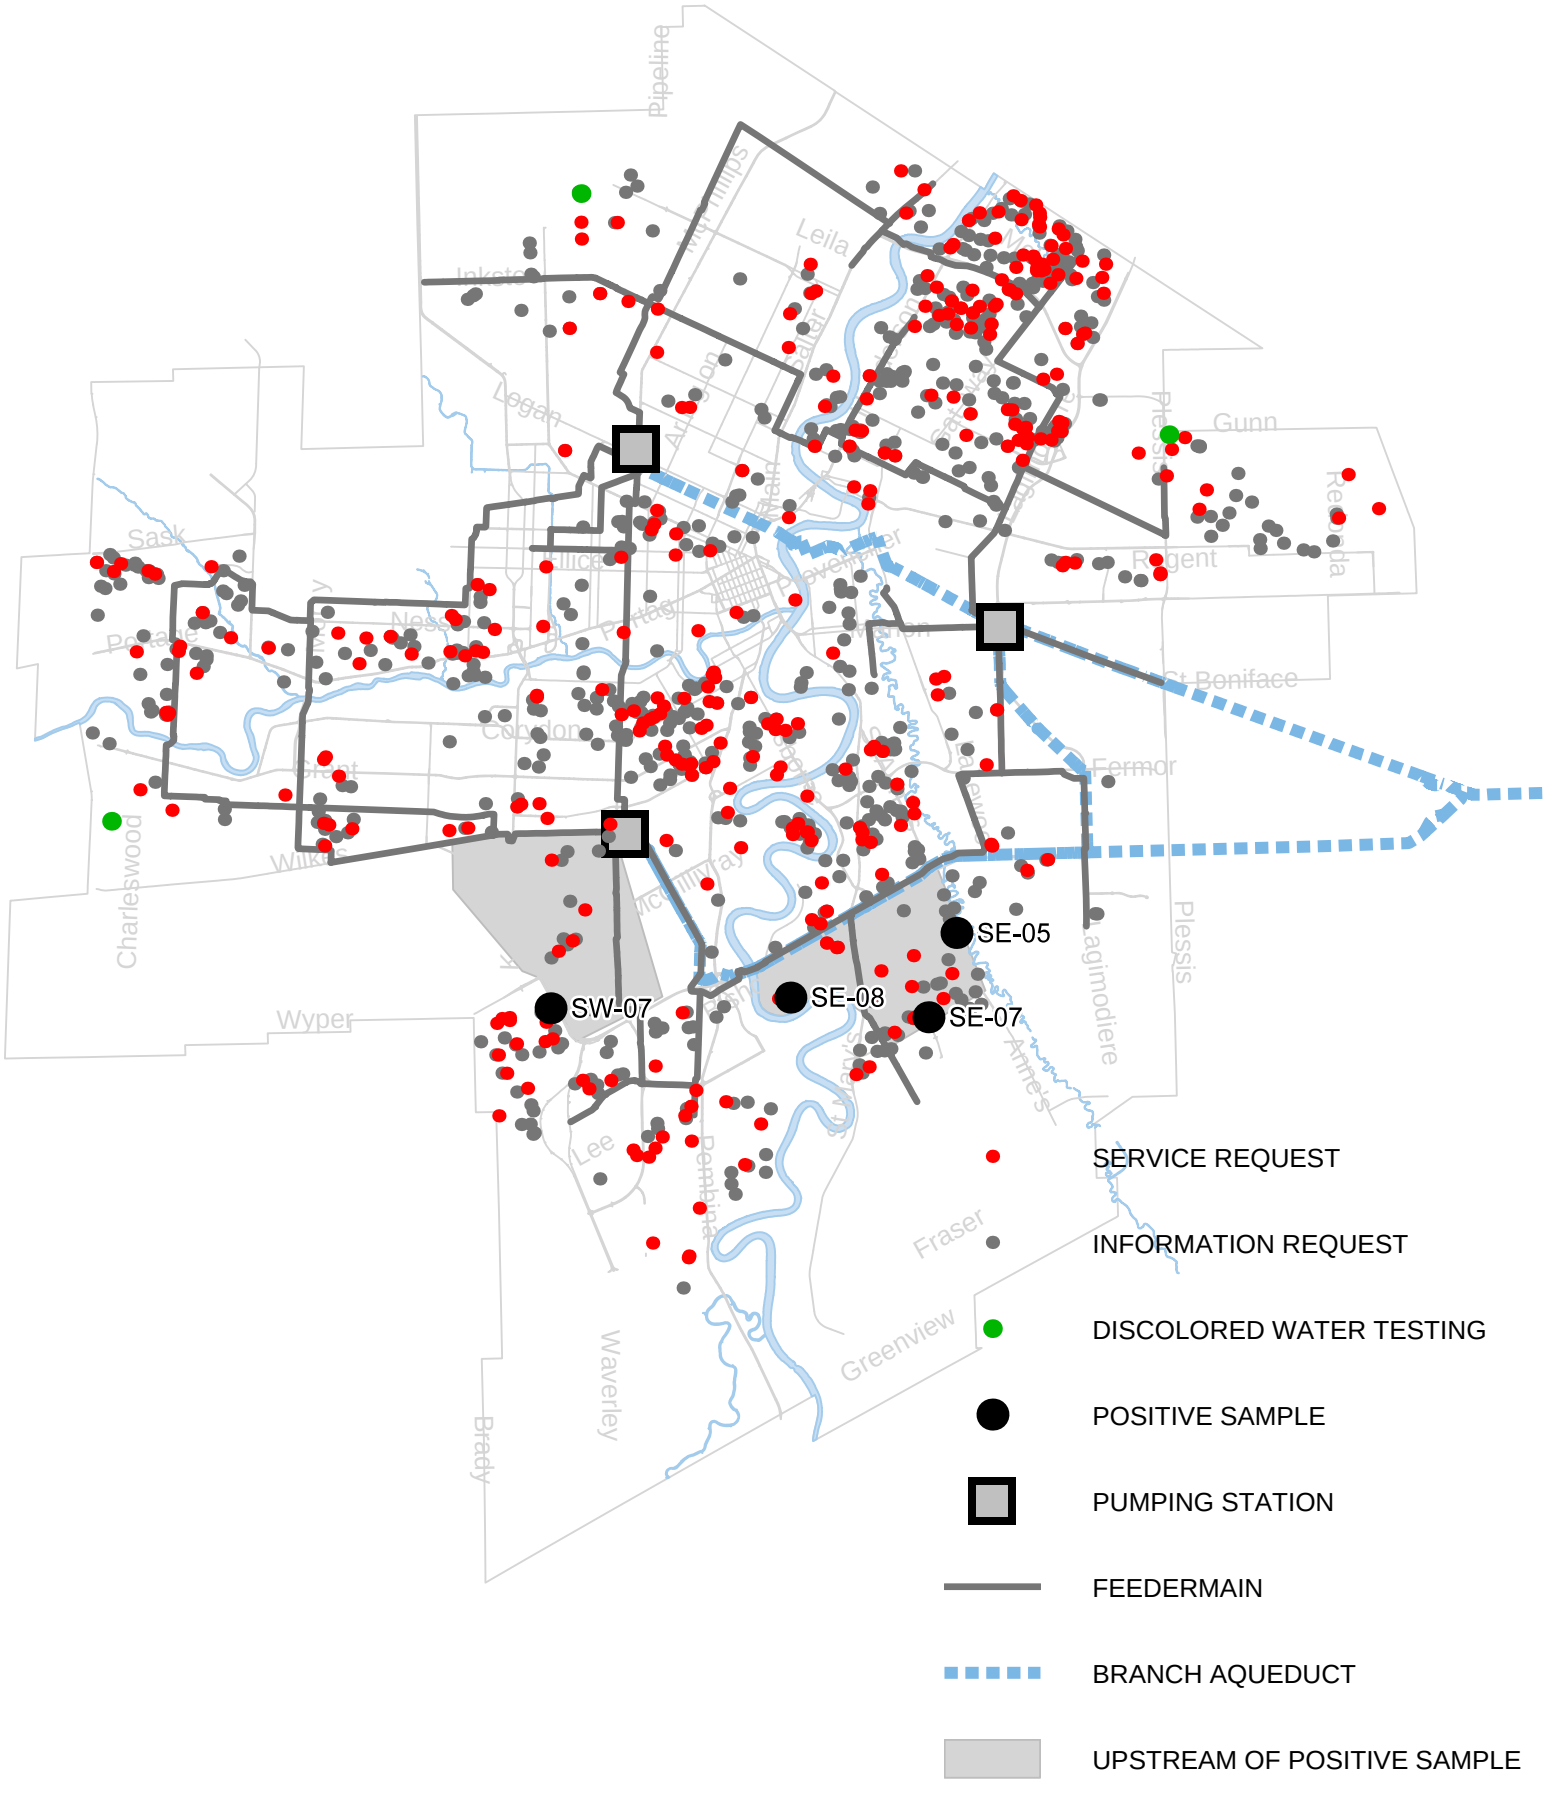

DISCOLORED WATER CALLS

JANUARY 26, 2015

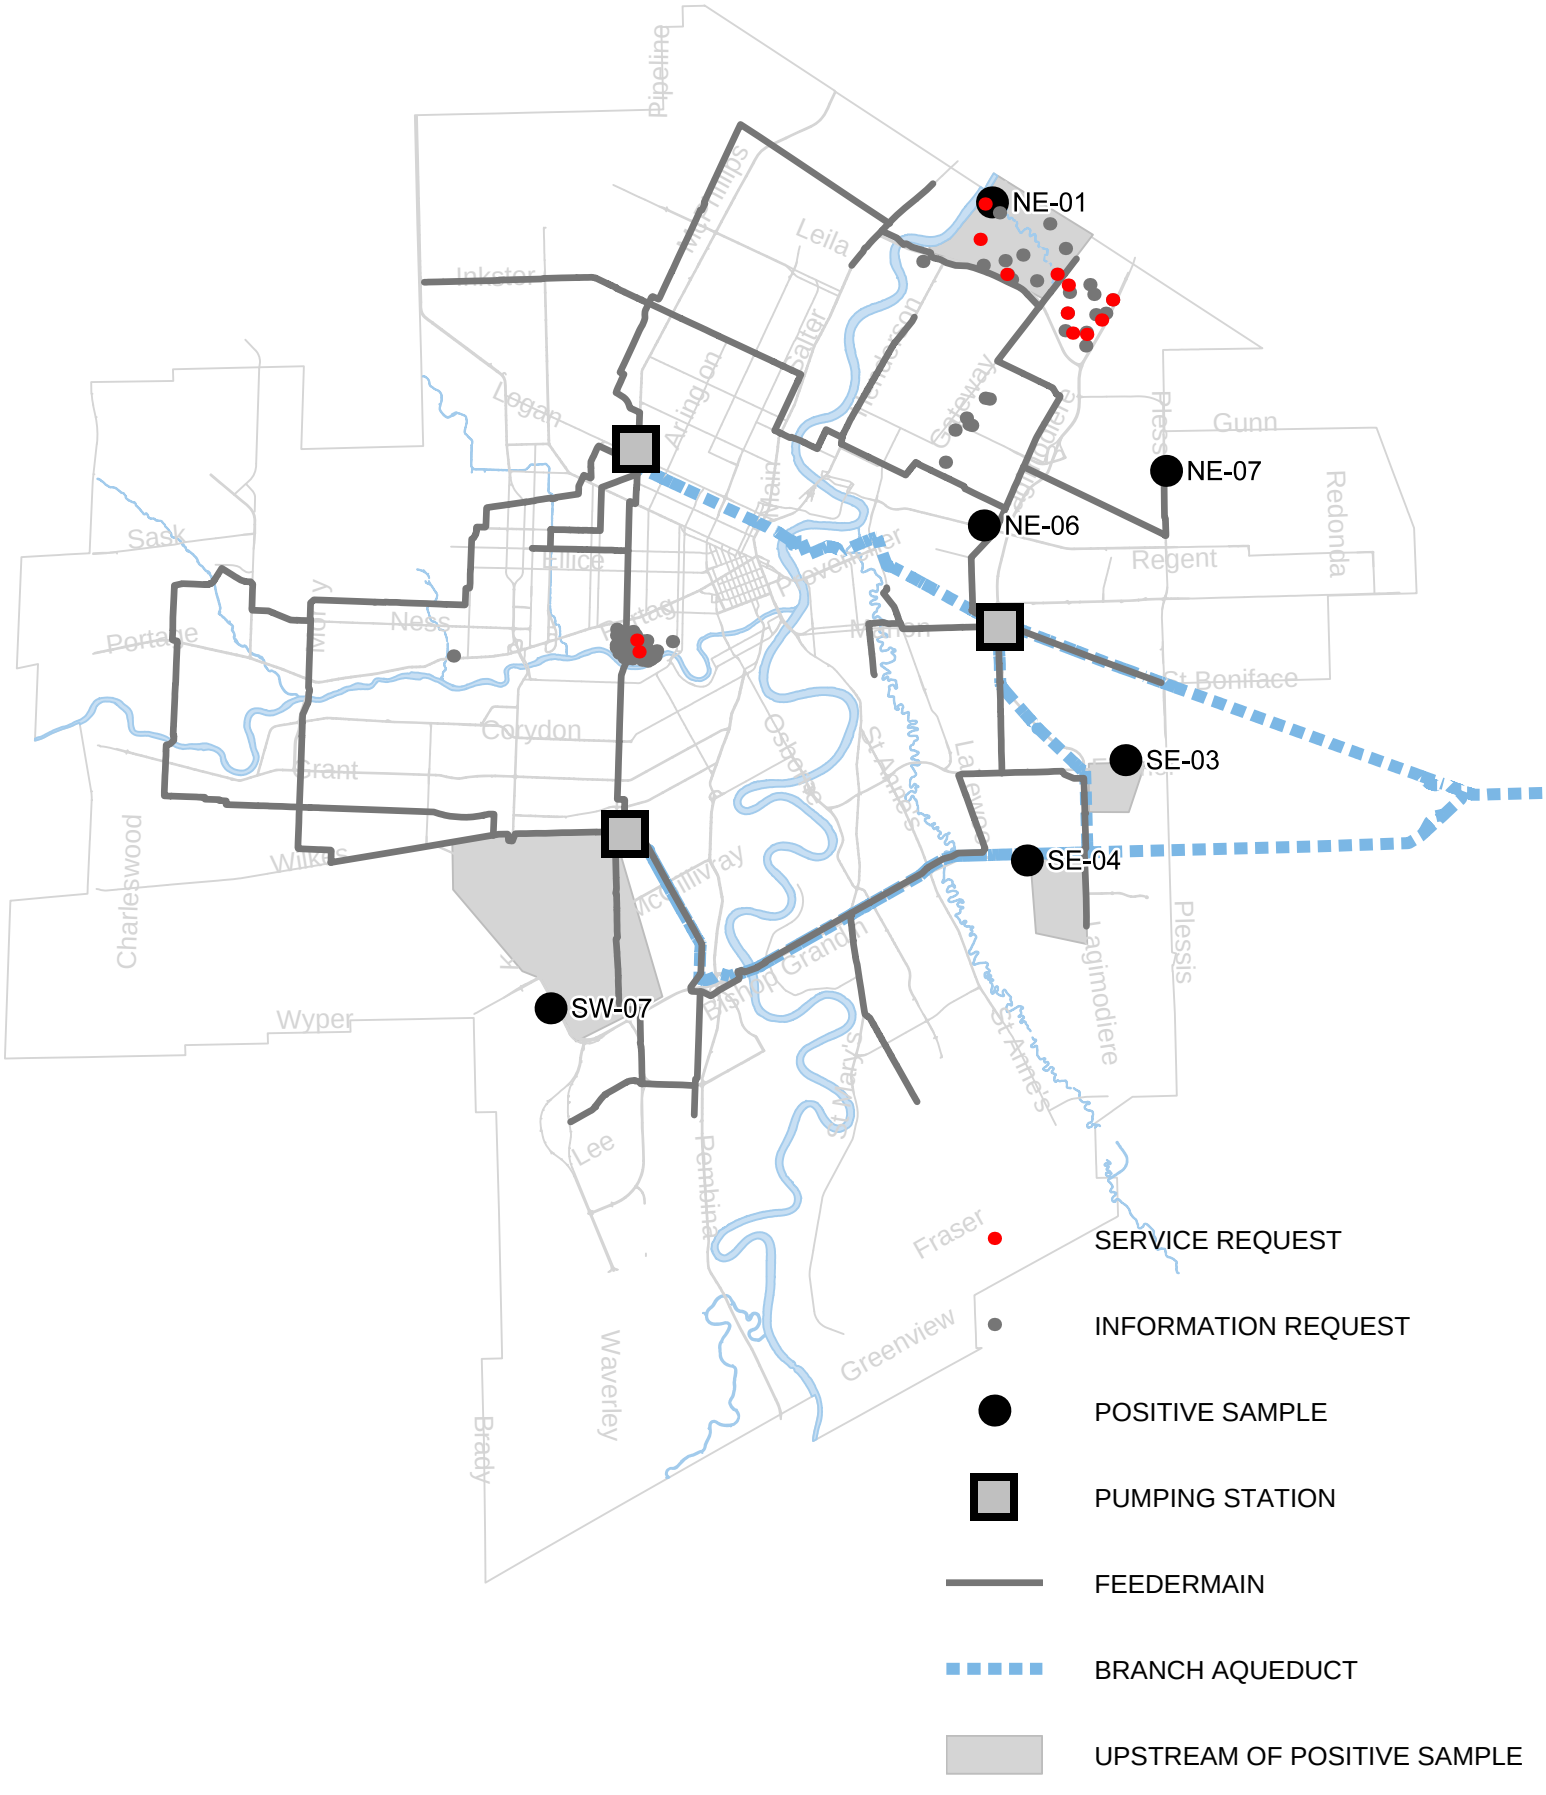

DISCOLORED WATER CALLS

JANUARY 18, 2015

(BIRD'S HILL FEEDERMAIN CLOSURE)

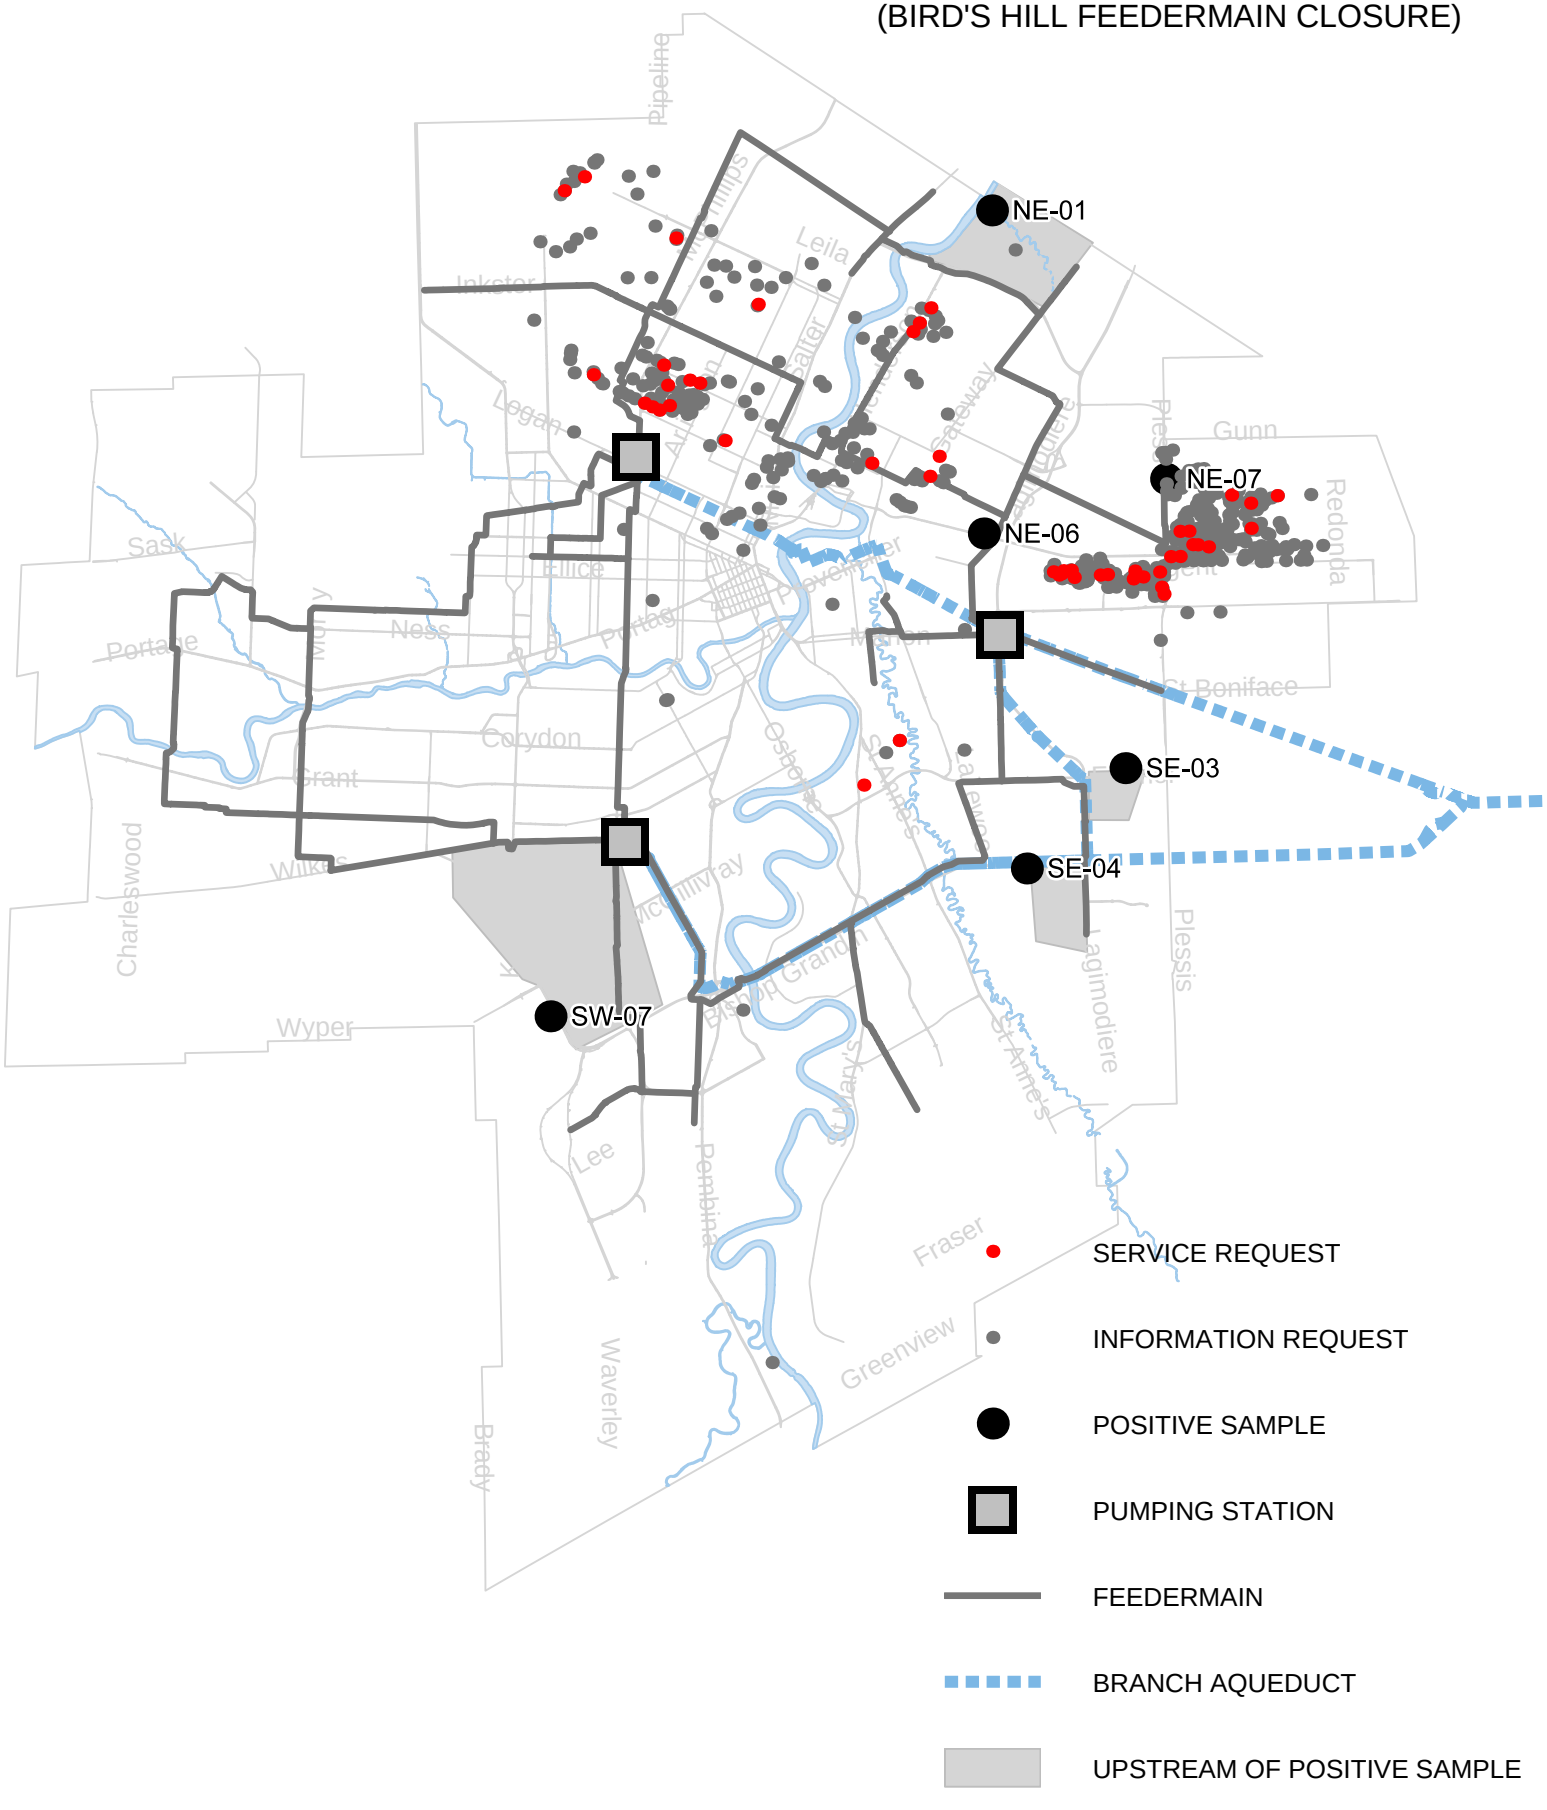

DISCOLORED WATER CALLS

DECEMBER 26, 2014

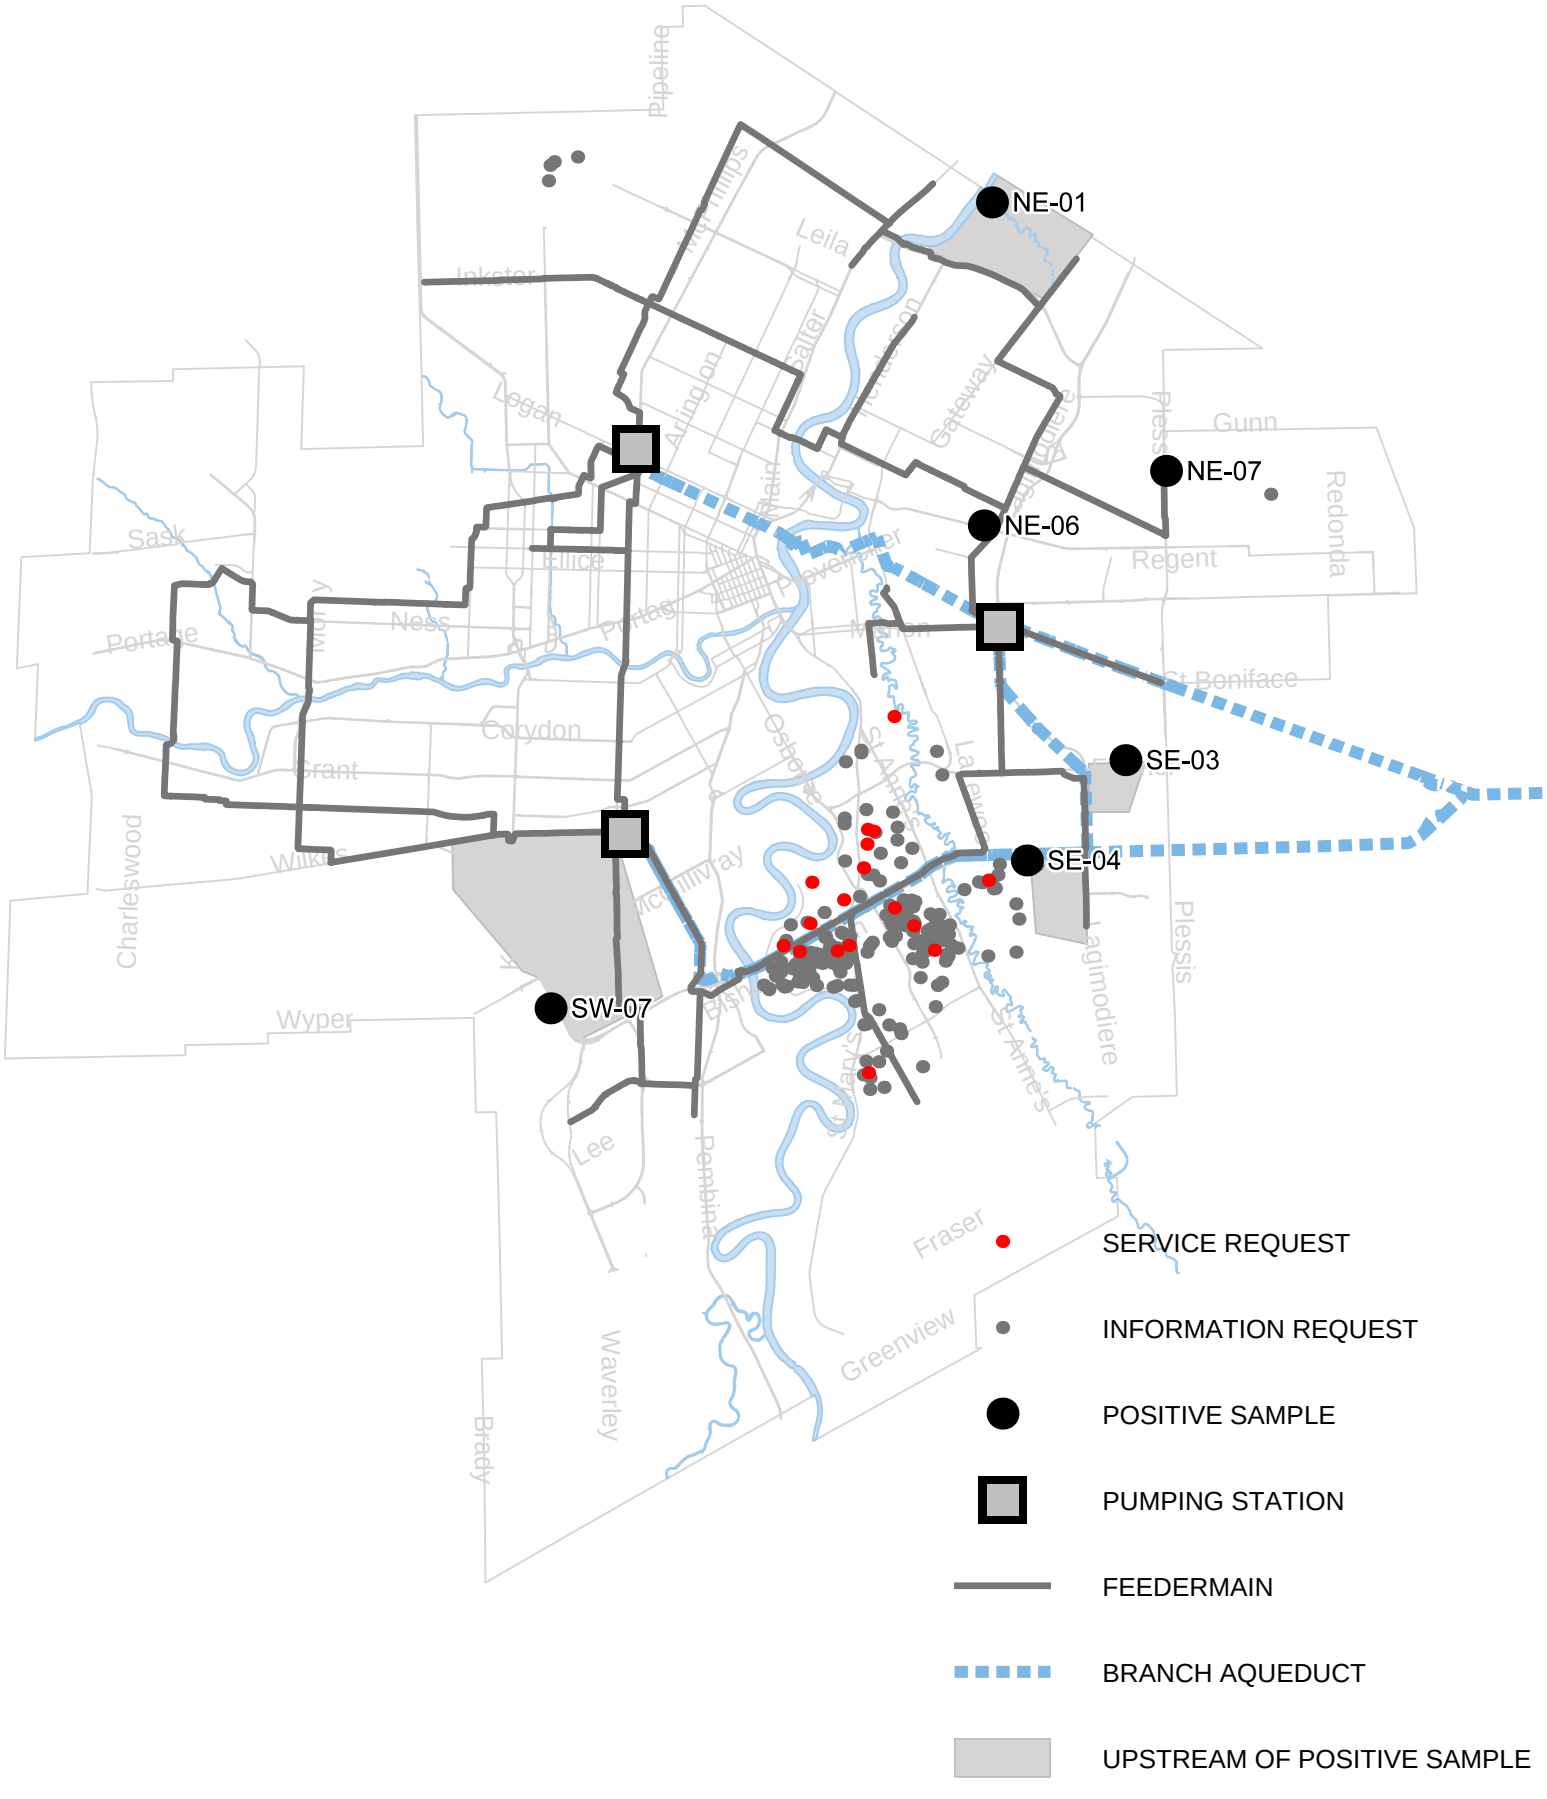

MISCELLANEOUS DAILY WORK

JANUARY 12-26, 2015

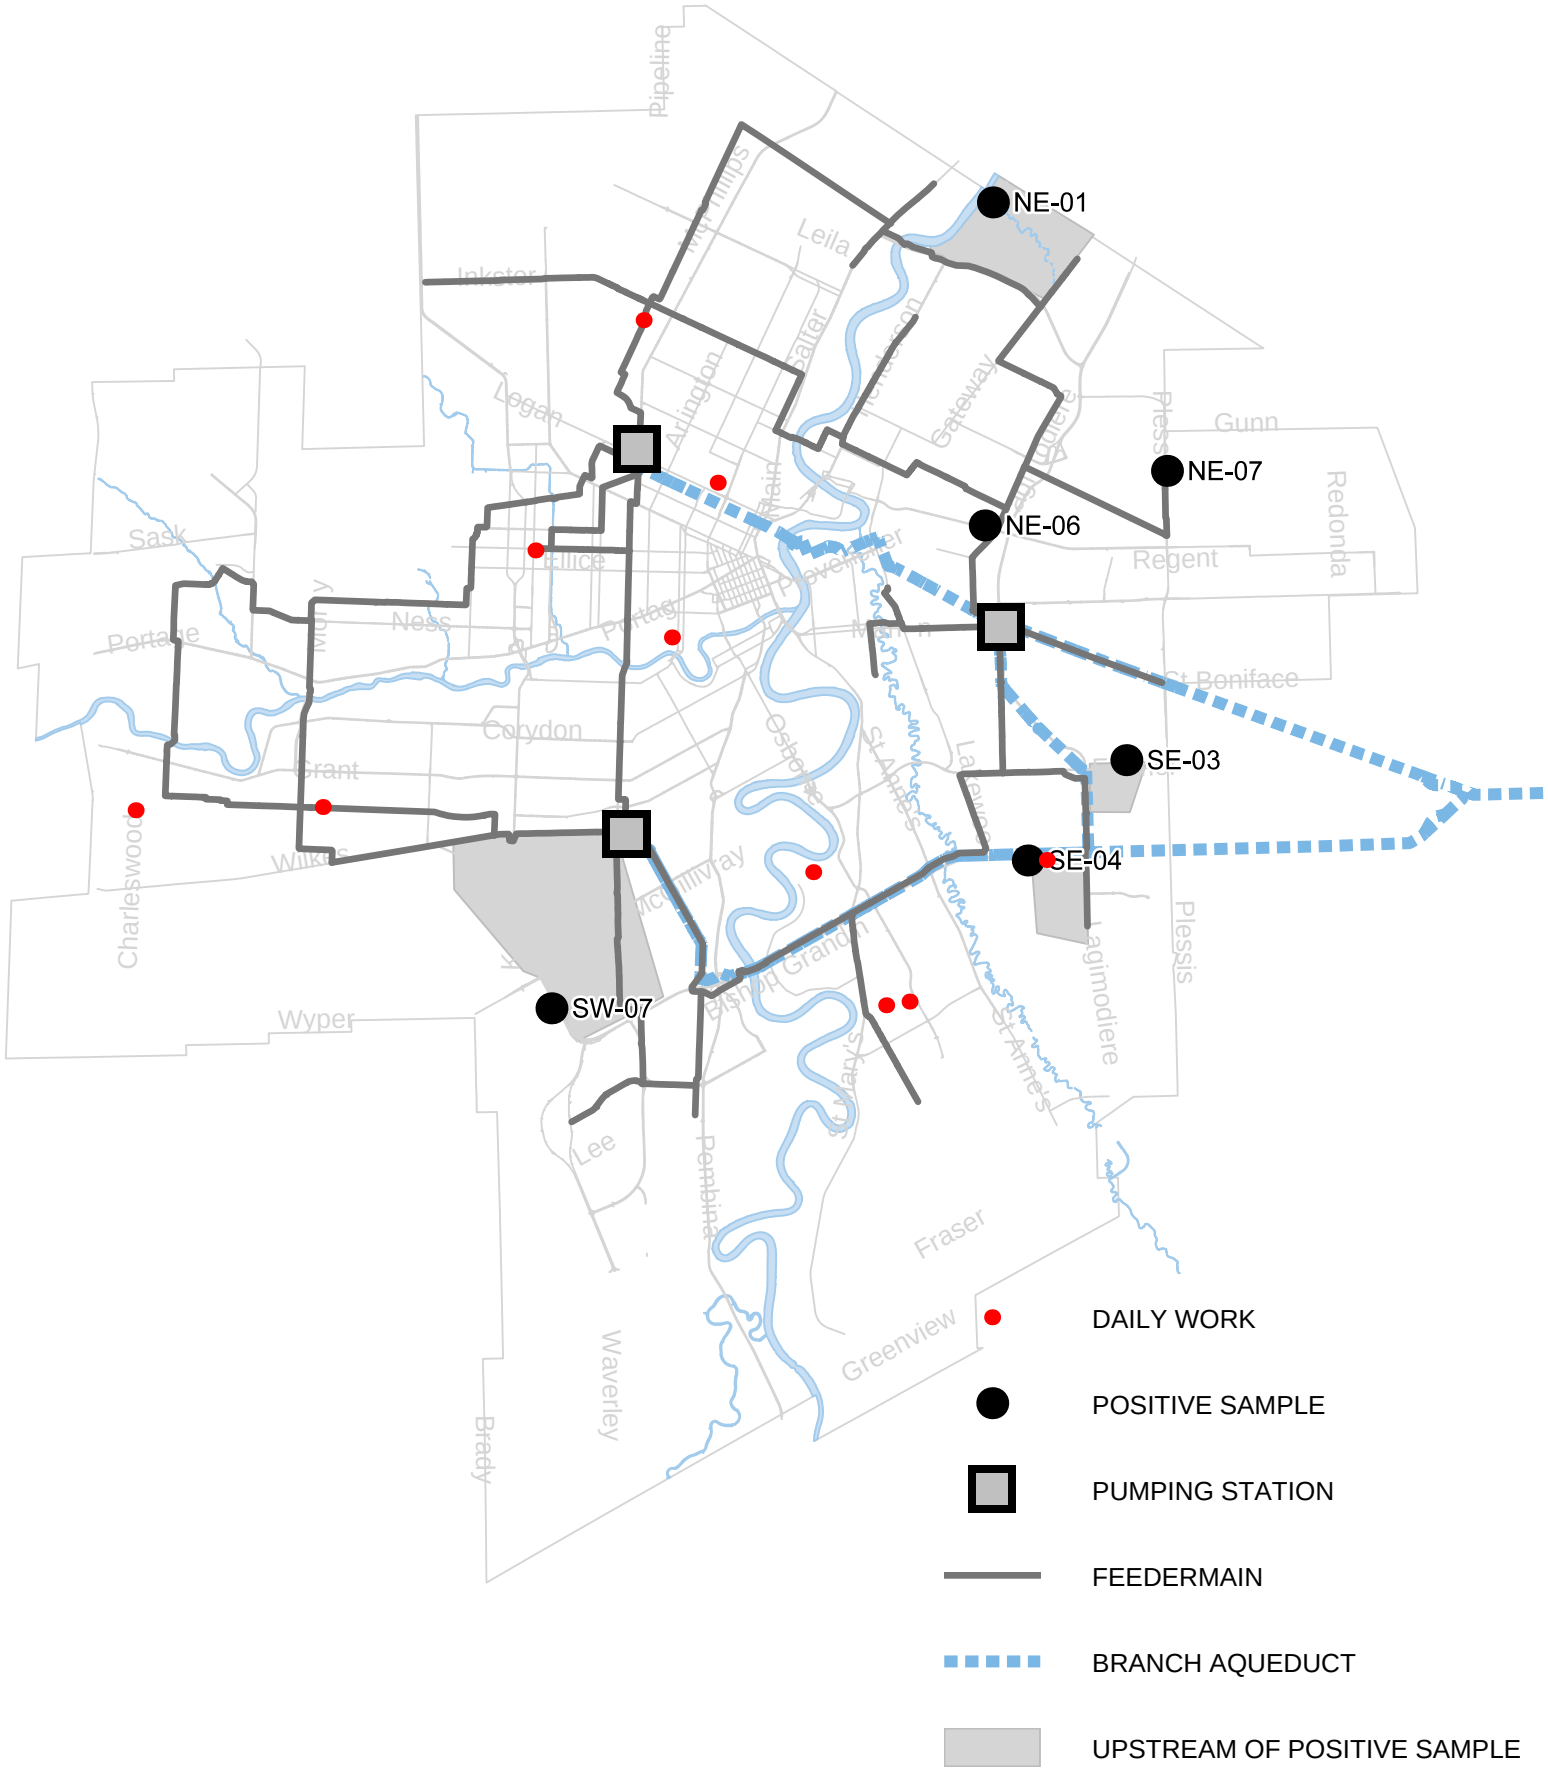

MISCELLANEOUS DAILY WORK

MAY 12- MAY 26, 2014

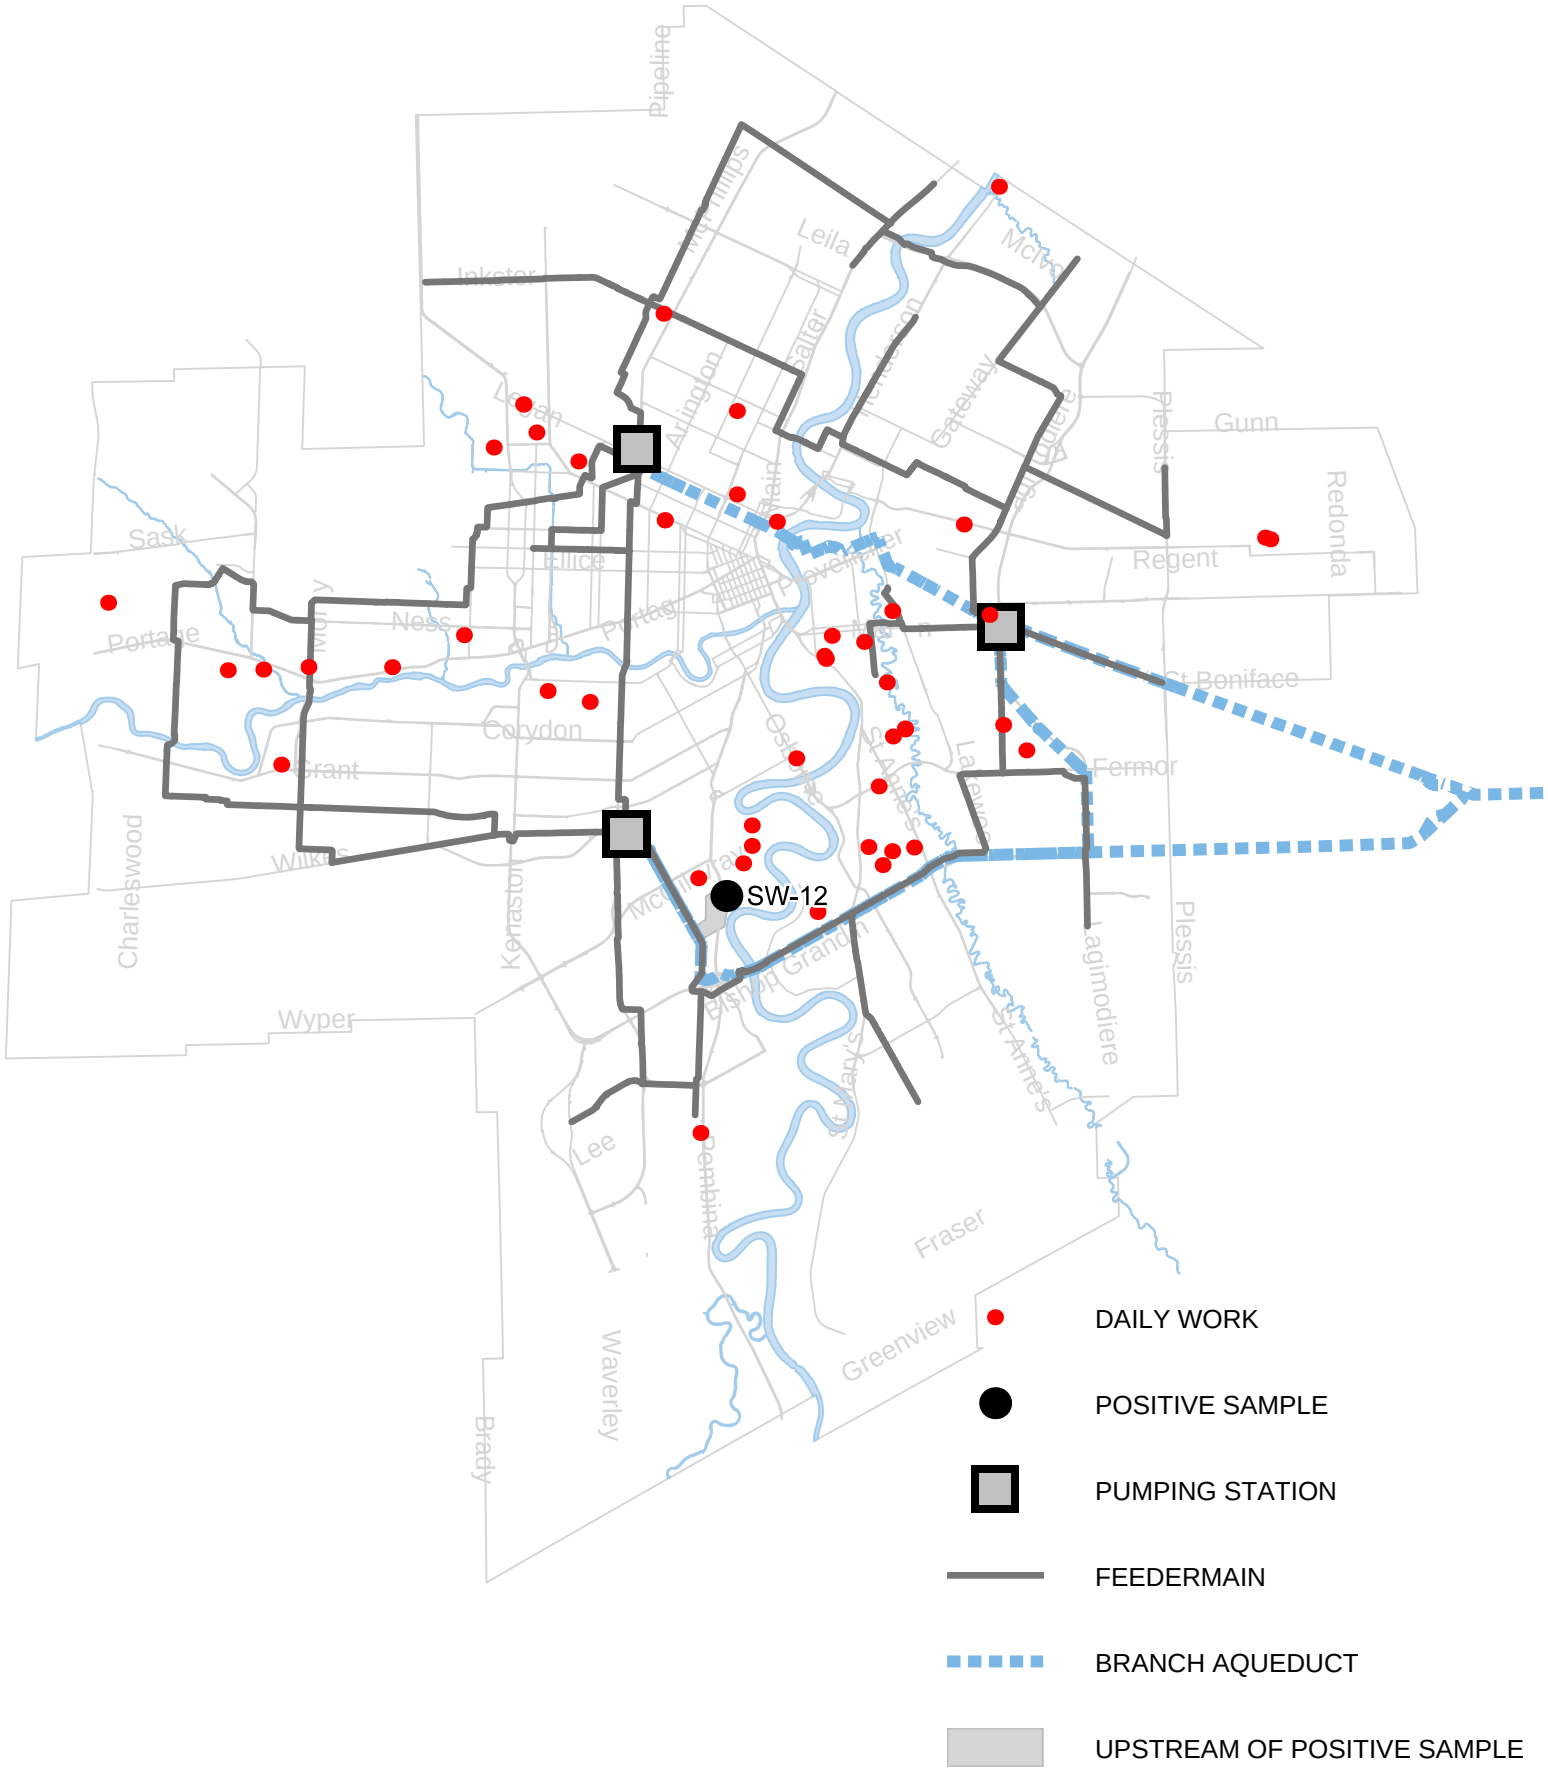

MISCELLANEOUS DAILY WORK

SEPTEMBER 23- OCTOBER 7, 2013

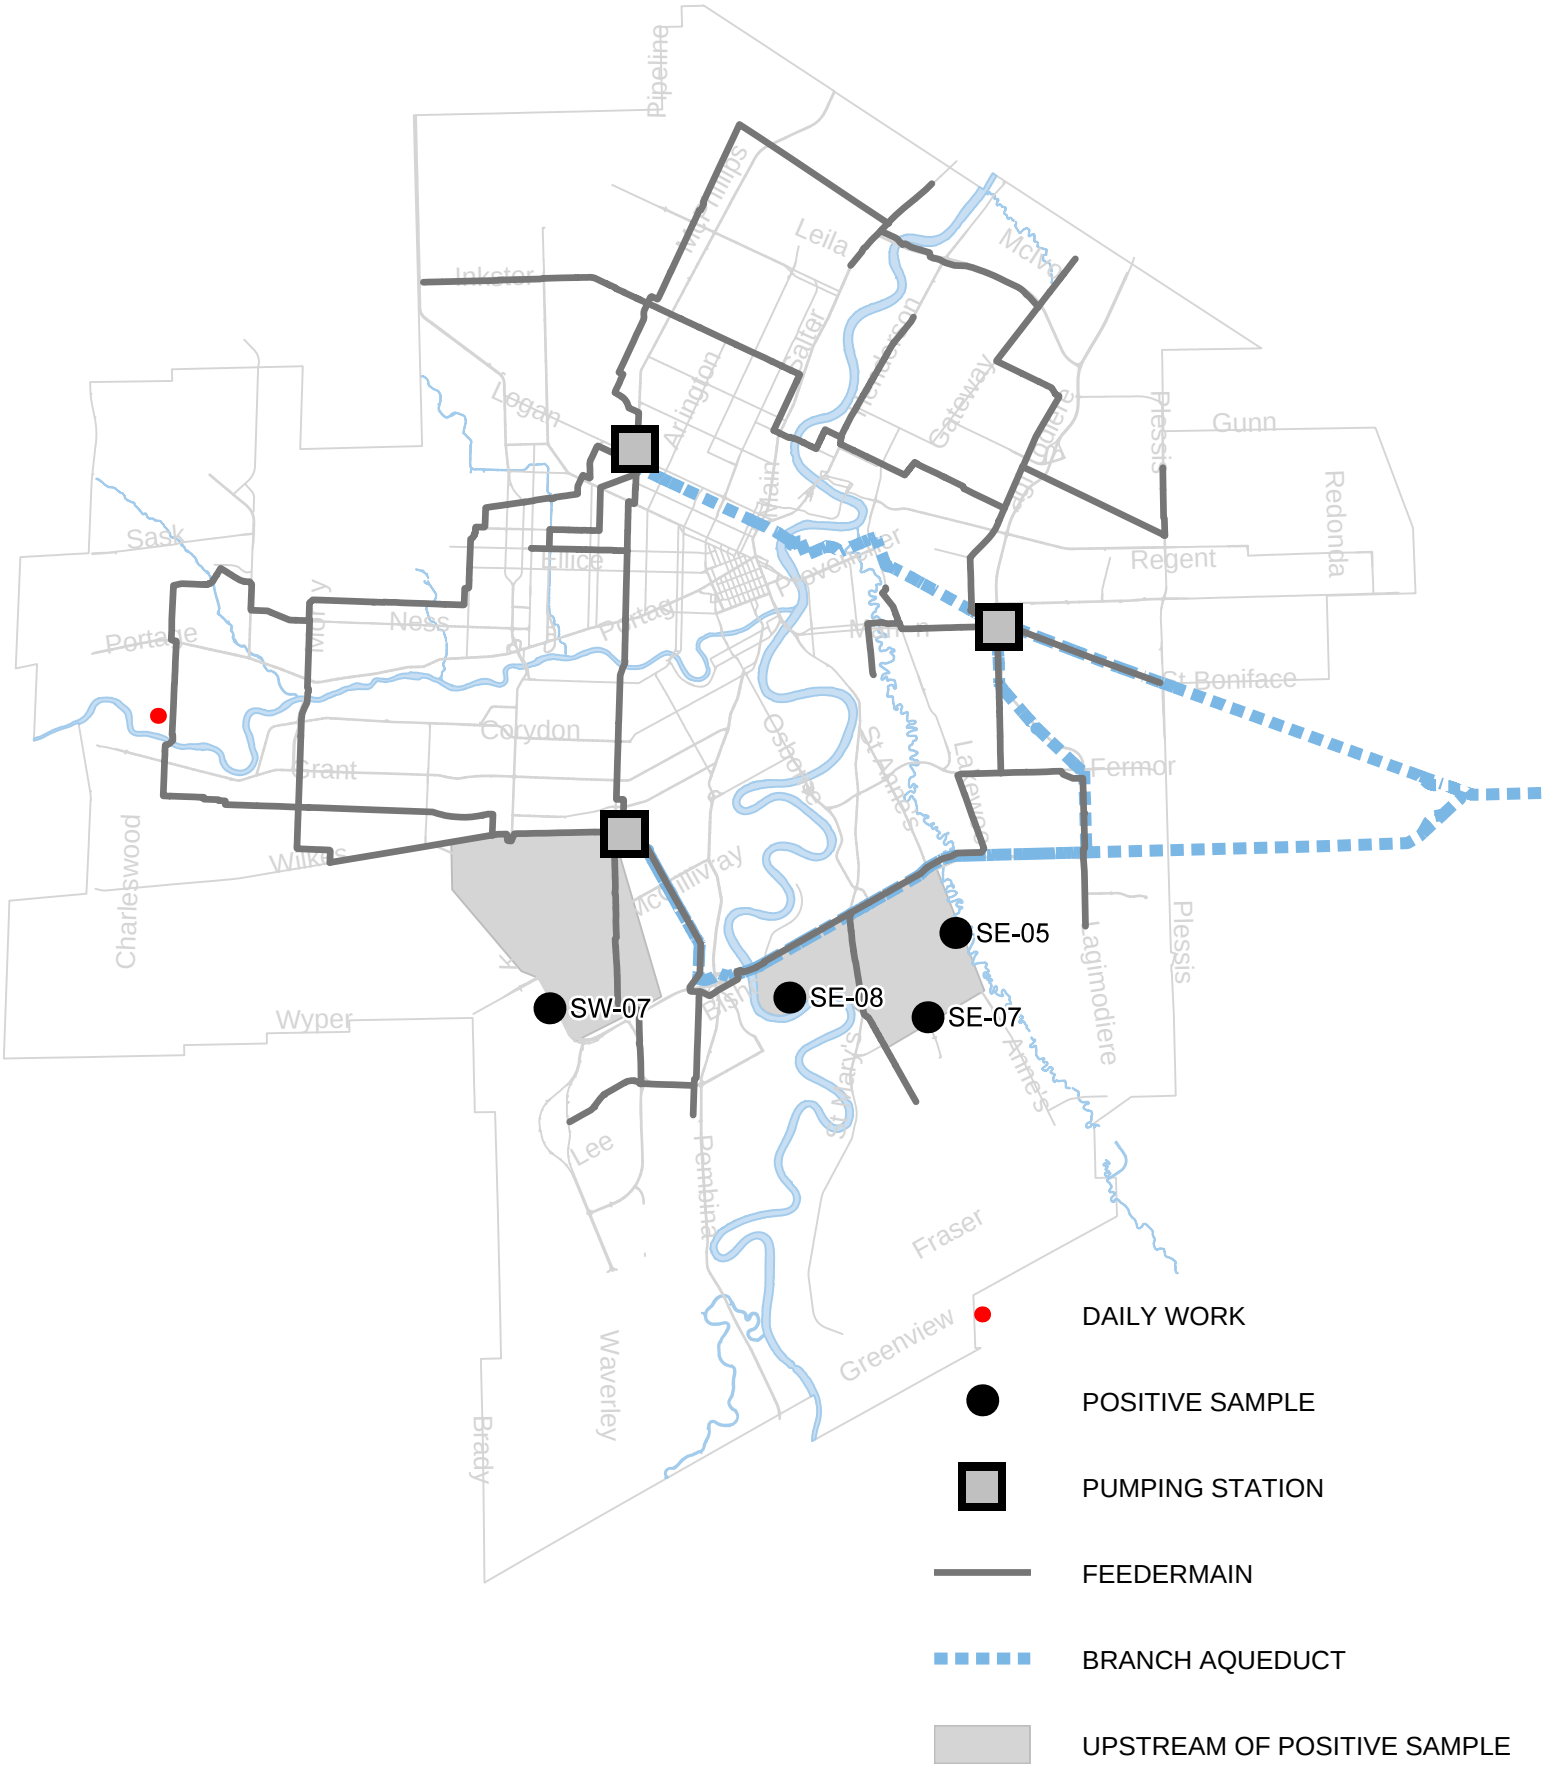

VALVE PIT INSPECTIONS

FEBRUARY, 2015

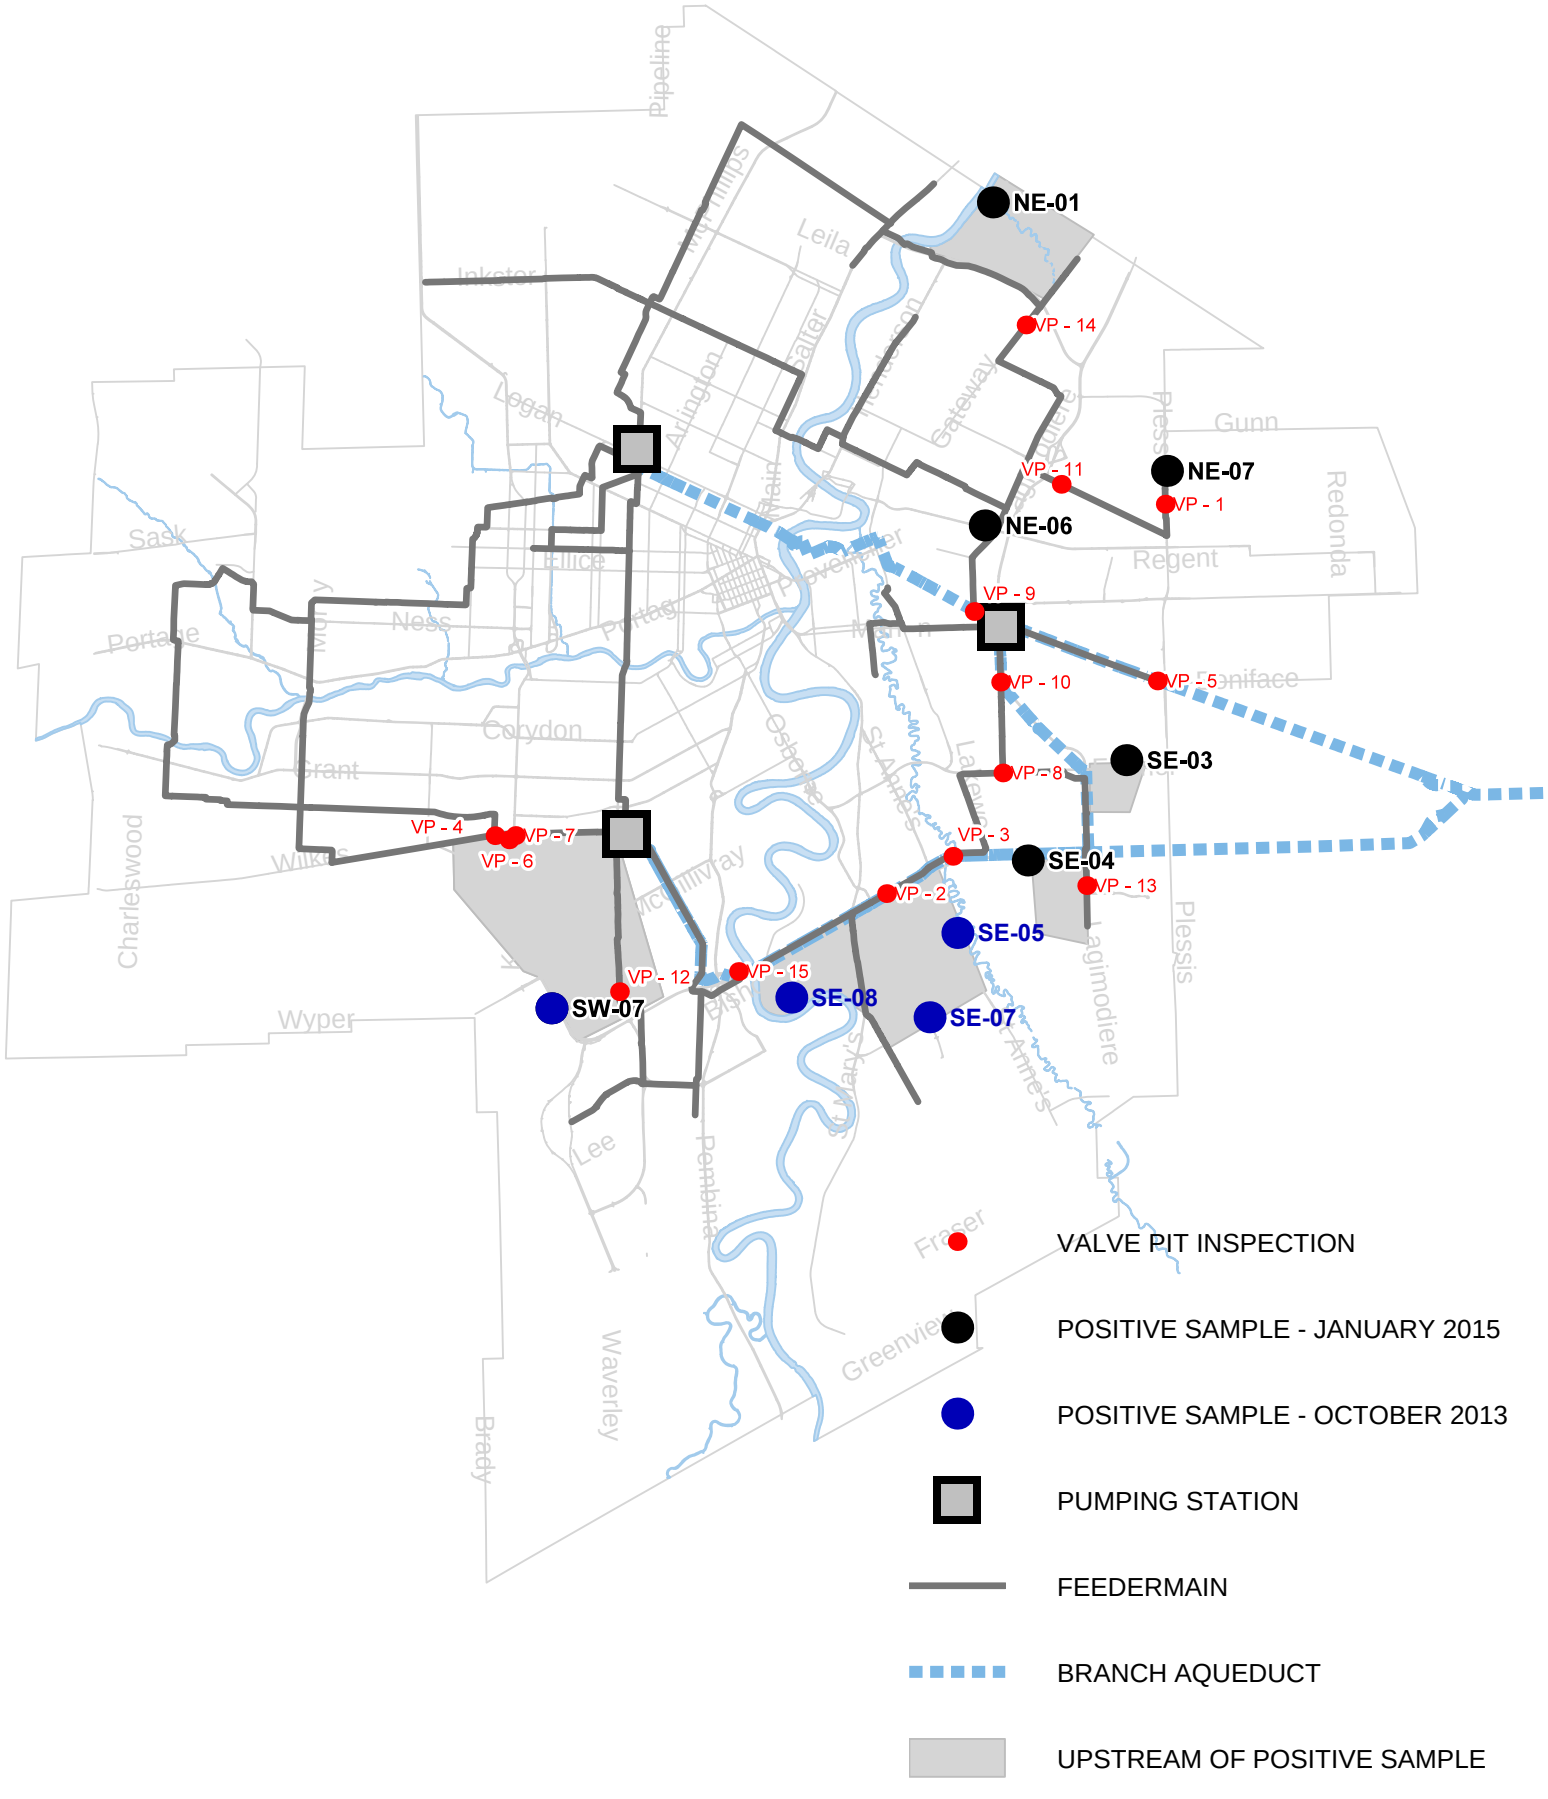

PRESSURE MONITORING POINTS

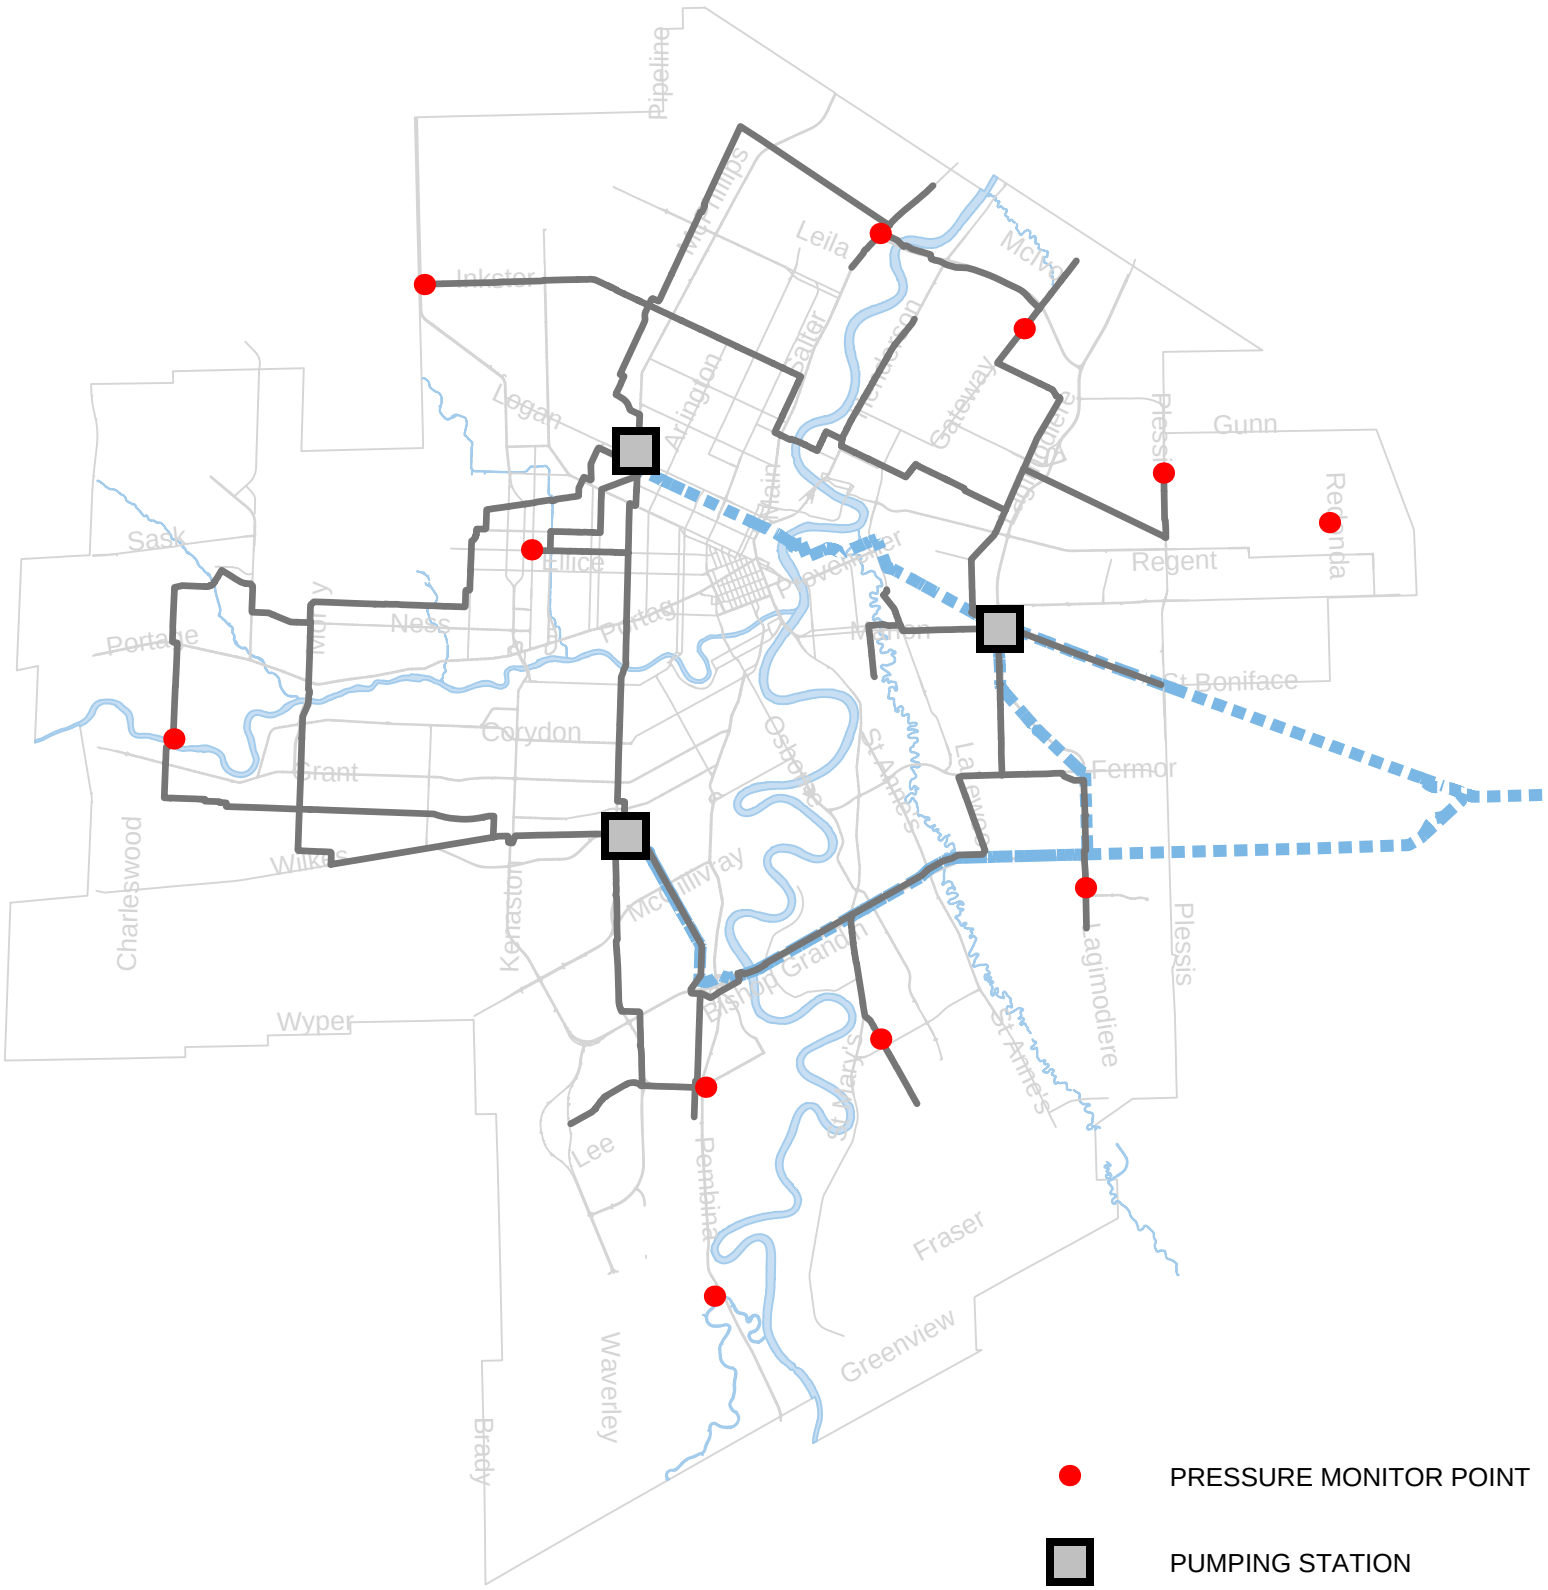

WATERMAIN MATERIAL
UPSTREAM OF POSITIVE SAMPLE

SAMPLE POINT SW-07

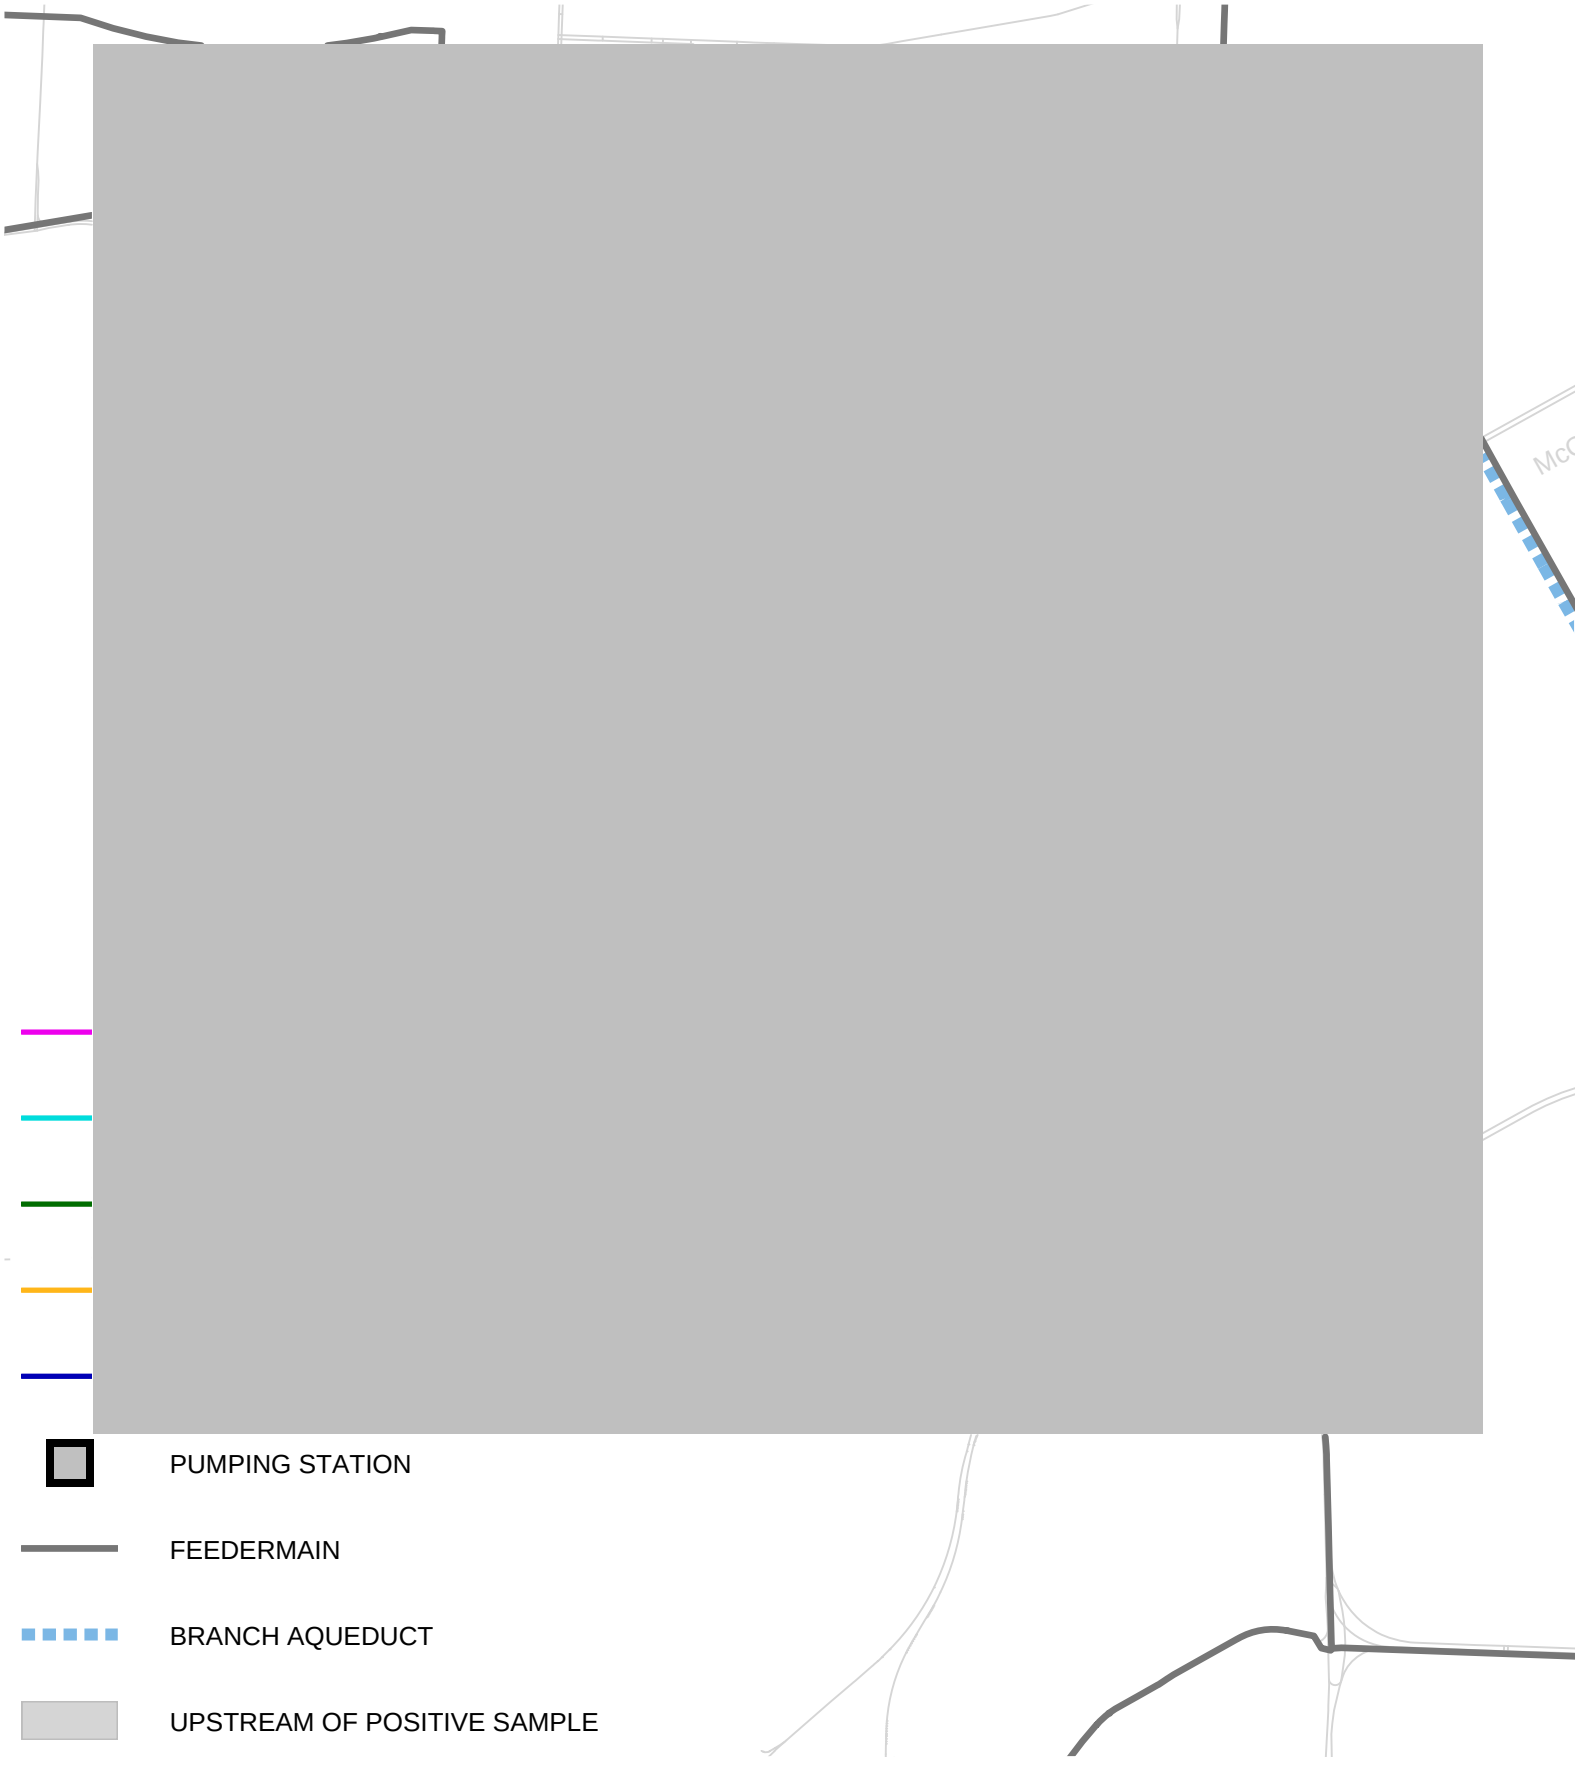

WATERMAIN AGE
UPSTREAM OF POSITIVE SAMPLE

SAMPLE POINT SW-07

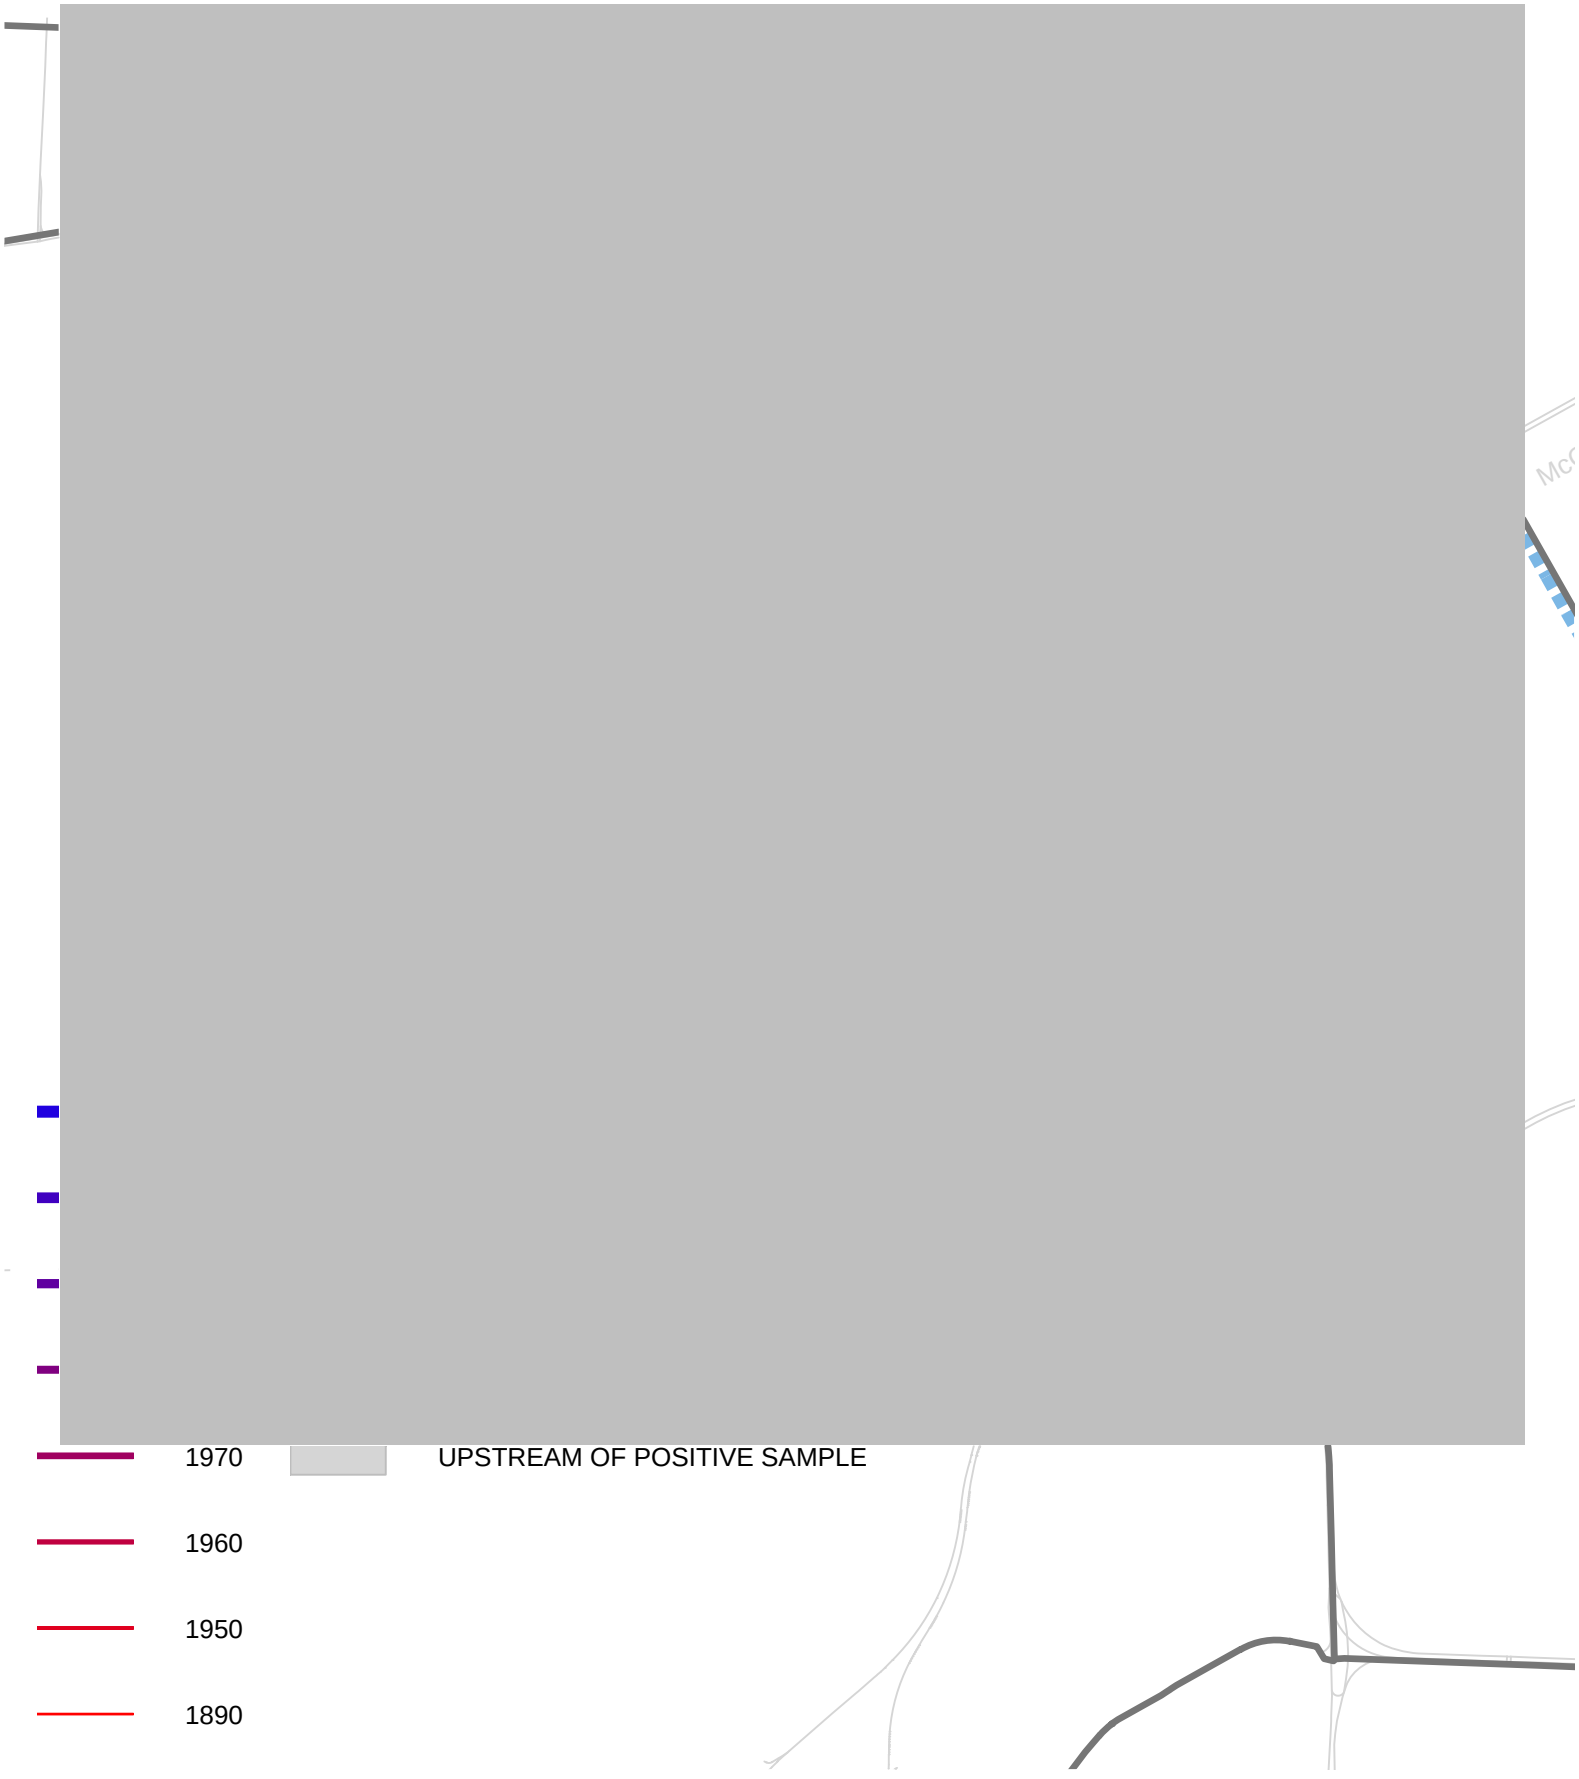

WATERMAIN MATERIAL
UPSTREAM OF POSITIVE SAMPLE

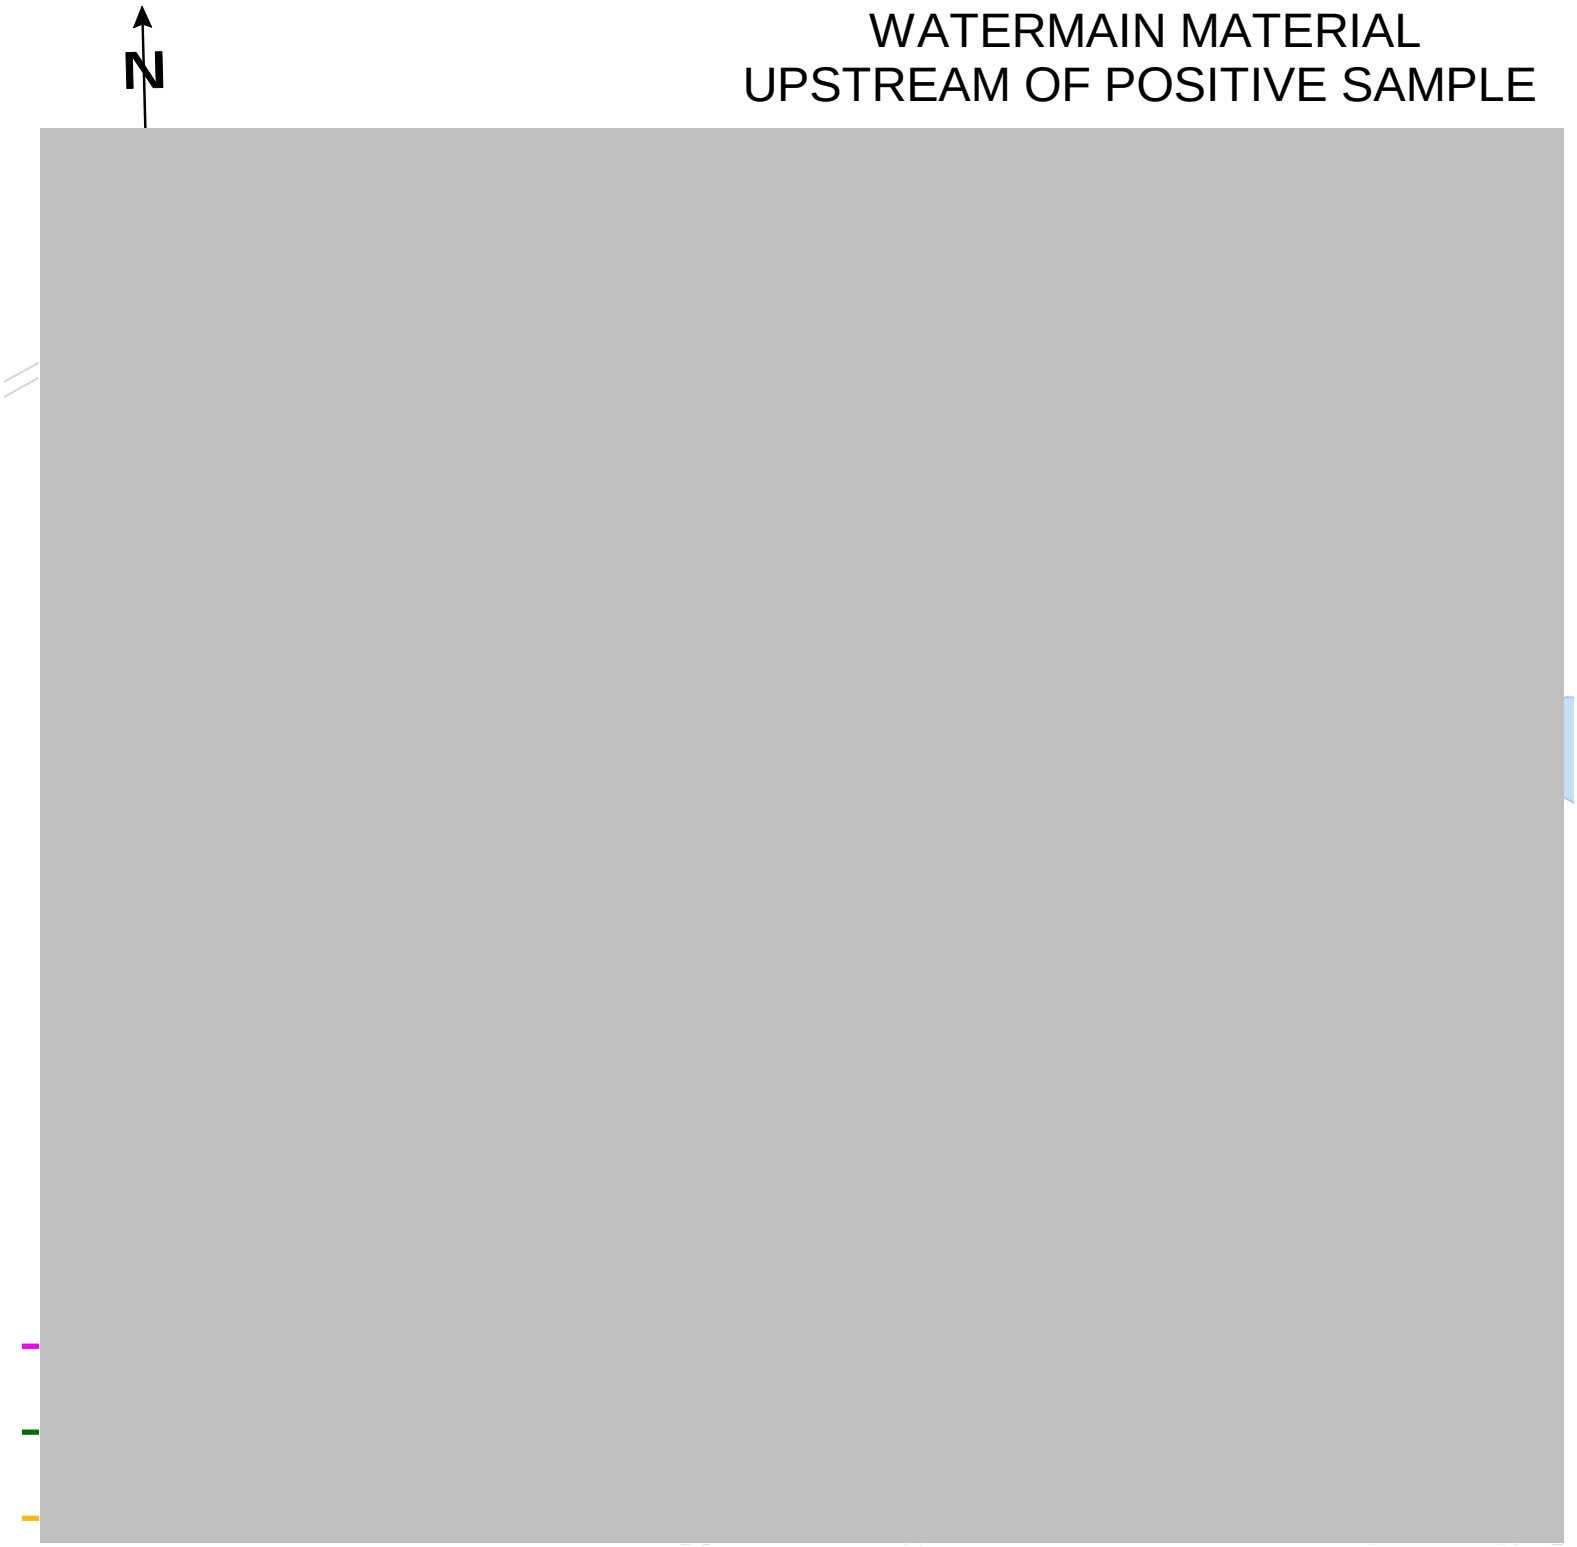

PVC

PUMPING STATION

FEEDERMAIN

BRANCH AQUEDUCT

UPSTREAM OF POSITIVE SAMPLE

WATERMAIN AGE
UPSTREAM OF POSITIVE SAMPLE

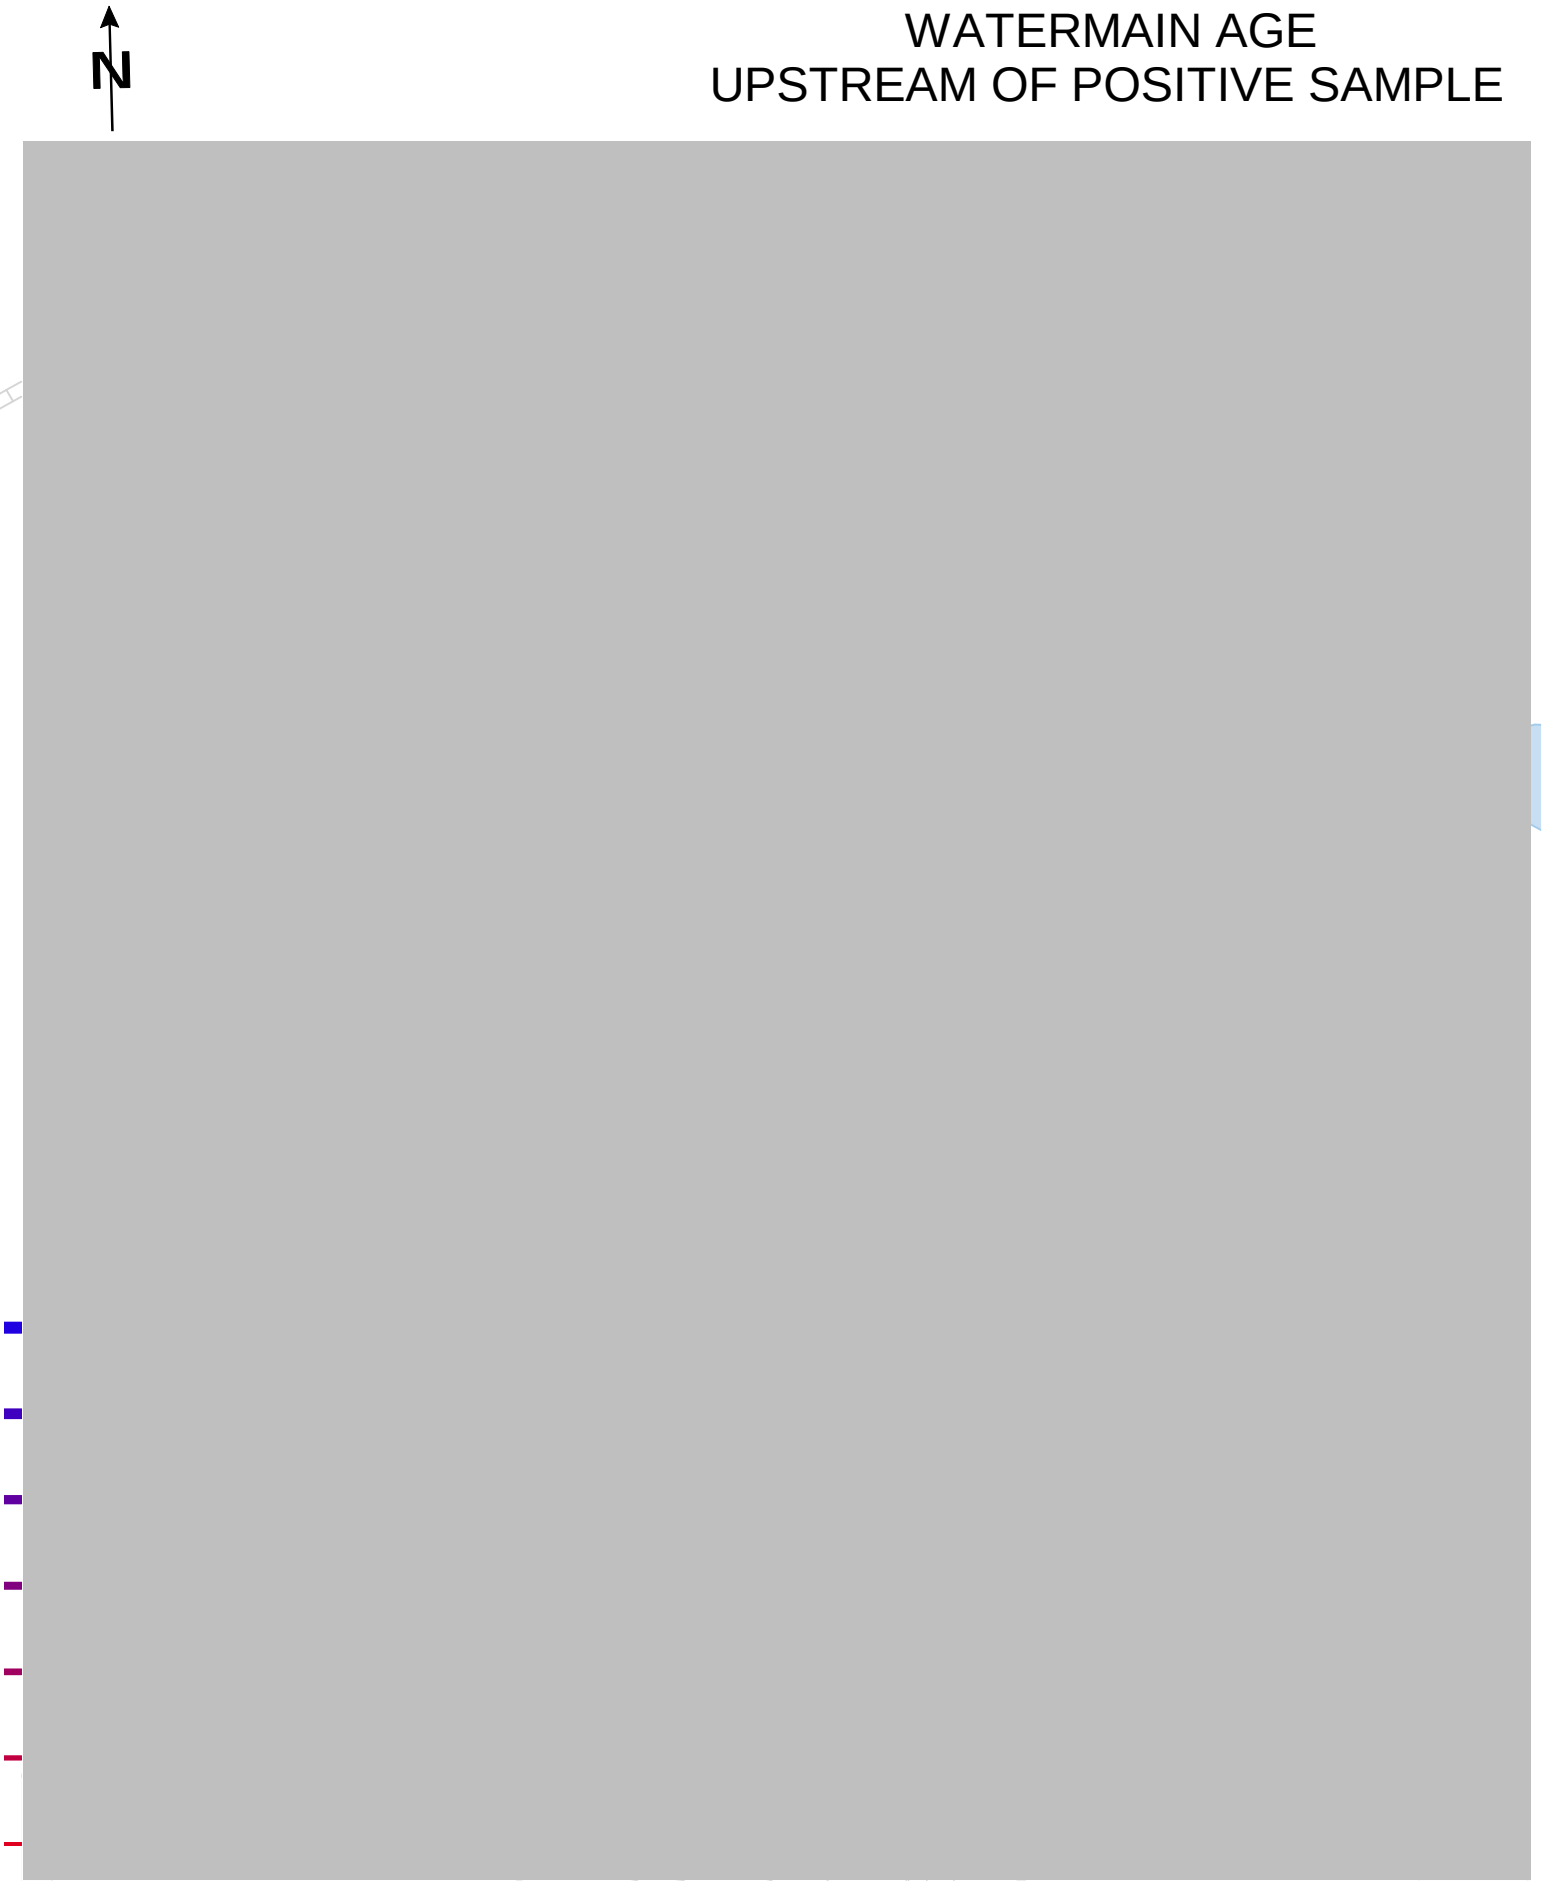

WATERMAIN MATERIAL
UPSTREAM OF POSITIVE SAMPLE

SAMPLE POINTS SE-05, SE-07 AND SE-08

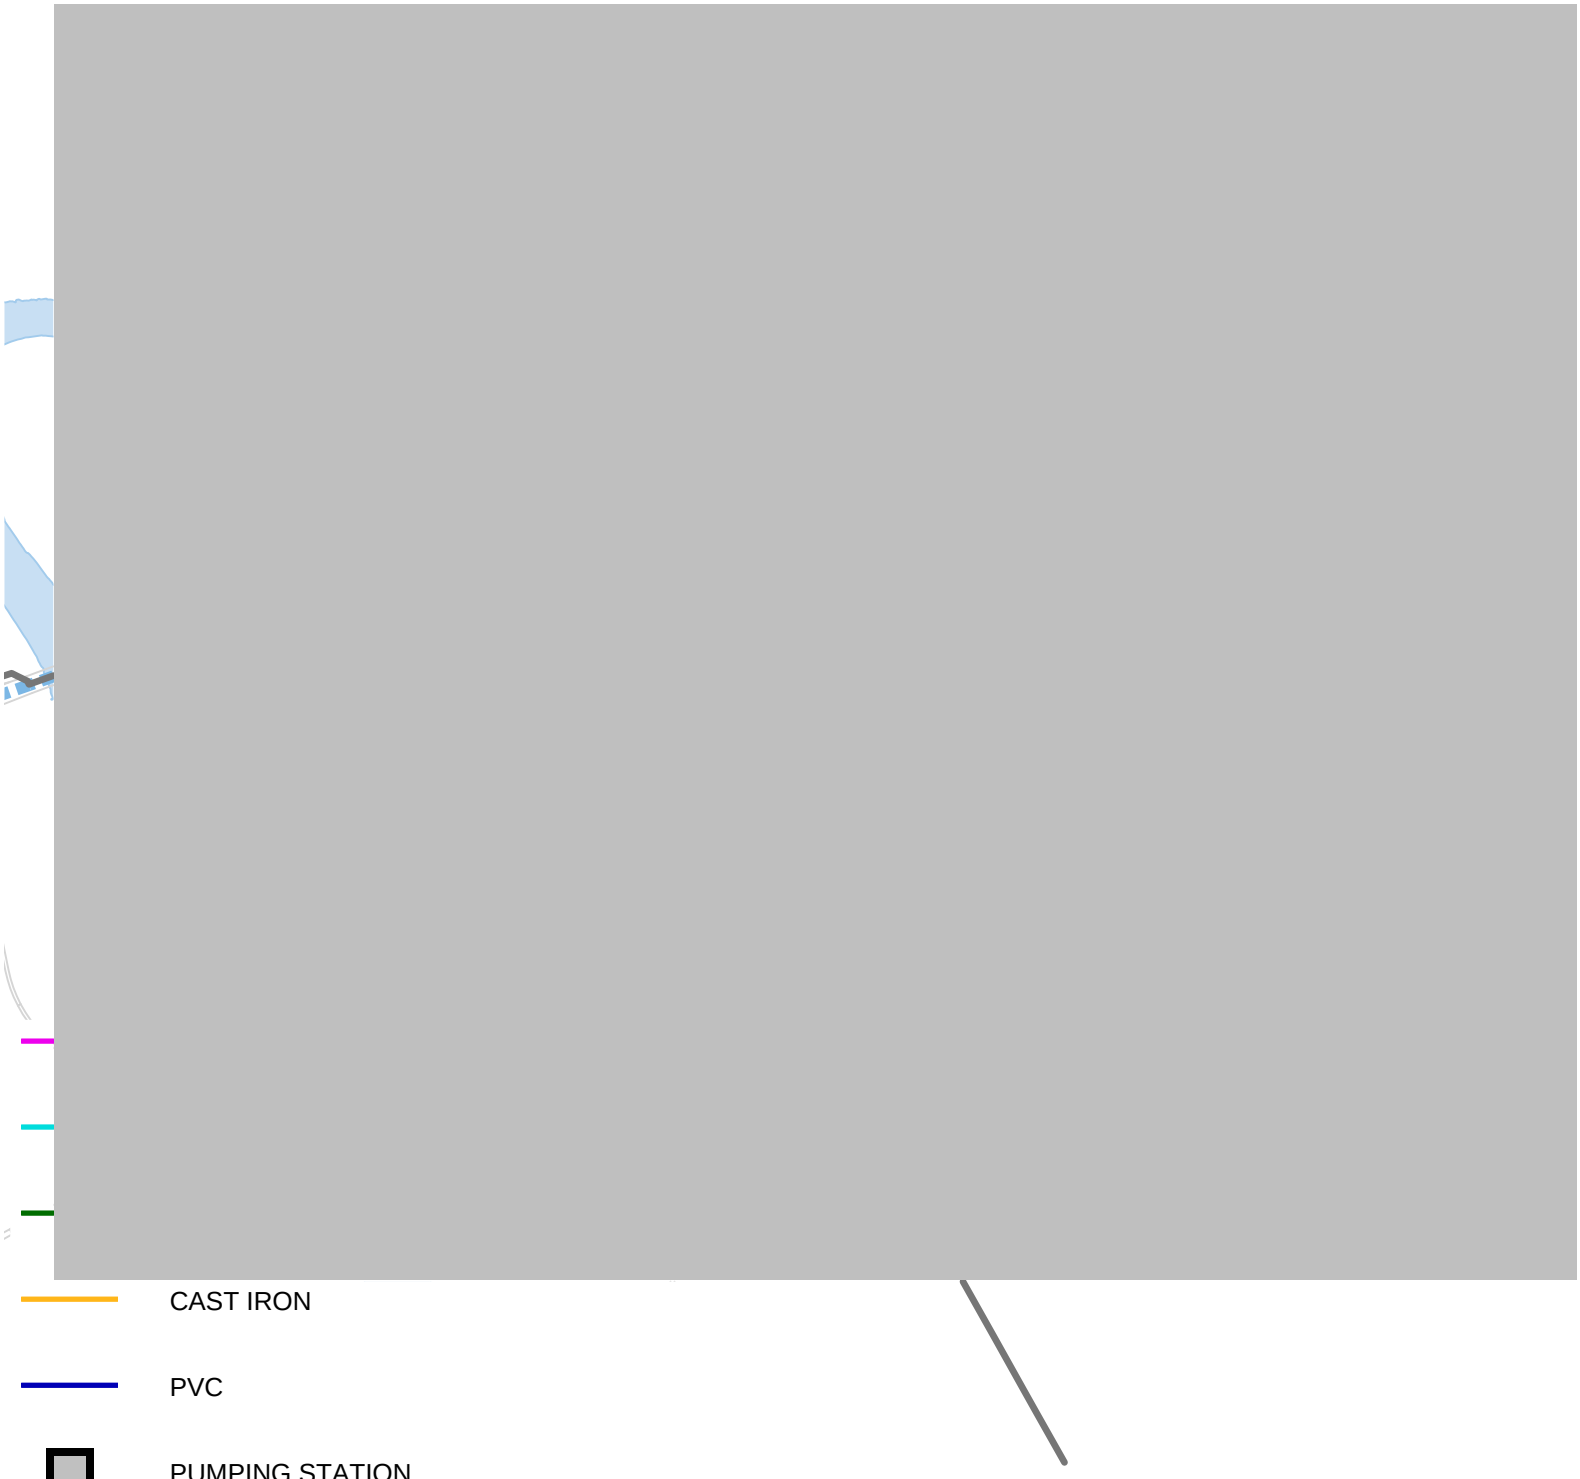

CAST IRON

PVC

PUMPING STATION

FEEDERMAIN

BRANCH AQUEDUCT

UPSTREAM OF POSITIVE SAMPLE

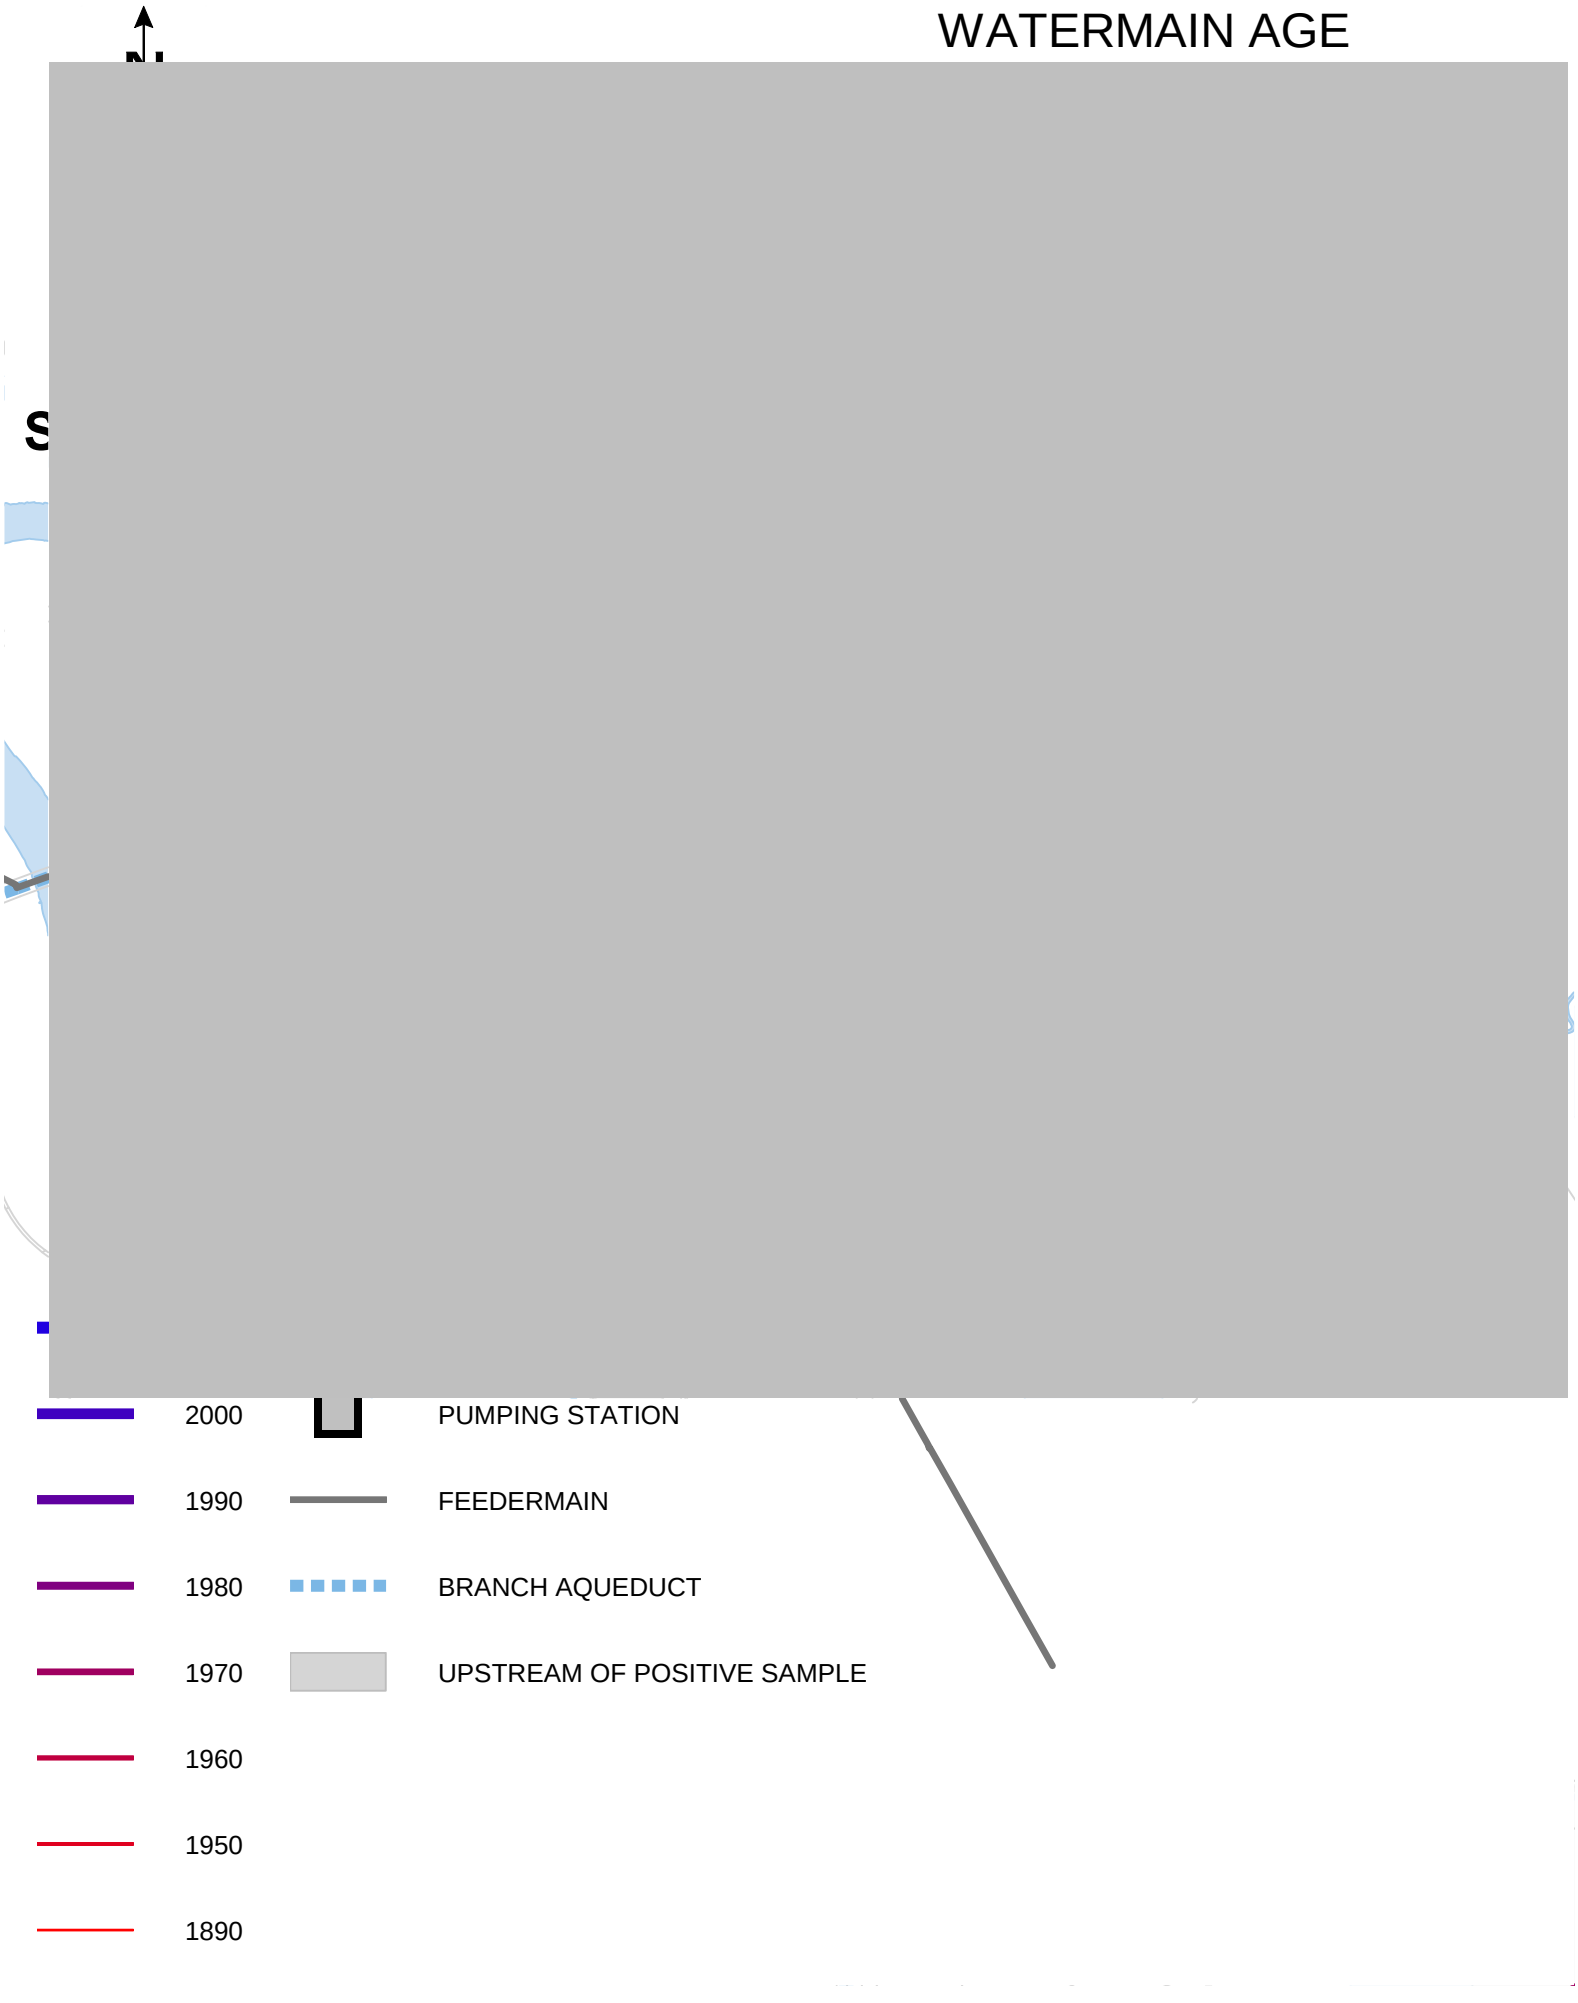
WATERMAIN AGE
2000
1990
1980
1970
1960
1950
1890
PUMPING STATION
FEEDERMAIN
BRANCH AQUEDUCT
UPSTREAM OF POSITIVE SAMPLE

WATERMAIN MATERIAL
UPSTREAM OF POSITIVE SAMPLE

ASBESTOS CEMENT

CAST IRON

PVC

PUMPING STATION

FEEDERMAIN

BRANCH AQUEDUCT

UPSTREAM OF POSITIVE SAMPLE

WATERMAIN AGE
UPSTREAM OF POSITIVE SAMPLE

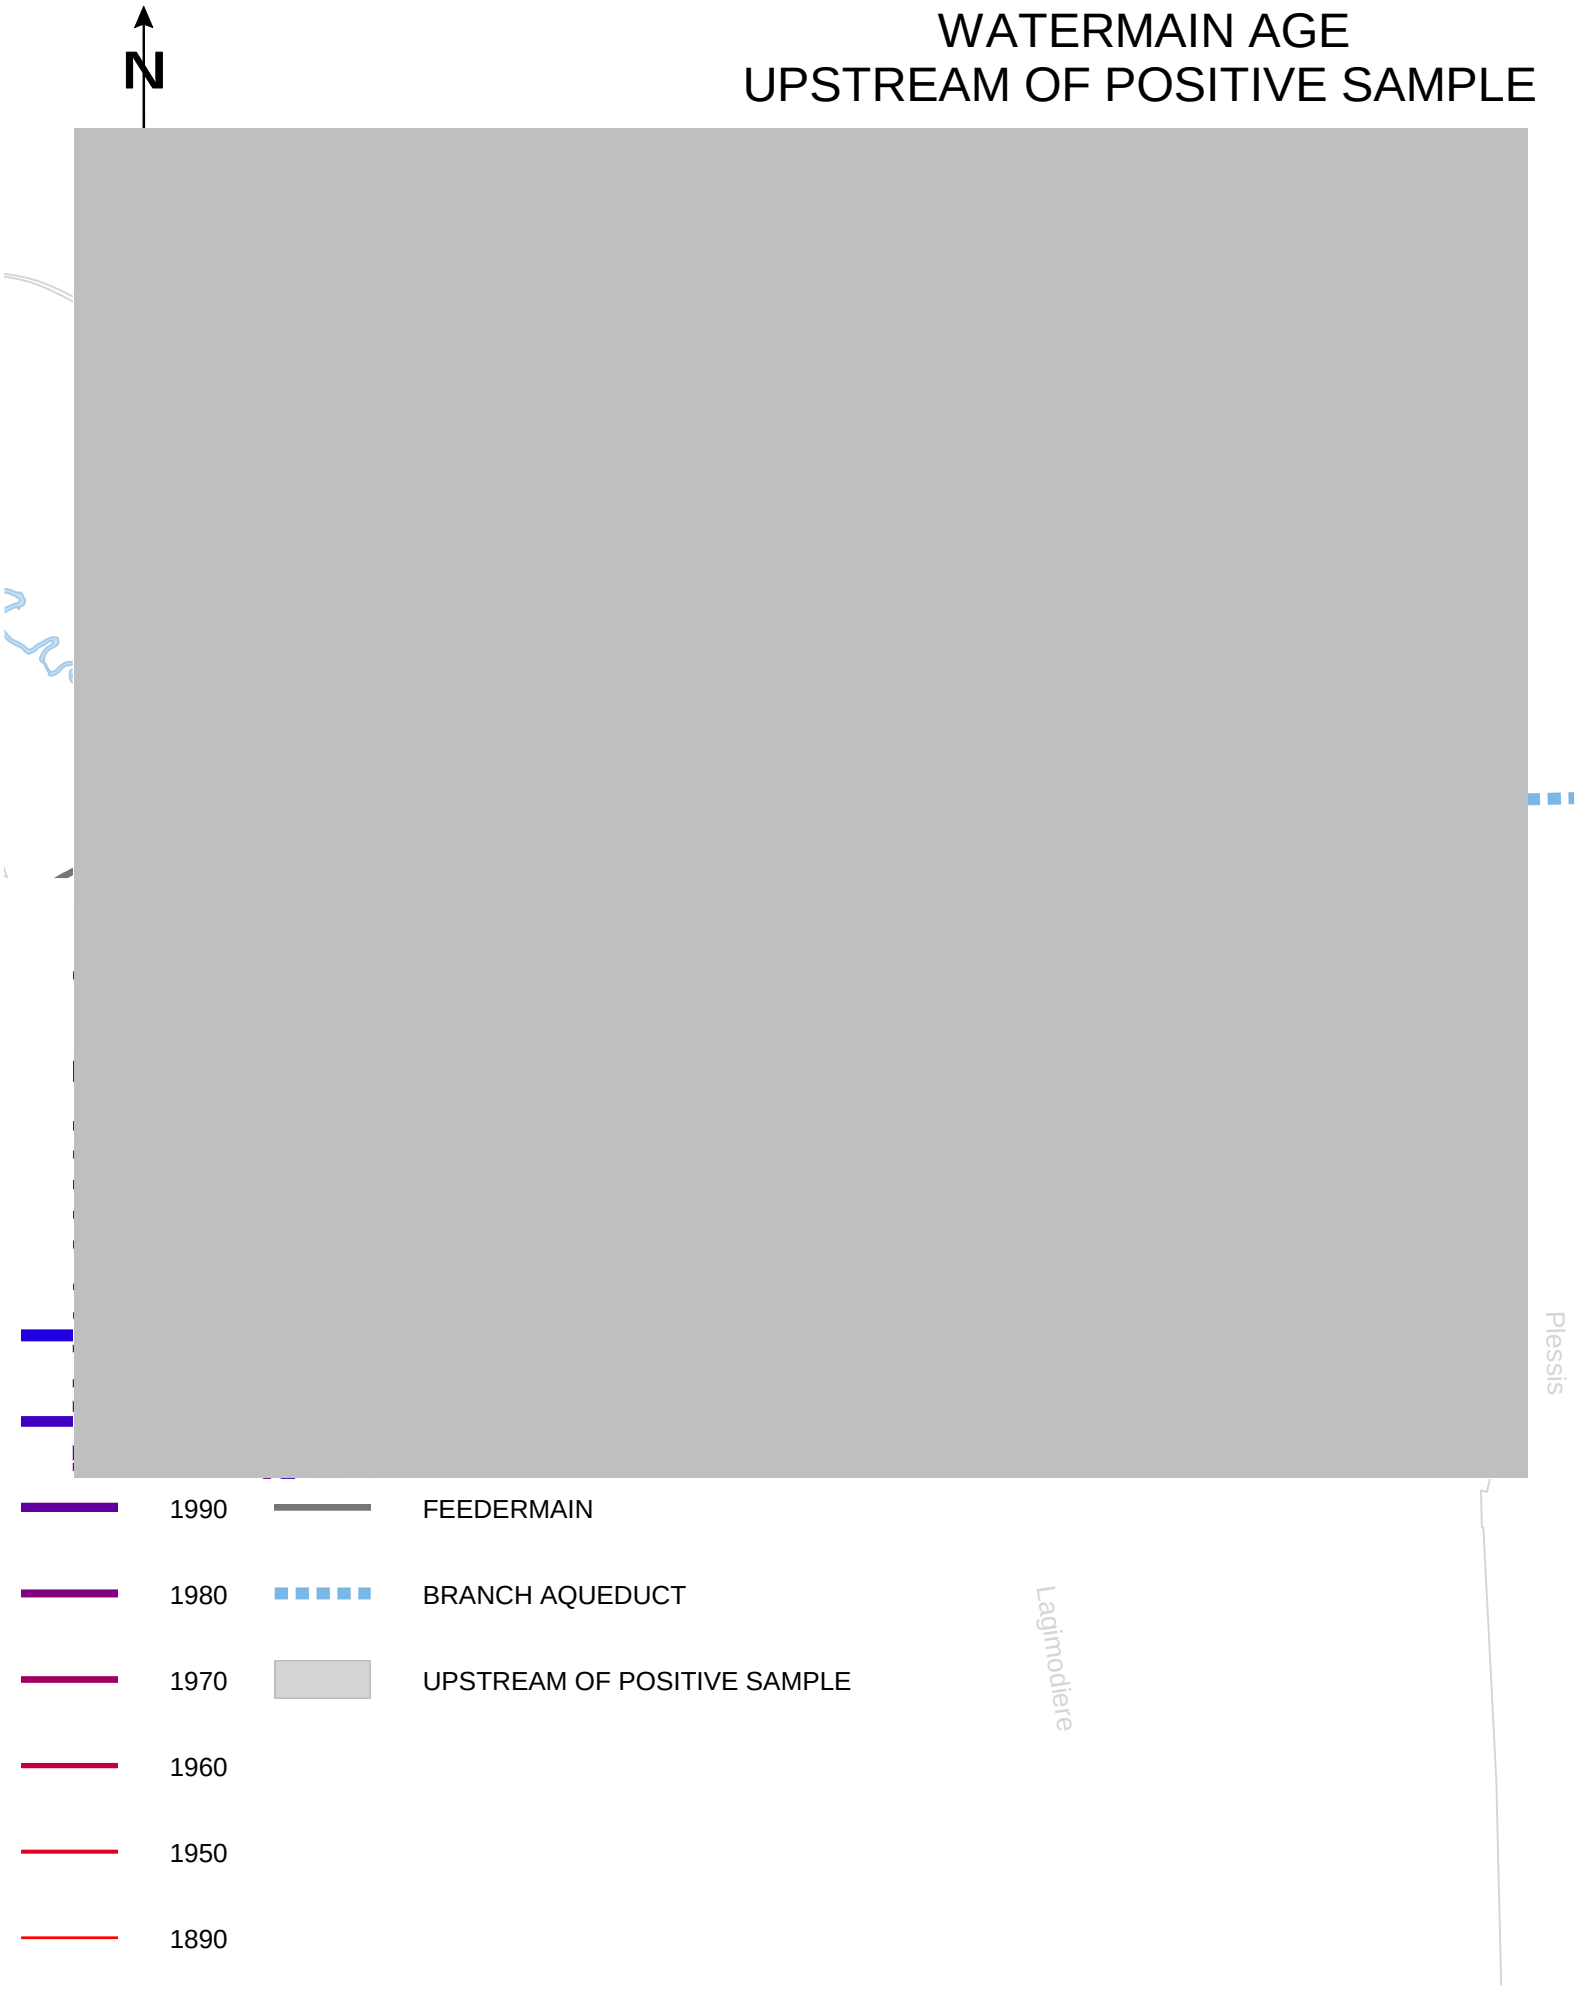

WATERMAIN MATERIAL
UPSTREAM OF POSITIVE SAMPLE

SAMPLE POINT NE-01

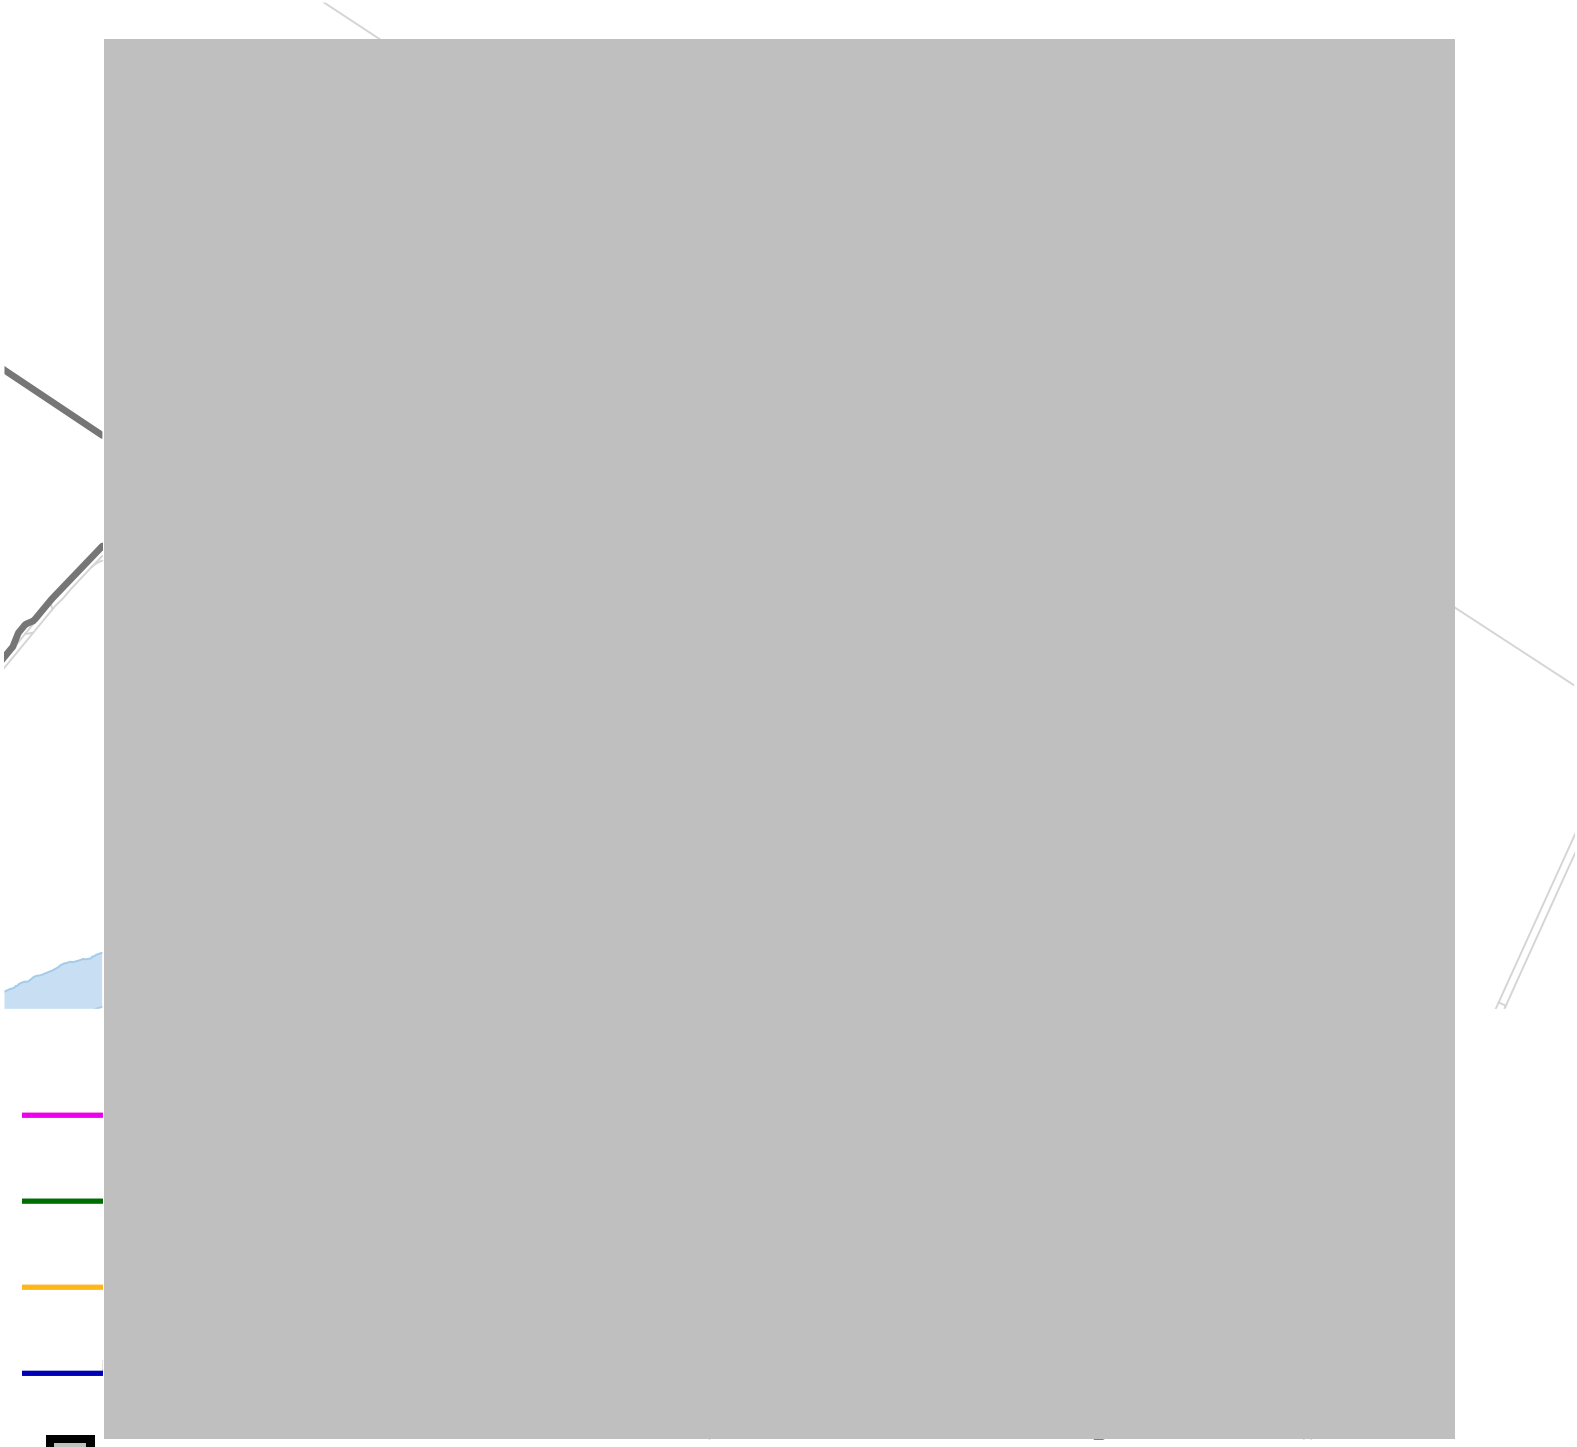

PUMPING STATION

FEEDERMAIN

BRANCH AQUEDUCT

UPSTREAM OF POSITIVE SAMPLE

WATERMAIN AGE
UPSTREAM OF POSITIVE SAMPLE

SAMPLE POINT NE-01

1970

1960

1950

1890

UPSTREAM OF POSITIVE SAMPLE

E2 Distribution System Pressures

E2a SCADA Hourly Pressure Values Jan 12-26 2015

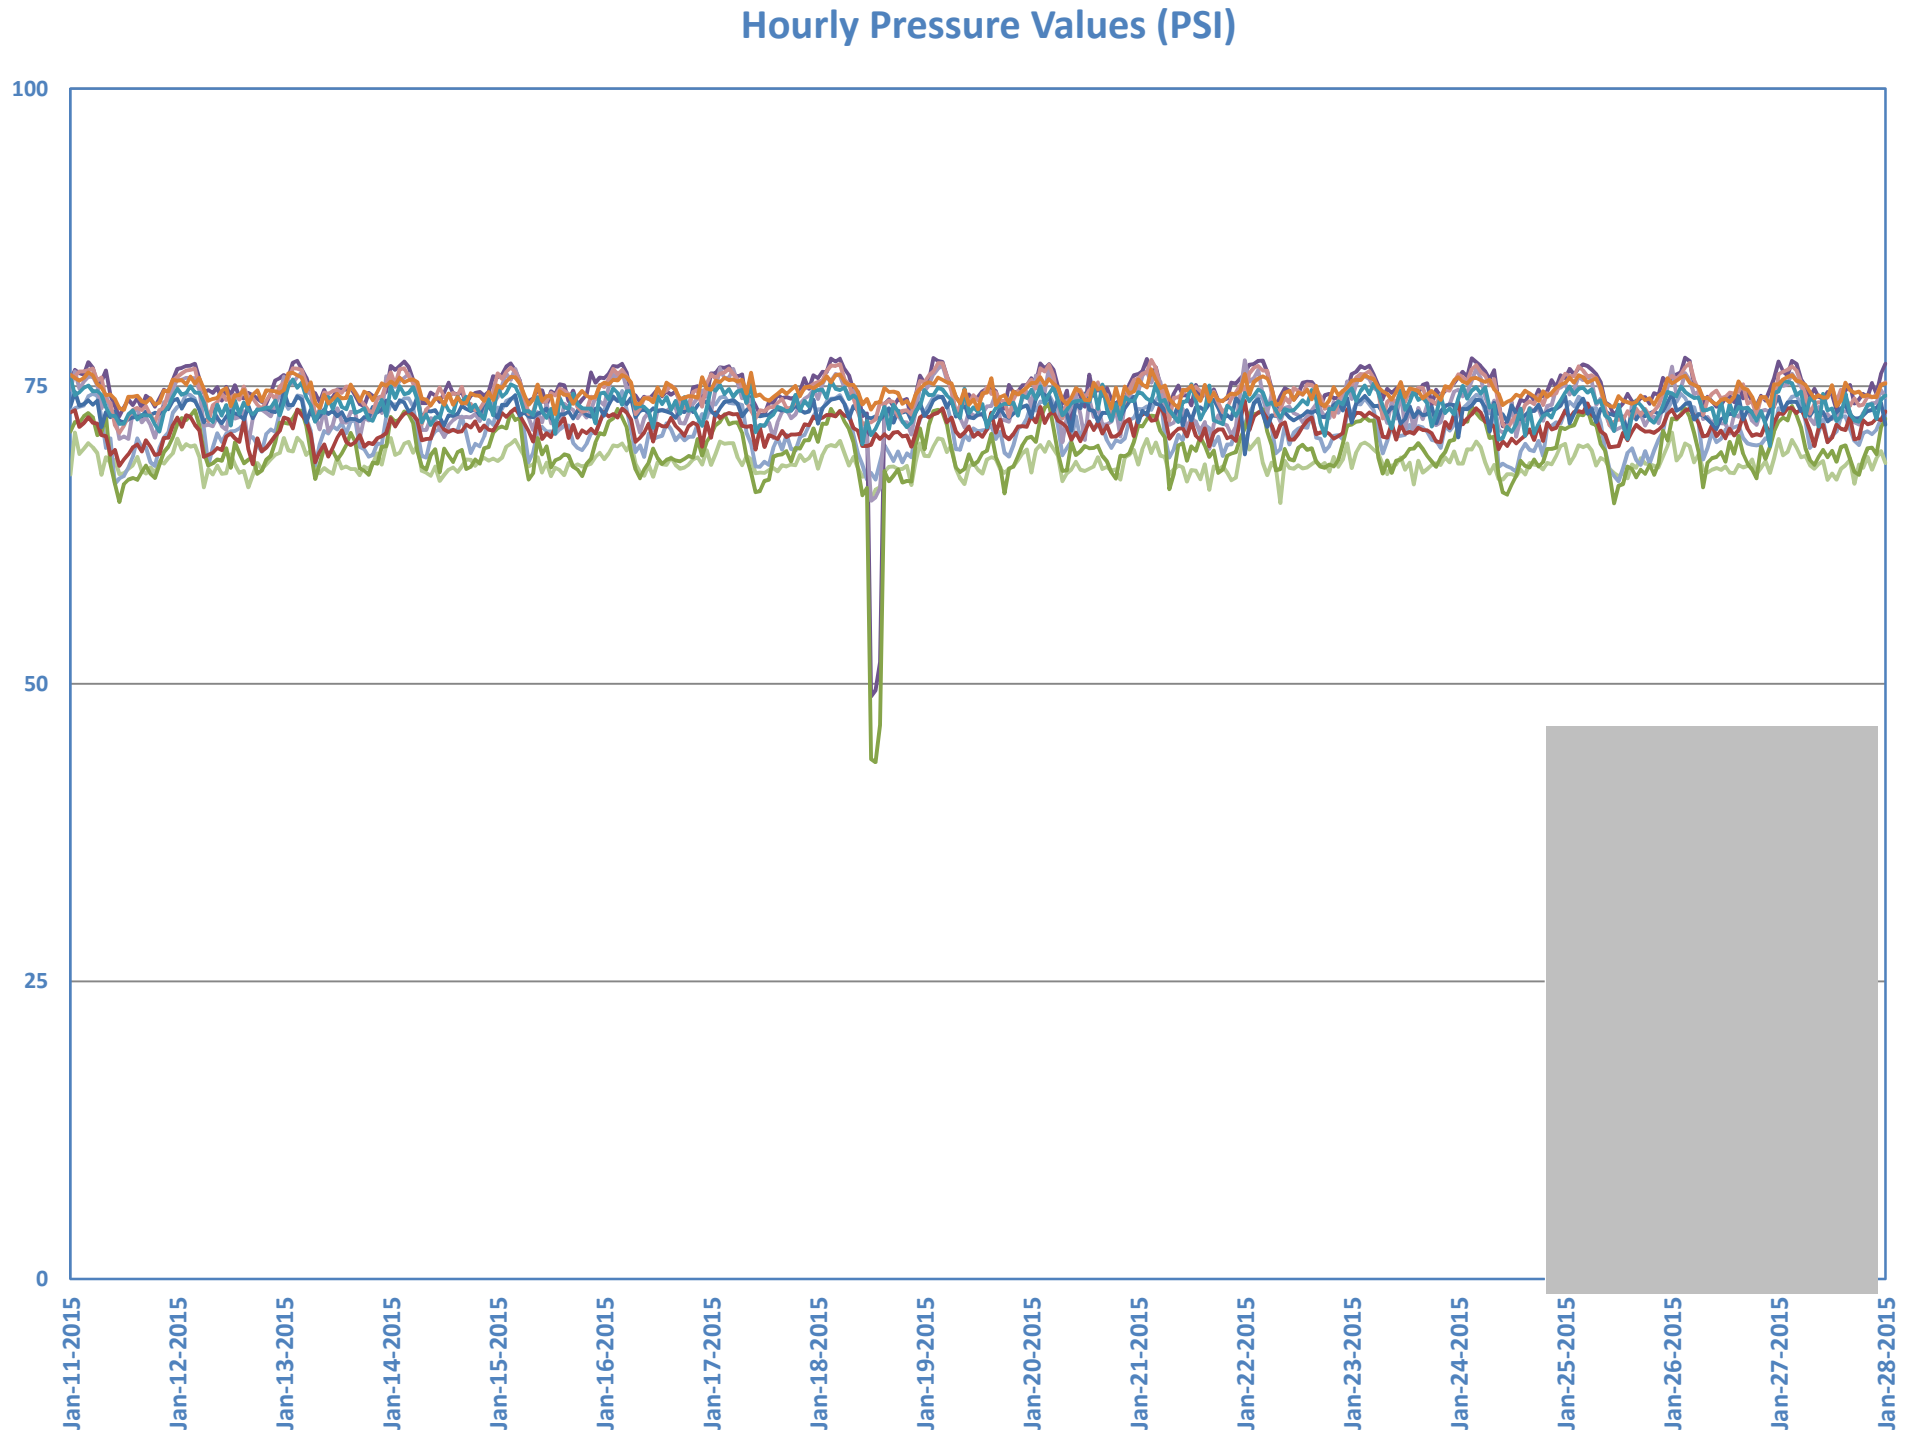
Hourly Pressure Values (PSI)
100
75
50
25
0
Jan-11-2015
Jan-12-2015
Jan-13-2015
Jan-14-2015
Jan-15-2015
Jan-16-2015
Jan-17-2015
Jan-18-2015
Jan-19-2015
Jan-20-2015
Jan-21-2015
Jan-22-2015
Jan-23-2015
Jan-24-2015
Jan-25-2015
Jan-26-2015
Jan-27-2015
Jan-28-2015

AECOM

E2b Pressure Points 1 Hourly Min May 12-May 26 2014

Global Trendset

Global Trendset

Trend Name: Press_Pts_#1 ▶ Search

Owner: dnaAdmin

Global trend: ◉ Yes ○ No

☐ Individual Y Axes ☑ Markers On

☐ Show Data Quality

Default Timescales



4hrs 8hrs 12hrs 24hrs

Add Pen | Delete Pen | Edit

New | Dismiss | Abandon | Add | Modify | Delete

Pressure Points - Primary

[PSI] [PSI] [PSI] [PSI] [PSI]

90.0
80.0
70.0
60.0
50.0
40.0

P

5/15/2014 5/22/2014

◄ 5/12/2014 12:00 AM << Primary >> 5/27/2014 12:00 AM ►

AECOM

E2c Pressure Points 2 Hourly Min May 12-May 26 2014

Global Trendset

Global Trendset

Trend Name: Press_Pts_#2 ▶ Search

Owner: dnaAdmin

Global trend: ◉ Yes ○ No

☐ Individual Y Axes ☑ Markers On

☐ Show Data Quality

Default Timescales

4hrs 8hrs 12hrs 24hrs

Add Pen | Delete Pen | Edit

New | Dismiss | Add | Abandon | Modify | Delete

Pressure Points - Secondary

[PSI] [PSI] [PSI] [PSI] [PSI] [PSI]

90.0
80.0
70.0
60.0
50.0
40.0

P

5/15/2014 5/22/2014

◄ 5/12/2014 12:00 AM << Primary >> 5/27/2014 12:00 AM ►

AECOM

E2d Pressure Points 1
Hourly Min Sep 23-Oct 7 2013

Global Trendset

Global Trendset

Trend Name: Press_Pts_#1 ▶ Search

Owner: dnaAdmin

Global trend: ◉ Yes ○ No

☐ Individual Y Axes ☑ Markers On

☐ Show Data Quality

Default Timescales



Add Pen | Delete Pen | Edit

New | Dismiss | Abandon | Add | Modify | Delete

Pressure Points - Primary

[PSI] [PSI] [PSI] [PSI] [PSI]

80.0
76.0
72.0
68.0
64.0
60.0
58.0

P

9/26/2013 10/3/2013

◄ 9/23/2013 12:00 AM << Primary >> 10/8/2013 12:00 AM ►

AECOM

E2e Pressure Points 2
Hourly Min Sep 23-Oct 7 2013

Global Trendset

Global Trendset

Trend Name: Press_Pts_#2 ▶ Search

Owner: dnaAdmin

Global trend: ◉ Yes ○ No

☐ Individual Y Axes ☑ Markers On

☐ Show Data Quality

Default Timescales

4hrs 8hrs 12hrs 24hrs

Add Pen | Delete Pen | Edit

New | Dismiss | Add | Abandon | Modify | Delete

Pressure Points - Secondary

[PSI] [PSI] [PSI] [PSI] [PSI] [PSI]

82.0
80.0
76.0
72.0
68.0
64.0
60.0

P

9/26/2013 10/3/2013

◄ 9/23/2013 12:00 AM << Primary >> 10/8/2013 12:00 AM ►

E2f Pressure Point Pressure Alarms Jan 12-26 2015

	dbName	ptName	description	message	sevInt
1/14/2015 3:06	analog	QMRR_599_PT		Value = 74.45 psi (HIGH state)	0
1/14/2015 3:06	analog	QMRR_599_PT		Issued command ACKNOWLEDGE ANALOG.QMRR_599_PT.:HILO by CarsonIkonen at wwdwsxos0	0
1/14/2015 3:08	analog	QMRR_599_PT		Value = 72.71 psi (NORMAL state)	0
1/14/2015 3:08	analog	QMRR_599_PT		Issued command ACKNOWLEDGE ANALOG.QMRR_599_PT.:HILO by CarsonIkonen at wwdwsxos0	0
1/14/2015 5:57	analog	QMSA_599_PT		Value = 76.05 psi (HIGH state)	0
1/14/2015 5:57	analog	QMSA_599_PT		Issued command ACKNOWLEDGE ANALOG.QMSA_599_PT.:HILO by CarsonIkonen at wwdwsxos0	0
1/14/2015 5:58	analog	QMSA_599_PT		Value = 74.89 psi (NORMAL state)	0
1/14/2015 5:58	analog	QMSA_599_PT		Issued command ACKNOWLEDGE ANALOG.QMSA_599_PT.:HILO by CarsonIkonen at wwdwsxos0	0
1/15/2015 1:24	analog	QMRR_599_PT		Value = 74.26 psi (HIGH state)	0
1/15/2015 1:24	analog	QMRR_599_PT		Issued command ACKNOWLEDGE ANALOG.QMRR_599_PT.:HILO by CarsonIkonen at wwdwsxos0	0
1/15/2015 1:26	analog	QMRR_599_PT		Value = 71.55 psi (NORMAL state)	0
1/15/2015 1:26	analog	QMRR_599_PT		Issued command ACKNOWLEDGE ANALOG.QMRR_599_PT.:HILO by CarsonIkonen at wwdwsxos0	0
1/15/2015 5:15	analog	QMSA_599_PT		Value = 76.05 psi (HIGH state)	0
1/15/2015 5:16	analog	QMSA_599_PT		Issued command ACKNOWLEDGE ANALOG.QMSA_599_PT.:HILO by CarsonIkonen at wwdwsxos0	0
1/15/2015 5:17	analog	QMRR_599_PT		Value = 76.22 psi (HIGH-HIGH state)	0
1/15/2015 5:17	analog	QMRR_599_PT		Issued command ACKNOWLEDGE ANALOG.QMRR_599_PT.:HILO by CarsonIkonen at wwdwsxos0	0
1/15/2015 5:18	analog	QMSA_599_PT		Value = 74.98 psi (NORMAL state)	0
1/15/2015 5:18	analog	QMSA_599_PT		Issued command ACKNOWLEDGE ANALOG.QMSA_599_PT.:HILO by CarsonIkonen at wwdwsxos0	0
1/15/2015 5:19	analog	QMRR_599_PT		Value = 71.91 psi (NORMAL state)	0
1/15/2015 5:19	analog	QMRR_599_PT		Issued command ACKNOWLEDGE ANALOG.QMRR_599_PT.:HILO by CarsonIkonen at wwdwsxos0	0
1/15/2015 23:42	analog	QMRR_599_PT		Value = 74.26 psi (HIGH state)	0
1/15/2015 23:43	analog	QMRR_599_PT		Issued command ACKNOWLEDGE ANALOG.QMRR_599_PT.:HILO by CarsonIkonen at wwdwsxos0	0
1/15/2015 23:44	analog	QMRR_599_PT		Value = 71.45 psi (NORMAL state)	0
1/15/2015 23:45	analog	QMRR_599_PT		Issued command ACKNOWLEDGE ANALOG.QMRR_599_PT.:HILO by CarsonIkonen at wwdwsxos0	0
1/16/2015 5:38	analog	QMSA_599_PT		Value = 76.14 psi (HIGH state)	0
1/16/2015 5:38	analog	QMSA_599_PT		Issued command ACKNOWLEDGE ANALOG.QMSA_599_PT.:HILO by M keMastroianni at wwdwsxo	0
1/16/2015 5:39	analog	QMRR_599_PT		Value = 75.97 psi (HIGH-HIGH state)	0
1/16/2015 5:39	analog	QMRR_599_PT		Issued command ACKNOWLEDGE ANALOG.QMRR_599_PT.:HILO by M keMastroianni at wwdwsxc	0
1/16/2015 5:40	analog	QMSA_599_PT		Value = 74.43 psi (NORMAL state)	0
1/16/2015 5:40	analog	QMSA_599_PT		Issued command ACKNOWLEDGE ANALOG.QMSA_599_PT.:HILO by CarsonIkonen at wwdwsxos0	0
1/16/2015 5:41	analog	QMRR_599_PT		Value = 73.41 psi (NORMAL state)	0
1/16/2015 5:41	analog	QMRR_599_PT		Issued command ACKNOWLEDGE ANALOG.QMRR_599_PT.:HILO by CarsonIkonen at wwdwsxos0	0
1/17/2015 3:40	analog	QMRR_599_PT		Value = 74.2 psi (HIGH state)	0
1/17/2015 3:41	analog	QMRR_599_PT		Issued command ACKNOWLEDGE ANALOG.QMRR_599_PT.:HILO by CarsonIkonen at wwdwsxos0	0
1/17/2015 3:42	analog	QMRR_599_PT		Value = 71.64 psi (NORMAL state)	0
1/17/2015 3:43	analog	QMRR_599_PT		Issued command ACKNOWLEDGE ANALOG.QMRR_599_PT.:HILO by CarsonIkonen at wwdwsxos0	0
1/17/2015 4:36	analog	QMRR_599_PT		Value = 74.42 psi (HIGH state)	0
1/17/2015 4:36	analog	QMRR_599_PT		Issued command ACKNOWLEDGE ANALOG.QMRR_599_PT.:HILO by M keMastroianni at wwdwsxc	0
1/17/2015 4:38	analog	QMRR_599_PT		Value = 71.91 psi (NORMAL state)	0
1/17/2015 4:38	analog	QMRR_599_PT		Issued command ACKNOWLEDGE ANALOG.QMRR_599_PT.:HILO by M keMastroianni at wwdwsxc	0
1/17/2015 4:54	analog	QMRR_599_PT		Value = 74.35 psi (HIGH state)	0
1/17/2015 4:55	analog	QMRR_599_PT		Issued command ACKNOWLEDGE ANALOG.QMRR_599_PT.:HILO by CarsonIkonen at wwdwsxos0	0
1/17/2015 4:56	analog	QMRR_599_PT		Value = 72.64 psi (NORMAL state)	0
1/17/2015 4:57	analog	QMRR_599_PT		Issued command ACKNOWLEDGE ANALOG.QMRR_599_PT.:HILO by CarsonIkonen at wwdwsxos0	0
1/17/2015 7:31	analog	QMSA_599_PT		Value = 76.23 psi (HIGH state)	0
1/17/2015 7:31	analog	QMSA_599_PT		Issued command ACKNOWLEDGE ANALOG.QMSA_599_PT.:HILO by CarsonIkonen at wwdwsxos0	0
1/17/2015 7:31	analog	QMRR_599_PT		Value = 74.93 psi (HIGH state)	0
1/17/2015 7:31	analog	QMRR_599_PT		Issued command ACKNOWLEDGE ANALOG.QMRR_599_PT.:HILO by CarsonIkonen at wwdwsxos0	0

1/17/2015 7:32	analog	QMSA_599_PT		Value = 74.98 psi (NORMAL state)	0
1/17/2015 7:32	analog	QMSA_599_PT		Issued command ACKNOWLEDGE ANALOG.QMSA_599_PT.:HILO by CarsonIkonen at wwdwsxos0	0
1/17/2015 7:33	analog	QMRR_599_PT		Value = 70.72 psi (NORMAL state)	0
1/17/2015 7:33	analog	QMRR_599_PT		Issued command ACKNOWLEDGE ANALOG.QMRR_599_PT.:HILO by CarsonIkonen at wwdwsxos0	0
1/18/2015 7:42	analog	QMRR_599_PT		Value = 74.69 psi (HIGH state)	0
1/18/2015 7:42	analog	QMSA_599_PT		Value = 76.2 psi (HIGH state)	0
1/18/2015 7:42	analog	QMSA_599_PT		Issued command ACKNOWLEDGE ANALOG.QMSA_599_PT.:HILO by CarsonIkonen at wwdwsxos0	0
1/18/2015 7:43	analog	QMRR_599_PT		Issued command ACKNOWLEDGE ANALOG.QMRR_599_PT.:HILO by CarsonIkonen at wwdwsxos0	0
1/18/2015 7:44	analog	QMSA_599_PT		Value = 74.92 psi (NORMAL state)	0
1/18/2015 7:44	analog	QMSA_599_PT		Issued command ACKNOWLEDGE ANALOG.QMSA_599_PT.:HILO by CarsonIkonen at wwdwsxos0	0
1/18/2015 7:44	analog	QMRR_599_PT		Value = 71.27 psi (NORMAL state)	0
1/18/2015 7:44	analog	QMRR_599_PT		Issued command ACKNOWLEDGE ANALOG.QMRR_599_PT.:HILO by CarsonIkonen at wwdwsxos0	0
1/18/2015 11:23	analog	QMRS_599_PT		Value = 62.71 psi (LOW state)	0
1/18/2015 11:23	analog	QMPR_599_PT		Value = 58.51 psi (LOW state)	0
1/18/2015 11:23	analog	QMPR_599_PT		Issued command ACKNOWLEDGE ANALOG.QMPR_599_PT.:HILO by MikeMastroianni at wwdwsxc	0
1/18/2015 11:23	analog	QMRS_599_PT		Issued command ACKNOWLEDGE ANALOG.QMRS_599_PT.:HILO by MikeMastroianni at wwdwsxc	0
1/18/2015 11:25	analog	QMRS_599_PT		Value = 43.24 psi (LOW-LOW state)	0
1/18/2015 11:25	analog	QMRS_599_PT		Issued command ACKNOWLEDGE ANALOG.QMRS_599_PT.:HILO by CarsonIkonen at wwdwsxos0	0
1/18/2015 11:25	analog	QMPR_599_PT		Value = 48.26 psi (LOW-LOW state)	0
1/18/2015 11:25	analog	QMPR_599_PT		Issued command ACKNOWLEDGE ANALOG.QMPR_599_PT.:HILO by MikeMastroianni at wwdwsxc	0
1/18/2015 11:43	analog	QMJB_599_PT		Value = 63.91 psi (LOW state)	0
1/18/2015 11:44	analog	QMJB_599_PT		Issued command ACKNOWLEDGE ANALOG.QMJB_599_PT.:HILO by CarsonIkonen at wwdwsxos0	0
1/18/2015 11:45	analog	QMJB_599_PT		Value = 65.29 psi (NORMAL state)	0
1/18/2015 11:46	analog	QMJB_599_PT		Issued command ACKNOWLEDGE ANALOG.QMJB_599_PT.:HILO by MikeMastroianni at wwdwsxo	0
1/18/2015 12:31	analog	QMJB_599_PT		Value = 63.82 psi (LOW state)	0
1/18/2015 12:31	analog	QMJB_599_PT		Issued command ACKNOWLEDGE ANALOG.QMJB_599_PT.:HILO by CarsonIkonen at wwdwsxos0	0
1/18/2015 12:33	analog	QMJB_599_PT		Value = 66.72 psi (NORMAL state)	0
1/18/2015 12:33	analog	QMJB_599_PT		Issued command ACKNOWLEDGE ANALOG.QMJB_599_PT.:HILO by CarsonIkonen at wwdwsxos0	0
1/18/2015 14:07	analog	QMPR_599_PT		Value = 58.48 psi (LOW state)	0
1/18/2015 14:07	analog	QMPR_599_PT		Issued command ACKNOWLEDGE ANALOG.QMPR_599_PT.:HILO by CarsonIkonen at wwdwsxos0	0
1/18/2015 14:16	analog	QMPR_599_PT		Value = 63.7 psi (NORMAL state)	0
1/18/2015 14:16	analog	QMPR_599_PT		Issued command ACKNOWLEDGE ANALOG.QMPR_599_PT.:HILO by CarsonIkonen at wwdwsxos0	0
1/18/2015 14:20	analog	QMRS_599_PT		Value = 63.81 psi (LOW state)	0
1/18/2015 14:20	analog	QMRS_599_PT		Issued command ACKNOWLEDGE ANALOG.QMRS_599_PT.:HILO by CarsonIkonen at wwdwsxos0	0
1/18/2015 14:27	analog	QMRS_599_PT		Value = 68.08 psi (NORMAL state)	0
1/18/2015 14:27	analog	QMRS_599_PT		Issued command ACKNOWLEDGE ANALOG.QMRS_599_PT.:HILO by CarsonIkonen at wwdwsxos0	0
1/19/2015 0:03	analog	QMPR_599_PT		Value = 78.72 psi (HIGH state)	0
1/19/2015 0:03	analog	QMPR_599_PT		Issued command ACKNOWLEDGE ANALOG.QMPR_599_PT.:HILO by MikeMastroianni at wwdwsxc	0
1/19/2015 0:06	analog	QMPR_599_PT		Value = 74.93 psi (NORMAL state)	0
1/19/2015 0:06	analog	QMPR_599_PT		Issued command ACKNOWLEDGE ANALOG.QMPR_599_PT.:HILO by MikeMastroianni at wwdwsxc	0
1/19/2015 1:18	analog	QMPR_599_PT		Value = 78.11 psi (HIGH state)	0
1/19/2015 1:18	analog	QMPR_599_PT		Issued command ACKNOWLEDGE ANALOG.QMPR_599_PT.:HILO by CarsonIkonen at wwdwsxos0	0
1/19/2015 1:20	analog	QMPR_599_PT		Value = 76.4 psi (NORMAL state)	0
1/19/2015 1:20	analog	QMPR_599_PT		Issued command ACKNOWLEDGE ANALOG.QMPR_599_PT.:HILO by CarsonIkonen at wwdwsxos0	0
1/19/2015 2:34	analog	QMPR_599_PT		Value = 78.02 psi (HIGH state)	0
1/19/2015 2:34	analog	QMPR_599_PT		Issued command ACKNOWLEDGE ANALOG.QMPR_599_PT.:HILO by CarsonIkonen at wwdwsxos0	0
1/19/2015 3:02	analog	QMPR_599_PT		Value = 76.83 psi (NORMAL state)	0
1/19/2015 3:03	analog	QMPR_599_PT		Issued command ACKNOWLEDGE ANALOG.QMPR_599_PT.:HILO by MikeMastroianni at wwdwsxc	0
1/19/2015 3:12	analog	QMRR_599_PT		Value = 74.11 psi (HIGH state)	0

1/19/2015 3:12	analog	QMRR_599_PT		Issued command ACKNOWLEDGE ANALOG.QMRR_599_PT.:HILO by CarsonIkonen at wwdwsxos0	0
1/19/2015 3:14	analog	QMRR_599_PT		Value = 71.79 psi (NORMAL state)	0
1/19/2015 3:14	analog	QMRR_599_PT		Issued command ACKNOWLEDGE ANALOG.QMRR_599_PT.:HILO by CarsonIkonen at wwdwsxos0	0
1/20/2015 3:40	analog	QMRR_599_PT		Value = 74.38 psi (HIGH state)	0
1/20/2015 3:40	analog	QMRR_599_PT		Issued command ACKNOWLEDGE ANALOG.QMRR_599_PT.:HILO by CarsonIkonen at wwdwsxos0	0
1/20/2015 3:42	analog	QMRR_599_PT		Value = 72.86 psi (NORMAL state)	0
1/20/2015 3:42	analog	QMRR_599_PT		Issued command ACKNOWLEDGE ANALOG.QMRR_599_PT.:HILO by CarsonIkonen at wwdwsxos0	0
1/20/2015 5:40	analog	QMSA_599_PT		Value = 76.44 psi (HIGH state)	0
1/20/2015 5:40	analog	QMSA_599_PT		Issued command ACKNOWLEDGE ANALOG.QMSA_599_PT.:HILO by M keMastroianni at wwdwsxo	0
1/20/2015 5:41	analog	QMRR_599_PT		Value = 74.66 psi (HIGH state)	0
1/20/2015 5:41	analog	QMRR_599_PT		Issued command ACKNOWLEDGE ANALOG.QMRR_599_PT.:HILO by M keMastroianni at wwdwsxo	0
1/20/2015 5:42	analog	QMSA_599_PT		Value = 74.86 psi (NORMAL state)	0
1/20/2015 5:42	analog	QMSA_599_PT		Issued command ACKNOWLEDGE ANALOG.QMSA_599_PT.:HILO by M keMastroianni at wwdwsxo	0
1/20/2015 5:43	analog	QMRR_599_PT		Value = 72.83 psi (NORMAL state)	0
1/20/2015 5:43	analog	QMRR_599_PT		Issued command ACKNOWLEDGE ANALOG.QMRR_599_PT.:HILO by M keMastroianni at wwdwsxo	0
1/20/2015 10:22	analog	QMSA_599_PT		Value = 76.08 psi (HIGH state)	0
1/20/2015 10:22	analog	QMSA_599_PT		Issued command ACKNOWLEDGE ANALOG.QMSA_599_PT.:HILO by CarsonIkonen at wwdwsxos0	0
1/20/2015 10:23	analog	QMSA_599_PT		Value = 74.92 psi (NORMAL state)	0
1/20/2015 10:23	analog	QMSA_599_PT		Issued command ACKNOWLEDGE ANALOG.QMSA_599_PT.:HILO by CarsonIkonen at wwdwsxos0	0
1/20/2015 23:30	analog	QMPR_599_PT		Value = 78.35 psi (HIGH state)	0
1/20/2015 23:30	analog	QMPR_599_PT		Issued command ACKNOWLEDGE ANALOG.QMPR_599_PT.:HILO by JohnPenner at wwdwsxos01	0
1/20/2015 23:32	analog	QMPR_599_PT		Value = 74.69 psi (NORMAL state)	0
1/20/2015 23:32	analog	QMPR_599_PT		Issued command ACKNOWLEDGE ANALOG.QMPR_599_PT.:HILO by JohnPenner at wwdwsxos01	0
1/21/2015 1:16	analog	QMPR_599_PT		Value = 78.05 psi (HIGH state)	0
1/21/2015 1:16	analog	QMPR_599_PT		Issued command ACKNOWLEDGE ANALOG.QMPR_599_PT.:HILO by CarsonIkonen at wwdwsxos0	0
1/21/2015 1:18	analog	QMPR_599_PT		Value = 75 psi (NORMAL state)	0
1/21/2015 1:18	analog	QMPR_599_PT		Issued command ACKNOWLEDGE ANALOG.QMPR_599_PT.:HILO by CarsonIkonen at wwdwsxos0	0
1/21/2015 1:23	analog	QMRR_599_PT		Value = 74.02 psi (HIGH state)	0
1/21/2015 1:23	analog	QMRR_599_PT		Issued command ACKNOWLEDGE ANALOG.QMRR_599_PT.:HILO by JohnPenner at wwdwsxos01	0
1/21/2015 1:25	analog	QMRR_599_PT		Value = 71.67 psi (NORMAL state)	0
1/21/2015 1:25	analog	QMRR_599_PT		Issued command ACKNOWLEDGE ANALOG.QMRR_599_PT.:HILO by JohnPenner at wwdwsxos01	0
1/21/2015 1:46	analog	QMRR_599_PT		Value = 74.17 psi (HIGH state)	0
1/21/2015 1:46	analog	QMRR_599_PT		Issued command ACKNOWLEDGE ANALOG.QMRR_599_PT.:HILO by CarsonIkonen at wwdwsxos0	0
1/21/2015 1:48	analog	QMRR_599_PT		Value = 72.58 psi (NORMAL state)	0
1/21/2015 1:48	analog	QMRR_599_PT		Issued command ACKNOWLEDGE ANALOG.QMRR_599_PT.:HILO by CarsonIkonen at wwdwsxos0	0
1/21/2015 2:12	analog	QMRR_599_PT		Value = 74.32 psi (HIGH state)	0
1/21/2015 2:13	analog	QMRR_599_PT		Issued command ACKNOWLEDGE ANALOG.QMRR_599_PT.:HILO by CarsonIkonen at wwdwsxos0	0
1/21/2015 2:14	analog	QMRR_599_PT		Value = 71.76 psi (NORMAL state)	0
1/21/2015 2:15	analog	QMRR_599_PT		Issued command ACKNOWLEDGE ANALOG.QMRR_599_PT.:HILO by CarsonIkonen at wwdwsxos0	0
1/21/2015 2:45	analog	QMRR_599_PT		Value = 74.08 psi (HIGH state)	0
1/21/2015 2:46	analog	QMRR_599_PT		Issued command ACKNOWLEDGE ANALOG.QMRR_599_PT.:HILO by CarsonIkonen at wwdwsxos0	0
1/21/2015 2:47	analog	QMRR_599_PT		Value = 72.1 psi (NORMAL state)	0
1/21/2015 2:48	analog	QMRR_599_PT		Issued command ACKNOWLEDGE ANALOG.QMRR_599_PT.:HILO by CarsonIkonen at wwdwsxos0	0
1/21/2015 3:01	analog	QMPR_599_PT		Value = 78.44 psi (HIGH state)	0
1/21/2015 3:01	analog	QMPR_599_PT		Issued command ACKNOWLEDGE ANALOG.QMPR_599_PT.:HILO by CarsonIkonen at wwdwsxos0	0
1/21/2015 3:03	analog	QMPR_599_PT		Value = 76.15 psi (NORMAL state)	0
1/21/2015 3:03	analog	QMPR_599_PT		Issued command ACKNOWLEDGE ANALOG.QMPR_599_PT.:HILO by CarsonIkonen at wwdwsxos0	0
1/21/2015 4:16	analog	QMRR_599_PT		Value = 74.02 psi (HIGH state)	0
1/21/2015 4:16	analog	QMRR_599_PT		Issued command ACKNOWLEDGE ANALOG.QMRR_599_PT.:HILO by CarsonIkonen at wwdwsxos0	0

1/21/2015 4:18	analog	QMRR_599_PT		Value = 72.28 psi (NORMAL state)	0
1/21/2015 4:18	analog	QMRR_599_PT		Issued command ACKNOWLEDGE ANALOG.QMRR_599_PT.:HILO by JohnPenner at wwdwsxos01	0
1/21/2015 4:20	analog	QMRR_599_PT		Value = 74.26 psi (HIGH state)	0
1/21/2015 4:20	analog	QMRR_599_PT		Issued command ACKNOWLEDGE ANALOG.QMRR_599_PT.:HILO by CarsonIkonen at wwdwsxos0	0
1/21/2015 4:22	analog	QMRR_599_PT		Value = 71.61 psi (NORMAL state)	0
1/21/2015 4:22	analog	QMRR_599_PT		Issued command ACKNOWLEDGE ANALOG.QMRR_599_PT.:HILO by CarsonIkonen at wwdwsxos0	0
1/21/2015 5:54	analog	QMSA_599_PT		Value = 76.14 psi (HIGH state)	0
1/21/2015 5:54	analog	QMSA_599_PT		Issued command ACKNOWLEDGE ANALOG.QMSA_599_PT.:HILO by CarsonIkonen at wwdwsxos0	0
1/21/2015 5:55	analog	QMSA_599_PT		Value = 74.7 psi (NORMAL state)	0
1/21/2015 5:55	analog	QMSA_599_PT		Issued command ACKNOWLEDGE ANALOG.QMSA_599_PT.:HILO by CarsonIkonen at wwdwsxos0	0
1/22/2015 2:30	analog	QMPR_599_PT		Value = 78.05 psi (HIGH state)	0
1/22/2015 2:30	analog	QMPR_599_PT		Issued command ACKNOWLEDGE ANALOG.QMPR_599_PT.:HILO by CarsonIkonen at wwdwsxos0	0
1/22/2015 2:32	analog	QMPR_599_PT		Value = 76.86 psi (NORMAL state)	0
1/22/2015 2:32	analog	QMPR_599_PT		Issued command ACKNOWLEDGE ANALOG.QMPR_599_PT.:HILO by CarsonIkonen at wwdwsxos0	0
1/22/2015 5:44	analog	QMSA_599_PT		Value = 76.23 psi (HIGH state)	0
1/22/2015 5:44	analog	QMSA_599_PT		Issued command ACKNOWLEDGE ANALOG.QMSA_599_PT.:HILO by CarsonIkonen at wwdwsxos0	0
1/22/2015 5:46	analog	QMSA_599_PT		Value = 74.73 psi (NORMAL state)	0
1/22/2015 5:46	analog	QMSA_599_PT		Issued command ACKNOWLEDGE ANALOG.QMSA_599_PT.:HILO by JohnPenner at wwdwsxos01	0
1/23/2015 5:25	analog	QMSA_599_PT		Value = 76.26 psi (HIGH state)	0
1/23/2015 5:25	analog	QMSA_599_PT		Issued command ACKNOWLEDGE ANALOG.QMSA_599_PT.:HILO by CarsonIkonen at wwdwsxos0	0
1/23/2015 5:27	analog	QMSA_599_PT		Value = 74.95 psi (NORMAL state)	0
1/23/2015 5:27	analog	QMSA_599_PT		Issued command ACKNOWLEDGE ANALOG.QMSA_599_PT.:HILO by CarsonIkonen at wwdwsxos0	0
1/23/2015 5:28	analog	QMSA_599_PT		Value = 76.05 psi (HIGH state)	0
1/23/2015 5:28	analog	QMSA_599_PT		Value = 74.89 psi (NORMAL state)	0
1/23/2015 5:28	analog	QMSA_599_PT		Issued command ACKNOWLEDGE ANALOG.QMSA_599_PT.:HILO by JohnPenner at wwdwsxos01	0
1/23/2015 5:34	analog	QMRR_599_PT		Value = 74.6 psi (HIGH state)	0
1/23/2015 5:35	analog	QMRR_599_PT		Issued command ACKNOWLEDGE ANALOG.QMRR_599_PT.:HILO by JohnPenner at wwdwsxos01	0
1/23/2015 5:37	analog	QMRR_599_PT		Value = 71.52 psi (NORMAL state)	0
1/23/2015 5:37	analog	QMRR_599_PT		Issued command ACKNOWLEDGE ANALOG.QMRR_599_PT.:HILO by JohnPenner at wwdwsxos01	0
1/24/2015 7:26	analog	QMSA_599_PT		Value = 76.02 psi (HIGH state)	0
1/24/2015 7:26	analog	QMSA_599_PT		Issued command ACKNOWLEDGE ANALOG.QMSA_599_PT.:HILO by CarsonIkonen at wwdwsxos0	0
1/24/2015 7:27	analog	QMSA_599_PT		Value = 74.95 psi (NORMAL state)	0
1/24/2015 7:27	analog	QMSA_599_PT		Issued command ACKNOWLEDGE ANALOG.QMSA_599_PT.:HILO by CarsonIkonen at wwdwsxos0	0
1/25/2015 7:40	analog	QMRR_599_PT		Value = 75.03 psi (HIGH-HIGH state)	0
1/25/2015 7:40	analog	QMRR_599_PT		Issued command ACKNOWLEDGE ANALOG.QMRR_599_PT.:HILO by CarsonIkonen at wwdwsxos0	0
1/25/2015 7:42	analog	QMRR_599_PT		Value = 71.76 psi (NORMAL state)	0
1/25/2015 7:43	analog	QMRR_599_PT		Issued command ACKNOWLEDGE ANALOG.QMRR_599_PT.:HILO by CarsonIkonen at wwdwsxos0	0
1/26/2015 0:49	analog	QMPR_599_PT		Value = 78.6 psi (HIGH state)	0
1/26/2015 0:50	analog	QMPR_599_PT		Issued command ACKNOWLEDGE ANALOG.QMPR_599_PT.:HILO by CarsonIkonen at wwdwsxos0	0
1/26/2015 0:52	analog	QMPR_599_PT		Value = 75.48 psi (NORMAL state)	0
1/26/2015 0:52	analog	QMPR_599_PT		Issued command ACKNOWLEDGE ANALOG.QMPR_599_PT.:HILO by JohnPenner at wwdwsxos01	0
1/26/2015 5:34	analog	QMSA_599_PT		Value = 76.02 psi (HIGH state)	0
1/26/2015 5:35	analog	QMSA_599_PT		Issued command ACKNOWLEDGE ANALOG.QMSA_599_PT.:HILO by JohnPenner at wwdwsxos01	0
1/26/2015 5:36	analog	QMPR_599_PT		Value = 78.32 psi (HIGH state)	0
1/26/2015 5:36	analog	QMPR_599_PT		Issued command ACKNOWLEDGE ANALOG.QMPR_599_PT.:HILO by JohnPenner at wwdwsxos01	0
1/26/2015 5:36	analog	QMRR_599_PT		Value = 74.11 psi (HIGH state)	0
1/26/2015 5:36	analog	QMRR_599_PT		Issued command ACKNOWLEDGE ANALOG.QMRR_599_PT.:HILO by JohnPenner at wwdwsxos01	0
1/26/2015 5:37	analog	QMSA_599_PT		Value = 74.95 psi (NORMAL state)	0
1/26/2015 5:37	analog	QMSA_599_PT		Issued command ACKNOWLEDGE ANALOG.QMSA_599_PT.:HILO by JohnPenner at wwdwsxos01	0

1/26/2015 5:38	analog	QMRR_599_PT		Value = 72.43 psi (NORMAL state)	0
1/26/2015 5:38	analog	QMRR_599_PT		Issued command ACKNOWLEDGE ANALOG.QMRR_599_PT.:HILO by JohnPenner at wwdwsxos01	0
1/26/2015 5:38	analog	QMPR_599_PT		Value = 74.78 psi (NORMAL state)	0
1/26/2015 5:38	analog	QMPR_599_PT		Issued command ACKNOWLEDGE ANALOG.QMPR_599_PT.:HILO by JohnPenner at wwdwsxos01	0

E2g Pressure Point Hourly Minimum Pressures Dec 2014 through Feb 2015

Timestamp																					
12/1/2014 0 47	72.5200025	12/1/2014 0 52	70.92000066	12/1/2014 0 44	73.1799977	12/1/2014 0 00	69.47	12/1/2014 0 00	66.48000244	12/1/2014 0 00	76.51000144	12/1/2014 0 44	70.82999821	12/1/2014 0 00	73.65000206	12/1/2014 0 03	71.8799991	12/1/2014 0 00	74.47000279	12/1/2014 0 52	74.69
12/1/2014 1 37	73.35000253	12/1/2014 1 03	70.89000066	12/1/2014 1 42	73.2999977	12/1/2014 1 42	70.75	12/1/2014 1 38	67.95000249	12/1/2014 1 00	76.51000144	12/1/2014 1 38	71.1599982	12/1/2014 1 38	74.51000209	12/1/2014 1 38	72.0699991	12/1/2014 1 38	74.59000279	12/1/2014 1 42	75.18
12/1/2014 2 24	74.57000257	12/1/2014 2 24	71.78000067	12/1/2014 2 06	74.14999767	12/1/2014 2 25	71.15	12/1/2014 2 25	69.47000255	12/1/2014 2 00	76.51000144	12/1/2014 2 24	72.34999817	12/1/2014 2 30	75.0900021	12/1/2014 2 24	72.33999909	12/1/2014 2 11	75.78000284	12/1/2014 2 25	75.48
12/1/2014 3 28	74.75000257	12/1/2014 3 32	71.72000067	12/1/2014 3 28	73.3299977	12/1/2014 3 27	71.61	12/1/2014 3 28	69.32000254	12/1/2014 3 00	76.51000144	12/1/2014 3 27	72.50999817	12/1/2014 3 28	74.42000208	12/1/2014 3 28	72.39999909	12/1/2014 3 29	75.35000282	12/1/2014 3 58	75.82
12/1/2014 4 55	75.00000258	12/1/2014 4 47	70.98000066	12/1/2014 4 46	73.81999768	12/1/2014 4 54	71.64	12/1/2014 4 51	69.01000253	12/1/2014 4 00	76.51000144	12/1/2014 4 46	72.43999817	12/1/2014 4 45	74.78000209	12/1/2014 4 56	72.54999909	12/1/2014 4 31	75.38000282	12/1/2014 4 39	75.73
12/1/2014 5 22	72.77000251	12/1/2014 5 50	68.24000063	12/1/2014 5 39	73.0599977	12/1/2014 5 27	70.48	12/1/2014 5 41	66.85000245	12/1/2014 5 00	76.51000144	12/1/2014 5 41	70.60999821	12/1/2014 5 48	74.08000207	12/1/2014 5 49	70.74999911	12/1/2014 5 49	73.95000277	12/1/2014 5 32	73.84
12/1/2014 6 35	71.73000247	12/1/2014 6 50	66.95000062	12/1/2014 6 36	71.43999775	12/1/2014 6 36	69.81	12/1/2014 6 35	67.27000247	12/1/2014 6 00	76.51000144	12/1/2014 6 35	70.9499982	12/1/2014 6 36	73.26000205	12/1/2014 6 50	66.59999916	12/1/2014 6 52	71.26000267	12/1/2014 6 35	72.61
12/1/2014 7 58	70.51000243	12/1/2014 7 33	66.10000061	12/1/2014 7 36	70.51999778	12/1/2014 7 24	69.16	12/1/2014 7 58	66.30000243	12/1/2014 7 00	76.51000144	12/1/2014 7 42	71.0999982	12/1/2014 7 32	72.58000203	12/1/2014 7 24	66.47999916	12/1/2014 7 17	70.87000265	12/1/2014 7 33	72.1
12/1/2014 8 00	70.51000243	12/1/2014 8 00	67.29000062	12/1/2014 8 05	70.70999778	12/1/2014 8 52	69.81	12/1/2014 8 00	66.30000243	12/1/2014 8 00	76.51000144	12/1/2014 8 23	71.3199982	12/1/2014 8 00	73.19000205	12/1/2014 8 02	68.30999914	12/1/2014 8 00	72.70000272	12/1/2014 8 26	73.22
12/1/2014 9 00	72.10000248	12/1/2014 9 06	68.15000063	12/1/2014 9 15	70.85999777	12/1/2014 9 28	70.26	12/1/2014 9 43	67.43000247	12/1/2014 9 00	76.51000144	12/1/2014 9 06	71.2799982	12/1/2014 9 54	73.07000204	12/1/2014 9 06	68.79999914	12/1/2014 9 16	72.97000273	12/1/2014 9 36	73.38
12/1/2014 10 14	71.73000247	12/1/2014 10 48	67.66000063	12/1/2014 10 41	70.66999778	12/1/2014 10 18	69.53	12/1/2014 10 37	67.40000247	12/1/2014 10 00	76.51000144	12/1/2014 10 48	70.88999821	12/1/2014 10 59	72.74000203	12/1/2014 10 01	69.52999913	12/1/2014 10 49	73.22000274	12/1/2014 10 09	73.04
12/1/2014 11 41	71.18000245	12/1/2014 11 21	67.81000063	12/1/2014 11 29	71.52999775	12/1/2014 11 00	70.05	12/1/2014 11 21	67.18000246	12/1/2014 11 00	76.51000144	12/1/2014 11 21	71.3499982	12/1/2014 11 00	72.74000203	12/1/2014 11 46	69.52999913	12/1/2014 11 12	73.34000274	12/1/2014 11 13	73.16
12/1/2014 12 45	71.21000246	12/1/2014 12 14	68.15000063	12/1/2014 12 16	71.18999776	12/1/2014 12 23	69.96	12/1/2014 12 49	67.09000246	12/1/2014 12 00	76.51000144	12/1/2014 12 17	70.51999822	12/1/2014 12 16	72.86000204	12/1/2014 12 09	69.58999913	12/1/2014 12 00	73.55000275	12/1/2014 12 57	73.59
12/1/2014 13 16	72.10000248	12/1/2014 13 07	68.02000063	12/1/2014 13 21	72.37999773	12/1/2014 13 17	70.23	12/1/2014 13 16	67.27000247	12/1/2014 13 00	76.51000144	12/1/2014 13 56	70.85999821	12/1/2014 13 45	73.50000206	12/1/2014 13 24	69.86999912	12/1/2014 13 30	74.01000277	12/1/2014 13 00	73.59
12/1/2014 14 51	72.5200025	12/1/2014 14 52	68.36000063	12/1/2014 14 23	72.13999773	12/1/2014 14 56	70.39	12/1/2014 14 25	66.48000244	12/1/2014 14 00	76.51000144	12/1/2014 14 25	71.0999982	12/1/2014 14 19	73.38000205	12/1/2014 14 33	70.16999912	12/1/2014 14 57	74.19000278	12/1/2014 14 22	73.8
12/1/2014 15 35	72.4900025	12/1/2014 15 43	68.36000063	12/1/2014 15 03	72.68999772	12/1/2014 15 00	70.42	12/1/2014 15 42	67.55000248	12/1/2014 15 00	76.51000144	12/1/2014 15 46	71.0999982	12/1/2014 15 58	73.68000206	12/1/2014 15 43	70.10999912	12/1/2014 15 46	73.98000277	12/1/2014 15 42	73.53
12/1/2014 16 42	72.31000249	12/1/2014 16 19	68.05000063	12/1/2014 16 16	71.46999775	12/1/2014 16 12	70.05	12/1/2014 16 45	67.09000246	12/1/2014 16 00	76.51000144	12/1/2014 16 16	71.3499982	12/1/2014 16 26	73.59000206	12/1/2014 16 45	69.55999913	12/1/2014 16 52	73.55000275	12/1/2014 16 51	73.59
12/1/2014 17 35	71.85000248	12/1/2014 17 13	67.35000063	12/1/2014 17 21	71.98999774	12/1/2014 17 20	70.29	12/1/2014 17 55	67.40000247	12/1/2014 17 00	76.51000144	12/1/2014 17 34	71.52999819	12/1/2014 17 27	73.26000205	12/1/2014 17 09	68.94999913	12/1/2014 17 41	72.51000271	12/1/2014 17 40	73.26
12/1/2014 18 48	71.03000245	12/1/2014 18 31	66.44000062	12/1/2014 18 53	71.64999775	12/1/2014 18 09	69.87	12/1/2014 18 13	66.79000245	12/1/2014 18 00	76.51000144	12/1/2014 18 10	70.9799982	12/1/2014 18 49	72.74000203	12/1/2014 18 13	68.30999914	12/1/2014 18 53	72.73000272	12/1/2014 18 10	72.58
12/1/2014 19 37	71.36000246	12/1/2014 19 01	67.20000062	12/1/2014 19 12	71.18999776	12/1/2014 19 25	69.84	12/1/2014 19 41	67.52000247	12/1/2014 19 00	76.51000144	12/1/2014 19 17	71.52999819	12/1/2014 19 54	73.29000205	12/1/2014 19 08	68.82999914	12/1/2014 19 22	72.54000272	12/1/2014 19 00	72.77
12/1/2014 20 20	72.6800025	12/1/2014 20 00	67.35000063	12/1/2014 20 28	70.45999778	12/1/2014 20 01	70.36	12/1/2014 20 14	67.88000249	12/1/2014 20 00	76.51000144	12/1/2014 20 44	71.1299982	12/1/2014 20 28	72.89000204	12/1/2014 20 04	68.45999914	12/1/2014 20 14	72.2100027	12/1/2014 20 04	73.19
12/1/2014 21 33	73.01000252	12/1/2014 21 02	67.32000062	12/1/2014 21 32	71.64999775	12/1/2014 21 58	69.78	12/1/2014 21 59	67.46000247	12/1/2014 21 00	76.51000144	12/1/2014 21 58	71.0399982	12/1/2014 21 58	71.490002	12/1/2014 21 58	68.70999914	12/1/2014 21 01	73.00000273	12/1/2014 21 23	73.71
12/1/2014 22 06	72.37000249	12/1/2014 22 49	68.18000063	12/1/2014 22 02	72.25999773	12/1/2014 22 00	69.78	12/1/2014 22 03	67.24000246	12/1/2014 22 00	76.51000144	12/1/2014 22 02	70.91999821	12/1/2014 22 00	71.490002	12/1/2014 22 02	69.37999913	12/1/2014 22 00	73.22000274	12/1/2014 22 50	72.77
12/1/2014 23 57	70.36000243	12/1/2014 23 08	69.24000064	12/1/2014 23 05	72.68999772	12/1/2014 23 57	67.82	12/1/2014 23 57	64.47000236	12/1/2014 23 00	76.51000144	12/1/2014 23 57	68.86999825	12/1/2014 23 58	72.92000204	12/1/2014 23 58	68.94999913	12/1/2014 23 57	73.25000274	12/1/2014 23 58	72.22
12/2/2014 0 03	73.56000253	12/2/2014 0 00	69.52000065	12/2/2014 0 02	72.86999771	12/2/2014 0 03	70.94	12/2/2014 0 03	67.52000247	12/2/2014 0 00	76.51000144	12/2/2014 0 02	71.2199982	12/2/2014 0 00	72.92000204	12/2/2014 0 02	71.41999911	12/2/2014 0 04	74.16000278	12/2/2014 0 00	72.22
12/2/2014 1 12	74.14000255	12/2/2014 1 08	71.29000066	12/2/2014 1 12	73.47999769	12/2/2014 1 12	71.67	12/2/2014 1 02	68.89000253	12/2/2014 1 00	76.51000144	12/2/2014 1 42	71.85999818	12/2/2014 1 17	74.60000209	12/2/2014 1 46	72.51999909	12/2/2014 1 22	75.17000281	12/2/2014 1 46	75.45
12/2/2014 2 10	75.33000259	12/2/2014 2 18	71.41000066	12/2/2014 2 50	74.11999767	12/2/2014 2 47	72.1	12/2/2014 2 20	69.59000255	12/2/2014 2 00	76.51000144	12/2/2014 2 01	72.56999817	12/2/2014 2 34	75.21000211	12/2/2014 2 04	72.61999909	12/2/2014 2 30	75.51000283	12/2/2014 2 03	75.91
12/2/2014 3 23	73.90000254	12/2/2014 3 53	71.59000067	12/2/2014 3 27	73.75999768	12/2/2014 3 23	71	12/2/2014 3 23	68.49000251	12/2/2014 3 00	76.51000144	12/2/2014 3 22	72.43999817	12/2/2014 3 19	74.81000209	12/2/2014 3 19	72.97999909	12/2/2014 3 23	75.44000282	12/2/2014 3 30	75.42
12/2/2014 4 17	74.32000256	12/2/2014 4 36	71.63000067	12/2/2014 4 59	73.87999768	12/2/2014 4 51	71.91	12/2/2014 4 17	68.2200025	12/2/2014 4 00	76.51000144	12/2/2014 4 17	71.92999818	12/2/2014 4 57	74.78000209	12/2/2014 4 18	72.45999909	12/2/2014 4 17	75.44000282	12/2/2014 4 50	75.15
12/2/2014 5 18	73.13000252	12/2/2014 5 56	69.40000064	12/2/2014 5 54	72.74999771	12/2/2014 5 59	70.69	12/2/2014 5 29	67.82000249	12/2/2014 5 00	76.51000144	12/2/2014 5 34	71.37999819	12/2/2014 5 57	74.08000207	12/2/2014 5 59	70.56999912	12/2/2014 5 49	74.10000277	12/2/2014 5 56	74.29
12/2/2014 6 47	72.6800025	12/2/2014 6 59	67.02000062	12/2/2014 6 02	71.03999777	12/2/2014 6 32	69.81	12/2/2014 6 03	67.18000246	12/2/2014 6 00	76.51000144	12/2/2014 6 22	71.3199982	12/2/2014 6 48	73.13000205	12/2/2014 6 48	67.14999916	12/2/2014 6 57	71.54000268	12/2/2014 6 51	73.1
12/2/2014 7 47	71.70000247	12/2/2014 7 10	65.40000061	12/2/2014 7 32	71.18999776	12/2/2014 7 13	69.1	12/2/2014 7 06	67.18000246	12/2/2014 7 00	76.51000144	12/2/2014 7 21	71.0699982	12/2/2014 7 18	73.13000205	12/2/2014 7 17	66.16999917	12/2/2014 7 18	70.68000265	12/2/2014 7 06	72.13
12/2/2014 8 20	71.30000246	12/2/2014 8 20	59.11000055	12/2/2014 8 20	69.14999783	12/2/2014 8 15	70.17	12/2/2014 8 19	66.14000242	12/2/2014 8 00	76.51000144	12/2/2014 8 55	71.0699982	12/2/2014 8 20	72.31000202	12/2/2014 8 19	59.36999925 A	12/2/2014 8 21	71.60000268	12/2/2014 8 19	67.06
12/2/2014 9 02	71.97000248	12/2/2014 9 22	67.72000063	12/2/2014 9 48	71.43999775	12/2/2014 9 15	69.74	12/2/2014 9 00	67.15000246	12/2/2014 9 00	76.51000144	12/2/2014 9 51	70.9799982	12/2/2014 9 23	73.44000205	12/2/2014 9 21	68.48999914	12/2/2014 9 21	72.36000271	12/2/2014 9 30	73.13
12/2/2014 10 24	71.24000246	12/2/2014 10 05	67.66000063	12/2/2014 10 07	71.21999776	12/2/2014 10 02	70.23	12/2/2014 10 25	67.58000248	12/2/2014 10 00	76.51000144	12/2/2014 10 24	71.0999982	12/2/2014 10 55	73.59000206	12/2/2014 10 45	69.80999912	12/2/2014 10 32	73.61000275	12/2/2014 10 39	72.74
12/2/2014 11 34	71.09000245	12/2/2014 11 04	68.24000063	12/2/2014 11 07	71.43999775	12/2/2014 11 31	70.2	12/2/2014 11 39	67.43000247	12/2/2014 11 00	76.51000144	12/2/2014 11 59	71.1899982	12/2/2014 11 46	73.26000205	12/2/2014 11 58	70.01999912	12/2/2014 11 02	73.58000275	12/2/2014 11 58	73.19
12/2/2014 12 53	71.03000245	12/2/2014 12 06	68.15000063	12/2/2014 12 24	70.66999778	12/2/2014 12 24	69.84	12/2/2014 12 45	67.15000246	12/2/2014 12 00	76.51000144	12/2/2014 12 53	71.0399982	12/2/2014 12 47	73.23000205	12/2/2014 12 17	69.74999913	12/2/2014 12 05	73.95000277	12/2/2014 12 00	73.19
12/2/2014 13 55	72.03000248	12/2/2014 13 22	67.99000063	12/2/2014 13 25	71.34999776	12/2/2014 13 37	69.62	12/2/2014 13 25	67.12000246	12/2/2014 13 00	76.51000144	12/2/2014 13 55	71.37999819	12/2/2014 13 37	73.13000205	12/2/2014 13 01	70.29999912	12/2/2014 13 37	73.80000276	12/2/2014 13 38	73.47
12/2/2014 14 42	71.94000248	12/2/2014 14 08	68.54000064	12/2/2014 14 21	70.79999777	12/2/2014 14 21	70.39	12/2/2014 14 02	67.40000247	12/2/2014 14 00	76.51000144	12/2/2014 14 03	71.40999819	12/2/2014 14 46	73.44000205	12/2/2014 14 02	70.38999912	12/2/2014 14 11	73.92000277	12/2/2014 14 10	73.35
12/2/2014 15 17	68.16000235	12/2/2014 15 48	68.05000063	12/2/2014 15 58	72.16999773	12/2/2014 15 27	70.42	12/2/2014 15 27	67.64000248	12/2/2014 15 00	76.51000144	12/2/2014 15 13	71.0399982	12/2/2014 15 10	73.41000205	12/2/2014 15 56	70.32999912	12/2/2014 15 02	74.22000278	12/2/2014 15 18	73.68
12/2/2014 16 58	71.55000247	12/2/2014 16 55	67.69000063	12/2/2014 16 50	71.37999776	12/2/2014 16 49	69.99	12/2/2014 16 33	67.76000248	12/2/2014 16 00	76.51000144	12/2/2014 16 03	71.1599982	12/2/2014 16 02	73.53000206	12/2/2014 16 56	69.46999913	12/2/2014 16 28	73.43000275	12/2/2014 16 59	72.95
12/2/2014 17 00	71.55000247	12/2/2014 17 23	66.25000061	12/2/2014 17 34	71.49999775	12/2/2014 17 33	70.2	12/2/2014 17 59	67.30000247	12/2/2014 17 00	76.51000144	12/2/2014 17 45	71.49999819	12/2/2014 17 17	73.16000205	12/2/2014 17 55	69.03999913	12/2/2014 17 55	72.85000273	12/2/2014 17 31	72.37
12/2/2014 18 57	71.49000246	12/2/2014 18 12	66.44000062	12/2/2014 18 25	70.45999778	12/2/2014 18 56	70.08	12/2/2014 18 52	67.12000246	12/2/2014 18 00	76.51000144	12/2/2014 18 24	71.2499982	12/2/2014 18 57	73.23000205	12/2/2014 18 56	67.93999915	12/2/2014 18 56	72.58000272	12/2/2014 18 27	72.43
12/2/2014 19 23	69.5300024	12/2/2014 19 00	67.23000062	12/2/2014 19 23	70.85999777	12/2/2014 19 00	70.02	12/2/2014 19 23	66.54000244	12/2/2014 19 00	76.51000144	12/2/2014 19 23	71.1599982	12/2/2014 19 23	73.29000205	12/2/2014 19 05	68.12999914	12/2/2014 19 01	72.1800027	12/2/2014 19 21	73.26
12/2/2014 20 44	70.57000243	12/2/2014 20 11	67.26000062	12/2/2014 20 44	71.09999776	12/2/2014 20 07	69.96	12/2/2014 20 07	67.46000247	12/2/2014 20 00	76.51000144	12/2/2014 20 01	71.2499982	12/2/2014 20 29	73.26000205	12/2/2014 20 11	68.48999914	12/2/2014 20 11	72.39000271	12/2/2014 20 44	73.19
12/2/2014 21 28	72.77000251	12/2/2014 21 20	67.60000063	12/2/2014 21 44	71.21999776	12/2/2014 21 23	70.26	12/2/2014 21 24	67.43000247	12/2/2014 21 00	76.51000144	12/2/2014 21 49	70.63999821	12/2/2014 21 50	70.42000197	12/2/2014 21 50	68.91999914	12/2/2014 21 20	73.19000274	12/2/2014 21 27	73.44
12/2/2014 22 09	72.83000251	12/2/2014 22 24	68.45000064	12/2/2014 22 12	71.70999775	12/2/2014 22 01	70.2	12/2/2014 22 05	67.82000249	12/2/2014 22 00	76.51000144	12/2/2014 22 05	71.49999819	12/2/2014 22 09	73.38000205	12/2/2014 22 01	69.58999913	12/2/2014 22 05	73.43000275	12/2/2014 22 27	73.35
12/2/2014 23 33	68.83000238	12/2/2014 23 11	69.40000064	12/2/2014 23 15	72.37999773	12/2/2014 23 37	70.48	12/2/2014 23 33	63.34000232	12/2/2014 23 00	76.51000144	12/2/2014 23 33	67.1599983	12/2/2014 23 33	71.390002	12/2/2014 23 34	70.80999911	12/2/2014 23 00	74.56000279	12/2/2014 23 23	74.42
12/3/2014 0 08	72.4600025	12/3/2014 0 59	70.43000065	12/3/2014 0 59	72.89999771	12/3/2014 0 58	70.75	12/3/2014 0 02	67.88000249	12/3/2014 0 00	76.51000144	12/3/2014 0 58	70.69999821	12/3/2014 0 10	74.08000207	12/3/2014 0 10	71.5799991	12/3/2014 0 10	74.9600028	12/3/2014 0 13	74.84
12/3/2014 1 32	73.23000252	12/3/2014 1 00	70.43000065	12/3/2014 1 00	72.89999771	12/3/2014 1 02	70.02	12/3/2014 1 03	67.73000248	12/3/2014 1 00	76.51000144	12/3/2014 1 02	70.33999822	12/3/2014 1 06	73.53000206	12/3/2014 1 02	71.8499991	12/3/2014 1 46	75.14000281	12/3/2014 1 32	75.24
12/3/2014 2 07	74.63000257	12/3/2014 2 03	71.20000066	12/3/2014 2 09	73.93999768	12/3/2014 2 03	71.15	12/3/2014 2 07	68.95000253	12/3/2014 2 00	76.51000144	12/3/2014 2 03	72.16999818	12/3/2014 2 03	74.60000209	12/3/2014 2 03	72.42999909	12/3/2014 2 03	75.47000282	12/3/2014 2 00	75.64
12/3/2014 3 54	74.08000255	12/3/2014 3 23	71.50000066	12/3/2014 3 02	73.99999768	12/3/2014 3 59	71.3	12/3/2014 3 59	68.2500025	12/3/2014 3 00	76.51000144	12/3/2014 3 59	72.10999818	12/3/2014 3 11	74.75000209	12/3/2014 3 16	72.76999909	12/3/2014 3 35	75.57000283	12/3/2014 3 41	75.57
12/3/2014 4 28	74.14000255	12/3/2014 4 52	70.89000066	12/3/2014 4 32	73.59999769	12/3/2014 4 00	71.3	12/3/2014 4 00	68.2500025	12/3/2014 4 00	76.51000144	12/3/2014 4 50	72.19999818	12/3/2014 4 16	74.81000209	12/3/2014 4 02	72.42999909	12/3/2014 4 12	75.54000283	12/3/2014 4 56	75.48
12/3/2014 5 42	72.28000249	12/3/2014 5 53	68.82000064	12/3/2014 5 18	72.22999773	12/3/2014 5 18	70.17	12/3/2014 5 43	66.27000243	12/3/2014 5 00	76.51000144	12/3/2014 5 18	70.08999823	12/3/2014 5 59	74.32000208	12/3/2014 5 55	70.19999912	12/3/2014 5 52	74.07000277	12/3/2014 5 18	74.2
12/3/2014 6 47	70.91000245	12/3/2014 6 52	66.41000062	12/3/2014 6 35	71.40999776	12/3/2014 6 48	69.23	12/3/2014 6 48	67.37000247	12/3/2014 6 00	76.51000144	12/3/2014 6 47	71.0699982	12/3/2014 6 51	73.44000205	12/3/2014 6 51	66.74999916	12/3/2014 6 52	71.42000267	12/3/2014 6 47	72.83
12/3/2014 7 18	70.72000244	12/3/2014 7 33	65.70000061	12/3/2014 7 09	70.63999778	12/3/2014 7 21	69.65	12/3/2014 7 52	66.75000245	12/3/2014 7 00	76.51000144	12/3/2014 7 52	71.1299982	12/3/2014 7 36	73.29000205	12/3/2014 7 18	66.41999917	12/3/2014 7 08	71.35000267	12/3/2014 7 07	72.16
12/3/2014 8 24	71.03000245	12/3/2014 8 00	67.08000062	12/3/2014 8 40	71.31999776	12/3/2014 8 21	69.81	12/3/2014 8 00	67.00000246	12/3/2014 8 00	76.51000144	12/3/2014 8 21	71.40999819	12/3/2014 8 36	73.19000205	12/3/2014 8 00	68.51999914	12/3/2014 8 13	72.58000272	12/3/2014 8 04	72.89
12/3/2014 9 08	71.67000247	12/3/2014 9 29	67.75000063	12/3/2014 9 19	71.82999774	12/3/2014 9 12	70.02	12/3/2014 9 46	66.91000245	12/3/2014 9 00	76.51000144	12/3/2014 9 42	70.79999821	12/3/2014 9 42	73.04000204	12/3/2014 9 05	69.28999913	12/3/2014 9 06	72.85000273	12/3/2014 9 42	73.35
12/3/2014 10 48	71.79000247	12/3/2014 10 48	67.90000063	12/3/2014 10 33	71.37999776	12/3/2014 10 52	69.74	12/3/2014 10 30	66.94000245	12/3/2014 10 00	76.51000144	12/3/2014 10 52	70.76999821	12/3/2014 10 17	73.10000205	12/3/2014 10 55	69.67999913	12/3/2014 10 44	73.61000275	12/3/2014 10 48	72.74
12/3/2014 11 20	71.39000246	12/3/2014 11 24	67.72000063	12/3/2014 11 53	71.43999775	12/3/2014 11 58	69.81	12/3/2014 11 24	66.57000244	12/3/2014 11 00	76.51000144	12/3/2014 11 58	71.0399982	12/3/2014 11 06	72.71000203	12/3/2014 11 28	69.46999913	12/3/2014 11 06	73.73000276	12/3/2014 11 10	73.5
12/3/2014 12 27	71.52000247	12/3/2014 12 00	68.51000064	12/3/2014 12 02	71.40999776	12/3/2014 12 00	69.81	12/3/2014 12 27	67.58000248	12/3/2014 12 00	76.51000144	12/3/2014 12 23	70.45999822	12/3/2014 12 57	73.23000205	12/3/2014 12 27	70.04999912	12/3/2014 12 02	73.86000276	12/3/2014 12 48	73.5
12/3/2014 13 41	71.67000247	12/3/2014 13 37	56.36000052	12/3/2014 13 45	69.9099978	12/3/2014 13 46	69.32	12/3/2014 13 41	67.24000246	12/3/2014 13 00	76.51000144	12/3/2014 13 41	70.45999822	12/3/2014 13 06	73.19000205	12/3/2014 13 45	68.67999914	12/3/2014 13 37	72.97000273	12/3/2014 13 37	70.94
12/3/2014 14 28	72.5200025	12/3/2014 14 24	69.12000064	12/3/2014 14 24	71.21999776	12/3/2014 14 33	70.48	12/3/2014 14 02	67.61000248	12/3/2014 14 00	76.51000144	12/3/2014 14 11	70.9499982	12/3/2014 14 42	73.38000205	12/3/2014 14 00	70.38999912	12/3/2014 14 01	74.22000278	12/3/2014 14 33	73.35
12/3/2014 15 45	71.52000247	12/3/2014 15 22	67.29000062	12/3/2014 15 50	71.03999777	12/3/2014 15 18	68.8	12/3/2014 15 53	67.24000246	12/3/2014 15 00	76.51000144	12/3/2014 15 45	70.9799982	12/3/2014 15 57	72.86000204	12/3/2014 15 57	69.55999913	12/3/2014 15 26	74.01000277	12/3/2014 15 53	73.8
12/3/2014 16 12	72.37000249	12/3/2014 16 15	64.9700006	12/3/2014 16 57	70.91999777	12/3/2014 16 37	69.68	12/3/2014 16 24	67.98000249	12/3/2014 16 00	76.51000144	12/3/2014 16 14	71.3199982	12/3/2014 16 58	72.62000203	12/3/2014 16 57	69.25999913	12/3/2014 16 23	73.37000275	12/3/2014 16 20	73.1
12/3/2014 17 57	71.52000247	12/3/2014 17 48	65.0300006	12/3/2014 17 36	70.82999777	12/3/2014 17 23	68.8	12/3/2014 17 28	67.27000247	12/3/2014 17 00	76.51000144	12/3/2014 17 57	71.1299982	12/3/2014 17 04	72.25000202	12/3/2014 17 37	68.27999914	12/3/2014 17 44	72.67000272	12/3/2014 17 46	71.85
12/3/2014 18 01	71.76000247	12/3/2014 18 28	66.28000062	12/3/2014 18 23	71.00999777	12/3/2014 18 46	69.9	12/3/2014 18 01	67.88000249	12/3/2014 18 00	76.51000144	12/3/2014 18 05	71.58999819	12/3/2014 18 12	72.92000204	12/3/2014 18 28	68.03999915	12/3/2014 18 06	72.33000271	12/3/2014 18 25	72.4
12/3/2014 19 07	72.31000249	12/3/2014 19 03	67.23000062	12/3/2014 19 18	70.36999779	12/3/2014 19 49	69.81	12/3/2014 19 14	67.55000248	12/3/2014 19 00	76.51000144	12/3/2014 19 02	71.46999819	12/3/2014 19 06	72.86000204	12/3/2014 19 15	68.21999914	12/3/2014 19 19	72.45000271	12/3/2014 19 06	71.94
12/3/2014 20 55	72.4300025	12/3/2014 20 17	67.47000063	12/3/2014 20 18	71.46999775	12/3/2014 20 45	69.81	12/3/2014 20 25	68.43000251	12/3/2014 20 00	76.51000144	12/3/2014 20 18	71.3499982	12/3/2014 20 03	72.98000204	12/3/2014 20 02	68.51999914	12/3/2014 20 02	72.88000273	12/3/2014 20 17	73.13
12/3/2014 21 00	72.80000251	12/3/2014 21 09	68.15000063	12/3/2014 21 07	71.24999776	12/3/2014 21 12	70.17	12/3/2014 21 00	67.98000249	12/3/2014 21 00	76.51000144	12/3/2014 21 12	71.95999818	12/3/2014 21 12	73.10000205	12/3/2014 21 12	69.00999913	12/3/2014 21 12	73.00000273	12/3/2014 21 09	73.32
12/3/2014 22 21	73.47000253	12/3/2014 22 07	68.24000063	12/3/2014 22 32	72.22999773	12/3/2014 22 20	70.69	12/3/2014 22 31	68.77000252	12/3/2014 22 00	76.51000144	12/3/2014 22 16	72.37999817	12/3/2014 22 32	73.53000206	12/3/2014 22 03	69.86999912	12/3/2014 22 01	73.58000275	12/3/2014 22 00	74.48
12/3/2014 23 17	73.90000254	12/3/2014 23 06	70.40000065	12/3/2014 23 26	71.67999775	12/3/2014 23 18	70.81	12/3/2014 23 22	68.95000253	12/3/2014 23 00	76.51000144	12/3/2014 23 43	72.28999817	12/3/2014 23 26	73.90000207	12/3/2014 23 26	71.14999911	12/3/2014 23 00	74.44000279	12/3/2014 23 05	74.96
12/4/2014 0 07	67.21000232	12/4/2014 0 02	71.35000066	12/4/2014 0 56	72.53999772	12/4/2014 0 07	66.75	12/4/2014 0 07	63.00000231	12/4/2014 0 00	76.51000144	12/4/2014 0 07	67.52999829	12/4/2014 0 07	73.01000204	12/4/2014 0 07	70.10999912	12/4/2014 0 31	74.68000279	12/4/2014 0 07	73.71
12/4/2014 1 04	73.04000252	12/4/2014 1 34	71.47000066	12/4/2014 1 37	73.38999769	12/4/2014 1 34	70.48	12/4/2014 1 00	67.95000249	12/4/2014 1 00	76.51000144	12/4/2014 1 34	71.1599982	12/4/2014 1 34	73.44000205	12/4/2014 1 00	71.7899991	12/4/2014 1 08	75.17000281	12/4/2014 1 48	75.39
12/4/2014 2 23	74.66000257	12/4/2014 2 13	71.53000067	12/4/2014 2 44	73.38999769	12/4/2014 2 43	71.64	12/4/2014 2 02	69.29000254	12/4/2014 2 00	76.51000144	12/4/2014 2 22	72.28999817	12/4/2014 2 53	74.63000209	12/4/2014 2 05	72.64999909	12/4/2014 2 14	74.8600028	12/4/2014 2 14	75.27
12/4/2014 3 52	74.11000255	12/4/2014 3 01	71.56000067	12/4/2014 3 44	73.1199977	12/4/2014 3 26	71	12/4/2014 3 43	68.74000252	12/4/2014 3 00	76.51000144	12/4/2014 3 44	72.25999817	12/4/2014 3 10	74.72000209	12/4/2014 3 44	72.1899991	12/4/2014 3 11	75.60000283	12/4/2014 3 52	75.61
12/4/2014 4 48	73.26000252	12/4/2014 4 56	71.05000066	12/4/2014 4 59	73.53999769	12/4/2014 4 47	71.06	12/4/2014 4 55	67.73000248	12/4/2014 4 00	76.51000144	12/4/2014 4 56	70.9499982	12/4/2014 4 56	73.93000207	12/4/2014 4 56	71.8799991	12/4/2014 4 56	74.99000281	12/4/2014 4 57	75.18
12/4/2014 5 53	71.09000245	12/4/2014 5 46	68.11000063	12/4/2014 5 50	72.80999771	12/4/2014 5 49	69.41	12/4/2014 5 45	65.5300024	12/4/2014 5 00	76.51000144	12/4/2014 5 48	68.89999825	12/4/2014 5 49	73.44000205	12/4/2014 5 49	70.16999912	12/4/2014 5 44	74.44000279	12/4/2014 5 44	74.02
12/4/2014 6 41	71.21000246	12/4/2014 6 41	66.19000061	12/4/2014 6 42	71.18999776	12/4/2014 6 16	69.47	12/4/2014 6 37	67.37000247	12/4/2014 6 00	76.51000144	12/4/2014 6 37	71.49999819	12/4/2014 6 33	72.68000203	12/4/2014 6 42	66.84999916	12/4/2014 6 42	71.29000267	12/4/2014 6 42	72.52
12/4/2014 7 18	70.05000242	12/4/2014 7 48	65.28000061	12/4/2014 7 18	70.97999777	12/4/2014 7 57	69.44	12/4/2014 7 39	66.88000245	12/4/2014 7 00	76.51000144	12/4/2014 7 39	71.0099982	12/4/2014 7 39	72.65000203	12/4/2014 7 08	66.01999917	12/4/2014 7 08	70.62000264	12/4/2014 7 15	71.85
12/4/2014 8 07	72.00000248	12/4/2014 8 43	66.13000061	12/4/2014 8 50	70.91999777	12/4/2014 8 43	69.32	12/4/2014 8 50	66.27000243	12/4/2014 8 00	76.51000144	12/4/2014 8 50	71.1599982	12/4/2014 8 18	72.86000204	12/4/2014 8 01	68.39999914	12/4/2014 8 06	72.36000271	12/4/2014 8 27	72.95
12/4/2014 9 46	71.61000247	12/4/2014 9 22	67.53000063	12/4/2014 9 10	72.04999774	12/4/2014 9 25	69.96	12/4/2014 9 46	67.09000246	12/4/2014 9 00	76.51000144	12/4/2014 9 18	71.43999819	12/4/2014 9 46	73.29000205	12/4/2014 9 58	69.00999913	12/4/2014 9 08	73.19000274	12/4/2014 9 22	73.44
12/4/2014 10 48	71.03000245	12/4/2014 10 26	67.99000063	12/4/2014 10 14	71.98999774	12/4/2014 10 43	70.02	12/4/2014 10 43	67.00000246	12/4/2014 10 00	76.51000144	12/4/2014 10 52	71.1899982	12/4/2014 10 25	73.41000205	12/4/2014 10 29	69.55999913	12/4/2014 10 25	73.49000275	12/4/2014 10 07	73.41
12/4/2014 11 21	70.78000244	12/4/2014 11 04	67.23000062	12/4/2014 11 03	71.31999776	12/4/2014 11 24	69.84	12/4/2014 11 25	66.36000243	12/4/2014 11 00	76.51000144	12/4/2014 11 29	70.85999821	12/4/2014 11 49	72.80000204	12/4/2014 11 54	69.34999913	12/4/2014 11 33	73.52000275	12/4/2014 11 59	72.92
12/4/2014 12 00	71.82000248	12/4/2014 12 16	68.36000063	12/4/2014 12 19	72.07999773	12/4/2014 12 37	70.08	12/4/2014 12 00	67.49000247	12/4/2014 12 00	76.51000144	12/4/2014 12 13	71.49999819	12/4/2014 12 41	72.80000204	12/4/2014 12 13	69.52999913	12/4/2014 12 34	73.49000275	12/4/2014 12 16	72.71
12/4/2014 13 01	71.70000247	12/4/2014 13 35	68.02000063	12/4/2014 13 52	70.94999777	12/4/2014 13 45	67.42	12/4/2014 13 46	67.33000247	12/4/2014 13 00	76.51000144	12/4/2014 13 45	69.87999823	12/4/2014 13 45	69.87000195	12/4/2014 13 45	68.42999914	12/4/2014 13 24	73.83000276	12/4/2014 13 40	73.71
12/4/2014 14 36	71.79000247	12/4/2014 14 25	68.15000063	12/4/2014 14 22	72.22999773	12/4/2014 14 57	69.96	12/4/2014 14 00	67.73000248	12/4/2014 14 00	76.51000144	12/4/2014 14 56	71.2199982	12/4/2014 14 16	72.95000204	12/4/2014 14 05	69.64999913	12/4/2014 14 26	73.98000277	12/4/2014 14 04	73.29
12/4/2014 15 03	71.67000247	12/4/2014 15 59	67.87000063	12/4/2014 15 57	71.37999776	12/4/2014 15 59	70.78	12/4/2014 15 04	67.49000247	12/4/2014 15 00	76.51000144	12/4/2014 15 11	71.2799982	12/4/2014 15 58	72.92000204	12/4/2014 15 03	69.67999913	12/4/2014 15 04	73.61000275	12/4/2014 15 03	73.65
12/4/2014 16 55	71.27000246	12/4/2014 16 00	67.87000063	12/4/2014 16 30	70.97999777	12/4/2014 16 46	70.02	12/4/2014 16 43	67.49000247	12/4/2014 16 00	76.51000144	12/4/2014 16 05	71.52999819	12/4/2014 16 00	72.92000204	12/4/2014 16 44	69.43999913	12/4/2014 16 06	73.43000275	12/4/2014 16 12	73.62
12/4/2014 17 26	72.5200025	12/4/2014 17 38	67.23000062	12/4/2014 17 30	70.63999778	12/4/2014 17 05	70.26	12/4/2014 17 36	68.37000251	12/4/2014 17 00	76.51000144	12/4/2014 17 56	71.76999819	12/4/2014 17 23	73.04000204	12/4/2014 17 44	68.45999914	12/4/2014 17 37	72.94000273	12/4/2014 17 25	73.32
12/4/2014 18 27	70.87000244	12/4/2014 18 31	66.22000061	12/4/2014 18 12	69.72999781	12/4/2014 18 39	69.26	12/4/2014 18 39	67.49000247	12/4/2014 18 00	76.51000144	12/4/2014 18 27	71.1899982	12/4/2014 18 27	72.10000202	12/4/2014 18 43	67.97999915	12/4/2014 18 23	72.1500027	12/4/2014 18 48	72.68
12/4/2014 19 15	71.18000245	12/4/2014 19 00	67.38000063	12/4/2014 19 33	71.21999776	12/4/2014 19 53	70.02	12/4/2014 19 27	68.2500025	12/4/2014 19 00	76.51000144	12/4/2014 19 15	71.79999818	12/4/2014 19 04	73.13000205	12/4/2014 19 23	68.45999914	12/4/2014 19 13	72.61000272	12/4/2014 19 16	73.26
12/4/2014 20 22	72.4300025	12/4/2014 20 05	67.75000063	12/4/2014 20 50	71.52999775	12/4/2014 20 01	70.26	12/4/2014 20 18	67.82000249	12/4/2014 20 00	76.51000144	12/4/2014 20 15	71.92999818	12/4/2014 20 18	72.83000204	12/4/2014 20 01	68.91999914	12/4/2014 20 23	72.48000271	12/4/2014 20 01	73.59
12/4/2014 21 51	72.6800025	12/4/2014 21 34	67.47000063	12/4/2014 21 23	71.28999776	12/4/2014 21 07	69.96	12/4/2014 21 00	67.91000249	12/4/2014 21 00	76.51000144	12/4/2014 21 02	71.37999819	12/4/2014 21 31	73.32000205	12/4/2014 21 07	69.00999913	12/4/2014 21 00	73.34000274	12/4/2014 21 52	73.35

12/4/2014 23 47	69.07000238	12/4/2014 23 45	69.89000065	12/4/2014 23 48	70.91999777	12/4/2014 23 48	67.82	12/4/2014 23 48	64.83000238	12/4/2014 23 00	76.51000144	12/4/2014 23 47	67.21999829	12/4/2014 23 48	72.46000203	12/4/2014 23 48	69.89999912	12/4/2014 23 48	73.34000274	12/4/2014 23 48	73.77
12/5/2014 0 52	72.92000251	12/5/2014 0 00	70.50000066	12/5/2014 0 16	72.65999772	12/5/2014 0 13	70.87	12/5/2014 0 01	67.64000248	12/5/2014 0 00	76.51000144	12/5/2014 0 16	70.30999822	12/5/2014 0 21	73.87000207	12/5/2014 0 13	71.8499991	12/5/2014 0 21	75.14000281	12/5/2014 0 00	74.29
12/5/2014 1 39	73.47000253	12/5/2014 1 07	71.05000066	12/5/2014 1 34	72.80999771	12/5/2014 1 16	71.61	12/5/2014 1 01	68.49000251	12/5/2014 1 00	76.51000144	12/5/2014 1 44	71.85999818	12/5/2014 1 05	74.20000208	12/5/2014 1 44	71.5799991	12/5/2014 1 45	74.68000279	12/5/2014 1 44	75.06
12/5/2014 2 39	74.08000255	12/5/2014 2 41	70.83000066	12/5/2014 2 21	73.1799977	12/5/2014 2 37	70.97	12/5/2014 2 37	68.92000253	12/5/2014 2 00	76.51000144	12/5/2014 2 36	71.89999818	12/5/2014 2 41	73.16000205	12/5/2014 2 41	71.8199991	12/5/2014 2 15	75.23000281	12/5/2014 2 42	75.61
12/5/2014 3 08	74.45000256	12/5/2014 3 17	71.35000066	12/5/2014 3 03	73.75999768	12/5/2014 3 08	71.42	12/5/2014 3 45	69.11000253	12/5/2014 3 00	76.51000144	12/5/2014 3 13	72.50999817	12/5/2014 3 02	74.51000209	12/5/2014 3 46	72.54999909	12/5/2014 3 08	75.47000282	12/5/2014 3 01	75.67
12/5/2014 4 23	73.84000254	12/5/2014 4 28	70.86000066	12/5/2014 4 23	72.71999771	12/5/2014 4 28	71	12/5/2014 4 23	68.2500025	12/5/2014 4 00	76.51000144	12/5/2014 4 23	71.73999819	12/5/2014 4 52	74.39000208	12/5/2014 4 23	71.8499991	12/5/2014 4 29	75.11000281	12/5/2014 4 01	75.24
12/5/2014 5 46	71.21000246	12/5/2014 5 49	69.15000064	12/5/2014 5 43	72.74999771	12/5/2014 5 58	69.38	12/5/2014 5 58	65.81000241	12/5/2014 5 00	76.51000144	12/5/2014 5 47	69.57999824	12/5/2014 5 47	73.38000205	12/5/2014 5 48	70.04999912	12/5/2014 5 48	73.19000274	12/5/2014 5 35	73.93
12/5/2014 6 00	71.45000246	12/5/2014 6 57	66.47000062	12/5/2014 6 49	71.24999776	12/5/2014 6 00	69.38	12/5/2014 6 00	65.81000241	12/5/2014 6 00	76.51000144	12/5/2014 6 32	71.3199982	12/5/2014 6 32	72.77000204	12/5/2014 6 52	66.96999916	12/5/2014 6 47	71.63000268	12/5/2014 6 47	72.71
12/5/2014 7 40	70.63000244	12/5/2014 7 16	66.19000061	12/5/2014 7 36	69.8799978	12/5/2014 7 44	69.38	12/5/2014 7 36	66.33000243	12/5/2014 7 00	76.51000144	12/5/2014 7 47	70.91999821	12/5/2014 7 21	72.80000204	12/5/2014 7 39	65.98999917	12/5/2014 7 32	70.96000266	12/5/2014 7 10	72.4
12/5/2014 8 42	70.87000244	12/5/2014 8 03	66.59000062	12/5/2014 8 24	71.89999774	12/5/2014 8 58	69.35	12/5/2014 8 12	66.72000245	12/5/2014 8 00	76.51000144	12/5/2014 8 16	71.2799982	12/5/2014 8 00	73.23000205	12/5/2014 8 04	67.45999915	12/5/2014 8 00	72.0900027	12/5/2014 8 12	72.68
12/5/2014 9 40	70.87000244	12/5/2014 9 44	67.20000062	12/5/2014 9 03	71.79999774	12/5/2014 9 00	69.35	12/5/2014 9 41	67.43000247	12/5/2014 9 00	76.51000144	12/5/2014 9 49	71.3499982	12/5/2014 9 30	73.10000205	12/5/2014 9 35	68.94999913	12/5/2014 9 35	72.82000273	12/5/2014 9 49	73.19
12/5/2014 10 10	69.5600024	12/5/2014 10 49	67.84000063	12/5/2014 10 39	71.52999775	12/5/2014 10 51	68.89	12/5/2014 10 10	66.85000245	12/5/2014 10 00	76.51000144	12/5/2014 10 10	70.91999821	12/5/2014 10 52	73.19000205	12/5/2014 10 10	68.91999914	12/5/2014 10 49	73.09000274	12/5/2014 10 03	73.26
12/5/2014 11 17	70.94000245	12/5/2014 11 40	67.53000063	12/5/2014 11 22	71.79999774	12/5/2014 11 51	69.96	12/5/2014 11 21	67.40000247	12/5/2014 11 00	76.51000144	12/5/2014 11 59	70.88999821	12/5/2014 11 01	73.07000204	12/5/2014 11 21	69.28999913	12/5/2014 11 22	73.19000274	12/5/2014 11 54	73.56
12/5/2014 12 46	71.45000246	12/5/2014 12 00	68.48000064	12/5/2014 12 43	71.06999777	12/5/2014 12 43	70.23	12/5/2014 12 55	66.94000245	12/5/2014 12 00	76.51000144	12/5/2014 12 54	70.88999821	12/5/2014 12 03	72.95000204	12/5/2014 12 24	69.92999912	12/5/2014 12 36	73.73000276	12/5/2014 12 24	73.26
12/5/2014 13 36	72.4300025	12/5/2014 13 04	67.81000063	12/5/2014 13 07	68.01999786	12/5/2014 13 21	69.56	12/5/2014 13 55	67.24000246	12/5/2014 13 00	76.51000144	12/5/2014 13 32	71.0999982	12/5/2014 13 55	73.29000205	12/5/2014 13 01	69.80999912	12/5/2014 13 02	73.37000275	12/5/2014 13 28	73.59
12/5/2014 14 03	71.55000247	12/5/2014 14 05	68.27000063	12/5/2014 14 06	70.70999778	12/5/2014 14 15	70.6	12/5/2014 14 22	67.70000248	12/5/2014 14 00	76.51000144	12/5/2014 14 02	71.37999819	12/5/2014 14 06	73.29000205	12/5/2014 14 02	69.86999912	12/5/2014 14 26	73.80000276	12/5/2014 14 10	73.93
12/5/2014 15 53	71.00000245	12/5/2014 15 36	68.30000063	12/5/2014 15 53	70.79999777	12/5/2014 15 04	70.45	12/5/2014 15 54	66.48000244	12/5/2014 15 00	76.51000144	12/5/2014 15 50	71.0099982	12/5/2014 15 53	73.26000205	12/5/2014 15 49	69.80999912	12/5/2014 15 58	73.58000275	12/5/2014 15 31	73.5
12/5/2014 16 20	72.10000248	12/5/2014 16 39	67.53000063	12/5/2014 16 42	71.46999775	12/5/2014 16 16	69.96	12/5/2014 16 57	67.85000249	12/5/2014 16 00	76.51000144	12/5/2014 16 16	71.52999819	12/5/2014 16 51	73.32000205	12/5/2014 16 45	68.82999914	12/5/2014 16 52	73.19000274	12/5/2014 16 46	72.98
12/5/2014 17 14	70.75000244	12/5/2014 17 11	67.41000063	12/5/2014 17 49	71.67999775	12/5/2014 17 49	70.29	12/5/2014 17 30	67.85000249	12/5/2014 17 00	76.51000144	12/5/2014 17 53	71.40999819	12/5/2014 17 49	73.41000205	12/5/2014 17 47	68.94999913	12/5/2014 17 54	72.73000272	12/5/2014 17 31	73.13
12/5/2014 18 56	71.00000245	12/5/2014 18 12	67.87000063	12/5/2014 18 32	71.46999775	12/5/2014 18 37	70.26	12/5/2014 18 32	67.64000248	12/5/2014 18 00	76.51000144	12/5/2014 18 29	71.58999819	12/5/2014 18 56	73.87000207	12/5/2014 18 20	69.16999913	12/5/2014 18 09	72.70000272	12/5/2014 18 36	73.32
12/5/2014 19 00	71.73000247	12/5/2014 19 06	67.26000062	12/5/2014 19 05	71.86999774	12/5/2014 19 08	70.36	12/5/2014 19 22	67.79000248	12/5/2014 19 00	76.51000144	12/5/2014 19 00	71.2199982	12/5/2014 19 57	73.68000206	12/5/2014 19 01	69.49999913	12/5/2014 19 48	73.37000275	12/5/2014 19 45	73.53
12/5/2014 20 48	71.03000245	12/5/2014 20 49	68.48000064	12/5/2014 20 13	72.04999774	12/5/2014 20 04	70.08	12/5/2014 20 04	67.73000248	12/5/2014 20 00	76.51000144	12/5/2014 20 48	71.37999819	12/5/2014 20 14	73.68000206	12/5/2014 20 38	69.49999913	12/5/2014 20 37	73.43000275	12/5/2014 20 09	73.5
12/5/2014 21 23	72.34000249	12/5/2014 21 02	68.63000064	12/5/2014 21 48	72.16999773	12/5/2014 21 23	70.39	12/5/2014 21 49	68.1600025	12/5/2014 21 00	76.51000144	12/5/2014 21 39	71.46999819	12/5/2014 21 23	73.68000206	12/5/2014 21 48	69.46999913	12/5/2014 21 19	73.37000275	12/5/2014 21 24	74.29
12/5/2014 22 18	72.89000251	12/5/2014 22 02	69.31000064	12/5/2014 22 13	72.19999773	12/5/2014 22 21	70.54	12/5/2014 22 56	67.43000247	12/5/2014 22 00	76.51000144	12/5/2014 22 17	71.40999819	12/5/2014 22 10	73.77000206	12/5/2014 22 17	69.64999913	12/5/2014 22 17	73.77000276	12/5/2014 22 28	74.2
12/5/2014 23 06	74.11000255	12/5/2014 23 21	70.13000065	12/5/2014 23 05	72.44999772	12/5/2014 23 02	69.01	12/5/2014 23 02	67.27000247	12/5/2014 23 00	76.51000144	12/5/2014 23 02	71.0399982	12/5/2014 23 02	73.29000205	12/5/2014 23 02	70.22999912	12/5/2014 23 01	74.13000277	12/5/2014 23 02	74.54
12/6/2014 0 16	71.30000246	12/6/2014 0 15	69.89000065	12/6/2014 0 20	72.86999771	12/6/2014 0 15	66.2	12/6/2014 0 15	63.92000234	12/6/2014 0 00	76.51000144	12/6/2014 0 15	67.79999828	12/6/2014 0 15	71.30000199	12/6/2014 0 15	70.44999912	12/6/2014 0 08	74.8300028	12/6/2014 0 15	74.48
12/6/2014 1 24	73.32000253	12/6/2014 1 25	70.25000065	12/6/2014 1 11	73.38999769	12/6/2014 1 21	70.57	12/6/2014 1 03	68.37000251	12/6/2014 1 00	76.51000144	12/6/2014 1 21	71.3499982	12/6/2014 1 00	74.8700021	12/6/2014 1 24	71.9099991	12/6/2014 1 21	74.99000281	12/6/2014 1 32	75.42
12/6/2014 2 26	74.69000257	12/6/2014 2 24	71.29000066	12/6/2014 2 23	73.44999769	12/6/2014 2 17	71.97	12/6/2014 2 09	69.35000254	12/6/2014 2 00	76.51000144	12/6/2014 2 09	72.89999816	12/6/2014 2 08	74.78000209	12/6/2014 2 18	72.51999909	12/6/2014 2 08	75.44000282	12/6/2014 2 10	75.57
12/6/2014 3 16	73.74000254	12/6/2014 3 24	70.62000066	12/6/2014 3 14	73.35999769	12/6/2014 3 15	70.63	12/6/2014 3 55	69.17000254	12/6/2014 3 00	76.51000144	12/6/2014 3 15	71.82999818	12/6/2014 3 15	74.32000208	12/6/2014 3 16	72.1599991	12/6/2014 3 50	75.29000282	12/6/2014 3 12	75.48
12/6/2014 4 00	75.12000259	12/6/2014 4 28	71.29000066	12/6/2014 4 00	73.96999768	12/6/2014 4 13	71.64	12/6/2014 4 51	69.62000255	12/6/2014 4 00	76.51000144	12/6/2014 4 00	72.74999816	12/6/2014 4 00	74.9300021	12/6/2014 4 14	72.61999909	12/6/2014 4 01	75.63000283	12/6/2014 4 16	75.7
12/6/2014 5 08	74.26000256	12/6/2014 5 47	70.74000066	12/6/2014 5 35	73.69999768	12/6/2014 5 40	70.6	12/6/2014 5 08	68.98000253	12/6/2014 5 00	76.51000144	12/6/2014 5 36	71.89999818	12/6/2014 5 33	74.81000209	12/6/2014 5 41	71.5799991	12/6/2014 5 32	75.17000281	12/6/2014 5 40	75.09
12/6/2014 6 37	72.83000251	12/6/2014 6 51	69.55000065	12/6/2014 6 41	72.53999772	12/6/2014 6 41	70.81	12/6/2014 6 46	67.46000247	12/6/2014 6 00	76.51000144	12/6/2014 6 45	71.0999982	12/6/2014 6 31	74.26000208	12/6/2014 6 41	71.5499991	12/6/2014 6 46	74.44000279	12/6/2014 6 45	74.96
12/6/2014 7 09	72.00000248	12/6/2014 7 51	68.30000063	12/6/2014 7 59	72.65999772	12/6/2014 7 08	70.45	12/6/2014 7 09	66.57000244	12/6/2014 7 00	76.51000144	12/6/2014 7 10	70.02999823	12/6/2014 7 59	73.47000206	12/6/2014 7 59	69.13999913	12/6/2014 7 52	72.82000273	12/6/2014 7 52	73.56
12/6/2014 8 43	71.61000247	12/6/2014 8 17	66.99000062	12/6/2014 8 42	71.40999776	12/6/2014 8 03	69.81	12/6/2014 8 51	66.79000245	12/6/2014 8 00	76.51000144	12/6/2014 8 59	71.40999819	12/6/2014 8 16	73.26000205	12/6/2014 8 56	66.81999916	12/6/2014 8 56	71.51000268	12/6/2014 8 26	72.89
12/6/2014 9 31	71.00000245	12/6/2014 9 13	65.73000061	12/6/2014 9 36	70.51999778	12/6/2014 9 28	69.35	12/6/2014 9 31	66.79000245	12/6/2014 9 00	76.51000144	12/6/2014 9 31	71.40999819	12/6/2014 9 56	72.80000204	12/6/2014 9 31	66.29999917	12/6/2014 9 32	70.80000265	12/6/2014 9 24	72.37
12/6/2014 10 23	71.27000246	12/6/2014 10 51	65.28000061	12/6/2014 10 45	69.9399978	12/6/2014 10 50	69.78	12/6/2014 10 00	67.40000247	12/6/2014 10 00	76.51000144	12/6/2014 10 28	71.49999819	12/6/2014 10 08	72.65000203	12/6/2014 10 23	65.83999917	12/6/2014 10 02	70.74000265	12/6/2014 10 38	72.25
12/6/2014 11 31	70.54000243	12/6/2014 11 01	65.1800006	12/6/2014 11 06	69.9399978	12/6/2014 11 10	68.95	12/6/2014 11 00	66.97000245	12/6/2014 11 00	76.51000144	12/6/2014 11 00	71.0699982	12/6/2014 11 36	72.52000203	12/6/2014 11 20	66.53999916	12/6/2014 11 21	71.05000266	12/6/2014 11 53	72.37
12/6/2014 12 52	68.22000236	12/6/2014 12 25	65.92000061	12/6/2014 12 15	70.60999778	12/6/2014 12 06	69.87	12/6/2014 12 02	67.52000247	12/6/2014 12 00	76.51000144	12/6/2014 12 12	71.52999819	12/6/2014 12 29	72.68000203	12/6/2014 12 06	66.81999916	12/6/2014 12 10	71.51000268	12/6/2014 12 28	72.61
12/6/2014 13 06	71.45000246	12/6/2014 13 06	66.89000062	12/6/2014 13 24	70.82999777	12/6/2014 13 47	69.65	12/6/2014 13 40	67.21000246	12/6/2014 13 00	76.51000144	12/6/2014 13 39	69.41999824	12/6/2014 13 34	72.92000204	12/6/2014 13 01	67.78999915	12/6/2014 13 10	72.27000271	12/6/2014 13 17	72.43
12/6/2014 14 00	72.34000249	12/6/2014 14 24	67.81000063	12/6/2014 14 30	71.18999776	12/6/2014 14 58	69.16	12/6/2014 14 41	67.70000248	12/6/2014 14 00	76.51000144	12/6/2014 14 10	71.49999819	12/6/2014 14 55	73.44000205	12/6/2014 14 03	68.33999914	12/6/2014 14 17	72.48000271	12/6/2014 14 50	73.04
12/6/2014 15 48	71.70000247	12/6/2014 15 44	67.44000063	12/6/2014 15 38	70.82999777	12/6/2014 15 00	69.16	12/6/2014 15 52	67.82000249	12/6/2014 15 00	76.51000144	12/6/2014 15 47	71.61999819	12/6/2014 15 08	73.93000207	12/6/2014 15 03	68.36999914	12/6/2014 15 15	72.51000271	12/6/2014 15 44	73.22
12/6/2014 16 50	71.70000247	12/6/2014 16 59	67.44000063	12/6/2014 16 10	70.73999778	12/6/2014 16 13	70.32	12/6/2014 16 56	67.64000248	12/6/2014 16 00	76.51000144	12/6/2014 16 55	71.49999819	12/6/2014 16 40	73.32000205	12/6/2014 16 21	68.36999914	12/6/2014 16 20	72.64000272	12/6/2014 16 23	72.8
12/6/2014 17 13	72.07000248	12/6/2014 17 16	67.02000062	12/6/2014 17 39	72.04999774	12/6/2014 17 00	70.32	12/6/2014 17 02	67.98000249	12/6/2014 17 00	76.51000144	12/6/2014 17 37	72.01999818	12/6/2014 17 02	73.62000206	12/6/2014 17 13	68.21999914	12/6/2014 17 07	72.85000273	12/6/2014 17 08	72.95
12/6/2014 18 17	72.37000249	12/6/2014 18 00	67.90000063	12/6/2014 18 43	71.55999775	12/6/2014 18 24	70.42	12/6/2014 18 21	67.40000247	12/6/2014 18 00	76.51000144	12/6/2014 18 21	71.3499982	12/6/2014 18 24	73.65000206	12/6/2014 18 10	68.82999914	12/6/2014 18 11	73.03000273	12/6/2014 18 28	73.16
12/6/2014 19 04	73.01000252	12/6/2014 19 11	68.69000064	12/6/2014 19 08	71.92999774	12/6/2014 19 12	70.69	12/6/2014 19 31	68.2800025	12/6/2014 19 00	76.51000144	12/6/2014 19 00	72.16999818	12/6/2014 19 20	73.59000206	12/6/2014 19 27	69.25999913	12/6/2014 19 16	73.55000275	12/6/2014 19 02	73.8
12/6/2014 20 02	73.35000253	12/6/2014 20 55	68.63000064	12/6/2014 20 12	72.40999772	12/6/2014 20 30	71.18	12/6/2014 20 07	68.1600025	12/6/2014 20 00	76.51000144	12/6/2014 20 30	72.28999817	12/6/2014 20 22	73.93000207	12/6/2014 20 19	70.32999912	12/6/2014 20 19	73.80000276	12/6/2014 20 00	74.08
12/6/2014 21 04	73.68000254	12/6/2014 21 38	69.00000064	12/6/2014 21 22	71.21999776	12/6/2014 21 26	70.48	12/6/2014 21 29	68.1300025	12/6/2014 21 00	76.51000144	12/6/2014 21 25	71.1599982	12/6/2014 21 25	71.580002	12/6/2014 21 26	69.46999913	12/6/2014 21 22	73.77000276	12/6/2014 21 17	74.11
12/6/2014 22 02	73.44000253	12/6/2014 22 06	69.70000065	12/6/2014 22 01	72.68999772	12/6/2014 22 34	71.12	12/6/2014 22 00	68.83000252	12/6/2014 22 00	76.51000144	12/6/2014 22 08	72.31999817	12/6/2014 22 31	74.42000208	12/6/2014 22 01	70.32999912	12/6/2014 22 53	74.16000278	12/6/2014 22 54	74.54
12/6/2014 23 23	74.14000255	12/6/2014 23 21	70.25000065	12/6/2014 23 41	72.50999772	12/6/2014 23 26	71.36	12/6/2014 23 23	69.14000253	12/6/2014 23 00	76.51000144	12/6/2014 23 02	72.77999816	12/6/2014 23 08	74.35000208	12/6/2014 23 57	70.87999911	12/6/2014 23 57	74.07000277	12/6/2014 23 56	74.78
12/7/2014 0 48	71.82000248	12/7/2014 0 49	70.07000065	12/7/2014 0 48	70.54999778	12/7/2014 0 47	68.25	12/7/2014 0 48	64.92000238	12/7/2014 0 00	76.51000144	12/7/2014 0 48	68.31999827	12/7/2014 0 48	71.88000201	12/7/2014 0 48	69.31999913	12/7/2014 0 49	73.31000274	12/7/2014 0 47	74.84
12/7/2014 1 00	73.74000254	12/7/2014 1 45	70.68000066	12/7/2014 1 46	73.81999768	12/7/2014 1 39	71.45	12/7/2014 1 00	68.1600025	12/7/2014 1 00	76.51000144	12/7/2014 1 05	72.01999818	12/7/2014 1 51	74.81000209	12/7/2014 1 06	72.42999909	12/7/2014 1 00	75.44000282	12/7/2014 1 00	75.45
12/7/2014 2 00	74.26000256	12/7/2014 2 29	71.41000066	12/7/2014 2 00	73.99999768	12/7/2014 2 19	71.76	12/7/2014 2 00	68.86000252	12/7/2014 2 00	76.51000144	12/7/2014 2 04	72.77999816	12/7/2014 2 04	75.0300021	12/7/2014 2 19	72.54999909	12/7/2014 2 20	75.29000282	12/7/2014 2 20	75.42
12/7/2014 3 30	75.36000259	12/7/2014 3 00	71.63000067	12/7/2014 3 13	73.41999769	12/7/2014 3 02	72.28	12/7/2014 3 13	69.75000256	12/7/2014 3 00	76.51000144	12/7/2014 3 43	73.20999815	12/7/2014 3 22	75.0900021	12/7/2014 3 56	72.76999909	12/7/2014 3 04	75.69000283	12/7/2014 3 02	75.73
12/7/2014 4 51	74.81000258	12/7/2014 4 47	71.81000067	12/7/2014 4 23	73.75999768	12/7/2014 4 19	72.46	12/7/2014 4 59	69.69000255	12/7/2014 4 00	76.51000144	12/7/2014 4 51	73.29999815	12/7/2014 4 47	75.0300021	12/7/2014 4 53	73.09999909	12/7/2014 4 02	75.78000284	12/7/2014 4 33	76.03
12/7/2014 5 44	74.57000257	12/7/2014 5 53	71.05000066	12/7/2014 5 52	73.53999769	12/7/2014 5 52	71.33	12/7/2014 5 53	69.26000254	12/7/2014 5 00	76.51000144	12/7/2014 5 52	72.80999816	12/7/2014 5 34	75.0900021	12/7/2014 5 45	72.64999909	12/7/2014 5 34	75.35000282	12/7/2014 5 52	75.48
12/7/2014 6 57	73.47000253	12/7/2014 6 33	70.37000065	12/7/2014 6 47	73.35999769	12/7/2014 6 48	71.21	12/7/2014 6 57	67.49000247	12/7/2014 6 00	76.51000144	12/7/2014 6 57	71.3499982	12/7/2014 6 53	74.63000209	12/7/2014 6 57	71.9999991	12/7/2014 6 43	75.02000281	12/7/2014 6 20	75.21
12/7/2014 7 32	71.64000247	12/7/2014 7 53	68.88000064	12/7/2014 7 42	72.53999772	12/7/2014 7 31	69.96	12/7/2014 7 33	66.88000245	12/7/2014 7 00	76.51000144	12/7/2014 7 32	70.45999822	12/7/2014 7 42	74.39000208	12/7/2014 7 37	69.92999912	12/7/2014 7 19	74.10000277	12/7/2014 7 38	74.05
12/7/2014 8 55	71.88000248	12/7/2014 8 59	66.92000062	12/7/2014 8 28	71.28999776	12/7/2014 8 50	69.96	12/7/2014 8 54	67.43000247	12/7/2014 8 00	76.51000144	12/7/2014 8 37	71.55999819	12/7/2014 8 37	73.29000205	12/7/2014 8 54	67.93999915	12/7/2014 8 59	72.33000271	12/7/2014 8 54	73.47
12/7/2014 9 53	71.67000247	12/7/2014 9 21	65.61000061	12/7/2014 9 55	71.06999777	12/7/2014 9 31	69.41	12/7/2014 9 28	67.12000246	12/7/2014 9 00	76.51000144	12/7/2014 9 24	71.2799982	12/7/2014 9 31	72.92000204	12/7/2014 9 31	65.95999917	12/7/2014 9 53	70.96000266	12/7/2014 9 35	72.1
12/7/2014 10 16	70.87000244	12/7/2014 10 34	64.4200006	12/7/2014 10 20	70.15999779	12/7/2014 10 24	69.59	12/7/2014 10 45	67.55000248	12/7/2014 10 00	76.51000144	12/7/2014 10 23	71.46999819	12/7/2014 10 34	72.62000203	12/7/2014 10 33	65.71999917	12/7/2014 10 37	70.53000264	12/7/2014 10 54	71.94
12/7/2014 11 22	71.42000246	12/7/2014 11 06	65.1500006	12/7/2014 11 55	70.45999778	12/7/2014 11 07	68.07	12/7/2014 11 11	67.58000248	12/7/2014 11 00	76.51000144	12/7/2014 11 00	71.46999819	12/7/2014 11 01	72.77000204	12/7/2014 11 08	65.92999917	12/7/2014 11 38	70.87000265	12/7/2014 11 52	71.7
12/7/2014 12 08	70.66000244	12/7/2014 12 25	65.83000061	12/7/2014 12 00	71.03999777	12/7/2014 12 40	69.5	12/7/2014 12 19	67.43000247	12/7/2014 12 00	76.51000144	12/7/2014 12 00	71.79999818	12/7/2014 12 00	72.62000203	12/7/2014 12 11	66.35999917	12/7/2014 12 25	71.11000266	12/7/2014 12 00	72.52
12/7/2014 13 32	71.18000245	12/7/2014 13 12	66.19000061	12/7/2014 13 19	70.36999779	12/7/2014 13 22	68.65	12/7/2014 13 22	64.83000238	12/7/2014 13 00	76.51000144	12/7/2014 13 21	69.26999825	12/7/2014 13 50	72.65000203	12/7/2014 13 08	67.42999915	12/7/2014 13 56	71.78000269	12/7/2014 13 56	70.54
12/7/2014 14 27	71.55000247	12/7/2014 14 08	66.86000062	12/7/2014 14 44	70.91999777	12/7/2014 14 46	70.05	12/7/2014 14 07	67.70000248	12/7/2014 14 00	76.51000144	12/7/2014 14 46	71.70999819	12/7/2014 14 46	73.44000205	12/7/2014 14 07	68.39999914	12/7/2014 14 07	72.54000272	12/7/2014 14 09	73.07
12/7/2014 15 41	71.88000248	12/7/2014 15 31	67.20000062	12/7/2014 15 00	71.64999775	12/7/2014 15 52	69.53	12/7/2014 15 02	67.67000248	12/7/2014 15 00	76.51000144	12/7/2014 15 52	70.42999822	12/7/2014 15 53	73.56000206	12/7/2014 15 45	68.24999914	12/7/2014 15 45	72.70000272	12/7/2014 15 27	72.86
12/7/2014 16 01	72.13000249	12/7/2014 16 29	66.99000062	12/7/2014 16 05	71.00999777	12/7/2014 16 30	69.71	12/7/2014 16 18	67.73000248	12/7/2014 16 00	76.51000144	12/7/2014 16 30	71.43999819	12/7/2014 16 13	73.53000206	12/7/2014 16 45	68.03999915	12/7/2014 16 41	72.51000271	12/7/2014 16 13	73.01
12/7/2014 17 45	71.76000247	12/7/2014 17 44	66.71000062	12/7/2014 17 06	71.09999776	12/7/2014 17 55	70.26	12/7/2014 17 28	67.82000249	12/7/2014 17 00	76.51000144	12/7/2014 17 46	71.95999818	12/7/2014 17 04	73.26000205	12/7/2014 17 52	68.15999914	12/7/2014 17 04	72.27000271	12/7/2014 17 43	72.71
12/7/2014 18 12	72.22000249	12/7/2014 18 20	66.22000061	12/7/2014 18 44	71.49999775	12/7/2014 18 55	70.29	12/7/2014 18 00	67.70000248	12/7/2014 18 00	76.51000144	12/7/2014 18 45	71.76999819	12/7/2014 18 00	73.35000205	12/7/2014 18 46	67.93999915	12/7/2014 18 21	72.39000271	12/7/2014 18 09	72.98
12/7/2014 19 24	72.03000248	12/7/2014 19 11	67.11000062	12/7/2014 19 05	71.79999774	12/7/2014 19 55	70.14	12/7/2014 19 06	67.64000248	12/7/2014 19 00	76.51000144	12/7/2014 19 25	71.95999818	12/7/2014 19 52	73.10000205	12/7/2014 19 02	67.81999915	12/7/2014 19 01	72.2400027	12/7/2014 19 37	73.01
12/7/2014 20 56	72.5500025	12/7/2014 20 17	67.41000063	12/7/2014 20 33	71.52999775	12/7/2014 20 05	70.36	12/7/2014 20 08	68.1000025	12/7/2014 20 00	76.51000144	12/7/2014 20 39	72.04999818	12/7/2014 20 39	73.44000205	12/7/2014 20 06	68.76999914	12/7/2014 20 09	72.45000271	12/7/2014 20 02	73.13
12/7/2014 21 40	72.4300025	12/7/2014 21 10	68.33000063	12/7/2014 21 08	71.06999777	12/7/2014 21 13	70.78	12/7/2014 21 07	68.07000249	12/7/2014 21 00	76.51000144	12/7/2014 21 03	72.19999818	12/7/2014 21 03	73.53000206	12/7/2014 21 03	69.03999913	12/7/2014 21 04	73.22000274	12/7/2014 21 13	73.87
12/7/2014 22 48	73.23000252	12/7/2014 22 00	69.43000065	12/7/2014 22 48	72.56999772	12/7/2014 22 48	70.11	12/7/2014 22 48	67.95000249	12/7/2014 22 00	76.51000144	12/7/2014 22 48	72.16999818	12/7/2014 22 48	72.65000203	12/7/2014 22 00	70.13999912	12/7/2014 22 01	73.67000276	12/7/2014 22 02	74.14
12/7/2014 23 00	74.32000256	12/7/2014 23 00	70.47000065	12/7/2014 23 07	72.77999771	12/7/2014 23 18	71.18	12/7/2014 23 01	69.35000254	12/7/2014 23 00	76.51000144	12/7/2014 23 01	72.83999816	12/7/2014 23 01	74.54000209	12/7/2014 23 07	71.20999911	12/7/2014 23 00	74.68000279	12/7/2014 23 07	75.18
12/8/2014 0 33	70.63000244	12/8/2014 0 39	70.86000066	12/8/2014 0 33	73.1799977	12/8/2014 0 39	70.69	12/8/2014 0 34	66.17000243	12/8/2014 0 00	76.51000144	12/8/2014 0 33	68.83999826	12/8/2014 0 34	72.83000204	12/8/2014 0 34	70.07999912	12/8/2014 0 34	72.88000273	12/8/2014 0 44	75.15
12/8/2014 1 15	72.5200025	12/8/2014 1 16	70.89000066	12/8/2014 1 21	73.69999768	12/8/2014 1 14	70.66	12/8/2014 1 16	68.1600025	12/8/2014 1 00	76.51000144	12/8/2014 1 04	71.0399982	12/8/2014 1 08	74.63000209	12/8/2014 1 08	71.9699991	12/8/2014 1 09	74.59000279	12/8/2014 1 16	75.12
12/8/2014 2 15	72.98000251	12/8/2014 2 05	71.26000066	12/8/2014 2 14	73.35999769	12/8/2014 2 15	70.45	12/8/2014 2 05	67.91000249	12/8/2014 2 00	76.51000144	12/8/2014 2 14	71.1599982	12/8/2014 2 15	74.39000208	12/8/2014 2 19	71.9699991	12/8/2014 2 15	74.8000028	12/8/2014 2 09	75.42
12/8/2014 3 12	74.42000256	12/8/2014 3 40	71.47000066	12/8/2014 3 17	73.56999769	12/8/2014 3 42	71.39	12/8/2014 3 16	68.49000251	12/8/2014 3 00	76.51000144	12/8/2014 3 16	71.85999818	12/8/2014 3 00	74.78000209	12/8/2014 3 16	72.36999909	12/8/2014 3 16	75.26000282	12/8/2014 3 43	75.48
12/8/2014 4 58	73.93000255	12/8/2014 4 58	71.01000066	12/8/2014 4 07	73.96999768	12/8/2014 4 52	71.45	12/8/2014 4 52	68.56000251	12/8/2014 4 00	76.51000144	12/8/2014 4 58	71.64999819	12/8/2014 4 57	74.81000209	12/8/2014 4 56	72.33999909	12/8/2014 4 38	75.26000282	12/8/2014 4 52	75.42
12/8/2014 5 02	72.71000251	12/8/2014 5 55	68.79000064	12/8/2014 5 39	73.2099977	12/8/2014 5 52	71.06	12/8/2014 5 03	67.43000247	12/8/2014 5 00	76.51000144	12/8/2014 5 03	71.2199982	12/8/2014 5 51	74.02000207	12/8/2014 5 52	70.38999912	12/8/2014 5 52	73.98000277	12/8/2014 5 56	74.05
12/8/2014 6 55	70.81000244	12/8/2014 6 43	67.05000062	12/8/2014 6 20	71.95999774	12/8/2014 6 51	69.44	12/8/2014 6 51	66.97000245	12/8/2014 6 00	76.51000144	12/8/2014 6 51	71.1299982	12/8/2014 6 20	73.04000204	12/8/2014 6 43	67.75999915	12/8/2014 6 47	71.42000267	12/8/2014 6 44	72.58
12/8/2014 7 40	71.24000246	12/8/2014 7 33	65.52000061	12/8/2014 7 17	70.21999779	12/8/2014 7 02	69.78	12/8/2014 7 16	67.09000246	12/8/2014 7 00	76.51000144	12/8/2014 7 03	71.3199982	12/8/2014 7 17	72.65000203	12/8/2014 7 08	66.62999916	12/8/2014 7 17	70.96000266	12/8/2014 7 17	72.46
12/8/2014 8 30	72.31000249	12/8/2014 8 44	67.78000063	12/8/2014 8 04	70.66999778	12/8/2014 8 35	70.17	12/8/2014 8 47	67.61000248	12/8/2014 8 00	76.51000144	12/8/2014 8 36	69.05999825	12/8/2014 8 32	72.46000203	12/8/2014 8 07	68.79999914	12/8/2014 8 00	72.79000272	12/8/2014 8 16	73.04
12/8/2014 9 20	71.76000247	12/8/2014 9 25	67.05000062	12/8/2014 9 00	72.10999773	12/8/2014 9 38	69.56	12/8/2014 9 38	66.60000244	12/8/2014 9 00	76.51000144	12/8/2014 9 38	70.76999821	12/8/2014 9 26	73.44000205	12/8/2014 9 10	69.13999913	12/8/2014 9 14	72.79000272	12/8/2014 9 36	73.38
12/8/2014 10 50	70.91000245	12/8/2014 10 38	67.87000063	12/8/2014 10 23	70.18999779	12/8/2014 10 50	69.32	12/8/2014 10 50	66.02000242	12/8/2014 10 00	76.51000144	12/8/2014 10 24	69.53999824	12/8/2014 10 18	73.10000205	12/8/2014 10 24	68.58999914	12/8/2014 10 04	73.25000274	12/8/2014 10 51	72.74
12/8/2014 11 08	70.91000245	12/8/2014 11 04	67.93000063	12/8/2014 11 13	70.91999777	12/8/2014 11 40	69.23	12/8/2014 11 09	65.32000239	12/8/2014 11 00	76.51000144	12/8/2014 11 09	70.15999822	12/8/2014 11 09	72.92000204	12/8/2014 11 09	69.25999913	12/8/2014 11 09	72.94000273	12/8/2014 11 17	73.38
12/8/2014 12 48	70.42000243	12/8/2014 12 26	67.96000063	12/8/2014 12 48	71.67999775	12/8/2014 12 21	70.23	12/8/2014 12 18	66.69000244	12/8/2014 12 00	76.51000144	12/8/2014 12 52	70.82999821	12/8/2014 12 55	72.58000203	12/8/2014 12 22	69.09999913	12/8/2014 12 18	73.25000274	12/8/2014 12 04	73.5
12/8/2014 13 48	70.57000243	12/8/2014 13 28	68.36000063	12/8/2014 13 13	70.60999778	12/8/2014 13 24	69.62	12/8/2014 13 35	67.40000247	12/8/2014 13 00	76.51000144	12/8/2014 13 21	70.73999821	12/8/2014 13 04	73.53000206	12/8/2014 13 53	69.98999912	12/8/2014 13 21	73.61000275	12/8/2014 13 22	73.26
12/8/2014 14 57	71.49000246	12/8/2014 14 24	68.33000063	12/8/2014 14 00	72.53999772	12/8/2014 14 50	69.41	12/8/2014 14 51	67.58000248	12/8/2014 14 00	76.51000144	12/8/2014 14 58	71.37999819	12/8/2014 14 52	72.80000204	12/8/2014 14 00	69.67999913	12/8/2014 14 00	73.52000275	12/8/2014 14 29	73.44
12/8/2014 15 01	71.91000248	12/8/2014 15 39	67.99000063	12/8/2014 15 48	72.37999773	12/8/2014 15 40	70.2	12/8/2014 15 05	67.15000246	12/8/2014 15 00	76.51000144	12/8/2014 15 43	70.79999821	12/8/2014 15 04	73.68000206	12/8/2014 15 07	68.73999914	12/8/2014 15 07	73.61000275	12/8/2014 15 18	73.59
12/8/2014 16 20	70.94000245	12/8/2014 16 58	67.02000062	12/8/2014 16 35	72.01999774	12/8/2014 16 23	70.48	12/8/2014 16 20	67.12000246	12/8/2014 16 00	76.51000144	12/8/2014 16 20	70.66999821	12/8/2014 16 09	73.23000205	12/8/2014 16 24	69.31999913	12/8/2014 16 53	73.34000274	12/8/2014 16 21	72.95
12/8/2014 17 36	71.49000246	12/8/2014 17 27	66.16000061	12/8/2014 17 56	71.52999775	12/8/2014 17 07	70.26	12/8/2014 17 46	67.40000247	12/8/2014 17 00	76.51000144	12/8/2014 17 05	71.1899982	12/8/2014 17 38	73.01000204	12/8/2014 17 41	68.61999914	12/8/2014 17 36	72.45000271	12/8/2014 17 28	72.61
12/8/2014 18 38	70.97000245	12/8/2014 18 42	66.53000062	12/8/2014 18 45	71.15999776	12/8/2014 18 23	69.71	12/8/2014 18 23	67.03000246	12/8/2014 18 00	76.51000144	12/8/2014 18 58	70.9799982	12/8/2014 18 23	73.23000205	12/8/2014 18 58	68.24999914	12/8/2014 18 57	72.48000271	12/8/2014 18 34	72.37
12/8/2014 19 36	70.97000245	12/8/2014 19 00	66.68000062	12/8/2014 19 28	71.18999776	12/8/2014 19 31	69.47	12/8/2014 19 36	67.06000246	12/8/2014 19 00	76.51000144	12/8/2014 19 55	71.37999819	12/8/2014 19 01	73.41000205	12/8/2014 19 10	68.39999914	12/8/2014 19 10	72.1800027	12/8/2014 19 02	72.77
12/8/2014 20 23	71.85000248	12/8/2014 20 09	67.47000063	12/8/2014 20 54	70.73999778	12/8/2014 20 15	70.23	12/8/2014 20 23	67.18000246	12/8/2014 20 00	76.51000144	12/8/2014 20 23	71.73999819	12/8/2014 20 31	73.32000205	12/8/2014 20 23	69.25999913	12/8/2014 20 00	72.76000272	12/8/2014 20 59	73.22

12/8/2014 21 07	71.06000245
12/8/2014 22 06	72.19000249
12/8/2014 23 51	71.64000247
12/9/2014 0 24	73.16000252
12/9/2014 1 46	74.35000256
12/9/2014 2 35	75.00000258
12/9/2014 3 16	74.14000255
12/9/2014 4 58	74.48000256
12/9/2014 5 20	72.6800025
12/9/2014 6 42	71.91000248
12/9/2014 7 02	71.42000246
12/9/2014 8 46	70.05000242
12/9/2014 9 50	71.30000246
12/9/2014 10 46	71.91000248
12/9/2014 11 50	71.24000246
12/9/2014 12 57	71.55000247
12/9/2014 13 01	72.00000248
12/9/2014 14 06	72.37000249
12/9/2014 15 52	72.25000249
12/9/2014 16 42	71.88000248
12/9/2014 17 27	71.94000248
12/9/2014 18 57	71.79000247
12/9/2014 19 28	71.61000247
12/9/2014 20 32	71.03000245
12/9/2014 21 55	73.04000252
12/9/2014 22 01	72.77000251
12/9/2014 23 10	72.25000249
12/10/2014 0 19	72.13000249
12/10/2014 1 06	74.66000257
12/10/2014 2 35	74.42000256
12/10/2014 3 14	74.75000257
12/10/2014 4 53	74.08000255
12/10/2014 5 28	71.33000246
12/10/2014 6 32	71.70000247
12/10/2014 7 59	70.84000244
12/10/2014 8 00	70.84000244
12/10/2014 9 53	71.61000247
12/10/2014 10 31	71.45000246
12/10/2014 11 15	71.64000247
12/10/2014 12 02	72.6500025
12/10/2014 12 54	70.78000244
12/10/2014 13 17	71.76000247
12/10/2014 14 13	72.22000249
12/10/2014 15 06	71.36000246
12/10/2014 16 12	70.51000243
12/10/2014 17 37	70.29000242
12/10/2014 18 19	71.39000246
12/10/2014 19 12	70.81000244
12/10/2014 20 15	71.67000247
12/10/2014 21 56	71.36000246
12/10/2014 22 02	72.6500025
12/10/2014 23 17	74.08000255
12/11/2014 0 41	71.24000246
12/11/2014 1 34	73.29000252
12/11/2014 2 40	73.59000253
12/11/2014 3 32	75.21000259
12/11/2014 4 42	74.63000257
12/11/2014 5 38	72.4900025
12/11/2014 6 37	72.19000249
12/11/2014 7 14	71.79000247
12/11/2014 8 03	72.07000248
12/11/2014 9 01	71.70000247
12/11/2014 10 15	72.07000248
12/11/2014 11 13	71.09000245
12/11/2014 12 23	72.4300025
12/11/2014 13 02	71.94000248
12/11/2014 14 35	72.03000248
12/11/2014 15 02	72.03000248
12/11/2014 16 42	71.45000246
12/11/2014 17 40	70.72000244
12/11/2014 18 21	71.52000247
12/11/2014 19 19	72.13000249
12/11/2014 20 45	70.42000243
12/11/2014 21 00	72.37000249
12/11/2014 22 44	72.16000249
12/11/2014 23 21	72.92000251
12/12/2014 0 09	74.35000256
12/12/2014 1 01	71.67000247
12/12/2014 2 10	75.09000258
12/12/2014 3 33	75.03000258
12/12/2014 4 54	74.20000255
12/12/2014 5 24	72.5200025
12/12/2014 6 16	71.45000246
12/12/2014 7 03	71.03000245
12/12/2014 8 15	70.60000243
12/12/2014 9 07	69.78000241
12/12/2014 10 29	70.60000243
12/12/2014 11 31	71.30000246
12/12/2014 12 24	72.6100025
12/12/2014 13 33	71.06000245
12/12/2014 14 00	72.5800025
12/12/2014 15 03	70.84000244
12/12/2014 16 08	70.81000244
12/12/2014 17 28	72.00000248
12/12/2014 18 51	71.30000246

12/8/2014 21 50	67.90000063
12/8/2014 22 01	67.87000063
12/8/2014 23 39	70.40000065
12/9/2014 0 17	70.92000066
12/9/2014 1 31	71.05000066
12/9/2014 2 24	71.32000066
12/9/2014 3 20	71.59000067
12/9/2014 4 48	71.20000066
12/9/2014 5 58	69.00000064
12/9/2014 6 35	66.92000062
12/9/2014 7 16	66.28000062
12/9/2014 8 00	66.34000062
12/9/2014 9 15	67.72000063
12/9/2014 10 16	68.08000063
12/9/2014 11 07	67.87000063
12/9/2014 12 09	68.88000064
12/9/2014 13 02	68.15000063
12/9/2014 14 47	68.73000064
12/9/2014 15 51	68.21000063
12/9/2014 16 34	67.38000063
12/9/2014 17 36	66.47000062
12/9/2014 18 00	66.83000062
12/9/2014 19 12	67.14000062
12/9/2014 20 29	66.80000062
12/9/2014 21 29	67.84000063
12/9/2014 22 08	68.33000063
12/9/2014 23 11	69.34000064
12/10/2014 0 20	69.24000064
12/10/2014 1 15	70.34000065
12/10/2014 2 16	70.83000066
12/10/2014 3 35	70.71000066
12/10/2014 4 26	70.65000066
12/10/2014 5 37	68.05000063
12/10/2014 6 37	66.74000062
12/10/2014 7 05	65.98000061
12/10/2014 8 04	67.78000063
12/10/2014 9 45	68.30000063
12/10/2014 10 48	66.71000062
12/10/2014 11 11	67.66000063
12/10/2014 12 18	68.97000064
12/10/2014 12 53	68.36000063
12/10/2014 13 49	67.66000063
12/10/2014 14 33	68.18000063
12/10/2014 15 35	67.66000063
12/10/2014 16 48	67.23000062
12/10/2014 17 59	65.83000061
12/10/2014 18 00	65.83000061
12/10/2014 19 00	66.50000062
12/10/2014 20 07	67.38000063
12/10/2014 21 05	67.72000063
12/10/2014 22 11	67.53000063
12/10/2014 23 14	69.82000065
12/11/2014 0 41	69.43000065
12/11/2014 1 30	70.07000065
12/11/2014 2 04	70.13000065
12/11/2014 3 06	71.41000066
12/11/2014 4 38	70.80000066
12/11/2014 5 55	68.48000064
12/11/2014 6 45	66.65000062
12/11/2014 7 10	65.83000061
12/11/2014 8 06	67.50000063
12/11/2014 9 25	68.18000063
12/11/2014 10 21	66.95000062
12/11/2014 11 09	67.75000063
12/11/2014 12 32	68.21000063
12/11/2014 13 24	67.63000063
12/11/2014 14 24	68.36000063
12/11/2014 15 56	67.75000063
12/11/2014 16 41	67.84000063
12/11/2014 17 24	67.26000062
12/11/2014 18 25	67.02000062
12/11/2014 19 26	67.05000062
12/11/2014 20 05	67.57000063
12/11/2014 21 01	67.69000063
12/11/2014 22 44	68.73000064
12/11/2014 23 20	69.70000065
12/12/2014 0 23	70.59000066
12/12/2014 1 02	68.66000064
12/12/2014 2 25	71.17000066
12/12/2014 3 02	71.47000066
12/12/2014 4 43	70.74000066
12/12/2014 5 54	68.57000064
12/12/2014 6 48	66.86000062
12/12/2014 7 36	66.19000061
12/12/2014 8 14	66.92000062
12/12/2014 9 12	66.83000062
12/12/2014 10 09	67.63000063
12/12/2014 11 07	68.45000064
12/12/2014 12 03	68.57000064
12/12/2014 13 16	67.72000063
12/12/2014 14 32	68.54000064
12/12/2014 15 51	68.02000063
12/12/2014 16 49	67.99000063
12/12/2014 17 34	67.57000063
12/12/2014 18 35	67.78000063

12/8/2014 21 01	71.64999775
12/8/2014 22 43	68.28999785
12/8/2014 23 04	73.2399977
12/9/2014 0 24	73.2399977
12/9/2014 1 27	73.53999769
12/9/2014 2 11	73.1499977
12/9/2014 3 33	73.53999769
12/9/2014 4 51	73.1799977
12/9/2014 5 36	72.53999772
12/9/2014 6 38	71.76999774
12/9/2014 7 08	70.51999778
12/9/2014 8 12	71.09999776
12/9/2014 9 58	71.55999775
12/9/2014 10 53	70.51999778
12/9/2014 11 02	72.04999774
12/9/2014 12 25	71.98999774
12/9/2014 13 33	71.98999774
12/9/2014 14 44	72.16999773
12/9/2014 15 02	71.98999774
12/9/2014 16 30	71.40999776
12/9/2014 17 38	70.88999777
12/9/2014 18 34	71.61999775
12/9/2014 19 05	71.28999776
12/9/2014 20 33	71.76999774
12/9/2014 21 14	70.24999779
12/9/2014 22 42	72.50999772
12/9/2014 23 19	73.0599977
12/10/2014 0 19	72.07999773
12/10/2014 1 00	73.66999769
12/10/2014 2 14	73.47999769
12/10/2014 3 21	74.05999767
12/10/2014 4 33	72.53999772
12/10/2014 5 48	72.86999771
12/10/2014 6 37	70.94999777
12/10/2014 7 20	70.76999778
12/10/2014 8 03	71.34999776
12/10/2014 9 14	71.46999775
12/10/2014 10 01	71.73999775
12/10/2014 11 40	69.9099978
12/10/2014 12 15	72.34999773
12/10/2014 12 37	72.56999772
12/10/2014 12 56	72.98999771
12/10/2014 13 28	71.92999774
12/10/2014 14 24	71.12999776
12/10/2014 15 34	71.28999776
12/10/2014 16 47	70.54999778
12/10/2014 17 58	70.27999779
12/10/2014 18 00	70.27999779
12/10/2014 19 12	71.15999776
12/10/2014 20 23	70.73999778
12/10/2014 21 26	71.76999774
12/10/2014 22 22	72.19999773
12/10/2014 23 22	72.65999772
12/11/2014 0 41	71.03999777
12/11/2014 1 13	73.1499977
12/11/2014 2 00	72.56999772
12/11/2014 3 07	73.44999769
12/11/2014 4 00	73.50999769
12/11/2014 5 19	72.92999771
12/11/2014 6 09	71.21999776
12/11/2014 7 24	70.51999778
12/11/2014 8 35	70.91999777
12/11/2014 9 11	71.12999776
12/11/2014 10 35	72.40999772
12/11/2014 11 14	70.97999777
12/11/2014 12 14	72.13999773
12/11/2014 13 57	72.10999773
12/11/2014 14 02	68.07999786
12/11/2014 15 19	70.70999778
12/11/2014 16 39	71.76999774
12/11/2014 17 33	71.09999776
12/11/2014 18 01	70.0299978
12/11/2014 19 01	71.52999775
12/11/2014 20 34	71.52999775
12/11/2014 21 43	68.16999786
12/11/2014 22 44	70.0299978
12/11/2014 23 32	72.98999771
12/12/2014 0 38	73.69999768
12/12/2014 1 02	72.47999772
12/12/2014 2 48	73.69999768
12/12/2014 3 52	73.53999769
12/12/2014 4 35	73.66999769
12/12/2014 5 47	72.59999772
12/12/2014 6 34	71.43999775
12/12/2014 7 47	71.00999777
12/12/2014 8 44	71.40999776
12/12/2014 9 45	71.09999776
12/12/2014 10 23	71.06999777
12/12/2014 11 58	72.04999774
12/12/2014 12 00	72.04999774
12/12/2014 13 39	69.9099978
12/12/2014 14 22	71.18999776
12/12/2014 15 53	71.92999774
12/12/2014 16 23	71.21999776
12/12/2014 17 40	70.51999778

12/8/2014 21 22	69.87
12/8/2014 22 39	70.57
12/8/2014 23 51	70.51
12/9/2014 0 05	71.3
12/9/2014 1 19	71.21
12/9/2014 2 35	71.3
12/9/2014 3 19	72.16
12/9/2014 4 09	71.27
12/9/2014 5 20	71.36
12/9/2014 6 22	70.11
12/9/2014 7 35	69.68
12/9/2014 8 39	66.72
12/9/2014 9 13	69.9
12/9/2014 10 42	69.68
12/9/2014 11 50	69.62
12/9/2014 12 34	70.14
12/9/2014 13 22	70.2
12/9/2014 14 55	70.26
12/9/2014 15 50	70.51
12/9/2014 16 35	70.05
12/9/2014 17 00	70.17
12/9/2014 18 57	69.35
12/9/2014 19 55	70.29
12/9/2014 20 32	70.26
12/9/2014 21 14	69.78
12/9/2014 22 09	70.48
12/9/2014 23 18	71.06
12/10/2014 0 19	70.02
12/10/2014 1 29	71.7
12/10/2014 2 10	70.57
12/10/2014 3 21	71.76
12/10/2014 4 02	70.6
12/10/2014 5 36	70.6
12/10/2014 6 32	69.68
12/10/2014 7 02	69.87
12/10/2014 8 11	69.5
12/10/2014 9 18	69.32
12/10/2014 10 58	70.45
12/10/2014 11 31	70.39
12/10/2014 12 04	69.23
12/10/2014 12 30	70.29
12/10/2014 12 52	70.48
12/10/2014 13 37	70.42
12/10/2014 14 13	70.08
12/10/2014 15 19	70.23
12/10/2014 16 21	69.44
12/10/2014 17 26	69.65
12/10/2014 18 26	69.74
12/10/2014 19 57	69.35
12/10/2014 20 11	70.36
12/10/2014 21 53	70.32
12/10/2014 22 26	69.41
12/10/2014 23 22	70.66
12/11/2014 0 41	67.7
12/11/2014 1 07	71.58
12/11/2014 2 03	70.08
12/11/2014 3 46	71.76
12/11/2014 4 33	71.09
12/11/2014 5 43	69.01
12/11/2014 6 47	69.68
12/11/2014 7 04	69.32
12/11/2014 8 49	68.89
12/11/2014 9 36	69.78
12/11/2014 10 44	70.36
12/11/2014 11 40	70.32
12/11/2014 12 35	69.07
12/11/2014 13 54	70.42
12/11/2014 14 47	70.26
12/11/2014 15 22	70.39
12/11/2014 16 42	69.65
12/11/2014 17 07	69.74
12/11/2014 18 31	70.08
12/11/2014 19 43	70.29
12/11/2014 20 58	70.05
12/11/2014 21 43	68.95
12/11/2014 22 45	69.13
12/11/2014 23 22	71.39
12/12/2014 0 05	72.13
12/12/2014 1 07	70.2
12/12/2014 2 13	71.67
12/12/2014 3 58	71.45
12/12/2014 4 53	70.81
12/12/2014 5 08	70.69
12/12/2014 6 51	69.93
12/12/2014 7 41	69.84
12/12/2014 8 37	68.58
12/12/2014 9 35	69.2
12/12/2014 10 27	70.51
12/12/2014 11 55	70.36
12/12/2014 12 07	70.45
12/12/2014 13 34	70.05
12/12/2014 14 32	69.29
12/12/2014 15 36	70.05
12/12/2014 16 13	70.29
12/12/2014 17 20	70.39

12/8/2014 21 12	67.30000247
12/8/2014 22 15	67.98000249
12/8/2014 23 51	65.99000242
12/9/2014 0 24	67.79000248
12/9/2014 1 19	68.86000252
12/9/2014 2 39	68.95000253
12/9/2014 3 33	69.41000254
12/9/2014 4 52	68.83000252
12/9/2014 5 17	67.76000248
12/9/2014 6 05	67.82000249
12/9/2014 7 36	67.21000246
12/9/2014 8 39	65.5300024
12/9/2014 9 16	66.17000243
12/9/2014 10 20	66.54000244
12/9/2014 11 06	67.15000246
12/9/2014 12 57	67.30000247
12/9/2014 13 01	67.40000247
12/9/2014 14 46	67.79000248
12/9/2014 15 13	67.43000247
12/9/2014 16 35	67.64000248
12/9/2014 17 27	67.30000247
12/9/2014 18 57	67.24000246
12/9/2014 19 59	67.33000247
12/9/2014 20 28	66.97000245
12/9/2014 21 14	66.91000245
12/9/2014 22 10	67.82000249
12/9/2014 23 10	68.2800025
12/10/2014 0 19	66.24000243
12/10/2014 1 23	68.3400025
12/10/2014 2 14	68.56000251
12/10/2014 3 58	68.80000252
12/10/2014 4 02	68.1000025
12/10/2014 5 34	66.48000244
12/10/2014 6 33	66.75000245
12/10/2014 7 55	66.88000245
12/10/2014 8 41	65.5900024
12/10/2014 9 41	66.97000245
12/10/2014 10 31	67.12000246
12/10/2014 11 15	67.00000246
12/10/2014 12 00	67.00000246
12/10/2014 12 30	67.24000246
12/10/2014 12 54	67.30000247
12/10/2014 13 17	67.06000246
12/10/2014 14 13	67.18000246
12/10/2014 15 45	67.06000246
12/10/2014 16 12	66.51000244
12/10/2014 17 25	66.82000245
12/10/2014 18 19	67.18000246
12/10/2014 19 16	66.94000245
12/10/2014 20 19	67.67000248
12/10/2014 21 56	67.21000246
12/10/2014 22 17	68.1000025
12/10/2014 23 08	69.23000254
12/11/2014 0 41	65.29000239
12/11/2014 1 39	67.95000249
12/11/2014 2 04	68.3400025
12/11/2014 3 55	68.80000252
12/11/2014 4 55	68.49000251
12/11/2014 5 43	65.5000024
12/11/2014 6 01	67.73000248
12/11/2014 7 14	67.27000247
12/11/2014 8 45	66.39000243
12/11/2014 9 57	66.66000244
12/11/2014 10 00	66.66000244
12/11/2014 11 37	67.40000247
12/11/2014 12 12	67.09000246
12/11/2014 13 24	66.97000245
12/11/2014 14 23	66.60000244
12/11/2014 15 00	67.33000247
12/11/2014 16 42	66.94000245
12/11/2014 17 20	67.33000247
12/11/2014 18 08	67.67000248
12/11/2014 19 54	67.98000249
12/11/2014 20 45	67.64000248
12/11/2014 21 44	66.24000243
12/11/2014 22 44	66.85000245
12/11/2014 23 11	68.89000253
12/12/2014 0 09	69.47000255
12/12/2014 1 01	65.63000241
12/12/2014 2 00	69.50000255
12/12/2014 3 51	68.86000252
12/12/2014 4 53	68.98000253
12/12/2014 5 24	67.52000247
12/12/2014 6 49	67.67000248
12/12/2014 7 24	67.00000246
12/12/2014 8 07	67.15000246
12/12/2014 9 23	65.4700024
12/12/2014 10 29	67.30000247
12/12/2014 11 00	67.52000247
12/12/2014 12 27	67.30000247
12/12/2014 13 40	66.85000245
12/12/2014 14 05	67.64000248
12/12/2014 15 03	67.76000248
12/12/2014 16 29	67.00000246
12/12/2014 17 53	67.06000246

12/8/2014 21 00	76.51000144
12/8/2014 22 00	76.51000144
12/8/2014 23 00	76.51000144
12/9/2014 0 00	76.51000144
12/9/2014 1 00	76.51000144
12/9/2014 2 00	76.51000144
12/9/2014 3 00	76.51000144
12/9/2014 4 00	76.51000144
12/9/2014 5 00	76.51000144
12/9/2014 6 00	76.51000144
12/9/2014 7 00	76.51000144
12/9/2014 8 00	76.51000144
12/9/2014 9 00	76.51000144
12/9/2014 10 00	76.51000144
12/9/2014 11 00	76.51000144
12/9/2014 12 00	76.51000144
12/9/2014 13 00	76.51000144
12/9/2014 14 00	76.51000144
12/9/2014 15 00	76.51000144
12/9/2014 16 00	76.51000144
12/9/2014 17 00	76.51000144
12/9/2014 18 00	76.51000144
12/9/2014 19 00	76.51000144
12/9/2014 20 00	76.51000144
12/9/2014 21 00	76.51000144
12/9/2014 22 00	76.51000144
12/9/2014 23 00	76.51000144
12/10/2014 0 00	76.51000144
12/10/2014 1 00	76.51000144
12/10/2014 2 00	76.51000144
12/10/2014 3 00	76.51000144
12/10/2014 4 00	76.51000144
12/10/2014 5 00	76.51000144
12/10/2014 6 00	76.51000144
12/10/2014 7 00	76.51000144
12/10/2014 8 00	76.51000144
12/10/2014 9 00	76.51000144
12/10/2014 10 00	76.51000144
12/10/2014 11 00	76.51000144
12/10/2014 12 00	76.51000144
12/10/2014 12 24	76.51000144
12/10/2014 13 00	76.54000144
12/10/2014 14 00	76.54000144
12/10/2014 15 00	76.54000144
12/10/2014 16 00	76.54000144
12/10/2014 17 00	76.54000144
12/10/2014 18 00	76.54000144
12/10/2014 19 00	76.54000144
12/10/2014 20 00	76.54000144
12/10/2014 21 00	76.54000144
12/10/2014 22 00	76.54000144
12/10/2014 23 00	76.54000144
12/11/2014 0 00	76.54000144
12/11/2014 1 00	76.54000144
12/11/2014 2 00	76.54000144
12/11/2014 3 00	76.54000144
12/11/2014 4 00	76.54000144
12/11/2014 5 00	76.54000144
12/11/2014 6 00	76.54000144
12/11/2014 7 00	76.54000144
12/11/2014 8 00	76.54000144
12/11/2014 9 00	76.54000144
12/11/2014 10 00	76.54000144
12/11/2014 11 00	76.54000144
12/11/2014 12 00	76.54000144
12/11/2014 13 00	76.54000144
12/11/2014 14 00	76.54000144
12/11/2014 15 00	76.54000144
12/11/2014 16 00	76.54000144
12/11/2014 17 00	76.54000144
12/11/2014 18 00	76.54000144
12/11/2014 19 00	76.54000144
12/11/2014 20 00	76.54000144
12/11/2014 21 00	76.54000144
12/11/2014 22 00	76.54000144
12/11/2014 23 00	76.54000144
12/12/2014 0 00	76.54000144
12/12/2014 1 00	76.54000144
12/12/2014 2 00	76.54000144
12/12/2014 3 00	76.54000144
12/12/2014 4 00	76.54000144
12/12/2014 5 00	76.54000144
12/12/2014 6 00	76.54000144
12/12/2014 7 00	76.54000144
12/12/2014 8 00	76.54000144
12/12/2014 9 00	76.54000144
12/12/2014 10 00	76.54000144
12/12/2014 11 00	76.54000144
12/12/2014 12 00	76.54000144
12/12/2014 13 00	76.54000144
12/12/2014 14 00	76.54000144
12/12/2014 15 00	76.54000144
12/12/2014 16 00	76.54000144
12/12/2014 17 00	76.54000144
12/12/2014 18 00	76.54000144

12/8/2014 21 04	71.76999819
12/8/2014 22 00	71.82999818
12/8/2014 23 51	69.35999824
12/9/2014 0 24	71.55999819
12/9/2014 1 26	72.04999818
12/9/2014 2 29	72.68999816
12/9/2014 3 36	72.77999816
12/9/2014 4 09	72.16999818
12/9/2014 5 16	70.9799982
12/9/2014 6 41	71.43999819
12/9/2014 7 22	71.64999819
12/9/2014 8 39	68.77999826
12/9/2014 9 16	70.79999821
12/9/2014 10 45	70.73999821
12/9/2014 11 07	70.9799982
12/9/2014 12 49	70.82999821
12/9/2014 13 02	71.3199982
12/9/2014 14 38	71.37999819
12/9/2014 15 06	70.9799982
12/9/2014 16 42	71.58999819
12/9/2014 17 09	71.37999819
12/9/2014 18 57	71.0999982
12/9/2014 19 11	71.40999819
12/9/2014 20 32	71.37999819
12/9/2014 21 10	71.43999819
12/9/2014 22 09	71.43999819
12/9/2014 23 11	71.70999819
12/10/2014 0 18	68.74999826
12/10/2014 1 21	72.37999817
12/10/2014 2 06	70.63999821
12/10/2014 3 58	72.28999817
12/10/2014 4 02	71.92999818
12/10/2014 5 34	70.15999822
12/10/2014 6 36	70.88999821
12/10/2014 7 16	71.3199982
12/10/2014 8 41	70.11999822
12/10/2014 9 46	70.73999821
12/10/2014 10 58	70.9499982
12/10/2014 11 33	70.51999822
12/10/2014 12 01	69.53999824
12/10/2014 12 53	71.1299982
12/10/2014 13 53	69.72999823
12/10/2014 14 51	70.91999821
12/10/2014 15 49	70.9499982
12/10/2014 16 13	70.88999821
12/10/2014 17 21	70.48999822
12/10/2014 18 26	70.66999821
12/10/2014 19 06	71.3499982
12/10/2014 20 37	71.61999819
12/10/2014 21 29	71.76999819
12/10/2014 22 25	71.37999819
12/10/2014 23 13	72.40999817
12/11/2014 0 40	69.23999825
12/11/2014 1 39	71.79999818
12/11/2014 2 03	71.0099982
12/11/2014 3 56	71.98999818
12/11/2014 4 38	71.89999818
12/11/2014 5 44	69.26999825
12/11/2014 6 48	71.0399982
12/11/2014 7 07	71.0699982
12/11/2014 8 45	69.66999824
12/11/2014 9 57	70.85999821
12/11/2014 10 51	71.40999819
12/11/2014 11 47	70.88999821
12/11/2014 12 39	70.9799982
12/11/2014 13 23	70.73999821
12/11/2014 14 07	71.1899982
12/11/2014 15 06	71.0699982
12/11/2014 16 04	71.1299982
12/11/2014 17 16	71.2799982
12/11/2014 18 41	71.1299982
12/11/2014 19 26	71.37999819
12/11/2014 20 49	71.1299982
12/11/2014 21 43	70.08999823
12/11/2014 22 44	70.85999821
12/11/2014 23 22	72.16999818
12/12/2014 0 05	72.92999816
12/12/2014 1 02	68.65999826
12/12/2014 2 39	72.65999816
12/12/2014 3 02	72.62999816
12/12/2014 4 53	72.13999818
12/12/2014 5 24	71.0699982
12/12/2014 6 38	71.43999819
12/12/2014 7 24	71.2199982
12/12/2014 8 36	69.50999824
12/12/2014 9 35	71.0099982
12/12/2014 10 07	71.1299982
12/12/2014 11 35	71.40999819
12/12/2014 12 50	71.61999819
12/12/2014 13 34	70.51999822
12/12/2014 14 22	70.73999821
12/12/2014 15 00	71.40999819
12/12/2014 16 09	71.40999819
12/12/2014 17 53	71.3499982
12/12/2014 18 31	71.40999819

12/8/2014 21 22	73.07000204
12/8/2014 22 43	71.390002
12/8/2014 23 51	74.48000208
12/9/2014 0 28	74.78000209
12/9/2014 1 24	74.63000209
12/9/2014 2 19	74.9700021
12/9/2014 3 33	74.66000209
12/9/2014 4 06	74.72000209
12/9/2014 5 17	74.54000209
12/9/2014 6 09	73.29000205
12/9/2014 7 21	72.80000204
12/9/2014 8 43	72.71000203
12/9/2014 9 47	73.01000204
12/9/2014 10 02	73.13000205
12/9/2014 11 50	73.23000205
12/9/2014 12 34	73.84000207
12/9/2014 13 11	73.26000205
12/9/2014 14 31	73.32000205
12/9/2014 15 59	73.81000207
12/9/2014 16 16	73.59000206
12/9/2014 17 24	73.44000205
12/9/2014 18 50	72.92000204
12/9/2014 19 05	73.23000205
12/9/2014 20 33	73.81000207
12/9/2014 21 02	73.32000205
12/9/2014 22 42	73.90000207
12/9/2014 23 27	74.29000208
12/10/2014 0 18	72.62000203
12/10/2014 1 11	74.78000209
12/10/2014 2 14	74.32000208
12/10/2014 3 14	75.0300021
12/10/2014 4 02	74.29000208
12/10/2014 5 04	74.32000208
12/10/2014 6 53	73.13000205
12/10/2014 7 08	72.58000203
12/10/2014 8 30	73.29000205
12/10/2014 9 00	73.65000206
12/10/2014 10 10	73.65000206
12/10/2014 11 06	72.89000204
12/10/2014 12 21	73.56000206
12/10/2014 12 56	73.16000205
12/10/2014 13 53	71.460002
12/10/2014 14 01	73.19000205
12/10/2014 15 54	73.35000205
12/10/2014 16 09	73.47000206
12/10/2014 17 26	72.74000203
12/10/2014 18 02	73.19000205
12/10/2014 19 00	73.19000205
12/10/2014 20 45	73.35000205
12/10/2014 21 37	73.38000205
12/10/2014 22 25	71.550002
12/10/2014 23 27	74.20000208
12/11/2014 0 40	72.83000204
12/11/2014 1 32	74.63000209
12/11/2014 2 43	74.14000207
12/11/2014 3 56	74.66000209
12/11/2014 4 00	74.48000208
12/11/2014 5 43	73.93000207
12/11/2014 6 55	73.13000205
12/11/2014 7 48	72.37000202
12/11/2014 8 30	73.19000205
12/11/2014 9 57	73.29000205
12/11/2014 10 49	73.74000206
12/11/2014 11 39	73.26000205
12/11/2014 12 19	73.35000205
12/11/2014 13 23	70.11000196
12/11/2014 14 02	72.22000202
12/11/2014 15 53	73.59000206
12/11/2014 16 46	72.89000204
12/11/2014 17 44	73.10000205
12/11/2014 18 54	73.23000205
12/11/2014 19 30	73.07000204
12/11/2014 20 03	73.41000205
12/11/2014 21 44	70.69000198
12/11/2014 22 23	73.26000205
12/11/2014 23 00	73.84000207
12/12/2014 0 00	74.60000209
12/12/2014 1 24	73.87000207
12/12/2014 2 03	74.78000209
12/12/2014 3 53	74.9700021
12/12/2014 4 44	74.78000209
12/12/2014 5 56	73.96000207
12/12/2014 6 37	73.01000204
12/12/2014 7 12	72.89000204
12/12/2014 8 08	72.98000204
12/12/2014 9 36	73.35000205
12/12/2014 10 00	73.50000206
12/12/2014 11 24	73.38000205
12/12/2014 12 00	73.41000205
12/12/2014 13 39	70.84000198
12/12/2014 14 22	72.95000204
12/12/2014 15 04	72.98000204
12/12/2014 16 09	72.92000204
12/12/2014 17 47	73.04000204
12/12/2014 18 26	73.19000205

12/8/2014 21 07	68.67999914
12/8/2014 22 01	69.71999913
12/8/2014 23 52	71.11999911
12/9/2014 0 21	72.1599991
12/9/2014 1 27	72.33999909
12/9/2014 2 36	72.88999909
12/9/2014 3 18	72.79999909
12/9/2014 4 10	72.39999909
12/9/2014 5 56	71.17999911
12/9/2014 6 55	67.29999915
12/9/2014 7 02	66.44999916
12/9/2014 8 02	68.30999914
12/9/2014 9 47	69.46999913
12/9/2014 10 16	69.55999913
12/9/2014 11 51	69.46999913
12/9/2014 12 13	69.80999912
12/9/2014 13 25	70.01999912
12/9/2014 14 31	70.19999912
12/9/2014 15 40	70.19999912
12/9/2014 16 31	69.58999913
12/9/2014 17 36	68.00999915
12/9/2014 18 25	67.78999915
12/9/2014 19 01	68.58999914
12/9/2014 20 01	68.97999913
12/9/2014 21 14	68.45999914
12/9/2014 22 45	69.67999913
12/9/2014 23 10	70.16999912
12/10/2014 0 18	69.61999913
12/10/2014 1 03	72.0699991
12/10/2014 2 07	72.0699991
12/10/2014 3 14	72.67999909
12/10/2014 4 58	71.8799991
12/10/2014 5 54	70.07999912
12/10/2014 6 52	67.35999915
12/10/2014 7 05	66.59999916
12/10/2014 8 05	68.70999914
12/10/2014 9 45	68.55999914
12/10/2014 10 48	69.61999913
12/10/2014 11 27	69.80999912
12/10/2014 12 13	70.10999912
12/10/2014 12 58	70.13999912
12/10/2014 13 53	68.61999914
12/10/2014 14 59	70.10999912
12/10/2014 15 30	69.31999913
12/10/2014 16 55	69.40999913
12/10/2014 17 59	68.27999914
12/10/2014 18 19	68.03999915
12/10/2014 19 31	68.48999914
12/10/2014 20 11	68.79999914
12/10/2014 21 06	68.79999914
12/10/2014 22 25	69.46999913
12/10/2014 23 01	71.08999911
12/11/2014 0 41	70.25999912
12/11/2014 1 40	71.7899991
12/11/2014 2 03	71.7599991
12/11/2014 3 56	72.0999991
12/11/2014 4 00	72.0999991
12/11/2014 5 55	70.04999912
12/11/2014 6 52	66.77999916
12/11/2014 7 07	66.10999917
12/11/2014 8 06	68.24999914
12/11/2014 9 32	68.88999914
12/11/2014 10 11	69.37999913
12/11/2014 11 10	61.52999922 A
12/11/2014 12 02	69.98999912
12/11/2014 13 24	68.67999914
12/11/2014 14 44	70.04999912
12/11/2014 15 07	69.61999913
12/11/2014 16 46	68.88999914
12/11/2014 17 29	68.67999914
12/11/2014 18 22	68.42999914
12/11/2014 19 13	68.39999914
12/11/2014 20 02	68.51999914
12/11/2014 21 43	68.33999914
12/11/2014 22 44	68.85999914
12/11/2014 23 01	70.62999911
12/12/2014 0 04	72.0999991
12/12/2014 1 02	69.58999913
12/12/2014 2 21	72.51999909
12/12/2014 3 11	72.88999909
12/12/2014 4 54	71.9399991
12/12/2014 5 56	70.65999911
12/12/2014 6 34	66.87999916
12/12/2014 7 28	66.13999917
12/12/2014 8 03	67.78999915
12/12/2014 9 41	68.70999914
12/12/2014 10 02	68.91999914
12/12/2014 11 04	69.71999913
12/12/2014 12 46	69.55999913
12/12/2014 13 39	69.58999913
12/12/2014 14 08	69.89999912
12/12/2014 15 46	70.04999912
12/12/2014 16 46	69.00999913
12/12/2014 17 43	69.06999913
12/12/2014 18 06	68.94999913

12/8/2014 21 08	72.2100027
12/8/2014 22 01	73.19000274
12/8/2014 23 52	74.47000279
12/9/2014 0 20	75.08000281
12/9/2014 1 19	75.26000282
12/9/2014 2 37	75.69000283
12/9/2014 3 33	75.29000282
12/9/2014 4 34	75.20000281
12/9/2014 5 47	74.04000277
12/9/2014 6 48	71.84000269
12/9/2014 7 13	70.96000266
12/9/2014 8 02	72.42000271
12/9/2014 9 35	73.28000274
12/9/2014 10 20	73.12000274
12/9/2014 11 22	73.43000275
12/9/2014 12 18	73.86000276
12/9/2014 13 05	74.01000277
12/9/2014 14 39	73.92000277
12/9/2014 15 59	74.07000277
12/9/2014 16 54	73.52000275
12/9/2014 17 47	72.85000273
12/9/2014 18 26	72.1800027
12/9/2014 19 16	72.51000271
12/9/2014 20 16	72.45000271
12/9/2014 21 14	72.48000271
12/9/2014 22 09	73.12000274
12/9/2014 23 10	72.97000273
12/10/2014 0 18	73.43000275
12/10/2014 1 07	74.50000279
12/10/2014 2 07	75.17000281
12/10/2014 3 14	75.72000283
12/10/2014 4 56	74.7700028
12/10/2014 5 53	73.22000274
12/10/2014 6 53	71.72000269
12/10/2014 7 20	71.23000267
12/10/2014 8 11	72.73000272
12/10/2014 9 04	73.19000274
12/10/2014 10 23	73.61000275
12/10/2014 11 50	73.61000275
12/10/2014 12 00	73.86000276
12/10/2014 12 57	73.98000277
12/10/2014 13 40	73.98000277
12/10/2014 14 29	73.77000276
12/10/2014 15 54	73.49000275
12/10/2014 16 21	73.43000275
12/10/2014 17 34	72.73000272
12/10/2014 18 48	72.2400027
12/10/2014 19 21	72.1200027
12/10/2014 20 24	72.76000272
12/10/2014 21 25	72.85000273
12/10/2014 22 01	73.34000274
12/10/2014 23 01	74.8000028
12/11/2014 0 41	73.77000276
12/11/2014 1 40	74.25000278
12/11/2014 2 44	74.68000279
12/11/2014 3 56	74.8900028
12/11/2014 4 01	75.26000282
12/11/2014 5 56	73.40000275
12/11/2014 6 53	71.02000266
12/11/2014 7 08	70.68000265
12/11/2014 8 06	72.48000271
12/11/2014 9 36	73.28000274
12/11/2014 10 08	73.37000275
12/11/2014 11 29	73.61000275
12/11/2014 12 20	73.86000276
12/11/2014 13 51	73.67000276
12/11/2014 14 24	73.89000277
12/11/2014 15 07	73.46000275
12/11/2014 16 27	73.52000275
12/11/2014 17 58	72.70000272
12/11/2014 18 57	72.48000271
12/11/2014 19 53	72.2400027
12/11/2014 20 00	72.97000273
12/11/2014 21 04	72.64000272
12/11/2014 22 19	73.40000275
12/11/2014 23 00	74.16000278
12/12/2014 0 11	75.17000281
12/12/2014 1 02	72.85000273
12/12/2014 2 26	75.14000281
12/12/2014 3 57	75.20000281
12/12/2014 4 53	75.29000282
12/12/2014 5 59	73.98000277
12/12/2014 6 38	71.42000267
12/12/2014 7 08	70.84000265
12/12/2014 8 11	72.51000271
12/12/2014 9 44	73.00000273
12/12/2014 10 03	72.58000272
12/12/2014 11 09	73.61000275
12/12/2014 12 41	73.64000276
12/12/2014 13 39	73.25000274
12/12/2014 14 54	73.43000275
12/12/2014 15 45	73.61000275
12/12/2014 16 28	73.12000274
12/12/2014 17 44	72.91000273
12/12/2014 18 14	72.73000272

12/8/2014 21 00	73.22
12/8/2014 22 01	73.29
12/8/2014 23 31	75.24
12/9/2014 0 21	75.15
12/9/2014 1 06	75.06
12/9/2014 2 22	75.54
12/9/2014 3 10	75.45
12/9/2014 4 47	74.75
12/9/2014 5 56	74.35
12/9/2014 6 53	73.19
12/9/2014 7 12	72.52
12/9/2014 8 17	72.92
12/9/2014 9 01	73.13
12/9/2014 10 20	73.1
12/9/2014 11 03	72.89
12/9/2014 12 45	73.56
12/9/2014 13 17	73.19
12/9/2014 14 30	73.56
12/9/2014 15 15	73.65
12/9/2014 16 36	73.04
12/9/2014 17 40	72.8
12/9/2014 18 05	72.86
12/9/2014 19 18	72.92
12/9/2014 20 20	72.98
12/9/2014 21 04	73.26
12/9/2014 22 02	73.59
12/9/2014 23 07	73.29
12/10/2014 0 18	73.62
12/10/2014 1 17	74.26
12/10/2014 2 19	75
12/10/2014 3 15	75.21
12/10/2014 4 55	74.75
12/10/2014 5 53	73.1
12/10/2014 6 36	72.46
12/10/2014 7 35	72.55
12/10/2014 8 03	73.13
12/10/2014 9 09	73.71
12/10/2014 10 24	73.01
12/10/2014 11 31	73.1
12/10/2014 12 19	73.13
12/10/2014 12 37	72.98
12/10/2014 12 54	73.22
12/10/2014 13 58	72.71
12/10/2014 14 00	72.71
12/10/2014 15 38	73.32
12/10/2014 16 47	73.01
12/10/2014 17 40	72.64
12/10/2014 18 00	72.95
12/10/2014 19 18	72.92
12/10/2014 20 01	72.86
12/10/2014 21 16	73.38
12/10/2014 22 31	73.8
12/10/2014 23 14	74.54
12/11/2014 0 40	74.2
12/11/2014 1 27	75.54
12/11/2014 2 12	74.45
12/11/2014 3 56	75.15
12/11/2014 4 38	75.15
12/11/2014 5 56	74.26
12/11/2014 6 07	73.16
12/11/2014 7 18	72.49
12/11/2014 8 09	72.89
12/11/2014 9 13	73.62
12/11/2014 10 29	73.41
12/11/2014 11 29	72.83
12/11/2014 12 20	73.56
12/11/2014 13 24	73.71
12/11/2014 14 29	73.5
12/11/2014 15 03	73.22
12/11/2014 16 40	73.35
12/11/2014 17 44	73.01
12/11/2014 18 03	72.64
12/11/2014 19 59	72.74
12/11/2014 20 00	72.74
12/11/2014 21 39	73.5
12/11/2014 22 43	73.5
12/11/2014 23 38	74.2
12/12/2014 0 23	74.57
12/12/2014 1 07	74.26
12/12/2014 2 02	75.33
12/12/2014 3 28	75.82
12/12/2014 4 28	75.3
12/12/2014 5 55	74.72
12/12/2014 6 38	72.86
12/12/2014 7 16	72.25
12/12/2014 8 14	72.55
12/12/2014 9 16	72.83
12/12/2014 10 50	72.95
12/12/2014 11 05	73.44
12/12/2014 12 51	73.77
12/12/2014 13 40	74.05
12/12/2014 14 19	73.41
12/12/2014 15 28	73.44
12/12/2014 16 28	73.26
12/12/2014 17 34	73.32

12/12/2014 19 44	71.42000246
12/12/2014 20 11	71.36000246
12/12/2014 21 26	72.83000251
12/12/2014 22 43	72.4600025
12/12/2014 23 04	73.74000254
12/13/2014 0 23	70.66000244
12/13/2014 1 00	74.05000255
12/13/2014 2 03	74.11000255
12/13/2014 3 01	74.96000258
12/13/2014 4 48	69.10000238
12/13/2014 5 36	74.57000257
12/13/2014 6 48	73.62000254
12/13/2014 7 02	72.40000249
12/13/2014 8 57	70.84000244
12/13/2014 9 18	71.55000247
12/13/2014 10 30	70.97000245
12/13/2014 11 36	70.84000244
12/13/2014 12 11	69.20000239
12/13/2014 13 27	69.84000241
12/13/2014 14 08	69.75000241
12/13/2014 15 15	69.20000239
12/13/2014 16 13	71.39000246
12/13/2014 17 07	72.4300025
12/13/2014 18 54	72.16000249
12/13/2014 19 48	73.01000252
12/13/2014 20 37	73.16000252
12/13/2014 21 39	73.07000252
12/13/2014 22 06	73.77000254
12/13/2014 23 49	70.11000242
12/14/2014 0 01	73.29000252
12/14/2014 1 03	73.68000254
12/14/2014 2 30	71.94000248
12/14/2014 3 57	73.96000255
12/14/2014 4 01	75.5800026
12/14/2014 5 20	74.78000257
12/14/2014 6 49	73.87000254
12/14/2014 7 22	72.6500025
12/14/2014 8 41	71.52000247
12/14/2014 9 33	71.49000246
12/14/2014 10 19	71.33000246
12/14/2014 11 12	71.30000246
12/14/2014 12 13	71.58000247
12/14/2014 13 42	70.63000244
12/14/2014 14 55	71.55000247
12/14/2014 15 46	70.72000244
12/14/2014 16 21	71.94000248
12/14/2014 17 50	71.55000247
12/14/2014 18 18	72.16000249
12/14/2014 19 47	72.37000249
12/14/2014 20 41	72.03000248
12/14/2014 21 05	72.5500025
12/14/2014 22 11	73.10000252
12/14/2014 23 54	72.40000249
12/15/2014 0 00	73.38000253
12/15/2014 1 14	74.05000255
12/15/2014 2 00	74.54000257
12/15/2014 3 47	74.08000255
12/15/2014 4 34	73.59000253
12/15/2014 5 48	72.16000249
12/15/2014 6 50	71.79000247
12/15/2014 7 04	71.49000246
12/15/2014 8 10	71.21000246
12/15/2014 9 18	71.24000246
12/15/2014 10 40	72.13000249
12/15/2014 11 52	70.29000242
12/15/2014 12 07	70.75000244
12/15/2014 13 30	71.73000247
12/15/2014 14 27	71.82000248
12/15/2014 15 42	72.10000248
12/15/2014 16 17	69.96000241
12/15/2014 17 48	69.04000238
12/15/2014 18 15	71.64000247
12/15/2014 19 11	70.48000243
12/15/2014 20 54	71.55000247
12/15/2014 21 00	72.16000249
12/15/2014 22 00	72.13000249
12/15/2014 23 51	71.73000247
12/16/2014 0 00	72.83000251
12/16/2014 1 01	74.72000257
12/16/2014 2 54	74.45000256
12/16/2014 3 04	75.21000259
12/16/2014 4 53	74.26000256
12/16/2014 5 35	72.5200025
12/16/2014 6 47	71.45000246
12/16/2014 7 25	70.63000244
12/16/2014 8 03	69.7100024
12/16/2014 9 36	71.64000247
12/16/2014 10 31	72.10000248
12/16/2014 11 42	71.18000245
12/16/2014 12 25	70.75000244
12/16/2014 13 01	71.88000248
12/16/2014 14 28	70.57000243
12/16/2014 15 50	71.55000247
12/16/2014 16 11	71.36000246
12/16/2014 17 40	70.57000243

12/12/2014 19 42	68.30000063
12/12/2014 20 31	68.85000064
12/12/2014 21 17	68.63000064
12/12/2014 22 10	69.64000065
12/12/2014 23 05	69.18000064
12/13/2014 0 23	69.43000065
12/13/2014 1 00	70.95000066
12/13/2014 2 45	71.32000066
12/13/2014 3 00	71.38000066
12/13/2014 4 47	58.44000054 A
12/13/2014 5 26	71.01000066
12/13/2014 6 51	70.43000065
12/13/2014 7 55	69.03000064
12/13/2014 8 54	66.71000062
12/13/2014 9 42	66.04000061
12/13/2014 10 31	65.70000061
12/13/2014 11 01	65.64000061
12/13/2014 12 10	52.03000048 A
12/13/2014 13 02	66.59000062
12/13/2014 14 16	65.25000061
12/13/2014 15 00	66.31000062
12/13/2014 16 02	66.37000062
12/13/2014 17 00	67.60000063
12/13/2014 18 03	68.21000063
12/13/2014 19 23	68.45000064
12/13/2014 20 06	68.85000064
12/13/2014 21 00	69.37000064
12/13/2014 22 34	66.77000062
12/13/2014 23 50	70.34000065
12/14/2014 0 22	70.53000066
12/14/2014 1 02	71.23000066
12/14/2014 2 04	71.63000067
12/14/2014 3 06	71.66000067
12/14/2014 4 40	71.78000067
12/14/2014 5 35	71.53000067
12/14/2014 6 14	70.68000066
12/14/2014 7 57	69.46000065
12/14/2014 8 47	67.57000063
12/14/2014 9 58	66.13000061
12/14/2014 10 36	65.0000006
12/14/2014 11 08	65.55000061
12/14/2014 12 36	65.92000061
12/14/2014 13 08	65.28000061
12/14/2014 14 00	67.02000062
12/14/2014 15 14	66.99000062
12/14/2014 16 31	67.02000062
12/14/2014 17 04	67.14000062
12/14/2014 18 23	66.50000062
12/14/2014 19 01	67.11000062
12/14/2014 20 59	67.53000063
12/14/2014 21 00	67.53000063
12/14/2014 22 00	69.24000064
12/14/2014 23 00	70.34000065
12/15/2014 0 01	70.89000066
12/15/2014 1 23	70.68000066
12/15/2014 2 04	70.95000066
12/15/2014 3 50	70.56000066
12/15/2014 4 35	70.68000066
12/15/2014 5 49	69.49000065
12/15/2014 6 36	67.38000063
12/15/2014 7 06	66.25000061
12/15/2014 8 06	66.68000062
12/15/2014 9 15	67.44000063
12/15/2014 10 01	67.50000063
12/15/2014 11 25	67.23000062
12/15/2014 12 53	68.11000063
12/15/2014 13 01	67.69000063
12/15/2014 14 26	68.30000063
12/15/2014 15 47	67.50000063
12/15/2014 16 17	67.02000062
12/15/2014 17 44	67.20000062
12/15/2014 18 28	66.83000062
12/15/2014 19 26	65.86000061
12/15/2014 20 28	67.02000062
12/15/2014 21 00	67.63000063
12/15/2014 22 00	68.15000063
12/15/2014 23 02	70.16000065
12/16/2014 0 07	70.01000065
12/16/2014 1 24	70.50000066
12/16/2014 2 15	71.84000067
12/16/2014 3 11	71.75000067
12/16/2014 4 22	70.62000066
12/16/2014 5 59	68.76000064
12/16/2014 6 47	66.68000062
12/16/2014 7 23	65.52000061
12/16/2014 8 00	67.32000062
12/16/2014 9 33	67.63000063
12/16/2014 10 04	67.93000063
12/16/2014 11 13	65.55000061
12/16/2014 12 07	67.41000063
12/16/2014 13 18	68.24000063
12/16/2014 14 40	68.24000063
12/16/2014 15 19	67.84000063
12/16/2014 16 50	67.69000063
12/16/2014 17 03	67.20000062

12/12/2014 18 06	71.98999774
12/12/2014 19 11	72.01999774
12/12/2014 20 16	71.34999776
12/12/2014 21 08	71.15999776
12/12/2014 22 00	71.89999774
12/12/2014 23 07	72.74999771
12/13/2014 0 22	73.1199977
12/13/2014 1 01	73.56999769
12/13/2014 2 08	73.47999769
12/13/2014 3 25	73.96999768
12/13/2014 4 47	69.23999782
12/13/2014 5 00	73.75999768
12/13/2014 6 22	73.01999771
12/13/2014 7 49	72.59999772
12/13/2014 8 51	71.21999776
12/13/2014 9 49	70.82999777
12/13/2014 10 08	70.0899978
12/13/2014 11 02	70.18999779
12/13/2014 12 11	69.14999783
12/13/2014 13 48	70.63999778
12/13/2014 14 07	70.82999777
12/13/2014 15 16	69.66999781
12/13/2014 16 27	71.46999775
12/13/2014 17 25	70.88999777
12/13/2014 18 43	68.47999785
12/13/2014 19 22	70.94999777
12/13/2014 20 00	72.31999773
12/13/2014 21 21	72.59999772
12/13/2014 22 34	72.25999773
12/13/2014 23 49	72.37999773
12/14/2014 0 37	72.74999771
12/14/2014 1 17	73.2699977
12/14/2014 2 11	73.75999768
12/14/2014 3 17	74.11999767
12/14/2014 4 38	74.14999767
12/14/2014 5 29	73.56999769
12/14/2014 6 49	73.50999769
12/14/2014 7 08	72.80999771
12/14/2014 8 46	71.55999775
12/14/2014 9 09	70.76999778
12/14/2014 10 30	70.42999779
12/14/2014 11 03	70.60999778
12/14/2014 12 00	70.39999779
12/14/2014 13 35	71.43999775
12/14/2014 14 13	71.24999776
12/14/2014 15 00	72.13999773
12/14/2014 16 29	71.46999775
12/14/2014 17 50	71.21999776
12/14/2014 18 14	71.00999777
12/14/2014 19 20	71.12999776
12/14/2014 20 40	71.64999775
12/14/2014 21 13	71.89999774
12/14/2014 22 01	71.89999774
12/14/2014 23 55	71.95999774
12/15/2014 0 53	73.2699977
12/15/2014 1 11	73.2699977
12/15/2014 2 26	73.50999769
12/15/2014 3 49	73.0599977
12/15/2014 4 56	73.0599977
12/15/2014 5 07	73.1499977
12/15/2014 6 57	71.46999775
12/15/2014 7 21	70.51999778
12/15/2014 8 11	70.21999779
12/15/2014 9 30	70.51999778
12/15/2014 10 28	70.18999779
12/15/2014 11 55	70.39999779
12/15/2014 12 36	71.52999775
12/15/2014 13 02	70.70999778
12/15/2014 14 00	71.24999776
12/15/2014 15 26	71.52999775
12/15/2014 16 15	70.66999778
12/15/2014 17 00	70.94999777
12/15/2014 18 50	71.03999777
12/15/2014 19 33	71.28999776
12/15/2014 20 29	71.00999777
12/15/2014 21 01	70.85999777
12/15/2014 22 03	72.10999773
12/15/2014 23 50	72.22999773
12/16/2014 0 04	73.41999769
12/16/2014 1 46	73.66999769
12/16/2014 2 27	74.05999767
12/16/2014 3 08	73.47999769
12/16/2014 4 57	73.1199977
12/16/2014 5 32	73.1199977
12/16/2014 6 11	72.13999773
12/16/2014 7 49	70.27999779
12/16/2014 8 08	70.76999778
12/16/2014 9 31	71.15999776
12/16/2014 10 22	71.03999777
12/16/2014 11 12	71.03999777
12/16/2014 12 55	71.09999776
12/16/2014 13 38	71.28999776
12/16/2014 14 08	71.21999776
12/16/2014 15 40	70.97999777
12/16/2014 16 45	71.18999776

12/12/2014 18 26	70.05
12/12/2014 19 44	68.34
12/12/2014 20 32	70.39
12/12/2014 21 59	70.57
12/12/2014 22 00	70.57
12/12/2014 23 00	71.58
12/13/2014 0 23	68.49
12/13/2014 1 16	71.58
12/13/2014 2 08	70.84
12/13/2014 3 59	72
12/13/2014 4 47	70.48
12/13/2014 5 39	71.79
12/13/2014 6 49	71.15
12/13/2014 7 18	70.39
12/13/2014 8 46	70.11
12/13/2014 9 52	69.71
12/13/2014 10 39	68.07
12/13/2014 11 00	68.68
12/13/2014 12 27	69.35
12/13/2014 13 37	69.84
12/13/2014 14 08	70.11
12/13/2014 15 26	69.9
12/13/2014 16 26	70.11
12/13/2014 17 07	70.32
12/13/2014 18 54	69.99
12/13/2014 19 21	70.42
12/13/2014 20 29	70.66
12/13/2014 21 24	71.15
12/13/2014 22 06	71.12
12/13/2014 23 49	67.7
12/14/2014 0 21	71.09
12/14/2014 1 11	71.58
12/14/2014 2 32	71.82
12/14/2014 3 11	72
12/14/2014 4 01	72.31
12/14/2014 5 20	71.82
12/14/2014 6 55	71.45
12/14/2014 7 17	70.72
12/14/2014 8 17	69.93
12/14/2014 9 40	69.59
12/14/2014 10 00	69.78
12/14/2014 11 05	69.99
12/14/2014 12 03	69.93
12/14/2014 13 22	70.29
12/14/2014 14 36	70.17
12/14/2014 15 00	70.57
12/14/2014 16 38	70.08
12/14/2014 17 01	69.62
12/14/2014 18 39	70.26
12/14/2014 19 02	70.14
12/14/2014 20 18	70.39
12/14/2014 21 02	70.2
12/14/2014 22 00	70.78
12/14/2014 23 55	70.14
12/15/2014 0 00	70.69
12/15/2014 1 14	71.15
12/15/2014 2 04	70.69
12/15/2014 3 45	71.24
12/15/2014 4 34	71.36
12/15/2014 5 49	69.87
12/15/2014 6 50	69.74
12/15/2014 7 33	69.68
12/15/2014 8 22	68.49
12/15/2014 9 47	70.08
12/15/2014 10 36	70.39
12/15/2014 11 13	69.65
12/15/2014 12 26	69.01
12/15/2014 13 43	70.08
12/15/2014 14 45	70.08
12/15/2014 15 16	70.14
12/15/2014 16 53	69.93
12/15/2014 17 52	69.99
12/15/2014 18 19	69.07
12/15/2014 19 23	69.68
12/15/2014 20 04	69.99
12/15/2014 21 11	69.96
12/15/2014 22 04	70.26
12/15/2014 23 51	69.53
12/16/2014 0 07	70.54
12/16/2014 1 11	71.76
12/16/2014 2 07	71.91
12/16/2014 3 08	71.06
12/16/2014 4 53	70.94
12/16/2014 5 08	71.3
12/16/2014 6 41	69.96
12/16/2014 7 22	69.26
12/16/2014 8 03	69.04
12/16/2014 9 40	69.59
12/16/2014 10 35	69.71
12/16/2014 11 21	68.92
12/16/2014 12 08	70.23
12/16/2014 13 32	69.9
12/16/2014 14 28	69.32
12/16/2014 15 49	69.81
12/16/2014 16 29	70.26

12/12/2014 18 51	67.09000246
12/12/2014 19 44	67.24000246
12/12/2014 20 32	67.73000248
12/12/2014 21 01	68.1300025
12/12/2014 22 43	68.43000251
12/12/2014 23 04	68.83000252
12/13/2014 0 23	64.83000238
12/13/2014 1 01	68.40000251
12/13/2014 2 02	69.11000253
12/13/2014 3 36	69.56000255
12/13/2014 4 48	63.46000233
12/13/2014 5 00	69.04000253
12/13/2014 6 50	67.85000249
12/13/2014 7 17	66.79000245
12/13/2014 8 33	67.49000247
12/13/2014 9 14	67.30000247
12/13/2014 10 22	67.09000246
12/13/2014 11 05	67.09000246
12/13/2014 12 11	66.17000243
12/13/2014 13 21	67.21000246
12/13/2014 14 19	67.58000248
12/13/2014 15 15	65.23000239
12/13/2014 16 24	67.55000248
12/13/2014 17 03	67.79000248
12/13/2014 18 09	68.1900025
12/13/2014 19 07	68.2800025
12/13/2014 20 02	68.46000251
12/13/2014 21 11	68.43000251
12/13/2014 22 38	68.04000249
12/13/2014 23 49	65.66000241
12/14/2014 0 01	67.55000248
12/14/2014 1 24	68.01000249
12/14/2014 2 06	69.32000254
12/14/2014 3 57	68.43000251
12/14/2014 4 28	69.56000255
12/14/2014 5 20	69.29000254
12/14/2014 6 59	68.49000251
12/14/2014 7 24	67.00000246
12/14/2014 8 10	67.00000246
12/14/2014 9 41	67.55000248
12/14/2014 10 55	67.21000246
12/14/2014 11 47	67.27000247
12/14/2014 12 03	67.67000248
12/14/2014 13 01	67.79000248
12/14/2014 14 01	67.85000249
12/14/2014 15 46	66.51000244
12/14/2014 16 25	67.67000248
12/14/2014 17 25	67.85000249
12/14/2014 18 23	67.24000246
12/14/2014 19 24	67.49000247
12/14/2014 20 06	67.91000249
12/14/2014 21 13	68.1900025
12/14/2014 22 03	68.43000251
12/14/2014 23 54	66.82000245
12/15/2014 0 00	67.64000248
12/15/2014 1 10	68.3400025
12/15/2014 2 00	68.86000252
12/15/2014 3 44	68.46000251
12/15/2014 4 57	68.80000252
12/15/2014 5 48	66.27000243
12/15/2014 6 34	67.58000248
12/15/2014 7 40	67.27000247
12/15/2014 8 23	66.27000243
12/15/2014 9 18	66.91000245
12/15/2014 10 00	67.64000248
12/15/2014 11 52	65.72000241
12/15/2014 12 11	67.09000246
12/15/2014 13 30	67.21000246
12/15/2014 14 01	68.1300025
12/15/2014 15 58	67.76000248
12/15/2014 16 58	67.24000246
12/15/2014 17 49	66.33000243
12/15/2014 18 15	66.79000245
12/15/2014 19 11	67.06000246
12/15/2014 20 45	67.55000248
12/15/2014 21 48	67.67000248
12/15/2014 22 08	67.27000247
12/15/2014 23 49	66.72000245
12/16/2014 0 03	67.21000246
12/16/2014 1 22	69.17000254
12/16/2014 2 04	69.07000253
12/16/2014 3 04	69.35000254
12/16/2014 4 53	67.46000247
12/16/2014 5 35	66.79000245
12/16/2014 6 47	67.21000246
12/16/2014 7 26	66.85000245
12/16/2014 8 03	66.27000243
12/16/2014 9 53	65.17000239
12/16/2014 10 12	67.24000246
12/16/2014 11 20	66.39000243
12/16/2014 12 00	67.03000246
12/16/2014 13 24	67.18000246
12/16/2014 14 28	65.3800024
12/16/2014 15 45	66.42000243
12/16/2014 16 29	66.97000245

12/12/2014 19 00	76.54000144
12/12/2014 20 00	76.54000144
12/12/2014 21 00	76.54000144
12/12/2014 22 00	76.54000144
12/12/2014 23 00	76.54000144
12/13/2014 0 00	76.54000144
12/13/2014 1 00	76.54000144
12/13/2014 2 00	76.54000144
12/13/2014 3 00	76.54000144
12/13/2014 4 00	76.54000144
12/13/2014 5 00	76.54000144
12/13/2014 6 00	76.54000144
12/13/2014 7 00	76.54000144
12/13/2014 8 00	76.54000144
12/13/2014 9 00	76.54000144
12/13/2014 10 00	76.54000144
12/13/2014 11 00	76.54000144
12/13/2014 12 00	76.54000144
12/13/2014 13 00	76.54000144
12/13/2014 14 00	76.54000144
12/13/2014 15 00	76.54000144
12/13/2014 16 00	76.54000144
12/13/2014 17 00	76.54000144
12/13/2014 18 00	76.54000144
12/13/2014 19 00	76.54000144
12/13/2014 20 00	76.54000144
12/13/2014 21 00	76.54000144
12/13/2014 22 00	76.54000144
12/13/2014 23 00	76.54000144
12/14/2014 0 00	76.54000144
12/14/2014 1 00	76.54000144
12/14/2014 2 00	76.54000144
12/14/2014 3 00	76.54000144
12/14/2014 4 00	76.54000144
12/14/2014 5 00	76.54000144
12/14/2014 6 00	76.54000144
12/14/2014 7 00	76.54000144
12/14/2014 8 00	76.54000144
12/14/2014 9 00	76.54000144
12/14/2014 10 00	76.54000144
12/14/2014 11 00	76.54000144
12/14/2014 12 00	76.54000144
12/14/2014 13 00	76.54000144
12/14/2014 14 00	76.54000144
12/14/2014 15 00	76.54000144
12/14/2014 16 00	76.54000144
12/14/2014 17 00	76.54000144
12/14/2014 18 00	76.54000144
12/14/2014 19 00	76.54000144
12/14/2014 20 00	76.54000144
12/14/2014 21 00	76.54000144
12/14/2014 22 00	76.54000144
12/14/2014 23 00	76.54000144
12/15/2014 0 00	76.54000144
12/15/2014 1 00	76.54000144
12/15/2014 2 00	76.54000144
12/15/2014 3 00	76.54000144
12/15/2014 4 00	76.54000144
12/15/2014 5 00	76.54000144
12/15/2014 6 00	76.54000144
12/15/2014 7 00	76.54000144
12/15/2014 8 00	76.54000144
12/15/2014 9 00	76.54000144
12/15/2014 10 00	76.54000144
12/15/2014 11 00	76.54000144
12/15/2014 12 00	76.54000144
12/15/2014 13 00	76.54000144
12/15/2014 14 00	76.54000144
12/15/2014 15 00	76.54000144
12/15/2014 16 00	76.54000144
12/15/2014 17 00	76.54000144
12/15/2014 18 00	76.54000144
12/15/2014 19 00	76.54000144
12/15/2014 20 00	76.54000144
12/15/2014 21 00	76.54000144
12/15/2014 22 00	76.54000144
12/15/2014 23 00	76.54000144
12/16/2014 0 00	76.54000144
12/16/2014 1 00	76.54000144
12/16/2014 2 00	76.54000144
12/16/2014 3 00	76.54000144
12/16/2014 4 00	76.54000144
12/16/2014 5 00	76.54000144
12/16/2014 6 00	76.54000144
12/16/2014 7 00	76.54000144
12/16/2014 8 00	76.54000144
12/16/2014 9 00	76.54000144
12/16/2014 10 00	76.54000144
12/16/2014 11 00	76.54000144
12/16/2014 12 00	76.54000144
12/16/2014 13 00	76.54000144
12/16/2014 14 00	76.54000144
12/16/2014 15 00	76.54000144
12/16/2014 16 00	76.54000144
12/16/2014 17 00	76.54000144

12/12/2014 19 44	70.76999821
12/12/2014 20 49	71.61999819
12/12/2014 21 12	71.1899982
12/12/2014 22 43	71.82999818
12/12/2014 23 03	72.37999817
12/13/2014 0 23	68.47999826
12/13/2014 1 11	72.22999817
12/13/2014 2 03	71.82999818
12/13/2014 3 42	72.74999816
12/13/2014 4 48	68.01999827
12/13/2014 5 39	72.50999817
12/13/2014 6 59	71.0699982
12/13/2014 7 14	70.48999822
12/13/2014 8 32	71.61999819
12/13/2014 9 32	71.61999819
12/13/2014 10 52	71.1599982
12/13/2014 11 25	71.73999819
12/13/2014 12 11	70.88999821
12/13/2014 13 12	71.46999819
12/13/2014 14 01	71.70999819
12/13/2014 15 15	69.14999825
12/13/2014 16 02	71.2799982
12/13/2014 17 08	71.79999818
12/13/2014 18 42	70.36999822
12/13/2014 19 13	72.07999818
12/13/2014 20 01	72.13999818
12/13/2014 21 57	72.28999817
12/13/2014 22 34	71.95999818
12/13/2014 23 50	68.34999827
12/14/2014 0 01	71.2499982
12/14/2014 1 02	72.16999818
12/14/2014 2 25	72.89999816
12/14/2014 3 57	72.77999816
12/14/2014 4 05	73.29999815
12/14/2014 5 20	72.68999816
12/14/2014 6 29	72.13999818
12/14/2014 7 23	71.0699982
12/14/2014 8 41	71.43999819
12/14/2014 9 50	71.43999819
12/14/2014 10 31	71.52999819
12/14/2014 11 01	71.76999819
12/14/2014 12 04	71.89999818
12/14/2014 13 07	71.85999818
12/14/2014 14 13	72.04999818
12/14/2014 15 45	69.75999823
12/14/2014 16 06	71.70999819
12/14/2014 17 16	71.82999818
12/14/2014 18 22	71.98999818
12/14/2014 19 09	71.76999819
12/14/2014 20 01	72.10999818
12/14/2014 21 17	70.85999821
12/14/2014 22 14	72.28999817
12/14/2014 23 54	68.74999826
12/15/2014 0 00	71.1599982
12/15/2014 1 14	71.79999818
12/15/2014 2 03	71.92999818
12/15/2014 3 44	72.47999817
12/15/2014 4 56	71.3199982
12/15/2014 5 50	70.02999823
12/15/2014 6 53	71.2799982
12/15/2014 7 17	71.2799982
12/15/2014 8 19	68.65999826
12/15/2014 9 58	70.91999821
12/15/2014 10 02	70.66999821
12/15/2014 11 52	70.30999822
12/15/2014 12 08	70.82999821
12/15/2014 13 01	70.69999821
12/15/2014 14 27	71.37999819
12/15/2014 15 52	71.2499982
12/15/2014 16 21	71.1899982
12/15/2014 17 48	70.79999821
12/15/2014 18 19	70.9499982
12/15/2014 19 23	71.1899982
12/15/2014 20 44	70.79999821
12/15/2014 21 02	71.2199982
12/15/2014 22 04	71.49999819
12/15/2014 23 50	68.74999826
12/16/2014 0 07	70.57999821
12/16/2014 1 24	72.01999818
12/16/2014 2 04	72.74999816
12/16/2014 3 07	71.79999818
12/16/2014 4 53	71.61999819
12/16/2014 5 36	70.39999822
12/16/2014 6 47	71.3199982
12/16/2014 7 49	71.0699982
12/16/2014 8 03	70.39999822
12/16/2014 9 36	70.18999822
12/16/2014 10 12	70.85999821
12/16/2014 11 16	70.48999822
12/16/2014 12 00	70.57999821
12/16/2014 13 46	70.73999821
12/16/2014 14 29	69.47999824
12/16/2014 15 45	70.54999821
12/16/2014 16 33	71.2199982
12/16/2014 17 15	71.1599982

12/12/2014 19 44	71.18000199
12/12/2014 20 44	73.90000207
12/12/2014 21 12	73.35000205
12/12/2014 22 02	73.84000207
12/12/2014 23 04	74.72000209
12/13/2014 0 23	73.19000205
12/13/2014 1 45	74.75000209
12/13/2014 2 07	74.39000208
12/13/2014 3 04	74.9300021
12/13/2014 4 53	73.84000207
12/13/2014 5 00	74.9700021
12/13/2014 6 08	74.8700021
12/13/2014 7 24	74.02000207
12/13/2014 8 32	73.29000205
12/13/2014 9 45	72.65000203
12/13/2014 10 19	72.71000203
12/13/2014 11 04	72.77000204
12/13/2014 12 11	70.23000196
12/13/2014 13 06	72.49000203
12/13/2014 14 35	73.35000205
12/13/2014 15 15	72.71000203
12/13/2014 16 43	73.38000205
12/13/2014 17 33	73.38000205
12/13/2014 18 43	71.73000201
12/13/2014 19 33	73.77000206
12/13/2014 20 46	74.02000207
12/13/2014 21 24	74.20000208
12/13/2014 22 33	74.05000207
12/13/2014 23 50	72.95000204
12/14/2014 0 16	74.51000209
12/14/2014 1 12	74.78000209
12/14/2014 2 06	74.69000209
12/14/2014 3 58	74.9000021
12/14/2014 4 00	74.9000021
12/14/2014 5 30	75.0900021
12/14/2014 6 40	74.9300021
12/14/2014 7 59	74.20000208
12/14/2014 8 41	72.92000204
12/14/2014 9 49	72.98000204
12/14/2014 10 16	73.23000205
12/14/2014 11 00	73.10000205
12/14/2014 12 42	72.83000204
12/14/2014 13 03	72.55000203
12/14/2014 14 14	73.29000205
12/14/2014 15 41	73.65000206
12/14/2014 16 41	73.53000206
12/14/2014 17 21	73.56000206
12/14/2014 18 24	73.47000206
12/14/2014 19 20	73.38000205
12/14/2014 20 03	73.38000205
12/14/2014 21 17	73.07000204
12/14/2014 22 08	73.84000207
12/14/2014 23 56	74.20000208
12/15/2014 0 58	74.57000209
12/15/2014 1 11	74.23000208
12/15/2014 2 22	74.17000208
12/15/2014 3 15	74.81000209
12/15/2014 4 35	74.39000208
12/15/2014 5 49	74.35000208
12/15/2014 6 35	73.13000205
12/15/2014 7 58	73.35000205
12/15/2014 8 20	73.07000204
12/15/2014 9 15	72.98000204
12/15/2014 10 55	72.71000203
12/15/2014 11 49	72.25000202
12/15/2014 12 36	72.68000203
12/15/2014 13 02	72.71000203
12/15/2014 14 27	73.29000205
12/15/2014 15 51	73.26000205
12/15/2014 16 26	73.56000206
12/15/2014 17 56	73.29000205
12/15/2014 18 50	73.16000205
12/15/2014 19 27	73.44000205
12/15/2014 20 44	70.97000198
12/15/2014 21 02	72.71000203
12/15/2014 22 32	73.81000207
12/15/2014 23 50	72.98000204
12/16/2014 0 07	74.26000208
12/16/2014 1 00	75.0000021
12/16/2014 2 29	75.1500021
12/16/2014 3 08	74.9700021
12/16/2014 4 57	74.75000209
12/16/2014 5 32	74.54000209
12/16/2014 6 11	73.50000206
12/16/2014 7 22	72.89000204
12/16/2014 8 02	73.23000205
12/16/2014 9 21	73.07000204
12/16/2014 10 00	73.32000205
12/16/2014 11 27	72.95000204
12/16/2014 12 34	73.13000205
12/16/2014 13 21	72.83000204
12/16/2014 14 05	73.19000205
12/16/2014 15 49	73.41000205
12/16/2014 16 15	73.41000205
12/16/2014 17 22	72.83000204

12/12/2014 19 45	68.91999914
12/12/2014 20 13	69.74999913
12/12/2014 21 01	69.95999912
12/12/2014 22 24	70.44999912
12/12/2014 23 07	70.22999912
12/13/2014 0 24	70.32999912
12/13/2014 1 21	72.33999909
12/13/2014 2 08	71.5199991
12/13/2014 3 08	72.2799991
12/13/2014 4 47	60.55999923 A
12/13/2014 5 40	72.0999991
12/13/2014 6 03	71.7299991
12/13/2014 7 58	69.67999913
12/13/2014 8 54	67.48999915
12/13/2014 9 40	66.71999916
12/13/2014 10 40	66.35999917
12/13/2014 11 17	66.04999917
12/13/2014 12 11	55.60999929 A
12/13/2014 13 40	67.78999915
12/13/2014 14 16	67.84999915
12/13/2014 15 16	67.81999915
12/13/2014 16 34	68.03999915
12/13/2014 17 08	67.90999915
12/13/2014 18 53	68.51999914
12/13/2014 19 02	69.49999913
12/13/2014 20 03	70.13999912
12/13/2014 21 14	69.98999912
12/13/2014 22 33	67.39999915
12/13/2014 23 50	69.67999913
12/14/2014 0 17	71.4899991
12/14/2014 1 29	72.1899991
12/14/2014 2 25	72.64999909
12/14/2014 3 17	72.82999909
12/14/2014 4 07	73.00999909
12/14/2014 5 58	72.61999909
12/14/2014 6 59	72.1599991
12/14/2014 7 55	70.16999912
12/14/2014 8 59	67.84999915
12/14/2014 9 57	65.77999917
12/14/2014 10 18	65.68999917
12/14/2014 11 05	65.89999917
12/14/2014 12 26	66.44999916
12/14/2014 13 06	67.11999916
12/14/2014 14 03	68.03999915
12/14/2014 15 24	67.97999915
12/14/2014 16 35	68.12999914
12/14/2014 17 51	68.15999914
12/14/2014 18 36	67.60999915
12/14/2014 19 23	66.68999916
12/14/2014 20 03	67.90999915
12/14/2014 21 18	68.21999914
12/14/2014 22 03	69.61999913
12/14/2014 23 01	71.02999911
12/15/2014 0 58	71.7899991
12/15/2014 1 15	71.7899991
12/15/2014 2 22	72.1299991
12/15/2014 3 49	72.57999909
12/15/2014 4 35	71.9099991
12/15/2014 5 54	70.74999911
12/15/2014 6 59	67.11999916
12/15/2014 7 17	66.32999917
12/15/2014 8 01	68.21999914
12/15/2014 9 08	68.64999914
12/15/2014 10 02	68.67999914
12/15/2014 11 52	69.03999913
12/15/2014 12 15	69.55999913
12/15/2014 13 13	69.46999913
12/15/2014 14 04	70.25999912
12/15/2014 15 55	69.77999913
12/15/2014 16 45	68.55999914
12/15/2014 17 01	68.42999914
12/15/2014 18 29	67.66999915
12/15/2014 19 32	68.30999914
12/15/2014 20 45	68.24999914
12/15/2014 21 02	68.27999914
12/15/2014 22 08	69.13999913
12/15/2014 23 50	70.59999912
12/16/2014 0 07	71.7899991
12/16/2014 1 00	72.61999909
12/16/2014 2 04	72.88999909
12/16/2014 3 09	72.61999909
12/16/2014 4 56	72.1299991
12/16/2014 5 55	70.41999912
12/16/2014 6 54	67.29999915
12/16/2014 7 22	66.29999917
12/16/2014 8 00	68.45999914
12/16/2014 9 15	68.97999913
12/16/2014 10 16	69.49999913
12/16/2014 11 16	69.22999913
12/16/2014 12 28	69.37999913
12/16/2014 13 29	69.98999912
12/16/2014 14 13	70.01999912
12/16/2014 15 29	69.92999912
12/16/2014 16 44	69.13999913
12/16/2014 17 40	68.55999914

12/12/2014 19 45	72.85000273
12/12/2014 20 00	73.25000274
12/12/2014 21 00	73.43000275
12/12/2014 22 00	73.92000277
12/12/2014 23 06	73.70000276
12/13/2014 0 24	73.61000275
12/13/2014 1 57	74.99000281
12/13/2014 2 08	74.62000279
12/13/2014 3 34	75.41000282
12/13/2014 4 48	66.44000249
12/13/2014 5 39	75.23000281
12/13/2014 6 44	74.59000279
12/13/2014 7 56	73.28000274
12/13/2014 8 32	72.0300027
12/13/2014 9 41	70.84000265
12/13/2014 10 39	71.02000266
12/13/2014 11 17	70.99000266
12/13/2014 12 12	63.33000237 A
12/13/2014 13 14	72.2400027
12/13/2014 14 12	71.75000269
12/13/2014 15 09	72.48000271
12/13/2014 16 42	72.58000272
12/13/2014 17 08	72.48000271
12/13/2014 18 54	72.91000273
12/13/2014 19 00	73.19000274
12/13/2014 20 59	73.28000274
12/13/2014 21 00	73.28000274
12/13/2014 22 33	70.41000264
12/13/2014 23 50	73.77000276
12/14/2014 0 17	74.7100028
12/14/2014 1 38	75.29000282
12/14/2014 2 58	75.41000282
12/14/2014 3 07	75.38000282
12/14/2014 4 28	75.54000283
12/14/2014 5 52	75.35000282
12/14/2014 6 23	75.05000281
12/14/2014 7 57	73.86000276
12/14/2014 8 54	72.1800027
12/14/2014 9 55	71.08000266
12/14/2014 10 34	70.80000265
12/14/2014 11 05	70.35000263
12/14/2014 12 23	71.29000267
12/14/2014 13 02	71.81000269
12/14/2014 14 00	72.27000271
12/14/2014 15 14	72.2400027
12/14/2014 16 39	72.36000271
12/14/2014 17 55	72.0900027
12/14/2014 18 36	72.0600027
12/14/2014 19 23	71.54000268
12/14/2014 20 02	72.1200027
12/14/2014 21 18	72.67000272
12/14/2014 22 01	73.73000276
12/14/2014 23 55	73.98000277
12/15/2014 0 54	75.41000282
12/15/2014 1 12	75.29000282
12/15/2014 2 22	75.32000282
12/15/2014 3 16	75.51000283
12/15/2014 4 36	75.20000281
12/15/2014 5 54	73.52000275
12/15/2014 6 48	71.48000268
12/15/2014 7 09	71.08000266
12/15/2014 8 00	72.1200027
12/15/2014 9 29	72.91000273
12/15/2014 10 48	72.91000273
12/15/2014 11 22	73.34000274
12/15/2014 12 13	72.82000273
12/15/2014 13 09	73.70000276
12/15/2014 14 30	73.52000275
12/15/2014 15 59	73.70000276
12/15/2014 16 58	72.39000271
12/15/2014 17 00	72.39000271
12/15/2014 18 46	71.87000269
12/15/2014 19 11	72.64000272
12/15/2014 20 19	72.33000271
12/15/2014 21 02	72.54000272
12/15/2014 22 01	72.64000272
12/15/2014 23 00	74.41000278
12/16/2014 0 08	75.05000281
12/16/2014 1 28	75.47000282
12/16/2014 2 08	75.63000283
12/16/2014 3 08	75.54000283
12/16/2014 4 58	74.9600028
12/16/2014 5 59	73.98000277
12/16/2014 6 50	71.66000268
12/16/2014 7 07	71.11000266
12/16/2014 8 11	72.94000273
12/16/2014 9 36	72.97000273
12/16/2014 10 00	73.43000275
12/16/2014 11 21	73.31000274
12/16/2014 12 20	73.40000275
12/16/2014 13 05	73.83000276
12/16/2014 14 32	73.83000276
12/16/2014 15 53	73.43000275
12/16/2014 16 41	73.28000274
12/16/2014 17 41	72.36000271

12/12/2014 18 50	73.44
12/12/2014 19 31	73.26
12/12/2014 20 21	73.68
12/12/2014 21 17	73.84
12/12/2014 22 00	74.08
12/12/2014 23 06	72.8
12/13/2014 0 24	74.69
12/13/2014 1 28	75
12/13/2014 2 07	74.66
12/13/2014 3 51	75.21
12/13/2014 4 47	64.07
12/13/2014 5 03	75.3
12/13/2014 6 09	75.12
12/13/2014 7 48	73.71
12/13/2014 8 32	72.74
12/13/2014 9 40	72.28
12/13/2014 10 40	72.22
12/13/2014 11 36	71.76
12/13/2014 12 11	57.87 A
12/13/2014 13 14	72.34
12/13/2014 14 16	71.79
12/13/2014 15 16	72.37
12/13/2014 16 42	72.95
12/13/2014 17 35	73.41
12/13/2014 18 53	73.65
12/13/2014 19 34	73.8
12/13/2014 20 02	74.26
12/13/2014 21 01	74.29
12/13/2014 22 33	72.25
12/13/2014 23 19	75.09
12/14/2014 0 02	74.84
12/14/2014 1 09	75.54
12/14/2014 2 43	75.64
12/14/2014 3 24	75.67
12/14/2014 4 59	75.97
12/14/2014 5 43	75.73
12/14/2014 6 14	75.27
12/14/2014 7 55	74.54
12/14/2014 8 41	73.07
12/14/2014 9 48	72.37
12/14/2014 10 18	72.1
12/14/2014 11 43	72.16
12/14/2014 12 02	72.16
12/14/2014 13 34	72.4
12/14/2014 14 24	72.55
12/14/2014 15 24	72.61
12/14/2014 16 10	73.13
12/14/2014 17 17	73.13
12/14/2014 18 30	72.71
12/14/2014 19 44	72.98
12/14/2014 20 06	73.5
12/14/2014 21 13	73.59
12/14/2014 22 03	74.02
12/14/2014 23 55	74.08
12/15/2014 0 57	74.81
12/15/2014 1 00	74.81
12/15/2014 2 04	75.09
12/15/2014 3 49	75.88
12/15/2014 4 44	75.42
12/15/2014 5 49	74.23
12/15/2014 6 49	73.04
12/15/2014 7 47	72.06
12/15/2014 8 53	72.64
12/15/2014 9 23	73.32
12/15/2014 10 58	73.13
12/15/2014 11 48	72.43
12/15/2014 12 01	73.01
12/15/2014 13 27	72.8
12/15/2014 14 14	73.41
12/15/2014 15 54	73.26
12/15/2014 16 59	72.58
12/15/2014 17 00	72.58
12/15/2014 18 15	72.92
12/15/2014 19 46	72.74
12/15/2014 20 38	73.04
12/15/2014 21 22	73.59
12/15/2014 22 24	73.84
12/15/2014 23 27	74.14
12/16/2014 0 58	74.96
12/16/2014 1 00	74.96
12/16/2014 2 08	75.61
12/16/2014 3 02	75.73
12/16/2014 4 53	74.72
12/16/2014 5 32	74.29
12/16/2014 6 41	72.86
12/16/2014 7 23	72.31
12/16/2014 8 12	73.26
12/16/2014 9 52	73.26
12/16/2014 10 00	73.5
12/16/2014 11 55	73.22
12/16/2014 12 07	72.64
12/16/2014 13 25	72.86
12/16/2014 14 42	73.16
12/16/2014 15 53	73.38
12/16/2014 16 44	73.35

12/16/2014 18 09	71.30000246	12/16/2014 18 16	67.32000062	12/16/2014 17 19	71.67999775	12/16/2014 17 27	70.08	12/16/2014 17 32	67.55000248	12/16/2014 18 00	76.54000144	12/16/2014 18 09	71.37999819	12/16/2014 18 59	73.29000205	12/16/2014 18 07	68.21999914	12/16/2014 18 00	72.76000272	12/16/2014 17 52	72.37
12/16/2014 19 23	72.4600025	12/16/2014 19 04	66.77000062	12/16/2014 18 49	71.49999775	12/16/2014 18 13	70.08	12/16/2014 18 52	67.18000246	12/16/2014 19 00	76.54000144	12/16/2014 19 44	71.3199982	12/16/2014 19 45	73.19000205	12/16/2014 19 01	68.36999914	12/16/2014 19 00	72.54000272	12/16/2014 18 31	72.37
12/16/2014 20 44	70.51000243	12/16/2014 20 41	67.69000063	12/16/2014 19 06	71.49999775	12/16/2014 19 45	70.32	12/16/2014 19 45	67.12000246	12/16/2014 20 00	76.54000144	12/16/2014 20 48	71.58999819	12/16/2014 20 39	73.68000206	12/16/2014 20 39	68.70999914	12/16/2014 20 39	72.97000273	12/16/2014 19 44	72.89
12/16/2014 21 13	71.42000246	12/16/2014 21 13	68.08000063	12/16/2014 20 40	71.70999775	12/16/2014 20 45	69.93	12/16/2014 20 48	67.09000246	12/16/2014 21 00	76.54000144	12/16/2014 21 13	71.2499982	12/16/2014 21 39	73.59000206	12/16/2014 21 43	68.82999914	12/16/2014 21 40	72.39000271	12/16/2014 20 49	73.13
12/16/2014 22 01	70.60000243	12/16/2014 22 02	67.26000062	12/16/2014 21 39	71.70999775	12/16/2014 21 36	70.14	12/16/2014 21 13	66.94000245	12/16/2014 22 00	76.54000144	12/16/2014 22 03	70.11999822	12/16/2014 22 03	72.19000202	12/16/2014 22 04	68.00999915	12/16/2014 22 01	72.97000273	12/16/2014 21 08	72.8
12/16/2014 23 38	70.26000242	12/16/2014 23 00	69.76000065	12/16/2014 22 01	71.46999775	12/16/2014 22 03	67.12	12/16/2014 22 01	66.33000243	12/16/2014 23 00	76.54000144	12/16/2014 23 32	67.46999829	12/16/2014 23 33	72.10000202	12/16/2014 23 33	70.68999911	12/16/2014 23 14	74.16000278	12/16/2014 22 09	73.59
12/17/2014 0 05	72.16000249	12/17/2014 0 12	70.31000065	12/16/2014 23 33	71.03999777	12/16/2014 23 44	70.87	12/16/2014 23 34	65.69000241	12/17/2014 0 00	76.54000144	12/17/2014 0 01	70.36999822	12/17/2014 0 05	74.54000209	12/17/2014 0 01	71.9699991	12/17/2014 0 13	74.9300028	12/16/2014 23 39	74.29
12/17/2014 1 00	74.08000255	12/17/2014 1 38	71.17000066	12/17/2014 0 00	73.69999768	12/17/2014 0 05	70.05	12/17/2014 0 01	67.24000246	12/17/2014 1 00	76.54000144	12/17/2014 1 41	72.13999818	12/17/2014 1 46	75.0000021	12/17/2014 1 38	72.42999909	12/17/2014 1 02	75.32000282	12/17/2014 0 49	74.66
12/17/2014 2 47	74.23000256	12/17/2014 2 02	70.83000066	12/17/2014 1 20	73.90999768	12/17/2014 1 07	71.67	12/17/2014 1 20	68.49000251	12/17/2014 2 00	76.54000144	12/17/2014 2 47	72.28999817	12/17/2014 2 48	74.9300021	12/17/2014 2 48	72.45999909	12/17/2014 2 48	75.41000282	12/17/2014 1 02	74.6
12/17/2014 3 20	74.14000255	12/17/2014 3 36	71.41000066	12/17/2014 2 47	73.81999768	12/17/2014 2 47	71.27	12/17/2014 2 47	68.68000252	12/17/2014 3 00	76.54000144	12/17/2014 3 24	71.64999819	12/17/2014 3 38	74.75000209	12/17/2014 3 27	73.03999909	12/17/2014 3 45	75.60000283	12/17/2014 2 47	75.09
12/17/2014 4 52	74.42000256	12/17/2014 4 47	71.01000066	12/17/2014 3 37	73.44999769	12/17/2014 3 20	71.33	12/17/2014 3 20	69.14000253	12/17/2014 4 00	76.54000144	12/17/2014 4 51	72.19999818	12/17/2014 4 50	74.9700021	12/17/2014 4 52	72.39999909	12/17/2014 4 11	75.54000283	12/17/2014 3 20	75.54
12/17/2014 5 02	72.03000248	12/17/2014 5 38	70.10000065	12/17/2014 4 55	73.81999768	12/17/2014 4 47	71.88	12/17/2014 4 50	68.80000252	12/17/2014 5 00	76.54000144	12/17/2014 5 18	70.88999821	12/17/2014 5 29	74.51000209	12/17/2014 5 57	71.14999911	12/17/2014 5 58	74.38000278	12/17/2014 4 43	75.54
12/17/2014 6 38	70.84000244	12/17/2014 6 58	66.83000062	12/17/2014 5 36	73.0899977	12/17/2014 5 28	70.75	12/17/2014 5 24	67.37000247	12/17/2014 6 00	76.54000144	12/17/2014 6 37	70.57999821	12/17/2014 6 37	72.65000203	12/17/2014 6 41	67.42999915	12/17/2014 6 37	71.60000268	12/17/2014 5 37	74.42
12/17/2014 7 25	70.42000243	12/17/2014 7 17	65.70000061	12/17/2014 6 37	70.51999778	12/17/2014 6 37	69.29	12/17/2014 6 38	66.57000244	12/17/2014 7 00	76.54000144	12/17/2014 7 24	71.1299982	12/17/2014 7 55	73.07000204	12/17/2014 7 15	66.59999916	12/17/2014 7 22	71.23000267	12/17/2014 6 55	72.89
12/17/2014 8 02	71.88000248	12/17/2014 8 00	66.83000062	12/17/2014 7 28	69.78999781	12/17/2014 7 19	69.44	12/17/2014 7 04	67.03000246	12/17/2014 8 00	76.54000144	12/17/2014 8 39	70.91999821	12/17/2014 8 44	72.86000204	12/17/2014 8 02	68.21999914	12/17/2014 8 08	72.45000271	12/17/2014 7 10	72.37
12/17/2014 9 03	71.09000245	12/17/2014 9 53	67.87000063	12/17/2014 8 50	70.94999777	12/17/2014 8 10	69.53	12/17/2014 8 00	67.27000247	12/17/2014 9 00	76.54000144	12/17/2014 9 13	71.1599982	12/17/2014 9 00	73.29000205	12/17/2014 9 03	68.67999914	12/17/2014 9 00	73.31000274	12/17/2014 8 02	72.89
12/17/2014 10 18	71.91000248	12/17/2014 10 48	67.66000063	12/17/2014 9 46	70.54999778	12/17/2014 9 08	69.96	12/17/2014 9 08	67.37000247	12/17/2014 10 00	76.54000144	12/17/2014 10 23	69.75999823	12/17/2014 10 22	72.92000204	12/17/2014 10 23	68.79999914	12/17/2014 10 14	73.31000274	12/17/2014 9 34	73.04
12/17/2014 11 16	67.15000232	12/17/2014 11 26	67.93000063	12/17/2014 10 39	70.70999778	12/17/2014 10 39	69.59	12/17/2014 10 06	66.82000245	12/17/2014 11 00	76.54000144	12/17/2014 11 33	69.57999824	12/17/2014 11 33	72.46000203	12/17/2014 11 30	68.15999914	12/17/2014 11 30	72.45000271	12/17/2014 10 51	73.32
12/17/2014 12 56	69.26000239	12/17/2014 12 30	68.15000063	12/17/2014 11 44	71.18999776	12/17/2014 11 30	66.91	12/17/2014 11 20	67.55000248	12/17/2014 12 00	76.54000144	12/17/2014 12 00	71.61999819	12/17/2014 12 34	73.01000204	12/17/2014 12 18	66.77999916	12/17/2014 12 18	72.61000272	12/17/2014 11 24	73.07
12/17/2014 13 05	71.73000247	12/17/2014 13 27	67.90000063	12/17/2014 12 39	71.09999776	12/17/2014 12 01	70.57	12/17/2014 12 57	67.91000249	12/17/2014 13 00	76.54000144	12/17/2014 13 08	71.2799982	12/17/2014 13 08	73.10000205	12/17/2014 13 16	68.73999914	12/17/2014 13 28	73.80000276	12/17/2014 12 21	73.19
12/17/2014 14 00	73.01000252	12/17/2014 14 39	68.91000064	12/17/2014 13 08	71.79999774	12/17/2014 13 21	70.08	12/17/2014 13 01	67.67000248	12/17/2014 14 00	76.54000144	12/17/2014 14 08	71.82999818	12/17/2014 14 00	73.65000206	12/17/2014 14 08	70.10999912	12/17/2014 14 51	73.92000277	12/17/2014 13 23	73.84
12/17/2014 15 50	71.27000246	12/17/2014 15 51	68.39000064	12/17/2014 14 08	71.34999776	12/17/2014 14 02	70.51	12/17/2014 14 13	67.95000249	12/17/2014 15 00	76.54000144	12/17/2014 15 50	71.46999819	12/17/2014 15 50	73.71000206	12/17/2014 15 58	69.77999913	12/17/2014 15 48	73.95000277	12/17/2014 14 38	73.93
12/17/2014 16 14	71.39000246	12/17/2014 16 42	67.47000063	12/17/2014 15 32	70.79999777	12/17/2014 15 37	70.51	12/17/2014 15 17	67.82000249	12/17/2014 16 00	76.54000144	12/17/2014 16 11	71.64999819	12/17/2014 16 37	73.26000205	12/17/2014 16 52	69.06999913	12/17/2014 16 59	73.49000275	12/17/2014 15 54	72.98
12/17/2014 17 33	72.03000248	12/17/2014 17 16	67.14000062	12/17/2014 16 37	70.73999778	12/17/2014 16 12	70.48	12/17/2014 16 11	67.70000248	12/17/2014 17 00	76.54000144	12/17/2014 17 29	71.64999819	12/17/2014 17 47	73.29000205	12/17/2014 17 43	68.42999914	12/17/2014 17 47	72.85000273	12/17/2014 16 15	72.74
12/17/2014 18 11	70.08000242	12/17/2014 18 27	65.92000061	12/17/2014 17 15	71.18999776	12/17/2014 17 40	69.71	12/17/2014 17 30	67.46000247	12/17/2014 18 00	76.54000144	12/17/2014 18 09	71.95999818	12/17/2014 18 15	73.29000205	12/17/2014 18 03	68.51999914	12/17/2014 18 46	72.54000272	12/17/2014 17 34	72.83
12/17/2014 19 03	71.73000247	12/17/2014 19 10	67.08000062	12/17/2014 18 12	71.24999776	12/17/2014 18 57	69.59	12/17/2014 18 11	67.18000246	12/17/2014 19 00	76.54000144	12/17/2014 19 00	72.19999818	12/17/2014 19 09	72.71000203	12/17/2014 19 47	68.42999914	12/17/2014 19 09	72.85000273	12/17/2014 18 23	72.74
12/17/2014 20 07	71.79000247	12/17/2014 20 23	67.35000063	12/17/2014 19 58	70.57999778	12/17/2014 19 09	70.42	12/17/2014 19 58	68.83000252	12/17/2014 20 00	76.54000144	12/17/2014 20 26	72.50999817	12/17/2014 20 23	72.89000204	12/17/2014 20 23	68.30999914	12/17/2014 20 05	72.33000271	12/17/2014 19 24	73.01
12/17/2014 21 19	71.18000245	12/17/2014 21 39	67.47000063	12/17/2014 20 49	70.51999778	12/17/2014 20 29	69.62	12/17/2014 20 00	68.83000252	12/17/2014 21 00	76.54000144	12/17/2014 21 39	69.99999823	12/17/2014 21 43	73.07000204	12/17/2014 21 40	68.70999914	12/17/2014 21 06	73.16000274	12/17/2014 20 39	73.41
12/17/2014 22 00	73.44000253	12/17/2014 22 10	68.15000063	12/17/2014 21 04	70.57999778	12/17/2014 21 39	67.82	12/17/2014 21 40	67.00000246	12/17/2014 22 00	76.54000144	12/17/2014 22 01	72.04999818	12/17/2014 22 06	73.10000205	12/17/2014 22 02	69.19999913	12/17/2014 22 02	72.94000273	12/17/2014 21 13	73.04
12/17/2014 23 04	73.41000253	12/17/2014 23 26	69.76000065	12/17/2014 22 10	71.46999775	12/17/2014 22 02	70.32	12/17/2014 22 02	68.46000251	12/17/2014 23 00	76.54000144	12/17/2014 23 59	67.79999828	12/17/2014 23 04	73.93000207	12/17/2014 23 59	70.25999912	12/17/2014 23 24	74.50000279	12/17/2014 22 06	73.56
12/18/2014 0 00	70.91000245	12/18/2014 0 00	70.37000065	12/17/2014 23 59	70.60999778	12/17/2014 23 59	68.65	12/17/2014 23 04	68.49000251	12/18/2014 0 00	76.54000144	12/18/2014 0 00	68.56999826	12/18/2014 0 20	74.02000207	12/18/2014 0 00	70.25999912	12/18/2014 0 00	75.14000281	12/17/2014 23 24	74.05
12/18/2014 1 02	74.51000257	12/18/2014 1 08	71.44000066	12/18/2014 0 00	70.60999778	12/18/2014 0 00	68.65	12/18/2014 0 00	65.4400024	12/18/2014 1 00	76.54000144	12/18/2014 1 02	72.04999818	12/18/2014 1 46	74.78000209	12/18/2014 1 07	72.1599991	12/18/2014 1 00	75.51000283	12/18/2014 0 00	75.03
12/18/2014 2 36	75.30000259	12/18/2014 2 00	71.93000067	12/18/2014 1 02	73.75999768	12/18/2014 1 47	71.45	12/18/2014 1 02	68.89000253	12/18/2014 2 00	76.54000144	12/18/2014 2 08	72.86999816	12/18/2014 2 03	75.1800021	12/18/2014 2 18	73.00999909	12/18/2014 2 09	75.87000284	12/18/2014 1 08	75.18
12/18/2014 3 09	73.26000252	12/18/2014 3 00	71.53000067	12/18/2014 2 22	74.02999767	12/18/2014 2 53	72.03	12/18/2014 2 03	69.53000255	12/18/2014 3 00	76.54000144	12/18/2014 3 09	72.13999818	12/18/2014 3 13	74.54000209	12/18/2014 3 07	72.70999909	12/18/2014 3 09	75.41000282	12/18/2014 2 08	75.94
12/18/2014 4 28	75.00000258	12/18/2014 4 56	71.14000066	12/18/2014 3 35	73.2999977	12/18/2014 3 10	71.52	12/18/2014 3 09	67.88000249	12/18/2014 4 00	76.54000144	12/18/2014 4 34	71.92999818	12/18/2014 4 58	75.0600021	12/18/2014 4 52	72.51999909	12/18/2014 4 56	75.14000281	12/18/2014 3 39	75.88
12/18/2014 5 47	70.78000244	12/18/2014 5 56	67.96000063	12/18/2014 4 39	73.66999769	12/18/2014 4 58	71.79	12/18/2014 4 43	69.29000254	12/18/2014 5 00	76.54000144	12/18/2014 5 47	69.44999824	12/18/2014 5 51	73.99000207	12/18/2014 5 57	70.19999912	12/18/2014 5 47	73.61000275	12/18/2014 4 51	75.03
12/18/2014 6 00	71.85000248	12/18/2014 6 59	66.31000062	12/18/2014 5 56	72.25999773	12/18/2014 5 47	69.47	12/18/2014 5 48	65.66000241	12/18/2014 6 00	76.54000144	12/18/2014 6 08	71.3199982	12/18/2014 6 45	73.32000205	12/18/2014 6 46	67.54999915	12/18/2014 6 48	71.90000269	12/18/2014 5 51	73.71
12/18/2014 7 08	70.17000242	12/18/2014 7 22	65.61000061	12/18/2014 6 58	71.61999775	12/18/2014 6 37	69.84	12/18/2014 6 00	66.21000243	12/18/2014 7 00	76.54000144	12/18/2014 7 42	70.9499982	12/18/2014 7 09	72.86000204	12/18/2014 7 12	66.38999917	12/18/2014 7 15	71.08000266	12/18/2014 6 55	72.92
12/18/2014 8 16	70.17000242	12/18/2014 8 09	67.32000062	12/18/2014 7 09	70.24999779	12/18/2014 7 08	69.41	12/18/2014 7 42	66.57000244	12/18/2014 8 00	76.54000144	12/18/2014 8 33	71.2799982	12/18/2014 8 55	73.47000206	12/18/2014 8 02	67.81999915	12/18/2014 8 25	72.67000272	12/18/2014 7 32	72.43
12/18/2014 9 29	71.09000245	12/18/2014 9 43	67.69000063	12/18/2014 8 28	71.03999777	12/18/2014 8 17	69.96	12/18/2014 8 17	67.24000246	12/18/2014 9 00	76.54000144	12/18/2014 9 31	71.0699982	12/18/2014 9 05	73.56000206	12/18/2014 9 21	69.22999913	12/18/2014 9 21	72.76000272	12/18/2014 8 02	72.68
12/18/2014 10 45	71.64000247	12/18/2014 10 05	67.90000063	12/18/2014 9 05	71.40999776	12/18/2014 9 07	69.44	12/18/2014 9 57	67.64000248	12/18/2014 10 00	76.54000144	12/18/2014 10 22	71.43999819	12/18/2014 10 09	73.47000206	12/18/2014 10 26	69.16999913	12/18/2014 10 06	73.58000275	12/18/2014 9 11	73.41
12/18/2014 11 56	71.70000247	12/18/2014 11 22	67.96000063	12/18/2014 10 56	71.95999774	12/18/2014 10 09	70.14	12/18/2014 10 01	67.18000246	12/18/2014 11 00	76.54000144	12/18/2014 11 35	71.0399982	12/18/2014 11 58	73.10000205	12/18/2014 11 10	69.43999913	12/18/2014 11 01	73.28000274	12/18/2014 10 44	72.95
12/18/2014 12 19	72.00000248	12/18/2014 12 01	68.39000064	12/18/2014 11 59	70.66999778	12/18/2014 11 58	70.17	12/18/2014 11 58	67.43000247	12/18/2014 12 00	76.54000144	12/18/2014 12 47	71.1599982	12/18/2014 12 00	73.10000205	12/18/2014 12 50	69.55999913	12/18/2014 12 27	73.83000276	12/18/2014 11 20	73.35
12/18/2014 13 21	72.31000249	12/18/2014 13 53	68.57000064	12/18/2014 12 00	70.66999778	12/18/2014 12 00	70.17	12/18/2014 12 29	67.09000246	12/18/2014 13 00	76.54000144	12/18/2014 13 32	70.05999823	12/18/2014 13 32	72.83000204	12/18/2014 13 46	69.77999913	12/18/2014 13 57	74.07000277	12/18/2014 12 08	72.92
12/18/2014 14 11	71.85000248	12/18/2014 14 50	68.66000064	12/18/2014 13 04	71.31999776	12/18/2014 13 45	70.51	12/18/2014 13 46	66.82000245	12/18/2014 14 00	76.54000144	12/18/2014 14 25	70.9799982	12/18/2014 14 15	73.77000206	12/18/2014 14 47	69.64999913	12/18/2014 14 29	74.01000277	12/18/2014 13 57	73.65
12/18/2014 15 49	72.16000249	12/18/2014 15 59	68.15000063	12/18/2014 14 08	70.85999777	12/18/2014 14 09	70.29	12/18/2014 14 26	67.76000248	12/18/2014 15 00	76.54000144	12/18/2014 15 58	71.0399982	12/18/2014 15 39	73.62000206	12/18/2014 15 54	69.71999913	12/18/2014 15 54	73.73000276	12/18/2014 14 29	73.65
12/18/2014 16 48	71.58000247	12/18/2014 16 58	67.60000063	12/18/2014 15 00	72.10999773	12/18/2014 15 27	69.78	12/18/2014 15 22	67.55000248	12/18/2014 16 00	76.54000144	12/18/2014 16 20	71.0399982	12/18/2014 16 16	72.95000204	12/18/2014 16 53	69.22999913	12/18/2014 16 54	73.37000275	12/18/2014 15 45	73.41
12/18/2014 17 50	72.10000248	12/18/2014 17 56	66.50000062	12/18/2014 16 46	71.34999776	12/18/2014 16 54	69.84	12/18/2014 16 44	67.70000248	12/18/2014 17 00	76.54000144	12/18/2014 17 22	71.46999819	12/18/2014 17 46	73.32000205	12/18/2014 17 34	68.70999914	12/18/2014 17 35	72.70000272	12/18/2014 16 13	73.22
12/18/2014 18 11	71.97000248	12/18/2014 18 13	66.89000062	12/18/2014 17 46	70.85999777	12/18/2014 17 59	70.08	12/18/2014 17 54	67.73000248	12/18/2014 18 00	76.54000144	12/18/2014 18 58	71.52999819	12/18/2014 18 07	73.47000206	12/18/2014 18 39	65.80999917	12/18/2014 18 19	72.54000272	12/18/2014 17 35	72.77
12/18/2014 19 18	70.45000243	12/18/2014 19 44	67.53000063	12/18/2014 18 43	70.85999777	12/18/2014 18 00	70.08	12/18/2014 18 28	67.79000248	12/18/2014 19 00	76.54000144	12/18/2014 19 36	71.0099982	12/18/2014 19 47	73.56000206	12/18/2014 19 03	68.76999914	12/18/2014 19 14	72.61000272	12/18/2014 18 00	73.19
12/18/2014 20 06	70.05000242	12/18/2014 20 05	66.89000062	12/18/2014 19 02	71.28999776	12/18/2014 19 59	70.26	12/18/2014 19 58	67.61000248	12/18/2014 20 00	76.54000144	12/18/2014 20 25	71.2199982	12/18/2014 20 43	73.26000205	12/18/2014 20 06	68.45999914	12/18/2014 20 20	72.94000273	12/18/2014 19 01	73.01
12/18/2014 21 43	72.4600025	12/18/2014 21 27	68.24000063	12/18/2014 20 10	70.97999777	12/18/2014 20 25	70.14	12/18/2014 20 25	67.03000246	12/18/2014 21 00	76.54000144	12/18/2014 21 35	71.46999819	12/18/2014 21 30	73.50000206	12/18/2014 21 49	68.82999914	12/18/2014 21 27	73.31000274	12/18/2014 20 29	72.22
12/18/2014 22 17	71.52000247	12/18/2014 22 07	68.76000064	12/18/2014 21 04	71.06999777	12/18/2014 21 13	70.94	12/18/2014 21 44	67.91000249	12/18/2014 22 00	76.54000144	12/18/2014 22 55	71.40999819	12/18/2014 22 55	73.65000206	12/18/2014 22 02	69.55999913	12/18/2014 22 13	73.34000274	12/18/2014 21 14	73.56
12/18/2014 23 45	68.22000236	12/18/2014 23 03	69.67000065	12/18/2014 22 55	71.55999775	12/18/2014 22 27	70.94	12/18/2014 22 03	68.1600025	12/18/2014 23 00	76.54000144	12/18/2014 23 46	67.98999828	12/18/2014 23 00	73.90000207	12/18/2014 23 47	70.22999912	12/18/2014 23 00	74.28000278	12/18/2014 22 42	73.9
12/19/2014 0 22	73.04000252	12/19/2014 0 04	69.58000065	12/18/2014 23 23	72.89999771	12/18/2014 23 00	71.12	12/18/2014 23 45	63.82000234	12/19/2014 0 00	76.54000144	12/19/2014 0 09	70.88999821	12/19/2014 0 31	74.66000209	12/19/2014 0 31	71.14999911	12/19/2014 0 33	75.17000281	12/18/2014 23 01	74.6
12/19/2014 1 18	73.71000254	12/19/2014 1 02	71.11000066	12/19/2014 0 02	73.90999768	12/19/2014 0 22	71.33	12/19/2014 0 00	67.95000249	12/19/2014 1 00	76.54000144	12/19/2014 1 22	71.79999818	12/19/2014 1 23	74.29000208	12/19/2014 1 23	71.9999991	12/19/2014 1 23	75.17000281	12/19/2014 0 09	74.72
12/19/2014 2 40	74.26000256	12/19/2014 2 41	70.68000066	12/19/2014 1 28	73.93999768	12/19/2014 1 22	71.79	12/19/2014 1 07	68.89000253	12/19/2014 2 00	76.54000144	12/19/2014 2 40	72.10999818	12/19/2014 2 41	75.0000021	12/19/2014 2 12	72.57999909	12/19/2014 2 44	75.23000281	12/19/2014 1 23	74.87
12/19/2014 3 18	75.03000258	12/19/2014 3 03	71.38000066	12/19/2014 2 55	73.69999768	12/19/2014 2 40	71.33	12/19/2014 2 40	68.2800025	12/19/2014 3 00	76.54000144	12/19/2014 3 05	73.26999815	12/19/2014 3 13	75.24000211	12/19/2014 3 24	72.97999909	12/19/2014 3 56	75.72000283	12/19/2014 2 04	75.73
12/19/2014 4 37	74.93000258	12/19/2014 4 36	70.59000066	12/19/2014 3 01	74.11999767	12/19/2014 3 11	72.16	12/19/2014 3 52	69.69000255	12/19/2014 4 00	76.54000144	12/19/2014 4 58	72.71999816	12/19/2014 4 12	75.1800021	12/19/2014 4 57	72.67999909	12/19/2014 4 52	75.57000283	12/19/2014 3 37	75.79
12/19/2014 5 33	73.19000252	12/19/2014 5 57	69.27000064	12/19/2014 4 38	73.96999768	12/19/2014 4 58	71.7	12/19/2014 4 54	69.04000253	12/19/2014 5 00	76.54000144	12/19/2014 5 32	71.43999819	12/19/2014 5 36	74.14000207	12/19/2014 5 40	70.44999912	12/19/2014 5 37	74.22000278	12/19/2014 4 26	75.61
12/19/2014 6 41	71.85000248	12/19/2014 6 12	66.80000062	12/19/2014 5 17	72.53999772	12/19/2014 5 03	71.15	12/19/2014 5 33	67.85000249	12/19/2014 6 00	76.54000144	12/19/2014 6 41	70.39999822	12/19/2014 6 48	72.49000203	12/19/2014 6 51	67.17999916	12/19/2014 6 52	71.57000268	12/19/2014 5 57	73.99
12/19/2014 7 35	70.36000243	12/19/2014 7 40	65.92000061	12/19/2014 6 48	70.66999778	12/19/2014 6 40	68.86	12/19/2014 6 19	66.42000243	12/19/2014 7 00	76.54000144	12/19/2014 7 52	70.85999821	12/19/2014 7 16	73.01000204	12/19/2014 7 02	66.35999917	12/19/2014 7 12	71.11000266	12/19/2014 6 51	73.01
12/19/2014 8 27	70.57000243	12/19/2014 8 01	67.29000062	12/19/2014 7 05	70.60999778	12/19/2014 7 11	69.47	12/19/2014 7 43	66.57000244	12/19/2014 8 00	76.54000144	12/19/2014 8 28	70.39999822	12/19/2014 8 00	74.17000208	12/19/2014 8 02	68.85999914	12/19/2014 8 09	72.79000272	12/19/2014 7 12	72.28
12/19/2014 9 50	71.27000246	12/19/2014 9 51	67.44000063	12/19/2014 8 28	71.55999775	12/19/2014 8 24	69.93	12/19/2014 8 04	66.48000244	12/19/2014 9 00	76.54000144	12/19/2014 9 20	70.79999821	12/19/2014 9 43	74.29000208	12/19/2014 9 33	69.16999913	12/19/2014 9 01	73.25000274	12/19/2014 8 02	73.01
12/19/2014 10 39	69.5900024	12/19/2014 10 42	67.78000063	12/19/2014 9 43	72.50999772	12/19/2014 9 13	69.71	12/19/2014 9 44	66.72000245	12/19/2014 10 00	76.54000144	12/19/2014 10 23	70.36999822	12/19/2014 10 35	74.42000208	12/19/2014 10 07	69.74999913	12/19/2014 10 31	73.31000274	12/19/2014 9 32	72.89
12/19/2014 11 07	70.87000244	12/19/2014 11 25	67.53000063	12/19/2014 10 11	72.50999772	12/19/2014 10 04	69.84	12/19/2014 10 23	66.17000243	12/19/2014 11 00	76.54000144	12/19/2014 11 25	70.60999821	12/19/2014 11 22	74.48000208	12/19/2014 11 28	69.71999913	12/19/2014 11 01	72.76000272	12/19/2014 10 20	73.07
12/19/2014 12 08	71.52000247	12/19/2014 12 10	67.93000063	12/19/2014 11 19	72.37999773	12/19/2014 11 08	70.11	12/19/2014 11 07	66.24000243	12/19/2014 12 00	76.54000144	12/19/2014 12 25	70.63999821	12/19/2014 12 48	74.48000208	12/19/2014 12 11	69.55999913	12/19/2014 12 11	73.34000274	12/19/2014 11 26	72.83
12/19/2014 13 00	70.94000245	12/19/2014 13 01	68.33000063	12/19/2014 12 30	73.0599977	12/19/2014 12 00	70.75	12/19/2014 12 25	66.30000243	12/19/2014 13 00	76.54000144	12/19/2014 13 03	70.69999821	12/19/2014 13 56	73.26000205	12/19/2014 13 00	69.89999912	12/19/2014 13 01	73.83000276	12/19/2014 12 38	73.35
12/19/2014 14 16	72.4600025	12/19/2014 14 55	68.27000063	12/19/2014 13 10	71.98999774	12/19/2014 13 44	70.36	12/19/2014 13 21	66.48000244	12/19/2014 14 00	76.54000144	12/19/2014 14 36	71.2799982	12/19/2014 14 29	73.56000206	12/19/2014 14 24	69.83999912	12/19/2014 14 20	73.73000276	12/19/2014 13 08	73.77
12/19/2014 15 25	72.22000249	12/19/2014 15 57	67.87000063	12/19/2014 14 30	72.07999773	12/19/2014 14 21	70.39	12/19/2014 14 53	67.95000249	12/19/2014 15 00	76.54000144	12/19/2014 15 54	71.3499982	12/19/2014 15 54	73.77000206	12/19/2014 15 08	69.80999912	12/19/2014 15 26	73.40000275	12/19/2014 14 12	73.5
12/19/2014 16 08	71.82000248	12/19/2014 16 43	68.15000063	12/19/2014 15 33	71.18999776	12/19/2014 15 13	70.69	12/19/2014 15 25	66.63000244	12/19/2014 16 00	76.54000144	12/19/2014 16 47	71.0399982	12/19/2014 16 12	72.98000204	12/19/2014 16 00	69.31999913	12/19/2014 16 43	73.19000274	12/19/2014 15 13	72.95
12/19/2014 17 27	71.39000246	12/19/2014 17 50	67.32000062	12/19/2014 16 11	70.97999777	12/19/2014 16 11	70.08	12/19/2014 16 08	67.15000246	12/19/2014 17 00	76.54000144	12/19/2014 17 09	71.55999819	12/19/2014 17 25	73.47000206	12/19/2014 17 31	69.03999913	12/19/2014 17 42	73.09000274	12/19/2014 16 06	73.9
12/19/2014 18 05	71.00000245	12/19/2014 18 05	67.72000063	12/19/2014 17 25	71.21999776	12/19/2014 17 38	70.08	12/19/2014 17 27	67.30000247	12/19/2014 18 00	76.54000144	12/19/2014 18 17	71.70999819	12/19/2014 18 24	73.41000205	12/19/2014 18 14	68.91999914	12/19/2014 18 14	72.82000273	12/19/2014 17 45	73.32
12/19/2014 19 29	72.13000249	12/19/2014 19 43	67.69000063	12/19/2014 18 55	71.76999774	12/19/2014 18 02	69.74	12/19/2014 18 05	67.67000248	12/19/2014 19 00	76.54000144	12/19/2014 19 29	70.66999821	12/19/2014 19 29	73.29000205	12/19/2014 19 04	69.43999913	12/19/2014 19 21	73.22000274	12/19/2014 18 48	73.38
12/19/2014 20 28	72.03000248	12/19/2014 20 00	68.39000064	12/19/2014 19 44	71.64999775	12/19/2014 19 29	70.02	12/19/2014 19 30	66.60000244	12/19/2014 20 00	76.54000144	12/19/2014 20 32	71.43999819	12/19/2014 20 29	73.93000207	12/19/2014 20 41	69.77999913	12/19/2014 20 41	73.22000274	12/19/2014 19 57	73.41
12/19/2014 21 00	73.04000252	12/19/2014 21 23	67.81000063	12/19/2014 20 55	71.95999774	12/19/2014 20 28	70.66	12/19/2014 20 28	67.37000247	12/19/2014 21 00	76.54000144	12/19/2014 21 56	71.82999818	12/19/2014 21 26	73.87000207	12/19/2014 21 33	69.74999913	12/19/2014 21 47	73.83000276	12/19/2014 20 00	73.41
12/19/2014 22 27	73.41000253	12/19/2014 22 03	68.91000064	12/19/2014 21 44	72.04999774	12/19/2014 21 00	71.12	12/19/2014 21 26	68.2500025	12/19/2014 22 00	76.54000144	12/19/2014 22 02	71.89999818	12/19/2014 22 37	74.08000207	12/19/2014 22 16	70.13999912	12/19/2014 22 00	73.37000275	12/19/2014 21 22	72.74
12/19/2014 23 12	74.29000256	12/19/2014 23 16	70.19000065	12/19/2014 22 56	71.76999774	12/19/2014 22 54	70.72	12/19/2014 22 54	67.67000248	12/19/2014 23 00	76.54000144	12/19/2014 23 38	71.98999818	12/19/2014 23 16	74.32000208	12/19/2014 23 00	71.35999911	12/19/2014 23 25	74.47000279	12/19/2014 22 16	74.42
12/20/2014 0 33	75.24000259	12/20/2014 0 10	70.74000066	12/19/2014 23 02	73.2999977	12/19/2014 23 20	71.03	12/19/2014 23 00	68.95000253	12/20/2014 0 00	76.54000144	12/20/2014 0 58	72.56999817	12/20/2014 0 58	74.78000209	12/20/2014 0 03	71.6699991	12/20/2014 0 00	75.20000281	12/19/2014 23 21	74.66
12/20/2014 1 23	70.91000245	12/20/2014 1 14	70.71000066	12/20/2014 0 10	73.2699977	12/20/2014 0 00	71.82	12/20/2014 0 10	69.90000256	12/20/2014 1 00	76.54000144	12/20/2014 1 23	70.30999822	12/20/2014 1 23	73.53000206	12/20/2014 1 24	70.56999912	12/20/2014 1 24	73.98000277	12/20/2014 0 03	75.3
12/20/2014 2 00	74.87000258	12/20/2014 2 03	70.98000066	12/20/2014 1 23	72.59999772	12/20/2014 1 29	71.09	12/20/2014 1 23	65.69000241	12/20/2014 2 00	76.54000144	12/20/2014 2 10	72.89999816	12/20/2014 2 53	75.1800021	12/20/2014 2 08	72.73999909	12/20/2014 2 04	75.17000281	12/20/2014 1 21	75
12/20/2014 3 00	75.18000259	12/20/2014 3 46	71.50000066	12/20/2014 2 03	73.59999769	12/20/2014 2 04	72.13	12/20/2014 2 04	69.14000253	12/20/2014 3 00	76.54000144	12/20/2014 3 14	73.20999815	12/20/2014 3 08	75.1800021	12/20/2014 3 14	72.79999909	12/20/2014 3 13	75.72000283	12/20/2014 2 03	75.18
12/20/2014 4 40	74.90000258	12/20/2014 4 47	71.66000067	12/20/2014 3 58	73.87999768	12/20/2014 3 14	72.13	12/20/2014 3 14	69.50000255	12/20/2014 4 00	76.54000144	12/20/2014 4 51	73.11999815	12/20/2014 4 35	74.9000021	12/20/2014 4 58	72.82999909	12/20/2014 4 57	75.23000281	12/20/2014 3 08	75.85
12/20/2014 5 55	75.03000258	12/20/2014 5 32	70.89000066	12/20/2014 4 00	73.87999768	12/20/2014 4 44	72.19	12/20/2014 4 44	69.53000255	12/20/2014 5 00	76.54000144	12/20/2014 5 58	72.40999817	12/20/2014 5 53	75.24000211	12/20/2014 5 41	72.30999909	12/20/2014 5 53	75.26000282	12/20/2014 4 24	75.57
12/20/2014 6 59	72.86000251	12/20/2014 6 33	69.98000065	12/20/2014 5 59	73.78999768	12/20/2014 5 57	72.06	12/20/2014 5 52	69.14000253	12/20/2014 6 00	76.54000144	12/20/2014 6 51	71.2799982	12/20/2014 6 58	74.8700021	12/20/2014 6 57	71.7599991	12/20/2014 6 57	74.9600028	12/20/2014 5 33	75.27
12/20/2014 7 00	72.86000251	12/20/2014 7 43	69.34000064	12/20/2014 6 42	73.66999769	12/20/2014 6 47	71.21	12/20/2014 6 59	67.70000248	12/20/2014 7 00	76.54000144	12/20/2014 7 00	72.04999818	12/20/2014 7 09	74.39000208	12/20/2014 7 48	70.13999912	12/20/2014 7 30	74.16000278	12/20/2014 6 57	74.63
12/20/2014 8 22	72.5500025	12/20/2014 8 41	67.26000062	12/20/2014 7 30	72.50999772	12/20/2014 7 58	71.36	12/20/2014 7 00	67.70000248	12/20/2014 8 00	76.54000144	12/20/2014 8 54	71.76999819	12/20/2014 8 27	73.56000206	12/20/2014 8 54	67.75999915	12/20/2014 8 54	71.78000269	12/20/2014 7 48	74.26
12/20/2014 9 20	71.91000248	12/20/2014 9 25	65.58000061	12/20/2014 8 58	71.86999774	12/20/2014 8 53	69.56	12/20/2014 8 54	67.55000248	12/20/2014 9 00	76.54000144	12/20/2014 9 13	71.67999819	12/20/2014 9 40	73.16000205	12/20/2014 9 55	66.59999916	12/20/2014 9 58	71.17000266	12/20/2014 8 21	73.1
12/20/2014 10 28	71.67000247	12/20/2014 10 36	65.67000061	12/20/2014 9 38	70.66999778	12/20/2014 9 06	69.29	12/20/2014 9 23	67.64000248	12/20/2014 10 00	76.54000144	12/20/2014 10 06	71.70999819	12/20/2014 10 10	73.32000205	12/20/2014 10 01	66.19999917	12/20/2014 10 19	70.74000265	12/20/2014 9 06	72.31
12/20/2014 11 02	71.61000247	12/20/2014 11 22	65.1200006	12/20/2014 10 44	70.73999778	12/20/2014 10 17	69.38	12/20/2014 10 01	67.46000247	12/20/2014 11 00	76.54000144	12/20/2014 11 15	71.46999819	12/20/2014 11 04	73.07000204	12/20/2014 11 18	65.86999917	12/20/2014 11 04	70.74000265	12/20/2014 10 29	72.22
12/20/2014 12 04	70.78000244	12/20/2014 12 09	65.79000061	12/20/2014 11 38	70.1299978	12/20/2014 11 00	69.44	12/20/2014 11 00	67.33000247	12/20/2014 12 00	76.54000144	12/20/2014 12 07	71.55999819	12/20/2014 12 33	72.86000204	12/20/2014 12 33	66.71999916	12/20/2014 12 30	71.32000267	12/20/2014 11 03	71.67
12/20/2014 13 22	70.51000243	12/20/2014 13 22	65.95000061	12/20/2014 12 00	70.88999777	12/20/2014 12 16	69.16	12/20/2014 12 27	67.33000247	12/20/2014 13 00	76.54000144	12/20/2014 13 22	69.84999823	12/20/2014 13 22	73.32000205	12/20/2014 13 23	67.20999916	12/20/2014 13 22	71.57000268	12/20/2014 12 57	72.49
12/20/2014 14 00	72.19000249	12/20/2014 14 00	66.56000062	12/20/2014 13 22	70.51999778	12/20/2014 13 21	68.25	12/20/2014 13 22	65.14000239	12/20/2014 14 00	76.54000144	12/20/2014 14 51	71.0099982	12/20/2014 14 20	73.26000205	12/20/2014 14 32	68.12999914	12/20/2014 14 31	71.87000269	12/20/2014 13 08	72.43
12/20/2014 15 27	72.4600025	12/20/2014 15 21	66.83000062	12/20/2014 14 09	71.70999775	12/20/2014 14 02	70.14	12/20/2014 14 21	68.04000249	12/20/2014 15 00	76.54000144	12/20/2014 15 54	71.82999818	12/20/2014 15 01	73.59000206	12/20/2014 15 19	68.39999914	12/20/2014 15 01	72.51000271	12/20/2014 14 21	72.74
12/20/2014 16 32	71.91000248	12/20/2014 16 22	66.83000062	12/20/2014 15 33	71.89999774	12/20/2014 15 21	70.29	12/20/2014 15 34	67.73000248	12/20/2014 16 00	76.54000144	12/20/2014 16 01	71.76999819	12/20/2014 16 01	73.59000206	12/20/2014 16 15	68.36999914	12/20/2014 16 57	72.58000272	12/20/2014 15 02	72.83

12/20/2014 18 08	72.4900025
12/20/2014 19 12	72.77000251
12/20/2014 20 08	72.6100025
12/20/2014 21 23	73.59000253
12/20/2014 22 18	73.59000253
12/20/2014 23 16	74.14000255
12/21/2014 0 03	75.39000259
12/21/2014 1 10	73.41000253
12/21/2014 2 06	74.57000257
12/21/2014 3 46	75.12000259
12/21/2014 4 00	75.33000259
12/21/2014 5 57	74.48000256
12/21/2014 6 16	73.77000254
12/21/2014 7 04	72.4300025
12/21/2014 8 56	71.24000246
12/21/2014 9 39	70.94000245
12/21/2014 10 34	71.58000247
12/21/2014 11 05	71.18000245
12/21/2014 12 49	70.72000244
12/21/2014 13 00	70.75000244
12/21/2014 14 12	71.21000246
12/21/2014 15 32	72.74000251
12/21/2014 16 22	72.34000249
12/21/2014 17 07	72.07000248
12/21/2014 18 35	72.07000248
12/21/2014 19 23	72.77000251
12/21/2014 20 52	72.6500025
12/21/2014 21 42	72.6800025
12/21/2014 22 15	73.56000253
12/21/2014 23 10	74.20000255
12/22/2014 0 13	73.04000252
12/22/2014 1 10	73.38000253
12/22/2014 2 17	75.06000258
12/22/2014 3 39	75.18000259
12/22/2014 4 59	74.84000258
12/22/2014 5 51	74.51000257
12/22/2014 6 41	72.92000251
12/22/2014 7 25	72.22000249
12/22/2014 8 59	70.45000243
12/22/2014 9 00	70.45000243
12/22/2014 10 01	70.42000243
12/22/2014 11 49	70.05000242
12/22/2014 12 29	69.90000241
12/22/2014 13 10	70.23000242
12/22/2014 14 42	71.97000248
12/22/2014 15 36	69.96000241
12/22/2014 16 09	71.18000245
12/22/2014 17 39	71.79000247
12/22/2014 18 12	71.30000246
12/22/2014 19 00	71.58000247
12/22/2014 20 08	72.34000249
12/22/2014 21 36	72.71000251
12/22/2014 22 34	73.29000252
12/22/2014 23 13	73.19000252
12/23/2014 0 35	72.19000249
12/23/2014 1 02	74.38000256
12/23/2014 2 29	74.63000257
12/23/2014 3 47	74.54000257
12/23/2014 4 32	73.26000252
12/23/2014 5 13	73.38000253
12/23/2014 6 52	73.13000252
12/23/2014 7 58	72.77000251
12/23/2014 8 31	72.40000249
12/23/2014 9 47	71.15000245
12/23/2014 10 12	70.72000244
12/23/2014 11 53	70.17000242
12/23/2014 12 28	70.36000243
12/23/2014 13 27	70.39000243
12/23/2014 14 39	71.36000246
12/23/2014 15 29	71.00000245
12/23/2014 16 22	72.4900025
12/23/2014 17 59	72.6500025
12/23/2014 18 51	72.16000249
12/23/2014 19 01	71.94000248
12/23/2014 20 58	71.55000247
12/23/2014 21 39	70.78000244
12/23/2014 22 00	72.6500025
12/23/2014 23 02	71.82000248
12/24/2014 0 49	71.52000247
12/24/2014 1 03	72.5800025
12/24/2014 2 11	74.93000258
12/24/2014 3 07	74.57000257
12/24/2014 4 58	73.29000252
12/24/2014 5 00	73.29000252
12/24/2014 6 55	73.53000253
12/24/2014 7 41	71.49000246
12/24/2014 8 20	72.37000249
12/24/2014 9 40	70.45000243
12/24/2014 10 27	70.54000243
12/24/2014 11 23	70.81000244
12/24/2014 12 27	71.42000246
12/24/2014 13 57	70.63000244
12/24/2014 14 01	70.91000245
12/24/2014 15 18	71.73000247

12/20/2014 18 16	68.54000064	
12/20/2014 19 16	68.36000063	
12/20/2014 20 58	68.73000064	
12/20/2014 21 00	68.73000064	
12/20/2014 22 05	69.64000065	
12/20/2014 23 00	70.40000065	
12/21/2014 0 03	70.37000065	
12/21/2014 1 10	69.49000065	
12/21/2014 2 29	71.44000066	
12/21/2014 3 46	71.59000067	
12/21/2014 4 18	71.93000067	
12/21/2014 5 54	71.59000067	
12/21/2014 6 26	70.80000066	
12/21/2014 7 59	69.12000064	
12/21/2014 8 38	67.26000062	
12/21/2014 9 44	66.10000061	
12/21/2014 10 31	65.34000061	
12/21/2014 11 01	64.8200006	A
12/21/2014 12 20	65.70000061	
12/21/2014 13 06	66.07000061	
12/21/2014 14 03	66.92000062	
12/21/2014 15 05	67.02000062	
12/21/2014 16 11	67.23000062	
12/21/2014 17 53	67.35000063	
12/21/2014 18 40	67.72000063	
12/21/2014 19 01	67.44000063	
12/21/2014 20 01	68.30000063	
12/21/2014 21 16	68.57000064	
12/21/2014 22 36	69.37000064	
12/21/2014 23 01	70.19000065	
12/22/2014 0 54	70.43000065	
12/22/2014 1 00	71.01000066	
12/22/2014 2 45	71.35000066	
12/22/2014 3 40	71.41000066	
12/22/2014 4 49	70.62000066	
12/22/2014 5 33	70.22000065	
12/22/2014 6 10	67.75000063	
12/22/2014 7 38	68.33000063	
12/22/2014 8 47	66.83000062	
12/22/2014 9 47	67.32000062	
12/22/2014 10 05	64.5700006	A
12/22/2014 11 17	66.71000062	
12/22/2014 12 25	67.02000062	
12/22/2014 13 00	67.96000063	
12/22/2014 14 09	67.99000063	
12/22/2014 15 07	68.24000063	
12/22/2014 16 40	67.47000063	
12/22/2014 17 31	67.63000063	
12/22/2014 18 44	66.80000062	
12/22/2014 19 31	67.72000063	
12/22/2014 20 01	67.66000063	
12/22/2014 21 10	68.45000064	
12/22/2014 22 05	68.79000064	
12/22/2014 23 13	65.28000061	
12/23/2014 0 36	69.64000065	
12/23/2014 1 24	71.14000066	
12/23/2014 2 54	71.75000067	
12/23/2014 3 33	71.38000066	
12/23/2014 4 59	71.11000066	
12/23/2014 5 49	69.95000065	
12/23/2014 6 37	67.87000063	
12/23/2014 7 24	67.47000063	
12/23/2014 8 10	67.75000063	
12/23/2014 9 12	67.20000062	
12/23/2014 10 04	66.80000062	
12/23/2014 11 54	66.71000062	
12/23/2014 12 58	67.35000063	
12/23/2014 13 00	67.35000063	
12/23/2014 14 00	67.66000063	
12/23/2014 15 30	67.14000062	
12/23/2014 16 13	67.47000063	
12/23/2014 17 59	66.01000061	
12/23/2014 18 00	66.01000061	
12/23/2014 19 09	66.80000062	
12/23/2014 20 20	67.81000063	
12/23/2014 21 13	67.60000063	
12/23/2014 22 22	68.63000064	
12/23/2014 23 36	67.84000063	
12/24/2014 0 02	69.95000065	
12/24/2014 1 04	70.62000066	
12/24/2014 2 48	71.35000066	
12/24/2014 3 16	71.35000066	
12/24/2014 4 43	70.98000066	
12/24/2014 5 56	70.37000065	
12/24/2014 6 19	68.73000064	
12/24/2014 7 59	68.30000063	
12/24/2014 8 59	66.80000062	
12/24/2014 9 50	66.04000061	
12/24/2014 10 07	65.0900006	
12/24/2014 11 34	64.5100006	A
12/24/2014 12 26	65.0300006	
12/24/2014 13 00	65.37000061	
12/24/2014 14 15	65.46000061	
12/24/2014 15 09	65.76000061	

12/20/2014 17 41	71.09999776
12/20/2014 18 09	71.18999776
12/20/2014 19 05	71.82999774
12/20/2014 20 15	72.37999773
12/20/2014 21 05	71.82999774
12/20/2014 22 33	70.48999778
12/20/2014 23 00	72.62999772
12/21/2014 0 58	73.66999769
12/21/2014 1 35	73.63999769
12/21/2014 2 28	73.90999768
12/21/2014 3 49	74.14999767
12/21/2014 4 11	74.21999767
12/21/2014 5 57	73.78999768
12/21/2014 6 42	73.53999769
12/21/2014 7 25	72.77999771
12/21/2014 8 56	70.54999778
12/21/2014 9 39	68.34999785
12/21/2014 10 47	70.63999778
12/21/2014 11 49	70.60999778
12/21/2014 12 21	71.49999775
12/21/2014 13 46	71.31999776
12/21/2014 14 16	71.64999775
12/21/2014 15 50	71.40999776
12/21/2014 16 19	70.94999777
12/21/2014 17 06	71.31999776
12/21/2014 18 25	71.82999774
12/21/2014 19 38	71.82999774
12/21/2014 20 12	72.04999774
12/21/2014 21 14	72.16999773
12/21/2014 22 30	70.66999778
12/21/2014 23 06	73.1199977
12/22/2014 0 13	71.49999775
12/22/2014 1 12	73.2699977
12/22/2014 2 43	74.05999767
12/22/2014 3 38	73.63999769
12/22/2014 4 49	73.50999769
12/22/2014 5 34	73.2399977
12/22/2014 6 47	72.62999772
12/22/2014 7 02	72.28999773
12/22/2014 8 55	71.52999775
12/22/2014 9 40	71.89999774
12/22/2014 10 08	72.31999773
12/22/2014 11 25	71.40999776
12/22/2014 12 42	71.95999774
12/22/2014 13 42	72.13999773
12/22/2014 14 41	72.50999772
12/22/2014 15 16	72.56999772
12/22/2014 16 23	72.71999771
12/22/2014 17 28	71.98999774
12/22/2014 18 45	71.58999775
12/22/2014 19 15	72.37999773
12/22/2014 20 50	71.98999774
12/22/2014 21 31	72.04999774
12/22/2014 22 01	72.28999773
12/22/2014 23 14	71.06999777
12/23/2014 0 36	72.47999772
12/23/2014 1 23	73.2399977
12/23/2014 2 41	74.14999767
12/23/2014 3 36	73.38999769
12/23/2014 4 58	73.44999769
12/23/2014 5 22	73.41999769
12/23/2014 6 11	69.9399978
12/23/2014 7 31	71.89999774
12/23/2014 8 38	71.34999776
12/23/2014 9 56	71.03999777
12/23/2014 10 50	70.85999777
12/23/2014 11 07	70.79999777
12/23/2014 12 42	70.21999779
12/23/2014 13 02	71.61999775
12/23/2014 14 30	72.28999773
12/23/2014 15 15	71.92999774
12/23/2014 16 32	71.89999774
12/23/2014 17 54	70.91999777
12/23/2014 18 42	71.24999776
12/23/2014 19 09	71.64999775
12/23/2014 20 30	71.34999776
12/23/2014 21 32	72.25999773
12/23/2014 22 06	71.95999774
12/23/2014 23 02	70.39999779
12/24/2014 0 06	71.73999775
12/24/2014 1 10	72.68999772
12/24/2014 2 00	73.99999768
12/24/2014 3 08	73.1799977
12/24/2014 4 09	74.11999767
12/24/2014 5 44	73.63999769
12/24/2014 6 45	71.79999774
12/24/2014 7 46	72.56999772
12/24/2014 8 13	70.88999777
12/24/2014 9 36	70.60999778
12/24/2014 10 32	70.18999779
12/24/2014 11 18	69.57999781
12/24/2014 12 04	69.75999781
12/24/2014 13 16	70.39999779
12/24/2014 14 14	68.99999783

12/20/2014 17 50	69.9
12/20/2014 18 30	70.48
12/20/2014 19 12	70.66
12/20/2014 20 11	70.84
12/20/2014 21 02	70.29
12/20/2014 22 00	71.36
12/20/2014 23 05	71.64
12/21/2014 0 33	71.7
12/21/2014 1 14	71.12
12/21/2014 2 23	72.31
12/21/2014 3 02	72.28
12/21/2014 4 00	72.43
12/21/2014 5 49	72.13
12/21/2014 6 54	71.39
12/21/2014 7 49	70.75
12/21/2014 8 51	69.9
12/21/2014 9 39	67.97
12/21/2014 10 03	69.62
12/21/2014 11 00	69.68
12/21/2014 12 46	69.35
12/21/2014 13 00	69.41
12/21/2014 14 00	70.17
12/21/2014 15 44	70.14
12/21/2014 16 28	70.36
12/21/2014 17 00	70.42
12/21/2014 18 43	70.2
12/21/2014 19 05	70.69
12/21/2014 20 48	70.87
12/21/2014 21 42	70.26
12/21/2014 22 37	70.17
12/21/2014 23 02	71.67
12/22/2014 0 13	70.97
12/22/2014 1 39	71.21
12/22/2014 2 34	72.31
12/22/2014 3 40	71.27
12/22/2014 4 45	71.94
12/22/2014 5 56	71.15
12/22/2014 6 47	70.54
12/22/2014 7 02	70.39
12/22/2014 8 04	69.93
12/22/2014 9 25	69.74
12/22/2014 10 09	69.13
12/22/2014 11 04	69.47
12/22/2014 12 00	69.68
12/22/2014 13 28	68.19
12/22/2014 14 44	70.54
12/22/2014 15 50	70.23
12/22/2014 16 42	70.75
12/22/2014 17 27	69.68
12/22/2014 18 02	70.2
12/22/2014 19 00	70.42
12/22/2014 20 03	69.62
12/22/2014 21 00	70.51
12/22/2014 22 01	70.14
12/22/2014 23 00	70.57
12/23/2014 0 37	70.29
12/23/2014 1 23	71.45
12/23/2014 2 20	72.28
12/23/2014 3 36	71.52
12/23/2014 4 59	71.7
12/23/2014 5 56	71.06
12/23/2014 6 11	70.05
12/23/2014 7 17	70.48
12/23/2014 8 14	69.71
12/23/2014 9 41	69.07
12/23/2014 10 16	69.59
12/23/2014 11 36	68.68
12/23/2014 12 54	70.05
12/23/2014 13 00	70.45
12/23/2014 14 39	70.29
12/23/2014 15 00	70.14
12/23/2014 16 47	70.6
12/23/2014 17 24	70.23
12/23/2014 18 34	70.17
12/23/2014 19 25	69.71
12/23/2014 20 05	70.32
12/23/2014 21 13	69.5
12/23/2014 22 04	70.63
12/23/2014 23 02	68.58
12/24/2014 0 49	69.87
12/24/2014 1 03	71.18
12/24/2014 2 34	72.13
12/24/2014 3 05	71.67
12/24/2014 4 41	71.82
12/24/2014 5 58	71.94
12/24/2014 6 47	70.11
12/24/2014 7 59	70.69
12/24/2014 8 26	70.2
12/24/2014 9 11	69.29
12/24/2014 10 05	69.41
12/24/2014 11 27	69.5
12/24/2014 12 10	69.68
12/24/2014 13 02	69.87
12/24/2014 14 30	69.44

12/20/2014 17 15	68.1000025
12/20/2014 18 08	68.2800025
12/20/2014 19 12	68.3100025
12/20/2014 20 52	68.43000251
12/20/2014 21 10	68.80000252
12/20/2014 22 32	68.43000251
12/20/2014 23 00	69.14000253
12/21/2014 0 03	69.93000256
12/21/2014 1 10	68.1600025
12/21/2014 2 11	69.17000254
12/21/2014 3 05	69.44000255
12/21/2014 4 27	69.81000256
12/21/2014 5 49	69.17000254
12/21/2014 6 16	68.40000251
12/21/2014 7 04	67.30000247
12/21/2014 8 56	67.70000248
12/21/2014 9 40	66.02000242
12/21/2014 10 06	67.52000247
12/21/2014 11 22	67.61000248
12/21/2014 12 46	66.63000244
12/21/2014 13 00	66.79000245
12/21/2014 14 09	67.52000247
12/21/2014 15 52	68.1300025
12/21/2014 16 02	67.85000249
12/21/2014 17 00	67.95000249
12/21/2014 18 29	67.91000249
12/21/2014 19 01	68.37000251
12/21/2014 20 48	67.61000248
12/21/2014 21 42	67.95000249
12/21/2014 22 37	68.37000251
12/21/2014 23 10	68.92000253
12/22/2014 0 13	66.72000245
12/22/2014 1 14	68.3100025
12/22/2014 2 09	69.32000254
12/22/2014 3 39	68.74000252
12/22/2014 4 49	68.95000253
12/22/2014 5 04	68.56000251
12/22/2014 6 41	67.88000249
12/22/2014 7 25	67.52000247
12/22/2014 8 46	66.02000242
12/22/2014 9 57	66.02000242
12/22/2014 10 01	65.14000239
12/22/2014 11 58	66.33000243
12/22/2014 12 29	65.81000241
12/22/2014 13 14	66.30000243
12/22/2014 14 14	66.24000243
12/22/2014 15 11	65.96000242
12/22/2014 16 09	66.36000243
12/22/2014 17 07	66.85000245
12/22/2014 18 58	66.75000245
12/22/2014 19 00	66.75000245
12/22/2014 20 04	67.88000249
12/22/2014 21 06	67.88000249
12/22/2014 22 05	68.3400025
12/22/2014 23 13	68.1300025
12/23/2014 0 37	66.39000243
12/23/2014 1 23	68.65000252
12/23/2014 2 12	69.41000254
12/23/2014 3 32	68.80000252
12/23/2014 4 49	68.2800025
12/23/2014 5 13	67.98000249
12/23/2014 6 48	67.95000249
12/23/2014 7 23	68.1000025
12/23/2014 8 23	67.70000248
12/23/2014 9 47	67.00000246
12/23/2014 10 12	66.42000243
12/23/2014 11 53	66.82000245
12/23/2014 12 28	66.17000243
12/23/2014 13 40	67.12000246
12/23/2014 14 29	67.03000246
12/23/2014 15 21	67.30000247
12/23/2014 16 18	67.79000248
12/23/2014 17 55	67.55000248
12/23/2014 18 53	67.76000248
12/23/2014 19 26	67.52000247
12/23/2014 20 58	67.18000246
12/23/2014 21 00	67.18000246
12/23/2014 22 21	67.15000246
12/23/2014 23 02	66.45000244
12/24/2014 0 49	65.72000241
12/24/2014 1 03	66.69000244
12/24/2014 2 05	69.38000254
12/24/2014 3 07	69.50000255
12/24/2014 4 58	68.04000249
12/24/2014 5 00	68.04000249
12/24/2014 6 45	68.37000251
12/24/2014 7 06	67.06000246
12/24/2014 8 30	67.73000248
12/24/2014 9 36	67.06000246
12/24/2014 10 50	67.09000246
12/24/2014 11 02	66.94000245
12/24/2014 12 56	67.79000248
12/24/2014 13 16	67.37000247
12/24/2014 14 14	67.73000248

12/20/2014 18 00	76.54000144
12/20/2014 19 00	76.54000144
12/20/2014 20 00	76.54000144
12/20/2014 21 00	76.54000144
12/20/2014 22 00	76.54000144
12/20/2014 23 00	76.54000144
12/21/2014 0 00	76.54000144
12/21/2014 1 00	76.54000144
12/21/2014 2 00	76.54000144
12/21/2014 3 00	76.54000144
12/21/2014 4 00	76.54000144
12/21/2014 5 00	76.54000144
12/21/2014 6 00	76.54000144
12/21/2014 7 00	76.54000144
12/21/2014 8 00	76.54000144
12/21/2014 9 00	76.54000144
12/21/2014 10 00	76.54000144
12/21/2014 11 00	76.54000144
12/21/2014 12 00	76.54000144
12/21/2014 13 00	76.54000144
12/21/2014 14 00	76.54000144
12/21/2014 15 00	76.54000144
12/21/2014 16 00	76.54000144
12/21/2014 17 00	76.54000144
12/21/2014 18 00	76.54000144
12/21/2014 19 00	76.54000144
12/21/2014 20 00	76.54000144
12/21/2014 21 00	76.54000144
12/21/2014 22 00	76.54000144
12/21/2014 23 00	76.54000144
12/22/2014 0 00	76.54000144
12/22/2014 1 00	76.54000144
12/22/2014 2 00	76.54000144
12/22/2014 3 00	76.54000144
12/22/2014 4 00	76.54000144
12/22/2014 5 00	76.54000144
12/22/2014 6 00	76.54000144
12/22/2014 7 00	76.54000144
12/22/2014 8 00	76.54000144
12/22/2014 9 00	76.54000144
12/22/2014 10 00	76.54000144
12/22/2014 11 00	76.54000144
12/22/2014 12 00	76.54000144
12/22/2014 13 00	76.54000144
12/22/2014 14 00	76.54000144
12/22/2014 15 00	76.54000144
12/22/2014 16 00	76.54000144
12/22/2014 17 00	76.54000144
12/22/2014 18 00	76.54000144
12/22/2014 19 00	76.54000144
12/22/2014 20 00	76.54000144
12/22/2014 21 00	76.54000144
12/22/2014 22 00	76.54000144
12/22/2014 23 00	76.54000144
12/23/2014 0 00	76.54000144
12/23/2014 1 00	76.54000144
12/23/2014 2 00	76.54000144
12/23/2014 3 00	76.54000144
12/23/2014 4 00	76.54000144
12/23/2014 5 00	76.54000144
12/23/2014 6 00	76.54000144
12/23/2014 7 00	76.54000144
12/23/2014 8 00	76.54000144
12/23/2014 9 00	76.54000144
12/23/2014 10 00	76.54000144
12/23/2014 11 00	76.54000144
12/23/2014 12 00	76.54000144
12/23/2014 13 00	76.54000144
12/23/2014 14 00	76.54000144
12/23/2014 15 00	76.54000144
12/23/2014 16 00	76.54000144
12/23/2014 17 00	76.54000144
12/23/2014 18 00	76.54000144
12/23/2014 19 00	76.54000144
12/23/2014 20 00	76.54000144
12/23/2014 21 00	76.54000144
12/23/2014 22 00	76.54000144
12/23/2014 23 00	76.54000144
12/24/2014 0 00	76.54000144
12/24/2014 1 00	76.54000144
12/24/2014 2 00	76.54000144
12/24/2014 3 00	76.54000144
12/24/2014 4 00	76.54000144
12/24/2014 5 00	76.54000144
12/24/2014 6 00	76.54000144
12/24/2014 7 00	76.54000144
12/24/2014 8 00	76.54000144
12/24/2014 9 00	76.54000144
12/24/2014 10 00	76.54000144
12/24/2014 11 00	76.54000144
12/24/2014 12 00	76.54000144
12/24/2014 13 00	76.54000144
12/24/2014 14 00	76.54000144
12/24/2014 15 00	76.54000144

12/20/2014 18 31	72.01999818
12/20/2014 19 26	71.98999818
12/20/2014 20 56	72.37999817
12/20/2014 21 00	72.37999817
12/20/2014 22 33	71.98999818
12/20/2014 23 02	72.62999816
12/21/2014 0 02	73.38999815
12/21/2014 1 09	68.77999826
12/21/2014 2 28	72.83999816
12/21/2014 3 27	73.32999815
12/21/2014 4 20	73.20999815
12/21/2014 5 41	72.74999816
12/21/2014 6 58	72.10999818
12/21/2014 7 04	71.2499982
12/21/2014 8 56	70.82999821
12/21/2014 9 39	70.82999821
12/21/2014 10 01	71.76999819
12/21/2014 11 19	71.49999819
12/21/2014 12 45	68.95999825
12/21/2014 13 01	71.2499982
12/21/2014 14 05	71.2499982
12/21/2014 15 05	71.89999818
12/21/2014 16 23	71.89999818
12/21/2014 17 35	72.16999818
12/21/2014 18 31	71.98999818
12/21/2014 19 59	71.92999818
12/21/2014 20 48	72.16999818
12/21/2014 21 42	72.07999818
12/21/2014 22 29	70.82999821
12/21/2014 23 01	72.43999817
12/22/2014 0 12	68.47999826
12/22/2014 1 01	71.92999818
12/22/2014 2 09	72.86999816
12/22/2014 3 39	72.28999817
12/22/2014 4 49	71.61999819
12/22/2014 5 04	72.19999818
12/22/2014 6 38	71.46999819
12/22/2014 7 25	71.2799982
12/22/2014 8 59	70.76999821
12/22/2014 9 25	70.36999822
12/22/2014 10 01	70.27999822
12/22/2014 11 42	70.24999822
12/22/2014 12 29	70.02999823
12/22/2014 13 04	70.36999822
12/22/2014 14 42	70.21999822
12/22/2014 15 11	70.51999822
12/22/2014 16 28	70.54999821
12/22/2014 17 02	70.30999822
12/22/2014 18 05	70.91999821
12/22/2014 19 57	71.2799982
12/22/2014 20 00	71.3199982
12/22/2014 21 02	71.49999819
12/22/2014 22 58	71.2499982
12/22/2014 23 01	70.54999821
12/23/2014 0 36	67.73999828
12/23/2014 1 30	70.66999821
12/23/2014 2 23	72.19999818
12/23/2014 3 32	72.19999818
12/23/2014 4 33	71.85999818
12/23/2014 5 14	71.67999819
12/23/2014 6 10	71.49999819
12/23/2014 7 09	71.76999819
12/23/2014 8 57	71.0099982
12/23/2014 9 00	70.9799982
12/23/2014 10 37	69.02999825
12/23/2014 11 14	70.82999821
12/23/2014 12 27	70.69999821
12/23/2014 13 04	71.2199982
12/23/2014 14 42	70.66999821
12/23/2014 15 29	70.69999821
12/23/2014 16 24	71.2799982
12/23/2014 17 55	71.43999819
12/23/2014 18 13	71.37999819
12/23/2014 19 25	71.40999819
12/23/2014 20 21	71.2499982
12/23/2014 21 12	71.1599982
12/23/2014 22 06	71.58999819
12/23/2014 23 01	69.99999823
12/24/2014 0 49	67.95999828
12/24/2014 1 03	69.60999824
12/24/2014 2 00	72.56999817
12/24/2014 3 08	72.43999817
12/24/2014 4 56	72.28999817
12/24/2014 5 03	72.34999817
12/24/2014 6 46	71.82999818
12/24/2014 7 10	71.49999819
12/24/2014 8 24	71.55999819
12/24/2014 9 53	71.0999982
12/24/2014 10 49	70.91999821
12/24/2014 11 03	71.0999982
12/24/2014 12 29	71.85999818
12/24/2014 13 16	71.85999818
12/24/2014 14 25	71.58999819
12/24/2014 15 21	71.95999818

12/20/2014 18 30	73.56000206
12/20/2014 19 20	74.08000207
12/20/2014 20 01	74.23000208
12/20/2014 21 18	74.20000208
12/20/2014 22 33	73.44000205
12/20/2014 23 00	74.60000209
12/21/2014 0 00	74.63000209
12/21/2014 1 09	73.53000206
12/21/2014 2 28	74.84000209
12/21/2014 3 28	75.27000211
12/21/2014 4 18	75.39000211
12/21/2014 5 44	75.27000211
12/21/2014 6 49	74.66000209
12/21/2014 7 25	74.17000208
12/21/2014 8 56	72.68000203
12/21/2014 9 39	70.36000197
12/21/2014 10 50	72.98000204
12/21/2014 11 41	72.52000203
12/21/2014 12 46	72.19000202
12/21/2014 13 40	73.38000205
12/21/2014 14 38	73.16000205
12/21/2014 15 53	72.40000203
12/21/2014 16 06	73.47000206
12/21/2014 17 29	73.68000206
12/21/2014 18 47	73.53000206
12/21/2014 19 09	73.84000207
12/21/2014 20 38	74.08000207
12/21/2014 21 11	74.11000207
12/21/2014 22 30	72.28000202
12/21/2014 23 00	74.39000208
12/22/2014 0 13	73.07000204
12/22/2014 1 00	74.39000208
12/22/2014 2 43	74.9700021
12/22/2014 3 39	75.0300021
12/22/2014 4 49	74.63000209
12/22/2014 5 34	74.72000209
12/22/2014 6 48	74.11000207
12/22/2014 7 37	73.84000207
12/22/2014 8 59	73.59000206
12/22/2014 9 12	73.10000205
12/22/2014 10 36	73.41000205
12/22/2014 11 25	73.74000206
12/22/2014 12 02	74.08000207
12/22/2014 13 00	74.23000208
12/22/2014 14 25	74.39000208
12/22/2014 15 16	74.42000208
12/22/2014 16 00	74.51000209
12/22/2014 17 54	73.62000206
12/22/2014 18 41	73.19000205
12/22/2014 19 26	74.08000207
12/22/2014 20 19	73.96000207
12/22/2014 21 03	74.02000207
12/22/2014 22 04	73.74000206
12/22/2014 23 02	73.16000205
12/23/2014 0 36	73.29000205
12/23/2014 1 23	74.57000209
12/23/2014 2 24	75.0300021
12/23/2014 3 55	74.78000209
12/23/2014 4 34	74.51000209
12/23/2014 5 57	74.8700021
12/23/2014 6 10	73.32000205
12/23/2014 7 06	73.65000206
12/23/2014 8 27	73.53000206
12/23/2014 9 06	73.53000206
12/23/2014 10 38	72.86000204
12/23/2014 11 06	73.53000206
12/23/2014 12 45	73.35000205
12/23/2014 13 00	73.47000206
12/23/2014 14 25	73.90000207
12/23/2014 15 42	73.87000207
12/23/2014 16 14	73.32000205
12/23/2014 17 25	73.50000206
12/23/2014 18 41	73.68000206
12/23/2014 19 26	73.81000207
12/23/2014 20 09	73.93000207
12/23/2014 21 40	74.11000207
12/23/2014 22 07	73.56000206
12/23/2014 23 41	72.68000203
12/24/2014 0 50	72.37000202
12/24/2014 1 04	74.29000208
12/24/2014 2 04	75.21000211
12/24/2014 3 09	74.63000209
12/24/2014 4 09	75.1800021
12/24/2014 5 44	74.9000021
12/24/2014 6 50	73.65000206
12/24/2014 7 06	73.87000207
12/24/2014 8 23	73.44000205
12/24/2014 9 40	72.98000204
12/24/2014 10 06	72.74000203
12/24/2014 11 13	72.68000203
12/24/2014 12 04	72.28000202
12/24/2014 13 17	72.62000203
12/24/2014 14 59	72.71000203
12/24/2014 15 00	72.71000203

12/20/2014 18 10	68.30999914
12/20/2014 19 17	69.25999913
12/20/2014 20 02	69.86999912
12/20/2014 21 07	69.52999913
12/20/2014 22 26	70.68999911
12/20/2014 23 02	71.11999911
12/21/2014 0 33	71.9399991
12/21/2014 1 10	70.04999912
12/21/2014 2 11	72.88999909
12/21/2014 3 05	72.85999909
12/21/2014 4 18	73.09999909
12/21/2014 5 35	72.64999909
12/21/2014 6 21	72.2199991
12/21/2014 7 59	70.62999911
12/21/2014 8 56	67.17999916
12/21/2014 9 40	65.77999917
12/21/2014 10 55	66.23999917
12/21/2014 11 01	65.80999917
12/21/2014 12 05	66.35999917
12/21/2014 13 00	66.93999916
12/21/2014 14 26	67.97999915
12/21/2014 15 53	68.15999914
12/21/2014 16 06	68.48999914
12/21/2014 17 12	68.45999914
12/21/2014 18 25	68.30999914
12/21/2014 19 02	69.06999913
12/21/2014 20 00	69.28999913
12/21/2014 21 15	69.61999913
12/21/2014 22 40	69.25999913
12/21/2014 23 02	70.80999911
12/22/2014 0 13	70.41999912
12/22/2014 1 40	72.0699991
12/22/2014 2 44	72.70999909
12/22/2014 3 39	72.54999909
12/22/2014 4 48	72.0999991
12/22/2014 5 57	70.83999911
12/22/2014 6 38	69.74999913
12/22/2014 7 11	69.28999913
12/22/2014 8 46	68.70999914
12/22/2014 9 07	68.45999914
12/22/2014 10 01	68.00999915
12/22/2014 11 30	68.58999914
12/22/2014 12 26	69.19999913
12/22/2014 13 19	69.37999913
12/22/2014 14 00	69.77999913
12/22/2014 15 59	69.16999913
12/22/2014 16 00	69.16999913
12/22/2014 17 44	68.85999914
12/22/2014 18 27	68.58999914
12/22/2014 19 05	69.09999913
12/22/2014 20 00	69.58999913
12/22/2014 21 06	69.40999913
12/22/2014 22 01	69.77999913
12/22/2014 23 13	68.21999914
12/23/2014 0 37	69.95999912
12/23/2014 1 30	71.6999991
12/23/2014 2 24	72.57999909
12/23/2014 3 45	72.76999909
12/23/2014 4 59	72.2199991
12/23/2014 5 57	71.38999911
12/23/2014 6 37	69.28999913
12/23/2014 7 18	69.25999913
12/23/2014 8 10	68.85999914
12/23/2014 9 06	68.24999914
12/23/2014 10 54	67.35999915
12/23/2014 11 53	68.42999914
12/23/2014 12 10	68.51999914
12/23/2014 13 46	68.64999914
12/23/2014 14 07	68.91999914
12/23/2014 15 03	69.19999913
12/23/2014 16 36	69.22999913
12/23/2014 17 25	68.79999914
12/23/2014 18 28	68.82999914
12/23/2014 19 26	68.55999914
12/23/2014 20 09	68.91999914
12/23/2014 21 13	68.85999914
12/23/2014 22 07	69.49999913
12/23/2014 23 01	68.06999915
12/24/2014 0 50	70.74999911
12/24/2014 1 04	71.41999911
12/24/2014 2 23	72.67999909
12/24/2014 3 05	72.39999909
12/24/2014 4 59	72.64999909
12/24/2014 5 45	71.9699991
12/24/2014 6 49	69.61999913
12/24/2014 7 06	69.74999913
12/24/2014 8 33	68.21999914
12/24/2014 9 43	67.17999916
12/24/2014 10 07	67.02999916
12/24/2014 11 23	66.32999917
12/24/2014 12 38	66.90999916
12/24/2014 13 08	66.74999916
12/24/2014 14 05	66.53999916
12/24/2014 15 00	66.29999917

12/20/2014 18 01	71.81000269
12/20/2014 19 06	73.31000274
12/20/2014 20 35	73.58000275
12/20/2014 21 14	73.77000276
12/20/2014 22 00	74.19000278
12/20/2014 23 04	74.56000279
12/21/2014 0 22	74.9600028
12/21/2014 1 10	73.34000274
12/21/2014 2 33	75.60000283
12/21/2014 3 43	75.57000283
12/21/2014 4 53	75.75000283
12/21/2014 5 47	75.29000282
12/21/2014 6 47	75.29000282
12/21/2014 7 58	73.61000275
12/21/2014 8 56	71.08000266
12/21/2014 9 32	70.26000263
12/21/2014 10 14	70.80000265
12/21/2014 11 08	70.68000265
12/21/2014 12 57	71.29000267
12/21/2014 13 01	70.84000265
12/21/2014 14 06	72.2400027
12/21/2014 15 33	72.33000271
12/21/2014 16 20	72.48000271
12/21/2014 17 26	72.33000271
12/21/2014 18 37	72.58000272
12/21/2014 19 21	72.61000272
12/21/2014 20 12	73.34000274
12/21/2014 21 11	73.61000275
12/21/2014 22 00	73.70000276
12/21/2014 23 10	74.47000279
12/22/2014 0 12	73.92000277
12/22/2014 1 00	74.9300028
12/22/2014 2 35	75.72000283
12/22/2014 3 40	75.38000282
12/22/2014 4 38	75.54000283
12/22/2014 5 53	74.19000278
12/22/2014 6 46	73.46000275
12/22/2014 7 12	72.73000272
12/22/2014 8 15	72.88000273
12/22/2014 9 13	72.76000272
12/22/2014 10 05	72.39000271
12/22/2014 11 08	72.39000271
12/22/2014 12 29	72.91000273
12/22/2014 13 19	73.09000274
12/22/2014 14 22	73.31000274
12/22/2014 15 15	73.70000276
12/22/2014 16 45	73.55000275
12/22/2014 17 44	73.00000273
12/22/2014 18 43	72.79000272
12/22/2014 19 05	72.76000272
12/22/2014 20 00	73.28000274
12/22/2014 21 00	73.40000275
12/22/2014 22 01	73.40000275
12/22/2014 23 13	70.93000266
12/23/2014 0 37	72.94000273
12/23/2014 1 31	74.8000028
12/23/2014 2 01	75.35000282
12/23/2014 3 47	75.32000282
12/23/2014 4 59	75.20000281
12/23/2014 5 57	74.62000279
12/23/2014 6 49	72.91000273
12/23/2014 7 06	73.25000274
12/23/2014 8 54	72.82000273
12/23/2014 9 06	71.87000269
12/23/2014 10 54	72.27000271
12/23/2014 11 20	72.67000272
12/23/2014 12 29	72.88000273
12/23/2014 13 58	72.97000273
12/23/2014 14 44	72.91000273
12/23/2014 15 30	73.09000274
12/23/2014 16 36	73.00000273
12/23/2014 17 36	72.88000273
12/23/2014 18 49	72.48000271
12/23/2014 19 16	72.67000272
12/23/2014 20 20	72.79000272
12/23/2014 21 29	73.61000275
12/23/2014 22 08	73.31000274
12/23/2014 23 02	72.58000272
12/24/2014 0 50	73.67000276
12/24/2014 1 03	75.02000281
12/24/2014 2 40	75.47000282
12/24/2014 3 16	75.38000282
12/24/2014 4 56	75.35000282
12/24/2014 5 45	74.62000279
12/24/2014 6 56	72.97000273
12/24/2014 7 22	73.40000275
12/24/2014 8 59	72.67000272
12/24/2014 9 40	71.78000269
12/24/2014 10 07	71.08000266
12/24/2014 11 20	70.96000266
12/24/2014 12 25	71.29000267
12/24/2014 13 08	71.11000266
12/24/2014 14 06	71.11000266
12/24/2014 15 00	71.51000268

12/20/2014 17 30	72.92
12/20/2014 18 43	73.16
12/20/2014 19 47	74.08
12/20/2014 20 26	74.35
12/20/2014 21 00	73.53
12/20/2014 22 03	74.6
12/20/2014 23 40	74.93
12/21/2014 0 03	75.06
12/21/2014 1 10	75.15
12/21/2014 2 47	75.54
12/21/2014 3 04	75.88
12/21/2014 4 08	75.91
12/21/2014 5 31	75.79
12/21/2014 6 43	75.18
12/21/2014 7 37	74.84
12/21/2014 8 51	73.22
12/21/2014 9 40	71.48
12/21/2014 10 25	72.13
12/21/2014 11 24	72.19
12/21/2014 12 32	72.31
12/21/2014 13 08	72.4
12/21/2014 14 25	71.94
12/21/2014 15 35	72.74
12/21/2014 16 07	73.16
12/21/2014 17 36	72.64
12/21/2014 18 10	73.5
12/21/2014 19 06	73.68
12/21/2014 20 05	73.47
12/21/2014 21 16	73.74
12/21/2014 22 02	73.8
12/21/2014 23 00	74.75
12/22/2014 0 12	73.74
12/22/2014 1 01	75.12
12/22/2014 2 11	75.7
12/22/2014 3 40	76
12/22/2014 4 49	75.12
12/22/2014 5 53	74.81
12/22/2014 6 48	74.08
12/22/2014 7 12	73.56
12/22/2014 8 50	73.32
12/22/2014 9 03	72.68
12/22/2014 10 05	70.72
12/22/2014 11 01	72.83
12/22/2014 12 24	73.13
12/22/2014 13 12	72.92
12/22/2014 14 01	73.68
12/22/2014 15 46	73.5
12/22/2014 16 29	73.62
12/22/2014 17 55	73.16
12/22/2014 18 21	73.19
12/22/2014 19 46	73.56
12/22/2014 20 39	73.84
12/22/2014 21 13	73.68
12/22/2014 22 35	74.08
12/22/2014 23 13	73.9
12/23/2014 0 37	74.23
12/23/2014 1 35	75.21
12/23/2014 2 01	75.57
12/23/2014 3 40	75.42
12/23/2014 4 37	74.84
12/23/2014 5 50	74.29
12/23/2014 6 37	73.59
12/23/2014 7 01	73.8
12/23/2014 8 46	73.5
12/23/2014 9 47	73.01
12/23/2014 10 39	73.19
12/23/2014 11 52	72.74
12/23/2014 12 29	72.8
12/23/2014 13 39	72.98
12/23/2014 14 48	73.65
12/23/2014 15 37	72.95
12/23/2014 16 07	73.35
12/23/2014 17 20	72.64
12/23/2014 18 11	72.68
12/23/2014 19 57	72.98
12/23/2014 20 20	72.37
12/23/2014 21 12	73.07
12/23/2014 22 19	73.96
12/23/2014 23 36	73.99
12/24/2014 0 05	74.48
12/24/2014 1 04	74.96
12/24/2014 2 21	75.67
12/24/2014 3 08	75.48
12/24/2014 4 43	75.48
12/24/2014 5 04	75.3
12/24/2014 6 33	74.08
12/24/2014 7 09	73.71
12/24/2014 8 33	72.77
12/24/2014 9 44	72.61
12/24/2014 10 04	72.25
12/24/2014 11 23	72.06
12/24/2014 12 36	72.13
12/24/2014 13 17	71.85
12/24/2014 14 59	72

12/24/2014 16 50	69.38000239	12/24/2014 16 50	67.41000063	12/24/2014 15 22	70.54999778	12/24/2014 15 15	69.71	12/24/2014 15 09	68.1300025	12/24/2014 16 00	76.54000144	12/24/2014 16 50	69.38999824	12/24/2014 16 41	73.44000205	12/24/2014 16 01	67.84999915	12/24/2014 16 01	72.27000271	12/24/2014 15 52	71.7
12/24/2014 17 36	72.74000251	12/24/2014 17 29	67.47000063	12/24/2014 16 44	70.36999779	12/24/2014 16 50	67.85	12/24/2014 16 50	65.66000241	12/24/2014 17 00	76.54000144	12/24/2014 17 36	72.28999817	12/24/2014 17 03	73.84000207	12/24/2014 17 02	68.76999914	12/24/2014 17 08	73.03000273	12/24/2014 16 18	72.34
12/24/2014 18 39	70.91000245	12/24/2014 18 24	68.30000063	12/24/2014 17 45	71.34999776	12/24/2014 17 58	70.48	12/24/2014 17 01	68.43000251	12/24/2014 18 00	76.54000144	12/24/2014 18 39	70.15999822	12/24/2014 18 15	73.59000206	12/24/2014 18 39	68.64999914	12/24/2014 18 19	73.40000275	12/24/2014 17 05	73.59
12/24/2014 19 00	73.29000252	12/24/2014 19 37	69.27000064	12/24/2014 18 49	71.43999775	12/24/2014 18 39	66.54	12/24/2014 18 40	66.30000243	12/24/2014 19 00	76.54000144	12/24/2014 19 44	72.53999817	12/24/2014 19 49	73.90000207	12/24/2014 19 01	70.25999912	12/24/2014 19 00	73.83000276	12/24/2014 18 40	73.59
12/24/2014 20 20	73.68000254	12/24/2014 20 19	69.58000065	12/24/2014 19 14	71.89999774	12/24/2014 19 14	71.15	12/24/2014 19 31	69.07000253	12/24/2014 20 00	76.54000144	12/24/2014 20 34	72.68999816	12/24/2014 20 16	73.99000207	12/24/2014 20 05	70.62999911	12/24/2014 20 19	73.98000277	12/24/2014 19 20	74.05
12/24/2014 21 22	73.99000255	12/24/2014 21 39	69.85000065	12/24/2014 20 16	72.40999772	12/24/2014 20 43	71.15	12/24/2014 20 47	69.04000253	12/24/2014 21 00	76.54000144	12/24/2014 21 49	72.71999816	12/24/2014 21 36	73.71000206	12/24/2014 21 31	70.62999911	12/24/2014 21 24	73.70000276	12/24/2014 20 59	74.51
12/24/2014 22 01	73.62000254	12/24/2014 22 38	69.55000065	12/24/2014 21 05	72.62999772	12/24/2014 21 10	71.09	12/24/2014 21 49	69.14000253	12/24/2014 22 00	76.54000144	12/24/2014 22 13	72.83999816	12/24/2014 22 38	73.96000207	12/24/2014 22 03	70.77999911	12/24/2014 22 13	73.92000277	12/24/2014 21 34	73.99
12/24/2014 23 23	74.11000255	12/24/2014 23 14	69.98000065	12/24/2014 22 38	72.62999772	12/24/2014 22 28	71.18	12/24/2014 22 32	69.11000253	12/24/2014 23 00	76.54000144	12/24/2014 23 24	72.77999816	12/24/2014 23 30	73.96000207	12/24/2014 23 04	70.74999911	12/24/2014 23 00	73.98000277	12/24/2014 22 37	74.9
12/25/2014 0 54	74.75000257	12/25/2014 0 13	70.62000066	12/24/2014 23 27	72.53999772	12/24/2014 23 58	71.36	12/24/2014 23 03	69.14000253	12/25/2014 0 00	76.54000144	12/25/2014 0 06	73.29999815	12/25/2014 0 07	74.26000208	12/25/2014 0 00	71.5199991	12/25/2014 0 00	74.47000279	12/24/2014 23 31	74.87
12/25/2014 1 21	70.23000242	12/25/2014 1 14	70.37000065	12/25/2014 0 22	73.0899977	12/25/2014 0 00	71.36	12/25/2014 0 17	69.69000255	12/25/2014 1 00	76.54000144	12/25/2014 1 21	68.25999827	12/25/2014 1 21	74.35000208	12/25/2014 1 22	69.40999913	12/25/2014 1 06	75.26000282	12/25/2014 0 35	75.36
12/25/2014 2 31	75.12000259	12/25/2014 2 07	71.20000066	12/25/2014 1 27	72.71999771	12/25/2014 1 27	70.87	12/25/2014 1 21	65.3500024	12/25/2014 2 00	76.54000144	12/25/2014 2 13	73.01999816	12/25/2014 2 02	75.1800021	12/25/2014 2 07	72.61999909	12/25/2014 2 07	75.57000283	12/25/2014 1 14	75.39
12/25/2014 3 00	75.5100026	12/25/2014 3 13	71.84000067	12/25/2014 2 51	74.08999767	12/25/2014 2 12	72.1	12/25/2014 2 12	69.17000254	12/25/2014 3 00	76.54000144	12/25/2014 3 04	73.32999815	12/25/2014 3 00	75.27000211	12/25/2014 3 02	73.12999909	12/25/2014 3 02	75.93000284	12/25/2014 2 50	75.85
12/25/2014 4 28	75.6400026	12/25/2014 4 35	72.05000067	12/25/2014 3 48	74.39999766	12/25/2014 3 20	72.28	12/25/2014 3 04	69.87000256	12/25/2014 4 00	76.54000144	12/25/2014 4 09	73.47999814	12/25/2014 4 42	75.39000211	12/25/2014 4 19	73.19999908	12/25/2014 4 44	75.90000284	12/25/2014 3 20	75.97
12/25/2014 5 51	75.33000259	12/25/2014 5 43	71.59000067	12/25/2014 4 49	74.33999766	12/25/2014 4 18	72.49	12/25/2014 4 08	70.14000257	12/25/2014 5 00	76.54000144	12/25/2014 5 07	72.68999816	12/25/2014 5 08	74.08000207	12/25/2014 5 55	72.57999909	12/25/2014 5 02	75.26000282	12/25/2014 4 20	76.37
12/25/2014 6 30	74.45000256	12/25/2014 6 03	70.95000066	12/25/2014 5 54	73.87999768	12/25/2014 5 07	71.79	12/25/2014 5 01	69.65000255	12/25/2014 6 00	76.54000144	12/25/2014 6 30	72.62999816	12/25/2014 6 36	74.69000209	12/25/2014 6 44	72.2499991	12/25/2014 6 56	75.29000282	12/25/2014 5 43	75.42
12/25/2014 7 03	73.96000255	12/25/2014 7 02	70.01000065	12/25/2014 6 19	73.56999769	12/25/2014 6 30	71.79	12/25/2014 6 55	69.04000253	12/25/2014 7 00	76.54000144	12/25/2014 7 08	71.98999818	12/25/2014 7 15	74.14000207	12/25/2014 7 14	71.14999911	12/25/2014 7 33	74.41000278	12/25/2014 6 19	75.48
12/25/2014 8 27	73.07000252	12/25/2014 8 53	67.50000063	12/25/2014 7 14	72.62999772	12/25/2014 7 15	70.94	12/25/2014 7 09	68.43000251	12/25/2014 8 00	76.54000144	12/25/2014 8 27	71.95999818	12/25/2014 8 07	73.99000207	12/25/2014 8 54	68.45999914	12/25/2014 8 44	72.73000272	12/25/2014 7 13	74.08
12/25/2014 9 31	72.83000251	12/25/2014 9 25	67.17000062	12/25/2014 8 06	72.07999773	12/25/2014 8 06	70.39	12/25/2014 8 27	68.01000249	12/25/2014 9 00	76.54000144	12/25/2014 9 27	72.01999818	12/25/2014 9 25	73.90000207	12/25/2014 9 36	68.21999914	12/25/2014 9 46	72.27000271	12/25/2014 8 54	73.07
12/25/2014 10 08	71.82000248	12/25/2014 10 36	67.17000062	12/25/2014 9 52	71.98999774	12/25/2014 9 31	70.02	12/25/2014 9 45	67.91000249	12/25/2014 10 00	76.54000144	12/25/2014 10 38	72.10999818	12/25/2014 10 30	73.62000206	12/25/2014 10 32	67.32999915	12/25/2014 10 20	72.0000027	12/25/2014 9 33	73.35
12/25/2014 11 01	72.13000249	12/25/2014 11 26	66.41000062	12/25/2014 10 20	71.79999774	12/25/2014 10 41	70.32	12/25/2014 10 06	67.82000249	12/25/2014 11 00	76.54000144	12/25/2014 11 00	72.04999818	12/25/2014 11 14	73.62000206	12/25/2014 11 21	66.96999916	12/25/2014 11 10	71.93000269	12/25/2014 10 19	72.61
12/25/2014 12 18	71.94000248	12/25/2014 12 15	66.37000062	12/25/2014 11 14	71.34999776	12/25/2014 11 49	70.29	12/25/2014 11 43	67.67000248	12/25/2014 12 00	76.54000144	12/25/2014 12 47	71.95999818	12/25/2014 12 00	73.38000205	12/25/2014 12 17	67.29999915	12/25/2014 12 36	71.78000269	12/25/2014 11 26	73.04
12/25/2014 13 15	72.34000249	12/25/2014 13 17	66.50000062	12/25/2014 12 23	71.76999774	12/25/2014 12 46	69.84	12/25/2014 12 12	67.73000248	12/25/2014 13 00	76.54000144	12/25/2014 13 08	72.13999818	12/25/2014 13 37	73.53000206	12/25/2014 13 37	67.63999915	12/25/2014 13 22	71.93000269	12/25/2014 12 16	73.01
12/25/2014 14 11	71.82000248	12/25/2014 14 08	66.71000062	12/25/2014 13 11	71.52999775	12/25/2014 13 38	70.26	12/25/2014 13 38	67.79000248	12/25/2014 14 00	76.54000144	12/25/2014 14 13	72.10999818	12/25/2014 14 09	73.77000206	12/25/2014 14 03	67.72999915	12/25/2014 14 04	72.39000271	12/25/2014 13 15	73.29
12/25/2014 15 48	72.74000251	12/25/2014 15 02	67.87000063	12/25/2014 14 13	71.46999775	12/25/2014 14 09	70.26	12/25/2014 14 19	67.76000248	12/25/2014 15 00	76.54000144	12/25/2014 15 31	72.22999817	12/25/2014 15 58	74.05000207	12/25/2014 15 22	68.64999914	12/25/2014 15 34	72.58000272	12/25/2014 14 08	73.01
12/25/2014 16 08	73.01000252	12/25/2014 16 11	68.69000064	12/25/2014 15 42	71.73999775	12/25/2014 15 02	70.45	12/25/2014 15 00	68.1000025	12/25/2014 16 00	76.54000144	12/25/2014 16 39	72.31999817	12/25/2014 16 17	73.99000207	12/25/2014 16 04	69.46999913	12/25/2014 16 26	73.19000274	12/25/2014 15 10	73.35
12/25/2014 17 45	72.89000251	12/25/2014 17 34	68.85000064	12/25/2014 16 00	72.56999772	12/25/2014 16 08	70.69	12/25/2014 16 21	68.2800025	12/25/2014 17 00	76.54000144	12/25/2014 17 45	72.37999817	12/25/2014 17 59	74.32000208	12/25/2014 17 11	70.07999912	12/25/2014 17 04	73.95000277	12/25/2014 16 00	73.9
12/25/2014 18 57	73.77000254	12/25/2014 18 09	69.00000064	12/25/2014 17 23	72.34999773	12/25/2014 17 45	71.24	12/25/2014 17 45	67.91000249	12/25/2014 18 00	76.54000144	12/25/2014 18 03	72.34999817	12/25/2014 18 00	74.32000208	12/25/2014 18 02	70.59999912	12/25/2014 18 15	73.83000276	12/25/2014 17 54	74.38
12/25/2014 19 03	73.50000253	12/25/2014 19 13	69.15000064	12/25/2014 18 23	72.62999772	12/25/2014 18 28	70.78	12/25/2014 18 57	68.74000252	12/25/2014 19 00	76.54000144	12/25/2014 19 08	70.85999821	12/25/2014 19 08	71.06000199	12/25/2014 19 08	68.30999914	12/25/2014 19 09	73.06000273	12/25/2014 18 27	74.35
12/25/2014 20 26	74.05000255	12/25/2014 20 34	69.61000065	12/25/2014 19 08	67.86999787	12/25/2014 19 07	69.87	12/25/2014 19 03	68.71000252	12/25/2014 20 00	76.54000144	12/25/2014 20 30	72.77999816	12/25/2014 20 00	73.87000207	12/25/2014 20 42	70.16999912	12/25/2014 20 33	74.13000277	12/25/2014 19 13	74.45
12/25/2014 21 50	73.62000254	12/25/2014 21 13	69.82000065	12/25/2014 20 31	72.34999773	12/25/2014 20 32	71.06	12/25/2014 20 26	69.14000253	12/25/2014 21 00	76.54000144	12/25/2014 21 32	72.59999817	12/25/2014 21 03	74.05000207	12/25/2014 21 02	70.29999912	12/25/2014 21 47	74.25000278	12/25/2014 20 26	74.66
12/25/2014 22 13	73.80000254	12/25/2014 22 16	69.40000064	12/25/2014 21 13	72.40999772	12/25/2014 21 03	70.57	12/25/2014 21 03	68.98000253	12/25/2014 22 00	76.54000144	12/25/2014 22 57	72.80999816	12/25/2014 22 58	74.23000208	12/25/2014 22 08	70.62999911	12/25/2014 22 49	74.22000278	12/25/2014 21 43	74.63
12/25/2014 23 00	74.84000258	12/25/2014 23 11	70.25000065	12/25/2014 22 06	72.80999771	12/25/2014 22 58	70.97	12/25/2014 22 13	69.11000253	12/25/2014 23 00	76.54000144	12/25/2014 23 01	72.89999816	12/25/2014 23 00	74.23000208	12/25/2014 23 19	70.77999911	12/25/2014 23 19	73.86000276	12/25/2014 22 03	74.6
12/26/2014 0 35	72.07000248	12/26/2014 0 00	68.36000063	12/25/2014 23 14	72.86999771	12/25/2014 23 00	70.97	12/25/2014 23 02	69.20000254	12/26/2014 0 00	76.54000144	12/26/2014 0 34	68.22999827	12/26/2014 0 35	72.92000204	12/26/2014 0 34	69.61999913	12/26/2014 0 34	72.45000271	12/25/2014 23 20	74.9
12/26/2014 1 22	74.23000256	12/26/2014 1 00	71.26000066	12/26/2014 0 34	71.86999774	12/26/2014 0 35	68.16	12/26/2014 0 35	65.63000241	12/26/2014 1 00	76.54000144	12/26/2014 1 23	72.40999817	12/26/2014 1 29	75.0600021	12/26/2014 1 00	72.0999991	12/26/2014 1 12	75.11000281	12/26/2014 0 35	74.08
12/26/2014 2 05	75.21000259	12/26/2014 2 24	71.41000066	12/26/2014 1 05	73.96999768	12/26/2014 1 00	72.06	12/26/2014 1 22	69.11000253	12/26/2014 2 00	76.54000144	12/26/2014 2 01	73.23999815	12/26/2014 2 04	75.36000211	12/26/2014 2 29	72.91999909	12/26/2014 2 15	75.69000283	12/26/2014 1 40	75.27
12/26/2014 3 52	75.79000261	12/26/2014 3 04	71.66000067	12/26/2014 2 09	74.14999767	12/26/2014 2 24	72.25	12/26/2014 2 01	69.72000256	12/26/2014 3 00	76.54000144	12/26/2014 3 18	73.47999814	12/26/2014 3 05	75.39000211	12/26/2014 3 02	73.00999909	12/26/2014 3 03	75.63000283	12/26/2014 2 01	75.67
12/26/2014 4 54	75.30000259	12/26/2014 4 31	71.84000067	12/26/2014 3 15	74.24999767	12/26/2014 3 03	72.37	12/26/2014 3 11	69.96000256	12/26/2014 4 00	76.54000144	12/26/2014 4 57	73.29999815	12/26/2014 4 04	75.1200021	12/26/2014 4 57	72.73999909	12/26/2014 4 03	76.05000285	12/26/2014 3 00	76.03
12/26/2014 5 54	74.29000256	12/26/2014 5 49	71.53000067	12/26/2014 4 55	73.78999768	12/26/2014 4 54	72.25	12/26/2014 4 03	69.78000256	12/26/2014 5 00	76.54000144	12/26/2014 5 04	72.62999816	12/26/2014 5 09	75.0600021	12/26/2014 5 55	72.67999909	12/26/2014 5 03	75.44000282	12/26/2014 4 59	75.91
12/26/2014 6 27	70.57000243	12/26/2014 6 58	70.74000066	12/26/2014 5 08	74.30999767	12/26/2014 5 54	71.97	12/26/2014 5 54	69.35000254	12/26/2014 6 00	76.54000144	12/26/2014 6 02	72.13999818	12/26/2014 6 41	74.48000208	12/26/2014 6 41	71.23999911	12/26/2014 6 41	74.99000281	12/26/2014 5 27	75.7
12/26/2014 7 59	73.99000255	12/26/2014 7 57	68.82000064	12/26/2014 6 41	72.74999771	12/26/2014 6 41	71.55	12/26/2014 6 02	68.49000251	12/26/2014 7 00	76.54000144	12/26/2014 7 56	72.68999816	12/26/2014 7 55	74.39000208	12/26/2014 7 50	70.96999911	12/26/2014 7 58	74.7100028	12/26/2014 6 41	75
12/26/2014 8 30	72.16000249	12/26/2014 8 38	68.57000064	12/26/2014 7 50	73.44999769	12/26/2014 7 55	71.3	12/26/2014 7 59	69.23000254	12/26/2014 8 00	76.54000144	12/26/2014 8 44	71.85999818	12/26/2014 8 58	74.23000208	12/26/2014 8 45	69.37999913	12/26/2014 8 38	72.85000273	12/26/2014 7 57	74.78
12/26/2014 9 57	71.15000245	12/26/2014 9 57	66.92000062	12/26/2014 8 38	72.10999773	12/26/2014 8 24	70.78	12/26/2014 8 30	68.3100025	12/26/2014 9 00	76.54000144	12/26/2014 9 48	70.91999821	12/26/2014 9 02	73.81000207	12/26/2014 9 58	67.78999915	12/26/2014 9 58	71.96000269	12/26/2014 8 51	73.87
12/26/2014 10 54	70.66000244	12/26/2014 10 40	64.18000059 A	12/26/2014 9 02	71.61999775	12/26/2014 9 57	69.35	12/26/2014 9 55	66.72000245	12/26/2014 10 00	76.54000144	12/26/2014 10 02	70.82999821	12/26/2014 10 40	70.75000198	12/26/2014 10 39	46.9099994 A	12/26/2014 10 56	66.6200025	12/26/2014 9 45	72.28
12/26/2014 11 40	70.63000244	12/26/2014 11 00	65.40000061	12/26/2014 10 39	69.54999781	12/26/2014 10 56	69.26	12/26/2014 10 40	66.66000244	12/26/2014 11 00	76.54000144	12/26/2014 11 51	70.88999821	12/26/2014 11 02	72.77000204	12/26/2014 11 17	52.58999933 A	12/26/2014 11 06	66.35000249	12/26/2014 10 40	71.82
12/26/2014 12 04	70.39000243	12/26/2014 12 06	65.98000061	12/26/2014 11 16	70.33999779	12/26/2014 11 00	69.68	12/26/2014 11 40	66.51000244	12/26/2014 12 00	76.54000144	12/26/2014 12 14	70.85999821	12/26/2014 12 00	74.02000207	12/26/2014 12 15	59.97999924 A	12/26/2014 12 16	68.70000257	12/26/2014 11 37	72.49
12/26/2014 13 06	70.91000245	12/26/2014 13 00	66.16000061	12/26/2014 12 33	72.28999773	12/26/2014 12 04	70.05	12/26/2014 12 27	66.72000245	12/26/2014 13 00	76.54000144	12/26/2014 13 02	70.9799982	12/26/2014 13 06	74.02000207	12/26/2014 13 19	67.17999916	12/26/2014 13 07	72.27000271	12/26/2014 12 22	72.28
12/26/2014 14 45	71.03000245	12/26/2014 14 00	67.05000062	12/26/2014 13 59	71.00999777	12/26/2014 13 58	70.26	12/26/2014 13 52	66.66000244	12/26/2014 14 00	76.54000144	12/26/2014 14 48	70.9499982	12/26/2014 14 00	74.39000208	12/26/2014 14 32	65.31999918	12/26/2014 14 39	72.67000272	12/26/2014 13 19	72.8
12/26/2014 15 14	70.87000244	12/26/2014 15 34	67.38000063	12/26/2014 14 00	71.00999777	12/26/2014 14 08	70.11	12/26/2014 14 00	66.91000245	12/26/2014 15 00	76.54000144	12/26/2014 15 13	70.9799982	12/26/2014 15 09	74.57000209	12/26/2014 15 24	66.04999917	12/26/2014 15 00	72.70000272	12/26/2014 14 09	72.55
12/26/2014 16 32	71.33000246	12/26/2014 16 00	68.05000063	12/26/2014 15 13	70.94999777	12/26/2014 15 10	70.54	12/26/2014 15 10	67.00000246	12/26/2014 16 00	76.54000144	12/26/2014 16 14	71.3499982	12/26/2014 16 07	74.63000209	12/26/2014 16 14	69.58999913	12/26/2014 16 21	73.49000275	12/26/2014 15 34	72.13
12/26/2014 17 28	72.22000249	12/26/2014 17 58	68.48000064	12/26/2014 16 03	72.16999773	12/26/2014 16 59	70.97	12/26/2014 16 01	67.33000247	12/26/2014 17 00	76.54000144	12/26/2014 17 34	71.55999819	12/26/2014 17 51	74.20000208	12/26/2014 17 35	69.77999913	12/26/2014 17 10	73.77000276	12/26/2014 16 00	73.68
12/26/2014 18 15	73.29000252	12/26/2014 18 41	68.42000064	12/26/2014 17 05	72.25999773	12/26/2014 17 30	70.66	12/26/2014 17 34	67.64000248	12/26/2014 18 00	76.54000144	12/26/2014 18 04	72.25999817	12/26/2014 18 30	73.38000205	12/26/2014 18 19	69.52999913	12/26/2014 18 20	73.46000275	12/26/2014 17 11	73.32
12/26/2014 19 48	72.5800025	12/26/2014 19 28	68.97000064	12/26/2014 18 14	71.82999774	12/26/2014 18 27	70.51	12/26/2014 18 21	68.40000251	12/26/2014 19 00	76.54000144	12/26/2014 19 47	72.22999817	12/26/2014 19 47	73.04000204	12/26/2014 19 31	69.71999913	12/26/2014 19 01	73.49000275	12/26/2014 18 11	73.35
12/26/2014 20 41	73.44000253	12/26/2014 20 00	68.73000064	12/26/2014 19 31	70.54999778	12/26/2014 19 48	70.14	12/26/2014 19 50	68.2200025	12/26/2014 20 00	76.54000144	12/26/2014 20 15	72.59999817	12/26/2014 20 32	73.44000205	12/26/2014 20 42	69.64999913	12/26/2014 20 00	73.83000276	12/26/2014 19 09	73.9
12/26/2014 21 49	73.90000254	12/26/2014 21 01	69.06000064	12/26/2014 20 23	71.64999775	12/26/2014 20 06	70.97	12/26/2014 20 15	68.43000251	12/26/2014 21 00	76.54000144	12/26/2014 21 41	72.62999816	12/26/2014 21 02	73.87000207	12/26/2014 21 36	70.10999912	12/26/2014 21 00	73.73000276	12/26/2014 20 41	74.14
12/26/2014 22 37	74.17000255	12/26/2014 22 42	69.64000065	12/26/2014 21 01	72.22999773	12/26/2014 21 35	70.78	12/26/2014 21 10	69.11000253	12/26/2014 22 00	76.54000144	12/26/2014 22 06	72.83999816	12/26/2014 22 24	74.29000208	12/26/2014 22 01	70.10999912	12/26/2014 22 13	74.16000278	12/26/2014 21 18	74.42
12/26/2014 23 00	74.51000257	12/26/2014 23 33	70.22000065	12/26/2014 22 02	72.74999771	12/26/2014 22 53	71.12	12/26/2014 22 14	69.04000253	12/26/2014 23 00	76.54000144	12/26/2014 23 22	72.77999816	12/26/2014 23 34	74.26000208	12/26/2014 23 34	70.87999911	12/26/2014 23 34	73.89000277	12/26/2014 22 06	74.87
12/27/2014 0 32	72.89000251	12/27/2014 0 31	70.16000065	12/26/2014 23 23	73.1199977	12/26/2014 23 01	71.33	12/26/2014 23 12	69.14000253	12/27/2014 0 00	76.54000144	12/27/2014 0 31	69.05999825	12/27/2014 0 32	72.80000204	12/27/2014 0 31	70.68999911	12/27/2014 0 32	74.19000278	12/26/2014 23 33	75
12/27/2014 1 03	73.77000254	12/27/2014 1 41	71.17000066	12/27/2014 0 37	73.01999771	12/27/2014 0 32	69.84	12/27/2014 0 32	66.51000244	12/27/2014 1 00	76.54000144	12/27/2014 1 03	72.28999817	12/27/2014 1 33	75.1200021	12/27/2014 1 06	72.2799991	12/27/2014 1 08	75.32000282	12/27/2014 0 31	74.57
12/27/2014 2 11	74.42000256	12/27/2014 2 22	71.47000066	12/27/2014 1 28	74.05999767	12/27/2014 1 07	71.88	12/27/2014 1 01	68.62000252	12/27/2014 2 00	76.54000144	12/27/2014 2 03	72.65999816	12/27/2014 2 41	75.0900021	12/27/2014 2 54	72.73999909	12/27/2014 2 40	75.54000283	12/27/2014 1 07	74.87
12/27/2014 3 56	75.36000259	12/27/2014 3 13	71.75000067	12/27/2014 2 36	73.99999768	12/27/2014 2 09	72.16	12/27/2014 2 03	69.26000254	12/27/2014 3 00	76.54000144	12/27/2014 3 08	72.80999816	12/27/2014 3 02	75.1200021	12/27/2014 3 00	72.79999909	12/27/2014 3 00	75.57000283	12/27/2014 2 10	75.88
12/27/2014 4 35	74.08000255	12/27/2014 4 44	71.69000067	12/27/2014 3 08	73.99999768	12/27/2014 3 08	72.03	12/27/2014 3 29	69.23000254	12/27/2014 4 00	76.54000144	12/27/2014 4 33	70.48999822	12/27/2014 4 34	74.9700021	12/27/2014 4 35	72.79999909	12/27/2014 4 42	75.78000284	12/27/2014 3 08	75.88
12/27/2014 5 34	74.20000255	12/27/2014 5 35	71.44000066	12/27/2014 4 03	74.30999767	12/27/2014 4 35	72.28	12/27/2014 4 35	68.92000253	12/27/2014 5 00	76.54000144	12/27/2014 5 24	72.01999818	12/27/2014 5 46	75.1800021	12/27/2014 5 34	72.67999909	12/27/2014 5 44	75.60000283	12/27/2014 4 34	75.76
12/27/2014 6 57	73.99000255	12/27/2014 6 46	70.62000066	12/27/2014 5 56	74.02999767	12/27/2014 5 57	72.06	12/27/2014 5 18	68.86000252	12/27/2014 6 00	76.54000144	12/27/2014 6 43	71.89999818	12/27/2014 6 37	74.51000209	12/27/2014 6 37	72.0699991	12/27/2014 6 33	75.32000282	12/27/2014 5 40	75.64
12/27/2014 7 48	72.00000248	12/27/2014 7 58	68.88000064	12/27/2014 6 53	73.56999769	12/27/2014 6 42	71.85	12/27/2014 6 45	68.53000251	12/27/2014 7 00	76.54000144	12/27/2014 7 53	70.60999821	12/27/2014 7 03	74.42000208	12/27/2014 7 58	70.35999912	12/27/2014 7 58	74.50000279	12/27/2014 6 54	75.15
12/27/2014 8 50	72.98000251	12/27/2014 8 33	68.66000064	12/27/2014 7 58	71.86999774	12/27/2014 7 52	70.2	12/27/2014 7 48	66.97000245	12/27/2014 8 00	76.54000144	12/27/2014 8 32	71.92999818	12/27/2014 8 32	73.41000205	12/27/2014 8 50	69.03999913	12/27/2014 8 32	73.40000275	12/27/2014 7 58	73.9
12/27/2014 9 54	72.34000249	12/27/2014 9 12	66.83000062	12/27/2014 8 02	71.52999775	12/27/2014 8 58	70.42	12/27/2014 8 03	67.98000249	12/27/2014 9 00	76.54000144	12/27/2014 9 34	71.58999819	12/27/2014 9 34	73.26000205	12/27/2014 9 46	67.32999915	12/27/2014 9 40	71.66000268	12/27/2014 8 00	73.9
12/27/2014 10 58	71.15000245	12/27/2014 10 32	65.49000061	12/27/2014 9 34	71.15999776	12/27/2014 9 35	69.81	12/27/2014 9 33	67.85000249	12/27/2014 10 00	76.54000144	12/27/2014 10 32	71.43999819	12/27/2014 10 33	73.23000205	12/27/2014 10 29	66.56999916	12/27/2014 10 40	70.84000265	12/27/2014 9 56	72.71
12/27/2014 11 47	70.26000242	12/27/2014 11 34	65.25000061	12/27/2014 10 09	70.66999778	12/27/2014 10 53	68.55	12/27/2014 10 56	67.64000248	12/27/2014 11 00	76.54000144	12/27/2014 11 46	71.0399982	12/27/2014 11 01	73.04000204	12/27/2014 11 01	65.31999918	12/27/2014 11 11	70.77000265	12/27/2014 10 40	72.22
12/27/2014 12 51	70.26000242	12/27/2014 12 23	65.31000061	12/27/2014 11 01	70.76999778	12/27/2014 11 02	69.59	12/27/2014 11 39	66.85000245	12/27/2014 12 00	76.54000144	12/27/2014 12 04	70.82999821	12/27/2014 12 29	73.90000207	12/27/2014 12 28	66.90999916	12/27/2014 12 05	71.69000268	12/27/2014 11 09	71.79
12/27/2014 13 14	70.57000243	12/27/2014 13 13	66.07000061	12/27/2014 12 03	70.85999777	12/27/2014 12 51	69.65	12/27/2014 12 08	66.69000244	12/27/2014 13 00	76.54000144	12/27/2014 13 33	70.88999821	12/27/2014 13 25	74.17000208	12/27/2014 13 00	67.78999915	12/27/2014 13 13	72.0900027	12/27/2014 12 51	72.31
12/27/2014 14 01	70.39000243	12/27/2014 14 02	66.62000062	12/27/2014 13 50	71.00999777	12/27/2014 13 05	69.68	12/27/2014 13 05	66.66000244	12/27/2014 14 00	76.54000144	12/27/2014 14 39	70.63999821	12/27/2014 14 54	74.23000208	12/27/2014 14 31	68.61999914	12/27/2014 14 23	72.58000272	12/27/2014 13 00	72.55
12/27/2014 15 07	71.27000246	12/27/2014 15 06	66.68000062	12/27/2014 14 52	71.70999775	12/27/2014 14 38	70.02	12/27/2014 14 17	66.79000245	12/27/2014 15 00	76.54000144	12/27/2014 15 06	70.73999821	12/27/2014 15 48	74.11000207	12/27/2014 15 02	68.76999914	12/27/2014 15 01	73.03000273	12/27/2014 14 58	72.61
12/27/2014 16 09	71.42000246	12/27/2014 16 27	67.69000063	12/27/2014 15 26	72.31999773	12/27/2014 15 07	70.45	12/27/2014 15 38	66.72000245	12/27/2014 16 00	76.54000144	12/27/2014 16 12	71.1899982	12/27/2014 16 01	74.66000209	12/27/2014 16 14	69.06999913	12/27/2014 16 08	73.06000273	12/27/2014 15 00	72.61
12/27/2014 17 00	71.42000246	12/27/2014 17 57	67.90000063	12/27/2014 16 30	72.31999773	12/27/2014 16 21	70.45	12/27/2014 16 23	66.94000245	12/27/2014 17 00	76.54000144	12/27/2014 17 42	71.1599982	12/27/2014 17 16	74.42000208	12/27/2014 17 21	69.25999913	12/27/2014 17 02	72.97000273	12/27/2014 16 28	72.74
12/27/2014 18 16	71.45000246	12/27/2014 18 35	67.81000063	12/27/2014 17 05	71.37999776	12/27/2014 17 27	70.36	12/27/2014 17 35	67.03000246	12/27/2014 18 00	76.54000144	12/27/2014 18 31	71.0699982	12/27/2014 18 51	74.29000208	12/27/2014 18 27	68.97999913	12/27/2014 18 35	73.25000274	12/27/2014 17 00	72.98
12/27/2014 19 02	72.5500025	12/27/2014 19 20	68.82000064	12/27/2014 18 15	72.10999773	12/27/2014 18 55	70.39	12/27/2014 18 27	67.21000246	12/27/2014 19 00	76.54000144	12/27/2014 19 06	71.79999818	12/27/2014 19 31	74.17000208	12/27/2014 19 54	69.37999913	12/27/2014 19 06	72.91000273	12/27/2014 18 20	73.53
12/27/2014 20 05	72.6800025	12/27/2014 20 05	68.88000064	12/27/2014 19 09	72.62999772	12/27/2014 19 10	70.11	12/27/2014 19 00	67.67000248	12/27/2014 20 00	76.54000144	12/27/2014 20 59	72.07999818	12/27/2014 20 12	74.08000207	12/27/2014 20 17	69.89999912	12/27/2014 20 06	73.58000275	12/27/2014 19 56	73.93
12/27/2014 21 52	72.86000251	12/27/2014 21 04	69.21000064	12/27/2014 20 14	72.19999773	12/27/2014 20 05	70.94	12/27/2014 20 05	68.2200025	12/27/2014 21 00	76.54000144	12/27/2014 21 00	72.07999818	12/27/2014 21 33	74.29000208	12/27/2014 21 00	70.07999912	12/27/2014 21 13	74.10000277	12/27/2014 20 30	74.23
12/27/2014 22 19	73.84000254	12/27/2014 22 07	69.70000065	12/27/2014 21 33	72.10999773	12/27/2014 21 32	70.84	12/27/2014 21 01	68.2800025	12/27/2014 22 00	76.54000144	12/27/2014 22 31	72.53999817	12/27/2014 22 31	74.29000208	12/27/2014 22 05	70.29999912	12/27/2014 22 05	74.10000277	12/27/2014 21 00	73.96
12/27/2014 23 35	71.27000246	12/27/2014 23 25	69.21000064	12/27/2014 22 10	72.92999771	12/27/2014 22 19	71.33	12/27/2014 22 50	68.56000251	12/27/2014 23 00	76.54000144	12/27/2014 23 05	72.22999817	12/27/2014 23 06	74.26000208	12/27/2014 23 24	70.29999912	12/27/2014 23 06	74.41000278	12/27/2014 22 10	74.35
12/28/2014 0 37	70.39000243	12/28/2014 0 38	70.22000065	12/27/2014 23 15	73.1499977	12/27/2014 23 04	71.58	12/27/2014 23 09	69.11000253	12/28/2014 0 00	76.54000144	12/28/2014 0 37	68.04999827	12/28/2014 0 37	73.29000205	12/28/2014 0 37	70.07999912	12/28/2014 0 37	74.16000278	12/27/2014 23 25	74.51
12/28/2014 1 39	74.17000255	12/28/2014 1 01	70.98000066	12/28/2014 0 24	73.44999769	12/28/2014 0 37	67.42	12/28/2014 0 37	63.95000234	12/28/2014 1 00	76.54000144	12/28/2014 1 01	71.58999819	12/28/2014 1 00	74.9300021	12/28/2014 1 00	72.1899991	12/28/2014 1 54	75.44000282	12/28/2014 0 43	74.54
12/28/2014 2 08	74.63000257	12/28/2014 2 27	71.59000067	12/28/2014 1 47	73.75999768	12/28/2014 1 16	71.52	12/28/2014 1 00	68.49000251	12/28/2014 2 00	76.54000144	12/28/2014 2 07	72.56999817	12/28/2014 2 33	75.0300021	12/28/2014 2 54	72.76999909	12/28/2014 2 40	75.35000282	12/28/2014 1 11	75.64
12/28/2014 3 01	75.27000259	12/28/2014 3 41	71.66000067	12/28/2014 2 33	73.96999768	12/28/2014 2 38	72.25	12/28/2014 2 16	68.98000253	12/28/2014 3 00	76.54000144	12/28/2014 3 01	73.08999815	12/28/2014 3 50	74.84000209	12/28/2014 3 09	72.79999909	12/28/2014 3 00	75.69000283	12/28/2014 2 15	75.64
12/28/2014 4 24	75.09000258	12/28/2014 4 37	71.84000067	12/28/2014 3 50	73.69999768	12/28/2014 3 09	72.19	12/28/2014 3 05	69.53000255	12/28/2014 4 00	76.54000144	12/28/2014 4 37	73.08999815	12/28/2014 4 25	75.0900021	12/28/2014 4 02	72.91999909	12/28/2014 4 03	75.90000284	12/28/2014 3 06	76.06
12/28/2014 5 48	74.78000257	12/28/2014 5 55	71.44000066	12/28/2014 4 25	73.81999768	12/28/2014 4 01	72.28	12/28/2014 4 05	69.81000256	12/28/2014 5 00	76.54000144	12/28/2014 5 10	72.77999816	12/28/2014 5 45	75.0300021	12/28/2014 5 40	72.79999909	12/28/2014 5 30	75.78000284	12/28/2014 4 09	76.22
12/28/2014 6 52	74.11000255	12/28/2014 6 47	71.14000066	12/28/2014 5 32	73.99999768	12/28/2014 5 33	72.16	12/28/2014 5 44	69.47000255	12/28/2014 6 00	76.54000144	12/28/2014 6 47	72.19999818	12/28/2014 6 17	75.24000211	12/28/2014 6 30	72.36999909	12/28/2014 6 03	75.44000282	12/28/2014 5 33	75.85
12/28/2014 7 56	71.91000248	12/28/2014 7 21	70.31000065	12/28/2014 6 53	73.53999769	12/28/2014 6 48	71.48	12/28/2014 6 58	68.62000252	12/28/2014 7 00	76.54000144	12/28/2014 7 49	70.42999822	12/28/2014 7 40	74.72000209	12/28/2014 7 56	71.11999911	12/28/2014 7 56	74.62000279	12/28/2014 6 03	75.24
12/28/2014 8 45	73.13000252	12/28/2014 8 53	68.48000064	12/28/2014 7 21	72.83999771	12/28/2014 7 49	70.45	12/28/2014 7 56	66.75000245	12/28/2014 8 00	76.54000144	12/28/2014 8 23	71.79999818	12/28/2014 8 46	73.68000206	12/28/2014 8 39	69.25999913	12/28/2014 8 56	73.22000274	12/28/2014 7 48	74.66
12/28/2014 9 14	71.79000247	12/28/2014 9 54	66.95000062	12/28/2014 8 47	72.40999772	12/28/2014 8 57	69.71	12/28/2014 8 00	67.61000248	12/28/2014 9 00	76.54000144	12/28/2014 9 34	71.85999818	12/28/2014 9 55	73.47000206	12/28/2014 9 56	67.57999915	12/28/2014 9 55	71.84000269	12/28/2014 8 37	74.02
12/28/2014 10 07	71.21000246	12/28/2014 10 46	65.28000061	12/28/2014 9 08	71.40999776	12/28/2014 9 34	69.65	12/28/2014 9 49	67.76000248	12/28/2014 10 00	76.54000144	12/28/2014 10 14	71.3499982	12/28/2014 10 26	73.10000205	12/28/2014 10 31	66.07999917	12/28/2014 10 26	70.62000264	12/28/2014 9 55	72.86
12/28/2014 11 21	71.33000246	12/28/2014 11 23	65.89000061	12/28/2014 10 58	70.76999778	12/28/2014 10 20	69.68	12/28/2014 10 03	67.33000247	12/28/2014 11 00	76.54000144	12/28/2014 11 08	71.0699982	12/28/2014 11 00	73.13000205	12/28/2014 11 18	66.62999916	12/28/2014 11 56	70.71000265	12/28/2014 10 49	72.55
12/28/2014 12 54	69.5000024	12/28/2014 12 14	65.28000061	12/28/2014 11 52	69.8799978	12/28/2014 11 21	69.56	12/28/2014 11 48	67.46000247	12/28/2014 12 00	76.54000144	12/28/2014 12 14	68.71999826	12/28/2014 12 15	72.58000203	12/28/2014 12 07	66.56999916	12/28/2014 12 04	71.42000267	12/28/2014 11 47	72.28
12/28/2014 13 11	70.05000242	12/28/2014 13 00	65.73000061	12/28/2014 12 59	70.0599978	12/28/2014 12 15	68.62	12/28/2014 12 15	66.33000243	12/28/2014 13 00	76.54000144	12/28/2014 13 54	70.51999822	12/28/2014 13 17	73.47000206	12/28/2014 13 07	66.90999916	12/28/2014 13 07	71.87000269	12/28/2014 12 14	72.49
12/28/2014 14 27	70.51000243	12/28/2014 14 55	66.71000062	12/28/2014 13 00	70.0599978	12/28/2014 13 15	69.65	12/28/2014 13 00	66.69000244	12/28/2014 14 00	76.54000144	12/28/2014 14 02	70.88999821	12/28/2014 14 39	73.77000206	12/28/2014 14 01	68.03999915	12/28/2014 14 00	72.1200027	12/28/2014 13 23	72.49

12/28/2014 16 14	71.61000247
12/28/2014 17 20	71.82000248
12/28/2014 18 32	72.28000249
12/28/2014 19 27	72.5500025
12/28/2014 20 17	72.07000248
12/28/2014 21 56	72.5500025
12/28/2014 22 00	72.98000251
12/28/2014 23 43	72.37000249
12/29/2014 0 42	73.50000253
12/29/2014 1 17	74.29000256
12/29/2014 2 48	74.69000257
12/29/2014 3 35	74.69000257
12/29/2014 4 51	74.72000257
12/29/2014 5 22	72.71000251
12/29/2014 6 49	72.10000248
12/29/2014 7 34	73.19000252
12/29/2014 8 44	72.37000249
12/29/2014 9 23	71.82000248
12/29/2014 10 31	71.36000246
12/29/2014 11 45	69.99000241
12/29/2014 12 41	70.20000242
12/29/2014 13 00	71.33000246
12/29/2014 14 49	71.49000246
12/29/2014 15 38	71.61000247
12/29/2014 16 19	70.97000245
12/29/2014 17 56	71.55000247
12/29/2014 18 16	72.4600025
12/29/2014 19 35	71.64000247
12/29/2014 20 12	72.28000249
12/29/2014 21 42	72.71000251
12/29/2014 22 09	71.45000246
12/29/2014 23 19	72.6800025
12/30/2014 0 15	71.21000246
12/30/2014 1 52	72.5800025
12/30/2014 2 19	74.63000257
12/30/2014 3 33	73.50000253
12/30/2014 4 40	73.71000254
12/30/2014 5 57	72.5500025
12/30/2014 6 09	71.91000248
12/30/2014 7 07	72.6500025
12/30/2014 8 19	71.49000246
12/30/2014 9 58	70.60000243
12/30/2014 10 18	70.57000243
12/30/2014 11 55	70.78000244
12/30/2014 12 51	68.80000237
12/30/2014 13 50	71.15000245
12/30/2014 14 21	71.06000245
12/30/2014 15 05	71.70000247
12/30/2014 16 33	71.64000247
12/30/2014 17 43	69.99000241
12/30/2014 18 20	70.23000242
12/30/2014 19 28	71.67000247
12/30/2014 20 30	71.33000246
12/30/2014 21 52	72.40000249
12/30/2014 22 31	72.00000248
12/30/2014 23 19	73.59000253
12/31/2014 0 06	71.39000246
12/31/2014 1 18	72.34000249
12/31/2014 2 57	75.03000258
12/31/2014 3 30	74.84000258
12/31/2014 4 27	73.35000253
12/31/2014 5 09	72.4900025
12/31/2014 6 18	71.52000247
12/31/2014 7 36	73.26000252
12/31/2014 8 59	71.91000248
12/31/2014 9 46	70.84000244
12/31/2014 10 41	71.49000246
12/31/2014 11 04	71.42000246
12/31/2014 12 10	71.82000248
12/31/2014 13 30	70.48000243
12/31/2014 14 24	71.58000247
12/31/2014 15 17	70.91000245
12/31/2014 16 21	71.36000246
12/31/2014 17 10	71.27000246
12/31/2014 18 00	71.76000247
12/31/2014 19 10	72.10000248
12/31/2014 20 10	72.71000251
12/31/2014 21 30	72.74000251
12/31/2014 22 17	73.50000253
12/31/2014 23 17	74.63000257
1/1/2015 0 10	74.63000257
1/1/2015 1 20	71.58000247
1/1/2015 2 03	74.05000255
1/1/2015 3 03	74.72000257
1/1/2015 4 09	74.63000257
1/1/2015 5 37	74.26000256
1/1/2015 6 00	74.48000256
1/1/2015 7 53	73.29000252
1/1/2015 8 22	72.40000249
1/1/2015 9 42	72.07000248
1/1/2015 10 56	72.28000249
1/1/2015 11 46	71.52000247
1/1/2015 12 02	71.82000248
1/1/2015 13 33	71.64000247

12/28/2014 16 36	67.08000062
12/28/2014 17 04	67.08000062
12/28/2014 18 08	67.08000062
12/28/2014 19 31	67.50000063
12/28/2014 20 14	68.39000064
12/28/2014 21 05	68.76000064
12/28/2014 22 07	69.64000065
12/28/2014 23 42	68.88000064
12/29/2014 0 01	70.56000066
12/29/2014 1 17	71.26000066
12/29/2014 2 28	71.59000067
12/29/2014 3 13	71.96000067
12/29/2014 4 31	71.63000067
12/29/2014 5 58	69.95000065
12/29/2014 6 46	69.37000064
12/29/2014 7 46	68.30000063
12/29/2014 8 57	68.21000063
12/29/2014 9 45	67.29000062
12/29/2014 10 27	66.41000062
12/29/2014 11 02	66.01000061
12/29/2014 12 58	66.95000062
12/29/2014 13 00	66.95000062
12/29/2014 14 11	66.95000062
12/29/2014 15 16	67.81000063
12/29/2014 16 55	67.32000062
12/29/2014 17 22	66.92000062
12/29/2014 18 45	67.17000062
12/29/2014 19 00	67.50000063
12/29/2014 20 00	68.54000064
12/29/2014 21 45	68.91000064
12/29/2014 22 03	68.79000064
12/29/2014 23 09	70.22000065
12/30/2014 0 05	70.56000066
12/30/2014 1 49	70.98000066
12/30/2014 2 11	71.17000066
12/30/2014 3 53	71.53000067
12/30/2014 4 00	71.50000066
12/30/2014 5 58	69.95000065
12/30/2014 6 53	69.55000065
12/30/2014 7 08	68.79000064
12/30/2014 8 52	67.75000063
12/30/2014 9 31	67.84000063
12/30/2014 10 59	66.83000062
12/30/2014 11 08	66.59000062
12/30/2014 12 51	66.44000062
12/30/2014 13 59	67.47000063
12/30/2014 14 00	67.47000063
12/30/2014 15 13	67.57000063
12/30/2014 16 49	67.50000063
12/30/2014 17 54	67.26000062
12/30/2014 18 46	67.17000062
12/30/2014 19 03	67.53000063
12/30/2014 20 04	67.53000063
12/30/2014 21 02	68.15000063
12/30/2014 22 03	68.18000063
12/30/2014 23 02	70.07000065
12/31/2014 0 06	69.82000065
12/31/2014 1 00	70.95000066
12/31/2014 2 12	71.44000066
12/31/2014 3 39	71.53000067
12/31/2014 4 37	71.26000066
12/31/2014 5 36	69.70000065
12/31/2014 6 43	69.03000064
12/31/2014 7 26	69.06000064
12/31/2014 8 24	67.72000063
12/31/2014 9 35	67.20000062
12/31/2014 10 12	66.34000062
12/31/2014 11 22	66.44000062
12/31/2014 12 33	66.89000062
12/31/2014 13 16	66.99000062
12/31/2014 14 06	66.53000062
12/31/2014 15 07	65.95000061
12/31/2014 16 00	66.80000062
12/31/2014 17 28	66.95000062
12/31/2014 18 11	67.53000063
12/31/2014 19 20	68.42000064
12/31/2014 20 11	69.00000064
12/31/2014 21 20	70.07000065
12/31/2014 22 13	69.89000065
12/31/2014 23 18	70.68000066
1/1/2015 0 04	69.82000065
1/1/2015 1 30	70.40000065
1/1/2015 2 09	70.80000066
1/1/2015 3 00	71.47000066
1/1/2015 4 21	71.75000067
1/1/2015 5 24	71.41000066
1/1/2015 6 34	71.14000066
1/1/2015 7 47	70.98000066
1/1/2015 8 34	69.64000065
1/1/2015 9 15	68.27000063
1/1/2015 10 46	66.83000062
1/1/2015 11 29	65.92000061
1/1/2015 12 21	66.22000061
1/1/2015 13 01	66.95000062

12/28/2014 15 26	71.40999776
12/28/2014 16 23	71.00999777
12/28/2014 17 46	71.52999775
12/28/2014 18 43	71.67999775
12/28/2014 19 28	72.13999773
12/28/2014 20 25	72.07999773
12/28/2014 21 03	72.22999773
12/28/2014 22 34	72.16999773
12/28/2014 23 41	73.01999771
12/29/2014 0 02	73.35999769
12/29/2014 1 25	73.56999769
12/29/2014 2 37	73.72999768
12/29/2014 3 16	73.50999769
12/29/2014 4 05	74.11999767
12/29/2014 5 12	73.47999769
12/29/2014 6 15	72.19999773
12/29/2014 7 50	72.71999771
12/29/2014 8 02	72.04999774
12/29/2014 9 48	71.00999777
12/29/2014 10 27	71.06999777
12/29/2014 11 09	71.43999775
12/29/2014 12 42	71.31999776
12/29/2014 13 57	71.73999775
12/29/2014 14 14	71.12999776
12/29/2014 15 06	71.95999774
12/29/2014 16 35	72.13999773
12/29/2014 17 08	71.24999776
12/29/2014 18 29	70.70999778
12/29/2014 19 47	71.67999775
12/29/2014 20 11	72.22999773
12/29/2014 21 28	72.07999773
12/29/2014 22 05	72.07999773
12/29/2014 23 20	72.68999772
12/30/2014 0 14	71.31999776
12/30/2014 1 53	73.35999769
12/30/2014 2 37	73.2699977
12/30/2014 3 20	73.75999768
12/30/2014 4 03	73.90999768
12/30/2014 5 57	73.2399977
12/30/2014 6 08	72.65999772
12/30/2014 7 51	72.62999772
12/30/2014 8 53	71.34999776
12/30/2014 9 36	71.06999777
12/30/2014 10 45	70.63999778
12/30/2014 11 58	71.67999775
12/30/2014 12 14	71.49999775
12/30/2014 13 46	71.70999775
12/30/2014 14 00	71.76999774
12/30/2014 15 32	72.10999773
12/30/2014 16 06	71.40999776
12/30/2014 17 44	71.89999774
12/30/2014 18 12	71.31999776
12/30/2014 19 16	71.89999774
12/30/2014 20 22	71.82999774
12/30/2014 21 38	72.44999772
12/30/2014 22 31	72.22999773
12/30/2014 23 24	73.56999769
12/31/2014 0 22	73.53999769
12/31/2014 1 20	73.59999769
12/31/2014 2 57	73.63999769
12/31/2014 3 10	74.02999767
12/31/2014 4 28	73.41999769
12/31/2014 5 32	73.2699977
12/31/2014 6 18	72.34999773
12/31/2014 7 57	72.19999773
12/31/2014 8 25	71.64999775
12/31/2014 9 12	70.91999777
12/31/2014 10 47	70.73999778
12/31/2014 11 57	69.9099978
12/31/2014 12 01	70.33999779
12/31/2014 13 49	69.50999781
12/31/2014 14 30	70.51999778
12/31/2014 15 27	70.85999777
12/31/2014 16 48	71.09999776
12/31/2014 17 44	70.70999778
12/31/2014 18 18	71.40999776
12/31/2014 19 35	70.76999778
12/31/2014 20 59	72.50999772
12/31/2014 21 00	72.50999772
12/31/2014 22 33	72.53999772
12/31/2014 23 08	73.2699977
1/1/2015 0 15	72.92999771
1/1/2015 1 20	71.58999775
1/1/2015 2 41	73.59999769
1/1/2015 3 54	73.63999769
1/1/2015 4 44	73.90999768
1/1/2015 5 40	74.14999767
1/1/2015 6 31	73.56999769
1/1/2015 7 57	73.1499977
1/1/2015 8 44	72.25999773
1/1/2015 9 51	71.49999775
1/1/2015 10 56	71.12999776
1/1/2015 11 11	69.9099978
1/1/2015 12 01	70.79999777

12/28/2014 15 51	69.68
12/28/2014 16 38	70.69
12/28/2014 17 53	70.05
12/28/2014 18 54	70.29
12/28/2014 19 01	70.54
12/28/2014 20 00	70.66
12/28/2014 21 33	70.45
12/28/2014 22 51	70.72
12/28/2014 23 05	70.94
12/29/2014 0 03	71.33
12/29/2014 1 07	71.73
12/29/2014 2 00	72.13
12/29/2014 3 54	72.06
12/29/2014 4 58	71.97
12/29/2014 5 58	70.69
12/29/2014 6 00	70.69
12/29/2014 7 40	70.84
12/29/2014 8 03	70.11
12/29/2014 9 48	70.14
12/29/2014 10 29	68.58
12/29/2014 11 43	69.84
12/29/2014 12 24	69.71
12/29/2014 13 57	69.71
12/29/2014 14 17	70.39
12/29/2014 15 50	70.17
12/29/2014 16 46	70.02
12/29/2014 17 56	70.14
12/29/2014 18 14	70.14
12/29/2014 19 20	70.36
12/29/2014 20 47	70.57
12/29/2014 21 28	70.45
12/29/2014 22 09	70.42
12/29/2014 23 23	71.36
12/30/2014 0 15	68.22
12/30/2014 1 19	71
12/30/2014 2 45	72.19
12/30/2014 3 04	72
12/30/2014 4 44	71.91
12/30/2014 5 57	70.97
12/30/2014 6 44	70.72
12/30/2014 7 31	70.57
12/30/2014 8 50	69.38
12/30/2014 9 43	69.96
12/30/2014 10 18	69.65
12/30/2014 11 10	70.05
12/30/2014 12 51	67.06
12/30/2014 13 15	69.81
12/30/2014 14 07	70.54
12/30/2014 15 13	69.99
12/30/2014 16 10	70.26
12/30/2014 17 57	70.36
12/30/2014 18 20	69.32
12/30/2014 19 57	70.08
12/30/2014 20 19	70.39
12/30/2014 21 17	70.78
12/30/2014 22 13	71.06
12/30/2014 23 21	69.93
12/31/2014 0 06	67.85
12/31/2014 1 16	71.7
12/31/2014 2 11	72.13
12/31/2014 3 30	72.16
12/31/2014 4 46	71.94
12/31/2014 5 21	71.03
12/31/2014 6 18	70.45
12/31/2014 7 26	70.97
12/31/2014 8 15	70.42
12/31/2014 9 52	70.02
12/31/2014 10 41	69.81
12/31/2014 11 08	69.93
12/31/2014 12 49	68.68
12/31/2014 13 30	69.41
12/31/2014 14 17	70.23
12/31/2014 15 46	70.17
12/31/2014 16 44	69.84
12/31/2014 17 53	70.36
12/31/2014 18 10	70.66
12/31/2014 19 32	71.06
12/31/2014 20 41	70.81
12/31/2014 21 07	71.09
12/31/2014 22 23	70.84
12/31/2014 23 44	71.52
1/1/2015 0 02	71.48
1/1/2015 1 20	68.22
1/1/2015 2 03	71.58
1/1/2015 3 32	72.03
1/1/2015 4 37	72.06
1/1/2015 5 41	71.94
1/1/2015 6 39	71.79
1/1/2015 7 57	71.18
1/1/2015 8 12	70.48
1/1/2015 9 42	69.74
1/1/2015 10 46	70.02
1/1/2015 11 52	69.93
1/1/2015 12 17	69.78

12/28/2014 15 02	66.57000244
12/28/2014 16 14	66.94000245
12/28/2014 17 12	67.55000248
12/28/2014 18 01	67.52000247
12/28/2014 19 05	68.1600025
12/28/2014 20 21	67.85000249
12/28/2014 21 33	68.1600025
12/28/2014 22 00	67.79000248
12/28/2014 23 43	66.60000244
12/29/2014 0 24	68.01000249
12/29/2014 1 17	68.53000251
12/29/2014 2 03	69.14000253
12/29/2014 3 35	69.29000254
12/29/2014 4 58	69.26000254
12/29/2014 5 42	67.70000248
12/29/2014 6 04	66.94000245
12/29/2014 7 14	67.27000247
12/29/2014 8 40	67.85000249
12/29/2014 9 07	67.52000247
12/29/2014 10 31	66.85000245
12/29/2014 11 45	67.21000246
12/29/2014 12 41	66.17000243
12/29/2014 13 00	66.72000245
12/29/2014 14 59	66.72000245
12/29/2014 15 00	66.72000245
12/29/2014 16 19	67.67000248
12/29/2014 17 21	66.57000244
12/29/2014 18 56	67.61000248
12/29/2014 19 35	67.30000247
12/29/2014 20 49	67.88000249
12/29/2014 21 43	67.64000248
12/29/2014 22 09	67.24000246
12/29/2014 23 19	68.1300025
12/30/2014 0 15	65.32000239
12/30/2014 1 15	67.03000246
12/30/2014 2 00	69.38000254
12/30/2014 3 33	68.95000253
12/30/2014 4 44	68.53000251
12/30/2014 5 57	66.79000245
12/30/2014 6 03	66.54000244
12/30/2014 7 07	67.82000249
12/30/2014 8 50	67.37000247
12/30/2014 9 58	67.18000246
12/30/2014 10 18	66.82000245
12/30/2014 11 39	67.06000246
12/30/2014 12 51	64.01000235
12/30/2014 13 55	66.85000245
12/30/2014 14 17	66.91000245
12/30/2014 15 05	66.97000245
12/30/2014 16 06	67.43000247
12/30/2014 17 16	66.57000244
12/30/2014 18 20	67.24000246
12/30/2014 19 24	67.30000247
12/30/2014 20 44	67.30000247
12/30/2014 21 38	67.76000248
12/30/2014 22 03	68.1300025
12/30/2014 23 21	68.2500025
12/31/2014 0 06	64.86000238
12/31/2014 1 04	68.1600025
12/31/2014 2 24	69.20000254
12/31/2014 3 38	69.26000254
12/31/2014 4 42	69.14000253
12/31/2014 5 09	67.52000247
12/31/2014 6 18	66.05000242
12/31/2014 7 46	68.3400025
12/31/2014 8 24	67.88000249
12/31/2014 9 46	67.21000246
12/31/2014 10 27	67.06000246
12/31/2014 11 55	67.30000247
12/31/2014 12 39	67.33000247
12/31/2014 13 28	67.49000247
12/31/2014 14 44	67.46000247
12/31/2014 15 32	67.67000248
12/31/2014 16 36	67.03000246
12/31/2014 17 27	67.18000246
12/31/2014 18 08	68.04000249
12/31/2014 19 10	67.76000248
12/31/2014 20 10	68.2800025
12/31/2014 21 38	68.56000251
12/31/2014 22 23	68.1600025
12/31/2014 23 01	69.35000254
1/1/2015 0 02	69.32000254
1/1/2015 1 20	65.63000241
1/1/2015 2 22	68.49000251
1/1/2015 3 01	69.04000253
1/1/2015 4 03	69.29000254
1/1/2015 5 23	69.23000254
1/1/2015 6 48	68.80000252
1/1/2015 7 53	67.70000248
1/1/2015 8 20	66.94000245
1/1/2015 9 42	67.43000247
1/1/2015 10 46	67.88000249
1/1/2015 11 13	67.67000248
1/1/2015 12 02	67.58000248

12/28/2014 16 00	76.54000144
12/28/2014 17 00	76.54000144
12/28/2014 18 00	76.54000144
12/28/2014 19 00	76.54000144
12/28/2014 20 00	76.54000144
12/28/2014 21 00	76.54000144
12/28/2014 22 00	76.54000144
12/28/2014 23 00	76.54000144
12/29/2014 0 00	76.54000144
12/29/2014 1 00	76.54000144
12/29/2014 2 00	76.54000144
12/29/2014 3 00	76.54000144
12/29/2014 4 00	76.54000144
12/29/2014 5 00	76.54000144
12/29/2014 6 00	76.54000144
12/29/2014 7 00	76.54000144
12/29/2014 8 00	76.54000144
12/29/2014 9 00	76.54000144
12/29/2014 10 00	76.54000144
12/29/2014 11 00	76.54000144
12/29/2014 12 00	76.54000144
12/29/2014 13 00	76.54000144
12/29/2014 14 00	76.54000144
12/29/2014 15 00	76.54000144
12/29/2014 16 00	76.54000144
12/29/2014 17 00	76.54000144
12/29/2014 18 00	76.54000144
12/29/2014 19 00	76.54000144
12/29/2014 20 00	76.54000144
12/29/2014 21 00	76.54000144
12/29/2014 22 00	76.54000144
12/29/2014 23 00	76.54000144
12/30/2014 0 00	76.54000144
12/30/2014 1 00	76.54000144
12/30/2014 2 00	76.54000144
12/30/2014 3 00	76.54000144
12/30/2014 4 00	76.54000144
12/30/2014 5 00	76.54000144
12/30/2014 6 00	76.54000144
12/30/2014 7 00	76.54000144
12/30/2014 8 00	76.54000144
12/30/2014 9 00	76.54000144
12/30/2014 10 00	76.54000144
12/30/2014 11 00	76.54000144
12/30/2014 12 00	76.54000144
12/30/2014 13 00	76.54000144
12/30/2014 14 00	76.54000144
12/30/2014 15 00	76.54000144
12/30/2014 16 00	76.54000144
12/30/2014 17 00	76.54000144
12/30/2014 18 00	76.54000144
12/30/2014 19 00	76.54000144
12/30/2014 20 00	76.54000144
12/30/2014 21 00	76.54000144
12/30/2014 22 00	76.54000144
12/30/2014 23 00	76.54000144
12/31/2014 0 00	76.54000144
12/31/2014 1 00	76.54000144
12/31/2014 2 00	76.54000144
12/31/2014 3 00	76.54000144
12/31/2014 4 00	76.54000144
12/31/2014 5 00	76.54000144
12/31/2014 6 00	76.54000144
12/31/2014 7 00	76.54000144
12/31/2014 8 00	76.54000144
12/31/2014 9 00	76.54000144
12/31/2014 10 00	76.54000144
12/31/2014 11 00	76.54000144
12/31/2014 12 00	76.54000144
12/31/2014 13 00	76.54000144
12/31/2014 14 00	76.54000144
12/31/2014 15 00	76.54000144
12/31/2014 16 00	76.54000144
12/31/2014 17 00	76.54000144
12/31/2014 18 00	76.54000144
12/31/2014 19 00	76.54000144
12/31/2014 20 00	76.54000144
12/31/2014 21 00	76.54000144
12/31/2014 22 00	76.54000144
12/31/2014 23 00	76.54000144
1/1/2015 0 00	76.54000144
1/1/2015 1 00	76.54000144
1/1/2015 2 00	76.54000144
1/1/2015 3 00	76.54000144
1/1/2015 4 00	76.54000144
1/1/2015 5 00	76.54000144
1/1/2015 6 00	76.54000144
1/1/2015 7 00	76.54000144
1/1/2015 8 00	76.54000144
1/1/2015 9 00	76.54000144
1/1/2015 10 00	76.54000144
1/1/2015 11 00	76.54000144
1/1/2015 12 00	76.54000144
1/1/2015 13 00	76.54000144

12/28/2014 16 21	71.1599982
12/28/2014 17 25	71.1299982
12/28/2014 18 01	71.61999819
12/28/2014 19 55	71.85999818
12/28/2014 20 24	72.04999818
12/28/2014 21 32	71.92999818
12/28/2014 22 00	72.16999818
12/28/2014 23 41	68.19999827
12/29/2014 0 19	71.55999819
12/29/2014 1 30	71.89999818
12/29/2014 2 10	72.22999817
12/29/2014 3 53	72.65999816
12/29/2014 4 26	72.31999817
12/29/2014 5 40	70.82999821
12/29/2014 6 04	70.60999821
12/29/2014 7 14	71.49999819
12/29/2014 8 10	71.0999982
12/29/2014 9 51	71.0699982
12/29/2014 10 35	70.79999821
12/29/2014 11 23	71.2199982
12/29/2014 12 17	70.91999821
12/29/2014 13 03	70.79999821
12/29/2014 14 53	71.3199982
12/29/2014 15 43	71.2199982
12/29/2014 16 20	71.55999819
12/29/2014 17 21	71.0699982
12/29/2014 18 19	71.55999819
12/29/2014 19 14	71.2499982
12/29/2014 20 21	71.64999819
12/29/2014 21 39	71.58999819
12/29/2014 22 56	70.88999821
12/29/2014 23 02	72.31999817
12/30/2014 0 14	67.76999828
12/30/2014 1 15	71.2499982
12/30/2014 2 38	71.92999818
12/30/2014 3 33	72.07999818
12/30/2014 4 57	71.85999818
12/30/2014 5 53	70.60999821
12/30/2014 6 09	69.72999823
12/30/2014 7 36	71.2799982
12/30/2014 8 49	70.08999823
12/30/2014 9 43	70.76999821
12/30/2014 10 02	71.3499982
12/30/2014 11 35	71.40999819
12/30/2014 12 50	67.98999828
12/30/2014 13 54	71.1299982
12/30/2014 14 21	71.2199982
12/30/2014 15 32	71.2499982
12/30/2014 16 16	71.40999819
12/30/2014 17 39	71.3199982
12/30/2014 18 21	71.0099982
12/30/2014 19 35	71.2199982
12/30/2014 20 15	71.67999819
12/30/2014 21 09	71.37999819
12/30/2014 22 32	71.76999819
12/30/2014 23 18	71.82999818
12/31/2014 0 06	68.31999827
12/31/2014 1 19	71.2499982
12/31/2014 2 56	72.71999816
12/31/2014 3 29	72.74999816
12/31/2014 4 46	72.43999817
12/31/2014 5 55	71.1299982
12/31/2014 6 18	70.21999822
12/31/2014 7 32	71.95999818
12/31/2014 8 16	71.2499982
12/31/2014 9 45	71.1599982
12/31/2014 10 39	71.43999819
12/31/2014 11 49	71.3499982
12/31/2014 12 31	71.2199982
12/31/2014 13 30	71.46999819
12/31/2014 14 13	71.58999819
12/31/2014 15 26	71.76999819
12/31/2014 16 36	71.67999819
12/31/2014 17 43	71.73999819
12/31/2014 18 10	71.82999818
12/31/2014 19 10	69.11999825
12/31/2014 20 26	72.22999817
12/31/2014 21 05	72.50999817
12/31/2014 22 24	72.19999818
12/31/2014 23 16	73.01999816
1/1/2015 0 03	72.62999816
1/1/2015 1 20	68.71999826
1/1/2015 2 04	72.07999818
1/1/2015 3 01	72.68999816
1/1/2015 4 03	72.47999817
1/1/2015 5 24	72.71999816
1/1/2015 6 29	72.50999817
1/1/2015 7 52	71.40999819
1/1/2015 8 16	70.69999821
1/1/2015 9 43	71.1899982
1/1/2015 10 53	71.67999819
1/1/2015 11 06	71.58999819
1/1/2015 12 25	71.92999818
1/1/2015 13 00	72.01999818

12/28/2014 16 41	74.05000207
12/28/2014 17 28	74.29000208
12/28/2014 18 44	73.65000206
12/28/2014 19 09	73.38000205
12/28/2014 20 25	73.56000206
12/28/2014 21 01	73.62000206
12/28/2014 22 19	74.23000208
12/28/2014 23 41	73.38000205
12/29/2014 0 33	74.57000209
12/29/2014 1 58	74.57000209
12/29/2014 2 00	74.57000209
12/29/2014 3 03	75.0900021
12/29/2014 4 38	74.66000209
12/29/2014 5 41	74.9000021
12/29/2014 6 16	73.99000207
12/29/2014 7 15	73.77000206
12/29/2014 8 43	73.44000205
12/29/2014 9 48	73.41000205
12/29/2014 10 58	72.83000204
12/29/2014 11 00	72.83000204
12/29/2014 12 12	73.29000205
12/29/2014 13 57	72.98000204
12/29/2014 14 23	73.68000206
12/29/2014 15 10	73.84000207
12/29/2014 16 17	73.50000206
12/29/2014 17 08	73.38000205
12/29/2014 18 32	73.35000205
12/29/2014 19 48	73.29000205
12/29/2014 20 24	73.84000207
12/29/2014 21 23	73.99000207
12/29/2014 22 56	72.55000203
12/29/2014 23 22	74.05000207
12/30/2014 0 14	72.55000203
12/30/2014 1 16	74.78000209
12/30/2014 2 37	74.8700021
12/30/2014 3 38	75.1800021
12/30/2014 4 48	75.21000211
12/30/2014 5 58	74.60000209
12/30/2014 6 02	73.99000207
12/30/2014 7 10	74.20000208
12/30/2014 8 56	72.86000204
12/30/2014 9 19	73.32000205
12/30/2014 10 26	73.29000205
12/30/2014 11 56	73.10000205
12/30/2014 12 54	73.10000205
12/30/2014 13 54	73.26000205
12/30/2014 14 35	73.50000206
12/30/2014 15 25	73.56000206
12/30/2014 16 16	73.53000206
12/30/2014 17 00	73.16000205
12/30/2014 18 00	73.59000206
12/30/2014 19 28	73.81000207
12/30/2014 20 30	73.53000206
12/30/2014 21 06	73.99000207
12/30/2014 22 02	74.26000208
12/30/2014 23 18	73.38000205
12/31/2014 0 12	74.63000209
12/31/2014 1 22	74.63000209
12/31/2014 2 00	75.1200021
12/31/2014 3 37	75.0900021
12/31/2014 4 38	74.84000209
12/31/2014 5 38	74.66000209
12/31/2014 6 38	73.99000207
12/31/2014 7 58	73.90000207
12/31/2014 8 23	73.59000206
12/31/2014 9 58	72.98000204
12/31/2014 10 05	72.68000203
12/31/2014 11 23	72.52000203
12/31/2014 12 50	72.92000204
12/31/2014 13 15	72.98000204
12/31/2014 14 59	73.16000205
12/31/2014 15 00	73.16000205
12/31/2014 16 36	72.98000204
12/31/2014 17 27	73.26000205
12/31/2014 18 04	73.47000206
12/31/2014 19 10	73.62000206
12/31/2014 20 30	74.05000207
12/31/2014 21 00	74.20000208
12/31/2014 22 40	74.42000208
12/31/2014 23 02	74.63000209
1/1/2015 0 02	74.39000208
1/1/2015 1 21	74.05000207
1/1/2015 2 52	75.0300021
1/1/2015 3 58	75.0300021
1/1/2015 4 14	74.81000209
1/1/2015 5 59	75.0900021
1/1/2015 6 03	74.75000209
1/1/2015 7 41	74.39000208
1/1/2015 8 23	74.08000207
1/1/2015 9 22	73.44000205
1/1/2015 10 56	73.38000205
1/1/2015 11 18	73.35000205
1/1/2015 12 44	73.32000205
1/1/2015 13 01	73.07000204

12/28/2014 16 33	68.88999914
12/28/2014 17 30	68.79999914
12/28/2014 18 33	68.76999914
12/28/2014 19 01	68.82999914
12/28/2014 20 17	69.43999913
12/28/2014 21 09	69.67999913
12/28/2014 22 08	70.44999912
12/28/2014 23 42	70.07999912
12/29/2014 0 11	72.2799991
12/29/2014 1 22	72.57999909
12/29/2014 2 04	72.54999909
12/29/2014 3 03	72.73999909
12/29/2014 4 03	72.79999909
12/29/2014 5 07	71.38999911
12/29/2014 6 16	70.71999911
12/29/2014 7 38	69.83999912
12/29/2014 8 20	69.19999913
12/29/2014 9 51	68.12999914
12/29/2014 10 58	67.75999915
12/29/2014 11 04	67.93999915
12/29/2014 12 42	68.09999915
12/29/2014 13 07	68.48999914
12/29/2014 14 00	68.51999914
12/29/2014 15 02	69.37999913
12/29/2014 16 04	68.79999914
12/29/2014 17 04	68.64999914
12/29/2014 18 00	68.79999914
12/29/2014 19 48	68.30999914
12/29/2014 20 47	69.80999912
12/29/2014 21 43	69.46999913
12/29/2014 22 13	69.86999912
12/29/2014 23 26	71.26999911
12/30/2014 0 15	70.56999912
12/30/2014 1 57	72.42999909
12/30/2014 2 45	72.42999909
12/30/2014 3 12	72.57999909
12/30/2014 4 38	72.45999909
12/30/2014 5 57	71.7899991
12/30/2014 6 14	70.53999912
12/30/2014 7 08	70.01999912
12/30/2014 8 56	68.85999914
12/30/2014 9 40	68.00999915
12/30/2014 10 26	68.00999915
12/30/2014 11 17	67.97999915
12/30/2014 12 54	68.48999914
12/30/2014 13 07	68.82999914
12/30/2014 14 11	69.13999913
12/30/2014 15 33	69.34999913
12/30/2014 16 54	69.28999913
12/30/2014 17 56	68.73999914
12/30/2014 18 33	68.91999914
12/30/2014 19 04	68.76999914
12/30/2014 20 03	69.37999913
12/30/2014 21 07	69.83999912
12/30/2014 22 06	69.92999912
12/30/2014 23 21	70.44999912
12/31/2014 0 06	70.32999912
12/31/2014 1 19	71.8499991
12/31/2014 2 57	72.0999991
12/31/2014 3 01	72.61999909
12/31/2014 4 54	72.70999909
12/31/2014 5 32	71.7299991
12/31/2014 6 44	70.65999911
12/31/2014 7 50	69.80999912
12/31/2014 8 55	69.28999913
12/31/2014 9 58	67.78999915
12/31/2014 10 10	68.00999915
12/31/2014 11 38	67.72999915
12/31/2014 12 24	67.97999915
12/31/2014 13 25	67.23999916
12/31/2014 14 31	68.12999914
12/31/2014 15 17	68.64999914
12/31/2014 16 46	68.06999915
12/31/2014 17 43	67.97999915
12/31/2014 18 10	68.82999914
12/31/2014 19 10	69.03999913
12/31/2014 20 02	70.44999912
12/31/2014 21 35	70.80999911
12/31/2014 22 18	71.05999911
12/31/2014 23 54	71.5799991
1/1/2015 0 04	71.17999911
1/1/2015 1 20	70.07999912
1/1/2015 2 03	71.8799991
1/1/2015 3 08	72.64999909
1/1/2015 4 08	72.67999909
1/1/2015 5 59	72.70999909
1/1/2015 6 49	72.36999909
1/1/2015 7 52	71.7899991
1/1/2015 8 48	70.53999912
1/1/2015 9 43	68.24999914
1/1/2015 10 59	67.72999915
1/1/2015 11 24	66.87999916
1/1/2015 12 01	66.96999916
1/1/2015 13 01	67.29999915

12/28/2014 16 15	72.97000273
12/28/2014 17 00	73.09000274
12/28/2014 18 28	72.88000273
12/28/2014 19 09	72.91000273
12/28/2014 20 49	73.40000275
12/28/2014 21 06	73.61000275
12/28/2014 22 08	73.83000276
12/28/2014 23 05	73.09000274
12/29/2014 0 05	74.9600028
12/29/2014 1 17	75.41000282
12/29/2014 2 00	75.57000283
12/29/2014 3 50	75.75000283
12/29/2014 4 39	75.69000283
12/29/2014 5 08	74.38000278
12/29/2014 6 38	73.89000277
12/29/2014 7 39	73.46000275
12/29/2014 8 40	73.06000273
12/29/2014 9 52	72.30000271
12/29/2014 10 58	72.2400027
12/29/2014 11 00	72.2400027
12/29/2014 12 08	72.58000272
12/29/2014 13 12	72.79000272
12/29/2014 14 00	73.22000274
12/29/2014 15 23	73.52000275
12/29/2014 16 13	72.94000273
12/29/2014 17 25	72.85000273
12/29/2014 18 20	72.82000273
12/29/2014 19 48	73.00000273
12/29/2014 20 00	73.28000274
12/29/2014 21 39	73.19000274
12/29/2014 22 13	73.55000275
12/29/2014 23 27	74.65000279
12/30/2014 0 05	74.59000279
12/30/2014 1 57	75.17000281
12/30/2014 2 10	75.60000283
12/30/2014 3 34	75.41000282
12/30/2014 4 41	75.29000282
12/30/2014 5 37	74.8300028
12/30/2014 6 03	74.07000277
12/30/2014 7 31	73.37000275
12/30/2014 8 56	72.39000271
12/30/2014 9 41	72.27000271
12/30/2014 10 20	72.2400027
12/30/2014 11 00	72.30000271
12/30/2014 12 12	72.39000271
12/30/2014 13 00	72.64000272
12/30/2014 14 06	73.28000274
12/30/2014 15 40	73.22000274
12/30/2014 16 02	73.19000274
12/30/2014 17 26	72.85000273
12/30/2014 18 47	72.79000272
12/30/2014 19 39	73.00000273
12/30/2014 20 30	73.22000274
12/30/2014 21 56	73.83000276
12/30/2014 22 02	73.80000276
12/30/2014 23 11	74.59000279
12/31/2014 0 09	75.17000281
12/31/2014 1 12	75.29000282
12/31/2014 2 02	75.78000284
12/31/2014 3 55	75.75000283
12/31/2014 4 28	75.63000283
12/31/2014 5 37	74.9300028
12/31/2014 6 56	74.35000278
12/31/2014 7 50	73.34000274
12/31/2014 8 46	73.00000273
12/31/2014 9 23	72.1200027
12/31/2014 10 37	71.96000269
12/31/2014 11 02	71.87000269
12/31/2014 12 33	72.39000271
12/31/2014 13 47	72.2100027
12/31/2014 14 05	72.54000272
12/31/2014 15 00	72.64000272
12/31/2014 16 47	71.78000269
12/31/2014 17 31	72.51000271
12/31/2014 18 17	72.91000273
12/31/2014 19 20	73.25000274
12/31/2014 20 14	73.95000277
12/31/2014 21 13	74.19000278
12/31/2014 22 11	74.59000279
12/31/2014 23 00	74.59000279
1/1/2015 0 17	74.62000279
1/1/2015 1 21	74.53000279
1/1/2015 2 47	75.11000281
1/1/2015 3 14	75.51000283
1/1/2015 4 18	75.38000282
1/1/2015 5 23	75.78000284
1/1/2015 6 29	75.41000282
1/1/2015 7 58	75.11000281
1/1/2015 8 34	74.10000277
1/1/2015 9 43	72.1200027
1/1/2015 10 42	71.84000269
1/1/2015 11 30	71.42000267
1/1/2015 12 05	70.93000266
1/1/2015 13 13	71.45000268

12/28/2014 15 02	72.86
12/28/2014 16 14	72.92
12/28/2014 17 04	73.04
12/28/2014 18 05	73.29
12/28/2014 19 01	72.55
12/28/2014 20 09	73.53
12/28/2014 21 33	73.84
12/28/2014 22 47	74.66
12/28/2014 23 05	74.29
12/29/2014 0 24	75.15
12/29/2014 1 22	75.39
12/29/2014 2 02	75.54
12/29/2014 3 04	75.82
12/29/2014 4 34	75.94
12/29/2014 5 41	75.03
12/29/2014 6 55	74.02
12/29/2014 7 25	73.96
12/29/2014 8 02	73.74
12/29/2014 9 52	73.07
12/29/2014 10 42	73.16
12/29/2014 11 02	72.74
12/29/2014 12 41	72.31
12/29/2014 13 00	72.86
12/29/2014 14 03	73.07
12/29/2014 15 09	73.22
12/29/2014 16 05	73.32
12/29/2014 17 28	72.98
12/29/2014 18 26	73.16
12/29/2014 19 01	73.13
12/29/2014 20 46	73.62
12/29/2014 21 23	73.84
12/29/2014 22 12	73.5
12/29/2014 23 24	74.42
12/30/2014 0 14	73.93
12/30/2014 1 50	75.33
12/30/2014 2 00	75.24
12/30/2014 3 59	75.7
12/30/2014 4 41	75
12/30/2014 5 19	75.15
12/30/2014 6 44	73.9
12/30/2014 7 47	74.11
12/30/2014 8 06	73.56
12/30/2014 9 40	72.68
12/30/2014 10 18	73.01
12/30/2014 11 23	72.58
12/30/2014 12 06	72.68
12/30/2014 13 19	73.19
12/30/2014 14 27	73.32
12/30/2014 15 59	73.5
12/30/2014 16 57	72.77
12/30/2014 17 44	72.22
12/30/2014 18 33	72.43
12/30/2014 19 00	73.41
12/30/2014 20 23	73.41
12/30/2014 21 10	73.9
12/30/2014 22 01	74.02
12/30/2014 23 37	74.48
12/31/2014 0 02	74.87
12/31/2014 1 19	75.09
12/31/2014 2 13	75.67
12/31/2014 3 28	75.61
12/31/2014 4 37	75.61
12/31/2014 5 56	74.35
12/31/2014 6 39	74.29
12/31/2014 7 50	72.95
12/31/2014 8 26	74.32
12/31/2014 9 33	72.89
12/31/2014 10 12	72.61
12/31/2014 11 04	71.06
12/31/2014 12 38	72.55
12/31/2014 13 14	72.89
12/31/2014 14 06	72
12/31/2014 15 00	72.37
12/31/2014 16 59	72.83
12/31/2014 17 11	72.34
12/31/2014 18 00	72.71
12/31/2014 19 14	73.71
12/31/2014 20 10	73.77
12/31/2014 21 10	73.93
12/31/2014 22 40	74.6
12/31/2014 23 08	75.09
1/1/2015 0 18	74.54
1/1/2015 1 20	73.16
1/1/2015 2 22	75.57
1/1/2015 3 32	75.7
1/1/2015 4 56	75.97
1/1/2015 5 37	75.61
1/1/2015 6 48	75.36
1/1/2015 7 47	74.6
1/1/2015 8 29	74.29
1/1/2015 9 58	73.62
1/1/2015 10 55	72.71
1/1/2015 11 06	72.52
1/1/2015 12 42	72.58

1/1/2015 14 02	71.24000246
1/1/2015 15 41	71.76000247
1/1/2015 16 07	72.31000249
1/1/2015 17 54	72.10000248
1/1/2015 18 01	72.5500025
1/1/2015 19 06	70.29000242
1/1/2015 20 29	72.22000249
1/1/2015 21 55	73.62000254
1/1/2015 22 49	73.47000253
1/1/2015 23 01	74.72000257
1/2/2015 0 32	70.05000242
1/2/2015 1 38	74.38000256
1/2/2015 2 33	74.05000255
1/2/2015 3 37	74.90000258
1/2/2015 4 20	73.99000255
1/2/2015 5 51	73.56000253
1/2/2015 6 11	72.40000249
1/2/2015 7 15	73.13000252
1/2/2015 8 23	72.34000249
1/2/2015 9 37	71.21000246
1/2/2015 10 10	69.6500024
1/2/2015 11 10	69.6800024
1/2/2015 12 30	70.66000244
1/2/2015 13 05	70.97000245
1/2/2015 14 50	71.52000247
1/2/2015 15 19	71.21000246
1/2/2015 16 33	72.07000248
1/2/2015 17 31	71.00000245
1/2/2015 18 22	70.26000242
1/2/2015 19 03	72.4900025
1/2/2015 20 51	72.6100025
1/2/2015 21 00	73.07000252
1/2/2015 22 40	73.44000253
1/2/2015 23 00	74.08000255
1/3/2015 0 56	73.19000252
1/3/2015 1 00	74.11000255
1/3/2015 2 03	74.69000257
1/3/2015 3 38	75.30000259
1/3/2015 4 58	75.03000258
1/3/2015 5 33	74.54000257
1/3/2015 6 50	73.96000255
1/3/2015 7 31	64.77000224
1/3/2015 8 00	71.94000248
1/3/2015 9 38	72.22000249
1/3/2015 10 30	71.39000246
1/3/2015 11 13	71.24000246
1/3/2015 12 42	71.36000246
1/3/2015 13 11	71.21000246
1/3/2015 14 08	71.52000247
1/3/2015 15 49	71.70000247
1/3/2015 16 12	72.00000248
1/3/2015 17 03	72.07000248
1/3/2015 18 52	71.61000247
1/3/2015 19 00	72.4300025
1/3/2015 20 35	73.26000252
1/3/2015 21 31	73.38000253
1/3/2015 22 26	72.95000251
1/3/2015 23 01	73.99000255
1/4/2015 0 30	71.03000245
1/4/2015 1 00	74.20000255
1/4/2015 2 01	74.84000258
1/4/2015 3 00	74.96000258
1/4/2015 4 35	75.09000258
1/4/2015 5 51	75.12000259
1/4/2015 6 59	74.08000255
1/4/2015 7 59	72.10000248
1/4/2015 8 01	71.97000248
1/4/2015 9 42	72.07000248
1/4/2015 10 35	71.36000246
1/4/2015 11 04	71.00000245
1/4/2015 12 59	71.15000245
1/4/2015 13 32	69.07000238
1/4/2015 14 07	71.36000246
1/4/2015 15 13	71.82000248
1/4/2015 16 23	71.97000248
1/4/2015 17 46	71.58000247
1/4/2015 18 31	71.33000246
1/4/2015 19 43	71.27000246
1/4/2015 20 34	71.97000248
1/4/2015 21 32	72.5500025
1/4/2015 22 03	73.23000252
1/4/2015 23 05	74.29000256
1/5/2015 0 04	69.90000241
1/5/2015 1 08	72.6800025
1/5/2015 2 04	74.78000257
1/5/2015 3 28	73.84000254
1/5/2015 4 53	73.41000253
1/5/2015 5 38	72.5800025
1/5/2015 6 36	72.10000248
1/5/2015 7 37	69.7100024
1/5/2015 8 02	71.21000246
1/5/2015 9 39	70.63000244
1/5/2015 10 57	70.72000244
1/5/2015 11 48	70.17000242
1/5/2015 12 48	70.20000242

1/1/2015 14 03	66.99000062
1/1/2015 15 31	67.63000063
1/1/2015 16 01	67.69000063
1/1/2015 17 11	68.24000063
1/1/2015 18 47	68.57000064
1/1/2015 19 02	68.30000063
1/1/2015 20 00	68.94000064
1/1/2015 21 18	69.40000064
1/1/2015 22 12	69.70000065
1/1/2015 23 00	70.10000065
1/2/2015 0 32	69.92000065
1/2/2015 1 05	71.72000067
1/2/2015 2 34	70.74000066
1/2/2015 3 53	71.69000067
1/2/2015 4 55	71.32000066
1/2/2015 5 18	70.28000065
1/2/2015 6 27	70.31000065
1/2/2015 7 09	69.37000064
1/2/2015 8 53	68.05000063
1/2/2015 9 55	67.14000062
1/2/2015 10 18	67.05000062
1/2/2015 11 11	66.74000062
1/2/2015 12 21	67.02000062
1/2/2015 13 49	67.57000063
1/2/2015 14 06	67.96000063
1/2/2015 15 28	67.87000063
1/2/2015 16 01	66.68000062
1/2/2015 17 35	67.32000062
1/2/2015 18 31	67.87000063
1/2/2015 19 10	68.30000063
1/2/2015 20 00	69.03000064
1/2/2015 21 00	69.27000064
1/2/2015 22 19	68.97000064
1/2/2015 23 34	70.13000065
1/3/2015 0 56	70.62000066
1/3/2015 1 13	70.74000066
1/3/2015 2 02	71.59000067
1/3/2015 3 20	71.75000067
1/3/2015 4 33	71.01000066
1/3/2015 5 39	71.26000066
1/3/2015 6 36	70.47000065
1/3/2015 7 29	53.9500005 A
1/3/2015 8 51	69.40000064
1/3/2015 9 55	67.29000062
1/3/2015 10 10	66.74000062
1/3/2015 11 32	65.92000061
1/3/2015 12 47	66.37000062
1/3/2015 13 54	66.99000062
1/3/2015 14 00	66.25000061
1/3/2015 15 45	67.47000063
1/3/2015 16 17	67.14000062
1/3/2015 17 08	67.20000062
1/3/2015 18 30	68.02000063
1/3/2015 19 01	68.79000064
1/3/2015 20 48	68.27000063
1/3/2015 21 05	68.63000064
1/3/2015 22 09	68.94000064
1/3/2015 23 02	69.27000064
1/4/2015 0 30	69.09000064
1/4/2015 1 12	70.65000066
1/4/2015 2 03	71.38000066
1/4/2015 3 08	71.53000067
1/4/2015 4 04	71.53000067
1/4/2015 5 36	71.38000066
1/4/2015 6 55	70.74000066
1/4/2015 7 40	69.58000065
1/4/2015 8 42	68.08000063
1/4/2015 9 40	66.53000062
1/4/2015 10 56	65.0900006
1/4/2015 11 50	63.75000059 A
1/4/2015 12 03	64.4200006 A
1/4/2015 13 42	64.7600006 A
1/4/2015 14 10	65.25000061
1/4/2015 15 30	66.37000062
1/4/2015 16 34	66.28000062
1/4/2015 17 51	66.19000061
1/4/2015 18 32	65.61000061
1/4/2015 19 42	64.7300006 A
1/4/2015 20 35	66.34000062
1/4/2015 21 35	68.33000063
1/4/2015 22 34	67.47000063
1/4/2015 23 00	70.13000065
1/5/2015 0 05	70.43000065
1/5/2015 1 40	71.08000066
1/5/2015 2 27	70.68000066
1/5/2015 3 28	71.29000066
1/5/2015 4 53	70.40000065
1/5/2015 5 59	68.57000064
1/5/2015 6 59	66.99000062
1/5/2015 7 10	66.07000061
1/5/2015 8 38	68.30000063
1/5/2015 9 35	68.42000064
1/5/2015 10 03	68.11000063
1/5/2015 11 11	67.72000063
1/5/2015 12 39	67.41000063

1/1/2015 13 47	71.09999776
1/1/2015 14 39	71.37999776
1/1/2015 15 57	70.30999779
1/1/2015 16 00	71.15999776
1/1/2015 17 10	72.10999773
1/1/2015 18 46	71.43999775
1/1/2015 19 44	72.56999772
1/1/2015 20 55	72.62999772
1/1/2015 21 10	71.95999774
1/1/2015 22 30	71.92999774
1/1/2015 23 06	68.19999785
1/2/2015 0 32	71.49999775
1/2/2015 1 22	73.84999768
1/2/2015 2 44	74.05999767
1/2/2015 3 31	73.90999768
1/2/2015 4 04	73.81999768
1/2/2015 5 17	73.47999769
1/2/2015 6 04	72.68999772
1/2/2015 7 02	72.62999772
1/2/2015 8 22	71.64999775
1/2/2015 9 40	70.70999778
1/2/2015 10 53	71.46999775
1/2/2015 11 23	70.42999779
1/2/2015 12 37	70.79999777
1/2/2015 13 04	70.82999777
1/2/2015 14 45	71.24999776
1/2/2015 15 07	70.76999778
1/2/2015 16 02	71.49999775
1/2/2015 17 32	71.64999775
1/2/2015 18 39	72.25999773
1/2/2015 19 45	72.25999773
1/2/2015 20 02	72.40999772
1/2/2015 21 01	71.64999775
1/2/2015 22 07	72.65999772
1/2/2015 23 01	72.74999771
1/3/2015 0 55	72.56999772
1/3/2015 1 26	73.93999768
1/3/2015 2 43	73.72999768
1/3/2015 3 55	74.14999767
1/3/2015 4 46	73.96999768
1/3/2015 5 42	73.66999769
1/3/2015 6 03	73.44999769
1/3/2015 7 31	67.00999789
1/3/2015 8 03	72.25999773
1/3/2015 9 34	71.34999776
1/3/2015 10 56	70.60999778
1/3/2015 11 00	70.60999778
1/3/2015 12 42	71.06999777
1/3/2015 13 20	71.46999775
1/3/2015 14 17	71.40999776
1/3/2015 15 24	71.09999776
1/3/2015 16 07	71.49999775
1/3/2015 17 11	71.95999774
1/3/2015 18 21	71.82999774
1/3/2015 19 17	72.07999773
1/3/2015 20 21	72.34999773
1/3/2015 21 07	72.16999773
1/3/2015 22 00	72.89999771
1/3/2015 23 10	72.68999772
1/4/2015 0 09	73.2699977
1/4/2015 1 25	73.84999768
1/4/2015 2 36	73.81999768
1/4/2015 3 34	73.66999769
1/4/2015 4 41	73.90999768
1/4/2015 5 24	73.96999768
1/4/2015 6 24	73.66999769
1/4/2015 7 31	72.56999772
1/4/2015 8 41	71.86999774
1/4/2015 9 49	71.15999776
1/4/2015 10 49	70.24999779
1/4/2015 11 51	66.51999791
1/4/2015 12 58	70.97999777
1/4/2015 13 00	70.97999777
1/4/2015 14 02	71.58999775
1/4/2015 15 35	71.98999774
1/4/2015 16 12	71.73999775
1/4/2015 17 20	71.18999776
1/4/2015 18 19	71.12999776
1/4/2015 19 43	71.34999776
1/4/2015 20 19	71.15999776
1/4/2015 21 18	72.31999773
1/4/2015 22 02	72.47999772
1/4/2015 23 15	73.1199977
1/5/2015 0 11	73.53999769
1/5/2015 1 09	73.47999769
1/5/2015 2 05	73.81999768
1/5/2015 3 32	72.59999772
1/5/2015 4 59	73.72999768
1/5/2015 5 51	73.0899977
1/5/2015 6 49	71.40999776
1/5/2015 7 50	70.0899978
1/5/2015 8 34	71.24999776
1/5/2015 9 42	72.07999773
1/5/2015 10 37	71.82999774
1/5/2015 11 30	71.98999774

1/1/2015 13 12	70.14
1/1/2015 14 18	69.9
1/1/2015 15 53	70.54
1/1/2015 16 40	70.23
1/1/2015 17 48	70.6
1/1/2015 18 21	70.23
1/1/2015 19 39	70.84
1/1/2015 20 18	70.32
1/1/2015 21 28	71.12
1/1/2015 22 01	71.18
1/1/2015 23 05	71.7
1/2/2015 0 32	68.95
1/2/2015 1 46	70.84
1/2/2015 2 17	72.25
1/2/2015 3 31	72.37
1/2/2015 4 51	72.16
1/2/2015 5 51	71.24
1/2/2015 6 11	70.36
1/2/2015 7 11	70.6
1/2/2015 8 52	70.05
1/2/2015 9 41	70.05
1/2/2015 10 14	69.87
1/2/2015 11 57	69.13
1/2/2015 12 12	69.26
1/2/2015 13 03	69.53
1/2/2015 14 00	70.08
1/2/2015 15 17	70.6
1/2/2015 16 41	70.11
1/2/2015 17 51	70.66
1/2/2015 18 30	70.36
1/2/2015 19 45	70.63
1/2/2015 20 55	70.75
1/2/2015 21 15	70.75
1/2/2015 22 09	70.87
1/2/2015 23 33	71.27
1/3/2015 0 55	71.3
1/3/2015 1 00	71.76
1/3/2015 2 03	71.79
1/3/2015 3 28	72.06
1/3/2015 4 42	72.28
1/3/2015 5 48	72.16
1/3/2015 6 41	71.7
1/3/2015 7 31	63.76
1/3/2015 8 04	70.32
1/3/2015 9 12	70.42
1/3/2015 10 09	69.96
1/3/2015 11 23	69.2
1/3/2015 12 07	69.84
1/3/2015 13 54	70.14
1/3/2015 14 35	70.2
1/3/2015 15 35	70.45
1/3/2015 16 24	70.39
1/3/2015 17 11	70.39
1/3/2015 18 52	70.17
1/3/2015 19 03	70.02
1/3/2015 20 47	70.69
1/3/2015 21 45	70.57
1/3/2015 22 26	70.6
1/3/2015 23 03	71.58
1/4/2015 0 30	69.16
1/4/2015 1 07	71.73
1/4/2015 2 01	72.06
1/4/2015 3 31	72.46
1/4/2015 4 35	72.52
1/4/2015 5 26	72.19
1/4/2015 6 20	71.58
1/4/2015 7 38	71.03
1/4/2015 8 42	70.51
1/4/2015 9 35	69.84
1/4/2015 10 15	69.65
1/4/2015 11 10	69.5
1/4/2015 12 22	70.05
1/4/2015 13 32	68.25
1/4/2015 14 05	70.05
1/4/2015 15 44	70.48
1/4/2015 16 33	70.11
1/4/2015 17 17	69.99
1/4/2015 18 31	70.02
1/4/2015 19 02	69.56
1/4/2015 20 32	69.71
1/4/2015 21 01	71.03
1/4/2015 22 48	70.84
1/4/2015 23 29	71.52
1/5/2015 0 11	71.24
1/5/2015 1 39	71.61
1/5/2015 2 08	71.94
1/5/2015 3 28	71.39
1/5/2015 4 52	70.81
1/5/2015 5 38	71.48
1/5/2015 6 50	70.11
1/5/2015 7 12	69.93
1/5/2015 8 02	70.02
1/5/2015 9 59	69.9
1/5/2015 10 00	69.9
1/5/2015 11 11	69.9

1/1/2015 13 14	67.73000248
1/1/2015 14 26	67.82000249
1/1/2015 15 49	68.07000249
1/1/2015 16 46	68.07000249
1/1/2015 17 01	68.1600025
1/1/2015 18 25	68.1600025
1/1/2015 19 02	67.88000249
1/1/2015 20 00	67.61000248
1/1/2015 21 00	68.62000252
1/1/2015 22 49	68.43000251
1/1/2015 23 01	69.44000255
1/2/2015 0 32	64.34000236
1/2/2015 1 42	68.56000251
1/2/2015 2 11	69.07000253
1/2/2015 3 18	69.75000256
1/2/2015 4 20	68.2500025
1/2/2015 5 57	68.04000249
1/2/2015 6 11	67.09000246
1/2/2015 7 48	68.53000251
1/2/2015 8 52	67.37000247
1/2/2015 9 37	67.79000248
1/2/2015 10 14	67.00000246
1/2/2015 11 57	65.93000242
1/2/2015 12 49	66.36000243
1/2/2015 13 05	66.30000243
1/2/2015 14 46	67.55000248
1/2/2015 15 23	67.37000247
1/2/2015 16 41	67.91000249
1/2/2015 17 31	67.40000247
1/2/2015 18 22	67.64000248
1/2/2015 19 03	67.88000249
1/2/2015 20 51	67.98000249
1/2/2015 21 00	68.40000251
1/2/2015 22 23	68.53000251
1/2/2015 23 11	69.56000255
1/3/2015 0 56	67.24000246
1/3/2015 1 02	68.53000251
1/3/2015 2 03	69.07000253
1/3/2015 3 01	69.53000255
1/3/2015 4 46	69.59000255
1/3/2015 5 07	69.38000254
1/3/2015 6 21	68.53000251
1/3/2015 7 31	59.22000217 A
1/3/2015 8 02	66.57000244
1/3/2015 9 45	67.82000249
1/3/2015 10 30	67.33000247
1/3/2015 11 36	67.37000247
1/3/2015 12 54	67.58000248
1/3/2015 13 29	67.67000248
1/3/2015 14 06	67.91000249
1/3/2015 15 24	67.79000248
1/3/2015 16 38	67.73000248
1/3/2015 17 24	68.01000249
1/3/2015 18 52	67.40000247
1/3/2015 19 01	68.07000249
1/3/2015 20 48	68.37000251
1/3/2015 21 45	68.56000251
1/3/2015 22 27	68.2800025
1/3/2015 23 01	68.95000253
1/4/2015 0 30	66.02000242
1/4/2015 1 07	68.53000251
1/4/2015 2 19	69.50000255
1/4/2015 3 41	69.72000256
1/4/2015 4 45	69.72000256
1/4/2015 5 59	69.50000255
1/4/2015 6 55	68.71000252
1/4/2015 7 59	66.72000245
1/4/2015 8 00	66.72000245
1/4/2015 9 42	67.67000248
1/4/2015 10 50	67.67000248
1/4/2015 11 33	67.67000248
1/4/2015 12 59	67.46000247
1/4/2015 13 32	66.05000242
1/4/2015 14 05	67.43000247
1/4/2015 15 03	67.73000248
1/4/2015 16 46	67.73000248
1/4/2015 17 13	67.64000248
1/4/2015 18 23	67.67000248
1/4/2015 19 43	67.18000246
1/4/2015 20 34	67.73000248
1/4/2015 21 09	68.2200025
1/4/2015 22 48	68.49000251
1/4/2015 23 03	69.26000254
1/5/2015 0 04	64.43000236
1/5/2015 1 08	67.52000247
1/5/2015 2 08	69.26000254
1/5/2015 3 28	68.1600025
1/5/2015 4 48	67.88000249
1/5/2015 5 38	67.49000247
1/5/2015 6 56	67.82000249
1/5/2015 7 37	66.33000243
1/5/2015 8 02	67.40000247
1/5/2015 9 39	67.18000246
1/5/2015 10 16	67.00000246
1/5/2015 11 48	67.30000247

1/1/2015 14 00	76.54000144
1/1/2015 15 00	76.54000144
1/1/2015 16 00	76.54000144
1/1/2015 17 00	76.54000144
1/1/2015 18 00	76.54000144
1/1/2015 19 00	76.54000144
1/1/2015 20 00	76.54000144
1/1/2015 21 00	76.54000144
1/1/2015 22 00	76.54000144
1/1/2015 23 00	76.54000144
1/2/2015 0 00	76.54000144
1/2/2015 1 00	76.54000144
1/2/2015 2 00	76.54000144
1/2/2015 3 00	76.54000144
1/2/2015 4 00	76.54000144
1/2/2015 5 00	76.54000144
1/2/2015 6 00	76.54000144
1/2/2015 7 00	76.54000144
1/2/2015 8 00	76.54000144
1/2/2015 9 00	76.54000144
1/2/2015 10 00	76.54000144
1/2/2015 11 00	76.54000144
1/2/2015 12 00	76.54000144
1/2/2015 13 00	76.54000144
1/2/2015 14 00	76.54000144
1/2/2015 15 00	76.54000144
1/2/2015 16 00	76.54000144
1/2/2015 17 00	76.54000144
1/2/2015 18 00	76.54000144
1/2/2015 19 00	76.54000144
1/2/2015 20 00	76.54000144
1/2/2015 21 00	76.54000144
1/2/2015 22 00	76.54000144
1/2/2015 23 00	76.54000144
1/3/2015 0 00	76.54000144
1/3/2015 1 00	76.54000144
1/3/2015 2 00	76.54000144
1/3/2015 3 00	76.54000144
1/3/2015 4 00	76.54000144
1/3/2015 5 00	76.54000144
1/3/2015 6 00	76.54000144
1/3/2015 7 00	76.54000144
1/3/2015 8 00	76.54000144
1/3/2015 9 00	76.54000144
1/3/2015 10 00	76.54000144
1/3/2015 11 00	76.54000144
1/3/2015 12 00	76.54000144
1/3/2015 13 00	76.54000144
1/3/2015 14 00	76.54000144
1/3/2015 15 00	76.54000144
1/3/2015 16 00	76.54000144
1/3/2015 17 00	76.54000144
1/3/2015 18 00	76.54000144
1/3/2015 19 00	76.54000144
1/3/2015 20 00	76.54000144
1/3/2015 21 00	76.54000144
1/3/2015 22 00	76.54000144
1/3/2015 23 00	76.54000144
1/4/2015 0 00	76.54000144
1/4/2015 1 00	76.54000144
1/4/2015 2 00	76.54000144
1/4/2015 3 00	76.54000144
1/4/2015 4 00	76.54000144
1/4/2015 5 00	76.54000144
1/4/2015 6 00	76.54000144
1/4/2015 7 00	76.54000144
1/4/2015 8 00	76.54000144
1/4/2015 9 00	76.54000144
1/4/2015 10 00	76.54000144
1/4/2015 11 00	76.54000144
1/4/2015 12 00	76.54000144
1/4/2015 13 00	76.54000144
1/4/2015 14 00	76.54000144
1/4/2015 15 00	76.54000144
1/4/2015 16 00	76.54000144
1/4/2015 17 00	76.54000144
1/4/2015 18 00	76.54000144
1/4/2015 19 00	76.54000144
1/4/2015 20 00	76.54000144
1/4/2015 21 00	76.54000144
1/4/2015 22 00	76.54000144
1/4/2015 23 00	76.54000144
1/5/2015 0 00	76.54000144
1/5/2015 1 00	76.54000144
1/5/2015 2 00	76.54000144
1/5/2015 3 00	76.54000144
1/5/2015 4 00	76.54000144
1/5/2015 5 00	76.54000144
1/5/2015 6 00	76.54000144
1/5/2015 7 00	76.54000144
1/5/2015 8 00	76.54000144
1/5/2015 9 00	76.54000144
1/5/2015 10 00	76.54000144
1/5/2015 11 00	76.54000144
1/5/2015 12 00	76.54000144

1/1/2015 14 01	71.85999818
1/1/2015 15 27	72.04999818
1/1/2015 16 27	71.85999818
1/1/2015 17 01	71.98999818
1/1/2015 18 16	72.07999818
1/1/2015 19 59	71.85999818
1/1/2015 20 00	71.79999818
1/1/2015 21 46	72.28999817
1/1/2015 22 27	72.25999817
1/1/2015 23 06	70.57999821
1/2/2015 0 32	68.65999826
1/2/2015 1 45	71.98999818
1/2/2015 2 34	71.79999818
1/2/2015 3 18	73.20999815
1/2/2015 4 21	72.31999817
1/2/2015 5 34	71.85999818
1/2/2015 6 11	70.63999821
1/2/2015 7 31	72.01999818
1/2/2015 8 51	71.1599982
1/2/2015 9 41	71.40999819
1/2/2015 10 10	71.2499982
1/2/2015 11 56	68.77999826
1/2/2015 12 36	70.88999821
1/2/2015 13 03	70.82999821
1/2/2015 14 50	71.2499982
1/2/2015 15 04	71.58999819
1/2/2015 16 16	71.46999819
1/2/2015 17 43	71.49999819
1/2/2015 18 27	71.1899982
1/2/2015 19 07	71.76999819
1/2/2015 20 51	72.07999818
1/2/2015 21 04	71.79999818
1/2/2015 22 32	72.04999818
1/2/2015 23 30	70.82999821
1/3/2015 0 54	69.87999823
1/3/2015 1 01	72.13999818
1/3/2015 2 02	72.37999817
1/3/2015 3 01	73.23999815
1/3/2015 4 59	73.17999815
1/3/2015 5 12	72.50999817
1/3/2015 6 54	72.07999818
1/3/2015 7 31	63.28999839
1/3/2015 8 03	69.35999824
1/3/2015 9 29	71.85999818
1/3/2015 10 29	71.61999819
1/3/2015 11 13	71.55999819
1/3/2015 12 45	70.82999821
1/3/2015 13 08	71.92999818
1/3/2015 14 10	72.01999818
1/3/2015 15 24	71.76999819
1/3/2015 16 50	71.82999818
1/3/2015 17 20	71.0999982
1/3/2015 18 52	71.64999819
1/3/2015 19 48	71.92999818
1/3/2015 20 33	72.07999818
1/3/2015 21 44	72.16999818
1/3/2015 22 26	72.07999818
1/3/2015 23 03	72.19999818
1/4/2015 0 29	68.59999826
1/4/2015 1 07	71.98999818
1/4/2015 2 02	72.80999816
1/4/2015 3 48	72.89999816
1/4/2015 4 30	72.83999816
1/4/2015 5 27	72.40999817
1/4/2015 6 59	71.98999818
1/4/2015 7 58	70.21999822
1/4/2015 8 02	70.79999821
1/4/2015 9 20	71.46999819
1/4/2015 10 25	71.46999819
1/4/2015 11 13	71.2199982
1/4/2015 12 36	71.52999819
1/4/2015 13 31	68.92999825
1/4/2015 14 04	71.1899982
1/4/2015 15 13	71.67999819
1/4/2015 16 44	72.01999818
1/4/2015 17 10	71.64999819
1/4/2015 18 30	71.92999818
1/4/2015 19 42	71.2199982
1/4/2015 20 39	71.64999819
1/4/2015 21 31	72.10999818
1/4/2015 22 45	71.98999818
1/4/2015 23 22	72.40999817
1/5/2015 0 04	68.37999827
1/5/2015 1 08	71.40999819
1/5/2015 2 07	72.62999816
1/5/2015 3 28	72.13999818
1/5/2015 4 52	71.49999819
1/5/2015 5 37	71.0399982
1/5/2015 6 59	71.0699982
1/5/2015 7 41	71.49999819
1/5/2015 8 54	71.0399982
1/5/2015 9 59	70.79999821
1/5/2015 10 19	70.45999822
1/5/2015 11 00	70.69999821
1/5/2015 12 49	71.0699982

1/1/2015 14 20	73.47000206
1/1/2015 15 49	73.32000205
1/1/2015 16 24	73.56000206
1/1/2015 17 11	73.90000207
1/1/2015 18 25	73.56000206
1/1/2015 19 14	73.68000206
1/1/2015 20 32	74.08000207
1/1/2015 21 00	74.08000207
1/1/2015 22 00	74.39000208
1/1/2015 23 06	71.610002
1/2/2015 0 33	74.23000208
1/2/2015 1 45	74.9300021
1/2/2015 2 34	74.8700021
1/2/2015 3 12	74.8700021
1/2/2015 4 41	74.8700021
1/2/2015 5 08	74.9700021
1/2/2015 6 04	74.57000209
1/2/2015 7 19	74.32000208
1/2/2015 8 52	73.96000207
1/2/2015 9 26	73.47000206
1/2/2015 10 15	72.52000203
1/2/2015 11 39	73.13000205
1/2/2015 12 14	72.98000204
1/2/2015 13 38	73.29000205
1/2/2015 14 18	73.56000206
1/2/2015 15 27	73.38000205
1/2/2015 16 00	73.74000206
1/2/2015 17 14	73.74000206
1/2/2015 18 28	73.74000206
1/2/2015 19 45	73.77000206
1/2/2015 20 38	74.11000207
1/2/2015 21 22	74.11000207
1/2/2015 22 09	74.08000207
1/2/2015 23 33	74.26000208
1/3/2015 0 55	74.17000208
1/3/2015 1 00	74.78000209
1/3/2015 2 48	74.72000209
1/3/2015 3 22	75.1500021
1/3/2015 4 14	75.0600021
1/3/2015 5 12	75.0000021
1/3/2015 6 03	74.72000209
1/3/2015 7 31	67.85000189
1/3/2015 8 13	73.93000207
1/3/2015 9 08	73.62000206
1/3/2015 10 24	73.41000205
1/3/2015 11 20	73.07000204
1/3/2015 12 16	73.29000205
1/3/2015 13 08	73.41000205
1/3/2015 14 42	73.41000205
1/3/2015 15 12	73.62000206
1/3/2015 16 08	73.71000206
1/3/2015 17 22	73.65000206
1/3/2015 18 38	73.23000205
1/3/2015 19 34	73.81000207
1/3/2015 20 47	73.81000207
1/3/2015 21 44	74.20000208
1/3/2015 22 29	74.23000208
1/3/2015 23 10	74.29000208
1/4/2015 0 29	74.63000209
1/4/2015 1 07	74.29000208
1/4/2015 2 38	75.1200021
1/4/2015 3 35	74.66000209
1/4/2015 4 31	75.0900021
1/4/2015 5 32	74.9700021
1/4/2015 6 02	74.81000209
1/4/2015 7 45	74.54000209
1/4/2015 8 45	73.71000206
1/4/2015 9 49	73.62000206
1/4/2015 10 32	73.35000205
1/4/2015 11 43	72.80000204
1/4/2015 12 48	73.07000204
1/4/2015 13 32	73.04000204
1/4/2015 14 04	73.26000205
1/4/2015 15 25	73.87000207
1/4/2015 16 53	73.81000207
1/4/2015 17 27	73.47000206
1/4/2015 18 52	73.32000205
1/4/2015 19 46	73.41000205
1/4/2015 20 29	73.35000205
1/4/2015 21 06	73.84000207
1/4/2015 22 45	73.62000206
1/4/2015 23 26	74.54000209
1/5/2015 0 11	74.63000209
1/5/2015 1 07	74.69000209
1/5/2015 2 05	74.9700021
1/5/2015 3 58	74.57000209
1/5/2015 4 00	74.57000209
1/5/2015 5 23	74.54000209
1/5/2015 6 11	73.68000206
1/5/2015 7 50	72.89000204
1/5/2015 8 05	73.59000206
1/5/2015 9 13	73.53000206
1/5/2015 10 41	73.62000206
1/5/2015 11 03	73.65000206
1/5/2015 12 41	73.90000207

1/1/2015 14 01	68.09999915
1/1/2015 15 27	68.70999914
1/1/2015 16 00	68.91999914
1/1/2015 17 33	69.37999913
1/1/2015 18 16	69.13999913
1/1/2015 19 07	69.28999913
1/1/2015 20 00	69.43999913
1/1/2015 21 18	70.38999912
1/1/2015 22 01	70.74999911
1/1/2015 23 06	69.86999912
1/2/2015 0 32	70.83999911
1/2/2015 1 18	72.42999909
1/2/2015 2 35	72.39999909
1/2/2015 3 31	72.88999909
1/2/2015 4 22	72.39999909
1/2/2015 5 58	72.0999991
1/2/2015 6 37	71.29999911
1/2/2015 7 43	70.50999912
1/2/2015 8 51	68.79999914
1/2/2015 9 53	68.24999914
1/2/2015 10 19	67.81999915
1/2/2015 11 39	67.57999915
1/2/2015 12 30	68.21999914
1/2/2015 13 10	68.76999914
1/2/2015 14 02	69.13999913
1/2/2015 15 12	69.37999913
1/2/2015 16 41	69.19999913
1/2/2015 17 22	68.64999914
1/2/2015 18 48	69.19999913
1/2/2015 19 03	69.52999913
1/2/2015 20 23	70.13999912
1/2/2015 21 16	69.98999912
1/2/2015 22 19	70.53999912
1/2/2015 23 30	69.49999913
1/3/2015 0 56	71.17999911
1/3/2015 1 01	71.9999991
1/3/2015 2 03	72.51999909
1/3/2015 3 02	72.67999909
1/3/2015 4 32	72.79999909
1/3/2015 5 55	72.2199991
1/3/2015 6 48	71.8499991
1/3/2015 7 30	54.05999931 A
1/3/2015 8 50	69.95999912
1/3/2015 9 54	67.72999915
1/3/2015 10 45	67.05999916
1/3/2015 11 23	66.87999916
1/3/2015 12 42	67.20999916
1/3/2015 13 13	67.39999915
1/3/2015 14 08	68.09999915
1/3/2015 15 35	68.48999914
1/3/2015 16 05	68.51999914
1/3/2015 17 05	68.76999914
1/3/2015 18 26	68.36999914
1/3/2015 19 07	68.97999913
1/3/2015 20 48	69.49999913
1/3/2015 21 12	70.22999912
1/3/2015 22 08	70.41999912
1/3/2015 23 02	69.86999912
1/4/2015 0 30	70.47999912
1/4/2015 1 11	72.2799991
1/4/2015 2 10	72.2499991
1/4/2015 3 20	72.85999909
1/4/2015 4 06	72.94999909
1/4/2015 5 51	72.64999909
1/4/2015 6 32	72.2499991
1/4/2015 7 58	71.4599991
1/4/2015 8 56	69.16999913
1/4/2015 9 50	67.08999916
1/4/2015 10 49	66.38999917
1/4/2015 11 04	66.35999917
1/4/2015 12 28	65.92999917
1/4/2015 13 00	66.77999916
1/4/2015 14 09	67.97999915
1/4/2015 15 06	68.36999914
1/4/2015 16 18	68.45999914
1/4/2015 17 30	67.42999915
1/4/2015 18 31	67.29999915
1/4/2015 19 43	66.90999916
1/4/2015 20 35	67.97999915
1/4/2015 21 06	69.34999913
1/4/2015 22 34	69.28999913
1/4/2015 23 23	71.6399991
1/5/2015 0 06	70.32999912
1/5/2015 1 35	72.39999909
1/5/2015 2 08	72.54999909
1/5/2015 3 25	72.70999909
1/5/2015 4 53	72.0699991
1/5/2015 5 58	70.96999911
1/5/2015 6 49	67.87999915
1/5/2015 7 06	67.23999916
1/5/2015 8 11	69.49999913
1/5/2015 9 56	69.37999913
1/5/2015 10 19	69.34999913
1/5/2015 11 04	69.43999913
1/5/2015 12 40	68.39999914

1/1/2015 14 00	72.45000271
1/1/2015 15 06	72.70000272
1/1/2015 16 02	72.76000272
1/1/2015 17 01	73.09000274
1/1/2015 18 38	72.91000273
1/1/2015 19 08	73.28000274
1/1/2015 20 39	73.49000275
1/1/2015 21 00	74.01000277
1/1/2015 22 01	73.95000277
1/1/2015 23 07	74.10000277
1/2/2015 0 33	74.47000279
1/2/2015 1 22	75.47000282
1/2/2015 2 34	75.20000281
1/2/2015 3 19	75.69000283
1/2/2015 4 46	75.66000283
1/2/2015 5 30	75.14000281
1/2/2015 6 16	74.44000279
1/2/2015 7 42	73.98000277
1/2/2015 8 15	72.85000273
1/2/2015 9 42	72.36000271
1/2/2015 10 19	71.90000269
1/2/2015 11 11	72.36000271
1/2/2015 12 14	72.42000271
1/2/2015 13 48	72.42000271
1/2/2015 14 10	73.12000274
1/2/2015 15 22	73.46000275
1/2/2015 16 48	73.34000274
1/2/2015 17 21	72.64000272
1/2/2015 18 17	72.88000273
1/2/2015 19 00	73.19000274
1/2/2015 20 09	73.70000276
1/2/2015 21 38	73.83000276
1/2/2015 22 22	74.01000277
1/2/2015 23 31	73.64000276
1/3/2015 0 54	74.56000279
1/3/2015 1 00	74.8600028
1/3/2015 2 15	75.32000282
1/3/2015 3 05	75.51000283
1/3/2015 4 02	75.60000283
1/3/2015 5 55	75.17000281
1/3/2015 6 08	74.65000279
1/3/2015 7 30	57.59000216 A
1/3/2015 8 22	73.28000274
1/3/2015 9 54	71.11000266
1/3/2015 10 59	71.38000267
1/3/2015 11 31	71.23000267
1/3/2015 12 21	71.72000269
1/3/2015 13 05	71.90000269
1/3/2015 14 17	72.48000271
1/3/2015 15 00	72.67000272
1/3/2015 16 58	72.73000272
1/3/2015 17 04	72.0000027
1/3/2015 18 52	72.88000273
1/3/2015 19 09	73.19000274
1/3/2015 20 52	73.31000274
1/3/2015 21 00	73.67000276
1/3/2015 22 58	74.13000277
1/3/2015 23 02	72.88000273
1/4/2015 0 01	74.8600028
1/4/2015 1 11	75.20000281
1/4/2015 2 10	75.54000283
1/4/2015 3 07	75.72000283
1/4/2015 4 42	75.90000284
1/4/2015 5 31	75.63000283
1/4/2015 6 01	75.47000282
1/4/2015 7 46	74.50000279
1/4/2015 8 50	73.16000274
1/4/2015 9 57	71.87000269
1/4/2015 10 48	71.29000267
1/4/2015 11 44	70.96000266
1/4/2015 12 28	70.77000265
1/4/2015 13 23	71.81000269
1/4/2015 14 21	72.0900027
1/4/2015 15 06	72.39000271
1/4/2015 16 15	72.58000272
1/4/2015 17 30	72.30000271
1/4/2015 18 31	70.96000266
1/4/2015 19 43	71.45000268
1/4/2015 20 00	72.54000272
1/4/2015 21 06	72.85000273
1/4/2015 22 06	73.61000275
1/4/2015 23 10	74.9300028
1/5/2015 0 05	73.67000276
1/5/2015 1 07	75.32000282
1/5/2015 2 03	75.54000283
1/5/2015 3 29	75.32000282
1/5/2015 4 53	74.99000281
1/5/2015 5 53	74.13000277
1/5/2015 6 52	72.1500027
1/5/2015 7 09	71.69000268
1/5/2015 8 00	73.49000275
1/5/2015 9 59	72.91000273
1/5/2015 10 00	72.91000273
1/5/2015 11 01	73.67000276
1/5/2015 12 40	71.81000269

1/1/2015 13 09	72.77
1/1/2015 14 00	73.01
1/1/2015 15 00	73.53
1/1/2015 16 20	73.74
1/1/2015 17 35	73.71
1/1/2015 18 43	73.74
1/1/2015 19 56	73.84
1/1/2015 20 31	74.11
1/1/2015 21 23	74.29
1/1/2015 22 01	74.54
1/1/2015 23 42	75.21
1/2/2015 0 41	75.39
1/2/2015 1 56	75.73
1/2/2015 2 35	75.7
1/2/2015 3 00	76.15
1/2/2015 4 49	75.7
1/2/2015 5 50	75.03
1/2/2015 6 37	74.69
1/2/2015 7 54	74.54
1/2/2015 8 49	73.87
1/2/2015 9 53	73.19
1/2/2015 10 21	73.01
1/2/2015 11 02	73.07
1/2/2015 12 13	72.68
1/2/2015 13 22	73.32
1/2/2015 14 18	72.95
1/2/2015 15 34	73.1
1/2/2015 16 24	73.44
1/2/2015 17 31	72.8
1/2/2015 18 42	73.01
1/2/2015 19 03	73.53
1/2/2015 20 42	73.71
1/2/2015 21 35	74.11
1/2/2015 22 20	73.8
1/2/2015 23 34	74.75
1/3/2015 0 28	74.63
1/3/2015 1 41	75.09
1/3/2015 2 03	75.27
1/3/2015 3 03	76.06
1/3/2015 4 09	75.61
1/3/2015 5 46	75.54
1/3/2015 6 07	74.84
1/3/2015 7 30	52.13 A
1/3/2015 8 02	74.05
1/3/2015 9 49	72.77
1/3/2015 10 24	72.77
1/3/2015 11 51	72.74
1/3/2015 12 03	71.91
1/3/2015 13 05	72.4
1/3/2015 14 27	73.26
1/3/2015 15 16	72.83
1/3/2015 16 14	73.1
1/3/2015 17 05	73.26
1/3/2015 18 39	73.62
1/3/2015 19 12	73.84
1/3/2015 20 00	73.9
1/3/2015 21 12	74.6
1/3/2015 22 26	74.26
1/3/2015 23 01	74.02
1/4/2015 0 03	74.78
1/4/2015 1 47	75.45
1/4/2015 2 33	75.82
1/4/2015 3 00	75.91
1/4/2015 4 30	76.06
1/4/2015 5 28	75.82
1/4/2015 6 59	75.15
1/4/2015 7 57	74.69
1/4/2015 8 11	74.05
1/4/2015 9 17	72.71
1/4/2015 10 53	71.91
1/4/2015 11 40	71.79
1/4/2015 12 31	71.97
1/4/2015 13 13	72.49
1/4/2015 14 36	72.55
1/4/2015 15 43	73.16
1/4/2015 16 24	72.34
1/4/2015 17 13	72.83
1/4/2015 18 31	72.74
1/4/2015 19 42	72.52
1/4/2015 20 01	73.04
1/4/2015 21 27	73.99
1/4/2015 22 34	73.44
1/4/2015 23 21	74.75
1/5/2015 0 06	75.39
1/5/2015 1 13	75
1/5/2015 2 08	75.79
1/5/2015 3 36	75.91
1/5/2015 4 53	74.78
1/5/2015 5 53	73.99
1/5/2015 6 47	73.07
1/5/2015 7 04	72.61
1/5/2015 8 02	73.53
1/5/2015 9 26	73.68
1/5/2015 10 47	73.22
1/5/2015 11 17	73.8

1/5/2015 13 31	70.84000244	1/5/2015 13 14	68.18000063	1/5/2015 12 19	71.55999775	1/5/2015 12 15	69.87	1/5/2015 12 48	67.09000246	1/5/2015 13 00	76.54000144	1/5/2015 13 17	70.76999821	1/5/2015 13 18	73.71000206	1/5/2015 13 07	69.43999913	1/5/2015 13 11	73.61000275	1/5/2015 12 40	72.34
1/5/2015 14 37	70.54000243	1/5/2015 14 22	68.15000063	1/5/2015 13 23	72.04999774	1/5/2015 13 23	70.23	1/5/2015 13 36	66.82000245	1/5/2015 14 00	76.54000144	1/5/2015 14 22	70.27999822	1/5/2015 14 17	73.47000206	1/5/2015 14 15	69.64999913	1/5/2015 14 01	73.43000275	1/5/2015 13 31	73.26
1/5/2015 15 00	71.12000245	1/5/2015 15 55	68.18000063	1/5/2015 14 04	72.10999773	1/5/2015 14 37	70.2	1/5/2015 14 41	67.06000246	1/5/2015 15 00	76.54000144	1/5/2015 15 54	71.1899982	1/5/2015 15 30	73.62000206	1/5/2015 15 00	69.34999913	1/5/2015 15 00	72.85000273	1/5/2015 14 01	73.68
1/5/2015 16 59	70.60000243	1/5/2015 16 10	67.50000063	1/5/2015 15 53	71.79999774	1/5/2015 15 57	69.65	1/5/2015 15 00	67.12000246	1/5/2015 16 00	76.54000144	1/5/2015 16 23	70.91999821	1/5/2015 16 05	73.50000206	1/5/2015 16 19	69.52999913	1/5/2015 16 01	73.52000275	1/5/2015 15 53	73.19
1/5/2015 17 03	70.57000243	1/5/2015 17 30	66.34000062	1/5/2015 16 26	71.89999774	1/5/2015 16 00	69.65	1/5/2015 16 59	66.94000245	1/5/2015 17 00	76.54000144	1/5/2015 17 03	70.39999822	1/5/2015 17 40	73.10000205	1/5/2015 17 43	68.73999914	1/5/2015 17 59	72.76000272	1/5/2015 16 30	72.43
1/5/2015 18 51	70.26000242	1/5/2015 18 22	66.28000062	1/5/2015 17 50	71.24999776	1/5/2015 17 53	69.84	1/5/2015 17 03	66.82000245	1/5/2015 18 00	76.54000144	1/5/2015 18 55	71.1599982	1/5/2015 18 05	73.32000205	1/5/2015 18 29	68.42999914	1/5/2015 18 08	72.2100027	1/5/2015 17 33	72.64
1/5/2015 19 52	70.78000244	1/5/2015 19 55	66.86000062	1/5/2015 18 00	71.06999777	1/5/2015 18 24	69.78	1/5/2015 18 59	67.24000246	1/5/2015 19 00	76.54000144	1/5/2015 19 51	70.91999821	1/5/2015 19 23	73.56000206	1/5/2015 19 52	67.20999916	1/5/2015 19 00	72.42000271	1/5/2015 18 22	72.46
1/5/2015 20 07	71.33000246	1/5/2015 20 44	67.14000062	1/5/2015 19 00	71.76999774	1/5/2015 19 52	69.68	1/5/2015 19 00	67.24000246	1/5/2015 20 00	76.54000144	1/5/2015 20 44	70.66999821	1/5/2015 20 18	73.41000205	1/5/2015 20 44	67.08999916	1/5/2015 20 45	71.38000267	1/5/2015 19 46	73.1
1/5/2015 21 13	72.34000249	1/5/2015 21 58	67.41000063	1/5/2015 20 45	71.43999775	1/5/2015 20 44	70.2	1/5/2015 20 44	67.09000246	1/5/2015 21 00	76.54000144	1/5/2015 21 19	71.3499982	1/5/2015 21 20	73.87000207	1/5/2015 21 19	69.03999913	1/5/2015 21 01	73.28000274	1/5/2015 20 22	73.22
1/5/2015 22 04	72.4600025	1/5/2015 22 00	66.86000062	1/5/2015 21 19	71.67999775	1/5/2015 21 23	69.65	1/5/2015 21 23	67.40000247	1/5/2015 22 00	76.54000144	1/5/2015 22 01	71.64999819	1/5/2015 22 01	73.71000206	1/5/2015 22 01	68.36999914	1/5/2015 22 01	72.1800027	1/5/2015 21 46	73.47
1/5/2015 23 51	71.24000246	1/5/2015 23 50	70.13000065	1/5/2015 22 01	71.55999775	1/5/2015 22 00	70.63	1/5/2015 22 00	68.2200025	1/5/2015 23 00	76.54000144	1/5/2015 23 50	68.53999826	1/5/2015 23 50	73.50000206	1/5/2015 23 34	70.87999911	1/5/2015 23 51	74.04000277	1/5/2015 22 02	73.35
1/6/2015 0 00	73.90000254	1/6/2015 0 00	70.56000066	1/5/2015 23 50	73.1499977	1/5/2015 23 51	69.41	1/5/2015 23 51	65.99000242	1/6/2015 0 00	76.54000144	1/6/2015 0 51	71.0999982	1/6/2015 0 52	74.84000209	1/6/2015 0 52	71.8499991	1/6/2015 0 00	75.20000281	1/5/2015 23 51	74.35
1/6/2015 1 37	74.11000255	1/6/2015 1 00	70.77000066	1/6/2015 0 47	73.01999771	1/6/2015 0 56	71.15	1/6/2015 0 06	68.1000025	1/6/2015 1 00	76.54000144	1/6/2015 1 00	71.52999819	1/6/2015 1 21	74.60000209	1/6/2015 1 42	72.42999909	1/6/2015 1 28	75.38000282	1/6/2015 0 56	75.24
1/6/2015 2 00	75.03000258	1/6/2015 2 44	71.17000066	1/6/2015 1 38	73.87999768	1/6/2015 1 11	71.91	1/6/2015 1 37	68.1900025	1/6/2015 2 00	76.54000144	1/6/2015 2 05	72.43999817	1/6/2015 2 05	75.1200021	1/6/2015 2 04	72.85999909	1/6/2015 2 34	75.41000282	1/6/2015 1 45	75.3
1/6/2015 3 30	73.74000254	1/6/2015 3 35	71.63000067	1/6/2015 2 05	73.56999769	1/6/2015 2 32	72.25	1/6/2015 2 00	69.44000255	1/6/2015 3 00	76.54000144	1/6/2015 3 27	72.19999818	1/6/2015 3 14	75.1200021	1/6/2015 3 59	72.39999909	1/6/2015 3 58	75.54000283	1/6/2015 2 13	75.42
1/6/2015 4 25	72.6500025	1/6/2015 4 41	70.77000066	1/6/2015 3 58	73.63999769	1/6/2015 3 58	71.52	1/6/2015 3 59	68.80000252	1/6/2015 4 00	76.54000144	1/6/2015 4 02	71.92999818	1/6/2015 4 23	74.9300021	1/6/2015 4 26	71.8799991	1/6/2015 4 26	74.8900028	1/6/2015 3 27	75.39
1/6/2015 5 44	71.88000248	1/6/2015 5 55	69.06000064	1/6/2015 4 00	73.63999769	1/6/2015 4 03	71	1/6/2015 4 25	68.2200025	1/6/2015 5 00	76.54000144	1/6/2015 5 44	70.51999822	1/6/2015 5 32	74.48000208	1/6/2015 5 51	70.90999911	1/6/2015 5 51	74.07000277	1/6/2015 4 10	75.64
1/6/2015 6 50	71.33000246	1/6/2015 6 23	66.68000062	1/6/2015 5 32	72.80999771	1/6/2015 5 44	70.54	1/6/2015 5 44	66.75000245	1/6/2015 6 00	76.54000144	1/6/2015 6 52	71.1599982	1/6/2015 6 49	73.26000205	1/6/2015 6 49	67.97999915	1/6/2015 6 50	71.75000269	1/6/2015 5 53	74.35
1/6/2015 7 16	70.94000245	1/6/2015 7 06	66.25000061	1/6/2015 6 45	71.31999776	1/6/2015 6 45	69.99	1/6/2015 6 56	67.52000247	1/6/2015 7 00	76.54000144	1/6/2015 7 10	70.91999821	1/6/2015 7 17	72.83000204	1/6/2015 7 03	66.65999916	1/6/2015 7 11	71.20000267	1/6/2015 6 53	72.52
1/6/2015 8 04	69.4700024	1/6/2015 8 03	67.99000063	1/6/2015 7 02	71.18999776	1/6/2015 7 16	69.2	1/6/2015 7 10	67.18000246	1/6/2015 8 00	76.54000144	1/6/2015 8 04	69.69999823	1/6/2015 8 02	73.19000205	1/6/2015 8 02	68.76999914	1/6/2015 8 03	72.88000273	1/6/2015 7 05	72.61
1/6/2015 9 51	70.72000244	1/6/2015 9 13	68.08000063	1/6/2015 8 33	71.61999775	1/6/2015 8 02	70.17	1/6/2015 8 04	64.65000237	1/6/2015 9 00	76.54000144	1/6/2015 9 54	70.73999821	1/6/2015 9 10	72.95000204	1/6/2015 9 14	69.31999913	1/6/2015 9 04	73.40000275	1/6/2015 8 02	73.04
1/6/2015 10 11	70.78000244	1/6/2015 10 47	68.33000063	1/6/2015 9 16	71.67999775	1/6/2015 9 18	69.62	1/6/2015 9 51	66.85000245	1/6/2015 10 00	76.54000144	1/6/2015 10 58	70.82999821	1/6/2015 10 12	73.32000205	1/6/2015 10 08	69.64999913	1/6/2015 10 08	73.00000273	1/6/2015 9 22	73.87
1/6/2015 11 40	70.81000244	1/6/2015 11 03	67.38000063	1/6/2015 10 10	71.58999775	1/6/2015 10 32	69.04	1/6/2015 10 11	67.18000246	1/6/2015 11 00	76.54000144	1/6/2015 11 05	70.45999822	1/6/2015 11 01	73.23000205	1/6/2015 11 30	68.33999914	1/6/2015 11 30	72.1200027	1/6/2015 10 57	73.29
1/6/2015 12 27	70.57000243	1/6/2015 12 09	68.51000064	1/6/2015 11 08	70.42999779	1/6/2015 11 05	67.94	1/6/2015 11 05	66.66000244	1/6/2015 12 00	76.54000144	1/6/2015 12 47	70.9799982	1/6/2015 12 51	73.26000205	1/6/2015 12 31	69.67999913	1/6/2015 12 28	73.55000275	1/6/2015 11 14	73.07
1/6/2015 13 33	69.99000241	1/6/2015 13 17	66.83000062	1/6/2015 12 10	71.73999775	1/6/2015 12 02	68.52	1/6/2015 12 27	66.54000244	1/6/2015 13 00	76.54000144	1/6/2015 13 17	70.9499982	1/6/2015 13 47	73.47000206	1/6/2015 13 33	70.16999912	1/6/2015 13 17	73.31000274	1/6/2015 12 54	73.74
1/6/2015 14 00	71.09000245	1/6/2015 14 58	68.97000064	1/6/2015 13 25	71.52999775	1/6/2015 13 00	68.8	1/6/2015 13 58	66.66000244	1/6/2015 14 00	76.54000144	1/6/2015 14 09	70.45999822	1/6/2015 14 09	72.40000203	1/6/2015 14 02	70.29999912	1/6/2015 14 03	73.86000276	1/6/2015 13 44	72.89
1/6/2015 15 00	71.79000247	1/6/2015 15 39	68.30000063	1/6/2015 14 08	70.94999777	1/6/2015 14 06	68.65	1/6/2015 14 00	66.66000244	1/6/2015 15 00	76.54000144	1/6/2015 15 01	71.0999982	1/6/2015 15 05	73.10000205	1/6/2015 15 55	70.29999912	1/6/2015 15 52	73.98000277	1/6/2015 14 23	73.96
1/6/2015 16 20	71.70000247	1/6/2015 16 59	67.35000063	1/6/2015 15 59	71.28999776	1/6/2015 15 59	69.56	1/6/2015 15 10	67.30000247	1/6/2015 16 00	76.54000144	1/6/2015 16 00	70.69999821	1/6/2015 16 36	73.59000206	1/6/2015 16 46	69.64999913	1/6/2015 16 36	73.49000275	1/6/2015 15 19	73.93
1/6/2015 17 30	70.91000245	1/6/2015 17 55	67.08000062	1/6/2015 16 00	71.28999776	1/6/2015 16 30	69.53	1/6/2015 16 30	67.79000248	1/6/2015 17 00	76.54000144	1/6/2015 17 24	71.1299982	1/6/2015 17 41	73.41000205	1/6/2015 17 55	68.58999914	1/6/2015 17 31	72.82000273	1/6/2015 16 35	73.5
1/6/2015 18 54	70.63000244	1/6/2015 18 27	66.28000062	1/6/2015 17 04	71.43999775	1/6/2015 17 34	68.58	1/6/2015 17 16	67.52000247	1/6/2015 18 00	76.54000144	1/6/2015 18 26	70.45999822	1/6/2015 18 51	72.95000204	1/6/2015 18 31	68.12999914	1/6/2015 18 26	72.42000271	1/6/2015 17 42	72.68
1/6/2015 19 07	69.4400024	1/6/2015 19 40	66.34000062	1/6/2015 18 47	71.28999776	1/6/2015 18 54	68	1/6/2015 18 54	67.09000246	1/6/2015 19 00	76.54000144	1/6/2015 19 07	71.1599982	1/6/2015 19 07	72.74000203	1/6/2015 19 30	68.39999914	1/6/2015 19 07	72.30000271	1/6/2015 18 57	72.64
1/6/2015 20 33	71.03000245	1/6/2015 20 30	66.99000062	1/6/2015 19 52	71.31999776	1/6/2015 19 19	68.31	1/6/2015 19 07	66.60000244	1/6/2015 20 00	76.54000144	1/6/2015 20 06	71.2799982	1/6/2015 20 05	73.29000205	1/6/2015 20 10	68.58999914	1/6/2015 20 21	72.61000272	1/6/2015 19 43	72.49
1/6/2015 21 14	71.76000247	1/6/2015 21 16	67.96000063	1/6/2015 20 18	71.37999776	1/6/2015 20 29	69.07	1/6/2015 20 02	67.70000248	1/6/2015 21 00	76.54000144	1/6/2015 21 02	71.52999819	1/6/2015 21 08	73.93000207	1/6/2015 21 15	69.34999913	1/6/2015 21 03	73.00000273	1/6/2015 20 30	72.86
1/6/2015 22 14	72.5500025	1/6/2015 22 03	68.57000064	1/6/2015 21 04	72.31999773	1/6/2015 21 02	68.86	1/6/2015 21 14	67.09000246	1/6/2015 22 00	76.54000144	1/6/2015 22 01	71.73999819	1/6/2015 22 15	73.65000206	1/6/2015 22 02	69.43999913	1/6/2015 22 06	73.70000276	1/6/2015 21 23	73.41
1/6/2015 23 03	73.71000254	1/6/2015 23 19	70.74000066	1/6/2015 22 02	72.25999773	1/6/2015 22 02	69.26	1/6/2015 22 02	67.82000249	1/6/2015 23 00	76.54000144	1/6/2015 23 10	71.3499982	1/6/2015 23 02	74.35000208	1/6/2015 23 13	71.14999911	1/6/2015 23 13	74.65000279	1/6/2015 22 01	73.32
1/7/2015 0 32	72.77000251	1/7/2015 0 34	70.71000066	1/6/2015 23 02	72.95999771	1/6/2015 23 07	70.39	1/6/2015 23 00	69.11000253	1/7/2015 0 00	76.54000144	1/7/2015 0 33	69.11999825	1/7/2015 0 33	74.14000207	1/7/2015 0 33	72.0399991	1/7/2015 0 33	75.08000281	1/6/2015 23 04	74.93
1/7/2015 1 50	74.02000255	1/7/2015 1 50	69.82000065	1/7/2015 0 32	73.2399977	1/7/2015 0 34	69.26	1/7/2015 0 32	67.15000246	1/7/2015 1 00	76.54000144	1/7/2015 1 07	71.95999818	1/7/2015 1 51	74.9000021	1/7/2015 1 50	69.16999913	1/7/2015 1 55	75.17000281	1/7/2015 0 32	75.24
1/7/2015 2 17	72.4300025	1/7/2015 2 18	71.20000066	1/7/2015 1 24	73.66999769	1/7/2015 1 54	70.81	1/7/2015 1 01	68.46000251	1/7/2015 2 00	76.54000144	1/7/2015 2 17	71.82999818	1/7/2015 2 00	75.0300021	1/7/2015 2 00	72.42999909	1/7/2015 2 13	75.51000283	1/7/2015 1 50	72.77
1/7/2015 3 33	74.14000255	1/7/2015 3 26	71.35000066	1/7/2015 2 27	73.87999768	1/7/2015 2 00	71.09	1/7/2015 2 17	67.91000249	1/7/2015 3 00	76.54000144	1/7/2015 3 34	71.1599982	1/7/2015 3 34	74.26000208	1/7/2015 3 34	72.33999909	1/7/2015 3 34	75.02000281	1/7/2015 2 18	75.73
1/7/2015 4 59	73.80000254	1/7/2015 4 59	71.08000066	1/7/2015 3 34	73.72999768	1/7/2015 3 35	70.87	1/7/2015 3 33	68.59000251	1/7/2015 4 00	76.54000144	1/7/2015 4 59	71.2199982	1/7/2015 4 00	74.8700021	1/7/2015 4 51	72.42999909	1/7/2015 4 42	75.44000282	1/7/2015 3 38	75.45
1/7/2015 5 35	72.4600025	1/7/2015 5 49	69.27000064	1/7/2015 4 19	73.90999768	1/7/2015 4 59	70.72	1/7/2015 4 55	68.86000252	1/7/2015 5 00	76.54000144	1/7/2015 5 03	70.39999822	1/7/2015 5 54	74.60000209	1/7/2015 5 49	70.96999911	1/7/2015 5 55	74.01000277	1/7/2015 4 58	75.45
1/7/2015 6 36	72.25000249	1/7/2015 6 56	66.89000062	1/7/2015 5 08	73.2399977	1/7/2015 5 03	69.1	1/7/2015 5 35	66.91000245	1/7/2015 6 00	76.54000144	1/7/2015 6 56	71.0699982	1/7/2015 6 41	73.50000206	1/7/2015 6 56	67.08999916	1/7/2015 6 49	72.2400027	1/7/2015 5 45	74.72
1/7/2015 7 30	71.55000247	1/7/2015 7 04	66.50000062	1/7/2015 6 55	70.63999778	1/7/2015 6 48	67.97	1/7/2015 6 41	67.43000247	1/7/2015 7 00	76.54000144	1/7/2015 7 23	71.0999982	1/7/2015 7 44	73.29000205	1/7/2015 7 17	66.77999916	1/7/2015 7 20	71.14000266	1/7/2015 6 48	73.35
1/7/2015 8 34	68.95000238	1/7/2015 8 40	67.17000062	1/7/2015 7 17	71.28999776	1/7/2015 7 40	67.42	1/7/2015 7 24	67.64000248	1/7/2015 8 00	76.54000144	1/7/2015 8 33	68.92999825	1/7/2015 8 44	73.23000205	1/7/2015 8 40	68.00999915	1/7/2015 8 41	72.94000273	1/7/2015 7 04	72.83
1/7/2015 9 23	70.60000243	1/7/2015 9 15	68.57000064	1/7/2015 8 44	71.61999775	1/7/2015 8 33	67.55	1/7/2015 8 34	64.43000236	1/7/2015 9 00	76.54000144	1/7/2015 9 52	70.9499982	1/7/2015 9 07	73.35000205	1/7/2015 9 27	69.49999913	1/7/2015 9 31	73.25000274	1/7/2015 8 40	71.73
1/7/2015 10 12	71.79000247	1/7/2015 10 40	68.05000063	1/7/2015 9 14	71.12999776	1/7/2015 9 27	68.83	1/7/2015 9 27	66.60000244	1/7/2015 10 00	76.54000144	1/7/2015 10 19	70.33999822	1/7/2015 10 52	72.89000204	1/7/2015 10 45	69.52999913	1/7/2015 10 46	73.34000274	1/7/2015 9 24	73.93
1/7/2015 11 24	71.58000247	1/7/2015 11 05	67.47000063	1/7/2015 10 56	70.91999777	1/7/2015 10 12	68.8	1/7/2015 10 23	67.61000248	1/7/2015 11 00	76.54000144	1/7/2015 11 45	70.69999821	1/7/2015 11 48	73.01000204	1/7/2015 11 12	69.71999913	1/7/2015 11 05	73.49000275	1/7/2015 10 12	72.68
1/7/2015 12 45	69.78000241	1/7/2015 12 34	68.30000063	1/7/2015 11 08	72.07999773	1/7/2015 11 45	68.62	1/7/2015 11 59	66.79000245	1/7/2015 12 00	76.54000144	1/7/2015 12 48	70.76999821	1/7/2015 12 45	73.23000205	1/7/2015 12 07	69.89999912	1/7/2015 12 32	73.67000276	1/7/2015 11 28	73.47
1/7/2015 13 06	70.33000243	1/7/2015 13 41	68.79000064	1/7/2015 12 19	71.31999776	1/7/2015 12 49	68.37	1/7/2015 12 00	66.79000245	1/7/2015 13 00	76.54000144	1/7/2015 13 27	70.82999821	1/7/2015 13 39	73.04000204	1/7/2015 13 45	70.04999912	1/7/2015 13 48	73.61000275	1/7/2015 12 41	73.5
1/7/2015 14 11	72.4600025	1/7/2015 14 13	68.94000064	1/7/2015 13 48	71.52999775	1/7/2015 13 03	69.2	1/7/2015 13 07	66.17000243	1/7/2015 14 00	76.54000144	1/7/2015 14 08	70.9799982	1/7/2015 14 05	73.35000205	1/7/2015 14 50	70.44999912	1/7/2015 14 16	74.10000277	1/7/2015 13 01	73.68
1/7/2015 15 58	72.40000249	1/7/2015 15 51	68.39000064	1/7/2015 14 05	71.61999775	1/7/2015 14 58	69.16	1/7/2015 14 48	67.98000249	1/7/2015 15 00	76.54000144	1/7/2015 15 58	71.2199982	1/7/2015 15 54	73.56000206	1/7/2015 15 55	70.19999912	1/7/2015 15 48	73.73000276	1/7/2015 14 50	73.87
1/7/2015 16 52	71.24000246	1/7/2015 16 53	67.60000063	1/7/2015 15 58	71.00999777	1/7/2015 15 58	69.13	1/7/2015 15 48	67.55000248	1/7/2015 16 00	76.54000144	1/7/2015 16 40	71.1899982	1/7/2015 16 48	73.35000205	1/7/2015 16 55	69.03999913	1/7/2015 16 52	73.49000275	1/7/2015 15 05	74.02
1/7/2015 17 47	71.64000247	1/7/2015 17 51	66.71000062	1/7/2015 16 00	71.00999777	1/7/2015 16 00	68.31	1/7/2015 16 25	67.21000246	1/7/2015 17 00	76.54000144	1/7/2015 17 11	70.88999821	1/7/2015 17 40	73.71000206	1/7/2015 17 57	68.64999914	1/7/2015 17 53	72.76000272	1/7/2015 16 49	73.5
1/7/2015 18 49	71.36000246	1/7/2015 18 26	66.95000062	1/7/2015 17 37	71.34999776	1/7/2015 17 25	68.28	1/7/2015 17 18	67.33000247	1/7/2015 18 00	76.54000144	1/7/2015 18 10	71.1299982	1/7/2015 18 10	73.10000205	1/7/2015 18 10	68.24999914	1/7/2015 18 38	72.45000271	1/7/2015 17 19	72.95
1/7/2015 19 14	71.73000247	1/7/2015 19 41	66.99000062	1/7/2015 18 35	71.79999774	1/7/2015 18 57	68.34	1/7/2015 18 53	67.64000248	1/7/2015 19 00	76.54000144	1/7/2015 19 25	71.0999982	1/7/2015 19 29	73.35000205	1/7/2015 19 05	68.73999914	1/7/2015 19 05	72.1800027	1/7/2015 18 18	72.68
1/7/2015 20 15	70.87000244	1/7/2015 20 28	67.47000063	1/7/2015 19 08	71.70999775	1/7/2015 19 32	68.77	1/7/2015 19 49	67.43000247	1/7/2015 20 00	76.54000144	1/7/2015 20 43	71.3199982	1/7/2015 20 36	73.87000207	1/7/2015 20 28	68.76999914	1/7/2015 20 12	73.06000273	1/7/2015 19 00	72.74
1/7/2015 21 36	71.58000247	1/7/2015 21 03	67.32000062	1/7/2015 20 06	72.04999774	1/7/2015 20 09	69.16	1/7/2015 20 01	67.55000248	1/7/2015 21 00	76.54000144	1/7/2015 21 36	71.1599982	1/7/2015 21 33	73.50000206	1/7/2015 21 01	68.94999913	1/7/2015 21 02	72.97000273	1/7/2015 20 29	72.86
1/7/2015 22 35	70.45000243	1/7/2015 22 01	68.42000064	1/7/2015 21 05	71.64999775	1/7/2015 21 11	69.56	1/7/2015 21 40	67.21000246	1/7/2015 22 00	76.54000144	1/7/2015 22 35	69.81999823	1/7/2015 22 39	73.29000205	1/7/2015 22 02	69.64999913	1/7/2015 22 35	73.19000274	1/7/2015 21 04	73.16
1/7/2015 23 00	71.97000248	1/7/2015 23 08	70.01000065	1/7/2015 22 06	71.28999776	1/7/2015 22 35	67.18	1/7/2015 22 36	65.78000241	1/7/2015 23 00	76.54000144	1/7/2015 23 59	67.95999828	1/7/2015 23 00	74.14000207	1/7/2015 23 59	70.87999911	1/7/2015 23 00	73.95000277	1/7/2015 22 02	73.65
1/8/2015 0 00	72.25000249	1/8/2015 0 00	70.10000065	1/7/2015 23 00	72.71999771	1/7/2015 23 08	70.48	1/7/2015 23 00	67.82000249	1/8/2015 0 00	76.54000144	1/8/2015 0 00	68.41999827	1/8/2015 0 00	74.26000208	1/8/2015 0 00	70.87999911	1/8/2015 0 00	74.35000278	1/7/2015 23 08	74.72
1/8/2015 1 14	72.83000251	1/8/2015 1 29	69.70000065	1/8/2015 0 15	73.53999769	1/8/2015 0 00	66.51	1/8/2015 0 00	65.72000241	1/8/2015 1 00	76.54000144	1/8/2015 1 14	71.1599982	1/8/2015 1 14	74.69000209	1/8/2015 1 29	72.2199991	1/8/2015 1 59	75.17000281	1/8/2015 0 05	75.24
1/8/2015 2 38	73.38000253	1/8/2015 2 43	71.87000067	1/8/2015 1 14	73.2399977	1/8/2015 1 14	70.05	1/8/2015 1 14	67.30000247	1/8/2015 2 00	76.54000144	1/8/2015 2 00	71.0099982	1/8/2015 2 07	75.0600021	1/8/2015 2 00	72.54999909	1/8/2015 2 00	75.17000281	1/8/2015 1 27	75.21
1/8/2015 3 48	73.23000252	1/8/2015 3 39	71.47000066	1/8/2015 2 00	73.47999769	1/8/2015 2 14	71.45	1/8/2015 2 38	68.1000025	1/8/2015 3 00	76.54000144	1/8/2015 3 48	71.70999819	1/8/2015 3 45	75.0300021	1/8/2015 3 21	72.67999909	1/8/2015 3 45	75.35000282	1/8/2015 2 39	75.48
1/8/2015 4 54	74.08000255	1/8/2015 4 57	71.35000066	1/8/2015 3 48	73.1799977	1/8/2015 3 48	70.57	1/8/2015 3 44	68.49000251	1/8/2015 4 00	76.54000144	1/8/2015 4 50	71.55999819	1/8/2015 4 41	75.0300021	1/8/2015 4 10	72.51999909	1/8/2015 4 53	75.08000281	1/8/2015 3 48	75.24
1/8/2015 5 35	72.03000248	1/8/2015 5 49	67.90000063	1/8/2015 4 10	73.66999769	1/8/2015 4 50	70.45	1/8/2015 4 19	68.59000251	1/8/2015 5 00	76.54000144	1/8/2015 5 36	70.15999822	1/8/2015 5 32	74.60000209	1/8/2015 5 58	70.71999911	1/8/2015 5 58	74.07000277	1/8/2015 4 19	75.18
1/8/2015 6 43	72.28000249	1/8/2015 6 47	66.80000062	1/8/2015 5 52	73.35999769	1/8/2015 5 31	69.65	1/8/2015 5 31	66.94000245	1/8/2015 6 00	76.54000144	1/8/2015 6 40	71.0399982	1/8/2015 6 58	73.53000206	1/8/2015 6 50	67.78999915	1/8/2015 6 52	71.84000269	1/8/2015 5 58	74.26
1/8/2015 7 22	70.97000245	1/8/2015 7 41	65.98000061	1/8/2015 6 40	71.67999775	1/8/2015 6 43	68.34	1/8/2015 6 43	67.12000246	1/8/2015 7 00	76.54000144	1/8/2015 7 07	70.73999821	1/8/2015 7 17	72.80000204	1/8/2015 7 19	66.62999916	1/8/2015 7 17	70.87000265	1/8/2015 6 43	72.89
1/8/2015 8 32	71.94000248	1/8/2015 8 20	67.72000063	1/8/2015 7 44	70.73999778	1/8/2015 7 26	66.63	1/8/2015 7 23	66.72000245	1/8/2015 8 00	76.54000144	1/8/2015 8 33	71.0099982	1/8/2015 8 29	73.19000205	1/8/2015 8 45	69.09999913	1/8/2015 8 06	73.28000274	1/8/2015 7 07	72.89
1/8/2015 9 57	71.64000247	1/8/2015 9 53	68.33000063	1/8/2015 8 44	71.55999775	1/8/2015 8 32	67.46	1/8/2015 8 00	67.61000248	1/8/2015 9 00	76.54000144	1/8/2015 9 57	71.0399982	1/8/2015 9 14	73.41000205	1/8/2015 9 56	69.06999913	1/8/2015 9 57	73.03000273	1/8/2015 8 16	73.53
1/8/2015 10 46	71.52000247	1/8/2015 10 21	67.99000063	1/8/2015 9 28	71.92999774	1/8/2015 9 11	68.49	1/8/2015 9 57	67.21000246	1/8/2015 10 00	76.54000144	1/8/2015 10 34	71.0699982	1/8/2015 10 51	73.74000206	1/8/2015 10 12	69.83999912	1/8/2015 10 11	73.34000274	1/8/2015 9 29	72.98
1/8/2015 11 13	70.11000242	1/8/2015 11 14	67.17000062	1/8/2015 10 41	72.10999773	1/8/2015 10 17	69.59	1/8/2015 10 38	67.30000247	1/8/2015 11 00	76.54000144	1/8/2015 11 40	70.54999821	1/8/2015 11 21	72.34000202	1/8/2015 11 21	69.74999913	1/8/2015 11 00	73.49000275	1/8/2015 10 42	73.84
1/8/2015 12 17	69.78000241	1/8/2015 12 46	68.33000063	1/8/2015 11 21	71.76999774	1/8/2015 11 40	69.13	1/8/2015 11 40	66.11000242	1/8/2015 12 00	76.54000144	1/8/2015 12 58	69.87999823	1/8/2015 12 51	72.92000204	1/8/2015 12 58	69.46999913	1/8/2015 12 09	73.61000275	1/8/2015 11 51	72.92
1/8/2015 13 00	70.02000242	1/8/2015 13 15	68.63000064	1/8/2015 12 06	71.73999775	1/8/2015 12 58	66.48	1/8/2015 12 58	66.14000242	1/8/2015 13 00	76.54000144	1/8/2015 13 57	70.91999821	1/8/2015 13 03	73.26000205	1/8/2015 13 07	70.22999912	1/8/2015 13 58	73.55000275	1/8/2015 12 16	73.65
1/8/2015 14 33	69.90000241	1/8/2015 14 49	68.66000064	1/8/2015 13 31	71.46999775	1/8/2015 13 00	66.48	1/8/2015 13 00	66.14000242	1/8/2015 14 00	76.54000144	1/8/2015 14 33	71.2499982	1/8/2015 14 59	73.53000206	1/8/2015 14 04	69.61999913	1/8/2015 14 00	73.55000275	1/8/2015 13 35	73.38
1/8/2015 15 47	71.06000245	1/8/2015 15 38	68.30000063	1/8/2015 14 42	71.58999775	1/8/2015 14 59	69.2	1/8/2015 14 33	67.24000246	1/8/2015 15 00	76.54000144	1/8/2015 15 47	70.9499982	1/8/2015 15 00	73.53000206	1/8/2015 15 00	69.89999912	1/8/2015 15 48	73.95000277	1/8/2015 14 30	74.02
1/8/2015 16 34	69.99000241	1/8/2015 16 58	68.11000063	1/8/2015 15 58	71.55999775	1/8/2015 15 00	69.2	1/8/2015 15 47	67.06000246	1/8/2015 16 00	76.54000144	1/8/2015 16 38	71.1299982	1/8/2015 16 14	73.16000205	1/8/2015 16 14	69.89999912	1/8/2015 16 14	73.37000275	1/8/2015 15 51	73.26
1/8/2015 17 59	71.06000245	1/8/2015 17 48	67.23000062	1/8/2015 16 00	71.55999775	1/8/2015 16 42	68.13	1/8/2015 16 10	67.15000246	1/8/2015 17 00	76.54000144	1/8/2015 17 51	70.91999821	1/8/2015 17 45	73.74000206	1/8/2015 17 52	68.12999914	1/8/2015 17 56	70.50000264	1/8/2015 16 18	73.19
1/8/2015 18 03	69.6500024	1/8/2015 18 13	66.62000062	1/8/2015 17 38	71.92999774	1/8/2015 17 48	68.71	1/8/2015 17 03	67.21000246	1/8/2015 18 00	76.54000144	1/8/2015 18 03	71.0099982	1/8/2015 18 17	73.53000206	1/8/2015 18 58	68.06999915	1/8/2015 18 05	71.66000268	1/8/2015 17 55	73.13
1/8/2015 19 42	70.11000242	1/8/2015 19 02	66.41000062	1/8/2015 18 02	71.03999777	1/8/2015 18 46	68.58	1/8/2015 18 26	67.12000246	1/8/2015 19 00	76.54000144	1/8/2015 19 05	70.9799982	1/8/2015 19 02	73.10000205	1/8/2015 19 03	67.90999915	1/8/2015 19 42	72.33000271	1/8/2015 18 10	72.28
1/8/2015 20 58	70.97000245	1/8/2015 20 54	67.05000062	1/8/2015 19 27	71.06999777	1/8/2015 19 02	69.04	1/8/2015 19 46	67.24000246	1/8/2015 20 00	76.54000144	1/8/2015 20 53	70.76999821	1/8/2015 20 54	73.26000205	1/8/2015 20 54	68.27999914	1/8/2015 20 54	72.1800027	1/8/2015 19 00	72.68
1/8/2015 21 00	70.97000245	1/8/2015 21 05	67.63000063	1/8/2015 20 42	71.64999775	1/8/2015 20 58	68.4	1/8/2015 20 54	67.03000246	1/8/2015 21 00	76.54000144	1/8/2015 21 05	70.9799982	1/8/2015 21 22	73.68000206	1/8/2015 21 05	68.85999914	1/8/2015 21 05	72.82000273	1/8/2015 20 18	73.38
1/8/2015 22 18	71.15000245	1/8/2015 22 10	68.51000064	1/8/2015 21 02	71.55999775	1/8/2015 21 00	68.4	1/8/2015 21 56	67.61000248	1/8/2015 22 00	76.54000144	1/8/2015 22 22	70.88999821	1/8/2015 22 22	73.35000205	1/8/2015 22 00	69.52999913	1/8/2015 22 00	73.49000275	1/8/2015 21 02	73.04
1/8/2015 23 43	73.26000252	1/8/2015 23 00	69.43000065	1/8/2015 22 21	71.61999775	1/8/2015 22 59	69.44	1/8/2015 22 22	67.00000246	1/8/2015 23 00	76.54000144	1/8/2015 23 23	71.98999818	1/8/2015 23 00	74.26000208	1/8/2015 23 01	71.32999911	1/8/2015 23 17	74.50000279	1/8/2015 22 00	73.59
1/9/2015 0 03	73.19000252	1/9/2015 0 04	71.20000066	1/8/2015 23 02	71.76999774	1/8/2015 23 00	69.44	1/8/2015 23 20	68.1900025	1/9/2015 0 00	76.54000144	1/9/2015 0 28	72.62999816	1/9/2015 0 18	75.0000021	1/9/2015 0 28	72.0699991	1/9/2015 0 47	75.35000282	1/8/2015 23 19	74.42
1/9/2015 1 34	72.5500025	1/9/2015 1 34	70.92000066	1/9/2015 0 07	73.41999769	1/9/2015 0 03	71.3	1/9/2015 0 32	69.56000255	1/9/2015 1 00	76.54000144	1/9/2015 1 33	69.87999823	1/9/2015 1 33	73.29000205	1/9/2015 1 34	71.9099991	1/9/2015 1 46	75.35000282	1/9/2015 0 04	75.48
1/9/2015 2 00	74.75000257	1/9/2015 2 32	70.77000066	1/9/2015 1 46	73.2099977	1/9/2015 1 34	68.22	1/9/2015 1 34	66.30000243	1/9/2015 2 00	76.54000144	1/9/2015 2 05	72.62999816	1/9/2015 2 21	74.84000209	1/9/2015 2 11	72.79999909	1/9/2015 2 10	75.41000282	1/9/2015 1 35	75.06
1/9/2015 3 37	74.60000257	1/9/2015 3 45	71.66000067	1/9/2015 2 44	73.35999769	1/9/2015 2 11	71.06	1/9/2015 2 05	69.20000254	1/9/2015 3 00	76.54000144	1/9/2015 3 37	72.77999816	1/9/2015 3 12	74.8700021	1/9/2015 3 46	72.94999909	1/9/2015 3 47	75.75000283	1/9/2015 2 32	75.27
1/9/2015 4 41	74.45000256	1/9/2015 4 54	71.11000066	1/9/2015 3 20	73.81999768	1/9/2015 3 29	71.45	1/9/2015 3 37	68.89000253	1/9/2015 4 00	76.54000144	1/9/2015 4 48	72.62999816	1/9/2015 4 55	74.9300021	1/9/2015 4 56	72.51999909	1/9/2015 4 49	75.44000282	1/9/2015 3 48	76
1/9/2015 5 39	72.22000249	1/9/2015 5 59	68.08000063	1/9/2015 4 40	73.81999768	1/9/2015 4 20	71.3	1/9/2015 4 49	68.95000253	1/9/2015 5 00	76.54000144	1/9/2015 5 45	70.27999822	1/9/2015 5 57	74.51000209	1/9/2015 5 59	70.83999911	1/9/2015 5 54	74.01000277	1/9/2015 4 59	75.61
1/9/2015 6 12	70.23000242	1/9/2015 6 57	65.73000061	1/9/2015 5 52	72.98999771	1/9/2015 5 32	69.71	1/9/2015 5 39	66.88000245	1/9/2015 6 00	76.54000144	1/9/2015 6 57	70.57999821	1/9/2015 6 51	73.59000206	1/9/2015 6 57	66.35999917	1/9/2015 6 58	71.66000268	1/9/2015 5 59	73.53
1/9/2015 7 46	70.66000244	1/9/2015 7 01	66.47000062	1/9/2015 6 58	71.49999775	1/9/2015 6 57	67.39	1/9/2015 6 57	66.48000244	1/9/2015 7 00	76.54000144	1/9/2015 7 02	71.1599982	1/9/2015 7 02	73.16000205	1/9/2015 7 02	66.47999916	1/9/2015 7 06	71.11000266	1/9/2015 6 48	73.01
1/9/2015 8 00	70.69000244	1/9/2015 8 14	67.72000063	1/9/2015 7 23	70.15999779	1/9/2015 7 03	67.94	1/9/2015 7 36	67.09000246	1/9/2015 8 00	76.54000144	1/9/2015 8 55	71.2799982	1/9/2015 8 45	73.93000207	1/9/2015 8 00	68.97999913	1/9/2015 8 00	72.67000272	1/9/2015 7 01	72.4
1/9/2015 9 37	70.97000245	1/9/2015 9 24	67.75000063	1/9/2015 8 17	71.58999775	1/9/2015 8 50	68.8	1/9/2015 8 48	67.40000247	1/9/2015 9 00	76.54000144	1/9/2015 9 10	71.3499982	1/9/2015 9 00	73.38000205	1/9/2015 9 48	69.52999913	1/9/2015 9 35	73.25000274	1/9/2015 8 01	73.1
1/9/2015 10 31	70.87000244	1/9/2015 10 09	68.18000063	1/9/2015 9 40	71.15999776	1/9/2015 9 00	69.41	1/9/2015 9 38	67.03000246	1/9/2015 10 00	76.54000144	1/9/2015 10 49	71.43999819	1/9/2015 10 28	73.50000206	1/9/2015 10 28	69.71999913	1/9/2015 10 48	73.40000275	1/9/2015 9 24	73.32
1/9/2015 11 00	70.60000243	1/9/2015 11 44	67.87000063	1/9/2015 10 30	71.49999775	1/9/2015 10 02	69.29	1/9/2015 10 25	67.09000246	1/9/2015 11 00	76.54000144	1/9/2015 11 54	67.67999828	1/9/2015 11 55	72.31000202	1/9/2015 11 58	69.06999913	1/9/2015 11 44	72.91000273	1/9/2015 10 00	73.38

1/9/2015 13 12	71.03000245	1/9/2015 13 00	68.21000063	1/9/2015 12 00	71.52999775	1/9/2015 12 03	67.73	1/9/2015 12 04	66.39000243	1/9/2015 13 00	76.54000144	1/9/2015 13 48	70.11999822	1/9/2015 13 48	70.14000196	1/9/2015 13 48	69.28999913	1/9/2015 13 48	73.28000274	1/9/2015 12 34	72.89
1/9/2015 14 55	71.76000247	1/9/2015 14 07	68.33000063	1/9/2015 13 53	71.31999776	1/9/2015 13 49	68.62	1/9/2015 13 57	67.06000246	1/9/2015 14 00	76.54000144	1/9/2015 14 18	71.1899982	1/9/2015 14 18	73.44000205	1/9/2015 14 00	70.32999912	1/9/2015 14 13	73.77000276	1/9/2015 13 06	73.5
1/9/2015 15 52	71.33000246	1/9/2015 15 52	68.51000064	1/9/2015 14 13	71.21999776	1/9/2015 14 01	69.26	1/9/2015 14 55	67.85000249	1/9/2015 15 00	76.54000144	1/9/2015 15 52	71.61999819	1/9/2015 15 00	74.14000207	1/9/2015 15 59	70.07999912	1/9/2015 15 49	73.67000276	1/9/2015 14 10	73.19
1/9/2015 16 29	71.36000246	1/9/2015 16 39	67.75000063	1/9/2015 15 29	72.50999772	1/9/2015 15 36	68.31	1/9/2015 15 52	67.49000247	1/9/2015 16 00	76.54000144	1/9/2015 16 26	71.3499982	1/9/2015 16 29	73.50000206	1/9/2015 16 59	69.49999913	1/9/2015 16 27	73.49000275	1/9/2015 15 04	73.5
1/9/2015 17 43	70.97000245	1/9/2015 17 28	66.89000062	1/9/2015 16 36	71.21999776	1/9/2015 16 58	69.29	1/9/2015 16 13	67.52000247	1/9/2015 17 00	76.54000144	1/9/2015 17 00	71.3499982	1/9/2015 17 27	73.87000207	1/9/2015 17 07	69.19999913	1/9/2015 17 42	73.09000274	1/9/2015 16 51	73.65
1/9/2015 18 43	71.85000248	1/9/2015 18 03	67.38000063	1/9/2015 17 42	71.86999774	1/9/2015 17 00	68.58	1/9/2015 17 11	67.43000247	1/9/2015 18 00	76.54000144	1/9/2015 18 25	71.3499982	1/9/2015 18 00	73.87000207	1/9/2015 18 15	68.97999913	1/9/2015 18 14	73.06000273	1/9/2015 17 39	72.52
1/9/2015 19 30	71.39000246	1/9/2015 19 01	67.38000063	1/9/2015 18 00	71.34999776	1/9/2015 18 00	69.01	1/9/2015 18 14	67.64000248	1/9/2015 19 00	76.54000144	1/9/2015 19 33	71.61999819	1/9/2015 19 43	73.81000207	1/9/2015 19 01	68.79999914	1/9/2015 19 09	72.94000273	1/9/2015 18 26	73.22
1/9/2015 20 05	72.22000249	1/9/2015 20 46	68.02000063	1/9/2015 19 31	71.28999776	1/9/2015 19 30	67.97	1/9/2015 19 31	67.40000247	1/9/2015 20 00	76.54000144	1/9/2015 20 07	71.3499982	1/9/2015 20 16	74.17000208	1/9/2015 20 37	69.77999913	1/9/2015 20 11	73.64000276	1/9/2015 19 01	72.52
1/9/2015 21 01	72.37000249	1/9/2015 21 05	68.11000063	1/9/2015 20 11	72.04999774	1/9/2015 20 05	69.74	1/9/2015 20 12	68.04000249	1/9/2015 21 00	76.54000144	1/9/2015 21 59	71.73999819	1/9/2015 21 05	73.96000207	1/9/2015 21 00	70.10999912	1/9/2015 21 01	73.46000275	1/9/2015 20 56	73.56
1/9/2015 22 05	72.80000251	1/9/2015 22 16	68.76000064	1/9/2015 21 05	71.76999774	1/9/2015 21 32	69.44	1/9/2015 21 01	68.40000251	1/9/2015 22 00	76.54000144	1/9/2015 22 51	71.82999818	1/9/2015 22 51	74.32000208	1/9/2015 22 04	70.56999912	1/9/2015 22 05	74.10000277	1/9/2015 21 07	73.93
1/9/2015 23 17	73.87000254	1/9/2015 23 10	69.67000065	1/9/2015 22 51	72.37999773	1/9/2015 22 00	70.14	1/9/2015 22 05	67.98000249	1/9/2015 23 00	76.54000144	1/9/2015 23 04	72.77999816	1/9/2015 23 52	74.66000209	1/9/2015 23 36	71.05999911	1/9/2015 23 37	73.86000276	1/9/2015 22 37	74.2
1/10/2015 0 37	74.63000257	1/10/2015 0 51	68.60000064	1/9/2015 23 41	73.01999771	1/9/2015 23 11	70.84	1/9/2015 23 00	68.80000252	1/10/2015 0 00	76.54000144	1/10/2015 0 51	73.26999815	1/10/2015 0 00	74.81000209	1/10/2015 0 51	71.9099991	1/10/2015 0 04	75.08000281	1/9/2015 23 36	73.5
1/10/2015 1 10	72.5200025	1/10/2015 1 09	70.74000066	1/10/2015 0 50	73.1199977	1/10/2015 0 00	71.36	1/10/2015 0 00	69.75000256	1/10/2015 1 00	76.54000144	1/10/2015 1 09	69.26999825	1/10/2015 1 09	73.74000206	1/10/2015 1 10	71.29999911	1/10/2015 1 10	74.41000278	1/10/2015 0 07	74.08
1/10/2015 2 55	73.87000254	1/10/2015 2 12	70.25000065	1/10/2015 1 09	71.86999774	1/10/2015 1 10	70.32	1/10/2015 1 10	67.91000249	1/10/2015 2 00	76.54000144	1/10/2015 2 54	72.13999818	1/10/2015 2 19	75.30000211	1/10/2015 2 48	72.45999909	1/10/2015 2 48	75.51000283	1/10/2015 1 09	73.93
1/10/2015 3 34	73.59000253	1/10/2015 3 23	71.26000066	1/10/2015 2 59	73.84999768	1/10/2015 2 55	70.14	1/10/2015 2 51	68.53000251	1/10/2015 3 00	76.54000144	1/10/2015 3 44	71.95999818	1/10/2015 3 30	74.8700021	1/10/2015 3 03	72.51999909	1/10/2015 3 35	75.26000282	1/10/2015 2 59	75.42
1/10/2015 4 22	75.18000259	1/10/2015 4 54	71.72000067	1/10/2015 3 00	73.84999768	1/10/2015 3 34	70.6	1/10/2015 3 45	68.3100025	1/10/2015 4 00	76.54000144	1/10/2015 4 47	73.01999816	1/10/2015 4 55	75.39000211	1/10/2015 4 55	73.03999909	1/10/2015 4 55	75.78000284	1/10/2015 3 34	75.21
1/10/2015 5 42	74.51000257	1/10/2015 5 48	71.26000066	1/10/2015 4 52	73.66999769	1/10/2015 4 50	71.73	1/10/2015 4 13	69.53000255	1/10/2015 5 00	76.54000144	1/10/2015 5 59	72.40999817	1/10/2015 5 59	75.1200021	1/10/2015 5 45	72.2199991	1/10/2015 5 40	75.57000283	1/10/2015 4 07	75.94
1/10/2015 6 56	73.04000252	1/10/2015 6 03	70.28000065	1/10/2015 5 46	73.78999768	1/10/2015 5 54	71.27	1/10/2015 5 58	68.80000252	1/10/2015 6 00	76.54000144	1/10/2015 6 49	70.91999821	1/10/2015 6 48	74.78000209	1/10/2015 6 33	71.7899991	1/10/2015 6 04	74.8600028	1/10/2015 5 23	75.67
1/10/2015 7 25	71.67000247	1/10/2015 7 55	69.46000065	1/10/2015 6 01	73.59999769	1/10/2015 6 54	70.02	1/10/2015 6 48	67.58000248	1/10/2015 7 00	76.54000144	1/10/2015 7 30	70.15999822	1/10/2015 7 42	74.45000208	1/10/2015 7 59	70.13999912	1/10/2015 7 37	73.80000276	1/10/2015 6 40	75.45
1/10/2015 8 49	71.91000248	1/10/2015 8 39	67.72000063	1/10/2015 7 19	72.65999772	1/10/2015 7 33	68.55	1/10/2015 7 25	66.63000244	1/10/2015 8 00	76.54000144	1/10/2015 8 34	71.76999819	1/10/2015 8 58	73.81000207	1/10/2015 8 59	68.09999915	1/10/2015 8 45	72.67000272	1/10/2015 7 12	74.48
1/10/2015 9 57	70.78000244	1/10/2015 9 55	66.13000061	1/10/2015 8 22	71.73999775	1/10/2015 8 57	69.04	1/10/2015 8 49	67.79000248	1/10/2015 9 00	76.54000144	1/10/2015 9 30	71.49999819	1/10/2015 9 43	73.47000206	1/10/2015 9 37	67.11999916	1/10/2015 9 47	71.60000268	1/10/2015 8 40	73.04
1/10/2015 10 47	70.69000244	1/10/2015 10 57	65.79000061	1/10/2015 9 36	70.76999778	1/10/2015 9 43	68.16	1/10/2015 9 31	67.18000246	1/10/2015 10 00	76.54000144	1/10/2015 10 51	71.43999819	1/10/2015 10 29	73.29000205	1/10/2015 10 47	66.41999917	1/10/2015 10 27	71.45000268	1/10/2015 9 38	72.49
1/10/2015 11 09	69.81000241	1/10/2015 11 26	65.0300006	1/10/2015 10 49	70.73999778	1/10/2015 10 49	67.21	1/10/2015 10 47	67.30000247	1/10/2015 11 00	76.54000144	1/10/2015 11 41	71.2499982	1/10/2015 11 25	72.98000204	1/10/2015 11 17	66.50999916	1/10/2015 11 25	71.02000266	1/10/2015 10 54	72.19
1/10/2015 12 23	70.26000242	1/10/2015 12 19	65.89000061	1/10/2015 11 24	70.0899978	1/10/2015 11 09	67.85	1/10/2015 11 44	67.21000246	1/10/2015 12 00	76.54000144	1/10/2015 12 24	71.3499982	1/10/2015 12 30	73.07000204	1/10/2015 12 14	66.93999916	1/10/2015 12 14	71.17000266	1/10/2015 11 08	71.82
1/10/2015 13 19	70.45000243	1/10/2015 13 34	66.44000062	1/10/2015 12 13	69.9699978	1/10/2015 12 13	67.58	1/10/2015 12 17	67.09000246	1/10/2015 13 00	76.54000144	1/10/2015 13 52	69.29999824	1/10/2015 13 56	72.92000204	1/10/2015 13 07	67.11999916	1/10/2015 13 02	72.2100027	1/10/2015 12 57	72.52
1/10/2015 14 08	69.99000241	1/10/2015 14 05	67.35000063	1/10/2015 13 55	71.31999776	1/10/2015 13 09	68.37	1/10/2015 13 52	65.17000239	1/10/2015 14 00	76.54000144	1/10/2015 14 05	71.52999819	1/10/2015 14 31	73.13000205	1/10/2015 14 09	67.20999916	1/10/2015 14 13	72.39000271	1/10/2015 13 44	72.34
1/10/2015 15 27	70.54000243	1/10/2015 15 05	67.84000063	1/10/2015 14 00	70.73999778	1/10/2015 14 02	68.4	1/10/2015 14 31	67.46000247	1/10/2015 15 00	76.54000144	1/10/2015 15 02	71.64999819	1/10/2015 15 13	73.71000206	1/10/2015 15 27	68.61999914	1/10/2015 15 21	72.54000272	1/10/2015 14 41	73.07
1/10/2015 16 55	71.00000245	1/10/2015 16 43	67.26000062	1/10/2015 15 38	71.46999775	1/10/2015 15 49	68.74	1/10/2015 15 31	67.70000248	1/10/2015 16 00	76.54000144	1/10/2015 16 02	71.61999819	1/10/2015 16 37	73.81000207	1/10/2015 16 01	68.45999914	1/10/2015 16 46	72.70000272	1/10/2015 15 08	73.32
1/10/2015 17 14	70.75000244	1/10/2015 17 22	67.20000062	1/10/2015 16 43	70.82999777	1/10/2015 16 10	68.92	1/10/2015 16 08	67.55000248	1/10/2015 17 00	76.54000144	1/10/2015 17 11	71.64999819	1/10/2015 17 32	73.41000205	1/10/2015 17 31	68.24999914	1/10/2015 17 47	72.70000272	1/10/2015 16 25	73.19
1/10/2015 18 22	71.52000247	1/10/2015 18 46	67.87000063	1/10/2015 17 31	71.92999774	1/10/2015 17 12	68.62	1/10/2015 17 10	67.55000248	1/10/2015 18 00	76.54000144	1/10/2015 18 03	71.73999819	1/10/2015 18 25	73.71000206	1/10/2015 18 28	68.58999914	1/10/2015 18 27	72.91000273	1/10/2015 17 07	73.1
1/10/2015 19 42	72.07000248	1/10/2015 19 33	67.93000063	1/10/2015 18 20	70.85999777	1/10/2015 18 17	68.95	1/10/2015 18 03	67.70000248	1/10/2015 19 00	76.54000144	1/10/2015 19 45	71.49999819	1/10/2015 19 48	73.93000207	1/10/2015 19 06	68.85999914	1/10/2015 19 48	72.97000273	1/10/2015 18 55	73.47
1/10/2015 20 23	72.28000249	1/10/2015 20 14	68.30000063	1/10/2015 19 45	71.09999776	1/10/2015 19 07	69.16	1/10/2015 19 48	67.58000248	1/10/2015 20 00	76.54000144	1/10/2015 20 23	71.92999818	1/10/2015 20 12	73.96000207	1/10/2015 20 02	69.61999913	1/10/2015 20 51	73.73000276	1/10/2015 19 06	73.68
1/10/2015 21 23	71.15000245	1/10/2015 21 56	68.91000064	1/10/2015 20 50	72.04999774	1/10/2015 20 13	69.99	1/10/2015 20 52	67.64000248	1/10/2015 21 00	76.54000144	1/10/2015 21 35	71.82999818	1/10/2015 21 54	74.11000207	1/10/2015 21 56	70.16999912	1/10/2015 21 25	73.89000277	1/10/2015 20 23	73.99
1/10/2015 22 51	72.22000249	1/10/2015 22 03	69.31000064	1/10/2015 21 35	72.77999771	1/10/2015 21 35	69.53	1/10/2015 21 56	65.90000242	1/10/2015 22 00	76.54000144	1/10/2015 22 23	71.76999819	1/10/2015 22 15	74.26000208	1/10/2015 22 06	70.53999912	1/10/2015 22 50	74.16000278	1/10/2015 21 17	74.14
1/10/2015 23 24	72.89000251	1/10/2015 23 17	69.89000065	1/10/2015 22 10	72.37999773	1/10/2015 22 22	69.87	1/10/2015 22 14	66.39000243	1/10/2015 23 00	76.54000144	1/10/2015 23 02	72.22999817	1/10/2015 23 50	74.60000209	1/10/2015 23 47	70.87999911	1/10/2015 23 06	74.07000277	1/10/2015 22 10	74.23
1/11/2015 0 16	70.36000243	1/11/2015 0 28	69.49000065	1/10/2015 23 50	72.80999771	1/10/2015 23 47	70.32	1/10/2015 23 24	66.60000244	1/11/2015 0 00	76.54000144	1/11/2015 0 03	71.70999819	1/11/2015 0 03	73.93000207	1/11/2015 0 04	69.49999913	1/11/2015 0 03	73.49000275	1/10/2015 23 01	74.72
1/11/2015 1 13	70.78000244	1/11/2015 1 35	70.31000065	1/11/2015 0 19	73.38999769	1/11/2015 0 03	69.44	1/11/2015 0 04	65.72000241	1/11/2015 1 00	76.54000144	1/11/2015 1 13	68.83999826	1/11/2015 1 13	73.16000205	1/11/2015 1 14	70.41999912	1/11/2015 1 14	73.80000276	1/11/2015 0 35	73.74
1/11/2015 2 03	74.66000257	1/11/2015 2 04	71.29000066	1/11/2015 1 13	73.0599977	1/11/2015 1 13	67.12	1/11/2015 1 13	64.89000238	1/11/2015 2 00	76.54000144	1/11/2015 2 07	72.74999816	1/11/2015 2 34	74.84000209	1/11/2015 2 16	72.76999909	1/11/2015 2 07	75.60000283	1/11/2015 1 13	75.03
1/11/2015 3 44	74.78000257	1/11/2015 3 38	71.87000067	1/11/2015 2 32	73.59999769	1/11/2015 2 07	71.52	1/11/2015 2 03	69.29000254	1/11/2015 3 00	76.54000144	1/11/2015 3 43	72.95999816	1/11/2015 3 12	75.36000211	1/11/2015 3 25	72.82999909	1/11/2015 3 44	75.93000284	1/11/2015 2 47	75.73
1/11/2015 4 54	75.21000259	1/11/2015 4 02	71.81000067	1/11/2015 3 09	73.90999768	1/11/2015 3 43	71.64	1/11/2015 3 44	69.26000254	1/11/2015 4 00	76.54000144	1/11/2015 4 46	73.23999815	1/11/2015 4 44	75.33000211	1/11/2015 4 21	73.22999908	1/11/2015 4 27	76.18000285	1/11/2015 3 00	75.97
1/11/2015 5 43	74.81000258	1/11/2015 5 57	70.89000066	1/11/2015 4 42	73.99999768	1/11/2015 4 54	71.64	1/11/2015 4 54	69.75000256	1/11/2015 5 00	76.54000144	1/11/2015 5 44	72.68999816	1/11/2015 5 30	75.0600021	1/11/2015 5 58	72.76999909	1/11/2015 5 58	75.47000282	1/11/2015 4 02	75.73
1/11/2015 6 59	73.16000252	1/11/2015 6 47	69.06000064	1/11/2015 5 55	74.11999767	1/11/2015 5 55	71.3	1/11/2015 5 58	69.38000254	1/11/2015 6 00	76.54000144	1/11/2015 6 59	71.55999819	1/11/2015 6 23	74.8700021	1/11/2015 6 52	72.0999991	1/11/2015 6 52	74.8900028	1/11/2015 5 57	75.15
1/11/2015 7 53	71.64000247	1/11/2015 7 53	68.94000064	1/11/2015 6 12	73.56999769	1/11/2015 6 53	70.39	1/11/2015 6 59	67.55000248	1/11/2015 7 00	76.54000144	1/11/2015 7 54	69.78999823	1/11/2015 7 59	74.26000208	1/11/2015 7 59	69.71999913	1/11/2015 7 59	73.86000276	1/11/2015 6 00	75.15
1/11/2015 8 44	71.97000248	1/11/2015 8 53	67.20000062	1/11/2015 7 14	73.01999771	1/11/2015 7 55	67.82	1/11/2015 7 55	66.17000243	1/11/2015 8 00	76.54000144	1/11/2015 8 44	71.95999818	1/11/2015 8 56	73.77000206	1/11/2015 8 54	68.42999914	1/11/2015 8 51	72.79000272	1/11/2015 7 54	74.51
1/11/2015 9 44	70.91000245	1/11/2015 9 22	65.2100006	1/11/2015 8 18	71.34999776	1/11/2015 8 50	69.23	1/11/2015 8 51	67.85000249	1/11/2015 9 00	76.54000144	1/11/2015 9 44	71.52999819	1/11/2015 9 43	73.41000205	1/11/2015 9 46	66.38999917	1/11/2015 9 57	71.17000266	1/11/2015 8 55	73.26
1/11/2015 10 13	70.39000243	1/11/2015 10 07	64.6000006 A	1/11/2015 9 47	70.79999777	1/11/2015 9 44	68.46	1/11/2015 9 32	67.40000247	1/11/2015 10 00	76.54000144	1/11/2015 10 26	71.3499982	1/11/2015 10 13	73.01000204	1/11/2015 10 04	66.19999917	1/11/2015 10 11	70.77000265	1/11/2015 9 42	72.4
1/11/2015 11 02	69.5600024	1/11/2015 11 14	64.7600006 A	1/11/2015 10 40	71.37999776	1/11/2015 10 17	67.76	1/11/2015 10 42	67.12000246	1/11/2015 11 00	76.54000144	1/11/2015 11 15	71.2499982	1/11/2015 11 39	72.74000203	1/11/2015 11 19	66.10999917	1/11/2015 11 01	70.74000265	1/11/2015 10 46	71.85
1/11/2015 12 02	70.14000242	1/11/2015 12 36	64.7000006 A	1/11/2015 11 39	70.57999778	1/11/2015 11 02	67.61	1/11/2015 11 00	66.91000245	1/11/2015 12 00	76.54000144	1/11/2015 12 03	71.1599982	1/11/2015 12 32	72.77000204	1/11/2015 12 12	65.74999917	1/11/2015 12 13	70.59000264	1/11/2015 11 38	71.67
1/11/2015 13 26	70.36000243	1/11/2015 13 38	65.76000061	1/11/2015 12 23	70.60999778	1/11/2015 12 16	68.22	1/11/2015 12 02	67.06000246	1/11/2015 13 00	76.54000144	1/11/2015 13 34	71.37999819	1/11/2015 13 39	72.92000204	1/11/2015 13 12	66.99999916	1/11/2015 13 27	71.45000268	1/11/2015 12 05	71.79
1/11/2015 14 03	66.91000231	1/11/2015 14 38	66.68000062	1/11/2015 13 37	71.40999776	1/11/2015 13 26	68.34	1/11/2015 13 43	67.49000247	1/11/2015 14 00	76.54000144	1/11/2015 14 03	68.74999826	1/11/2015 14 34	72.83000204	1/11/2015 14 21	67.42999915	1/11/2015 14 04	71.78000269	1/11/2015 13 50	72.13
1/11/2015 15 07	70.29000242	1/11/2015 15 44	66.65000062	1/11/2015 14 02	70.97999777	1/11/2015 14 03	67.36	1/11/2015 14 03	64.04000235	1/11/2015 15 00	76.54000144	1/11/2015 15 20	71.61999819	1/11/2015 15 18	73.29000205	1/11/2015 15 18	68.30999914	1/11/2015 15 44	72.30000271	1/11/2015 14 45	72.64
1/11/2015 16 23	70.69000244	1/11/2015 16 53	66.92000062	1/11/2015 15 11	71.43999775	1/11/2015 15 21	68.71	1/11/2015 15 20	67.46000247	1/11/2015 16 00	76.54000144	1/11/2015 16 31	71.40999819	1/11/2015 16 54	73.44000205	1/11/2015 16 47	67.97999915	1/11/2015 16 30	72.1200027	1/11/2015 15 11	72.43
1/11/2015 17 56	71.33000246	1/11/2015 17 12	66.19000061	1/11/2015 16 54	71.09999776	1/11/2015 16 11	68.89	1/11/2015 16 19	67.46000247	1/11/2015 17 00	76.54000144	1/11/2015 17 22	71.64999819	1/11/2015 17 19	73.41000205	1/11/2015 17 59	67.90999915	1/11/2015 17 41	72.0300027	1/11/2015 16 11	73.1
1/11/2015 18 58	70.69000244	1/11/2015 18 54	66.10000061	1/11/2015 17 23	71.18999776	1/11/2015 17 09	68.43	1/11/2015 17 44	67.55000248	1/11/2015 18 00	76.54000144	1/11/2015 18 37	71.61999819	1/11/2015 18 19	73.32000205	1/11/2015 18 09	67.48999915	1/11/2015 18 28	72.0000027	1/11/2015 17 27	73.04
1/11/2015 19 00	70.69000244	1/11/2015 19 13	66.13000061	1/11/2015 18 52	71.15999776	1/11/2015 18 37	68.28	1/11/2015 18 54	67.52000247	1/11/2015 19 00	76.54000144	1/11/2015 19 01	71.76999819	1/11/2015 19 41	73.32000205	1/11/2015 19 01	67.87999915	1/11/2015 19 14	71.81000269	1/11/2015 18 14	72.86
1/11/2015 20 12	71.61000247	1/11/2015 20 25	67.23000062	1/11/2015 19 59	71.18999776	1/11/2015 19 18	68.83	1/11/2015 19 25	67.40000247	1/11/2015 20 00	76.54000144	1/11/2015 20 40	71.58999819	1/11/2015 20 00	73.62000206	1/11/2015 20 13	66.87999916	1/11/2015 20 13	71.60000268	1/11/2015 19 37	73.04
1/11/2015 21 22	72.34000249	1/11/2015 21 07	68.91000064	1/11/2015 20 00	71.18999776	1/11/2015 20 14	68.25	1/11/2015 20 41	67.58000248	1/11/2015 21 00	76.54000144	1/11/2015 21 32	71.79999818	1/11/2015 21 07	73.99000207	1/11/2015 21 33	68.91999914	1/11/2015 21 34	72.97000273	1/11/2015 20 10	73.32
1/11/2015 22 03	72.83000251	1/11/2015 22 02	68.60000064	1/11/2015 21 28	71.06999777	1/11/2015 21 03	69.29	1/11/2015 21 26	68.1600025	1/11/2015 22 00	76.54000144	1/11/2015 22 34	71.73999819	1/11/2015 22 35	73.35000205	1/11/2015 22 35	69.71999913	1/11/2015 22 03	73.83000276	1/11/2015 21 03	73.68
1/11/2015 23 48	72.40000249	1/11/2015 23 19	69.46000065	1/11/2015 22 34	71.31999776	1/11/2015 22 34	69.38	1/11/2015 22 34	68.3400025	1/11/2015 23 00	76.54000144	1/11/2015 23 48	71.76999819	1/11/2015 23 48	73.29000205	1/11/2015 23 48	69.06999913	1/11/2015 23 48	72.42000271	1/11/2015 22 34	73.9
1/12/2015 0 31	73.01000252	1/12/2015 0 27	68.76000064	1/11/2015 23 47	72.31999773	1/11/2015 23 48	69.26	1/11/2015 23 48	67.37000247	1/12/2015 0 00	76.54000144	1/12/2015 0 26	68.31999827	1/12/2015 0 27	74.84000209	1/12/2015 0 26	70.29999912	1/12/2015 0 32	74.8000028	1/11/2015 23 47	73.71
1/12/2015 1 47	74.17000255	1/12/2015 1 00	71.99000067	1/12/2015 0 27	73.50999769	1/12/2015 0 27	70.23	1/12/2015 0 27	67.76000248	1/12/2015 1 00	76.54000144	1/12/2015 1 50	71.64999819	1/12/2015 1 32	74.8700021	1/12/2015 1 31	72.67999909	1/12/2015 1 03	75.57000283	1/12/2015 0 26	73.32
1/12/2015 2 53	74.57000257	1/12/2015 2 49	72.11000067	1/12/2015 1 32	73.53999769	1/12/2015 1 02	70.94	1/12/2015 1 31	68.95000253	1/12/2015 2 00	76.54000144	1/12/2015 2 49	72.50999817	1/12/2015 2 39	74.9700021	1/12/2015 2 32	72.88999909	1/12/2015 2 01	75.69000283	1/12/2015 1 31	75.82
1/12/2015 3 06	75.03000258	1/12/2015 3 25	72.30000067	1/12/2015 2 18	73.90999768	1/12/2015 2 53	70.78	1/12/2015 2 49	69.04000253	1/12/2015 3 00	76.54000144	1/12/2015 3 12	73.14999815	1/12/2015 3 24	74.69000209	1/12/2015 3 07	73.25999908	1/12/2015 3 13	75.96000284	1/12/2015 2 49	76.06
1/12/2015 4 34	74.11000255	1/12/2015 4 59	71.69000067	1/12/2015 3 19	73.99999768	1/12/2015 3 59	71.76	1/12/2015 3 39	69.75000256	1/12/2015 4 00	76.54000144	1/12/2015 4 34	71.89999818	1/12/2015 4 48	75.0900021	1/12/2015 4 54	72.48999909	1/12/2015 4 59	74.8900028	1/12/2015 3 01	76.34
1/12/2015 5 59	71.67000247	1/12/2015 5 48	67.96000063	1/12/2015 4 03	73.72999768	1/12/2015 4 34	70.6	1/12/2015 4 34	68.04000249	1/12/2015 5 00	76.54000144	1/12/2015 5 52	69.32999824	1/12/2015 5 22	73.99000207	1/12/2015 5 58	70.83999911	1/12/2015 5 56	74.13000277	1/12/2015 4 34	75.21
1/12/2015 6 00	71.67000247	1/12/2015 6 54	67.20000062	1/12/2015 5 22	72.89999771	1/12/2015 5 52	68.1	1/12/2015 5 48	65.78000241	1/12/2015 6 00	76.54000144	1/12/2015 6 49	71.1899982	1/12/2015 6 33	73.41000205	1/12/2015 6 42	67.23999916	1/12/2015 6 59	72.0600027	1/12/2015 5 48	73.41
1/12/2015 7 29	70.54000243	1/12/2015 7 47	66.41000062	1/12/2015 6 33	71.67999775	1/12/2015 6 52	68.55	1/12/2015 6 00	66.51000244	1/12/2015 7 00	76.54000144	1/12/2015 7 06	71.0399982	1/12/2015 7 52	72.92000204	1/12/2015 7 16	66.53999916	1/12/2015 7 15	71.17000266	1/12/2015 6 46	73.16
1/12/2015 8 37	70.29000242	1/12/2015 8 11	67.96000063	1/12/2015 7 52	71.03999777	1/12/2015 7 41	66.63	1/12/2015 7 11	66.60000244	1/12/2015 8 00	76.54000144	1/12/2015 8 09	71.0699982	1/12/2015 8 28	72.77000204	1/12/2015 8 31	68.88999914	1/12/2015 8 06	72.48000271	1/12/2015 7 15	72.83
1/12/2015 9 55	71.36000246	1/12/2015 9 07	67.87000063	1/12/2015 8 03	71.24999776	1/12/2015 8 04	68.49	1/12/2015 8 41	67.06000246	1/12/2015 9 00	76.54000144	1/12/2015 9 07	71.0999982	1/12/2015 9 18	73.47000206	1/12/2015 9 22	69.46999913	1/12/2015 9 29	73.37000275	1/12/2015 8 05	73.16
1/12/2015 10 39	71.09000245	1/12/2015 10 31	67.93000063	1/12/2015 9 26	71.55999775	1/12/2015 9 00	67.73	1/12/2015 9 55	67.40000247	1/12/2015 10 00	76.54000144	1/12/2015 10 44	70.73999821	1/12/2015 10 54	73.07000204	1/12/2015 10 23	69.52999913	1/12/2015 10 54	73.12000274	1/12/2015 9 07	72.74
1/12/2015 11 34	70.78000244	1/12/2015 11 52	67.41000063	1/12/2015 10 54	70.85999777	1/12/2015 10 53	69.13	1/12/2015 10 47	67.49000247	1/12/2015 11 00	76.54000144	1/12/2015 11 20	69.29999824	1/12/2015 11 22	72.52000203	1/12/2015 11 04	69.37999913	1/12/2015 11 53	73.25000274	1/12/2015 10 31	73.01
1/12/2015 12 38	71.21000246	1/12/2015 12 00	68.15000063	1/12/2015 11 21	71.06999777	1/12/2015 11 48	68.07	1/12/2015 11 34	66.97000245	1/12/2015 12 00	76.54000144	1/12/2015 12 54	70.79999821	1/12/2015 12 54	72.83000204	1/12/2015 12 32	69.92999912	1/12/2015 12 44	73.52000275	1/12/2015 11 00	73.22
1/12/2015 13 19	69.75000241	1/12/2015 13 04	68.48000064	1/12/2015 12 53	71.12999776	1/12/2015 12 46	69.2	1/12/2015 12 53	67.03000246	1/12/2015 13 00	76.54000144	1/12/2015 13 46	70.88999821	1/12/2015 13 49	72.31000202	1/12/2015 13 49	69.43999913	1/12/2015 13 49	73.55000275	1/12/2015 12 34	73.5
1/12/2015 14 03	71.82000248	1/12/2015 14 57	68.54000064	1/12/2015 13 03	69.78999781	1/12/2015 13 19	69.01	1/12/2015 13 46	66.39000243	1/12/2015 14 00	76.54000144	1/12/2015 14 43	71.0999982	1/12/2015 14 07	73.41000205	1/12/2015 14 15	70.07999912	1/12/2015 14 12	73.80000276	1/12/2015 13 02	73.93
1/12/2015 15 43	69.5000024	1/12/2015 15 00	68.54000064	1/12/2015 14 20	71.86999774	1/12/2015 14 56	68.28	1/12/2015 14 56	67.21000246	1/12/2015 15 00	76.54000144	1/12/2015 15 58	70.45999822	1/12/2015 15 58	73.50000206	1/12/2015 15 58	69.86999912	1/12/2015 15 56	73.73000276	1/12/2015 14 02	73.01
1/12/2015 16 00	70.11000242	1/12/2015 16 14	68.11000063	1/12/2015 15 00	72.10999773	1/12/2015 15 39	69.47	1/12/2015 15 58	66.51000244	1/12/2015 16 00	76.54000144	1/12/2015 16 46	71.0099982	1/12/2015 16 00	73.50000206	1/12/2015 16 56	69.74999913	1/12/2015 16 06	73.46000275	1/12/2015 15 04	73.59
1/12/2015 17 39	70.05000242	1/12/2015 17 38	66.86000062	1/12/2015 16 39	71.55999775	1/12/2015 16 18	68.28	1/12/2015 16 00	66.51000244	1/12/2015 17 00	76.54000144	1/12/2015 17 35	71.2799982	1/12/2015 17 52	73.53000206	1/12/2015 17 23	68.48999914	1/12/2015 17 39	72.88000273	1/12/2015 16 56	73.41
1/12/2015 18 14	70.08000242	1/12/2015 18 08	67.08000062	1/12/2015 17 52	71.55999775	1/12/2015 17 00	68.46	1/12/2015 17 35	66.75000245	1/12/2015 18 00	76.54000144	1/12/2015 18 45	71.40999819	1/12/2015 18 37	73.47000206	1/12/2015 18 32	68.39999914	1/12/2015 18 55	72.45000271	1/12/2015 17 23	72.83
1/12/2015 19 34	70.17000242	1/12/2015 19 03	67.26000062	1/12/2015 18 37	71.18999776	1/12/2015 18 18	68.65	1/12/2015 18 45	67.12000246	1/12/2015 19 00	76.54000144	1/12/2015 19 39	71.52999819	1/12/2015 19 40	73.53000206	1/12/2015 19 16	68.21999914	1/12/2015 19 00	72.76000272	1/12/2015 18 14	72.68
1/12/2015 20 11	71.58000247	1/12/2015 20 01	67.63000063	1/12/2015 19 40	71.73999775	1/12/2015 19 46	68.86	1/12/2015 19 01	67.43000247	1/12/2015 20 00	76.54000144	1/12/2015 20 52	71.1299982	1/12/2015 20 19	73.13000205	1/12/2015 20 06	68.61999914	1/12/2015 20 04	72.91000273	1/12/2015 19 46	72.77
1/12/2015 21 27	71.79000247	1/12/2015 21 20	67.57000063	1/12/2015 20 18	71.67999775	1/12/2015 20 52	69.2	1/12/2015 20 48	67.46000247	1/12/2015 21 00	76.54000144	1/12/2015 21 31	71.40999819	1/12/2015 21 30	73.01000204	1/12/2015 21 02	69.13999913	1/12/2015 21 30	73.00000273	1/12/2015 20 00	73.5
1/12/2015 22 00	72.80000251	1/12/2015 22 02	68.79000064	1/12/2015 21 41	71.49999775	1/12/2015 21 31	69.07	1/12/2015 21 01	67.73000248	1/12/2015 22 00	76.54000144	1/12/2015 22 01	71.67999819	1/12/2015 22 01	73.71000206	1/12/2015 22 01	69.37999913	1/12/2015 22 16	73.89000277	1/12/2015 21 01	73.53
1/12/2015 23 18	73.99000255	1/12/2015 23 11	70.37000065	1/12/2015 22 28	72.01999774	1/12/2015 22 21	69.84	1/12/2015 22 00	67.91000249	1/12/2015 23 00	76.54000144	1/12/2015 23 03	72.68999816	1/12/2015 23 00	74.45000208	1/12/2015 23 02	71.6099991	1/12/2015 23 23	74.8300028	1/12/2015 22 32	74.05
1/13/2015 0 33	73.07000252	1/13/2015 0 33	70.65000066	1/12/2015 23 00	72.56999772	1/12/2015 23 00	71.09	1/12/2015 23 00	69.38000254	1/13/2015 0 00	76.54000144	1/13/2015 0 32	69.26999825	1/13/2015 0 00	74.57000209	1/13/2015 0 32	71.05999911	1/13/2015 0 29	75.05000281	1/12/2015 23 21	75.21
1/13/2015 1 07	74.48000256	1/13/2015 1 09	70.98000066	1/13/2015 0 13	73.38999769	1/13/2015 0 32	68.28	1/13/2015 0 33	67.03000246	1/13/2015 1 00	76.54000144	1/13/2015 1 04	71.98999818	1/13/2015 1 21	74.9000021	1/13/2015 1 05	71.9099991	1/13/2015 1 06	75.32000282	1/13/2015 0 33	75.42
1/13/2015 2 15	74.32000256	1/13/2015 2 16	71.50000066	1/13/2015 1 05	73.3299977	1/13/2015 1 55	70.63	1/13/2015 1 14	68.86000252	1/13/2015 2 00	76.54000144	1/13/2015 2 15	72.34999817	1/13/2015 2 28	74.57000209	1/13/2015 2 16	72.30999909	1/13/2015 2 33	75.69000283	1/13/2015 1 00	75.73
1/13/2015 3 48	74.96000258	1/13/2015 3 47	71.93000067	1/13/2015 2 28	73.38999769	1/13/2015 2 15	71.03	1/13/2015 2 16	68.49000251	1/13/2015 3 00	76.54000144	1/13/2015 3 39	72.22999817	1/13/2015 3 56	75.0600021	1/13/2015 3 40	72.82999909	1/13/2015 3 35	75.69000283	1/13/2015 2 16	75.67
1/13/2015 4 33	74.05000255	1/13/2015 4 38	70.83000066	1/13/2015 3 39	73.56999769	1/13/2015 3 40	71.42	1/13/2015 3 13	69.62000255	1/13/2015 4 00	76.54000144	1/13/2015 4 59	71.55999819	1/13/2015 4 59	74.57000209	1/13/2015 4 59	72.0399991	1/13/2015 4 39	74.9600028	1/13/2015 3 39	75.79
1/13/2015 5 41	70.91000245	1/13/2015 5 52	69.24000064	1/13/2015 4 38	73.72999768	1/13/2015 4 54	71.55	1/13/2015 4 54	68.86000252	1/13/2015 5 00	76.54000144	1/13/2015 5 37	69.35999824	1/13/2015 5 42	74.32000208	1/13/2015 5 57	70.25999912	1/13/2015 5 42	74.10000277	1/13/2015 4 38	75.42
1/13/2015 6 27	71.15000245	1/13/2015 6 33	67.02000062	1/13/2015 5 51	72.62999772	1/13/2015 5 37	68.16	1/13/2015 5 37	65.90000242	1/13/2015 6 00	76.54000144	1/13/2015 6 51	70.91999821	1/13/2015 6 43	73.26000205	1/13/2015 6 51	66.81999916	1/13/2015 6 43	71.63000268	1/13/2015 5 53	74.05
1/13/2015 7 04	68.83000238	1/13/2015 7 01	65.76000061	1/13/2015 6 43	70.88999777	1/13/2015 6 51	68.1	1/13/2015 6 51	67.73000248	1/13/2015 7 00	76.54000144	1/13/2015 7 08	70.9799982	1/13/2015 7 30	72.65000203	1/13/2015 7 13	66.26999917	1/13/2015 7 09	71.23000267	1/13/2015 6 46	73.26
1/13/2015 8 20	70.94000245	1/13/2015 8 07	67.47000063	1/13/2015 7 13	70.63999778	1/13/2015 7 08	68.19	1/13/2015 7 28	66.66000244	1/13/2015 8 00	76.54000144	1/13/2015 8 36	71.3499982	1/13/2015 8 03	73.13000205	1/13/2015 8 14	68.58999914	1/13/2015 8 03	73.03000273	1/13/2015 7 08	72.49
1/13/2015 9 05	70.66000244	1/13/2015 9 20	67.93000063	1/13/2015 8 27	71.49999775	1/13/2015 8 24	68.8	1/13/2015 8 03	67.21000246	1/13/2015 9 00	76.54000144	1/13/2015 9 55	71.1599982	1/13/2015 9 16	73.19000205	1/13/2015 9 17	69.46999913	1/13/2015 9 02	73.25000274	1/13/2015 8 49	72.8
1/13/2015 10 00	71.18000245	1/13/2015 10 32	68.27000063	1/13/2015 9 53	71.00999777	1/13/2015 9 59	69.1	1/13/2015 9 34	67.21000246	1/13/2015 10 00	76.54000144	1/13/2015 10 29	71.3499982	1/13/2015 10 12	73.16000205	1/13/2015 10 19	69.31999913	1/13/2015 10 02	73.61000275	1/13/2015 9 13	73.32

1/13/2015 11 48	70.36000243	1/13/2015 11 48	68.30000063	1/13/2015 10 44	70.91999777	1/13/2015 10 44	68.92	1/13/2015 10 15	67.46000247	1/13/2015 11 00	76.54000144	1/13/2015 11 05	70.69999821	1/13/2015 11 17	73.32000205	1/13/2015 11 52	70.04999912	1/13/2015 11 02	73.64000276	1/13/2015 10 19	73.38
1/13/2015 12 08	71.33000246	1/13/2015 12 37	68.30000063	1/13/2015 11 51	71.00999777	1/13/2015 11 23	69.07	1/13/2015 11 48	66.63000244	1/13/2015 12 00	76.54000144	1/13/2015 12 05	70.54999821	1/13/2015 12 50	73.68000206	1/13/2015 12 23	69.95999912	1/13/2015 12 31	73.98000277	1/13/2015 11 35	73.47
1/13/2015 13 10	70.36000243	1/13/2015 13 36	68.11000063	1/13/2015 12 53	71.89999774	1/13/2015 12 45	68.92	1/13/2015 12 08	67.27000247	1/13/2015 13 00	76.54000144	1/13/2015 13 36	71.0099982	1/13/2015 13 09	73.41000205	1/13/2015 13 05	69.95999912	1/13/2015 13 05	73.89000277	1/13/2015 12 00	73.41
1/13/2015 14 04	70.84000244	1/13/2015 14 07	68.33000063	1/13/2015 13 57	71.82999774	1/13/2015 13 10	68.77	1/13/2015 13 10	66.72000245	1/13/2015 14 00	76.54000144	1/13/2015 14 07	70.85999821	1/13/2015 14 48	73.53000206	1/13/2015 14 11	70.68999911	1/13/2015 14 49	74.44000279	1/13/2015 13 41	73.87
1/13/2015 15 12	69.96000241	1/13/2015 15 23	68.39000064	1/13/2015 14 42	71.76999774	1/13/2015 14 37	69.01	1/13/2015 14 00	67.52000247	1/13/2015 15 00	76.54000144	1/13/2015 15 12	70.76999821	1/13/2015 15 08	72.92000204	1/13/2015 15 09	70.25999912	1/13/2015 15 48	73.83000276	1/13/2015 14 25	73.8
1/13/2015 16 59	70.60000243	1/13/2015 16 22	67.90000063	1/13/2015 15 26	71.55999775	1/13/2015 15 57	69.87	1/13/2015 15 12	66.75000245	1/13/2015 16 00	76.54000144	1/13/2015 16 21	70.91999821	1/13/2015 16 54	73.56000206	1/13/2015 16 22	69.67999913	1/13/2015 16 25	73.43000275	1/13/2015 15 37	73.56
1/13/2015 17 00	70.60000243	1/13/2015 17 46	66.13000061	1/13/2015 16 08	71.21999776	1/13/2015 16 22	69.32	1/13/2015 16 44	67.46000247	1/13/2015 17 00	76.54000144	1/13/2015 17 03	71.1899982	1/13/2015 17 42	73.62000206	1/13/2015 17 39	68.33999914	1/13/2015 17 33	72.94000273	1/13/2015 16 37	73.38
1/13/2015 18 13	70.14000242	1/13/2015 18 52	67.14000062	1/13/2015 17 42	71.55999775	1/13/2015 17 07	68.95	1/13/2015 17 36	66.69000244	1/13/2015 18 00	76.54000144	1/13/2015 18 13	70.79999821	1/13/2015 18 13	73.38000205	1/13/2015 18 43	68.42999914	1/13/2015 18 42	72.2100027	1/13/2015 17 10	72.92
1/13/2015 19 52	71.27000246	1/13/2015 19 52	66.86000062	1/13/2015 18 24	71.86999774	1/13/2015 18 56	68.58	1/13/2015 18 56	67.15000246	1/13/2015 19 00	76.54000144	1/13/2015 19 30	71.40999819	1/13/2015 19 04	73.53000206	1/13/2015 19 04	68.55999914	1/13/2015 19 04	72.27000271	1/13/2015 18 42	72.86
1/13/2015 20 29	70.23000242	1/13/2015 20 55	67.50000063	1/13/2015 19 45	71.73999775	1/13/2015 19 00	68.58	1/13/2015 19 23	67.61000248	1/13/2015 20 00	76.54000144	1/13/2015 20 45	71.0699982	1/13/2015 20 49	73.47000206	1/13/2015 20 45	68.70999914	1/13/2015 20 00	72.79000272	1/13/2015 19 20	72.46
1/13/2015 21 47	71.18000245	1/13/2015 21 42	68.18000063	1/13/2015 20 51	71.79999774	1/13/2015 20 45	68.98	1/13/2015 20 29	67.27000247	1/13/2015 21 00	76.54000144	1/13/2015 21 18	71.0699982	1/13/2015 21 22	73.38000205	1/13/2015 21 45	69.40999913	1/13/2015 21 20	73.40000275	1/13/2015 20 35	73.56
1/13/2015 22 03	71.03000245	1/13/2015 22 04	68.57000064	1/13/2015 21 22	71.98999774	1/13/2015 21 18	68.71	1/13/2015 21 22	67.37000247	1/13/2015 22 00	76.54000144	1/13/2015 22 03	71.0099982	1/13/2015 22 54	73.68000206	1/13/2015 22 03	69.40999913	1/13/2015 22 03	73.40000275	1/13/2015 21 40	73.1
1/13/2015 23 01	73.13000252	1/13/2015 23 00	69.15000064	1/13/2015 22 54	72.44999772	1/13/2015 22 11	69.1	1/13/2015 22 08	67.55000248	1/13/2015 23 00	76.54000144	1/13/2015 23 01	71.73999819	1/13/2015 23 01	74.08000207	1/13/2015 23 01	69.83999912	1/13/2015 23 01	73.28000274	1/13/2015 22 14	73.22
1/14/2015 0 38	69.38000239	1/14/2015 0 43	69.98000065	1/13/2015 23 00	72.50999772	1/13/2015 23 01	70.08	1/13/2015 23 01	67.91000249	1/14/2015 0 00	76.54000144	1/14/2015 0 38	69.35999824	1/14/2015 0 39	74.26000208	1/14/2015 0 38	71.4899991	1/14/2015 0 39	74.28000278	1/13/2015 23 01	73.62
1/14/2015 1 03	74.60000257	1/14/2015 1 13	71.17000066	1/14/2015 0 32	73.38999769	1/14/2015 0 38	69.81	1/14/2015 0 38	64.65000237	1/14/2015 1 00	76.54000144	1/14/2015 1 46	72.01999818	1/14/2015 1 52	74.9700021	1/14/2015 1 48	72.57999909	1/14/2015 1 00	75.11000281	1/14/2015 0 38	74.54
1/14/2015 2 52	74.87000258	1/14/2015 2 21	72.11000067	1/14/2015 1 48	73.66999769	1/14/2015 1 00	71.61	1/14/2015 1 00	69.23000254	1/14/2015 2 00	76.54000144	1/14/2015 2 51	72.77999816	1/14/2015 2 53	75.0600021	1/14/2015 2 32	72.91999909	1/14/2015 2 39	75.66000283	1/14/2015 1 54	75.61
1/14/2015 3 00	73.93000255	1/14/2015 3 05	71.69000067	1/14/2015 2 52	73.81999768	1/14/2015 2 51	72.16	1/14/2015 2 00	69.41000254	1/14/2015 3 00	76.54000144	1/14/2015 3 04	72.43999817	1/14/2015 3 04	74.8700021	1/14/2015 3 05	72.82999909	1/14/2015 3 58	75.84000284	1/14/2015 2 21	75.88
1/14/2015 4 49	74.75000257	1/14/2015 4 57	71.23000066	1/14/2015 3 04	74.05999767	1/14/2015 3 41	72.28	1/14/2015 3 04	68.89000253	1/14/2015 4 00	76.54000144	1/14/2015 4 04	71.98999818	1/14/2015 4 50	75.1500021	1/14/2015 4 46	72.2199991	1/14/2015 4 57	75.29000282	1/14/2015 3 10	76
1/14/2015 5 53	71.85000248	1/14/2015 5 48	69.55000065	1/14/2015 4 38	73.93999768	1/14/2015 4 04	71.82	1/14/2015 4 51	68.80000252	1/14/2015 5 00	76.54000144	1/14/2015 5 53	70.24999822	1/14/2015 5 47	74.39000208	1/14/2015 5 54	70.62999911	1/14/2015 5 54	73.98000277	1/14/2015 4 59	75.51
1/14/2015 6 59	71.33000246	1/14/2015 6 54	66.44000062	1/14/2015 5 53	73.1799977	1/14/2015 5 47	70.6	1/14/2015 5 53	66.82000245	1/14/2015 6 00	76.54000144	1/14/2015 6 22	71.67999819	1/14/2015 6 53	73.59000206	1/14/2015 6 47	67.08999916	1/14/2015 6 54	71.54000268	1/14/2015 5 48	74.54
1/14/2015 7 21	69.5000024	1/14/2015 7 32	65.86000061	1/14/2015 6 51	71.67999775	1/14/2015 6 50	70.11	1/14/2015 6 48	67.49000247	1/14/2015 7 00	76.54000144	1/14/2015 7 25	70.85999821	1/14/2015 7 22	72.43000203	1/14/2015 7 22	66.56999916	1/14/2015 7 09	71.14000266	1/14/2015 6 13	73.04
1/14/2015 8 00	70.05000242	1/14/2015 8 01	67.32000062	1/14/2015 7 35	69.9399978	1/14/2015 7 15	69.81	1/14/2015 7 25	66.30000243	1/14/2015 8 00	76.54000144	1/14/2015 8 34	71.0699982	1/14/2015 8 22	73.32000205	1/14/2015 8 12	68.42999914	1/14/2015 8 04	72.39000271	1/14/2015 7 19	72.46
1/14/2015 9 02	70.91000245	1/14/2015 9 02	67.66000063	1/14/2015 8 22	71.43999775	1/14/2015 8 23	69.23	1/14/2015 8 01	67.18000246	1/14/2015 9 00	76.54000144	1/14/2015 9 41	71.0699982	1/14/2015 9 27	73.10000205	1/14/2015 9 02	69.22999913	1/14/2015 9 00	73.43000275	1/14/2015 8 13	73.19
1/14/2015 10 35	71.42000246	1/14/2015 10 59	67.78000063	1/14/2015 9 31	71.40999776	1/14/2015 9 02	70.48	1/14/2015 9 41	67.24000246	1/14/2015 10 00	76.54000144	1/14/2015 10 57	71.1899982	1/14/2015 10 23	72.92000204	1/14/2015 10 03	69.74999913	1/14/2015 10 23	73.58000275	1/14/2015 9 02	72.86
1/14/2015 11 02	70.60000243	1/14/2015 11 00	67.78000063	1/14/2015 10 14	71.37999776	1/14/2015 10 10	70.32	1/14/2015 10 58	67.06000246	1/14/2015 11 00	76.54000144	1/14/2015 11 46	71.0999982	1/14/2015 11 38	73.29000205	1/14/2015 11 05	69.71999913	1/14/2015 11 36	73.67000276	1/14/2015 10 23	73.32
1/14/2015 12 28	69.87000241	1/14/2015 12 36	68.42000064	1/14/2015 11 15	70.91999777	1/14/2015 11 39	70.42	1/14/2015 11 00	67.06000246	1/14/2015 12 00	76.54000144	1/14/2015 12 29	71.1299982	1/14/2015 12 54	73.35000205	1/14/2015 12 29	70.04999912	1/14/2015 12 39	73.95000277	1/14/2015 11 24	72.55
1/14/2015 13 09	70.54000243	1/14/2015 13 05	67.90000063	1/14/2015 12 25	71.86999774	1/14/2015 12 55	69.62	1/14/2015 12 28	66.82000245	1/14/2015 13 00	76.54000144	1/14/2015 13 44	71.2799982	1/14/2015 13 59	73.44000205	1/14/2015 13 48	70.29999912	1/14/2015 13 01	73.98000277	1/14/2015 12 11	73.65
1/14/2015 14 44	70.60000243	1/14/2015 14 00	68.63000064	1/14/2015 13 02	71.67999775	1/14/2015 13 13	70.54	1/14/2015 13 13	66.66000244	1/14/2015 14 00	76.54000144	1/14/2015 14 47	71.3199982	1/14/2015 14 21	73.32000205	1/14/2015 14 48	70.59999912	1/14/2015 14 26	73.86000276	1/14/2015 13 46	73.22
1/14/2015 15 37	71.30000246	1/14/2015 15 52	68.88000064	1/14/2015 14 48	72.01999774	1/14/2015 14 03	70.51	1/14/2015 14 48	67.40000247	1/14/2015 15 00	76.54000144	1/14/2015 15 10	71.0699982	1/14/2015 15 17	73.56000206	1/14/2015 15 51	70.47999912	1/14/2015 15 45	74.10000277	1/14/2015 14 43	73.96
1/14/2015 16 39	70.33000243	1/14/2015 16 58	68.05000063	1/14/2015 15 23	71.89999774	1/14/2015 15 11	70.69	1/14/2015 15 07	67.70000248	1/14/2015 16 00	76.54000144	1/14/2015 16 40	71.0999982	1/14/2015 16 56	73.38000205	1/14/2015 16 43	69.77999913	1/14/2015 16 44	73.46000275	1/14/2015 15 23	73.53
1/14/2015 17 47	69.99000241	1/14/2015 17 16	67.02000062	1/14/2015 16 37	72.07999773	1/14/2015 16 39	70.45	1/14/2015 16 00	67.33000247	1/14/2015 17 00	76.54000144	1/14/2015 17 39	71.43999819	1/14/2015 17 03	73.44000205	1/14/2015 17 44	68.79999914	1/14/2015 17 23	72.88000273	1/14/2015 16 59	73.56
1/14/2015 18 22	69.6500024	1/14/2015 18 17	66.86000062	1/14/2015 17 33	71.37999776	1/14/2015 17 47	69.56	1/14/2015 17 12	67.24000246	1/14/2015 18 00	76.54000144	1/14/2015 18 21	71.43999819	1/14/2015 18 31	73.38000205	1/14/2015 18 14	68.00999915	1/14/2015 18 29	72.45000271	1/14/2015 17 48	72.52
1/14/2015 19 07	70.97000245	1/14/2015 19 21	67.50000063	1/14/2015 18 47	71.49999775	1/14/2015 18 26	70.11	1/14/2015 18 22	67.27000247	1/14/2015 19 00	76.54000144	1/14/2015 19 00	71.82999818	1/14/2015 19 19	73.50000206	1/14/2015 19 31	68.48999914	1/14/2015 19 05	72.82000273	1/14/2015 18 38	73.1
1/14/2015 20 57	70.42000243	1/14/2015 20 05	66.01000061	1/14/2015 19 50	71.40999776	1/14/2015 19 11	70.05	1/14/2015 19 32	67.73000248	1/14/2015 20 00	76.54000144	1/14/2015 20 57	71.67999819	1/14/2015 20 49	73.62000206	1/14/2015 20 05	68.45999914	1/14/2015 20 33	72.79000272	1/14/2015 19 17	72.68
1/14/2015 21 05	70.94000245	1/14/2015 21 01	67.02000062	1/14/2015 20 49	71.79999774	1/14/2015 20 11	70.54	1/14/2015 20 07	67.49000247	1/14/2015 21 00	76.54000144	1/14/2015 21 05	71.1899982	1/14/2015 21 27	73.41000205	1/14/2015 21 05	69.34999913	1/14/2015 21 25	72.97000273	1/14/2015 20 51	72.83
1/14/2015 22 02	71.67000247	1/14/2015 22 03	68.82000064	1/14/2015 21 26	71.37999776	1/14/2015 21 05	70.23	1/14/2015 21 01	67.03000246	1/14/2015 22 00	76.54000144	1/14/2015 22 30	71.1599982	1/14/2015 22 31	71.15000199	1/14/2015 22 30	69.37999913	1/14/2015 22 31	73.55000275	1/14/2015 21 31	73.44
1/14/2015 23 48	69.38000239	1/14/2015 23 47	69.67000065	1/14/2015 22 30	68.53999784	1/14/2015 22 31	68.28	1/14/2015 22 31	67.70000248	1/14/2015 23 00	76.54000144	1/14/2015 23 47	65.72999833	1/14/2015 23 48	69.87000195	1/14/2015 23 48	68.79999914	1/14/2015 23 48	73.43000275	1/14/2015 22 07	74.17
1/15/2015 0 08	70.33000243	1/15/2015 0 09	71.05000066	1/14/2015 23 48	68.10999786	1/14/2015 23 47	64.07	1/14/2015 23 48	62.54000229	1/15/2015 0 00	76.54000144	1/15/2015 0 09	70.21999822	1/15/2015 0 10	73.77000206	1/15/2015 0 09	71.7599991	1/15/2015 0 02	75.23000281	1/14/2015 23 47	74.32
1/15/2015 1 22	74.08000255	1/15/2015 1 26	71.05000066	1/15/2015 0 05	73.01999771	1/15/2015 0 04	70.97	1/15/2015 0 08	66.08000242	1/15/2015 1 00	76.54000144	1/15/2015 1 22	71.52999819	1/15/2015 1 23	74.60000209	1/15/2015 1 22	72.30999909	1/15/2015 1 23	75.05000281	1/15/2015 0 31	74.87
1/15/2015 2 32	74.84000258	1/15/2015 2 00	71.47000066	1/15/2015 1 23	72.98999771	1/15/2015 1 22	71.24	1/15/2015 1 22	67.76000248	1/15/2015 2 00	76.54000144	1/15/2015 2 18	71.89999818	1/15/2015 2 32	74.78000209	1/15/2015 2 43	72.76999909	1/15/2015 2 41	75.57000283	1/15/2015 1 22	75.09
1/15/2015 3 30	74.84000258	1/15/2015 3 29	71.29000066	1/15/2015 2 31	73.50999769	1/15/2015 2 20	71.55	1/15/2015 2 16	69.32000254	1/15/2015 3 00	76.54000144	1/15/2015 3 29	72.50999817	1/15/2015 3 51	75.0300021	1/15/2015 3 48	72.82999909	1/15/2015 3 27	75.51000283	1/15/2015 2 33	75.91
1/15/2015 4 13	73.59000253	1/15/2015 4 55	70.92000066	1/15/2015 3 51	74.30999767	1/15/2015 3 30	71.73	1/15/2015 3 57	69.20000254	1/15/2015 4 00	76.54000144	1/15/2015 4 54	71.43999819	1/15/2015 4 14	74.75000209	1/15/2015 4 21	72.2799991	1/15/2015 4 21	74.8300028	1/15/2015 3 27	74.69
1/15/2015 5 13	73.32000253	1/15/2015 5 58	69.15000064	1/15/2015 4 21	73.99999768	1/15/2015 4 54	71.55	1/15/2015 4 54	68.1900025	1/15/2015 5 00	76.54000144	1/15/2015 5 14	71.46999819	1/15/2015 5 59	74.29000208	1/15/2015 5 59	70.44999912	1/15/2015 5 55	73.55000275	1/15/2015 4 47	75.45
1/15/2015 6 45	70.72000244	1/15/2015 6 49	66.50000062	1/15/2015 5 59	72.89999771	1/15/2015 5 15	71.39	1/15/2015 5 13	68.07000249	1/15/2015 6 00	76.54000144	1/15/2015 6 33	71.49999819	1/15/2015 6 32	73.04000204	1/15/2015 6 46	67.45999915	1/15/2015 6 55	71.66000268	1/15/2015 5 58	73.87
1/15/2015 7 35	70.33000243	1/15/2015 7 18	66.04000061	1/15/2015 6 32	71.28999776	1/15/2015 6 54	69.99	1/15/2015 6 45	66.82000245	1/15/2015 7 00	76.54000144	1/15/2015 7 38	71.0999982	1/15/2015 7 10	72.95000204	1/15/2015 7 08	66.59999916	1/15/2015 7 12	71.48000268	1/15/2015 6 06	72.37
1/15/2015 8 04	70.45000243	1/15/2015 8 03	67.50000063	1/15/2015 7 28	70.39999779	1/15/2015 7 00	69.9	1/15/2015 7 12	66.91000245	1/15/2015 8 00	76.54000144	1/15/2015 8 07	71.2499982	1/15/2015 8 00	73.13000205	1/15/2015 8 08	68.33999914	1/15/2015 8 00	72.85000273	1/15/2015 7 07	72.8
1/15/2015 9 49	70.91000245	1/15/2015 9 57	67.69000063	1/15/2015 8 34	70.45999778	1/15/2015 8 08	69.59	1/15/2015 8 04	66.75000245	1/15/2015 9 00	76.54000144	1/15/2015 9 41	70.9499982	1/15/2015 9 45	73.13000205	1/15/2015 9 01	69.58999913	1/15/2015 9 01	73.09000274	1/15/2015 8 03	73.35
1/15/2015 10 30	70.69000244	1/15/2015 10 21	67.81000063	1/15/2015 9 42	71.49999775	1/15/2015 9 48	70.42	1/15/2015 9 22	67.46000247	1/15/2015 10 00	76.54000144	1/15/2015 10 02	71.37999819	1/15/2015 10 42	73.38000205	1/15/2015 10 32	69.64999913	1/15/2015 10 03	73.43000275	1/15/2015 9 22	73.65
1/15/2015 11 13	71.24000246	1/15/2015 11 13	67.87000063	1/15/2015 10 55	72.10999773	1/15/2015 10 00	70.57	1/15/2015 10 30	66.94000245	1/15/2015 11 00	76.54000144	1/15/2015 11 13	70.88999821	1/15/2015 11 24	73.47000206	1/15/2015 11 41	69.98999912	1/15/2015 11 08	73.40000275	1/15/2015 10 58	73.41
1/15/2015 12 42	70.54000243	1/15/2015 12 00	68.18000063	1/15/2015 11 20	71.06999777	1/15/2015 11 34	70.29	1/15/2015 11 58	67.46000247	1/15/2015 12 00	76.54000144	1/15/2015 12 47	71.3199982	1/15/2015 12 59	72.68000203	1/15/2015 12 43	70.07999912	1/15/2015 12 24	73.49000275	1/15/2015 11 15	73.35
1/15/2015 13 00	71.33000246	1/15/2015 13 10	68.18000063	1/15/2015 12 59	71.03999777	1/15/2015 12 00	70.72	1/15/2015 12 48	67.15000246	1/15/2015 13 00	76.54000144	1/15/2015 13 19	71.43999819	1/15/2015 13 00	72.68000203	1/15/2015 13 14	70.04999912	1/15/2015 13 34	74.10000277	1/15/2015 12 19	73.8
1/15/2015 14 00	71.49000246	1/15/2015 14 10	68.54000064	1/15/2015 13 00	71.03999777	1/15/2015 13 49	70.48	1/15/2015 13 50	67.43000247	1/15/2015 14 00	76.54000144	1/15/2015 14 06	71.2199982	1/15/2015 14 20	73.26000205	1/15/2015 14 50	70.13999912	1/15/2015 14 06	74.07000277	1/15/2015 13 57	73.74
1/15/2015 15 49	71.61000247	1/15/2015 15 56	67.84000063	1/15/2015 14 17	71.73999775	1/15/2015 14 51	70.9	1/15/2015 14 51	67.40000247	1/15/2015 15 00	76.54000144	1/15/2015 15 56	70.9499982	1/15/2015 15 43	73.62000206	1/15/2015 15 56	70.29999912	1/15/2015 15 46	73.95000277	1/15/2015 14 54	73.8
1/15/2015 16 30	71.70000247	1/15/2015 16 22	67.41000063	1/15/2015 15 15	72.19999773	1/15/2015 15 59	70.66	1/15/2015 15 49	67.33000247	1/15/2015 16 00	76.54000144	1/15/2015 16 31	71.52999819	1/15/2015 16 57	73.53000206	1/15/2015 16 28	69.86999912	1/15/2015 16 16	73.58000275	1/15/2015 15 56	73.74
1/15/2015 17 52	70.51000243	1/15/2015 17 49	66.74000062	1/15/2015 16 37	72.59999772	1/15/2015 16 00	70.66	1/15/2015 16 05	67.67000248	1/15/2015 17 00	76.54000144	1/15/2015 17 04	71.1599982	1/15/2015 17 53	73.10000205	1/15/2015 17 53	68.82999914	1/15/2015 17 56	72.64000272	1/15/2015 16 36	73.22
1/15/2015 18 23	70.11000242	1/15/2015 18 32	66.13000061	1/15/2015 17 53	70.54999778	1/15/2015 17 15	69.99	1/15/2015 17 16	67.06000246	1/15/2015 18 00	76.54000144	1/15/2015 18 23	70.85999821	1/15/2015 18 28	73.26000205	1/15/2015 18 30	68.09999915	1/15/2015 18 56	72.64000272	1/15/2015 17 39	72.86
1/15/2015 19 23	69.10000238	1/15/2015 19 08	66.34000062	1/15/2015 18 33	71.40999776	1/15/2015 18 15	70.11	1/15/2015 18 23	67.06000246	1/15/2015 19 00	76.54000144	1/15/2015 19 12	70.82999821	1/15/2015 19 27	73.23000205	1/15/2015 19 04	68.42999914	1/15/2015 19 35	72.0600027	1/15/2015 18 01	72.58
1/15/2015 20 06	71.39000246	1/15/2015 20 07	66.53000062	1/15/2015 19 52	71.43999775	1/15/2015 19 27	70.26	1/15/2015 19 13	67.30000247	1/15/2015 20 00	76.54000144	1/15/2015 20 07	71.49999819	1/15/2015 20 03	73.29000205	1/15/2015 20 16	68.55999914	1/15/2015 20 15	72.76000272	1/15/2015 19 46	72.55
1/15/2015 21 06	70.05000242	1/15/2015 21 02	66.95000062	1/15/2015 20 43	71.40999776	1/15/2015 20 45	70.2	1/15/2015 20 41	67.64000248	1/15/2015 21 00	76.54000144	1/15/2015 21 01	71.52999819	1/15/2015 21 14	73.01000204	1/15/2015 21 14	68.03999915	1/15/2015 21 14	72.33000271	1/15/2015 20 16	73.47
1/15/2015 22 39	72.71000251	1/15/2015 22 11	67.57000063	1/15/2015 21 58	71.89999774	1/15/2015 21 14	70.42	1/15/2015 21 02	67.43000247	1/15/2015 22 00	76.54000144	1/15/2015 22 10	71.79999818	1/15/2015 22 14	73.65000206	1/15/2015 22 10	69.49999913	1/15/2015 22 12	73.58000275	1/15/2015 21 13	72.71
1/15/2015 23 47	72.4600025	1/15/2015 23 47	69.73000065	1/15/2015 22 45	70.73999778	1/15/2015 22 43	70.26	1/15/2015 22 10	67.98000249	1/15/2015 23 00	76.54000144	1/15/2015 23 46	69.26999825	1/15/2015 23 13	74.39000208	1/15/2015 23 47	71.29999911	1/15/2015 23 47	74.44000279	1/15/2015 22 11	73.38
1/16/2015 0 38	72.83000251	1/16/2015 0 00	70.95000066	1/15/2015 23 16	72.98999771	1/15/2015 23 46	69.35	1/15/2015 23 47	66.17000243	1/16/2015 0 00	76.54000144	1/16/2015 0 37	71.3499982	1/16/2015 0 21	74.72000209	1/16/2015 0 01	72.2499991	1/16/2015 0 00	74.9300028	1/15/2015 23 07	74.32
1/16/2015 1 15	74.11000255	1/16/2015 1 19	70.98000066	1/16/2015 0 01	73.2399977	1/16/2015 0 38	71.24	1/16/2015 0 05	68.1900025	1/16/2015 1 00	76.54000144	1/16/2015 1 18	71.82999818	1/16/2015 1 12	75.0000021	1/16/2015 1 13	72.42999909	1/16/2015 1 12	75.54000283	1/16/2015 0 07	74.96
1/16/2015 2 33	75.06000258	1/16/2015 2 08	71.81000067	1/16/2015 1 19	73.2399977	1/16/2015 1 15	71.82	1/16/2015 1 24	69.11000253	1/16/2015 2 00	76.54000144	1/16/2015 2 01	72.28999817	1/16/2015 2 20	75.0300021	1/16/2015 2 02	72.61999909	1/16/2015 2 02	75.35000282	1/16/2015 1 23	75.7
1/16/2015 3 19	74.93000258	1/16/2015 3 20	72.05000067	1/16/2015 2 53	73.93999768	1/16/2015 2 54	72.37	1/16/2015 2 07	69.65000255	1/16/2015 3 00	76.54000144	1/16/2015 3 15	73.35999815	1/16/2015 3 18	75.27000211	1/16/2015 3 59	73.19999908	1/16/2015 3 46	75.87000284	1/16/2015 2 01	75.73
1/16/2015 4 35	74.54000257	1/16/2015 4 51	70.68000066	1/16/2015 3 58	73.44999769	1/16/2015 3 00	72.37	1/16/2015 3 02	69.84000256	1/16/2015 4 00	76.54000144	1/16/2015 4 22	72.50999817	1/16/2015 4 35	75.1500021	1/16/2015 4 23	72.48999909	1/16/2015 4 35	75.63000283	1/16/2015 3 46	76.03
1/16/2015 5 18	72.34000249	1/16/2015 5 50	69.00000064	1/16/2015 4 00	73.44999769	1/16/2015 4 22	71.48	1/16/2015 4 47	69.50000255	1/16/2015 5 00	76.54000144	1/16/2015 5 18	71.1299982	1/16/2015 5 33	74.45000208	1/16/2015 5 59	70.83999911	1/16/2015 5 38	74.38000278	1/16/2015 4 23	75.54
1/16/2015 6 51	70.54000243	1/16/2015 6 55	66.68000062	1/16/2015 5 18	72.80999771	1/16/2015 5 22	70.94	1/16/2015 5 18	67.18000246	1/16/2015 6 00	76.54000144	1/16/2015 6 08	71.3499982	1/16/2015 6 53	73.47000206	1/16/2015 6 54	67.48999915	1/16/2015 6 52	72.0600027	1/16/2015 5 18	74.32
1/16/2015 7 36	70.14000242	1/16/2015 7 12	66.16000061	1/16/2015 6 33	71.15999776	1/16/2015 6 51	70.23	1/16/2015 6 08	67.12000246	1/16/2015 7 00	76.54000144	1/16/2015 7 33	71.2799982	1/16/2015 7 36	72.89000204	1/16/2015 7 13	66.44999916	1/16/2015 7 12	71.02000266	1/16/2015 6 42	73.1
1/16/2015 8 11	69.75000241	1/16/2015 8 19	67.11000062	1/16/2015 7 02	71.31999776	1/16/2015 7 34	69.74	1/16/2015 7 36	66.94000245	1/16/2015 8 00	76.54000144	1/16/2015 8 58	71.1599982	1/16/2015 8 15	73.01000204	1/16/2015 8 02	68.39999914	1/16/2015 8 03	72.88000273	1/16/2015 7 37	72.74
1/16/2015 9 38	70.66000244	1/16/2015 9 30	66.34000062	1/16/2015 8 13	71.43999775	1/16/2015 8 21	70.57	1/16/2015 8 11	66.51000244	1/16/2015 9 00	76.54000144	1/16/2015 9 02	71.46999819	1/16/2015 9 28	73.01000204	1/16/2015 9 00	69.06999913	1/16/2015 9 02	73.09000274	1/16/2015 8 10	73.07
1/16/2015 10 29	70.97000245	1/16/2015 10 44	67.78000063	1/16/2015 9 28	71.43999775	1/16/2015 9 15	70.39	1/16/2015 9 36	67.27000247	1/16/2015 10 00	76.54000144	1/16/2015 10 16	71.3499982	1/16/2015 10 06	73.10000205	1/16/2015 10 51	69.55999913	1/16/2015 10 20	73.16000274	1/16/2015 9 06	73.59
1/16/2015 11 35	70.08000242	1/16/2015 11 34	67.99000063	1/16/2015 10 50	70.21999779	1/16/2015 10 56	70.36	1/16/2015 10 41	67.30000247	1/16/2015 11 00	76.54000144	1/16/2015 11 52	71.3499982	1/16/2015 11 32	73.04000204	1/16/2015 11 33	66.50999916	1/16/2015 11 12	73.67000276	1/16/2015 10 20	73.35
1/16/2015 12 10	71.06000245	1/16/2015 12 41	67.44000063	1/16/2015 11 00	71.49999775	1/16/2015 11 00	70.36	1/16/2015 11 08	67.37000247	1/16/2015 12 00	76.54000144	1/16/2015 12 43	71.0999982	1/16/2015 12 57	73.26000205	1/16/2015 12 16	69.86999912	1/16/2015 12 40	73.67000276	1/16/2015 11 25	73.41
1/16/2015 13 07	70.87000244	1/16/2015 13 20	67.90000063	1/16/2015 12 35	71.31999776	1/16/2015 12 53	69.93	1/16/2015 12 57	66.91000245	1/16/2015 13 00	76.54000144	1/16/2015 13 56	71.2799982	1/16/2015 13 14	73.01000204	1/16/2015 13 11	69.98999912	1/16/2015 13 27	73.46000275	1/16/2015 12 08	73.93
1/16/2015 14 32	70.51000243	1/16/2015 14 24	68.54000064	1/16/2015 13 27	71.03999777	1/16/2015 13 20	70.26	1/16/2015 13 08	66.97000245	1/16/2015 14 00	76.54000144	1/16/2015 14 16	71.58999819	1/16/2015 14 01	73.68000206	1/16/2015 14 05	69.98999912	1/16/2015 14 05	73.77000276	1/16/2015 13 09	73.26
1/16/2015 15 48	71.36000246	1/16/2015 15 00	68.54000064	1/16/2015 14 20	71.46999775	1/16/2015 14 01	70.75	1/16/2015 14 32	67.15000246	1/16/2015 15 00	76.54000144	1/16/2015 15 14	70.88999821	1/16/2015 15 09	74.14000207	1/16/2015 15 59	69.83999912	1/16/2015 15 49	73.80000276	1/16/2015 14 36	73.62
1/16/2015 16 48	70.02000242	1/16/2015 16 34	67.81000063	1/16/2015 15 17	71.55999775	1/16/2015 15 01	70.26	1/16/2015 15 56	67.37000247	1/16/2015 16 00	76.54000144	1/16/2015 16 12	70.57999821	1/16/2015 16 32	73.13000205	1/16/2015 16 55	69.34999913	1/16/2015 16 13	73.22000274	1/16/2015 15 17	73.8
1/16/2015 17 00	71.49000246	1/16/2015 17 32	67.11000062	1/16/2015 16 06	71.95999774	1/16/2015 16 52	70.14	1/16/2015 16 52	67.33000247	1/16/2015 17 00	76.54000144	1/16/2015 17 53	71.58999819	1/16/2015 17 32	73.53000206	1/16/2015 17 56	68.82999914	1/16/2015 17 53	72.82000273	1/16/2015 16 12	73.62
1/16/2015 18 20	71.12000245	1/16/2015 18 26	67.53000063	1/16/2015 17 55	71.18999776	1/16/2015 17 21	70.11	1/16/2015 17 23	67.67000248	1/16/2015 18 00	76.54000144	1/16/2015 18 25	71.2799982	1/16/2015 18 17	73.47000206	1/16/2015 18 16	68.64999914	1/16/2015 18 26	72.67000272	1/16/2015 17 10	72.89
1/16/2015 19 04	71.64000247	1/16/2015 19 32	68.42000064	1/16/2015 18 04	71.52999775	1/16/2015 18 08	70.14	1/16/2015 18 16	67.70000248	1/16/2015 19 00	76.54000144	1/16/2015 19 04	71.3499982	1/16/2015 19 31	73.77000206	1/16/2015 19 01	69.31999913	1/16/2015 19 09	72.97000273	1/16/2015 18 26	73.13
1/16/2015 20 26	72.07000248	1/16/2015 20 08	68.69000064	1/16/2015 19 57	71.89999774	1/16/2015 19 18	70.87	1/16/2015 19 04	67.82000249	1/16/2015 20 00	76.54000144	1/16/2015 20 04	71.46999819	1/16/2015 20 26	73.62000206	1/16/2015 20 17	69.55999913	1/16/2015 20 17	73.03000273	1/16/2015 19 00	73.16
1/16/2015 21 26	69.84000241	1/16/2015 21 19	68.27000063	1/16/2015 20 17	71.52999775	1/16/2015 20 18	70.26	1/16/2015 20 26	67.33000247	1/16/2015 21 00	76.54000144	1/16/2015 21 58	71.82999818	1/16/2015 21 15	73.29000205	1/16/2015 21 16	69.25999913	1/16/2015 21 59	73.28000274	1/16/2015 20 21	73.74
1/16/2015 22 36	71.76000247	1/16/2015 22 11	68.51000064	1/16/2015 21 58	71.67999775	1/16/2015 21 59	69.93	1/16/2015 21 38	67.88000249	1/16/2015 22 00	76.54000144	1/16/2015 22 28	71.73999819	1/16/2015 22 11	73.44000205	1/16/2015 22 11	69.71999913	1/16/2015 22 00	73.28000274	1/16/2015 21 03	73.44
1/16/2015 23 42	72.19000249	1/16/2015 23 00	70.13000065	1/16/2015 22 00	71.67999775	1/16/2015 22 00	69.93	1/16/2015 22 11	67.76000248	1/16/2015 23 00	76.54000144	1/16/2015 23 42	68.22999827	1/16/2015 23 42	72.80000204	1/16/2015 23 43	70.07999912	1/16/2015 23 42	74.13000277	1/16/2015 22 11	73.77
1/17/2015 0 00	72.80000251	1/17/2015 0 00	70.77000066	1/16/2015 23 54	72.19999773	1/16/2015 23 44	70.39	1/16/2015 23 44	66.39000243	1/17/2015 0 00	76.54000144	1/17/2015 0 01	70.60999821	1/17/2015 0 09	74.69000209	1/17/2015 0 02	71.8199991	1/17/2015 0 46	75.02000281	1/16/2015 23 00	74.2
1/17/2015 1 33	74.23000256	1/17/2015 1 44	71.20000066	1/17/2015 0 05	73.1199977	1/17/2015 0 00	70.69	1/17/2015 0 02	67.58000248	1/17/2015 1 00	76.54000144	1/17/2015 1 32	72.04999818	1/17/2015 1 36	75.0000021	1/17/2015 1 05	72.54999909	1/17/2015 1 37	75.32000282	1/17/2015 0 05	74.29
1/17/2015 2 26	74.90000258	1/17/2015 2 24	71.87000067	1/17/2015 1 19	73.78999768	1/17/2015 1 33	71.39	1/17/2015 1 00	68.59000251	1/17/2015 2 00	76.54000144	1/17/2015 2 00	72.98999816	1/17/2015 2 00	75.0300021	1/17/2015 2 49	72.91999909	1/17/2015 2 03	75.72000283	1/17/2015 1 00	75.42
1/17/2015 3 38	74.29000256	1/17/2015 3 43	71.44000066	1/17/2015 2 33	74.11999767	1/17/2015 2 03	72.13	1/17/2015 2 00	69.38000254	1/17/2015 3 00	76.54000144	1/17/2015 3 42	72.04999818	1/17/2015 3 39	75.0300021	1/17/2015 3 43	72.79999909	1/17/2015 3 43	75.41000282	1/17/2015 2 07	75.88
1/17/2015 4 34	73.19000252	1/17/2015 4 42	71.66000067	1/17/2015 3 26	73.96999768	1/17/2015 3 42	71.64	1/17/2015 3 43	68.49000251	1/17/2015 4 00	76.54000144	1/17/2015 4 34	72.10999818	1/17/2015 4 49	74.84000209	1/17/2015 4 42	72.61999909	1/17/2015 4 43	75.35000282	1/17/2015 3 33	75.91
1/17/2015 5 52	74.51000257	1/17/2015 5 45	71.23000066	1/17/2015 4 49	73.53999769	1/17/2015 4 42	71.06	1/17/2015 4 34	68.1300025	1/17/2015 5 00	76.54000144	1/17/2015 5 56	72.47999817	1/17/2015 5 12	75.1500021	1/17/2015 5 59	72.51999909	1/17/2015 5 33	75.02000281	1/17/2015 4 34	75
1/17/2015 6 56	73.74000254	1/17/2015 6 39	70.80000066	1/17/2015 5 32	73.99999768	1/17/2015 5 19	72.13	1/17/2015 5 56	68.71000252	1/17/2015 6 00	76.54000144	1/17/2015 6 57	71.2799982	1/17/2015 6 27	74.9000021	1/17/2015 6 58	71.9099991	1/17/2015 6 58	74.9600028	1/17/2015 5 46	75.33
1/17/2015 7 06	72.25000249	1/17/2015 7 48	69.00000064	1/17/2015 6 06	73.78999768	1/17/2015 6 56	71.27	1/17/2015 6 56	67.73000248	1/17/2015 7 00	76.54000144	1/17/2015 7 24	70.24999822	1/17/2015 7 42	74.39000208	1/17/2015 7 38	70.13999912	1/17/2015 7 37	73.61000275	1/17/2015 6 53	74.78
1/17/2015 8 53	72.03000248	1/17/2015 8 47	67.60000063	1/17/2015 7 33	72.01999774	1/17/2015 7 29	70.51	1/17/2015 7 06	66.51000244	1/17/2015 8 00	76.54000144	1/17/2015 8 26	72.01999818	1/17/2015 8 53	73.68000206	1/17/2015 8 58	68.51999914	1/17/2015 8 51	72.88000273	1/17/2015 7 59	73.59
1/17/2015 9 02	69.90000241	1/17/2015 9 59	66.10000061	1/17/2015 8 41	72.10999773	1/17/2015 8 33	70.26	1/17/2015 8 41	68.01000249	1/17/2015 9 00	76.54000144	1/17/2015 9 01	71.2799982	1/17/2015 9 47	73.38000205	1/17/2015 9 38	67.42999915	1/17/2015 9 28	71.90000269	1/17/2015 8 00	73.59

1/17/2015 11 42	69.5000024	
1/17/2015 12 01	70.48000243	
1/17/2015 13 58	70.66000244	
1/17/2015 14 00	70.66000244	
1/17/2015 15 10	71.52000247	
1/17/2015 16 06	71.61000247	
1/17/2015 17 12	71.39000246	
1/17/2015 18 48	71.67000247	
1/17/2015 19 25	72.25000249	
1/17/2015 20 07	72.10000248	
1/17/2015 21 23	72.6500025	
1/17/2015 22 27	73.32000253	
1/17/2015 23 41	70.91000245	
1/18/2015 0 01	72.5200025	
1/18/2015 1 07	74.08000255	
1/18/2015 2 48	74.72000257	
1/18/2015 3 52	75.24000259	
1/18/2015 4 41	75.4800026	
1/18/2015 5 29	74.75000257	
1/18/2015 6 57	73.74000254	
1/18/2015 7 20	72.4300025	
1/18/2015 8 26	72.4600025	
1/18/2015 9 46	70.91000245	
1/18/2015 10 09	69.96000241	
1/18/2015 11 43	63.91000221	A
1/18/2015 12 31	63.82000221	A
1/18/2015 13 06	65.14000225	
1/18/2015 14 03	66.20000229	
1/18/2015 15 52	70.60000243	
1/18/2015 16 36	71.03000245	
1/18/2015 17 00	70.78000244	
1/18/2015 18 04	71.15000245	
1/18/2015 19 35	70.81000244	
1/18/2015 20 59	70.94000245	
1/18/2015 21 00	70.94000245	
1/18/2015 22 00	72.86000251	
1/18/2015 23 34	66.33000229	
1/19/2015 0 05	70.63000244	
1/19/2015 1 37	73.10000252	
1/19/2015 2 29	74.72000257	
1/19/2015 3 14	74.17000255	
1/19/2015 4 38	74.87000258	
1/19/2015 5 15	72.6100025	
1/19/2015 6 46	71.94000248	
1/19/2015 7 31	70.87000244	
1/19/2015 8 23	71.30000246	
1/19/2015 9 47	71.24000246	
1/19/2015 10 51	71.39000246	
1/19/2015 11 01	70.63000244	
1/19/2015 12 22	70.45000243	
1/19/2015 13 56	71.12000245	
1/19/2015 14 42	71.88000248	
1/19/2015 15 04	70.94000245	
1/19/2015 16 00	69.90000241	
1/19/2015 17 35	70.84000244	
1/19/2015 18 43	70.02000242	
1/19/2015 19 42	70.23000242	
1/19/2015 20 36	71.91000248	
1/19/2015 21 42	71.58000247	
1/19/2015 22 04	71.30000246	
1/19/2015 23 43	69.87000241	
1/20/2015 0 00	73.35000253	
1/20/2015 1 20	74.35000256	
1/20/2015 2 59	74.51000257	
1/20/2015 3 00	74.51000257	
1/20/2015 4 54	74.81000258	
1/20/2015 5 39	72.13000249	
1/20/2015 6 57	70.29000242	
1/20/2015 7 00	70.29000242	
1/20/2015 8 05	70.26000242	
1/20/2015 9 50	71.27000246	
1/20/2015 10 27	67.79000234	
1/20/2015 11 52	69.6800024	
1/20/2015 12 00	70.48000243	
1/20/2015 13 31	70.33000243	
1/20/2015 14 30	71.55000247	
1/20/2015 15 51	71.36000246	
1/20/2015 16 17	70.69000244	
1/20/2015 17 54	70.84000244	
1/20/2015 18 54	70.26000242	
1/20/2015 19 58	70.78000244	
1/20/2015 20 00	70.78000244	
1/20/2015 21 32	72.07000248	
1/20/2015 22 26	71.67000247	
1/20/2015 23 28	69.32000239	
1/21/2015 0 01	72.00000248	
1/21/2015 1 17	72.92000251	
1/21/2015 2 25	73.84000254	
1/21/2015 3 37	74.29000256	
1/21/2015 4 57	73.23000252	
1/21/2015 5 49	71.73000247	
1/21/2015 6 26	71.21000246	
1/21/2015 7 29	70.48000243	
1/21/2015 8 02	69.26000239	

1/17/2015 11 42	65.34000061	
1/17/2015 12 28	66.25000061	
1/17/2015 13 31	66.71000062	
1/17/2015 14 30	67.57000063	
1/17/2015 15 29	67.90000063	
1/17/2015 16 39	67.60000063	
1/17/2015 17 33	67.32000062	
1/17/2015 18 26	68.21000063	
1/17/2015 19 01	68.21000063	
1/17/2015 20 48	69.06000064	
1/17/2015 21 29	69.24000064	
1/17/2015 22 02	69.92000065	
1/17/2015 23 41	69.43000065	
1/18/2015 0 00	70.34000065	
1/18/2015 1 17	71.23000066	
1/18/2015 2 07	71.75000067	
1/18/2015 3 14	71.75000067	
1/18/2015 4 04	72.27000067	
1/18/2015 5 43	71.81000067	
1/18/2015 6 03	71.23000066	
1/18/2015 7 41	69.49000065	
1/18/2015 8 58	68.08000063	
1/18/2015 9 58	65.83000061	
1/18/2015 10 31	65.0000006	
1/18/2015 11 36	41.71000038	A
1/18/2015 12 09	41.59000038	A
1/18/2015 13 11	42.99000039	A
1/18/2015 14 00	46.53000043	A
1/18/2015 15 27	66.44000062	
1/18/2015 16 36	65.70000061	
1/18/2015 17 52	65.73000061	
1/18/2015 18 50	65.34000061	
1/18/2015 19 10	65.25000061	
1/18/2015 20 42	66.59000062	
1/18/2015 21 00	66.99000062	
1/18/2015 22 51	68.30000063	
1/18/2015 23 36	67.84000063	
1/19/2015 0 01	69.03000064	
1/19/2015 1 06	71.66000067	
1/19/2015 2 33	71.75000067	
1/19/2015 3 18	72.45000067	
1/19/2015 4 54	71.78000067	
1/19/2015 5 53	68.54000064	
1/19/2015 6 46	66.22000061	
1/19/2015 7 09	65.92000061	
1/19/2015 8 02	67.26000062	
1/19/2015 9 13	67.38000063	
1/19/2015 10 49	67.38000063	
1/19/2015 11 15	67.96000063	
1/19/2015 12 28	67.63000063	
1/19/2015 13 09	68.39000064	
1/19/2015 14 37	68.69000064	
1/19/2015 15 19	68.02000063	
1/19/2015 16 12	67.41000063	
1/19/2015 17 59	66.01000061	
1/19/2015 18 36	65.55000061	
1/19/2015 19 01	66.10000061	
1/19/2015 20 06	67.17000062	
1/19/2015 21 08	67.05000062	
1/19/2015 22 05	68.48000064	
1/19/2015 23 01	69.52000065	
1/20/2015 0 28	70.19000065	
1/20/2015 1 00	70.34000065	
1/20/2015 2 05	71.78000067	
1/20/2015 3 03	70.89000066	
1/20/2015 4 55	71.26000066	
1/20/2015 5 57	68.94000064	
1/20/2015 6 17	66.92000062	
1/20/2015 7 17	65.58000061	
1/20/2015 8 02	67.32000062	
1/20/2015 9 16	67.44000063	
1/20/2015 10 22	67.69000063	
1/20/2015 11 50	67.75000063	
1/20/2015 12 48	68.18000063	
1/20/2015 13 26	68.66000064	
1/20/2015 14 48	68.88000064	
1/20/2015 15 03	68.33000063	
1/20/2015 16 03	67.90000063	
1/20/2015 17 23	66.16000061	
1/20/2015 18 18	66.41000062	
1/20/2015 19 29	67.11000062	
1/20/2015 20 09	67.20000062	
1/20/2015 21 10	68.02000063	
1/20/2015 22 07	68.88000064	
1/20/2015 23 28	68.91000064	
1/21/2015 0 06	70.07000065	
1/21/2015 1 22	70.71000066	
1/21/2015 2 52	71.63000067	
1/21/2015 3 41	71.05000066	
1/21/2015 4 57	71.23000066	
1/21/2015 5 49	68.54000064	
1/21/2015 6 59	66.34000062	
1/21/2015 7 07	66.07000061	
1/21/2015 8 03	67.38000063	

1/17/2015 10 20	69.9399978
1/17/2015 11 08	70.24999779
1/17/2015 12 47	71.18999776
1/17/2015 13 01	71.00999777
1/17/2015 14 24	69.63999781
1/17/2015 15 32	71.31999776
1/17/2015 16 35	71.12999776
1/17/2015 17 15	72.19999773
1/17/2015 18 11	71.86999774
1/17/2015 19 33	71.73999775
1/17/2015 20 08	71.55999775
1/17/2015 21 14	71.95999774
1/17/2015 22 25	73.0599977
1/17/2015 23 41	70.88999777
1/18/2015 0 09	72.92999771
1/18/2015 1 52	73.75999768
1/18/2015 2 16	73.81999768
1/18/2015 3 13	73.72999768
1/18/2015 4 51	73.99999768
1/18/2015 5 14	73.53999769
1/18/2015 6 39	73.35999769
1/18/2015 7 39	72.37999773
1/18/2015 8 54	71.76999774
1/18/2015 9 58	70.1299978
1/18/2015 10 00	70.1299978
1/18/2015 11 28	69.9699978
1/18/2015 12 22	70.63999778
1/18/2015 13 47	69.57999781
1/18/2015 14 13	70.97999777
1/18/2015 15 08	70.79999777
1/18/2015 16 56	70.63999778
1/18/2015 17 07	70.57999778
1/18/2015 18 53	70.97999777
1/18/2015 19 28	71.43999775
1/18/2015 20 00	71.55999775
1/18/2015 21 00	71.92999774
1/18/2015 22 05	72.53999772
1/18/2015 23 34	72.65999772
1/19/2015 0 01	72.28999773
1/19/2015 1 16	73.56999769
1/19/2015 2 21	73.59999769
1/19/2015 3 26	73.87999768
1/19/2015 4 58	74.21999767
1/19/2015 5 52	72.86999771
1/19/2015 6 54	71.21999776
1/19/2015 7 14	69.29999782
1/19/2015 8 10	70.79999777
1/19/2015 9 47	70.76999778
1/19/2015 10 35	70.18999779
1/19/2015 11 00	70.73999778
1/19/2015 12 21	70.24999779
1/19/2015 13 21	71.21999776
1/19/2015 14 00	71.52999775
1/19/2015 15 29	72.31999773
1/19/2015 16 48	70.0599978
1/19/2015 17 02	70.63999778
1/19/2015 18 08	71.09999776
1/19/2015 19 19	71.76999774
1/19/2015 20 42	71.12999776
1/19/2015 21 41	70.94999777
1/19/2015 22 19	69.8499978
1/19/2015 23 44	70.39999779
1/20/2015 0 02	73.78999768
1/20/2015 1 04	73.75999768
1/20/2015 2 58	73.53999769
1/20/2015 3 00	73.53999769
1/20/2015 4 05	73.3299977
1/20/2015 5 46	72.62999772
1/20/2015 6 46	71.82999774
1/20/2015 7 13	70.48999778
1/20/2015 8 00	71.49999775
1/20/2015 9 53	71.12999776
1/20/2015 10 25	70.48999778
1/20/2015 11 14	71.55999775
1/20/2015 12 01	71.76999774
1/20/2015 13 51	72.56999772
1/20/2015 14 24	71.37999776
1/20/2015 15 06	72.10999773
1/20/2015 16 21	72.04999774
1/20/2015 17 11	71.24999776
1/20/2015 18 54	70.88999777
1/20/2015 19 30	71.34999776
1/20/2015 20 23	71.12999776
1/20/2015 21 31	71.67999775
1/20/2015 22 10	72.25999773
1/20/2015 23 28	71.12999776
1/21/2015 0 02	73.66999769
1/21/2015 1 31	73.3299977
1/21/2015 2 10	73.63999769
1/21/2015 3 00	73.72999768
1/21/2015 4 14	73.38999769
1/21/2015 5 43	72.77999771
1/21/2015 6 03	71.43999775
1/21/2015 7 10	70.18999779

1/17/2015 10 47	69.41
1/17/2015 11 42	68.04
1/17/2015 12 54	69.68
1/17/2015 13 21	70.08
1/17/2015 14 51	70.29
1/17/2015 15 24	70.05
1/17/2015 16 16	70.32
1/17/2015 17 09	70.2
1/17/2015 18 40	70.57
1/17/2015 19 56	70.81
1/17/2015 20 00	71
1/17/2015 21 04	71.21
1/17/2015 22 33	71.36
1/17/2015 23 41	67.3
1/18/2015 0 01	71.3
1/18/2015 1 11	71.94
1/18/2015 2 25	72.13
1/18/2015 3 02	72.31
1/18/2015 4 02	72.37
1/18/2015 5 57	72.19
1/18/2015 6 10	71.76
1/18/2015 7 26	70.66
1/18/2015 8 38	70.57
1/18/2015 9 40	69.32
1/18/2015 10 02	69.65
1/18/2015 11 25	69.29
1/18/2015 12 45	69.5
1/18/2015 13 18	69.65
1/18/2015 14 28	69.1
1/18/2015 15 13	70.36
1/18/2015 16 36	69.65
1/18/2015 17 02	69.78
1/18/2015 18 49	70.05
1/18/2015 19 02	70.23
1/18/2015 20 59	69.93
1/18/2015 21 00	69.93
1/18/2015 22 01	70.81
1/18/2015 23 34	69.04
1/19/2015 0 42	71.55
1/19/2015 1 19	71.42
1/19/2015 2 33	71.91
1/19/2015 3 14	71.79
1/19/2015 4 59	71.97
1/19/2015 5 19	70.51
1/19/2015 6 50	70.17
1/19/2015 7 25	69.38
1/19/2015 8 12	69.41
1/19/2015 9 12	69.5
1/19/2015 10 16	69.84
1/19/2015 11 07	69.13
1/19/2015 12 22	69.13
1/19/2015 13 56	70.29
1/19/2015 14 07	70.66
1/19/2015 15 56	70.48
1/19/2015 16 39	69.93
1/19/2015 17 39	70.29
1/19/2015 18 42	69.81
1/19/2015 19 42	69.59
1/19/2015 20 23	70.2
1/19/2015 21 01	70.17
1/19/2015 22 19	69.59
1/19/2015 23 43	70.78
1/20/2015 0 24	70.84
1/20/2015 1 00	71.97
1/20/2015 2 59	71.91
1/20/2015 3 00	71.91
1/20/2015 4 56	71.79
1/20/2015 5 37	70.84
1/20/2015 6 47	69.99
1/20/2015 7 53	69.81
1/20/2015 8 01	69.04
1/20/2015 9 44	70.32
1/20/2015 10 27	68.58
1/20/2015 11 00	70.39
1/20/2015 12 35	69.62
1/20/2015 13 10	69.9
1/20/2015 14 20	70.29
1/20/2015 15 30	70.23
1/20/2015 16 21	69.44
1/20/2015 17 11	69.84
1/20/2015 18 11	69.99
1/20/2015 19 25	69.68
1/20/2015 20 53	70.2
1/20/2015 21 14	70.45
1/20/2015 22 01	70.78
1/20/2015 23 28	68.28
1/21/2015 0 01	71.48
1/21/2015 1 33	71.24
1/21/2015 2 37	71.39
1/21/2015 3 41	71.52
1/21/2015 4 22	71.61
1/21/2015 5 51	70.81
1/21/2015 6 40	69.84
1/21/2015 7 07	69.62

1/17/2015 10 24	67.18000246
1/17/2015 11 42	65.29000239
1/17/2015 12 03	67.18000246
1/17/2015 13 11	67.37000247
1/17/2015 14 23	67.73000248
1/17/2015 15 39	67.27000247
1/17/2015 16 22	67.61000248
1/17/2015 17 38	67.85000249
1/17/2015 18 26	67.85000249
1/17/2015 19 03	67.95000249
1/17/2015 20 54	68.2800025
1/17/2015 21 19	68.1000025
1/17/2015 22 02	68.46000251
1/17/2015 23 41	64.01000235
1/18/2015 0 01	67.30000247
1/18/2015 1 01	68.1300025
1/18/2015 2 03	69.26000254
1/18/2015 3 05	69.90000256
1/18/2015 4 02	69.75000256
1/18/2015 5 41	69.35000254
1/18/2015 6 59	68.3400025
1/18/2015 7 38	67.00000246
1/18/2015 8 55	67.88000249
1/18/2015 9 25	67.18000246
1/18/2015 10 01	66.75000245
1/18/2015 11 25	65.4700024
1/18/2015 12 53	65.14000239
1/18/2015 13 16	65.93000242
1/18/2015 14 28	64.01000235
1/18/2015 15 53	67.37000247
1/18/2015 16 17	67.27000247
1/18/2015 17 52	67.24000246
1/18/2015 18 08	67.30000247
1/18/2015 19 29	67.55000248
1/18/2015 20 59	66.69000244
1/18/2015 21 00	66.69000244
1/18/2015 22 18	68.46000251
1/18/2015 23 34	63.61000233
1/19/2015 0 01	68.2800025
1/19/2015 1 37	68.04000249
1/19/2015 2 29	69.59000255
1/19/2015 3 14	69.07000253
1/19/2015 4 41	69.20000254
1/19/2015 5 16	67.21000246
1/19/2015 6 40	67.61000248
1/19/2015 7 23	67.27000247
1/19/2015 8 58	66.79000245
1/19/2015 9 00	66.79000245
1/19/2015 10 45	66.94000245
1/19/2015 11 57	67.03000246
1/19/2015 12 36	66.79000245
1/19/2015 13 00	67.67000248
1/19/2015 14 21	67.52000247
1/19/2015 15 04	67.06000246
1/19/2015 16 00	66.94000245
1/19/2015 17 02	67.43000247
1/19/2015 18 43	67.09000246
1/19/2015 19 42	66.79000245
1/19/2015 20 40	67.61000248
1/19/2015 21 42	67.30000247
1/19/2015 22 04	67.46000247
1/19/2015 23 43	64.77000237
1/20/2015 0 00	67.76000248
1/20/2015 1 32	67.98000249
1/20/2015 2 34	69.26000254
1/20/2015 3 34	68.68000252
1/20/2015 4 56	69.20000254
1/20/2015 5 37	66.97000245
1/20/2015 6 58	67.03000246
1/20/2015 7 35	66.27000243
1/20/2015 8 14	66.69000244
1/20/2015 9 30	67.09000246
1/20/2015 10 28	64.31000236
1/20/2015 11 15	66.82000245
1/20/2015 12 31	66.82000245
1/20/2015 13 31	66.45000244
1/20/2015 14 31	67.27000247
1/20/2015 15 47	67.09000246
1/20/2015 16 26	67.12000246
1/20/2015 17 54	67.00000246
1/20/2015 18 23	66.97000245
1/20/2015 19 58	67.15000246
1/20/2015 20 18	67.06000246
1/20/2015 21 26	67.55000248
1/20/2015 22 26	67.40000247
1/20/2015 23 28	64.04000235
1/21/2015 0 01	67.27000247
1/21/2015 1 17	68.07000249
1/21/2015 2 11	68.62000252
1/21/2015 3 33	68.40000251
1/21/2015 4 57	67.88000249
1/21/2015 5 49	66.27000243
1/21/2015 6 26	67.49000247
1/21/2015 7 30	66.75000245

1/17/2015 11 00	76.54000144
1/17/2015 12 00	76.54000144
1/17/2015 13 00	76.54000144
1/17/2015 14 00	76.54000144
1/17/2015 15 00	76.54000144
1/17/2015 16 00	76.54000144
1/17/2015 17 00	76.54000144
1/17/2015 18 00	76.54000144
1/17/2015 19 00	76.54000144
1/17/2015 20 00	76.54000144
1/17/2015 21 00	76.54000144
1/17/2015 22 00	76.54000144
1/17/2015 23 00	76.54000144
1/18/2015 0 00	76.54000144
1/18/2015 1 00	76.54000144
1/18/2015 2 00	76.54000144
1/18/2015 3 00	76.54000144
1/18/2015 4 00	76.54000144
1/18/2015 5 00	76.54000144
1/18/2015 6 00	76.54000144
1/18/2015 7 00	76.54000144
1/18/2015 8 00	76.54000144
1/18/2015 9 00	76.54000144
1/18/2015 10 00	76.54000144
1/18/2015 11 00	76.54000144
1/18/2015 12 00	76.54000144
1/18/2015 13 00	76.54000144
1/18/2015 14 00	76.54000144
1/18/2015 15 00	76.54000144
1/18/2015 16 00	76.54000144
1/18/2015 17 00	76.54000144
1/18/2015 18 00	76.54000144
1/18/2015 19 00	76.54000144
1/18/2015 20 00	76.54000144
1/18/2015 21 00	76.54000144
1/18/2015 22 00	76.54000144
1/18/2015 23 00	76.54000144
1/19/2015 0 00	76.54000144
1/19/2015 1 00	76.54000144
1/19/2015 2 00	76.54000144
1/19/2015 3 00	76.54000144
1/19/2015 4 00	76.54000144
1/19/2015 5 00	76.54000144
1/19/2015 6 00	76.54000144
1/19/2015 7 00	76.54000144
1/19/2015 8 00	76.54000144
1/19/2015 9 00	76.54000144
1/19/2015 10 00	76.54000144
1/19/2015 11 00	76.54000144
1/19/2015 12 00	76.54000144
1/19/2015 13 00	76.54000144
1/19/2015 14 00	76.54000144
1/19/2015 15 00	76.54000144
1/19/2015 16 00	76.54000144
1/19/2015 17 00	76.54000144
1/19/2015 18 00	76.54000144
1/19/2015 19 00	76.54000144
1/19/2015 20 00	76.54000144
1/19/2015 21 00	76.54000144
1/19/2015 22 00	76.54000144
1/19/2015 23 00	76.54000144
1/20/2015 0 00	76.54000144
1/20/2015 1 00	76.54000144
1/20/2015 2 00	76.54000144
1/20/2015 3 00	76.54000144
1/20/2015 4 00	76.54000144
1/20/2015 5 00	76.54000144
1/20/2015 6 00	76.54000144
1/20/2015 7 00	76.54000144
1/20/2015 8 00	76.54000144
1/20/2015 9 00	76.54000144
1/20/2015 10 00	76.54000144
1/20/2015 11 00	76.54000144
1/20/2015 12 00	76.54000144
1/20/2015 13 00	76.54000144
1/20/2015 14 00	76.54000144
1/20/2015 15 00	76.54000144
1/20/2015 16 00	76.54000144
1/20/2015 17 00	76.54000144
1/20/2015 18 00	76.54000144
1/20/2015 19 00	76.54000144
1/20/2015 20 00	76.54000144
1/20/2015 21 00	76.54000144
1/20/2015 22 00	76.54000144
1/20/2015 23 00	76.54000144
1/21/2015 0 00	76.54000144
1/21/2015 1 00	76.54000144
1/21/2015 2 00	76.54000144
1/21/2015 3 00	76.54000144
1/21/2015 4 00	76.54000144
1/21/2015 5 00	76.54000144
1/21/2015 6 00	76.54000144
1/21/2015 7 00	76.54000144
1/21/2015 8 00	76.54000144

1/17/2015 11 41	68.50999826
1/17/2015 12 04	71.89999818
1/17/2015 13 02	71.64999819
1/17/2015 14 32	71.73999819
1/17/2015 15 18	71.92999818
1/17/2015 16 34	71.82999818
1/17/2015 17 10	71.89999818
1/17/2015 18 51	72.10999818
1/17/2015 19 14	72.16999818
1/17/2015 20 22	72.22999817
1/17/2015 21 19	72.01999818
1/17/2015 22 03	71.98999818
1/17/2015 23 41	67.86999828
1/18/2015 0 01	71.2499982
1/18/2015 1 02	72.13999818
1/18/2015 2 02	72.74999816
1/18/2015 3 13	73.29999815
1/18/2015 4 54	73.41999815
1/18/2015 5 58	72.98999816
1/18/2015 6 59	72.19999818
1/18/2015 7 40	70.69999821
1/18/2015 8 24	72.07999818
1/18/2015 9 04	71.43999819
1/18/2015 10 09	71.40999819
1/18/2015 11 24	70.82999821
1/18/2015 12 27	71.43999819
1/18/2015 13 18	71.37999819
1/18/2015 14 28	68.50999826
1/18/2015 15 53	71.52999819
1/18/2015 16 36	71.2199982
1/18/2015 17 08	71.49999819
1/18/2015 18 50	71.82999818
1/18/2015 19 01	71.3199982
1/18/2015 20 58	71.55999819
1/18/2015 21 00	72.07999818
1/18/2015 22 26	71.85999818
1/18/2015 23 34	68.10999827
1/19/2015 0 15	71.73999819
1/19/2015 1 15	71.76999819
1/19/2015 2 32	72.16999818
1/19/2015 3 13	72.47999817
1/19/2015 4 11	72.34999817
1/19/2015 5 43	70.76999821
1/19/2015 6 53	71.0999982
1/19/2015 7 32	71.1299982
1/19/2015 8 31	70.51999822
1/19/2015 9 54	71.0399982
1/19/2015 10 12	71.0399982
1/19/2015 11 28	71.0099982
1/19/2015 12 18	70.79999821
1/19/2015 13 57	71.1899982
1/19/2015 14 41	71.43999819
1/19/2015 15 53	70.91999821
1/19/2015 16 42	71.0099982
1/19/2015 17 01	71.37999819
1/19/2015 18 47	71.43999819
1/19/2015 19 26	71.43999819
1/19/2015 20 43	71.2799982
1/19/2015 21 01	71.76999819
1/19/2015 22 23	71.52999819
1/19/2015 23 44	68.34999827
1/20/2015 0 23	70.9799982
1/20/2015 1 32	72.07999818
1/20/2015 2 08	72.28999817
1/20/2015 3 02	72.28999817
1/20/2015 4 05	72.25999817
1/20/2015 5 37	70.85999821
1/20/2015 6 47	71.2499982
1/20/2015 7 35	70.9499982
1/20/2015 8 17	71.1899982
1/20/2015 9 00	71.2799982
1/20/2015 10 27	69.14999825
1/20/2015 11 19	70.9799982
1/20/2015 12 35	70.57999821
1/20/2015 13 31	70.9499982
1/20/2015 14 27	70.9799982
1/20/2015 15 52	71.2799982
1/20/2015 16 17	71.1599982
1/20/2015 17 32	71.2799982
1/20/2015 18 53	70.9799982
1/20/2015 19 01	70.82999821
1/20/2015 20 53	71.2499982
1/20/2015 21 08	71.37999819
1/20/2015 22 01	71.85999818
1/20/2015 23 27	67.64999828
1/21/2015 0 01	71.0699982
1/21/2015 1 17	71.1899982
1/21/2015 2 59	71.76999819
1/21/2015 3 33	72.31999817
1/21/2015 4 54	71.76999819
1/21/2015 5 49	70.24999822
1/21/2015 6 58	71.67999819
1/21/2015 7 03	71.3499982
1/21/2015 8 03	68.59999826

1/17/2015 11 42	72.28000202
1/17/2015 12 13	73.29000205
1/17/2015 13 42	72.89000204
1/17/2015 14 24	73.04000204
1/17/2015 15 43	73.87000207
1/17/2015 16 35	73.74000206
1/17/2015 17 02	73.26000205
1/17/2015 18 55	73.62000206
1/17/2015 19 09	73.84000207
1/17/2015 20 36	73.53000206
1/17/2015 21 25	74.29000208
1/17/2015 22 25	74.48000208
1/17/2015 23 41	73.59000206
1/18/2015 0 00	74.69000209
1/18/2015 1 10	74.9700021
1/18/2015 2 54	75.21000211
1/18/2015 3 00	75.33000211
1/18/2015 4 52	75.24000211
1/18/2015 5 14	74.8700021
1/18/2015 6 35	75.0300021
1/18/2015 7 39	74.29000208
1/18/2015 8 54	73.96000207
1/18/2015 9 12	73.04000204
1/18/2015 10 14	72.86000204
1/18/2015 11 28	72.89000204
1/18/2015 12 23	72.68000203
1/18/2015 13 39	73.19000205
1/18/2015 14 32	73.47000206
1/18/2015 15 53	73.26000205
1/18/2015 16 25	72.95000204
1/18/2015 17 07	72.89000204
1/18/2015 18 37	73.35000205
1/18/2015 19 24	73.44000205
1/18/2015 20 59	73.23000205
1/18/2015 21 00	73.23000205
1/18/2015 22 26	73.19000205
1/18/2015 23 34	72.55000203
1/19/2015 0 06	74.75000209
1/19/2015 1 16	74.72000209
1/19/2015 2 25	75.0000021
1/19/2015 3 07	75.1500021
1/19/2015 4 14	75.0600021
1/19/2015 5 43	74.66000209
1/19/2015 6 47	73.16000205
1/19/2015 7 14	72.10000202
1/19/2015 8 36	73.16000205
1/19/2015 9 52	73.13000205
1/19/2015 10 02	73.04000204
1/19/2015 11 11	72.86000204
1/19/2015 12 22	72.98000204
1/19/2015 13 22	72.95000204
1/19/2015 14 17	73.13000205
1/19/2015 15 57	73.26000205
1/19/2015 16 10	73.35000205
1/19/2015 17 40	72.95000204
1/19/2015 18 14	73.19000205
1/19/2015 19 21	73.53000206
1/19/2015 20 43	73.59000206
1/19/2015 21 41	73.29000205
1/19/2015 22 19	73.23000205
1/19/2015 23 33	74.54000209
1/20/2015 0 28	74.78000209
1/20/2015 1 04	74.9700021
1/20/2015 2 19	75.1200021
1/20/2015 3 17	74.9700021
1/20/2015 4 05	74.72000209
1/20/2015 5 42	74.42000208
1/20/2015 6 52	73.35000205
1/20/2015 7 03	72.52000203
1/20/2015 8 32	73.04000204
1/20/2015 9 36	73.10000205
1/20/2015 10 28	71.88000201
1/20/2015 11 27	72.68000203
1/20/2015 12 35	71.85000201
1/20/2015 13 46	73.68000206
1/20/2015 14 18	73.32000205
1/20/2015 15 21	73.16000205
1/20/2015 16 21	73.38000205
1/20/2015 17 58	73.16000205
1/20/2015 18 23	72.80000204
1/20/2015 19 43	73.26000205
1/20/2015 20 23	73.32000205
1/20/2015 21 36	73.77000206
1/20/2015 22 25	73.87000207
1/20/2015 23 28	73.50000206
1/21/2015 0 00	74.60000209
1/21/2015 1 41	74.66000209
1/21/2015 2 15	74.29000208
1/21/2015 3 34	74.9300021
1/21/2015 4 19	74.84000209
1/21/2015 5 47	74.39000208
1/21/2015 6 57	73.59000206
1/21/2015 7 35	72.62000203
1/21/2015 8 14	72.62000203

1/17/2015 11 10	66.59999916
1/17/2015 12 51	67.17999916
1/17/2015 13 12	67.45999915
1/17/2015 14 01	68.58999914
1/17/2015 15 17	68.94999913
1/17/2015 16 02	68.85999914
1/17/2015 17 06	68.67999914
1/17/2015 18 44	68.91999914
1/17/2015 19 00	69.28999913
1/17/2015 20 06	69.98999912
1/17/2015 21 22	69.98999912
1/17/2015 22 08	70.68999911
1/17/2015 23 41	70.90999911
1/18/2015 0 03	71.8799991
1/18/2015 1 02	72.51999909
1/18/2015 2 08	72.91999909
1/18/2015 3 59	73.28999908
1/18/2015 4 38	73.25999908
1/18/2015 5 45	73.03999909
1/18/2015 6 04	72.1599991
1/18/2015 7 45	70.35999912
1/18/2015 8 52	68.45999914
1/18/2015 9 47	66.74999916
1/18/2015 10 16	65.86999917
1/18/2015 11 24	65.10999918
1/18/2015 12 03	66.41999917
1/18/2015 13 12	66.96999916
1/18/2015 14 29	66.96999916
1/18/2015 15 36	68.00999915
1/18/2015 16 31	67.93999915
1/18/2015 17 37	67.48999915
1/18/2015 18 52	67.20999916
1/18/2015 19 01	67.84999915
1/18/2015 20 59	68.09999915
1/18/2015 21 02	68.58999914
1/18/2015 22 02	69.71999913
1/18/2015 23 34	70.04999912
1/19/2015 0 05	71.20999911
1/19/2015 1 15	72.2199991
1/19/2015 2 33	72.73999909
1/19/2015 3 14	72.82999909
1/19/2015 4 52	72.54999909
1/19/2015 5 53	70.77999911
1/19/2015 6 53	67.57999915
1/19/2015 7 14	66.71999916
1/19/2015 8 03	68.58999914
1/19/2015 9 13	69.31999913
1/19/2015 10 08	69.37999913
1/19/2015 11 04	69.86999912
1/19/2015 12 15	69.89999912
1/19/2015 13 27	69.64999913
1/19/2015 14 33	70.29999912
1/19/2015 15 47	69.67999913
1/19/2015 16 38	69.22999913
1/19/2015 17 56	69.00999913
1/19/2015 18 27	68.18999914
1/19/2015 19 16	68.76999914
1/19/2015 20 17	68.94999913
1/19/2015 21 01	69.43999913
1/19/2015 22 01	69.61999913
1/19/2015 23 44	69.58999913
1/20/2015 0 28	71.7599991
1/20/2015 1 25	72.64999909
1/20/2015 2 09	73.00999909
1/20/2015 3 35	72.42999909
1/20/2015 4 56	72.30999909
1/20/2015 5 57	70.59999912
1/20/2015 6 47	67.35999915
1/20/2015 7 03	66.77999916
1/20/2015 8 03	69.09999913
1/20/2015 9 08	69.71999913
1/20/2015 10 28	69.55999913
1/20/2015 11 56	69.95999912
1/20/2015 12 35	69.46999913
1/20/2015 13 51	70.38999912
1/20/2015 14 35	70.41999912
1/20/2015 15 31	70.62999911
1/20/2015 16 47	69.43999913
1/20/2015 17 28	68.76999914
1/20/2015 18 24	68.27999914
1/20/2015 19 25	68.42999914
1/20/2015 20 04	69.25999913
1/20/2015 21 02	69.52999913
1/20/2015 22 02	69.77999913
1/20/2015 23 02	69.83999912
1/21/2015 0 01	71.9099991
1/21/2015 1 18	71.9699991
1/21/2015 2 10	72.51999909
1/21/2015 3 38	72.70999909
1/21/2015 4 58	71.8499991
1/21/2015 5 56	70.74999911
1/21/2015 6 52	67.93999915
1/21/2015 7 16	67.14999916
1/21/2015 8 14	67.54999915

1/17/2015 11 42	71.66000268
1/17/2015 12 56	71.66000268
1/17/2015 13 07	72.0900027
1/17/2015 14 02	72.67000272
1/17/2015 15 01	73.06000273
1/17/2015 16 08	72.79000272
1/17/2015 17 55	72.67000272
1/17/2015 18 09	72.70000272
1/17/2015 19 00	72.85000273
1/17/2015 20 43	73.92000277
1/17/2015 21 20	73.83000276
1/17/2015 22 14	74.07000277
1/17/2015 23 42	74.50000279
1/18/2015 0 07	75.17000281
1/18/2015 1 39	75.44000282
1/18/2015 2 04	75.81000284
1/18/2015 3 14	76.02000284
1/18/2015 4 30	76.27000285
1/18/2015 5 57	75.57000283
1/18/2015 6 04	75.08000281
1/18/2015 7 45	73.46000275
1/18/2015 8 58	72.85000273
1/18/2015 9 57	71.57000268
1/18/2015 10 08	71.20000267
1/18/2015 11 28	70.56000264
1/18/2015 12 01	71.11000266
1/18/2015 13 10	71.81000269
1/18/2015 14 06	72.33000271
1/18/2015 15 27	72.36000271
1/18/2015 16 07	72.39000271
1/18/2015 17 36	72.0600027
1/18/2015 18 51	72.0600027
1/18/2015 19 29	72.48000271
1/18/2015 20 16	72.36000271
1/18/2015 21 00	72.61000272
1/18/2015 22 02	73.43000275
1/18/2015 23 34	72.76000272
1/19/2015 0 15	75.23000281
1/19/2015 1 16	75.08000281
1/19/2015 2 32	75.78000284
1/19/2015 3 05	76.30000285
1/19/2015 4 52	75.60000283
1/19/2015 5 52	74.53000279
1/19/2015 6 54	71.45000268
1/19/2015 7 12	71.05000266
1/19/2015 8 03	72.82000273
1/19/2015 9 07	73.09000274
1/19/2015 10 40	73.46000275
1/19/2015 11 21	73.43000275
1/19/2015 12 22	73.34000274
1/19/2015 13 31	73.73000276
1/19/2015 14 33	73.89000277
1/19/2015 15 01	73.73000276
1/19/2015 16 50	73.52000275
1/19/2015 17 56	72.79000272
1/19/2015 18 57	72.42000271
1/19/2015 19 00	72.42000271
1/19/2015 20 05	73.12000274
1/19/2015 21 01	73.37000275
1/19/2015 22 01	73.58000275
1/19/2015 23 44	73.46000275
1/20/2015 0 29	74.8300028
1/20/2015 1 00	74.8300028
1/20/2015 2 03	75.84000284
1/20/2015 3 04	75.78000284
1/20/2015 4 36	75.17000281
1/20/2015 5 43	74.04000277
1/20/2015 6 47	71.93000269
1/20/2015 7 21	71.26000267
1/20/2015 8 10	72.73000272
1/20/2015 9 26	73.73000276
1/20/2015 10 25	73.58000275
1/20/2015 11 24	73.64000276
1/20/2015 12 35	73.12000274
1/20/2015 13 13	74.07000277
1/20/2015 14 53	73.95000277
1/20/2015 15 10	74.25000278
1/20/2015 16 46	73.77000276
1/20/2015 17 59	72.76000272
1/20/2015 18 00	72.76000272
1/20/2015 19 00	72.76000272
1/20/2015 20 04	73.00000273
1/20/2015 21 26	73.34000274
1/20/2015 22 01	74.13000277
1/20/2015 23 02	72.73000272
1/21/2015 0 01	74.59000279
1/21/2015 1 41	75.05000281
1/21/2015 2 19	75.54000283
1/21/2015 3 38	75.32000282
1/21/2015 4 58	74.56000279
1/21/2015 5 57	73.22000274
1/21/2015 6 53	72.0000027
1/21/2015 7 13	71.54000268
1/21/2015 8 07	72.51000271

1/17/2015 10 28	72	
1/17/2015 11 42	71.82	
1/17/2015 12 42	72.25	
1/17/2015 13 07	72.4	
1/17/2015 14 45	72	
1/17/2015 15 54	72.89	
1/17/2015 16 03	73.32	
1/17/2015 17 06	73.19	
1/17/2015 18 21	73.07	
1/17/2015 19 08	73.96	
1/17/2015 20 18	73.35	
1/17/2015 21 29	74.11	
1/17/2015 22 38	74.48	
1/17/2015 23 40	74.69	
1/18/2015 0 30	75.09	
1/18/2015 1 24	75.48	
1/18/2015 2 07	75.94	
1/18/2015 3 15	76.15	
1/18/2015 4 18	76.7	
1/18/2015 5 48	76.25	
1/18/2015 6 50	75.06	
1/18/2015 7 45	74.35	
1/18/2015 8 51	73.38	
1/18/2015 9 38	72.49	
1/18/2015 10 42	71.64	
1/18/2015 11 36	47.43	A
1/18/2015 12 09	47.13	A
1/18/2015 13 07	48.59	A
1/18/2015 14 00	51.8	A
1/18/2015 15 53	71.52	
1/18/2015 16 36	72.61	
1/18/2015 17 47	72.25	
1/18/2015 18 39	72.34	
1/18/2015 19 02	72.77	
1/18/2015 20 59	72.22	
1/18/2015 21 00	72.22	
1/18/2015 22 51	73.07	
1/18/2015 23 34	74.42	
1/19/2015 0 01	74.66	
1/19/2015 1 00	75.51	
1/19/2015 2 29	76.58	
1/19/2015 3 18	76.61	
1/19/2015 4 58	75.82	
1/19/2015 5 34	74.54	
1/19/2015 6 53	73.04	
1/19/2015 7 36	71.94	
1/19/2015 8 03	73.04	
1/19/2015 9 13	72.89	
1/19/2015 10 17	72.95	
1/19/2015 11 08	73.47	
1/19/2015 12 37	72.98	
1/19/2015 13 05	73.35	
1/19/2015 14 03	73.41	
1/19/2015 15 39	73.35	
1/19/2015 16 59	73.19	
1/19/2015 17 28	72.98	
1/19/2015 18 36	71.79	
1/19/2015 19 43	72.16	
1/19/2015 20 13	72.64	
1/19/2015 21 27	73.56	
1/19/2015 22 02	73.53	
1/19/2015 23 01	74.35	
1/20/2015 0 58	75.27	
1/20/2015 1 00	75.27	
1/20/2015 2 05	76.09	
1/20/2015 3 03	75.48	
1/20/2015 4 55	75.48	
1/20/2015 5 53	74.32	
1/20/2015 6 06	72.83	
1/20/2015 7 02	72.4	
1/20/2015 8 51	71.48	
1/20/2015 9 00	71.82	
1/20/2015 10 29	73.77	
1/20/2015 11 58	73.29	
1/20/2015 12 51	73.16	
1/20/2015 13 06	73.59	
1/20/2015 14 55	73.77	
1/20/2015 15 47	73.93	
1/20/2015 16 05	73.5	
1/20/2015 17 34	72.37	
1/20/2015 18 14	72.83	
1/20/2015 19 56	73.19	
1/20/2015 20 00	72.77	
1/20/2015 21 00	73.5	
1/20/2015 22 07	73.74	
1/20/2015 23 28	73.13	
1/21/2015 0 19	75.09	
1/21/2015 1 14	74.78	
1/21/2015 2 19	75.57	
1/21/2015 3 42	75.3	
1/21/2015 4 58	75.09	
1/21/2015 5 56	73.99	
1/21/2015 6 50	73.1	
1/21/2015 7 12	72.4	

1/21/2015 9 17	69.93000241	1/21/2015 9 56	67.93000063	1/21/2015 8 11	71.49999775	1/21/2015 8 02	69.44	1/21/2015 8 03	64.16000235	1/21/2015 9 00	76.54000144	1/21/2015 9 59	70.85999821	1/21/2015 9 00	73.19000205	1/21/2015 9 05	69.61999913	1/21/2015 9 45	73.58000275	1/21/2015 8 04	72.83
1/21/2015 10 53	69.93000241	1/21/2015 10 32	67.90000063	1/21/2015 9 29	71.46999775	1/21/2015 9 10	69.84	1/21/2015 9 56	66.97000245	1/21/2015 10 00	76.54000144	1/21/2015 10 17	70.91999821	1/21/2015 10 27	73.04000204	1/21/2015 10 02	69.58999913	1/21/2015 10 44	73.22000274	1/21/2015 9 42	73.19
1/21/2015 11 18	70.23000242	1/21/2015 11 06	67.90000063	1/21/2015 10 02	71.06999777	1/21/2015 10 00	70.39	1/21/2015 10 31	66.60000244	1/21/2015 11 00	76.54000144	1/21/2015 11 57	71.3499982	1/21/2015 11 12	73.10000205	1/21/2015 11 28	69.64999913	1/21/2015 11 30	73.83000276	1/21/2015 10 35	73.38
1/21/2015 12 45	69.78000241	1/21/2015 12 01	68.18000063	1/21/2015 11 25	71.70999775	1/21/2015 11 43	69.99	1/21/2015 11 22	66.60000244	1/21/2015 12 00	76.54000144	1/21/2015 12 01	71.0699982	1/21/2015 12 04	73.26000205	1/21/2015 12 21	69.95999912	1/21/2015 12 04	73.77000276	1/21/2015 11 52	73.01
1/21/2015 13 42	70.29000242	1/21/2015 13 47	68.39000064	1/21/2015 12 30	71.67999775	1/21/2015 12 28	70.08	1/21/2015 12 01	66.88000245	1/21/2015 13 00	76.54000144	1/21/2015 13 43	71.37999819	1/21/2015 13 04	73.41000205	1/21/2015 13 04	70.16999912	1/21/2015 13 20	73.83000276	1/21/2015 12 00	73.38
1/21/2015 14 00	71.30000246	1/21/2015 14 25	67.60000063	1/21/2015 13 04	70.45999778	1/21/2015 13 42	70.2	1/21/2015 13 42	66.94000245	1/21/2015 14 00	76.54000144	1/21/2015 14 02	71.0099982	1/21/2015 14 06	73.56000206	1/21/2015 14 19	70.22999912	1/21/2015 14 10	74.01000277	1/21/2015 13 08	73.47
1/21/2015 15 58	69.75000241	1/21/2015 15 57	68.63000064	1/21/2015 14 18	70.97999777	1/21/2015 14 00	70.45	1/21/2015 14 21	66.60000244	1/21/2015 15 00	76.54000144	1/21/2015 15 58	70.9499982	1/21/2015 15 21	73.62000206	1/21/2015 15 55	70.38999912	1/21/2015 15 58	73.89000277	1/21/2015 14 25	73.65
1/21/2015 16 00	69.75000241	1/21/2015 16 30	68.05000063	1/21/2015 15 26	72.13999773	1/21/2015 15 58	69.96	1/21/2015 15 58	66.30000243	1/21/2015 16 00	76.54000144	1/21/2015 16 25	71.3499982	1/21/2015 16 49	72.83000204	1/21/2015 16 37	69.49999913	1/21/2015 16 38	73.49000275	1/21/2015 15 38	73.5
1/21/2015 17 20	69.93000241	1/21/2015 17 20	66.28000062	1/21/2015 16 49	71.12999776	1/21/2015 16 00	69.96	1/21/2015 16 00	66.30000243	1/21/2015 17 00	76.54000144	1/21/2015 17 28	71.2499982	1/21/2015 17 55	73.19000205	1/21/2015 17 54	68.51999914	1/21/2015 17 47	72.70000272	1/21/2015 16 04	73.26
1/21/2015 18 16	70.29000242	1/21/2015 18 18	67.02000062	1/21/2015 17 43	71.06999777	1/21/2015 17 28	69.99	1/21/2015 17 25	66.91000245	1/21/2015 18 00	76.54000144	1/21/2015 18 16	70.9499982	1/21/2015 18 55	73.01000204	1/21/2015 18 58	68.36999914	1/21/2015 18 47	72.30000271	1/21/2015 17 29	73.19
1/21/2015 19 18	70.29000242	1/21/2015 19 10	67.38000063	1/21/2015 18 55	70.48999778	1/21/2015 18 16	70.23	1/21/2015 18 16	66.51000244	1/21/2015 19 00	76.54000144	1/21/2015 19 55	71.3199982	1/21/2015 19 51	73.41000205	1/21/2015 19 16	68.42999914	1/21/2015 19 11	72.79000272	1/21/2015 18 08	72.8
1/21/2015 20 28	69.75000241	1/21/2015 20 03	67.81000063	1/21/2015 19 44	71.06999777	1/21/2015 19 51	70.26	1/21/2015 19 55	67.61000248	1/21/2015 20 00	76.54000144	1/21/2015 20 44	71.55999819	1/21/2015 20 04	73.26000205	1/21/2015 20 04	68.24999914	1/21/2015 20 04	72.82000273	1/21/2015 19 17	73.1
1/21/2015 21 54	70.57000243	1/21/2015 21 48	67.66000063	1/21/2015 20 08	71.43999775	1/21/2015 20 32	70.14	1/21/2015 20 28	66.85000245	1/21/2015 21 00	76.54000144	1/21/2015 21 58	71.61999819	1/21/2015 21 37	73.84000207	1/21/2015 21 02	69.46999913	1/21/2015 21 12	73.58000275	1/21/2015 20 04	72.92
1/21/2015 22 00	71.61000247	1/21/2015 22 02	67.53000063	1/21/2015 21 23	72.10999773	1/21/2015 21 58	70.42	1/21/2015 21 00	67.09000246	1/21/2015 22 00	76.54000144	1/21/2015 22 36	71.58999819	1/21/2015 22 36	72.89000204	1/21/2015 22 01	69.55999913	1/21/2015 22 10	73.83000276	1/21/2015 21 48	73.56
1/21/2015 23 33	73.26000252	1/21/2015 23 22	69.89000065	1/21/2015 22 36	70.94999777	1/21/2015 22 35	70.05	1/21/2015 22 00	67.33000247	1/21/2015 23 00	76.54000144	1/21/2015 23 59	69.26999825	1/21/2015 23 15	74.39000208	1/21/2015 23 28	71.20999911	1/21/2015 23 28	74.19000278	1/21/2015 22 26	74.45
1/22/2015 0 00	69.4700024	1/22/2015 0 00	69.37000064	1/21/2015 23 00	73.1499977	1/21/2015 23 23	71.09	1/21/2015 23 29	68.53000251	1/22/2015 0 00	76.54000144	1/22/2015 0 00	67.37999829	1/22/2015 0 00	72.65000203	1/22/2015 0 00	70.04999912	1/22/2015 0 00	74.56000279	1/21/2015 23 23	74.93
1/22/2015 1 43	73.26000252	1/22/2015 1 06	70.37000065	1/22/2015 0 01	71.28999776	1/22/2015 0 00	67.85	1/22/2015 0 00	63.49000233	1/22/2015 1 00	76.54000144	1/22/2015 1 01	71.0699982	1/22/2015 1 00	74.32000208	1/22/2015 1 00	71.7599991	1/22/2015 1 06	74.56000279	1/22/2015 0 16	74.9
1/22/2015 2 24	75.00000258	1/22/2015 2 27	71.81000067	1/22/2015 1 00	73.72999768	1/22/2015 1 00	71.33	1/22/2015 1 06	68.1900025	1/22/2015 2 00	76.54000144	1/22/2015 2 35	72.86999816	1/22/2015 2 00	75.36000211	1/22/2015 2 16	73.06999909	1/22/2015 2 42	75.81000284	1/22/2015 1 05	74.69
1/22/2015 3 34	72.71000251	1/22/2015 3 34	70.53000066	1/22/2015 2 00	74.17999767	1/22/2015 2 36	72.25	1/22/2015 2 53	69.44000255	1/22/2015 3 00	76.54000144	1/22/2015 3 33	69.41999824	1/22/2015 3 39	75.0000021	1/22/2015 3 34	70.80999911	1/22/2015 3 34	73.67000276	1/22/2015 2 17	76.12
1/22/2015 4 52	72.6100025	1/22/2015 4 28	70.98000066	1/22/2015 3 43	73.93999768	1/22/2015 3 34	71.73	1/22/2015 3 34	66.97000245	1/22/2015 4 00	76.54000144	1/22/2015 4 59	71.0399982	1/22/2015 4 46	75.24000211	1/22/2015 4 59	72.45999909	1/22/2015 4 29	75.35000282	1/22/2015 3 34	74.87
1/22/2015 5 39	69.5000024	1/22/2015 5 50	69.09000064	1/22/2015 4 59	73.44999769	1/22/2015 4 52	71.52	1/22/2015 4 54	67.46000247	1/22/2015 5 00	76.54000144	1/22/2015 5 41	68.71999826	1/22/2015 5 40	74.60000209	1/22/2015 5 50	70.83999911	1/22/2015 5 51	73.92000277	1/22/2015 4 40	75.27
1/22/2015 6 52	71.64000247	1/22/2015 6 32	67.08000062	1/22/2015 5 33	73.01999771	1/22/2015 5 39	70.42	1/22/2015 5 40	65.20000239	1/22/2015 6 00	76.54000144	1/22/2015 6 59	71.40999819	1/22/2015 6 59	73.41000205	1/22/2015 6 45	67.57999915	1/22/2015 6 51	72.36000271	1/22/2015 5 33	74.14
1/22/2015 7 57	69.75000241	1/22/2015 7 14	66.37000062	1/22/2015 6 46	72.07999773	1/22/2015 6 45	69.68	1/22/2015 6 35	67.33000247	1/22/2015 7 00	76.54000144	1/22/2015 7 58	68.74999826	1/22/2015 7 12	72.98000204	1/22/2015 7 18	66.62999916	1/22/2015 7 06	70.99000266	1/22/2015 6 03	72.71
1/22/2015 8 08	69.6800024	1/22/2015 8 09	67.05000062	1/22/2015 7 05	70.57999778	1/22/2015 7 12	69.56	1/22/2015 7 58	65.20000239	1/22/2015 8 00	76.54000144	1/22/2015 8 09	71.0399982	1/22/2015 8 02	73.13000205	1/22/2015 8 13	68.82999914	1/22/2015 8 00	73.09000274	1/22/2015 7 03	72.58
1/22/2015 9 38	70.94000245	1/22/2015 9 08	68.33000063	1/22/2015 8 22	71.24999776	1/22/2015 8 28	69.84	1/22/2015 8 00	65.20000239	1/22/2015 9 00	76.54000144	1/22/2015 9 24	71.2199982	1/22/2015 9 27	73.01000204	1/22/2015 9 07	69.43999913	1/22/2015 9 07	73.37000275	1/22/2015 8 09	72.55
1/22/2015 10 38	69.75000241	1/22/2015 10 08	68.05000063	1/22/2015 9 11	71.49999775	1/22/2015 9 22	70.42	1/22/2015 9 38	67.00000246	1/22/2015 10 00	76.54000144	1/22/2015 10 12	70.76999821	1/22/2015 10 09	72.98000204	1/22/2015 10 20	69.55999913	1/22/2015 10 55	73.22000274	1/22/2015 9 29	73.53
1/22/2015 11 36	69.5300024	1/22/2015 11 14	68.42000064	1/22/2015 10 04	71.70999775	1/22/2015 10 09	70.17	1/22/2015 10 38	66.63000244	1/22/2015 11 00	76.54000144	1/22/2015 11 43	71.0999982	1/22/2015 11 40	73.26000205	1/22/2015 11 40	69.71999913	1/22/2015 11 06	73.67000276	1/22/2015 10 24	73.77
1/22/2015 12 46	70.94000245	1/22/2015 12 15	68.66000064	1/22/2015 11 26	71.52999775	1/22/2015 11 46	70.42	1/22/2015 11 36	66.14000242	1/22/2015 12 00	76.54000144	1/22/2015 12 22	70.76999821	1/22/2015 12 49	73.26000205	1/22/2015 12 15	70.01999912	1/22/2015 12 13	73.86000276	1/22/2015 11 44	73.47
1/22/2015 13 23	70.05000242	1/22/2015 13 42	68.54000064	1/22/2015 12 13	71.86999774	1/22/2015 12 23	70.66	1/22/2015 12 03	67.21000246	1/22/2015 13 00	76.54000144	1/22/2015 13 13	70.73999821	1/22/2015 13 13	73.77000206	1/22/2015 13 33	70.19999912	1/22/2015 13 31	73.95000277	1/22/2015 12 19	73.53
1/22/2015 14 27	71.00000245	1/22/2015 14 55	68.24000063	1/22/2015 13 09	72.40999772	1/22/2015 13 12	69.99	1/22/2015 13 23	65.96000242	1/22/2015 14 00	76.54000144	1/22/2015 14 11	70.66999821	1/22/2015 14 27	73.59000206	1/22/2015 14 58	70.35999912	1/22/2015 14 18	74.13000277	1/22/2015 13 13	73.68
1/22/2015 15 24	70.94000245	1/22/2015 15 43	68.66000064	1/22/2015 14 08	71.73999775	1/22/2015 14 14	69.81	1/22/2015 14 14	67.21000246	1/22/2015 15 00	76.54000144	1/22/2015 15 46	71.0999982	1/22/2015 15 53	73.68000206	1/22/2015 15 50	70.29999912	1/22/2015 15 50	73.64000276	1/22/2015 14 24	72.4
1/22/2015 16 07	70.97000245	1/22/2015 16 47	67.17000062	1/22/2015 15 53	71.82999774	1/22/2015 15 39	70.87	1/22/2015 15 02	67.43000247	1/22/2015 16 00	76.54000144	1/22/2015 16 08	71.2499982	1/22/2015 16 57	73.59000206	1/22/2015 16 54	69.49999913	1/22/2015 16 56	73.58000275	1/22/2015 15 52	73.71
1/22/2015 17 36	71.24000246	1/22/2015 17 57	66.89000062	1/22/2015 16 54	70.76999778	1/22/2015 16 49	70.72	1/22/2015 16 08	66.51000244	1/22/2015 17 00	76.54000144	1/22/2015 17 14	71.43999819	1/22/2015 17 48	73.32000205	1/22/2015 17 42	68.76999914	1/22/2015 17 42	72.79000272	1/22/2015 16 08	73.22
1/22/2015 18 32	69.75000241	1/22/2015 18 43	66.41000062	1/22/2015 17 59	70.82999777	1/22/2015 17 32	70.29	1/22/2015 17 26	67.49000247	1/22/2015 18 00	76.54000144	1/22/2015 18 32	71.43999819	1/22/2015 18 36	73.29000205	1/22/2015 18 47	68.55999914	1/22/2015 18 47	72.33000271	1/22/2015 17 57	72.4
1/22/2015 19 54	70.84000244	1/22/2015 19 40	67.11000062	1/22/2015 18 00	70.82999777	1/22/2015 18 01	69.44	1/22/2015 18 32	66.94000245	1/22/2015 19 00	76.54000144	1/22/2015 19 57	71.43999819	1/22/2015 19 40	73.44000205	1/22/2015 19 40	68.27999914	1/22/2015 19 58	72.42000271	1/22/2015 18 43	72.86
1/22/2015 20 04	69.5600024	1/22/2015 20 00	67.81000063	1/22/2015 19 12	71.18999776	1/22/2015 19 39	70.36	1/22/2015 19 05	67.03000246	1/22/2015 20 00	76.54000144	1/22/2015 20 01	71.43999819	1/22/2015 20 08	73.07000204	1/22/2015 20 00	68.76999914	1/22/2015 20 12	72.36000271	1/22/2015 19 05	72.4
1/22/2015 21 08	72.31000249	1/22/2015 21 05	68.27000063	1/22/2015 20 01	71.76999774	1/22/2015 20 08	70.08	1/22/2015 20 04	66.94000245	1/22/2015 21 00	76.54000144	1/22/2015 21 04	71.85999818	1/22/2015 21 09	73.99000207	1/22/2015 21 01	69.25999913	1/22/2015 21 05	73.25000274	1/22/2015 20 25	73.44
1/22/2015 22 02	72.71000251	1/22/2015 22 05	69.18000064	1/22/2015 21 23	71.70999775	1/22/2015 21 14	70.54	1/22/2015 21 08	67.64000248	1/22/2015 22 00	76.54000144	1/22/2015 22 37	72.07999818	1/22/2015 22 06	73.65000206	1/22/2015 22 01	70.07999912	1/22/2015 22 06	73.86000276	1/22/2015 21 01	73.68
1/22/2015 23 26	70.69000244	1/22/2015 23 53	69.92000065	1/22/2015 22 06	71.73999775	1/22/2015 22 37	70.29	1/22/2015 22 02	68.37000251	1/22/2015 23 00	76.54000144	1/22/2015 23 27	67.83999828	1/22/2015 23 27	72.68000203	1/22/2015 23 27	70.62999911	1/22/2015 23 05	74.22000278	1/22/2015 22 06	73.16
1/23/2015 0 13	73.01000252	1/23/2015 0 24	70.83000066	1/22/2015 23 27	70.79999777	1/22/2015 23 26	70.57	1/22/2015 23 26	65.87000241	1/23/2015 0 00	76.54000144	1/23/2015 0 41	71.2199982	1/23/2015 0 42	74.39000208	1/23/2015 0 42	71.8499991	1/23/2015 0 00	75.11000281	1/22/2015 23 27	74.26
1/23/2015 1 23	74.84000258	1/23/2015 1 06	70.86000066	1/23/2015 0 38	73.72999768	1/23/2015 0 38	71.09	1/23/2015 0 00	68.1300025	1/23/2015 1 00	76.54000144	1/23/2015 1 01	72.83999816	1/23/2015 1 02	74.81000209	1/23/2015 1 04	72.36999909	1/23/2015 1 02	75.26000282	1/23/2015 0 42	74.9
1/23/2015 2 42	75.24000259	1/23/2015 2 07	71.90000067	1/23/2015 1 04	73.72999768	1/23/2015 1 48	71.94	1/23/2015 1 07	68.95000253	1/23/2015 2 00	76.54000144	1/23/2015 2 15	73.35999815	1/23/2015 2 30	75.39000211	1/23/2015 2 30	72.97999909	1/23/2015 2 06	75.90000284	1/23/2015 1 41	75.61
1/23/2015 3 37	75.12000259	1/23/2015 3 37	71.63000067	1/23/2015 2 11	74.30999767	1/23/2015 2 27	72.06	1/23/2015 2 15	69.56000255	1/23/2015 3 00	76.54000144	1/23/2015 3 36	72.92999816	1/23/2015 3 37	75.0300021	1/23/2015 3 37	73.09999909	1/23/2015 3 18	75.93000284	1/23/2015 2 02	76.03
1/23/2015 4 59	74.84000258	1/23/2015 4 51	71.08000066	1/23/2015 3 12	73.78999768	1/23/2015 3 12	72.06	1/23/2015 3 37	69.69000255	1/23/2015 4 00	76.54000144	1/23/2015 4 56	72.83999816	1/23/2015 4 45	75.0600021	1/23/2015 4 44	72.64999909	1/23/2015 4 57	75.57000283	1/23/2015 3 36	76.19
1/23/2015 5 20	73.80000254	1/23/2015 5 58	69.03000064	1/23/2015 4 02	74.05999767	1/23/2015 4 39	72.25	1/23/2015 4 53	69.26000254	1/23/2015 5 00	76.54000144	1/23/2015 5 20	72.19999818	1/23/2015 5 34	74.57000209	1/23/2015 5 59	70.96999911	1/23/2015 5 41	74.35000278	1/23/2015 4 51	75.79
1/23/2015 6 40	71.15000245	1/23/2015 6 49	67.50000063	1/23/2015 5 56	73.2099977	1/23/2015 5 51	71.48	1/23/2015 5 20	68.56000251	1/23/2015 6 00	76.54000144	1/23/2015 6 46	71.64999819	1/23/2015 6 46	72.80000204	1/23/2015 6 45	68.03999915	1/23/2015 6 59	72.30000271	1/23/2015 5 54	74.51
1/23/2015 7 30	71.27000246	1/23/2015 7 03	66.50000062	1/23/2015 6 45	70.97999777	1/23/2015 6 47	70.39	1/23/2015 6 49	67.27000247	1/23/2015 7 00	76.54000144	1/23/2015 7 25	71.46999819	1/23/2015 7 30	73.01000204	1/23/2015 7 06	67.23999916	1/23/2015 7 09	71.26000267	1/23/2015 6 56	73.62
1/23/2015 8 19	71.42000246	1/23/2015 8 58	67.72000063	1/23/2015 7 03	70.66999778	1/23/2015 7 26	68.8	1/23/2015 7 26	67.00000246	1/23/2015 8 00	76.54000144	1/23/2015 8 22	71.58999819	1/23/2015 8 16	73.41000205	1/23/2015 8 06	68.82999914	1/23/2015 8 02	72.85000273	1/23/2015 7 14	72.74
1/23/2015 9 31	71.12000245	1/23/2015 9 00	67.72000063	1/23/2015 8 50	71.12999776	1/23/2015 8 11	69.78	1/23/2015 8 03	67.15000246	1/23/2015 9 00	76.54000144	1/23/2015 9 53	71.37999819	1/23/2015 9 10	73.59000206	1/23/2015 9 06	69.31999913	1/23/2015 9 24	73.40000275	1/23/2015 8 52	73.32
1/23/2015 10 56	70.69000244	1/23/2015 10 02	68.27000063	1/23/2015 9 00	71.46999775	1/23/2015 9 58	70.51	1/23/2015 9 46	67.49000247	1/23/2015 10 00	76.54000144	1/23/2015 10 57	71.43999819	1/23/2015 10 22	73.59000206	1/23/2015 10 05	69.55999913	1/23/2015 10 31	73.03000273	1/23/2015 9 54	72.74
1/23/2015 11 41	70.57000243	1/23/2015 11 08	68.36000063	1/23/2015 10 11	71.37999776	1/23/2015 10 16	69.9	1/23/2015 10 25	67.06000246	1/23/2015 11 00	76.54000144	1/23/2015 11 41	71.0399982	1/23/2015 11 20	73.32000205	1/23/2015 11 00	69.46999913	1/23/2015 11 05	73.49000275	1/23/2015 10 38	73.53
1/23/2015 12 02	71.27000246	1/23/2015 12 48	68.21000063	1/23/2015 11 05	71.98999774	1/23/2015 11 35	70.29	1/23/2015 11 18	66.85000245	1/23/2015 12 00	76.54000144	1/23/2015 12 43	71.37999819	1/23/2015 12 06	73.44000205	1/23/2015 12 48	69.49999913	1/23/2015 12 06	73.28000274	1/23/2015 11 00	72.52
1/23/2015 13 59	71.24000246	1/23/2015 13 25	68.11000063	1/23/2015 12 57	71.79999774	1/23/2015 12 22	69.38	1/23/2015 12 47	66.66000244	1/23/2015 13 00	76.54000144	1/23/2015 13 18	71.67999819	1/23/2015 13 20	73.41000205	1/23/2015 13 25	69.74999913	1/23/2015 13 01	73.64000276	1/23/2015 12 55	73.56
1/23/2015 14 03	69.99000241	1/23/2015 14 14	68.42000064	1/23/2015 13 06	71.28999776	1/23/2015 13 38	70.63	1/23/2015 13 59	66.75000245	1/23/2015 14 00	76.54000144	1/23/2015 14 33	71.46999819	1/23/2015 14 04	73.50000206	1/23/2015 14 07	70.53999912	1/23/2015 14 21	73.92000277	1/23/2015 13 25	73.65
1/23/2015 15 50	70.63000244	1/23/2015 15 11	68.27000063	1/23/2015 14 03	72.13999773	1/23/2015 14 09	69.68	1/23/2015 14 00	66.75000245	1/23/2015 15 00	76.54000144	1/23/2015 15 12	71.40999819	1/23/2015 15 04	73.77000206	1/23/2015 15 55	70.07999912	1/23/2015 15 45	73.80000276	1/23/2015 14 48	73.29
1/23/2015 16 19	71.09000245	1/23/2015 16 49	68.42000064	1/23/2015 15 46	71.76999774	1/23/2015 15 27	70.81	1/23/2015 15 50	66.57000244	1/23/2015 16 00	76.54000144	1/23/2015 16 18	71.0399982	1/23/2015 16 28	73.65000206	1/23/2015 16 25	69.46999913	1/23/2015 16 44	73.52000275	1/23/2015 15 08	73.47
1/23/2015 17 25	70.97000245	1/23/2015 17 21	66.47000062	1/23/2015 16 00	71.61999775	1/23/2015 16 25	70.36	1/23/2015 16 40	67.73000248	1/23/2015 17 00	76.54000144	1/23/2015 17 57	71.40999819	1/23/2015 17 54	73.50000206	1/23/2015 17 54	69.03999913	1/23/2015 17 54	72.45000271	1/23/2015 16 28	73.01
1/23/2015 18 59	71.73000247	1/23/2015 18 14	67.90000063	1/23/2015 17 53	69.8499978	1/23/2015 17 49	70.39	1/23/2015 17 29	67.79000248	1/23/2015 18 00	76.54000144	1/23/2015 18 57	71.70999819	1/23/2015 18 27	73.59000206	1/23/2015 18 26	69.13999913	1/23/2015 18 38	72.91000273	1/23/2015 17 46	73.38
1/23/2015 19 24	71.49000246	1/23/2015 19 21	68.05000063	1/23/2015 18 00	71.61999775	1/23/2015 18 57	70.02	1/23/2015 18 43	67.30000247	1/23/2015 19 00	76.54000144	1/23/2015 19 24	71.64999819	1/23/2015 19 58	73.84000207	1/23/2015 19 04	69.37999913	1/23/2015 19 13	73.40000275	1/23/2015 18 36	73.1
1/23/2015 20 18	70.29000242	1/23/2015 20 00	68.82000064	1/23/2015 19 18	71.64999775	1/23/2015 19 59	70.29	1/23/2015 19 00	67.46000247	1/23/2015 20 00	76.54000144	1/23/2015 20 18	71.85999818	1/23/2015 20 00	73.84000207	1/23/2015 20 00	69.74999913	1/23/2015 20 55	73.83000276	1/23/2015 19 02	73.26
1/23/2015 21 28	70.81000244	1/23/2015 21 25	68.97000064	1/23/2015 20 52	71.76999774	1/23/2015 20 00	70.29	1/23/2015 20 18	66.94000245	1/23/2015 21 00	76.54000144	1/23/2015 21 28	70.88999821	1/23/2015 21 31	73.13000205	1/23/2015 21 10	69.19999913	1/23/2015 21 31	72.73000272	1/23/2015 20 01	74.02
1/23/2015 22 01	71.70000247	1/23/2015 22 02	69.24000064	1/23/2015 21 31	70.51999778	1/23/2015 21 28	68.04	1/23/2015 21 28	66.91000245	1/23/2015 22 00	76.54000144	1/23/2015 22 09	71.52999819	1/23/2015 22 09	73.74000206	1/23/2015 22 06	70.16999912	1/23/2015 22 21	73.92000277	1/23/2015 21 27	73.87
1/23/2015 23 23	67.06000232	1/23/2015 23 24	69.43000065	1/23/2015 22 02	71.98999774	1/23/2015 22 17	70.69	1/23/2015 22 01	67.67000248	1/23/2015 23 00	76.54000144	1/23/2015 23 23	66.15999832	1/23/2015 23 24	73.90000207	1/23/2015 23 24	70.53999912	1/23/2015 23 24	74.35000278	1/23/2015 22 02	74.02
1/24/2015 0 00	72.10000248	1/24/2015 0 34	70.43000065	1/23/2015 23 24	71.86999774	1/23/2015 23 23	67.21	1/23/2015 23 23	61.96000227	1/24/2015 0 00	76.54000144	1/24/2015 0 11	69.96999823	1/24/2015 0 04	74.20000208	1/24/2015 0 04	71.7299991	1/24/2015 0 12	75.02000281	1/23/2015 23 29	74.42
1/24/2015 1 06	73.13000252	1/24/2015 1 29	70.59000066	1/24/2015 0 04	72.86999771	1/24/2015 0 00	70.36	1/24/2015 0 00	66.30000243	1/24/2015 1 00	76.54000144	1/24/2015 1 02	71.82999818	1/24/2015 1 07	74.81000209	1/24/2015 1 05	72.0999991	1/24/2015 1 28	74.99000281	1/24/2015 0 00	74.42
1/24/2015 2 12	73.38000253	1/24/2015 2 13	71.56000067	1/24/2015 1 03	73.63999769	1/24/2015 1 00	71.82	1/24/2015 1 06	68.1000025	1/24/2015 2 00	76.54000144	1/24/2015 2 12	72.47999817	1/24/2015 2 12	75.1200021	1/24/2015 2 06	72.61999909	1/24/2015 2 00	75.41000282	1/24/2015 1 18	74.93
1/24/2015 3 07	75.12000259	1/24/2015 3 49	71.56000067	1/24/2015 2 00	73.96999768	1/24/2015 2 18	72.06	1/24/2015 2 18	69.11000253	1/24/2015 3 00	76.54000144	1/24/2015 3 06	73.05999815	1/24/2015 3 14	75.1200021	1/24/2015 3 08	73.15999908	1/24/2015 3 06	75.72000283	1/24/2015 2 20	75.42
1/24/2015 4 32	74.96000258	1/24/2015 4 29	72.24000067	1/24/2015 3 09	74.11999767	1/24/2015 3 42	72.19	1/24/2015 3 05	69.26000254	1/24/2015 4 00	76.54000144	1/24/2015 4 32	72.77999816	1/24/2015 4 32	75.1200021	1/24/2015 4 38	73.12999909	1/24/2015 4 38	75.87000284	1/24/2015 3 07	76.09
1/24/2015 5 58	74.11000255	1/24/2015 5 32	71.44000066	1/24/2015 4 32	73.87999768	1/24/2015 4 11	72.49	1/24/2015 4 32	69.23000254	1/24/2015 5 00	76.54000144	1/24/2015 5 58	72.43999817	1/24/2015 5 52	75.1200021	1/24/2015 5 59	72.67999909	1/24/2015 5 38	75.44000282	1/24/2015 4 45	76.31
1/24/2015 6 56	72.98000251	1/24/2015 6 48	70.16000065	1/24/2015 5 35	73.81999768	1/24/2015 5 58	72.03	1/24/2015 5 58	68.62000252	1/24/2015 6 00	76.54000144	1/24/2015 6 57	70.30999822	1/24/2015 6 46	74.75000209	1/24/2015 6 03	71.8199991	1/24/2015 6 26	74.9300028	1/24/2015 5 56	75.3
1/24/2015 7 13	71.79000247	1/24/2015 7 56	69.03000064	1/24/2015 6 32	73.1799977	1/24/2015 6 50	71.64	1/24/2015 6 56	67.67000248	1/24/2015 7 00	76.54000144	1/24/2015 7 24	69.93999823	1/24/2015 7 23	74.29000208	1/24/2015 7 57	70.59999912	1/24/2015 7 55	73.73000276	1/24/2015 6 54	74.93
1/24/2015 8 57	71.36000246	1/24/2015 8 51	67.35000063	1/24/2015 7 54	71.70999775	1/24/2015 7 23	71	1/24/2015 7 13	66.57000244	1/24/2015 8 00	76.54000144	1/24/2015 8 57	71.46999819	1/24/2015 8 56	73.38000205	1/24/2015 8 57	68.03999915	1/24/2015 8 56	72.30000271	1/24/2015 7 54	74.32
1/24/2015 9 45	70.81000244	1/24/2015 9 59	66.07000061	1/24/2015 8 59	70.51999778	1/24/2015 8 59	69.71	1/24/2015 8 58	67.21000246	1/24/2015 9 00	76.54000144	1/24/2015 9 58	71.2799982	1/24/2015 9 38	73.26000205	1/24/2015 9 33	67.08999916	1/24/2015 9 32	71.26000267	1/24/2015 8 57	72.8
1/24/2015 10 28	70.17000242	1/24/2015 10 04	65.28000061	1/24/2015 9 17	69.9099978	1/24/2015 9 00	69.71	1/24/2015 9 26	67.15000246	1/24/2015 10 00	76.54000144	1/24/2015 10 11	71.64999819	1/24/2015 10 03	72.62000203	1/24/2015 10 03	66.07999917	1/24/2015 10 12	70.84000265	1/24/2015 9 59	71.64
1/24/2015 11 57	69.99000241	1/24/2015 11 01	65.49000061	1/24/2015 10 56	69.63999781	1/24/2015 10 03	69.59	1/24/2015 10 38	67.00000246	1/24/2015 11 00	76.54000144	1/24/2015 11 01	71.61999819	1/24/2015 11 53	72.65000203	1/24/2015 11 01	66.01999917	1/24/2015 11 00	70.84000265	1/24/2015 10 04	71.42
1/24/2015 12 23	69.5300024	1/24/2015 12 02	66.01000061	1/24/2015 11 51	69.75999781	1/24/2015 11 21	69.29	1/24/2015 11 53	66.66000244	1/24/2015 12 00	76.54000144	1/24/2015 12 01	71.61999819	1/24/2015 12 07	73.13000205	1/24/2015 12 03	66.62999916	1/24/2015 12 18	71.54000268	1/24/2015 11 06	71.91
1/24/2015 13 03	70.33000243	1/24/2015 13 07	66.74000062	1/24/2015 12 02	69.8799978	1/24/2015 12 11	69.78	1/24/2015 12 11	66.91000245	1/24/2015 13 00	76.54000144	1/24/2015 13 30	68.89999825	1/24/2015 13 07	73.26000205	1/24/2015 13 04	67.26999915	1/24/2015 13 20	71.48000268	1/24/2015 12 02	72
1/24/2015 14 56	70.81000244	1/24/2015 14 30	67.35000063	1/24/2015 13 25	70.54999778	1/24/2015 13 19	69.74	1/24/2015 13 31	66.60000244	1/24/2015 14 00	76.54000144	1/24/2015 14 44	71.46999819	1/24/2015 14 31	73.26000205	1/24/2015 14 45	68.06999915	1/24/2015 14 31	72.48000271	1/24/2015 13 40	72.61
1/24/2015 15 02	70.48000243	1/24/2015 15 31	67.66000063	1/24/2015 14 58	70.82999777	1/24/2015 14 56	70.05	1/24/2015 14 02	67.24000246	1/24/2015 15 00	76.54000144	1/24/2015 15 24	71.61999819	1/24/2015 15 16	73.59000206	1/24/2015 15 26	68.64999914	1/24/2015 15 16	72.39000271	1/24/2015 14 11	73.22
1/24/2015 16 28	70.75000244	1/24/2015 16 16	67.44000063	1/24/2015 15 00	70.82999777	1/24/2015 15 08	70.08	1/24/2015 15 00	67.58000248	1/24/2015 16 00	76.54000144	1/24/2015 16 00	71.76999819	1/24/2015 16 36	73.07000204	1/24/2015 16 36	68.55999914	1/24/2015 16 50	72.64000272	1/24/2015 15 38	73.59
1/24/2015 17 20	68.65000237	1/24/2015 17 00	67.66000063	1/24/2015 16 23	70.73999778	1/24/2015 16 41	70.45	1/24/2015 16 00	67.73000248	1/24/2015 17 00	76.54000144	1/24/2015 17 37	71.85999818	1/24/2015 17 36	73.04000204	1/24/2015 17 32	68.58999914	1/24/2015 17 20	72.85000273	1/24/2015 16 18	73.47
1/24/2015 18 30	71.27000246	1/24/2015 18 01	67.75000063	1/24/2015 17 36	70.63999778	1/24/2015 17 03	70.45	1/24/2015 17 01	67.73000248	1/24/2015 18 00	76.54000144	1/24/2015 18 33	71.92999818	1/24/2015 18 00	73.77000206	1/24/2015 18 59	68.48999914	1/24/2015 18 33	73.06000273	1/24/2015 17 01	72.8
1/24/2015 19 03	71.97000248	1/24/2015 19 00	68.63000064	1/24/2015 18 44	71.09999776	1/24/2015 18 09	69.65	1/24/2015 18 30	67.82000249	1/24/2015 19 00	76.54000144	1/24/2015 19 28	72.16999818	1/24/2015 19 24	73.53000206	1/24/2015 19 03	69.09999913	1/24/2015 19 07	73.28000274	1/24/2015 18 53	73.56
1/24/2015 20 21	71.97000248	1/24/2015 20 24	68.85000064	1/24/2015 19 35	69.69999781	1/24/2015 19 00	70.42	1/24/2015 19 00	68.01000249	1/24/2015 20 00	76.54000144	1/24/2015 20 23	71.79999818	1/24/2015 20 20	73.96000207	1/24/2015 20 23	69.09999913	1/24/2015 20 09	73.80000276	1/24/2015 19 28	73.87
1/24/2015 21 15	72.5800025	1/24/2015 21 06	69.24000064	1/24/2015 20 52	72.04999774	1/24/2015 20 23	69.41	1/24/2015 20 23	67.67000248	1/24/2015 21 00	76.54000144	1/24/2015 21 01	72.25999817	1/24/2015 21 52	74.08000207	1/24/2015 21 02	70.29999912	1/24/2015 21 27	73.95000277	1/24/2015 20 44	73.93
1/24/2015 22 06	72.4900025	1/24/2015 22 02	69.64000065	1/24/2015 21 12	71.79999774	1/24/2015 21 14	71.12	1/24/2015 21 15	68.2500025	1/24/2015 22 00	76.54000144	1/24/2015 22 03	72.01999818	1/24/2015 22 03	74.02000207	1/24/2015 22 12	70.74999911	1/24/2015 22 02	74.07000277	1/24/2015 21 40	74.02
1/24/2015 23 22	73.99000255	1/24/2015 23 21	70.53000066	1/24/2015 22 03	72.22999773	1/24/2015 22 04	70.87	1/24/2015 22 14	68.74000252	1/24/2015 23 00	76.54000144	1/24/2015 23 01	72.62999816	1/24/2015 23 13	74.57000209	1/24/2015 23 04	71.08999911	1/24/2015 23 13	74.62000279	1/24/2015 22 11	74.72
1/25/2015 0 47	71.52000247	1/25/2015 0 03	70.92000066	1/24/2015 23 26	72.86999771	1/24/2015 23 03	71.73	1/24/2015 23 02	69.17000254	1/25/2015 0 00	76.54000144	1/25/2015 0 46	68.10999827	1/25/2015 0 46	73.19000205	1/25/2015 0 47	71.11999911	1/25/2015 0 47	74.35000278	1/24/2015 23 04	74.6
1/25/2015 1 03	73.74000254	1/25/2015 1 40	71.26000066	1/25/2015 0 46	71.58999775	1/25/2015 0 47	69.2	1/25/2015 0 47	65.63000241	1/25/2015 1 00	76.54000144	1/25/2015 1 00	71.73999819	1/25/2015 1 46	75.1200021	1/25/2015 1 02	72.54999909	1/25/2015 1 00	75.20000281	1/25/2015 0 46	75.09
1/25/2015 2 03	74.32000256	1/25/2015 2 04	71.69000067	1/25/2015 1 02	73.63999769	1/25/2015 1 32	71.85	1/25/2015 1 03	68.3100025	1/25/2015 2 00	76.54000144	1/25/2015 2 00	72.37999817	1/25/2015 2 43	75.0300021	1/25/2015 2 01	72.48999909	1/25/2015 2 44	75.60000283	1/25/2015 1 13	75.67
1/25/2015 3 11	74.84000258	1/25/2015 3 02	72.14000067	1/25/2015 2 11	73.75999768	1/25/2015 2 34	72.58	1/25/2015 2 03	68.98000253	1/25/2015 3 00	76.54000144	1/25/2015 3 03	73.01999816	1/25/2015 3 12	75.36000211	1/25/2015 3 12	73.28999908	1/25/2015 3 02	75.84000284	1/25/2015 2 00	75.97
1/25/2015 4 23	75.30000259	1/25/2015 4 14	72.24000067	1/25/2015 3 27	73.81999768	1/25/2015 3 06	72.49	1/25/2015 3 03	69.53000255	1/25/2015 4 00	76.54000144	1/25/2015 4 59	72.68999816	1/25/2015 4 22	75.27000211	1/25/2015 4 59	73.03999909	1/25/2015 4 59	75.81000284	1/25/2015 3 00	76.52
1/25/2015 5 53	74.81000258	1/25/2015 5 00	71.78000067	1/25/2015 4 57	74.14999767	1/25/2015 4 56	72.58	1/25/2015 4 19	69.56000255	1/25/2015 5 00	76.54000144	1/25/2015 5 49	72.65999816	1/25/2015 5 03	75.1500021	1/25/2015 5 08	72.82999909	1/25/2015 5 00	75.81000284	1/25/2015 4 30	76.55
1/25/2015 6 47	73.23000252	1/25/2015 6 55	71.05000066	1/25/2015 5 08	71.70999775	1/25/2015 5 24	72.4	1/25/2015 5 49	69.01000253	1/25/2015 6 00	76.54000144	1/25/2015 6 42	71.52999819	1/25/2015 6 37	74.69000209	1/25/2015 6 59	72.0999991	1/25/2015 6 47	75.23000281	1/25/2015 5 39	76.15
1/25/2015 7 38	71.49000246	1/25/2015 7 44	69.40000064	1/25/2015 6 17	73.1199977	1/25/2015 6 22	71.79	1/25/2015 6 47	68.1000025	1/25/2015 7 00	76.54000144	1/25/2015 7 39	69.93999823	1/25/2015 7 43	74.51000209	1/25/2015 7 43	70.65999911	1/25/2015 7 43	74.07000277	1/25/2015 6 46	75.42

1/25/2015 8 44	71.67000247	1/25/2015 8 46	67.44000063	1/25/2015 7 51	72.74999771	1/25/2015 7 36	70.87	1/25/2015 7 38	66.21000243	1/25/2015 8 00	76.54000144	1/25/2015 8 28	72.01999818	1/25/2015 8 57	73.59000206	1/25/2015 8 57	68.61999914	1/25/2015 8 54	72.85000273	1/25/2015 7 44	74.69
1/25/2015 9 09	70.20000242	1/25/2015 9 39	65.61000061	1/25/2015 8 57	71.37999776	1/25/2015 8 57	69.71	1/25/2015 8 05	68.1000025	1/25/2015 9 00	76.54000144	1/25/2015 9 09	71.2799982	1/25/2015 9 32	72.92000204	1/25/2015 9 54	66.23999917	1/25/2015 9 39	71.11000266	1/25/2015 8 42	73.59
1/25/2015 10 19	69.99000241	1/25/2015 10 59	65.1800006	1/25/2015 9 15	70.45999778	1/25/2015 9 48	69.01	1/25/2015 9 09	67.00000246	1/25/2015 10 00	76.54000144	1/25/2015 10 33	71.58999819	1/25/2015 10 31	72.92000204	1/25/2015 10 28	65.86999917	1/25/2015 10 00	70.59000264	1/25/2015 9 44	72.22
1/25/2015 11 17	69.81000241	1/25/2015 11 03	65.0900006	1/25/2015 10 46	68.92999783	1/25/2015 10 17	69.56	1/25/2015 10 25	67.12000246	1/25/2015 11 00	76.54000144	1/25/2015 11 39	71.3499982	1/25/2015 11 00	72.95000204	1/25/2015 11 28	65.98999917	1/25/2015 11 18	70.44000264	1/25/2015 10 21	71.88
1/25/2015 12 39	69.96000241	1/25/2015 12 13	65.89000061	1/25/2015 11 24	69.54999781	1/25/2015 11 25	69.29	1/25/2015 11 46	67.09000246	1/25/2015 12 00	76.54000144	1/25/2015 12 29	71.1599982	1/25/2015 12 23	72.92000204	1/25/2015 12 33	66.50999916	1/25/2015 12 16	71.35000267	1/25/2015 11 55	71.91
1/25/2015 13 08	70.45000243	1/25/2015 13 01	65.58000061	1/25/2015 12 09	69.9099978	1/25/2015 12 39	69.87	1/25/2015 12 10	66.91000245	1/25/2015 13 00	76.54000144	1/25/2015 13 59	71.0999982	1/25/2015 13 20	73.23000205	1/25/2015 13 02	67.39999915	1/25/2015 13 02	71.32000267	1/25/2015 12 22	72.28
1/25/2015 14 01	69.4400024	1/25/2015 14 22	66.74000062	1/25/2015 13 56	70.45999778	1/25/2015 13 28	69.78	1/25/2015 13 59	67.27000247	1/25/2015 14 00	76.54000144	1/25/2015 14 00	68.44999826	1/25/2015 14 01	72.89000204	1/25/2015 14 01	67.32999915	1/25/2015 14 59	72.30000271	1/25/2015 13 06	72.46
1/25/2015 15 01	71.42000246	1/25/2015 15 19	66.53000062	1/25/2015 14 00	70.57999778	1/25/2015 14 01	69.1	1/25/2015 14 01	66.45000244	1/25/2015 15 00	76.54000144	1/25/2015 15 50	71.64999819	1/25/2015 15 39	73.23000205	1/25/2015 15 08	67.93999915	1/25/2015 15 00	72.30000271	1/25/2015 14 01	71.97
1/25/2015 16 09	71.18000245	1/25/2015 16 10	67.05000062	1/25/2015 15 42	69.8499978	1/25/2015 15 32	69.99	1/25/2015 15 36	67.40000247	1/25/2015 16 00	76.54000144	1/25/2015 16 10	71.67999819	1/25/2015 16 13	73.50000206	1/25/2015 16 00	68.24999914	1/25/2015 16 06	72.54000272	1/25/2015 15 41	73.13
1/25/2015 17 07	71.03000245	1/25/2015 17 42	65.76000061	1/25/2015 16 24	70.27999779	1/25/2015 16 42	70.23	1/25/2015 16 11	67.58000248	1/25/2015 17 00	76.54000144	1/25/2015 17 46	71.58999819	1/25/2015 17 46	73.07000204	1/25/2015 17 25	67.75999915	1/25/2015 17 47	71.75000269	1/25/2015 16 32	72.89
1/25/2015 18 12	71.36000246	1/25/2015 18 50	66.71000062	1/25/2015 17 17	69.78999781	1/25/2015 17 54	70.32	1/25/2015 17 46	67.33000247	1/25/2015 18 00	76.54000144	1/25/2015 18 39	71.89999818	1/25/2015 18 44	73.04000204	1/25/2015 18 53	67.57999915	1/25/2015 18 35	71.81000269	1/25/2015 17 16	72.86
1/25/2015 19 02	70.97000245	1/25/2015 19 01	66.34000062	1/25/2015 18 46	70.42999779	1/25/2015 18 45	70.11	1/25/2015 18 00	67.61000248	1/25/2015 19 00	76.54000144	1/25/2015 19 00	71.76999819	1/25/2015 19 58	73.44000205	1/25/2015 19 01	67.57999915	1/25/2015 19 25	71.96000269	1/25/2015 18 34	72.06
1/25/2015 20 16	71.42000246	1/25/2015 20 00	67.57000063	1/25/2015 19 18	70.33999779	1/25/2015 19 06	70.39	1/25/2015 19 33	67.55000248	1/25/2015 20 00	76.54000144	1/25/2015 20 20	71.61999819	1/25/2015 20 00	73.44000205	1/25/2015 20 06	68.48999914	1/25/2015 20 11	72.36000271	1/25/2015 19 42	72.86
1/25/2015 21 01	71.55000247	1/25/2015 21 00	68.33000063	1/25/2015 20 00	70.63999778	1/25/2015 20 51	70.36	1/25/2015 20 37	67.82000249	1/25/2015 21 00	76.54000144	1/25/2015 21 51	71.92999818	1/25/2015 21 05	74.02000207	1/25/2015 21 34	69.28999913	1/25/2015 21 00	73.40000275	1/25/2015 20 02	73.13
1/25/2015 22 01	71.97000248	1/25/2015 22 12	69.21000064	1/25/2015 21 07	72.31999773	1/25/2015 21 20	70.2	1/25/2015 21 01	68.07000249	1/25/2015 22 00	76.54000144	1/25/2015 22 01	71.98999818	1/25/2015 22 01	74.02000207	1/25/2015 22 01	69.34999913	1/25/2015 22 02	73.73000276	1/25/2015 21 02	73.93
1/25/2015 23 46	73.29000252	1/25/2015 23 00	70.43000065	1/25/2015 22 01	72.28999773	1/25/2015 22 01	70.75	1/25/2015 22 01	67.61000248	1/25/2015 23 00	76.54000144	1/25/2015 23 24	72.25999817	1/25/2015 23 28	74.66000209	1/25/2015 23 24	71.5199991	1/25/2015 23 13	74.59000279	1/25/2015 22 01	74.11
1/26/2015 0 48	73.47000253	1/26/2015 0 47	70.50000066	1/25/2015 23 21	72.74999771	1/25/2015 23 21	71.94	1/25/2015 23 01	69.14000253	1/26/2015 0 00	76.54000144	1/26/2015 0 47	68.95999825	1/26/2015 0 47	73.53000206	1/26/2015 0 47	70.32999912	1/26/2015 0 10	75.41000282	1/25/2015 23 03	74.87
1/26/2015 1 06	73.80000254	1/26/2015 1 02	71.41000066	1/26/2015 0 47	71.24999776	1/26/2015 0 48	71.85	1/26/2015 0 48	68.2500025	1/26/2015 1 00	76.54000144	1/26/2015 1 48	71.64999819	1/26/2015 1 47	75.30000211	1/26/2015 1 01	72.70999909	1/26/2015 1 00	75.63000283	1/26/2015 0 47	73.74
1/26/2015 2 00	74.84000258	1/26/2015 2 05	72.27000067	1/26/2015 1 18	73.90999768	1/26/2015 1 00	72.31	1/26/2015 1 48	68.43000251	1/26/2015 2 00	76.54000144	1/26/2015 2 01	72.56999817	1/26/2015 2 38	74.8700021	1/26/2015 2 06	73.25999908	1/26/2015 2 00	76.02000284	1/26/2015 1 00	76
1/26/2015 3 55	75.24000259	1/26/2015 3 50	72.36000067	1/26/2015 2 32	73.50999769	1/26/2015 2 00	72.58	1/26/2015 2 00	69.23000254	1/26/2015 3 00	76.54000144	1/26/2015 3 55	72.65999816	1/26/2015 3 41	75.27000211	1/26/2015 3 26	73.19999908	1/26/2015 3 17	76.12000285	1/26/2015 2 06	75.82
1/26/2015 4 36	73.93000255	1/26/2015 4 42	71.01000066	1/26/2015 3 41	74.08999767	1/26/2015 3 47	72.4	1/26/2015 3 55	69.47000255	1/26/2015 4 00	76.54000144	1/26/2015 4 40	71.82999818	1/26/2015 4 02	74.63000209	1/26/2015 4 58	72.39999909	1/26/2015 4 58	75.54000283	1/26/2015 3 31	76.58
1/26/2015 5 32	72.6800025	1/26/2015 5 40	68.97000064	1/26/2015 4 01	73.96999768	1/26/2015 4 41	71.79	1/26/2015 4 41	68.2500025	1/26/2015 5 00	76.54000144	1/26/2015 5 33	70.82999821	1/26/2015 5 54	74.05000207	1/26/2015 5 54	70.62999911	1/26/2015 5 54	73.70000276	1/26/2015 4 59	75.09
1/26/2015 6 03	71.39000246	1/26/2015 6 58	66.50000062	1/26/2015 5 56	73.1499977	1/26/2015 5 54	71.73	1/26/2015 5 32	67.58000248	1/26/2015 6 00	76.54000144	1/26/2015 6 03	71.1599982	1/26/2015 6 23	73.62000206	1/26/2015 6 56	68.12999914	1/26/2015 6 41	72.0300027	1/26/2015 5 38	74.78
1/26/2015 7 27	70.91000245	1/26/2015 7 03	66.34000062	1/26/2015 6 50	71.70999775	1/26/2015 6 56	69.93	1/26/2015 6 03	66.39000243	1/26/2015 7 00	76.54000144	1/26/2015 7 36	71.2799982	1/26/2015 7 51	72.77000204	1/26/2015 7 23	67.63999915	1/26/2015 7 08	71.48000268	1/26/2015 6 56	73.01
1/26/2015 8 04	70.42000243	1/26/2015 8 04	67.60000063	1/26/2015 7 31	71.03999777	1/26/2015 7 46	69.71	1/26/2015 7 03	67.03000246	1/26/2015 8 00	76.54000144	1/26/2015 8 04	68.44999826	1/26/2015 8 43	73.19000205	1/26/2015 8 05	68.55999914	1/26/2015 8 15	72.94000273	1/26/2015 7 10	72.8
1/26/2015 9 02	71.39000246	1/26/2015 9 33	65.1800006	1/26/2015 8 34	71.43999775	1/26/2015 8 12	70.32	1/26/2015 8 04	64.19000235	1/26/2015 9 00	76.54000144	1/26/2015 9 28	70.73999821	1/26/2015 9 28	72.68000203	1/26/2015 9 33	68.24999914	1/26/2015 9 32	72.2100027	1/26/2015 8 05	73.38
1/26/2015 10 49	70.97000245	1/26/2015 10 15	66.47000062	1/26/2015 9 16	71.67999775	1/26/2015 9 31	69.74	1/26/2015 9 00	67.49000247	1/26/2015 10 00	76.54000144	1/26/2015 10 19	71.0999982	1/26/2015 10 17	73.19000205	1/26/2015 10 15	69.13999913	1/26/2015 10 11	72.82000273	1/26/2015 9 59	73.29
1/26/2015 11 07	71.67000247	1/26/2015 11 46	68.18000063	1/26/2015 10 17	70.42999779	1/26/2015 10 14	69.38	1/26/2015 10 35	67.55000248	1/26/2015 11 00	76.54000144	1/26/2015 11 27	70.82999821	1/26/2015 11 21	72.89000204	1/26/2015 11 34	69.28999913	1/26/2015 11 47	73.52000275	1/26/2015 10 00	73.29
1/26/2015 12 55	70.11000242	1/26/2015 12 06	67.81000063	1/26/2015 11 27	71.70999775	1/26/2015 11 57	70.63	1/26/2015 11 30	67.24000246	1/26/2015 12 00	76.54000144	1/26/2015 12 02	70.51999822	1/26/2015 12 05	73.38000205	1/26/2015 12 02	68.85999914	1/26/2015 12 03	73.34000274	1/26/2015 11 45	73.26
1/26/2015 13 52	71.00000245	1/26/2015 13 01	68.11000063	1/26/2015 12 26	71.21999776	1/26/2015 12 28	69.62	1/26/2015 12 44	67.21000246	1/26/2015 13 00	76.54000144	1/26/2015 13 56	71.1299982	1/26/2015 13 25	73.59000206	1/26/2015 13 14	70.16999912	1/26/2015 13 48	73.80000276	1/26/2015 12 07	73.16
1/26/2015 14 54	70.78000244	1/26/2015 14 09	67.38000063	1/26/2015 13 11	71.49999775	1/26/2015 13 09	70.26	1/26/2015 13 09	67.52000247	1/26/2015 14 00	76.54000144	1/26/2015 14 53	70.51999822	1/26/2015 14 53	73.04000204	1/26/2015 14 09	69.80999912	1/26/2015 14 32	73.67000276	1/26/2015 13 58	73.65
1/26/2015 15 47	69.78000241	1/26/2015 15 52	67.87000063	1/26/2015 14 42	71.67999775	1/26/2015 14 54	69.59	1/26/2015 14 54	66.21000243	1/26/2015 15 00	76.54000144	1/26/2015 15 56	70.18999822	1/26/2015 15 28	73.56000206	1/26/2015 15 33	69.80999912	1/26/2015 15 33	73.55000275	1/26/2015 14 46	72.46
1/26/2015 16 23	70.57000243	1/26/2015 16 39	67.75000063	1/26/2015 15 06	72.19999773	1/26/2015 15 56	69.13	1/26/2015 15 56	66.33000243	1/26/2015 16 00	76.54000144	1/26/2015 16 23	70.54999821	1/26/2015 16 04	73.16000205	1/26/2015 16 35	69.34999913	1/26/2015 16 47	73.43000275	1/26/2015 15 52	72.8
1/26/2015 17 43	69.07000238	1/26/2015 17 46	67.17000062	1/26/2015 16 55	71.40999776	1/26/2015 16 35	70.11	1/26/2015 16 31	66.05000242	1/26/2015 17 00	76.54000144	1/26/2015 17 25	71.2799982	1/26/2015 17 16	73.81000207	1/26/2015 17 35	68.88999914	1/26/2015 17 48	72.82000273	1/26/2015 16 55	73.32
1/26/2015 18 01	70.51000243	1/26/2015 18 27	66.83000062	1/26/2015 17 42	71.12999776	1/26/2015 17 34	70.08	1/26/2015 17 39	66.30000243	1/26/2015 18 00	76.54000144	1/26/2015 18 45	71.37999819	1/26/2015 18 58	73.16000205	1/26/2015 18 20	68.33999914	1/26/2015 18 58	72.61000272	1/26/2015 17 33	72.68
1/26/2015 19 55	71.70000247	1/26/2015 19 09	67.14000062	1/26/2015 18 45	72.04999774	1/26/2015 18 09	69.9	1/26/2015 18 49	67.49000247	1/26/2015 19 00	76.54000144	1/26/2015 19 54	70.91999821	1/26/2015 19 00	73.16000205	1/26/2015 19 33	68.85999914	1/26/2015 19 31	72.54000272	1/26/2015 18 25	72.71
1/26/2015 20 11	69.99000241	1/26/2015 20 07	67.29000062	1/26/2015 19 45	71.18999776	1/26/2015 19 24	70.51	1/26/2015 19 34	67.15000246	1/26/2015 20 00	76.54000144	1/26/2015 20 07	70.88999821	1/26/2015 20 33	73.23000205	1/26/2015 20 08	69.31999913	1/26/2015 20 12	72.97000273	1/26/2015 19 03	73.29
1/26/2015 21 19	71.79000247	1/26/2015 21 03	67.47000063	1/26/2015 20 00	71.58999775	1/26/2015 20 52	70.54	1/26/2015 20 07	67.12000246	1/26/2015 21 00	76.54000144	1/26/2015 21 58	71.67999819	1/26/2015 21 58	73.35000205	1/26/2015 21 23	69.34999913	1/26/2015 21 23	72.85000273	1/26/2015 20 07	73.41
1/26/2015 22 02	72.16000249	1/26/2015 22 03	69.31000064	1/26/2015 21 59	69.9699978	1/26/2015 21 02	70.45	1/26/2015 21 15	67.46000247	1/26/2015 22 00	76.54000144	1/26/2015 22 09	71.61999819	1/26/2015 22 00	73.35000205	1/26/2015 22 01	69.92999912	1/26/2015 22 59	73.25000274	1/26/2015 21 54	73.77
1/26/2015 23 00	73.84000254	1/26/2015 23 00	66.74000062	1/26/2015 22 00	69.9699978	1/26/2015 22 12	71.03	1/26/2015 22 00	67.73000248	1/26/2015 23 00	76.54000144	1/26/2015 23 01	71.64999819	1/26/2015 23 01	73.71000206	1/26/2015 23 00	68.03999915	1/26/2015 23 00	73.25000274	1/26/2015 22 06	74.08
1/27/2015 0 06	70.97000245	1/27/2015 0 05	70.62000066	1/26/2015 23 00	72.19999773	1/26/2015 23 02	71.45	1/26/2015 23 00	68.95000253	1/27/2015 0 00	76.54000144	1/27/2015 0 06	68.80999826	1/27/2015 0 06	74.02000207	1/27/2015 0 06	70.93999911	1/27/2015 0 07	75.23000281	1/26/2015 23 00	70.66
1/27/2015 1 03	73.44000253	1/27/2015 1 08	71.47000066	1/27/2015 0 07	72.95999771	1/27/2015 0 06	70.17	1/27/2015 0 06	64.98000238	1/27/2015 1 00	76.54000144	1/27/2015 1 02	71.40999819	1/27/2015 1 26	74.9300021	1/27/2015 1 06	72.1599991	1/27/2015 1 04	75.41000282	1/27/2015 0 06	74.6
1/27/2015 2 48	74.72000257	1/27/2015 2 32	71.78000067	1/27/2015 1 04	74.02999767	1/27/2015 1 03	71.76	1/27/2015 1 30	68.71000252	1/27/2015 2 00	76.54000144	1/27/2015 2 03	72.40999817	1/27/2015 2 46	75.30000211	1/27/2015 2 33	72.97999909	1/27/2015 2 33	75.75000283	1/27/2015 1 03	75.12
1/27/2015 3 38	74.35000256	1/27/2015 3 28	71.59000067	1/27/2015 2 08	74.33999766	1/27/2015 2 46	72.06	1/27/2015 2 46	68.89000253	1/27/2015 3 00	76.54000144	1/27/2015 3 38	71.49999819	1/27/2015 3 04	75.1800021	1/27/2015 3 38	72.64999909	1/27/2015 3 39	75.47000282	1/27/2015 2 31	75.61
1/27/2015 4 50	74.08000255	1/27/2015 4 37	71.14000066	1/27/2015 3 58	74.24999767	1/27/2015 3 42	71.73	1/27/2015 3 38	68.3100025	1/27/2015 4 00	76.54000144	1/27/2015 4 44	71.1599982	1/27/2015 4 41	75.0300021	1/27/2015 4 37	72.45999909	1/27/2015 4 38	75.17000281	1/27/2015 3 29	75.67
1/27/2015 5 33	71.30000246	1/27/2015 5 48	68.82000064	1/27/2015 4 40	73.99999768	1/27/2015 4 37	71.94	1/27/2015 4 13	68.71000252	1/27/2015 5 00	76.54000144	1/27/2015 5 44	69.63999824	1/27/2015 5 34	74.26000208	1/27/2015 5 53	70.29999912	1/27/2015 5 59	74.28000278	1/27/2015 4 38	75.39
1/27/2015 6 56	70.45000243	1/27/2015 6 31	67.02000062	1/27/2015 5 58	72.44999772	1/27/2015 5 43	70.84	1/27/2015 5 43	65.72000241	1/27/2015 6 00	76.54000144	1/27/2015 6 48	71.43999819	1/27/2015 6 48	72.77000204	1/27/2015 6 47	67.75999915	1/27/2015 6 51	72.0000027	1/27/2015 5 53	73.04
1/27/2015 7 44	70.26000242	1/27/2015 7 09	66.83000062	1/27/2015 6 47	70.0599978	1/27/2015 6 47	69.81	1/27/2015 6 56	67.03000246	1/27/2015 7 00	76.54000144	1/27/2015 7 24	70.9799982	1/27/2015 7 29	72.89000204	1/27/2015 7 06	67.08999916	1/27/2015 7 04	71.90000269	1/27/2015 6 56	73.01
1/27/2015 8 27	71.03000245	1/27/2015 8 13	67.72000063	1/27/2015 7 09	70.66999778	1/27/2015 7 50	69.53	1/27/2015 7 44	66.57000244	1/27/2015 8 00	76.54000144	1/27/2015 8 06	68.47999826	1/27/2015 8 04	72.74000203	1/27/2015 8 04	69.03999913	1/27/2015 8 00	72.82000273	1/27/2015 7 24	72.74
1/27/2015 9 24	71.55000247	1/27/2015 9 13	67.84000063	1/27/2015 8 36	70.39999779	1/27/2015 8 00	69.99	1/27/2015 8 08	66.57000244	1/27/2015 9 00	76.54000144	1/27/2015 9 50	70.33999822	1/27/2015 9 50	73.53000206	1/27/2015 9 12	69.46999913	1/27/2015 9 18	73.46000275	1/27/2015 8 29	73.32
1/27/2015 10 22	70.57000243	1/27/2015 10 46	67.99000063	1/27/2015 9 14	71.52999775	1/27/2015 9 24	70.51	1/27/2015 9 53	66.94000245	1/27/2015 10 00	76.54000144	1/27/2015 10 37	70.05999823	1/27/2015 10 19	72.98000204	1/27/2015 10 54	69.77999913	1/27/2015 10 34	73.55000275	1/27/2015 9 49	73.32
1/27/2015 11 28	69.5900024	1/27/2015 11 11	67.47000063	1/27/2015 10 53	71.55999775	1/27/2015 10 45	70.05	1/27/2015 10 22	66.30000243	1/27/2015 11 00	76.54000144	1/27/2015 11 07	69.14999825	1/27/2015 11 00	72.83000204	1/27/2015 11 50	69.34999913	1/27/2015 11 07	73.16000274	1/27/2015 10 38	73.22
1/27/2015 12 57	70.69000244	1/27/2015 12 33	68.54000064	1/27/2015 11 02	70.70999778	1/27/2015 11 00	70.29	1/27/2015 11 29	66.82000245	1/27/2015 12 00	76.54000144	1/27/2015 12 58	71.1299982	1/27/2015 12 54	73.01000204	1/27/2015 12 09	69.43999913	1/27/2015 12 27	73.28000274	1/27/2015 11 11	73.32
1/27/2015 13 32	69.75000241	1/27/2015 13 24	68.51000064	1/27/2015 12 09	71.12999776	1/27/2015 12 33	70.45	1/27/2015 12 58	67.15000246	1/27/2015 13 00	76.54000144	1/27/2015 13 32	70.82999821	1/27/2015 13 36	72.19000202	1/27/2015 13 36	69.58999913	1/27/2015 13 00	73.67000276	1/27/2015 12 58	73.04
1/27/2015 14 30	71.09000245	1/27/2015 14 43	68.39000064	1/27/2015 13 36	70.15999779	1/27/2015 13 27	70.23	1/27/2015 13 32	65.99000242	1/27/2015 14 00	76.54000144	1/27/2015 14 48	70.91999821	1/27/2015 14 13	73.26000205	1/27/2015 14 58	70.16999912	1/27/2015 14 18	73.98000277	1/27/2015 13 00	73.04
1/27/2015 15 06	71.33000246	1/27/2015 15 56	67.75000063	1/27/2015 14 35	71.76999774	1/27/2015 14 39	69.9	1/27/2015 14 23	66.88000245	1/27/2015 15 00	76.54000144	1/27/2015 15 01	70.21999822	1/27/2015 15 17	73.59000206	1/27/2015 15 06	70.01999912	1/27/2015 15 57	73.37000275	1/27/2015 14 21	73.71
1/27/2015 16 20	71.33000246	1/27/2015 16 53	67.14000062	1/27/2015 15 48	71.52999775	1/27/2015 15 12	70.42	1/27/2015 15 02	66.88000245	1/27/2015 16 00	76.54000144	1/27/2015 16 19	70.57999821	1/27/2015 16 24	73.56000206	1/27/2015 16 24	69.55999913	1/27/2015 16 00	73.37000275	1/27/2015 15 57	72.8
1/27/2015 17 48	70.39000243	1/27/2015 17 01	66.86000062	1/27/2015 16 24	70.18999779	1/27/2015 16 58	70.54	1/27/2015 16 20	66.63000244	1/27/2015 17 00	76.54000144	1/27/2015 17 17	71.2199982	1/27/2015 17 26	73.74000206	1/27/2015 17 51	68.51999914	1/27/2015 17 00	73.06000273	1/27/2015 16 53	73.47
1/27/2015 18 02	70.33000243	1/27/2015 18 06	67.14000062	1/27/2015 17 22	70.70999778	1/27/2015 17 45	70.32	1/27/2015 17 00	66.82000245	1/27/2015 18 00	76.54000144	1/27/2015 18 47	71.37999819	1/27/2015 18 47	73.38000205	1/27/2015 18 06	68.18999914	1/27/2015 18 22	72.48000271	1/27/2015 17 40	72.52
1/27/2015 19 47	70.97000245	1/27/2015 19 04	66.77000062	1/27/2015 18 44	71.28999776	1/27/2015 18 50	70.2	1/27/2015 18 02	66.11000242	1/27/2015 19 00	76.54000144	1/27/2015 19 04	71.37999819	1/27/2015 19 07	73.62000206	1/27/2015 19 34	68.79999914	1/27/2015 19 08	72.70000272	1/27/2015 18 06	72.89
1/27/2015 20 45	72.22000249	1/27/2015 20 09	68.05000063	1/27/2015 19 00	70.63999778	1/27/2015 19 33	70.11	1/27/2015 19 47	66.88000245	1/27/2015 20 00	76.54000144	1/27/2015 20 04	72.01999818	1/27/2015 20 12	73.59000206	1/27/2015 20 34	69.46999913	1/27/2015 20 30	73.19000274	1/27/2015 19 34	71.91
1/27/2015 21 28	71.06000245	1/27/2015 21 09	68.63000064	1/27/2015 20 07	71.03999777	1/27/2015 20 24	70.45	1/27/2015 20 04	67.52000247	1/27/2015 21 00	76.54000144	1/27/2015 21 48	71.73999819	1/27/2015 21 49	73.23000205	1/27/2015 21 04	69.92999912	1/27/2015 21 12	73.49000275	1/27/2015 20 49	73.71
1/27/2015 22 14	72.03000248	1/27/2015 22 50	66.92000062	1/27/2015 21 57	72.13999773	1/27/2015 21 49	69.87	1/27/2015 21 49	67.40000247	1/27/2015 22 00	76.54000144	1/27/2015 22 50	71.98999818	1/27/2015 22 51	73.16000205	1/27/2015 22 50	67.48999915	1/27/2015 22 51	73.55000275	1/27/2015 21 48	73.96
1/27/2015 23 55	69.07000238	1/27/2015 23 05	70.19000065	1/27/2015 22 51	71.21999776	1/27/2015 22 51	71.06	1/27/2015 22 51	67.88000249	1/27/2015 23 00	76.54000144	1/27/2015 23 54	68.53999826	1/27/2015 23 55	73.74000206	1/27/2015 23 55	71.26999911	1/27/2015 23 55	74.04000277	1/27/2015 22 50	74.17
1/28/2015 0 01	72.74000251	1/28/2015 0 33	71.08000066	1/27/2015 23 54	72.92999771	1/27/2015 23 54	69.84	1/27/2015 23 55	64.71000237	1/28/2015 0 00	76.54000144	1/28/2015 0 00	71.3199982	1/28/2015 0 01	74.9300021	1/28/2015 0 00	71.9699991	1/28/2015 0 00	75.32000282	1/27/2015 23 01	74.69
1/28/2015 1 15	74.17000255	1/28/2015 1 11	71.59000067	1/28/2015 0 01	73.56999769	1/28/2015 0 01	71.85	1/28/2015 0 01	67.40000247	1/28/2015 1 00	76.54000144	1/28/2015 1 10	72.28999817	1/28/2015 1 10	74.9700021	1/28/2015 1 02	72.88999909	1/28/2015 1 15	75.63000283	1/28/2015 0 05	75.21
1/28/2015 2 39	73.99000255	1/28/2015 2 02	71.56000067	1/28/2015 1 20	73.93999768	1/28/2015 1 44	72.22	1/28/2015 1 01	68.89000253	1/28/2015 2 00	76.54000144	1/28/2015 2 07	72.92999816	1/28/2015 2 38	74.9700021	1/28/2015 2 01	73.03999909	1/28/2015 2 01	75.51000283	1/28/2015 1 00	75.73
1/28/2015 3 39	74.45000256	1/28/2015 3 15	72.27000067	1/28/2015 2 36	73.87999768	1/28/2015 2 51	72.13	1/28/2015 2 21	69.35000254	1/28/2015 3 00	76.54000144	1/28/2015 3 42	72.86999816	1/28/2015 3 33	74.9700021	1/28/2015 3 15	72.94999909	1/28/2015 3 30	76.05000285	1/28/2015 2 12	76
1/28/2015 4 14	73.90000254	1/28/2015 4 49	71.41000066	1/28/2015 3 45	74.27999767	1/28/2015 3 10	72.31	1/28/2015 3 37	69.44000255	1/28/2015 4 00	76.54000144	1/28/2015 4 14	72.37999817	1/28/2015 4 18	75.1800021	1/28/2015 4 53	72.51999909	1/28/2015 4 14	75.44000282	1/28/2015 3 24	76.22
1/28/2015 5 49	71.55000247	1/28/2015 5 51	69.40000064	1/28/2015 4 56	73.72999768	1/28/2015 4 47	72.43	1/28/2015 4 14	68.2200025	1/28/2015 5 00	76.54000144	1/28/2015 5 53	70.42999822	1/28/2015 5 47	74.66000209	1/28/2015 5 52	71.26999911	1/28/2015 5 52	74.62000279	1/28/2015 4 58	75.61
1/28/2015 6 55	72.4600025	1/28/2015 6 34	68.08000063	1/28/2015 5 10	73.59999769	1/28/2015 5 53	71.3	1/28/2015 5 53	66.57000244	1/28/2015 6 00	76.54000144	1/28/2015 6 41	72.07999818	1/28/2015 6 57	73.68000206	1/28/2015 6 48	68.79999914	1/28/2015 6 42	72.76000272	1/28/2015 5 52	73.74
1/28/2015 7 17	71.52000247	1/28/2015 7 05	66.95000062	1/28/2015 6 57	71.76999774	1/28/2015 6 57	70.45	1/28/2015 6 03	67.76000248	1/28/2015 7 00	76.54000144	1/28/2015 7 14	71.67999819	1/28/2015 7 10	73.35000205	1/28/2015 7 11	67.72999915	1/28/2015 7 10	71.78000269	1/28/2015 6 03	73.5
1/28/2015 8 19	72.00000248	1/28/2015 8 02	68.60000064	1/28/2015 7 03	71.43999775	1/28/2015 7 11	69.9	1/28/2015 7 11	67.09000246	1/28/2015 8 00	76.54000144	1/28/2015 8 03	71.85999818	1/28/2015 8 21	73.53000206	1/28/2015 8 01	69.52999913	1/28/2015 8 03	73.43000275	1/28/2015 7 03	73.13
1/28/2015 9 04	72.16000249	1/28/2015 9 21	68.63000064	1/28/2015 8 21	71.24999776	1/28/2015 8 09	70.69	1/28/2015 8 00	67.37000247	1/28/2015 9 00	76.54000144	1/28/2015 9 26	71.73999819	1/28/2015 9 20	73.56000206	1/28/2015 9 17	70.10999912	1/28/2015 9 27	74.13000277	1/28/2015 8 07	73.9
1/28/2015 10 22	72.07000248	1/28/2015 10 31	68.24000063	1/28/2015 9 26	72.50999772	1/28/2015 9 17	69.81	1/28/2015 9 43	67.43000247	1/28/2015 10 54	75.80000142	1/28/2015 10 50	71.55999819	1/28/2015 10 26	73.77000206	1/28/2015 10 23	70.38999912	1/28/2015 10 18	73.92000277	1/28/2015 9 53	73.96
1/28/2015 11 09	71.94000248	1/28/2015 11 06	68.66000064	1/28/2015 10 26	71.46999775	1/28/2015 10 43	70.72	1/28/2015 10 22	67.67000248	1/28/2015 11 06	75.38000142	1/28/2015 11 59	71.46999819	1/28/2015 11 15	73.32000205	1/28/2015 11 15	70.32999912	1/28/2015 11 16	73.83000276	1/28/2015 10 44	72.58
1/28/2015 12 38	72.10000248	1/28/2015 12 20	68.05000063	1/28/2015 11 15	71.21999776	1/28/2015 11 39	70.81	1/28/2015 11 24	67.76000248	1/28/2015 12 20	75.77000142	1/28/2015 12 49	71.64999819	1/28/2015 12 59	73.32000205	1/28/2015 12 10	70.38999912	1/28/2015 12 20	73.95000277	1/28/2015 11 53	73.93
1/28/2015 13 26	72.22000249	1/28/2015 13 03	69.00000064	1/28/2015 12 59	71.76999774	1/28/2015 12 19	70.72	1/28/2015 12 15	67.70000248	1/28/2015 13 00	76.17000143	1/28/2015 13 54	71.73999819	1/28/2015 13 00	73.32000205	1/28/2015 13 03	70.13999912	1/28/2015 13 23	74.01000277	1/28/2015 12 20	73.65
1/28/2015 14 47	72.4900025	1/28/2015 14 28	68.76000064	1/28/2015 13 00	71.76999774	1/28/2015 13 36	71.03	1/28/2015 13 51	67.67000248	1/28/2015 14 21	75.59000142	1/28/2015 14 48	71.2199982	1/28/2015 14 17	73.59000206	1/28/2015 14 27	70.50999912	1/28/2015 14 47	74.01000277	1/28/2015 13 37	74.23
1/28/2015 15 50	72.16000249	1/28/2015 15 51	68.54000064	1/28/2015 14 04	72.37999773	1/28/2015 14 47	69.78	1/28/2015 14 47	67.46000247	1/28/2015 15 27	75.74000142	1/28/2015 15 48	71.49999819	1/28/2015 15 04	73.77000206	1/28/2015 15 59	70.56999912	1/28/2015 15 52	74.19000278	1/28/2015 14 51	73.93
1/28/2015 16 41	71.27000246	1/28/2015 16 27	67.41000063	1/28/2015 15 57	72.65999772	1/28/2015 15 34	70.08	1/28/2015 15 06	67.73000248	1/28/2015 16 37	75.35000142	1/28/2015 16 27	71.82999818	1/28/2015 16 13	73.87000207	1/28/2015 16 37	70.13999912	1/28/2015 16 57	73.46000275	1/28/2015 15 51	74.14
1/28/2015 17 40	71.30000246	1/28/2015 17 54	67.75000063	1/28/2015 16 44	72.28999773	1/28/2015 16 17	70.42	1/28/2015 16 00	68.01000249	1/28/2015 17 30	75.04000141	1/28/2015 17 11	71.79999818	1/28/2015 17 10	73.47000206	1/28/2015 17 48	68.97999913	1/28/2015 17 48	72.94000273	1/28/2015 16 23	73.87
1/28/2015 18 59	71.61000247	1/28/2015 18 27	67.41000063	1/28/2015 17 07	71.73999775	1/28/2015 17 10	70.08	1/28/2015 17 41	67.58000248	1/28/2015 18 37	74.6700014	1/28/2015 18 29	71.70999819	1/28/2015 18 33	73.41000205	1/28/2015 18 43	68.27999914	1/28/2015 18 48	72.73000272	1/28/2015 17 45	72.98
1/28/2015 19 00	71.61000247	1/28/2015 19 06	67.72000063	1/28/2015 18 14	71.34999776	1/28/2015 18 24	70.32	1/28/2015 18 08	67.67000248	1/28/2015 19 37	75.10000141	1/28/2015 19 18	72.07999818	1/28/2015 19 43	73.99000207	1/28/2015 19 58	69.19999913	1/28/2015 19 07	73.09000274	1/28/2015 18 44	73.19
1/28/2015 20 00	72.71000251	1/28/2015 20 02	67.72000063	1/28/2015 19 09	71.28999776	1/28/2015 19 06	70.54	1/28/2015 19 18	67.76000248	1/28/2015 20 07	75.31000141	1/28/2015 20 34	72.22999817	1/28/2015 20 17	74.05000207	1/28/2015 20 02	69.13999913	1/28/2015 20 15	73.00000273	1/28/2015 19 06	73.13
1/28/2015 21 03	72.13000249	1/28/2015 21 00	68.39000064	1/28/2015 20 45	72.04999774	1/28/2015 20 16	70.78	1/28/2015 20 59	67.82000249	1/28/2015 21 03	75.56000142	1/28/2015 21 03	71.95999818	1/28/2015 21 07	73.62000206	1/28/2015 21 03	69.40999913	1/28/2015 21 04	73.19000274	1/28/2015 20 03	73.53
1/28/2015 22 05	72.95000251	1/28/2015 22 46	65.0600006	1/28/2015 21 23	71.89999774	1/28/2015 21 03	69.74	1/28/2015 21 00	67.82000249	1/28/2015 22 47	72.20000136	1/28/2015 22 47	72.22999817	1/28/2015 22 48	74.02000207	1/28/2015 22 47	67.39999915	1/28/2015 22 46	73.61000275	1/28/2015 21 03	73.38
1/28/2015 23 58	70.72000244	1/28/2015 23 58	70.34000065	1/28/2015 22 17	72.22999773	1/28/2015 22 23	71.3	1/28/2015 22 01	68.98000253	1/28/2015 23 59	76.81000144	1/28/2015 23 58	69.23999825	1/28/2015 23 15	74.54000209	1/28/2015 23 59	70.65999911	1/28/2015 23 59	73.70000276	1/28/2015 22 01	73.9
1/29/2015 0 00	70.72000244	1/29/2015 0 00	70.34000065	1/28/2015 23 00	73.41999769	1/28/2015 23 58	69.81	1/28/2015 23 58	65.5300024	1/29/2015 0 00	76.81000144	1/29/2015 0 03	71.70999819	1/29/2015 0 00	75.0300021	1/29/2015 0 03	71.9999991	1/29/2015 0 00	73.70000276	1/28/2015 23 08	74.66
1/29/2015 1 00	74.51000257	1/29/2015 1 20	71.69000067	1/29/2015 0 40	73.63999769	1/29/2015 0 00	69.81	1/29/2015 0 00	65.5300024	1/29/2015 1 02	78.03000146	1/29/2015 1 15	72.65999816	1/29/2015 1 21	75.36000211	1/29/2015 1 16	72.64999909	1/29/2015 1 01	75.54000283	1/29/2015 0 50	74.48
1/29/2015 2 01	74.90000258	1/29/2015 2 09	72.11000067	1/29/2015 1 10	74.14999767	1/29/2015 1 00	72.25	1/29/2015 1 00	69.32000254	1/29/2015 2 08	78.49000147	1/29/2015 2 01	73.14999815	1/29/2015 2 53	75.1500021	1/29/2015 2 01	73.22999908	1/29/2015 2 01	75.78000284	1/29/2015 1 22	75.85
1/29/2015 3 22	75.36000259	1/29/2015 3 15	72.36000067	1/29/2015 2 52	73.93999768	1/29/2015 2 20	72.31	1/29/2015 2 01	69.56000255	1/29/2015 3 56	78.73000148	1/29/2015 3 55	73.29999815	1/29/2015 3 46	75.45000211	1/29/2015 3 46	73.03999909	1/29/2015 3 51	76.09000285	1/29/2015 2 21	76.22
1/29/2015 4 32	74.90000258	1/29/2015 4 48	71.47000066	1/29/2015 3 06	74.27999767	1/29/2015 3 54	72.31	1/29/2015 3 55	69.81000256	1/29/2015 4 58	77.63000146	1/29/2015 4 57	72.86999816	1/29/2015 4 33	75.33000211	1/29/2015 4 59	72.64999909	1/29/2015 4 49	75.57000283	1/29/2015 3 55	76.12
1/29/2015 5 52	72.4300025	1/29/2015 5 38	69.43000065	1/29/2015 4 24	74.36999766	1/29/2015 4 44	72.06	1/29/2015 4 13	69.23000254	1/29/2015 5 39	76.44000144	1/29/2015 5 48	70.85999821	1/29/2015 5 52	74.54000209	1/29/2015 5 46	71.20999911	1/29/2015 5 46	74.7400028	1/29/2015 4 59	75.7
1/29/2015 6 41	72.4900025	1/29/2015 6 50	67.57000063	1/29/2015 5 50	72.62999772	1/29/2015 5 56	70.69	1/29/2015 5 54	67.15000246	1/29/2015 6 49	75.04000141	1/29/2015 6 58	72.43999817	1/29/2015 6 31	73.90000207	1/29/2015 6 52	67.93999915	1/29/2015 6 58	72.30000271	1/29/2015 5 38	74.11

1/29/2015 7 39	71.30000246	1/29/2015 7 14	67.02000062	1/29/2015 6 57	71.82999774	1/29/2015 6 41	70.78	1/29/2015 6 58	67.88000249	1/29/2015 7 02	74.5800014	1/29/2015 7 07	71.73999819	1/29/2015 7 56	73.10000205	1/29/2015 7 10	66.81999916	1/29/2015 7 10	71.66000268	1/29/2015 6 08	73.07
1/29/2015 8 55	70.87000244	1/29/2015 8 18	68.21000063	1/29/2015 7 45	70.33999779	1/29/2015 7 55	70.05	1/29/2015 7 39	67.55000248	1/29/2015 8 03	74.15000139	1/29/2015 8 36	69.44999824	1/29/2015 8 10	73.44000205	1/29/2015 8 01	68.94999913	1/29/2015 8 04	73.06000273	1/29/2015 7 30	72.68
1/29/2015 9 40	71.33000246	1/29/2015 9 59	68.66000064	1/29/2015 8 18	71.34999776	1/29/2015 8 37	69.56	1/29/2015 8 37	66.51000244	1/29/2015 9 54	75.04000141	1/29/2015 9 38	71.76999819	1/29/2015 9 47	72.95000204	1/29/2015 9 23	69.46999913	1/29/2015 9 11	73.43000275	1/29/2015 8 36	73.59
1/29/2015 10 18	71.09000245	1/29/2015 10 44	68.11000063	1/29/2015 9 46	70.45999778	1/29/2015 9 26	70.2	1/29/2015 9 01	67.67000248	1/29/2015 10 32	74.98000141	1/29/2015 10 55	71.79999818	1/29/2015 10 00	73.71000206	1/29/2015 10 21	69.86999912	1/29/2015 10 38	73.40000275	1/29/2015 9 19	73.87
1/29/2015 11 23	71.70000247	1/29/2015 11 24	68.54000064	1/29/2015 10 07	71.43999775	1/29/2015 10 32	70.48	1/29/2015 10 01	67.58000248	1/29/2015 11 23	75.50000142	1/29/2015 11 27	71.43999819	1/29/2015 11 12	73.38000205	1/29/2015 11 52	69.98999912	1/29/2015 11 31	73.86000276	1/29/2015 10 31	73.44
1/29/2015 12 50	69.96000241	1/29/2015 12 26	68.30000063	1/29/2015 11 20	71.43999775	1/29/2015 11 42	70.32	1/29/2015 11 23	67.70000248	1/29/2015 12 22	75.16000141	1/29/2015 12 44	71.1599982	1/29/2015 12 50	73.19000205	1/29/2015 12 14	69.71999913	1/29/2015 12 14	73.67000276	1/29/2015 11 18	73.68
1/29/2015 13 43	71.82000248	1/29/2015 13 06	68.97000064	1/29/2015 12 08	72.07999773	1/29/2015 12 25	70.05	1/29/2015 12 50	66.63000244	1/29/2015 13 38	75.50000142	1/29/2015 13 34	72.01999818	1/29/2015 13 03	73.71000206	1/29/2015 13 06	70.35999912	1/29/2015 13 31	73.67000276	1/29/2015 12 08	73.56
1/29/2015 14 43	71.18000245	1/29/2015 14 48	68.51000064	1/29/2015 13 44	72.07999773	1/29/2015 13 00	71.09	1/29/2015 13 48	67.21000246	1/29/2015 14 25	75.65000142	1/29/2015 14 40	71.55999819	1/29/2015 14 12	73.32000205	1/29/2015 14 43	70.22999912	1/29/2015 14 26	73.80000276	1/29/2015 13 06	73.93
1/29/2015 15 59	71.61000247	1/29/2015 15 12	68.33000063	1/29/2015 14 44	71.49999775	1/29/2015 14 00	70.57	1/29/2015 14 29	67.91000249	1/29/2015 15 59	75.28000141	1/29/2015 15 28	72.01999818	1/29/2015 15 55	73.44000205	1/29/2015 15 27	70.10999912	1/29/2015 15 52	73.73000276	1/29/2015 14 59	73.53
1/29/2015 16 47	70.26000242	1/29/2015 16 52	67.84000063	1/29/2015 15 30	71.28999776	1/29/2015 15 51	70.78	1/29/2015 15 59	67.85000249	1/29/2015 16 21	75.07000141	1/29/2015 16 11	71.3499982	1/29/2015 16 28	73.32000205	1/29/2015 16 59	69.34999913	1/29/2015 16 52	72.94000273	1/29/2015 15 59	73.07
1/29/2015 17 42	70.72000244	1/29/2015 17 30	66.99000062	1/29/2015 16 54	71.98999774	1/29/2015 16 28	70.2	1/29/2015 16 12	67.33000247	1/29/2015 17 24	74.3100014	1/29/2015 17 36	71.46999819	1/29/2015 17 23	73.29000205	1/29/2015 17 46	68.24999914	1/29/2015 17 57	72.45000271	1/29/2015 16 54	72.92
1/29/2015 18 19	69.6500024	1/29/2015 18 54	66.47000062	1/29/2015 17 14	70.79999777	1/29/2015 17 48	70.08	1/29/2015 17 32	67.06000246	1/29/2015 18 15	73.70000139	1/29/2015 18 14	71.49999819	1/29/2015 18 48	73.04000204	1/29/2015 18 23	67.78999915	1/29/2015 18 50	72.1200027	1/29/2015 17 39	72.25
1/29/2015 19 09	71.15000245	1/29/2015 19 00	67.08000062	1/29/2015 18 45	70.97999777	1/29/2015 18 03	69.9	1/29/2015 18 50	67.03000246	1/29/2015 19 44	74.5800014	1/29/2015 19 05	71.1599982	1/29/2015 19 25	73.53000206	1/29/2015 19 19	67.97999915	1/29/2015 19 19	72.0000027	1/29/2015 18 50	72.46
1/29/2015 20 41	71.27000246	1/29/2015 20 10	66.77000062	1/29/2015 19 21	71.31999776	1/29/2015 19 46	69.84	1/29/2015 19 05	66.82000245	1/29/2015 20 42	74.4900014	1/29/2015 20 41	71.40999819	1/29/2015 20 11	73.38000205	1/29/2015 20 17	68.36999914	1/29/2015 20 00	72.27000271	1/29/2015 19 21	72.86
1/29/2015 21 33	71.55000247	1/29/2015 21 13	67.47000063	1/29/2015 20 42	71.49999775	1/29/2015 20 41	69.93	1/29/2015 20 11	67.12000246	1/29/2015 21 07	75.59000142	1/29/2015 21 09	71.79999818	1/29/2015 21 09	73.35000205	1/29/2015 21 05	69.00999913	1/29/2015 21 07	72.51000271	1/29/2015 20 11	72.89
1/29/2015 22 33	71.58000247	1/29/2015 22 06	68.76000064	1/29/2015 21 36	71.40999776	1/29/2015 21 12	70.63	1/29/2015 21 02	67.98000249	1/29/2015 22 33	75.53000142	1/29/2015 22 01	71.89999818	1/29/2015 22 16	74.14000207	1/29/2015 22 08	69.86999912	1/29/2015 22 02	73.64000276	1/29/2015 21 08	73.26
1/29/2015 23 14	72.80000251	1/29/2015 23 12	69.12000064	1/29/2015 22 21	72.47999772	1/29/2015 22 45	70.63	1/29/2015 22 33	67.70000248	1/29/2015 23 00	76.69000144	1/29/2015 23 14	71.98999818	1/29/2015 23 14	73.71000206	1/29/2015 23 13	67.42999915	1/29/2015 23 00	74.62000279	1/29/2015 22 45	73.93
1/30/2015 0 26	71.03000245	1/30/2015 0 26	69.76000065	1/29/2015 23 11	72.95999771	1/29/2015 23 14	71.15	1/29/2015 23 14	67.73000248	1/30/2015 0 25	76.26000143	1/30/2015 0 25	69.63999824	1/30/2015 0 25	73.90000207	1/30/2015 0 25	70.59999912	1/30/2015 0 26	73.89000277	1/29/2015 23 13	70.6
1/30/2015 1 19	74.02000255	1/30/2015 1 00	71.11000066	1/30/2015 0 25	72.77999771	1/30/2015 0 26	69.59	1/30/2015 0 26	65.93000242	1/30/2015 1 15	77.63000146	1/30/2015 1 02	72.65999816	1/30/2015 1 50	74.9700021	1/30/2015 1 14	72.45999909	1/30/2015 1 01	75.32000282	1/30/2015 0 07	75.67
1/30/2015 2 21	74.20000255	1/30/2015 2 17	71.35000066	1/30/2015 1 28	74.08999767	1/30/2015 1 03	72.03	1/30/2015 1 03	69.01000253	1/30/2015 2 38	77.85000146	1/30/2015 2 20	72.25999817	1/30/2015 2 42	74.9700021	1/30/2015 2 38	72.0399991	1/30/2015 2 42	75.20000281	1/30/2015 1 00	74.84
1/30/2015 3 06	73.68000254	1/30/2015 3 10	71.41000066	1/30/2015 2 55	73.50999769	1/30/2015 2 46	71.24	1/30/2015 2 21	68.43000251	1/30/2015 3 02	78.00000146	1/30/2015 3 05	71.85999818	1/30/2015 3 06	74.81000209	1/30/2015 3 06	72.1899991	1/30/2015 3 07	75.14000281	1/30/2015 2 21	75.48
1/30/2015 4 23	73.26000252	1/30/2015 4 36	71.14000066	1/30/2015 3 06	73.53999769	1/30/2015 3 06	70.97	1/30/2015 3 02	68.37000251	1/30/2015 4 24	77.63000146	1/30/2015 4 23	72.04999818	1/30/2015 4 28	74.78000209	1/30/2015 4 58	72.33999909	1/30/2015 4 23	75.26000282	1/30/2015 3 06	75.94
1/30/2015 5 47	70.66000244	1/30/2015 5 57	69.21000064	1/30/2015 4 27	72.98999771	1/30/2015 4 57	72.06	1/30/2015 4 23	68.37000251	1/30/2015 5 48	76.26000143	1/30/2015 5 46	70.02999823	1/30/2015 5 47	74.05000207	1/30/2015 5 47	70.38999912	1/30/2015 5 57	73.58000275	1/30/2015 4 23	75.45
1/30/2015 6 51	71.82000248	1/30/2015 6 58	67.93000063	1/30/2015 5 47	72.50999772	1/30/2015 5 47	69.44	1/30/2015 5 47	66.08000242	1/30/2015 6 51	74.95000141	1/30/2015 6 45	71.46999819	1/30/2015 6 44	73.41000205	1/30/2015 6 49	67.93999915	1/30/2015 6 50	71.87000269	1/30/2015 5 47	73.96
1/30/2015 7 13	69.41000239	1/30/2015 7 33	65.25000061	1/30/2015 6 18	71.73999775	1/30/2015 6 44	69.68	1/30/2015 6 45	67.06000246	1/30/2015 7 22	73.85000139	1/30/2015 7 58	70.63999821	1/30/2015 7 34	72.89000204	1/30/2015 7 13	66.47999916	1/30/2015 7 09	70.74000265	1/30/2015 6 07	73.13
1/30/2015 8 03	70.08000242	1/30/2015 8 11	66.47000062	1/30/2015 7 59	71.03999777	1/30/2015 7 42	69.56	1/30/2015 7 55	66.24000243	1/30/2015 8 15	74.5200014	1/30/2015 8 02	71.2199982	1/30/2015 8 08	72.65000203	1/30/2015 8 02	68.30999914	1/30/2015 8 09	72.1800027	1/30/2015 7 19	72.74
1/30/2015 9 52	69.01000238	1/30/2015 9 23	67.75000063	1/30/2015 8 00	71.03999777	1/30/2015 8 42	69.93	1/30/2015 8 03	66.66000244	1/30/2015 9 45	74.2200014	1/30/2015 9 52	70.48999822	1/30/2015 9 49	72.71000203	1/30/2015 9 38	69.22999913	1/30/2015 9 02	72.82000273	1/30/2015 8 03	72.64
1/30/2015 10 06	71.03000245	1/30/2015 10 33	67.87000063	1/30/2015 9 21	71.18999776	1/30/2015 9 19	69.07	1/30/2015 9 52	65.90000242	1/30/2015 10 23	74.77000141	1/30/2015 10 33	70.85999821	1/30/2015 10 34	72.89000204	1/30/2015 10 07	69.13999913	1/30/2015 10 18	73.00000273	1/30/2015 9 01	72.8
1/30/2015 11 16	70.78000244	1/30/2015 11 20	67.63000063	1/30/2015 10 07	71.37999776	1/30/2015 10 06	69.74	1/30/2015 10 29	66.39000243	1/30/2015 11 31	74.95000141	1/30/2015 11 28	71.0699982	1/30/2015 11 22	73.07000204	1/30/2015 11 25	69.31999913	1/30/2015 11 40	73.16000274	1/30/2015 10 55	72.95
1/30/2015 12 35	69.5300024	1/30/2015 12 31	67.99000063	1/30/2015 11 57	71.67999775	1/30/2015 11 53	70.26	1/30/2015 11 53	67.09000246	1/30/2015 12 13	74.4900014	1/30/2015 12 13	70.91999821	1/30/2015 12 38	73.13000205	1/30/2015 12 37	68.64999914	1/30/2015 12 14	73.25000274	1/30/2015 11 41	73.13
1/30/2015 13 03	68.55000237	1/30/2015 13 08	67.47000063	1/30/2015 12 38	71.43999775	1/30/2015 12 01	69.87	1/30/2015 12 02	66.97000245	1/30/2015 13 04	74.4600014	1/30/2015 13 38	70.79999821	1/30/2015 13 04	73.35000205	1/30/2015 13 22	69.22999913	1/30/2015 13 13	73.43000275	1/30/2015 12 02	73.29
1/30/2015 14 30	70.78000244	1/30/2015 14 03	67.84000063	1/30/2015 13 19	71.92999774	1/30/2015 13 38	69.35	1/30/2015 13 03	66.02000242	1/30/2015 14 20	75.56000142	1/30/2015 14 31	70.76999821	1/30/2015 14 44	73.96000207	1/30/2015 14 06	69.95999912	1/30/2015 14 17	73.67000276	1/30/2015 13 08	72.68
1/30/2015 15 44	71.21000246	1/30/2015 15 26	68.27000063	1/30/2015 14 46	71.95999774	1/30/2015 14 24	70.45	1/30/2015 14 11	67.30000247	1/30/2015 15 45	74.98000141	1/30/2015 15 22	71.0699982	1/30/2015 15 21	73.62000206	1/30/2015 15 58	69.71999913	1/30/2015 15 45	73.43000275	1/30/2015 14 28	73.59
1/30/2015 16 21	71.06000245	1/30/2015 16 09	67.57000063	1/30/2015 15 04	71.61999775	1/30/2015 15 23	70.08	1/30/2015 15 26	67.27000247	1/30/2015 16 48	74.3700014	1/30/2015 16 38	70.9499982	1/30/2015 16 08	73.38000205	1/30/2015 16 23	69.37999913	1/30/2015 16 39	73.00000273	1/30/2015 15 31	73.07
1/30/2015 17 31	70.87000244	1/30/2015 17 29	66.74000062	1/30/2015 16 18	71.18999776	1/30/2015 16 35	69.96	1/30/2015 16 21	67.06000246	1/30/2015 17 31	74.2200014	1/30/2015 17 51	70.60999821	1/30/2015 17 54	73.38000205	1/30/2015 17 34	68.82999914	1/30/2015 17 34	72.88000273	1/30/2015 16 11	72.71
1/30/2015 18 18	69.5600024	1/30/2015 18 27	66.92000062	1/30/2015 17 38	70.30999779	1/30/2015 17 10	70.39	1/30/2015 17 21	67.09000246	1/30/2015 18 23	74.6400014	1/30/2015 18 19	71.0999982	1/30/2015 18 25	73.29000205	1/30/2015 18 38	69.13999913	1/30/2015 18 16	72.79000272	1/30/2015 17 12	72.61
1/30/2015 19 12	70.42000243	1/30/2015 19 00	67.87000063	1/30/2015 18 32	70.94999777	1/30/2015 18 47	70.32	1/30/2015 18 18	66.72000245	1/30/2015 19 19	75.31000141	1/30/2015 19 20	70.9799982	1/30/2015 19 23	73.62000206	1/30/2015 19 08	69.16999913	1/30/2015 19 05	72.82000273	1/30/2015 18 34	73.38
1/30/2015 20 53	71.85000248	1/30/2015 20 16	68.11000063	1/30/2015 19 01	71.12999776	1/30/2015 19 28	70.45	1/30/2015 19 00	66.94000245	1/30/2015 20 19	75.62000142	1/30/2015 20 20	71.61999819	1/30/2015 20 21	73.93000207	1/30/2015 20 01	70.07999912	1/30/2015 20 01	73.77000276	1/30/2015 19 05	73.32
1/30/2015 21 40	72.31000249	1/30/2015 21 11	68.63000064	1/30/2015 20 04	71.52999775	1/30/2015 20 57	70.23	1/30/2015 20 53	67.61000248	1/30/2015 21 01	75.04000141	1/30/2015 21 01	71.73999819	1/30/2015 21 12	73.96000207	1/30/2015 21 00	70.01999912	1/30/2015 21 07	73.77000276	1/30/2015 20 33	73.41
1/30/2015 22 54	72.5500025	1/30/2015 22 04	69.52000065	1/30/2015 21 24	71.92999774	1/30/2015 21 34	70.94	1/30/2015 21 03	68.2200025	1/30/2015 22 00	76.05000143	1/30/2015 22 54	72.07999818	1/30/2015 22 00	74.29000208	1/30/2015 22 13	70.41999912	1/30/2015 22 09	74.19000278	1/30/2015 21 58	73.99
1/30/2015 23 48	71.61000247	1/30/2015 23 13	69.82000065	1/30/2015 22 51	71.79999774	1/30/2015 22 00	71.18	1/30/2015 22 54	67.55000248	1/30/2015 23 12	76.08000143	1/30/2015 23 49	67.95999828	1/30/2015 23 49	73.23000205	1/30/2015 23 50	71.14999911	1/30/2015 23 20	74.50000279	1/30/2015 22 00	73.99
1/31/2015 0 17	72.5800025	1/31/2015 0 00	70.74000066	1/30/2015 23 49	71.92999774	1/30/2015 23 48	70.97	1/30/2015 23 48	66.51000244	1/31/2015 0 25	76.96000144	1/31/2015 0 17	71.0699982	1/31/2015 0 00	74.78000209	1/31/2015 0 21	71.9099991	1/31/2015 0 25	75.20000281	1/30/2015 23 13	74.51
1/31/2015 1 08	73.44000253	1/31/2015 1 13	70.92000066	1/31/2015 0 09	73.44999769	1/31/2015 0 27	71.27	1/31/2015 0 17	67.12000246	1/31/2015 1 33	77.91000146	1/31/2015 1 07	72.22999817	1/31/2015 1 00	75.0600021	1/31/2015 1 03	72.2799991	1/31/2015 1 03	75.44000282	1/31/2015 0 00	75.18
1/31/2015 2 10	74.23000256	1/31/2015 2 01	71.47000066	1/31/2015 1 37	73.87999768	1/31/2015 1 31	71.76	1/31/2015 1 08	68.3400025	1/31/2015 2 09	77.88000146	1/31/2015 2 10	72.62999816	1/31/2015 2 34	75.24000211	1/31/2015 2 34	72.2199991	1/31/2015 2 08	75.54000283	1/31/2015 1 00	75.73
1/31/2015 3 08	75.27000259	1/31/2015 3 26	72.17000067	1/31/2015 2 01	73.69999768	1/31/2015 2 08	72.06	1/31/2015 2 10	69.38000254	1/31/2015 3 18	78.55000147	1/31/2015 3 04	73.20999815	1/31/2015 3 08	75.45000211	1/31/2015 3 00	73.34999908	1/31/2015 3 25	76.02000284	1/31/2015 2 21	75.7
1/31/2015 4 28	75.12000259	1/31/2015 4 40	71.72000067	1/31/2015 3 38	74.02999767	1/31/2015 3 47	72.31	1/31/2015 3 08	69.50000255	1/31/2015 4 08	78.58000147	1/31/2015 4 45	73.26999815	1/31/2015 4 07	75.24000211	1/31/2015 4 12	73.12999909	1/31/2015 4 12	75.87000284	1/31/2015 3 09	76.34
1/31/2015 5 23	74.23000256	1/31/2015 5 59	71.23000066	1/31/2015 4 07	74.24999767	1/31/2015 4 52	72.4	1/31/2015 4 07	69.69000255	1/31/2015 5 52	77.76000146	1/31/2015 5 20	72.16999818	1/31/2015 5 52	75.1500021	1/31/2015 5 48	72.39999909	1/31/2015 5 52	75.32000282	1/31/2015 4 40	76.09
1/31/2015 6 33	73.07000252	1/31/2015 6 52	70.16000065	1/31/2015 5 45	73.69999768	1/31/2015 5 36	72.1	1/31/2015 5 23	68.62000252	1/31/2015 6 59	76.75000144	1/31/2015 6 29	71.3499982	1/31/2015 6 39	74.60000209	1/31/2015 6 40	70.96999911	1/31/2015 6 55	74.59000279	1/31/2015 5 45	75.76
1/31/2015 7 45	72.98000251	1/31/2015 7 56	68.73000064	1/31/2015 6 39	72.98999771	1/31/2015 6 52	71.03	1/31/2015 6 29	67.33000247	1/31/2015 7 48	75.50000142	1/31/2015 7 57	71.55999819	1/31/2015 7 31	74.48000208	1/31/2015 7 56	69.40999913	1/31/2015 7 56	73.40000275	1/31/2015 6 03	75.27
1/31/2015 8 29	69.99000241	1/31/2015 8 54	67.11000062	1/31/2015 7 38	72.86999771	1/31/2015 7 58	70.39	1/31/2015 7 58	67.95000249	1/31/2015 8 37	74.3700014	1/31/2015 8 38	70.9799982	1/31/2015 8 57	73.19000205	1/31/2015 8 38	67.87999915	1/31/2015 8 51	72.1200027	1/31/2015 7 50	74.48
1/31/2015 9 41	70.57000243	1/31/2015 9 41	65.92000061	1/31/2015 8 50	70.88999777	1/31/2015 8 37	69.99	1/31/2015 8 58	67.24000246	1/31/2015 9 05	73.61000138	1/31/2015 9 11	70.82999821	1/31/2015 9 39	72.92000204	1/31/2015 9 25	66.87999916	1/31/2015 9 44	71.05000266	1/31/2015 8 23	73.35
1/31/2015 10 01	69.90000241	1/31/2015 10 40	64.5100006 A	1/31/2015 9 35	70.70999778	1/31/2015 9 12	69.1	1/31/2015 9 41	66.75000245	1/31/2015 10 41	72.63000137	1/31/2015 10 04	71.0699982	1/31/2015 10 13	72.58000203	1/31/2015 10 41	65.77999917	1/31/2015 10 41	70.65000265	1/31/2015 9 44	72.43
1/31/2015 11 01	69.87000241	1/31/2015 11 04	65.43000061	1/31/2015 10 57	69.8499978	1/31/2015 10 32	69.5	1/31/2015 10 03	66.88000245	1/31/2015 11 56	73.00000137	1/31/2015 11 59	71.1599982	1/31/2015 11 31	72.62000203	1/31/2015 11 02	66.16999917	1/31/2015 11 03	71.08000266	1/31/2015 10 33	71.88
1/31/2015 12 48	69.5600024	1/31/2015 12 26	65.89000061	1/31/2015 11 00	69.8499978	1/31/2015 11 11	69.32	1/31/2015 11 30	66.88000245	1/31/2015 12 22	73.09000138	1/31/2015 12 52	71.3199982	1/31/2015 12 06	73.04000204	1/31/2015 12 08	66.81999916	1/31/2015 12 08	71.29000267	1/31/2015 11 02	72.16
1/31/2015 13 15	70.36000243	1/31/2015 13 22	66.41000062	1/31/2015 12 16	70.36999779	1/31/2015 12 25	69.78	1/31/2015 12 25	66.75000245	1/31/2015 13 18	72.38000136	1/31/2015 13 18	68.41999827	1/31/2015 13 27	73.32000205	1/31/2015 13 19	66.68999916	1/31/2015 13 19	71.66000268	1/31/2015 12 26	72.31
1/31/2015 14 33	70.75000244	1/31/2015 14 00	66.99000062	1/31/2015 13 18	69.75999781	1/31/2015 13 44	69.93	1/31/2015 13 46	66.33000243	1/31/2015 14 47	74.2800014	1/31/2015 14 29	70.9799982	1/31/2015 14 52	73.53000206	1/31/2015 14 02	68.12999914	1/31/2015 14 52	72.33000271	1/31/2015 13 42	72.43
1/31/2015 15 02	70.84000244	1/31/2015 15 14	67.11000062	1/31/2015 14 47	71.00999777	1/31/2015 14 58	70.42	1/31/2015 14 52	67.00000246	1/31/2015 15 13	73.67000139	1/31/2015 15 13	71.0999982	1/31/2015 15 26	73.32000205	1/31/2015 15 40	67.11999916	1/31/2015 15 25	72.73000272	1/31/2015 14 04	73.04
1/31/2015 16 16	68.37000236	1/31/2015 16 53	67.81000063	1/31/2015 15 14	71.31999776	1/31/2015 15 16	69.44	1/31/2015 15 02	67.40000247	1/31/2015 16 00	73.73000139	1/31/2015 16 08	71.2799982	1/31/2015 16 00	73.59000206	1/31/2015 16 01	68.27999914	1/31/2015 16 11	72.64000272	1/31/2015 15 13	72.83
1/31/2015 17 05	71.24000246	1/31/2015 17 42	67.14000062	1/31/2015 16 35	71.86999774	1/31/2015 16 16	70.36	1/31/2015 16 08	67.30000247	1/31/2015 17 26	74.4000014	1/31/2015 17 06	71.70999819	1/31/2015 17 10	73.65000206	1/31/2015 17 02	68.48999914	1/31/2015 17 57	72.94000273	1/31/2015 16 13	73.22
1/31/2015 18 09	71.33000246	1/31/2015 18 28	67.69000063	1/31/2015 17 15	71.76999774	1/31/2015 17 20	70.14	1/31/2015 17 00	67.30000247	1/31/2015 18 07	74.7000014	1/31/2015 18 37	71.98999818	1/31/2015 18 38	73.65000206	1/31/2015 18 55	69.09999913	1/31/2015 18 38	72.76000272	1/31/2015 17 03	73.13
1/31/2015 19 09	71.85000248	1/31/2015 19 05	67.38000063	1/31/2015 18 36	71.37999776	1/31/2015 18 54	70.14	1/31/2015 18 57	68.1000025	1/31/2015 19 06	75.28000141	1/31/2015 19 36	71.85999818	1/31/2015 19 36	73.90000207	1/31/2015 19 06	69.06999913	1/31/2015 19 04	72.94000273	1/31/2015 18 42	73.13
1/31/2015 20 00	72.16000249	1/31/2015 20 00	68.27000063	1/31/2015 19 25	72.07999773	1/31/2015 19 05	70.29	1/31/2015 19 05	67.70000248	1/31/2015 20 20	75.44000142	1/31/2015 20 27	72.25999817	1/31/2015 20 19	73.84000207	1/31/2015 20 09	69.43999913	1/31/2015 20 01	73.49000275	1/31/2015 19 00	73.1
1/31/2015 21 52	72.5800025	1/31/2015 21 10	68.54000064	1/31/2015 20 19	72.04999774	1/31/2015 20 35	70.29	1/31/2015 20 00	68.2200025	1/31/2015 21 01	75.83000142	1/31/2015 21 39	71.76999819	1/31/2015 21 26	74.11000207	1/31/2015 21 02	70.25999912	1/31/2015 21 02	73.70000276	1/31/2015 20 12	73.99
1/31/2015 22 14	73.01000252	1/31/2015 22 00	69.58000065	1/31/2015 21 54	71.64999775	1/31/2015 21 51	70.6	1/31/2015 21 52	67.79000248	1/31/2015 22 01	76.44000144	1/31/2015 22 02	72.50999817	1/31/2015 22 38	74.60000209	1/31/2015 22 01	70.80999911	1/31/2015 22 06	74.25000278	1/31/2015 21 25	74.2
1/31/2015 23 57	68.28000236	1/31/2015 23 09	70.31000065	1/31/2015 22 27	72.83999771	1/31/2015 22 14	71.24	1/31/2015 22 14	68.46000251	1/31/2015 23 57	76.41000143	1/31/2015 23 57	67.76999828	1/31/2015 23 56	74.54000209	1/31/2015 23 58	70.38999912	1/31/2015 23 00	74.59000279	1/31/2015 22 14	74.57
2/1/2015 0 01	72.5800025	2/1/2015 0 31	70.68000066	1/31/2015 23 00	72.95999771	1/31/2015 23 57	66.91	1/31/2015 23 57	63.52000233	2/1/2015 0 02	76.57000144	2/1/2015 0 02	70.48999822	2/1/2015 0 01	74.45000208	2/1/2015 0 02	71.4899991	2/1/2015 0 02	74.8000028	1/31/2015 23 38	74.29
2/1/2015 1 01	73.32000253	2/1/2015 1 09	71.29000066	2/1/2015 0 01	72.95999771	2/1/2015 0 01	70.78	2/1/2015 0 01	66.88000245	2/1/2015 1 42	77.79000146	2/1/2015 1 09	72.04999818	2/1/2015 1 33	75.0900021	2/1/2015 1 14	72.33999909	2/1/2015 1 01	75.54000283	2/1/2015 0 32	75.12
2/1/2015 2 01	74.72000257	2/1/2015 2 39	71.66000067	2/1/2015 1 33	73.44999769	2/1/2015 1 54	71.88	2/1/2015 1 09	68.1300025	2/1/2015 2 00	77.79000146	2/1/2015 2 04	72.92999816	2/1/2015 2 13	75.1800021	2/1/2015 2 18	72.70999909	2/1/2015 2 44	75.17000281	2/1/2015 1 19	75.51
2/1/2015 3 23	74.93000258	2/1/2015 3 07	72.02000067	2/1/2015 2 12	74.21999767	2/1/2015 2 15	72.28	2/1/2015 2 05	69.23000254	2/1/2015 3 07	78.31000147	2/1/2015 3 27	73.11999815	2/1/2015 3 17	75.21000211	2/1/2015 3 03	72.94999909	2/1/2015 3 29	75.75000283	2/1/2015 2 09	75.82
2/1/2015 4 41	75.24000259	2/1/2015 4 28	71.93000067	2/1/2015 3 50	74.17999767	2/1/2015 3 23	72.06	2/1/2015 3 23	69.44000255	2/1/2015 4 48	78.49000147	2/1/2015 4 06	73.29999815	2/1/2015 4 41	75.27000211	2/1/2015 4 44	73.22999908	2/1/2015 4 36	75.78000284	2/1/2015 3 03	76.06
2/1/2015 5 20	74.72000257	2/1/2015 5 29	71.69000067	2/1/2015 4 15	74.33999766	2/1/2015 4 35	72.19	2/1/2015 4 56	69.65000255	2/1/2015 5 42	78.28000147	2/1/2015 5 52	72.74999816	2/1/2015 5 31	75.33000211	2/1/2015 5 57	73.00999909	2/1/2015 5 53	75.51000283	2/1/2015 4 56	76
2/1/2015 6 18	73.77000254	2/1/2015 6 04	70.89000066	2/1/2015 5 46	73.75999768	2/1/2015 5 51	72.25	2/1/2015 5 47	69.41000254	2/1/2015 6 52	77.33000145	2/1/2015 6 33	72.16999818	2/1/2015 6 33	74.8700021	2/1/2015 6 33	72.0999991	2/1/2015 6 04	75.29000282	2/1/2015 5 54	75.97
2/1/2015 7 38	72.22000249	2/1/2015 7 59	68.82000064	2/1/2015 6 33	73.75999768	2/1/2015 6 32	71.79	2/1/2015 6 18	68.37000251	2/1/2015 7 47	75.53000142	2/1/2015 7 41	70.21999822	2/1/2015 7 51	73.50000206	2/1/2015 7 58	70.07999912	2/1/2015 7 47	73.40000275	2/1/2015 6 05	75.18
2/1/2015 8 57	72.22000249	2/1/2015 8 54	67.23000062	2/1/2015 7 51	72.25999773	2/1/2015 7 51	70.29	2/1/2015 7 40	66.51000244	2/1/2015 8 55	74.77000141	2/1/2015 8 59	71.70999819	2/1/2015 8 46	73.35000205	2/1/2015 8 54	68.48999914	2/1/2015 8 59	72.30000271	2/1/2015 7 46	73.96
2/1/2015 9 36	70.81000244	2/1/2015 9 48	66.13000061	2/1/2015 8 46	71.64999775	2/1/2015 8 19	70.29	2/1/2015 8 32	67.79000248	2/1/2015 9 56	73.51000138	2/1/2015 9 51	71.55999819	2/1/2015 9 35	72.89000204	2/1/2015 9 59	66.62999916	2/1/2015 9 51	71.05000266	2/1/2015 8 03	73.35
2/1/2015 10 23	67.67000234	2/1/2015 10 35	65.31000061	2/1/2015 9 35	69.38999782	2/1/2015 9 38	69.99	2/1/2015 9 48	67.03000246	2/1/2015 10 58	72.90000137	2/1/2015 10 54	71.61999819	2/1/2015 10 02	73.07000204	2/1/2015 10 13	65.65999917	2/1/2015 10 18	70.80000265	2/1/2015 9 51	72.58
2/1/2015 11 15	69.6200024	2/1/2015 11 22	64.9100006 A	2/1/2015 10 44	70.48999778	2/1/2015 10 13	69.68	2/1/2015 10 31	66.85000245	2/1/2015 11 00	72.90000137	2/1/2015 11 03	71.49999819	2/1/2015 11 18	72.92000204	2/1/2015 11 07	65.80999917	2/1/2015 11 23	70.41000264	2/1/2015 10 20	71.88
2/1/2015 12 10	69.75000241	2/1/2015 12 04	65.49000061	2/1/2015 11 07	70.66999778	2/1/2015 11 19	69.62	2/1/2015 11 06	67.06000246	2/1/2015 12 28	73.45000138	2/1/2015 12 30	71.67999819	2/1/2015 12 41	72.92000204	2/1/2015 12 14	66.23999917	2/1/2015 12 03	71.20000267	2/1/2015 11 22	71.15
2/1/2015 13 08	70.36000243	2/1/2015 13 23	65.95000061	2/1/2015 12 54	70.60999778	2/1/2015 12 37	69.78	2/1/2015 12 00	66.97000245	2/1/2015 13 24	73.30000138	2/1/2015 13 00	71.43999819	2/1/2015 13 06	72.92000204	2/1/2015 13 07	66.77999916	2/1/2015 13 07	71.48000268	2/1/2015 12 21	71.91
2/1/2015 14 00	70.45000243	2/1/2015 14 00	66.71000062	2/1/2015 13 43	70.66999778	2/1/2015 13 06	69.9	2/1/2015 13 31	67.24000246	2/1/2015 14 05	74.00000139	2/1/2015 14 02	71.67999819	2/1/2015 14 21	73.41000205	2/1/2015 14 13	67.45999915	2/1/2015 14 00	71.90000269	2/1/2015 13 21	72.34
2/1/2015 15 26	68.77000237	2/1/2015 15 02	65.28000061	2/1/2015 14 47	71.55999775	2/1/2015 14 14	69.78	2/1/2015 14 03	67.49000247	2/1/2015 15 26	73.94000139	2/1/2015 15 25	68.74999826	2/1/2015 15 34	73.19000205	2/1/2015 15 13	68.00999915	2/1/2015 15 34	72.58000272	2/1/2015 14 00	72.83
2/1/2015 16 40	69.96000241	2/1/2015 16 39	66.71000062	2/1/2015 15 03	71.73999775	2/1/2015 15 26	68.55	2/1/2015 15 26	65.5600024	2/1/2015 16 53	74.2500014	2/1/2015 16 44	71.40999819	2/1/2015 16 44	73.38000205	2/1/2015 16 13	68.18999914	2/1/2015 16 00	72.85000273	2/1/2015 15 34	72.46
2/1/2015 17 03	71.67000247	2/1/2015 17 12	66.99000062	2/1/2015 16 14	71.61999775	2/1/2015 16 23	69.87	2/1/2015 16 44	66.69000244	2/1/2015 17 05	74.2200014	2/1/2015 17 39	71.98999818	2/1/2015 17 29	73.71000206	2/1/2015 17 23	68.03999915	2/1/2015 17 59	72.70000272	2/1/2015 16 52	72.46
2/1/2015 18 00	71.55000247	2/1/2015 18 22	67.08000062	2/1/2015 17 49	72.01999774	2/1/2015 17 39	70.32	2/1/2015 17 44	67.58000248	2/1/2015 18 28	74.5200014	2/1/2015 18 50	71.85999818	2/1/2015 18 36	73.47000206	2/1/2015 18 37	67.90999915	2/1/2015 18 36	72.45000271	2/1/2015 17 32	72.61
2/1/2015 19 49	70.69000244	2/1/2015 19 02	66.44000062	2/1/2015 18 22	71.34999776	2/1/2015 18 04	70.26	2/1/2015 18 04	67.55000248	2/1/2015 19 26	73.88000139	2/1/2015 19 25	71.61999819	2/1/2015 19 03	73.19000205	2/1/2015 19 03	67.57999915	2/1/2015 19 26	71.75000269	2/1/2015 18 22	72.37
2/1/2015 20 00	71.82000248	2/1/2015 20 29	67.29000062	2/1/2015 19 03	70.88999777	2/1/2015 19 27	69.81	2/1/2015 19 27	67.24000246	2/1/2015 20 33	74.86000141	2/1/2015 20 30	71.85999818	2/1/2015 20 30	73.19000205	2/1/2015 20 00	68.76999914	2/1/2015 20 00	73.00000273	2/1/2015 19 02	72.86
2/1/2015 21 12	71.58000247	2/1/2015 21 12	67.60000063	2/1/2015 20 37	71.98999774	2/1/2015 20 00	70.45	2/1/2015 20 00	67.76000248	2/1/2015 21 13	75.01000141	2/1/2015 21 11	71.67999819	2/1/2015 21 11	73.65000206	2/1/2015 21 11	68.79999914	2/1/2015 21 11	73.12000274	2/1/2015 20 12	73.62
2/1/2015 22 05	72.95000251	2/1/2015 22 54	69.03000064	2/1/2015 21 12	72.07999773	2/1/2015 21 09	70.63	2/1/2015 21 12	67.46000247	2/1/2015 22 02	75.83000142	2/1/2015 22 55	71.64999819	2/1/2015 22 34	73.19000205	2/1/2015 22 55	67.32999915	2/1/2015 22 55	71.48000268	2/1/2015 21 12	72.95
2/1/2015 23 58	67.91000234	2/1/2015 23 25	70.62000066	2/1/2015 22 13	72.56999772	2/1/2015 22 34	70.87	2/1/2015 22 05	68.3400025	2/1/2015 23 59	75.19000141	2/1/2015 23 58	68.25999827	2/1/2015 23 04	74.63000209	2/1/2015 23 59	69.52999913	2/1/2015 23 00	74.38000278	2/1/2015 22 55	70.66
2/2/2015 0 00	67.91000234	2/2/2015 0 00	70.62000066	2/1/2015 23 48	72.89999771	2/1/2015 23 58	68.65	2/1/2015 23 58	63.52000233	2/2/2015 0 00	75.19000141	2/2/2015 0 04	70.91999821	2/2/2015 0 04	74.54000209	2/2/2015 0 00	70.41999912	2/2/2015 0 03	74.50000279	2/1/2015 23 59	74.11
2/2/2015 1 15	74.63000257	2/2/2015 1 02	71.23000066	2/2/2015 0 04	73.2999977	2/2/2015 0 00	68.65	2/2/2015 0 00	63.52000233	2/2/2015 1 01	77.76000146	2/2/2015 1 15	72.28999817	2/2/2015 1 02	74.9300021	2/2/2015 1 54	72.33999909	2/2/2015 1 02	75.14000281	2/2/2015 0 00	74.11
2/2/2015 2 00	74.66000257	2/2/2015 2 00	71.99000067	2/2/2015 1 02	73.78999768	2/2/2015 1 58	71.76	2/2/2015 1 58	68.92000253	2/2/2015 2 08	78.40000147	2/2/2015 2 20	72.86999816	2/2/2015 2 21	75.33000211	2/2/2015 2 33	72.85999909	2/2/2015 2 21	75.72000283	2/2/2015 1 02	75.91
2/2/2015 3 37	74.05000255	2/2/2015 3 34	71.87000067	2/2/2015 2 01	74.05999767	2/2/2015 2 00	71.76	2/2/2015 2 00	68.92000253	2/2/2015 3 41	78.43000147	2/2/2015 3 09	71.98999818	2/2/2015 3 13	75.0000021	2/2/2015 3 06	72.82999909	2/2/2015 3 38	75.72000283	2/2/2015 2 33	76
2/2/2015 4 26	73.77000254	2/2/2015 4 57	71.17000066	2/2/2015 3 13	73.2999977	2/2/2015 3 10	71	2/2/2015 3 37	68.86000252	2/2/2015 4 56	77.67000146	2/2/2015 4 30	72.22999817	2/2/2015 4 30	75.0000021	2/2/2015 4 59	72.61999909	2/2/2015 4 55	75.17000281	2/2/2015 3 10	75.76
2/2/2015 5 40	73.29000252	2/2/2015 5 54	69.92000065	2/2/2015 4 46	74.17999767	2/2/2015 4 30	71.91	2/2/2015 4 26	68.43000251	2/2/2015 5 48	76.20000143	2/2/2015 5 12	70.21999822	2/2/2015 5 17	74.66000209	2/2/2015 5 49	70.83999911	2/2/2015 5 46	74.50000279	2/2/2015 4 56	75.39

2/2/2015 6 25	71.39000246	2/2/2015 6 31	67.50000063	2/2/2015 5 14	73.38999769	2/2/2015 5 13	70.54	2/2/2015 5 38	67.55000248	2/2/2015 6 53	74.77000141	2/2/2015 6 51	71.3499982	2/2/2015 6 52	73.99000207	2/2/2015 6 52	68.61999914	2/2/2015 6 48	72.94000273	2/2/2015 5 49	73.74
2/2/2015 7 03	70.94000245	2/2/2015 7 33	67.20000062	2/2/2015 6 26	72.47999772	2/2/2015 6 52	69.71	2/2/2015 6 26	67.33000247	2/2/2015 7 49	74.3100014	2/2/2015 7 53	71.1899982	2/2/2015 7 27	73.19000205	2/2/2015 7 39	68.18999914	2/2/2015 7 39	72.39000271	2/2/2015 6 48	73.22
2/2/2015 8 43	70.42000243	2/2/2015 8 44	68.18000063	2/2/2015 7 26	71.15999776	2/2/2015 7 48	70.14	2/2/2015 7 03	66.88000245	2/2/2015 8 36	75.16000141	2/2/2015 8 44	71.0099982	2/2/2015 8 50	73.44000205	2/2/2015 8 15	68.97999913	2/2/2015 8 44	73.09000274	2/2/2015 7 58	73.38
2/2/2015 9 08	71.06000245	2/2/2015 9 47	67.72000063	2/2/2015 8 31	71.55999775	2/2/2015 8 19	70.42	2/2/2015 8 43	66.69000244	2/2/2015 9 00	74.89000141	2/2/2015 9 38	71.0099982	2/2/2015 9 38	73.29000205	2/2/2015 9 54	69.00999913	2/2/2015 9 39	72.88000273	2/2/2015 8 00	73.38
2/2/2015 10 00	69.6200024	2/2/2015 10 22	67.26000062	2/2/2015 9 29	71.76999774	2/2/2015 9 00	69.59	2/2/2015 9 08	67.40000247	2/2/2015 10 23	73.97000139	2/2/2015 10 46	70.63999821	2/2/2015 10 17	72.77000204	2/2/2015 10 16	68.85999914	2/2/2015 10 22	72.73000272	2/2/2015 9 27	73.56
2/2/2015 11 22	69.90000241	2/2/2015 11 02	67.38000063	2/2/2015 10 23	70.76999778	2/2/2015 10 57	69.01	2/2/2015 10 22	66.66000244	2/2/2015 11 23	73.91000139	2/2/2015 11 18	70.9799982	2/2/2015 11 03	73.13000205	2/2/2015 11 26	69.06999913	2/2/2015 11 00	72.76000272	2/2/2015 10 16	73.16
2/2/2015 12 11	70.23000242	2/2/2015 12 16	67.53000063	2/2/2015 11 03	71.03999777	2/2/2015 11 03	69.84	2/2/2015 11 18	66.48000244	2/2/2015 12 19	74.15000139	2/2/2015 12 12	70.91999821	2/2/2015 12 05	72.83000204	2/2/2015 12 24	69.09999913	2/2/2015 12 19	72.97000273	2/2/2015 11 03	73.13
2/2/2015 13 27	71.61000247	2/2/2015 13 51	67.96000063	2/2/2015 12 02	70.66999778	2/2/2015 12 24	70.23	2/2/2015 12 11	66.91000245	2/2/2015 13 04	74.98000141	2/2/2015 13 41	71.0399982	2/2/2015 13 29	72.71000203	2/2/2015 13 04	69.67999913	2/2/2015 13 37	73.55000275	2/2/2015 12 09	73.04
2/2/2015 14 54	71.61000247	2/2/2015 14 00	67.93000063	2/2/2015 13 12	71.52999775	2/2/2015 13 11	70.14	2/2/2015 13 03	66.94000245	2/2/2015 14 57	74.6400014	2/2/2015 14 32	70.42999822	2/2/2015 14 25	73.32000205	2/2/2015 14 54	69.92999912	2/2/2015 14 26	73.58000275	2/2/2015 13 03	73.29
2/2/2015 15 54	71.18000245	2/2/2015 15 10	68.66000064	2/2/2015 14 18	70.79999777	2/2/2015 14 54	70.32	2/2/2015 14 00	67.37000247	2/2/2015 15 58	75.19000141	2/2/2015 15 53	71.3199982	2/2/2015 15 33	73.68000206	2/2/2015 15 00	69.25999913	2/2/2015 15 33	73.61000275	2/2/2015 14 19	73.5
2/2/2015 16 02	70.57000243	2/2/2015 16 13	67.84000063	2/2/2015 15 10	71.49999775	2/2/2015 15 47	70.05	2/2/2015 15 48	67.03000246	2/2/2015 16 59	74.86000141	2/2/2015 16 01	71.1599982	2/2/2015 16 25	73.26000205	2/2/2015 16 27	69.28999913	2/2/2015 16 27	72.97000273	2/2/2015 15 01	73.62
2/2/2015 17 55	70.66000244	2/2/2015 17 30	66.77000062	2/2/2015 16 09	70.66999778	2/2/2015 16 24	69.78	2/2/2015 16 43	67.43000247	2/2/2015 17 53	73.94000139	2/2/2015 17 02	71.43999819	2/2/2015 17 00	73.62000206	2/2/2015 17 56	68.33999914	2/2/2015 17 53	72.61000272	2/2/2015 16 12	72.58
2/2/2015 18 36	70.66000244	2/2/2015 18 26	66.56000062	2/2/2015 17 00	71.31999776	2/2/2015 17 30	70.32	2/2/2015 17 55	66.88000245	2/2/2015 18 36	73.94000139	2/2/2015 18 36	70.69999821	2/2/2015 18 33	73.13000205	2/2/2015 18 47	67.75999915	2/2/2015 18 36	72.1500027	2/2/2015 17 03	72.8
2/2/2015 19 32	69.7100024	2/2/2015 19 02	66.65000062	2/2/2015 18 40	71.03999777	2/2/2015 18 36	69.78	2/2/2015 18 36	66.66000244	2/2/2015 19 36	74.2200014	2/2/2015 19 36	71.2799982	2/2/2015 19 37	73.29000205	2/2/2015 19 00	68.06999915	2/2/2015 19 02	72.1500027	2/2/2015 18 42	72.46
2/2/2015 20 54	71.00000245	2/2/2015 20 00	67.50000063	2/2/2015 19 44	70.91999777	2/2/2015 19 28	70.11	2/2/2015 19 32	66.79000245	2/2/2015 20 47	74.80000141	2/2/2015 20 24	71.2799982	2/2/2015 20 23	73.47000206	2/2/2015 20 03	68.45999914	2/2/2015 20 03	72.54000272	2/2/2015 19 00	72.8
2/2/2015 21 17	70.84000244	2/2/2015 21 00	67.66000063	2/2/2015 20 39	71.52999775	2/2/2015 20 03	70.51	2/2/2015 20 23	66.94000245	2/2/2015 21 43	74.77000141	2/2/2015 21 42	71.55999819	2/2/2015 21 21	73.62000206	2/2/2015 21 09	68.88999914	2/2/2015 21 01	72.79000272	2/2/2015 20 01	73.22
2/2/2015 22 23	71.36000246	2/2/2015 22 00	69.21000064	2/2/2015 21 34	71.49999775	2/2/2015 21 46	70.72	2/2/2015 21 17	67.49000247	2/2/2015 22 16	74.83000141	2/2/2015 22 23	71.0399982	2/2/2015 22 15	73.99000207	2/2/2015 22 02	70.04999912	2/2/2015 22 02	73.77000276	2/2/2015 21 05	73.19
2/2/2015 23 18	73.80000254	2/2/2015 23 23	69.85000065	2/2/2015 22 26	72.65999772	2/2/2015 22 12	70.45	2/2/2015 22 00	68.1000025	2/2/2015 23 08	76.44000144	2/2/2015 23 59	69.08999825	2/2/2015 23 19	74.32000208	2/2/2015 23 08	71.17999911	2/2/2015 23 12	74.8300028	2/2/2015 22 07	74.2
2/3/2015 0 00	73.26000252	2/3/2015 0 03	70.95000066	2/2/2015 23 48	73.2399977	2/2/2015 23 59	69.01	2/2/2015 23 18	68.83000252	2/3/2015 0 00	76.90000144	2/3/2015 0 00	69.69999823	2/3/2015 0 03	74.51000209	2/3/2015 0 00	71.26999911	2/3/2015 0 07	75.11000281	2/2/2015 23 59	74.6
2/3/2015 1 22	74.51000257	2/3/2015 1 16	71.29000066	2/3/2015 0 03	72.92999771	2/3/2015 0 00	69.01	2/3/2015 0 00	66.14000242	2/3/2015 1 17	77.82000146	2/3/2015 1 22	71.89999818	2/3/2015 1 10	75.0300021	2/3/2015 1 16	72.48999909	2/3/2015 1 16	75.23000281	2/3/2015 0 00	74.6
2/3/2015 2 16	75.00000258	2/3/2015 2 02	71.81000067	2/3/2015 1 11	74.08999767	2/3/2015 1 12	72.19	2/3/2015 1 22	68.59000251	2/3/2015 2 03	77.91000146	2/3/2015 2 37	72.50999817	2/3/2015 2 00	75.39000211	2/3/2015 2 17	72.94999909	2/3/2015 2 16	75.78000284	2/3/2015 1 17	75.21
2/3/2015 3 03	74.57000257	2/3/2015 3 07	71.53000067	2/3/2015 2 14	74.24999767	2/3/2015 2 40	72.31	2/3/2015 2 16	69.41000254	2/3/2015 3 44	78.37000147	2/3/2015 3 06	71.55999819	2/3/2015 3 03	75.0900021	2/3/2015 3 03	73.15999908	2/3/2015 3 03	75.90000284	2/3/2015 2 03	75.51
2/3/2015 4 56	74.17000255	2/3/2015 4 50	71.26000066	2/3/2015 3 03	73.99999768	2/3/2015 3 07	70.97	2/3/2015 3 03	68.89000253	2/3/2015 4 39	77.57000146	2/3/2015 4 31	71.89999818	2/3/2015 4 31	74.8700021	2/3/2015 4 31	72.48999909	2/3/2015 4 31	75.29000282	2/3/2015 3 07	75.73
2/3/2015 5 56	73.29000252	2/3/2015 5 39	68.73000064	2/3/2015 4 46	73.41999769	2/3/2015 4 31	71.76	2/3/2015 4 56	69.07000253	2/3/2015 5 38	76.08000143	2/3/2015 5 17	70.9499982	2/3/2015 5 18	74.26000208	2/3/2015 5 55	70.77999911	2/3/2015 5 52	74.25000278	2/3/2015 4 52	75.39
2/3/2015 6 33	69.90000241	2/3/2015 6 58	66.95000062	2/3/2015 5 56	73.44999769	2/3/2015 5 47	71.24	2/3/2015 5 19	67.95000249	2/3/2015 6 58	74.5500014	2/3/2015 6 33	71.0999982	2/3/2015 6 48	73.01000204	2/3/2015 6 58	67.78999915	2/3/2015 6 58	71.48000268	2/3/2015 5 51	74.26
2/3/2015 7 28	69.6500024	2/3/2015 7 23	65.79000061	2/3/2015 6 47	71.43999775	2/3/2015 6 33	69.56	2/3/2015 6 53	66.79000245	2/3/2015 7 41	73.67000139	2/3/2015 7 32	71.0099982	2/3/2015 7 29	72.62000203	2/3/2015 7 21	66.68999916	2/3/2015 7 04	70.93000266	2/3/2015 6 06	72.89
2/3/2015 8 00	71.03000245	2/3/2015 8 04	67.69000063	2/3/2015 7 33	70.79999777	2/3/2015 7 28	69.41	2/3/2015 7 41	66.69000244	2/3/2015 8 07	74.2200014	2/3/2015 8 06	70.79999821	2/3/2015 8 03	73.01000204	2/3/2015 8 02	68.88999914	2/3/2015 8 08	72.73000272	2/3/2015 7 23	72.46
2/3/2015 9 59	70.23000242	2/3/2015 9 55	68.15000063	2/3/2015 8 40	71.21999776	2/3/2015 8 03	70.23	2/3/2015 8 59	66.69000244	2/3/2015 9 12	75.19000141	2/3/2015 9 17	70.60999821	2/3/2015 9 57	73.35000205	2/3/2015 9 44	69.61999913	2/3/2015 9 28	73.25000274	2/3/2015 8 11	73.29
2/3/2015 10 00	70.23000242	2/3/2015 10 10	68.05000063	2/3/2015 9 16	71.49999775	2/3/2015 9 17	69.93	2/3/2015 9 00	66.69000244	2/3/2015 10 34	74.7300014	2/3/2015 10 13	71.2499982	2/3/2015 10 00	73.35000205	2/3/2015 10 09	69.61999913	2/3/2015 10 13	73.89000277	2/3/2015 9 02	73.8
2/3/2015 11 48	70.02000242	2/3/2015 11 04	68.30000063	2/3/2015 10 06	71.70999775	2/3/2015 10 36	70.32	2/3/2015 10 25	66.72000245	2/3/2015 11 20	75.10000141	2/3/2015 11 12	71.0099982	2/3/2015 11 09	72.98000204	2/3/2015 11 49	69.89999912	2/3/2015 11 49	73.52000275	2/3/2015 10 57	73.96
2/3/2015 12 06	70.66000244	2/3/2015 12 53	68.05000063	2/3/2015 11 42	71.46999775	2/3/2015 11 46	70.36	2/3/2015 11 38	67.40000247	2/3/2015 12 15	75.07000141	2/3/2015 12 33	70.79999821	2/3/2015 12 33	73.38000205	2/3/2015 12 27	69.95999912	2/3/2015 12 27	73.64000276	2/3/2015 11 38	73.59
2/3/2015 13 18	71.03000245	2/3/2015 13 09	68.48000064	2/3/2015 12 04	71.18999776	2/3/2015 12 58	70.05	2/3/2015 12 06	67.30000247	2/3/2015 13 18	75.19000141	2/3/2015 13 42	71.1899982	2/3/2015 13 02	73.32000205	2/3/2015 13 08	69.92999912	2/3/2015 13 01	73.92000277	2/3/2015 12 36	73.19
2/3/2015 14 06	71.21000246	2/3/2015 14 43	68.69000064	2/3/2015 13 07	71.61999775	2/3/2015 13 00	70.05	2/3/2015 13 14	66.91000245	2/3/2015 14 05	75.59000142	2/3/2015 14 09	70.63999821	2/3/2015 14 37	73.16000205	2/3/2015 14 06	69.80999912	2/3/2015 14 16	73.89000277	2/3/2015 13 07	73.38
2/3/2015 15 28	70.20000242	2/3/2015 15 54	68.36000063	2/3/2015 14 12	71.55999775	2/3/2015 14 43	70.17	2/3/2015 14 26	67.37000247	2/3/2015 15 57	75.19000141	2/3/2015 15 53	70.85999821	2/3/2015 15 43	73.68000206	2/3/2015 15 43	70.22999912	2/3/2015 15 44	73.83000276	2/3/2015 14 30	73.53
2/3/2015 16 20	71.45000246	2/3/2015 16 42	67.72000063	2/3/2015 15 57	71.76999774	2/3/2015 15 53	69.62	2/3/2015 15 57	66.75000245	2/3/2015 16 39	74.4900014	2/3/2015 16 19	71.0399982	2/3/2015 16 01	73.29000205	2/3/2015 16 43	69.19999913	2/3/2015 16 43	73.22000274	2/3/2015 15 54	72.58
2/3/2015 17 01	70.48000243	2/3/2015 17 31	66.86000062	2/3/2015 16 12	71.64999775	2/3/2015 16 15	70.54	2/3/2015 16 09	67.43000247	2/3/2015 17 28	74.4300014	2/3/2015 17 33	71.1899982	2/3/2015 17 54	73.50000206	2/3/2015 17 33	68.82999914	2/3/2015 17 50	72.61000272	2/3/2015 16 56	73.68
2/3/2015 18 11	69.99000241	2/3/2015 18 00	66.83000062	2/3/2015 17 52	71.12999776	2/3/2015 17 05	69.81	2/3/2015 17 05	66.88000245	2/3/2015 18 15	74.3100014	2/3/2015 18 11	71.43999819	2/3/2015 18 15	73.19000205	2/3/2015 18 28	68.27999914	2/3/2015 18 26	72.27000271	2/3/2015 17 05	72.98
2/3/2015 19 17	71.79000247	2/3/2015 19 28	66.50000062	2/3/2015 18 14	70.36999779	2/3/2015 18 56	69.87	2/3/2015 18 01	67.03000246	2/3/2015 19 20	74.77000141	2/3/2015 19 32	71.2199982	2/3/2015 19 01	73.07000204	2/3/2015 19 01	68.61999914	2/3/2015 19 02	72.45000271	2/3/2015 18 57	72.83
2/3/2015 20 23	71.15000245	2/3/2015 20 03	67.69000063	2/3/2015 19 35	70.63999778	2/3/2015 19 02	69.87	2/3/2015 19 02	67.27000247	2/3/2015 20 22	74.4600014	2/3/2015 20 00	70.76999821	2/3/2015 20 26	73.35000205	2/3/2015 20 05	68.76999914	2/3/2015 20 03	72.48000271	2/3/2015 19 28	72.77
2/3/2015 21 08	70.75000244	2/3/2015 21 02	66.89000062	2/3/2015 20 04	71.21999776	2/3/2015 20 00	69.96	2/3/2015 20 00	67.15000246	2/3/2015 21 01	74.7000014	2/3/2015 21 04	71.3199982	2/3/2015 21 22	73.59000206	2/3/2015 21 44	69.25999913	2/3/2015 21 05	73.09000274	2/3/2015 20 41	73.29
2/3/2015 22 07	72.16000249	2/3/2015 22 02	68.30000063	2/3/2015 21 38	71.58999775	2/3/2015 21 01	70.57	2/3/2015 21 08	66.60000244	2/3/2015 22 02	75.50000142	2/3/2015 22 44	71.58999819	2/3/2015 22 02	73.99000207	2/3/2015 22 01	69.52999913	2/3/2015 22 02	73.58000275	2/3/2015 21 00	73.47
2/3/2015 23 59	69.38000239	2/3/2015 23 44	68.24000063	2/3/2015 22 44	71.76999774	2/3/2015 22 44	69.99	2/3/2015 22 45	67.58000248	2/3/2015 23 09	75.68000142	2/3/2015 23 58	67.98999828	2/3/2015 23 59	72.77000204	2/3/2015 23 44	68.39999914	2/3/2015 23 45	73.06000273	2/3/2015 22 05	74.42
2/4/2015 0 00	69.38000239	2/4/2015 0 00	69.89000065	2/3/2015 23 59	71.12999776	2/3/2015 23 59	67.18	2/3/2015 23 59	64.34000236	2/4/2015 0 00	74.95000141	2/4/2015 0 00	70.21999822	2/4/2015 0 00	72.77000204	2/4/2015 0 00	69.95999912	2/4/2015 0 00	74.10000277	2/3/2015 23 43	71.64
2/4/2015 1 58	73.93000255	2/4/2015 1 10	71.17000066	2/4/2015 0 00	71.12999776	2/4/2015 0 00	67.18	2/4/2015 0 00	64.34000236	2/4/2015 1 00	78.03000146	2/4/2015 1 53	72.59999817	2/4/2015 1 58	75.0000021	2/4/2015 1 01	72.45999909	2/4/2015 1 11	75.17000281	2/4/2015 0 00	72.19
2/4/2015 2 00	73.93000255	2/4/2015 2 02	71.53000067	2/4/2015 1 47	73.78999768	2/4/2015 1 58	71.48	2/4/2015 1 54	68.89000253	2/4/2015 2 41	78.46000147	2/4/2015 2 02	72.74999816	2/4/2015 2 00	75.0000021	2/4/2015 2 03	73.00999909	2/4/2015 2 03	75.84000284	2/4/2015 1 20	75.45
2/4/2015 3 55	73.47000253	2/4/2015 3 00	72.21000067	2/4/2015 2 00	74.21999767	2/4/2015 2 00	71.48	2/4/2015 2 00	68.95000253	2/4/2015 3 36	78.67000148	2/4/2015 3 55	72.16999818	2/4/2015 3 51	75.45000211	2/4/2015 3 56	73.25999908	2/4/2015 3 25	75.93000284	2/4/2015 2 02	75.54
2/4/2015 4 18	72.95000251	2/4/2015 4 19	71.20000066	2/4/2015 3 51	74.27999767	2/4/2015 3 59	72.43	2/4/2015 3 56	67.82000249	2/4/2015 4 59	77.63000146	2/4/2015 4 18	71.98999818	2/4/2015 4 04	74.72000209	2/4/2015 4 15	72.54999909	2/4/2015 4 57	75.54000283	2/4/2015 3 59	76.09
2/4/2015 5 47	71.67000247	2/4/2015 5 51	67.93000063	2/4/2015 4 24	73.41999769	2/4/2015 4 08	71.3	2/4/2015 4 18	68.1600025	2/4/2015 5 51	75.13000141	2/4/2015 5 46	70.36999822	2/4/2015 5 55	73.77000206	2/4/2015 5 59	69.31999913	2/4/2015 5 58	72.70000272	2/4/2015 4 04	75.42
2/4/2015 6 40	71.70000247	2/4/2015 6 03	64.7600006 A	2/4/2015 5 50	72.44999772	2/4/2015 5 51	70.66	2/4/2015 5 47	66.08000242	2/4/2015 6 57	73.61000138	2/4/2015 6 33	71.52999819	2/4/2015 6 40	73.44000205	2/4/2015 6 54	66.81999916	2/4/2015 6 57	71.35000267	2/4/2015 5 52	73.32
2/4/2015 7 58	69.13000239	2/4/2015 7 11	65.28000061	2/4/2015 6 54	71.37999776	2/4/2015 6 34	69.81	2/4/2015 6 40	67.52000247	2/4/2015 7 43	72.93000137	2/4/2015 7 54	71.2499982	2/4/2015 7 36	72.77000204	2/4/2015 7 17	66.13999917	2/4/2015 7 11	70.56000264	2/4/2015 6 03	72.55
2/4/2015 8 00	69.13000239	2/4/2015 8 00	66.44000062	2/4/2015 7 47	70.36999779	2/4/2015 7 19	69.74	2/4/2015 7 54	66.27000243	2/4/2015 8 00	73.12000138	2/4/2015 8 28	70.88999821	2/4/2015 8 16	72.83000204	2/4/2015 8 02	68.00999915	2/4/2015 8 02	71.87000269	2/4/2015 7 34	71.61
2/4/2015 9 02	70.14000242	2/4/2015 9 07	67.11000062	2/4/2015 8 40	70.42999779	2/4/2015 8 02	69.9	2/4/2015 8 03	66.54000244	2/4/2015 9 26	74.3100014	2/4/2015 9 52	70.66999821	2/4/2015 9 00	72.86000204	2/4/2015 9 17	68.91999914	2/4/2015 9 55	72.45000271	2/4/2015 8 03	72.58
2/4/2015 10 55	70.66000244	2/4/2015 10 19	67.66000063	2/4/2015 9 32	70.88999777	2/4/2015 9 52	69.93	2/4/2015 9 33	66.69000244	2/4/2015 10 56	74.19000139	2/4/2015 10 56	71.0699982	2/4/2015 10 22	72.86000204	2/4/2015 10 38	68.73999914	2/4/2015 10 00	72.70000272	2/4/2015 9 52	72.58
2/4/2015 11 47	69.29000239	2/4/2015 11 59	67.44000063	2/4/2015 10 19	72.16999773	2/4/2015 10 22	70.26	2/4/2015 10 56	66.02000242	2/4/2015 11 52	74.4900014	2/4/2015 11 51	71.0099982	2/4/2015 11 15	72.80000204	2/4/2015 11 18	69.06999913	2/4/2015 11 55	72.82000273	2/4/2015 10 19	72.74
2/4/2015 12 10	70.11000242	2/4/2015 12 06	67.02000062	2/4/2015 11 57	71.12999776	2/4/2015 11 51	70.45	2/4/2015 11 51	65.96000242	2/4/2015 12 29	74.4900014	2/4/2015 12 02	70.9499982	2/4/2015 12 13	73.19000205	2/4/2015 12 02	69.16999913	2/4/2015 12 14	72.27000271	2/4/2015 11 26	72.31
2/4/2015 13 32	70.91000245	2/4/2015 13 55	67.38000063	2/4/2015 12 11	71.21999776	2/4/2015 12 05	70.45	2/4/2015 12 00	66.66000244	2/4/2015 13 18	74.4600014	2/4/2015 13 39	71.2799982	2/4/2015 13 12	72.95000204	2/4/2015 13 09	69.06999913	2/4/2015 13 33	73.16000274	2/4/2015 12 24	72.92
2/4/2015 14 27	70.60000243	2/4/2015 14 02	68.36000063	2/4/2015 13 45	70.73999778	2/4/2015 13 54	69.81	2/4/2015 13 05	66.54000244	2/4/2015 14 10	74.15000139	2/4/2015 14 28	71.37999819	2/4/2015 14 55	73.10000205	2/4/2015 14 55	69.74999913	2/4/2015 14 39	73.19000274	2/4/2015 13 02	73.07
2/4/2015 15 05	71.15000245	2/4/2015 15 15	67.63000063	2/4/2015 14 13	71.00999777	2/4/2015 14 13	70.23	2/4/2015 14 13	66.94000245	2/4/2015 15 55	74.5200014	2/4/2015 15 59	70.91999821	2/4/2015 15 24	73.19000205	2/4/2015 15 54	69.64999913	2/4/2015 15 44	73.40000275	2/4/2015 14 36	73.01
2/4/2015 16 19	70.84000244	2/4/2015 16 55	66.99000062	2/4/2015 15 00	72.25999773	2/4/2015 15 35	70.84	2/4/2015 15 23	67.15000246	2/4/2015 16 26	73.76000139	2/4/2015 16 26	70.82999821	2/4/2015 16 08	73.59000206	2/4/2015 16 55	69.28999913	2/4/2015 16 20	72.54000272	2/4/2015 15 47	72.37
2/4/2015 17 43	70.29000242	2/4/2015 17 55	66.37000062	2/4/2015 16 53	71.70999775	2/4/2015 16 00	70.23	2/4/2015 16 43	67.55000248	2/4/2015 17 36	73.79000139	2/4/2015 17 18	71.58999819	2/4/2015 17 22	73.35000205	2/4/2015 17 10	68.21999914	2/4/2015 17 59	72.1800027	2/4/2015 16 16	72.28
2/4/2015 18 12	70.33000243	2/4/2015 18 21	66.31000062	2/4/2015 17 56	71.18999776	2/4/2015 17 55	70.42	2/4/2015 17 43	66.72000245	2/4/2015 18 13	73.48000138	2/4/2015 18 16	71.2799982	2/4/2015 18 24	73.01000204	2/4/2015 18 38	67.42999915	2/4/2015 18 38	71.42000267	2/4/2015 17 28	72.16
2/4/2015 19 09	71.15000245	2/4/2015 19 02	65.64000061	2/4/2015 18 09	71.06999777	2/4/2015 18 47	69.81	2/4/2015 18 12	66.94000245	2/4/2015 19 22	73.36000138	2/4/2015 19 01	71.73999819	2/4/2015 19 42	73.32000205	2/4/2015 19 10	67.66999915	2/4/2015 19 05	71.66000268	2/4/2015 18 13	71.85
2/4/2015 20 01	71.09000245	2/4/2015 20 05	66.31000062	2/4/2015 19 41	71.98999774	2/4/2015 19 05	70.11	2/4/2015 19 01	66.94000245	2/4/2015 20 09	73.97000139	2/4/2015 20 32	71.85999818	2/4/2015 20 43	73.56000206	2/4/2015 20 22	68.61999914	2/4/2015 20 02	72.1200027	2/4/2015 19 22	72.16
2/4/2015 21 09	71.91000248	2/4/2015 21 03	66.71000062	2/4/2015 20 28	71.37999776	2/4/2015 20 46	70.57	2/4/2015 20 01	67.15000246	2/4/2015 21 38	74.4300014	2/4/2015 21 41	71.40999819	2/4/2015 21 17	73.99000207	2/4/2015 21 09	68.45999914	2/4/2015 21 02	72.27000271	2/4/2015 20 59	72.83
2/4/2015 22 11	72.6500025	2/4/2015 22 08	67.93000063	2/4/2015 21 01	72.37999773	2/4/2015 21 00	70.66	2/4/2015 21 03	67.79000248	2/4/2015 22 02	75.01000141	2/4/2015 22 51	71.92999818	2/4/2015 22 11	73.35000205	2/4/2015 22 01	69.25999913	2/4/2015 22 02	72.64000272	2/4/2015 21 03	72.49
2/4/2015 23 00	73.19000252	2/4/2015 23 06	68.66000064	2/4/2015 22 07	72.37999773	2/4/2015 22 54	70.45	2/4/2015 22 11	68.1300025	2/4/2015 23 01	76.02000143	2/4/2015 23 02	72.43999817	2/4/2015 23 00	74.17000208	2/4/2015 23 02	70.38999912	2/4/2015 23 00	73.77000276	2/4/2015 22 01	73.44
2/5/2015 0 10	73.01000252	2/5/2015 0 12	68.76000064	2/4/2015 23 55	73.2999977	2/4/2015 23 00	71.48	2/4/2015 23 00	68.71000252	2/5/2015 0 11	74.6400014	2/5/2015 0 11	68.71999826	2/5/2015 0 11	73.62000206	2/5/2015 0 12	69.00999913	2/5/2015 0 11	73.22000274	2/4/2015 23 06	73.1
2/5/2015 1 00	74.75000257	2/5/2015 1 23	71.72000067	2/5/2015 0 11	72.16999773	2/5/2015 0 10	71.3	2/5/2015 0 10	66.51000244	2/5/2015 1 00	77.79000146	2/5/2015 1 07	72.59999817	2/5/2015 1 02	75.1800021	2/5/2015 1 15	72.88999909	2/5/2015 1 06	75.32000282	2/5/2015 0 28	74.08
2/5/2015 2 05	73.96000255	2/5/2015 2 00	71.99000067	2/5/2015 1 21	73.75999768	2/5/2015 1 01	72.16	2/5/2015 1 08	69.07000253	2/5/2015 2 06	78.37000147	2/5/2015 2 06	72.43999817	2/5/2015 2 06	75.0000021	2/5/2015 2 07	72.76999909	2/5/2015 2 06	75.78000284	2/5/2015 1 15	74.87
2/5/2015 3 50	74.26000256	2/5/2015 3 13	71.84000067	2/5/2015 2 54	73.90999768	2/5/2015 2 05	72.25	2/5/2015 2 06	68.80000252	2/5/2015 3 17	78.40000147	2/5/2015 3 16	72.31999817	2/5/2015 3 16	75.0000021	2/5/2015 3 16	72.82999909	2/5/2015 3 20	75.81000284	2/5/2015 2 03	76.03
2/5/2015 4 54	74.54000257	2/5/2015 4 48	71.53000067	2/5/2015 3 16	73.50999769	2/5/2015 3 16	71.52	2/5/2015 3 13	69.69000255	2/5/2015 4 54	77.48000145	2/5/2015 4 32	72.50999817	2/5/2015 4 57	74.66000209	2/5/2015 4 57	72.48999909	2/5/2015 4 58	75.08000281	2/5/2015 3 13	76
2/5/2015 5 43	72.22000249	2/5/2015 5 59	67.35000063	2/5/2015 4 57	73.1799977	2/5/2015 4 53	71.94	2/5/2015 4 58	69.04000253	2/5/2015 5 55	75.65000142	2/5/2015 5 50	70.51999822	2/5/2015 5 26	74.63000209	2/5/2015 5 59	69.46999913	2/5/2015 5 58	72.70000272	2/5/2015 4 48	75.7
2/5/2015 6 41	70.69000244	2/5/2015 6 35	66.68000062	2/5/2015 5 50	73.2699977	2/5/2015 5 50	70.66	2/5/2015 5 43	66.72000245	2/5/2015 6 02	74.2500014	2/5/2015 6 41	70.60999821	2/5/2015 6 46	73.53000206	2/5/2015 6 42	67.42999915	2/5/2015 6 02	71.81000269	2/5/2015 5 59	73.19
2/5/2015 7 10	70.87000244	2/5/2015 7 13	65.92000061	2/5/2015 6 31	71.15999776	2/5/2015 6 44	70.02	2/5/2015 6 41	66.51000244	2/5/2015 7 13	72.78000137	2/5/2015 7 03	71.1299982	2/5/2015 7 38	72.46000203	2/5/2015 7 13	66.71999916	2/5/2015 7 03	70.90000265	2/5/2015 6 41	71.94
2/5/2015 8 05	69.7100024	2/5/2015 8 06	67.60000063	2/5/2015 7 13	69.8799978	2/5/2015 7 38	69.5	2/5/2015 7 14	66.79000245	2/5/2015 8 03	74.3100014	2/5/2015 8 10	71.0399982	2/5/2015 8 01	73.26000205	2/5/2015 8 16	68.70999914	2/5/2015 8 00	72.97000273	2/5/2015 7 02	72.22
2/5/2015 9 58	71.42000246	2/5/2015 9 48	68.24000063	2/5/2015 8 04	71.24999776	2/5/2015 8 06	69.44	2/5/2015 8 05	66.02000242	2/5/2015 9 24	75.28000141	2/5/2015 9 24	70.91999821	2/5/2015 9 58	73.01000204	2/5/2015 9 24	69.22999913	2/5/2015 9 00	73.73000276	2/5/2015 8 03	73.16
2/5/2015 10 56	70.94000245	2/5/2015 10 00	68.24000063	2/5/2015 9 56	71.00999777	2/5/2015 9 41	69.93	2/5/2015 9 01	67.61000248	2/5/2015 10 59	75.10000141	2/5/2015 10 36	71.3199982	2/5/2015 10 00	73.01000204	2/5/2015 10 13	69.61999913	2/5/2015 10 14	73.09000274	2/5/2015 9 23	73.8
2/5/2015 11 21	70.42000243	2/5/2015 11 14	67.81000063	2/5/2015 10 00	71.67999775	2/5/2015 10 37	68.77	2/5/2015 10 56	67.27000247	2/5/2015 11 01	74.95000141	2/5/2015 11 01	70.57999821	2/5/2015 11 21	73.44000205	2/5/2015 11 04	69.83999912	2/5/2015 11 57	73.43000275	2/5/2015 10 36	73.26
2/5/2015 12 20	70.87000244	2/5/2015 12 08	68.27000063	2/5/2015 11 49	70.21999779	2/5/2015 11 10	69.9	2/5/2015 11 46	66.48000244	2/5/2015 12 09	75.07000141	2/5/2015 12 31	70.91999821	2/5/2015 12 53	73.53000206	2/5/2015 12 25	69.89999912	2/5/2015 12 33	73.95000277	2/5/2015 11 03	73.5
2/5/2015 13 00	70.51000243	2/5/2015 13 54	68.79000064	2/5/2015 12 48	71.46999775	2/5/2015 12 17	70.29	2/5/2015 12 21	66.94000245	2/5/2015 13 49	75.31000141	2/5/2015 13 08	71.1899982	2/5/2015 13 15	73.68000206	2/5/2015 13 43	70.41999912	2/5/2015 13 47	73.95000277	2/5/2015 12 08	73.1
2/5/2015 14 59	70.94000245	2/5/2015 14 01	67.38000063	2/5/2015 13 28	71.31999776	2/5/2015 13 25	70.45	2/5/2015 13 08	67.18000246	2/5/2015 14 56	75.22000141	2/5/2015 14 32	70.85999821	2/5/2015 14 25	73.62000206	2/5/2015 14 33	69.43999913	2/5/2015 14 32	73.37000275	2/5/2015 13 28	73.77
2/5/2015 15 46	70.20000242	2/5/2015 15 00	68.15000063	2/5/2015 14 50	70.79999777	2/5/2015 14 19	70.39	2/5/2015 14 59	67.46000247	2/5/2015 15 18	74.6700014	2/5/2015 15 47	71.0699982	2/5/2015 15 00	73.53000206	2/5/2015 15 33	69.77999913	2/5/2015 15 48	73.49000275	2/5/2015 14 01	73.01
2/5/2015 16 38	71.94000248	2/5/2015 16 00	67.50000063	2/5/2015 15 26	71.86999774	2/5/2015 15 37	70.78	2/5/2015 15 51	66.45000244	2/5/2015 16 55	74.7000014	2/5/2015 16 47	70.9499982	2/5/2015 16 47	73.35000205	2/5/2015 16 44	69.49999913	2/5/2015 16 48	73.31000274	2/5/2015 15 32	73.47
2/5/2015 17 40	71.24000246	2/5/2015 17 33	66.74000062	2/5/2015 16 43	69.44999782	2/5/2015 16 08	68.25	2/5/2015 16 32	67.49000247	2/5/2015 17 42	74.6100014	2/5/2015 17 39	71.37999819	2/5/2015 17 59	73.10000205	2/5/2015 17 54	68.70999914	2/5/2015 17 55	72.70000272	2/5/2015 16 47	72.89
2/5/2015 18 19	70.78000244	2/5/2015 18 38	66.99000062	2/5/2015 17 54	70.42999779	2/5/2015 17 22	70.23	2/5/2015 17 40	66.94000245	2/5/2015 18 36	74.3400014	2/5/2015 18 41	71.43999819	2/5/2015 18 00	73.10000205	2/5/2015 18 18	68.03999915	2/5/2015 18 35	72.54000272	2/5/2015 17 31	73.13
2/5/2015 19 49	70.97000245	2/5/2015 19 20	66.41000062	2/5/2015 18 48	71.24999776	2/5/2015 18 18	70.29	2/5/2015 18 19	67.06000246	2/5/2015 19 31	74.80000141	2/5/2015 19 49	71.37999819	2/5/2015 19 52	73.13000205	2/5/2015 19 53	68.76999914	2/5/2015 19 53	72.42000271	2/5/2015 18 29	73.13
2/5/2015 20 20	70.81000244	2/5/2015 20 55	67.23000062	2/5/2015 19 50	70.73999778	2/5/2015 19 53	69.62	2/5/2015 19 45	66.91000245	2/5/2015 20 11	74.4300014	2/5/2015 20 11	71.55999819	2/5/2015 20 35	73.56000206	2/5/2015 20 06	68.88999914	2/5/2015 20 00	72.58000272	2/5/2015 19 53	72.83
2/5/2015 21 59	71.55000247	2/5/2015 21 00	68.54000064	2/5/2015 20 03	70.82999777	2/5/2015 20 42	70.11	2/5/2015 20 18	67.40000247	2/5/2015 21 08	75.22000141	2/5/2015 21 10	71.1299982	2/5/2015 21 38	73.84000207	2/5/2015 21 03	68.82999914	2/5/2015 21 02	72.88000273	2/5/2015 20 11	72.71
2/5/2015 22 32	71.24000246	2/5/2015 22 07	68.63000064	2/5/2015 21 24	71.49999775	2/5/2015 21 56	70.26	2/5/2015 21 59	67.64000248	2/5/2015 22 11	75.77000142	2/5/2015 22 36	71.64999819	2/5/2015 22 37	73.07000204	2/5/2015 22 03	70.16999912	2/5/2015 22 15	73.40000275	2/5/2015 21 02	73.13
2/5/2015 23 15	74.08000255	2/5/2015 23 00	70.13000065	2/5/2015 22 37	71.24999776	2/5/2015 22 02	70.32	2/5/2015 22 32	67.15000246	2/5/2015 23 00	76.87000144	2/5/2015 23 43	72.62999816	2/5/2015 23 51	74.81000209	2/5/2015 23 01	71.5799991	2/5/2015 23 00	74.7700028	2/5/2015 22 02	74.08
2/6/2015 0 15	69.84000241	2/6/2015 0 25	70.89000066	2/5/2015 23 06	73.1499977	2/5/2015 23 10	71.76	2/5/2015 23 00	69.20000254	2/6/2015 0 15	76.11000143	2/6/2015 0 15	68.34999827	2/6/2015 0 14	73.62000206	2/6/2015 0 16	70.90999911	2/6/2015 0 16	74.16000278	2/5/2015 23 03	74.66
2/6/2015 1 04	74.38000256	2/6/2015 1 26	71.08000066	2/6/2015 0 15	72.83999771	2/6/2015 0 25	71.06	2/6/2015 0 15	64.01000235	2/6/2015 1 26	77.82000146	2/6/2015 1 26	72.16999818	2/6/2015 1 22	74.72000209	2/6/2015 1 23	72.2199991	2/6/2015 1 23	74.9300028	2/6/2015 0 15	73.93
2/6/2015 2 58	74.48000256	2/6/2015 2 25	71.93000067	2/6/2015 1 09	73.47999769	2/6/2015 1 26	71.48	2/6/2015 1 25	68.95000253	2/6/2015 2 02	78.49000147	2/6/2015 2 57	72.92999816	2/6/2015 2 26	74.9700021	2/6/2015 2 04	73.22999908	2/6/2015 2 12	75.87000284	2/6/2015 1 09	75.54
2/6/2015 3 00	74.48000256	2/6/2015 3 19	71.93000067	2/6/2015 2 23	73.96999768	2/6/2015 2 42	72.25	2/6/2015 2 58	69.32000254	2/6/2015 3 59	78.25000147	2/6/2015 3 54	72.68999816	2/6/2015 3 06	75.0600021	2/6/2015 3 59	72.73999909	2/6/2015 3 35	75.90000284	2/6/2015 2 05	76.03
2/6/2015 4 49	74.69000257	2/6/2015 4 46	71.75000067	2/6/2015 3 06	73.56999769	2/6/2015 3 54	71.3	2/6/2015 3 00	69.32000254	2/6/2015 4 59	78.00000146	2/6/2015 4 59	72.74999816	2/6/2015 4 00	75.1800021	2/6/2015 4 03	72.94999909	2/6/2015 4 50	75.69000283	2/6/2015 3 00	76.09

2/6/2015 6 23	71.18000245	2/6/2015 6 33	67.20000062	2/6/2015 5 27	72.92999771	2/6/2015 5 48	70.75	2/6/2015 5 48	66.33000243	2/6/2015 6 51	74.4000014	2/6/2015 6 24	71.64999819	2/6/2015 6 53	73.65000206	2/6/2015 6 46	68.06999915	2/6/2015 6 59	71.84000269	2/6/2015 5 49	74.23
2/6/2015 7 48	70.42000243	2/6/2015 7 31	65.89000061	2/6/2015 6 38	71.73999775	2/6/2015 6 45	70.08	2/6/2015 6 23	67.24000246	2/6/2015 7 09	73.36000138	2/6/2015 7 03	71.58999819	2/6/2015 7 06	72.92000204	2/6/2015 7 06	67.05999916	2/6/2015 7 09	71.20000267	2/6/2015 6 02	73.1
2/6/2015 8 41	71.00000245	2/6/2015 8 00	66.86000062	2/6/2015 7 16	71.03999777	2/6/2015 7 59	68.71	2/6/2015 7 48	67.03000246	2/6/2015 8 29	74.5200014	2/6/2015 8 17	71.40999819	2/6/2015 8 30	73.29000205	2/6/2015 8 01	68.73999914	2/6/2015 8 01	72.73000272	2/6/2015 7 46	72.55
2/6/2015 9 57	69.93000241	2/6/2015 9 12	68.24000063	2/6/2015 8 30	71.34999776	2/6/2015 8 00	68.71	2/6/2015 8 41	66.60000244	2/6/2015 9 45	74.77000141	2/6/2015 9 58	71.40999819	2/6/2015 9 58	73.32000205	2/6/2015 9 13	69.52999913	2/6/2015 9 59	73.31000274	2/6/2015 8 03	72.8
2/6/2015 10 00	69.93000241	2/6/2015 10 39	68.45000064	2/6/2015 9 58	72.04999774	2/6/2015 9 05	70.23	2/6/2015 9 00	67.09000246	2/6/2015 10 27	74.86000141	2/6/2015 10 35	71.40999819	2/6/2015 10 27	73.04000204	2/6/2015 10 27	69.74999913	2/6/2015 10 00	73.31000274	2/6/2015 9 57	73.29
2/6/2015 11 03	69.99000241	2/6/2015 11 19	68.45000064	2/6/2015 10 24	70.85999777	2/6/2015 10 42	70.2	2/6/2015 10 16	66.91000245	2/6/2015 11 32	75.22000141	2/6/2015 11 03	70.69999821	2/6/2015 11 21	72.86000204	2/6/2015 11 29	69.92999912	2/6/2015 11 05	73.70000276	2/6/2015 10 39	72.92
2/6/2015 12 01	70.45000243	2/6/2015 12 25	68.11000063	2/6/2015 11 23	70.97999777	2/6/2015 11 58	70.39	2/6/2015 11 03	66.42000243	2/6/2015 12 48	75.28000141	2/6/2015 12 35	71.46999819	2/6/2015 12 19	73.01000204	2/6/2015 12 16	69.28999913	2/6/2015 12 17	73.40000275	2/6/2015 11 38	73.35
2/6/2015 13 40	70.91000245	2/6/2015 13 48	66.83000062	2/6/2015 12 19	70.63999778	2/6/2015 12 00	70.39	2/6/2015 12 01	65.87000241	2/6/2015 13 48	74.4900014	2/6/2015 13 06	70.88999821	2/6/2015 13 48	73.47000206	2/6/2015 13 48	69.09999913	2/6/2015 13 59	73.95000277	2/6/2015 12 05	73.56
2/6/2015 14 09	70.36000243	2/6/2015 14 11	68.66000064	2/6/2015 13 56	72.16999773	2/6/2015 13 06	70.51	2/6/2015 13 40	67.12000246	2/6/2015 14 57	75.28000141	2/6/2015 14 35	71.43999819	2/6/2015 14 57	73.50000206	2/6/2015 14 12	69.98999912	2/6/2015 14 49	73.86000276	2/6/2015 13 48	71.73
2/6/2015 15 43	70.26000242	2/6/2015 15 07	68.33000063	2/6/2015 14 07	70.94999777	2/6/2015 14 14	70.45	2/6/2015 14 56	67.09000246	2/6/2015 15 49	75.13000141	2/6/2015 15 00	71.37999819	2/6/2015 15 04	73.32000205	2/6/2015 15 48	70.10999912	2/6/2015 15 36	74.01000277	2/6/2015 14 45	73.59
2/6/2015 16 47	71.42000246	2/6/2015 16 16	67.87000063	2/6/2015 15 03	71.00999777	2/6/2015 15 34	70.63	2/6/2015 15 00	66.94000245	2/6/2015 16 57	74.6700014	2/6/2015 16 23	71.37999819	2/6/2015 16 24	73.19000205	2/6/2015 16 24	69.40999913	2/6/2015 16 24	73.61000275	2/6/2015 15 43	73.35
2/6/2015 17 22	71.03000245	2/6/2015 17 28	67.60000063	2/6/2015 16 37	71.21999776	2/6/2015 16 30	70.48	2/6/2015 16 31	67.67000248	2/6/2015 17 40	74.3400014	2/6/2015 17 17	71.58999819	2/6/2015 17 58	73.74000206	2/6/2015 17 47	69.03999913	2/6/2015 17 49	72.97000273	2/6/2015 16 30	73.47
2/6/2015 18 14	71.15000245	2/6/2015 18 17	67.47000063	2/6/2015 17 19	72.07999773	2/6/2015 17 52	69.93	2/6/2015 17 31	67.79000248	2/6/2015 18 14	74.83000141	2/6/2015 18 02	71.67999819	2/6/2015 18 31	73.62000206	2/6/2015 18 10	69.13999913	2/6/2015 18 18	73.22000274	2/6/2015 17 32	73.44
2/6/2015 19 48	70.45000243	2/6/2015 19 00	67.57000063	2/6/2015 18 44	71.61999775	2/6/2015 18 56	70.39	2/6/2015 18 14	67.33000247	2/6/2015 19 45	74.92000141	2/6/2015 19 45	71.2499982	2/6/2015 19 00	73.99000207	2/6/2015 19 08	69.52999913	2/6/2015 19 08	73.16000274	2/6/2015 18 35	72.92
2/6/2015 20 13	72.19000249	2/6/2015 20 42	68.33000063	2/6/2015 19 43	72.50999772	2/6/2015 19 09	70.36	2/6/2015 19 44	66.97000245	2/6/2015 20 10	74.7300014	2/6/2015 20 10	70.9799982	2/6/2015 20 10	72.86000204	2/6/2015 20 10	68.97999913	2/6/2015 20 10	73.22000274	2/6/2015 19 45	73.35
2/6/2015 21 50	72.00000248	2/6/2015 21 58	68.11000063	2/6/2015 20 43	71.43999775	2/6/2015 20 10	69.71	2/6/2015 20 42	67.55000248	2/6/2015 21 49	75.07000141	2/6/2015 21 49	71.2799982	2/6/2015 21 58	73.01000204	2/6/2015 21 58	68.97999913	2/6/2015 21 54	73.22000274	2/6/2015 20 16	74.08
2/6/2015 22 04	72.03000248	2/6/2015 22 00	68.11000063	2/6/2015 21 19	71.79999774	2/6/2015 21 37	70.11	2/6/2015 21 50	67.43000247	2/6/2015 22 03	74.3400014	2/6/2015 22 02	72.28999817	2/6/2015 22 00	73.01000204	2/6/2015 22 03	68.39999914	2/6/2015 22 03	72.1800027	2/6/2015 21 49	73.68
2/6/2015 23 00	72.37000249	2/6/2015 23 21	69.37000064	2/6/2015 22 00	72.16999773	2/6/2015 22 24	70.94	2/6/2015 22 05	68.3100025	2/6/2015 23 19	75.74000142	2/6/2015 23 05	72.56999817	2/6/2015 23 00	74.08000207	2/6/2015 23 00	70.59999912	2/6/2015 23 19	73.70000276	2/6/2015 22 04	72.52
2/7/2015 0 02	71.00000245	2/7/2015 0 02	66.47000062	2/6/2015 23 09	72.95999771	2/6/2015 23 14	71.36	2/6/2015 23 00	68.83000252	2/7/2015 0 03	74.98000141	2/7/2015 0 01	67.83999828	2/7/2015 0 01	73.10000205	2/7/2015 0 02	68.85999914	2/7/2015 0 01	73.09000274	2/6/2015 23 13	73.84
2/7/2015 1 55	73.35000253	2/7/2015 1 01	70.16000065	2/7/2015 0 02	72.01999774	2/7/2015 0 01	69.62	2/7/2015 0 02	63.76000234	2/7/2015 1 13	77.09000145	2/7/2015 1 55	72.01999818	2/7/2015 1 44	74.9700021	2/7/2015 1 06	71.9699991	2/7/2015 1 02	74.7700028	2/7/2015 0 48	74.02
2/7/2015 2 00	74.32000256	2/7/2015 2 10	71.69000067	2/7/2015 1 46	73.53999769	2/7/2015 1 56	71.52	2/7/2015 1 55	68.53000251	2/7/2015 2 04	77.79000146	2/7/2015 2 00	72.50999817	2/7/2015 2 00	74.72000209	2/7/2015 2 00	72.42999909	2/7/2015 2 12	75.32000282	2/7/2015 1 01	74.84
2/7/2015 3 00	75.21000259	2/7/2015 3 00	72.24000067	2/7/2015 2 00	74.11999767	2/7/2015 2 33	72.19	2/7/2015 2 00	68.65000252	2/7/2015 3 49	78.55000147	2/7/2015 3 02	73.35999815	2/7/2015 3 20	75.1800021	2/7/2015 3 29	73.37999908	2/7/2015 3 59	76.15000285	2/7/2015 2 04	75.42
2/7/2015 4 29	74.63000257	2/7/2015 4 31	71.75000067	2/7/2015 3 19	73.87999768	2/7/2015 3 53	72.34	2/7/2015 3 00	69.84000256	2/7/2015 4 19	77.88000146	2/7/2015 4 14	72.43999817	2/7/2015 4 11	75.24000211	2/7/2015 4 15	72.82999909	2/7/2015 4 15	75.38000282	2/7/2015 3 08	76.52
2/7/2015 5 45	74.90000258	2/7/2015 5 40	70.68000066	2/7/2015 4 11	73.69999768	2/7/2015 4 14	71.39	2/7/2015 4 29	68.68000252	2/7/2015 5 52	77.73000146	2/7/2015 5 46	72.56999817	2/7/2015 5 29	75.0300021	2/7/2015 5 53	72.48999909	2/7/2015 5 40	75.44000282	2/7/2015 4 11	75.51
2/7/2015 6 55	72.6500025	2/7/2015 6 05	69.46000065	2/7/2015 5 54	73.75999768	2/7/2015 5 16	72.06	2/7/2015 5 58	69.01000253	2/7/2015 6 20	76.87000144	2/7/2015 6 56	70.82999821	2/7/2015 6 39	74.66000209	2/7/2015 6 08	71.38999911	2/7/2015 6 06	74.44000279	2/7/2015 5 40	75.42
2/7/2015 7 26	71.42000246	2/7/2015 7 52	68.79000064	2/7/2015 6 39	72.92999771	2/7/2015 6 57	71.18	2/7/2015 6 56	67.03000246	2/7/2015 7 53	75.86000142	2/7/2015 7 26	70.54999821	2/7/2015 7 52	74.02000207	2/7/2015 7 51	70.07999912	2/7/2015 7 34	73.64000276	2/7/2015 6 05	74.48
2/7/2015 8 47	72.31000249	2/7/2015 8 52	67.05000062	2/7/2015 7 58	72.50999772	2/7/2015 7 25	70.75	2/7/2015 7 20	66.69000244	2/7/2015 8 47	74.7000014	2/7/2015 8 45	71.58999819	2/7/2015 8 46	73.29000205	2/7/2015 8 46	68.21999914	2/7/2015 8 46	72.0900027	2/7/2015 7 53	73.56
2/7/2015 9 59	70.66000244	2/7/2015 9 58	66.04000061	2/7/2015 8 40	71.03999777	2/7/2015 8 38	69.56	2/7/2015 8 49	67.70000248	2/7/2015 9 16	73.64000139	2/7/2015 9 33	71.67999819	2/7/2015 9 57	73.44000205	2/7/2015 9 47	66.81999916	2/7/2015 9 48	71.08000266	2/7/2015 8 58	73.07
2/7/2015 10 03	66.78000231	2/7/2015 10 00	66.04000061	2/7/2015 9 27	71.06999777	2/7/2015 9 43	69.62	2/7/2015 9 59	67.30000247	2/7/2015 10 09	72.93000137	2/7/2015 10 49	71.64999819	2/7/2015 10 49	72.95000204	2/7/2015 10 23	66.56999916	2/7/2015 10 38	71.14000266	2/7/2015 9 36	72.49
2/7/2015 11 37	70.39000243	2/7/2015 11 23	65.70000061	2/7/2015 10 55	70.51999778	2/7/2015 10 31	69.65	2/7/2015 10 50	67.06000246	2/7/2015 11 08	72.57000137	2/7/2015 11 57	71.73999819	2/7/2015 11 01	72.65000203	2/7/2015 11 19	66.68999916	2/7/2015 11 09	71.08000266	2/7/2015 10 51	72.13
2/7/2015 12 04	70.39000243	2/7/2015 12 19	65.28000061	2/7/2015 11 09	69.9699978	2/7/2015 11 08	69.5	2/7/2015 11 09	67.00000246	2/7/2015 12 19	72.84000137	2/7/2015 12 08	71.64999819	2/7/2015 12 15	72.55000203	2/7/2015 12 12	67.29999915	2/7/2015 12 56	71.75000269	2/7/2015 11 41	72.49
2/7/2015 13 21	70.69000244	2/7/2015 13 19	66.59000062	2/7/2015 12 24	70.36999779	2/7/2015 12 24	69.47	2/7/2015 12 00	67.03000246	2/7/2015 13 04	73.82000139	2/7/2015 13 03	71.76999819	2/7/2015 13 30	73.35000205	2/7/2015 13 04	67.81999915	2/7/2015 13 11	72.2400027	2/7/2015 12 23	72.37
2/7/2015 14 53	68.07000235	2/7/2015 14 03	66.80000062	2/7/2015 13 30	71.09999776	2/7/2015 13 01	70.29	2/7/2015 13 04	67.49000247	2/7/2015 14 06	74.2500014	2/7/2015 14 03	71.79999818	2/7/2015 14 04	73.35000205	2/7/2015 14 13	67.93999915	2/7/2015 14 28	72.45000271	2/7/2015 13 03	72.31
2/7/2015 15 22	70.66000244	2/7/2015 15 29	67.17000062	2/7/2015 14 08	71.37999776	2/7/2015 14 01	70.32	2/7/2015 14 43	67.49000247	2/7/2015 15 17	74.6400014	2/7/2015 15 52	71.89999818	2/7/2015 15 52	73.50000206	2/7/2015 15 59	68.79999914	2/7/2015 15 32	72.73000272	2/7/2015 14 20	73.16
2/7/2015 16 34	71.49000246	2/7/2015 16 00	67.41000063	2/7/2015 15 21	70.82999777	2/7/2015 15 03	70.29	2/7/2015 15 06	67.58000248	2/7/2015 16 10	74.4300014	2/7/2015 16 01	71.82999818	2/7/2015 16 36	73.65000206	2/7/2015 16 37	68.85999914	2/7/2015 16 14	72.97000273	2/7/2015 15 59	73.1
2/7/2015 17 28	71.61000247	2/7/2015 17 46	66.95000062	2/7/2015 16 14	71.06999777	2/7/2015 16 23	70.26	2/7/2015 16 55	67.79000248	2/7/2015 17 17	74.4000014	2/7/2015 17 12	71.67999819	2/7/2015 17 45	73.50000206	2/7/2015 17 16	68.94999913	2/7/2015 17 16	72.79000272	2/7/2015 16 00	73.1
2/7/2015 18 03	71.70000247	2/7/2015 18 12	67.81000063	2/7/2015 17 41	71.46999775	2/7/2015 17 12	69.81	2/7/2015 17 19	67.61000248	2/7/2015 18 00	74.86000141	2/7/2015 18 01	71.92999818	2/7/2015 18 00	73.65000206	2/7/2015 18 27	68.64999914	2/7/2015 18 49	72.76000272	2/7/2015 17 23	73.1
2/7/2015 19 00	71.82000248	2/7/2015 19 34	68.18000063	2/7/2015 18 11	71.55999775	2/7/2015 18 04	70.42	2/7/2015 18 58	67.70000248	2/7/2015 19 00	75.44000142	2/7/2015 19 50	72.04999818	2/7/2015 19 07	73.93000207	2/7/2015 19 01	68.85999914	2/7/2015 19 21	72.91000273	2/7/2015 18 50	73.53
2/7/2015 20 18	72.4300025	2/7/2015 20 12	68.63000064	2/7/2015 19 05	72.16999773	2/7/2015 19 03	70.26	2/7/2015 19 00	67.70000248	2/7/2015 20 00	75.83000142	2/7/2015 20 48	71.82999818	2/7/2015 20 49	73.62000206	2/7/2015 20 17	70.04999912	2/7/2015 20 09	73.61000275	2/7/2015 19 11	73.62
2/7/2015 21 39	73.07000252	2/7/2015 21 15	69.15000064	2/7/2015 20 51	71.55999775	2/7/2015 20 48	70.05	2/7/2015 20 00	68.1300025	2/7/2015 21 07	76.23000143	2/7/2015 21 09	71.92999818	2/7/2015 21 16	74.11000207	2/7/2015 21 04	70.41999912	2/7/2015 21 13	74.07000277	2/7/2015 20 10	73.99
2/7/2015 22 51	72.37000249	2/7/2015 22 08	69.43000065	2/7/2015 21 46	72.71999771	2/7/2015 21 15	70.39	2/7/2015 21 31	67.95000249	2/7/2015 22 09	76.41000143	2/7/2015 22 25	72.16999818	2/7/2015 22 05	74.14000207	2/7/2015 22 26	70.50999912	2/7/2015 22 05	73.73000276	2/7/2015 21 24	74.57
2/7/2015 23 01	74.08000255	2/7/2015 23 28	70.34000065	2/7/2015 22 02	72.34999773	2/7/2015 22 25	70.9	2/7/2015 22 08	68.62000252	2/7/2015 23 09	76.81000144	2/7/2015 23 08	73.29999815	2/7/2015 23 09	74.54000209	2/7/2015 23 14	71.38999911	2/7/2015 23 20	74.44000279	2/7/2015 22 22	74.51
2/8/2015 0 32	72.37000249	2/8/2015 0 32	69.92000065	2/7/2015 23 03	73.1199977	2/7/2015 23 37	71.73	2/7/2015 23 05	69.44000255	2/8/2015 0 03	77.15000145	2/8/2015 0 31	68.65999826	2/8/2015 0 32	72.80000204	2/8/2015 0 32	70.77999911	2/8/2015 0 08	74.9300028	2/7/2015 23 02	74.93
2/8/2015 1 00	74.05000255	2/8/2015 1 01	71.26000066	2/8/2015 0 31	71.76999774	2/8/2015 0 31	69.59	2/8/2015 0 32	65.84000241	2/8/2015 1 07	77.73000146	2/8/2015 1 01	72.34999817	2/8/2015 1 16	75.0000021	2/8/2015 1 18	72.48999909	2/8/2015 1 25	75.54000283	2/8/2015 0 02	74.81
2/8/2015 2 04	74.66000257	2/8/2015 2 03	71.69000067	2/8/2015 1 18	73.66999769	2/8/2015 1 04	71.91	2/8/2015 1 07	68.68000252	2/8/2015 2 02	78.15000147	2/8/2015 2 05	72.65999816	2/8/2015 2 00	75.1200021	2/8/2015 2 04	72.51999909	2/8/2015 2 02	75.47000282	2/8/2015 1 06	75.79
2/8/2015 3 22	75.03000258	2/8/2015 3 19	72.21000067	2/8/2015 2 00	73.66999769	2/8/2015 2 05	71.82	2/8/2015 2 05	69.07000253	2/8/2015 3 02	78.28000147	2/8/2015 3 01	73.20999815	2/8/2015 3 39	75.0600021	2/8/2015 3 48	73.37999908	2/8/2015 3 02	76.21000285	2/8/2015 2 05	76.19
2/8/2015 4 08	75.4800026	2/8/2015 4 54	72.33000067	2/8/2015 3 39	74.08999767	2/8/2015 3 01	72.16	2/8/2015 3 23	69.56000255	2/8/2015 4 59	78.73000148	2/8/2015 4 44	73.23999815	2/8/2015 4 52	75.24000211	2/8/2015 4 25	73.25999908	2/8/2015 4 52	76.05000285	2/8/2015 3 05	76.49
2/8/2015 5 57	74.54000257	2/8/2015 5 56	71.72000067	2/8/2015 4 47	74.05999767	2/8/2015 4 15	72.4	2/8/2015 4 14	69.84000256	2/8/2015 5 44	78.18000147	2/8/2015 5 57	72.68999816	2/8/2015 5 22	75.24000211	2/8/2015 5 57	72.97999909	2/8/2015 5 57	75.66000283	2/8/2015 4 35	76.7
2/8/2015 6 50	73.74000254	2/8/2015 6 42	70.65000066	2/8/2015 5 52	73.90999768	2/8/2015 5 56	72.16	2/8/2015 5 57	69.07000253	2/8/2015 6 47	77.21000145	2/8/2015 6 58	72.01999818	2/8/2015 6 47	74.84000209	2/8/2015 6 58	71.9399991	2/8/2015 6 24	75.17000281	2/8/2015 5 56	75.94
2/8/2015 7 28	72.6100025	2/8/2015 7 59	68.69000064	2/8/2015 6 47	72.83999771	2/8/2015 6 48	71.7	2/8/2015 6 53	68.43000251	2/8/2015 7 49	75.77000142	2/8/2015 7 29	70.9499982	2/8/2015 7 58	73.87000207	2/8/2015 7 58	69.98999912	2/8/2015 7 58	73.58000275	2/8/2015 6 59	75.27
2/8/2015 8 38	72.07000248	2/8/2015 8 39	67.08000062	2/8/2015 7 50	71.52999775	2/8/2015 7 22	70.57	2/8/2015 7 30	66.97000245	2/8/2015 8 38	74.4000014	2/8/2015 8 42	71.55999819	2/8/2015 8 00	73.87000207	2/8/2015 8 58	68.33999914	2/8/2015 8 58	72.36000271	2/8/2015 7 57	74.2
2/8/2015 9 29	70.72000244	2/8/2015 9 37	65.58000061	2/8/2015 8 57	71.49999775	2/8/2015 8 20	70.11	2/8/2015 8 38	67.73000248	2/8/2015 9 41	73.36000138	2/8/2015 9 26	71.2199982	2/8/2015 9 36	73.10000205	2/8/2015 9 31	66.44999916	2/8/2015 9 32	70.87000265	2/8/2015 8 39	73.22
2/8/2015 10 49	69.78000241	2/8/2015 10 13	64.6700006 A	2/8/2015 9 42	70.76999778	2/8/2015 9 26	69.74	2/8/2015 9 58	67.00000246	2/8/2015 10 23	72.84000137	2/8/2015 10 01	71.61999819	2/8/2015 10 25	72.86000204	2/8/2015 10 06	66.19999917	2/8/2015 10 06	71.02000266	2/8/2015 9 38	72.61
2/8/2015 11 00	70.23000242	2/8/2015 11 17	64.5400006 A	2/8/2015 10 40	70.88999777	2/8/2015 10 01	68.92	2/8/2015 10 49	66.63000244	2/8/2015 11 01	73.09000138	2/8/2015 11 57	71.67999819	2/8/2015 11 13	72.92000204	2/8/2015 11 28	66.35999917	2/8/2015 11 59	71.08000266	2/8/2015 10 39	72.34
2/8/2015 12 22	70.33000243	2/8/2015 12 11	65.37000061	2/8/2015 11 40	70.27999779	2/8/2015 11 28	69.5	2/8/2015 11 00	67.09000246	2/8/2015 12 26	73.09000138	2/8/2015 12 01	71.40999819	2/8/2015 12 41	73.01000204	2/8/2015 12 10	66.47999916	2/8/2015 12 00	71.08000266	2/8/2015 11 20	71.73
2/8/2015 13 28	69.75000241	2/8/2015 13 10	64.6000006 A	2/8/2015 12 37	69.9699978	2/8/2015 12 35	69.38	2/8/2015 12 32	67.12000246	2/8/2015 13 00	73.09000138	2/8/2015 13 12	68.59999826	2/8/2015 13 13	72.68000203	2/8/2015 13 04	66.87999916	2/8/2015 13 12	71.45000268	2/8/2015 12 05	72.55
2/8/2015 14 00	70.51000243	2/8/2015 14 01	66.16000061	2/8/2015 13 55	70.0299978	2/8/2015 13 13	68.58	2/8/2015 13 13	66.69000244	2/8/2015 14 02	74.00000139	2/8/2015 14 17	71.79999818	2/8/2015 14 17	73.16000205	2/8/2015 14 01	67.90999915	2/8/2015 14 14	71.78000269	2/8/2015 13 23	72.31
2/8/2015 15 05	71.24000246	2/8/2015 15 47	66.92000062	2/8/2015 14 59	71.21999776	2/8/2015 14 00	69.93	2/8/2015 14 00	66.82000245	2/8/2015 15 26	74.5500014	2/8/2015 15 51	71.89999818	2/8/2015 15 48	73.38000205	2/8/2015 15 02	68.42999914	2/8/2015 15 12	72.39000271	2/8/2015 14 56	72.46
2/8/2015 16 43	71.21000246	2/8/2015 16 26	67.47000063	2/8/2015 15 51	71.06999777	2/8/2015 15 39	69.99	2/8/2015 15 05	67.40000247	2/8/2015 16 28	74.4000014	2/8/2015 16 01	71.76999819	2/8/2015 16 13	73.01000204	2/8/2015 16 29	68.39999914	2/8/2015 16 45	72.70000272	2/8/2015 15 09	72.8
2/8/2015 17 47	70.66000244	2/8/2015 17 55	67.05000062	2/8/2015 16 11	70.60999778	2/8/2015 16 47	70.23	2/8/2015 16 02	67.76000248	2/8/2015 17 43	74.09000139	2/8/2015 17 42	71.70999819	2/8/2015 17 18	73.13000205	2/8/2015 17 43	68.12999914	2/8/2015 17 43	72.0600027	2/8/2015 16 28	72.95
2/8/2015 18 57	70.51000243	2/8/2015 18 40	66.25000061	2/8/2015 17 17	70.94999777	2/8/2015 17 55	69.93	2/8/2015 17 47	67.00000246	2/8/2015 18 38	74.06000139	2/8/2015 18 39	71.79999818	2/8/2015 18 25	73.38000205	2/8/2015 18 39	67.08999916	2/8/2015 18 38	71.93000269	2/8/2015 17 42	73.16
2/8/2015 19 07	71.12000245	2/8/2015 19 02	66.86000062	2/8/2015 18 28	71.34999776	2/8/2015 18 38	69.81	2/8/2015 18 39	66.72000245	2/8/2015 19 13	74.2500014	2/8/2015 19 12	72.04999818	2/8/2015 19 57	73.32000205	2/8/2015 19 41	68.06999915	2/8/2015 19 13	72.2100027	2/8/2015 18 00	73.22
2/8/2015 20 22	71.94000248	2/8/2015 20 00	67.17000062	2/8/2015 19 11	70.91999777	2/8/2015 19 35	70.48	2/8/2015 19 57	67.43000247	2/8/2015 20 00	74.83000141	2/8/2015 20 21	72.10999818	2/8/2015 20 00	73.32000205	2/8/2015 20 10	68.21999914	2/8/2015 20 40	71.17000266	2/8/2015 19 58	73.07
2/8/2015 21 05	71.91000248	2/8/2015 21 08	67.75000063	2/8/2015 20 10	70.66999778	2/8/2015 20 13	70.26	2/8/2015 20 22	67.98000249	2/8/2015 21 10	75.13000141	2/8/2015 21 04	72.22999817	2/8/2015 21 37	73.90000207	2/8/2015 21 11	69.03999913	2/8/2015 21 10	72.94000273	2/8/2015 20 00	73.07
2/8/2015 22 23	72.71000251	2/8/2015 22 00	69.61000065	2/8/2015 21 27	72.22999773	2/8/2015 21 02	70.57	2/8/2015 21 05	68.04000249	2/8/2015 22 01	75.99000143	2/8/2015 22 26	72.22999817	2/8/2015 22 23	73.23000205	2/8/2015 22 01	70.04999912	2/8/2015 22 05	74.07000277	2/8/2015 21 30	73.65
2/8/2015 23 50	71.91000248	2/8/2015 23 01	70.74000066	2/8/2015 22 10	72.22999773	2/8/2015 22 22	70.94	2/8/2015 22 23	68.1000025	2/8/2015 23 49	77.09000145	2/8/2015 23 49	69.41999824	2/8/2015 23 00	74.26000208	2/8/2015 23 50	70.96999911	2/8/2015 23 13	74.7700028	2/8/2015 22 26	74.54
2/9/2015 0 08	74.17000255	2/9/2015 0 59	71.08000066	2/8/2015 23 23	72.95999771	2/8/2015 23 47	70.97	2/8/2015 23 50	66.14000242	2/9/2015 0 01	77.54000145	2/9/2015 0 02	71.98999818	2/9/2015 0 59	74.84000209	2/9/2015 0 00	72.2799991	2/9/2015 0 03	75.63000283	2/8/2015 23 08	75.24
2/9/2015 1 51	73.62000254	2/9/2015 1 00	71.08000066	2/9/2015 0 59	73.2099977	2/9/2015 0 22	71.94	2/9/2015 0 08	68.53000251	2/9/2015 1 00	78.25000147	2/9/2015 1 51	72.37999817	2/9/2015 1 00	74.84000209	2/9/2015 1 14	72.88999909	2/9/2015 1 00	75.57000283	2/9/2015 0 08	75.51
2/9/2015 2 51	73.65000254	2/9/2015 2 17	72.42000067	2/9/2015 1 00	73.2099977	2/9/2015 1 46	72.06	2/9/2015 1 47	68.68000252	2/9/2015 2 43	78.46000147	2/9/2015 2 05	72.89999816	2/9/2015 2 06	75.0000021	2/9/2015 2 44	73.03999909	2/9/2015 2 17	75.96000284	2/9/2015 1 00	75.7
2/9/2015 3 42	73.71000254	2/9/2015 3 44	72.21000067	2/9/2015 2 06	73.84999768	2/9/2015 2 29	71.76	2/9/2015 2 55	69.62000255	2/9/2015 3 43	78.37000147	2/9/2015 3 43	72.10999818	2/9/2015 3 18	75.1200021	2/9/2015 3 44	72.88999909	2/9/2015 3 51	76.05000285	2/9/2015 2 44	76.34
2/9/2015 4 34	74.63000257	2/9/2015 4 59	71.56000067	2/9/2015 3 18	74.33999766	2/9/2015 3 39	72.37	2/9/2015 3 42	68.2200025	2/9/2015 4 33	77.70000146	2/9/2015 4 24	72.04999818	2/9/2015 4 33	75.1800021	2/9/2015 4 56	72.54999909	2/9/2015 4 57	75.38000282	2/9/2015 3 43	76.43
2/9/2015 5 23	71.91000248	2/9/2015 5 55	69.21000064	2/9/2015 4 33	73.96999768	2/9/2015 4 25	71.27	2/9/2015 4 24	68.89000253	2/9/2015 5 34	76.38000143	2/9/2015 5 24	70.54999821	2/9/2015 5 49	74.42000208	2/9/2015 5 53	71.05999911	2/9/2015 5 54	73.86000276	2/9/2015 4 57	75.64
2/9/2015 6 45	71.67000247	2/9/2015 6 33	66.59000062	2/9/2015 5 48	72.44999772	2/9/2015 5 24	70.63	2/9/2015 5 48	66.57000244	2/9/2015 6 52	74.6400014	2/9/2015 6 13	71.37999819	2/9/2015 6 13	73.35000205	2/9/2015 6 42	67.57999915	2/9/2015 6 52	71.90000269	2/9/2015 5 55	73.29
2/9/2015 7 51	70.33000243	2/9/2015 7 39	65.92000061	2/9/2015 6 50	72.04999774	2/9/2015 6 14	69.81	2/9/2015 6 41	67.37000247	2/9/2015 7 39	73.70000139	2/9/2015 7 26	71.0399982	2/9/2015 7 21	72.83000204	2/9/2015 7 38	66.32999917	2/9/2015 7 19	70.84000265	2/9/2015 6 51	72.95
2/9/2015 8 14	70.29000242	2/9/2015 8 04	67.23000062	2/9/2015 7 53	71.03999777	2/9/2015 7 22	69.5	2/9/2015 7 53	66.91000245	2/9/2015 8 07	73.85000139	2/9/2015 8 06	68.92999825	2/9/2015 8 07	72.46000203	2/9/2015 8 07	67.75999915	2/9/2015 8 05	72.51000271	2/9/2015 7 22	72.03
2/9/2015 9 14	69.5900024	2/9/2015 9 00	67.93000063	2/9/2015 8 06	70.33999779	2/9/2015 8 07	68.4	2/9/2015 8 51	67.09000246	2/9/2015 9 52	74.4000014	2/9/2015 9 52	71.0399982	2/9/2015 9 10	73.26000205	2/9/2015 9 06	68.03999915	2/9/2015 9 19	71.81000269	2/9/2015 8 51	73.32
2/9/2015 10 01	70.42000243	2/9/2015 10 59	67.57000063	2/9/2015 9 41	70.97999777	2/9/2015 9 31	68.89	2/9/2015 9 14	66.45000244	2/9/2015 10 13	75.13000141	2/9/2015 10 00	70.9799982	2/9/2015 10 11	73.23000205	2/9/2015 10 48	67.87999915	2/9/2015 10 43	69.16000259	2/9/2015 9 18	73.56
2/9/2015 11 09	70.84000244	2/9/2015 11 00	67.57000063	2/9/2015 10 14	71.24999776	2/9/2015 10 19	70.29	2/9/2015 10 01	67.15000246	2/9/2015 11 30	74.98000141	2/9/2015 11 17	70.85999821	2/9/2015 11 14	73.29000205	2/9/2015 11 27	68.67999914	2/9/2015 11 10	72.2400027	2/9/2015 10 25	73.56
2/9/2015 12 42	70.45000243	2/9/2015 12 02	67.44000063	2/9/2015 11 31	71.40999776	2/9/2015 11 16	69.78	2/9/2015 11 09	66.85000245	2/9/2015 12 29	75.10000141	2/9/2015 12 07	69.32999824	2/9/2015 12 35	73.04000204	2/9/2015 12 03	69.40999913	2/9/2015 12 19	73.37000275	2/9/2015 11 09	73.1
2/9/2015 13 52	71.06000245	2/9/2015 13 15	68.30000063	2/9/2015 12 16	72.07999773	2/9/2015 12 31	70.11	2/9/2015 12 15	66.57000244	2/9/2015 13 05	75.16000141	2/9/2015 13 05	70.73999821	2/9/2015 13 05	73.01000204	2/9/2015 13 05	69.67999913	2/9/2015 13 05	73.19000274	2/9/2015 12 00	73.53
2/9/2015 14 10	70.57000243	2/9/2015 14 49	68.73000064	2/9/2015 13 04	72.07999773	2/9/2015 13 32	70.02	2/9/2015 13 48	66.91000245	2/9/2015 14 17	75.41000142	2/9/2015 14 01	71.1299982	2/9/2015 14 01	73.44000205	2/9/2015 14 10	70.44999912	2/9/2015 14 11	73.86000276	2/9/2015 13 29	73.74
2/9/2015 15 28	71.24000246	2/9/2015 15 09	68.33000063	2/9/2015 14 27	71.95999774	2/9/2015 14 01	70.02	2/9/2015 14 10	66.39000243	2/9/2015 15 57	75.07000141	2/9/2015 15 20	71.40999819	2/9/2015 15 00	73.99000207	2/9/2015 15 47	69.89999912	2/9/2015 15 09	73.86000276	2/9/2015 14 47	73.74
2/9/2015 16 59	71.55000247	2/9/2015 16 42	67.96000063	2/9/2015 15 29	71.82999774	2/9/2015 15 56	70.94	2/9/2015 15 33	67.24000246	2/9/2015 16 14	74.92000141	2/9/2015 16 19	71.1899982	2/9/2015 16 03	73.68000206	2/9/2015 16 59	69.80999912	2/9/2015 16 41	73.49000275	2/9/2015 15 46	73.01
2/9/2015 17 42	70.60000243	2/9/2015 17 38	67.05000062	2/9/2015 16 29	71.70999775	2/9/2015 16 03	70.42	2/9/2015 16 30	67.76000248	2/9/2015 17 41	74.3400014	2/9/2015 17 31	71.52999819	2/9/2015 17 32	73.44000205	2/9/2015 17 24	68.73999914	2/9/2015 17 41	72.76000272	2/9/2015 16 58	73.71
2/9/2015 18 40	70.26000242	2/9/2015 18 58	66.77000062	2/9/2015 17 36	71.58999775	2/9/2015 17 31	69.47	2/9/2015 17 07	67.30000247	2/9/2015 18 07	74.2200014	2/9/2015 18 04	71.2499982	2/9/2015 18 41	73.65000206	2/9/2015 18 08	68.06999915	2/9/2015 18 59	72.39000271	2/9/2015 17 25	72.92
2/9/2015 19 15	71.03000245	2/9/2015 19 00	66.77000062	2/9/2015 18 09	70.54999778	2/9/2015 18 08	70.08	2/9/2015 18 36	66.72000245	2/9/2015 19 00	74.2500014	2/9/2015 19 08	71.49999819	2/9/2015 19 51	73.47000206	2/9/2015 19 06	68.79999914	2/9/2015 19 00	72.39000271	2/9/2015 18 09	72.98
2/9/2015 20 23	71.36000246	2/9/2015 20 11	67.75000063	2/9/2015 19 56	71.31999776	2/9/2015 19 37	70.17	2/9/2015 19 03	67.55000248	2/9/2015 20 23	74.80000141	2/9/2015 20 39	71.58999819	2/9/2015 20 01	73.87000207	2/9/2015 20 31	68.97999913	2/9/2015 20 31	72.85000273	2/9/2015 19 24	73.07
2/9/2015 21 04	71.49000246	2/9/2015 21 29	68.08000063	2/9/2015 20 03	71.95999774	2/9/2015 20 43	70.32	2/9/2015 20 11	67.49000247	2/9/2015 21 04	75.19000141	2/9/2015 21 00	71.76999819	2/9/2015 21 04	73.74000206	2/9/2015 21 03	68.94999913	2/9/2015 21 06	73.06000273	2/9/2015 20 31	72.71
2/9/2015 22 43	70.26000242	2/9/2015 22 02	68.39000064	2/9/2015 21 38	72.04999774	2/9/2015 21 09	70.51	2/9/2015 21 04	66.88000245	2/9/2015 22 03	75.99000143	2/9/2015 22 42	69.84999823	2/9/2015 22 43	71.06000199	2/9/2015 22 43	68.18999914	2/9/2015 22 05	73.83000276	2/9/2015 21 49	73.29
2/9/2015 23 00	74.48000256	2/9/2015 23 00	69.58000065	2/9/2015 22 43	70.0899978	2/9/2015 22 42	70.48	2/9/2015 22 43	65.3800024	2/9/2015 23 00	76.87000144	2/9/2015 23 06	73.01999816	2/9/2015 23 00	73.90000207	2/9/2015 23 12	71.6699991	2/9/2015 23 03	74.8900028	2/9/2015 22 25	73.93
2/10/2015 0 07	70.66000244	2/10/2015 0 09	69.46000065	2/9/2015 23 00	72.80999771	2/9/2015 23 07	71.27	2/9/2015 23 00	69.20000254	2/10/2015 0 07	77.36000145	2/10/2015 0 08	68.04999827	2/10/2015 0 09	73.59000206	2/10/2015 0 09	70.47999912	2/10/2015 0 37	75.44000282	2/9/2015 23 12	74.42
2/10/2015 1 27	73.65000254	2/10/2015 1 04	70.62000066	2/10/2015 0 09	72.34999773	2/10/2015 0 09	68.37	2/10/2015 0 07	65.5600024	2/10/2015 1 28	77.57000146	2/10/2015 1 28	71.58999819	2/10/2015 1 03	74.75000209	2/10/2015 1 03	72.45999909	2/10/2015 1 04	75.08000281	2/10/2015 0 09	75.18
2/10/2015 2 11	74.87000258	2/10/2015 2 12	72.11000067	2/10/2015 1 02	74.02999767	2/10/2015 1 29	71.42	2/10/2015 1 28	68.04000249	2/10/2015 2 11	78.15000147	2/10/2015 2 11	72.65999816	2/10/2015 2 10	74.9000021	2/10/2015 2 11	72.67999909	2/10/2015 2 11	75.51000283	2/10/2015 1 05	75.7
2/10/2015 3 39	74.78000257	2/10/2015 3 40	71.99000067	2/10/2015 2 44	73.75999768	2/10/2015 2 45	72.55	2/10/2015 2 48	69.23000254	2/10/2015 3 28	78.49000147	2/10/2015 3 39	72.80999816	2/10/2015 3 40	74.9300021	2/10/2015 3 40	72.97999909	2/10/2015 3 27	76.12000285	2/10/2015 2 19	76.4

2/10/2015 4 35	74.32000256	2/10/2015 4 36	70.80000066	2/10/2015 3 40	73.53999769	2/10/2015 3 26	72.37	2/10/2015 3 39	69.01000253	2/10/2015 4 43	77.60000146	2/10/2015 4 35	72.25999817	2/10/2015 4 36	74.63000209	2/10/2015 4 36	71.9699991	2/10/2015 4 37	74.9600028	2/10/2015 3 40	76.31
2/10/2015 5 24	72.28000249	2/10/2015 5 32	69.82000065	2/10/2015 4 50	73.41999769	2/10/2015 4 09	72.03	2/10/2015 4 35	68.49000251	2/10/2015 5 31	76.32000143	2/10/2015 5 24	70.9799982	2/10/2015 5 32	73.68000206	2/10/2015 5 32	70.71999911	2/10/2015 5 58	74.16000278	2/10/2015 4 36	75.45
2/10/2015 6 57	71.49000246	2/10/2015 6 33	65.79000061	2/10/2015 5 53	72.92999771	2/10/2015 5 32	71	2/10/2015 5 24	67.27000247	2/10/2015 6 47	74.7000014	2/10/2015 6 31	71.89999818	2/10/2015 6 54	73.53000206	2/10/2015 6 51	67.81999915	2/10/2015 6 50	71.72000269	2/10/2015 5 48	74.26
2/10/2015 7 32	70.54000243	2/10/2015 7 12	66.01000061	2/10/2015 6 45	71.79999774	2/10/2015 6 54	69.84	2/10/2015 6 47	67.73000248	2/10/2015 7 13	73.82000139	2/10/2015 7 32	70.88999821	2/10/2015 7 24	73.04000204	2/10/2015 7 11	66.56999916	2/10/2015 7 13	71.48000268	2/10/2015 6 11	72.98
2/10/2015 8 01	71.00000245	2/10/2015 8 03	67.72000063	2/10/2015 7 35	70.54999778	2/10/2015 7 19	69.29	2/10/2015 7 32	66.88000245	2/10/2015 8 18	74.4300014	2/10/2015 8 13	68.80999826	2/10/2015 8 28	73.04000204	2/10/2015 8 05	68.58999914	2/10/2015 8 02	73.00000273	2/10/2015 7 21	72.25
2/10/2015 9 17	71.09000245	2/10/2015 9 17	68.08000063	2/10/2015 8 00	71.67999775	2/10/2015 8 14	69.81	2/10/2015 8 13	66.48000244	2/10/2015 9 29	75.01000141	2/10/2015 9 43	71.1899982	2/10/2015 9 06	73.19000205	2/10/2015 9 44	69.58999913	2/10/2015 9 06	73.70000276	2/10/2015 8 01	73.65
2/10/2015 10 29	70.60000243	2/10/2015 10 48	68.48000064	2/10/2015 9 06	71.58999775	2/10/2015 9 06	70.36	2/10/2015 9 21	67.37000247	2/10/2015 10 08	74.77000141	2/10/2015 10 08	70.85999821	2/10/2015 10 00	73.32000205	2/10/2015 10 18	69.46999913	2/10/2015 10 09	73.43000275	2/10/2015 9 10	74.08
2/10/2015 11 47	70.29000242	2/10/2015 11 51	68.45000064	2/10/2015 10 46	71.21999776	2/10/2015 10 18	68.1	2/10/2015 10 58	66.88000245	2/10/2015 11 16	75.16000141	2/10/2015 11 07	71.0999982	2/10/2015 11 06	73.16000205	2/10/2015 11 23	70.25999912	2/10/2015 11 40	73.64000276	2/10/2015 10 42	73.74
2/10/2015 12 43	71.06000245	2/10/2015 12 46	68.27000063	2/10/2015 11 40	71.67999775	2/10/2015 11 59	68.34	2/10/2015 11 47	66.39000243	2/10/2015 12 21	75.13000141	2/10/2015 12 02	71.49999819	2/10/2015 12 46	73.10000205	2/10/2015 12 25	70.38999912	2/10/2015 12 56	74.22000278	2/10/2015 11 16	73.9
2/10/2015 13 14	71.03000245	2/10/2015 13 08	69.03000064	2/10/2015 12 25	71.67999775	2/10/2015 12 00	68.34	2/10/2015 12 53	67.27000247	2/10/2015 13 34	75.59000142	2/10/2015 13 55	71.37999819	2/10/2015 13 13	73.93000207	2/10/2015 13 28	70.25999912	2/10/2015 13 00	74.35000278	2/10/2015 12 31	73.9
2/10/2015 14 48	70.48000243	2/10/2015 14 11	68.91000064	2/10/2015 13 11	72.25999773	2/10/2015 13 42	70.08	2/10/2015 13 14	66.91000245	2/10/2015 14 56	75.71000142	2/10/2015 14 32	70.79999821	2/10/2015 14 15	73.96000207	2/10/2015 14 15	69.77999913	2/10/2015 14 00	74.41000278	2/10/2015 13 30	73.93
2/10/2015 15 56	71.58000247	2/10/2015 15 56	68.54000064	2/10/2015 14 52	72.10999773	2/10/2015 14 52	70.45	2/10/2015 14 32	67.00000246	2/10/2015 15 53	75.65000142	2/10/2015 15 28	70.9799982	2/10/2015 15 17	73.84000207	2/10/2015 15 33	70.16999912	2/10/2015 15 24	74.16000278	2/10/2015 14 01	74.17
2/10/2015 16 40	70.02000242	2/10/2015 16 33	68.30000063	2/10/2015 15 59	72.19999773	2/10/2015 15 25	69.96	2/10/2015 15 56	67.24000246	2/10/2015 16 13	75.10000141	2/10/2015 16 18	71.2199982	2/10/2015 16 48	73.77000206	2/10/2015 16 39	69.95999912	2/10/2015 16 46	73.73000276	2/10/2015 15 25	73.71
2/10/2015 17 00	71.03000245	2/10/2015 17 54	67.14000062	2/10/2015 16 49	72.07999773	2/10/2015 16 18	70.39	2/10/2015 16 40	66.24000243	2/10/2015 17 46	74.7000014	2/10/2015 17 19	71.43999819	2/10/2015 17 55	73.50000206	2/10/2015 17 50	68.67999914	2/10/2015 17 51	72.94000273	2/10/2015 16 08	73.53
2/10/2015 18 27	71.27000246	2/10/2015 18 30	67.53000063	2/10/2015 17 35	72.19999773	2/10/2015 17 43	69.5	2/10/2015 17 39	66.82000245	2/10/2015 18 51	74.4000014	2/10/2015 18 14	71.49999819	2/10/2015 18 34	73.35000205	2/10/2015 18 56	68.55999914	2/10/2015 18 22	72.61000272	2/10/2015 17 55	73.13
2/10/2015 19 18	71.09000245	2/10/2015 19 39	67.41000063	2/10/2015 18 07	72.22999773	2/10/2015 18 14	69.65	2/10/2015 18 14	67.46000247	2/10/2015 19 47	74.7000014	2/10/2015 19 45	71.3199982	2/10/2015 19 44	73.44000205	2/10/2015 19 46	68.36999914	2/10/2015 19 46	72.1200027	2/10/2015 18 26	72.89
2/10/2015 20 14	71.30000246	2/10/2015 20 43	67.05000062	2/10/2015 19 11	71.67999775	2/10/2015 19 19	69.93	2/10/2015 19 45	67.21000246	2/10/2015 20 04	75.01000141	2/10/2015 20 18	71.1899982	2/10/2015 20 15	73.65000206	2/10/2015 20 01	68.58999914	2/10/2015 20 26	73.03000273	2/10/2015 19 19	73.35
2/10/2015 21 53	71.52000247	2/10/2015 21 47	68.39000064	2/10/2015 20 53	71.89999774	2/10/2015 20 44	70.08	2/10/2015 20 18	66.69000244	2/10/2015 21 46	75.07000141	2/10/2015 21 36	71.55999819	2/10/2015 21 04	73.62000206	2/10/2015 21 36	69.13999913	2/10/2015 21 46	72.97000273	2/10/2015 20 08	72.95
2/10/2015 22 44	72.37000249	2/10/2015 22 08	68.45000064	2/10/2015 21 35	72.22999773	2/10/2015 21 00	70.26	2/10/2015 21 11	67.03000246	2/10/2015 22 02	75.71000142	2/10/2015 22 08	71.92999818	2/10/2015 22 05	73.62000206	2/10/2015 22 02	69.06999913	2/10/2015 22 15	73.22000274	2/10/2015 21 50	73.56
2/10/2015 23 56	69.32000239	2/10/2015 23 56	70.50000066	2/10/2015 22 44	72.16999773	2/10/2015 22 58	70.57	2/10/2015 22 01	68.1600025	2/10/2015 23 57	75.99000143	2/10/2015 23 56	68.50999826	2/10/2015 23 56	73.53000206	2/10/2015 23 05	70.80999911	2/10/2015 23 06	74.10000277	2/10/2015 22 14	74.05
2/11/2015 0 00	71.97000248	2/11/2015 0 03	70.80000066	2/10/2015 23 06	71.00999777	2/10/2015 23 06	69.96	2/10/2015 23 56	64.19000235	2/11/2015 0 45	76.99000144	2/11/2015 0 14	70.18999822	2/11/2015 0 19	74.60000209	2/11/2015 0 01	71.7599991	2/11/2015 0 19	75.47000282	2/10/2015 23 56	74.54
2/11/2015 1 04	73.38000253	2/11/2015 1 08	71.38000066	2/11/2015 0 18	73.56999769	2/11/2015 0 45	70.32	2/11/2015 0 00	66.69000244	2/11/2015 1 09	77.12000145	2/11/2015 1 08	71.98999818	2/11/2015 1 09	74.72000209	2/11/2015 1 08	72.42999909	2/11/2015 1 09	75.23000281	2/11/2015 0 05	74.42
2/11/2015 2 28	73.96000255	2/11/2015 2 29	71.44000066	2/11/2015 1 08	73.35999769	2/11/2015 1 01	71.73	2/11/2015 1 04	68.1000025	2/11/2015 2 34	78.03000146	2/11/2015 2 37	72.47999817	2/11/2015 2 40	74.75000209	2/11/2015 2 34	72.57999909	2/11/2015 2 30	75.57000283	2/11/2015 1 08	75
2/11/2015 3 40	73.71000254	2/11/2015 3 42	72.02000067	2/11/2015 2 29	73.72999768	2/11/2015 2 34	71.73	2/11/2015 2 29	68.56000251	2/11/2015 3 59	78.34000147	2/11/2015 3 41	72.34999817	2/11/2015 3 11	75.24000211	2/11/2015 3 59	72.79999909	2/11/2015 3 59	75.51000283	2/11/2015 2 29	75.79
2/11/2015 4 46	74.38000256	2/11/2015 4 44	70.95000066	2/11/2015 3 41	74.14999767	2/11/2015 3 35	71.94	2/11/2015 3 41	68.3400025	2/11/2015 4 44	77.85000146	2/11/2015 4 03	72.01999818	2/11/2015 4 14	75.0300021	2/11/2015 4 47	72.67999909	2/11/2015 4 48	75.38000282	2/11/2015 3 27	76.03
2/11/2015 5 23	73.29000252	2/11/2015 5 47	68.18000063	2/11/2015 4 48	73.63999769	2/11/2015 4 45	71.73	2/11/2015 4 03	68.2200025	2/11/2015 5 47	76.66000144	2/11/2015 5 39	71.0999982	2/11/2015 5 38	74.63000209	2/11/2015 5 54	70.44999912	2/11/2015 5 45	73.95000277	2/11/2015 4 44	75.57
2/11/2015 6 46	70.75000244	2/11/2015 6 18	66.86000062	2/11/2015 5 56	72.92999771	2/11/2015 5 53	70.87	2/11/2015 5 38	66.97000245	2/11/2015 6 07	74.5800014	2/11/2015 6 46	71.3199982	2/11/2015 6 50	72.89000204	2/11/2015 6 54	67.81999915	2/11/2015 6 33	71.78000269	2/11/2015 5 54	73.68
2/11/2015 7 37	70.94000245	2/11/2015 7 22	65.25000061	2/11/2015 6 49	70.36999779	2/11/2015 6 51	69.74	2/11/2015 6 46	66.63000244	2/11/2015 7 19	73.42000138	2/11/2015 7 11	70.9799982	2/11/2015 7 23	72.80000204	2/11/2015 7 23	66.19999917	2/11/2015 7 12	70.99000266	2/11/2015 6 07	72.89
2/11/2015 8 10	70.20000242	2/11/2015 8 10	67.44000063	2/11/2015 7 36	71.00999777	2/11/2015 7 12	68.52	2/11/2015 7 37	66.79000245	2/11/2015 8 07	74.4900014	2/11/2015 8 28	70.21999822	2/11/2015 8 30	72.22000202	2/11/2015 8 08	68.79999914	2/11/2015 8 06	72.64000272	2/11/2015 7 23	72.16
2/11/2015 9 39	71.30000246	2/11/2015 9 57	68.15000063	2/11/2015 8 38	71.09999776	2/11/2015 8 30	69.9	2/11/2015 8 29	65.4400024	2/11/2015 9 39	74.98000141	2/11/2015 9 36	70.88999821	2/11/2015 9 39	73.38000205	2/11/2015 9 15	69.61999913	2/11/2015 9 11	73.37000275	2/11/2015 8 10	73.41
2/11/2015 10 22	71.03000245	2/11/2015 10 00	68.15000063 O	2/11/2015 9 35	70.33999779	2/11/2015 9 48	69.41	2/11/2015 9 49	67.12000246	2/11/2015 10 57	75.07000141	2/11/2015 10 14	71.2799982	2/11/2015 10 26	73.44000205	2/11/2015 10 11	69.86999912	2/11/2015 10 17	73.52000275	2/11/2015 9 15	72.64
2/11/2015 11 27	71.45000246	2/11/2015 11 01	67.72000063	2/11/2015 10 54	72.07999773	2/11/2015 10 28	69.9	2/11/2015 10 18	66.88000245	2/11/2015 11 37	74.92000141	2/11/2015 11 24	70.66999821	2/11/2015 11 24	73.23000205	2/11/2015 11 00	69.49999913	2/11/2015 11 16	73.64000276	2/11/2015 10 00	73.22 O
2/11/2015 12 21	71.09000245	2/11/2015 12 10	68.51000064	2/11/2015 11 28	72.28999773	2/11/2015 11 27	69.56	2/11/2015 11 40	66.63000244	2/11/2015 12 02	75.13000141	2/11/2015 12 09	71.0999982	2/11/2015 12 53	73.38000205	2/11/2015 12 29	70.19999912	2/11/2015 12 34	73.73000276	2/11/2015 11 19	73.9
2/11/2015 13 27	70.87000244	2/11/2015 13 00	68.91000064	2/11/2015 12 55	71.58999775	2/11/2015 12 17	69.35	2/11/2015 12 21	66.91000245	2/11/2015 13 00	75.62000142	2/11/2015 13 48	70.9799982	2/11/2015 13 24	73.19000205	2/11/2015 13 06	70.07999912	2/11/2015 13 48	73.98000277	2/11/2015 12 11	72.89
2/11/2015 14 04	70.84000244	2/11/2015 14 04	68.82000064	2/11/2015 13 18	72.16999773	2/11/2015 13 06	69.96	2/11/2015 13 27	66.79000245	2/11/2015 14 16	75.31000141	2/11/2015 14 22	71.1299982	2/11/2015 14 09	73.59000206	2/11/2015 14 25	70.10999912	2/11/2015 14 26	73.89000277	2/11/2015 13 54	73.65
2/11/2015 15 43	71.45000246	2/11/2015 15 43	68.27000063	2/11/2015 14 11	70.60999778	2/11/2015 14 12	69.81	2/11/2015 14 22	66.91000245	2/11/2015 15 58	75.47000142	2/11/2015 15 26	71.40999819	2/11/2015 15 53	73.71000206	2/11/2015 15 49	70.13999912	2/11/2015 15 53	74.31000278	2/11/2015 14 32	73.29
2/11/2015 16 30	70.05000242	2/11/2015 16 30	67.90000063	2/11/2015 15 53	71.55999775	2/11/2015 15 53	70.57	2/11/2015 15 38	67.12000246	2/11/2015 16 58	74.7300014	2/11/2015 16 10	70.9499982	2/11/2015 16 59	73.68000206	2/11/2015 16 37	69.61999913	2/11/2015 16 38	73.46000275	2/11/2015 15 10	73.01
2/11/2015 17 25	70.84000244	2/11/2015 17 39	66.89000062	2/11/2015 16 37	71.95999774	2/11/2015 16 38	70.14	2/11/2015 16 26	66.66000244	2/11/2015 17 56	74.2800014	2/11/2015 17 30	71.52999819	2/11/2015 17 41	73.56000206	2/11/2015 17 41	68.67999914	2/11/2015 17 55	72.51000271	2/11/2015 16 03	73.53
2/11/2015 18 37	71.27000246	2/11/2015 18 02	67.14000062	2/11/2015 17 38	71.03999777	2/11/2015 17 25	69.81	2/11/2015 17 30	67.09000246	2/11/2015 18 19	74.19000139	2/11/2015 18 35	71.2499982	2/11/2015 18 22	73.13000205	2/11/2015 18 48	68.39999914	2/11/2015 18 32	72.45000271	2/11/2015 17 29	72.86
2/11/2015 19 48	70.84000244	2/11/2015 19 26	66.77000062	2/11/2015 18 15	70.79999777	2/11/2015 18 41	69.44	2/11/2015 18 38	67.00000246	2/11/2015 19 01	74.6400014	2/11/2015 19 34	71.49999819	2/11/2015 19 19	73.56000206	2/11/2015 19 03	68.48999914	2/11/2015 19 03	72.42000271	2/11/2015 18 10	72.98
2/11/2015 20 57	70.63000244	2/11/2015 20 03	67.26000062	2/11/2015 19 44	71.31999776	2/11/2015 19 27	70.08	2/11/2015 19 23	67.30000247	2/11/2015 20 58	74.3700014	2/11/2015 20 56	69.02999825	2/11/2015 20 58	73.35000205	2/11/2015 20 08	68.73999914	2/11/2015 20 08	72.82000273	2/11/2015 19 34	73.26
2/11/2015 21 18	69.93000241	2/11/2015 21 01	66.28000062	2/11/2015 20 20	71.46999775	2/11/2015 20 57	68.1	2/11/2015 20 58	65.96000242	2/11/2015 21 00	74.3700014	2/11/2015 21 17	70.02999823	2/11/2015 21 00	73.35000205	2/11/2015 21 02	68.91999914	2/11/2015 21 02	72.79000272	2/11/2015 20 31	73.35
2/11/2015 22 22	72.10000248	2/11/2015 22 21	69.06000064	2/11/2015 21 13	71.64999775	2/11/2015 21 01	69.53	2/11/2015 21 00	65.96000242	2/11/2015 22 01	74.92000141	2/11/2015 22 52	71.92999818	2/11/2015 22 21	74.26000208	2/11/2015 22 03	69.89999912	2/11/2015 22 03	73.43000275	2/11/2015 21 04	72.52
2/11/2015 23 01	73.50000253	2/11/2015 23 15	68.79000064	2/11/2015 22 05	72.47999772	2/11/2015 22 53	70.17	2/11/2015 22 53	67.37000247	2/11/2015 23 16	76.32000143	2/11/2015 23 17	72.10999818	2/11/2015 23 00	74.48000208	2/11/2015 23 16	69.80999912	2/11/2015 23 16	73.09000274	2/11/2015 22 25	73.93
2/12/2015 0 32	70.33000243	2/12/2015 0 32	69.37000064	2/11/2015 23 13	72.95999771	2/11/2015 23 21	70.94	2/11/2015 23 01	68.74000252	2/12/2015 0 33	76.99000144	2/12/2015 0 32	68.65999826	2/12/2015 0 33	74.66000209	2/12/2015 0 32	70.53999912	2/12/2015 0 32	73.80000276	2/11/2015 23 13	74.48
2/12/2015 1 35	72.83000251	2/12/2015 1 42	71.08000066	2/12/2015 0 32	73.1799977	2/12/2015 0 31	68.37	2/12/2015 0 32	64.77000237	2/12/2015 1 16	77.30000145	2/12/2015 1 15	71.3499982	2/12/2015 1 15	74.66000209	2/12/2015 1 09	72.42999909	2/12/2015 1 41	75.41000282	2/12/2015 0 32	73.8
2/12/2015 2 10	73.68000254	2/12/2015 2 31	71.20000066	2/12/2015 1 54	73.84999768	2/12/2015 1 09	71.52	2/12/2015 1 36	67.95000249	2/12/2015 2 23	77.88000146	2/12/2015 2 30	71.55999819	2/12/2015 2 27	74.63000209	2/12/2015 2 31	72.39999909	2/12/2015 2 04	75.72000283	2/12/2015 1 40	75.48
2/12/2015 3 47	73.59000253	2/12/2015 3 56	71.84000067	2/12/2015 2 27	73.44999769	2/12/2015 2 31	71.03	2/12/2015 2 19	68.04000249	2/12/2015 3 48	78.03000146	2/12/2015 3 47	72.01999818	2/12/2015 3 48	74.84000209	2/12/2015 3 48	72.61999909	2/12/2015 3 48	75.29000282	2/12/2015 2 31	75.57
2/12/2015 4 47	73.16000252	2/12/2015 4 57	71.23000066	2/12/2015 3 54	74.05999767	2/12/2015 3 59	71.36	2/12/2015 3 51	68.1600025	2/12/2015 4 47	77.09000145	2/12/2015 4 47	71.40999819	2/12/2015 4 47	74.84000209	2/12/2015 4 48	72.39999909	2/12/2015 4 47	75.23000281	2/12/2015 3 52	75.97
2/12/2015 5 38	71.73000247	2/12/2015 5 42	68.91000064	2/12/2015 4 13	73.69999768	2/12/2015 4 04	71.09	2/12/2015 4 47	67.79000248	2/12/2015 5 54	75.38000142	2/12/2015 5 46	68.83999826	2/12/2015 5 43	74.26000208	2/12/2015 5 54	70.01999912	2/12/2015 5 59	73.83000276	2/12/2015 4 08	75.06
2/12/2015 6 13	70.29000242	2/12/2015 6 56	66.50000062	2/12/2015 5 58	72.34999773	2/12/2015 5 42	69.41	2/12/2015 5 43	65.93000242	2/12/2015 6 55	73.79000139	2/12/2015 6 12	71.3499982	2/12/2015 6 48	72.74000203	2/12/2015 6 47	67.60999915	2/12/2015 6 46	71.78000269	2/12/2015 5 46	73.19
2/12/2015 7 38	69.99000241	2/12/2015 7 17	65.79000061	2/12/2015 6 45	71.61999775	2/12/2015 6 46	69.47	2/12/2015 6 13	66.69000244	2/12/2015 7 39	73.18000138	2/12/2015 7 51	71.0699982	2/12/2015 7 36	72.46000203	2/12/2015 7 21	66.65999916	2/12/2015 7 14	71.05000266	2/12/2015 6 02	72.8
2/12/2015 8 48	69.5300024	2/12/2015 8 22	67.14000062	2/12/2015 7 45	70.27999779	2/12/2015 7 21	68.28	2/12/2015 7 46	66.69000244	2/12/2015 8 12	74.3700014	2/12/2015 8 42	69.32999824	2/12/2015 8 19	73.23000205	2/12/2015 8 11	68.67999914	2/12/2015 8 04	72.67000272	2/12/2015 7 11	72.4
2/12/2015 9 19	71.15000245	2/12/2015 9 16	67.47000063	2/12/2015 8 19	70.79999777	2/12/2015 8 04	69.81	2/12/2015 8 42	65.72000241	2/12/2015 9 15	74.3700014	2/12/2015 9 59	70.76999821	2/12/2015 9 00	73.26000205	2/12/2015 9 16	69.16999913	2/12/2015 9 04	73.55000275	2/12/2015 8 12	72.74
2/12/2015 10 25	70.26000242	2/12/2015 10 39	68.33000063	2/12/2015 9 01	72.01999774	2/12/2015 9 37	70.11	2/12/2015 9 19	66.69000244	2/12/2015 10 03	74.2500014	2/12/2015 10 02	71.0999982	2/12/2015 10 25	73.47000206	2/12/2015 10 10	69.46999913	2/12/2015 10 52	73.55000275	2/12/2015 9 12	73.53
2/12/2015 11 22	70.78000244	2/12/2015 11 17	67.99000063	2/12/2015 10 04	71.67999775	2/12/2015 10 55	69.1	2/12/2015 10 25	66.02000242	2/12/2015 11 17	75.01000141	2/12/2015 11 06	71.3199982	2/12/2015 11 25	73.23000205	2/12/2015 11 07	69.80999912	2/12/2015 11 33	73.61000275	2/12/2015 10 03	73.74
2/12/2015 12 43	69.87000241	2/12/2015 12 43	68.42000064	2/12/2015 11 14	72.16999773	2/12/2015 11 47	69.32	2/12/2015 11 06	67.15000246	2/12/2015 12 02	75.10000141	2/12/2015 12 42	71.2799982	2/12/2015 12 40	73.26000205	2/12/2015 12 43	70.01999912	2/12/2015 12 08	73.67000276	2/12/2015 11 23	73.44
2/12/2015 13 26	70.51000243	2/12/2015 13 14	68.60000064	2/12/2015 12 42	71.52999775	2/12/2015 12 57	70.17	2/12/2015 12 43	66.79000245	2/12/2015 13 26	74.6400014	2/12/2015 13 59	71.0099982	2/12/2015 13 00	73.53000206	2/12/2015 13 34	70.13999912	2/12/2015 13 23	73.92000277	2/12/2015 12 50	73.71
2/12/2015 14 23	69.87000241	2/12/2015 14 28	68.76000064	2/12/2015 13 15	72.07999773	2/12/2015 13 15	70.26	2/12/2015 13 30	66.97000245	2/12/2015 14 47	75.44000142	2/12/2015 14 55	70.66999821	2/12/2015 14 58	72.86000204	2/12/2015 14 58	70.04999912	2/12/2015 14 58	73.58000275	2/12/2015 13 41	73.74
2/12/2015 15 48	71.18000245	2/12/2015 15 58	68.79000064	2/12/2015 14 28	71.06999777	2/12/2015 14 50	70.29	2/12/2015 14 23	66.72000245	2/12/2015 15 48	75.16000141	2/12/2015 15 22	71.2799982	2/12/2015 15 00	72.86000204	2/12/2015 15 37	70.47999912	2/12/2015 15 00	73.58000275	2/12/2015 14 55	73.84
2/12/2015 16 49	71.30000246	2/12/2015 16 49	67.78000063	2/12/2015 15 48	71.15999776	2/12/2015 15 00	70.39	2/12/2015 15 00	67.24000246	2/12/2015 16 24	75.19000141	2/12/2015 16 22	71.1899982	2/12/2015 16 16	73.56000206	2/12/2015 16 57	69.31999913	2/12/2015 16 23	73.43000275	2/12/2015 15 54	73.44
2/12/2015 17 14	69.5900024	2/12/2015 17 31	67.02000062	2/12/2015 16 32	71.52999775	2/12/2015 16 29	69.71	2/12/2015 16 06	66.91000245	2/12/2015 17 48	74.15000139	2/12/2015 17 14	71.1599982	2/12/2015 17 15	73.19000205	2/12/2015 17 40	68.91999914	2/12/2015 17 40	72.79000272	2/12/2015 16 27	73.26
2/12/2015 18 24	70.78000244	2/12/2015 18 11	66.25000061	2/12/2015 17 22	71.64999775	2/12/2015 17 00	69.78	2/12/2015 17 14	66.69000244	2/12/2015 18 24	74.3400014	2/12/2015 18 24	70.9799982	2/12/2015 18 44	73.26000205	2/12/2015 18 57	68.18999914	2/12/2015 18 24	72.61000272	2/12/2015 17 47	72.74
2/12/2015 19 28	70.75000244	2/12/2015 19 47	67.05000062	2/12/2015 18 46	71.61999775	2/12/2015 18 20	69.65	2/12/2015 18 24	66.45000244	2/12/2015 19 32	74.06000139	2/12/2015 19 04	71.0999982	2/12/2015 19 07	73.26000205	2/12/2015 19 04	68.18999914	2/12/2015 19 33	72.0000027	2/12/2015 18 05	72.64
2/12/2015 20 26	70.51000243	2/12/2015 20 01	67.38000063	2/12/2015 19 07	71.28999776	2/12/2015 19 32	69.99	2/12/2015 19 03	66.79000245	2/12/2015 20 35	74.6400014	2/12/2015 20 26	70.54999821	2/12/2015 20 46	73.29000205	2/12/2015 20 02	68.70999914	2/12/2015 20 02	72.70000272	2/12/2015 19 47	73.13
2/12/2015 21 27	72.03000248	2/12/2015 21 45	67.99000063	2/12/2015 20 46	71.79999774	2/12/2015 20 21	69.53	2/12/2015 20 30	66.72000245	2/12/2015 21 10	75.44000142	2/12/2015 21 12	71.49999819	2/12/2015 21 42	73.81000207	2/12/2015 21 02	69.43999913	2/12/2015 21 09	72.88000273	2/12/2015 20 26	72.77
2/12/2015 22 46	72.5200025	2/12/2015 22 05	68.42000064	2/12/2015 21 16	71.95999774	2/12/2015 21 01	70.36	2/12/2015 21 21	67.98000249	2/12/2015 22 02	75.56000142	2/12/2015 22 34	71.95999818	2/12/2015 22 05	74.02000207	2/12/2015 22 01	69.37999913	2/12/2015 22 09	73.80000276	2/12/2015 21 01	73.8
2/12/2015 23 00	73.90000254	2/12/2015 23 10	70.13000065	2/12/2015 22 13	72.13999773	2/12/2015 22 09	70.17	2/12/2015 22 46	67.79000248	2/12/2015 23 02	76.60000144	2/12/2015 23 02	72.50999817	2/12/2015 23 26	74.66000209	2/12/2015 23 14	70.99999911	2/12/2015 23 00	74.50000279	2/12/2015 22 01	74.02
2/13/2015 0 41	68.89000238	2/13/2015 0 42	68.91000064	2/12/2015 23 23	73.3299977	2/12/2015 23 02	71.09	2/12/2015 23 02	69.01000253	2/13/2015 0 41	74.92000141	2/13/2015 0 40	68.16999827	2/13/2015 0 41	73.62000206	2/13/2015 0 41	70.47999912	2/13/2015 0 41	73.86000276	2/12/2015 23 10	74.2
2/13/2015 1 14	73.35000253	2/13/2015 1 15	70.47000065	2/13/2015 0 40	73.1199977	2/13/2015 0 41	67.49	2/13/2015 0 41	63.82000234	2/13/2015 1 01	77.70000146	2/13/2015 1 02	71.85999818	2/13/2015 1 15	74.63000209	2/13/2015 1 15	72.64999909	2/13/2015 1 01	75.44000282	2/13/2015 0 14	74.9
2/13/2015 2 10	74.96000258	2/13/2015 2 15	71.35000066	2/13/2015 1 15	73.2699977	2/13/2015 1 01	71.79	2/13/2015 1 14	68.2200025	2/13/2015 2 00	78.12000147	2/13/2015 2 23	72.74999816	2/13/2015 2 00	75.21000211	2/13/2015 2 17	73.03999909	2/13/2015 2 02	75.81000284	2/13/2015 1 19	74.69
2/13/2015 3 38	75.12000259	2/13/2015 3 48	71.84000067	2/13/2015 2 16	74.14999767	2/13/2015 2 16	71.97	2/13/2015 2 16	69.07000253	2/13/2015 3 43	78.55000147	2/13/2015 3 38	72.89999816	2/13/2015 3 38	74.9000021	2/13/2015 3 38	72.94999909	2/13/2015 3 38	75.63000283	2/13/2015 2 00	76
2/13/2015 4 50	74.63000257	2/13/2015 4 58	70.68000066	2/13/2015 3 38	73.96999768	2/13/2015 3 38	71.42	2/13/2015 3 28	69.41000254	2/13/2015 4 45	77.76000146	2/13/2015 4 57	72.50999817	2/13/2015 4 45	75.1200021	2/13/2015 4 58	72.70999909	2/13/2015 4 59	75.69000283	2/13/2015 3 24	76.25
2/13/2015 5 54	72.28000249	2/13/2015 5 49	69.58000065	2/13/2015 4 31	73.99999768	2/13/2015 4 15	71.82	2/13/2015 4 58	69.11000253	2/13/2015 5 55	75.71000142	2/13/2015 5 48	70.60999821	2/13/2015 5 43	74.81000209	2/13/2015 5 55	71.32999911	2/13/2015 5 54	74.16000278	2/13/2015 4 42	75.48
2/13/2015 6 50	71.94000248	2/13/2015 6 57	67.57000063	2/13/2015 5 05	72.74999771	2/13/2015 5 54	70.26	2/13/2015 5 48	66.33000243	2/13/2015 6 47	74.86000141	2/13/2015 6 56	71.55999819	2/13/2015 6 56	73.23000205	2/13/2015 6 51	67.84999915	2/13/2015 6 51	71.57000268	2/13/2015 5 54	73.99
2/13/2015 7 47	70.60000243	2/13/2015 7 18	66.31000062	2/13/2015 6 32	71.79999774	2/13/2015 6 56	69.53	2/13/2015 6 46	67.67000248	2/13/2015 7 43	73.51000138	2/13/2015 7 22	71.37999819	2/13/2015 7 21	72.83000204	2/13/2015 7 24	66.62999916	2/13/2015 7 27	71.45000268	2/13/2015 6 08	73.59
2/13/2015 8 14	68.83000238	2/13/2015 8 07	66.89000062	2/13/2015 7 22	71.09999776	2/13/2015 7 55	69.29	2/13/2015 7 02	66.91000245	2/13/2015 8 07	74.2800014	2/13/2015 8 29	69.75999823	2/13/2015 8 44	72.83000204	2/13/2015 8 03	68.12999914	2/13/2015 8 00	72.85000273	2/13/2015 7 06	72.86
2/13/2015 9 07	70.60000243	2/13/2015 9 39	67.78000063	2/13/2015 8 03	70.54999778	2/13/2015 8 01	69.78	2/13/2015 8 00	67.33000247	2/13/2015 9 13	74.7000014	2/13/2015 9 24	71.43999819	2/13/2015 9 44	72.62000203	2/13/2015 9 14	69.40999913	2/13/2015 9 24	73.37000275	2/13/2015 8 38	73.04
2/13/2015 10 32	70.84000244	2/13/2015 10 33	67.90000063	2/13/2015 9 44	71.31999776	2/13/2015 9 47	69.81	2/13/2015 9 14	67.46000247	2/13/2015 10 14	74.4300014	2/13/2015 10 44	71.3499982	2/13/2015 10 00	73.04000204	2/13/2015 10 18	69.40999913	2/13/2015 10 18	72.91000273	2/13/2015 9 39	73.44
2/13/2015 11 30	71.58000247	2/13/2015 11 02	67.84000063	2/13/2015 10 16	71.21999776	2/13/2015 10 05	68.8	2/13/2015 10 53	67.58000248	2/13/2015 11 10	74.92000141	2/13/2015 11 04	71.3499982	2/13/2015 11 41	73.13000205	2/13/2015 11 47	70.13999912	2/13/2015 11 00	73.22000274	2/13/2015 10 14	73.5
2/13/2015 12 54	69.96000241	2/13/2015 12 05	68.45000064	2/13/2015 11 46	71.49999775	2/13/2015 11 54	70.2	2/13/2015 11 32	67.49000247	2/13/2015 12 50	75.25000141	2/13/2015 12 33	71.49999819	2/13/2015 12 28	73.13000205	2/13/2015 12 02	69.74999913	2/13/2015 12 02	73.37000275	2/13/2015 11 05	73.19
2/13/2015 13 00	71.42000246	2/13/2015 13 55	68.48000064	2/13/2015 12 22	71.12999776	2/13/2015 12 33	70.11	2/13/2015 12 33	67.64000248	2/13/2015 13 07	75.38000142	2/13/2015 13 36	71.2799982	2/13/2015 13 23	73.38000205	2/13/2015 13 13	69.92999912	2/13/2015 13 20	73.83000276	2/13/2015 12 22	73.41
2/13/2015 14 22	70.81000244	2/13/2015 14 00	68.48000064	2/13/2015 13 53	72.19999773	2/13/2015 13 14	69.68	2/13/2015 13 31	67.61000248	2/13/2015 14 23	75.19000141	2/13/2015 14 06	70.9499982	2/13/2015 14 32	73.62000206	2/13/2015 14 02	69.83999912	2/13/2015 14 47	73.73000276	2/13/2015 13 00	73.74
2/13/2015 15 26	71.00000245	2/13/2015 15 31	68.54000064	2/13/2015 14 33	71.06999777	2/13/2015 14 39	70.08	2/13/2015 14 02	66.72000245	2/13/2015 15 51	75.25000141	2/13/2015 15 26	71.2499982	2/13/2015 15 18	73.87000207	2/13/2015 15 58	69.92999912	2/13/2015 15 44	73.86000276	2/13/2015 14 27	73.35
2/13/2015 16 49	71.03000245	2/13/2015 16 13	68.33000063	2/13/2015 15 18	71.76999774	2/13/2015 15 26	70.02	2/13/2015 15 22	67.03000246	2/13/2015 16 27	75.16000141	2/13/2015 16 14	71.67999819	2/13/2015 16 02	73.47000206	2/13/2015 16 31	69.46999913	2/13/2015 16 20	73.52000275	2/13/2015 15 07	73.8
2/13/2015 17 40	71.39000246	2/13/2015 17 43	66.89000062	2/13/2015 16 07	71.86999774	2/13/2015 16 07	69.81	2/13/2015 16 30	67.55000248	2/13/2015 17 40	74.6400014	2/13/2015 17 31	71.61999819	2/13/2015 17 09	73.65000206	2/13/2015 17 54	69.19999913	2/13/2015 17 50	72.85000273	2/13/2015 16 40	73.44
2/13/2015 18 32	71.36000246	2/13/2015 18 31	67.60000063	2/13/2015 17 00	71.95999774	2/13/2015 17 32	70.02	2/13/2015 17 42	67.49000247	2/13/2015 18 10	74.86000141	2/13/2015 18 16	71.76999819	2/13/2015 18 48	73.68000206	2/13/2015 18 04	69.06999913	2/13/2015 18 36	72.88000273	2/13/2015 17 40	73.07
2/13/2015 19 03	71.88000248	2/13/2015 19 37	68.60000064	2/13/2015 18 07	71.95999774	2/13/2015 18 07	69.78	2/13/2015 18 40	67.64000248	2/13/2015 19 26	74.89000141	2/13/2015 19 09	71.92999818	2/13/2015 19 04	73.96000207	2/13/2015 19 16	69.16999913	2/13/2015 19 05	73.09000274	2/13/2015 18 10	73.47
2/13/2015 20 43	72.13000249	2/13/2015 20 02	68.69000064	2/13/2015 19 13	72.40999772	2/13/2015 19 25	70.17	2/13/2015 19 09	67.82000249	2/13/2015 20 00	75.44000142	2/13/2015 20 21	72.04999818	2/13/2015 20 21	74.02000207	2/13/2015 20 22	70.07999912	2/13/2015 20 33	73.46000275	2/13/2015 19 08	73.99
2/13/2015 21 00	72.80000251	2/13/2015 21 06	69.34000064	2/13/2015 20 33	72.53999772	2/13/2015 20 58	70.87	2/13/2015 20 33	68.1900025	2/13/2015 21 47	75.99000143	2/13/2015 21 01	72.19999818	2/13/2015 21 24	74.05000207	2/13/2015 21 01	69.86999912	2/13/2015 21 25	73.64000276	2/13/2015 20 22	74.02
2/13/2015 22 00	72.95000251	2/13/2015 22 16	69.37000064	2/13/2015 21 24	71.03999777	2/13/2015 21 12	70.78	2/13/2015 21 02	68.2800025	2/13/2015 22 48	76.05000143	2/13/2015 22 00	72.47999817	2/13/2015 22 35	74.42000208	2/13/2015 22 15	70.04999912	2/13/2015 22 31	74.35000278	2/13/2015 21 06	73.84
2/13/2015 23 03	73.84000254	2/13/2015 23 43	69.15000064	2/13/2015 22 21	72.83999771	2/13/2015 22 00	70.94	2/13/2015 22 00	68.43000251	2/13/2015 23 44	76.35000143	2/13/2015 23 44	72.22999817	2/13/2015 23 19	74.20000208	2/13/2015 23 44	70.44999912	2/13/2015 23 43	74.41000278	2/13/2015 22 44	74.78
2/14/2015 0 22	74.87000258	2/14/2015 0 21	71.01000066	2/13/2015 23 43	72.40999772	2/13/2015 23 09	71.48	2/13/2015 23 10	69.29000254	2/14/2015 0 29	77.51000145	2/14/2015 0 00	73.56999814	2/14/2015 0 18	74.84000209	2/14/2015 0 01	71.9399991	2/14/2015 0 00	75.20000281	2/13/2015 23 43	74.66
2/14/2015 1 17	73.59000253	2/14/2015 1 23	70.47000065	2/14/2015 0 32	73.66999769	2/14/2015 0 03	71.97	2/14/2015 0 01	69.96000256	2/14/2015 1 18	77.24000145	2/14/2015 1 18	69.93999823	2/14/2015 1 19	74.35000208	2/14/2015 1 19	71.5499991	2/14/2015 1 19	74.28000278	2/14/2015 0 17	75.3
2/14/2015 2 27	74.93000258	2/14/2015 2 11	71.59000067	2/14/2015 1 23	73.1799977	2/14/2015 1 23	71.24	2/14/2015 1 17	68.07000249	2/14/2015 2 20	77.88000146	2/14/2015 2 07	72.86999816	2/14/2015 2 21	75.1200021	2/14/2015 2 21	72.61999909	2/14/2015 2 20	75.51000283	2/14/2015 1 18	74.2

2/14/2015 3 19	75.33000259
2/14/2015 4 51	71.21000246
2/14/2015 5 49	74.14000255
2/14/2015 6 49	72.5200025
2/14/2015 7 46	71.64000247
2/14/2015 8 19	70.11000242
2/14/2015 9 58	70.02000242
2/14/2015 10 31	69.10000238
2/14/2015 11 47	70.23000242
2/14/2015 12 57	67.12000232
2/14/2015 13 01	69.29000239
2/14/2015 14 38	71.12000245
2/14/2015 15 50	70.17000242
2/14/2015 16 05	70.69000244
2/14/2015 17 54	70.84000244
2/14/2015 18 14	71.33000246
2/14/2015 19 00	71.49000246
2/14/2015 20 40	72.19000249
2/14/2015 21 05	70.60000243
2/14/2015 22 03	72.89000251
2/14/2015 23 09	73.80000254
2/15/2015 0 04	74.78000257
2/15/2015 1 37	67.76000234
2/15/2015 2 04	74.05000255
2/15/2015 3 01	75.03000258
2/15/2015 4 34	74.90000258
2/15/2015 5 21	74.05000255
2/15/2015 6 42	73.53000253
2/15/2015 7 33	71.36000246
2/15/2015 8 37	71.82000248
2/15/2015 9 43	69.5000024
2/15/2015 10 26	69.7100024
2/15/2015 11 24	70.14000242
2/15/2015 12 50	70.87000244
2/15/2015 13 13	68.83000238
2/15/2015 14 02	70.72000244
2/15/2015 15 27	70.05000242
2/15/2015 16 14	71.61000247
2/15/2015 17 07	70.84000244
2/15/2015 18 05	71.76000247
2/15/2015 19 23	72.16000249
2/15/2015 20 48	72.40000249
2/15/2015 21 02	72.5800025
2/15/2015 22 02	72.89000251
2/15/2015 23 35	70.23000242
2/16/2015 0 01	72.6500025
2/16/2015 1 05	73.93000255
2/16/2015 2 03	74.93000258
2/16/2015 3 13	75.12000259
2/16/2015 4 43	74.87000258
2/16/2015 5 58	74.51000257
2/16/2015 6 59	73.53000253
2/16/2015 7 03	72.25000249
2/16/2015 8 53	71.88000248
2/16/2015 9 32	70.42000243
2/16/2015 10 05	69.96000241
2/16/2015 11 02	69.7100024
2/16/2015 12 14	69.6800024
2/16/2015 13 12	70.20000242
2/16/2015 14 18	70.87000244
2/16/2015 15 32	71.33000246
2/16/2015 16 44	70.87000244
2/16/2015 17 40	70.91000245
2/16/2015 18 27	70.94000245
2/16/2015 19 49	71.18000245
2/16/2015 20 12	71.21000246
2/16/2015 21 57	71.30000246
2/16/2015 22 01	72.34000249
2/16/2015 23 42	67.91000234
2/17/2015 0 15	73.47000253
2/17/2015 1 25	74.42000256
2/17/2015 2 25	74.54000257
2/17/2015 3 28	74.45000256
2/17/2015 4 34	73.77000254
2/17/2015 5 34	72.4900025
2/17/2015 6 48	71.27000246
2/17/2015 7 33	70.78000244
2/17/2015 8 54	68.59000237
2/17/2015 9 10	70.66000244
2/17/2015 10 02	71.55000247
2/17/2015 11 22	70.29000242
2/17/2015 12 44	70.91000245
2/17/2015 13 07	71.67000247
2/17/2015 14 46	70.69000244
2/17/2015 15 54	70.91000245
2/17/2015 16 12	71.09000245
2/17/2015 17 57	71.09000245
2/17/2015 18 01	70.84000244
2/17/2015 19 13	70.39000243
2/17/2015 20 03	70.69000244
2/17/2015 21 11	71.45000246
2/17/2015 22 31	71.18000245
2/17/2015 23 43	70.36000243

2/14/2015 3 00	71.66000067	
2/14/2015 4 50	71.35000066	
2/14/2015 5 51	70.95000066	
2/14/2015 6 49	70.34000065	
2/14/2015 7 55	69.21000064	
2/14/2015 8 44	67.11000062	
2/14/2015 9 09	66.10000061	
2/14/2015 10 31	65.1500006	
2/14/2015 11 43	65.67000061	
2/14/2015 12 04	66.53000062	
2/14/2015 13 00	66.56000062	
2/14/2015 14 14	67.44000063	
2/14/2015 15 13	67.47000063	
2/14/2015 16 27	67.72000063	
2/14/2015 17 38	67.53000063	
2/14/2015 18 02	67.69000063	
2/14/2015 19 20	68.76000064	
2/14/2015 20 10	68.91000064	
2/14/2015 21 05	67.84000063	
2/14/2015 22 23	69.98000065	
2/14/2015 23 06	70.37000065	
2/15/2015 0 00	70.56000066	
2/15/2015 1 09	71.38000066	
2/15/2015 2 14	71.50000066	
2/15/2015 3 47	72.36000067	
2/15/2015 4 18	72.21000067	
2/15/2015 5 55	71.44000066	
2/15/2015 6 42	70.98000066	
2/15/2015 7 34	68.91000064	
2/15/2015 8 53	67.90000063	
2/15/2015 9 41	65.83000061	
2/15/2015 10 06	66.19000061	
2/15/2015 11 09	65.79000061	
2/15/2015 12 04	66.25000061	
2/15/2015 13 40	66.77000062	
2/15/2015 14 24	67.72000063	
2/15/2015 15 15	67.66000063	
2/15/2015 16 30	67.26000062	
2/15/2015 17 27	67.60000063	
2/15/2015 18 27	68.36000063	
2/15/2015 19 00	68.42000064	
2/15/2015 20 48	68.82000064	
2/15/2015 21 06	69.31000064	
2/15/2015 22 08	69.55000065	
2/15/2015 23 35	70.13000065	
2/16/2015 0 31	70.95000066	
2/16/2015 1 38	71.47000066	
2/16/2015 2 00	71.81000067	
2/16/2015 3 34	72.39000067	
2/16/2015 4 52	72.48000067	
2/16/2015 5 48	70.92000066	
2/16/2015 6 53	70.92000066	
2/16/2015 7 33	69.37000064	
2/16/2015 8 52	67.50000063	
2/16/2015 9 56	65.46000061	
2/16/2015 10 41	65.37000061	
2/16/2015 11 40	64.6300006	A
2/16/2015 12 00	65.70000061	
2/16/2015 13 01	65.83000061	
2/16/2015 14 20	66.80000062	
2/16/2015 15 54	66.83000062	
2/16/2015 16 27	66.95000062	
2/16/2015 17 32	66.83000062	
2/16/2015 18 32	66.22000061	
2/16/2015 19 06	66.74000062	
2/16/2015 20 12	67.32000062	
2/16/2015 21 57	66.86000062	
2/16/2015 22 01	68.91000064	
2/16/2015 23 02	70.74000066	
2/17/2015 0 21	71.05000066	
2/17/2015 1 25	71.44000066	
2/17/2015 2 13	72.11000067	
2/17/2015 3 14	71.66000067	
2/17/2015 4 14	68.79000064	
2/17/2015 5 58	69.55000065	
2/17/2015 6 16	67.47000063	
2/17/2015 7 11	66.19000061	
2/17/2015 8 09	67.78000063	
2/17/2015 9 11	67.08000062	
2/17/2015 10 18	68.45000064	
2/17/2015 11 00	68.76000064	
2/17/2015 12 56	68.82000064	
2/17/2015 13 14	67.96000063	
2/17/2015 14 16	69.12000064	
2/17/2015 15 55	68.82000064	
2/17/2015 16 36	68.24000063	
2/17/2015 17 30	66.44000062	
2/17/2015 18 57	66.41000062	
2/17/2015 19 00	66.41000062	
2/17/2015 20 19	67.60000063	
2/17/2015 21 03	68.08000063	
2/17/2015 22 10	68.24000063	
2/17/2015 23 00	70.07000065	

2/14/2015 2 44	74.11999767
2/14/2015 3 23	73.90999768
2/14/2015 4 08	74.14999767
2/14/2015 5 22	74.05999767
2/14/2015 6 54	73.1799977
2/14/2015 7 24	72.53999772
2/14/2015 8 59	71.58999775
2/14/2015 9 37	71.28999776
2/14/2015 10 50	70.82999777
2/14/2015 11 13	70.54999778
2/14/2015 12 32	71.00999777
2/14/2015 13 31	70.88999777
2/14/2015 14 07	71.15999776
2/14/2015 15 14	71.64999775
2/14/2015 16 19	71.67999775
2/14/2015 17 25	70.39999779
2/14/2015 18 34	72.16999773
2/14/2015 19 00	72.47999772
2/14/2015 20 04	72.53999772
2/14/2015 21 05	72.01999774
2/14/2015 22 02	73.2699977
2/14/2015 23 39	73.50999769
2/15/2015 0 10	73.44999769
2/15/2015 1 43	73.44999769
2/15/2015 2 40	73.87999768
2/15/2015 3 34	74.24999767
2/15/2015 4 13	73.99999768
2/15/2015 5 46	73.69999768
2/15/2015 6 34	73.2699977
2/15/2015 7 53	72.50999772
2/15/2015 8 26	71.43999775
2/15/2015 9 38	71.00999777
2/15/2015 10 10	71.06999777
2/15/2015 11 37	70.57999778
2/15/2015 12 28	71.21999776
2/15/2015 13 09	70.39999779
2/15/2015 14 11	71.64999775
2/15/2015 15 03	71.70999775
2/15/2015 16 54	71.52999775
2/15/2015 17 00	72.44999772
2/15/2015 18 36	72.01999774
2/15/2015 19 16	71.58999775
2/15/2015 20 13	72.10999773
2/15/2015 21 18	72.56999772
2/15/2015 22 01	71.95999774
2/15/2015 23 34	71.12999776
2/16/2015 0 43	73.0899977
2/16/2015 1 09	73.63999769
2/16/2015 2 08	73.84999768
2/16/2015 3 56	74.24999767
2/16/2015 4 56	74.14999767
2/16/2015 5 14	73.87999768
2/16/2015 6 27	73.66999769
2/16/2015 7 54	72.25999773
2/16/2015 8 58	70.70999778
2/16/2015 9 00	70.70999778
2/16/2015 10 48	70.45999778
2/16/2015 11 08	70.1299978
2/16/2015 12 59	70.15999779
2/16/2015 13 00	70.15999779
2/16/2015 14 50	70.70999778
2/16/2015 15 31	70.79999777
2/16/2015 16 23	71.98999774
2/16/2015 17 54	71.37999776
2/16/2015 18 58	71.49999775
2/16/2015 19 48	71.15999776
2/16/2015 20 48	71.95999774
2/16/2015 21 41	71.82999774
2/16/2015 22 15	71.89999774
2/16/2015 23 43	72.47999772
2/17/2015 0 15	73.50999769
2/17/2015 1 28	73.81999768
2/17/2015 2 45	74.14999767
2/17/2015 3 42	73.72999768
2/17/2015 4 14	73.0899977
2/17/2015 5 01	73.35999769
2/17/2015 6 01	71.55999775
2/17/2015 7 52	70.97999777
2/17/2015 8 16	72.10999773
2/17/2015 9 05	71.46999775
2/17/2015 10 44	71.98999774
2/17/2015 11 29	70.85999777
2/17/2015 12 23	72.01999774
2/17/2015 13 05	71.92999774
2/17/2015 14 28	72.01999774
2/17/2015 15 40	71.46999775
2/17/2015 16 32	71.76999774
2/17/2015 17 17	71.58999775
2/17/2015 18 28	71.34999776
2/17/2015 19 16	71.24999776
2/17/2015 20 04	72.10999773
2/17/2015 21 30	71.95999774
2/17/2015 22 25	72.07999773
2/17/2015 23 42	71.34999776

2/14/2015 2 07	71.88	
2/14/2015 3 19	72.1	
2/14/2015 4 14	72.13	
2/14/2015 5 20	71.79	
2/14/2015 6 49	70.08	
2/14/2015 7 32	69.96	
2/14/2015 8 44	68.37	
2/14/2015 9 19	69.07	
2/14/2015 10 00	69.13	
2/14/2015 11 49	69.32	
2/14/2015 12 57	68.13	
2/14/2015 13 26	69.9	
2/14/2015 14 13	69.87	
2/14/2015 15 17	69.65	
2/14/2015 16 52	69.96	
2/14/2015 17 54	69.44	
2/14/2015 18 55	69.87	
2/14/2015 19 43	70.39	
2/14/2015 20 01	70.05	
2/14/2015 21 05	69.16	
2/14/2015 22 03	71.18	
2/14/2015 23 40	71.42	
2/15/2015 0 00	72.19	
2/15/2015 1 37	68.58	
2/15/2015 2 14	71.21	
2/15/2015 3 01	72.16	
2/15/2015 4 56	72.22	
2/15/2015 5 54	71.61	
2/15/2015 6 42	71.33	
2/15/2015 7 39	69.84	
2/15/2015 8 59	69.62	
2/15/2015 9 37	69.2	
2/15/2015 10 59	69.01	
2/15/2015 11 09	68.86	
2/15/2015 12 13	69.35	
2/15/2015 13 56	69.81	
2/15/2015 14 27	69.5	
2/15/2015 15 06	69.99	
2/15/2015 16 59	69.29	
2/15/2015 17 00	69.29	
2/15/2015 18 28	70.02	
2/15/2015 19 54	69.74	
2/15/2015 20 00	70.23	
2/15/2015 21 02	70.69	
2/15/2015 22 02	70.75	
2/15/2015 23 34	67.73	
2/16/2015 0 05	71	
2/16/2015 1 01	71.67	
2/16/2015 2 03	72	
2/16/2015 3 29	72.22	
2/16/2015 4 14	71.91	
2/16/2015 5 55	71.82	
2/16/2015 6 59	71.27	
2/16/2015 7 24	70.32	
2/16/2015 8 52	69.04	
2/16/2015 9 46	69.5	
2/16/2015 10 43	68.46	
2/16/2015 11 00	68.46	
2/16/2015 12 35	69.07	
2/16/2015 13 22	69.16	
2/16/2015 14 22	69.38	
2/16/2015 15 09	69.74	
2/16/2015 16 21	69.65	
2/16/2015 17 56	69.99	
2/16/2015 18 12	69.87	
2/16/2015 19 35	69.96	
2/16/2015 20 45	69.53	
2/16/2015 21 05	69.74	
2/16/2015 22 34	70.29	
2/16/2015 23 42	68.58	
2/17/2015 0 23	71.45	
2/17/2015 1 25	71.48	
2/17/2015 2 39	71.61	
2/17/2015 3 24	71.15	
2/17/2015 4 55	71.91	
2/17/2015 5 57	70.66	
2/17/2015 6 38	69.47	
2/17/2015 7 39	69.04	
2/17/2015 8 54	68.52	
2/17/2015 9 02	69.04	
2/17/2015 10 47	62.14	A
2/17/2015 11 22	63.46	
2/17/2015 12 38	63.85	
2/17/2015 13 01	62.85	
2/17/2015 14 43	62.42	A
2/17/2015 15 02	63	
2/17/2015 16 33	62.69	
2/17/2015 17 47	59.67	A
2/17/2015 18 44	60.77	A
2/17/2015 19 03	61.17	A
2/17/2015 20 03	63.21	
2/17/2015 21 06	63.58	
2/17/2015 22 31	64.1	
2/17/2015 23 43	62.24	A

2/14/2015 2 21	69.32000254
2/14/2015 3 00	69.65000255
2/14/2015 4 33	69.56000255
2/14/2015 5 35	68.74000252
2/14/2015 6 08	67.40000247
2/14/2015 7 09	66.75000245
2/14/2015 8 44	66.45000244
2/14/2015 9 05	66.66000244
2/14/2015 10 13	67.00000246
2/14/2015 11 35	67.15000246
2/14/2015 12 57	64.74000237
2/14/2015 13 53	65.96000242
2/14/2015 14 09	67.15000246
2/14/2015 15 46	66.88000245
2/14/2015 16 19	67.61000248
2/14/2015 17 08	67.58000248
2/14/2015 18 16	67.67000248
2/14/2015 19 53	67.61000248
2/14/2015 20 49	67.70000248
2/14/2015 21 05	66.79000245
2/14/2015 22 44	68.65000252
2/14/2015 23 07	69.17000254
2/15/2015 0 04	69.81000256
2/15/2015 1 37	64.16000235
2/15/2015 2 14	68.89000253
2/15/2015 3 01	69.62000255
2/15/2015 4 01	69.41000254
2/15/2015 5 40	68.86000252
2/15/2015 6 50	68.01000249
2/15/2015 7 39	65.87000241
2/15/2015 8 53	67.79000248
2/15/2015 9 43	66.72000245
2/15/2015 10 59	66.85000245
2/15/2015 11 00	66.85000245
2/15/2015 12 21	67.21000246
2/15/2015 13 13	66.11000242
2/15/2015 14 02	66.88000245
2/15/2015 15 23	66.63000244
2/15/2015 16 00	67.88000249
2/15/2015 17 45	67.79000248
2/15/2015 18 34	67.15000246
2/15/2015 19 54	68.01000249
2/15/2015 20 48	67.95000249
2/15/2015 21 02	68.07000249
2/15/2015 22 02	68.1000025
2/15/2015 23 35	64.98000238
2/16/2015 0 05	67.58000248
2/16/2015 1 01	68.62000252
2/16/2015 2 21	69.47000255
2/16/2015 3 13	69.75000256
2/16/2015 4 15	69.50000255
2/16/2015 5 53	68.98000253
2/16/2015 6 59	67.91000249
2/16/2015 7 24	67.40000247
2/16/2015 8 55	67.70000248
2/16/2015 9 42	67.27000247
2/16/2015 10 33	66.94000245
2/16/2015 11 06	66.69000244
2/16/2015 12 14	66.72000245
2/16/2015 13 22	67.24000246
2/16/2015 14 18	66.66000244
2/16/2015 15 55	67.61000248
2/16/2015 16 40	67.70000248
2/16/2015 17 13	67.67000248
2/16/2015 18 43	67.52000247
2/16/2015 19 00	67.61000248
2/16/2015 20 45	67.37000247
2/16/2015 21 57	67.15000246
2/16/2015 22 16	67.85000249
2/16/2015 23 42	64.22000235
2/17/2015 0 15	68.2500025
2/17/2015 1 25	68.89000253
2/17/2015 2 25	69.50000255
2/17/2015 3 47	68.40000251
2/17/2015 4 14	68.89000253
2/17/2015 5 32	67.18000246
2/17/2015 6 48	67.18000246
2/17/2015 7 48	66.24000243
2/17/2015 8 54	64.22000235
2/17/2015 9 10	66.54000244
2/17/2015 10 55	67.27000247
2/17/2015 11 26	66.79000245
2/17/2015 12 01	67.12000246
2/17/2015 13 11	67.09000246
2/17/2015 14 58	66.85000245
2/17/2015 15 00	66.85000245
2/17/2015 16 37	67.03000246
2/17/2015 17 43	66.79000245
2/17/2015 18 01	67.12000246
2/17/2015 19 22	66.63000244
2/17/2015 20 03	67.21000246
2/17/2015 21 00	67.95000249
2/17/2015 22 31	66.72000245
2/17/2015 23 43	64.37000236

2/14/2015 3 12	78.37000147
2/14/2015 4 51	77.79000146
2/14/2015 5 09	77.36000145
2/14/2015 6 12	77.15000145
2/14/2015 7 58	75.35000142
2/14/2015 8 31	74.2200014
2/14/2015 9 48	72.96000137
2/14/2015 10 35	72.66000137
2/14/2015 11 32	72.96000137
2/14/2015 12 32	73.18000138
2/14/2015 13 02	73.58000138
2/14/2015 14 23	74.4300014
2/14/2015 15 51	74.4300014
2/14/2015 16 32	74.4900014
2/14/2015 17 37	74.5200014
2/14/2015 18 24	75.10000141
2/14/2015 19 12	75.19000141
2/14/2015 20 00	75.86000142
2/14/2015 21 04	75.59000142
2/14/2015 22 00	76.41000143
2/14/2015 23 09	77.09000145
2/15/2015 0 04	76.66000144
2/15/2015 1 37	76.60000144
2/15/2015 2 06	77.85000146
2/15/2015 3 44	78.18000147
2/15/2015 4 25	78.58000147
2/15/2015 5 58	77.82000146
2/15/2015 6 42	77.36000145
2/15/2015 7 39	75.93000143
2/15/2015 8 58	74.86000141
2/15/2015 9 24	73.67000139
2/15/2015 10 31	73.39000138
2/15/2015 11 02	73.39000138
2/15/2015 12 02	73.51000138
2/15/2015 13 14	73.91000139
2/15/2015 14 14	74.5500014
2/15/2015 15 27	74.4900014
2/15/2015 16 08	74.95000141
2/15/2015 17 41	74.92000141
2/15/2015 18 06	75.01000141
2/15/2015 19 26	75.53000142
2/15/2015 20 18	75.71000142
2/15/2015 21 02	75.56000142
2/15/2015 22 02	76.20000143
2/15/2015 23 34	75.53000142
2/16/2015 0 01	77.30000145
2/16/2015 1 01	77.57000146
2/16/2015 2 13	78.37000147
2/16/2015 3 19	78.76000148
2/16/2015 4 41	78.25000147
2/16/2015 5 53	77.27000145
2/16/2015 6 58	76.93000144
2/16/2015 7 52	76.32000143
2/16/2015 8 46	75.25000141
2/16/2015 9 32	73.48000138
2/16/2015 10 37	72.63000137
2/16/2015 11 19	72.29000136
2/16/2015 12 27	72.69000137
2/16/2015 13 12	73.70000139
2/16/2015 14 00	73.88000139
2/16/2015 15 46	74.3100014
2/16/2015 16 28	74.5200014
2/16/2015 17 31	74.2800014
2/16/2015 18 25	73.73000139
2/16/2015 19 00	74.09000139
2/16/2015 20 12	74.7000014
2/16/2015 21 41	75.22000141
2/16/2015 22 16	74.89000141
2/16/2015 23 42	76.38000143
2/17/2015 0 02	77.45000145
2/17/2015 1 02	78.06000146
2/17/2015 2 00	78.40000147
2/17/2015 3 15	78.31000147
2/17/2015 4 48	77.88000146
2/17/2015 5 58	76.51000144
2/17/2015 6 42	74.4900014
2/17/2015 7 17	73.54000138
2/17/2015 8 54	74.2500014
2/17/2015 9 39	74.80000141
2/17/2015 10 24	75.10000141
2/17/2015 11 27	74.7300014
2/17/2015 12 32	75.25000141
2/17/2015 13 28	75.35000142
2/17/2015 14 05	75.47000142
2/17/2015 15 50	75.41000142
2/17/2015 16 51	75.16000141
2/17/2015 17 31	74.3700014
2/17/2015 18 30	74.2800014
2/17/2015 19 00	74.3100014
2/17/2015 20 06	74.7300014
2/17/2015 21 11	75.50000142
2/17/2015 22 02	75.59000142
2/17/2015 23 41	76.08000143

2/14/2015 3 07	73.20999815
2/14/2015 4 52	72.59999817
2/14/2015 5 34	72.25999817
2/14/2015 6 48	70.51999822
2/14/2015 7 07	70.79999821
2/14/2015 8 43	70.66999821
2/14/2015 9 26	70.79999821
2/14/2015 10 05	71.3199982
2/14/2015 11 14	71.61999819
2/14/2015 12 57	68.80999826
2/14/2015 13 01	71.1899982
2/14/2015 14 22	71.64999819
2/14/2015 15 24	71.43999819
2/14/2015 16 05	71.61999819
2/14/2015 17 17	71.67999819
2/14/2015 18 54	71.89999818
2/14/2015 19 52	71.76999819
2/14/2015 20 48	71.73999819
2/14/2015 21 04	71.1599982
2/14/2015 22 08	72.25999817
2/14/2015 23 40	72.98999816
2/15/2015 0 09	73.53999814
2/15/2015 1 37	68.86999825
2/15/2015 2 13	72.50999817
2/15/2015 3 19	73.08999815
2/15/2015 4 01	73.01999816
2/15/2015 5 57	71.3499982
2/15/2015 6 51	71.3499982
2/15/2015 7 39	69.75999823
2/15/2015 8 53	71.67999819
2/15/2015 9 43	71.1599982
2/15/2015 10 25	71.43999819
2/15/2015 11 51	71.3499982
2/15/2015 12 41	71.64999819
2/15/2015 13 13	71.0699982
2/15/2015 14 02	71.1299982
2/15/2015 15 06	71.37999819
2/15/2015 16 13	71.58999819
2/15/2015 17 28	71.98999818
2/15/2015 18 34	71.70999819
2/15/2015 19 26	71.73999819
2/15/2015 20 44	72.13999818
2/15/2015 21 14	72.01999818
2/15/2015 22 02	71.92999818
2/15/2015 23 34	67.31999829
2/16/2015 0 06	71.0999982
2/16/2015 1 01	72.34999817
2/16/2015 2 20	72.74999816
2/16/2015 3 28	73.01999816
2/16/2015 4 05	72.89999816
2/16/2015 5 53	72.16999818
2/16/2015 6 48	71.46999819
2/16/2015 7 23	70.54999821
2/16/2015 8 42	71.3499982
2/16/2015 9 47	71.49999819
2/16/2015 10 53	71.46999819
2/16/2015 11 06	71.37999819
2/16/2015 12 14	71.0699982
2/16/2015 13 54	71.76999819
2/16/2015 14 21	68.56999826
2/16/2015 15 31	71.52999819
2/16/2015 16 02	71.89999818
2/16/2015 17 32	71.58999819
2/16/2015 18 39	71.61999819
2/16/2015 19 58	71.64999819
2/16/2015 20 29	71.92999818
2/16/2015 21 42	70.51999822
2/16/2015 22 01	71.89999818
2/16/2015 23 42	68.28999827
2/17/2015 0 14	71.89999818
2/17/2015 1 24	72.07999818
2/17/2015 2 38	72.37999817
2/17/2015 3 23	72.25999817
2/17/2015 4 14	72.37999817
2/17/2015 5 33	71.0099982
2/17/2015 6 48	71.1899982
2/17/2015 7 47	70.60999821
2/17/2015 8 53	68.47999826
2/17/2015 9 10	70.54999821
2/17/2015 10 10	70.9799982
2/17/2015 11 03	71.1599982
2/17/2015 12 00	70.66999821
2/17/2015 13 02	70.9499982
2/17/2015 14 58	71.1599982
2/17/2015 15 49	70.9499982
2/17/2015 16 11	71.40999819
2/17/2015 17 46	71.2499982
2/17/2015 18 38	71.0399982
2/17/2015 19 13	71.1899982
2/17/2015 20 14	71.49999819
2/17/2015 21 00	71.92999818
2/17/2015 22 30	70.69999821
2/17/2015 23 42	66.67999831

2/14/2015 3 23	75.1800021
2/14/2015 4 11	75.1500021
2/14/2015 5 45	75.0000021
2/14/2015 6 54	74.51000209
2/14/2015 7 32	73.90000207
2/14/2015 8 59	73.62000206
2/14/2015 9 41	73.26000205
2/14/2015 10 32	72.89000204
2/14/2015 11 21	72.95000204
2/14/2015 12 00	73.29000205
2/14/2015 13 26	73.23000205
2/14/2015 14 22	73.62000206
2/14/2015 15 17	73.65000206
2/14/2015 16 28	73.47000206
2/14/2015 17 25	73.47000206
2/14/2015 18 16	73.59000206
2/14/2015 19 52	73.96000207
2/14/2015 20 30	73.56000206
2/14/2015 21 06	73.53000206
2/14/2015 22 13	74.63000209
2/14/2015 23 40	74.42000208
2/15/2015 0 10	74.78000209
2/15/2015 1 43	74.42000208
2/15/2015 2 00	74.9300021
2/15/2015 3 19	75.33000211
2/15/2015 4 39	75.30000211
2/15/2015 5 58	74.81000209
2/15/2015 6 00	74.81000209
2/15/2015 7 51	73.93000207
2/15/2015 8 49	73.74000206
2/15/2015 9 09	73.10000205
2/15/2015 10 47	73.04000204
2/15/2015 11 14	72.95000204
2/15/2015 12 18	73.07000204
2/15/2015 13 24	73.38000205
2/15/2015 14 00	73.59000206
2/15/2015 15 13	73.23000205
2/15/2015 16 08	73.50000206
2/15/2015 17 41	73.77000206
2/15/2015 18 30	73.96000207
2/15/2015 19 55	73.99000207
2/15/2015 20 55	74.11000207
2/15/2015 21 02	74.17000208
2/15/2015 22 01	74.02000207
2/15/2015 23 34	73.41000205
2/16/2015 0 48	74.63000209
2/16/2015 1 09	74.9000021
2/16/2015 2 06	75.1200021
2/16/2015 3 20	75.39000211
2/16/2015 4 14	75.21000211
2/16/2015 5 33	75.0000021
2/16/2015 6 43	74.84000209
2/16/2015 7 03	74.26000208
2/16/2015 8 56	73.81000207
2/16/2015 9 41	73.19000205
2/16/2015 10 17	72.98000204
2/16/2015 11 36	72.92000204
2/16/2015 12 27	73.23000205
2/16/2015 13 13	73.19000205
2/16/2015 14 21	73.23000205
2/16/2015 15 06	73.44000205
2/16/2015 16 21	73.59000206
2/16/2015 17 59	73.38000205
2/16/2015 18 00	73.38000205
2/16/2015 19 48	73.59000206
2/16/2015 20 29	73.87000207
2/16/2015 21 41	73.26000205
2/16/2015 22 15	73.87000207
2/16/2015 23 42	74.42000208
2/17/2015 0 15	74.72000209
2/17/2015 1 28	75.0600021
2/17/2015 2 45	75.33000211
2/17/2015 3 24	74.9000021
2/17/2015 4 14	74.23000208
2/17/2015 5 58	74.32000208
2/17/2015 6 02	73.53000206
2/17/2015 7 52	72.74000203
2/17/2015 8 17	73.68000206
2/17/2015 9 05	73.53000206
2/17/2015 10 02	72.98000204
2/17/2015 11 29	72.83000204
2/17/2015 12 32	73.71000206
2/17/2015 13 06	73.74000206
2/17/2015 14 34	73.77000206
2/17/2015 15 41	73.47000206
2/17/2015 16 23	73.74000206
2/17/2015 17 44	73.71000206
2/17/2015 18 04	73.62000206
2/17/2015 19 13	73.47000206
2/17/2015 20 26	73.71000206
2/17/2015 21 14	73.87000207
2/17/2015 22 31	72.55000203
2/17/2015 23 52	74.45000208

2/14/2015 3 13	73.12999909
2/14/2015 4 37	72.82999909
2/14/2015 5 35	72.51999909
2/14/2015 6 12	71.6999991
2/14/2015 7 33	69.67999913
2/14/2015 8 59	67.87999915
2/14/2015 9 19	66.44999916
2/14/2015 10 17	66.13999917
2/14/2015 11 01	66.35999917
2/14/2015 12 07	66.96999916
2/14/2015 13 01	67.39999915
2/14/2015 14 23	68.48999914
2/14/2015 15 40	68.76999914
2/14/2015 16 21	68.48999914
2/14/2015 17 21	68.61999914
2/14/2015 18 01	68.82999914
2/14/2015 19 19	69.22999913
2/14/2015 20 48	68.97999913
2/14/2015 21 06	69.00999913
2/14/2015 22 01	70.80999911
2/14/2015 23 03	71.05999911
2/15/2015 0 04	70.47999912
2/15/2015 1 38	70.71999911
2/15/2015 2 01	72.61999909
2/15/2015 3 15	73.12999909
2/15/2015 4 24	73.28999908
2/15/2015 5 58	72.51999909
2/15/2015 6 51	71.9999991
2/15/2015 7 52	70.22999912
2/15/2015 8 54	68.06999915
2/15/2015 9 42	66.71999916
2/15/2015 10 22	66.62999916
2/15/2015 11 04	66.99999916
2/15/2015 12 22	67.02999916
2/15/2015 13 04	67.72999915
2/15/2015 14 27	68.30999914
2/15/2015 15 15	68.36999914
2/15/2015 16 30	68.30999914
2/15/2015 17 45	68.79999914
2/15/2015 18 39	69.00999913
2/15/2015 19 01	68.79999914
2/15/2015 20 07	69.98999912
2/15/2015 21 14	70.53999912
2/15/2015 22 01	70.41999912
2/15/2015 23 34	70.65999911
2/16/2015 0 00	71.9699991
2/16/2015 1 02	72.39999909
2/16/2015 2 01	73.00999909
2/16/2015 3 08	73.28999908
2/16/2015 4 40	73.31999908
2/16/2015 5 53	72.33999909
2/16/2015 6 48	71.9699991
2/16/2015 7 58	70.10999912
2/16/2015 8 52	68.33999914
2/16/2015 9 57	66.41999917
2/16/2015 10 41	65.89999917
2/16/2015 11 24	65.65999917
2/16/2015 12 07	66.44999916
2/16/2015 13 23	67.02999916
2/16/2015 14 22	67.90999915
2/16/2015 15 06	68.33999914
2/16/2015 16 40	68.18999914
2/16/2015 17 55	67.75999915
2/16/2015 18 33	67.39999915
2/16/2015 19 12	68.12999914
2/16/2015 20 29	68.82999914
2/16/2015 21 42	68.45999914
2/16/2015 22 16	68.30999914
2/16/2015 23 43	70.96999911
2/17/2015 0 02	72.61999909
2/17/2015 1 00	72.82999909
2/17/2015 2 40	73.19999908
2/17/2015 3 01	72.85999909
2/17/2015 4 13	70.80999911
2/17/2015 5 53	70.65999911
2/17/2015 6 51	67.90999915
2/17/2015 7 12	66.59999916
2/17/2015 8 02	68.48999914
2/17/2015 9 06	69.06999913
2/17/2015 10 26	69.49999913
2/17/2015 11 09	69.46999913
2/17/2015 12 56	69.86999912
2/17/2015 13 13	69.58999913
2/17/2015 14 59	70.50999912
2/17/2015 15 46	69.92999912
2/17/2015 16 47	70.04999912
2/17/2015 17 27	68.67999914
2/17/2015 18 18	68.73999914
2/17/2015 19 00	68.73999914
2/17/2015 20 01	69.19999913
2/17/2015 21 12	69.52999913
2/17/2015 22 02	69.31999913
2/17/2015 23 42	70.93999911

2/14/2015 3 19	75.90000284
2/14/2015 4 36	75.66000283
2/14/2015 5 01	75.26000282
2/14/2015 6 48	74.65000279
2/14/2015 7 46	73.37000275
2/14/2015 8 44	71.45000268
2/14/2015 9 56	70.74000265
2/14/2015 10 17	71.02000266
2/14/2015 11 01	70.77000265
2/14/2015 12 00	71.51000268
2/14/2015 13 00	72.0000027
2/14/2015 14 41	72.85000273
2/14/2015 15 40	72.45000271
2/14/2015 16 56	72.67000272
2/14/2015 17 54	72.82000273
2/14/2015 18 02	72.76000272
2/14/2015 19 52	72.91000273
2/14/2015 20 49	73.22000274
2/14/2015 21 06	73.25000274
2/14/2015 22 08	74.38000278
2/14/2015 23 00	74.65000279
2/15/2015 0 04	73.61000275
2/15/2015 1 37	75.08000281
2/15/2015 2 00	75.63000283
2/15/2015 3 01	75.90000284
2/15/2015 4 00	75.99000284
2/15/2015 5 40	75.32000282
2/15/2015 6 51	75.02000281
2/15/2015 7 53	73.92000277
2/15/2015 8 54	72.48000271
2/15/2015 9 42	71.23000267
2/15/2015 10 18	71.02000266
2/15/2015 11 56	71.29000267
2/15/2015 12 07	71.38000267
2/15/2015 13 04	72.0600027
2/15/2015 14 03	72.36000271
2/15/2015 15 14	72.82000273
2/15/2015 16 01	73.16000274
2/15/2015 17 41	73.03000273
2/15/2015 18 03	72.94000273
2/15/2015 19 01	73.22000274
2/15/2015 20 18	73.58000275
2/15/2015 21 14	73.55000275
2/15/2015 22 01	74.10000277
2/15/2015 23 34	74.44000279
2/16/2015 0 06	75.08000281
2/16/2015 1 01	75.32000282
2/16/2015 2 14	75.90000284
2/16/2015 3 30	76.24000285
2/16/2015 4 10	76.02000284
2/16/2015 5 53	75.32000282
2/16/2015 6 02	75.14000281
2/16/2015 7 33	74.22000278
2/16/2015 8 56	72.54000272
2/16/2015 9 23	70.87000265
2/16/2015 10 24	70.74000265
2/16/2015 11 00	70.56000264
2/16/2015 12 05	70.87000265
2/16/2015 13 00	72.0600027
2/16/2015 14 09	72.51000271
2/16/2015 15 18	72.45000271
2/16/2015 16 39	72.51000271
2/16/2015 17 46	72.1500027
2/16/2015 18 42	71.75000269
2/16/2015 19 11	72.0000027
2/16/2015 20 00	72.73000272
2/16/2015 21 02	72.67000272
2/16/2015 22 15	72.64000272
2/16/2015 23 06	74.62000279
2/17/2015 0 08	75.35000282
2/17/2015 1 12	75.54000283
2/17/2015 2 21	75.99000284
2/17/2015 3 47	75.72000283
2/17/2015 4 14	74.56000279
2/17/2015 5 57	73.92000277
2/17/2015 6 54	72.1200027
2/17/2015 7 03	71.14000266
2/17/2015 8 05	73.12000274
2/17/2015 9 13	73.25000274
2/17/2015 10 55	73.22000274
2/17/2015 11 02	73.49000275
2/17/2015 12 00	73.80000276
2/17/2015 13 00	73.95000277
2/17/2015 14 59	73.77000276
2/17/2015 15 00	73.77000276
2/17/2015 16 55	73.77000276
2/17/2015 17 37	73.34000274
2/17/2015 18 59	72.58000272
2/17/2015 19 00	72.58000272
2/17/2015 20 00	73.16000274
2/17/2015 21 14	73.43000275
2/17/2015 22 03	73.34000274
2/17/2015 23 42	74.16000278

2/14/2015 2 07	75.61
2/14/2015 3 13	76.22
2/14/2015 4 51	75.54
2/14/2015 5 24	75.18
2/14/2015 6 34	74.87
2/14/2015 7 52	73.9
2/14/2015 8 31	73.07
2/14/2015 9 53	72.49
2/14/2015 10 47	72.1
2/14/2015 11 37	72.55
2/14/2015 12 07	72.16
2/14/2015 13 36	72.71
2/14/2015 14 07	73.19
2/14/2015 15 16	73.35
2/14/2015 16 39	73.16
2/14/2015 17 38	73.01
2/14/2015 18 35	73.47
2/14/2015 19 52	73.87
2/14/2015 20 36	74.32
2/14/2015 21 05	73.62
2/14/2015 22 44	74.2
2/14/2015 23 08	74.84
2/15/2015 0 03	74.96
2/15/2015 1 38	74.66
2/15/2015 2 31	75.7
2/15/2015 3 53	76.4
2/15/2015 4 48	76.58
2/15/2015 5 57	75.51
2/15/2015 6 16	75.48
2/15/2015 7 52	73.53
2/15/2015 8 01	73.62
2/15/2015 9 59	72.49
2/15/2015 10 44	72.16
2/15/2015 11 02	72.64
2/15/2015 12 22	72.61
2/15/2015 13 40	72.16
2/15/2015 14 11	73.59
2/15/2015 15 51	73.13
2/15/2015 16 29	72.64
2/15/2015 17 29	73.5
2/15/2015 18 07	73.87
2/15/2015 19 00	74.32
2/15/2015 20 17	73.96
2/15/2015 21 31	74.45
2/15/2015 22 24	74.38
2/15/2015 23 38	74.63
2/16/2015 0 01	75.15
2/16/2015 1 20	75.48
2/16/2015 2 01	76.34
2/16/2015 3 00	76.49
2/16/2015 4 29	76.37
2/16/2015 5 48	75.48
2/16/2015 6 45	75.3
2/16/2015 7 58	74.26
2/16/2015 8 57	73.8
2/16/2015 9 47	72.68
2/16/2015 10 20	72
2/16/2015 11 57	72.03
2/16/2015 12 19	71.82
2/16/2015 13 12	72.19
2/16/2015 14 38	73.04
2/16/2015 15 12	73.32
2/16/2015 16 40	72.95
2/16/2015 17 36	72.86
2/16/2015 18 26	71.76
2/16/2015 19 50	73.1
2/16/2015 20 13	73.59
2/16/2015 21 57	73.22
2/16/2015 22 01	73.84
2/16/2015 23 42	75.06
2/17/2015 0 02	75.18
2/17/2015 1 20	75.85
2/17/2015 2 13	76.28
2/17/2015 3 33	75.82
2/17/2015 4 14	74.45
2/17/2015 5 58	74.69
2/17/2015 6 07	73.13
2/17/2015 7 12	72.46
2/17/2015 8 21	73.56
2/17/2015 9 45	73.35
2/17/2015 10 30	73.44
2/17/2015 11 22	73.59
2/17/2015 12 47	73.19
2/17/2015 13 03	73.68
2/17/2015 14 06	73.99
2/17/2015 15 22	73.77
2/17/2015 16 36	73.29
2/17/2015 17 12	73.13
2/17/2015 18 58	72.61
2/17/2015 19 00	72.61
2/17/2015 20 00	73.26
2/17/2015 21 06	73.29
2/17/2015 22 04	73.93
2/17/2015 23 00	74.42
2/18/2015 0 00	75.06

E3 Pumping Station Pressures

E3a Pumping Station Pressures Jan 2015

Global Trendset

Global Trendset

Trend Name: Stn_Pressures ▶ Search

Owner: dnaAdmin

Global trend: (•) Yes ( ) No

☐ Individual Y Axes ☐ Markers On

☐ Show Data Quality

Default Timescales

4hrs 8hrs 12hrs 24hrs

Add Pen | Delete Pen | Edit

New | Abandon | Modify

Dismiss | Add | Delete

Pumping Station Pressures

[psi] [psi] [psi]

90.0
88.0
84.0
80.0
76.0
72.0
68.0

△ McPhillips Station Pressure

□ Hurst Station Pressure

◇ MacLean Station Pressure

P

1/15/2015 1/22/2015

◄ 1/11/2015 12:00 AM << Primary >> 1/28/2015 12:00 AM ►

AECOM

E3b Pumping Station Hourly Min Pressures May 12-May 26 2014

Global Trendset

Global Trendset

Trend Name: PStn_Pressures ▶ Search

Owner: DougSulymka

Global trend: (•) Yes ( ) No

☐ Individual Y Axes ☑ Markers On

☐ Show Data Quality

Default Timescales

4hrs 8hrs 12hrs 24hrs

Add Pen | Delete Pen | Edit

New | Abandon | Modify

Dismiss | Add | Delete

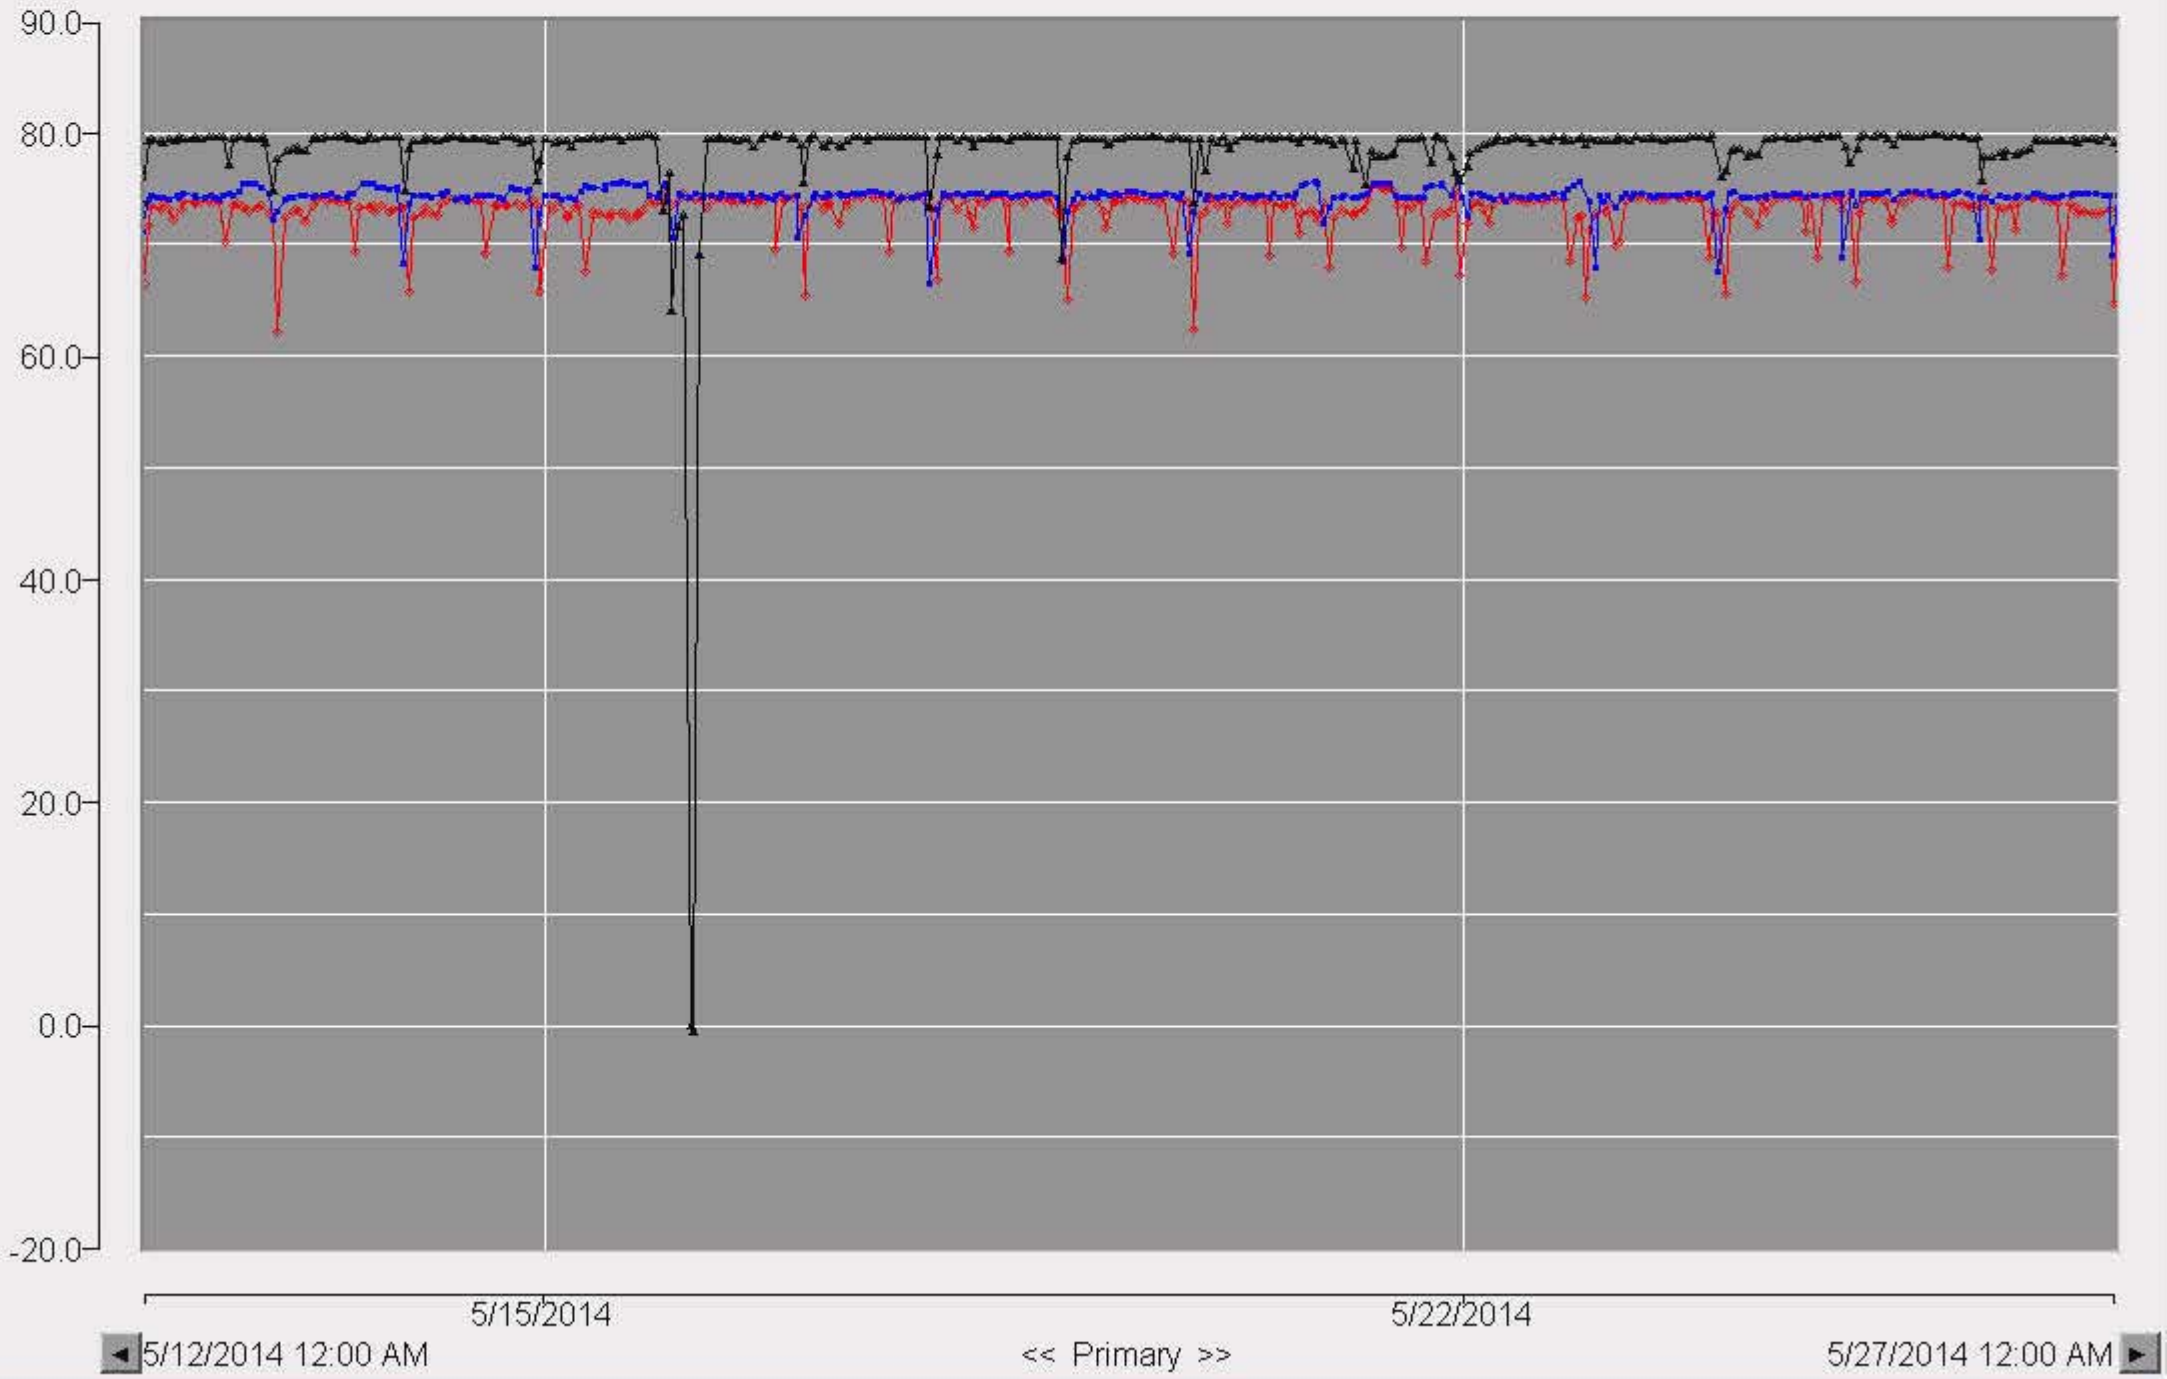

AECOM

E3c Pumping Station Hourly Min Pressures Sep 23-Oct 7 2013

Global Trendset

Global Trendset

Trend Name: PStn_Pressures ▶ Search

Owner: DougSulymka

Global trend: (•) Yes ( ) No

☐ Individual Y Axes ☑ Markers On

☐ Show Data Quality

Default Timescales

4hrs 8hrs 12hrs 24hrs

Add Pen | Delete Pen | Edit

New | Abandon | Modify

Dismiss | Add | Delete

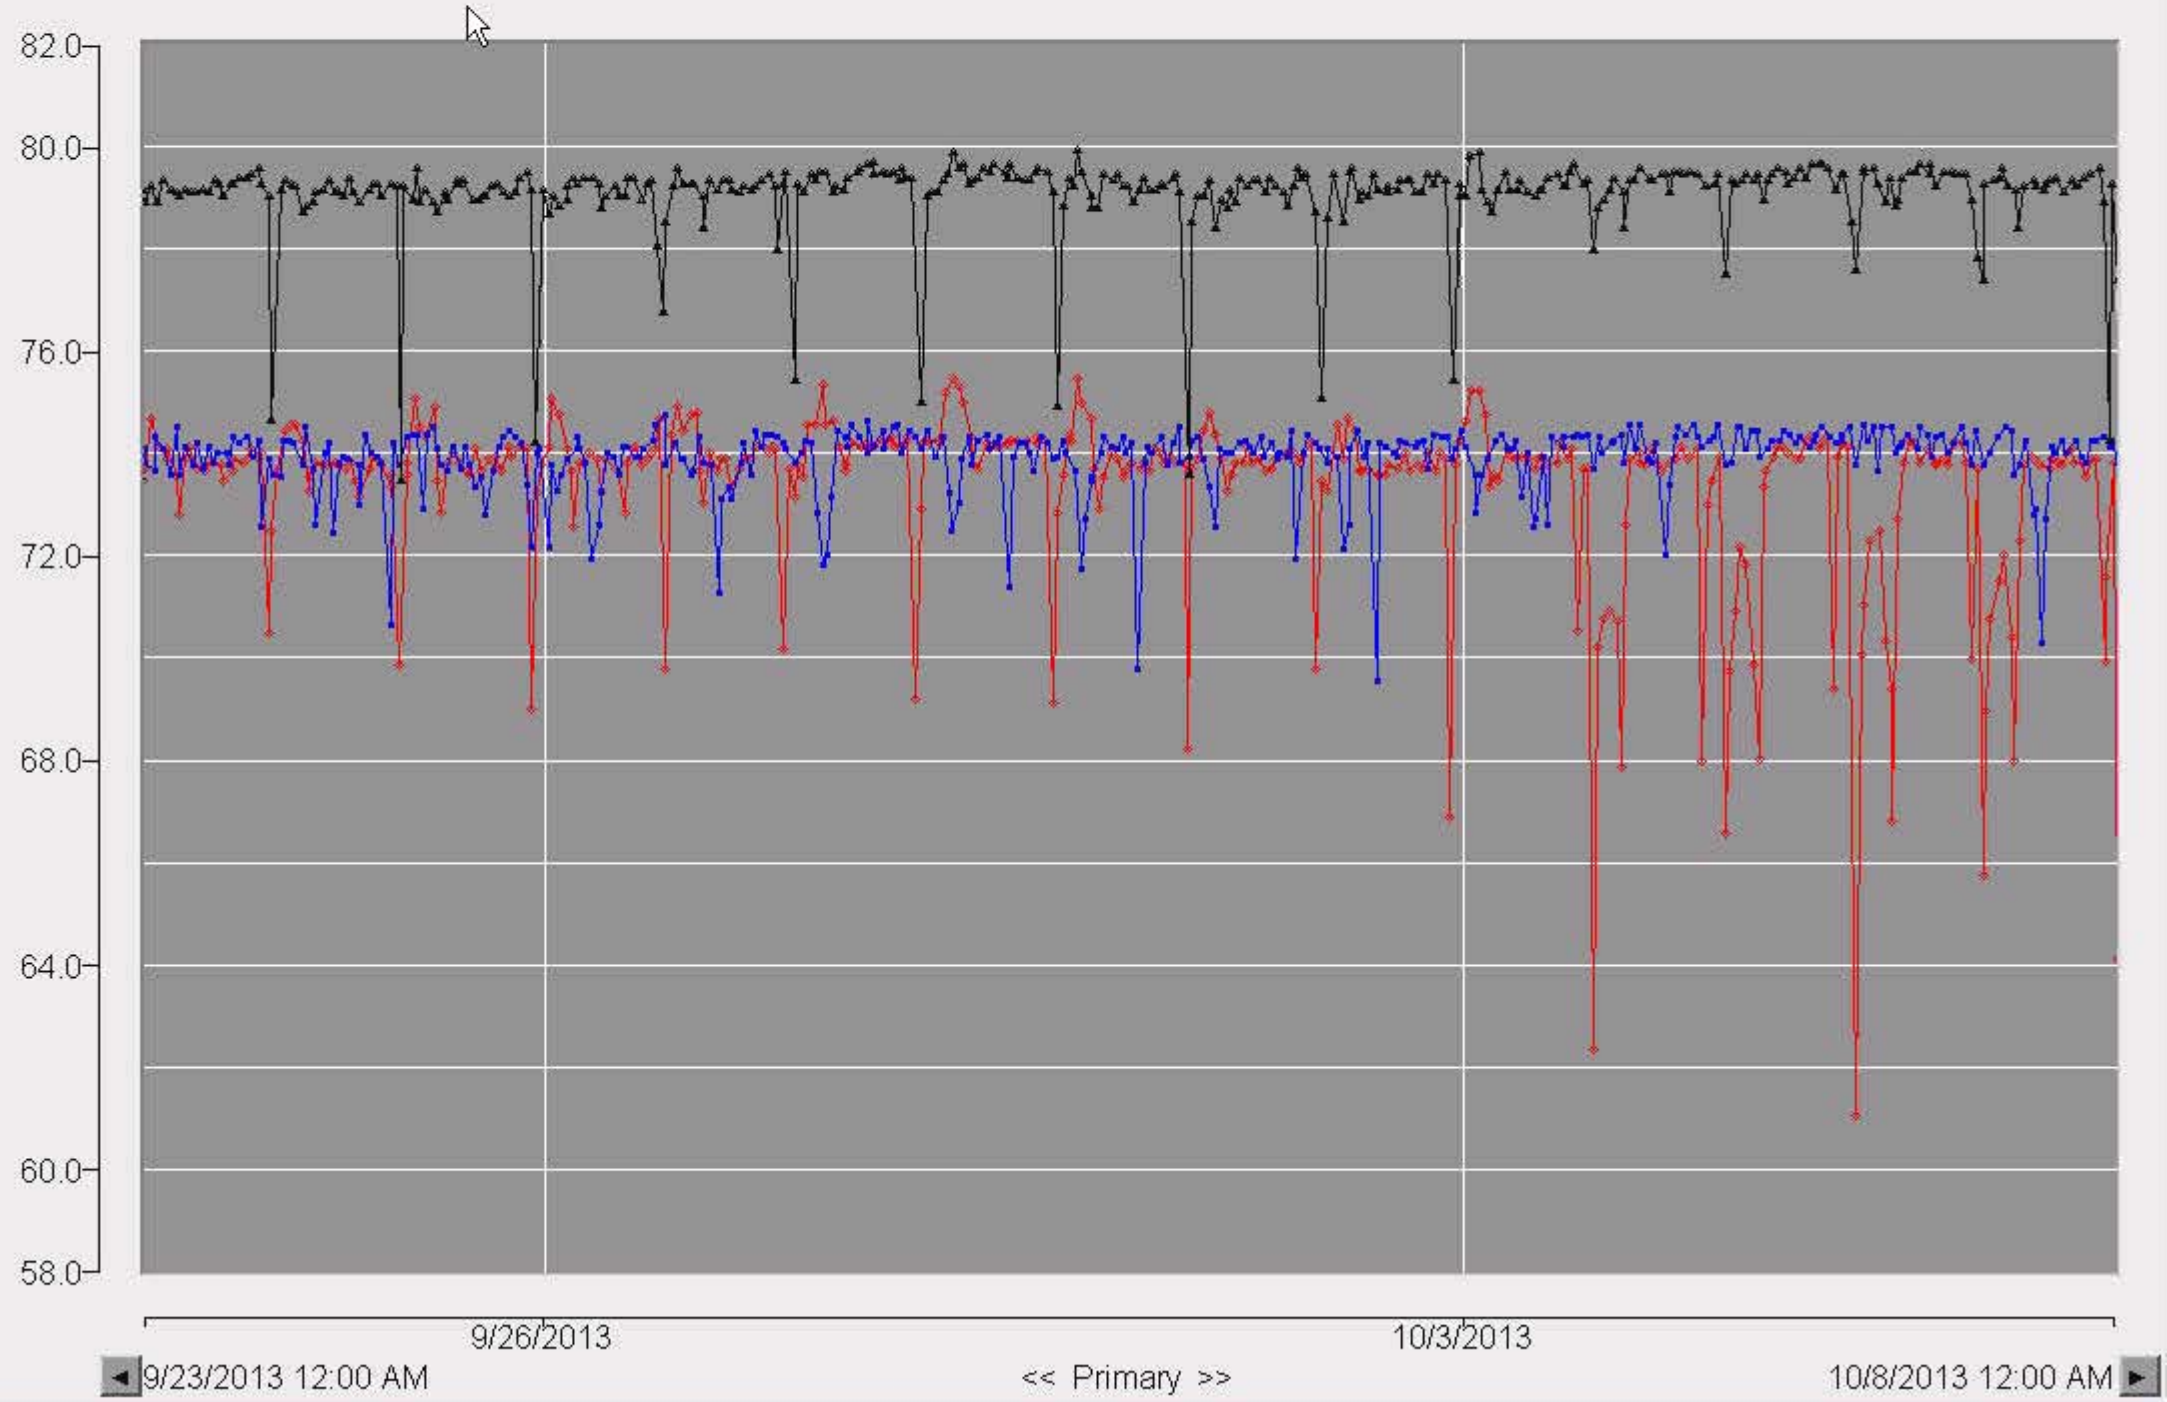

E3d Pumping Station Pressure Alarms Jan 12-26 2015

	dbName	ptName	description	message	sevInt
1/12/2015 0:25	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.1603 psig (LOW state)	0
1/12/2015 0:25	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.1603 psig (LOW state)	0
1/12/2015 0:25	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos02	0
1/12/2015 0:25	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 72.9344 psig (NORMAL state)	0
1/12/2015 0:25	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 72.9344 psig (NORMAL state)	0
1/12/2015 0:25	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos02	0
1/12/2015 0:25	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.2153 psig (LOW state)	0
1/12/2015 0:25	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.2153 psig (LOW state)	0
1/12/2015 0:26	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos03	0
1/12/2015 0:26	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 71.4137 psig (NORMAL state)	0
1/12/2015 0:26	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 71.4137 psig (NORMAL state)	0
1/12/2015 0:26	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos03	0
1/12/2015 0:26	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.8198 psig (LOW state)	0
1/12/2015 0:26	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.8198 psig (LOW state)	0
1/12/2015 0:26	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 70.9374 psig (NORMAL state)	0
1/12/2015 0:26	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 70.9374 psig (NORMAL state)	0
1/12/2015 0:26	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos03	0
1/12/2015 0:26	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.3985 psig (LOW state)	0
1/12/2015 0:26	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.3985 psig (LOW state)	0
1/12/2015 0:26	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos03	0
1/12/2015 0:26	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 71.1573 psig (NORMAL state)	0
1/12/2015 0:26	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 71.1573 psig (NORMAL state)	0
1/12/2015 0:26	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos03	0
1/12/2015 11:20	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 68.4092 psig (LOW state)	0
1/12/2015 11:20	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 68.4092 psig (LOW state)	0
1/12/2015 11:20	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos03	0
1/12/2015 11:20	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 71.4321 psig (NORMAL state)	0
1/12/2015 11:20	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 71.4321 psig (NORMAL state)	0
1/12/2015 11:20	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos03	0
1/13/2015 0:31	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 68.0611 psig (LOW state)	0
1/13/2015 0:31	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 68.0611 psig (LOW state)	0
1/13/2015 0:31	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos02	0
1/13/2015 0:31	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 73.3008 psig (NORMAL state)	0
1/13/2015 0:31	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 73.3008 psig (NORMAL state)	0
1/13/2015 0:31	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos02	0
1/14/2015 0:37	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 66.4122 psig (LOW-LOW state)	0
1/14/2015 0:37	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 66.4122 psig (LOW-LOW state)	0
1/14/2015 0:37	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 73.0443 psig (NORMAL state)	0
1/14/2015 0:37	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 73.0443 psig (NORMAL state)	0
1/14/2015 0:37	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos03	0
1/14/2015 5:57	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.1191 psig (HIGH state)	0
1/14/2015 5:57	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.1191 psig (HIGH state)	0
1/14/2015 5:57	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos01	0
1/14/2015 5:57	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.4595 psig (NORMAL state)	0
1/14/2015 5:57	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.4595 psig (NORMAL state)	0
1/14/2015 5:57	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos03	0
1/14/2015 5:57	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.0275 psig (HIGH state)	0
1/14/2015 5:57	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.0275 psig (HIGH state)	0
1/14/2015 5:57	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos03	0

1/14/2015 5:57	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.7527 psig (NORMAL state)	0
1/14/2015 5:57	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.7527 psig (NORMAL state)	0
1/14/2015 5:58	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos01	0
1/14/2015 5:58	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.229 psig (HIGH state)	0
1/14/2015 5:58	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.229 psig (HIGH state)	0
1/14/2015 5:58	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos03	0
1/14/2015 5:58	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 76.9649 psig (NORMAL state)	0
1/14/2015 5:58	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 76.9649 psig (NORMAL state)	0
1/14/2015 5:58	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos01	0
1/14/2015 5:58	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.0275 psig (HIGH state)	0
1/14/2015 5:58	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.0275 psig (HIGH state)	0
1/14/2015 5:58	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos01	0
1/14/2015 5:58	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 76.0489 psig (NORMAL state)	0
1/14/2015 5:58	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 76.0489 psig (NORMAL state)	0
1/14/2015 5:58	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos01	0
1/14/2015 23:46	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command INHIBIT ALARMS by CarsonIkonen at wwdwsxos03	0
1/14/2015 23:46	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command INHIBIT RTN by CarsonIkonen at wwdwsxos03	0
1/14/2015 23:46	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 65.8992 psig (LOW-LOW state)	0
1/14/2015 23:46	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 65.8992 psig (LOW-LOW state)	0
1/14/2015 23:46	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.8748 psig (LOW state)	0
1/14/2015 23:46	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.8748 psig (LOW state)	0
1/14/2015 23:46	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 70.4427 psig (NORMAL state)	0
1/14/2015 23:46	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 70.4427 psig (NORMAL state)	0
1/14/2015 23:46	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.2153 psig (LOW state)	0
1/14/2015 23:46	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.2153 psig (LOW state)	0
1/14/2015 23:47	analog	HMD_050_PT	(H) Discharge Header Pressure (60-90 psig)	Value = 71.4321 psig (LOW state)	0
1/14/2015 23:47	analog	HMD_050_PT	(H) Discharge Header Pressure (60-90 psig)	Value = 71.4321 psig (LOW state)	0
1/14/2015 23:47	analog	HMD_050_PT		Issued command ACKNOWLEDGE ANALOG.HMD_050_PT.:HILO by CarsonIkonen at wwdwsxos03	0
1/14/2015 23:47	analog	HMD_050_PT	(H) Discharge Header Pressure (60-90 psig)	Value = 70.9008 psig (LOW-LOW state)	0
1/14/2015 23:47	analog	HMD_050_PT	(H) Discharge Header Pressure (60-90 psig)	Value = 70.9008 psig (LOW-LOW state)	0
1/14/2015 23:47	analog	HMD_050_PT	(H) Discharge Header Pressure (60-90 psig)	Issued command ACKNOWLEDGE ANALOG.HMD_050_PT.:HILO by CarsonIkonen at wwdwsxos03	0
1/14/2015 23:47	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 67.4748 psig (LOW-LOW state)	0
1/14/2015 23:47	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 67.4748 psig (LOW-LOW state)	0
1/14/2015 23:47	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 68.1527 psig (LOW state)	0
1/14/2015 23:47	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 68.1527 psig (LOW state)	0
1/14/2015 23:47	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 67.9511 psig (LOW-LOW state)	0
1/14/2015 23:47	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 67.9511 psig (LOW-LOW state)	0
1/14/2015 23:47	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 68.1893 psig (LOW state)	0
1/14/2015 23:47	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 68.1893 psig (LOW state)	0
1/14/2015 23:48	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 67.1817 psig (LOW-LOW state)	0
1/14/2015 23:48	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 67.1817 psig (LOW-LOW state)	0
1/14/2015 23:48	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 68.9405 psig (LOW state)	0
1/14/2015 23:48	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 68.9405 psig (LOW state)	0
1/14/2015 23:48	analog	HMD_050_PT	(H) Discharge Header Pressure (60-90 psig)	Value = 71.2855 psig (LOW state)	0
1/14/2015 23:48	analog	HMD_050_PT	(H) Discharge Header Pressure (60-90 psig)	Value = 71.2855 psig (LOW state)	0
1/14/2015 23:48	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 70.5893 psig (NORMAL state)	0
1/14/2015 23:48	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 70.5893 psig (NORMAL state)	0
1/14/2015 23:48	analog	HMD_050_PT	(H) Discharge Header Pressure (60-90 psig)	Issued command ACKNOWLEDGE ANALOG.HMD_050_PT.:HILO by CarsonIkonen at wwdwsxos03	0
1/14/2015 23:48	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.6183 psig (LOW state)	0
1/14/2015 23:48	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.6183 psig (LOW state)	0

1/14/2015 23:49	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 70.6992 psig (NORMAL state)	0
1/14/2015 23:49	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 70.6992 psig (NORMAL state)	0
1/14/2015 23:49	analog	HMD_050_PT	(H) Discharge Header Pressure (60-90 psig)	Value = 72.1466 psig (NORMAL state)	0
1/14/2015 23:49	analog	HMD_050_PT	(H) Discharge Header Pressure (60-90 psig)	Value = 72.1466 psig (NORMAL state)	0
1/14/2015 23:49	analog	HMD_050_PT	(H) Discharge Header Pressure (60-90 psig)	Issued command ACKNOWLEDGE ANALOG.HMD_050_PT.:HILO by CarsonIkonen at wwdwsxos03	0
1/15/2015 5:15	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.1191 psig (HIGH state)	0
1/15/2015 5:15	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.1191 psig (HIGH state)	0
1/15/2015 5:16	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 79.3099 psig (HIGH-HIGH state)	0
1/15/2015 5:16	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 79.3099 psig (HIGH-HIGH state)	0
1/15/2015 5:16	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.7969 psig (HIGH state)	0
1/15/2015 5:16	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.7969 psig (HIGH state)	0
1/15/2015 5:16	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 79.5298 psig (HIGH-HIGH state)	0
1/15/2015 5:16	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 79.5298 psig (HIGH-HIGH state)	0
1/15/2015 5:16	analog	HMD_050_PT	(H) Discharge Header Pressure (60-90 psig)	Value = 78.1557 psig (HIGH state)	0
1/15/2015 5:16	analog	HMD_050_PT	(H) Discharge Header Pressure (60-90 psig)	Value = 78.1557 psig (HIGH state)	0
1/15/2015 5:16	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.9802 psig (HIGH state)	0
1/15/2015 5:16	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.9802 psig (HIGH state)	0
1/15/2015 5:16	analog	HMD_050_PT	(H) Discharge Header Pressure (60-90 psig)	Issued command ACKNOWLEDGE ANALOG.HMD_050_PT.:HILO by CarsonIkonen at wwdwsxos03	0
1/15/2015 5:17	analog	HMD_050_PT	(H) Discharge Header Pressure (60-90 psig)	Value = 77.8443 psig (NORMAL state)	0
1/15/2015 5:17	analog	HMD_050_PT	(H) Discharge Header Pressure (60-90 psig)	Value = 77.8443 psig (NORMAL state)	0
1/15/2015 5:17	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 79.9328 psig (HIGH-HIGH state)	0
1/15/2015 5:17	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 79.9328 psig (HIGH-HIGH state)	0
1/15/2015 5:17	analog	HMD_050_PT	(H) Discharge Header Pressure (60-90 psig)	Issued command ACKNOWLEDGE ANALOG.HMD_050_PT.:HILO by CarsonIkonen at wwdwsxos03	0
1/15/2015 5:17	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.1374 psig (HIGH state)	0
1/15/2015 5:17	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.1374 psig (HIGH state)	0
1/15/2015 5:18	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.9725 psig (NORMAL state)	0
1/15/2015 5:18	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.9725 psig (NORMAL state)	0
1/15/2015 5:18	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.229 psig (HIGH state)	0
1/15/2015 5:18	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.229 psig (HIGH state)	0
1/15/2015 5:18	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.0198 psig (NORMAL state)	0
1/15/2015 5:18	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.0198 psig (NORMAL state)	0
1/15/2015 23:45	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 68.5374 psig (LOW state)	0
1/15/2015 23:45	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 68.5374 psig (LOW state)	0
1/15/2015 23:46	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 71.7985 psig (NORMAL state)	0
1/15/2015 23:46	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 71.7985 psig (NORMAL state)	0
1/16/2015 5:37	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.1191 psig (HIGH state)	0
1/16/2015 5:37	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.1191 psig (HIGH state)	0
1/16/2015 5:38	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 79.1267 psig (HIGH-HIGH state)	0
1/16/2015 5:38	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 79.1267 psig (HIGH-HIGH state)	0
1/16/2015 5:38	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.7969 psig (HIGH state)	0
1/16/2015 5:38	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.7969 psig (HIGH state)	0
1/16/2015 5:38	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 79.0168 psig (HIGH-HIGH state)	0
1/16/2015 5:38	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 79.0168 psig (HIGH-HIGH state)	0
1/16/2015 5:38	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.8885 psig (HIGH state)	0
1/16/2015 5:38	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.8885 psig (HIGH state)	0
1/16/2015 5:38	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 79.0351 psig (HIGH-HIGH state)	0
1/16/2015 5:38	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 79.0351 psig (HIGH-HIGH state)	0
1/16/2015 5:39	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.9802 psig (HIGH state)	0
1/16/2015 5:39	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.9802 psig (HIGH state)	0
1/16/2015 5:39	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 79.2366 psig (HIGH-HIGH state)	0

1/16/2015 5:39	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 79.2366 psig (HIGH-HIGH state)	0
1/16/2015 5:39	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.742 psig (HIGH state)	0
1/16/2015 5:39	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.742 psig (HIGH state)	0
1/16/2015 5:40	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.9542 psig (NORMAL state)	0
1/16/2015 5:40	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.9542 psig (NORMAL state)	0
1/16/2015 5:41	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ENABLE ALARMS by CarsonIkonen at wwdwsxos03	0
1/16/2015 5:41	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ENABLE RTN by CarsonIkonen at wwdwsxos03	0
1/16/2015 23:42	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 65.7527 psig (LOW-LOW state)	0
1/16/2015 23:42	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 65.7527 psig (LOW-LOW state)	0
1/16/2015 23:42	analog	PMD_050_PT		Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by MikeMastroianni at wwdwsxos0	0
1/16/2015 23:42	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 70.7908 psig (NORMAL state)	0
1/16/2015 23:42	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 70.7908 psig (NORMAL state)	0
1/16/2015 23:42	analog	PMD_050_PT		Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by MikeMastroianni at wwdwsxos0	0
1/16/2015 23:42	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.8748 psig (LOW state)	0
1/16/2015 23:42	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.8748 psig (LOW state)	0
1/16/2015 23:42	analog	PMD_050_PT		Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by MikeMastroianni at wwdwsxos0	0
1/16/2015 23:42	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 70.9374 psig (NORMAL state)	0
1/16/2015 23:42	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 70.9374 psig (NORMAL state)	0
1/16/2015 23:42	analog	PMD_050_PT		Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by MikeMastroianni at wwdwsxos0	0
1/16/2015 23:43	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.3985 psig (LOW state)	0
1/16/2015 23:43	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.3985 psig (LOW state)	0
1/16/2015 23:43	analog	PMD_050_PT		Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by MikeMastroianni at wwdwsxos0	0
1/16/2015 23:43	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 70.2229 psig (NORMAL state)	0
1/16/2015 23:43	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 70.2229 psig (NORMAL state)	0
1/16/2015 23:43	analog	PMD_050_PT		Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by MikeMastroianni at wwdwsxos0	0
1/16/2015 23:43	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.8931 psig (LOW state)	0
1/16/2015 23:43	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.8931 psig (LOW state)	0
1/16/2015 23:43	analog	PMD_050_PT		Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by MikeMastroianni at wwdwsxos0	0
1/16/2015 23:43	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 70.7176 psig (NORMAL state)	0
1/16/2015 23:43	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 70.7176 psig (NORMAL state)	0
1/16/2015 23:43	analog	PMD_050_PT		Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by MikeMastroianni at wwdwsxos0	0
1/16/2015 23:43	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.9115 psig (LOW state)	0
1/16/2015 23:43	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.9115 psig (LOW state)	0
1/16/2015 23:43	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command INHIBIT ALARMS by MikeMastroianni at wwdwsxos01	0
1/16/2015 23:43	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command INHIBIT RTN by MikeMastroianni at wwdwsxos01	0
1/16/2015 23:43	analog	PMD_050_PT		Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by MikeMastroianni at wwdwsxos0	0
1/16/2015 23:43	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 71.1206 psig (NORMAL state)	0
1/16/2015 23:43	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 71.1206 psig (NORMAL state)	0
1/17/2015 5:13	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ENABLE ALARMS by CarsonIkonen at wwdwsxos03	0
1/17/2015 5:13	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ENABLE RTN by CarsonIkonen at wwdwsxos03	0
1/17/2015 7:31	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.229 psig (HIGH state)	0
1/17/2015 7:31	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.229 psig (HIGH state)	0
1/17/2015 7:31	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos03	0
1/17/2015 7:31	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.6977 psig (NORMAL state)	0
1/17/2015 7:31	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.6977 psig (NORMAL state)	0
1/17/2015 7:31	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos03	0
1/17/2015 11:20	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.3206 psig (HIGH state)	0
1/17/2015 11:20	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.3206 psig (HIGH state)	0
1/17/2015 11:20	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by MikeMastroianni at wwdwsxos0	0
1/17/2015 11:21	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.5145 psig (NORMAL state)	0

1/17/2015 11:21	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.5145 psig (NORMAL state)	0
1/17/2015 11:21	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos02	0
1/17/2015 11:41	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 68.2809 psig (LOW state)	0
1/17/2015 11:41	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 68.2809 psig (LOW state)	0
1/17/2015 11:41	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 70.9008 psig (NORMAL state)	0
1/17/2015 11:41	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 70.9008 psig (NORMAL state)	0
1/17/2015 11:41	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by MikeMastroianni at wwdwsxos0	0
1/17/2015 23:40	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.1603 psig (LOW state)	0
1/17/2015 23:40	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.1603 psig (LOW state)	0
1/17/2015 23:40	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 70.8641 psig (NORMAL state)	0
1/17/2015 23:40	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 70.8641 psig (NORMAL state)	0
1/17/2015 23:40	analog	PMD_050_PT		Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by MikeMastroianni at wwdwsxos0	0
1/17/2015 23:40	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.7466 psig (LOW state)	0
1/17/2015 23:40	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.7466 psig (LOW state)	0
1/17/2015 23:41	analog	PMD_050_PT		Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by MikeMastroianni at wwdwsxos0	0
1/17/2015 23:41	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 70.058 psig (NORMAL state)	0
1/17/2015 23:41	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 70.058 psig (NORMAL state)	0
1/17/2015 23:41	analog	PMD_050_PT		Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by MikeMastroianni at wwdwsxos0	0
1/17/2015 23:41	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.3618 psig (LOW state)	0
1/17/2015 23:41	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.3618 psig (LOW state)	0
1/17/2015 23:41	analog	PMD_050_PT		Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by MikeMastroianni at wwdwsxos0	0
1/17/2015 23:41	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 70.626 psig (NORMAL state)	0
1/17/2015 23:41	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 70.626 psig (NORMAL state)	0
1/17/2015 23:41	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command INHIBIT ALARMS by MikeMastroianni at wwdwsxos01	0
1/17/2015 23:41	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command INHIBIT RTN by MikeMastroianni at wwdwsxos01	0
1/17/2015 23:41	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command INHIBIT ALARMS by MikeMastroianni at wwdwsxos01	0
1/17/2015 23:41	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command INHIBIT RTN by MikeMastroianni at wwdwsxos01	0
1/17/2015 23:41	analog	PMD_050_PT		Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by MikeMastroianni at wwdwsxos0	0
1/17/2015 23:41	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.9298 psig (LOW state)	0
1/17/2015 23:41	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.9298 psig (LOW state)	0
1/17/2015 23:41	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 70.0947 psig (NORMAL state)	0
1/17/2015 23:41	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 70.0947 psig (NORMAL state)	0
1/18/2015 5:05	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ENABLE ALARMS by CarsonIkonen at wwdwsxos03	0
1/18/2015 5:05	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ENABLE RTN by CarsonIkonen at wwdwsxos03	0
1/18/2015 7:42	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.1008 psig (HIGH state)	0
1/18/2015 7:42	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.1008 psig (HIGH state)	0
1/18/2015 7:42	analog	PMD_050_PT		Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos03	0
1/18/2015 7:42	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.8626 psig (NORMAL state)	0
1/18/2015 7:42	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.8626 psig (NORMAL state)	0
1/18/2015 7:42	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos03	0
1/18/2015 7:42	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.0824 psig (HIGH state)	0
1/18/2015 7:42	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.0824 psig (HIGH state)	0
1/18/2015 7:42	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos03	0
1/18/2015 7:43	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.9542 psig (NORMAL state)	0
1/18/2015 7:43	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.9542 psig (NORMAL state)	0
1/18/2015 7:43	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.2107 psig (HIGH state)	0
1/18/2015 7:43	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.2107 psig (HIGH state)	0
1/18/2015 7:43	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos03	0
1/18/2015 7:43	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.9725 psig (NORMAL state)	0
1/18/2015 7:43	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.9725 psig (NORMAL state)	0

1/18/2015 7:43	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos03	0
1/18/2015 7:43	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.3206 psig (HIGH state)	0
1/18/2015 7:43	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.3206 psig (HIGH state)	0
1/18/2015 7:43	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos03	0
1/18/2015 7:43	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.7527 psig (NORMAL state)	0
1/18/2015 7:43	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.7527 psig (NORMAL state)	0
1/18/2015 7:43	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos03	0
1/18/2015 10:11	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.3023 psig (HIGH state)	0
1/18/2015 10:11	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.3023 psig (HIGH state)	0
1/18/2015 10:11	analog	PMD_050_PT		Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos03	0
1/18/2015 10:12	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.8443 psig (NORMAL state)	0
1/18/2015 10:12	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.8443 psig (NORMAL state)	0
1/18/2015 10:12	analog	PMD_050_PT		Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos03	0
1/18/2015 11:22	analog	LMD_050_PT	(L) Discharge Header Pressure (60-90 psig)	Value = 83.0107 psig (HIGH state)	0
1/18/2015 11:22	analog	LMD_050_PT	(L) Discharge Header Pressure (60-90 psig)	Value = 83.0107 psig (HIGH state)	0
1/18/2015 11:23	analog	LMD_050_PT	(L) Discharge Header Pressure (60-90 psig)	Value = 84.5863 psig (HIGH-HIGH state)	0
1/18/2015 11:23	analog	LMD_050_PT	(L) Discharge Header Pressure (60-90 psig)	Value = 84.5863 psig (HIGH-HIGH state)	0
1/18/2015 11:23	analog	LMD_050_PT	(L) Discharge Header Pressure (60-90 psig)	Issued command ACKNOWLEDGE ANALOG.LMD_050_PT.:HILO by MikeMastroianni at wwdwsxos0	0
1/18/2015 11:23	analog	LMD_050_PT	(L) Discharge Header Pressure (60-90 psig)	Value = 83.7985 psig (HIGH state)	0
1/18/2015 11:23	analog	LMD_050_PT	(L) Discharge Header Pressure (60-90 psig)	Value = 83.7985 psig (HIGH state)	0
1/18/2015 11:23	analog	LMD_050_PT	(L) Discharge Header Pressure (60-90 psig)	Issued command ACKNOWLEDGE ANALOG.LMD_050_PT.:HILO by MikeMastroianni at wwdwsxos0	0
1/18/2015 11:23	analog	LMD_050_PT	(L) Discharge Header Pressure (60-90 psig)	Value = 82.626 psig (NORMAL state)	0
1/18/2015 11:23	analog	LMD_050_PT	(L) Discharge Header Pressure (60-90 psig)	Value = 82.626 psig (NORMAL state)	0
1/18/2015 11:23	analog	LMD_050_PT	(L) Discharge Header Pressure (60-90 psig)	Issued command ACKNOWLEDGE ANALOG.LMD_050_PT.:HILO by MikeMastroianni at wwdwsxos0	0
1/18/2015 14:28	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 68.3176 psig (LOW state)	0
1/18/2015 14:28	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 68.3176 psig (LOW state)	0
1/18/2015 14:28	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos03	0
1/18/2015 14:28	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 72.1099 psig (NORMAL state)	0
1/18/2015 14:28	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 72.1099 psig (NORMAL state)	0
1/18/2015 14:28	analog	PMD_050_PT		Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos03	0
1/18/2015 23:29	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command INHIBIT ALARMS by MikeMastroianni at wwdwsxos01	0
1/18/2015 23:29	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command INHIBIT RTN by MikeMastroianni at wwdwsxos01	0
1/18/2015 23:33	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 65.6977 psig (LOW-LOW state)	0
1/18/2015 23:33	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 65.6977 psig (LOW-LOW state)	0
1/18/2015 23:33	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 71.945 psig (NORMAL state)	0
1/18/2015 23:33	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 71.945 psig (NORMAL state)	0
1/18/2015 23:33	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 68.4458 psig (LOW state)	0
1/18/2015 23:33	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 68.4458 psig (LOW state)	0
1/18/2015 23:33	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 70.0397 psig (NORMAL state)	0
1/18/2015 23:33	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 70.0397 psig (NORMAL state)	0
1/18/2015 23:34	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.8015 psig (LOW state)	0
1/18/2015 23:34	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.8015 psig (LOW state)	0
1/18/2015 23:34	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 70.4611 psig (NORMAL state)	0
1/18/2015 23:34	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 70.4611 psig (NORMAL state)	0
1/18/2015 23:34	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.2336 psig (LOW state)	0
1/18/2015 23:34	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.2336 psig (LOW state)	0
1/18/2015 23:34	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 70.0031 psig (NORMAL state)	0
1/18/2015 23:34	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 70.0031 psig (NORMAL state)	0
1/19/2015 5:41	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ENABLE ALARMS by CarsonIkonen at wwdwsxos03	0
1/19/2015 5:41	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ENABLE RTN by CarsonIkonen at wwdwsxos03	0

1/19/2015 5:47	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.7603 psig (HIGH state)	0
1/19/2015 5:47	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.7603 psig (HIGH state)	0
1/19/2015 5:47	analog	PMD_050_PT		Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by MikeMastroianni at wwdwsxos0	0
1/19/2015 5:47	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.7527 psig (NORMAL state)	0
1/19/2015 5:47	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.7527 psig (NORMAL state)	0
1/19/2015 5:47	analog	PMD_050_PT		Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by MikeMastroianni at wwdwsxos0	0
1/19/2015 5:47	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.1924 psig (HIGH state)	0
1/19/2015 5:47	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.1924 psig (HIGH state)	0
1/19/2015 5:47	analog	PMD_050_PT		Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by MikeMastroianni at wwdwsxos0	0
1/19/2015 5:47	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.4229 psig (NORMAL state)	0
1/19/2015 5:47	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.4229 psig (NORMAL state)	0
1/19/2015 5:48	analog	PMD_050_PT		Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by MikeMastroianni at wwdwsxos0	0
1/19/2015 5:50	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.0092 psig (HIGH state)	0
1/19/2015 5:50	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.0092 psig (HIGH state)	0
1/19/2015 5:50	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.4229 psig (NORMAL state)	0
1/19/2015 5:50	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.4229 psig (NORMAL state)	0
1/19/2015 5:50	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos02	0
1/19/2015 5:50	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.0641 psig (HIGH state)	0
1/19/2015 5:50	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.0641 psig (HIGH state)	0
1/19/2015 5:50	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.3863 psig (NORMAL state)	0
1/19/2015 5:50	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.3863 psig (NORMAL state)	0
1/19/2015 5:50	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos03	0
1/19/2015 23:33	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command INHIBIT ALARMS by MikeMastroianni at wwdwsxos01	0
1/19/2015 23:33	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command INHIBIT RTN by MikeMastroianni at wwdwsxos01	0
1/19/2015 23:43	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 64.5252 psig (LOW-LOW state)	0
1/19/2015 23:43	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 64.5252 psig (LOW-LOW state)	0
1/19/2015 23:43	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 70.4061 psig (NORMAL state)	0
1/19/2015 23:43	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 70.4061 psig (NORMAL state)	0
1/19/2015 23:43	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.5267 psig (LOW state)	0
1/19/2015 23:43	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.5267 psig (LOW state)	0
1/19/2015 23:43	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 70.2595 psig (NORMAL state)	0
1/19/2015 23:43	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 70.2595 psig (NORMAL state)	0
1/19/2015 23:43	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.7832 psig (LOW state)	0
1/19/2015 23:43	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.7832 psig (LOW state)	0
1/19/2015 23:44	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 70.0397 psig (NORMAL state)	0
1/19/2015 23:44	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 70.0397 psig (NORMAL state)	0
1/19/2015 23:44	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.8382 psig (LOW state)	0
1/19/2015 23:44	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.8382 psig (LOW state)	0
1/19/2015 23:44	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 70.0947 psig (NORMAL state)	0
1/19/2015 23:44	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 70.0947 psig (NORMAL state)	0
1/20/2015 4:50	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ENABLE ALARMS by CarsonIkonen at wwdwsxos03	0
1/20/2015 4:50	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ENABLE RTN by CarsonIkonen at wwdwsxos03	0
1/20/2015 5:40	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.3023 psig (HIGH state)	0
1/20/2015 5:40	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.3023 psig (HIGH state)	0
1/20/2015 5:40	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by MikeMastroianni at wwdwsxos0	0
1/20/2015 5:41	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.6611 psig (NORMAL state)	0
1/20/2015 5:41	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.6611 psig (NORMAL state)	0
1/20/2015 5:41	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by MikeMastroianni at wwdwsxos0	0
1/20/2015 5:41	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.1557 psig (HIGH state)	0
1/20/2015 5:41	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.1557 psig (HIGH state)	0

1/20/2015 5:41	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by MikeMastroianni at wwdwsxos0	0
1/20/2015 5:41	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.826 psig (NORMAL state)	0
1/20/2015 5:41	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.826 psig (NORMAL state)	0
1/20/2015 5:41	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by MikeMastroianni at wwdwsxos0	0
1/20/2015 5:42	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.1374 psig (HIGH state)	0
1/20/2015 5:42	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.1374 psig (HIGH state)	0
1/20/2015 5:42	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.5695 psig (NORMAL state)	0
1/20/2015 5:42	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.5695 psig (NORMAL state)	0
1/20/2015 5:42	analog	PMD_050_PT		Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by MikeMastroianni at wwdwsxos0	0
1/20/2015 5:44	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.4672 psig (HIGH state)	0
1/20/2015 5:44	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.4672 psig (HIGH state)	0
1/20/2015 5:44	analog	PMD_050_PT		Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by MikeMastroianni at wwdwsxos0	0
1/20/2015 5:44	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.5145 psig (NORMAL state)	0
1/20/2015 5:44	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.5145 psig (NORMAL state)	0
1/20/2015 5:44	analog	PMD_050_PT		Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by MikeMastroianni at wwdwsxos0	0
1/20/2015 10:22	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.4122 psig (HIGH state)	0
1/20/2015 10:22	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.4122 psig (HIGH state)	0
1/20/2015 10:22	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos03	0
1/20/2015 10:22	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.9359 psig (NORMAL state)	0
1/20/2015 10:22	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.9359 psig (NORMAL state)	0
1/20/2015 10:22	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos03	0
1/20/2015 10:22	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.2656 psig (HIGH state)	0
1/20/2015 10:22	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.2656 psig (HIGH state)	0
1/20/2015 10:22	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos03	0
1/20/2015 10:23	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.9725 psig (NORMAL state)	0
1/20/2015 10:23	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.9725 psig (NORMAL state)	0
1/20/2015 10:23	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos03	0
1/20/2015 10:27	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.8565 psig (LOW state)	0
1/20/2015 10:27	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.8565 psig (LOW state)	0
1/20/2015 10:27	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos03	0
1/20/2015 10:27	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 72.1649 psig (NORMAL state)	0
1/20/2015 10:27	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 72.1649 psig (NORMAL state)	0
1/20/2015 10:27	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos03	0
1/20/2015 23:26	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command INHIBIT ALARMS by JohnPenner at wwdwsxos01	0
1/20/2015 23:26	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command INHIBIT RTN by JohnPenner at wwdwsxos01	0
1/20/2015 23:27	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 67.255 psig (LOW-LOW state)	0
1/20/2015 23:27	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 67.255 psig (LOW-LOW state)	0
1/20/2015 23:27	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 71.3771 psig (NORMAL state)	0
1/20/2015 23:27	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 71.3771 psig (NORMAL state)	0
1/20/2015 23:27	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.655 psig (LOW state)	0
1/20/2015 23:27	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.655 psig (LOW state)	0
1/20/2015 23:27	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 71.1573 psig (NORMAL state)	0
1/20/2015 23:27	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 71.1573 psig (NORMAL state)	0
1/20/2015 23:27	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 68.4824 psig (LOW state)	0
1/20/2015 23:27	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 68.4824 psig (LOW state)	0
1/20/2015 23:27	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 70.113 psig (NORMAL state)	0
1/20/2015 23:27	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 70.113 psig (NORMAL state)	0
1/20/2015 23:27	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.6916 psig (LOW state)	0
1/20/2015 23:27	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.6916 psig (LOW state)	0
1/20/2015 23:28	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 70.2229 psig (NORMAL state)	0

1/20/2015 23:28	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 70.2229 psig (NORMAL state)	0
1/21/2015 5:53	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ENABLE ALARMS by CarsonIkonen at wwdwsxos03	0
1/21/2015 5:53	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ENABLE RTN by CarsonIkonen at wwdwsxos03	0
1/21/2015 5:53	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.1191 psig (HIGH state)	0
1/21/2015 5:53	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.1191 psig (HIGH state)	0
1/21/2015 5:53	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.9176 psig (NORMAL state)	0
1/21/2015 5:53	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.9176 psig (NORMAL state)	0
1/21/2015 5:53	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.3023 psig (HIGH state)	0
1/21/2015 5:53	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.3023 psig (HIGH state)	0
1/21/2015 5:53	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.8992 psig (NORMAL state)	0
1/21/2015 5:53	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.8992 psig (NORMAL state)	0
1/21/2015 5:54	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos03	0
1/21/2015 5:54	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.2107 psig (HIGH state)	0
1/21/2015 5:54	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.2107 psig (HIGH state)	0
1/21/2015 5:54	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos03	0
1/21/2015 5:54	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.9725 psig (NORMAL state)	0
1/21/2015 5:54	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.9725 psig (NORMAL state)	0
1/21/2015 5:54	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos03	0
1/21/2015 5:54	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.284 psig (HIGH state)	0
1/21/2015 5:54	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.284 psig (HIGH state)	0
1/21/2015 5:54	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos03	0
1/21/2015 5:54	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.9725 psig (NORMAL state)	0
1/21/2015 5:54	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.9725 psig (NORMAL state)	0
1/21/2015 5:55	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos03	0
1/21/2015 7:27	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.1557 psig (HIGH state)	0
1/21/2015 7:27	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.1557 psig (HIGH state)	0
1/21/2015 7:27	analog	PMD_050_PT		Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by JohnPenner at wwdwsxos01	0
1/21/2015 7:28	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.8443 psig (NORMAL state)	0
1/21/2015 7:28	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.8443 psig (NORMAL state)	0
1/21/2015 7:28	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos02	0
1/21/2015 8:02	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 68.7206 psig (LOW state)	0
1/21/2015 8:02	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 68.7206 psig (LOW state)	0
1/21/2015 8:02	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 71.084 psig (NORMAL state)	0
1/21/2015 8:02	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 71.084 psig (NORMAL state)	0
1/21/2015 8:02	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos03	0
1/21/2015 23:59	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command INHIBIT ALARMS by JohnPenner at wwdwsxos01	0
1/21/2015 23:59	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command INHIBIT RTN by JohnPenner at wwdwsxos01	0
1/22/2015 0:00	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 66.3573 psig (LOW-LOW state)	0
1/22/2015 0:00	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 66.3573 psig (LOW-LOW state)	0
1/22/2015 0:00	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.9298 psig (LOW state)	0
1/22/2015 0:00	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.9298 psig (LOW state)	0
1/22/2015 0:00	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 70.1679 psig (NORMAL state)	0
1/22/2015 0:00	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 70.1679 psig (NORMAL state)	0
1/22/2015 0:00	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.5084 psig (LOW state)	0
1/22/2015 0:00	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.5084 psig (LOW state)	0
1/22/2015 0:00	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 70.8824 psig (NORMAL state)	0
1/22/2015 0:00	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 70.8824 psig (NORMAL state)	0
1/22/2015 5:44	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.4122 psig (HIGH state)	0
1/22/2015 5:44	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.4122 psig (HIGH state)	0
1/22/2015 5:44	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.9542 psig (NORMAL state)	0

1/22/2015 5:44	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.9542 psig (NORMAL state)	0
1/22/2015 5:44	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.174 psig (HIGH state)	0
1/22/2015 5:44	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.174 psig (HIGH state)	0
1/22/2015 5:44	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.7527 psig (NORMAL state)	0
1/22/2015 5:44	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.7527 psig (NORMAL state)	0
1/22/2015 5:44	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.174 psig (HIGH state)	0
1/22/2015 5:44	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.174 psig (HIGH state)	0
1/22/2015 5:44	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.9359 psig (NORMAL state)	0
1/22/2015 5:44	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.9359 psig (NORMAL state)	0
1/22/2015 5:45	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.1191 psig (HIGH state)	0
1/22/2015 5:45	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.1191 psig (HIGH state)	0
1/22/2015 5:45	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.9176 psig (NORMAL state)	0
1/22/2015 5:45	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.9176 psig (NORMAL state)	0
1/22/2015 5:45	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.0641 psig (HIGH state)	0
1/22/2015 5:45	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.0641 psig (HIGH state)	0
1/22/2015 5:45	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.8626 psig (NORMAL state)	0
1/22/2015 5:45	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.8626 psig (NORMAL state)	0
1/22/2015 5:45	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.4855 psig (HIGH state)	0
1/22/2015 5:45	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.4855 psig (HIGH state)	0
1/22/2015 5:45	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.9542 psig (NORMAL state)	0
1/22/2015 5:45	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.9542 psig (NORMAL state)	0
1/22/2015 5:45	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.0458 psig (HIGH state)	0
1/22/2015 5:45	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.0458 psig (HIGH state)	0
1/22/2015 5:45	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.7344 psig (NORMAL state)	0
1/22/2015 5:45	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.7344 psig (NORMAL state)	0
1/22/2015 5:46	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.0824 psig (HIGH state)	0
1/22/2015 5:46	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.0824 psig (HIGH state)	0
1/22/2015 5:46	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.5695 psig (NORMAL state)	0
1/22/2015 5:46	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.5695 psig (NORMAL state)	0
1/22/2015 6:56	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ENABLE ALARMS by JohnPenner at wwdwsxos01	0
1/22/2015 6:56	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ENABLE RTN by JohnPenner at wwdwsxos01	0
1/22/2015 7:40	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.0458 psig (HIGH state)	0
1/22/2015 7:40	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.0458 psig (HIGH state)	0
1/22/2015 7:40	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos02	0
1/22/2015 7:40	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.6611 psig (NORMAL state)	0
1/22/2015 7:40	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.6611 psig (NORMAL state)	0
1/22/2015 7:40	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.1924 psig (HIGH state)	0
1/22/2015 7:40	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.1924 psig (HIGH state)	0
1/22/2015 7:40	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos03	0
1/22/2015 7:40	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.6427 psig (NORMAL state)	0
1/22/2015 7:40	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.6427 psig (NORMAL state)	0
1/22/2015 7:40	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos02	0
1/22/2015 7:40	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.2656 psig (HIGH state)	0
1/22/2015 7:40	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.2656 psig (HIGH state)	0
1/22/2015 7:41	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos03	0
1/22/2015 7:41	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.9176 psig (NORMAL state)	0
1/22/2015 7:41	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.9176 psig (NORMAL state)	0
1/22/2015 7:41	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos02	0
1/22/2015 7:57	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.1969 psig (LOW state)	0
1/22/2015 7:57	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.1969 psig (LOW state)	0

1/22/2015 7:57	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 70.6626 psig (NORMAL state)	0
1/22/2015 7:57	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 70.6626 psig (NORMAL state)	0
1/22/2015 7:57	analog	PMD_050_PT		Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by JohnPenner at wwdwsxos01	0
1/22/2015 23:26	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 67.4015 psig (LOW-LOW state)	0
1/22/2015 23:26	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 67.4015 psig (LOW-LOW state)	0
1/22/2015 23:26	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos03	0
1/22/2015 23:26	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 71.2672 psig (NORMAL state)	0
1/22/2015 23:26	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 71.2672 psig (NORMAL state)	0
1/22/2015 23:26	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command INHIBIT ALARMS by CarsonIkonen at wwdwsxos03	0
1/22/2015 23:26	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command INHIBIT RTN by CarsonIkonen at wwdwsxos03	0
1/22/2015 23:26	analog	PMD_050_PT		Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by JohnPenner at wwdwsxos01	0
1/22/2015 23:26	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.2336 psig (LOW state)	0
1/22/2015 23:26	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.2336 psig (LOW state)	0
1/22/2015 23:26	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 70.6992 psig (NORMAL state)	0
1/22/2015 23:26	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 70.6992 psig (NORMAL state)	0
1/22/2015 23:26	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 68.116 psig (LOW state)	0
1/22/2015 23:26	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 68.116 psig (LOW state)	0
1/22/2015 23:27	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 70.3695 psig (NORMAL state)	0
1/22/2015 23:27	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 70.3695 psig (NORMAL state)	0
1/22/2015 23:27	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.1603 psig (LOW state)	0
1/22/2015 23:27	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.1603 psig (LOW state)	0
1/22/2015 23:27	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 70.4244 psig (NORMAL state)	0
1/22/2015 23:27	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 70.4244 psig (NORMAL state)	0
1/23/2015 5:25	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.7603 psig (HIGH state)	0
1/23/2015 5:25	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.7603 psig (HIGH state)	0
1/23/2015 5:25	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.2031 psig (NORMAL state)	0
1/23/2015 5:25	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.2031 psig (NORMAL state)	0
1/23/2015 5:25	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.8885 psig (HIGH state)	0
1/23/2015 5:25	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.8885 psig (HIGH state)	0
1/23/2015 5:25	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.9359 psig (NORMAL state)	0
1/23/2015 5:25	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.9359 psig (NORMAL state)	0
1/23/2015 5:25	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.5588 psig (HIGH state)	0
1/23/2015 5:25	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.5588 psig (HIGH state)	0
1/23/2015 5:26	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.7893 psig (NORMAL state)	0
1/23/2015 5:26	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.7893 psig (NORMAL state)	0
1/23/2015 5:26	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.1374 psig (HIGH state)	0
1/23/2015 5:26	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.1374 psig (HIGH state)	0
1/23/2015 5:26	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 76.7634 psig (NORMAL state)	0
1/23/2015 5:26	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 76.7634 psig (NORMAL state)	0
1/23/2015 5:27	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ENABLE ALARMS by CarsonIkonen at wwdwsxos03	0
1/23/2015 5:27	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ENABLE RTN by CarsonIkonen at wwdwsxos03	0
1/23/2015 5:27	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ENABLE ALARMS by CarsonIkonen at wwdwsxos03	0
1/23/2015 5:27	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ENABLE RTN by CarsonIkonen at wwdwsxos03	0
1/23/2015 5:27	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.229 psig (HIGH state)	0
1/23/2015 5:27	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.229 psig (HIGH state)	0
1/23/2015 5:27	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.9725 psig (NORMAL state)	0
1/23/2015 5:27	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.9725 psig (NORMAL state)	0
1/23/2015 5:28	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos03	0
1/23/2015 23:20	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command INHIBIT ALARMS by CarsonIkonen at wwdwsxos03	0
1/23/2015 23:20	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command INHIBIT RTN by CarsonIkonen at wwdwsxos03	0

1/23/2015 23:22	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.1969 psig (LOW state)	0
1/23/2015 23:22	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.1969 psig (LOW state)	0
1/23/2015 23:22	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 71.1573 psig (NORMAL state)	0
1/23/2015 23:22	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 71.1573 psig (NORMAL state)	0
1/23/2015 23:23	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.1603 psig (LOW state)	0
1/23/2015 23:23	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.1603 psig (LOW state)	0
1/23/2015 23:23	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 67.255 psig (LOW-LOW state)	0
1/23/2015 23:23	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 67.255 psig (LOW-LOW state)	0
1/23/2015 23:23	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 68.7389 psig (LOW state)	0
1/23/2015 23:23	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 68.7389 psig (LOW state)	0
1/23/2015 23:23	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 67.8229 psig (LOW-LOW state)	0
1/23/2015 23:23	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 67.8229 psig (LOW-LOW state)	0
1/23/2015 23:23	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.2885 psig (LOW state)	0
1/23/2015 23:23	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.2885 psig (LOW state)	0
1/23/2015 23:24	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 70.0031 psig (NORMAL state)	0
1/23/2015 23:24	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 70.0031 psig (NORMAL state)	0
1/23/2015 23:24	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.3802 psig (LOW state)	0
1/23/2015 23:24	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.3802 psig (LOW state)	0
1/23/2015 23:24	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 70.2412 psig (NORMAL state)	0
1/23/2015 23:24	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 70.2412 psig (NORMAL state)	0
1/23/2015 23:24	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.7466 psig (LOW state)	0
1/23/2015 23:24	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.7466 psig (LOW state)	0
1/23/2015 23:24	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 70.8458 psig (NORMAL state)	0
1/23/2015 23:24	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 70.8458 psig (NORMAL state)	0
1/24/2015 7:27	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ENABLE ALARMS by CarsonIkonen at wwdwsxos03	0
1/24/2015 7:27	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ENABLE RTN by CarsonIkonen at wwdwsxos03	0
1/24/2015 10:01	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.0458 psig (HIGH state)	0
1/24/2015 10:01	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.0458 psig (HIGH state)	0
1/24/2015 10:01	analog	PMD_050_PT		Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos03	0
1/24/2015 10:01	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.9542 psig (NORMAL state)	0
1/24/2015 10:01	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.9542 psig (NORMAL state)	0
1/24/2015 10:01	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command INHIBIT ALARMS by CarsonIkonen at wwdwsxos03	0
1/24/2015 10:01	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command INHIBIT RTN by CarsonIkonen at wwdwsxos03	0
1/24/2015 10:01	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos03	0
1/24/2015 10:01	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.1191 psig (HIGH state)	0
1/24/2015 10:01	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.1191 psig (HIGH state)	0
1/24/2015 10:02	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.8626 psig (NORMAL state)	0
1/24/2015 10:02	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.8626 psig (NORMAL state)	0
1/24/2015 18:21	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ENABLE ALARMS by JohnPenner at wwdwsxos01	0
1/24/2015 18:21	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ENABLE RTN by JohnPenner at wwdwsxos01	0
1/25/2015 0:45	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 65.3313 psig (LOW-LOW state)	0
1/25/2015 0:45	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 65.3313 psig (LOW-LOW state)	0
1/25/2015 0:45	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 73.6855 psig (NORMAL state)	0
1/25/2015 0:45	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 73.6855 psig (NORMAL state)	0
1/25/2015 0:45	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos03	0
1/25/2015 0:46	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command INHIBIT ALARMS by CarsonIkonen at wwdwsxos03	0
1/25/2015 0:46	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command INHIBIT RTN by CarsonIkonen at wwdwsxos03	0
1/25/2015 0:46	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.3985 psig (LOW state)	0
1/25/2015 0:46	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.3985 psig (LOW state)	0
1/25/2015 0:46	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 70.3511 psig (NORMAL state)	0

1/25/2015 0:46	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 70.3511 psig (NORMAL state)	0
1/25/2015 0:46	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.5634 psig (LOW state)	0
1/25/2015 0:46	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.5634 psig (LOW state)	0
1/25/2015 0:46	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 70.2046 psig (NORMAL state)	0
1/25/2015 0:46	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 70.2046 psig (NORMAL state)	0
1/25/2015 0:46	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.8565 psig (LOW state)	0
1/25/2015 0:46	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.8565 psig (LOW state)	0
1/25/2015 0:46	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 71.3221 psig (NORMAL state)	0
1/25/2015 0:46	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 71.3221 psig (NORMAL state)	0
1/25/2015 7:40	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.0275 psig (HIGH state)	0
1/25/2015 7:40	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.0275 psig (HIGH state)	0
1/25/2015 7:40	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.716 psig (NORMAL state)	0
1/25/2015 7:40	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.716 psig (NORMAL state)	0
1/25/2015 7:40	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.2107 psig (HIGH state)	0
1/25/2015 7:40	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.2107 psig (HIGH state)	0
1/25/2015 7:40	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.5695 psig (NORMAL state)	0
1/25/2015 7:40	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.5695 psig (NORMAL state)	0
1/25/2015 7:40	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.0458 psig (HIGH state)	0
1/25/2015 7:40	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.0458 psig (HIGH state)	0
1/25/2015 7:40	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.6794 psig (NORMAL state)	0
1/25/2015 7:40	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.6794 psig (NORMAL state)	0
1/25/2015 7:42	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ENABLE ALARMS by CarsonIkonen at wwdwsxos03	0
1/25/2015 7:42	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ENABLE RTN by CarsonIkonen at wwdwsxos03	0
1/25/2015 9:51	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.0275 psig (HIGH state)	0
1/25/2015 9:51	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.0275 psig (HIGH state)	0
1/25/2015 9:51	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.4962 psig (NORMAL state)	0
1/25/2015 9:51	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.4962 psig (NORMAL state)	0
1/25/2015 9:51	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos02	0
1/25/2015 9:52	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.2473 psig (HIGH state)	0
1/25/2015 9:52	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.2473 psig (HIGH state)	0
1/25/2015 9:52	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.9359 psig (NORMAL state)	0
1/25/2015 9:52	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.9359 psig (NORMAL state)	0
1/25/2015 9:52	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by JohnPenner at wwdwsxos01	0
1/25/2015 9:52	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.3206 psig (HIGH state)	0
1/25/2015 9:52	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.3206 psig (HIGH state)	0
1/25/2015 9:52	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by JohnPenner at wwdwsxos01	0
1/25/2015 9:52	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.771 psig (NORMAL state)	0
1/25/2015 9:52	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.771 psig (NORMAL state)	0
1/25/2015 9:52	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by JohnPenner at wwdwsxos01	0
1/25/2015 14:00	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 68.0061 psig (LOW state)	0
1/25/2015 14:00	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 68.0061 psig (LOW state)	0
1/25/2015 14:00	analog	PMD_050_PT		Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos03	0
1/25/2015 14:00	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 71.2672 psig (NORMAL state)	0
1/25/2015 14:00	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 71.2672 psig (NORMAL state)	0
1/25/2015 14:00	analog	PMD_050_PT		Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos03	0
1/26/2015 0:46	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 66.1374 psig (LOW-LOW state)	0
1/26/2015 0:46	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 66.1374 psig (LOW-LOW state)	0
1/26/2015 0:46	analog	PMD_050_PT		Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos03	0
1/26/2015 0:46	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.087 psig (LOW state)	0
1/26/2015 0:46	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.087 psig (LOW state)	0

1/26/2015 0:46	analog	PMD_050_PT		Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos03	0
1/26/2015 0:46	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 72.5863 psig (NORMAL state)	0
1/26/2015 0:46	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 72.5863 psig (NORMAL state)	0
1/26/2015 0:46	analog	PMD_050_PT		Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos03	0
1/26/2015 0:46	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 68.684 psig (LOW state)	0
1/26/2015 0:46	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 68.684 psig (LOW state)	0
1/26/2015 0:46	analog	PMD_050_PT		Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos03	0
1/26/2015 0:46	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 71.0656 psig (NORMAL state)	0
1/26/2015 0:46	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 71.0656 psig (NORMAL state)	0
1/26/2015 0:46	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos02	0
1/26/2015 0:47	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.655 psig (LOW state)	0
1/26/2015 0:47	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 69.655 psig (LOW state)	0
1/26/2015 0:47	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 71.4687 psig (NORMAL state)	0
1/26/2015 0:47	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 71.4687 psig (NORMAL state)	0
1/26/2015 0:47	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos02	0
1/26/2015 5:34	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.1008 psig (HIGH state)	0
1/26/2015 5:34	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.1008 psig (HIGH state)	0
1/26/2015 5:34	analog	PMD_050_PT		Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by JohnPenner at wwdwsxos01	0
1/26/2015 5:35	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 79.1634 psig (HIGH-HIGH state)	0
1/26/2015 5:35	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 79.1634 psig (HIGH-HIGH state)	0
1/26/2015 5:35	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.687 psig (HIGH state)	0
1/26/2015 5:35	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.687 psig (HIGH state)	0
1/26/2015 5:35	analog	PMD_050_PT		Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by JohnPenner at wwdwsxos01	0
1/26/2015 5:35	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 79.2366 psig (HIGH-HIGH state)	0
1/26/2015 5:35	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 79.2366 psig (HIGH-HIGH state)	0
1/26/2015 5:35	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by JohnPenner at wwdwsxos01	0
1/26/2015 5:35	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.9435 psig (HIGH state)	0
1/26/2015 5:35	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.9435 psig (HIGH state)	0
1/26/2015 5:35	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by JohnPenner at wwdwsxos01	0
1/26/2015 5:35	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 79.2 psig (HIGH-HIGH state)	0
1/26/2015 5:35	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 79.2 psig (HIGH-HIGH state)	0
1/26/2015 5:35	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by JohnPenner at wwdwsxos01	0
1/26/2015 5:35	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.8153 psig (HIGH state)	0
1/26/2015 5:35	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.8153 psig (HIGH state)	0
1/26/2015 5:35	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by JohnPenner at wwdwsxos01	0
1/26/2015 5:36	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 79.0168 psig (HIGH-HIGH state)	0
1/26/2015 5:36	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 79.0168 psig (HIGH-HIGH state)	0
1/26/2015 5:36	analog	PMD_050_PT		Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by JohnPenner at wwdwsxos01	0
1/26/2015 5:36	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.742 psig (HIGH state)	0
1/26/2015 5:36	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.742 psig (HIGH state)	0
1/26/2015 5:36	analog	PMD_050_PT		Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by JohnPenner at wwdwsxos01	0
1/26/2015 5:36	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.9176 psig (NORMAL state)	0
1/26/2015 5:36	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.9176 psig (NORMAL state)	0
1/26/2015 5:36	analog	PMD_050_PT		Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by JohnPenner at wwdwsxos01	0
1/26/2015 7:39	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.0641 psig (HIGH state)	0
1/26/2015 7:39	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.0641 psig (HIGH state)	0
1/26/2015 7:39	analog	PMD_050_PT		Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos03	0
1/26/2015 7:39	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.716 psig (NORMAL state)	0
1/26/2015 7:39	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.716 psig (NORMAL state)	0
1/26/2015 7:39	analog	PMD_050_PT		Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos03	0

1/26/2015 7:39	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.1924 psig (HIGH state)	0
1/26/2015 7:39	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.1924 psig (HIGH state)	0
1/26/2015 7:39	analog	PMD_050_PT		Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos03	0
1/26/2015 7:39	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.7527 psig (NORMAL state)	0
1/26/2015 7:39	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.7527 psig (NORMAL state)	0
1/26/2015 7:39	analog	PMD_050_PT		Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos03	0
1/26/2015 7:39	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.1008 psig (HIGH state)	0
1/26/2015 7:39	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 78.1008 psig (HIGH state)	0
1/26/2015 7:39	analog	PMD_050_PT		Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos03	0
1/26/2015 7:39	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.4779 psig (NORMAL state)	0
1/26/2015 7:39	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 77.4779 psig (NORMAL state)	0
1/26/2015 7:39	analog	PMD_050_PT		Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos03	0
1/26/2015 8:04	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 68.9588 psig (LOW state)	0
1/26/2015 8:04	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 68.9588 psig (LOW state)	0
1/26/2015 8:04	analog	PMD_050_PT		Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos03	0
1/26/2015 8:04	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 71.542 psig (NORMAL state)	0
1/26/2015 8:04	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Value = 71.542 psig (NORMAL state)	0
1/26/2015 8:04	analog	PMD_050_PT	(P) Discharge Header Pressure (60-90 PSIG)	Issued command ACKNOWLEDGE ANALOG.PMD_050_PT.:HILO by CarsonIkonen at wwdwsxos03	0

E3e Pumping Station Power Failure Events

Pump Station Power Failure Events

Event Data	MacLean PS	McPhillips PS	Hurst PS
16-Jan-15		x	
3-Jan-15	x		
13-Dec-14	X		
13-Dec-14	x		
30-Sep-14	x	x	x
21-Sep-14	x		
24-Jul-14			x
28-Jun-14	x	x	x
9-Jun-14	x	x	x
16-Mar-14	x		
2-Jan-14	x		
18-Aug-13	x		
16-Aug-13	x	x	
17-Jul-13	x		
2-Jun-13	x		
29-May-13	x		
11-May-13		x	
23-Apr-13		x	
15-Apr-13	x		
11-Jan-13			x

E3f Pumping Station
Hourly Pressures Jan 2015

	McPhillips				MacLean				Hurst		
Date	Average	Maximum	Minimum	Date	Average	Maximum	Minimum	Date	Average	Maximum	Minimum
2015-01-10 18:00:00	75 02115	75.81069	74.08855	2015-01-10 18:00:00	79.97407	80.46412	79 56641	2015-01-10 18:00:00	75.00326	75.44427	74.58321
2015-01-10 19:00:00	75 03259	75.93893	73.8687	2015-01-10 19:00:00	79.97249	80.42748	79.49313	2015-01-10 19:00:00	74.93725	75 57252	73.50229
2015-01-10 20:00:00	75 00843	75.81069	74.21679	2015-01-10 20:00:00	79.97955	80.39084	79 52977	2015-01-10 20:00:00	75.00123	75.49924	74.50992
2015-01-10 21:00:00	74 98666	76.15878	73.90534	2015-01-10 21:00:00	79.97923	80.46412	79 58473	2015-01-10 21:00:00	75.01396	75.4626	74.45496
2015-01-10 22:00:00	75.0309	75.82901	73.97863	2015-01-10 22:00:00	79.96359	80.48244	79.43817	2015-01-10 22:00:00	75.01236	75.60916	74.4916
2015-01-10 23:00:00	75 05639	76.10382	73.97863	2015-01-10 23:00:00	79.9719	80.42748	79.2	2015-01-10 23:00:00	75.01816	75 84733	74.32672
2015-01-11 00:00:00	75 36671	77.80763	73.28244	2015-01-11 00:00:00	79.22243	80.70229	78.4855	2015-01-11 00:00:00	75.02898	75.68244	74.12519
2015-01-11 01:00:00	74 97976	77.00153	65.77099	2015-01-11 01:00:00	79.99326	81.56336	77.9542	2015-01-11 01:00:00	74.97972	76 21374	73 3374
2015-01-11 02:00:00	75.12678	75.92061	74.12519	2015-01-11 02:00:00	80.0979	80.50076	79 52977	2015-01-11 02:00:00	75.00794	75.44427	74.65649
2015-01-11 03:00:00	75.4222	76.39695	74.27176	2015-01-11 03:00:00	80.37847	80.81221	79 89618	2015-01-11 03:00:00	75.0152	75.5542	74.67481
2015-01-11 04:00:00	75.46955	76.36031	74.38168	2015-01-11 04:00:00	80.4594	80.73893	79 89618	2015-01-11 04:00:00	74.99366	75 29771	74.72977
2015-01-11 05:00:00	75.17732	76.19542	74.08855	2015-01-11 05:00:00	80.1177	80.70229	79 32824	2015-01-11 05:00:00	74.98918	75 38931	74.61985
2015-01-11 06:00:00	74 50005	75.62748	73.08092	2015-01-11 06:00:00	79.90479	80.31756	79 38321	2015-01-11 06:00:00	74.96904	75.4626	74.50992
2015-01-11 07:00:00	73 33034	78.17405	71.02901	2015-01-11 07:00:00	79.8983	82.24122	78.46718	2015-01-11 07:00:00	74.99956	77.11145	74.45496
2015-01-11 08:00:00	74 98657	77.11145	73.96031	2015-01-11 08:00:00	79.95332	82.77252	78 21069	2015-01-11 08:00:00	74.95393	75 81069	74.4
2015-01-11 09:00:00	75 04021	77.84427	73.90534	2015-01-11 09:00:00	79.92392	80.55573	79 52977	2015-01-11 09:00:00	75.07464	76 87328	74.54656
2015-01-11 10:00:00	74 98814	75.86565	74.23511	2015-01-11 10:00:00	79.94552	80.3542	79.40153	2015-01-11 10:00:00	74.98	75.42595	74.34504
2015-01-11 11:00:00	74 99481	75.93893	74.3084	2015-01-11 11:00:00	79.97093	80.51908	79.40153	2015-01-11 11:00:00	75.01469	75 33435	74.71145
2015-01-11 12:00:00	75 00567	76.04885	74.3084	2015-01-11 12:00:00	79.97239	80.46412	79.40153	2015-01-11 12:00:00	75.00555	75 33435	74.71145
2015-01-11 13:00:00	75 00604	75.84733	74.21679	2015-01-11 13:00:00	79.98004	80.40916	79.47481	2015-01-11 13:00:00	75.00848	75 35267	74.58321
2015-01-11 14:00:00	74 85658	75.93893	68.77557	2015-01-11 14:00:00	79.98208	80.51908	79 32824	2015-01-11 14:00:00	75.0032	75.5542	74.41832
2015-01-11 15:00:00	75 00614	75.92061	74.12519	2015-01-11 15:00:00	79.96629	80.5374	79 27328	2015-01-11 15:00:00	74.99822	75 29771	74.58321
2015-01-11 16:00:00	74 99144	76.03053	73.97863	2015-01-11 16:00:00	79.96441	80.46412	79 54809	2015-01-11 16:00:00	75.00063	75 38931	74.67481
2015-01-11 17:00:00	74 99017	75.86565	74.18015	2015-01-11 17:00:00	79.95644	80.48244	79 51145	2015-01-11 17:00:00	74.99776	75 33435	74.65649
2015-01-11 18:00:00	74.9749	76.03053	74.12519	2015-01-11 18:00:00	79.95605	80.51908	79.47481	2015-01-11 18:00:00	74.9946	75 33435	74.67481
2015-01-11 19:00:00	75.0684	76.12214	74.10687	2015-01-11 19:00:00	79.99486	80.3542	79 56641	2015-01-11 19:00:00	75.00694	75.4626	74.71145
2015-01-11 20:00:00	75.0498	76.14046	73.88702	2015-01-11 20:00:00	79.97926	80.46412	79 23664	2015-01-11 20:00:00	75.00623	75.4626	74.61985
2015-01-11 21:00:00	75 06374	75.88397	73.81374	2015-01-11 21:00:00	79.97953	80.37252	79 54809	2015-01-11 21:00:00	74.94135	75.5542	73.6855
2015-01-11 22:00:00	75.10413	76.15878	73.63053	2015-01-11 22:00:00	79.98606	80.42748	79 38321	2015-01-11 22:00:00	75.0303	75.70076	74.01527
2015-01-11 23:00:00	75 85127	77.47786	73.50229	2015-01-11 23:00:00	79.93846	81.08702	77.49618	2015-01-11 23:00:00	75.02141	75 92061	73.7771
2015-01-12 00:00:00	75 31376	77.20305	69.16031	2015-01-12 00:00:00	80.03566	81.92977	77.69771	2015-01-12 00:00:00	75.00623	76 32366	73.17252
2015-01-12 01:00:00	75 20032	76.56183	73.48397	2015-01-12 01:00:00	80.25777	81.32519	79.62137	2015-01-12 01:00:00	75.0178	75.5542	74.21679
2015-01-12 02:00:00	75 52054	76.83664	74.01527	2015-01-12 02:00:00	80.57824	81.27023	79.8229	2015-01-12 02:00:00	75.00679	75.60916	74.36336
2015-01-12 03:00:00	75.62518	76.98321	74.63817	2015-01-12 03:00:00	80.63531	81.32519	80 02443	2015-01-12 03:00:00	74.99975	75 51756	74.65649
2015-01-12 04:00:00	75.18883	76.28702	73.02595	2015-01-12 04:00:00	80.2728	80.79389	79.2916	2015-01-12 04:00:00	74.98035	75.4626	74.47328
2015-01-12 05:00:00	73.41893	75.66412	70.7542	2015-01-12 05:00:00	79.78123	80.61069	78 50382	2015-01-12 05:00:00	74.92402	75 57252	74.23511
2015-01-12 06:00:00	75 07191	77.05649	73.81374	2015-01-12 06:00:00	79.99618	82.46107	78.63206	2015-01-12 06:00:00	74.97484	76 23206	74.32672
2015-01-12 07:00:00	74 94858	75.95725	73.70382	2015-01-12 07:00:00	79.97795	80.5374	79 51145	2015-01-12 07:00:00	75.08961	76 81832	74.58321
2015-01-12 08:00:00	75 05725	76.25038	73.8687	2015-01-12 08:00:00	79.98045	80.48244	79.43817	2015-01-12 08:00:00	75.01184	75.4626	74.60153
2015-01-12 09:00:00	74 96668	76.28702	73.50229	2015-01-12 09:00:00	79.96461	80.57405	79.40153	2015-01-12 09:00:00	75.0001	75.48092	74.47328
2015-01-12 10:00:00	75.1228	77.78931	73.96031	2015-01-12 10:00:00	79.9693	80.48244	79 51145	2015-01-12 10:00:00	75.00838	75.60916	74.25344
2015-01-12 11:00:00	74 86172	76.39695	68.40916	2015-01-12 11:00:00	79.96015	80.64733	79 51145	2015-01-12 11:00:00	75.00099	75.5542	74.45496
2015-01-12 12:00:00	75 00363	76.04885	73.81374	2015-01-12 12:00:00	79.97291	80.50076	79.49313	2015-01-12 12:00:00	75.00849	75.49924	74.4
2015-01-12 13:00:00	75 03003	76.1771	73.44733	2015-01-12 13:00:00	79.96343	80.5374	79 54809	2015-01-12 13:00:00	74.93433	75 53588	73.37405
2015-01-12 14:00:00	75 01078	76.10382	73.00763	2015-01-12 14:00:00	79.9698	80.55573	79 54809	2015-01-12 14:00:00	74.99811	75.6458	74.45496
2015-01-12 15:00:00	74 98713	76.48855	73.42901	2015-01-12 15:00:00	79.95047	80.48244	79.47481	2015-01-12 15:00:00	74.97649	75 51756	74.23511
2015-01-12 16:00:00	74 98644	76.06718	73.85038	2015-01-12 16:00:00	79.96441	80.46412	79.47481	2015-01-12 16:00:00	75.0032	75.79237	74.36336
2015-01-12 17:00:00	75 007	75.93893	73.96031	2015-01-12 17:00:00	79.95826	80.50076	79 52977	2015-01-12 17:00:00	75.00597	75 53588	74.4916
2015-01-12 18:00:00	74 99411	76.01221	73.96031	2015-01-12 18:00:00	79.96316	80.55573	79 51145	2015-01-12 18:00:00	74.98282	75 84733	74.4
2015-01-12 19:00:00	75 02619	76.19542	73.90534	2015-01-12 19:00:00	79.97778	80.50076	79 52977	2015-01-12 19:00:00	75.01679	75 84733	74.43664
2015-01-12 20:00:00	75 03377	76.25038	73.41069	2015-01-12 20:00:00	79.98227	80.39084	79.49313	2015-01-12 20:00:00	75.00988	75.79237	74.34504
2015-01-12 21:00:00	75 03182	76.43359	73.85038	2015-01-12 21:00:00	79.96818	80.4458	79 52977	2015-01-12 21:00:00	75.00301	75.79237	74.27176
2015-01-12 22:00:00	75.10019	76.06718	73.97863	2015-01-12 22:00:00	79.99152	80.37252	79.60305	2015-01-12 22:00:00	75.02468	75.6458	74.34504
2015-01-12 23:00:00	75.74644	76.69008	74.4916	2015-01-12 23:00:00	79.97996	80.2626	79.71298	2015-01-12 23:00:00	75.03829	75.62748	74.54656
2015-01-13 00:00:00	75 36384	77.3313	68.06107	2015-01-13 00:00:00	79.9556	80.81221	78.4855	2015-01-13 00:00:00	74.98867	75 92061	73.53893
2015-01-13 01:00:00	75 05199	76.19542	73.46565	2015-01-13 01:00:00	80.13109	80.8855	79 21832	2015-01-13 01:00:00	75.01232	75 59084	74.43664
2015-01-13 02:00:00	75.42341	76.65344	73.46565	2015-01-13 02:00:00	80.48523	81.03206	79 38321	2015-01-13 02:00:00	75.0144	75 51756	74.45496
2015-01-13 03:00:00	75.47655	76.52519	73.72214	2015-01-13 03:00:00	80.46859	81.10534	79.65802	2015-01-13 03:00:00	74.99704	75.44427	74.50992
2015-01-13 04:00:00	75.1095	76.23206	73.30076	2015-01-13 04:00:00	80.15091	80.95878	79.12672	2015-01-13 04:00:00	74.97233	75.40763	74.45496
2015-01-13 05:00:00	74.11485	77.84427	70.73588	2015-01-13 05:00:00	79.83531	81.28855	78 98015	2015-01-13 05:00:00	74.98919	76.61679	74.18015
2015-01-13 06:00:00	74 86419	75.81069	73.79542	2015-01-13 06:00:00	79.91466	82.71756	78.63206	2015-01-13 06:00:00	75.01031	76.8916	74.45496
2015-01-13 07:00:00	74 94004	76.06718	73.88702	2015-01-13 07:00:00	79.96196	80.5374	79.40153	2015-01-13 07:00:00	75.00099	75.49924	74.54656
2015-01-13 08:00:00	75 06338	75.88397	74.08855	2015-01-13 08:00:00	79.98764	80.64733	79.43817	2015-01-13 08:00:00	75.01145	75 38931	74.43664
2015-01-13 09:00:00	74 99012	76.23206	73.66718	2015-01-13 09:00:00	79.95349	80.61069	79.45649	2015-01-13 09:00:00	74.99604	75.48092	74.41832
2015-01-13 10:00:00	75 00905	76.19542	73.88702	2015-01-13 10:00:00	79.9689	80.39084	79.47481	2015-01-13 10:00:00	75.00215	75.48092	74.34504
2015-01-13 11:00:00	74 99956	76.39695	73.44733	2015-01-13 11:00:00	79.96309	80.66565	79 54809	2015-01-13 11:00:00	74.99758	75.5542	74.41832
2015-01-13 12:00:00	74 99873	76.19542	73.66718	2015-01-13 12:00:00	79.96455	80.4458	79 52977	2015-01-13 12:00:00	75.00447	75 57252	74.56489
2015-01-13 13:00:00	75 01018	76.41527	73.75878	2015-01-13 13:00:00	79.96801	80.5374	79.47481	2015-01-13 13:00:00	75.00187	75.62748	74.32672
2015-01-13 14:00:00	75 02231	76.37863	73.52061	2015-01-13 14:00:00	79.98058	80.50076	79 25496	2015-01-13 14:00:00	75.00128	75 57252	74.14351
2015-01-13 15:00:00	74 98809	76.19542	73.61221	2015-01-13 15:00:00	79.94893	80.51908	79.40153	2015-01-13 15:00:00	74.99459	75 88397	73.83206
2015-01-13 16:00:00	74 97704	75.92061	73.75878	2015-01-13 16:00:00	79.95608	80.4458	79.43817	2015-01-13 16:00:00	74.99694	75.42595	74.52824
2015-01-13 17:00:00	74 97908	76.15878	73.88702	2015-01-13 17:00:00	79.95665	80.37252	79 38321	2015-01-13 17:00:00	75.00188	75.48092	74.60153

	McPhillips				MacLean				Hurst		
Date	Average	Maximum	Minimum	Date	Average	Maximum	Minimum	Date	Average	Maximum	Minimum
2015-01-13 18:00:00	75 00768	75.81069	73.6855	2015-01-13 18:00:00	79.96906	80.46412	79.45649	2015-01-13 18:00:00	75.00238	75 51756	74.47328
2015-01-13 19:00:00	75 00707	75.82901	74.03359	2015-01-13 19:00:00	79.9788	80.5374	79.43817	2015-01-13 19:00:00	74.99739	75 37099	74.63817
2015-01-13 20:00:00	75 03223	76.34198	73.57557	2015-01-13 20:00:00	79.97902	80.46412	79 32824	2015-01-13 20:00:00	75.00638	75.68244	74.43664
2015-01-13 21:00:00	75 03669	76.61679	73.55725	2015-01-13 21:00:00	79.96921	80.50076	79 36489	2015-01-13 21:00:00	74.93254	75.68244	73.44733
2015-01-13 22:00:00	75 07689	76.28702	73.72214	2015-01-13 22:00:00	79.98644	80.48244	79.45649	2015-01-13 22:00:00	75.01601	75 97557	74.07023
2015-01-13 23:00:00	75.70742	76.90992	73.85038	2015-01-13 23:00:00	79.96577	80.64733	77 99084	2015-01-13 23:00:00	75.04536	75 90229	74.07023
2015-01-14 00:00:00	75 58734	77.01985	66.41221	2015-01-14 00:00:00	79.99142	81.10534	78.61374	2015-01-14 00:00:00	74.98503	76 39695	73.61221
2015-01-14 01:00:00	75 29092	76.81832	73.61221	2015-01-14 01:00:00	80.12845	81.23359	79 25496	2015-01-14 01:00:00	75.01083	75 88397	74.54656
2015-01-14 02:00:00	75 57757	76.52519	74.54656	2015-01-14 02:00:00	80.44885	81.03206	79.67634	2015-01-14 02:00:00	75.01359	75 51756	74.61985
2015-01-14 03:00:00	75.64376	76.83664	73.97863	2015-01-14 03:00:00	80.54282	81.10534	79.69466	2015-01-14 03:00:00	74.99508	75.42595	74.21679
2015-01-14 04:00:00	75 32106	76.65344	73.57557	2015-01-14 04:00:00	80.13674	80.75725	79 32824	2015-01-14 04:00:00	74.98596	75.60916	74.29008
2015-01-14 05:00:00	74.17608	78.22901	72.0916	2015-01-14 05:00:00	79.84087	81.34351	78 85191	2015-01-14 05:00:00	74.98421	76 23206	74.21679
2015-01-14 06:00:00	74 90391	76.21374	73.72214	2015-01-14 06:00:00	79.91332	82.9374	78.68702	2015-01-14 06:00:00	75.00502	76 90992	74.01527
2015-01-14 07:00:00	74 94835	75.97557	73.57557	2015-01-14 07:00:00	79.9695	80.46412	79 38321	2015-01-14 07:00:00	74.99896	75.5542	74 3084
2015-01-14 08:00:00	75 04723	76.28702	73.83206	2015-01-14 08:00:00	79.98623	80.51908	79.45649	2015-01-14 08:00:00	75.01066	75.44427	74.58321
2015-01-14 09:00:00	75 00605	76.43359	73.55725	2015-01-14 09:00:00	79.96629	80.42748	79.47481	2015-01-14 09:00:00	74.99946	75 59084	74.38168
2015-01-14 10:00:00	74 98594	76.19542	73.79542	2015-01-14 10:00:00	79.95325	80.4458	79 51145	2015-01-14 10:00:00	75.00056	75.68244	74.58321
2015-01-14 11:00:00	75.0063	76.2687	73.6855	2015-01-14 11:00:00	79.96803	80.48244	79 51145	2015-01-14 11:00:00	75.00653	75.60916	74.38168
2015-01-14 12:00:00	75 01287	76.12214	73.53893	2015-01-14 12:00:00	79.96718	80.4458	79 54809	2015-01-14 12:00:00	74.9987	75.66412	74.4
2015-01-14 13:00:00	75 01168	76.43359	73.75878	2015-01-14 13:00:00	79.96702	80.42748	79.49313	2015-01-14 13:00:00	74.99805	75 53588	74.47328
2015-01-14 14:00:00	75 02699	76.81832	73.37405	2015-01-14 14:00:00	79.97246	80.51908	79 38321	2015-01-14 14:00:00	75.00339	75.70076	74.21679
2015-01-14 15:00:00	75 00327	76.39695	73.55725	2015-01-14 15:00:00	79.96152	80.57405	79.45649	2015-01-14 15:00:00	74.99409	75.44427	74.50992
2015-01-14 16:00:00	74 98494	76.47023	73.53893	2015-01-14 16:00:00	79.95391	80.4458	79.60305	2015-01-14 16:00:00	74.99458	75.44427	74.52824
2015-01-14 17:00:00	74.9725	76.23206	73.3374	2015-01-14 17:00:00	79.95531	80.48244	79.45649	2015-01-14 17:00:00	74.99919	75.48092	74.41832
2015-01-14 18:00:00	74 99492	76.12214	73.66718	2015-01-14 18:00:00	79.95903	80.50076	79 38321	2015-01-14 18:00:00	75.00221	75.5542	74.45496
2015-01-14 19:00:00	75 02752	76.14046	74.05191	2015-01-14 19:00:00	79.97591	80.46412	79.60305	2015-01-14 19:00:00	75.00462	75 37099	74.61985
2015-01-14 20:00:00	75 01943	76.21374	73.83206	2015-01-14 20:00:00	79.98665	80.48244	79.60305	2015-01-14 20:00:00	75.00478	75.42595	74.61985
2015-01-14 21:00:00	75 03365	76.21374	73.64885	2015-01-14 21:00:00	79.98001	80.42748	79 27328	2015-01-14 21:00:00	75.00226	75.48092	74.45496
2015-01-14 22:00:00	74 97286	76.04885	73.20916	2015-01-14 22:00:00	79.98807	80.50076	79.43817	2015-01-14 22:00:00	74.27098	75 35267	72.36641
2015-01-14 23:00:00	74.47624	76.15878	65.89924	2015-01-14 23:00:00	79.97805	80.70229	79.2	2015-01-14 23:00:00	73.53002	74 94962	69.70992
2015-01-15 00:00:00	74.49331	76.0855	71.85344	2015-01-15 00:00:00	79.94115	80.2626	79 25496	2015-01-15 00:00:00	74.83044	75 95725	73.35573
2015-01-15 01:00:00	75 21505	76.52519	72.69618	2015-01-15 01:00:00	80.00352	81.05038	78 85191	2015-01-15 01:00:00	75.03274	75 99389	74.05191
2015-01-15 02:00:00	75 55022	76.81832	74.07023	2015-01-15 02:00:00	80.41046	81.08702	79.45649	2015-01-15 02:00:00	75.03427	75.66412	74 3084
2015-01-15 03:00:00	75 55696	76.90992	74.07023	2015-01-15 03:00:00	80.43574	81.23359	79 32824	2015-01-15 03:00:00	74.96757	75 86565	74.38168
2015-01-15 04:00:00	75.19776	76.58015	73.35573	2015-01-15 04:00:00	80.05274	81.14198	79 09008	2015-01-15 04:00:00	74.98508	75.68244	74.10687
2015-01-15 05:00:00	75.62138	79.93282	73.22748	2015-01-15 05:00:00	79.80757	81.54504	78 90687	2015-01-15 05:00:00	74.95116	78.15573	74.18015
2015-01-15 06:00:00	74 90324	76.81832	73.83206	2015-01-15 06:00:00	79.76671	82.47939	78 08244	2015-01-15 06:00:00	75.06373	77 20305	74.12519
2015-01-15 07:00:00	74.9084	75.88397	73.74046	2015-01-15 07:00:00	79.97477	80.59237	79.40153	2015-01-15 07:00:00	74.99723	75 51756	74.60153
2015-01-15 08:00:00	75.10078	76.25038	73.6855	2015-01-15 08:00:00	79.98627	80.42748	79.49313	2015-01-15 08:00:00	75.01278	75.75573	74.4
2015-01-15 09:00:00	74 98778	76.04885	73.97863	2015-01-15 09:00:00	79.96389	80.51908	79 56641	2015-01-15 09:00:00	74.99952	75.44427	74.45496
2015-01-15 10:00:00	74 98292	75.97557	73.92366	2015-01-15 10:00:00	79.9548	80.50076	79.47481	2015-01-15 10:00:00	74.99819	75.4626	74.67481
2015-01-15 11:00:00	74 99517	76.06718	73.88702	2015-01-15 11:00:00	79.97226	80.40916	79 56641	2015-01-15 11:00:00	74.9972	75.70076	74.58321
2015-01-15 12:00:00	74 98559	75.84733	73.7771	2015-01-15 12:00:00	79.96344	80.4458	79 52977	2015-01-15 12:00:00	75.00235	75 51756	74.54656
2015-01-15 13:00:00	75 02554	76.43359	74.10687	2015-01-15 13:00:00	79.96499	80.4458	79 51145	2015-01-15 13:00:00	75.00562	75.42595	74.43664
2015-01-15 14:00:00	75 02821	75.84733	74.08855	2015-01-15 14:00:00	79.96432	80.39084	79 58473	2015-01-15 14:00:00	75.00252	75.4626	74.43664
2015-01-15 15:00:00	74 97882	75.66412	73.79542	2015-01-15 15:00:00	79.95566	80.33588	79.47481	2015-01-15 15:00:00	74.99949	75.48092	74.58321
2015-01-15 16:00:00	74 99054	76.10382	73.70382	2015-01-15 16:00:00	79.94894	80.29924	79 56641	2015-01-15 16:00:00	74.999	75 37099	74.65649
2015-01-15 17:00:00	74 97875	77.18473	73.79542	2015-01-15 17:00:00	79.9472	80.61069	79.45649	2015-01-15 17:00:00	74.99506	75.77405	74.43664
2015-01-15 18:00:00	74 99733	76.03053	73.42901	2015-01-15 18:00:00	79.96039	80.64733	79 54809	2015-01-15 18:00:00	74.99902	75 84733	74.52824
2015-01-15 19:00:00	75 02923	76.37863	73.61221	2015-01-15 19:00:00	79.97739	80.5374	79.45649	2015-01-15 19:00:00	75.00662	75 57252	74.56489
2015-01-15 20:00:00	75 03503	75.93893	73.70382	2015-01-15 20:00:00	79.9815	80.5374	79.49313	2015-01-15 20:00:00	75.00681	75.60916	74.38168
2015-01-15 21:00:00	75 03245	76.15878	73.90534	2015-01-15 21:00:00	79.97607	80.55573	79.14504	2015-01-15 21:00:00	74.99871	75.5542	74.45496
2015-01-15 22:00:00	75 09292	76.10382	73.6855	2015-01-15 22:00:00	79.98886	80.39084	79 09008	2015-01-15 22:00:00	74.95901	75.40763	73.42901
2015-01-15 23:00:00	75 30896	77.11145	68.5374	2015-01-15 23:00:00	79.97312	80.40916	79.41985	2015-01-15 23:00:00	74.99774	76.19542	73.35573
2015-01-16 00:00:00	74.65151	75.95725	72.89771	2015-01-16 00:00:00	79.9888	80.2626	79.63969	2015-01-16 00:00:00	75.035	75.49924	74.36336
2015-01-16 01:00:00	75.2387	76.50687	73.42901	2015-01-16 01:00:00	80.02462	80.51908	79.67634	2015-01-16 01:00:00	75.00946	75.6458	74.36336
2015-01-16 02:00:00	75 58137	76.72672	73.55725	2015-01-16 02:00:00	80.44236	81.0687	79.43817	2015-01-16 02:00:00	75.00521	75.7374	74.4916
2015-01-16 03:00:00	75.70417	76.81832	74.61985	2015-01-16 03:00:00	80.52795	81.03206	79 87786	2015-01-16 03:00:00	75.00127	75 29771	74.60153
2015-01-16 04:00:00	75 38922	76.54351	73.35573	2015-01-16 04:00:00	80.17484	81.16031	79.2916	2015-01-16 04:00:00	74.97933	75 51756	74.56489
2015-01-16 05:00:00	75 04519	79.23664	72.6229	2015-01-16 05:00:00	79.83451	81.65496	79 05344	2015-01-16 05:00:00	74.97192	76 83664	74.05191
2015-01-16 06:00:00	74 89858	76.0855	72.76947	2015-01-16 06:00:00	79.9548	82.82748	78 94351	2015-01-16 06:00:00	75.0173	76 59847	74.21679
2015-01-16 07:00:00	74 91967	75.7374	73.70382	2015-01-16 07:00:00	79.95283	80.39084	79.47481	2015-01-16 07:00:00	74.99456	75.4626	74.41832
2015-01-16 08:00:00	75 05411	76.04885	73.46565	2015-01-16 08:00:00	79.97472	80.64733	79.47481	2015-01-16 08:00:00	74.99993	75.44427	74.43664
2015-01-16 09:00:00	75 00962	76.06718	73.81374	2015-01-16 09:00:00	79.96587	80.55573	79 51145	2015-01-16 09:00:00	75.01027	75.5542	74.4916
2015-01-16 10:00:00	74 96674	75.93893	73.75878	2015-01-16 10:00:00	79.95737	80.55573	79.43817	2015-01-16 10:00:00	74.99149	75.4626	74.34504
2015-01-16 11:00:00	75 02198	76.23206	74.10687	2015-01-16 11:00:00	79.97173	80.46412	79.40153	2015-01-16 11:00:00	75.00443	75.70076	74.34504
2015-01-16 12:00:00	74 99674	76.12214	73.52061	2015-01-16 12:00:00	79.96219	80.39084	79.49313	2015-01-16 12:00:00	75.00198	75.49924	74.56489
2015-01-16 13:00:00	75 02295	76.15878	73.83206	2015-01-16 13:00:00	79.97406	80.46412	79 52977	2015-01-16 13:00:00	75.00653	75 53588	74.4916
2015-01-16 14:00:00	75 01791	76.25038	73.75878	2015-01-16 14:00:00	79.95675	80.40916	79 51145	2015-01-16 14:00:00	75.00268	75 53588	74.58321
2015-01-16 15:00:00	74 99989	76.04885	73.50229	2015-01-16 15:00:00	79.96204	80.40916	79.62137	2015-01-16 15:00:00	74.99754	75.42595	74.47328
2015-01-16 16:00:00	74 99327	75.99389	73.20916	2015-01-16 16:00:00	79.96409	80.46412	79 34656	2015-01-16 16:00:00	74.99423	75.6458	74.4
2015-01-16 17:00:00	74 98491	76.23206	73.96031	2015-01-16 17:00:00	79.94869	80.40916	79.41985	2015-01-16 17:00:00	74.99941	75 38931	74.52824

	McPhillips				MacLean				Hurst		
Date	Average	Maximum	Minimum	Date	Average	Maximum	Minimum	Date	Average	Maximum	Minimum
2015-01-16 18:00:00	75 02786	75.81069	74.01527	2015-01-16 18:00:00	79.9703	80.46412	79.47481	2015-01-16 18:00:00	75.00586	75.5542	74.56489
2015-01-16 19:00:00	75 04883	76.03053	74.08855	2015-01-16 19:00:00	79.98208	80.39084	79.60305	2015-01-16 19:00:00	75.00496	75 29771	74.71145
2015-01-16 20:00:00	75 01702	76.1771	73.8687	2015-01-16 20:00:00	79.96694	80.37252	79 56641	2015-01-16 20:00:00	75.00352	75 51756	74.54656
2015-01-16 21:00:00	75 00656	76.06718	73.8687	2015-01-16 21:00:00	79.96147	80.55573	78 99847	2015-01-16 21:00:00	74.92226	75 84733	73.37405
2015-01-16 22:00:00	75.15472	76.30534	73.35573	2015-01-16 22:00:00	79.98344	80.59237	79 23664	2015-01-16 22:00:00	75.02977	75 97557	74.10687
2015-01-16 23:00:00	74 96333	76.72672	65.75267	2015-01-16 23:00:00	79.97294	80.62901	79.40153	2015-01-16 23:00:00	74.99065	76.10382	72.64122
2015-01-17 00:00:00	74 30495	75.68244	71.96336	2015-01-17 00:00:00	79.98335	80.31756	79.71298	2015-01-17 00:00:00	75.03523	75 82901	74 3084
2015-01-17 01:00:00	74 99137	76.28702	73.63053	2015-01-17 01:00:00	79.97869	80.2626	79.62137	2015-01-17 01:00:00	75.01711	75.62748	74.36336
2015-01-17 02:00:00	75 39216	76.34198	74.21679	2015-01-17 02:00:00	80.22148	80.77557	79.76794	2015-01-17 02:00:00	75.00981	75 35267	74.69313
2015-01-17 03:00:00	75.60251	76.63511	73.61221	2015-01-17 03:00:00	80.52291	81.52672	79 36489	2015-01-17 03:00:00	75.00672	75.49924	74.29008
2015-01-17 04:00:00	75 53912	76.74504	73.55725	2015-01-17 04:00:00	80.49112	81.63664	79 30992	2015-01-17 04:00:00	74.99709	75.7374	74.23511
2015-01-17 05:00:00	75.18446	76.30534	74.03359	2015-01-17 05:00:00	80.06335	81.19695	79.41985	2015-01-17 05:00:00	74.97317	75 53588	74.61985
2015-01-17 06:00:00	74 39753	75.5542	73.04427	2015-01-17 06:00:00	79.89669	80.50076	79.18168	2015-01-17 06:00:00	74.97175	75 31603	74.56489
2015-01-17 07:00:00	74 36146	78.22901	71.9084	2015-01-17 07:00:00	79.84536	81.61832	78.76031	2015-01-17 07:00:00	74.97623	77 20305	74.12519
2015-01-17 08:00:00	74 92834	75.81069	73.96031	2015-01-17 08:00:00	80.05134	82.80916	79 30992	2015-01-17 08:00:00	75.04901	76 59847	74.14351
2015-01-17 09:00:00	74 88038	75.77405	73.57557	2015-01-17 09:00:00	79.93536	80.33588	79 25496	2015-01-17 09:00:00	74.99254	76.2687	74.36336
2015-01-17 10:00:00	74 97196	75.86565	73.97863	2015-01-17 10:00:00	79.95585	80.50076	79 32824	2015-01-17 10:00:00	75.0046	75.42595	74.4916
2015-01-17 11:00:00	75 01095	78.50382	68.28092	2015-01-17 11:00:00	79.9734	80.79389	79 30992	2015-01-17 11:00:00	74.99605	76 01221	73.85038
2015-01-17 12:00:00	75 00843	75.7374	74.16183	2015-01-17 12:00:00	79.9741	80.40916	79.45649	2015-01-17 12:00:00	75.00242	75 31603	74.67481
2015-01-17 13:00:00	75 02979	76.30534	74.25344	2015-01-17 13:00:00	79.98313	80.66565	79.45649	2015-01-17 13:00:00	75.00116	75 35267	74.63817
2015-01-17 14:00:00	75 04042	75.84733	73.83206	2015-01-17 14:00:00	79.97906	80.4458	79 54809	2015-01-17 14:00:00	75.00125	75.40763	74.52824
2015-01-17 15:00:00	75 00479	76.03053	74.21679	2015-01-17 15:00:00	79.96808	80.4458	79 58473	2015-01-17 15:00:00	75.00302	75 37099	74.50992
2015-01-17 16:00:00	74 99616	75.93893	74.08855	2015-01-17 16:00:00	79.96209	80.29924	79.43817	2015-01-17 16:00:00	74.99901	75.49924	74.56489
2015-01-17 17:00:00	75.0065	75.84733	74.19847	2015-01-17 17:00:00	79.96275	80.50076	79 54809	2015-01-17 17:00:00	74.9985	75.44427	74.58321
2015-01-17 18:00:00	75 01206	75.84733	74.01527	2015-01-17 18:00:00	79.96751	80.3542	79 51145	2015-01-17 18:00:00	75.00099	75.4626	74.63817
2015-01-17 19:00:00	75 03771	75.86565	74.23511	2015-01-17 19:00:00	79.977	80.31756	79.65802	2015-01-17 19:00:00	75.0021	75 33435	74.69313
2015-01-17 20:00:00	75.0136	76.12214	74.25344	2015-01-17 20:00:00	79.97969	80.37252	79.62137	2015-01-17 20:00:00	75.00329	75.42595	74.63817
2015-01-17 21:00:00	75 03513	75.93893	73.79542	2015-01-17 21:00:00	79.97435	80.33588	79.49313	2015-01-17 21:00:00	74.94578	75 53588	73.53893
2015-01-17 22:00:00	75 28754	76.25038	74.08855	2015-01-17 22:00:00	79.96895	80.31756	79.62137	2015-01-17 22:00:00	75.01854	75.40763	74.4916
2015-01-17 23:00:00	74 96739	76.83664	69.16031	2015-01-17 23:00:00	79.97126	80.5374	79.45649	2015-01-17 23:00:00	74.98475	76.43359	72.6229
2015-01-18 00:00:00	74.19718	75.37099	72.60458	2015-01-18 00:00:00	79.98833	80.29924	79.71298	2015-01-18 00:00:00	75.03247	75 38931	74.52824
2015-01-18 01:00:00	74 89373	76.10382	73.50229	2015-01-18 01:00:00	80.00647	80.37252	79.63969	2015-01-18 01:00:00	75.02086	75.49924	74.58321
2015-01-18 02:00:00	75 37666	76.37863	74.21679	2015-01-18 02:00:00	80.35343	80.83053	79.62137	2015-01-18 02:00:00	75.01613	75 33435	74.71145
2015-01-18 03:00:00	75.62159	76.48855	74.76641	2015-01-18 03:00:00	80.66001	81.16031	80.17099	2015-01-18 03:00:00	75.00047	75 33435	74.67481
2015-01-18 04:00:00	75.68228	76.47023	74.82137	2015-01-18 04:00:00	80.69277	81.08702	80 22595	2015-01-18 04:00:00	75.00056	75 31603	74.76641
2015-01-18 05:00:00	75 34333	76.30534	74.38168	2015-01-18 05:00:00	80.37921	80.77557	79.74962	2015-01-18 05:00:00	74.98776	75 31603	74.61985
2015-01-18 06:00:00	74.68425	75.88397	73.48397	2015-01-18 06:00:00	79.89177	80.4458	79 05344	2015-01-18 06:00:00	74.96546	75 37099	74.54656
2015-01-18 07:00:00	74 27762	78.55878	71.98168	2015-01-18 07:00:00	79.86423	81.41679	78.79695	2015-01-18 07:00:00	74.98519	77 09313	74.08855
2015-01-18 08:00:00	74 91642	75.93893	73.75878	2015-01-18 08:00:00	79.99256	82.46107	79.16336	2015-01-18 08:00:00	74.94875	75 38931	74.34504
2015-01-18 09:00:00	74 88295	75.82901	73.63053	2015-01-18 09:00:00	79.9228	80.39084	79.47481	2015-01-18 09:00:00	75.07731	76 58015	74.50992
2015-01-18 10:00:00	75.15096	78.54046	73.92366	2015-01-18 10:00:00	79.95171	80.75725	79.40153	2015-01-18 10:00:00	74.99033	75 86565	74.32672
2015-01-18 11:00:00	74 94866	75.71908	73.48397	2015-01-18 11:00:00	80.03865	84.73282	78 88855	2015-01-18 11:00:00	74.99472	75.68244	74.4916
2015-01-18 12:00:00	75 00221	75.68244	74.29008	2015-01-18 12:00:00	79.9635	80.37252	79.47481	2015-01-18 12:00:00	75.00151	75.62748	74.47328
2015-01-18 13:00:00	75 00534	75.77405	74.3084	2015-01-18 13:00:00	79.97149	80.33588	79.47481	2015-01-18 13:00:00	75.00565	75.40763	74.65649
2015-01-18 14:00:00	74 92011	75.88397	68.31756	2015-01-18 14:00:00	79.92443	80.77557	79 27328	2015-01-18 14:00:00	75.00388	75 93893	73.85038
2015-01-18 15:00:00	75 01843	75.95725	73.81374	2015-01-18 15:00:00	79.97554	80.72061	79 23664	2015-01-18 15:00:00	75.00237	75.44427	74.4916
2015-01-18 16:00:00	74 99798	76.15878	73.83206	2015-01-18 16:00:00	79.96741	80.50076	79 38321	2015-01-18 16:00:00	75.00268	75 57252	74.4916
2015-01-18 17:00:00	74 97664	75.97557	73.50229	2015-01-18 17:00:00	79.96002	80.57405	79.45649	2015-01-18 17:00:00	75.00049	75.49924	74.50992
2015-01-18 18:00:00	75 00488	75.77405	73.79542	2015-01-18 18:00:00	79.95499	80.5374	79.41985	2015-01-18 18:00:00	74.99644	75 35267	74.58321
2015-01-18 19:00:00	75 03744	75.81069	73.85038	2015-01-18 19:00:00	79.98961	80.57405	79.41985	2015-01-18 19:00:00	75.00527	75 33435	74.56489
2015-01-18 20:00:00	75 03596	76.32366	73.31908	2015-01-18 20:00:00	79.97208	80.77557	78.79695	2015-01-18 20:00:00	74.9971	75 81069	74.25344
2015-01-18 21:00:00	75 03818	75.97557	73.94198	2015-01-18 21:00:00	79.99448	80.40916	78 92519	2015-01-18 21:00:00	75.00678	75 37099	74.52824
2015-01-18 22:00:00	75.17979	76.47023	73.53893	2015-01-18 22:00:00	79.91403	80.39084	78.11908	2015-01-18 22:00:00	74.97678	75.66412	73.53893
2015-01-18 23:00:00	74 94945	77.03817	65.69771	2015-01-18 23:00:00	80.0015	82.07634	77 88092	2015-01-18 23:00:00	75.00187	76 34198	72.84275
2015-01-19 00:00:00	74.7371	76.2687	73.28244	2015-01-19 00:00:00	80.06957	81.43511	79.43817	2015-01-19 00:00:00	75.02748	75 51756	74.50992
2015-01-19 01:00:00	75 31296	76.61679	73.1542	2015-01-19 01:00:00	80.42888	81.43511	79 36489	2015-01-19 01:00:00	75.01208	75 84733	74.27176
2015-01-19 02:00:00	75.64926	77.11145	73.53893	2015-01-19 02:00:00	80.74197	82.03969	79.74962	2015-01-19 02:00:00	75.00961	75 84733	74.45496
2015-01-19 03:00:00	75.67916	76.8	74.25344	2015-01-19 03:00:00	80.83481	81.5084	80 07939	2015-01-19 03:00:00	75.00085	75.6458	74.56489
2015-01-19 04:00:00	75 34066	76.74504	73.8687	2015-01-19 04:00:00	80.37581	81.21527	79.40153	2015-01-19 04:00:00	74.97156	75 57252	74.36336
2015-01-19 05:00:00	74 55703	78.76031	72.18321	2015-01-19 05:00:00	79.84957	81.0687	78.6687	2015-01-19 05:00:00	74.9804	76 50687	74.21679
2015-01-19 06:00:00	74 89671	76.23206	73.41069	2015-01-19 06:00:00	79.95953	82.51603	78 81527	2015-01-19 06:00:00	75.01512	76.61679	74.01527
2015-01-19 07:00:00	74 93009	76.23206	73.39237	2015-01-19 07:00:00	79.95509	80.66565	79.47481	2015-01-19 07:00:00	74.9916	75.68244	74.25344
2015-01-19 08:00:00	75 04781	76.36031	73.39237	2015-01-19 08:00:00	79.98398	80.5374	79.40153	2015-01-19 08:00:00	75.00783	75 53588	74.38168
2015-01-19 09:00:00	74 98102	76.54351	73.39237	2015-01-19 09:00:00	79.95915	80.70229	79 38321	2015-01-19 09:00:00	74.99476	75.79237	74.36336
2015-01-19 10:00:00	75 00497	76.25038	73.7771	2015-01-19 10:00:00	79.96557	80.5374	79 56641	2015-01-19 10:00:00	74.99914	75 57252	74.47328
2015-01-19 11:00:00	74 99428	76.34198	73.39237	2015-01-19 11:00:00	79.96223	80.61069	79 51145	2015-01-19 11:00:00	74.99668	75.44427	74.47328
2015-01-19 12:00:00	75 00755	76.37863	73.52061	2015-01-19 12:00:00	79.97485	80.55573	79.45649	2015-01-19 12:00:00	74.99938	75.70076	74 3084
2015-01-19 13:00:00	75.0225	76.50687	73.64885	2015-01-19 13:00:00	79.96549	80.59237	79 34656	2015-01-19 13:00:00	75.0127	75.5542	74.43664
2015-01-19 14:00:00	75 02291	76.74504	73.83206	2015-01-19 14:00:00	79.96903	80.46412	79 54809	2015-01-19 14:00:00	75.00456	75.62748	74.38168
2015-01-19 15:00:00	74 97472	76.59847	73.48397	2015-01-19 15:00:00	79.95294	80.5374	79.47481	2015-01-19 15:00:00	74.99441	75 59084	74.38168
2015-01-19 16:00:00	74 98506	77.22137	73.19084	2015-01-19 16:00:00	79.94579	80.4458	79.45649	2015-01-19 16:00:00	74.99651	75 92061	74.36336
2015-01-19 17:00:00	74 97436	76.0855	73.88702	2015-01-19 17:00:00	79.95344	80.46412	79 38321	2015-01-19 17:00:00	74.99503	75.49924	74.4916

	McPhillips				MacLean				Hurst		
Date	Average	Maximum	Minimum	Date	Average	Maximum	Minimum	Date	Average	Maximum	Minimum
2015-01-19 18:00:00	74 98846	76.0855	73.8687	2015-01-19 18:00:00	79.96471	80.68397	79 36489	2015-01-19 18:00:00	74.99965	75.5542	74.4
2015-01-19 19:00:00	75.0301	76.28702	73.52061	2015-01-19 19:00:00	79.98662	80.68397	79 30992	2015-01-19 19:00:00	75.00493	75.66412	74.38168
2015-01-19 20:00:00	75 03332	76.81832	73.3374	2015-01-19 20:00:00	79.97788	80.62901	79.43817	2015-01-19 20:00:00	75.00443	75 57252	74.4
2015-01-19 21:00:00	75 03156	76.65344	73.70382	2015-01-19 21:00:00	79.97889	80.3542	79 36489	2015-01-19 21:00:00	75.00434	75.60916	74.34504
2015-01-19 22:00:00	75.15577	76.25038	73.61221	2015-01-19 22:00:00	79.98514	80.46412	79 34656	2015-01-19 22:00:00	74.95568	75.66412	73.53893
2015-01-19 23:00:00	75.18214	76.74504	64.52519	2015-01-19 23:00:00	79.91405	82.09466	78 30229	2015-01-19 23:00:00	74.99217	76.45191	72.7145
2015-01-20 00:00:00	74.67947	76.28702	72.56794	2015-01-20 00:00:00	80.0134	80.9771	78 94351	2015-01-20 00:00:00	75.02889	75 90229	74.07023
2015-01-20 01:00:00	75 24207	76.47023	73.72214	2015-01-20 01:00:00	80.16992	81.03206	79.45649	2015-01-20 01:00:00	75.02243	75.66412	74.60153
2015-01-20 02:00:00	75 54255	76.98321	73.66718	2015-01-20 02:00:00	80.51694	81.10534	79 54809	2015-01-20 02:00:00	75.00038	75.62748	74.4
2015-01-20 03:00:00	75.65824	77.09313	73.79542	2015-01-20 03:00:00	80.60353	81.52672	79.49313	2015-01-20 03:00:00	75.00754	75.7374	74.29008
2015-01-20 04:00:00	75 32792	77.03817	73.88702	2015-01-20 04:00:00	80.21576	81.14198	79.2916	2015-01-20 04:00:00	74.98119	75 84733	74.29008
2015-01-20 05:00:00	74.78028	78.46718	72.21985	2015-01-20 05:00:00	79.83055	81.16031	78.61374	2015-01-20 05:00:00	74.97283	76.8916	74.25344
2015-01-20 06:00:00	74 89039	76.54351	73.41069	2015-01-20 06:00:00	79.94737	82.60763	78.6687	2015-01-20 06:00:00	75.01766	76.65344	74.19847
2015-01-20 07:00:00	74 95865	76.23206	73.63053	2015-01-20 07:00:00	79.96765	80.68397	79.16336	2015-01-20 07:00:00	75.00563	75.62748	74.4
2015-01-20 08:00:00	75 03754	76.43359	73.30076	2015-01-20 08:00:00	79.97109	81.36183	78.70534	2015-01-20 08:00:00	75.01003	75.71908	74.43664
2015-01-20 09:00:00	74.9819	76.14046	73.63053	2015-01-20 09:00:00	79.97393	81.01374	79 52977	2015-01-20 09:00:00	74.99479	75.71908	74.47328
2015-01-20 10:00:00	75 00169	78.52214	69.85649	2015-01-20 10:00:00	79.96793	80.62901	79 38321	2015-01-20 10:00:00	74.91582	76.12214	72.86107
2015-01-20 11:00:00	75 00362	76.32366	73.72214	2015-01-20 11:00:00	79.94949	80.59237	79.40153	2015-01-20 11:00:00	74.99522	75 81069	74.36336
2015-01-20 12:00:00	74 99962	76.96489	72.56794	2015-01-20 12:00:00	79.97039	80.72061	79.16336	2015-01-20 12:00:00	75.00169	76.19542	73.52061
2015-01-20 13:00:00	75 00617	76.61679	73.3374	2015-01-20 13:00:00	79.97134	80.55573	79.47481	2015-01-20 13:00:00	75.00604	75.79237	74.36336
2015-01-20 14:00:00	75 04307	76.28702	73.48397	2015-01-20 14:00:00	79.96555	80.59237	79.41985	2015-01-20 14:00:00	75.01096	76.0855	74.19847
2015-01-20 15:00:00	74 99379	76.01221	73.74046	2015-01-20 15:00:00	79.96232	80.42748	79 30992	2015-01-20 15:00:00	74.99267	75 86565	74.19847
2015-01-20 16:00:00	74 97347	76.1771	73.42901	2015-01-20 16:00:00	79.96168	80.64733	79 32824	2015-01-20 16:00:00	74.98689	75 93893	74.01527
2015-01-20 17:00:00	74 96961	76.10382	73.6855	2015-01-20 17:00:00	79.94385	80.61069	79 09008	2015-01-20 17:00:00	74.9495	75 81069	74.27176
2015-01-20 18:00:00	75 00283	76.01221	73.53893	2015-01-20 18:00:00	79.96788	80.51908	79 32824	2015-01-20 18:00:00	74.95099	75.70076	73.85038
2015-01-20 19:00:00	75 03714	76.15878	73.61221	2015-01-20 19:00:00	79.97639	80.57405	79.16336	2015-01-20 19:00:00	74.97823	75 93893	74.01527
2015-01-20 20:00:00	75 03464	76.14046	73.74046	2015-01-20 20:00:00	79.97807	80.66565	79.40153	2015-01-20 20:00:00	75.01257	75 59084	74.25344
2015-01-20 21:00:00	75 02979	76.14046	73.83206	2015-01-20 21:00:00	79.97542	80.59237	79.62137	2015-01-20 21:00:00	75.00243	75.79237	74.34504
2015-01-20 22:00:00	75.11702	76.78168	73.97863	2015-01-20 22:00:00	79.98744	80.40916	79 52977	2015-01-20 22:00:00	75.02927	75.60916	74.23511
2015-01-20 23:00:00	74.5139	76.85496	67.25496	2015-01-20 23:00:00	79.94136	82.1313	77 80763	2015-01-20 23:00:00	75.00698	76.69008	72.67786
2015-01-21 00:00:00	74.5519	75.92061	72.27481	2015-01-21 00:00:00	80.01273	80.62901	79 21832	2015-01-21 00:00:00	75.02642	75.60916	74.52824
2015-01-21 01:00:00	75.10187	76.98321	72.95267	2015-01-21 01:00:00	80.07779	81.14198	78.77863	2015-01-21 01:00:00	75.00442	75 88397	74.25344
2015-01-21 02:00:00	75 33671	76.7084	73.30076	2015-01-21 02:00:00	80.35988	81.23359	79.49313	2015-01-21 02:00:00	74.99755	75.77405	74.14351
2015-01-21 03:00:00	75.48209	77.44122	73.63053	2015-01-21 03:00:00	80.40983	81.74656	79 38321	2015-01-21 03:00:00	75.01672	76.1771	74.19847
2015-01-21 04:00:00	75.10431	76.61679	73.39237	2015-01-21 04:00:00	80.10681	81.28855	78 99847	2015-01-21 04:00:00	74.98211	75.77405	74.29008
2015-01-21 05:00:00	73 97582	78.37557	71.32214	2015-01-21 05:00:00	79.85208	81.83817	78 55878	2015-01-21 05:00:00	74.98646	77 01985	74.12519
2015-01-21 06:00:00	74 87859	76.01221	73.35573	2015-01-21 06:00:00	79.88001	82.79084	78.0458	2015-01-21 06:00:00	75.01372	76.72672	74.08855
2015-01-21 07:00:00	75.10278	78.43053	73.66718	2015-01-21 07:00:00	79.96982	80.79389	79 32824	2015-01-21 07:00:00	74.9924	75 93893	74.32672
2015-01-21 08:00:00	74 89594	76.36031	68.72061	2015-01-21 08:00:00	79.98438	80.57405	79.2916	2015-01-21 08:00:00	75.00619	75 59084	73.90534
2015-01-21 09:00:00	74 95606	76.36031	73.52061	2015-01-21 09:00:00	79.95786	80.48244	79 54809	2015-01-21 09:00:00	74.99484	75.68244	74.41832
2015-01-21 10:00:00	75 01741	76.30534	73.7771	2015-01-21 10:00:00	79.97297	80.57405	79.45649	2015-01-21 10:00:00	75.01103	75.60916	74.4
2015-01-21 11:00:00	75 00226	76.34198	73.7771	2015-01-21 11:00:00	79.95964	80.48244	79.49313	2015-01-21 11:00:00	74.99564	75.70076	74.45496
2015-01-21 12:00:00	75.0234	76.48855	73.31908	2015-01-21 12:00:00	79.96714	80.4458	79.45649	2015-01-21 12:00:00	74.99416	75.60916	74.45496
2015-01-21 13:00:00	74 99903	76.58015	73.42901	2015-01-21 13:00:00	79.97061	80.42748	79.47481	2015-01-21 13:00:00	75.00267	75.7374	74 3084
2015-01-21 14:00:00	75 04165	76.32366	73.3374	2015-01-21 14:00:00	79.96404	80.51908	79.43817	2015-01-21 14:00:00	75.00488	75.7374	74.18015
2015-01-21 15:00:00	74 97853	76.83664	73.72214	2015-01-21 15:00:00	79.95553	80.4458	79 56641	2015-01-21 15:00:00	75.00068	75 59084	74.45496
2015-01-21 16:00:00	74 99939	76.06718	73.90534	2015-01-21 16:00:00	79.95429	80.51908	79.49313	2015-01-21 16:00:00	74.99471	75 59084	74.52824
2015-01-21 17:00:00	74 95631	76.25038	73.30076	2015-01-21 17:00:00	79.93774	80.81221	79 32824	2015-01-21 17:00:00	74.99597	75.60916	74.32672
2015-01-21 18:00:00	75 01695	76.12214	73.22748	2015-01-21 18:00:00	79.96459	80.42748	79.49313	2015-01-21 18:00:00	75.00195	75.7374	74.32672
2015-01-21 19:00:00	75.0296	76.14046	74.07023	2015-01-21 19:00:00	79.97705	80.4458	79 36489	2015-01-21 19:00:00	75.00175	75 51756	74.47328
2015-01-21 20:00:00	75 01435	76.48855	73.59389	2015-01-21 20:00:00	79.97595	80.42748	79.45649	2015-01-21 20:00:00	75.00364	75.66412	74.47328
2015-01-21 21:00:00	75 03344	76.23206	73.79542	2015-01-21 21:00:00	79.97176	80.46412	79.47481	2015-01-21 21:00:00	75.00475	75.5542	74.4916
2015-01-21 22:00:00	75 09453	76.15878	73.75878	2015-01-21 22:00:00	79.99702	80.4458	79 34656	2015-01-21 22:00:00	74.9501	75.6458	73.44733
2015-01-21 23:00:00	75.75617	77.20305	70.18626	2015-01-21 23:00:00	79.94381	80.62901	78.70534	2015-01-21 23:00:00	75.03079	75.71908	73.44733
2015-01-22 00:00:00	74 50104	76.90992	66.35725	2015-01-22 00:00:00	80.00374	82.05802	77.9542	2015-01-22 00:00:00	75.00127	76.74504	72.40305
2015-01-22 01:00:00	75.17651	77.29466	72.87939	2015-01-22 01:00:00	80.11642	81.27023	78.46718	2015-01-22 01:00:00	75.01715	76 25038	74.12519
2015-01-22 02:00:00	75 58545	76.7084	74.14351	2015-01-22 02:00:00	80.46201	80.94046	79 89618	2015-01-22 02:00:00	75.005	75 33435	74.65649
2015-01-22 03:00:00	75 05774	76.63511	70.57099	2015-01-22 03:00:00	80.36916	81.56336	77 91756	2015-01-22 03:00:00	74.98627	75 88397	73.41069
2015-01-22 04:00:00	74 07681	75.04122	72.6229	2015-01-22 04:00:00	79.91723	80.5374	79 25496	2015-01-22 04:00:00	74.97363	75.42595	74.47328
2015-01-22 05:00:00	73 53825	78.4855	70.03969	2015-01-22 05:00:00	79.83216	81.32519	78 98015	2015-01-22 05:00:00	74.97598	77.11145	74.47328
2015-01-22 06:00:00	74 87923	75.97557	73.66718	2015-01-22 06:00:00	79.95007	82.77252	78.61374	2015-01-22 06:00:00	75.02302	76 92824	74.36336
2015-01-22 07:00:00	75 00137	78.26565	69.19695	2015-01-22 07:00:00	79.95185	80.57405	79 09008	2015-01-22 07:00:00	74.98605	75.66412	74.10687
2015-01-22 08:00:00	75 00601	76.65344	73.53893	2015-01-22 08:00:00	79.99993	80.8855	79.43817	2015-01-22 08:00:00	75.02077	75 81069	74 3084
2015-01-22 09:00:00	74.9737	76.0855	73.42901	2015-01-22 09:00:00	79.95725	80.62901	79.41985	2015-01-22 09:00:00	74.99346	75 51756	74.43664
2015-01-22 10:00:00	75 00206	76.47023	73.48397	2015-01-22 10:00:00	79.96849	80.51908	79.49313	2015-01-22 10:00:00	75.00248	75.66412	74.47328
2015-01-22 11:00:00	75 02167	76.32366	73.72214	2015-01-22 11:00:00	79.96784	80.5374	79.47481	2015-01-22 11:00:00	74.99836	75.70076	74.34504
2015-01-22 12:00:00	74 99371	76.19542	73.46565	2015-01-22 12:00:00	79.965	80.46412	79.45649	2015-01-22 12:00:00	74.99971	75.62748	74.47328
2015-01-22 13:00:00	75 02163	76.61679	73.50229	2015-01-22 13:00:00	79.97647	80.51908	79 34656	2015-01-22 13:00:00	75.00303	75 51756	74.43664
2015-01-22 14:00:00	75.0112	76.61679	73.19084	2015-01-22 14:00:00	79.9716	80.66565	79 32824	2015-01-22 14:00:00	75.00045	75 84733	74.21679
2015-01-22 15:00:00	74 99871	76.12214	73.74046	2015-01-22 15:00:00	79.95799	80.64733	79.2916	2015-01-22 15:00:00	74.9929	75.60916	74.43664
2015-01-22 16:00:00	74 98536	76.12214	73.75878	2015-01-22 16:00:00	79.95783	80.48244	79.40153	2015-01-22 16:00:00	74.9918	75.4626	74.56489
2015-01-22 17:00:00	74 97878	76.03053	73.59389	2015-01-22 17:00:00	79.94431	80.57405	79 30992	2015-01-22 17:00:00	74.99565	75.48092	74.52824

	McPhillips				MacLean				Hurst		
Date	Average	Maximum	Minimum	Date	Average	Maximum	Minimum	Date	Average	Maximum	Minimum
2015-01-22 18:00:00	74.9945	76.1771	73.63053	2015-01-22 18:00:00	79.96068	80.51908	79.16336	2015-01-22 18:00:00	74.99847	75 53588	74.47328
2015-01-22 19:00:00	75 03471	76.8	73.70382	2015-01-22 19:00:00	79.97834	80.79389	79 23664	2015-01-22 19:00:00	75.00497	75.70076	74.38168
2015-01-22 20:00:00	75 02263	76.15878	73.74046	2015-01-22 20:00:00	79.97535	80.51908	79.41985	2015-01-22 20:00:00	74.9996	75 51756	74.38168
2015-01-22 21:00:00	75 03911	76.12214	74.01527	2015-01-22 21:00:00	79.97354	80.51908	79 25496	2015-01-22 21:00:00	75.00072	75.42595	74.4916
2015-01-22 22:00:00	75.11556	76.34198	73.81374	2015-01-22 22:00:00	79.98797	80.4458	79.63969	2015-01-22 22:00:00	74.96322	75 59084	73.66718
2015-01-22 23:00:00	74.61028	76.43359	67.40153	2015-01-22 23:00:00	79.97613	80.57405	79 36489	2015-01-22 23:00:00	74.99699	76 39695	72.69618
2015-01-23 00:00:00	74.68419	76.15878	73.19084	2015-01-23 00:00:00	79.97955	80.37252	79 58473	2015-01-23 00:00:00	75.03019	75.66412	74.18015
2015-01-23 01:00:00	75 28885	76.2687	74.19847	2015-01-23 01:00:00	80.00678	80.48244	79 36489	2015-01-23 01:00:00	75.01428	75 38931	74.47328
2015-01-23 02:00:00	75.63214	76.52519	74.74809	2015-01-23 02:00:00	80.45075	81.01374	79 80458	2015-01-23 02:00:00	75.00972	75 31603	74.71145
2015-01-23 03:00:00	75.69392	76.56183	74.4916	2015-01-23 03:00:00	80.55573	81.23359	79.78626	2015-01-23 03:00:00	74.99259	75.42595	74.54656
2015-01-23 04:00:00	75 39946	76.45191	74.34504	2015-01-23 04:00:00	80.18778	80.99542	79.43817	2015-01-23 04:00:00	74.98238	75 35267	74.63817
2015-01-23 05:00:00	75.4735	78.98015	73.66718	2015-01-23 05:00:00	79.81573	81.10534	78 94351	2015-01-23 05:00:00	74.97612	76.45191	74.36336
2015-01-23 06:00:00	74 92456	76.48855	73.57557	2015-01-23 06:00:00	79.95883	82.73588	78.77863	2015-01-23 06:00:00	75.02166	76.78168	74.29008
2015-01-23 07:00:00	74 92262	75.99389	73.57557	2015-01-23 07:00:00	79.95505	80.62901	79.47481	2015-01-23 07:00:00	74.99382	75.4626	74.61985
2015-01-23 08:00:00	75 05798	76.32366	73.99695	2015-01-23 08:00:00	79.98711	80.37252	79 51145	2015-01-23 08:00:00	75.00788	75.49924	74.56489
2015-01-23 09:00:00	74 98822	76.19542	73.99695	2015-01-23 09:00:00	79.96167	80.48244	79.43817	2015-01-23 09:00:00	74.99978	75.68244	74.58321
2015-01-23 10:00:00	75 00091	76.8916	73.63053	2015-01-23 10:00:00	79.97445	80.61069	79.43817	2015-01-23 10:00:00	75.00317	75.62748	74 3084
2015-01-23 11:00:00	74 98735	76.74504	73.79542	2015-01-23 11:00:00	79.96173	80.42748	79.45649	2015-01-23 11:00:00	74.99159	75.62748	74.41832
2015-01-23 12:00:00	75 00463	76.25038	73.41069	2015-01-23 12:00:00	79.97052	80.46412	79.47481	2015-01-23 12:00:00	75.0025	75.71908	74.56489
2015-01-23 13:00:00	75 01437	76.06718	73.20916	2015-01-23 13:00:00	79.96417	80.39084	79 56641	2015-01-23 13:00:00	75.00134	75.4626	74.52824
2015-01-23 14:00:00	75 01358	76.1771	73.8687	2015-01-23 14:00:00	79.9628	80.40916	79 52977	2015-01-23 14:00:00	75.0026	75.48092	74.47328
2015-01-23 15:00:00	74 98386	76.1771	73.39237	2015-01-23 15:00:00	79.95403	80.59237	79.43817	2015-01-23 15:00:00	74.99941	75.48092	74.43664
2015-01-23 16:00:00	74 99611	76.47023	73.61221	2015-01-23 16:00:00	79.95271	80.42748	79 52977	2015-01-23 16:00:00	74.99531	75 59084	74.45496
2015-01-23 17:00:00	74 97445	76.48855	73.81374	2015-01-23 17:00:00	79.96162	80.51908	79.41985	2015-01-23 17:00:00	74.99921	75.7374	74.58321
2015-01-23 18:00:00	75 02642	76.0855	73.92366	2015-01-23 18:00:00	79.96471	80.33588	79.40153	2015-01-23 18:00:00	74.99556	75 38931	74.65649
2015-01-23 19:00:00	75 01665	76.0855	73.79542	2015-01-23 19:00:00	79.96977	80.51908	79 56641	2015-01-23 19:00:00	74.99534	75.5542	74.50992
2015-01-23 20:00:00	75 03177	76.45191	73.72214	2015-01-23 20:00:00	79.96489	80.4458	79 58473	2015-01-23 20:00:00	75.00562	75 38931	74.61985
2015-01-23 21:00:00	75 00921	76.56183	73.11756	2015-01-23 21:00:00	79.98141	80.50076	79 25496	2015-01-23 21:00:00	74.93592	75.77405	73.09924
2015-01-23 22:00:00	75.11392	76.0855	73.55725	2015-01-23 22:00:00	79.97918	80.51908	79.47481	2015-01-23 22:00:00	75.01021	75 81069	74.16183
2015-01-23 23:00:00	73.6937	76.1771	67.25496	2015-01-23 23:00:00	79.97128	80.50076	79.47481	2015-01-23 23:00:00	74.98875	76.0855	72.23817
2015-01-24 00:00:00	73 84285	75.29771	71.21221	2015-01-24 00:00:00	79.91357	80.4458	79.2916	2015-01-24 00:00:00	75.02282	75 86565	74.18015
2015-01-24 01:00:00	74.61061	75.95725	72.97099	2015-01-24 01:00:00	79.73029	80.5374	78 85191	2015-01-24 01:00:00	75.01838	75.44427	74.4916
2015-01-24 02:00:00	75.14452	76.1771	73.96031	2015-01-24 02:00:00	80.20913	80.83053	79.49313	2015-01-24 02:00:00	75.01974	75.42595	74.67481
2015-01-24 03:00:00	75 39115	76.39695	74.3084	2015-01-24 03:00:00	80.44964	81.05038	79.9145	2015-01-24 03:00:00	75.00618	75.42595	74.61985
2015-01-24 04:00:00	75.40075	76.32366	74.01527	2015-01-24 04:00:00	80.50913	81.14198	79.9145	2015-01-24 04:00:00	74.99482	75.49924	74.54656
2015-01-24 05:00:00	74 92502	76.04885	73.90534	2015-01-24 05:00:00	80.06665	80.75725	79.43817	2015-01-24 05:00:00	74.98246	75 35267	74.63817
2015-01-24 06:00:00	74 00423	75.66412	72.12824	2015-01-24 06:00:00	79.89953	80.39084	79.18168	2015-01-24 06:00:00	74.96341	75 33435	74.36336
2015-01-24 07:00:00	74 24873	77.93588	71.21221	2015-01-24 07:00:00	79.87666	82.25954	78 90687	2015-01-24 07:00:00	74.98219	77 01985	74.34504
2015-01-24 08:00:00	74 88946	75.99389	73.66718	2015-01-24 08:00:00	80.01305	82.91908	79.2916	2015-01-24 08:00:00	75.04663	76 90992	74.07023
2015-01-24 09:00:00	74 87181	75.7374	73.88702	2015-01-24 09:00:00	79.93177	80.51908	79.40153	2015-01-24 09:00:00	74.99979	75 38931	74.63817
2015-01-24 10:00:00	75.18688	78.33893	74.27176	2015-01-24 10:00:00	79.94704	80.59237	79 21832	2015-01-24 10:00:00	74.9961	76 06718	74.10687
2015-01-24 11:00:00	74 99148	75.97557	74.27176	2015-01-24 11:00:00	79.97972	80.48244	79.49313	2015-01-24 11:00:00	75.00221	75.40763	74.4916
2015-01-24 12:00:00	75 00239	75.79237	73.94198	2015-01-24 12:00:00	79.98096	80.48244	79.49313	2015-01-24 12:00:00	74.99458	75.48092	74.65649
2015-01-24 13:00:00	74 86621	75.77405	70.77252	2015-01-24 13:00:00	79.98331	80.40916	79.40153	2015-01-24 13:00:00	75.01213	75.6458	74.23511
2015-01-24 14:00:00	75 01843	75.92061	74.03359	2015-01-24 14:00:00	79.97494	80.50076	79 54809	2015-01-24 14:00:00	74.99815	75.44427	74.4916
2015-01-24 15:00:00	75 02232	76.14046	74.25344	2015-01-24 15:00:00	79.96637	80.42748	79.49313	2015-01-24 15:00:00	75.0042	75.44427	74.60153
2015-01-24 16:00:00	75 01053	75.95725	74.07023	2015-01-24 16:00:00	79.96219	80.24427	79 56641	2015-01-24 16:00:00	74.99757	75.40763	74.56489
2015-01-24 17:00:00	75 00197	75.99389	73.96031	2015-01-24 17:00:00	79.95825	80.61069	79 52977	2015-01-24 17:00:00	74.99867	75 51756	74.43664
2015-01-24 18:00:00	75 02452	75.92061	73.90534	2015-01-24 18:00:00	79.96755	80.50076	79 56641	2015-01-24 18:00:00	74.99869	75 37099	74.60153
2015-01-24 19:00:00	75 04076	75.97557	74.21679	2015-01-24 19:00:00	79.98157	80.42748	79 54809	2015-01-24 19:00:00	75.00499	75 37099	74.65649
2015-01-24 20:00:00	75 02146	76.19542	73.79542	2015-01-24 20:00:00	79.97071	80.37252	79.60305	2015-01-24 20:00:00	74.93468	75 95725	73.08092
2015-01-24 21:00:00	75 01993	75.88397	74.16183	2015-01-24 21:00:00	79.9807	80.29924	79.67634	2015-01-24 21:00:00	75.00932	75.5542	74.60153
2015-01-24 22:00:00	75 09338	75.93893	74.12519	2015-01-24 22:00:00	79.97343	80.2626	79.67634	2015-01-24 22:00:00	75.02368	75 53588	74.61985
2015-01-24 23:00:00	75.64469	76.54351	74.60153	2015-01-24 23:00:00	79.97991	80.3542	79.63969	2015-01-24 23:00:00	75.02016	75.5542	74.4916
2015-01-25 00:00:00	75 54782	77.01985	65.3313	2015-01-25 00:00:00	79.97073	80.64733	79 23664	2015-01-25 00:00:00	74.98447	76.14046	73.31908
2015-01-25 01:00:00	74.43827	75.51756	73.2458	2015-01-25 01:00:00	79.98053	80.29924	79.60305	2015-01-25 01:00:00	75.01883	75.48092	74.58321
2015-01-25 02:00:00	74.9017	76.01221	73.88702	2015-01-25 02:00:00	80.17332	80.68397	79.71298	2015-01-25 02:00:00	75.01717	75 35267	74.67481
2015-01-25 03:00:00	75 32121	76.23206	74.60153	2015-01-25 03:00:00	80.54647	81.03206	80 02443	2015-01-25 03:00:00	75.00421	75 27939	74.60153
2015-01-25 04:00:00	75 38125	76.12214	74.25344	2015-01-25 04:00:00	80.64985	81.03206	80 04275	2015-01-25 04:00:00	74.99965	75 35267	74.72977
2015-01-25 05:00:00	75 08856	76.2687	74.18015	2015-01-25 05:00:00	80.38048	81.19695	79.8229	2015-01-25 05:00:00	74.98627	75 38931	74.29008
2015-01-25 06:00:00	74 25206	75.44427	72.82443	2015-01-25 06:00:00	79.87857	80.2626	79.45649	2015-01-25 06:00:00	74.96565	75 37099	74.50992
2015-01-25 07:00:00	73 87671	78.21069	71.45038	2015-01-25 07:00:00	79.85947	81.94809	78.76031	2015-01-25 07:00:00	74.98611	76 92824	74.18015
2015-01-25 08:00:00	74.8976	76.04885	73.81374	2015-01-25 08:00:00	79.98955	82.86412	79 09008	2015-01-25 08:00:00	74.95753	75.4626	74.08855
2015-01-25 09:00:00	75 04836	78.32061	73.20916	2015-01-25 09:00:00	79.93102	80.70229	79 30992	2015-01-25 09:00:00	75.0773	76 81832	74.52824
2015-01-25 10:00:00	75 00127	75.95725	74.23511	2015-01-25 10:00:00	79.95642	80.37252	79 51145	2015-01-25 10:00:00	74.98711	75.48092	74.56489
2015-01-25 11:00:00	74 99297	75.66412	74.07023	2015-01-25 11:00:00	79.96331	80.50076	79.47481	2015-01-25 11:00:00	75.00461	75.4626	74.54656
2015-01-25 12:00:00	75 00191	75.92061	74.14351	2015-01-25 12:00:00	79.97087	80.39084	79 56641	2015-01-25 12:00:00	74.99951	75.44427	74.63817
2015-01-25 13:00:00	75 00524	75.77405	72.89771	2015-01-25 13:00:00	79.98817	80.40916	79.45649	2015-01-25 13:00:00	75.00233	75 38931	74.65649
2015-01-25 14:00:00	74 88489	76.14046	68.00611	2015-01-25 14:00:00	79.96998	80.42748	79.2	2015-01-25 14:00:00	75.01135	75.77405	74.23511
2015-01-25 15:00:00	75 02036	75.79237	73.92366	2015-01-25 15:00:00	79.9584	80.50076	79 51145	2015-01-25 15:00:00	75.00261	75.40763	74.47328
2015-01-25 16:00:00	75.0002	75.84733	74.10687	2015-01-25 16:00:00	79.96897	80.4458	79 58473	2015-01-25 16:00:00	75.00141	75 38931	74.54656
2015-01-25 17:00:00	74 97785	75.79237	74.05191	2015-01-25 17:00:00	79.95137	80.5374	79.41985	2015-01-25 17:00:00	74.99634	75 37099	74.50992

	McPhillips				MacLean				Hurst		
Date	Average	Maximum	Minimum	Date	Average	Maximum	Minimum	Date	Average	Maximum	Minimum
2015-01-25 18:00:00	75 01109	75.77405	73.92366	2015-01-25 18:00:00	79.97321	80.42748	79.40153	2015-01-25 18:00:00	75.00076	75.40763	74.63817
2015-01-25 19:00:00	75 02388	75.92061	74.14351	2015-01-25 19:00:00	79.97188	80.4458	79 30992	2015-01-25 19:00:00	75.00561	75.44427	74.63817
2015-01-25 20:00:00	75 05394	76.1771	74.01527	2015-01-25 20:00:00	79.98761	80.42748	79 54809	2015-01-25 20:00:00	75.00298	75.4626	74.58321
2015-01-25 21:00:00	75 04819	75.82901	73.88702	2015-01-25 21:00:00	79.99087	80.39084	79.60305	2015-01-25 21:00:00	74.94364	75.42595	73.39237
2015-01-25 22:00:00	75.10626	76.1771	73.8687	2015-01-25 22:00:00	79.98515	80.4458	79 21832	2015-01-25 22:00:00	75.02541	75.48092	74 3084
2015-01-25 23:00:00	75.9457	77.23969	74.41832	2015-01-25 23:00:00	79.99152	80.39084	79.62137	2015-01-25 23:00:00	75.02917	75.62748	74.03359
2015-01-26 00:00:00	75 97479	77.22137	66.1374	2015-01-26 00:00:00	80.00526	82.07634	77.3313	2015-01-26 00:00:00	74.98331	75 93893	73.52061
2015-01-26 01:00:00	74 98567	76.25038	73.26412	2015-01-26 01:00:00	80.23413	80.90382	79.41985	2015-01-26 01:00:00	75.0157	75 59084	74.58321
2015-01-26 02:00:00	75 36302	76.21374	74.41832	2015-01-26 02:00:00	80.55871	80.92214	79 87786	2015-01-26 02:00:00	75.00948	75.48092	74.60153
2015-01-26 03:00:00	75.49093	76.34198	74.18015	2015-01-26 03:00:00	80.64016	81.08702	80.18931	2015-01-26 03:00:00	74.99913	75 35267	74.58321
2015-01-26 04:00:00	75 01299	76.0855	73.17252	2015-01-26 04:00:00	80.20535	80.81221	79.2916	2015-01-26 04:00:00	74.9705	75.5542	74.4916
2015-01-26 05:00:00	74.6869	79.23664	72.54962	2015-01-26 05:00:00	79.83605	81.91145	78 87023	2015-01-26 05:00:00	74.97568	76 90992	74.29008
2015-01-26 06:00:00	74 86744	75.93893	73.00763	2015-01-26 06:00:00	79.99479	82.3145	78.17405	2015-01-26 06:00:00	75.02775	76.8916	74.18015
2015-01-26 07:00:00	75 07836	78.19237	73.79542	2015-01-26 07:00:00	79.97121	80.42748	79.47481	2015-01-26 07:00:00	74.99875	75 57252	74.45496
2015-01-26 08:00:00	74.8792	76.2687	68.95878	2015-01-26 08:00:00	79.98898	80.62901	79 51145	2015-01-26 08:00:00	75.00711	75.79237	73.83206
2015-01-26 09:00:00	74 97362	76.7084	73.61221	2015-01-26 09:00:00	79.95511	82.16794	76 98321	2015-01-26 09:00:00	74.99781	75.4626	74.47328
2015-01-26 10:00:00	74 98376	76.28702	73.8687	2015-01-26 10:00:00	79.97003	80.72061	78 98015	2015-01-26 10:00:00	74.99745	75 53588	74.52824
2015-01-26 11:00:00	74 98561	75.86565	73.99695	2015-01-26 11:00:00	79.95483	80.57405	79.47481	2015-01-26 11:00:00	74.99461	75.49924	74.56489
2015-01-26 12:00:00	75 01667	76.48855	73.61221	2015-01-26 12:00:00	79.97887	80.92214	79 21832	2015-01-26 12:00:00	74.99835	75.68244	74.41832
2015-01-26 13:00:00	75.0298	76.04885	74.14351	2015-01-26 13:00:00	79.97692	80.39084	79.41985	2015-01-26 13:00:00	75.00499	75.4626	74.50992
2015-01-26 14:00:00	75 00008	76.94656	73.30076	2015-01-26 14:00:00	79.96864	81.10534	78 98015	2015-01-26 14:00:00	74.93507	75.68244	73.39237
2015-01-26 15:00:00	74 99276	76.30534	73.26412	2015-01-26 15:00:00	79.95646	80.68397	79 25496	2015-01-26 15:00:00	74.99005	76 06718	73.99695
2015-01-26 16:00:00	75 01783	76.30534	73.19084	2015-01-26 16:00:00	79.95481	80.95878	79.12672	2015-01-26 16:00:00	74.98731	75 92061	74.14351
2015-01-26 17:00:00	74.9415	76.2687	73.83206	2015-01-26 17:00:00	79.95236	80.4458	79.47481	2015-01-26 17:00:00	75.08078	76 52519	74.34504
2015-01-26 18:00:00	75 02431	75.88397	73.85038	2015-01-26 18:00:00	79.96141	80.40916	79 56641	2015-01-26 18:00:00	74.9925	75 38931	74.45496
2015-01-26 19:00:00	75 05176	76.45191	73.70382	2015-01-26 19:00:00	79.98191	80.5374	79 52977	2015-01-26 19:00:00	75.00699	75 53588	74.45496
2015-01-26 20:00:00	75 02475	75.93893	73.61221	2015-01-26 20:00:00	79.97771	80.55573	79.45649	2015-01-26 20:00:00	74.99593	75.5542	74.54656
2015-01-26 21:00:00	75 03113	76.10382	73.83206	2015-01-26 21:00:00	79.98016	80.61069	79 25496	2015-01-26 21:00:00	74.97323	75 53588	73.30076
2015-01-26 22:00:00	75 08917	76.14046	73.6855	2015-01-26 22:00:00	79.99355	80.59237	77 31298	2015-01-26 22:00:00	74.99263	75.6458	73.50229
2015-01-26 23:00:00	75.76764	76.74504	73.35573	2015-01-26 23:00:00	79.92258	80.84885	75.62748	2015-01-26 23:00:00	75.03375	76 06718	74.05191
2015-01-27 00:00:00	74 20868	76.92824	68.75725	2015-01-27 00:00:00	79.99551	81.17863	78 52214	2015-01-27 00:00:00	74.99641	76 03053	73.48397
2015-01-27 01:00:00	74 85086	75.92061	72.87939	2015-01-27 01:00:00	80.07581	80.95878	78 81527	2015-01-27 01:00:00	75.01177	75.6458	74.32672
2015-01-27 02:00:00	75 24268	76.36031	73.64885	2015-01-27 02:00:00	80.34051	80.8855	79.7313	2015-01-27 02:00:00	75.01132	75 37099	74.54656
2015-01-27 03:00:00	75 35697	76.61679	73.48397	2015-01-27 03:00:00	80.47702	81.49008	79.47481	2015-01-27 03:00:00	74.9965	75 82901	74.18015
2015-01-27 04:00:00	74 97954	76.14046	72.47634	2015-01-27 04:00:00	80.15441	80.79389	79.12672	2015-01-27 04:00:00	74.98038	75 59084	74.4916
2015-01-27 05:00:00	73.79119	78.85191	71.08397	2015-01-27 05:00:00	79.83918	82.24122	78 52214	2015-01-27 05:00:00	74.97536	77 22137	74.14351
2015-01-27 06:00:00	74 87337	76.39695	73.52061	2015-01-27 06:00:00	79.9959	83.02901	78 55878	2015-01-27 06:00:00	75.02613	76.65344	74.07023
2015-01-27 07:00:00	75.10522	78.43053	73.64885	2015-01-27 07:00:00	79.95916	80.40916	79.41985	2015-01-27 07:00:00	74.99763	75 59084	74.47328
2015-01-27 08:00:00	74 88371	76.15878	68.37252	2015-01-27 08:00:00	79.98816	80.70229	79.41985	2015-01-27 08:00:00	75.00819	75.60916	74.18015
2015-01-27 09:00:00	74 97887	76.43359	73.50229	2015-01-27 09:00:00	79.96777	80.70229	79 32824	2015-01-27 09:00:00	75.00256	75.6458	74.4
2015-01-27 10:00:00	74 99202	76.56183	73.3374	2015-01-27 10:00:00	79.97023	80.62901	79.40153	2015-01-27 10:00:00	74.98825	75.66412	74.25344
2015-01-27 11:00:00	75 03295	76.30534	73.17252	2015-01-27 11:00:00	79.96741	80.59237	79 21832	2015-01-27 11:00:00	75.00677	75.70076	74.25344
2015-01-27 12:00:00	74 99134	76.12214	73.57557	2015-01-27 12:00:00	79.95829	80.57405	79.2916	2015-01-27 12:00:00	74.9991	75.49924	74.47328
2015-01-27 13:00:00	75 00489	76.67176	73.00763	2015-01-27 13:00:00	79.98153	81.05038	79 01679	2015-01-27 13:00:00	74.92169	75.7374	73.39237
2015-01-27 14:00:00	75 04793	76.65344	73.22748	2015-01-27 14:00:00	79.96259	80.70229	79.2	2015-01-27 14:00:00	75.01002	75 82901	74.10687
2015-01-27 15:00:00	74 99823	76.59847	73.00763	2015-01-27 15:00:00	79.95855	80.92214	79.1084	2015-01-27 15:00:00	74.99596	76 36031	74.16183
2015-01-27 16:00:00	74 98003	76.12214	73.17252	2015-01-27 16:00:00	79.94774	80.3542	79 36489	2015-01-27 16:00:00	74.97868	75.71908	74 3084
2015-01-27 17:00:00	74.9646	76.56183	73.81374	2015-01-27 17:00:00	79.95328	80.4458	79.49313	2015-01-27 17:00:00	75.06601	76.65344	74.32672
2015-01-27 18:00:00	75 03266	76.32366	73.57557	2015-01-27 18:00:00	79.9717	80.57405	79 38321	2015-01-27 18:00:00	75.00221	75 57252	74.52824
2015-01-27 19:00:00	75 04708	76.1771	73.70382	2015-01-27 19:00:00	80.00005	80.86718	78 96183	2015-01-27 19:00:00	75.00538	75.68244	74.54656
2015-01-27 20:00:00	75 00897	76.01221	74.19847	2015-01-27 20:00:00	79.97291	80.4458	79.18168	2015-01-27 20:00:00	75.00614	75.44427	74.52824
2015-01-27 21:00:00	75 03131	76.37863	73.94198	2015-01-27 21:00:00	79.98184	80.37252	79.49313	2015-01-27 21:00:00	74.93445	75.49924	73.64885
2015-01-27 22:00:00	75.12522	76.81832	73.63053	2015-01-27 22:00:00	79.89615	80.72061	75.5542	2015-01-27 22:00:00	75.03109	76 37863	73.97863
2015-01-27 23:00:00	75 56935	76.7084	67.89618	2015-01-27 23:00:00	80.02447	81.43511	78 50382	2015-01-27 23:00:00	75.00641	76.15878	73.31908
2015-01-28 00:00:00	74 30063	75.27939	72.69618	2015-01-28 00:00:00	80.00028	80.50076	79 32824	2015-01-28 00:00:00	75.01015	75 37099	74.41832
2015-01-28 01:00:00	75 00006	76.15878	73.72214	2015-01-28 01:00:00	80.14899	80.61069	79.45649	2015-01-28 01:00:00	75.02529	75.42595	74.71145
2015-01-28 02:00:00	75 30459	76.2687	74.23511	2015-01-28 02:00:00	80.44027	80.9771	79 87786	2015-01-28 02:00:00	75.00189	75.44427	74.4
2015-01-28 03:00:00	75.40449	76.25038	74.4916	2015-01-28 03:00:00	80.52846	81.03206	80 04275	2015-01-28 03:00:00	74.99694	75 38931	74.60153
2015-01-28 04:00:00	75 06591	75.97557	73.92366	2015-01-28 04:00:00	80.10044	80.92214	79 30992	2015-01-28 04:00:00	74.98424	75.4626	74.54656
2015-01-28 05:00:00	73.78199	78.52214	71.68855	2015-01-28 05:00:00	79.86339	81.96641	79 05344	2015-01-28 05:00:00	74.9904	76 98321	74.47328
2015-01-28 06:00:00	74.9482	76.34198	73.74046	2015-01-28 06:00:00	80.00038	83.12061	78.41221	2015-01-28 06:00:00	74.92847	75.60916	74.27176
2015-01-28 07:00:00	74 94452	76.19542	74.08855	2015-01-28 07:00:00	79.97317	80.39084	79 51145	2015-01-28 07:00:00	75.07954	76 90992	74.4916
2015-01-28 08:00:00	75 05834	75.81069	74.25344	2015-01-28 08:00:00	79.98871	80.40916	79 56641	2015-01-28 08:00:00	75.00833	75.40763	74.56489
2015-01-28 09:00:00	74 98105	75.88397	74.10687	2015-01-28 09:00:00	79.96823	80.37252	79 54809	2015-01-28 09:00:00	75.00442	75 33435	74.56489
2015-01-28 10:00:00	75 01222	76.1771	73.88702	2015-01-28 10:00:00	79.95962	80.55573	79.1084	2015-01-28 10:00:00	74.99329	75 51756	74.43664

E4 Flushing Report, March 2015

E4a Watermain Cleaning Reports 2012-2014

Water and Waste Department
Environmental Standards Division

2012 Water Main Cleaning Program

Water Quality Monitoring Summary Report

January 2013

2012 Water Main Cleaning Program

Water Quality Monitoring Summary Report

Compliance Reporting Technician

Laboratory Assistant

Laboratory Assistant

Renée Grosselle, B. Sc.
Supervisor of Compliance Reporting Branch

Kelly Kjartanson, M. Sc., P. Eng.
Manager of Environmental Standards Division

January 2013

TABLE OF CONTENTS PAGE

SUMMARY **1**

LOCAL MONITORING **2**

TABLE 1: LOCAL AREA MONITORING 2
Chlorine Levels 3
Total Coliform, E. coli and HPC 3
Turbidity 3
pH and Temperature 4
True Colour 4

REGIONAL MONITORING **5**

TABLE 2: REGIONAL AREA MONITORING 5
Chlorine Levels 6
Total Coliform, E. coli and HPC 6
Turbidity 6
pH and Temperature 6
True Colour 7
Dissolved Oxygen 7
Chlorine Levels 7
Total Coliform, E. coli and HPC 7
Turbidity 8
pH and Temperature 8
True Colour 8
Dissolved Oxygen 8

ENVIRONMENTAL MONITORING **9**

TABLE 3: ENVIRONMENTAL MONITORING 9
Chlorine Levels 9
Turbidity 10
pH and Temperature 10
True Colour 10
BOD5 and Total Suspended Solids 10
Dissolved Oxygen 11
Metals 11
TABLE 4: METAL RESULT SUMMARY 11

CONCLUSIONS **12**

RECOMMENDATIONS **13**

REFERENCES **15**

APPENDIX A, 2012 WATER MAIN CLEANING PROGRAM AREA 16
APPENDIX B, 2012 WATER MAIN CLEANING PROGRAM LABORATORY ANALYSIS SUMMARY LOCAL MONITORING 18
APPENDIX C, 2012 WATER MAIN CLEANING PROGRAM LABORATORY ANALYSIS SUMMARY REGIONAL MONITORING 37
APPENDIX D, 2012 WATER MAIN CLEANING PROGRAM LABORATORY ANALYSIS SUMMARY SENSITIVE USERS MONITORING 40
APPENDIX E, 2012 WATER MAIN CLEANING PROGRAM LABORATORY ANALYSIS SUMMARY ENVIRONMENTAL MONITORING 43

SUMMARY

In 2012, The City of Winnipeg - Water & Waste Department worked on a watermain cleaning project that targeted approximately half of the area originally cleaned in 2005[1].

The flushing was carried out using a unidirectional flow technique. During unidirectional flushing, water system valves are operated to create one-way flow to the water main being cleaned. A hydrant connected to the main is then opened to remove the built-up sediment. This type of flushing increases the velocity of the water flow in the main to about two metres or six feet per second (it is normally less than 0.3 metres or 1 foot per second). This high velocity produces a scouring action in the mains, removing sediment deposits. The flushing starts at a clean water source (e.g., the water pumping stations) and moves toward the outer limits of the city. This ensures that clean water is always used to flush the mains.

This report summarizes the data and observations for 2012 obtained by Environmental Standards Division staff. The water quality monitoring carried out as part of the Water Main Cleaning Program included Local Monitoring to determine the impact on water quality in the neighbourhood being cleaned, Regional Monitoring to measure the long-term impact on the water quality of the region being cleaned, and Environmental Monitoring in response to concerns respecting discharges to the environment. In addition, four sensitive users were identified in the area where the flushing was taking place. The monitoring results for the sensitive users were reviewed regularly to ensure they were not being negatively affected by the program. Appendix A illustrates the areas cleaned in the 2012 program. The data generated from the program was entered into the Laboratory Information Management System and is included in the Appendices.

Local Monitoring

Local monitoring was conducted in some of the neighbourhoods being cleaned to determine the impact on local customers by the cleaning program. Monitoring locations, parameters and frequency for flushing operations are provided in Table 1 below.

TABLE 1: LOCAL AREA MONITORING

Locations	**Parameters**	**Frequency**
• Households/businesses (specific location determined in field) Normally 2 households/businesses for 2 sequences per weekday.	• Free Chlorine • Total Chlorine • Total Coliform • *E. coli* • Heterotrophic Plate Count • Turbidity • pH • Temperature • Colour, True	• Once (Pre Flush) • Once (Post Flush) • Once (Few Days Post Flush)*
* - Samples a few days post flush will be taken if water quality has not improved on post flush sample. - Additional post flush samples will be taken if required.		

The Local Monitoring results (Appendix B) were used to tabulate the short-term impact of water main flushing on the quality of water delivered to customers. Homes and businesses were chosen randomly to be representative of the neighborhoods being flushed. Comparing the pre-flush sample results with the post-flush sample results allowed the short-term impact of the flushing to be observed. Post-flush samples were usually collected the same day or the day following the flushing in the area. Occasionally, a post-flush sample was obtained several or more days after flushing, usually due to the customer not being home or the business being closed. A household or business was resampled if the post-flush sample contained a positive total coliform or E. coli, high heterotrophic plate count of >500 cfu/mL, and/or a turbidity of >1.0 NTU.

Chlorine Levels

The level of free chlorine in the post-flush samples showed a mean increase of 0.01 mg/L from the pre-flush samples, and the total chlorine mean showed no change. In most cases, a few days after flushing chlorine levels were slightly higher than the original pre-flush levels. The mean value of post-flush samples for free chlorine was 0.61 mg/L and the mean value for total chlorine levels was 0.77 mg/L.

Total Coliform, E. coli and HPC

The majority of the sample results from the local monitoring locations were negative for total coliform, E. coli and heterotrophic bacteria (HPC). The locations that showed a positive bacteria result for total coliform and/or E. coli, and/or had a heterotrophic plate count of >500 cfu/mL were resampled. A total of 6 locations were required to be resampled due to seven positive total coliform results. There were no positive E. coli results reported and no HPC counts of >500 cfu/mL. One resample came back positive for total coliform, and as a result the location was sampled again, as well as locations upstream and downstream. All resamples came back negative for E. coli and heterotrophic bacteria (HPC). Pre-flush samples that were positive were not resampled if the post-flush samples came back negative because the post-flush sample was treated as the resample. For the 2012 program, the bacterial analysis for the program was done by the contract laboratory ALS.

Turbidity

The mean pre-flush turbidity value was 0.34 NTU and the mean post-flush value was 0.26 NTU. All post-flush locations with results above 1.0 NTU were resampled. One post-flush sample had a turbidity value above 1.0 NTU. This location was resampled and found to have a

turbidity of <1.0 NTU. On average the post-flush turbidity values measured this year were significantly lower than in 2011.

pH and Temperature

There was little variance between the mean pH for the pre flush samples and the mean pH for the post flush samples. The mean pH for the pre flush samples was 7.51 units with a range from 7.24 to 7.83 units. The mean pH for the post flush samples was 7.48 units with a range from 7.22 to 7.84 units. The drinking water guidelines[2] recommend a range of 6.5 to 8.5 units. All of the samples were well within this range. The temperature showed a minimal increase on average of 0.4°C from the pre to post flush. The mean pre-flush temperature was 12.2 degrees Celsius and the mean post flush temperature was 12.6 degrees Celsius.

True Colour

The mean pre-flush true colour was 1.01 colour units. The mean post-flush true colour was 1.04 colour units. The results show that there was little difference between the pre and post flush samples.

Regional Monitoring

Regional monitoring included the routine "weekly" monitoring locations in the region, three additional boundary locations, and four large sensitive users in the area. Appendix C provides a summary of the regional monitoring results. The sampling locations, parameters, and frequency of monitoring are provided in Table 2.

TABLE 2: REGIONAL AREA MONITORING

Locations	**Parameters**	**Frequency**
• SE-08 • SW-04 • SW-06 • SW-07 • SW-08 • SW-14 ***Sensitive Users*** • [redacted] • [redacted] • [redacted] • [redacted]	• Free Chlorine • Total Chlorine • Total Coliform • *E. Coli* • Heterotrophic Plate Count • Turbidity • pH • Temperature • Colour, True • Dissolved Oxygen	• Weekly

[redacted] were identified as sensitive user locations. These locations were monitored on a weekly basis. In addition, they were monitored daily while water main cleaning was being done in the area due to their high sensitivity to any water main disturbances. The maintenance staff at each location developed their own internal protocol should they experience dirty water due to the water main cleaning. In addition, the Water Services staff exercised a lot of caution when working near the sensitive users to minimize any disturbances in their systems.

Regional Monitoring of the six locations was performed to determine if disturbed water main sediment was affecting the entire area being cleaned as well as the distribution system outside of the area being cleaned. All of these locations were part of our routine distribution system water quality monitoring program.

Chlorine Levels

Chlorine dosages at MacLean, Hurst and McPhillips Pumping Stations were increased from 1.1 mg/L to 1.2 mg/L from the beginning of May to the middle of August to maintain target levels of disinfectant in the distribution system. The mean free chlorine at the six selected regional locations was 0.73 mg/L and the total chlorine was 0.91 mg/L.

Total Coliform, E. coli and HPC

The six regional locations were sampled weekly for total coliform, E. coli, and heterotrophic plate count throughout the duration of the program. No positive results were reported for total coliform or E. coli, and there were no HPC counts above 500 cfu/mL.

Turbidity

The mean turbidity for the regional monitoring was 0.26 NTU. The target for turbidity results in the distribution system is <1.0 NTU. Only one sample had a turbidity result of >1.0 NTU. This location was resampled and a result of 0.31 NTU was obtained.

pH and Temperature

The mean pH for the regional monitoring was 7.46 units with a range from 7.29 to 7.61 units. The drinking water guidelines recommend a range of 6.5 to 8.5 units. All of the samples were well within this range. The mean temperature for the regional monitoring was 15.9 degrees Celsius. The water temperature steadily increased as the ambient temperature increased.

True Colour

The mean true colour for the six regional locations was 1.3 colour units, with a range from 0.5 to 2.5 colour units.

Dissolved Oxygen

The mean dissolved oxygen level for the six regional locations was 10.2 mg/L with a range from 9.0 to 11.9 mg/L. These levels are within expected typical treated water ranges. An average value for dissolved oxygen in surface water sources[3] is 9.7 mg/L with a range from 6.9 mg/L to 12.2 mg/L.

Sensitive Users

Four sensitive users were identified for the 2012 watermain cleaning program;

Sampling was performed at these locations weekly, with the exception of the days in which the flushing was done close to them, in which case sampling was done daily. The samples were analyzed for the same parameters as the regional monitoring locations. Appendix D provides a summary of the sensitive users monitoring results.

Chlorine Levels

The mean free chlorine for the four sensitive users was 0.69 mg/L and the total chlorine was 0.87 mg/L.

Total Coliform, E. coli and HPC

There were no positive results reported for total coliform or E. coli, and there were no HPC counts above 500 cfu/mL for all of the sensitive users.

Turbidity

The mean turbidity for the regional monitoring was 0.40 NTU. The target for turbidity results in the distribution system is <1.0 NTU. Three samples had a turbidity result of >1.0 NTU. [redacted] had a turbidity result of 1.37 NTU on June 18 and 1.21 NTU on June 20. The location was resampled on June 19 and June 21, respectively, and both resamples reported turbidities of <1.0 NTU. [redacted] had a turbidity of 1.36 NTU on June 12. This location was resampled on June 14 and a result of 0.59 NTU was obtained.

pH and Temperature

The mean pH for the sensitive users was 7.47 units with a range from 7.23 to 7.68 units. The drinking water guidelines recommend a range of 6.5 to 8.5 units. All of the samples were well within this range. The mean temperature for the sensitive users was 22.1 degrees Celsius. The water temperature steadily increased as the ambient temperature increased.

True Colour

The mean true colour for the four sensitive users was 1.2 colour units, with a range from 0.5 to 2.5 colour units.

Dissolved Oxygen

The mean dissolved oxygen level for the sensitive users was 10.0 mg/L with a range from 9.0 to 12.1 mg/L. These levels are within expected treated water ranges.

Environmental Monitoring

A baseline Environmental Monitoring Program was conducted as part of the operation. The program consisted of collecting grab samples from hydrant discharges from selected flushing sequences to determine background quality of the water being discharged to the catch basins of land drainage and combined sewers. One grab sample and one composite sample were taken each day. Appendix E provides a summary of the Environmental Monitoring results. The parameters monitored and the frequency of monitoring is provided in Table 3.

TABLE 3: ENVIRONMENTAL MONITORING

Locations	**Parameters**	**Frequency**
• Fire Hydrants (specific location(s) determined in field coinciding with sequence of household samples).	• Free Chlorine • Total Chlorine • Turbidity • pH • Temperature • True Colour • Total Suspended Solids • BOD • Dissolved Oxygen • Metal Scan	• Daily

Chlorine Levels

A dechlorination system was employed to remove chlorine from the discharged water prior to the water entering the catch basins of land drainage and combined sewers. Environmental Standards field staff performed random chlorine spot checks on the water being discharged to the catch basins to ensure the dechlorination system was functioning properly. Of the 116 samples analyzed, 8 had detectable chlorine levels. Chlorine was detected because the de-chlorinating dosing pump was not functioning properly on a few days. Most of the results indicate that the dechlorination system was functioning properly the majority of the time.

Turbidity

There were 58 hydrant composite samples collected and analyzed for the flushing program. The composite samples contained mainly the "dirty" water expelled during flushing resulting in relatively high turbidities. The mean turbidity for the hydrant composites was 24.2 NTU with a range from 0.73 to 204 NTU and generally decreased as flushing time increased. The hydrant discharge was flushed until it was clear.

pH and Temperature

The mean pH of the hydrant discharge was 7.82 units which is slightly higher than the distribution system average of 7.57 units for the same time period. The mean temperature for the environmental monitoring samples was 15.4 degrees Celsius which is normal for the distribution system during the summer.

True Colour

The mean true colour of the hydrant discharge was 1.3 colour units, with a range from 0.5 to 3.0 colour units. These are expected results for the distribution system during the summer.

BOD5 and Total Suspended Solids

BOD_5 results ranged from <2 to 17 mg/L for the hydrant composite samples with a mean value of 4.4 mg/L. Total suspended solids results ranged from <4 to 302 mg/L with a mean value of 29.9 mg/L. According to the Manitoba Conservation Report, *Manitoba Water Quality Standards, Objectives, and Guidelines*[4] (2002), the guidelines for municipal wastewater effluents are 30 mg/L BOD_5 and 30 mg/L total suspended solids. The mean results for both BOD_5 and total suspended solids were below the guideline.

Dissolved Oxygen

The mean dissolved oxygen level for the hydrant composite samples was 9.8 mg/L with a range from 8.2 to 11.7 mg/L. These levels are within expected treated water ranges.

Metals

A metal scan was added in the 2011 and 2012 monitoring program in response to the increased discoloured water complaints in 2010. The results for this year's program are provided in Table 4. With the exception of iron and manganese, the metal results are below the drinking water guidelines[2].

TABLE 4: METAL RESULT SUMMARY

	Total Calcium	**Total Copper**	**Total Iron**	**Total Magnesium**	**Total Manganese**	**Total Sodium**	**Total Lead**	**Total Zinc**
	(mg/L)							
Average	21.8	0.02	3.1	5.9	0.62	31.0	0.001	0.009
Maximum	32.7	0.05	12.4	11.9	1.88	37.5	0.010	0.047
Minimum	17.9	0.002	0.1	4.7	0.04	26.1	<0.001	0.002
Drinking Water Guideline[2]	None	<1.0	$\leq$ 0.3	None	$\leq$ 0.05	$\leq$ 200	0.010	$\leq$ 5.0

CONCLUSIONS

The following conclusions were determined from the Water Quality Monitoring Program:

- Local Monitoring generally did not show a change in chlorine or colour levels following the completion of water main cleaning in the area.
- Local Monitoring generally showed an improvement in turbidity levels. This year, post flush samples were generally not collected on the same day as flushing because it was found that post-flush samples collected the next day rather than later the same day showed significant improvement in turbidity.
- Regional Monitoring locations within the cleaning program area showed no difference in water quality from the water quality at the regular distribution system monitoring locations outside of the cleaning area.
- Environmental Monitoring showed that the dechlorination system was functioning effectively the majority of the time but there were days where the pump was not functioning properly.
- Both Local and Regional Monitoring showed that bacteria were not present in the water with the flushing disturbances. All resample results were reported to be negative.
- The BOD_5 and total suspended solids average results from the Environmental Monitoring hydrant discharge samples were below the guideline values.
- The average metal results from the Environmental Monitoring hydrant discharge samples were below the drinking water guidelines with the exception of manganese and iron. The results confirm the presence of iron and manganese in the hydrant discharges which were identified in AECOM's report[5] as the likely cause of discoloured water occurrences.

RECOMMENDATIONS

The following recommendations are provided for the future:

- Local Monitoring samples should continue to be obtained from businesses in the area where possible, since it was sometimes difficult to obtain samples from households, especially the initial post-flush sample.
- Pre-flush samples should be collected at least 2 sequences ahead of the flushing crew to prevent artificially high turbidity and colour results caused by disturbances from flushing nearby.
- Samples should continue to be obtained from households with water quality complaints or concerns. Any water complaints or concerns that occur during the weekend should be noted by Water Services staff and followed up by Environmental Standards staff the following workday.
- Environmental Monitoring should be continued to monitor the quality of the water being discharged to the catch basins. This monitoring should continue to include composite samples analyzed for chlorine, colour, total suspended solids, BOD_5, turbidity, pH, metal scan and dissolved oxygen. In 2012, discoloured water did not present itself as a significant issue for the program however it is recommended that we continue to sample for the additional parameters going forward so we may compare results from year to year as we monitor discoloured water occurrences.
- A spare de-chlorinating pump and Vita-D-Chlor pucks should be purchased and kept on hand for instances where the duty pump is not dosing properly to ensure chlorinated water is not being discharged into the environment.

- In order to ensure effective monitoring for the duration of the flushing program, the program should be scheduled to run from the beginning of May to the end of August. This will ensure that there is sufficient temporary staff available to perform the work.

REFERENCES

1. Marsland, M. et al. 2006. 2005 Water Main Cleaning Program. Water Quality Monitoring Summary Report. City of Winnipeg, Environmental Standards Division, Research Branch.

2. Federal-Provincial-Territorial Committee on Drinking Water of the Federal-Provincial-Territorial Committee on Health and Environment. May 2008. Guidelines for Canadian Drinking Water Quality Summary Table. Retrieved 3 January 2013 http://www.hc-sc.gc.ca/ewh-semt/alt_formats/pdf/pubs/water-eau/2012-sum_guide-res_recom/2012-sum_guide-res_recom-eng.pdf

3. Red Water Release in Drinking Water Distribution Systems. Imran et al, September 2005 edition of the AWWA Journal

4. Williamson, Dwight. 2002. Manitoba Water Quality Standards, Objectives, and Guidelines. Manitoba Conservation Water Branch, Water Quality Management Section. Retrieved 3 January 2013 <http://www.gov.mb.ca/waterstewardship/water_quality/quality/mwqsog_2002.pdf>

5. AECOM. November 2011. City of Winnipeg Discoloured Water Investigation Report of Findings DRAFT. AECOM.

APPENDIX A

2012 Water Main Cleaning Program Area

2012 Water Main Cleaning Area

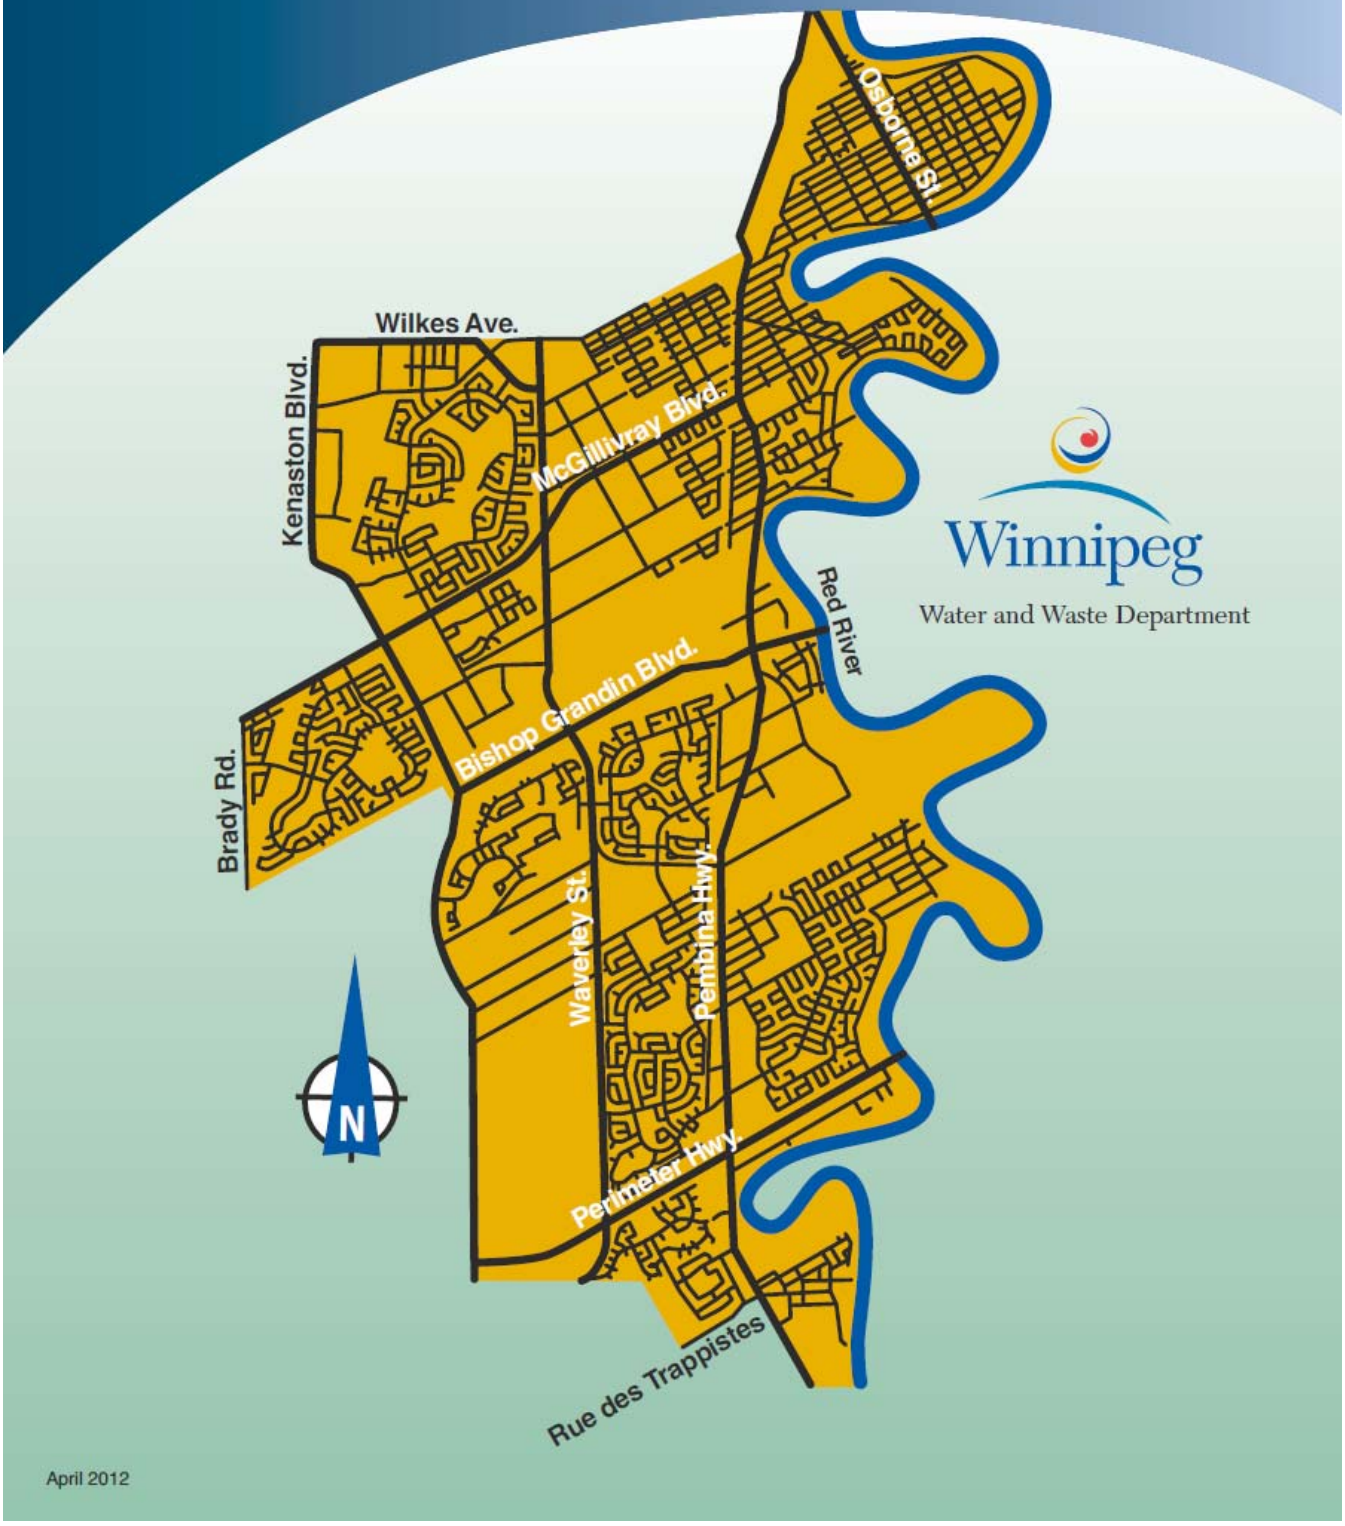

APPENDIX B

2012 Water Main Cleaning Program Laboratory Analysis Summary Local Monitoring

2012 Water Main Cleaning Program

Laboratory Analysis Report Household Monitoring

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
7-May-12		31	324524	0.51	0 69	<1	<1	<10	0 22	7 5	7 82	1.0
8-May-12		31	324518	0.54	0.70	<1	<1	<10	0.17	8 5	7.42	1.5
7-May-12		31	324525	0.56	0.79	<1	<1	<10	1 22	7.7	7 54	2.0
8-May-12		31	324519	0.70	0 94	<1	<1	<10	0 20	9 2	7.47	2.0
7-May-12		32	324527	0.43	0 57	<1	<1	<10	0 26	7 9	7.72	1.0
8-May-12		32	324523	0.64	0 86	<1	<1	<10	0 23	8 8	7.48	2.0
7-May-12		32	324526	0.37	0 58	<1	<1	<10	0 27	7 8	7 83	1.0
8-May-12		32	324522	0.73	0 89	<1	<1	<10	0 27	8 9	7.45	2.0
8-May-12		40	325049	0.68	0 91	<1	<1	<10	0.16	10.0	7.46	1.0
9-May-12		40	325043	0.57	0.71	<1	<1	<10	0 20	9.1	7.45	1.0
8-May-12		40	325048	0.50	0.72	<1	<1	<10	0.15	10.5	7.47	1.5
9-May-12		40	325042	0.53	0 68	<1	<1	<10	0 22	9 0	7.42	1.0
8-May-12		41	325050	0.86	1 01	<1	<1	<10	0.19	8.7	7.47	1.5
9-May-12		41	325046	0.80	0 98	<1	<1	<10	0 39	8 8	7.46	1.0
8-May-12		41	325051	0.84	0.98	<1	<1	<10	0 28	9.4	7.47	1.0
9-May-12		41	325047	0.64	0.82	<1	<1	<10	0 25	8 9	7 58	1.0
9-May-12		48	325101	0.77	0.94	<1	<1	<10	0 60	10.1	7 54	1.0
10-May-12		48	325095	0.83	1.01	<1	<1	<10	0.16	10.2	7 33	1.0
9-May-12		48	325102	0.74	0.91	<1	<1	<10	0 28	10.3	7 53	1.0
10-May-12		48	325096	0.84	0.98	<1	<1	<10	0 22	10.6	7.48	1.0
9-May-12		49	325104	0.92	1.11	<1	<1	<10	0.16	11.2	7.73	1.0
10-May-12		49	325100	0.94	1.10	<1	<1	<10	0.18	12.1	7 52	2.0
9-May-12		49	325103	0.84	1.06	<1	<1	<10	0.17	11.4	7 54	1.0
10-May-12		49	325099	0.94	1.08	<1	<1	<10	0 27	11.9	7.42	1.0

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
10-May-12		56	325141	0.52	0.73	<1	<1	<10	0.18	9.4	7.42	1.0
11-May-12		56	325135	0.75	0 92	<1	<1	<10	0 20	6 9	7.42	1.5
10-May-12		56	325140	0.73	0 90	<1	<1	<10	0.13	6 9	7 39	1.0
11-May-12		56	325134	0.53	0 66	<1	<1	<10	0.18	8.7	7.45	2.0
10-May-12		59	325143	0.92	1.10	<1	<1	<10	0.17	9 9	7 55	2.0
14-May-12		59	325139	1.03	1.15	<1	<1	<10	0 99	9 8	7.46	2.0
10-May-12		59	325142	0.87	1 02	<1	<1	<10	0.19	10.4	7 52	1.0
14-May-12		59	325138	1.09	1 28	<1	<1	<10	0.42	9 8	7.47	1.0
11-May-12		64	325195	0.79	1 06	<1	<1	<10	0.17	8 9	7.44	1.0
14-May-12		64	325189	1.02	1.19	<1	<1	<10	0.44	9.1	7 38	1.0
11-May-12		64	325196	0.77	1.01	<1	<1	<10	0.16	8 5	7.42	2.0
14-May-12		64	325190	1.03	1.19	<1	<1	<10	0 26	8 8	7 39	1.0
11-May-12		65	325197	0.70	0.92	<1	<1	<10	0.15	6 5	7 39	1.0
14-May-12		65	325193	1.05	1.22	<1	<1	<10	0.74	8 8	7 37	1.0
11-May-12		65	325198	0.82	0.97	<1	<1	<10	0 29	7 3	7 36	1.0
14-May-12		65	325194	1.14	1.27	<1	<1	<10	0 34	9 0	7.41	2.0
14-May-12		94	325359	0.89	1.00	<1	<1	<10	0 20	7 9	7.42	1.0
15-May-12		94	325353	0.70	0.91	<1	<1	<10	0 22	8 3	7.44	1.5
14-May-12		94	325360	0.87	0.99	<1	<1	<10	0 24	7 8	7.46	1.0
15-May-12		94	325354	0.73	0.92	<1	<1	<10	0.19	8.1	7.49	1.0
14-May-12		95	325361	0.81	0.97	<1	<1	<10	0 36	7 8	7.41	1.0
15-May-12		95	325357	0.83	0.97	<1	<1	<10	0 21	9 0	7.56	1.0
14-May-12		95	325362	0.89	1.02	<1	<1	<10	0.15	8.7	7.56	1.0
15-May-12		95	325358	0.85	0.98	<1	<1	<10	0.16	8 8	7.58	1.5
15-May-12		101	325403	0.75	0.97	<1	<1	<10	0 27	7 8	7.45	2.5
16-May-12		101	325397	0.74	0.92	<1	<1	<10	0 21	8 9	7.33	2.0
15-May-12		101	325404	0.85	0.97	<1	<1	<10	0.19	7 3	7.51	2.0
16-May-12		101	325398	0.78	0.98	<1	<1	<10	0.19	8 8	7.43	1.0
15-May-12		102	325405	0.71	0.85	<1	<1	<10	1 07	9 8	7.61	2.0
16-May-12		102	325401	0.75	0.94	<1	<1	<10	0.20	9.1	7.51	2.0

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
15-May-12		102	325406	0.76	0 90	<1	<1	<10	0 84	9 2	7 62	2.5
16-May-12		102	325402	0.76	0 92	<1	<1	<10	0 22	9 2	7 55	2.0
16-May-12		113	325812	0.96	1.12	<1	<1	<10	0 22	8 8	7 67	1.0
17-May-12		113	325806	0.92	1 07	<1	<1	10	0.19	9.4	7 54	1.5
16-May-12		113	325811	0.95	1 09	<1	<1	<10	0 22	8 9	7 53	1.0
17-May-12		113	325805	0.90	1.08	<1	<1	<10	0 24	9 5	7 39	2.0
16-May-12		114	325814	0.91	1.06	<1	<1	<10	0.18	9.4	7 69	1.0
17-May-12		114	325810	0.84	0.97	<1	<1	20	0 23	10.5	7 60	1.0
16-May-12		114	325813	0.88	1.03	<1	<1	<10	0 21	9 6	7 62	1.0
17-May-12		114	325809	0.87	1.01	<1	<1	<10	0 23	10.2	7 50	1.0
17-May-12		130	325872	0.67	0.92	<1	<1	<10	0 22	9 0	7 52	1.0
18-May-12		130	325866	0.67	0.80	<1	<1	<10	0.17	10.0	7.42	1.0
17-May-12		130	325871	0.73	0.94	<1	<1	10	0 22	9 2	7 56	1.0
18-May-12		130	325865	0.69	0.89	<1	<1	<10	0.17	10.4	7 38	1.0
17-May-12		131	325873	0.68	0.84	<1	<1	<10	0 24	8 9	7 52	1.0
18-May-12		131	325869	0.90	1.11	<1	<1	<10	0.19	9 9	7.37	1.0
17-May-12		131	325874	0.80	1.03	<1	<1	30	0.14	9.1	7.50	1.5
18-May-12		131	325870	1.01	1.14	<1	<1	30	0 20	10.3	7.39	1.0
18-May-12		139	325916	0.70	0.84	NA	NA	NA	0.15	9 0	7.37	1.0
22-May-12		139	325910	0.80	1.03	<1	<1	<10	0.17	11.0	7.22	1.0
18-May-12		139	325917	0.66	0.89	NA	NA	NA	0.15	8 8	7.34	1.0
22-May-12		139	325911	0.90	1.06	<1	<1	<10	0.15	11.0	7.24	1.0
18-May-12		140	325918	0.49	0.68	NA	NA	NA	0.16	8 2	7.42	1.0
22-May-12		140	325914	0.87	1.04	<1	<1	<10	0.15	11.1	7.33	1 5
18-May-12		140	325919	0.64	0.78	NA	NA	NA	0.19	8.7	7.36	1 0
22-May-12		140	325915	0.94	1.11	<1	<1	<10	0.16	10.8	7.32	1 0
22-May-12		186	326070	0.19	0.31	<1	<1	10	1.97	8.7	7.31	1 0
23-May-12		186	326064	0.57	0.75	<1	<1	10	0.55	8.7	7.54	1 0

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
22-May-12		186	326069	0.77	0 94	<1	<1	70	0.17	12.7	7 36	1.5
23-May-12		186	326063	0.70	0 88	<1	<1	20	0.16	9.1	7.44	1.0
22-May-12		188	326072	0.71	0 84	<1	<1	<10	0.16	11.1	7.47	1.0
23-May-12		188	326068	0.79	0 86	<1	<1	<10	0.18	11.0	7 55	1.0
22-May-12		188	326071	0.67	0 85	<1	<1	<10	0.17	10.1	7.44	1.0
23-May-12		188	326067	0.75	0 91	<1	<1	70	0.17	11.5	7 51	1.0
23-May-12		198	326534	0.61	0.77	<1	<1	<10	0 20	9 3	7 68	1.0
24-May-12		198	326528	0.59	0.73	<1	<1	NR	0.19	9.7	7 32	1.0
23-May-12		198	326535	0.58	0.77	<1	<1	<10	0.19	9.1	7 66	1.0
24-May-12		198	326529	0.57	0.80	<1	<1	NR	0.19	9.4	7 34	1.0
23-May-12		199	326536	0.65	0.79	<1	<1	<10	0.17	9.4	7.77	1.0
24-May-12		199	326532	0.55	0.74	<1	<1	NR	0.18	10.2	7.41	1.0
23-May-12		199	326537	0.58	0.72	<1	<1	<10	0.19	9 2	7.78	1.0
24-May-12		199	326533	0.60	0.74	<1	<1	NR	0.17	10.1	7.39	1.0
24-May-12		208	326573	0.61	0.74	<1	<1	NR	0.16	10.2	7.27	1.0
25-May-12		208	326567	0.64	0.84	<1	<1	<10	0 22	11.9	7.52	1.0
24-May-12		208	326572	0.44	0.59	<1	<1	NR	0.17	9 8	7.34	1.0
25-May-12		208	326566	0.38	0.53	<1	<1	<10	0.18	10.1	7.52	1.0
24-May-12		209	326575	0.51	0.66	<1	<1	NR	0.17	8 2	7.31	1.0
28-May-12		209	326571	0.75	0.90	<1	<1	30	0 21	8.4	7.45	1.0
24-May-12		209	326574	0.52	0.74	<1	<1	NR	0 26	9 2	7.24	1.0
28-May-12		209	326570	0.67	0.86	<1	<1	<10	0 20	10.1	7.48	1.0
25-May-12		223	326608	0.77	0.89	<1	<1	1180	0 23	8 2	7.38	1.5
28-May-12		223	326602	0.63	0.82	<1	<1	10	0.17	9.7	7.52	1.0
25-May-12		223	326607	0.66	0.81	<1	<1	<10	0.21	8 6	7.42	1.0
28-May-12		223	326601	0.53	0.70	<1	<1	<10	0.16	10.3	7.57	1 0
25-May-12		225	326610	0.66	0.75	<1	<1	<10	0.20	9 0	7.32	1 0
28-May-12		225	326606	0.45	0.77	<1	<1	10	0.14	9 5	7.48	1 0
25-May-12		225	326609	0.64	0.77	<1	<1	<10	0.21	9 2	7.39	1 0
28-May-12		225	326605	0.63	0.82	<1	<1	10	0.16	10.1	7.59	1 0

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
28-May-12		256	326813	0.49	0 67	<1	<1	<10	0 32	7.4	7 36	1.0
1-Jun-12		256	326807	0.56	0 68	<1	<1	<10	0 26	7.4	7 52	1.0
28-May-12		256	326812	0.60	0.74	<1	<1	<10	0.40	9.1	7 28	1.0
1-Jun-12		256	326806	0.53	0 67	<1	<1	<10	0 27	8 3	7.46	0.5
28-May-12		258	326815	0.61	0.73	<1	<1	<10	0.18	9 2	7.41	1.0
1-Jun-12		258	326811	0.62	0.73	<1	<1	<10	0.15	8 8	7 56	0.5
28-May-12		258	326814	0.70	0.85	<1	<1	10	0.16	9 3	7.46	1.0
1-Jun-12		258	326810	0.53	0.73	<1	<1	<10	0.15	9.7	7 54	1.0
29-May-12		270	326847	0.75	0.91	NA	NA	NA	0.41	8.7	7 35	0.5
30-May-12		270	326841	0.54	0.76	<1	<1	<10	0.19	9.1	7.42	1.0
29-May-12		270	326848	0.72	0.80	NA	NA	NA	0 34	8 6	7.40	0.5
30-May-12		270	326842	0.57	0.80	<1	<1	<10	0.19	9 3	7.46	1.0
29-May-12		272	326849	0.70	0.83	NA	NA	NA	0 33	9 0	7.40	0.5
30-May-12		272	326845	0.53	0.66	<1	<1	<10	0 20	9.4	7.42	1.0
29-May-12		272	326850	0.69	0.79	NA	NA	NA	0 24	9.7	7 55	1.0
30-May-12		272	326846	0.70	0.83	<1	<1	<10	0.18	9 6	7 54	1.0
30-May-12		281	327249	0.62	0.80	NA	NA	NA	0 08	9.4	7.49	1.0
31-May-12		281	327243	0.74	0.90	<1	<1	<10	0 07	10.0	7.84	1.0
30-May-12		281	327250	0.69	0.84	NA	NA	NA	0 20	9.4	7.48	1.0
31-May-12		281	327244	0.80	0.91	<1	<1	40	0.17	10.0	7.80	1.0
30-May-12		283	327251	0.67	0.80	NA	NA	NA	0.17	10.0	7.55	1.0
31-May-12		283	327247	0.55	0.76	<1	<1	<10	0.16	10.3	7.81	0.5
30-May-12		283	327252	0.56	0.75	NA	NA	NA	0 20	9 0	7.52	1.0
31-May-12		283	327248	0.54	0.67	<1	<1	<10	0.17	8 5	7.80	1.0
31-May-12		295	327289	0.45	0.90	<1	<1	10	0.17	10.3	7.75	1 0
1-Jun-12		295	327283	0.40	0.61	<1	<1	<10	0.24	9.7	7.49	1 0
31-May-12		295	327290	0.78	0.95	<1	<1	<10	0.16	11.8	7.75	1 0
1-Jun-12		295	327284	0.46	0.58	<1	<1	10	0.21	8 6	7.49	1 0

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
31-May-12		296	327292	0.65	0 83	<1	<1	<10	0.16	10.9	7.77	0.5
1-Jun-12		296	327288	0.64	0 80	<1	<1	<10	0.43	10.1	7 51	1.0
31-May-12		296	327291	0.77	0 92	3	<1	30	0.16	12.2	7 81	1.0
1-Jun-12		296	327287	0.51	0 64	<1	<1	<10	0 25	9 0	7.47	1.0
1-Jun-12		304	327333	0.50	0 60	<1	<1	<10	0.18	13.2	7 59	1.0
4-Jun-12		304	327327	0.52	0 66	<1	<1	10	0.15	13.2	7 50	1.0
1-Jun-12		304	327332	0.62	0 85	<1	<1	<10	0.12	11.2	7 58	1.0
4-Jun-12		304	327326	0.55	0.75	<1	<1	<10	0.19	11.9	7 37	1.0
1-Jun-12		306	327335	0.85	1 05	<1	<1	<10	0 69	13.1	7 56	1.0
4-Jun-12		306	327331	0.64	0 84	<1	<1	10	0.16	11.5	7 54	1.0
1-Jun-12		306	327334	0.87	1 02	<1	<1	<10	0.73	12.8	7 55	1.0
4-Jun-12		306	327330	0.66	0 87	<1	<1	<10	0.14	11.8	7 52	1.5
4-Jun-12		337	327523	0.74	0.88	101	<1	<10	0.15	10.7	7.44	1.5
5-Jun-12		337	327517	0.70	0 85	41	<1	10	0 25	11.4	7 50	1.0
7-Jun-12		337	328099	0.84	0 99	200	<1	10	0 20	11.7	NA	NA
7-Jun-12		337	328100	0.84	1 03	<1	<1	<10	0 21	11.6	NA	NA
7-Jun-12		337	328101	0.82	0 97	<1	<1	<10	0.19	11.4	NA	NA
11-Jun-12		337	328309	0.70	0 91	<1	<1	30	0.19	12.7	NA	NA
11-Jun-12		337	328310	NA	NA	<1	<1	<10	NA	NA	NA	NA
11-Jun-12		337	328311	0.73	0.89	<1	<1	<10	0.15	12.6	NA	NA
11-Jun-12		337	328313	0.73	0.92	<1	<1	<10	0 22	12.9	NA	NA
4-Jun-12		337	327522	0.57	0.79	<1	<1	<10	0.17	10.8	7.44	1.0
5-Jun-12		337	327516	0.70	0.87	<1	<1	<10	0 21	11.0	7 51	0.5
4-Jun-12		338	327524	0.71	0.88	<1	<1	10	0.13	13.3	7 53	1.0
5-Jun-12		338	327520	0.73	0.85	<1	<1	<10	0 25	11.5	7 54	1.0
4-Jun-12		338	327525	0.82	0.93	<1	<1	<10	0.13	13.8	7.48	1.0
5-Jun-12		338	327521	0.92	1.03	<1	<1	<10	0.16	13.1	7.41	1.0
5-Jun-12		348	327936	0.74	0.91	1	<1	<10	0 20	12.4	7.48	1.0
6-Jun-12		348	327930	0.76	0.89	<1	<1	<10	0.13	11.2	7 28	1.0
5-Jun-12		348	327937	0.71	0.97	<1	<1	<10	0.19	12.5	7 54	1.0
6-Jun-12		348	327931	0.82	0.97	<1	<1	<10	0.13	11.6	7 32	1.0

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
5-Jun-12		349	327939	0.79	0 91	<1	<1	<10	0 21	11.7	7 59	0.5
6-Jun-12		349	327935	0.86	1 00	<1	<1	<10	0.16	13.3	7 33	1.5
5-Jun-12		349	327938	0.85	0 99	<1	<1	10	0 22	13.4	7 50	1.0
6-Jun-12		349	327934	0.83	1 05	<1	<1	<10	0.18	14.9	7.45	1.0
6-Jun-12		360	328002	0.88	1 08	<1	<1	<10	0 83	14.0	7.49	0.5
7-Jun-12		360	327996	0.85	1 00	<1	<1	<10	0 25	13.4	7 37	1.0
6-Jun-12		360	328001	0.70	0 84	<1	<1	<10	0 39	10.6	7 51	1.0
7-Jun-12		360	327995	0.83	0 98	<1	<1	<10	0 34	10.7	7 31	0.5
6-Jun-12		361	328004	0.37	0.49	<1	<1	<10	0.44	9 2	7.49	1.0
7-Jun-12		361	328000	0.78	0.91	<1	<1	<10	0.19	11.5	7.43	1.0
6-Jun-12		361	328003	0.53	0.64	1	<1	<10	0 60	9 3	7 54	1.0
7-Jun-12		361	327999	0.72	0.89	<1	<1	<10	0 50	10.9	7.40	1.0
7-Jun-12		374	328080	0.83	1.02	<1	<1	<10	0.18	13.4	7.45	1.0
8-Jun-12		374	328074	0.81	0.97	<1	<1	<10	0 27	13.6	7.46	1.0
7-Jun-12		374	328079	0.74	0.96	<1	<1	<10	0.16	13.4	7 39	1.0
8-Jun-12		374	328073	0.71	0.94	<1	<1	<10	0.48	13.7	7.42	1.0
7-Jun-12		375	328082	0.76	0.91	<1	<1	10	0 21	12.5	7.36	1.0
8-Jun-12		375	328078	0.73	0.91	<1	<1	<10	0 37	13.8	7.45	1.0
7-Jun-12		375	328081	0.93	1.06	<1	<1	<10	0 21	14.5	7.40	0.5
8-Jun-12		375	328077	0.72	0.94	<1	<1	<10	0 23	15.2	7.44	0.5
8-Jun-12		383	328131	0.53	0.67	<1	<1	<10	0 27	11.9	7.46	1.0
11-Jun-12		383	328125	0.49	0.64	<1	<1	<10	0 32	10.3	7.60	0.5
8-Jun-12		383	328130	0.58	0.81	<1	<1	<10	0 26	10.3	7.49	0.5
11-Jun-12		383	328124	0.53	0.68	<1	<1	<10	0 23	10.1	7.52	1.0
8-Jun-12		384	328132	0.63	0.81	2	<1	<10	0.17	12.1	7.33	1.5
11-Jun-12		384	328128	0.70	0.91	<1	<1	<10	0 22	11.9	7.58	1.0
8-Jun-12		384	328133	0.75	0.85	<1	<1	10	0 21	11.9	7.33	1.0
11-Jun-12		384	328129	0.49	0.66	<1	<1	<10	0.19	11.9	7.53	0.5
11-Jun-12		418	328343	0.38	0.56	<1	<1	<10	0 31	8.7	7.80	0.5
12-Jun-12		418	328337	0.61	0.76	<1	<1	<10	0.17	11.0	7.54	1.0

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
11-Jun-12		418	328344	0.36	0 50	<1	<1	<10	0 32	9.1	7 82	1.0
12-Jun-12		418	328338	0.62	0.72	<1	<1	<10	0.17	11.1	7 52	1.0
11-Jun-12		420	328346	0.40	0 55	<1	<1	<10	0 92	10.0	7.72	1.0
12-Jun-12		420	328342	0.53	0 65	<1	<1	40	0 26	10.4	7 55	1.0
11-Jun-12		420	328345	0.40	0 56	<1	<1	<10	0 51	9 9	7 68	0.5
12-Jun-12		420	328341	0.39	0 50	<1	<1	10	0 27	10.2	7 61	1.0
12-Jun-12		429	328706	0.50	0 64	<1	<1	<10	0 22	10.2	7 58	0.5
13-Jun-12		429	328700	0.33	0.44	<1	<1	<10	0.44	11.1	7.47	2.0
12-Jun-12		429	328705	0.48	0 62	2	<1	<10	0.19	9.4	7 58	1.0
13-Jun-12		429	328699	0.32	0.49	<1	<1	<10	0.48	10.3	7 35	1.0
12-Jun-12		431	328707	0.45	0 65	<1	<1	<10	0.19	11.2	7 52	1.0
13-Jun-12		431	328703	0.25	0 38	<1	<1	10	0.49	12.1	7 37	1.0
12-Jun-12		431	328708	0.46	0.62	1	<1	10	0 20	10.1	7 57	0.5
13-Jun-12		431	328704	0.21	0.33	<1	<1	<10	0 60	10.2	7.40	1.0
13-Jun-12		442	328760	0.41	0.50	<1	<1	<10	0 60	10.7	7.48	1.0
14-Jun-12		442	328756	0.31	0.43	<1	<1	<10	0 23	11.1	7 52	2.5
13-Jun-12		442	328759	0.36	0.50	<1	<1	<10	0.48	10.6	7.43	2.0
14-Jun-12		442	328755	0.38	0.50	<1	<1	<10	0 23	10.5	7 52	1.0
13-Jun-12		447	328758	0.38	0.48	<1	<1	10	0 24	12.4	7.42	2.0
14-Jun-12		447	328752	0.36	0.49	<1	<1	<10	0 30	11.2	7.49	1.0
13-Jun-12		447	328757	0.21	0.31	<1	<1	<10	0 20	14.2	7.42	2.0
14-Jun-12		447	328751	0.32	0.51	<1	<1	<10	0 29	10.9	7 60	3.0
14-Jun-12		452	328854	0.39	0.58	<1	<1	<10	0 32	13.4	7 57	1.0
15-Jun-12		452	328848	0.65	0.75	<1	<1	<10	0 34	13.8	7.55	1.0
14-Jun-12		452	328853	0.40	0.66	<1	<1	20	0 34	11.3	7.55	1.0
15-Jun-12		452	328847	0.63	0.77	<1	<1	<10	0 36	14.1	7.31	0.5
14-Jun-12		453	328856	0.72	0.96	<1	<1	<10	1.79	12.3	7.52	2.5
15-Jun-12		453	328852	0.53	0.67	<1	<1	<10	0.19	12.2	7.45	1.0

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
14-Jun-12		453	328855	0.45	0 66	<1	<1	<10	0 25	12.3	7.49	1.0
15-Jun-12		453	328851	0.62	0.77	<1	<1	10	0.18	12.3	7.47	1.0
15-Jun-12		466	328873	0.36	0 52	<1	<1	10	0 23	10.2	7.46	1.0
18-Jun-12		466	328867	0.35	0 54	<1	<1	<10	0 29	10.8	7 28	1.0
15-Jun-12		466	328874	0.34	0 51	<1	<1	<10	0 23	10.5	7.45	0.5
18-Jun-12		466	328868	0.25	0 51	<1	<1	<10	0 21	11.6	7.43	1.0
15-Jun-12		467	328875	0.46	0 58	<1	<1	<10	0 39	11.2	7.47	1.0
18-Jun-12		467	328871	0.19	0 34	<1	<1	<10	0 21	11.9	7.40	1.0
15-Jun-12		467	328876	0.37	0 50	<1	<1	<10	0 34	10.9	7 55	1.0
18-Jun-12		467	328872	0.22	0.39	1	<1	<10	0 35	11.5	7.42	1.0
20-Jun-12		467	329523	0.34	0.45	<1	<1	NR	0 23	13.9	NA	NA
18-Jun-12		495	329064	0.61	0.84	8	<1	<10	1.78	12.3	7 50	1.0
19-Jun-12		495	329058	0.67	0.80	1	<1	360	0 24	13.7	7.40	0.5
21-Jun-12		495	329544	0.64	0.81	<1	<1	320	0 31	11.5	NA	NA
18-Jun-12		495	329065	0.79	0.94	<1	<1	<10	1 04	14.4	7.45	1.0
19-Jun-12		495	329059	0.65	0.96	<1	<1	<10	0.16	14.5	7.41	1.0
18-Jun-12		498	329066	0.91	1.03	4	<1	<10	1.16	14.3	7.47	1.0
19-Jun-12		498	329062	0.74	0.91	<1	<1	<10	0.19	14.4	7 36	1.0
18-Jun-12		498	329067	0.63	0.77	<1	<1	<10	0 28	13.7	7.45	1.0
19-Jun-12		498	329063	0.61	0.82	<1	<1	<10	0 31	13.1	7.41	0.5
19-Jun-12		506	329115	0.38	0.53	<1	<1	<10	0 28	11.7	7.45	1.0
20-Jun-12		506	329109	0.23	0.35	<1	<1	NR	0 23	11.8	7 57	1.0
19-Jun-12		506	329116	0.39	0.52	<1	<1	80	0 25	10.7	7.47	1.0
20-Jun-12		506	329110	0.42	0.53	<1	<1	NR	0 24	11.2	7 62	1.0
19-Jun-12		507	329117	0.38	0.51	<1	<1	260	0 26	12.0	7.46	1.0
20-Jun-12		507	329113	0.38	0.50	10	<1	NR	0 25	11.8	7 52	1.5
22-Jun-12		507	329595	0.37	0.50	<1	<1	<10	0 26	12.2	NA	NA
19-Jun-12		507	329118	0.35	0.48	<1	<1	50	0 24	11.7	7.46	1.0
20-Jun-12		507	329114	0.33	0.45	<1	<1	NR	0 21	11.3	7 50	1.0

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
20-Jun-12		518	329495	0.11	0 21	<1	<1	NR	0 53	10.4	7 60	1.0
21-Jun-12		518	329489	0.04	0.14	<1	<1	<10	0 57	11.0	7 56	1.0
22-Jun-12		518	329731	0.05	0.15	NA	NA	NA	NA	10.9	NA	NA
25-Jun-12		518	329793	0.27	0.42	NA	NA	NA	NA	11.8	NA	NA
20-Jun-12		518	329494	0.10	0 20	<1	<1	NR	0 61	10.1	7 63	1.0
21-Jun-12		518	329488	0.08	0.15	3	<1	<10	0 83	11.4	7 55	1.0
22-Jun-12		page ppp	329730	<0.02	0.08	NA	NA	NA	NA	10.9	NA	NA
25-Jun-12		518	329732	0.18	0.30	<1	<1	<10	0 94	13.2	NA	NA
20-Jun-12		519	329496	0.12	0.26	<1	<1	NR	0 30	12.0	7 59	0.5
21-Jun-12		519	329492	0.14	0.26	4	<1	<10	0.48	11.3	7 60	0.5
25-Jun-12		519	329773	0.15	0.26	<1	<1	<10	0.46	12.6	NA	NA
20-Jun-12		519	329497	0.20	0.32	<1	<1	NR	0 29	12.0	7 56	1.0
21-Jun-12		519	329493	0.12	0.28	<1	<1	<10	0.42	11.4	7.58	1.0
21-Jun-12		531	329540	0.26	0.37	<1	<1	10	0 32	12.4	7.52	1.0
22-Jun-12		531	329534	0.23	0.31	<1	<1	<10	0 62	13.0	7.51	1.0
21-Jun-12		531	329539	0.20	0.32	<1	<1	10	0 36	11.2	7.55	1.0
22-Jun-12		531	329533	0.30	0.48	<1	<1	<10	0 23	11.0	7.39	1.0
21-Jun-12		533	329542	0.72	0.85	<1	<1	<10	0.78	14.1	7.52	1.0
22-Jun-12		533	329538	0.74	0.90	<1	<1	<10	0 23	15.2	7.44	1.0
21-Jun-12		533	329541	0.63	0.88	<1	<1	<10	1 03	13.7	7.62	1.0
22-Jun-12		533	329537	0.67	0.84	<1	<1	<10	0 32	15.2	7.55	1.0
22-Jun-12		542	329603	0.36	0.49	<1	<1	<10	0 28	11.9	7.49	1.0
25-Jun-12		542	329597	0.13	0.27	<1	<1	<10	0.48	11.4	7.58	1.0
22-Jun-12		542	329602	0.26	0.47	<1	<1	<10	0 27	11.3	7.49	0.5
25-Jun-12		542	329596	0.18	0.32	<1	<1	<10	0 50	11.7	7.67	1.0
22-Jun-12		544	329604	1.13	1.22	<1	<1	<10	5.45	14.1	7.59	1.0
25-Jun-12		544	329600	0.72	0.81	<1	<1	<10	0.17	13.8	7.60	1.0
22-Jun-12		544	329605	0.94	1.09	2	<1	<10	2 80	11.5	7.50	0.5
25-Jun-12		544	329601	0.91	1.09	<1	<1	<10	0 84	15.2	7.46	1.0
25-Jun-12		564	329781	0.44	0.57	<1	<1	<10	0 30	13.8	7.51	1.0
26-Jun-12		564	329775	0.39	0.62	<1	<1	<10	0.27	15.0	7.44	1.0

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
25-Jun-12		564	329780	0.40	0 59	<1	<1	10	0 28	12.3	7 58	1.0
26-Jun-12		564	329774	0.36	0 60	1	<1	<10	0 27	14.4	7.40	0.5
28-Jun-12		564	330263	0.36	0 50	<1	<1	<10	0 30	12.0	NA	NA
25-Jun-12		567	329783	0.10	0 22	<1	<1	<10	1 60	10.6	7 55	1.0
26-Jun-12		567	329779	0.37	0.48	<1	<1	<10	0 25	11.0	7.46	1.0
25-Jun-12		567	329782	0.11	0.20	<1	<1	20	1.48	10.7	7.40	1.0
26-Jun-12		567	329778	0.42	0.52	<1	<1	10	0 26	10.5	7.48	1.0
26-Jun-12		580	329816	0.72	0.92	<1	<1	10	0.19	13.2	7 39	1.0
28-Jun-12		580	329810	0.71	0.91	<1	<1	<10	0 36	16.0	7 60	1.0
26-Jun-12		580	329817	0.82	0.97	<1	<1	<10	0.15	16.0	7 52	1.0
28-Jun-12		580	329811	0.72	0.91	<1	<1	<10	0 39	18.0	7 64	1.0
26-Jun-12		581	329819	0.67	0.88	<1	<1	<10	0.13	13.5	7 50	1.0
28-Jun-12		581	329815	0.84	1.00	<1	<1	<10	0 37	14.6	7 59	0.5
26-Jun-12		581	329818	0.68	0.85	1	<1	<10	0.14	14.2	7 50	1.0
28-Jun-12		581	329814	0.80	0.95	<1	<1	<10	0 38	14.3	7.62	0.5
27-Jun-12		588	330208	0.64	0.86	<1	<1	<10	0 33	13.3	7.65	1.0
28-Jun-12		588	330202	0.77	0.89	<1	<1	<10	0.16	14.7	7.62	1.0
27-Jun-12		588	330207	0.65	0.90	<1	<1	<10	0.13	13.6	7.67	1.0
28-Jun-12		588	330201	0.68	0.82	<1	<1	<10	0.16	14.5	7.58	1.0
27-Jun-12		589	330209	0.33	0.49	<1	<1	<10	0.13	13.4	7.66	1.0
28-Jun-12		589	330205	0.25	0.35	<1	<1	<10	0 21	13.8	7.66	1.0
27-Jun-12		589	330210	0.31	0.45	<1	<1	<10	0.13	13.7	7.56	1.0
28-Jun-12		589	330206	0.23	0.36	<1	<1	40	0 20	13.1	7.52	1.0
28-Jun-12		601	330261	0.64	0.80	<1	<1	<10	0.13	13.7	7.62	0.5
3-Jul-12		601	330257	0.80	0.94	<1	<1	<10	0.22	16.5	7.60	1 0
28-Jun-12		601	330260	0.61	0.77	<1	<1	<10	0.18	13.4	7.70	1.0
3-Jul-12		601	330256	0.81	0.93	<1	<1	<10	0.29	16.3	7.57	1 5
28-Jun-12		602	330258	0.59	0.79	<1	<1	<10	0.13	13.9	7.68	1 0
3-Jul-12		602	330252	0.78	0.89	<1	<1	<10	0.21	16.0	7.44	1 0

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
28-Jun-12		602	330259	0.67	0 80	<1	<1	<10	0 24	13.4	7 64	1.0
3-Jul-12		602	330253	0.73	0.92	<1	<1	<10	0.18	15.2	7.40	1 5
3-Jul-12		657	330299	0.56	0.69	<1	<1	<10	0.14	11.4	7.48	1 0
4-Jul-12		657	330293	0.15	0.24	<1	<1	<10	0 25	12.1	7.46	1 0
3-Jul-12		657	330298	0.76	0.97	<1	<1	<10	0.13	12.3	7 50	1 5
4-Jul-12		657	330292	0.64	0.73	<1	<1	<10	0.13	12.3	7 35	0 5
3-Jul-12		658	330301	0.37	0.58	<1	<1	<10	0.15	11.2	7.45	1 0
4-Jul-12		658	330297	0.36	0.59	<1	<1	10	0 21	12.2	7.42	1 0
3-Jul-12		658	330300	0.59	0.71	<1	<1	<10	0.15	11.3	7.48	1 0
4-Jul-12		658	330296	0.17	0.31	<1	<1	<10	0 24	11.5	7.45	0 5
4-Jul-12		667	330907	0.70	0.81	<1	<1	<10	0.14	12.2	7.49	0 5
5-Jul-12		667	330903	0.59	0.77	<1	<1	<10	0.19	12.1	7.45	1 0
4-Jul-12		667	330908	0.71	0.81	<1	<1	10	0.14	12.2	7.49	1 0
6-Jul-12		667	330904	0.43	0.61	<1	<1	<10	0.18	11.3	7.42	0 5
4-Jul-12		668	330905	0.75	0.98	<1	<1	510	0.16	12.2	7 53	1 0
5-Jul-12		668	330899	0.40	0.60	<1	<1	<10	0.17	11.4	7.47	0 5
4-Jul-12		668	330906	0.76	0.91	<1	<1	<10	0.16	10.3	7 50	1 0
5-Jul-12		668	330900	0.47	0.58	<1	<1	<10	0.17	9 9	7.44	1 0
5-Jul-12		677	330952	0.70	0.88	<1	<1	<10	0 20	11.4	7 50	0 5
6-Jul-12		677	330946	0.54	0.81	<1	<1	<10	0 21	12.5	7.42	1 0
5-Jul-12		677	330953	0.45	0.63	<1	<1	180	0.18	12.5	7 50	0 5
6-Jul-12		677	330947	0.54	0.75	<1	<1	80	0 21	13.2	7.49	1 0
5-Jul-12		678	330955	0.53	0.66	<1	<1	<10	0.18	11.9	7.46	0 5
6-Jul-12		678	330951	0.67	0.82	<1	<1	<10	0 20	12.3	7.44	0 5
5-Jul-12		678	330954	0.47	0.65	<1	<1	<10	0.17	12.6	7.45	1 0
6-Jul-12		678	330950	0.66	0.80	<1	<1	<10	0.18	12.5	7 50	0.5
6-Jul-12		685	330998	0.60	0.78	<1	<1	10	0.17	13.3	7 53	0.5
9-Jul-12		685	330992	0.47	0.70	<1	<1	<10	0.13	12.0	7 54	1.0
6-Jul-12		685	330997	0.58	0.83	<1	<1	<10	0.16	13.5	7 64	1.0
9-Jul-12		685	330991	0.60	0.74	<1	<1	<10	0.14	13.2	7 61	0.5

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
6-Jul-12		686	330999	0.40	0.63	<1	<1	10	0.15	12.1	7 56	0 5
9-Jul-12		686	330995	0.49	0.68	<1	<1	>3000	0.14	11.2	7 57	0 5
17-Jul-12		686	332325	0.27	0.45	<1	<1	<10	0.15	14.9	NA	NA
6-Jul-12		686	331000	0.61	0.83	<1	<1	10	0.14	11.6	7 55	1 0
9-Jul-12		686	330996	0.42	0.56	<1	<1	<10	0.14	13.5	7 62	1 0
9-Jul-12		718	331182	0.46	0.64	<1	<1	<10	0 24	14.2	7 57	1 0
10-Jul-12		718	331178	0.71	0.86	<1	<1	<10	0 24	16.6	7 38	1 0
9-Jul-12		718	331181	0.17	0.34	<1	<1	<10	0.17	14.5	7 62	1 0
10-Jul-12		718	331177	0.10	0.26	<1	<1	<10	0.16	14.5	7.40	0 5
9-Jul-12		721	331180	0.60	0.75	1	<1	<10	0.19	13.6	7 62	0 5
10-Jul-12		721	331174	0.75	0.90	<1	<1	<10	0 20	14.5	7.40	0 5
9-Jul-12		721	331179	0.51	0.66	<1	<1	<10	0 29	16.5	7 62	1 0
10-Jul-12		721	331173	0.78	0.98	<1	<1	<10	1.19	15.3	7 35	1 0
10-Jul-12		721	331127	0.78	0.98	<1	<1	<10	0.78	15.3	7.45	1 0
10-Jul-12		732	331222	0.91	1.07	<1	<1	<10	0 52	15.5	7.41	1 0
12-Jul-12		732	331216	0.90	1.02	<1	<1	<10	0.19	15.6	7.43	1 0
10-Jul-12		732	331221	0.81	1.02	<1	<1	<10	0 29	16.2	7 52	1 0
12-Jul-12		732	331215	0.73	0.92	<1	<1	10	0 21	16.4	7.48	0 5
10-Jul-12		733	331223	1.06	1.19	<1	<1	<10	0.15	17.9	7 55	1 0
11-Jul-12		733	331219	0.82	0.94	<1	<1	<10	0 54	17.1	7.49	1 0
10-Jul-12		733	331224	0.97	1.12	<1	<1	<10	0.15	17.1	7.49	0 5
11-Jul-12		733	331220	0.89	1.00	<1	<1	<10	0 52	16.0	7.41	1 0
11-Jul-12		743	331647	0.13	0.31	<1	<1	<10	0.19	12.0	7.47	0 5
16-Jul-12		743	331641	0.71	0.81	<1	<1	10	0.17	15.4	7.46	1 0
11-Jul-12		743	331646	0.92	1.12	<1	<1	<10	0 24	19.5	7.49	1 0
16-Jul-12		743	331640	0.32	0.44	<1	<1	<10	0.18	15.0	7.42	0 5
11-Jul-12		744	331648	1.03	1.23	<1	<1	<10	0.79	17.3	7 59	1 0
16-Jul-12		744	331644	0.66	0.77	<1	<1	<10	0.17	15.9	7 58	1 0
11-Jul-12		744	331649	0.62	0.76	<1	<1	<10	0 35	12.9	7.45	1.0
16-Jul-12		744	331645	0.81	0.91	<1	<1	<10	0 23	14.0	7.47	0.5

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
13-Jul-12		747	331695	0.88	1.07	<1	<1	<10	0.19	17.7	7 52	1 0
16-Jul-12		747	331689	0.63	0.85	<1	<1	<10	0 23	17.2	7.46	1 0
13-Jul-12		747	331696	0.79	0.92	<1	<1	<10	0 20	16.5	7.48	1 0
16-Jul-12		747	331690	0.76	0.98	<1	<1	<10	0 20	18.8	7.41	0 5
13-Jul-12		748	331697	0.85	1.05	<1	<1	<10	0 25	17.5	7.48	1 0
16-Jul-12		748	331693	0.80	0.93	<1	<1	<10	0.15	19.0	7.42	1 0
13-Jul-12		748	331698	0.66	0.85	<1	<1	<10	0 20	16.2	7 53	1 0
16-Jul-12		748	331694	0.81	0.93	<1	<1	<10	0.16	20.0	7.42	1 5
16-Jul-12		785	331910	0.75	0.91	<1	<1	<10	0.19	14.0	7 54	1 0
17-Jul-12		785	331904	0.58	0.76	<1	<1	<10	0.15	15.3	7.48	2 0
16-Jul-12		785	331911	0.55	0.72	<1	<1	10	0.16	14.2	7.43	1 0
17-Jul-12		785	331905	0.60	0.79	<1	<1	10	0.14	17.0	7.42	2 0
16-Jul-12		786	331913	0.60	0.80	<1	<1	<10	0.14	13.6	7.44	1 5
17-Jul-12		786	331909	0.72	0.89	<1	<1	<10	0.17	15.3	7.46	1 5
16-Jul-12		786	331912	0.66	0.81	<1	<1	<10	0.15	13.1	7.47	1 0
17-Jul-12		786	331908	0.66	0.86	<1	<1	<10	0 20	15.8	7.46	1 5
17-Jul-12		801	331976	0.69	0.86	<1	<1	<10	0.16	16.8	7 39	1 5
18-Jul-12		801	331970	0.64	0.87	<1	<1	<10	0.15	14.4	7 33	2 5
17-Jul-12		801	331977	0.71	0.92	<1	<1	<10	0.12	18.0	7.41	2 0
18-Jul-12		801	331971	0.76	0.92	<1	<1	10	0.15	14.6	7 35	2 5
17-Jul-12		802	331978	0.70	0.87	<1	<1	<10	0.13	15.9	7.42	1 5
18-Jul-12		802	331974	0.65	0.82	<1	<1	10	0 32	12.8	7.42	2 0
17-Jul-12		802	331979	0.66	0.85	<1	<1	<10	0.12	17.1	7 39	2 5
18-Jul-12		802	331975	0.71	0.84	<1	<1	<10	0 28	13.0	7.41	2 5
18-Jul-12		810	332358	0.51	0.66	<1	<1	<10	0.14	14.0	7.42	1 5
19-Jul-12		810	332352	0.70	0.86	<1	<1	10	0 21	16.8	7.42	0 5
18-Jul-12		810	332359	0.56	0.69	<1	<1	<10	0.14	14.2	7 39	1 0
19-Jul-12		810	332353	0.28	0.41	<1	<1	<10	0.19	14.1	7 37	0 5

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
18-Jul-12		812	332360	0.82	0.95	<1	<1	20	0.12	14.6	7.40	1 0
19-Jul-12		812	332356	0.59	0.78	<1	<1	<10	0.14	15.3	7.40	0 5
18-Jul-12		812	332361	0.44	0.56	<1	<1	<10	0.12	13.4	7.41	1 5
19-Jul-12		812	332357	0.60	0.83	<1	<1	<10	0.14	13.8	7.42	0 5
19-Jul-12		824	332419	0.43	0.64	<1	<1	<10	0.19	15.8	7 59	0 5
20-Jul-12		824	332413	0.86	1.04	<1	<1	<10	0 33	15.4	7 63	0 5
19-Jul-12		824	332420	0.78	0.94	<1	<1	<10	0 21	13.8	7 56	1 0
20-Jul-12		824	332414	0.45	0.65	<1	<1	<10	0 21	13.1	7 56	1 0
19-Jul-12		825	332421	0.60	0.78	<1	<1	<10	0.16	13.1	7 55	0 5
20-Jul-12		825	332417	0.99	1.11	<1	<1	<10	0 31	15.7	7.48	1 0
19-Jul-12		825	332422	0.81	0.99	<1	<1	10	0.76	13.5	7.49	0 5
20-Jul-12		825	332418	0.98	1.10	<1	<1	<10	0 32	15.5	7.48	0 5
20-Jul-12		837	332457	0.69	0.85	<1	<1	<10	0.76	12.1	7 52	1 0
23-Jul-12		837	332451	0.36	0.53	<1	<1	<10	0 30	15.8	7 59	0 5
20-Jul-12		837	332456	0.43	0.64	<1	<1	<10	0 26	12.8	7 51	0 5
23-Jul-12		837	332450	0.38	0.54	<1	<1	<10	0 30	15.8	7 60	1 0
20-Jul-12		838	332458	0.47	0.59	<1	<1	<10	0.15	14.5	7 53	1 0
23-Jul-12		838	332454	0.41	0.52	<1	<1	10	0 28	11.7	7 51	1 0
20-Jul-12		838	332459	0.47	0.62	<1	<1	<10	0 22	15.2	7 52	0 5
23-Jul-12		838	332455	0.42	0.50	<1	<1	<10	0 28	11.9	7.49	1 0
23-Jul-12		867	332650	0.80	0.92	<1	<1	<10	0.40	16.5	7 37	1 0
24-Jul-12		867	332644	0.63	0.79	<1	<1	40	0 27	16.6	7 31	0 5
23-Jul-12		867	332649	0.64	0.82	<1	<1	<10	0.17	15.5	7 58	0 5
24-Jul-12		867	332643	0.62	0.78	<1	<1	60	0 26	16.0	7.42	1 0
23-Jul-12		868	332652	0.15	0.29	<1	<1	10	0 28	14.0	7.43	1 0
24-Jul-12		868	332648	0.42	0.55	<1	<1	100	0 27	15.5	7.44	1 0
23-Jul-12		868	332651	0.19	0.32	<1	<1	<10	0 25	14.8	7.49	0 5
24-Jul-12		868	332647	0.17	0.32	<1	<1	110	0 54	14.2	7.41	0 5
24-Jul-12		879	332732	0.61	0.75	<1	<1	200	0 35	17.4	7 38	1 0
25-Jul-12		879	332726	0.65	0.77	<1	<1	<10	0 35	18.1	7.44	0 5

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
24-Jul-12		879	332731	0.30	0.50	<1	<1	280	0 30	16.8	7.40	1 5
25-Jul-12		879	332725	0.59	0.81	<1	<1	10	0.40	17.3	7.47	0 5
24-Jul-12		880	332734	0.55	0.75	<1	<1	50	0 50	14.9	7.42	1 0
25-Jul-12		880	332730	0.72	0.85	<1	<1	<10	0 29	16.6	7.47	1 0
24-Jul-12		880	332733	0.48	0.63	<1	<1	30	0.44	13.8	7 38	1 0
25-Jul-12		880	332729	0.67	0.84	<1	<1	<10	0 28	16.9	7 51	1 0
25-Jul-12		893	333135	0.62	0.82	<1	<1	10	0 23	14.3	7.49	1 0
26-Jul-12		893	333129	0.63	0.83	<1	<1	10	0 20	14.6	7 54	1 0
25-Jul-12		893	333134	0.62	0.82	<1	<1	<10	0.16	15.3	7.48	0 5
26-Jul-12		893	333128	0.63	0.81	<1	<1	<10	0.18	14.5	7.46	1 0
25-Jul-12		894	333137	0.45	0.65	<1	<1	<10	0 33	14.2	7 62	0 5
26-Jul-12		894	333133	0.54	0.66	<1	<1	120	0 33	13.9	7 61	1 0
25-Jul-12		894	333136	0.46	0.62	<1	<1	10	0 31	15.3	7 60	0 5
26-Jul-12		894	333132	0.43	0.59	<1	<1	<10	0 25	14.8	7 51	0 5
26-Jul-12		907	333174	0.82	0.96	3	<1	10	0 93	16.0	7 53	1 0
27-Jul-12		907	333168	0.86	0.99	<1	<1	<10	0 29	19.0	7 52	1 0
26-Jul-12		907	333173	0.72	0.91	<1	<1	<10	1.48	16.8	7 52	1 0
27-Jul-12		907	333167	0.57	0.80	<1	<1	10	0 21	16.0	7 66	1 0
26-Jul-12		908	333176	0.47	0.66	<1	<1	10	0.15	13.8	7.46	1 0
27-Jul-12		908	333172	0.43	0.63	<1	<1	<10	0 22	14.9	7.47	1 0
26-Jul-12		908	333175	0.56	0.77	<1	<1	<10	0.16	14.8	7 51	0 5
27-Jul-12		908	333171	0.43	0.59	<1	<1	<10	0 22	15.0	7.48	1 0
27-Jul-12		917	333214	0.44	0.64	<1	<1	<10	0.18	17.6	7 58	1 0
30-Jul-12		917	333208	0.77	0.93	<1	<1	<10	0 20	17.5	7 51	1 0
27-Jul-12		917	333213	0.56	0.77	<1	<1	10	0.18	16.2	7 53	1 0
30-Jul-12		917	333207	0.76	0.91	<1	<1	20	0.19	16.5	7.45	1 0
27-Jul-12		919	333215	0.32	0.50	<1	<1	10	0 28	14.9	7 61	1 0
30-Jul-12		919	333211	0.32	0.45	<1	<1	<10	0 26	16.9	7 53	1 0

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
27-Jul-12		919	333216	0.72	0.85	<1	<1	<10	0 60	16.1	7 62	1 0
30-Jul-12		919	333212	0.44	0.56	<1	<1	<10	0 23	16.3	7 56	1 0
30-Jul-12		950	333377	0.39	0.66	<1	<1	<10	0 28	14.3	7 64	0 5
31-Jul-12		950	333371	0.49	0.65	<1	<1	<10	0 26	14.9	7 61	1 0
30-Jul-12		950	333378	0.53	0.69	<1	<1	<10	0 32	14.5	7 58	1 0
31-Jul-12		950	333372	0.46	0.72	<1	<1	<10	0 22	15.5	7 52	0 5
30-Jul-12		951	333380	0.41	0.61	<1	<1	<10	0 26	14.8	7 58	0 5
31-Jul-12		951	333376	0.52	0.64	<1	<1	<10	0 20	14.5	7 57	1 0
30-Jul-12		951	333379	0.47	0.64	<1	<1	<10	0 27	13.4	7 61	1 0
31-Jul-12		951	333375	0.43	0.62	<1	<1	<10	0 23	13.8	7 58	1 0
31-Jul-12		960	333449	0.67	0.90	<1	<1	<10	0 26	12.7	7 58	1 0
1-Aug-12		960	333443	0.66	0.97	1	<1	10	0.74	14.3	7.49	1 0
3-Aug-12		960	333897	0.63	0.78	<1	<1	<10	0.18	13.4	NA	NA
31-Jul-12		960	333450	0.76	0.89	<1	<1	<10	0 29	12.6	7 52	0 5
1-Aug-12		960	333444	0.83	1.05	<1	<1	<10	0 69	14.1	7 57	1 0
31-Jul-12		961	333451	0.62	0.80	<1	<1	<10	0 24	15.0	7.42	1 0
1-Aug-12		961	333447	0.68	0.83	<1	<1	<10	0 27	14.7	7.46	1 0
31-Jul-12		961	333452	0.47	0.67	<1	<1	<10	0 26	14.9	7.49	1 0
1-Aug-12		961	333448	0.72	0.87	<1	<1	<10	0 25	14.5	7.48	1 0
1-Aug-12		974	333806	0.60	0.77	<1	<1	<10	0.15	15.0	7.40	1 0
2-Aug-12		974	333802	0.62	0.76	<1	<1	<10	0 22	16.3	7.47	1 0
1-Aug-12		974	333805	0.66	0.82	<1	<1	<10	0.15	15.6	7.47	1 0
2-Aug-12		974	333801	0.67	0.82	<1	<1	<10	0 22	15.9	7 51	1 0
1-Aug-12		975	333804	0.68	0.86	<1	<1	30	0 22	17.6	7.44	1 0
2-Aug-12		975	333798	0.58	0.70	<1	<1	<10	0 30	15.0	7.48	1 0
1-Aug-12		975	333803	0.55	0.76	<1	<1	10	0.17	14.5	7.45	1 0
2-Aug-12		975	333797	0.60	0.72	<1	<1	<10	0.41	14.0	7 52	1 0
2-Aug-12		979	333858	0.50	0.75	<1	<1	<10	0.18	16.0	7.45	1 0
3-Aug-12		979	333852	0.65	0.78	<1	<1	<10	0 63	16.7	7 51	1 0

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
2-Aug-12		979	333857	0.53	0.74	<1	<1	<10	0.17	14.9	7.46	1 0
3-Aug-12		979	333851	0.61	0.80	<1	<1	10	0 21	16.2	7 51	1 0
2-Aug-12		980	333859	0.44	0.64	<1	<1	<10	0.17	14.0	7 54	0 5
3-Aug-12		980	333855	0.61	0.77	<1	<1	<10	0 23	17.1	7 55	1 5
2-Aug-12		980	333860	0.72	0.84	<1	<1	<10	0.19	16.0	7.49	1 0
3-Aug-12		980	333856	0.51	0.67	<1	<1	<10	0 24	17.0	7 56	1 0
3-Aug-12		992	333891	0.60	0.78	<1	<1	<10	0 20	16.1	7 52	1 0
7-Aug-12		992	333885	0.42	0.53	<1	<1	<10	0.19	14.1	7 56	1 0
3-Aug-12		992	333892	0.51	0.71	<1	<1	<10	0 20	14.4	7.48	1 0
7-Aug-12		992	333886	0.47	0.58	<1	<1	<10	0 20	15.6	7 62	1 0
3-Aug-12		993	333894	0.36	0.48	<1	<1	<10	0.40	17.3	7 50	1 5
7-Aug-12		993	333890	0.69	0.81	<1	<1	<10	0 24	16.6	7 60	1 0
3-Aug-12		993	333893	0.38	0.58	<1	<1	10	0 26	17.4	7 51	1 0
7-Aug-12		993	333889	0.74	0.86	<1	<1	100	0.19	16.0	7 59	1 0

NR - No result NA - Not analyzed

Comments:

On May 18, 29 and 30, pre-flush bacteriological sample were not analyzed due to a technician error.

On May 24 and June 20 there were no results for HPC due to a contract lab error.

*Bracketed ( ) addresses indicate alternate location was sampled because initial location was inaccessible for the Post-Flush or Few days Post-Flush sampling.

No re-sample collected when a pre-flush sample test positive for bacti and the post-flush is negative.

APPENDIX C

2012 Water Main Cleaning Program Laboratory Analysis Summary Regional Monitoring

2012 Water Main Cleaning Program

Laboratory Analysis Report Regional Monitoring

SE08_

Date Sampled	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E. Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (ºC)	True Colour (tcu)	pH (units)	Dissolved Oxygen (mg/L)
7-May-12	324570	0.67	0.90	<1	<1	20	0.25	9.9	1.0	7.43	NA[1]
14-May-12	325235	0.75	0.99	<1	<1	<10	0.30	11.6	1.0	7.47	NA[1]
23-May-12	325973	0.62	0.82	<1	<1	<10	0.21	12.4	1.0	7.46	11.2
31-May-12	326685	0.65	0.81	<1	<1	<10	0.36	12.9	1.5	7.56	10.9
5-Jun-12	327429	0.80	0.96	<1	<1	10	0.21	14.0	1.0	7.48	11.2
12-Jun-12	328203	0.63	0.83	<1	<1	<10	0.16	15.3	2.0	7.51	11.6
19-Jun-12	328910	0.71	0.86	<1	<1	<10	0.18	16.4	1.0	7.45	10.0
26-Jun-12	329637	0.75	0.89	<1	<1	<10	0.25	16.1	0.5	7.46	10.0
3-Jul-12	330429	0.65	0.79	<1	<1	<10	0.20	19.2	2.0	7.48	10.0
10-Jul-12	331110	0.74	0.96	<1	<1	<10	0.18	20.5	1.0	7.56	9.1
16-Jul-12	331840	0.61	0.83	<1	<1	<10	0.21	21.4	2.0	7.48	9.1
24-Jul-12	332627	0.64	0.80	<1	<1	10	0.19	21.4	1.0	7.45	9.2
31-Jul-12	333349	0.63	0.81	<1	<1	<10	0.29	21.2	1.0	7.52	9.4
8-Aug-12	333948	0.66	0.82	<1	<1	<10	0.23	21.4	1.5	7.47	NA[2]
14-Aug-12	334711	0.66	0.81	<1	<1	<10	0.24	20.8	0.5	7.52	9.9

SW04_

Date Sampled	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E. Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (ºC)	True Colour (tcu)	pH (units)	Dissolved Oxygen (mg/L)
7-May-12	324579	0.77	0.95	<1	<1	30	0.31	7.9	1.5	7.45	NA[1]
14-May-12	325244	0.86	1.03	<1	<1	<10	0.14	9.2	1.0	7.29	NA[1]
22-May-12	325982	0.62	0.79	<1	<1	<10	0.17	10.3	1.0	7.41	11.3
31-May-12	326694	0.78	0.99	<1	<1	<10	0.15	11.4	2.0	7.52	11.1
5-Jun-12	327438	0.81	0.97	<1	<1	10	0.36	11.5	1.0	7.48	11.3
12-Jun-12	328212	0.74	0.93	<1	<1	<10	0.15	12.9	2.5	7.46	11.6
19-Jun-12	328919	0.79	0.94	<1	<1	<10	0.15	13.8	1.0	7.42	10.1
26-Jun-12	329646	0.78	0.94	<1	<1	<10	0.14	15.1	0.5	7.43	10.0
3-Jul-12	330422	0.74	0.95	<1	<1	<10	0.19	16.4	2.0	7.41	10.3
10-Jul-12	331103	0.83	1.02	<1	<1	<10	0.17	19.0	1.0	7.46	9.5
16-Jul-12	331833	0.74	0.89	<1	<1	<10	0.13	17.6	2.0	7.43	9.3
24-Jul-12	332620	0.76	0.90	<1	<1	<10	0.20	19.0	2.0	7.39	9.4
31-Jul-12	333342	0.76	0.90	<1	<1	10	0.19	19.1	1.0	7.45	9.5
8-Aug-12	333957	0.78	0.94	<1	<1	<10	0.32	18.9	1.0	7.45	9.3
14-Aug-12	334720	0.71	0.92	<1	<1	<10	0.19	19.8	1.0	7.47	10.2

SW06_

Date Sampled	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E. Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (ºC)	True Colour (tcu)	pH (units)	Dissolved Oxygen (mg/L)
1-May-12	323961	0.83	1.06	<1	<1	<10	0.16	8.3	1.0	7.47	NA[1]
8-May-12	324581	0.84	1.14	<1	<1	<10	0.19	10.1	1.0	7.47	NA[1]
15-May-12	325246	0.95	1.13	<1	<1	<10	0.15	12.6	1.0	7.56	11.9
22-May-12	325984	0.83	1.04	<1	<1	<10	0.14	14.2	1.0	7.41	11.2
28-May-12	326696	0.83	1.04	<1	<1	<10	0.15	14.7	2.0	7.52	11.0
4-Jun-12	327440	0.90	1.10	<1	<1	<10	0.16	14.8	1.0	7.40	11.5
12-Jun-12	328214	0.90	1.07	<1	<1	<10	0.14	17.5	2.0	7.48	10.6
18-Jun-12	328921	0.98	1.14	<1	<1	<10	0.15	18.2	1.0	7.42	10.3
26-Jun-12	329648	0.89	1.08	<1	<1	<10	0.15	18.7	1.0	7.45	10.2
3-Jul-12	330423	0.87	1.06	<1	<1	<10	0.16	21.5	2.0	7.44	10.2
9-Jul-12	331104	0.86	1.06	<1	<1	<10	0.17	22.7	1.0	7.46	9.5
16-Jul-12	331834	0.96	1.13	<1	<1	<10	0.20	23.9	2.0	7.39	9.5
24-Jul-12	332621	0.92	1.16	<1	<1	60	0.18	23.6	1.0	7.39	9.1
31-Jul-12	333343	0.99	1.20	<1	<1	<10	0.21	23.6	1.0	7.49	9.7
7-Aug-12	333959	0.80	0.99	<1	<1	<10	0.18	23.0	1.0	7.47	10.7
14-Aug-12	334722	0.96	1.11	<1	<1	<10	0.20	22.2	0.5	7.45	10.2

SW07_

Date Sampled	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E. Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (ºC)	True Colour (tcu)	pH (units)	Dissolved Oxygen (mg/L)
7-May-12	324582	0.79	0.97	<1	<1	<10	0.19	10.3	1.0	7.33	NA[1]
14-May-12	325247	1.05	1.23	<1	<1	<10	0.22	11.7	1.0	7.46	NA[1]
22-May-12	325985	0.67	0.85	<1	<1	<10	0.14	10.2	1.0	7.41	11.3
31-May-12	326697	0.81	0.99	<1	<1	<10	0.18	11.6	1.5	7.56	11.1
5-Jun-12	327441	0.83	1.00	<1	<1	20	0.17	13.0	1.0	7.49	11.3
12-Jun-12	328215	0.72	0.91	<1	<1	<10	0.14	14.4	2.0	7.46	11.6
19-Jun-12	328922	0.73	0.89	<1	<1	<10	0.43	13.8	1.5	7.41	10.1
26-Jun-12	329649	0.87	1.05	<1	<1	10	0.24	15.5	1.0	7.52	9.9
3-Jul-12	330424	0.77	0.92	<1	<1	<10	0.25	16.8	2.0	7.43	10.0
10-Jul-12	331105	0.97	1.11	<1	<1	<10	0.19	19.4	1.0	7.49	9.4
16-Jul-12	331835	0.74	0.97	<1	<1	<10	0.21	19.0	2.0	7.43	9.4
24-Jul-12	332622	0.78	0.98	<1	<1	<10	0.15	21.1	2.0	7.38	9.4
31-Jul-12	333344	0.79	0.93	<1	<1	<10	0.24	19.5	1.0	7.44	9.4
8-Aug-12	333960	0.80	0.95	<1	<1	<10	0.21	18.8	1.5	7.44	9.4
14-Aug-12	334723	0.76	0.92	<1	<1	<10	0.23	19.9	1.5	7.46	10.0

SW08

Date Sampled	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E. Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (ºC)	True Colour (tcu)	pH (units)	Dissolved Oxygen (mg/L)
7-May-12	324583	0.50	0.66	<1	<1	<10	0.19	9.0	1.0	7.42	NA[1]
14-May-12	325248	0.83	0.99	<1	<1	<10	0.24	9.6	1.0	7.54	NA[1]
22-May-12	325986	0.64	0.83	<1	<1	<10	0.14	10.2	1.0	7.33	11.2
28-May-12	326698	0.52	0.69	<1	<1	<10	0.15	10.5	2.0	7.61	11.3
5-Jun-12	327442	0.64	0.79	<1	<1	20	0.14	10.7	1.0	7.54	11.4
11-Jun-12	328216	0.56	0.76	<1	<1	<10	0.13	12.1	1.0	7.50	10.7
19-Jun-12	328923	0.59	0.78	<1	<1	<10	0.18	12.4	1.0	7.42	10.1
26-Jun-12	329650	0.72	0.87	<1	<1	<10	0.13	13.2	1.0	7.44	10.1
3-Jul-12	330425	0.78	0.96	<1	<1	<10	0.35	15.0	2.0	7.48	10.1
9-Jul-12	331106	0.79	1.00	<1	<1	<10	0.31	15.9	1.0	7.48	9.6
16-Jul-12	331836	0.64	0.83	<1	<1	<10	0.34	16.8	2.0	7.43	9.3
24-Jul-12	332623	0.62	0.79	<1	<1	10	0.27	21.1	1.0	7.43	9.4
31-Jul-12	333345	0.54	0.74	<1	<1	<10	3.84	18.5	1.0	7.51	9.3
01-Aug-12*	333850	NA	NA	NA	NA	NA	0.31	NA	NA	NA	NA
8-Aug-12	333961	0.61	0.82	<1	<1	<10	0.25	19.1	1.5	7.47	NA[2]
13-Aug-12	334724	0.47	0.62	<1	<1	<10	0.28	18.0	0.5	7.52	10.3

*On August 1, the location was re-sampled due to a high turbidity of 3.84 NTU on July 31. Other parameters were not analysed for the re-sample.

SW14_

Date Sampled	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E. Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (ºC)	True Colour (tcu)	pH (units)	Dissolved Oxygen (mg/L)
7-May-12	324588	0.77	0.92	<1	<1	<10	0.24	7.9	1.0	7.40	NA[1]
14-May-12	325253	0.84	1.01	<1	<1	<10	0.14	9.3	1.0	7.49	NA[1]
22-May-12	325991	0.59	0.77	<1	<1	<10	0.15	10.3	1.0	7.51	11.2
31-May-12	326703	0.55	0.71	<1	<1	<10	0.52	12.5	2.0	7.56	10.9
5-Jun-12	327447	0.68	0.85	<1	<1	<10	0.24	12.9	1.0	7.46	11.0
12-Jun-12	328221	0.51	0.67	<1	<1	<10	0.33	14.3	2.0	7.49	11.3
19-Jun-12	328928	0.53	0.72	<1	<1	<10	0.32	14.5	1.0	7.46	9.9
26-Jun-12	329655	0.58	0.79	<1	<1	<10	0.36	16.1	1.0	7.44	9.8
3-Jul-12	330427	0.54	0.72	<1	<1	<10	0.36	17.7	2.0	7.49	9.9
10-Jul-12	331108	0.54	0.68	<1	<1	<10	0.41	18.1	1.0	7.52	9.2
16-Jul-12	331838	0.54	0.71	<1	<1	10	0.31	19.0	2.0	7.44	9.0
24-Jul-12	332625	0.59	0.76	<1	<1	10	0.34	21.3	1.0	7.33	9.2
31-Jul-12	333347	0.55	0.73	<1	<1	<10	0.22	20.2	1.0	7.42	9.2
8-Aug-12	333966	0.46	0.58	<1	<1	<10	0.22	20.6	1.5	7.37	9.3
14-Aug-12	334729	0.54	0.70	<1	<1	<10	0.32	20.2	0.5	7.45	9.7

NA: Not analysed NR: No result

[1]Dissolved oxygen was not analysed prior to May 14, 2012.

[2]Dissolved oxygen was not analysed due to instrument error/malfunction.

APPENDIX D

2012 Water Main Cleaning Program Laboratory Analysis Summary Sensitive Users Monitoring

2012 Water Main Cleaning Program

Laboratory Analysis Report Sensitive Users Monitoring

Date Sampled	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E. Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (ºC)	True Colour (tcu)	pH (units)	Dissolved Oxygen (mg/L)
1-May-12	324028	0.69	0.86	<1	<1	<10	0.31	8 0	1.0	7.46	NA[1]
7-May-12	324530	0.58	0.73	<1	<1	<10	0.19	8.4	1.0	7.58	NA[1]
14-May-12	325307	0.66	0.84	<1	<1	<10	0.21	9 0	2.0	7.32	12.1
22-May-12	326041	0.53	0.74	<1	<1	<10	0.17	9.1	1.0	7.39	11.3
31-May-12	326739	0.67	0.89	<1	<1	<10	0.42	10.4	1.0	7 59	11.1
5-Jun-12	327501	0.66	0.85	<1	<1	<10	0.15	10.8	1.0	7 30	11.5
12-Jun-12	328257	0.63	0.79	<1	<1	<10	0.16	11.8	2.0	7.45	12.0
19-Jun-12	328982	0.71	0.90	<1	<1	<10	0.18	14.1	1.0	7.46	10.2
26-Jun-12	329709	0.72	0.91	<1	<1	<10	0.26	13.2	1.0	7.44	10.0
3-Jul-12	330421	0.76	0.95	<1	<1	<10	0.16	14 8	2.0	7 38	10.4
9-Jul-12	331126	0.51	0.66	<1	<1	<10	0 29	16 5	1.0	7.62	9.5
10-Jul-12	331102	0.78	0.98	<1	<1	<10	0.78	15 3	1.0	7.45	9.5
10-Jul-12	331127	0.78	0.98	<1	<1	<10	0.78	15 3	1.0	7.45	9.5
11-Jul-12	331128	0.74	0.95	<1	<1	<10	0 34	16 9	1.0	7 38	9.6
12-Jul-12	331129	0.86	1.03	<1	<1	<10	0 30	15 9	1.0	7 39	9.6
13-Jul-12	331130	0.77	0.93	<1	<1	<10	0 23	16 5	1.0	7.44	9.3
16-Jul-12	331832	0.79	0.94	<1	<1	<10	0 26	16.4	2.5	7.44	9.4
24-Jul-12	332619	0.85	1.03	<1	<1	<10	0 87	20 2	1.0	7 37	9.5
31-Jul-12	333341	0.79	0.96	<1	<1	<10	0 36	17.7	1.0	7.44	9.3
8-Aug-12	334016	0.56	0.73	<1	<1	<10	0 25	18.4	1.0	7.43	NA[2]
14-Aug-12	334795	0.66	0.93	<1	<1	<10	0 25	19 5	1.0	7.43	10.0

Date Sampled	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E. Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (ºC)	True Colour (tcu)	pH (units)	Dissolved Oxygen (mg/L)
1-May-12	324027	0.64	0.86	<1	<1	<10	0.25	8.1	1.0	7.48	NA[1]
7-May-12	324529	0.67	0.82	<1	<1	<10	0.21	8 5	1.0	7.57	NA[1]
14-May-12	325306	0.79	0.99	<1	<1	<10	0.24	9.1	1.0	7.36	11.8
22-May-12	326040	0.71	0.88	<1	<1	<10	0.21	10.1	1.0	7.37	11.2
31-May-12	326738	0.63	0.85	<1	<1	<10	0.18	11.3	2.0	7.51	11.1
5-Jun-12	327500	0.76	0.91	<1	<1	<10	0.18	12.1	1.0	7.23	11.3
12-Jun-12	328256	0.62	0.77	<1	<1	<10	0.18	13.3	2.0	7.47	11.5
20-Jun-12	328981	0.59	0.75	<1	<1	NR[3]	0.27	14.8	0.5	7.43	9.9
26-Jun-12	329708	0.74	0.91	<1	<1	<10	0.32	15.3	1.0	7.43	10.0
3-Jul-12	330420	0.69	0.89	<1	<1	<10	0.41	18.0	2.0	7.38	10.1
9-Jul-12	331122	0.56	0.71	<1	<1	<10	1.14	18.0	2.0	7.51	9.5
9-Jul-12	331121	0.56	0.71	<1	<1	<10	0.20	18.0	1.0	7.58	9.5
10-Jul-12	331101	0.71	0.89	<1	<1	<10	0.28	15.4	1.0	7.44	9.4
11-Jul-12	331123	0.72	0.89	<1	<1	<10	0.25	20.5	1.0	7.35	9.5
12-Jul-12	331124	0.72	0.95	<1	<1	<10	0.22	19.5	1.0	7.37	9.5
13-Jul-12	331125	0.71	0.88	<1	<1	<10	0.31	20.5	1.0	7.40	9.1
16-Jul-12	331831	0.67	0.87	<1	<1	<10	0.31	19.1	2.0	7.39	9.3
24-Jul-12	332618	0.76	0.92	<1	<1	<10	0.33	20.3	1.0	7.50	9.4
31-Jul-12	333340	0.76	0.93	<1	<1	<10	0.30	20.7	1.0	7.48	9.4
8-Aug-12	334015	0.67	0.87	<1	<1	<10	0.35	20.2	1.0	7.44	NA[2]
14-Aug-12	334794	0.79	0.93	<1	<1	<10	0.41	20.0	1.0	7.46	9.9

Date Sampled	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E. Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (ºC)	True Colour (tcu)	pH (units)	Dissolved Oxygen (mg/L)
7-May-12	324590	0.78	1.03	<1	<1	<10	0.20	8.6	1.0	7.51	NA[1]
14-May-12	325255	0.90	1.09	<1	<1	<10	0.21	9.4	1.0	7.53	NA[1]
22-May-12	325993	0.71	0.86	<1	<1	<10	0.15	9 8	1.0	7.46	11.2
31-May-12	326705	0.61	0.78	<1	<1	<10	0.17	11.4	2.0	7.64	10.8
5-Jun-12	327449	0.84	1.00	<1	<1	10	0.22	12.4	1.0	7.53	11.1
12-Jun-12	328223	0.65	0.81	<1	<1	<10	0.24	12.9	2.0	7.50	11.6
18-Jun-12	328930	0.68	0.84	<1	<1	<10	1.37	14.7	2.0	7 52	9.7
19-Jun-12	329093	0.77	0.96	<1	<1	<10	0 56	15 3	1.0	7.52	10.1
19-Jun-12	329092	0.74	0.89	<1	<1	<10	0.49	14.1	1.0	7.45	10.1
20-Jun-12	329094	0.80	0.95	<1	<1	NR[3]	1 21	15 2	1.0	7.63	9.9
21-Jun-12	329096	0.70	0.86	<1	<1	<10	0 39	15.7	1.0	7.60	9.9
21-Jun-12	329095	0.62	0.80	<1	<1	<10	0 97	14.1	1.0	7.52	10.1
26-Jun-12	329657	0.71	0.91	<1	<1	<10	0.19	15.3	1.0	7.43	9.9
3-Jul-12	330428	0.73	0.95	<1	<1	<10	0.24	16.8	2.0	7.53	10.1
10-Jul-12	331109	0.68	0.84	<1	<1	10	0.17	20.4	1.0	7.61	9.3
16-Jul-12	331839	0.60	0.81	<1	<1	<10	0.24	18.4	2.0	7.50	9.1
24-Jul-12	332626	0.87	1.02	<1	<1	130	0.18	21.6	1.0	7.42	9.1
31-Jul-12	333348	0.60	0.75	<1	<1	<10	0.20	19.5	1.0	7.48	9.1
8-Aug-12	333968	0.54	0.70	<1	<1	20	0.24	20.1	1.5	7.57	9.0
14-Aug-12	334731	0.72	0.88	<1	<1	<10	0.28	20.1	0.5	7.68	9.0

Date Sampled	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E. Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (ºC)	True Colour (tcu)	pH (units)	Dissolved Oxygen (mg/L)
7-May-12	324585	0.59	0.80	<1	<1	<10	0.33	12.1	1.0	7.43	NA[1]
14-May-12	325250	0.79	1.03	<1	<1	<10	0.91	12.1	1.0	7.54	NA[1]
22-May-12	325988	0.67	0.87	<1	<1	<10	0.66	12 0	1.0	7.41	11.2
31-May-12	326700	0.67	0.86	<1	<1	<10	0 28	11.7	1.0	7.60	11.0
5-Jun-12	327444	0.79	1.00	<1	<1	<10	0 29	14.4	1.0	7.52	11.2
12-Jun-12	328218	0.41	0.62	<1	<1	<10	1 36	14.7	2.5	7.50	11.4
14-June-12*	328878	NA	NA	NA	NA	NA	0 59	NA	NA	NA	NA
19-Jun-12	328925	0.60	0.79	<1	<1	<10	0 28	13 3	1.0	7.46	10.0
26-Jun-12	329652	0.72	0.87	<1	<1	<10	0.73	16.1	1.0	7.49	9.9
3-Jul-12	330426	0.61	0.80	<1	<1	<10	0.48	19 0	2.5	7.45	10.1
9-Jul-12	331131	0.66	0.85	<1	<1	<10	0.60	18.6	1.5	7.52	9.4
10-Jul-12	331107	0.78	0.96	<1	<1	<10	0 59	20.7	1.0	7.47	9.4
10-Jul-12	331132	0.78	0.96	<1	<1	<10	0.49	20.7	1.0	7.44	9.4
11-Jul-12	331133	0.80	0.95	<1	<1	<10	0.66	20 9	1.0	7.41	9.4
12-Jul-12	331134	0.84	1.00	<1	<1	<10	0.77	20 0	1.0	7.43	9.5
13-Jul-12	331135	0.65	0.82	<1	<1	<10	0 50	20 2	1.0	7.42	9.0
16-Jul-12	331797	0.59	0.79	<1	<1	20	0.42	21.7	2.5	7.51	9.1
24-Jul-12	332566	0.61	0.76	<1	<1	40	0 58	21 8	1.0	7.39	9.1
31-Jul-12	333288	0.65	0.78	<1	<1	<10	0 38	22.1	1.0	7.44	9.3
8-Aug-12	333963	0.52	0.69	<1	<1	<10	0.44	22 0	1.5	7.47	NA[2]
14-Aug-12	334726	0.70	0.82	<1	<1	<10	0 37	20 8	0.5	7.52	9.9

*On June 14, the location was re-sampled due to a high turbidity of 1.36 NTU on June 12. Other parameters were not analysed for the re-sample.

NA: Not analysed NR: No result
NOTE:
[1]Dissolved oxygen was not analysed prior to May 14, 2012.
[2]Dissolved oxygen was not analysed due to instrument error/malfunction.
[3]No HPC result reported by the contract lab.

APPENDIX E

2012 Water Main Cleaning Program Laboratory Analysis Summary Environmental Monitoring

2012 Water Main Cleaning Program

Laboratory Analysis Report Environmental Monitoring

Date Sampled	Sample Location	Hydrant Number	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)	TSS (mg/L)	BOD_5 (mg/L)	DO (mg/L)	Soluble Calcium (mg/L)	Soluble Copper (mg/L)	Soluble Iron (mg/L)	Soluble Magnesium (mg/L)	Soluble Manganese (mg/L)	Soluble Sodium (mg/L)	Soluble Lead (mg/L)	Soluble Zinc (mg/L)	Total Calcium (mg/L)	Total Copper (mg/L)	Total Iron (mg/L)	Total Magnesium (mg/L)	Total Manganese (mg/L)	Total Sodium (mg/L)	Total Lead (mg/L)	Total Zinc (mg/L)
7-May-12	Hydrant Flush Comp.	60004003	30	324520	<0.02	<0.02	29.4	8.7	7.93	2.5	45	4	11.5	21.8	0.01	1.25	5.6	0.745	30.5	<0.001	0.001	21.5	0.036	6.4	5.8	1.330	30.4	0.002	0.015
7-May-12	Hydrant Flush,	60003982	29	324521	<0.02	<0.02																							
8-May-12	Hydrant Flush Comp.	60004320	36	325044	<0.02	<0.02	9.43	9.1	7.81	1.0	13	3	11.6	21.9	0.01	1.05	5.3	0.515	30.3	<0.001	0.002	22.5	0.020	2.2	5.8	0.771	30.0	<0.001	0.011
8-May-12	Hydrant Flush,	60005346	39	325045	<0.02	<0.02																							
9-May-12	Hydrant Flush Comp.	60001453	49	325097	<0.02	<0.02	11.9	10.4	7.91	1.0	19	5	11.5	21.7	<0.01	0.11	5.6	0.573	29.3	<0.001	<0.001	22.3	0.027	1.8	5.7	1.100	30.4	<0.001	0.012
9-May-12	Hydrant Flush,	70020348	50	325098	<0.02	<0.02																							
11-May-12	Hydrant Flush Comp.	60004445	63	325191	<0.02	<0.02	1.89	11.1	7.83	3.0	<4	3	11.0	20.2	0.03	0.32	5.6	0.078	30.3	<0.001	<0.001	22.1	0.045	0.7	6.4	0.093	32.1	<0.001	<0.003
11-May-12	Hydrant Flush,	60004091	62	325192	<0.02	<0.02																							
14-May-12	Hydrant Flush Comp.	70007303	96	325355	<0.02	<0.02	0.73	10.9	7.75	2.0	<4	2	11.0	20.3	<0.01	0.02	5.4	0.011	29.1	<0.001	<0.001	20.3	0.005	0.1	5.6	0.042	29.3	<0.001	<0.003
14-May-12	Hydrant Flush,	70005216	93	325356	<0.02	<0.02																							
15-May-12	Hydrant Flush Comp.	70007290	102	325399	<0.02	<0.02	14.9	10.4	7.76	2.0	18	3	11.3	18.0	<0.01	0.06	4.9	0.202	27.0	<0.001	<0.001	17.9	0.011	0.7	5.0	0.272	27.6	0.001	<0.003
15-May-12	Hydrant Flush,	70007289	103	325400	<0.02	<0.02																							
16-May-12	Hydrant Flush Comp.	60004108	113	325807	<0.02	<0.02	30.2	11.7	7.88	2.0	36	5	10.7	20.2	<0.01	0.89	5.5	0.561	29.5	<0.001	<0.001	20.7	0.017	4.2	5.7	0.911	29.8	0.004	0.008
16-May-12	Hydrant Flush,	60005328	112	325808	<0.02	<0.02																							
17-May-12	Hydrant Flush Comp.	60004203	129	325867	<0.02	<0.02	6.93	13.4	7.90	1.0	8	<2	10.5	19.0	<0.01	0.03	5.5	0.009	28.6	<0.001	<0.001	21.9	0.007	0.9	5.5	0.100	32.5	<0.001	<0.003
17-May-12	Hydrant Flush,	60004210	130	325868	<0.02	<0.02																							
18-May-12	Hydrant Flush Comp.	60005386	139	325912	<0.02	<0.02	14.4	12.7	7.75	1.5	17	4	10.4	24.4	<0.01	0.42	5.8	0.509	33.8	<0.001	<0.001	24.3	0.020	1.7	6.4	0.629	35.3	<0.001	0.029
18-May-12	Hydrant Flush,	60004160	138	325913	<0.02	<0.02																							
22-May-12	Hydrant Flush Comp.	60003604	187	326065	<0.02	<0.02	9.18	14.2	7.84	1.0	13	NR	10.2	24.2	<0.01	0.61	5.9	0.246	34.0	<0.001	<0.001	24.0	0.018	0.9	6.4	0.352	35.0	<0.001	<0.003
22-May-12	Hydrant Flush,	60001373	188	326066	<0.02	<0.02																							
23-May-12	Hydrant Flush Comp.	60003780	196	326530	<0.02	<0.02	21.4	11.7	7.88	2.0	27	NR	10.6	22.0	<0.01	0.20	5.8	0.126	31.8	<0.001	<0.001	22.4	0.046	2.1	5.9	0.657	35.3	0.001	0.019
23-May-12	Hydrant Flush,	60004791	197	326531	<0.02	<0.02																							
24-May-12	Hydrant Flush Comp.	60003768	208	326568	<0.02	<0.02	32.4	12.1	7.69	2.5	36	<2	10.5	22.8	<0.01	<0.01	5.7	0.068	31.5	<0.001	<0.001	23.0	0.003	0.1	6.3	0.211	32.3	<0.001	<0.003
24-May-12	Hydrant Flush,	60003768	209	326569	<0.02	<0.02																							
25-May-12	Hydrant Flush Comp.	70004875	222	326603	<0.02	<0.02	1.65	10.2	7.85	1.0	<4	3	11.0	17.9	<0.01	0.01	5.2	0.055	26.6	<0.001	<0.001	17.9	0.005	0.2	5.3	0.061	27.0	<0.001	<0.003
25-May-12	Hydrant Flush,	60005119	219	326604	<0.02	<0.02																							
28-May-12	Hydrant Flush Comp.	70005856	259	326808	<0.02	<0.02	17.3	11.9	7.85	2.5	35	<2	10.8	19.1	0.01	0.82	5.3	0.820	26.1	<0.001	0.003	19.5	0.038	3.0	5.3	1.360	27.6	0.001	0.021
28-May-12	Hydrant Flush,	60003484	253	326809	<0.02	<0.02																							
29-May-12	Hydrant Flush Comp.	60003578	268	326843	<0.02	<0.02	30.3	10.1	7.91	0.5	42	2	10.8	20.1	<0.01	0.17	5.8	0.427	28.7	<0.001	<0.001	21.3	0.033	2.2	5.9	0.880	29.3	0.002	0.014
29-May-12	Hydrant Flush,	60007401	265	326844	<0.02	<0.02																							
30-May-12	Hydrant Flush Comp.	70003038	282	327245	<0.02	<0.02	6.11	10.2	7.92	2.0	9	3	10.7	20.5	<0.01	0.27	5.3	0.752	30.8	<0.001	<0.001	20.4	0.031	11.5	5.3	1.190	30.9	0.002	0.014
30-May-12	Hydrant Flush,	70002454	278	327246	<0.02	<0.02																							
31-May-12	Hydrant Flush Comp.	60001574	292	327285	<0.02	<0.02	65.5	15.1	7.80	0.5	52	4	9.8	19.5	<0.01	0.07	5.5	0.702	30.7	<0.001	<0.001	19.2	0.028	2.0	5.6	0.999	30.3	<0.001	0.011
31-May-12	Hydrant Flush,	60000882	289	327286	<0.02	<0.02																							
1-Jun-12	Hydrant Flush Comp.	60000867	301	327328	<0.02	<0.02	20.6	14.5	7.70	1.0	22	7	9.9	23.7	<0.01	0.25	6.4	0.175	35.1	<0.001	<0.001	24.9	0.012	4.4	6.9	0.238	35.6	0.002	0.019
1-Jun-12	Hydrant Flush,	60000867	302	327329	<0.02	<0.02																							
4-Jun-12	Hydrant Flush Comp.	70004607	335	327518	<0.02	<0.02	13.2	NR	7.82	1.5	29	7	NR	24.0	0.01	1.16	6.2	1.140	35.1	<0.001	0.006	24.4	0.025	2.6	6.1	1.290	36.7	0.001	0.016
4-Jun-12	Hydrant Flush,	70004607	334	327519	<0.02	<0.02																							

Date Sampled	Sample Location	Hydrant Number	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)	TSS (mg/L)	BOD_5 (mg/L)	DO (mg/L)	Soluble Calcium (mg/L)	Soluble Copper (mg/L)	Soluble Iron (mg/L)	Soluble Magnesium (mg/L)	Soluble Manganese (mg/L)	Soluble Sodium (mg/L)	Soluble Lead (mg/L)	Soluble Zinc (mg/L)	Total Calcium (mg/L)	Total Copper (mg/L)	Total Iron (mg/L)	Total Magnesium (mg/L)	Total Manganese (mg/L)	Total Sodium (mg/L)	Total Lead (mg/L)	Total Zinc (mg/L)
5-Jun-12	Hydrant Flush Comp.	60000782	348	327932	<0.02	<0.02	19.8	15.4	7.84	1.0	33	6	10.2	24.5	<0.01	0.14	6.3	0.550	36.3	<0.001	<0.001	24.6	0.018	1.9	6.3	0.636	36.8	0.010	0.008
5-Jun-12	Hydrant Flush,	60000568	344	327933	<0.02	<0.02																							
6-Jun-12	Hydrant Flush Comp.	60000777	358	327997	<0.02	<0.02	44.4	14.5	7.79	1.5	65	7	9.9	20.6	<0.01	0.08	5.2	1.300	33.5	<0.001	<0.001	24.9	0.044	11.5	6.8	1.880	34.3	0.004	0.022
6-Jun-12	Hydrant Flush,	60001349	356	327998	<0.02	<0.02																							
7-Jun-12	Hydrant Flush Comp.	60003932	372	328075	<0.02	<0.02	24.6	14.9	7.68	1.5	22	<2	10.3	19.8	<0.01	2.11	5.5	0.326	29.6	<0.001	0.002	20.4	0.015	3.8	5.7	0.508	30.7	<0.001	0.004
7-Jun-12	Hydrant Flush,	60000760	370	328076	<0.02	<0.02																							
8-Jun-12	Hydrant Flush Comp.	60003391	381	328126	<0.02	<0.02	26.2	14.7	7.83	1.0	26	6	9.6	19.3	<0.01	0.17	5.5	0.139	29.6	<0.001	<0.001	21.5	0.009	4.0	6.0	0.208	31.6	<0.001	<0.003
8-Jun-12	Hydrant Flush,	60003391	380	328127	<0.02	<0.02																							
11-Jun-12	Hydrant Flush Comp.	60000763	419	328339	<0.02	<0.02	127	10.8	7.58	1.5	114	2	10.3	21.3	<0.01	0.61	5.7	0.382	31.1	<0.001	<0.001	24.4	0.027	8.9	6.0	1.020	32.7	0.004	0.012
11-Jun-12	Hydrant Flush,	70011266	419	328340	<0.02	<0.02																							
12-Jun-12	Hydrant Flush Comp.	60001970	424	328701	<0.02	<0.02	31.1	10.9	7.85	0.5	25	5	11.7	19.5	<0.01	0.09	5.8	0.294	29.6	<0.001	<0.001	19.6	0.011	1.4	5.9	0.398	32.9	0.001	<0.003
12-Jun-12	Hydrant Flush,	60000509	430	328702	<0.02	<0.02																							
13-Jun-12	Hydrant Flush Comp.	60000510	440	328753	<0.02	<0.02	8.92	10.3	7.70	2.0	5	9	10.5	17.5	<0.01	0.02	4.5	0.043	26.8	<0.001	<0.001	19.7	0.002	0.8	4.9	0.050	30.2	<0.001	<0.003
13-Jun-12	Hydrant Flush,	60000515	439	328754	<0.02	<0.02																							
14-Jun-12	Hydrant Flush Comp.	60006445	449	328849	<0.02	<0.02	13.9	13.8	7.83	2.5	15	5	10.0	18.8	<0.01	0.62	5.0	0.445	27.4	<0.001	<0.001	18.6	0.019	3.9	4.9	0.653	27.7	0.002	0.009
14-Jun-12	Hydrant Flush,	60006446	450	328850	<0.02	<0.02																							
15-Jun-12	Hydrant Flush Comp.	60004432	462	328869	<0.02	<0.02	204	12.1	7.89	1.0	302	14	10.8	20.3	0.07	0.58	5.4	0.140	29.0	<0.001	<0.001	20.7	0.013	3.7	5.5	0.407	29.2	0.003	0.017
15-Jun-12	Hydrant Flush,	60007470	459	328870	<0.02	<0.02																							
18-Jun-12	Hydrant Flush Comp.	70002036	493	329060	<0.02	<0.02	3.98	16.1	7.84	1.0	4	<2	9.4	18.9	<0.01	0.04	5.3	0.033	27.3	<0.001	<0.001	22.0	0.005	0.5	5.4	0.110	30.5	<0.001	<0.003
18-Jun-12	Hydrant Flush,	60005401	495	329061	<0.02	<0.02																							
19-Jun-12	Hydrant Flush Comp.	60004548	506	329111	<0.02	<0.02	9.56	11.1	7.70	1.0	10	3	10.3	19.5	<0.01	0.12	5.5	0.168	30.5	<0.001	<0.001	21.5	0.006	1.4	5.9	0.255	31.7	0.001	<0.003
19-Jun-12	Hydrant Flush,	60004549	505	329112	<0.02	<0.02																							
20-Jun-12	Hydrant Flush Comp.	60004601	517	329490	<0.02	<0.02	15.1	11.5	7.79	1.0	16	10	10.2	22.9	<0.01	0.99	5.6	0.517	34.2	<0.001	<0.001	23.6	0.014	5.2	5.7	0.749	35.2	0.002	0.004
20-Jun-12	Hydrant Flush,	60003492	518	329491	<0.02	<0.02																							
21-Jun-12	Hydrant Flush Comp.	60007194	530	329535	<0.02	<0.02	55.2	14.1	7.99	1.5	53	6	10.2	18.9	<0.01	0.06	5.0	0.719	27.0	<0.001	<0.001	21.1	0.030	12.4	5.6	1.630	29.4	0.003	0.013
21-Jun-12	Hydrant Flush,	60007194	531	329536	<0.02	<0.02																							
22-Jun-12	Hydrant Flush Comp.	60004806	538	329598	<0.02	<0.02	16.7	16.4	7.70	1.0	12	4	9.6	21.3	<0.01	1.15	5.8	0.158	32.7	<0.001	<0.001	22.0	0.005	5.2	5.9	0.217	33.1	<0.001	<0.003
22-Jun-12	Hydrant Flush,	60004806	537	329599	<0.02	<0.02																							
25-Jun-12	Hydrant Flush Comp.	70003496	564	329776	<0.02	<0.02	24.1	15.3	7.81	1.5	31	<2	9.7	22.0	<0.01	1.00	5.8	0.191	30.8	<0.001	<0.001	23.1	0.021	4.6	6.3	0.670	30.8	0.003	0.010
25-Jun-12	Hydrant Flush,	60006329	566	329777	<0.02	<0.02																							
27-Jun-12	Hydrant Flush Comp.	70004974	575	330203	<0.02	<0.02	29.6	17.7	8.01	1.0	51	10	9.3	22.9	<0.01	0.42	5.9	0.905	33.3	<0.001	<0.001	24.3	0.033	4.3	6.6	1.460	35.1	0.003	0.015
27-Jun-12	Hydrant Flush,	70004974	576	330204	<0.02	<0.02																							
28-Jun-12	Hydrant Flush Comp.	60001232	591	330254	<0.02	<0.02	22.2	17.5	7.86	1.0	33	17	9.3	20.3	<0.01	1.31	4.8	0.920	30.0	<0.001	0.002	21.6	0.023	5.2	5.5	1.100	30.1	0.003	0.010
28-Jun-12	Hydrant Flush,	60000705	589	330255	<0.02	<0.02																							
29-Jun-12	Hydrant Flush Comp.	60001143	601	330294	<0.02	<0.02	8.77	18.8	7.84	1.0	12	3	9.1	18.6	<0.01	0.30	4.7	0.475	27.0	<0.001	<0.001	19.5	0.013	2.6	5.0	0.606	27.4	0.001	0.004
29-Jun-12	Hydrant Flush,	60001143	602	330295	<0.02	<0.02																							
4-Jul-12	Hydrant Flush Comp.	70038578	661	330901	<0.02	<0.02	4.9	15.5	7.71	1.0	5	4	9.4	21.2	0.02	<0.01	5.0	0.055	28.2	<0.001	0.002	21.5	0.032	0.3	5.4	0.067	29.4	0.002	0.004
4-Jul-12	Hydrant Flush,	70025567	663	330902	<0.02	<0.02																							
5-Jul-12	Hydrant Flush Comp.	70025556	672	330948	<0.02	<0.02	1.4	19.0	7.80	1.0	<4	3	9.1	18.8	<0.01	0.06	4.7	0.297	26.5	<0.001	<0.001	18.7	0.009	0.4	4.7	0.356	26.1	<0.001	0.003
5-Jul-12	Hydrant Flush,	70025556	670	330949	<0.02	<0.02																							
6-Jul-12	Hydrant Flush Comp.	70025506	683	330993	<0.02	<0.02	2.0	17.1	7.75	0.5	4	6	9.1	18.3	<0.01	0.10	4.9	0.075	27.0	<0.001	<0.001	19.0	0.005	0.2	5.0	0.077	27.0	<0.001	<0.003
6-Jul-12	Hydrant Flush,	70025578	685	330994	<0.02	<0.02																							
9-Jul-12	Hydrant Flush Comp.	60000441	715	331175	<0.02	<0.02	4.4	21.0	7.83	1.0	6	<3	8.7	19.3	<0.01	0.13	5.4	0.269	29.0	<0.001	<0.001	19.5	0.008	1.3	5.4	0.337	29.5	<0.001	<0.003
9-Jul-12	Hydrant Flush,	70045004	721	331176	<0.02	<0.02																							
10-Jul-12	Hydrant Flush Comp.	60005397	726	331217	<0.02	<0.02	19.8	21.8	7.76	1.0	35	5	8.5	20.4	<0.01	0.10	5.3	0.297	29.3	<0.001	<0.001	21.3	0.010	1.8	6.6	0.451	29.3	0.001	0.007
10-Jul-12	Hydrant Flush,	60005397	725	331218	<0.02	<0.02																							
11-Jul-12	Hydrant Flush Comp.	60000077	735	331642	<0.02	<0.02	5.5	21.1	7.80	1.0	6	<3	8.7	20.7	<0.01	0.11	5.3	0.043	29.6	<0.001	<0.001	20.7	0.010	0.9	5.5	0.237	30.8	<0.001	<0.003

Date Sampled	Sample Location	Hydrant Number	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)	TSS (mg/L)	BOD_5 (mg/L)	DO (mg/L)	Soluble Calcium (mg/L)	Soluble Copper (mg/L)	Soluble Iron (mg/L)	Soluble Magnesium (mg/L)	Soluble Manganese (mg/L)	Soluble Sodium (mg/L)	Soluble Lead (mg/L)	Soluble Zinc (mg/L)	Total Calcium (mg/L)	Total Copper (mg/L)	Total Iron (mg/L)	Total Magnesium (mg/L)	Total Manganese (mg/L)	Total Sodium (mg/L)	Total Lead (mg/L)	Total Zinc (mg/L)
11-Jul-12	Hydrant Flush,	60000077	736	331643	<0.02	<0.02																							
13-Jul-12	Hydrant Flush Comp.	70011365	743	331691	<0.02	<0.02	5.6	21.9	7.71	0.5	13	4	8.3	20.2	0.01	0.65	5.4	1.110	30.4	<0.001	0.005	22.0	0.035	1.8	5.6	1.460	30.3	<0.001	0.014
13-Jul-12	Hydrant Flush,	70011365	744	331692	<0.02	<0.02																							
16-Jul-12	Hydrant Flush Comp.	60000507	780	331906	0.67	0.82	16.7	18.2	7.87	1.5	18	NR	9.1	21.3	<0.01	0.08	5.3	0.022	28.4	<0.001	<0.001	21.5	0.011	2.1	5.6	0.270	28.5	0.002	0.006
16-Jul-12	Hydrant Flush,	60004633	782	331907	0.56	0.72																							
17-Jul-12	Hydrant Flush Comp.	60000269	797	331972	<0.02	<0.02	14.4	17.2	7.80	2.5	22	3	9.2	19.6	<0.01	0.31	4.8	0.889	27.6	<0.001	<0.001	20.5	0.022	1.7	4.9	1.220	27.9	<0.001	0.010
17-Jul-12	Hydrant Flush,	60001656	798	331973	<0.02	<0.02																							
18-Jul-12	Hydrant Flush Comp.	60000633	804	332354	0.62	0.73	87.5	20.9	7.84	2.0	38	<3	8.5	20.6	<0.01	4.14	5.4	0.160	28.2	<0.001	<0.001	21.3	0.014	9.4	5.8	0.467	28.1	<0.001	<0.003
18-Jul-12	Hydrant Flush,	60000387	803	332355	0.89	0.98																							
19-Jul-12	Hydrant Flush Comp.	70000799	820	332415	<0.02	<0.02	37.2	21.7	7.96	1.0	67	<3	8.5	21.2	<0.01	0.11	6.1	0.193	28.3	<0.001	<0.001	32.7	0.021	2.5	11.9	0.922	30.0	<0.001	0.007
19-Jul-12	Hydrant Flush,	70000799	818	332416	<0.02	<0.02																							
20-Jul-12	Hydrant Flush Comp.	60000410	831	332452	<0.02	<0.02	16.8	22.0	7.87	0.5	29	<3	8.6	21.5	<0.01	0.22	5.9	0.256	29.3	<0.001	0.005	22.5	0.015	2.1	6.2	0.709	29.2	<0.001	0.004
20-Jul-12	Hydrant Flush,	60001695	829	332453	<0.02	<0.02																							
23-Jul-12	Hydrant Flush Comp.	60000203	860	332645	<0.02	<0.02	20.6	20.4	7.84	1.0	51	<3	8.6	20.7	<0.01	0.01	5.4	0.086	27.9	<0.001	<0.001	22.0	0.025	7.8	5.7	1.150	29.2	<0.001	0.013
23-Jul-12	Hydrant Flush,	60000283	863	332646	0.57	0.74																							
24-Jul-12	Hydrant Flush Comp.	60000190	876	332727	<0.02	<0.02	30.1	18.5	7.76	1.0	32	9	8.8	20.9	<0.01	1.64	5.4	0.335	33.8	<0.001	<0.001	21.3	0.007	1.8	5.5	0.358	34.2	<0.001	<0.003
24-Jul-12	Hydrant Flush,	60000170	878	332728	<0.02	<0.02																							
25-Jul-12	Hydrant Flush Comp.	60001733	888	333130	<0.02	<0.02	9.2	19.5	7.82	0.5	11	<3	8.8	20.9	<0.01	0.15	5.4	0.109	30.0	<0.001	<0.001	21.5	0.009	1.5	5.5	0.344	30.3	<0.001	<0.003
25-Jul-12	Hydrant Flush,	60001797	886	333131	<0.02	<0.02																							
26-Jul-12	Hydrant Flush Comp.	60003270	901	333169	<0.02	<0.02	3.9	20.1	7.89	1.0	5	<3	8.8	20.3	<0.01	0.15	5.1	0.046	28.6	<0.001	<0.001	20.9	0.005	0.7	5.2	0.117	29.4	<0.001	<0.003
26-Jul-12	Hydrant Flush,	60000163	904	333170	<0.02	<0.02																							
27-Jul-12	Hydrant Flush Comp.	60001758	912	333209	<0.02	<0.02	36.1	19.7	7.90	1.5	37	14	8.6	20.9	<0.01	0.20	5.4	0.699	32.1	<0.001	<0.001	22.9	0.024	5.8	6.0	0.934	33.1	<0.001	0.013
27-Jul-12	Hydrant Flush,	60001758	914	333210	<0.02	<0.02																							
30-Jul-12	Hydrant Flush Comp.	60004027	942	333373	<0.02	<0.02	10.4	18.1	7.79	1.0	12	3	9.3	21.1	<0.01	0.28	5.1	0.264	29.8	<0.001	<0.001	22.4	0.011	2.0	5.6	0.356	30.7	<0.001	0.004
30-Jul-12	Hydrant Flush,	70000093	940	333374	0.21	0.37																							
31-Jul-12	Hydrant Flush Comp.	60006219	956	333445	<0.02	<0.02	14.7	21.9	7.82	1.0	20	7	8.2	20.8	<0.01	0.01	5.3	0.343	37.3	<0.001	0.004	21.8	0.016	2.5	5.7	0.416	37.5	<0.001	0.047
31-Jul-12	Hydrant Flush,	60004806	958	333446	<0.02	<0.02																							
1-Aug-12	Hydrant Flush Comp.	60004018	968	333799	<0.02	<0.02	8.0	20.9	7.77	1.0	10	4	8.7	20.8	<0.01	0.04	5.4	0.235	30.6	<0.001	0.004	20.8	0.009	1.8	5.6	0.349	30.3	<0.001	0.004
1-Aug-12	Hydrant Flush,	60004019	967	333800	<0.02	<0.02																							
3-Aug-12	Hydrant Flush Comp.	60004765	985	333887	0.10	0.26	30.8	19.1	7.90	1.5	53	<3	8.9	21.0	<0.01	0.03	5.7	0.031	29.7	<0.001	<0.001	24.7	0.018	3.9	7.1	0.324	30.0	<0.001	0.010
3-Aug-12	Hydrant Flush,	60006235	987	333888	0.64	0.77																							

NR - No result NA - Not analyzed NS - No sample

NOTE On May 22, 23, and July 16 there were no results for BOD5 due to QC failure.
On June 4 there were no results for temperature and dissolved oxygen due to an instrument error.
On July 16 there was no BOD result due to QC failure.
On July 16, 18, 23, 30 and August 3 the chlorine levels were above 0.02 mg/L because the pump used for dechlorinating was intermittently malfunctionning.

Water and Waste Department
Environmental Standards Division

2013 Water Main Cleaning Program

Water Quality Monitoring Summary Report

April 2014

2013 Water Main Cleaning Program

Water Quality Monitoring Summary Report

Compliance Reporting Technician

Laboratory Technician

Laboratory Technician

Laboratory Technician

Renée Grosselle, B. Sc.
Supervisor of Compliance Reporting Branch

Kelly Kjartanson, M. Sc., P. Eng.
Manager of Environmental Standards Division

April 2014

TABLE OF CONTENTS **PAGE**

SUMMARY **1**

LOCAL MONITORING **2**

TABLE 1: LOCAL AREA MONITORING 2
Chlorine Levels 3
Total Coliform, E. coli and HPC 3
Turbidity 4
pH and Temperature 4
True Colour 4
TABLE 2: LOCAL MONITORING RESULTS SUMMARY 4

REGIONAL MONITORING **6**

TABLE 3: REGIONAL AREA MONITORING 6
Chlorine Levels 6
Total Coliform, E. coli and HPC 7
Turbidity 7
pH and Temperature 7
True Colour 7
Dissolved Oxygen 7
Sensitive Users 9
Chlorine Levels 9
Total Coliform, E. coli and HPC 9
Turbidity 9
pH and Temperature 9
True Colour 9
Dissolved Oxygen 9
TABLE 4: REGIONAL MONITORING RESULTS SUMMARY 8
TABLE 5: SENSITIVE USERS MONITORING RESULTS SUMMARY 8

ENVIRONMENTAL MONITORING **10**

TABLE 6: ENVIRONMENTAL MONITORING 10
Chlorine Levels 11
Turbidity 11
pH and Temperature 11
True Colour 11
BOD5 and Total Suspended Solids 12
Dissolved Oxygen 12
TABLE 7: ENVIRONMENTAL MONITORING RESULTS SUMMARY 11
Metals 11
TABLE 8: METAL RESULT SUMMARY 11

CONCLUSIONS **14**

RECOMMENDATIONS **16**

REFERENCES **17**

APPENDIX A, 2013 WATER MAIN CLEANING PROGRAM AREA 18
APPENDIX B, 2013 WATER MAIN CLEANING PROGRAM LABORATORY ANALYSIS SUMMARY LOCAL MONITORING 20
APPENDIX C, 2013 WATER MAIN CLEANING PROGRAM LABORATORY ANALYSIS SUMMARY REGIONAL MONITORING 41
APPENDIX D, 2013 WATER MAIN CLEANING PROGRAM LABORATORY ANALYSIS SUMMARY SENSITIVE USERS MONITORING 47
APPENDIX E, 2013 WATER MAIN CLEANING PROGRAM LABORATORY ANALYSIS SUMMARY ENVIRONMENTAL MONITORING 50

SUMMARY

In 2013, The City of Winnipeg - Water and Waste Department worked on a watermain cleaning project that targeted approximately half of the area originally cleaned in 2005 and a portion of the area originally cleaned in 2006[1].

The flushing was carried out using a unidirectional flow technique. During unidirectional flushing, water system valves are operated to create one-way flow to the water main being cleaned. A hydrant connected to the main is then opened to remove the built-up sediment. This type of flushing increases the velocity of the water flow in the main to about two metres or six feet per second (it is normally less than 0.3 metres or 1 foot per second). This high velocity produces a scouring action in the mains, removing sediment deposits. The flushing starts at a clean water source (e.g., the water pumping stations) and moves toward the outer limits of the city. This ensures that clean water is always used to flush the mains.

This report summarizes the data and observations for 2013 obtained by Environmental Standards Division staff. The water quality monitoring carried out as part of the Water Main Cleaning Program included Local Monitoring to determine the impact on water quality in the neighbourhood being cleaned, Regional Monitoring to measure the long-term impact on the water quality of the region being cleaned, and Environmental Monitoring in response to concerns respecting discharges to the environment. In addition, two sensitive users were identified in the area where the flushing was taking place. The monitoring results for the sensitive users were reviewed regularly to ensure they were not being negatively affected by the program. Appendix A illustrates the areas cleaned in the 2013 program. The data generated from the program was entered into the Laboratory Information Management System and is included in the Appendices.

In 2013, the City of Winnipeg experienced an unprecedented increase in discoloured water events. The Water and Waste Department engaged the engineering consulting firm of CH2M Hill to assist in investigating the cause of the increase in reports of discoloured water in the water distribution system, and to provide recommendations to mitigate future recurrences of discoloured water[2]. While this review was ongoing, Winnipeg experienced an unprecedented spike in customer reports of discoloured water in mid-August 2013. These discoloured water events contributed to the increased results for certain parameters analysed during this program.

Local Monitoring

Local monitoring was conducted in some of the neighbourhoods being cleaned to determine the impact on local customers by the cleaning program. Monitoring locations, parameters and frequency for flushing operations are provided in Table 1 below.

TABLE 1: LOCAL AREA MONITORING

Locations	Parameters	Frequency
• Households/businesses (specific location determined in field) Normally 2 households/businesses for 2 sequences per weekday.	• Free Chlorine • Total Chlorine • Total Coliform • *E. coli* • Heterotrophic Plate Count • Turbidity • pH • Temperature • Colour, True	• Once (Pre-Flush) • Once (Post-Flush) • Once (Few Days Post-Flush)*
* - Samples a few days post-flush will be taken if water quality has not improved on post-flush samples. - Additional post-flush samples will be taken if required.		

The Local Monitoring results (Appendix B) were used to tabulate the short-term impact of water main flushing on the quality of water delivered to customers. A summary of the local monitoring results are provided in Table 2. Homes and businesses were chosen randomly to be

representative of the neighborhoods being flushed. Comparing the pre-flush sample results with the post-flush sample results allowed the short-term impact of the flushing to be observed. Post-flush samples were usually collected the same day or the day following the flushing in the area. Occasionally, a post-flush sample was obtained several or more days after flushing, usually due to the customer not being home or the business being closed. A household or business was resampled if the post-flush sample contained a positive total coliform or E. coli, high heterotrophic plate count of >500 cfu/mL, and/or a turbidity of >1.0 NTU.

Chlorine Levels

The level of free chlorine in the post-flush samples showed a mean increase of 0.02 mg/L from the pre-flush samples, and the total chlorine showed a mean increase of 0.01 mg/L. In most cases, a few days after flushing chlorine levels were slightly higher than the original pre-flush levels. The mean value of post-flush samples for free chlorine was 0.65 mg/L and the mean value for total chlorine levels was 0.82 mg/L.

Total Coliform, E. coli and HPC

The majority of the sample results from the local monitoring locations were negative for total coliform, E. coli and heterotrophic bacteria (HPC). The locations that showed a positive bacteria result for total coliform and/or E. coli, and/or had a heterotrophic plate count of >500 cfu/mL were resampled. A total of 3 locations were required to be resampled due to positive total coliform results. Two of the resampled locations were reported positive for total coliform, and as a result the locations were resampled again, as well as locations up stream and downstream. There were no positive E. coli results reported. There was one HPC result of >500 cfu/mL and the resample were reported negative. Pre-flush samples that were positive were not resampled if the post-flush samples came back negative because the post-flush sample was

treated as the resample. For the 2013 program, the bacterial analysis for the program was done by the contract laboratory ALS.

Turbidity

The mean pre-flush turbidity value was 0.52 NTU and the mean post-flush value was 0.46 NTU. All post-flush locations with results above 1.0 NTU were resampled. Four post-flush samples had a turbidity value above 1.0 NTU. These locations were resampled and found to have a turbidity of <1.0 NTU. On average the post-flush turbidity values measured this year were higher than in 2012. It is thought that this was due to the increase in discoloured water events.

pH and Temperature

There was no variance between the mean pH for the pre-flush samples and the mean pH for the post-flush samples. The mean pH for the pre-flush samples was 7.58 units with a range from 7.38 to 7.81 units. The mean pH for the post-flush samples was 7.58 units with a range from 7.29 to 7.84 units. The drinking water guidelines [3] recommend a range of 6.5 to 8.5 units. All of the samples were well within this range. The temperature showed a minimal increase on average of 0.5°C from the pre to post-flush. The mean pre-flush temperature was 10.8 degrees Celsius and the mean post-flush temperature was 11.3 Celsius.

True Colour

The mean pre-flush true colour was 0.85 colour units. The mean post-flush true colour was 0.86 colour units. The results show that there was little difference between the pre and post flush samples.

TABLE 2: LOCAL MONITORING RESULTS SUMMARY

Parameters		**Mean**	**Minimum**	**Maximum**
Free Chlorine (mg/L)	Pre-flush	0.63	0.17	1.43
	Post-flush	0.65	0.21	1.10
Total Chlorine (mg/L)	Pre-flush	0.81	0.32	1.67
	Post-Flush	0.82	0.32	1.26
Turbidity (NTU)	Pre-flush	0.52	0.10	24.6
	Post-flush	0.46	0.10	10.7
pH (units)	Pre-flush	7.58	7.38	7.81
	Post-flush	7.58	7.29	7.84
Temp (˚C)	Pre-flush	10.8	5.0	17.8
	Post-flush	11.3	5.1	17.7
True Colour (TCU)	Pre-flush	0.9	0.5	2.5
	Post-flush	0.9	0.5	3.0

Regional Monitoring

Regional monitoring included the routine "weekly" monitoring locations in the region, three additional boundary locations, and two large sensitive users in the area. Appendix C provides a summary of the regional monitoring results. The sampling locations, parameters, and frequency of monitoring are provided in Table 3.

TABLE 3: REGIONAL AREA MONITORING

Locations	Parameters	Frequency
• SW-01 • SW-03 • SW-17 • WC-04 • WC-05 • WC-06 • WC-08 • WC-10 • WC-11 ***Sensitive Users*** • [redacted] • [redacted]	• Free Chlorine • Total Chlorine • Total Coliform • *E. Coli* • Heterotrophic Plate Count • Turbidity • pH • Temperature • Colour, True • Dissolved Oxygen	• Weekly

Regional Monitoring of the nine locations was performed to determine if disturbed water main sediment was affecting the entire area being cleaned as well as the distribution system outside of the area being cleaned. All of these locations are part of our routine distribution system water quality monitoring program. A summary of the regional monitoring results are provided in Table 4.

Chlorine Levels

Chlorine dosages at MacLean, Hurst and McPhillips Pumping Stations were not adjusted in 2013. MacLean Pumping Station was maintained at 1.3 mg/L while Hurst and McPhillips

Pumping Stations were maintained at 1.2 mg/L to achieve target levels of disinfectant in the distribution system. The mean free chlorine at the nine selected regional locations was 0.68 mg/L and the total chlorine was 0.84 mg/L.

Total Coliform, E. coli and HPC

The nine regional locations were sampled weekly for total coliform, E. coli, and heterotrophic plate count throughout the duration of the program. One sample had a total coliform result of 1 MPNU/100 mL. This location was resampled and a result of <1 MPNU/100 mL was reported. No positive results were reported for E. coli, and there were no HPC counts above 500 cfu/mL.

Turbidity

The mean turbidity for the regional monitoring was 0.33 NTU. The target for turbidity results in the distribution system is <1.0 NTU. Three samples had turbidity results of >1.0 NTU. These locations were resampled and results of 0.25, 0.40, and 0.57 NTU were obtained.

pH and Temperature

The mean pH for the regional monitoring was 7.58 units with a range from 7.36 to 7.99 units. The drinking water guidelines[3] recommend a range of 6.5 to 8.5 units. All of the samples were well within this range. The mean temperature for the regional monitoring was 11.1 degrees Celsius. The water temperature steadily increased as the ambient temperature increased.

True Colour

The mean true colour for the nine regional locations was 1.7 colour units, with a range from 0.5 to 6.0 colour units.

Dissolved Oxygen

The mean dissolved oxygen level for the nine regional locations was 10.5 mg/L with a range from 7.9 to 13.3 mg/L. An average value for dissolved oxygen in surface water sources[4] is

9.7 mg/L with a range from 6.9 mg/L to 12.2 mg/L. All results that were higher than 12.2 mg/L were obtained in April and early May. As the temperature increased, dissolved oxygen results decreased due to the inverse relationship between temperature and dissolved oxygen.

TABLE 4: REGIONAL MONITORING RESULTS SUMMARY

Parameters	Mean	Minimum	Maximum
Free Chlorine (mg/L)	0.68	0.23	1.03
Total Chlorine (mg/L)	0.84	0.39	1.24
Turbidity (NTU)	0.31	0.12	2.02
pH (units)	7.58	7.36	7.99
Temp (˚C)	11.0	4.0	19.7
True Colour (TCU)	1.7	0.5	6.0
Dissolved Oxygen (mg/L)	10.5	7.9	13.3

Sensitive Users

Two sensitive users were identified for the 2013 watermain cleaning program ; Sampling was performed at these locations weekly, with the exception of the days in which the flushing was done close to them, in which case sampling was done daily. The maintenance staff at each location developed their own internal protocol should they experience dirty water due to the water main cleaning. In addition, the Water Services staff exercised a lot of caution when working near the sensitive users to minimize any disturbances in their systems. The samples were analyzed for the same parameters as the regional monitoring locations. Appendix D provides a summary of the sensitive users monitoring results. A summary of the sensitive users monitoring results are provided in Table 5.

Chlorine Levels

The mean free chlorine for the two sensitive users was 0.64 mg/L and the total chlorine was 0.82 mg/L.

Total Coliform, E. coli and HPC

There were no positive results reported for total coliform or E. coli, and there were no HPC counts above 500 cfu/mL for the two sensitive user locations.

Turbidity

The mean turbidity for the sensitive user samples was 0.50 NTU. The target for turbidity results in the distribution system is <1.0 NTU. One sample had a turbidity result of >1.0 NTU. The location was resampled and a result of 0.40 NTU was reported.

pH and Temperature

The mean pH for the sensitive user samples was 7.60 units with a range from 7.44 to 7.91 units. The drinking water guidelines[3] recommend a range of 6.5 to 8.5 units. All of the samples were well within this range. The water temperature steadily increased as the ambient temperature increased.

True Colour

The mean true colour for the two sensitive user samples was 1.5 colour units, with a range from 0.5 to 3.0 colour units.

Dissolved Oxygen

The mean dissolved oxygen level for the sensitive user samples was 10.3 mg/L with a range from 8.0 to 13.1 mg/L. An average value for dissolved oxygen in surface water sources[4] is 9.7 mg/L with a range from 6.9 mg/L to 12.2 mg/L. All results that were higher than 12.2 mg/L were obtained from April to mid-May. As the temperature increased, dissolved oxygen results decreased due to the inverse relationship between temperature and dissolved oxygen.

TABLE 5: SENSITIVE USERS MONITORING RESULTS SUMMARY

Parameters	Mean	Minimum	Maximum
Free Chlorine (mg/L)	0.66	0.40	0.84
Total Chlorine (mg/L)	0.84	0.58	1.09
Turbidity (NTU)	0.44	0.19	2.01
pH (units)	7.60	7.44	7.91
Temp (˚C)	11.6℃	4.0	18.4
True Colour (TCU)	1.5	0.5	3.0
Dissolved Oxygen (mg/L)	10.3	8.0	13.1

Environmental Monitoring

A baseline Environmental Monitoring Program was conducted as part of the 2013 program. The program consisted of collecting grab samples from hydrant discharges from selected flushing sequences to determine background quality of the water being discharged to the catch basins of land drainage and combined sewers. One grab sample and one composite sample were taken each day. Appendix E provides a summary of the Environmental Monitoring results. The parameters monitored and the frequency of monitoring are provided in Table 6. A summary of the environmental monitoring results are provided in Table 7.

TABLE 6: ENVIRONMENTAL MONITORING

Locations	Parameters	Frequency
• Fire Hydrants (specific location(s) determined in field coinciding with sequence of household samples).	• Free Chlorine • Total Chlorine • Turbidity • pH • Temperature • Colour, True • Total Suspended Solids • BOD_5 • Dissolved Oxygen • Metal Scan	• Daily

Chlorine Levels

A dechlorination system was employed to remove chlorine from the discharged water prior to the water entering the catch basins of land drainage and combined sewers. Environmental Standards field staff performed random chlorine spot checks on the water being discharged to the catch basins to ensure the dechlorination system was functioning properly. Of the 125 samples analyzed, 5 had detectable chlorine levels. Chlorine was detected because Water Services flushing crews had operational issues on those few days. Most of the results indicate that the dechlorination system was functioning properly.

Turbidity

There were 61 hydrant composite samples collected and analyzed for the flushing program. The composite samples contained mainly the "dirty" water expelled during flushing resulting in relatively high turbidities. The mean turbidity for the hydrant composites was 37.3 NTU with a range from 3.11 to 237 NTU and generally decreased as flushing time increased. The hydrant discharge was flushed until it was clear.

pH and Temperature

The mean pH of the hydrant composite samples was 7.82 units which is higher than the distribution system average of 7.51 units for the same time period. The mean temperature for the environmental monitoring samples was 12.8 degrees Celsius which is normal for the distribution system during the summer.

True Colour

The mean true colour of the hydrant composite samples was 1.1 colour units, with a range from 0.5 to 3.0 colour units. These are expected results for the distribution system during the summer.

BOD5 and Total Suspended Solids

BOD_5 results ranged from <3 to 20 mg/L for the hydrant composite samples with a mean value of 5.5 mg/L. Total suspended solids results ranged from 4 to 566 mg/L with a mean value of 49 mg/L. According to the Manitoba Conservation Report, *Manitoba Water Quality Standards, Objectives, and Guidelines*[5] (2002), the guidelines for municipal wastewater effluents are 30 mg/L BOD_5 and 30 mg/L total suspended solids. The mean result for BOD_5 was below the guideline. The mean result for total suspended solids was above the guideline which was caused by the increase in discoloured water events in 2013.

Dissolved Oxygen

An average value for dissolved oxygen in surface water sources[4] is 9.7 mg/L with a range from 6.9 mg/L to 12.2 mg/L. The two results that were higher than 12.2 mg/L were obtained from April to mid-May. As the temperature increased, dissolved oxygen results decreased due to the inverse relationship between temperature and dissolved oxygen.

TABLE 7: ENVIRONMENTAL MONITORING RESULT SUMMARY

Parameters	**Mean**	**Minimum**	**Maximum**
Free Chlorine (mg/L)	0.02	<0.02	0.68
Total Chlorine (mg/L)	0.03	<0.02	0.81
Turbidity (NTU)	37.3	3.11	237
pH (units)	7.82	7.33	8.00
Temp (˚C)	12.8	5.1	20.3
True Colour (TCU)	1.1	0.5	3.0
BOD_5 (mg/L)	5.5	<3	>20
Total Suspended Solids (mg/L)	49	4	566
Dissolved Oxygen (mg/L)	10.0	8.8	12.6

Metals

A metal scan was added for the hydrant discharge samples in the 2011, 2012, and 2013 monitoring programs in response to the increased discoloured water complaints in 2010. The results for this year's program are provided in Table 8. With the exception of iron, manganese, and lead, the metal results are below the drinking water guidelines[3]. A summary is provided in Table 8 below.

TABLE 8: METAL RESULT SUMMARY

	Total Calcium	**Total Copper**	**Total Iron**	**Total Magnesium**	**Total Manganese**	**Total Sodium**	**Total Lead**	**Total Zinc**
	(mg/L)							
Average	25.2	0.03	6.5	6.1	0.87	39.4	0.003	0.010
Maximum	82.8	0.17	34.5	19.1	4.31	36.1	0.035	0.082
Minimum	19.8	0.006	0.21	4.4	0.09	23.8	<0.001	<0.003
Drinking Water Guideline[3]	None	<1.0	≤ 0.3	None	≤ 0.05	≤ 200	0.010	≤ 5.0

CONCLUSIONS

The following conclusions were determined from the Water Quality Monitoring Program:

- Local Monitoring generally did not show a change in chlorine or colour levels following the completion of water main cleaning in the area.
- Local Monitoring generally showed an improvement in turbidity levels. This year, post flush samples were generally not collected on the same day as flushing because it was found that post-flush samples collected the next day rather than later the same day showed significant improvement in turbidity.
- Regional Monitoring locations within the cleaning program area showed no difference in water quality from the water quality at the regular distribution system monitoring locations outside of the cleaning area.
- Environmental Monitoring showed that the dechlorination system was functioning properly with the exception of a few days when Water Services had operational issues.
- Both Local and Regional Monitoring showed that bacteria were not present in the water with the flushing disturbances. All resample results were reported to be negative.
- The BOD_5 average result from the Environmental Monitoring hydrant discharge samples was below the guideline value.
- The total suspended solid results from the Environmental Monitoring hydrant samples were above the guideline. It is thought that this was caused by the increase in discoloured water events in 2013.

- The average metal results from the Environmental Monitoring hydrant discharge samples were below the drinking water guidelines[3] with the exception of manganese, iron, and lead. The results confirm the presence of iron and manganese in the hydrant discharges which were identified in CH2M Hill's report[2] as the likely cause of discoloured water occurrences. The lead results were higher than the guidelines for three samples.

RECOMMENDATIONS

The following recommendations are provided:

- Local Monitoring samples should continue to be obtained from businesses in the area where possible, since it was sometimes difficult to obtain samples from households, especially the initial post-flush sample.
- Pre-flush samples should be collected at least 5 sequences ahead of the flushing crew to prevent artificially high turbidity and colour results caused by disturbances from flushing nearby.
- Samples should continue to be obtained from households with water quality complaints or concerns. Any water complaints or concerns that occur during the weekend should be noted by Water Services staff and followed up by Environmental Standards staff the following workday.
- Environmental Monitoring should be continued to monitor the quality of the water being discharged to the catch basins. This monitoring should continue to include composite samples analyzed for chlorine, colour, total suspended solids, BOD_5, turbidity, pH, metal scan and dissolved oxygen so we may compare results from year to year as we monitor discoloured water occurrences.
- A spare de-chlorinating pump and Vita-D-Chlor pucks should be purchased and kept on hand for instances when the de-chlorinating system is not dosing properly to ensure chlorinated water is not being discharged into the environment.

REFERENCES

1. Marsland, M. et al. 2006. 2005 Water Main Cleaning Program. Water Quality Monitoring Summary Report. City of Winnipeg, Environmental Standards Division, Research Branch.

2. CH2M Hill. December 2013. Winnipeg Discoloured Water Investigation. Summary Report.

3. Federal-Provincial-Territorial Committee on Drinking Water of the Federal-Provincial-Territorial Committee on Health and Environment. August 2012. Guidelines for Canadian Drinking Water Quality Summary Table. Retrieved 5 March 2014 http://www.hc-sc.gc.ca/ewh-semt/alt_formats/pdf/pubs/water-eau/2012-sum_guide-res_recom/2012-sum_guide-res_recom-eng.pdf

4. Red Water Release in Drinking Water Distribution Systems. Imran et al, September 2005 edition of the AWWA Journal

5. Williamson, Dwight. 2002. Manitoba Water Quality Standards, Objectives, and Guidelines. Manitoba Conservation Water Branch, Water Quality Management Section. Retrieved 3 January 2013 http://www.gov.mb.ca/waterstewardship/water_quality/quality/mwqsog_2002.pdf

APPENDIX A

2013 Water Main Cleaning Program Area

2013 Water Main Cleaning Area

Winnipeg

Water and Waste Department

April 2013

APPENDIX B

2013 Water Main Cleaning Program Laboratory Analysis Summary Local Monitoring

APPENDIX C

2013 Water Main Cleaning Program Laboratory Analysis Summary Regional Monitoring

APPENDIX D

2013 Water Main Cleaning Program Laboratory Analysis Summary Sensitive Users Monitoring

APPENDIX E

2013 Water Main Cleaning Program Laboratory Analysis Summary Environmental Monitoring

Water and Waste Department
Environmental Standards Division

2014 Water Main Cleaning Program

Water Quality Monitoring Summary Report

DRAFT

January 2015

2014 Water Main Cleaning Program

Water Quality Monitoring Summary Report

Draft Copy

[redacted]
Compliance Reporting Technician

[redacted]
Laboratory Technician

[redacted]
Laboratory Technician

[redacted]
Laboratory Technician

[redacted]
Laboratory Technician

[redacted]
Laboratory Technician

Renée Grosselle, B. Sc.
Manager of Environmental Standards Division

January 2015

TABLE OF CONTENTS ..... PAGE

SUMMARY 1

LOCAL MONITORING 2

TABLE 1: LOCAL AREA MONITORING 2
TABLE 2: LOCAL MONITORING RESULTS SUMMARY 3

REGIONAL MONITORING 4

TABLE 3: REGIONAL AREA MONITORING 4
TABLE 4: REGIONAL MONITORING RESULTS SUMMARY 5

SENSITIVE USERS 5

TABLE 5: SENSITIVE USERS MONITORING RESULTS SUMMARY 6

ENVIRONMENTAL MONITORING 6

TABLE 6: ENVIRONMENTAL MONITORING 6
TABLE 7: ENVIRONMENTAL MONITORING RESULT SUMMARY 7

METALS 7

TABLE 8: METAL RESULT SUMMARY 7

CONCLUSIONS 8

RECOMMENDATIONS 9

REFERENCES 9

APPENDIX A 50
2014 WATER MAIN CLEANING PROGRAM AREA 50
APPENDIX B 51
2014 WATER MAIN CLEANING PROGRAM LABORATORY ANALYSIS SUMMARY LOCAL MONITORING 51
APPENDIX C 52
2014 WATER MAIN CLEANING PROGRAM LABORATORY ANALYSIS SUMMARY REGIONAL MONITORING 52
APPENDIX D 53
2014 WATER MAIN CLEANING PROGRAM LABORATORY ANALYSIS SUMMARY SENSITIVE USERS MONITORING 53
APPENDIX E 54
2014 WATER MAIN CLEANING PROGRAM LABORATORY ANALYSIS SUMMARY ENVIRONMENTAL MONITORING 54

Draft Copy

SUMMARY

In 2014, The City of Winnipeg – Water and Waste Department worked on a watermain cleaning project that targeted approximately half of the area of The City of Winnipeg. Based on recommendations outlined in the Winnipeg Discoloured Water Investigation consultant report[1], for the 2014 Water Main Cleaning Program (WMCP), the City implemented an accelerated water main cleaning program. The intent of the accelerated cleaning program was to revisit all areas that were previously cleaned over the past six years, re-flush the water mains within a two year period and therefore minimize the impact of discoloured water events.

The flushing was carried out using a unidirectional flow technique. During unidirectional flushing, water system valves are operated to create one-way flow to the water main being cleaned. A hydrant connected to the main is then opened to remove the built-up sediment. This type of flushing increases the velocity of the water flow in the main to about two metres or six feet per second (it is normally less than 0.3 metres or 1 foot per second). This high velocity produces a scouring action in the mains, removing sediment deposits. The flushing starts at a clean water source (e.g., the water pumping stations) and moves toward the outer limits of the city. This ensures that clean water is always used to flush the mains.

This report summarizes the data and observations for 2014 obtained by Environmental Standards Division staff. The water quality monitoring carried out as part of the Water Main Cleaning Program included Local Monitoring to determine the impact on water quality in the neighbourhood being cleaned, Regional Monitoring to measure the long-term impact on the water quality of the region being cleaned, and Environmental Monitoring in response to concerns respecting discharges to the environment. In addition, two sensitive users were identified in the area where the flushing was taking place. The monitoring results for the sensitive users were reviewed regularly to ensure they were not being negatively affected by the program. Appendix A illustrates the areas cleaned in the 2014 program.

Draft Copy

The data generated from the program was entered into the Laboratory Information Management System and is included in the Appendices.

Local Monitoring

Local monitoring was conducted in some of the neighbourhoods being cleaned to determine the impact on local customers by the cleaning program. Monitoring locations, parameters and frequency for flushing operations are provided in Table 1 below.

TABLE 1: LOCAL AREA MONITORING

Locations	**Parameters**	**Frequency**
• Households/businesses (specific location determined in field) Normally 2 households/businesses for 2 sequences per weekday.	• Free Chlorine • Total Chlorine • Total Coliform • E. coli • Heterotrophic Plate Count • Turbidity • pH • Temperature • Colour, True	• Once (Pre-Flush) • Once (Post-Flush) • Once (Few Days Post-Flush)*
* - Samples a few days post-flush will be taken if water quality has not improved on post-flush samples. - Additional post-flush samples will be taken if required.		

The Local Monitoring results (Appendix B) were used to tabulate the short-term impact of water main flushing on the quality of water delivered to customers. A summary of the local monitoring results are provided in Table 2. Homes and businesses were chosen randomly to be representative of the neighborhoods being flushed. Comparing the pre-flush sample results with the post-flush sample results allowed the short-term impact of the flushing to be observed. Post-flush samples were usually collected the same day or the day following the flushing in the area. Occasionally, a post-flush sample was obtained several or more days after flushing, usually due to the customer not being home or the business being closed. A household or business was resampled if the post-flush sample contained a positive total coliform or E. coli, high heterotrophic plate count of >500 cfu/mL, free chlorine of <0.10 mg/L, and/or a turbidity of >1.00 NTU, until the results reported were acceptable.

Draft Copy

Environmental Standards staff responds to all water quality complaints or concerns received during regular working hours and when applicable will collect a sample from that location. Complaints and concerns that are received after hours are noted by Water Services staff and followed up by Environmental Standards staff the following workday.

TABLE 2: LOCAL MONITORING RESULTS SUMMARY

Parameters		**Mean**	**Minimum**	**Maximum**
Free Chlorine (mg/L)	**Pre-flush**	**0.67**	**0.06**	**1.33**
	Post-flush	**0.65**	**<0.02[1]**	**1.25**
Total Chlorine (mg/L)	**Pre-flush**	**0.85**	**0.14**	**1.55**
	Post-Flush	**0.82**	**<0.02[1]**	**1.40**
Turbidity (NTU)	**Pre-flush**	**0.54**	**0.11**	**8.60[2]**
	Post-flush	**0.38**	**0.14**	**3.29[2]**
pH (units)	**Pre-flush**	**7.54**	**7.36**	**8.03**
	Post-flush	**7.55**	**7.34**	**8.18**
Temperature (˚C)	**Pre-flush**	**16.1**	**10.1**	**24.0**
	Post-flush	**16.2**	**9.7**	**22.0**
True Colour (TCU)	**Pre-flush**	**1.6**	**0.5**	**7.0**
	Post-flush	**1.6**	**0.5**	**7.0**

1 - There were two instances where the post flush free chlorine was below 0.10 mg/L. Additional flushing was performed at these locations until chlorine results were satisfactory.
2 – There were fourteen results for turbidity that were higher than 1.00 ntu. The locations were resampled a few days post flush, until the turbidity results were adequate.

Draft Copy

Regional Monitoring

Regional monitoring included nine routine "weekly" monitoring locations in the region, three pumping stations, and two large sensitive users in the area. Appendix C provides a summary of the regional monitoring results. The sampling locations, parameters, and frequency of monitoring are provided in Table 3.

TABLE 3: REGIONAL AREA MONITORING

Locations	Parameters	Frequency
• NE-01 • NWFM • NW-01 • SE-01 • SE-02 • SE-05 • SE-11 • SE-14 • SW-04 • SW-06 • WC-01 • WC-12 **Sensitive Users** • [redacted] • [redacted]	• Free Chlorine • Total Chlorine • Total Coliform • E. Coli • Heterotrophic Plate Count • Turbidity • pH • Temperature • Colour, True • Dissolved Oxygen	• Weekly

Regional Monitoring of the nine locations was performed to determine if disturbed water main sediment was affecting the entire area being cleaned as well as the distribution system outside of the area being cleaned. All of these locations are part of our routine distribution system water quality monitoring program. A summary of the regional monitoring results are provided in Table 4.

Draft Copy

TABLE 4: REGIONAL MONITORING RESULTS SUMMARY

Parameters	Mean	Minimum	Maximum
Free Chlorine (mg/L)	**0.89**	**0.52**	**1.37**
Total Chlorine (mg/L)	**1.08**	**0.70**	**1.58**
Turbidity (NTU)	**0.22**	**0.09**	**0.96**
pH (units)	**7.52**	**6.42**	**7.87**
Temperature (˚C)	**16.1**	**7.8**	**22.9**
True Colour (TCU)	**1.2**	**0.5**	**10.0**
Dissolved Oxygen (mg/L)	**10.2**	**8.3**	**12.9**

Sensitive Users

Two sensitive users were identified for the 2014 water main cleaning program; Sampling was performed at these locations weekly, with the exception of the days in which the flushing was being done in the area, in which case sampling was done daily. The maintenance staff at each location developed their own internal protocol should they experience dirty water due to the water main cleaning. In addition, the Water Services staff exercised a lot of caution when working near the sensitive users to minimize any disturbances in their systems. The samples were analyzed for the same parameters as the regional monitoring locations. Appendix D provides a summary of the sensitive users monitoring results. A summary of the sensitive users monitoring results are provided in Table 5.

Draft Copy

TABLE 5: SENSITIVE USERS MONITORING RESULTS SUMMARY

Parameters	Guideline	Mean	Minimum	Maximum
Free Chlorine (mg/L)	**>0.10**	**0.76**	**0.16**	**1.16**
Total Chlorine (mg/L)	**>0.10**	**0.94**	**0.21**	**1.36**
Turbidity (NTU)	**<1.00**	**0.35**	**0.12**	**2.06**[1]
pH (units)	**6.5 – 8.5**	**7.59**	**7.41**	**7.93**
Temperature (˚C)	**<15.0**	**15.5**	**11.2**	**20.0**
True Colour (TCU)	**<15.0**	**1.2**	**0.5**	**5.0**
Dissolved Oxygen (mg/L)	**no guideline**	**9.9**	**9.0**	**11.8**

1 - There were two occurrences where the post flush turbidity was higher than 1.0 ntu. The locations were resampled a few days post flush, until the turbidity results were below the guideline of 1.0 ntu.

Environmental Monitoring

A baseline Environmental Monitoring Program was conducted as part of the 2014 program. The program consisted of collecting grab samples from hydrant discharges from selected flushing sequences to determine background quality of the water being discharged to the catch basins of land drainage and combined sewers. One grab sample and one composite sample were taken each day. Appendix E provides a summary of the Environmental Monitoring results. The parameters monitored and the frequency of monitoring is provided in Table 6. A summary of the environmental monitoring results are provided in Table 7.

TABLE 6: ENVIRONMENTAL MONITORING

Locations	Parameters	Frequency
Fire Hydrants (specific location(s) determined in field coinciding with sequence of household samples).	• Free Chlorine • Total Chlorine • Turbidity • pH • Temperature • Colour, True • Total Suspended Solids • BOD5 • Dissolved Oxygen • Metal Scan	• Daily

Draft Copy

TABLE 7: ENVIRONMENTAL MONITORING RESULT SUMMARY

Parameters	Mean	Minimum	Maximum
Free Chlorine (mg/L)	**0.03**	**<0.02**	**0.96[2]**
Total Chlorine (mg/L)	**0.03**	**<0.02**	**1.13[2]**
Turbidity (NTU)	**73.7**	**2.56**	**525**
pH (units)	**7.70**	**7.22**	**8.00**
Temperature (˚C)	**17.0**	**11.7**	**21.1**
True Colour (TCU)	**2.3**	**0.5**	**13**
BOD5 (mg/L) [1]	**5.7**	**<3.0**	**>18.3**
Total Suspended Solids (mg/L)[1]	**48**	**<3**	**270**
Dissolved Oxygen (mg/L)	**9.3**	**8.4**	**10.8**

1 - According to the Manitoba Conservation Report, Manitoba Water Quality Standards, Objectives, and Guidelines[3] (2002), the guidelines for municipal wastewater effluents are 25 mg/L BOD5 and 25 mg/L total suspended solids.
2 - There were fifteen instances where chlorine was >0.02 mg/L because Water Services flushing crews had operational issues with the dechlorination system on those days. Most of the results indicated that the dechlorination system was functioning properly.

Metals

A metal scan was added for the hydrant discharge samples in the 2011, 2012, 2013, and 2014 monitoring programs in response to the increased discoloured water complaints in 2010. The results for this year's program are provided in Table 8. With the exception of iron, manganese, and lead, the metal results are below the drinking water guidelines[2]. A summary is provided in Table 8 below.

TABLE 8: METAL RESULT SUMMARY

	Total Calcium	Total Copper	Total Iron	Total Magnesium	Total Manganese	Total Sodium	Total Lead	Total Zinc
	(mg/L)							
Average	22.2	0.0559	14.6	5.55	1.315	28.6	0.0149	0.0313
Maximum	26.4	0.2509	79.9	6.92	6.358	36.1	0.2165	0.1575
Minimum	18.3	0.0024	0.32	4.70	0.041	24.3	<0.0004	0.0034
Drinking Water Guideline[2]	None	≤1.0*	≤0.3*	None	≤0.05*	≤200*	0.010	≤5.0*

* Aesthetic objective: These guidelines have an objective and not a maximum acceptable limit. These parameters should not impact the safety of the water to drink and there is no anticipated health risk for short-term exposures.

Draft Copy

CONCLUSIONS

The following conclusions were determined from the Water Quality Monitoring Program:

- Local Monitoring generally did not show a change in chlorine or colour levels following the completion of water main cleaning in the area.
- Local Monitoring generally showed an improvement in turbidity levels. This year, post flush samples were generally not collected on the same day as flushing because it was found that post-flush samples collected the next day rather than later the same day showed significant improvement in turbidity.
- Regional Monitoring locations within the cleaning program area showed no difference in water quality from the water quality at the regular distribution system monitoring locations outside of the cleaning area.
- Environmental Monitoring showed that the dechlorination system was functioning properly with the exception of a few days when Water Services had operational issues.
- Both Local and Regional Monitoring showed that bacteria were not present in the water with the flushing disturbances. All resample results were reported to be negative.
- The BOD5 average result from the Environmental Monitoring hydrant discharge samples was below the guideline value.
- The total suspended solid average result from the Environmental Monitoring hydrant samples was above the guideline value.
- The average metal results from the Environmental Monitoring hydrant discharge samples were below the drinking water guidelines[2] with the exception of manganese, iron, and lead.

Draft Copy

RECOMMENDATIONS

The following recommendations are provided:

- Local Monitoring samples should continue to be obtained from businesses in the area where possible, since it was sometimes difficult to obtain samples from households, especially the initial post-flush sample.
- Pre-flush samples should be collected at least 5 sequences ahead of the flushing crew to prevent artificially high turbidity and colour results caused by disturbances from flushing nearby.
- Samples should continue to be obtained from households with water quality complaints or concerns. Any water complaints or concerns that occur during the weekend should be noted by Water Services staff and followed up by Environmental Standards staff the following workday.
- Environmental Monitoring should be continued to monitor the quality of the water being discharged to the catch basins. This monitoring should continue to include composite samples analyzed for chlorine, colour, total suspended solids, BOD5, turbidity, pH, metal scan and dissolved oxygen so we may compare results from year to year as we monitor discoloured water occurrences.
- A spare de-chlorinating pump and Vita-D-Chlor pucks should be purchased and kept on hand for instances when the de-chlorinating system is not dosing properly to ensure chlorinated water is not being discharged into the environment.

Draft Copy

REFERENCES

1. CH2M Hill. December 2013. Winnipeg Discoloured Water Investigation. Summary Report.
2. Federal-Provincial-Territorial Committee on Drinking Water of the Federal-Provincial-Territorial Committee on Health and Environment. October 2014. Guidelines for Canadian Drinking Water Quality Summary Table. Retrieved February 4, 2015. http://www.hc-sc.gc.ca/ewh-semt/pubs/water-eau/sum_guide-res_recom/index-eng.php.
3. Manitoba Water Stewardship. July 2011. Manitoba Water Quality Standards, Objectives, and Guidelines. Retrieved February 4, 2015. http://www.gov.mb.ca/waterstewardship/water_quality/quality/website_notice_mwqsog_2011.html.

APPENDIX A

2014 Water Main Cleaning Program Area

Draft Copy

APPENDIX B

2014 Water Main Cleaning Program Laboratory Analysis Summary Local Monitoring

Draft Copy

APPENDIX C

2014 Water Main Cleaning Program Laboratory Analysis Summary Regional Monitoring

Draft Copy

APPENDIX D

2014 Water Main Cleaning Program Laboratory Analysis Summary Sensitive Users Monitoring

Draft Copy

APPENDIX E

2014 Water Main Cleaning Program Laboratory Analysis Summary Environmental Monitoring

Draft Copy

E4b Environmental Monitoring (Hydrants) Reports 2011-2014

2011 Water Main Cleaning Program

Laboratory Analysis Report Environmental Monitoring

Date Sampled	Sample Location	Hydrant Number	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Turbidity (ntu)	Temperature (°C)	pH (units)	Apparent Colour (acu)	True Colour (tcu)	TSS (mg/L)	BOD_5 (mg/L)	DO (mg/L)	Soluble Calcium (mg/L)	Soluble Copper (mg/L)	Soluble Iron (mg/L)	Soluble Magnesium (mg/L)	Soluble Manganese (mg/L)	Soluble Sodium (mg/L)	Soluble Lead (mg/L)	Soluble Zinc (mg/L)	Total Calcium (mg/L)	Total Copper (mg/L)	Total Iron (mg/L)	Total Magnesium (mg/L)	Total Manganese (mg/L)	Total Sodium (mg/L)	Total Lead (mg/L)	Total Zinc (mg/L)
26-May-11	Hydrant Flush Comp.	50002807	2	293027	0.04	0.05	53.5	12.4	7 81	NA	NA	73	5	10.7	20.2	<0 01	<0.01	5 5	0.444	31 8	<0.001	<0.001	25 3	0.056	12 0	6.7	1.480	36.0	0.002	0 019
26-May-11	Hydrant Flush,	50002839	1	293026	<0 02	0.02	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
27-May-11	Hydrant Flush Comp.	50003347	10	293334	0.22	0.35	51.5	12 3	7 66	18.0	7 5	40	<2	10.4	20.7	<0 01	<0.01	5 8	0.002	31.7	<0.001	<0.001	21 0	0.018	10 2	5.7	0.165	31.4	0.001	<0.003
27-May-11	Hydrant Flush,	50004233	11	293335	0.23	0.37	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
30-May-11	Hydrant Flush Comp.	70003111	41	293317	0.04	0.07	34.0	11.7	7.75	10.0	2 5	41	2	NR	19.6	<0 01	0.02	5 5	0.320	31 9	<0.001	<0.001	21 6	0.012	3.4	6 0	0.455	33.3	0.001	<0.003
30-May-11	Hydrant Flush,	50004195	40	293318	0.05	0.08	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
31-May-11	Hydrant Flush Comp.	50003822	47	293389	0.08	0.10	17.9	11 6	7 93	100 0	2 5	18	<2	10.6	20.1	<0 01	<0.01	5 3	0.039	30 5	<0.001	<0.001	21 5	0.028	4.1	5.7	0 649	31.6	0.002	0 007
31-May-11	Hydrant Flush,	50001199	50	293390	0.05	0.08	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
1-Jun-11	Hydrant Flush Comp.	50004647	55	293850	<0 02	<0 02	12.0	10 8	7.86	7 5	5 0	10	2	10.8	21.9	<0 01	<0.01	6 0	0.262	35.1	<0.001	<0.001	22 5	0.012	2.3	6 0	0 389	34.3	0.001	<0.003
1-Jun-11	Hydrant Flush,	50003847	56	293851	<0 02	<0 02	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
2-Jun-11	Hydrant Flush Comp.	50003840	63	293899	<0 02	<0 02	6.90	10 9	7.82	25.0	3 5	6	4	10.6	22.2	<0 01	0.02	6 0	0.133	36 0	<0.001	<0.001	22.1	0.006	1.1	6 0	0.164	35.5	0.001	<0.003
2-Jun-11	Hydrant Flush,	50001215	62	293900	<0 02	<0 02	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
3-Jun-11	Hydrant Flush Comp.	70001566	73	294153	<0 02	<0 02	9.70	12 5	7.73	50.0	2 5	16	3	10.5	22.8	<0 01	<0.01	6 8	0.725	41 5	<0.001	<0.001	23 6	0.026	2.7	5 5	0 843	39.9	0.001	<0.003
3-Jun-11	Hydrant Flush,	70013254	72	294154	<0 02	<0 02	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
6-Jun-11	Hydrant Flush Comp.	50003632	98	294168	<0 02	<0 02	17.0	12.4	7 81	100 0	5 0	24	6	10.3	20.4	<0 01	<0.01	5.7	0.280	33.4	<0.001	<0.001	21 0	0.016	3.2	5 8	0 397	36.3	0.002	<0.003
6-Jun-11	Hydrant Flush,	50003669	94	294169	<0 02	<0 02	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
7-Jun-11	Hydrant Flush Comp.	50003679	106	294586	<0 02	<0 02	170	12.1	7.73	250 0	7 5	42	8	10.7	20.2	<0 01	<0.01	5 8	0.369	35 9	<0.001	<0.001	22 5	0.021	35 3	5.7	0 830	39.0	0.025	<0.003
7-Jun-11	Hydrant Flush,	50003677	105	294587	<0 02	<0 02	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
8-Jun-11	Hydrant Flush Comp.	50003794	117	294631	<0 02	<0 02	9.20	12 3	7.77	25.0	2 0	9	9	10.3	18.2	<0 01	<0.01	5 5	0.174	33 8	<0.001	<0.001	22 8	0.016	3.2	6 6	0 270	39.4	<0 001	<0.003
8-Jun-11	Hydrant Flush,	50003734	116	294632	<0 02	<0 02	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
9-Jun-11	Hydrant Flush Comp.	700009375	122	294647	<0 02	<0 02	8.00	12.1	7.75	25.0	2 5	11	7	10.5	18.1	<0 01	<0.01	5 5	0.101	33 3	<0.001	<0.001	20 8	0.006	1.3	5 9	0.130	36.5	<0 001	<0.003
9-Jun-11	Hydrant Flush,	50004771	123	294648	<0 02	<0 02	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
10-Jun-11	Hydrant Flush Comp.	50003353	130	294772	<0 02	<0 02	12.5	12.1	7.73	25.0	3 0	11	7	10.5	23.6	<0 01	<0.01	6 8	0.080	42 3	<0.001	<0.001	21.4	0.004	1.7	6 6	0.133	39.9	0.001	<0.003
10-Jun-11	Hydrant Flush,	50003353	131	294773	<0 02	<0 02	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
13-Jun-11	Hydrant Flush Comp.	70019639	79	294990	<0 02	<0 02	0.95	13.1	7.78	13.0	7 5	<4	5	10.0	22.3	<0 01	<0.01	7 0	0.065	42.1	<0.001	<0.001	23 8	0.004	0.3	7 5	0 083	46.5	<0 001	<0.003
13-Jun-11	Hydrant Flush,	50002944	78	294991	<0 02	<0 02	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
14-Jun-11	Hydrant Flush Comp.	50002774	156	295326	<0 02	<0 02	7.91	12 5	7.73	88.0	7 5	11	3	10.1	24.8	<0 01	<0.01	7.4	0.474	45 8	<0.001	<0.001	24.1	0.014	1.8	7 3	0 638	42.9	0.002	<0.003
14-Jun-11	Hydrant Flush,	50002774	157	295327	<0 02	<0 02	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
15-Jun-11	Hydrant Flush Comp.	40003084	163	295377	<0 02	<0 02	8.40	12.7	7.79	130 0	13.0	13	5	9 6	23.1	<0 01	<0.01	6 2	0.116	35 6	<0.001	<0.001	22 9	0.006	0.8	6 5	0.142	33.3	0.001	<0.003
15-Jun-11	Hydrant Flush,	500033268	162	295378	<0 02	<0 02	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA

Date Sampled	Sample Location	Hydrant Number	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Turbidity (ntu)	Temperature (°C)	pH (units)	Apparent Colour (acu)	True Colour (tcu)	TSS (mg/L)	BOD_5 (mg/L)	DO (mg/L)	Soluble Calcium (mg/L)	Soluble Copper (mg/L)	Soluble Iron (mg/L)	Soluble Magnesium (mg/L)	Soluble Manganese (mg/L)	Soluble Sodium (mg/L)	Soluble Lead (mg/L)	Soluble Zinc (mg/L)	Total Calcium (mg/L)	Total Copper (mg/L)	Total Iron (mg/L)	Total Magnesium (mg/L)	Total Manganese (mg/L)	Total Sodium (mg/L)	Total Lead (mg/L)	Total Zinc (mg/L)
16-Jun-11	Hydrant Flush Comp.	40002651	173	295439	<0 02	<0 02	8.84	13.1	7 86	13.0	2 5	18	7	10.1	21.3	<0 01	<0.01	6 2	0.655	33 8	<0.001	<0.001	23.4	0.024	2.5	6 2	0 887	35.5	0.001	<0.003
16-Jun-11	Hydrant Flush,	40003056	171	295440	<0 02	<0 02	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
17-Jun-11	Hydrant Flush Comp.	40003279	181	295510	<0 02	<0 02	37.6	12 3	7.74	150 0	5 0	29	7	10.6	22.4	<0 01	<0.01	5 9	0.242	34 5	<0.001	<0.001	24.4	0.016	8.0	6 2	0.466	35.7	0.001	<0.003
17-Jun-11	Hydrant Flush,	40003273	179	295511	<0 02	<0 02	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
20-Jun-11	Hydrant Flush Comp.	70002654	144	295681	<0 02	<0 02	23.0	15.1	7 63	75.0	5 0	16	10	9 8	22.5	<0 01	0.02	6.1	0.157	37 3	<0.001	<0.001	21 6	0.009	5.3	5 8	0.191	34.8	<0 001	<0.003
20-Jun-11	Hydrant Flush,	70002654	143	295682	<0 02	<0 02	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
21-Jun-11	Hydrant Flush Comp.	50000470	155	296040	<0 02	<0 02	23.8	12 5	7 84	130 0	7 5	32	<2	10.3	23.0	<0 01	<0.01	5.7	0.176	33 9	<0.001	<0.001	22 2	0.017	3.7	5 8	0 528	32.4	0.001	<0.003
21-Jun-11	Hydrant Flush,	50000072	154	296041	<0 02	<0 02	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
22-Jun-11	Hydrant Flush Comp.	40003326	229	296073	<0 02	<0 02	1.96	15 2	7.70	13.0	2 5	5	11	9.7	21.1	<0 01	<0.01	4 5	0.073	26.7	<0.001	<0.001	21.4	0.004	0.3	6 5	0 070	44.8	<0 001	<0.003
22-Jun-11	Hydrant Flush,	40003378	228	296074	<0 02	<0 02	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
23-Jun-11	Hydrant Flush Comp.	40000598	239	296141	<0 02	<0 02	16.3	15.4	7 82	120 0	5 0	15	6	9 5	19.5	<0 01	<0.01	5 0	0.353	34 6	<0.001	<0.001	21 5	0.007	1.8	5 2	0.484	37.4	0.002	<0.003
23-Jun-11	Hydrant Flush,	40000323	238	296142	<0 02	<0 02	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
24-Jun-11	Hydrant Flush Comp.	50001649	185	296326	<0 02	<0 02	15 0	12.4	7.75	150.0	13.0	14	6	10.2	20.9	<0 01	<0.01	6 0	0.177	34.4	<0.001	<0.001	24 8	0.009	1.4	6 6	0 267	48.0	<0 001	<0.003
24-Jun-11	Hydrant Flush,	50001649	184	296327	<0 02	<0 02	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
27-Jun-11	Hydrant Flush Comp.	50002061	195	296371	<0 02	<0 02	19.1	14.7	7 80	160.0	15.0	29	7	9 8	19.1	<0 01	<0.01	4 9	0.525	34.1	<0.001	<0.001	18.4	0.014	2.0	4.7	0 692	31.7	0.001	0 004
27-Jun-11	Hydrant Flush,	50004105	194	296372	<0 02	<0 02	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
28-Jun-11	Hydrant Flush Comp.	50002220	205	296764	<0 02	<0 02	74.1	14.1	7 85	250.0	15.0	108	4	10.1	19.6	<0 01	<0.01	5 2	0.325	33 0	<0.001	<0.001	24.4	0.014	6.1	6 9	0 556	33.5	0.002	0 004
28-Jun-11	Hydrant Flush,	50002218	204	296765	<0 02	<0 02	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
29-Jun-11	Hydrant Flush Comp.	50000792	219	296812	<0 02	<0 02	32.4	15.7	7 88	150.0	10.0	57	NR	9 5	19.5	<0 01	<0.01	5.1	0.343	32 2	<0.001	<0.001	20.1	0.012	1.0	5 2	0 352	34.7	<0 001	0 006
29-Jun-11	Hydrant Flush,	70001988	218	296813	<0 02	<0 02	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
30-Jun-11	Hydrant Flush Comp.	70020942	231	296853	<0 02	<0 02	40.2	15 6	7.76	150 0	7 5	70	10	9 8	21.1	<0 01	<0.01	4.4	0.828	28.1	<0.001	<0.001	20 3	0.027	10 3	4 3	1 090	34.7	0.001	0 019
30-Jun-11	Hydrant Flush,	70020942	230	296854	<0 02	<0 02	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
4-Jul-11	Hydrant Flush Comp.	50001371	246	297082	<0 02	<0 02	3.54	15 6	7.68	15.0	2 0	6	2	9 8	17.9	<0 01	<0.01	5 0	0.041	30 5	<0.001	<0.001	19 2	0.004	1.2	5.4	0 060	31.7	<0 001	<0.003
4-Jul-11	Hydrant Flush,	50001371	245	297083	<0 02	<0 02	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
5-Jul-11	Hydrant Flush Comp.	40001350	332	297445	<0 02	<0 02	4.91	16 5	7.74	18.0	2 5	8	16	9 9	18.0	<0 01	<0.01	5.1	0.214	33 3	<0.001	<0.001	17 9	0.006	1.0	5.4	0 253	33.3	<0 001	0 003
5-Jul-11	Hydrant Flush,	40001350	333	297446	<0 02	<0 02	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
6-Jul-11	Hydrant Flush Comp.	50002184	262	297508	<0 02	<0 02	23.5	15 6	7 60	25.0	2 5	15	19	9 6	19.2	<0 01	0.02	5 0	0.168	33.1	<0.001	<0.001	21.1	0.011	4.7	5.1	0 215	35.2	<0 001	0 007
6-Jul-11	Hydrant Flush,	50000318	261	297509	<0 02	<0 02	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
7-Jul-11	Hydrant Flush Comp.	50001688	273	297578	<0 02	<0 02	2.90	16 0	7.72	15.0	NR	4	3	9 6	20.6	<0 01	<0.01	5 3	0.053	33.1	<0.001	<0.001	21 8	0.005	0.6	5.4	0 072	33.5	<0 001	<0.003
7-Jul-11	Hydrant Flush,	50002058	272	297579	<0 02	<0 02	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
8-Jul-11	Hydrant Flush Comp.	50002178	280	297646	<0 02	<0 02	10.9	16.1	7 54	21.0	NR	4	10	9.7	17.4	<0 01	<0.01	4.7	0.065	28 6	<0.001	<0.001	19 3	0.005	2.1	5 2	0 087	32.1	<0 001	<0.003
8-Jul-11	Hydrant Flush,	50002178	281	297647	<0 02	<0 02	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
12-Jul-11	Hydrant Flush Comp.	50002832	300	298172	<0 02	<0 02	12.2	14 8	7.49	50.0	NR	12	6	9.7	18.9	<0 01	<0.01	5 0	0.235	29 8	<0.001	<0.001	19 3	0.016	2.1	5 2	0 282	29.7	0.001	0 005
12-Jul-11	Hydrant Flush,	50002842	298	298173	<0 02	<0 02	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
13-Jul-11	Hydrant Flush Comp.	50000411	308	298200	<0 02	<0 02	7.34	16 2	7.79	50.0	5 0	8	4	9 3	18.0	<0 01	<0.01	4 9	0.292	28.7	<0.001	<0.001	17 9	0.009	1.0	5 0	0 335	29.0	<0 001	<0.003
13-Jul-11	Hydrant Flush,	50000411	309	298201	<0 02	<0 02	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA

Date Sampled	Sample Location	Hydrant Number	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Turbidity (ntu)	Temperature (°C)	pH (units)	Apparent Colour (acu)	True Colour (tcu)	TSS (mg/L)	BOD_5 (mg/L)	DO (mg/L)	Soluble Calcium (mg/L)	Soluble Copper (mg/L)	Soluble Iron (mg/L)	Soluble Magnesium (mg/L)	Soluble Manganese (mg/L)	Soluble Sodium (mg/L)	Soluble Lead (mg/L)	Soluble Zinc (mg/L)	Total Calcium (mg/L)	Total Copper (mg/L)	Total Iron (mg/L)	Total Magnesium (mg/L)	Total Manganese (mg/L)	Total Sodium (mg/L)	Total Lead (mg/L)	Total Zinc (mg/L)
14-Jul-11	Hydrant Flush Comp.	50002714	319	298252	<0 02	<0 02	14.6	19.1	7.85	63.0	5 0	17	<5	9 0	18.4	<0 01	0.01	5 0	0.370	31 3	<0.001	<0.001	18 9	0.014	3.3	5.1	0.452	32.4	0.002	<0.003
14-Jul-11	Hydrant Flush,	50002644	318	298253	<0 02	<0 02	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
15-Jul-11	Hydrant Flush Comp.	50003088	329	298344	<0 02	<0 02	13.2	20 2	7.77	100 0	5 0	27	9	9.1	18.7	<0 01	<0.01	5 0	0.713	30.4	<0.001	<0.001	18 6	0.025	4.3	5.1	1 060	30.8	0.002	0 013
15-Jul-11	Hydrant Flush,	50003088	328	298345	<0 02	<0 02	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
18-Jul-11	Hydrant Flush Comp.	70001182	361	298532	<0 02	<0 02	4.00	20 5	7.72	10.0	0 5	6	5	8 9	18.9	<0 01	<0.01	5.4	0.093	30 8	<0.001	<0.001	18.7	0.007	0.9	5.1	0.108	30.2	<0 001	<0.003
18-Jul-11	Hydrant Flush,	70000988	363	298533	<0 02	<0 02	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
19-Jul-11	Hydrant Flush Comp.	50002746	370	298903	<0 02	<0 02	56.0	20.4	7.74	120 0	2 5	53	3	8 9	19.7	<0 01	0.02	5 5	0.689	30.1	<0.001	0 015	20 0	0.031	14 9	5 6	1 560	29.4	0.005	0 043
19-Jul-11	Hydrant Flush,	50004380	371	298904	<0 02	<0 02	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
20-Jul-11	Hydrant Flush Comp.	50002692	379	299045	<0 02	<0 02	15.7	18 2	7.76	130 0	1 0	27	2	8 9	20.8	<0 01	<0.01	5 2	0.054	31 9	<0.001	<0.001	20 6	0.018	2.8	5 5	0 384	32.1	0.002	0 021
20-Jul-11	Hydrant Flush,	70001003	381	299046	<0 02	<0 02	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
21-Jul-11	Hydrant Flush Comp.	50000447	389	299098	<0 02	<0 02	28.2	19 3	7.72	50.0	1 0	40	21	8 8	19.5	<0 01	<0.01	5 3	0.371	33 8	<0.001	<0.001	20 8	0.014	13.7	5 5	0 583	35.8	<0 001	<0.003
21-Jul-11	Hydrant Flush,	50002749	390	299099	<0 02	<0 02	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
22-Jul-11	Hydrant Flush Comp.	50002783	401	299127	<0 02	<0 02	24.1	18.1	7.79	75.0	2 5	28	10	9 6	17.1	<0 01	<0.01	4.4	0.963	27.4	<0.001	<0.001	19.7	0.034	8.5	4 8	1 570	28.6	0.005	0 014
22-Jul-11	Hydrant Flush,	50002783	399	299128	<0 02	<0 02	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
25-Jul-11	Hydrant Flush Comp.	50001919	410	299339	<0 02	<0 02	24.2	20.7	7.54	50.0	5 0	34	3	9 3	19.5	<0 01	<0.01	4 9	0.196	25 8	<0.001	<0.001	20 6	0.008	5.7	5.1	0 295	27.6	<0 001	<0.003
25-Jul-11	Hydrant Flush,	50001919	409	299340	<0 02	<0 02	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
26-Jul-11	Hydrant Flush Comp.	50000961	420	299657	<0 02	<0 02	28.8	21 3	7.78	130 0	2 5	31	2	9 3	21.9	<0 01	<0.01	4 6	0.312	26 6	<0.001	<0.001	22 0	0.029	7.4	5.1	0 956	28.3	0.002	0 009
26-Jul-11	Hydrant Flush,	50004029	418	299658	<0 02	<0 02	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
27-Jul-11	Hydrant Flush Comp.	50002994	430	299722	<0 02	<0 02	48.7	20 8	7 51	150 0	2 0	47	4	9 3	20.3	<0 01	<0.01	5 0	0.928	27 3	<0.001	<0.001	24.7	0.055	19 5	5 3	1 920	27.7	0.003	0 022
27-Jul-11	Hydrant Flush,	50002999	429	299723	<0 02	<0 02	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
28-Jul-11	Hydrant Flush Comp.	50001538	440	299784	<0 02	<0 02	0.74	21 3	7 67	25.0	2 5	16	5	8 8	19.7	<0 01	<0.01	5 0	0.171	29 3	<0.001	<0.001	20 2	0.007	2.1	5 2	0 221	29.8	<0 001	0 003
28-Jul-11	Hydrant Flush,	50001086	438	299785	<0 02	<0 02	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
29-Jul-11	Hydrant Flush Comp.	50001778	451	299828	<0 02	<0 02	23.4	18.4	7.73	50.0	2 5	26	3	9 3	20.5	<0 01	<0.01	5.1	0.554	30 0	<0.001	<0.001	20 2	0.041	7.0	5.4	1 010	30.2	0.001	0 013
29-Jul-11	Hydrant Flush,	70002588	450	299829	<0 02	<0 02	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
4-Aug-11	Hydrant Flush Comp.	40003282	451	300393	<0 02	<0 02	6 3	19 2	7 67	25.0	4 0	8	4	9.4	20.8	<0 01	<0.01	5 0	0.358	30.7	<0.001	<0.001	21 3	0.011	1.2	5 3	0.433	32.7	0.009	<0.003
4-Aug-11	Hydrant Flush,	40003282	450	300394	<0 02	<0 02	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
5-Aug-11	Hydrant Flush Comp.	70023197	461	300562	<0 02	<0 02	46.6	18.1	7 96	200 0	7 5	84	<2	9 2	20.7	<0 01	<0.01	4 9	0.001	29 9	<0.001	<0.001	23 6	0.015	1.9	5.1	0 308	32.3	0.002	0 006
5-Aug-11	Hydrant Flush,	70023197	462	300563	<0 02	<0 02	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
8-Aug-11	Hydrant Flush Comp.	50001304	507	300662	<0 02	<0 02	11.1	17 5	7.87	50.0	1 0	18	8	9.1	23.7	<0 01	<0.01	4 6	0.508	34 6	<0.001	<0.001	23 2	0.016	4.0	4 9	0 631	33.8	0.002	0 006
8-Aug-11	Hydrant Flush,	50003476	501	300663	<0 02	<0 02	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
9-Aug-11	Hydrant Flush Comp.	40002893	500	301053	<0 02	<0 02	20.9	17 9	7.88	50.0	2 5	27	3	9 0	21.9	<0 01	<0.01	4 9	0.195	32 5	<0.001	<0.001	23 3	0.016	7.4	5 0	0 394	32.7	0.017	0 004
9-Aug-11	Hydrant Flush,	70000759	501	301054	<0 02	<0 02	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
10-Aug-11	Hydrant Flush Comp.	40003845	511	301104	<0 02	<0 02	29.4	17.1	7.71	500 0	1 0	94	2	9 0	20.3	<0 01	<0.01	4 6	0.074	29.7	<0.001	<0.001	23 6	0.028	12 2	4 8	1 610	33.1	0.006	0 017
10-Aug-11	Hydrant Flush,	40003845	510	301105	<0 02	<0 02	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
11-Aug-11	Hydrant Flush Comp.	40002839	519	301148	<0 02	<0 02	3 3	17.4	7.83	50.0	1 0	17	2	8 9	22.3	<0 01	<0.01	5 2	0.232	31 6	<0.001	<0.001	22 6	0.010	2.6	5 2	0.451	32.6	0.015	<0.003
11-Aug-11	Hydrant Flush,	40002839	520	301149	<0 02	<0 02	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
12-Aug-11	Hydrant Flush Comp.	40002360	531	301322	<0 02	<0 02	11.3	18.1	7 86	25.0	2 5	10	5	8 8	21.6	<0 01	<0.01	4 6	0.134	34 2	<0.001	<0.001	21.7	0.007	3.4	5 0	0.172	35.8	0.001	<0.003
12-Aug-11	Hydrant Flush,	40002360	530	301323	<0 02	<0 02	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA

Date Sampled	Sample Location	Hydrant Number	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Turbidity (ntu)	Temperature (°C)	pH (units)	Apparent Colour (acu)	True Colour (tcu)	TSS (mg/L)	BOD_5 (mg/L)	DO (mg/L)	Soluble Calcium (mg/L)	Soluble Copper (mg/L)	Soluble Iron (mg/L)	Soluble Magnesium (mg/L)	Soluble Manganese (mg/L)	Soluble Sodium (mg/L)	Soluble Lead (mg/L)	Soluble Zinc (mg/L)	Total Calcium (mg/L)	Total Copper (mg/L)	Total Iron (mg/L)	Total Magnesium (mg/L)	Total Manganese (mg/L)	Total Sodium (mg/L)	Total Lead (mg/L)	Total Zinc (mg/L)
15-Aug-11	Hydrant Flush Comp.	40001488	560	301340	<0 02	<0 02	21.5	14.1	7 82	130 0	2 5	32	2	9.7	21.8	<0 01	<0.01	5 0	0.112	33 2	<0.001	<0.001	23 9	0.015	2.8	5 3	0 601	34.1	0.004	0 009
15-Aug-11	Hydrant Flush,	40002376	561	301341	<0 02	<0 02	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
16-Aug-11	Hydrant Flush Comp.	40002388	571	301695	<0 02	<0 02	8 8	17 0	7.86	25.0	1 0	4	3	9 8	23.3	<0 01	<0.01	5 2	0.126	34.1	<0.001	<0.001	23 6	0.004	0.6	5 8	0.146	35.0	<0 001	<0.003
16-Aug-11	Hydrant Flush,	40002388	572	301696	<0 02	<0 02	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
17-Aug-11	Hydrant Flush Comp.	40003639	579	301744	<0 02	<0 02	3 2	17 2	7 85	25.0	2 5	<4	7	9 2	23.1	<0 01	<0.01	5 6	0.078	37.7	<0.001	<0.001	23 6	0.005	1.2	5 8	0 095	38.3	<0 001	<0.003
17-Aug-11	Hydrant Flush,	40002751	578	301745	<0 02	<0 02	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
18-Aug-11	Hydrant Flush Comp.	70013859	588	301815	<0 02	<0 02	15.4	16 0	7 83	50.0	2 5	23	6	9 2	20.0	<0 01	<0.01	4.7	0.279	32 0	<0.001	<0.001	22 6	0.016	1.8	5 2	0.467	34.7	0.002	0 004
18-Aug-11	Hydrant Flush,	70009885	587	301816	<0 02	<0 02	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
19-Aug-11	Hydrant Flush Comp.	70013856	596	301827	<0 02	<0 02	33.2	15 6	7 93	150 0	2 0	31	6	9 3	22.8	<0 01	<0.01	5 6	0.885	36 9	<0.001	<0.001	25 8	0.049	8.3	6.4	1 810	37.3	0.004	0 022
19-Aug-11	Hydrant Flush,	70005014	595	301828	<0 02	<0 02	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
22-Aug-11	Hydrant Flush Comp.	50003978	609	302067	<0 02	<0 02	11.0	19 0	7 87	75.0	2 5	16	2	8.1	20.1	<0 01	<0.01	6 2	0.165	31 2	<0.001	<0.001	20 9	0.016	2.2	6 3	0.491	31.2	0.001	0 014
22-Aug-11	Hydrant Flush,	70009029	613	302068	<0 02	<0 02	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
23-Aug-11	Hydrant Flush Comp.	70002663	618	302466	<0 02	<0 02	30.3	16 6	7 96	150 0	2 0	53	3	9 8	24.6	<0 01	<0.01	5 6	0.864	33 5	<0.001	<0.001	25 6	0.034	3.4	6 3	1.770	34.9	0.003	0 024
23-Aug-11	Hydrant Flush,	50000834	619	302467	<0 02	<0 02	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
24-Aug-11	Hydrant Flush Comp.	50000983	629	302514	<0 02	<0 02	5 2	19.1	7.26	25.0	2 0	10	6	8.7	17.4	<0 01	<0.01	4 6	0.255	28 8	<0.001	<0.001	18.4	0.007	1.0	4 8	0 300	29.2	<0 001	<0.003
24-Aug-11	Hydrant Flush,	50000983	630	302515	<0 02	<0 02	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
25-Aug-11	Hydrant Flush Comp.	50000742	638	302538	<0 02	<0 02	9.4	17 3	7.54	25.0	2 5	10	3	8.7	17.5	<0 01	<0.01	4.4	0.484	27 0	<0.001	<0.001	19 0	0.019	2.6	4.4	0 677	28.2	<0 001	0 006
25-Aug-11	Hydrant Flush,	50000821	639	302539	<0 02	<0 02	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
26-Aug-11	Hydrant Flush Comp.	70023898	606	302799	<0 02	<0 02	26.0	13.7	7.71	200 0	2 5	38	<2	9 8	19.1	<0 01	<0.01	4.7	0.011	28.4	<0.001	<0.001	20 8	0.060	4.4	5 3	0 502	28.4	0.008	0 018
26-Aug-11	Hydrant Flush,	70023898	607	302800	<0 02	<0 02	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
29-Aug-11	Hydrant Flush Comp.	50002039	648	302817	<0 02	<0 02	8.7	19 2	7.73	50.0	2 0	12	3	8.1	16.9	<0 01	<0.01	4 0	0.180	26.1	<0.001	<0.001	17 3	0.009	1.0	4.4	0 219	26.5	0.001	<0.003
29-Aug-11	Hydrant Flush,	50001768	649	302818	<0 02	<0 02	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
30-Aug-11	Hydrant Flush Comp.	50001548	661	303182	<0 02	<0 02	9 6	19.4	7.62	100 0	2 0	9	8	9.7	20.4	<0 01	<0.01	4 6	0.525	31 8	<0.001	<0.001	20.7	0.019	2.4	4.7	0 675	32.3	0.002	0 008
30-Aug-11	Hydrant Flush,	50001943	662	303183	<0 02	<0 02	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
31-Aug-11	Hydrant Flush Comp.	50003577	669	303249	<0 02	<0 02	4 3	19 3	7 63	30.0	2 0	11	10	9 0	19.3	<0 01	<0.01	5 8	0.167	35 8	<0.001	<0.001	19.1	0.008	1.2	5.7	0.193	36.7	<0 001	<0.003
31-Aug-11	Hydrant Flush,	50003577	670	303250	<0 02	<0 02	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
1-Sep-11	Hydrant Flush Comp.	50001148	679	303418	<0 02	<0 02	11.5	18.1	7.70	50.0	2 0	18	4	9.1	20.9	<0 01	<0.01	5 6	0.524	33.1	<0.001	<0.001	20.7	0.021	1.8	5 6	0.727	35.1	<0 001	0 010
1-Sep-11	Hydrant Flush,	70012896	680	303419	<0 02	<0 02	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
2-Sep-11	Hydrant Flush Comp.	70045953	688	303583	<0 02	<0 02	30.7	19 0	7.76	160 0	2 0	50	NR	8.7	17.1	<0 01	<0.01	5.7	0.768	35.4	<0.001	<0.001	19.4	0.047	11 8	6 3	1 900	38.2	<0 001	0 031
2-Sep-11	Hydrant Flush,	70045953	689	303584	<0 02	<0 02	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
6-Sep-11	Hydrant Flush Comp.	50000463	727	303920	<0 02	<0 02	4 9	19 2	7.69	30.0	2 0	10	5	9 0	17.6	<0 01	<0.01	6 2	0.375	34.7	<0.001	<0.001	19.1	0.012	1.5	6 0	0.435	37.5	<0 001	0 007
6-Sep-11	Hydrant Flush,	50000463	728	303921	<0 02	<0 02	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
7-Sep-11	Hydrant Flush Comp.	50000355	742	304004	<0 02	<0 02	10.8	19 3	7.63	30.0	2 0	10	4	8 9	20.4	<0 01	<0.01	5.7	0.140	35 5	<0.001	<0.001	20 2	0.011	3.2	5.7	0.184	35.8	0.001	0 006
7-Sep-11	Hydrant Flush,	50000374	741	304005	<0 02	<0 02	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
9-Sep-11	Hydrant Flush Comp.	50000837	757	304053	<0 02	<0 02	1 8	18 9	7.72	16.0	1 0	<4	3	9.1	20.3	<0 01	<0.01	5 6	0.149	35 2	<0.001	<0.001	21.7	0.007	0.9	5.7	0.172	37.3	<0 001	0 004
9-Sep-11	Hydrant Flush,	70002109	758	304054	<0 02	<0 02	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
12-Sep-11	Hydrant Flush Comp.	50001977	770	304234	<0 02	<0 02	17.5	18 3	7.76	50.0	1 0	17	5	8 9	21.1	<0 01	<0.01	5.4	0.149	35 2	<0.001	<0.001	20 9	0.009	3.6	6 3	0 204	35.7	0.003	0 004
12-Sep-11	Hydrant Flush,	50000262	769	304235	<0 02	<0 02	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA

Date Sampled	Sample Location	Hydrant Number	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Turbidity (ntu)	Temperature (°C)	pH (units)	Apparent Colour (acu)	True Colour (tcu)	TSS (mg/L)	BOD_5 (mg/L)	DO (mg/L)	Soluble Calcium (mg/L)	Soluble Copper (mg/L)	Soluble Iron (mg/L)	Soluble Magnesium (mg/L)	Soluble Manganese (mg/L)	Soluble Sodium (mg/L)	Soluble Lead (mg/L)	Soluble Zinc (mg/L)	Total Calcium (mg/L)	Total Copper (mg/L)	Total Iron (mg/L)	Total Magnesium (mg/L)	Total Manganese (mg/L)	Total Sodium (mg/L)	Total Lead (mg/L)	Total Zinc (mg/L)
13-Sep-11	Hydrant Flush Comp.	50002009	777	304624	<0 02	<0 02	168.0	18 0	7 88	250 0	1 0	100	4	NR	23.0	<0 01	<0.01	5.4	0.590	33.4	<0.001	<0.001	24.4	0.044	14 2	5 9	1 380	36.8	0.011	0 025
13-Sep-11	Hydrant Flush,	50001943	778	304625	<0 02	<0 02	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
14-Sep-11	Hydrant Flush Comp.	50001565	788	304691	<0 02	<0 02	72.0	17 5	7 91	250 0	1 0	107	NR	9 2	21.7	<0 01	<0.01	5 2	0.837	32 9	<0.001	<0.001	24 6	0.046	21 6	5 9	1 860	34.0	0.013	0 026
14-Sep-11	Hydrant Flush,	50002586	789	304692	<0 02	<0 02	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
16-Sep-11	Hydrant Flush Comp.	50001617	804	304728	<0 02	<0 02	37.0	15 8	7 83	150 0	1 0	39	8	9 6	20.7	<0 01	<0.01	5.1	0.320	35 3	<0.001	<0.001	23.7	0.019	10.4	5.7	0 525	36.3	0.003	0 008
16-Sep-11	Hydrant Flush,	50001622	805	304729	<0 02	<0 02	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA

NR - No result NA - Not analyzed

NOTE: On May 30 and September 13, there was no result for dissolved oxygen due to an instrument error.
On June 29, September 2, and September 14, there was no result for BOD5 due to QC failure.
On July 7, 8 and 12 there were no results for true colour due to lab error.

2012 Water Main Cleaning Program

Laboratory Analysis Report Environmental Monitoring

Date Sampled	Sample Location	Hydrant Number	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)	TSS (mg/L)	BOD_5 (mg/L)	DO (mg/L)	Soluble Calcium (mg/L)	Soluble Copper (mg/L)	Soluble Iron (mg/L)	Soluble Magnesium (mg/L)	Soluble Manganese (mg/L)	Soluble Sodium (mg/L)	Soluble Lead (mg/L)	Soluble Zinc (mg/L)	Total Calcium (mg/L)	Total Copper (mg/L)	Total Iron (mg/L)	Total Magnesium (mg/L)	Total Manganese (mg/L)	Total Sodium (mg/L)	Total Lead (mg/L)	Total Zinc (mg/L)
7-May-12	Hydrant Flush Comp.	60004003	30	324520	<0.02	<0.02	29.4	8.7	7.93	2.5	45	4	11.5	21.8	0.01	1.25	5.6	0.745	30.5	<0.001	0.001	21.5	0.036	6.4	5.8	1.330	30.4	0.002	0.015
7-May-12	Hydrant Flush,	60003982	29	324521	<0.02	<0.02																							
8-May-12	Hydrant Flush Comp.	60004320	36	325044	<0.02	<0.02	9.43	9.1	7.81	1.0	13	3	11.6	21.9	0.01	1.05	5.3	0.515	30.3	<0.001	0.002	22.5	0.020	2.2	5.8	0.771	30.0	<0.001	0.011
8-May-12	Hydrant Flush,	60005346	39	325045	<0.02	<0.02																							
9-May-12	Hydrant Flush Comp.	60001453	49	325097	<0.02	<0.02	11.9	10.4	7.91	1.0	19	5	11.5	21.7	<0.01	0.11	5.6	0.573	29.3	<0.001	<0.001	22.3	0.027	1.8	5.7	1.100	30.4	<0.001	0.012
9-May-12	Hydrant Flush,	70020348	50	325098	<0.02	<0.02																							
11-May-12	Hydrant Flush Comp.	60004445	63	325191	<0.02	<0.02	1.89	11.1	7.83	3.0	<4	3	11.0	20.2	0.03	0.32	5.6	0.078	30.3	<0.001	<0.001	22.1	0.045	0.7	6.4	0.093	32.1	<0.001	<0.003
11-May-12	Hydrant Flush,	60004091	62	325192	<0.02	<0.02																							
14-May-12	Hydrant Flush Comp.	70007303	96	325355	<0.02	<0.02	0.73	10.9	7.75	2.0	<4	2	11.0	20.3	<0.01	0.02	5.4	0.011	29.1	<0.001	<0.001	20.3	0.005	0.1	5.6	0.042	29.3	<0.001	<0.003
14-May-12	Hydrant Flush,	70005216	93	325356	<0.02	<0.02																							
15-May-12	Hydrant Flush Comp.	70007290	102	325399	<0.02	<0.02	14.9	10.4	7.76	2.0	18	3	11.3	18.0	<0.01	0.06	4.9	0.202	27.0	<0.001	<0.001	17.9	0.011	0.7	5.0	0.272	27.6	0.001	<0.003
15-May-12	Hydrant Flush,	70007289	103	325400	<0.02	<0.02																							
16-May-12	Hydrant Flush Comp.	60004108	113	325807	<0.02	<0.02	30.2	11.7	7.88	2.0	36	5	10.7	20.2	<0.01	0.89	5.5	0.561	29.5	<0.001	<0.001	20.7	0.017	4.2	5.7	0.911	29.8	0.004	0.008
16-May-12	Hydrant Flush,	60005328	112	325808	<0.02	<0.02																							
17-May-12	Hydrant Flush Comp.	60004203	129	325867	<0.02	<0.02	6.93	13.4	7.90	1.0	8	<2	10.5	19.0	<0.01	0.03	5.5	0.009	28.6	<0.001	<0.001	21.9	0.007	0.9	5.5	0.100	32.5	<0.001	<0.003
17-May-12	Hydrant Flush,	60004210	130	325868	<0.02	<0.02																							
18-May-12	Hydrant Flush Comp.	60005386	139	325912	<0.02	<0.02	14.4	12.7	7.75	1.5	17	4	10.4	24.4	<0.01	0.42	5.8	0.509	33.8	<0.001	<0.001	24.3	0.020	1.7	6.4	0.629	35.3	<0.001	0.029
18-May-12	Hydrant Flush,	60004160	138	325913	<0.02	<0.02																							
22-May-12	Hydrant Flush Comp.	60003604	187	326065	<0.02	<0.02	9.18	14.2	7.84	1.0	13	NR	10.2	24.2	<0.01	0.61	5.9	0.246	34.0	<0.001	<0.001	24.0	0.018	0.9	6.4	0.352	35.0	<0.001	<0.003
22-May-12	Hydrant Flush,	60001373	188	326066	<0.02	<0.02																							
23-May-12	Hydrant Flush Comp.	60003780	196	326530	<0.02	<0.02	21.4	11.7	7.88	2.0	27	NR	10.6	22.0	<0.01	0.20	5.8	0.126	31.8	<0.001	<0.001	22.4	0.046	2.1	5.9	0.657	35.3	0.001	0.019
23-May-12	Hydrant Flush,	60004791	197	326531	<0.02	<0.02																							
24-May-12	Hydrant Flush Comp.	60003768	208	326568	<0.02	<0.02	32.4	12.1	7.69	2.5	36	<2	10.5	22.8	<0.01	<0.01	5.7	0.068	31.5	<0.001	<0.001	23.0	0.003	0.1	6.3	0.211	32.3	<0.001	<0.003
24-May-12	Hydrant Flush,	60003768	209	326569	<0.02	<0.02																							
25-May-12	Hydrant Flush Comp.	70004875	222	326603	<0.02	<0.02	1.65	10.2	7.85	1.0	<4	3	11.0	17.9	<0.01	0.01	5.2	0.055	26.6	<0.001	<0.001	17.9	0.005	0.2	5.3	0.061	27.0	<0.001	<0.003
25-May-12	Hydrant Flush,	60005119	219	326604	<0.02	<0.02																							
28-May-12	Hydrant Flush Comp.	70005856	259	326808	<0.02	<0.02	17.3	11.9	7.85	2.5	35	<2	10.8	19.1	0.01	0.82	5.3	0.820	26.1	<0.001	0.003	19.5	0.038	3.0	5.3	1.360	27.6	0.001	0.021
28-May-12	Hydrant Flush,	60003484	253	326809	<0.02	<0.02																							
29-May-12	Hydrant Flush Comp.	60003578	268	326843	<0.02	<0.02	30.3	10.1	7.91	0.5	42	2	10.8	20.1	<0.01	0.17	5.8	0.427	28.7	<0.001	<0.001	21.3	0.033	2.2	5.9	0.880	29.3	0.002	0.014
29-May-12	Hydrant Flush,	60007401	265	326844	<0.02	<0.02																							
30-May-12	Hydrant Flush Comp.	70003038	282	327245	<0.02	<0.02	6.11	10.2	7.92	2.0	9	3	10.7	20.5	<0.01	0.27	5.3	0.752	30.8	<0.001	<0.001	20.4	0.031	11.5	5.3	1.190	30.9	0.002	0.014
30-May-12	Hydrant Flush,	70002454	278	327246	<0.02	<0.02																							
31-May-12	Hydrant Flush Comp.	60001574	292	327285	<0.02	<0.02	65.5	15.1	7.80	0.5	52	4	9.8	19.5	<0.01	0.07	5.5	0.702	30.7	<0.001	<0.001	19.2	0.028	2.0	5.6	0.999	30.3	<0.001	0.011
31-May-12	Hydrant Flush,	60000882	289	327286	<0.02	<0.02																							
1-Jun-12	Hydrant Flush Comp.	60000867	301	327328	<0.02	<0.02	20.6	14.5	7.70	1.0	22	7	9.9	23.7	<0.01	0.25	6.4	0.175	35.1	<0.001	<0.001	24.9	0.012	4.4	6.9	0.238	35.6	0.002	0.019
1-Jun-12	Hydrant Flush,	60000867	302	327329	<0.02	<0.02																							
4-Jun-12	Hydrant Flush Comp.	70004607	335	327518	<0.02	<0.02	13.2	NR	7.82	1.5	29	7	NR	24.0	0.01	1.16	6.2	1.140	35.1	<0.001	0.006	24.4	0.025	2.6	6.1	1.290	36.7	0.001	0.016
4-Jun-12	Hydrant Flush,	70004607	334	327519	<0.02	<0.02																							

Date Sampled	Sample Location	Hydrant Number	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)	TSS (mg/L)	BOD_5 (mg/L)	DO (mg/L)	Soluble Calcium (mg/L)	Soluble Copper (mg/L)	Soluble Iron (mg/L)	Soluble Magnesium (mg/L)	Soluble Manganese (mg/L)	Soluble Sodium (mg/L)	Soluble Lead (mg/L)	Soluble Zinc (mg/L)	Total Calcium (mg/L)	Total Copper (mg/L)	Total Iron (mg/L)	Total Magnesium (mg/L)	Total Manganese (mg/L)	Total Sodium (mg/L)	Total Lead (mg/L)	Total Zinc (mg/L)
5-Jun-12	Hydrant Flush Comp.	60000782	348	327932	<0.02	<0.02	19.8	15.4	7.84	1.0	33	6	10.2	24.5	<0.01	0.14	6.3	0.550	36.3	<0.001	<0.001	24.6	0.018	1.9	6.3	0.636	36.8	0.010	0.008
5-Jun-12	Hydrant Flush,	60000568	344	327933	<0.02	<0.02																							
6-Jun-12	Hydrant Flush Comp.	60000777	358	327997	<0.02	<0.02	44.4	14.5	7.79	1.5	65	7	9.9	20.6	<0.01	0.08	5.2	1.300	33.5	<0.001	<0.001	24.9	0.044	11.5	6.8	1.880	34.3	0.004	0.022
6-Jun-12	Hydrant Flush,	60001349	356	327998	<0.02	<0.02																							
7-Jun-12	Hydrant Flush Comp.	60003932	372	328075	<0.02	<0.02	24.6	14.9	7.68	1.5	22	<2	10.3	19.8	<0.01	2.11	5.5	0.326	29.6	<0.001	0.002	20.4	0.015	3.8	5.7	0.508	30.7	<0.001	0.004
7-Jun-12	Hydrant Flush,	60000760	370	328076	<0.02	<0.02																							
8-Jun-12	Hydrant Flush Comp.	60003391	381	328126	<0.02	<0.02	26.2	14.7	7.83	1.0	26	6	9.6	19.3	<0.01	0.17	5.5	0.139	29.6	<0.001	<0.001	21.5	0.009	4.0	6.0	0.208	31.6	<0.001	<0.003
8-Jun-12	Hydrant Flush,	60003391	380	328127	<0.02	<0.02																							
11-Jun-12	Hydrant Flush Comp.	60000763	419	328339	<0.02	<0.02	127	10.8	7.58	1.5	114	2	10.3	21.3	<0.01	0.61	5.7	0.382	31.1	<0.001	<0.001	24.4	0.027	8.9	6.0	1.020	32.7	0.004	0.012
11-Jun-12	Hydrant Flush,	70011266	419	328340	<0.02	<0.02																							
12-Jun-12	Hydrant Flush Comp.	60001970	424	328701	<0.02	<0.02	31.1	10.9	7.85	0.5	25	5	11.7	19.5	<0.01	0.09	5.8	0.294	29.6	<0.001	<0.001	19.6	0.011	1.4	5.9	0.398	32.9	0.001	<0.003
12-Jun-12	Hydrant Flush,	60000509	430	328702	<0.02	<0.02																							
13-Jun-12	Hydrant Flush Comp.	60000510	440	328753	<0.02	<0.02	8.92	10.3	7.70	2.0	5	9	10.5	17.5	<0.01	0.02	4.5	0.043	26.8	<0.001	<0.001	19.7	0.002	0.8	4.9	0.050	30.2	<0.001	<0.003
13-Jun-12	Hydrant Flush,	60000515	439	328754	<0.02	<0.02																							
14-Jun-12	Hydrant Flush Comp.	60006445	449	328849	<0.02	<0.02	13.9	13.8	7.83	2.5	15	5	10.0	18.8	<0.01	0.62	5.0	0.445	27.4	<0.001	<0.001	18.6	0.019	3.9	4.9	0.653	27.7	0.002	0.009
14-Jun-12	Hydrant Flush,	60006446	450	328850	<0.02	<0.02																							
15-Jun-12	Hydrant Flush Comp.	60004432	462	328869	<0.02	<0.02	204	12.1	7.89	1.0	302	14	10.8	20.3	0.07	0.58	5.4	0.140	29.0	<0.001	<0.001	20.7	0.013	3.7	5.5	0.407	29.2	0.003	0.017
15-Jun-12	Hydrant Flush,	60007470	459	328870	<0.02	<0.02																							
18-Jun-12	Hydrant Flush Comp.	70002036	493	329060	<0.02	<0.02	3.98	16.1	7.84	1.0	4	<2	9.4	18.9	<0.01	0.04	5.3	0.033	27.3	<0.001	<0.001	22.0	0.005	0.5	5.4	0.110	30.5	<0.001	<0.003
18-Jun-12	Hydrant Flush,	60005401	495	329061	<0.02	<0.02																							
19-Jun-12	Hydrant Flush Comp.	60004548	506	329111	<0.02	<0.02	9.56	11.1	7.70	1.0	10	3	10.3	19.5	<0.01	0.12	5.5	0.168	30.5	<0.001	<0.001	21.5	0.006	1.4	5.9	0.255	31.7	0.001	<0.003
19-Jun-12	Hydrant Flush,	60004549	505	329112	<0.02	<0.02																							
20-Jun-12	Hydrant Flush Comp.	60004601	517	329490	<0.02	<0.02	15.1	11.5	7.79	1.0	16	10	10.2	22.9	<0.01	0.99	5.6	0.517	34.2	<0.001	<0.001	23.6	0.014	5.2	5.7	0.749	35.2	0.002	0.004
20-Jun-12	Hydrant Flush,	60003492	518	329491	<0.02	<0.02																							
21-Jun-12	Hydrant Flush Comp.	60007194	530	329535	<0.02	<0.02	55.2	14.1	7.99	1.5	53	6	10.2	18.9	<0.01	0.06	5.0	0.719	27.0	<0.001	<0.001	21.1	0.030	12.4	5.6	1.630	29.4	0.003	0.013
21-Jun-12	Hydrant Flush,	60007194	531	329536	<0.02	<0.02																							
22-Jun-12	Hydrant Flush Comp.	60004806	538	329598	<0.02	<0.02	16.7	16.4	7.70	1.0	12	4	9.6	21.3	<0.01	1.15	5.8	0.158	32.7	<0.001	<0.001	22.0	0.005	5.2	5.9	0.217	33.1	<0.001	<0.003
22-Jun-12	Hydrant Flush,	60004806	537	329599	<0.02	<0.02																							
25-Jun-12	Hydrant Flush Comp.	70003496	564	329776	<0.02	<0.02	24.1	15.3	7.81	1.5	31	<2	9.7	22.0	<0.01	1.00	5.8	0.191	30.8	<0.001	<0.001	23.1	0.021	4.6	6.3	0.670	30.8	0.003	0.010
25-Jun-12	Hydrant Flush,	60006329	566	329777	<0.02	<0.02																							
27-Jun-12	Hydrant Flush Comp.	70004974	575	330203	<0.02	<0.02	29.6	17.7	8.01	1.0	51	10	9.3	22.9	<0.01	0.42	5.9	0.905	33.3	<0.001	<0.001	24.3	0.033	4.3	6.6	1.460	35.1	0.003	0.015
27-Jun-12	Hydrant Flush,	70004974	576	330204	<0.02	<0.02																							
28-Jun-12	Hydrant Flush Comp.	60001232	591	330254	<0.02	<0.02	22.2	17.5	7.86	1.0	33	17	9.3	20.3	<0.01	1.31	4.8	0.920	30.0	<0.001	0.002	21.6	0.023	5.2	5.5	1.100	30.1	0.003	0.010
28-Jun-12	Hydrant Flush,	60000705	589	330255	<0.02	<0.02																							
29-Jun-12	Hydrant Flush Comp.	60001143	601	330294	<0.02	<0.02	8.77	18.8	7.84	1.0	12	3	9.1	18.6	<0.01	0.30	4.7	0.475	27.0	<0.001	<0.001	19.5	0.013	2.6	5.0	0.606	27.4	0.001	0.004
29-Jun-12	Hydrant Flush,	60001143	602	330295	<0.02	<0.02																							
4-Jul-12	Hydrant Flush Comp.	70038578	661	330901	<0.02	<0.02	4.9	15.5	7.71	1.0	5	4	9.4	21.2	0.02	<0.01	5.0	0.055	28.2	<0.001	0.002	21.5	0.032	0.3	5.4	0.067	29.4	0.002	0.004
4-Jul-12	Hydrant Flush,	70025567	663	330902	<0.02	<0.02																							
5-Jul-12	Hydrant Flush Comp.	70025556	672	330948	<0.02	<0.02	1.4	19.0	7.80	1.0	<4	3	9.1	18.8	<0.01	0.06	4.7	0.297	26.5	<0.001	<0.001	18.7	0.009	0.4	4.7	0.356	26.1	<0.001	0.003
5-Jul-12	Hydrant Flush,	70025556	670	330949	<0.02	<0.02																							
6-Jul-12	Hydrant Flush Comp.	70025506	683	330993	<0.02	<0.02	2.0	17.1	7.75	0.5	4	6	9.1	18.3	<0.01	0.10	4.9	0.075	27.0	<0.001	<0.001	19.0	0.005	0.2	5.0	0.077	27.0	<0.001	<0.003
6-Jul-12	Hydrant Flush,	70025578	685	330994	<0.02	<0.02																							
9-Jul-12	Hydrant Flush Comp.	60000441	715	331175	<0.02	<0.02	4.4	21.0	7.83	1.0	6	<3	8.7	19.3	<0.01	0.13	5.4	0.269	29.0	<0.001	<0.001	19.5	0.008	1.3	5.4	0.337	29.5	<0.001	<0.003
9-Jul-12	Hydrant Flush,	70045004	721	331176	<0.02	<0.02																							
10-Jul-12	Hydrant Flush Comp.	60005397	726	331217	<0.02	<0.02	19.8	21.8	7.76	1.0	35	5	8.5	20.4	<0.01	0.10	5.3	0.297	29.3	<0.001	<0.001	21.3	0.010	1.8	6.6	0.451	29.3	0.001	0.007
10-Jul-12	Hydrant Flush,	60005397	725	331218	<0.02	<0.02																							
11-Jul-12	Hydrant Flush Comp.	60000077	735	331642	<0.02	<0.02	5.5	21.1	7.80	1.0	6	<3	8.7	20.7	<0.01	0.11	5.3	0.043	29.6	<0.001	<0.001	20.7	0.010	0.9	5.5	0.237	30.8	<0.001	<0.003

Date Sampled	Sample Location	Hydrant Number	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)	TSS (mg/L)	BOD_5 (mg/L)	DO (mg/L)	Soluble Calcium (mg/L)	Soluble Copper (mg/L)	Soluble Iron (mg/L)	Soluble Magnesium (mg/L)	Soluble Manganese (mg/L)	Soluble Sodium (mg/L)	Soluble Lead (mg/L)	Soluble Zinc (mg/L)	Total Calcium (mg/L)	Total Copper (mg/L)	Total Iron (mg/L)	Total Magnesium (mg/L)	Total Manganese (mg/L)	Total Sodium (mg/L)	Total Lead (mg/L)	Total Zinc (mg/L)
11-Jul-12	Hydrant Flush,	60000077	736	331643	<0.02	<0.02																							
13-Jul-12	Hydrant Flush Comp.	70011365	743	331691	<0.02	<0.02	5.6	21.9	7.71	0.5	13	4	8.3	20.2	0.01	0.65	5.4	1.110	30.4	<0.001	0.005	22.0	0.035	1.8	5.6	1.460	30.3	<0.001	0.014
13-Jul-12	Hydrant Flush,	70011365	744	331692	<0.02	<0.02																							
16-Jul-12	Hydrant Flush Comp.	60000507	780	331906	0.67	0.82	16.7	18.2	7.87	1.5	18	NR	9.1	21.3	<0.01	0.08	5.3	0.022	28.4	<0.001	<0.001	21.5	0.011	2.1	5.6	0.270	28.5	0.002	0.006
16-Jul-12	Hydrant Flush,	60004633	782	331907	0.56	0.72																							
17-Jul-12	Hydrant Flush Comp.	60000269	797	331972	<0.02	<0.02	14.4	17.2	7.80	2.5	22	3	9.2	19.6	<0.01	0.31	4.8	0.889	27.6	<0.001	<0.001	20.5	0.022	1.7	4.9	1.220	27.9	<0.001	0.010
17-Jul-12	Hydrant Flush,	60001656	798	331973	<0.02	<0.02																							
18-Jul-12	Hydrant Flush Comp.	60000633	804	332354	0.62	0.73	87.5	20.9	7.84	2.0	38	<3	8.5	20.6	<0.01	4.14	5.4	0.160	28.2	<0.001	<0.001	21.3	0.014	9.4	5.8	0.467	28.1	<0.001	<0.003
18-Jul-12	Hydrant Flush,	60000387	803	332355	0.89	0.98																							
19-Jul-12	Hydrant Flush Comp.	70000799	820	332415	<0.02	<0.02	37.2	21.7	7.96	1.0	67	<3	8.5	21.2	<0.01	0.11	6.1	0.193	28.3	<0.001	<0.001	32.7	0.021	2.5	11.9	0.922	30.0	<0.001	0.007
19-Jul-12	Hydrant Flush,	70000799	818	332416	<0.02	<0.02																							
20-Jul-12	Hydrant Flush Comp.	60000410	831	332452	<0.02	<0.02	16.8	22.0	7.87	0.5	29	<3	8.6	21.5	<0.01	0.22	5.9	0.256	29.3	<0.001	0.005	22.5	0.015	2.1	6.2	0.709	29.2	<0.001	0.004
20-Jul-12	Hydrant Flush,	60001695	829	332453	<0.02	<0.02																							
23-Jul-12	Hydrant Flush Comp.	60000203	860	332645	<0.02	<0.02	20.6	20.4	7.84	1.0	51	<3	8.6	20.7	<0.01	0.01	5.4	0.086	27.9	<0.001	<0.001	22.0	0.025	7.8	5.7	1.150	29.2	<0.001	0.013
23-Jul-12	Hydrant Flush,	60000283	863	332646	0.57	0.74																							
24-Jul-12	Hydrant Flush Comp.	60000190	876	332727	<0.02	<0.02	30.1	18.5	7.76	1.0	32	9	8.8	20.9	<0.01	1.64	5.4	0.335	33.8	<0.001	<0.001	21.3	0.007	1.8	5.5	0.358	34.2	<0.001	<0.003
24-Jul-12	Hydrant Flush,	60000170	878	332728	<0.02	<0.02																							
25-Jul-12	Hydrant Flush Comp.	60001733	888	333130	<0.02	<0.02	9.2	19.5	7.82	0.5	11	<3	8.8	20.9	<0.01	0.15	5.4	0.109	30.0	<0.001	<0.001	21.5	0.009	1.5	5.5	0.344	30.3	<0.001	<0.003
25-Jul-12	Hydrant Flush,	60001797	886	333131	<0.02	<0.02																							
26-Jul-12	Hydrant Flush Comp.	60003270	901	333169	<0.02	<0.02	3.9	20.1	7.89	1.0	5	<3	8.8	20.3	<0.01	0.15	5.1	0.046	28.6	<0.001	<0.001	20.9	0.005	0.7	5.2	0.117	29.4	<0.001	<0.003
26-Jul-12	Hydrant Flush,	60000163	904	333170	<0.02	<0.02																							
27-Jul-12	Hydrant Flush Comp.	60001758	912	333209	<0.02	<0.02	36.1	19.7	7.90	1.5	37	14	8.6	20.9	<0.01	0.20	5.4	0.699	32.1	<0.001	<0.001	22.9	0.024	5.8	6.0	0.934	33.1	<0.001	0.013
27-Jul-12	Hydrant Flush,	60001758	914	333210	<0.02	<0.02																							
30-Jul-12	Hydrant Flush Comp.	60004027	942	333373	<0.02	<0.02	10.4	18.1	7.79	1.0	12	3	9.3	21.1	<0.01	0.28	5.1	0.264	29.8	<0.001	<0.001	22.4	0.011	2.0	5.6	0.356	30.7	<0.001	0.004
30-Jul-12	Hydrant Flush,	70000093	940	333374	0.21	0.37																							
31-Jul-12	Hydrant Flush Comp.	60006219	956	333445	<0.02	<0.02	14.7	21.9	7.82	1.0	20	7	8.2	20.8	<0.01	0.01	5.3	0.343	37.3	<0.001	0.004	21.8	0.016	2.5	5.7	0.416	37.5	<0.001	0.047
31-Jul-12	Hydrant Flush,	60004806	958	333446	<0.02	<0.02																							
1-Aug-12	Hydrant Flush Comp.	60004018	968	333799	<0.02	<0.02	8.0	20.9	7.77	1.0	10	4	8.7	20.8	<0.01	0.04	5.4	0.235	30.6	<0.001	0.004	20.8	0.009	1.8	5.6	0.349	30.3	<0.001	0.004
1-Aug-12	Hydrant Flush,	60004019	967	333800	<0.02	<0.02																							
3-Aug-12	Hydrant Flush Comp.	60004765	985	333887	0.10	0.26	30.8	19.1	7.90	1.5	53	<3	8.9	21.0	<0.01	0.03	5.7	0.031	29.7	<0.001	<0.001	24.7	0.018	3.9	7.1	0.324	30.0	<0.001	0.010
3-Aug-12	Hydrant Flush,	60006235	987	333888	0.64	0.77																							

NR - No result NA - Not analyzed NS - No sample

NOTE On May 22, 23, and July 16 there were no results for BOD5 due to QC failure.
On June 4 there were no results for temperature and dissolved oxygen due to an instrument error.
On July 16 there was no BOD resu t due to QC failure.
On July 16, 18, 23, 30 and August 3 the chlorine levels were above 0.02 mg/L because the pump used for dechlorinating was intermittently malfunctionning.

Winnipeg

2013 Water Main Cleaning Program

Laboratory Analysis Report Environmental Monitoring

Date Sampled	Sample Location	Hydrant Number	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)	TSS (mg/L)	BOD_5 (mg/L)	DO (mg/L)	Soluble Calcium (mg/L)	Soluble Copper (mg/L)	Soluble Iron (mg/L)	Soluble Magnesium (mg/L)	Soluble Manganese (mg/L)	Soluble Sodium (mg/L)	Soluble Lead (mg/L)	Soluble Zinc (mg/L)	Total Calcium (mg/L)	Total Copper (mg/L)	Total Iron (mg/L)	Total Magnesium (mg/L)	Total Manganese (mg/L)	Total Sodium (mg/L)	Total Lead (mg/L)	Total Zinc (mg/L)
6-May-13	Hydrant Flush Comp.	60002277	24	358920	<0.02	<0 02	237	9.7	7 59	2.0	566	>20	12.00	27.1	<0 01	0.01	5.9	0.874	30.4	<0.001	<0.001	82 8	0 032	2 90	19.1	1 060	30 9	0.004	0.035
6-May-13	Hydrant Flush,	60003157	26	358921	<0.02	<0 02																							
7-May-13	Hydrant Flush Comp.	60002287	35	358981	<0.02	<0 02	35 5	7.7	7 54	3.0	38	19	12.10	23.2	<0 01	0.11	5.8	0.487	34 2	<0.001	<0.001	24.7	0.017	1 39	6 2	0 588	35 3	0.003	0.051
7-May-13	Hydrant Flush,	60002287	36	358982	<0.02	<0 02																							
8-May-13	Hydrant Flush Comp.	60002759	47	359368	<0.02	<0 02	63 0	5.1	7 66	2.5	78	17	12.30	23.2	<0 01	0.17	5.8	0.298	32 3	<0.001	<0.001	24 9	0 013	3 54	6.1	0.414	33.7	<0 001	<0 003
8-May-13	Hydrant Flush,	60002921	45	359369	<0.02	<0 02																							
9-May-13	Hydrant Flush Comp.	60003027	56	359437	<0.02	<0 02	33 3	5.1	7 92	3.0	58	4	12.20	23.0	<0 01	0.05	5.3	1.550	32.4	<0.001	<0.001	25 9	0.063	3.73	5 6	2.470	32.4	0.002	0.016
9-May-13	Hydrant Flush,	70001225	55	359438	<0.02	<0 02																							
10-May-13	Hydrant Flush Comp.	NS	NS	359503	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS
10-May-13	Hydrant Flush,	60006757	64	359504	<0.02	<0 02																							
13-May-13	Hydrant Flush Comp.	60002305	91	359704	<0.02	<0 02	8 33	5 2	7 81	2.0	10	<3	12.60	26.5	<0 01	0 01	6.0	0.204	31 8	<0.001	<0.001	27 2	0 009	2.46	6 2	0 292	33 0	<0 001	<0 003
13-May-13	Hydrant Flush,	60002305	90	359705	<0.02	<0 02																							
14-May-13	Hydrant Flush Comp.	60003336	102	359749	<0.02	<0 02	22 8	7.7	7 90	1.5	26	6	11.30	23.4	<0 01	0.21	5.6	0.442	28 6	<0.001	<0.001	23 8	0.010	1 64	6.1	0 571	29.1	0.004	<0 003
14-May-13	Hydrant Flush,	60003336	104	359750	<0.02	<0 02																							
15-May-13	Hydrant Flush Comp.	70001100	112	360142	<0.02	<0 02	14.7	6 5	7 91	1.0	15	NR	11.60	22.8	<0 01	<0.01	5.4	0.312	32 0	<0.001	<0.001	25.1	0.011	2.46	5 9	0.481	31.7	0.002	0.006
15-May-13	Hydrant Flush,	60002454	116	360143	<0.02	<0 02																							
16-May-13	Hydrant Flush Comp.	70002806	124	360187	<0.02	<0 02	19.7	7.7	7 66	1.0	18	>17	11.30	24.2	<0 01	0.07	6.4	0.178	30.1	<0.001	<0.001	25 5	0.006	0 82	6 5	0 218	33 2	<0 001	<0 003
16-May-13	Hydrant Flush,	60002170	123	360188	<0.02	<0 02																							
17-May-13	Hydrant Flush Comp.	60006738	135	360230	<0.02	0 02	16 8	6 9	7 96	1.0	NR	3	11.00	23.5	<0 01	0.27	5.7	0.863	35 3	<0.001	<0.001	23 6	0.048	2 30	5 8	1 500	35.4	0.003	0.011
17-May-13	Hydrant Flush,	60002340	136	360231	<0.02	0 02																							
21-May-13	Hydrant Flush Comp.	NS	NS	360759	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS
21-May-13	Hydrant Flush,	60006823	180	360760	<0.02	<0 02																							
22-May-13	Hydrant Flush Comp.	60002580	186	360804	<0.02	<0 02	20.1	9 3	7 89	1.0	25	3	11.60	22.8	<0 01	0.18	5.1	0.611	30.7	<0.001	<0.001	23 3	0.023	1 61	5 6	0 877	32 0	0.001	0.005
22-May-13	Hydrant Flush,	60002771	188	360805	<0.02	<0 02																							
23-May-13	Hydrant Flush Comp.	60003840	198	360915	<0.02	<0 02	12 9	6 9	7 90	1.0	17	9	11.50	23.8	<0 01	0.08	5.4	0.471	32 6	<0.001	<0.001	25 3	0.029	3 50	5 8	0 584	34 0	0.003	<0 003
23-May-13	Hydrant Flush,	70000261	196	360916	<0.02	<0 02																							
24-May-13	Hydrant Flush Comp.	60002778	209	361013	<0.02	<0 02	7 93	7 8	7 91	1.5	10	5	11.80	20.5	<0 01	0.07	5.5	0.162	32.7	<0.001	<0.001	23 2	0.009	2.79	5 8	0 210	35.1	0.002	<0 003
24-May-13	Hydrant Flush,	60002804	207	361014	<0.02	<0 02																							
27-May-13	Hydrant Flush Comp.	60003614	245	361250	<0.02	<0 02	13 8	7 8	7 92	1.0	18	<3	11.50	23.4	<0 01	0.05	5.6	0.295	26 6	<0.001	<0.001	24 0	0.023	2.71	5 8	0 657	29 6	0.002	0.005
27-May-13	Hydrant Flush,	60002433	241	361251	<0.02	<0 02																							
28-May-13	Hydrant Flush Comp.	60003243	251	361316	<0.02	<0 02	12.1	11.2	7 96	1.0	20	<1	10.40	20.4	<0 01	0.07	6.5	0.081	30 2	<0.001	<0.001	23.1	0.014	0 68	6 6	0 296	31 9	<0 001	<0 003
28-May-13	Hydrant Flush,	60002511	254	361317	<0.02	<0 02																							
29-May-13	Hydrant Flush Comp.	60002434	263	361754	<0.02	<0 02	18 9	9.7	7 97	1.0	18	NR	10.80	19.8	<0 01	0.22	5.3	0.423	28.7	<0.001	<0.001	20.7	0.036	2 05	5 6	1 030	35 2	0.001	0.008
29-May-13	Hydrant Flush,	60003670	265	361755	<0.02	<0 02																							
30-May-13	Hydrant Flush Comp.	70001990	274	361831	<0.02	<0 02	3 81	7 2	7 92	1.5	4	<2	11.40	24.5	<0 01	0.08	4.6	0.204	28 2	<0.001	<0.001	26 0	0.016	0 67	4.7	0 386	28 9	<0 001	<0 003
30-May-13	Hydrant Flush,	60002664	275	361832	<0.02	<0 02																							

Winnipeg

2013 Water Main Cleaning Program

Laboratory Analysis Report Environmental Monitoring

Date Sampled	Sample Location	Hydrant Number	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)	TSS (mg/L)	BOD_5 (mg/L)	DO (mg/L)	Soluble Calcium (mg/L)	Soluble Copper (mg/L)	Soluble Iron (mg/L)	Soluble Magnesium (mg/L)	Soluble Manganese (mg/L)	Soluble Sodium (mg/L)	Soluble Lead (mg/L)	Soluble Zinc (mg/L)	Total Calcium (mg/L)	Total Copper (mg/L)	Total Iron (mg/L)	Total Magnesium (mg/L)	Total Manganese (mg/L)	Total Sodium (mg/L)	Total Lead (mg/L)	Total Zinc (mg/L)
31-May-13	Hydrant Flush Comp.	60003860	285	361879	<0.02	<0 02	22 0	9.4	7 93	1.0	23	NR	10.80	20.8	<0 01	0.03	4.5	0.007	24.1	<0.001	<0.001	21 6	0.019	0.78	4 6	0.126	25.4	0.001	<0 003
31-May-13	Hydrant Flush,	60003860	286	361880	<0.02	<0 02																							
3-Jun-13	Hydrant Flush Comp.	60004318	317	362115	<0.02	<0 02	21 5	8.7	7 93	1.0	23	NR	10.60	22.8	<0 01	0.04	5.0	0.233	27.1	<0.001	<0.001	23 9	0.013	1 90	5 0	0.414	28.4	<0 001	<0 003
3-Jun-13	Hydrant Flush,	60004289	320	362116	<0.02	<0 02																							
4-Jun-13	Hydrant Flush Comp.	60003294	330	362145	<0.02	<0 02	3.11	9.4	7 85	1.0	8	5	10.80	23.0	<0 01	0.01	5.0	0.078	29 3	<0.001	<0.001	25 3	0.007	0 21	5 2	0 087	29.4	<0 001	<0 003
4-Jun-13	Hydrant Flush,	60002956	332	362146	<0.02	<0 02																							
5-Jun-13	Hydrant Flush Comp.	20003064	337	362541	<0.02	<0 02	22 5	11.9	7 89	1.0	27	<3	10.30	23.4	<0 01	0.08	4.8	0.189	27.4	<0.001	<0.001	23.4	0.013	1.11	5.1	0 248	29 2	<0 001	<0 003
5-Jun-13	Hydrant Flush,	20003064	338	362542	<0.02	<0 02																							
6-Jun-13	Hydrant Flush Comp.	NS	NS	362611	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS
6-Jun-13	Hydrant Flush,	70004377	343	362612	<0.02	0 02																							
7-Jun-13	Hydrant Flush Comp.	70001004	348	362674	<0.02	<0 02	39.4	12.3	7 86	0.5	28	<3	10.10	19.0	<0 01	0.15	5.3	0.167	25 5	<0.001	<0.001	19 8	0.015	9.13	5 2	0 282	25 5	<0 001	<0 003
7-Jun-13	Hydrant Flush,	70001004	349	362675	<0.02	<0 02																							
10-Jun-13	Hydrant Flush Comp.	20001782	373	362867	<0.02	<0 02	10 3	11.4	7 85	1.0	10	<3	10.20	22.4	<0 01	0.04	4.8	0.098	28 8	<0.001	<0.001	23 2	0.010	1 02	5.4	0.161	29.1	<0 001	<0 003
10-Jun-13	Hydrant Flush,	20001782	372	362868	<0.02	<0 02																							
11-Jun-13	Hydrant Flush Comp.	20000849	379	362889	<0.02	<0 02	27 0	10.6	7.73	1.0	20	3	10.20	20.6	<0 01	0.11	4.7	0.129	26 9	<0.001	<0.001	22 2	0.008	1 25	4.7	0.150	27 6	0.001	<0 003
11-Jun-13	Hydrant Flush,	20000816	378	362890	<0.02	<0 02																							
12-Jun-13	Hydrant Flush Comp.	20002788	386	363327	<0.02	<0 02	25.1	12.7	7.74	1.0	24	7	9.77	20.3	<0 01	0.20	4.8	0.241	26 8	<0.001	<0.001	22 6	0.007	1 35	4 8	0 248	29 2	<0 001	<0 003
12-Jun-13	Hydrant Flush,	20002788	388	363328	<0.02	<0 02																							
13-Jun-13	Hydrant Flush Comp.	20001008	391	363404	<0.02	<0 02	61 0	12.1	7 90	1.0	45	<3	10.10	21.0	<0 01	0.25	4.6	0.436	24 9	<0.001	<0.001	22 3	0.029	6.72	4.7	0 908	25 3	0.002	<0 003
13-Jun-13	Hydrant Flush,	20000970	392	363405	<0.02	<0 02																							
14-Jun-13	Hydrant Flush Comp.	20000837	400	363444	<0.02	<0 02	39.7	11.3	7 65	1.0	32	8	9.41	21.3	<0 01	0.24	4.4	0.299	24.4	<0.001	<0.001	21 9	0.013	5 50	4 9	0 386	24.1	<0 001	<0 003
14-Jun-13	Hydrant Flush,	20000835	398	363445	<0.02	<0 02																							
17-Jun-13	Hydrant Flush Comp.	70045394	425	363646	<0.02	<0 02	39 6	13.4	7.78	1.0	35	<3	10.00	22.1	<0 01	0.09	5.0	0.241	24 5	<0.001	<0.001	22 3	0.012	2 22	5.1	0 313	25 5	<0 001	<0 003
17-Jun-13	Hydrant Flush,	70045394	424	363647	<0.02	<0 02																							
18-Jun-13	Hydrant Flush Comp.	20001003	433	363688	<0.02	<0 02	39 0	11.4	7 60	1.0	29	6	9.43	22.4	<0 01	0.21	4.7	0.231	26 2	<0.001	<0.001	25.1	0.016	10.30	4.7	0 341	27.4	<0 001	<0 003
18-Jun-13	Hydrant Flush,	20001003	434	363689	<0.02	<0 02																							
19-Jun-13	Hydrant Flush Comp.	20000986	443	364144	<0.02	<0 02	100	11.8	7.73	1.0	68	4	9 52	23.7	<0 01	0.08	6.4	0.569	33 9	<0.001	<0.001	26 6	0.044	29.80	6.7	1 020	36.1	0.003	<0 003
19-Jun-13	Hydrant Flush,	20000999	439	364145	<0.02	<0 02																							
20-Jun-13	Hydrant Flush Comp.	20001045	450	364196	<0.02	<0 02	44.4	13.2	7.76	0.5	39	5	9.43	22.0	<0 01	0.53	5.7	0.848	30.7	<0.001	<0.001	22 9	0.056	14.50	5 8	1 380	31 5	0.002	0.006
20-Jun-13	Hydrant Flush,	20001045	449	364197	<0.02	<0 02																							
21-Jun-13	Hydrant Flush Comp.	70014574	459	364237	<0.02	<0 02	39 9	11.0	7 53	1.0	38	11	9 60	23.1	<0 01	0.34	5.8	0.543	31 2	<0.001	0 003	23 0	0.027	17.70	5 9	0 686	31.7	0.001	0.003
21-Jun-13	Hydrant Flush,	70014574	460	364238	<0.02	<0 02																							
24-Jun-13	Hydrant Flush Comp.	20000897	495	364442	<0.02	<0 02	9 90	14.9	7 87	1.5	12	<1	9 61	21.8	<0 01	0.12	5.9	0.186	30 3	<0.001	<0.001	22 6	0.016	3 03	5 9	0.450	31 9	<0 001	<0 003
24-Jun-13	Hydrant Flush,	20001308	483	364443	<0.02	<0 02																							
25-Jun-13	Hydrant Flush Comp.	70002811	502	364817	<0.02	<0 02	20 2	16.6	7 85	1.0	22	<3	9.41	22.8	<0 01	0.28	6.2	0.737	33 8	<0.001	<0.001	24 9	0.057	7 57	6.4	1.750	34 8	0.003	0.013
25-Jun-13	Hydrant Flush,	20001492	500	364818	<0.02	<0 02																							

2013 Water Main Cleaning Program

Laboratory Analysis Report Environmental Monitoring

Date Sampled	Sample Location	Hydrant Number	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)	TSS (mg/L)	BOD_5 (mg/L)	DO (mg/L)	Soluble Calcium (mg/L)	Soluble Copper (mg/L)	Soluble Iron (mg/L)	Soluble Magnesium (mg/L)	Soluble Manganese (mg/L)	Soluble Sodium (mg/L)	Soluble Lead (mg/L)	Soluble Zinc (mg/L)	Total Calcium (mg/L)	Total Copper (mg/L)	Total Iron (mg/L)	Total Magnesium (mg/L)	Total Manganese (mg/L)	Total Sodium (mg/L)	Total Lead (mg/L)	Total Zinc (mg/L)

Winnipeg

2013 Water Main Cleaning Program

Laboratory Analysis Report Environmental Monitoring

Date Sampled	Sample Location	Hydrant Number	Sequence Number	Sample Number	Free Chlorine	Total Chlorine	Turbidity	Temperature	pH	True Colour	TSS	BOD_5	DO	Soluble Calcium	Soluble Copper	Soluble Iron	Soluble Magnesium	Soluble Manganese	Soluble Sodium	Soluble Lead	Soluble Zinc	Total Calcium	Total Copper	Total Iron	Total Magnesium	Total Manganese	Total Sodium	Total Lead	Total Zinc
					(mg/L)	(mg/L)	(ntu)	(°C)	(units)	(tcu)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)
26-Jun-13	Hydrant Flush Comp.	20001615	509	364897	<0.02	<0 02	13 8	14.0	7 91	1.0	12	NR	9 88	21.4	<0 01	0.05	5.6	0.030	30 9	<0.001	<0.001	21 5	0.012	2 66	5.7	0 216	31.4	0.003	<0 003
26-Jun-13	Hydrant Flush,	20003806	510	364898	<0.02	<0 02																							
27-Jun-13	Hydrant Flush Comp.	20000950	519	364970	<0.02	<0 02	25 5	15.7	7.79	0.5	28	<1	9 35	20.9	<0 01	0.16	5.6	0.220	29 9	<0.001	<0.001	20 9	0.015	2 63	5 6	0.449	29.4	0.003	<0 003
27-Jun-13	Hydrant Flush,	20001277	518	364971	<0.02	<0 02																							
28-Jun-13	Hydrant Flush Comp.	20001105	528	365005	<0.02	<0 02	16	17.2	7.78	1.0	17	<3	9 23	21.4	<0 01	0.17	5.2	0.495	26 3	<0.001	<0.001	22 8	0.035	4.42	5.4	1.160	26.7	0.010	<0 003
28-Jun-13	Hydrant Flush,	20001105	529	365006	<0.02	<0 02																							
3-Jul-13	Hydrant Flush Comp.	20001840	568	365183	<0.02	<0 02	34.1	16.0	7 84	0.5	36	NR	9 65	20.9	<0 01	0.21	5.0	0.337	25 0	<0.001	<0.001	21 2	0.017	8 39	5.1	0.461	25.4	0.004	0.021
3-Jul-13	Hydrant Flush,	20001840	569	365184	<0.02	<0 02																							
4-Jul-13	Hydrant Flush Comp.	20002045	578	365606	<0.02	<0 02	12.7	19.1	7 89	0.5	13	NR	9 06	20.6	<0 01	0.07	5.0	0.057	25 9	<0.001	<0.001	21.7	0.011	1 95	5 0	0 330	25.7	<0 001	<0 003
4-Jul-13	Hydrant Flush,	20001457	582	365607	<0.02	<0 02																							
5-Jul-13	Hydrant Flush Comp.	20001440	590	365705	<0.02	<0 02	30 6	14.3	7 33	1.0	27	NR	9.76	22.3	<0 01	0.26	4.7	0.076	25 0	<0.001	0 031	22 3	0.014	9 98	4.7	0.194	26.1	<0 001	0.031
5-Jul-13	Hydrant Flush,	20001440	589	365706	<0.02	<0 02																							
8-Jul-13	Hydrant Flush Comp.	20001523	611	365868	0 55	0.72	15 6	15.9	8 00	1.0	16	NR	9 50	21.7	<0 01	0.10	4.6	0.034	25 6	<0.001	<0.001	22 0	0.028	2 96	5 0	0 512	25 5	<0 001	<0 003
8-Jul-13	Hydrant Flush,	20001523	610	365869	0 08	0.19																							
9-Jul-13	Hydrant Flush Comp.	20001630	620	365918	<0.02	<0 02	15 6	12.9	7 89	1.0	13	NR	10.00	20.8	<0 01	0.29	4.2	0.055	24 8	<0.001	<0.001	21 8	0.015	3 39	4.7	0 322	26.7	<0 001	<0 003
9-Jul-13	Hydrant Flush,	20001630	619	365919	<0.02	<0 02																							
10-Jul-13	Hydrant Flush Comp.	20001662	629	366334	<0.02	<0 02	26 2	16.2	7 92	0.5	28	NR	9.17	21.0	<0 01	0.57	4.5	0.171	23 0	<0.001	<0.001	21 2	0.025	4 54	4 6	0.799	24 0	<0 001	0.005
10-Jul-13	Hydrant Flush,	2002406	630	366335	<0.02	<0 02																							
11-Jul-13	Hydrant Flush Comp.	20002407	639	366385	<0.02	<0 02	102	11.5	7.76	0.5	130	NR	9 66	22.9	<0 01	0.55	4.5	1.750	22 5	<0.001	<0.001	23.4	0.091	34.20	4 5	3 820	23 8	<0 001	0.033
11-Jul-13	Hydrant Flush,	20001716	640	366386	0.11	0 23																							
12-Jul-13	Hydrant Flush Comp.	20002232	649	366428	<0.02	<0 02	33 3	17.3	7.79	0.5	46	14	9.16	22.0	<0 01	0.57	4.3	1.100	24 0	<0.001	<0.001	22 3	0.056	5 06	4.4	2 330	24.4	<0 001	0.016
12-Jul-13	Hydrant Flush,	20002232	650	366429	<0.02	<0 02																							
15-Jul-13	Hydrant Flush Comp.	20000735	679	366612	<0.02	<0 02	30 3	15.1	7 81	1.0	29	NR	9 60	19.8	<0 01	0.15	5.0	0.168	27 5	<0.001	0 002	20 8	0.013	7 04	5.1	0 273	28.1	0.035	0.004
15-Jul-13	Hydrant Flush,	20000726	681	366613	<0.02	<0 02																							
16-Jul-13	Hydrant Flush Comp.	20000244	691	366661	<0.02	<0 02	38 6	15.1	7 83	1.0	32	NR	9.49	20.3	0.02	2.78	4.4	1.090	24.7	0 007	0 006	22.7	0.044	9.48	5.1	1 550	25 3	0.020	0.014
16-Jul-13	Hydrant Flush,	20000244	690	366662	<0.02	<0 02																							
19-Jul-13	Hydrant Flush Comp.	20000361	709	367220	<0.02	<0 02	33 8	20.3	7 90	0.5	25	8	8 80	21.0	<0 01	1.24	5.9	0.344	29 2	<0.001	<0.001	21 2	0.019	5 22	6 0	0.450	29.7	0.003	<0 003
19-Jul-13	Hydrant Flush,	20000361	711	367221	<0.02	<0 02																							
22-Jul-13	Hydrant Flush Comp.	20000711	736	367431	<0.02	<0 02	105	18.0	7 80	1.5	74	4	9.16	22.7	<0 01	0.31	6.1	0.353	30 9	<0.001	<0.001	25.4	0.035	28.40	6.4	0.791	31.1	0.002	0.007
22-Jul-13	Hydrant Flush,	20000354	738	367432	<0.02	<0 02																							
23-Jul-13	Hydrant Flush Comp.	70001216	748	367457	<0.02	<0 02	234	15.1	7 82	1.0	348	NR	9 38	22.5	<0 01	4.98	5.9	0.310	25 3	<0.001	<0.001	31.4	0.026	34.50	8 9	0 608	30.1	0.001	0.010
23-Jul-13	Hydrant Flush,	20000268	747	367458	<0.02	<0 02																							
24-Jul-13	Hydrant Flush Comp.	20000382	756	367863	<0.02	<0 02	54 6	18.2	7 85	1.0	58	NR	9.10	22.9	0.02	2.35	5.7	0.839	29 8	<0.001	0 002	23 9	0.077	18.20	6.7	2.470	31 0	0.011	0.032
24-Jul-13	Hydrant Flush,	20000459	759	367864	<0.02	<0 02																							
25-Jul-13	Hydrant Flush Comp.	20000450	767	367905	<0.02	<0 02	39 8	17.1	7 94	2.5	54	7	0 38	23.0	<0 01	0.55	6.0	0.163	30 5	<0.001	<0.001	29 9	0.031	9 01	7 9	0 836	31 3	0.001	0.011
25-Jul-13	Hydrant Flush,	20000450	770	367906	<0.02	<0 02																							

2013 Water Main Cleaning Program

Laboratory Analysis Report Environmental Monitoring

Date Sampled	Sample Location	Hydrant Number	Sequence Number	Sample Number	Free Chlorine	Total Chlorine	Turbidity	Temperature	pH	True Colour	TSS	BOD_5	DO	Soluble Calcium	Soluble Copper	Soluble Iron	Soluble Magnesium	Soluble Manganese	Soluble Sodium	Soluble Lead	Soluble Zinc	Total Calcium	Total Copper	Total Iron	Total Magnesium	Total Manganese	Total Sodium	Total Lead	Total Zinc
					(mg/L)	(mg/L)	(ntu)	(°C)	(units)	(tcu)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)
26-Jul-13	Hydrant Flush Comp.	20000434	776	367943	<0.02	<0 02	65 6	18.1	7 85	1.0	140	<3	9.16	27.6	0.01	0.95	7.6	0.487	27 5	<0.001	0 002	41 3	0.167	14.10	12.8	3 360	28 5	0.006	0.082
26-Jul-13	Hydrant Flush,	20000744	778	367944	<0.02	<0 02																							
29-Jul-13	Hydrant Flush Comp.	20000579	807	368138	<0.02	<0 02	44.7	17.9	7 97	1.0	45	NR	9.14	21.0	0.03	1.96	5.2	1.530	27 8	<0.001	0 012	22 3	0.116	10.10	5.7	4 310	28.7	<0 001	0.047
29-Jul-13	Hydrant Flush,	20000637	809	368139	<0.02	<0 02																							
30-Jul-13	Hydrant Flush Comp.	20001121	817	368166	0.16	0 33	26 5	19.2	7 89	1.5	35	NR	9 00	19.3	0.05	3.26	5.5	1.150	24 9	<0.001	0 015	23.4	0.110	8 94	5.7	1.780	29 9	<0 001	0.036
30-Jul-13	Hydrant Flush,	70001466	819	368167	0 68	0 81																							
31-Jul-13	Hydrant Flush Comp.	20002036	828	368553	<0.02	<0 02	24 8	15.0	7 85	1.0	21	NR	9.75	22.5	<0 01	0.51	5.0	0.530	27 8	<0.001	<0.001	23 6	0.042	4 51	5.1	1 340	29 8	<0 001	0.014
31-Jul-13	Hydrant Flush,	20001851	827	368554	<0.02	<0 02																							
1-Aug-13	Hydrant Flush Comp.	20002400	837	368591	<0.02	<0 02	6.94	19.4	7 83	0.5	10	NR	9 08	21.5	0.01	0.51	5.2	0.443	28 0	<0.001	<0.001	21 5	0.031	2 00	5 5	1 010	30.1	<0 001	0.015
1-Aug-13	Hydrant Flush,	70001987	839	368592	<0.02	<0 02																							
2-Aug-13	Hydrant Flush Comp.	20001122	850	368639	<0.02	<0 02	11 2	17.9	7 80	0.5	12	NR	9 35	20.5	<0 01	0.27	4.8	0.103	25 8	<0.001	<0.001	21 3	0.009	3.12	5 0	0.176	26.7	0.001	<0 003
2-Aug-13	Hydrant Flush,	20001121	852	368640	<0.02	<0 02																							
6-Aug-13	Hydrant Flush Comp.	20000522	890	368818	<0.02	<0 02	75 9	15.8	7 82	1.0	230	NR	9 52	19.7	<0 01	0.25	5.2	0.442	26 5	<0.001	<0.001	55 2	0.035	7.10	18.5	0 858	29 3	0.006	0.035
6-Aug-13	Hydrant Flush,	20000522	892	368819	<0.02	<0 02																							
7-Aug-13	Hydrant Flush Comp.	20000216	901	369274	<0.02	<0 02	22 5	14.9	7.72	1.0	22	6	9.79	19.0	0.03	3.27	4.7	1.260	27 0	0 001	0 005	21 0	0.037	4 97	4.7	1 300	27 2	0.003	0.008
7-Aug-13	Hydrant Flush,	70026700	900	369275	<0.02	<0 02																							
8-Aug-13	Hydrant Flush Comp.	70020190	911	369325	<0.02	<0 02	23 3	14.6	7 91	1.0	35	<1	9 83	21.5	<0 01	0.81	4.8	0.405	26 5	<0.001	<0.001	24.1	0.018	1 60	5 3	0 539	27.1	0.002	<0 003
8-Aug-13	Hydrant Flush,	20000264	910	369326	<0.02	<0 02																							
9-Aug-13	Hydrant Flush Comp.	70019419	920	369360	<0.02	<0 02	6.11	13.3	7.77	1.0	13	<3	10.10	19.2	<0 01	0.02	4.9	0.114	27 9	<0.001	<0.001	23 5	0.007	0.46	5.7	0.144	28 0	<0 001	<0 003
9-Aug-13	Hydrant Flush,	70019345	922	369361	<0.02	<0 02																							

NOTE: On May 10, 21, and June 6 there was no sample due to valve issues while attempting to sample the hydrant.
On May 17 there was no result for TSS due to technician error.
On May 15, June 26, July 3-11, 15, 16, and August 2 there was no result for BOD due to technician error.
On May 29, 31, June 3, July 23, 24, 29-31, August 1 and 6 there was no result for BOD due to QC failure.
On July 8, 11, and 30, the chlorine was high because the flushing crew were unable to add enough dechlorination chemical during the flush.

2014 Water Main Cleaning Program

Laboratory Analysis Report Environmental Monitoring

Date Sampled	Sample Location	Hydrant Number	Sequence Number	Sample Number	Free Chlorine	Total Chlorine	Turbidity	Temperature	pH	True Colour	TSS	BOD_5	DO	Soluble Calcium	Soluble Copper	Soluble Iron	Soluble Magnesium	Soluble Manganese	Soluble Sodium	Soluble Lead	Soluble Zinc	Total Calcium	Total Copper	Total Iron	Total Magnesium	Total Manganese	Total Sodium	Total Lead	Total Zinc
					(mg/L)	(mg/L)	(ntu)	(°C)	(units)	(tcu)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)
08-Jul-14	Hydrant Flush Comp.	60002113	25	401400	<0.02	<0 02	3.89	18.3	7.72	2.0	<3	5	9.10	17.3	0.0041	0.094	4.68	0.1462	24.0	<0.0004	0.0033	18.9	0.0087	1.02	4.78	0.1777	25.1	<0.0004	0 0052
08-Jul-14	Hydrant Flush,	60002113	24	401401	<0.02	<0 02																							
09-Jul-14	Hydrant Flush Comp.	70014677	23	402033	<0.02	<0 02	8.90	19.3	7.63	1.0	7	6	9.06	18.1	0.0021	0.105	4.79	0.0746	23.7	<0.0004	0.0057	18.3	0.0061	1.37	4.82	0.0816	24.3	0.0006	0 0063
09-Jul-14	Hydrant Flush,	60005058	30	402034	<0.02	<0 02																							
10-Jul-14	Hydrant Flush Comp.	60002870	41	402055	<0.02	<0 02	66.4	18.2	7.73	2.5	89	7	9.26	20.5	0.0054	0.466	5.28	1.423	27.3	0.0005	0.0058	20.8	0.0708	15.8	5.33	1 981	28.3	0.0161	0 0234
10-Jul-14	Hydrant Flush,	60002101	42	402056	<0.02	<0 02																							
11-Jul-14	Hydrant Flush Comp.	6113	43	402120	<0.02	<0 02	173	16.4	7.87	2.5	167	<3	9.65	23.2	0.0080	2.77	5.47	0.2563	26.2	0.0011	0.0067	24.4	0.0708	36 0	6.76	1 559	29.0	0.0104	0 0353
11-Jul-14	Hydrant Flush,	8369	44	402121	<0.02	<0 02																							
11-Jul-14	Hydrant Flush Comp.	70002009	52	402131	<0.02	<0 02	31.8	19.5	7.74	2.0	17	6	8.70	23.4	0.0051	0.691	5.32	0.5993	29.0	0.0005	0.0059	24.0	0.0385	18.0	5.56	1.138	29.1	0.0059	0 0219
11-Jul-14	Hydrant Flush,	60002047	50	402132	0.83	1.04																							
14-Jul-14	Hydrant Flush Comp.	60001700	65	402347	<0.02	<0 02	53.0	16.5	7.49	1.0	57	>8	9.42	23.1	0.0226	1.82	5.24	1 033	27.6	0.0018	0.0083	23.4	0.1191	22.4	5.40	1 393	28.4	0.0130	0 0296
14-Jul-14	Hydrant Flush,	60003306	64	402348	<0.02	0.02																							
14-Jul-14	Hydrant Flush Comp.	7765	128	402358	<0.02	<0 02	125	18.1	7.56	0.5	96	>8	9.04	23.6	0.0067	0.487	5.47	1 296	29.0	<0.0004	0.0106	25.4	0.1388	39.8	5.68	2.075	29.5	0.0112	0.1036
14-Jul-14	Hydrant Flush,	7769	127	402359	<0.02	<0 02																							
15-Jul-14	Hydrant Flush Comp.	60001620	74	402380	<0.02	<0 02	68.0	17.5	7.95	2.5	60	9	9.20	24.6	0.0034	0.230	5.61	1 568	27.8	0.0015	0.0088	25.2	0.0922	20.4	5.65	2.754	28.1	0.1243	0 0463
15-Jul-14	Hydrant Flush,	60000975	73	402381	<0.02	<0 02																							
15-Jul-14	Hydrant Flush Comp.	70015634	135	402393	<0.02	<0 02	525	18.4	7.54	2.0	270	>11	8.97	22.3	0.0021	0.667	5.10	2 360	27.1	0.0026	0.0064	26.1	0.1305	59.0	5.68	4 271	28.6	0.2165	0 0886
15-Jul-14	Hydrant Flush,	10501	137	402394	<0.02	<0 02																							
16-Jul-14	Hydrant Flush Comp.	10100	144	402838	<0.02	<0 02	82.5	16.2	7.55	2.0	46	<3	9.54	22.3	0.0033	0.249	4.96	0.3335	26.1	0.0006	0.0054	22.8	0.0837	13.3	5.12	1.438	26.6	0.0288	0 0702
16-Jul-14	Hydrant Flush,	10111	145	402839	<0.02	<0 02																							

2014 Water Main Cleaning Program

Laboratory Analysis Report Environmental Monitoring

Date Sampled	Sample Location	Hydrant Number	Sequence Number	Sample Number	Free Chlorine	Total Chlorine	Turbidity	Temperature	pH	True Colour	TSS	BOD_5	DO	Soluble Calcium	Soluble Copper	Soluble Iron	Soluble Magnesium	Soluble Manganese	Soluble Sodium	Soluble Lead	Soluble Zinc	Total Calcium	Total Copper	Total Iron	Total Magnesium	Total Manganese	Total Sodium	Total Lead	Total Zinc
					(mg/L)	(mg/L)	(ntu)	(°C)	(units)	(tcu)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)
16-Jul-14	Hydrant Flush Comp.	60006909	81	402850	<0.02	<0 02	67.5	17.4	7.68	2.5	52	6	9.39	22.7	0.0044	0.230	5.14	1 213	26.5	<0.0004	0.0081	23.4	0.0587	21.1	5.19	1 819	26.9	0.0080	0 0250
16-Jul-14	Hydrant Flush,	70002737	80	402851	<0.02	<0 02																							
17-Jul-14	Hydrant Flush Comp.	60005258	88	402894	<0.02	<0 02	7.23	17.0	7.84	0.5	7	3	9.54	22.4	0.0023	0.096	4.99	0.2395	26.1	<0.0004	0.0028	22.5	0.0101	2.15	5.10	0.3388	26.3	0.0006	0 0058
17-Jul-14	Hydrant Flush,	60005205	90	402895	<0.02	<0 02																							
17-Jul-14	Hydrant Flush Comp.	10641	157	402905	<0.02	<0 02	184	17.5	7.65	2.5	84	10	9.32	23.1	0.0024	0.255	5.26	1 035	26.3	0.0009	0.0059	23.8	0.0909	18.0	5.60	1 389	27.1	0.0581	0 0950
17-Jul-14	Hydrant Flush,	70021413	158	402906	<0.02	<0 02																							
18-Jul-14	Hydrant Flush Comp.	60005690	95	402951	<0.02	<0 02	18.2	20.7	7.76	1.0	18	5	9.23	20.0	0.0095	0.382	4.98	1 234	27.0	<0.0004	0.0055	21.0	0.0518	5.74	5.02	1 583	28.0	0.0022	0 0157
18-Jul-14	Hydrant Flush,	60004721	93	402952	<0.02	<0 02																							
18-Jul-14	Hydrant Flush Comp.	7399	164	402963	<0.02	<0 02	48.8	17.5	7.28	2.0	23	<3	9.40	21.1	0.0021	0.390	5.77	0.2237	27.8	<0.0004	0.0026	22.2	0.0182	7.53	5.77	0.2607	30.1	0.0017	0 0130
18-Jul-14	Hydrant Flush,	7354	167	402964	<0.02	<0 02																							
21-Jul-14	Hydrant Flush Comp.	60004993	121	403155	<0.02	<0 02	25.7	20.6	7.86	2.0	26	10	8.63	19.8	0.0109	1.35	4.95	0.8378	25.1	0.0008	0.0060	20.0	0.0326	7.88	5.31	0.9814	25.5	0.0046	0 0149
21-Jul-14	Hydrant Flush,	60004993	120	403156	<0.02	<0 02																							
21-Jul-14	Hydrant Flush Comp.	10479	196	403166	<0.02	<0 02	8.06	19.2	7.81	2.0	6	4	8.89	20.9	0.0088	0.700	5.15	0.3453	26.8	0.0006	0.0043	21.3	0.0175	2.09	5.31	0.3931	27.0	0.0013	0 0061
21-Jul-14	Hydrant Flush,	7390	198	403167	<0.02	<0 02																							
22-Jul-14	Hydrant Flush Comp.	8659	206	403196	0.76	0 87	152	18.6	8.00	2.5	164	<3	9.09	20.7	0.0142	1.50	5.11	0.2935	26.1	0.0012	0.0052	22.7	0.0969	18.9	6.24	1 831	26.7	0.0106	0 0368
22-Jul-14	Hydrant Flush,	70003271	210	403197	0.21	0 32																							
22-Jul-14	Hydrant Flush Comp.	60004455	132	403207	<0.02	<0 02	84.6	19.4	7.89	2.0	63	6	8.83	20.8	0.0533	7.86	4.94	0.8522	25.8	0.0057	0.0119	21.8	0.1422	26.7	5.04	1.137	26.5	0.0170	0 0291
22-Jul-14	Hydrant Flush,	70000602	130	403208	<0.02	<0 02																							
23-Jul-14	Hydrant Flush Comp.	70003368	141	403620	<0.02	<0 02	79.6	17.5	7.62	1.0	52	>18	9.38	21.1	0.0039	0.239	4.70	1 006	26.6	<0.0004	0.0013	21.5	0.0410	21.4	4.99	1.405	27.3	0.0019	0 0147
23-Jul-14	Hydrant Flush,	60006923	142	403621	<0.02	<0 02																							

2014 Water Main Cleaning Program

Laboratory Analysis Report Environmental Monitoring

Date Sampled	Sample Location	Hydrant Number	Sequence Number	Sample Number	Free Chlorine	Total Chlorine	Turbidity	Temperature	pH	True Colour	TSS	BOD_5	DO	Soluble Calcium	Soluble Copper	Soluble Iron	Soluble Magnesium	Soluble Manganese	Soluble Sodium	Soluble Lead	Soluble Zinc	Total Calcium	Total Copper	Total Iron	Total Magnesium	Total Manganese	Total Sodium	Total Lead	Total Zinc
					(mg/L)	(mg/L)	(ntu)	(°C)	(units)	(tcu)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)
23-Jul-14	Hydrant Flush Comp.	7408	217	403631	<0.02	<0 02	52.2	18.3	7.84	1.5	44	<3	9.56	20.1	0.0070	2.71	4.73	0.3150	25.3	<0.0004	0.0030	21.1	0.0247	18.1	4.86	0.5287	26.1	0.0048	0 0079
23-Jul-14	Hydrant Flush,	3033	219	403632	<0.02	<0 02																							
24-Jul-14	Hydrant Flush Comp.	5901	227	403695	<0.02	<0 02	40.6	18.8	7.78	2.0	46	5	9.04	21.2	0.0038	0.103	4.83	0.7443	25.8	<0.0004	0.0009	21.8	0.0400	7.74	5.21	1.039	26.2	0.0030	0 0147
24-Jul-14	Hydrant Flush,	8303	229	403696	<0.02	<0 02																							
24-Jul-14	Hydrant Flush Comp.	70010429	152	403706	<0.02	<0 02	104	17.3	7.89	1.5	53	3	9.14	21.6	0.0400	5.77	4.96	1.603	26.4	0.0383	0.0248	21.9	0.0952	15.8	5.03	2 396	26.8	0.1008	0 0654
24-Jul-14	Hydrant Flush,	60004721	154	403707	<0.02	<0 02																							
25-Jul-14	Hydrant Flush Comp.	70029810	165	403893	<0.02	<0 02	101	17.5	7.71	1.0	92	4	9.15	21.3	0.0026	0.166	4.82	0.7574	26.4	<0.0004	0.0015	22.5	0.0515	27.7	5.12	1.662	26.6	0.0019	0 0209
25-Jul-14	Hydrant Flush,	60005749	162	403894	<0.02	<0 02																							
25-Jul-14	Hydrant Flush Comp.	10199	237	403904	<0.02	<0 02	68.4	19.1	7.39	1.5	79	13	8.65	21.6	0.0152	1.62	4.80	1 863	25.4	0.0008	0.0067	22.4	0.0923	19.1	5.56	2.324	26.5	0.0053	0 0355
25-Jul-14	Hydrant Flush,	10199	239	403905	<0.02	<0 02																							
28-Jul-14	Hydrant Flush Comp.	60003960	197	403974	0.96	1.13	49.8	21.1	7.97	1.0	31	<3	9.03	21.3	0.0074	0.249	4.87	0.1280	25.4	<0.0004	0.0046	22.6	0.1735	10.1	5.15	1.238	27.0	0.0062	0 0913
28-Jul-14	Hydrant Flush,	60003962	198	403975	<0.02	<0 02																							
28-Jul-14	Hydrant Flush Comp.	5491	265	403985	<0.02	<0 02	56.2	17.7	7.70	1.0	40	<3	9.30	21.3	0.0026	0.166	4.81	0.2064	25.5	<0.0004	0.0016	22.1	0.0396	17.1	4.95	0.8333	26.9	0.0045	0 0115
28-Jul-14	Hydrant Flush,	10341	268	403986	<0.02	<0 02																							
29-Jul-14	Hydrant Flush Comp.	60005159	208	404016	<0.02	<0 02	4.88	20.0	7.75	0.5	7	4	8.84	20.7	0.0090	0.140	4.80	1 326	26.0	<0.0004	0.0021	21.5	0.0513	2.07	4.92	1.661	26.5	0.0010	0 0130
29-Jul-14	Hydrant Flush,	60005159	207	404017	<0.02	<0 02																							
29-Jul-14	Hydrant Flush Comp.	10619	276	404028	<0.02	<0 02	34.8	17.7	7.71	0.5	25	4	9.28	20.9	0.0278	2.09	4.95	1.794	25.5	0.0019	0.0075	21.3	0.0720	7.05	5.11	2.240	25.9	0.0056	0 0190
29-Jul-14	Hydrant Flush,	6539	277	404029	<0.02	<0 02																							
30-Jul-14	Hydrant Flush Comp.	70001693	221	404476	<0.02	<0 02	54.4	18.2	7.85	1.5	31	3	8.98	20.7	0.0070	0.393	5.03	0.8780	26.0	0.0027	0.0042	21.6	0.0439	8.52	5.11	1 273	26.1	0.0472	0 0187
30-Jul-14	Hydrant Flush,	60004413	220	404477	<0.02	<0 02																							

2014 Water Main Cleaning Program

Laboratory Analysis Report Environmental Monitoring

Date Sampled	Sample Location	Hydrant Number	Sequence Number	Sample Number	Free Chlorine	Total Chlorine	Turbidity	Temperature	pH	True Colour	TSS	BOD_5	DO	Soluble Calcium	Soluble Copper	Soluble Iron	Soluble Magnesium	Soluble Manganese	Soluble Sodium	Soluble Lead	Soluble Zinc	Total Calcium	Total Copper	Total Iron	Total Magnesium	Total Manganese	Total Sodium	Total Lead	Total Zinc
					(mg/L)	(mg/L)	(ntu)	(°C)	(units)	(tcu)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)
30-Jul-14	Hydrant Flush Comp.	10421	285	404491	<0.02	<0 02	65.6	17.0	7.68	2.0	88	9	9.24	21.4	0.0162	2.11	4.85	1 936	26.0	0.0012	0.0062	23.0	0.1332	34 8	5.20	2.952	26.1	0.0153	0 0547
30-Jul-14	Hydrant Flush,	6680	286	404492	<0.02	<0 02																							
31-Jul-14	Hydrant Flush Comp.	8254	292	404538	<0.02	<0 02	55.6	17.3	7.69	1.5	33	6	9.26	20.4	0.0029	0.195	4.78	0.4435	25.5	<0.0004	0.0027	21.6	0.0258	10.4	4.86	0.5969	25.7	0.0055	0 0068
31-Jul-14	Hydrant Flush,	3259	293	404539	<0.02	<0 02																							
31-Jul-14	Hydrant Flush Comp.	60006554	231	404549	<0.02	<0 02	11.6	19.0	7.82	1.0	37	<3	8.80	20.2	0.0068	0.280	4.57	0.7202	25.3	<0.0004	0.0022	24.0	0.0369	5.13	6.15	1.114	26.2	0.0027	0 0120
31-Jul-14	Hydrant Flush,	60006554	232	404550	<0.02	<0 02																							
01-Aug-14	Hydrant Flush Comp.	60005848	244	404634	<0.02	<0 02	141	19.2	7.62	2.5	86	4	8.85	20.2	0.0034	0.191	5.12	1 871	27.0	<0.0004	0.0045	21.8	0.1578	36.5	5.27	4 212	27.0	0.0098	0 0875
01-Aug-14	Hydrant Flush,	60004525	243	404635	<0.02	<0 02																							
01-Aug-14	Hydrant Flush Comp.	70008574	297	404645	<0.02	<0 02	482	16.2	7.49	2.5	132	7	9.33	20.3	0.0022	0.276	5.01	2 536	25.3	<0.0004	0.0011	24.1	0.1352	79.9	5.50	6 358	25.6	0.0100	0 0582
01-Aug-14	Hydrant Flush,	5448	298	404646	<0.02	<0 02																							
05-Aug-14	Hydrant Flush Comp.	60006072	289	404861	<0.02	0 02	40.0	18.8	7.41	0.5	38	8	8.87	20.9	0.0061	0.288	5.13	1 033	27.3	<0.0004	0.0054	21.5	0.0828	16.9	5.19	1 324	28.6	0.0037	0 0457
05-Aug-14	Hydrant Flush,	60005992	291	404862	<0.02	<0 02																							
05-Aug-14	Hydrant Flush Comp.	3657	341	404872	<0.02	<0 02	47.0	18.8	7.52	1.5	30	6	NR	20.4	0.0042	0.340	4.91	0.7003	26.4	<0.0004	0.0021	20.5	0.0459	8.97	4.99	0.8904	26.4	0.0050	0 0100
05-Aug-14	Hydrant Flush,	2392	343	404873	<0.02	<0 02																							
06-Aug-14	Hydrant Flush Comp.	78208	351	405296	<0.02	<0 02	56.8	17.1	7.72	4.0	44	5	9.32	21.5	0.0109	1.04	4.67	1.792	27.0	0.0008	0.0043	22.2	0.0676	12 9	4.84	2.735	27.1	0.0067	0 0201
06-Aug-14	Hydrant Flush,	804	354	405297	<0.02	<0 02																							

2014 Water Main Cleaning Program

Laboratory Analysis Report Environmental Monitoring

Date Sampled	Sample Location	Hydrant Number	Sequence Number	Sample Number	Free Chlorine	Total Chlorine	Turbidity	Temperature	pH	True Colour	TSS	BOD_5	DO	Soluble Calcium	Soluble Copper	Soluble Iron	Soluble Magnesium	Soluble Manganese	Soluble Sodium	Soluble Lead	Soluble Zinc	Total Calcium	Total Copper	Total Iron	Total Magnesium	Total Manganese	Total Sodium	Total Lead	Total Zinc
					(mg/L)	(mg/L)	(ntu)	(°C)	(units)	(tcu)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)
06-Aug-14	Hydrant Flush Comp.	60004898	300	405312	<0.02	<0 02	39.6	17.7	7.67	2.5	53	<3	9.49	20.5	0.0014	0.076	4.85	0.1175	26.4	<0.0004	0.0008	23.4	0.0165	11.3	5.82	0.2907	26.9	0.0034	0 0074
06-Aug-14	Hydrant Flush,	60004904	299	405313	<0.02	<0 02																							
07-Aug-14	Hydrant Flush Comp.	60007466	306	405366	<0.02	<0.02	58.2	17.2	7.66	1.0	43	4	9.24	20.6	0.0126	2.04	4.88	0.2681	25.6	0.0016	0.0164	21.1	0.0448	9.76	5.05	0.3176	27.0	0.0074	0 0414
07-Aug-14	Hydrant Flush,	60007466	307	405367	<0.02	<0 02																							
07-Aug-14	Hydrant Flush Comp.	3102	366	405386	<0.02	<0.02	48.6	17.9	7.81	1.5	38	11	9.08	21.4	0.0254	3.13	4.86	1 557	26.5	0.0015	0.0132	22.0	0.0717	10.4	4.87	2 240	26.8	0.0044	0 0374
07-Aug-14	Hydrant Flush,	10431	368	405387	<0.02	<0 02																							
08-Aug-14	Hydrant Flush Comp.	5538	377	405415	<0.02	<0 02	8.03	16.1	7.60	2.5	12	5	9.20	21.3	0.0122	0.754	4.85	0.5910	26.9	0.0005	0.0045	21.6	0.0208	1.55	5.14	0.6501	27.6	0.0011	0 0076
08-Aug-14	Hydrant Flush,	5478	383	405416	<0.02	<0 02																							
08-Aug-14	Hydrant Flush Comp.	70002134	315	405433	0.03	0 04	83.2	17.4	7.73	3.0	47	6	9.03	20.5	0.0677	5.99	4.72	2.109	25.1	0.0059	0.0495	20.5	0.1682	18.0	5.02	2.674	26.0	0.0170	0.1575
08-Aug-14	Hydrant Flush,	60006485	320	405434	<0.02	<0 02																							
11-Aug-14	Hydrant Flush Comp.	60003548	349	405593	0.02	0 02	32.6	14.5	7.61	1.0	30	13	9.75	20.7	0.0014	0.265	4.69	0.1639	26.4	<0.0004	0.0037	20.8	0.0143	13.0	4.70	0.2395	26.8	0.0037	0 0065
11-Aug-14	Hydrant Flush,	60003548	348	405594	<0.02	<0 02																							
11-Aug-14	Hydrant Flush Comp.	809	406	405604	<0.02	<0 02	63.8	15.9	7.75	0.5	51	5	9.74	19.4	0.0181	1.83	4.96	1.777	25.8	0.0013	0.0200	21.5	0.1204	16 0	5.09	2.650	27.1	0.0118	0 0882
11-Aug-14	Hydrant Flush,	10471	408	405605	<0.02	<0 02																							
12-Aug-14	Hydrant Flush Comp.	60004530	365	405668	<0.02	<0 02	33.5	17.9	7.22	0.5	41	10	9.24	19.6	0.0070	4.02	4.89	0.3361	26.0	0.0032	0.0040	20.8	0.0273	20.9	4.92	0.4223	26.6	0.0150	0 0076
12-Aug-14	Hydrant Flush,	60004568	364	405669	<0.02	<0 02																							
13-Aug-14	Hydrant Flush Comp.	60003557	371	406131	<0.02	<0.02	60.6	16.1	7 36	0.5	32	>17	8.81	20.2	0.0028	1.85	4.62	0.2325	26.3	0.0025	0.0064	20.3	0.0169	11.6	4.73	0.2966	26.7	0.0116	0 0136
13-Aug-14	Hydrant Flush,	60003531	370	406132	<0.02	<0 02																							
14-Aug-14	Hydrant Flush Comp.	60003663	383	406224	<0.02	<0 02	29.5	17.7	7.60	2.0	13	11	9.02	21.2	0.0009	0.217	5.93	0.0926	31.9	<0.0004	0.0024	21.3	0.0073	5.89	6.23	0.1185	32.8	0.0021	0 0047
14-Aug-14	Hydrant Flush,	60004793	382	406225	<0.02	<0 02																							

2014 Water Main Cleaning Program

Laboratory Analysis Report Environmental Monitoring

Date Sampled	Sample Location	Hydrant Number	Sequence Number	Sample Number	Free Chlorine	Total Chlorine	Turbidity	Temperature	pH	True Colour	TSS	BOD_5	DO	Soluble Calcium	Soluble Copper	Soluble Iron	Soluble Magnesium	Soluble Manganese	Soluble Sodium	Soluble Lead	Soluble Zinc	Total Calcium	Total Copper	Total Iron	Total Magnesium	Total Manganese	Total Sodium	Total Lead	Total Zinc
					(mg/L)	(mg/L)	(ntu)	(°C)	(units)	(tcu)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)
15-Aug-14	Hydrant Flush Comp.	6219	414	405630	<0.02	<0 02	143	19.0	7.74	1.0	74	3	9.11	21.5	0.0050	1.05	5.90	0.8711	31.4	0.0022	0.0101	21.9	0.0930	22 9	6.11	1.666	31.6	0.0478	0 0458
15-Aug-14	Hydrant Flush,	6229	415	405631	<0.02	<0 02																							
15-Aug-14	Hydrant Flush Comp.	60004877	399	406271	<0.02	<0 02	2.62	20.7	7.70	1.5	<3	6	8.90	22.1	0.0016	0.124	6.11	0.0387	31.2	<0.0004	0.0046	22.5	0.0024	0.315	6.22	0.0410	32.3	<0.0004	0 0057
15-Aug-14	Hydrant Flush,	60004877	398	406272	<0.02	<0 02																							
18-Aug-14	Hydrant Flush Comp.	6237	441	406296	0.04	0 04	8.35	19.3	7.67	2.0	10	8	8.61	23.3	0.0046	0.271	6.07	0.5252	32.0	<0.0004	0.0050	23.7	0.0179	2.76	6.47	0.6013	32.8	0.0012	0 0089
18-Aug-14	Hydrant Flush,	6237	440	406297	<0.02	<0 02																							
18-Aug-14	Hydrant Flush Comp.	70004608	438	406486	<0.02	0 02	52.6	19.7	7.62	2.0	24	11	8.69	21.5	0.0022	0.467	5.94	0.4955	31.1	0.0004	0.0055	21.9	0.0222	8.99	5.98	0.6983	31.5	0.0117	0 0200
18-Aug-14	Hydrant Flush,	60006068	435	406487	<0.02	<0 02																							
19-Aug-14	Hydrant Flush Comp.	4116	449	406497	<0.02	<0 02	57.4	18.2	7.66	1.5	43	<3	9.14	21.7	0.0019	0.636	5.82	0.0995	30.9	<0.0004	0.0033	22.1	0.0100	7.74	5.95	0.2407	31.4	0.0008	0 0056
19-Aug-14	Hydrant Flush,	10314	450	406498	<0.02	<0 02																							
19-Aug-14	Hydrant Flush Comp.	60007043	444	406532	<0.02	<0 02	336	18.4	7.91	0.5	114	5	8.80	21.9	0.0010	0.443	6.03	0.7422	31.4	<0.0004	0.0027	24.8	0.0452	36.2	6.92	1 275	31.5	0.0085	0 0425
19-Aug-14	Hydrant Flush,	60007121	447	406533	<0.02	<0 02																							
20-Aug-14	Hydrant Flush Comp.	10317	459	406918	<0.02	<0 02	27.2	17.7	7.51	1.0	21	6	9.03	22.2	0.0064	1.05	5.85	0.4910	30.8	0.0006	0.0033	22.4	0.0174	4.74	5.89	0.5783	31.5	0.0022	0 0071
20-Aug-14	Hydrant Flush,	10317	460	406919	<0.02	<0 02																							
20-Aug-14	Hydrant Flush Comp.	70003167	464	406929	<0.02	<0 02	4.58	20.7	7.62	2.5	3	8	8.80	22.3	0.0030	0.295	5.85	0.0896	30.5	0.0005	0.0126	22.5	0.0073	0.975	5.97	0.0974	31.0	0.0014	0 0094
20-Aug-14	Hydrant Flush,	60007076	460	406930	<0.02	<0 02																							
21-Aug-14	Hydrant Flush Comp.	6544	466	407006	<0.02	<0 02	140	17.0	7.53	1.0	111	<3	9.06	23.7	0.0086	1.59	5.98	1.654	31.0	0.0005	0.0126	26.4	0.1013	35.1	6.46	3 951	32.8	0.0067	0 0601
21-Aug-14	Hydrant Flush,	4163	468	407007	<0.02	<0 02																							

2014 Water Main Cleaning Program

Laboratory Analysis Report Environmental Monitoring

Date Sampled	Sample Location	Hydrant Number	Sequence Number	Sample Number	Free Chlorine	Total Chlorine	Turbidity	Temperature	pH	True Colour	TSS	BOD_5	DO	Soluble Calcium	Soluble Copper	Soluble Iron	Soluble Magnesium	Soluble Manganese	Soluble Sodium	Soluble Lead	Soluble Zinc	Total Calcium	Total Copper	Total Iron	Total Magnesium	Total Manganese	Total Sodium	Total Lead	Total Zinc
					(mg/L)	(mg/L)	(ntu)	(°C)	(units)	(tcu)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)
21-Aug-14	Hydrant Flush Comp.	60007102	470	407017	<0.02	<0 02	3.48	18.8	7.92	1.0	<3	4	8.86	23.2	0.0037	0.170	5.86	0.0344	31.1	<0.0004	0.0028	23.4	0.0079	0.822	6.01	0.0975	31.6	<0.0004	0 0035
21-Aug-14	Hydrant Flush,	60007142	475	407018	<0.02	<0 02																							
22-Aug-14	Hydrant Flush Comp.	60001494	482	407115	<0.02	<0 02	19.5	20.2	7.51	0.5	20	12	8.36	22.5	0.0044	0.142	5.92	0.8759	31.0	<0.0004	0.0042	22.8	0.0386	7.67	5.98	1 011	31.2	0.0044	0 0140
22-Aug-14	Hydrant Flush,	60001514	485	407116	<0.02	<0 02																							
22-Aug-14	Hydrant Flush Comp.	4120	474	407126	<0.02	<0.02	76.8	15.8	7.24	1.0	61	11	9.05	18.9	0.0012	0.162	5.22	0.4852	28.0	<0.0004	0.0060	19.9	0.0215	19.7	5.37	0.6189	28.7	0.0011	0 0116
22-Aug-14	Hydrant Flush,	4104	475	407127	<0.02	<0 02																							
25-Aug-14	Hydrant Flush Comp.	862	492	407262	<0.02	<0 02	318	16.0	7.67	2.0	143	NR	8.85	19.0	0.0017	0.213	5.17	0.5061	28.2	<0.0004	0.0066	21.7	0.1301	45.9	6.27	1.806	28.6	0.0126	0.1337
25-Aug-14	Hydrant Flush,	793	496	407263	<0.02	<0 02																							
25-Aug-14	Hydrant Flush Comp.	60000954	511	407289	0.05	0.11	87.6	18.5	7.82	2.0	38	NR	8.73	19.6	0.0016	0.108	5.36	0.2618	27.8	<0.0004	0.0061	19.9	0.0414	24.7	5.48	0.8714	29.2	0.0056	0 0475
25-Aug-14	Hydrant Flush,	60000970	509	407290	<0.02	<0 02																							
26-Aug-14	Hydrant Flush Comp.	1001	503	407311	<0.02	0 02	82.2	15.7	7.84	1.0	80	8	9.36	20.1	0.0056	0.305	5.20	2 343	28.6	<0.0004	0.0071	21.8	0.1630	23.1	5.74	5 851	28.7	0.0059	0 0976
26-Aug-14	Hydrant Flush,	10257	505	407312	<0.02	<0 02																							
26-Aug-14	Hydrant Flush Comp.	60000980	515	407323	<0.02	<0 02	64.4	17.9	7.69	0.5	45	6	8.94	18.9	0.0012	0.112	5.19	0.7364	28.4	<0.0004	0.0036	20.7	0.0549	18.3	5.46	1 089	28.4	0.0139	0 0558
26-Aug-14	Hydrant Flush,	60000934	514	407324	<0.02	<0 02																							
27-Aug-14	Hydrant Flush Comp.	60005426	528	407677	<0.02	<0 02	499	18.9	7.54	1.0	200	7	8.80	19.2	0.0281	2.92	5.15	0.9995	28.3	0.0159	0.0100	19.8	0.2509	27.7	5.26	1.418	28.6	0.1788	0 0652
27-Aug-14	Hydrant Flush,	60005438	530	407678	<0.02	<0 02																							
27-Aug-14	Hydrant Flush Comp.	70004715	509	407689	<0.02	0 02	7.97	16.7	7.71	0.5	16	3	9.00	20.5	0.0065	0.679	5.01	0.3978	27.0	0.0007	0.0047	20.9	0.0147	2.14	5.09	0.4602	27.6	0.0021	0 0082
27-Aug-14	Hydrant Flush,	70004715	510	407690	<0.02	<0 02																							
28-Aug-14	Hydrant Flush Comp.	70003476	519	407774	<0.02	<0 02	65.0	17.0	7.70	2.0	32	<3	9.03	19.9	0.0030	0.560	4.88	0.1581	26.9	<0.0004	0.0036	20.3	0.0276	13.7	5.02	0.6343	27.2	0.0025	0 0154
28-Aug-14	Hydrant Flush,	70003476	520	407775	<0.02	<0 02																							

2014 Water Main Cleaning Program

Laboratory Analysis Report Environmental Monitoring

Date Sampled	Sample Location	Hydrant Number	Sequence Number	Sample Number	Free Chlorine	Total Chlorine	Turbidity	Temperature	pH	True Colour	TSS	BOD_5	DO	Soluble Calcium	Soluble Copper	Soluble Iron	Soluble Magnesium	Soluble Manganese	Soluble Sodium	Soluble Lead	Soluble Zinc	Total Calcium	Total Copper	Total Iron	Total Magnesium	Total Manganese	Total Sodium	Total Lead	Total Zinc
					(mg/L)	(mg/L)	(ntu)	(°C)	(units)	(tcu)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)
28-Aug-14	Hydrant Flush Comp.	60001368	540	407787	<0.02	<0.02	15.6	18.1	7 58	0.5	9	12	8.88	18.6	0.0081	2.61	5.34	0.2521	26.6	0.0011	0.0048	19.7	0.0113	4.69	5.38	0.2813	27.3	0.0059	0 0055
28-Aug-14	Hydrant Flush,	70000584	542	407788	<0.02	<0 02																							
4-Sep-14	Hydrant Flush Comp.	10405	592	408498	<0.02	<0.02	67.6	15.7	7.53	2.5	39	NR	9.23	19.0	0.0032	0.357	5.13	0.7046	27.2	<0.0004	0.0021	20.0	0.0307	18.1	5.44	1 267	27.1	0.0043	0 0158
4-Sep-14	Hydrant Flush,	1513	591	408499	<0.02	<0 02																							
11-Sep-14	Hydrant Flush Comp.	6637	662	409171	<0.02	<0.02	12.8	14.5	7.73	7.5	9	<3	9.68	20.7	0.0048	0.372	5.60	0.3916	30.4	<0.0004	0.0034	20.8	0.0201	3.86	5.67	0.6163	30.9	0.0007	0 0087
11-Sep-14	Hydrant Flush,	6636	663	409172	<0.02	<0 02																							
12-Sep-14	Hydrant Flush Comp.	3680	675	409246	<0.02	<0 02	101	NA	7.80	13.0	68	<3	9.70	21.3	0.0291	4.35	5.97	1.456	32.0	0.0018	0.0143	22.2	0.0597	8.45	6.27	2.131	32.8	0.0039	0 0315
12-Sep-14	Hydrant Flush,	645	674	409247	<0.02	<0 02																							
15-Sep-14	Hydrant Flush Comp.	5840	700	409400	<0.02	<0 02	8.90	15.0	7.80	6.0	8	<3	9.49	22.2	0.0043	0.427	5.80	0.1549	30.2	0.0005	0.0018	22.6	0.0119	2.38	5.82	0.2049	30.3	0.0017	0 0038
15-Sep-14	Hydrant Flush,	70020753	701	409401	<0.02	<0 02																							
16-Sep-14	Hydrant Flush Comp.	3677	709	409424	<0.02	<0.02	63.4	16.1	7.80	2.5	44	4	9.48	22.0	0.0044	1.16	5.78	0.4935	30.0	<0.0004	0.0017	23.1	0.0287	20.8	6.12	0.8584	30.5	0.0028	0 0141
16-Sep-14	Hydrant Flush,	5192	710	409425	<0.02	<0 02																							
18-Sep-14	Hydrant Flush Comp.	7003297	724	409888	<0.02	<0 02	56.0	13.9	7.71	4.0	35	<3	9.97	22.7	0.0107	5.53	5.79	0.4564	30.8	0.0012	0.0078	23.3	0.0241	12.1	6.25	0.6901	30.7	0.0027	0 0106
18-Sep-14	Hydrant Flush,	5233	725	409889	<0.02	<0 02																							
19-Sep-14	Hydrant Flush Comp.	10637	731	409974	<0.02	<0 02	44.4	15.0	7.62	6.0	31	7	9.66	22.8	0.0083	2.64	5.85	0.5427	30.3	<0.0004	0.0051	23.3	0.0263	15.3	6.06	0.7501	31.1	0.0007	0 0113
19-Sep-14	Hydrant Flush,	NS	NS	409975	NS	NS																							
22-Sep-14	Hydrant Flush Comp.	50002944	77	410168	<0.02	<0 02	15.6	15.4	7.75	11.0	16	<3	10.1	21.6	0.0055	0.202	5.61	0.9343	28.2	<0.0004	0.0029	22.0	0.0369	6.46	5.78	1 258	30.3	0.0023	0 0122
22-Sep-14	Hydrant Flush,	5002651	79	410169	<0.02	<0 02																							

2014 Water Main Cleaning Program

Laboratory Analysis Report Environmental Monitoring

Date Sampled	Sample Location	Hydrant Number	Sequence Number	Sample Number	Free Chlorine	Total Chlorine	Turbidity	Temperature	pH	True Colour	TSS	BOD_5	DO	Soluble Calcium	Soluble Copper	Soluble Iron	Soluble Magnesium	Soluble Manganese	Soluble Sodium	Soluble Lead	Soluble Zinc	Total Calcium	Total Copper	Total Iron	Total Magnesium	Total Manganese	Total Sodium	Total Lead	Total Zinc
					(mg/L)	(mg/L)	(ntu)	(°C)	(units)	(tcu)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)
23-Sep-14	Hydrant Flush Comp.	50002664	88	410207	<0.02	<0 02	41.6	15.4	7.79	2.5	47	<3	9.90	21.1	0.0040	0.576	5.60	0.4952	28.1	0.0023	0.0021	21.4	0.0343	22.2	5.79	0.7083	29.1	0.0288	0 0127
23-Sep-14	Hydrant Flush,	50000853	92	410208	<0.02	<0 02																							
25-Sep-14	Hydrant Flush Comp.	70015457	108	410657	<0.02	<0 02	7.39	15.9	7.83	10.0	12	3	9.71	23.2	0.0092	0.441	5.91	0.7792	28.8	0.0005	0.0042	23.3	0.0339	3.94	5.92	1.065	29.5	0.0030	0 0150
25-Sep-14	Hydrant Flush,	50003686	109	410658	<0.02	<0 02																							
30-Sep-14	Hydrant Flush Comp.	70001814	162	410934	<0.02	<0 02	2.56	14.1	7.71	6.0	<3	7	9.95	21.6	0.0039	0.045	5.77	0.2465	29.9	<0.0004	0.0018	23.6	0.0091	0.932	6.17	0.2631	33.0	0.0004	0 0034
30-Sep-14	Hydrant Flush,	70001814	161	410935	<0.02	<0 02																							
2-Oct-14	Hydrant Flush Comp.	50002349	188	411450	<0.02	<0 02	28.1	15.0	7.75	2.0	20	<3	9.72	22.7	0.0044	0.346	5.96	0.3736	32.2	<0.0004	0.0021	23.3	0.0183	3.75	6.04	0.5107	32.7	0.0021	0 0070
2-Oct-14	Hydrant Flush,	50005013	186	411451	<0.02	<0 02																							
3-Oct-14	Hydrant Flush Comp.	70001292	203	411513	<0.02	<0 02	8.87	12.0	7.63	5.0	10	<3	9.78	24.8	0.0092	0.240	6.57	0.9877	34.8	0.0004	0.0030	25.1	0.0430	2.39	6.81	1 248	36.1	0.0057	0 0155
3-Oct-14	Hydrant Flush,	50001667	201	411514	<0.02	<0 02																							
6-Oct-14	Hydrant Flush Comp.	50000108	237	411698	<0.02	<0 02	113	12.9	7.74	4.0	80	7	10.2	22.2	0.0099	1.89	5.10	1.442	28.4	<0.0004	0.0106	23.0	0.0701	28.5	5.36	2.191	31.0	0.0036	0 0640
6-Oct-14	Hydrant Flush,	50000792	235	411699	<0.02	<0 02																							
7-Oct-14	Hydrant Flush Comp.	50002902	249	411731	<0.02	<0 02	17.4	12.4	7.81	5.0	16	3	10.2	22.3	0.0133	0.979	5.34	0.7397	29.8	0.0006	0.0071	22.3	0.0322	3.15	5.35	0.9172	31.0	0.0018	0 0107
7-Oct-14	Hydrant Flush,	70020852	247	411732	<0.02	<0 02																							
9-Oct-14	Hydrant Flush Comp.	70011580	278	412011	<0.02	0 02	15.7	12.1	7.73	2.0	7	5	10.5	20.4	0.0035	0.068	5.05	0.3168	28.7	<0.0004	0.0041	21.6	0.0143	2.43	5.26	0.4188	29.4	0.0012	0 0073
9-Oct-14	Hydrant Flush,	50000317	281	412012	<0.02	0.02																							
10-Oct-14	Hydrant Flush Comp.	50002058	293	412074	<0.02	<0 02	62.2	12.2	7.62	3.0	51	6	10.8	23.1	0.0019	0.266	5.39	0.4704	30.4	<0.0004	0.0042	24.2	0.0218	7.39	6.08	0.6771	30.7	0.0009	0 0258
10-Oct-14	Hydrant Flush,	50002162	295	412075	<0.02	<0 02																							
14-Oct-14	Hydrant Flush Comp.	4851	843	412273	<0.02	<0 02	6.13	11.8	7.98	0.5	8	5	10.4	22.0	0.0027	0.266	5.54	0.0922	29.4	<0.0004	0.0375	22.8	0.0044	1.07	5.98	0.1004	30.2	0.0009	0 0490
14-Oct-14	Hydrant Flush,	10662	845	412274	<0.02	<0 02																							

2014 Water Main Cleaning Program

Laboratory Analysis Report Environmental Monitoring

Date Sampled	Sample Location	Hydrant Number	Sequence Number	Sample Number	Free Chlorine	Total Chlorine	Turbidity	Temperature	pH	True Colour	TSS	BOD_5	DO	Soluble Calcium	Soluble Copper	Soluble Iron	Soluble Magnesium	Soluble Manganese	Soluble Sodium	Soluble Lead	Soluble Zinc	Total Calcium	Total Copper	Total Iron	Total Magnesium	Total Manganese	Total Sodium	Total Lead	Total Zinc
					(mg/L)	(mg/L)	(ntu)	(°C)	(units)	(tcu)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)
16-Oct-14	Hydrant Flush Comp.	70013554	866	412806	<0.02	<0 02	5.81	13.0	7.86	5.0	3	NR	10.0	20.6	0.0036	0.068	5.05	0.1820	29.7	<0.0004	0.0046	20.7	0.0113	1.41	5.31	0.2279	30.1	0.0015	0 0130
16-Oct-14	Hydrant Flush,	10403	866	412807	<0.02	<0 02																							
17-Oct-14	Hydrant Flush Comp.	532	871	412887	<0.02	<0 02	127	11.8	7.77	2.0	93	12	10.7	20.6	0.0034	0.141	5.20	1 248	29.0	0.0005	0.0037	23.6	0.0918	21 9	6.58	2.038	29.1	0.1112	0 0799
17-Oct-14	Hydrant Flush,	402	868	412888	<0.02	<0 02																							
21-Oct-14	Hydrant Flush Comp.	10507	917	413089	<0.02	<0 02	127	11.8	7.95	2.0	80	4	10.7	22.5	0.0055	0.329	5.30	1 508	27.3	<0.0004	0.0025	25.2	0.1179	12.0	6.30	3.682	27.9	0.0042	0 0994
21-Oct-14	Hydrant Flush,	10203	918	413090	<0.02	<0 02																							
21-Oct-14	Hydrant Flush Comp.	NR	570	413100	<0.02	<0 02	4.45	12.4	7.92	0.5	4	3	10.4	22.4	0.0220	0.290	5.29	0.6057	27.9	0.0011	0.0053	23.1	0.0505	0.986	5.33	0.7232	27.9	0.0041	0 0129
21-Oct-14	Hydrant Flush,	70029277	569	413101	<0.02	<0 02																							
22-Oct-14	Hydrant Flush Comp.	303	931	413525	<0.02	<0 02	17.4	11.7	7.78	5.0	20	5	10.5	22.8	0.0055	0.332	5.38	0.4109	27.5	<0.0004	0.0023	23.7	0.0174	4.28	5.62	0.5052	28.7	0.0016	0 0104
22-Oct-14	Hydrant Flush,	309	932	413526	<0.02	<0 02																							

NOTE: On July 11, 14, 22, and 28, and August 5, 8, 11, 18, 25, 26, and 27, the chlorine was high because the flushing crew were unable to add enough dechlorination chemical during the flush.
On August 5, there was no result for DO due to instrument malfunction.
On August 25 and September 4, there were no results for BOD5 due to QC failure.
On September 12, temperature was not analysed due to technician error.
On September 19, a hydrant flush sample was not taken due to technician error.
On October 16, there was no result for BOD_5 due to technician error.
On October 21, there was no number for the hydrant because it has not been assigned.

E4c Household Monitoring Reports 2011-2014

2011 Water Main Cleaning Program

Laboratory Analysis Report Household Monitoring

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100m L)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	Apparent Colour (acu)	True Colour (tcu)
26-May-11		1	293007	0.29	0.45	<1	<1	<10	0.16	10.3	7.78	13.0	3.0
26-May-11		1	293008	0.60	0.75	<1	<1	<10	0.57	12.1	7.84	18.0	6.0
26-May-11		1	293009	0.66	0 84	<1	<1	<10	0.25	10.2	7.85	18 0	7.0
26-May-11		1	293010	0.63	0.77	<1	<1	<10	0.72	12 2	7.83	21 0	10.0
26-May-11		2	293011	0.91	1 03	<1	<1	<10	0.39	7.1	7.79	18 0	7.5
26-May-11		2	293012	0.89	1 02	<1	<1	<10	0.71	8.3	7.81	20.0	10.0
26-May-11		2	293013	0.85	0 96	<1	<1	<10	0.19	12.3	7.83	18 0	11.0
26-May-11		2	293014	0.79	0 93	<1	<1	<10	0.73	10.4	7.79	20.0	10.0
27-May-11		9	293332	0.88	1 20	<1	<1	<10	0.20	12 0	7.31	7.5	2.0
27-May-11		9	293333	0.88	1.14	<1	<1	<10	0.24	11.9	7.36	8.0	3.0
27-May-11		9	293336	0.99	1 26	<1	<1	<10	0.47	10.8	7.38	15 0	5.0
27-May-11		9	293337	0.75	1 03	<1	<1	<10	0.22	11.1	7.38	13.0	3.0
27-May-11		10	293338	1.02	1.18	<1	<1	<10	0.16	6.3	7.43	13 0	3.5
27-May-11		10	293339	0.85	1 09	<1	<1	<10	0.27	9.2	7.41	15.0	5.0
27-May-11		10	293340	0.54	0.77	<1	<1	<10	0.50	6.3	7.42	16 0	5.0
27-May-11		10	293341	0.59	0.79	<1	<1	80	0.34	6.3	7.40	16 0	6.0
30-May-11		40	293320	0.62	0.77	<1	<1	<10	1.24	11.5	7.52	18 0	2.5
30-May-11		40	293312	0.63	0 81	<1	<1	<10	7.72	11.5	7.33	20.0	3.0
31-May-11		40	293868	0.65	0 84	NA	NA	NA	0.27	11.0	NA	NA	NA
30-May-11		40	293319	0.65	0.78	<1	<1	<10	1.38	11.8	7.45	15 0	2.0
30-May-11		40	293325	0.65	0 88	<1	<1	<10	2.06	11.2	7.44	22.0	3.0
31-May-11		40	293869	0.70	0 84	NA	NA	NA	0.32	8.6	NA	NA	NA
30-May-11		41	293323	0.69	0 87	<1	<1	<10	0.26	9.7	7.43	13 0	0.5
30-May-11		41	293321	0.70	0 83	<1	<1	<10	0.21	10.6	7.38	18 0	3.0

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100m L)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	Apparent Colour (acu)	True Colour (tcu)
30-May-11		41	293324	0.58	0.72	<1	<1	<10	0.21	10.1	7.39	15 0	0.5
30-May-11		41	293322	0.82	0 92	<1	<1	<10	0.25	11.0	7.52	16 0	2.5
31-May-11		47	293388	0.68	0 81	<1	<1	10	0.30	9.7	7.74	2.5	0.5
31-May-11		47	293387	0.64	0 82	<1	<1	<10	0.41	12 2	7.73	0.5	0.5
31-May-11		47	293391	0.78	0 93	<1	<1	<10	0.20	10.5	7.79	2.5	0.5
31-May-11		47	293392	0.73	0 83	<1	<1	<10	0.27	12.9	7.79	2.5	0.5
31-May-11		48	293394	0.61	0.74	<1	<1	10	0.30	10.5	7.79	1.0	0.5
31-May-11		48	293393	0.71	0 85	<1	<1	<10	0.22	11 5	7.78	2.5	0.5
31-May-11		48	293395	0.61	0 81	<1	<1	<10	0.23	10 5	7.77	3.5	0.5
31-May-11		48	293396	0.72	0 88	<1	<1	<10	0.35	11.1	7.81	5.0	1.0
1-Jun-11		55	293852	0.39	0 61	<1	<1	<10	0.71	12.7	7.59	13 0	0.5
1-Jun-11		55	293848	0.50	0 68	<1	<1	<10	0.24	12.7	7.42	15 0	3.0
1-Jun-11		60	293849	0.37	0 69	<1	<1	20	0.94	11 6	7.54	18 0	5.0
2-Jun-11		60	293933	0.55	0 69	<1	<1	<10	0.79	12.1	7.49	13 0	2.5
1-Jun-11		55	293856	0.47	0 68	<1	<1	<10	0.39	11 6	7.58	5.0	0.5
1-Jun-11		55	293854	0.45	0.70	<1	<1	<10	1.94	11.7	7.49	13 0	0.5
2-Jun-11		55	293934	0.39	0 56	NA	NA	NA	0.40	10.5	NA	NA	NA
1-Jun-11		60	293855	0.67	0 92	1	<1	<10	1.95	11.5	7.55	17 0	0.5
2-Jun-11		60	293859	0.54	0.78	<1	<1	<10	0.67	12.2	7.46	13 0	2.5
2-Jun-11		63	293898	0.51	0.72	4	<1	<10	0.28	8.5	7.50	15 0	2.5
2-Jun-11		63	293897	0.53	0 68	<1	<1	<10	0.56	8.3	7.44	15 0	0.5
2-Jun-11		63	293901	0.42	0.69	3	<1	<10	0.28	10.1	7.49	13 0	2.5
2-Jun-11		63	293902	0.40	0 62	<1	<1	<10	0.76	9.8	7.54	13 0	2.5
2-Jun-11		64	293904	0.42	0 65	<1	<1	<10	0.28	8.4	7.46	13 0	2.5
2-Jun-11		64	293903	0.47	0.61	<1	<1	<10	0.45	8.6	7.45	13 0	2.5
2-Jun-11		64	293905	0.37	0.66	<1	<1	<10	0.26	9.5	7.51	13 0	2.5
2-Jun-11		64	293906	0.39	0.67	<1	<1	<10	0.37	9.3	7.41	13 0	0.5
3-Jun-11		73	294152	0.59	0 86	<1	<1	<10	0.77	12.7	7.45	13 0	2.5
3-Jun-11		73	294151	0.54	0.77	1	<1	<10	1.77	12.7	7.51	15 0	2.5
6-Jun-11		73	294177	NA	NA	<1	<1	<10	0.30	14.1	NA	NA	NA

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100m L)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	Apparent Colour (acu)	True Colour (tcu)
3-Jun-11		73	294155	0.51	0.76	<1	<1	<10	1.52	9.6	7.43	15 0	0.5
3-Jun-11		73	294156	0.49	0.71	<1	<1	<10	1.67	10.1	7.48	18 0	2.5
6-Jun-11		73	294178	NA	NA	NA	NA	NA	0.24	NA	NA	NA	NA
3-Jun-11		74	294158	0.58	0.79	<1	<1	40	0.40	8.6	7.35	13 0	2.0
3-Jun-11		74	294157	0.41	0.70	<1	<1	170	1.30	8.5	7.44	18.0	2.5
6-Jun-11		74	294179	NA	NA	NA	NA	NA	0.26	NA	NA	NA	NA
3-Jun-11		74	294159	0.74	1 02	<1	<1	<10	0.53	9.3	7.42	13 0	2.5
3-Jun-11		74	294160	0.69	0 99	5	<1	<10	0.43	10.1	7.51	15.0	5.0
6-Jun-11		74	294206	0.48	0.76	<1	<1	<10	0.25	10.1	NA	NA	NA
6-Jun-11		94	294166	0.58	0.78	<1	<1	<10	0.72	11.7	7.40	7.5	0.5
6-Jun-11		94	294167	0.79	0 95	<1	<1	<10	0.26	11.5	7.30	10 0	0.5
6-Jun-11		94	294170	0.61	0 85	<1	<1	10	0.18	12.7	7.43	11 0	2.0
6-Jun-11		94	294171	0.80	0 97	<1	<1	<10	0.23	12.4	7.35	10 0	2.5
6-Jun-11		95	294172	0.48	0 63	<1	<1	<10	0.78	10.4	7.42	15 0	2.5
6-Jun-11		95	294173	0.50	0.73	<1	<1	<10	0.25	10.4	7.39	10.0	2.5
6-Jun-11		95	294174	0.47	0 62	<1	<1	20	0.79	10.3	7.50	5.0	0.5
6-Jun-11		95	294175	0.53	0.77	<1	<1	<10	0.31	10.2	7.42	13.0	4.0
7-Jun-11		106	294590	0.57	0 69	2	<1	30	0.30	10.4	7.55	13 0	2.0
7-Jun-11		106	294584	0.88	1 01	<1	<1	40	2.08	10.3	7.58	75 0	10.0
9-Jun-11		106	294744	NA	NA	NA	NA	NA	0.27	NA	NA	NA	NA
7-Jun-11		106	294591	0.36	0 53	<1	<1	<10	0.33	8.6	7.63	10 0	2.5
7-Jun-11		106	294585	0.42	0 66	<1	<1	<10	0.46	9.9	7.64	10.0	2.5
7-Jun-11		105	294592	0.43	0 59	<1	<1	<10	0.26	11.2	7.56	15 0	4.0
7-Jun-11		105	294588	0.40	0 57	<1	<1	<10	0.45	10.3	7.62	15.0	2.5
7-Jun-11		105	294593	0.29	0 50	<1	<1	<10	0.27	9.7	7.53	15 0	5.0
7-Jun-11		105	294589	0.59	0.75	<1	<1	<10	0.46	10.2	7.70	15.0	4.0
8-Jun-11		116	294635	0.48	0 67	<1	<1	<10	0.22	11 0	7.49	5.0	2.5
9-Jun-11		116	294629	0.65	0 80	<1	<1	<10	0.30	11.2	7.71	2.5	0.5
8-Jun-11		116	294636	0.60	0.71	<1	<1	<10	0.20	11.1	7.47	7.5	2.5
9-Jun-11		116	294630	0.70	0 82	<1	<1	<10	0.31	11.6	7.75	2.5	0.5

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	Apparent Colour (acu)	True Colour (tcu)
8-Jun-11		117	294637	0.55	0 69	<1	<1	<10	0.24	9.8	7.41	10 0	5.0
9-Jun-11		117	294633	0.61	0.74	<1	<1	<10	0.27	10.9	7.81	2.5	1.0
8-Jun-11		117	294638	0.60	0.75	<1	<1	<10	0.22	8.6	7.43	7.5	2.5
9-Jun-11		117	294634	0.40	0 54	<1	<1	<10	0.29	8.8	7.79	2.5	0.5
9-Jun-11		122	294651	0.63	0.76	<1	<1	<10	0.33	11.5	7.91	15 0	2.5
9-Jun-11		122	294645	0.29	0 56	<1	<1	<10	0.53	10.7	7.81	13.0	3.0
9-Jun-11		122	294652	0.50	0 65	<1	<1	<10	0.27	11.1	7.76	15 0	5.0
9-Jun-11		122	294646	0.45	0 58	<1	<1	<10	0.36	10.8	7.79	18.0	5.0
9-Jun-11		123	294653	0.50	0 66	<1	<1	<10	0.23	10.8	7.78	15 0	5.0
9-Jun-11		123	294649	0.62	0.72	<1	<1	<10	0.30	11.8	7.69	15.0	4.0
9-Jun-11		123	294654	0.59	0.77	<1	<1	<10	0.26	12.7	7.76	15 0	5.0
9-Jun-11		123	294650	0.49	0.75	<1	<1	<10	0.61	10.9	7.73	18.0	5.0
10-Jun-11		130	294776	0.29	0.45	<1	<1	<10	0.38	9.6	7.55	15 0	5.0
10-Jun-11		130	294770	0.39	0 54	<1	<1	<10	0.33	10.3	7.56	15.0	7.0
10-Jun-11		130	294777	0.34	0.49	<1	<1	<10	0.33	10.1	7.51	15 0	5.0
10-Jun-11		130	294771	0.42	0 60	<1	<1	<10	0.30	10.7	7.48	15.0	7.0
10-Jun-11		131	294778	0.39	0 61	<1	<1	<10	0.28	8.3	7.43	15 0	4.0
10-Jun-11		131	294774	0.49	0 64	<1	<1	<10	0.32	8.9	7.42	13.0	3.0
10-Jun-11		131	294779	0.40	0 57	<1	<1	<10	0.28	9.9	7.44	16 0	5.0
10-Jun-11		131	294775	0.52	0.70	<1	<1	<10	0.34	10.9	7.49	15.0	4.0
13-Jun-11		78	294994	0.23	0 50	<1	<1	<10	0.29	11 3	7.60	11 0	5.0
14-Jun-11		78	294988	0.22	0.47	<1	<1	<10	0.20	12.6	7.39	13 0	6.0
13-Jun-11		78	294995	0.53	0.77	<1	<1	<10	0.16	10.7	7.51	7.0	4.0
14-Jun-11		78	294989	0.51	0 69	<1	<1	<10	0.15	10.9	7.34	10 0	7.5
13-Jun-11		79	294996	0.47	0 69	<1	<1	<10	0.25	10.7	7.50	6.0	2.5
14-Jun-11		79	294992	0.44	0 68	<1	<1	<10	0.20	10 5	7.36	13 0	4.0
13-Jun-11		79	294997	0.40	0 56	<1	<1	<10	0.24	11 3	7.59	8.0	5.0
14-Jun-11		79	294993	0.47	0 69	<1	<1	<10	0.24	10 9	7.48	13 0	7.5
14-Jun-11		156	295330	0.47	0 61	<1	<1	<10	0.39	12.1	7.34	11 0	7.5
14-Jun-11		156	295324	0.58	0.72	<1	<1	<10	0.39	13.9	7.33	13 0	5.0

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	Apparent Colour (acu)	True Colour (tcu)
14-Jun-11		156	295331	0.35	0 57	<1	<1	<10	0.20	11.8	7.47	15 0	2.5
14-Jun-11		156	295325	0.47	0 61	<1	<1	<10	0.97	12.9	7.37	15.0	5.0
14-Jun-11		157	295332	0.40	0 58	<1	<1	<10	0.19	14.6	7.44	13 0	7.5
14-Jun-11		157	295328	0.57	0.74	<1	<1	<10	0.41	13.6	7.28	13.0	4.0
14-Jun-11		157	295333	0.38	0 52	<1	<1	<10	0.45	13.1	7.47	13 0	2.5
14-Jun-11		157	295329	0.62	0.74	<1	<1	<10	0.39	12.5	7.37	10.0	5.0
15-Jun-11		163	295381	0.43	0 65	<1	<1	<10	0.22	9.2	7.71	15 0	7.5
16-Jun-11		163	295375	0.47	0 68	<1	<1	<10	0.24	9.5	7.47	13 0	5.0
15-Jun-11		163	295382	0.45	0 67	<1	<1	<10	0.19	11 2	7.65	5.0	7.5
16-Jun-11		163	295376	0.67	0 80	<1	<1	<10	0.21	11.3	7.45	15 0	2.5
15-Jun-11		164	295383	0.60	0 88	<1	<1	<10	0.19	9.5	7.65	15 0	10.0
16-Jun-11		164	295379	0.74	0 91	<1	<1	<10	0.21	9.9	7.43	13 0	0.5
15-Jun-11		164	295384	0.50	0.71	<1	<1	10	0.19	9.0	7.67	13 0	10.0
16-Jun-11		164	295380	0.62	0.77	<1	<1	<10	0.21	9.2	7.42	15 0	2.5
16-Jun-11		173	295443	0.46	0 69	<1	<1	<10	0.19	9.2	7.26	13 0	5.0
17-Jun-11		173	295437	0.53	0.73	<1	<1	<10	0.18	10.5	7.43	13.0	5.0
16-Jun-11		173	295444	0.49	0.73	<1	<1	10	0.20	10.5	7.37	14 0	0.5
17-Jun-11		173	295438	0.43	0 66	<1	<1	<10	0.26	9.1	7.06	15.0	6.0
16-Jun-11		174	295445	0.53	0 69	<1	<1	<10	0.23	8.3	7.33	13 0	2.5
17-Jun-11		174	295441	0.71	1.12	<1	<1	<10	0.43	8.9	7.42	10.0	2.5
16-Jun-11		174	295446	0.41	0.74	<1	<1	<10	0.18	9.0	7.38	50 0	10.0
17-Jun-11		174	295442	0.69	1 03	<1	<1	<10	0.16	9.3	7.31	13 0	5.0
17-Jun-11		184	295514	0.40	0 63	<1	<1	20	0.28	10.3	7.46	15 0	5.0
20-Jun-11		184	295508	0.50	0 62	<1	<1	70	0.24	11.5	7.43	13 0	2.5
17-Jun-11		184	295515	0.20	0 25	<1	<1	<10	0.62	10 5	7.80	13 0	4.0
20-Jun-11		184	295509	0.20	0 34	1	<1	20	0.20	12.3	7.46	13 0	3.0
23-Jun-11		184	296153	0.16	0.24	<1	<1	<10	0.29	NA	NA	NA	NA
24-Jun-11		184	296335	0.38	0 55	<1	<1	<10	0.23	NA	NA	NA	NA
17-Jun-11		179	295516	0.23	0.45	<1	1	40	0.30	8.6	7.43	13 0	5.0
17-Jun-11		179	295512	0.30	0 60	<1	<1	10	0.20	8.1	7.44	13.0	5.0

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100m L)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	Apparent Colour (acu)	True Colour (tcu)
17-Jun-11		179	295517	0.73	0 87	<1	<1	10	0.24	12.2	7.50	10 0	5.0
17-Jun-11		179	295513	0.73	0 87	<1	<1	<10	0.29	12.2	7.43	13.0	5.0
20-Jun-11		143	295685	0.64	0 80	<1	<1	<10	0.21	13.3	7.42	13 0	0.5
20-Jun-11		143	295679	0.28	0.48	<1	<1	<10	0.26	12.7	7.41	10.0	2.5
20-Jun-11		143	295686	0.50	0 66	<1	<1	<10	0.23	11.9	7.47	10 0	0.5
20-Jun-11		143	295680	0.65	0 83	<1	<1	20	0.23	13.3	7.48	10 0	2.0
20-Jun-11		145	295687	0.47	0 60	<1	<1	10	0.29	10.9	7.44	13 0	2.5
20-Jun-11		145	295683	0.59	0.74	<1	<1	<10	0.28	12.5	7.42	13.0	2.5
20-Jun-11		145	295688	0.20	0 32	<1	<1	<10	0.80	11.7	7.46	10 0	2.5
20-Jun-11		145	295684	0.48	0 64	<1	<1	<10	0.27	12.3	7.38	11.0	2.5
21-Jun-11		154	296044	0.39	0 62	<1	<1	<10	0.26	12.9	7.62	7.5	5.0
21-Jun-11		154	296038	0.39	0 50	<1	<1	<10	0.81	12.7	7.53	16 0	5.0
21-Jun-11		154	296045	0.29	0 53	<1	<1	<10	1.23	13.1	7.54	16 0	5.0
21-Jun-11		154	296039	0.43	0 57	<1	<1	<10	0.59	13.0	7.48	13 0	5.0
21-Jun-11		155	296046	0.23	0 37	<1	<1	<10	0.28	13.0	7.55	15 0	5.0
21-Jun-11		155	296042	0.64	0 81	<1	<1	<10	2.90	12.0	7.53	25.0	5.0
22-Jun-11		155	296089	NA	NA	NA	NA	NA	0.33	NA	NA	NA	NA
21-Jun-11		155	296047	0.25	0 39	<1	<1	<10	0.87	10.1	7.60	10 0	5.0
21-Jun-11		155	296043	0.51	0 65	<1	<1	<10	1.87	12.5	7.38	18.0	5.0
22-Jun-11		155	296088	NA	NA	NA	NA	NA	0.28	NA	NA	NA	NA
22-Jun-11		228	296077	0.52	0 62	<1	<1	<10	0.17	11.9	7.30	10.0	2.5
22-Jun-11		228	296071	0.60	0.73	<1	<1	<10	0.18	12.7	7.36	10 0	4.0
22-Jun-11		228	296078	0.60	0.75	<1	<1	20	0.19	11.4	7.32	10 0	5.0
22-Jun-11		228	296072	0.66	0 81	<1	<1	<10	0.16	12.1	7.36	10 0	2.5
22-Jun-11		229	296079	0.57	0.77	20	<1	50	0.24	15.3	7.39	10.0	2.5
22-Jun-11		229	296075	0.64	0 85	<1	<1	<10	0.16	15.4	7.41	5.0	2.0
22-Jun-11		229	296080	0.50	0 69	<1	<1	<10	0.22	11.1	7.26	10 0	2.5
22-Jun-11		229	296076	0.50	0.72	<1	<1	<10	0.16	11.5	7.43	7.5	2.5
23-Jun-11		238	296145	0.42	0 63	<1	<1	<10	0.43	9.6	7.46	13.0	3.0
23-Jun-11		238	296139	0.39	0 57	<1	<1	<10	0.23	11.9	7.36	13 0	2.5

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100m L)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	Apparent Colour (acu)	True Colour (tcu)
23-Jun-11		238	296146	0.30	0 52	<1	<1	<10	0.68	9.9	7.60	13 0	2.5
24-Jun-11		238	296140	0.42	0 66	<1	<1	<10	0.21	12.5	7.57	13.0	5.0
23-Jun-11		239	296147	0.38	0.48	<1	<1	<10	0.37	10.2	7.47	13.0	2.5
24-Jun-11		239	296143	0.38	0 60	<1	<1	<10	0.31	12.3	7.53	13.0	2.5
23-Jun-11		239	296148	0.37	0 53	<1	<1	<10	0.65	10.0	7.58	15.0	2.5
23-Jun-11		239	296144	0.39	0 61	<1	<1	<10	0.30	14.1	7.42	15.0	2.0
24-Jun-11		184	296330	0.34	0.45	<1	<1	<10	0.24	11.4	7.22	10.0	5.0
24-Jun-11		184	296324	0.38	0 56	<1	<1	<10	0.21	12.9	7.43	15 0	7.5
24-Jun-11		184	296331	0.37	0 54	<1	<1	<10	0.26	12.1	7.45	13 0	5.0
24-Jun-11		184	296325	0.40	0 55	<1	<1	10	0.23	13.3	7.56	15.0	5.0
24-Jun-11		185	296332	0.50	0 65	<1	<1	<10	5.59	13 3	7.40	130.0	7.5
24-Jun-11		185	296328	0.33	0 57	<1	<1	10	0.30	14.0	7.47	10.0	7.5
24-Jun-11		185	296333	0.63	0 86	<1	<1	<10	0.25	11 8	7.48	25 0	7.5
24-Jun-11		185	296329	0.40	0 62	<1	<1	<10	0.24	12.3	7.50	10.0	5.0
27-Jun-11		194	296375	0.59	0 81	<1	<1	<10	0.14	11 2	7.54	16 0	10.0
28-Jun-11		194	296369	0.37	0 56	<1	<1	<10	0.15	11.7	7.40	15 0	7.5
27-Jun-11		194	296376	0.51	0.73	1	1	40	0.21	13 3	7.45	16 0	10.0
27-Jun-11		194	296370	0.44	0 67	<1	<1	30	0.24	13.5	7.41	16 0	10.0
27-Jun-11		195	296377	0.55	0.78	<1	<1	20	0.15	12 2	7.44	14 0	10.0
27-Jun-11		195	296373	0.48	0.73	<1	<1	<10	0.23	13.8	7.44	15 0	10.0
27-Jun-11		195	296378	0.49	0 67	<1	<1	10	0.16	13.1	7.45	15 0	13.0
27-Jun-11		195	296374	0.46	0 62	<1	<1	20	0.20	13.5	7.29	13 0	7.5
28-Jun-11		206	296768	0.49	0.71	<1	<1	<10	0.28	13 3	7.52	13 0	5.0
28-Jun-11		206	296762	0.48	0.73	<1	<1	<10	0.17	12.7	7.40	15 0	7.5
28-Jun-11		206	296769	0.38	0 66	<1	<1	<10	0.26	9.8	7.45	15 0	7.5
28-Jun-11		206	296763	0.41	0 56	<1	<1	<10	0.15	9.9	7.36	15 0	5.0
28-Jun-11		205	296770	0.47	0 63	<1	<1	<10	0.21	10.1	7.50	15 0	5.0
28-Jun-11		205	296766	0.39	0 58	<1	<1	<10	0.15	9.8	7.44	15.0	10.0

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100m L)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	Apparent Colour (acu)	True Colour (tcu)
28-Jun-11		205	296771	0.44	0 60	<1	<1	<10	0.19	10.5	7.48	15 0	7.5
28-Jun-11		205	296767	0.47	0 57	<1	<1	<10	0.15	10.7	7.42	15.0	7.5
29-Jun-11		220	296816	0.40	0 61	<1	<1	60	0.28	10.1	7.50	18 0	7.5
29-Jun-11		220	296810	0.43	0 66	<1	<1	<10	0.18	9.9	7.49	15.0	5.0
29-Jun-11		220	296817	0.25	0.48	<1	<1	<10	0.36	11.0	7.46	18 0	7.5
29-Jun-11		220	296811	0.23	0.44	<1	<1	<10	0.17	11.6	7.47	13.0	7.5
29-Jun-11		221	296818	0.33	0 54	<1	<1	<10	0.19	11.3	7.45	16 0	7.5
29-Jun-11		221	296814	0.30	0 54	<1	<1	50	0.47	11.5	7.70	13 0	7.5
29-Jun-11		221	296819	0.29	0 50	<1	<1	430	0.22	12.7	7.48	16 0	10.0
30-Jun-11		221	296815	0.53	0.71	<1	<1	<10	0.17	13.3	7.39	10.0	2.5
30-Jun-11		230	296859	0.31	0.43	<1	<1	<10	0.29	14.5	7.49	13.0	2.5
30-Jun-11		230	296855	0.65	0 80	<1	<1	<10	0.22	15.7	7.46	13.0	5.0
30-Jun-11		230	296860	0.25	0.40	<1	<1	<10	0.39	14.9	7.41	15.0	2.0
30-Jun-11		230	296856	0.63	0.77	<1	<1	<10	0.28	16.4	7.47	10.0	5.0
30-Jun-11		231	296857	0.26	0 38	<1	<1	<10	0.38	13.5	7.48	13.0	3.0
30-Jun-11		231	296851	0.62	0 85	<1	<1	<10	0.50	16.2	7.51	13.0	5.0
30-Jun-11		231	296858	0.29	0.43	<1	<1	<10	0.20	13.7	7.40	15.0	2.5
30-Jun-11		231	296852	0.55	0.77	<1	<1	<10	0.48	15.5	7.36	13.0	5.0
4-Jul-11		247	297088	0.18	0 34	<1	<1	<10	0.34	12.8	7.44	10 0	1.0
5-Jul-11		247	297084	0.32	0 50	<1	<1	<10	0.24	13.5	7.44	7.5	2.5
4-Jul-11		246	297087	0.28	0.42	<1	<1	<10	0.19	11.8	7.44	15 0	2.0
5-Jul-11		246	297081	0.37	0.49	<1	<1	<10	0.24	13.1	7.41	7.5	0.5
4-Jul-11		247	297089	0.37	0.44	<1	<1	<10	0.32	11 5	7.47	7.5	2.5
5-Jul-11		247	297085	0.23	0.46	<1	<1	<10	0.26	10.8	7.53	7.5	0.5
4-Jul-11		246	297086	0.30	0.45	<1	<1	<10	0.74	12 0	7.39	10 0	0.5
5-Jul-11		246	297080	0.33	0.49	<1	<1	<10	0.29	13.3	7.44	10.0	1.0
5-Jul-11		333	297450	0.32	0 51	<1	<1	<10	0.19	14.4	7.39	10 0	0.5
5-Jul-11		333	297444	0.68	0.79	<1	<1	<10	0.30	15.1	7.37	10.0	0.5
5-Jul-11		333	297449	0.34	0 52	<1	<1	<10	0.20	14.1	7.41	5.0	0.5
5-Jul-11		333	297443	0.59	0.76	<1	<1	<10	0.18	16.0	7.44	5.0	0.5

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100m L)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	Apparent Colour (acu)	True Colour (tcu)
5-Jul-11		332	297451	0.41	0 57	<1	<1	<10	0.17	13.6	7.39	5.0	0.5
5-Jul-11		332	297447	0.71	0 88	<1	<1	<10	0.68	14.4	7.43	15 0	0.5
5-Jul-11		332	297452	0.32	0.42	<1	<1	140	0.18	14.1	7.47	3.0	0.5
5-Jul-11		332	297448	0.72	0 85	<1	<1	<10	0.42	13 9	7.42	7.5	0.5
6-Jul-11		262	297514	0.17	0 26	<1	<1	<10	0.34	12.8	7.36	10 0	0.5
6-Jul-11		262	297510	0.26	0 38	<1	<1	<10	0.42	13.4	7.37	5.0	0.5
6-Jul-11		262	297515	0.18	0 29	<1	<1	<10	0.39	13.3	7.49	10 0	2.0
6-Jul-11		262	297511	0.29	0 38	<1	<1	<10	0.34	12.9	7.52	7.5	2.0
6-Jul-11		261	297513	0.40	0.49	<1	<1	<10	0.18	15.1	7.35	7.5	2.5
6-Jul-11		261	297507	0.12	0 31	<1	<1	<10	0.54	15.4	7.46	10.0	1.0
6-Jul-11		261	297512	0.30	0 52	<1	<1	<10	0.18	15.0	7.31	5.0	0.5
7-Jul-11		261	297506	0.39	0 63	<1	<1	<10	0.48	15.1	7.30	13.0	NA[2]
7-Jul-11		275	297584	0.21	0 29	<1	<1	<10	0.25	11.8	7.45	7.5	NA[2]
8-Jul-11		275	297580	0.31	0.47	<1	<1	<10	0.30	13.1	7.40	5.0	NA[2]
7-Jul-11		275	297585	0.16	0 29	<1	<1	<10	0.23	11.5	7.42	10 0	NA[2]
8-Jul-11		275	297581	0.25	0 38	<1	<1	<10	0.20	12.8	7.41	10 0	NA[2]
7-Jul-11		272	297582	0.16	0 29	<1	<1	<10	0.23	13.1	7.47	10 0	NA[2]
8-Jul-11		272	297576	0.32	0.49	<1	<1	<10	0.32	14.9	7.41	7.5	NA[2]
7-Jul-11		272	297583	0.12	0 27	<1	<1	<10	0.29	12.6	7.41	5.0	NA[2]
8-Jul-11		272	297577	0.35	0.45	<1	<1	<10	0.34	15.1	7.40	10 0	NA[2]
8-Jul-11		280	297652	0.31	0 39	<1	<1	<10	0.27	10.8	7.42	10 0	NA[2]
11-Jul-11		280	297648	0.35	0 57	<1	<1	<10	0.23	12.2	7.58	5.0	NA[2]
8-Jul-11		280	297653	0.34	0.42	<1	<1	20	0.22	12.2	7.39	10.0	NA[2]
11-Jul-11		280	297649	0.40	0 66	<1	<1	<10	0.25	12.5	7.47	5.0	NA[2]
8-Jul-11		281	297650	0.24	0 37	<1	<1	<10	0.24	12.5	7.40	10 0	NA[2]
11-Jul-11		281	297644	0.43	0 55	<1	<1	<10	0.21	12.8	7.33	5.0	NA[2]
8-Jul-11		281	297651	0.30	0.44	<1	<1	<10	0.26	12.1	7.47	7.5	NA[2]
11-Jul-11		281	297645	0.33	0 52	<1	<1	<10	0.23	12.6	7.55	5.0	NA[2]

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	Apparent Colour (acu)	True Colour (tcu)
12-Jul-11		300	298176	0.41	0 63	<1	<1	<10	0.29	10.7	7.44	5.0	NA[2]
12-Jul-11		300	298170	0.46	0 64	<1	<1	<10	0.27	10.9	7.61	5.0	NA[2]
12-Jul-11		300	298177	0.38	0 60	<1	<1	250	0.22	10.3	7.48	5.0	NA[2]
12-Jul-11		300	298171	0.34	0 55	<1	<1	<10	0.28	11.5	7.56	5.0	NA[2]
12-Jul-11		301	298179	0.55	0 83	<1	<1	20	0.23	10.8	7.50	5.0	NA[2]
13-Jul-11		301	298175	0.62	0.78	<1	<1	<10	0.34	10.5	7.39	5.0	NA[2]
12-Jul-11		301	298178	0.23	0.40	<1	<1	<10	0.24	11.2	7.52	5.0	NA[2]
13-Jul-11		301	298174	0.25	0.40	<1	<1	<10	0.23	11.4	7.43	6.0	NA[2]
13-Jul-11		309	298204	0.62	0 88	<1	<1	<10	0.45	10.7	7.34	7.5	2.5
13-Jul-11		309	298198	0.65	0 90	<1	<1	<10	0.54	10.5	7.31	15.0	4.0
13-Jul-11		309	298205	0.71	0 89	<1	<1	<10	0.25	10.9	7.36	5.0	2.5
13-Jul-11		309	298199	0.74	0 93	<1	<1	<10	0.66	10.9	7.32	15.0	5.0
13-Jul-11		310	298207	0.47	0 56	<1	<1	<10	0.34	11.7	7.75	5.0	2.5
13-Jul-11		310	298203	0.43	0 58	<1	<1	<10	0.84	11.5	7.28	15.0	2.5
13-Jul-11		310	298206	0.34	0 58	<1	<1	<10	0.21	11 3	7.01	6.0	2.5
13-Jul-11		310	298202	0.31	0 50	<1	<1	<10	0.89	11.6	7.35	15.0	5.0
14-Jul-11		320	298257	0.56	0.77	<1	<1	<10	0.20	10 9	7.39	13 0	2.5
14-Jul-11		320	298251	0.48	0.78	<1	<1	<10	0.36	11.2	7.47	10 0	2.5
14-Jul-11		320	298256	0.69	0 85	<1	<1	<10	0.20	10.7	7.35	15 0	2.5
14-Jul-11		320	298250	0.65	0 87	<1	<1	<10	0.51	10.9	7.58	7.5	2.5
14-Jul-11		321	298258	0.38	0 56	<1	<1	<10	0.26	9.8	7.27	13 0	1.0
14-Jul-11		321	298254	0.37	0 53	<1	<1	<10	0.76	11.9	7.40	13.0	2.5
14-Jul-11		321	298259	0.33	0 50	<1	<1	<10	0.25	9.3	7.40	7.5	1.0
14-Jul-11		321	298255	0.28	0.47	<1	<1	<10	1.35	11.2	7.44	13.0	2.5
15-Jul-11		321	298353	NA	NA	NA	NA	NA	0.33	NA	NA	NA	NA
15-Jul-11		330	298350	0.70	0 88	<1	<1	<10	0.22	11.7	7.32	10 0	2.5
15-Jul-11		330	298346	0.73	0 89	<1	<1	<10	0.22	12.3	7.39	10 0	2.5
15-Jul-11		330	298351	0.70	0 93	<1	<1	<10	0.21	13.9	7.33	10 0	5.0
15-Jul-11		330	298347	0.66	0 84	<1	<1	<10	0.20	13.8	7.46	10 0	5.0

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	Apparent Colour (acu)	True Colour (tcu)
15-Jul-11		329	298349	0.63	0 86	<1	<1	<10	0.31	12.5	7.43	7.5	2.5
15-Jul-11		329	298343	0.68	0 82	<1	<1	10	0.32	12 9	7.39	10 0	2.5
15-Jul-11		329	298348	0.61	0 85	<1	<1	<10	0.19	11.8	7.38	10 0	2.5
15-Jul-11		329	298342	0.58	0 83	<1	<1	<10	0.44	12.7	7.31	15 0	5.0
18-Jul-11		360	298536	0.51	0 68	<1	<1	<10	0.28	15.1	7.54	5.0	0.5
18-Jul-11		360	298530	0.54	0.79	<1	<1	<10	0.52	19.6	7.64	16.0	2.5
18-Jul-11		360	298537	0.51	0 65	<1	<1	<10	0.24	18.0	7.46	7.5	2.5
18-Jul-11		360	298531	0.63	0.71	<1	<1	<10	0.37	20.2	7.45	18.0	5.0
18-Jul-11		361	298538	0.39	0 55	<1	<1	10	0.26	13.5	7.45	5.0	0.5
18-Jul-11		361	298534	0.61	0 81	<1	<1	<10	0.54	17.7	7.48	15 0	2.5
18-Jul-11		363	298539	0.24	0 39	<1	<1	<10	1.65	13 0	7.53	25 0	2.5
18-Jul-11		363	298535	0.30	0.46	<1	<1	<10	7.90	15.0	7.40	50.0	0.5
19-Jul-11		363	298912	NA	NA	NA	NA	NA	0.45	NA	NA	NA	NA
19-Jul-11		369	298907	0.54	0.72	<1	<1	<10	0.28	17.4	7.39	10.0	1.0
19-Jul-11		369	298901	0.81	0 91	<1	<1	<10	0.37	19.2	7.30	13.0	1.0
19-Jul-11		369	298908	0.53	0.72	<1	<1	<10	0.32	17.3	7.36	5.0	0.5
19-Jul-11		369	298902	0.74	0 88	<1	<1	<10	0.36	18.7	7.28	13.0	1.0
19-Jul-11		370	298909	0.66	0 88	<1	<1	<10	0.28	19.9	7.36	10.0	0.5
19-Jul-11		370	298905	0.65	0 83	<1	<1	<10	0.37	18.4	7.38	13 0	1.0
19-Jul-11		370	298906	0.70	0 86	<1	<1	<10	0.40	20.2	7.45	13 0	2.5
19-Jul-11		370	298910	0.66	0 81	<1	<1	<10	0.31	18.4	7.25	7.5	0.5
20-Jul-11		380	299052	0.61	0 81	<1	<1	<10	0.18	15.7	7.37	7.5	2.5
20-Jul-11		380	299048	0.43	0 69	<1	<1	<10	0.57	19.5	7.43	15.0	2.5
20-Jul-11		379	299049	0.68	0 88	<1	<1	<10	0.19	15.0	7.45	10.0	1.0
20-Jul-11		379	299043	0.53	0 69	<1	<1	<10	0.43	18.1	7.49	13 0	1.0
20-Jul-11		379	299050	0.54	0 84	<1	<1	<10	0.24	14.0	7.35	5.0	0.5
20-Jul-11		379	299044	0.65	0 82	<1	<1	<10	0.38	17.4	7.35	15 0	2.5
20-Jul-11		380	299051	0.54	0 83	<1	<1	<10	0.20	16.2	7.45	7.5	0.5
20-Jul-11		380	299047	0.52	0.71	<1	<1	<10	0.24	19.2	7.43	7.5	1.0

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	Apparent Colour (acu)	True Colour (tcu)
21-Jul-11		388	299102	0.26	0.41	<1	<1	<10	0.26	16.1	7.41	5.0	0.5
21-Jul-11		388	299096	0.27	0.43	<1	<1	<10	0.40	17.4	7.26	10.0	0.5
21-Jul-11		388	299103	0.31	0.44	<1	<1	<10	1.11	15.7	7.36	15.0	2.5
21-Jul-11		388	299097	0.22	0 39	<1	<1	<10	0.83	16.5	7.28	13.0	1.0
21-Jul-11		389	299104	0.35	0.48	<1	<1	<10	1.20	17.3	7.43	7.5	1.0
22-Jul-11		389	299100	0.40	0.73	<1	<1	<10	0.41	15.2	7.45	7.5	1.0
21-Jul-11		389	299105	0.37	0 50	<1	<1	<10	1.22	17.2	7.32	7.5	2.5
22-Jul-11		389	299101	0.38	0 56	<1	<1	<10	0.19	13.7	7.46	5.0	1.0
22-Jul-11		400	299131	0.30	0.46	<1	<1	<10	0.34	13.7	7.46	7.5	1.0
25-Jul-11		400	299125	0.31	0 52	<1	<1	<10	0.19	13.5	7.47	6.0	1.0
22-Jul-11		400	299132	0.26	0 36	<1	<1	<10	0.43	13.1	7.48	10 0	2.5
25-Jul-11		400	299126	0.31	0.48	<1	<1	<10	0.24	13.8	7.58	5.0	1.0
22-Jul-11		402	299134	0.35	0 50	<1	<1	<10	0.29	12.4	7.47	5.0	1.0
25-Jul-11		402	299130	0.47	0 66	<1	<1	10	0.52	12.6	7.07	6.0	1.0
22-Jul-11		402	299133	0.20	0 35	<1	<1	<10	0.47	12.7	7.53	5.0	0.5
25-Jul-11		402	299129	0.36	0 54	<1	<1	30	0.42	13.2	7.67	5.0	2.0
25-Jul-11		411	299345	0.63	0 97	<1	<1	<10	0.24	16.8	7.38	5.0	2.5
25-Jul-11		411	299341	0.67	1 03	<1	<1	<10	0.18	16.9	7.51	6.0	1.0
25-Jul-11		410	299344	0.73	1 00	1	<1	<10	0.57	14.7	7.36	5.0	2.0
25-Jul-11		410	299338	0.69	0 92	<1	<1	<10	0.37	15.3	7.41	5.0	1.0
25-Jul-11		410	299343	0.40	0 63	<1	<1	<10	0.29	14.5	7.30	5.0	2.5
25-Jul-11		410	299337	0.53	0 69	<1	<1	50	0.27	15.5	7.53	5.0	2.5
25-Jul-11		411	299346	0.55	0.75	<1	<1	<10	0.23	16.6	7.35	5.0	1.0
25-Jul-11		411	299342	0.60	0 81	<1	<1	<10	0.30	17.1	7.44	5.0	1.0
26-Jul-11		420	299664	0.58	0 83	<1	<1	<10	2.83	18.3	7.34	25.0	2.5
26-Jul-11		420	299660	0.64	0 87	<1	<1	<10	0.50	18.3	7.40	5.0	2.5
26-Jul-11		420	299663	0.30	0.47	<1	<1	<10	0.10	17.8	7.27	2.5	2.0
26-Jul-11		420	299659	0.31	0 55	<1	<1	<10	0.18	17.7	7.38	5.0	2.5
26-Jul-11		419	299661	0.36	0 55	<1	<1	<10	0.98	13.6	7.25	7.5	2.0
26-Jul-11		419	299655	0.42	0 60	<1	<1	<10	0.66	14.0	7.11	5.0	2.0

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	Apparent Colour (acu)	True Colour (tcu)
26-Jul-11		419	299662	0.44	0.79	<1	<1	<10	1.89	13.3	7.37	18.0	2.0
26-Jul-11		419	299656	0.48	0 82	<1	<1	<10	0.28	13.5	7.37	6.0	2.0
27-Jul-11		430	299726	0.30	0.45	<1	<1	<10	0.34	14.7	7.60	2.5	1.0
27-Jul-11		430	299720	0.28	0.47	1	<1	10	0.22	14.4	7.62	2.5	1.0
29-Jul-11		430	299838	0.45	0.68	<1	<1	20	0.28	15.1	NA	NA	NA
27-Jul-11		431	299728	0.15	0 27	<1	<1	<10	0.27	16.5	7.65	2.5	1.0
27-Jul-11		431	299724	0.16	0 32	<1	<1	10	0.29	16.7	7.61	2.5	1.0
27-Jul-11		431	299725	0.34	0.49	<1	<1	<10	0.61	17 2	7.52	2.5	1.0
27-Jul-11		431	299729	0.20	0 38	<1	<1	<10	0.40	16.7	7.50	2.5	1.0
27-Jul-11		430	299727	0.25	0.41	<1	<1	140	0.35	14.3	7.60	5.0	1.0
27-Jul-11		430	299721	0.22	0 36	<1	<1	340	0.24	14.3	7.53	2.5	1.0
28-Jul-11		441	299789	0.20	0.45	<1	<1	90	0.29	17 2	7.39	5.0	1.0
28-Jul-11		441	299783	0.22	0.43	<1	<1	<10	0.30	17.8	7.54	5.0	1.0
28-Jul-11		442	299791	0.44	0.71	<1	<1	<10	0.23	16.9	7.38	5.0	1.0
28-Jul-11		442	299787	0.56	0.78	<1	<1	30	0.38	17.2	7.30	5.0	1.0
28-Jul-11		442	299790	0.30	0 56	<1	<1	60	0.40	18.1	7.31	5.0	1.0
28-Jul-11		442	299786	0.32	0 61	<1	<1	20	0.74	18.7	7.41	5.0	2.5
28-Jul-11		441	299788	0.32	0.76	<1	<1	1400	0.63	18 9	7.37	2.5	1.0
28-Jul-11		441	299782	0.25	0 66	<1	<1	<10	0.73	19.1	7.19	5.0	1.0
2-Aug-11		441	300281	0.15	0 23	<1	<1	<10	0.40	19.7	NA	NA	NA
29-Jul-11		452	299834	0.49	0.73	<1	<1	<10	2.61	15.5	7.42	16 0	1.0
29-Jul-11		452	299830	0.43	0 69	<1	<1	<10	0.63	16.9	7.36	5.0	1.0
29-Jul-11		452	299835	0.23	0.41	<1	<1	<10	2.45	15.3	7.41	25 0	1.0
29-Jul-11		452	299831	0.25	0.44	<1	<1	<10	0.20	16.7	7.43	5.0	1.0
29-Jul-11		451	299832	0.42	0 68	<1	<1	<10	0.31	16.2	7.36	5.0	1.0
29-Jul-11		451	299826	0.49	0.73	<1	<1	<10	0.49	16.8	7.34	5.0	1.0
29-Jul-11		451	299833	0.27	0.43	<1	<1	<10	0.29	14.6	7.38	2.5	1.0
29-Jul-11		451	299827	0.35	0.46	<1	<1	<10	0.50	16.1	7.41	5.0	1.0
4-Aug-11		449	300397	0.40	0 55	<1	<1	<10	0.17	15.2	7.45	7.5	2.5
4-Aug-11		449	300391	0.41	0 54	<1	<1	<10	0.46	17.0	7.43	16.0	2.5

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100m L)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	Apparent Colour (acu)	True Colour (tcu)
4-Aug-11		449	300398	0.39	0 51	<1	<1	<10	0.21	17.5	7.50	5.0	1.0
4-Aug-11		449	300392	0.35	0 51	<1	<1	<10	0.62	19.1	7.49	15 0	2.5
4-Aug-11		450	300399	0.32	0 53	<1	<1	<10	0.25	15.7	7.57	7.5	2.5
4-Aug-11		450	300395	0.40	0 51	<1	<1	<10	0.41	18.6	7.54	13 0	2.5
4-Aug-11		450	300400	0.29	0 38	<1	<1	<10	0.25	15 3	7.53	7.5	2.0
4-Aug-11		450	300396	0.40	0 51	<1	<1	<10	0.49	18.0	7.56	10 0	2.5
5-Aug-11		460	300566	0.48	0 59	<1	<1	<10	0.18	15.4	7.60	10 0	1.0
5-Aug-11		460	300560	0.33	0 53	<1	<1	<10	0.37	16.5	7.58	15 0	2.5
5-Aug-11		460	300567	0.28	0.42	<1	<1	<10	0.17	17 2	7.56	13 0	2.0
5-Aug-11		460	300561	0.37	0 59	<1	<1	<10	0.40	17.0	7.61	15 0	2.5
5-Aug-11		461	300568	0.30	0.48	<1	<1	<10	0.21	17.1	7.53	13 0	2.5
5-Aug-11		461	300564	0.47	0.71	<1	<1	<10	0.44	16.9	7.51	16 0	5.0
5-Aug-11		461	300569	0.29	0.41	<1	<1	<10	0.24	16 5	7.71	13 0	0.5
5-Aug-11		461	300565	0.65	0.75	<1	<1	<10	0.45	18.3	7.65	16 0	2.5
8-Aug-11		500	300666	0.48	0 62	<1	<1	<10	0.18	16 6	7.55	5.0	1.0
9-Aug-11		500	300660	0.58	0.73	<1	<1	<10	0.34	17 2	7.46	5.0	1.0
8-Aug-11		500	300667	0.56	0 67	<1	<1	<10	0.20	17 3	7.74	5.0	1.0
9-Aug-11		500	300661	0.60	0.75	<1	<1	<10	0.59	17.7	7.68	5.0	2.5
8-Aug-11		501	300668	0.38	0 59	<1	<1	<10	0.22	18.6	7.70	5.0	2.0
9-Aug-11		501	300664	0.42	0 62	<1	<1	<10	0.33	18.0	7.59	5.0	2.0
8-Aug-11		501	300669	0.48	0 69	<1	<1	<10	0.19	17.9	7.48	5.0	2.5
9-Aug-11		501	300665	0.50	0.72	<1	<1	<10	0.44	17.6	7.52	5.0	1.0
9-Aug-11		500	301058	0.29	0 39	<1	<1	<10	0.24	17.4	7.64	6.0	2.5
10-Aug-11		500	301052	0.39	0 52	<1	<1	260	0.28	17 5	7.45	5.0	2.0
9-Aug-11		500	301057	0.24	0 36	<1	<1	<10	0.25	15.5	7.46	5.0	2.0
10-Aug-11		500	301051	0.32	0 51	<1	<1	<10	0.21	17.4	7.60	5.0	1.0
9-Aug-11		501	301059	0.45	0 58	<1	<1	<10	0.20	15.4	7.51	5.0	2.0
10-Aug-11		501	301055	0.43	0 63	1	<1	<10	0.22	16.6	7.53	5.0	2.0
15-Aug-11		501	301349	0.50	0.66	<1	<1	<10	NA	15.1	NA	NA	NA

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100m L)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	Apparent Colour (acu)	True Colour (tcu)
9-Aug-11		501	301060	0.48	0 61	<1	<1	10	0.21	15.0	7.46	4.0	1.0
10-Aug-11		501	301056	0.55	0 67	<1	<1	10	0.23	16.3	7.47	5.0	2.0
10-Aug-11		511	301108	0.11	0 22	<1	<1	<10	0.30	15 5	7.46	5.0	1.0
11-Aug-11		511	301102	0.05	0.19	<1	<1	<10	0.35	14.4	7.49	5.0	1.0
10-Aug-11		511	301109	0.12	0 22	<1	<1	<10	0.30	15 6	7.42	5.0	1.0
11-Aug-11		511	301103	0.06	0 20	<1	<1	<10	0.35	13.6	7.50	5.0	1.0
10-Aug-11		512	301111	0.15	0 21	<1	<1	<10	0.49	15.2	7.42	5.0	1.0
11-Aug-11		512	301107	0.10	0 20	<1	<1	10	0.41	14.3	7.43	5.0	2.0
10-Aug-11		512	301110	0.12	0 21	<1	<1	<10	0.30	14.4	7.45	5.0	1.0
11-Aug-11		512	301106	0.08	0.18	<1	<1	10	0.36	14.5	7.58	5.0	2.0
11-Aug-11		518	301153	0.10	0 21	<1	<1	<10	0.41	15 9	7.58	5.0	1.0
11-Aug-11		518	301147	0.09	0 24	<1	<1	<10	0.42	18.1	7.59	5.0	1.0
11-Aug-11		518	301152	0.11	0 22	1	<1	190	0.34	16 2	7.52	5.0	2.0
11-Aug-11		518	301146	0.08	0 26	<1	<1	<10	0.40	18 3	7.69	5.0	1.0
11-Aug-11		519	301154	0.08	0 25	<1	<1	<10	0.40	15 5	7.50	5.0	1.0
11-Aug-11		519	301150	0.12	0 26	<1	<1	10	0.39	17.3	7.60	5.0	1.0
11-Aug-11		519	301155	0.09	0 21	<1	<1	<10	0.39	15.7	7.50	5.0	1.0
11-Aug-11		519	301151	0.15	0 32	<1	<1	<10	0.37	18.0	7.68	5.0	2.0
12-Aug-11		530	301326	0.15	0 24	<1	<1	10	0.30	14 2	7.53	5.0	2.0
12-Aug-11		530	301320	0.14	0 24	<1	<1	<10	0.46	15.7	7.56	5.0	1.0
12-Aug-11		530	301327	0.12	0 24	<1	<1	<10	0.29	14 0	7.57	5.0	2.5
12-Aug-11		530	301321	0.11	0 21	<1	<1	20	0.61	15.3	7.49	5.0	2.0
12-Aug-11		531	301328	0.14	0 27	<1	<1	<10	0.30	16.1	7.78	5.0	2.0
12-Aug-11		531	301324	0.11	0 20	<1	<1	<10	0.56	15 9	7.77	5.0	2.0
12-Aug-11		531	301329	0.18	0 28	<1	<1	40	0.28	16 3	7.58	5.0	2.5
12-Aug-11		531	301325	0.15	0 25	<1	<1	<10	0.45	16.4	7.53	5.0	2.0
15-Aug-11		560	301344	0.35	0.50	<1	<1	<10	0.34	15 3	7.71	5.0	1.0
16-Aug-11		560	301338	0.31	0 52	<1	<1	<10	0.25	16.4	7.57	5.0	1.0
15-Aug-11		560	301345	0.39	0.57	<1	<1	<10	0.69	16.1	7.56	10 0	2.0
16-Aug-11		560	301339	0.30	0.48	<1	<1	<10	0.26	16 2	7.57	5.0	1.0

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	Apparent Colour (acu)	True Colour (tcu)
15-Aug-11		561	301346	0.48	0 59	<1	<1	50	0.30	15.9	7.53	5.0	2.5
16-Aug-11		561	301342	0.35	0 55	<1	<1	<10	0.23	16.4	7.58	5.0	2.0
15-Aug-11		561	301347	0.48	0 62	<1	<1	<10	0.33	16.1	7.57	5.0	2.0
16-Aug-11		561	301343	0.33	0 54	66	<1	2100	0.25	16.0	7.45	5.0	1.0
19-Aug-11		561	301858	0.32	0.44	<1	<1	<10	0.31	16.7	NA	NA	NA
16-Aug-11		572	301702	0.23	0 36	<1	<1	<10	0.24	14.4	7.64	6.0	2.0
17-Aug-11		572	301698	0.36	0 50	<1	<1	<10	0.20	14.7	7.62	5.0	2.5
16-Aug-11		572	301701	0.23	0.40	<1	<1	30	0.34	14.3	7.64	6.0	1.0
17-Aug-11		572	301697	0.35	0 52	<1	<1	<10	0.31	15.0	7.58	5.0	2.0
16-Aug-11		571	301699	0.29	0 38	4	<1	140	0.24	14.0	7.65	5.0	1.0
17-Aug-11		571	301693	0.24	0 36	<1	<1	<10	0.24	15.2	7.76	5.0	2.5
16-Aug-11		571	301700	0.18	0 29	<1	<1	<10	0.20	13 2	7.66	5.0	1.0
17-Aug-11		571	301694	0.32	0.44	<1	<1	<10	0.22	14.9	7.74	5.0	2.5
17-Aug-11		578	301748	0.10	0 21	<1	<1	<10	0.42	15 0	7.62	5.0	2.0
17-Aug-11		578	301742	0.11	0 27	<1	<1	<10	0.40	13.2	7.53	7.5	2.5
17-Aug-11		578	301749	0.11	0 22	<1	<1	<10	0.27	16.2	7.61	5.0	2.5
17-Aug-11		578	301743	0.13	0 24	<1	<1	<10	0.32	14.6	7.55	5.0	2.5
17-Aug-11		579	301750	0.13	0 23	<1	<1	<10	0.26	15.5	7.62	5.0	2.5
17-Aug-11		579	301746	0.18	0 26	<1	<1	<10	0.70	14.7	7.67	15.0	2.5
17-Aug-11		579	301751	0.12	0 25	<1	<1	<10	0.27	16.0	7.53	5.0	2.5
17-Aug-11		579	301747	0.14	0 28	<1	<1	<10	0.35	15.0	7.43	5.0	2.5
18-Aug-11		588	301819	0.10	0 23	<1	<1	<10	0.29	14 6	7.67	5.0	2.0
19-Aug-11		588	301813	0.18	0 32	<1	<1	<10	0.30	15.0	7.81	5.0	1.0
18-Aug-11		588	301820	0.14	0 20	<1	<1	<10	0.28	13 6	7.63	5.0	2.5
19-Aug-11		588	301814	0.16	0 31	<1	<1	<10	0.31	14.0	7.73	5.0	2.0
18-Aug-11		589	301821	0.11	0.18	<1	<1	<10	0.33	14 6	7.71	5.0	2.5
19-Aug-11		589	301817	0.12	0 22	<1	<1	<10	0.40	14.6	7.77	5.0	1.0
18-Aug-11		589	301822	0.12	0 20	2	<1	<10	0.33	15.5	7.63	5.0	2.5
19-Aug-11		589	301818	0.13	0 22	<1	<1	<10	0.39	14.7	7.74	5.0	1.0

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	Apparent Colour (acu)	True Colour (tcu)
19-Aug-11		595	301831	0.11	0 22	<1	<1	<10	0.34	14.2	7.61	7.5	1.0
19-Aug-11		595	301825	0.11	0.19	<1	<1	<10	0.30	13.8	7.61	5.0	1.0
19-Aug-11		595	301832	0.11	0 23	<1	<1	<10	0.30	14.4	7.64	5.0	1.0
19-Aug-11		595	301826	0.11	0 23	<1	<1	<10	0.45	14.4	7.62	7.5	1.0
19-Aug-11		596	301834	0.12	0 21	<1	<1	<10	0.32	14.4	7.54	5.0	1.0
19-Aug-11		596	301830	0.10	0 22	<1	<1	<10	0.31	15.0	7.56	5.0	1.0
19-Aug-11		596	301833	0.12	0 20	<1	<1	<10	0.31	14 8	7.70	5.0	1.0
19-Aug-11		596	301829	0.12	0 24	<1	<1	<10	0.32	14.5	7.61	5.0	1.0
22-Aug-11		609	302072	0.55	0.73	<1	<1	<10	2.71	20.5	7.55	18.0	2.0
23-Aug-11		609	302066	0.39	0 64	<1	<1	<10	0.18	20.5	7.43	5.0	2.0
22-Aug-11		609	302071	0.61	0.79	<1	<1	<10	0.26	20.6	7.41	5.0	1.0
23-Aug-11		609	302065	0.50	0.72	<1	<1	<10	0.21	19.4	7.35	5.0	2.0
22-Aug-11		613	302074	0.45	0 67	<1	<1	40	0.21	20.9	7.52	7.5	2.0
23-Aug-11		613	302070	0.49	0 63	<1	<1	<10	0.19	21.0	7.46	5.0	1.0
22-Aug-11		613	302073	0.49	0 65	<1	<1	20	0.66	22 2	7.48	10 0	2.0
23-Aug-11		613	302069	0.45	0 67	<1	<1	<10	0.18	20.2	7.43	5.0	2.0
23-Aug-11		619	302471	0.53	0.76	118	<1	<10	0.45	18.1	7.49	7.5	2.0
24-Aug-11		619	302465	0.59	0.74	<1	<1	<10	0.17	17.5	7.06	5.0	2.0
23-Aug-11		619	302470	0.46	0 86	<1	<1	20	0.20	17.5	7.52	5.0	2.0
24-Aug-11		619	302464	0.62	0.76	<1	<1	<10	0.19	17.3	7.00	5.0	1.0
23-Aug-11		621	302472	0.47	0 60	<1	<1	<10	0.17	18.3	7.54	5.0	1.0
24-Aug-11		621	302468	0.45	0 65	<1	<1	<10	0.24	18.0	7.01	5.0	1.0
23-Aug-11		621	302473	0.44	0 61	1	<1	390	0.18	18.0	7.55	5.0	2.0
24-Aug-11		621	302469	0.49	0 66	<1	<1	<10	0.25	17.3	7.06	5.0	1.0
24-Aug-11		631	302518	0.37	0 54	<1	<1	<10	0.15	17.4	7.05	5.0	1.0
25-Aug-11		631	302512	0.35	0 58	<1	<1	<10	0.21	15.7	7.41	5.0	2.0
24-Aug-11		631	302519	0.45	0 60	<1	<1	10	0.15	16.7	7.10	5.0	1.0
25-Aug-11		631	302513	0.41	0 61	<1	<1	<10	0.17	16.2	7.38	5.0	1.0
24-Aug-11		632	302520	0.31	0.49	<1	<1	<10	0.15	16.6	7.03	5.0	2.0
25-Aug-11		632	302516	0.36	0 52	<1	<1	<10	0.21	15.9	7.23	6.0	2.0

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	Apparent Colour (acu)	True Colour (tcu)
24-Aug-11		632	302521	0.38	0 57	<1	<1	<10	0.15	17.4	7.01	6.0	2.0
25-Aug-11		632	302517	0.40	0 58	<1	<1	<10	0.30	16.3	7.28	5.0	1.0
25-Aug-11		638	302542	0.72	0 91	<1	<1	<10	0.16	18 3	7.27	5.0	1.0
26-Aug-11		638	302536	0.68	0 85	<1	<1	<10	0.17	16.8	7.47	7.5	2.5
25-Aug-11		638	302543	0.82	0 97	<1	<1	<10	0.19	18 5	7.28	6.0	2.0
26-Aug-11		638	302537	0.73	0 89	<1	<1	<10	0.19	17.4	7.41	7.5	2.0
25-Aug-11		639	302544	0.49	0 68	<1	<1	<10	0.20	19.1	7.32	5.0	1.0
26-Aug-11		639	302540	0.51	0 68	<1	<1	<10	0.18	18.3	7.54	7.5	2.5
25-Aug-11		639	302545	0.49	0 69	<1	<1	<10	0.26	18 8	7.38	6.0	1.0
26-Aug-11		639	302541	0.62	0.76	<1	<1	<10	0.20	18.8	7.39	6.0	2.5
26-Aug-11		606	302803	0.11	0.17	<1	<1	1600	0.28	13.7	7.48	6.0	2.5
29-Aug-11		606	302797	0.04	0.16	<1	<1	100	0.30	13.7	7.32	5.0	1.0
26-Aug-11		606	302804	0.08	0.16	<1	<1	<10	0.27	13.3	7.47	7.5	2.5
29-Aug-11		606	302798	<0.02	0.12	<1	<1	470	0.27	13.4	7.49	5.0	1.0
26-Aug-11		607	302805	0.05	0.17	<1	<1	10	0.29	13.3	7.45	6.0	2.5
29-Aug-11		607	302801	<0.02	0.14	<1	<1	10	0.26	13.2	7.46	6.0	1.0
26-Aug-11		607	302806	0.07	0.18	<1	<1	<10	0.24	13.2	7.34	6.0	2.5
29-Aug-11		607	302802	0.02	0.10	<1	<1	<10	0.28	13.0	7.47	6.0	1.0
29-Aug-11		647	302821	0.62	0.76	<1	<1	<10	0.41	17.7	7.54	6.0	1.0
30-Aug-11		647	302815	0.82	0 96	<1	<1	<10	0.20	18.5	7.17	6.0	2.0
29-Aug-11		647	302822	0.52	0 65	<1	<1	30	0.30	17.5	7.51	6.0	1.0
30-Aug-11		647	302816	0.76	0 89	<1	<1	<10	0.23	18.0	7.26	6.0	2.0
29-Aug-11		648	302823	0.48	0.71	<1	<1	<10	0.28	17.8	7.54	5.0	1.0
30-Aug-11		648	302819	0.72	0 86	<1	<1	<10	0.23	18.1	7.30	6.0	1.0
29-Aug-11		648	302824	0.50	0 69	<1	<1	<10	0.36	17.6	7.48	5.0	1.0
30-Aug-11		648	302820	0.70	0 83	<1	<1	<10	0.25	18.3	7.30	6.0	1.0
30-Aug-11		661	303186	0.56	0.74	<1	<1	<10	0.24	17.6	7.38	7.5	2.0
31-Aug-11		661	303180	0.24	0.48	<1	<1	<10	0.22	18.5	7.32	7.5	1.5

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	Apparent Colour (acu)	True Colour (tcu)
30-Aug-11		661	303187	0.59	0.75	<1	<1	<10	0.36	17.8	7.39	7.5	2.0
31-Aug-11		661	303181	0.18	0.46	<1	<1	<10	0.23	18.3	7.37	8.0	1.5
30-Aug-11		663	303188	0.54	0.76	<1	<1	<10	0.24	18 3	7.36	6.0	2.0
31-Aug-11		663	303184	0.68	0 88	<1	<1	<10	0.19	19.1	7.35	7.5	2.0
30-Aug-11		663	303189	0.50	0.72	<1	<1	<10	0.21	18 5	7.51	6.0	2.0
31-Aug-11		663	303185	0.69	0 90	<1	<1	<10	0.20	19 0	7.51	7.5	2.5
31-Aug-11		670	303253	0.79	0 93	<1	<1	<10	0.49	17.8	7.38	7.5	2.0
1-Sep-11		670	303247	0.81	0 96	<1	<1	<10	0.20	18 8	7.17	5.0	1.0
31-Aug-11		670	303254	0.76	0.91	<1	<1	10	0.45	17 3	7.42	10 0	2.5
1-Sep-11		670	303248	0.82	0 99	<1	<1	<10	0.16	18 6	7.35	5.0	1.0
31-Aug-11		671	303255	0.53	0 67	<1	<1	20	0.41	18.8	7.44	8.5	1.5
1-Sep-11		671	303251	0.72	0 86	<1	<1	<10	0.22	18 3	7.48	5.0	1.0
31-Aug-11		671	303256	0.50	0 65	<1	<1	<10	0.42	18.9	7.42	10 0	2.0
1-Sep-11		671	303252	0.65	0.79	<1	<1	<10	0.21	18 6	7.40	5.0	1.0
01-Sep-11		680	303422	0.42	0.55	<1	<1	<10	0.29	17.1	7.54	6.0	1.0
02-Sep-11		680	303416	0.46	0 60	<1	<1	70	0.21	17 3	7.26	5.0	1.0
01-Sep-11		680	303423	0.44	0.59	<1	<1	<10	0.21	16 8	7.57	5.0	1.0
02-Sep-11		680	303417	0.45	0 67	<1	<1	<10	0.21	16 9	7.41	6.0	1.0
01-Sep-11		681	303424	0.47	0 63	<1	<1	<10	0.30	16.7	7.55	5.0	1.0
02-Sep-11		681	303420	0.42	0 64	<1	<1	<10	0.41	16.7	7.45	5.0	1.0
01-Sep-11		681	303425	0.44	0 61	<1	<1	<10	0.28	16 9	7.57	7.5	1.0
02-Sep-11		681	303421	0.44	0 64	<1	<1	<10	0.39	16 6	7.40	6.0	1.0
02-Sep-11		690	303587	0.63	0.77	<1	<1	<10	0.17	19.1	7.36	6.0	1.0
06-Sep-11		690	303581	0.73	1 03	<1	<1	<10	0.17	18.3	7.32	6.0	1.0
02-Sep-11		690	303588	0.69	0 88	<1	<1	<10	0.17	19.3	7.39	5.0	1.0
06-Sep-11		690	303582	0.70	1 02	<1	<1	10	0.17	18 6	7.39	6.0	2.0
02-Sep-11		691	303589	0.62	0 83	<1	<1	<10	0.19	18.3	7.40	5.0	1.0
07-Sep-11		691	303585	0.77	0 90	<1	<1	<10	0.19	19.0	7.31	5.0	1.0
02-Sep-11		691	303590	0.79	0 94	<1	<1	10	0.19	18.0	7.41	5.0	1.0
07-Sep-11		691	303586	0.73	0 85	<1	<1	<10	0.20	19.1	7.34	5.0	1.0

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	Apparent Colour (acu)	True Colour (tcu)
06-Sep-11		728	303924	0.43	0 62	<1	<1	10	0.21	17.8	7.45	5.0	1.0
07-Sep-11		728	303918	0.63	0 80	<1	<1	<10	0.26	17.4	7.48	5.0	1.0
06-Sep-11		728	303925	0.59	0.77	<1	<1	<10	0.23	18.0	7.45	5.0	1.0
07-Sep-11		728	303919	0.56	0.73	<1	<1	<10	0.26	17.9	7.35	5.0	1.0
06-Sep-11		729	303926	0.32	0 54	<1	<1	<10	0.21	17.9	7.42	5.0	2.0
07-Sep-11		729	303922	0.57	0.78	<1	<1	<10	0.23	18.0	7.31	6.0	2.0
06-Sep-11		729	303927	0.36	0 59	<1	<1	<10	0.17	18.2	7.45	5.0	2.0
07-Sep-11		729	303923	0.70	0 92	<1	<1	<10	0.24	17.6	7.31	6.0	2.0
07-Sep-11		742	304008	0.49	0 65	<1	<1	<10	0.24	18.0	7.44	5.0	1.0
09-Sep-11		742	304002	0.68	0 93	<1	<1	<10	0.18	18.7	7.46	5.0	1.0
07-Sep-11		742	304009	0.57	0.72	<1	<1	<10	0.29	17.7	7.30	6.0	2.0
09-Sep-11		742	304003	0.71	0 91	<1	<1	<10	0.22	17.6	7.38	5.0	1.0
07-Sep-11		743	304010	0.68	0 87	<1	<1	<10	0.25	17.1	7.29	5.0	1.0
09-Sep-11		743	304006	0.68	0 95	<1	<1	<10	0.18	18.0	7.54	5.0	1.0
07-Sep-11		743	304011	0.70	0 95	<1	<1	10	0.21	17.3	7.32	5.0	1.0
09-Sep-11		743	304007	0.70	0 93	<1	<1	<10	0.20	17.7	7.52	5.0	1.0
09-Sep-11		758	304057	0.69	0 91	<1	<1	<10	0.23	17.4	7.43	5.0	1.0
12-Sep-11		758	304051	0.61	0.74	<1	<1	<10	0.21	17.2	7.34	5.0	1.0
09-Sep-11		758	304058	0.65	0 87	<1	<1	<10	0.20	17.9	7.49	5.0	1.0
12-Sep-11		758	304052	0.64	0.79	<1	<1	<10	0.22	16.8	7.39	5.0	1.0
09-Sep-11		759	304059	0.78	0 91	<1	<1	<10	0.17	16 5	7.45	5.0	1.0
12-Sep-11		759	304055	0.45	0 60	<1	<1	<10	0.21	16.9	7.48	8.0	1.0
09-Sep-11		759	304060	0.72	0 88	<1	<1	<10	0.30	16 6	7.48	6.0	1.0
12-Sep-11		759	304056	0.42	0 61	<1	<1	<10	0.23	17.5	7.57	10 0	1.0
12-Sep-11		768	304238	0.72	0 91	<1	<1	<10	0.22	17.7	7.59	5.0	1.0
13-Sep-11		768	304232	0.56	0.73	<1	<1	40	0.19	17.2	7.36	5.0	1.0
12-Sep-11		768	304239	0.76	0 98	<1	<1	<10	0.25	17 9	7.52	5.0	1.0
13-Sep-11		768	304233	0.58	0.76	<1	<1	<10	0.21	16 5	7.42	5.0	1.0
12-Sep-11		770	304240	0.61	0.79	<1	<1	<10	0.17	17 3	7.47	7.5	1.0
13-Sep-11		770	304236	0.77	0 93	<1	<1	<10	0.19	18.2	7.56	5.0	1.0

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100m L)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	Apparent Colour (acu)	True Colour (tcu)
12-Sep-11		770	304241	0.61	0.78	<1	<1	<10	0.17	17.4	7.59	6.0	1.0
13-Sep-11		770	304237	0.75	0 92	<1	<1	<10	0.23	18.0	7.60	6.0	1.0
13-Sep-11		777	304628	0.46	0 63	<1	<1	<10	0.26	17 9	7.49	5.0	1.0
14-Sep-11		777	304622	0.61	0.77	<1	<1	<10	0.25	18.0	7.47	5.0	1.0
13-Sep-11		777	304629	0.30	0.49	<1	<1	10	0.26	17.6	7.54	5.0	1.0
14-Sep-11		777	304623	0.48	0 65	<1	<1	<10	0.28	17.9	7.43	6.0	1.0
13-Sep-11		778	304630	0.64	0 86	<1	<1	<10	0.22	17.9	7.47	5.0	1.0
16-Sep-11		778	304626	0.68	0 92	<1	<1	<10	0.34	18.2	7.46	5.0	1.0
13-Sep-11		778	304631	0.70	0 89	<1	<1	<10	0.18	17.8	7.55	5.0	1.0
16-Sep-11		778	304627	0.70	0 95	<1	<1	<10	0.29	18.0	7.51	5.0	1.0
14-Sep-11		788	304695	0.69	0 93	<1	<1	<10	0.37	18.0	7.53	7.5	1.0
19-Sep-11		788	304689	0.65	0 86	<1	<1	<10	0.20	18.4	7.52	5.0	1.0
14-Sep-11		788	304696	0.77	0 98	<1	<1	<10	0.23	18.2	7.42	6.0	1.0
19-Sep-11		788	304690	0.69	0 88	<1	<1	<10	0.21	18.2	7.52	5.0	1.0
14-Sep-11		794	304697	0.69	0 85	<1	<1	<10	0.32	18 5	7.44	7.5	1.0
16-Sep-11		794	304693	0.71	0 86	<1	<1	10	0.21	18.1	7.52	5.0	1.0
14-Sep-11		794	304698	0.72	0 88	<1	<1	<10	1.07	18 3	7.44	7.5	1.0
16-Sep-11		794	304694	0.69	0 85	<1	<1	<10	0.24	17.7	7.45	5.0	1.0
16-Sep-11		804	304732	0.62	0 84	<1	<1	20	0.24	17 2	7.56	6.0	1.0
19-Sep-11		804	304726	0.77	0 92	<1	<1	<10	0.21	16 5	7.52	5.0	1.0
16-Sep-11		804	304733	0.58	0 81	<1	<1	<10	0.27	17.5	7.50	5.0	1.0
19-Sep-11		804	304727	0.73	0 89	<1	<1	10	0.25	17.0	7.60	5.0	1.0
16-Sep-11		805	304734	0.44	0 58	<1	<1	<10	0.25	17 2	7.55	5.0	1.0
19-Sep-11		805	304730	0.56	0.75	<1	<1	<10	0.22	17.5	7.52	5.0	1.0
16-Sep-11		805	304735	0.47	0 63	<1	<1	<10	2.34	17.4	7.54	25 0	1.0
19-Sep-11		805	304731	0.53	0.72	<1	<1	<10	0.24	17.9	7.48	5.0	1.0
28-Sep-11		547	305567	0.13	0 26	<1	<1	10	0.21	14.5	7.71	5.0	1.0
28-Sep-11		547	305596	0.52	0 67	<1	<1	10	0.31	13.8	7.61	6.0	1.0
28-Sep-11		548	305568	0.54	0.71	<1	<1	<10	0.53	13.4	7.50	10.0	1.0
28-Sep-11		548	305570	0.26	0.41	<1	<1	<10	0.27	11.7	7.26	5.0	1.0

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	Apparent Colour (acu)	True Colour (tcu)
28-Sep-11		548	305569	0.36	0 52	<1	<1	<10	0.33	13.5	7.66	5.0	1.0
28-Sep-11		548	305571	0.31	0.46	<1	<1	<10	0.31	13 9	7.54	5.0	1.0
28-Sep-11		548	305597	0.31	0.45	<1	<1	<10	0.22	14 3	7.64	5.0	1.0
28-Sep-11		548	305598	0.33	0 55	<1	<1	<10	0.35	13.7	7.53	5.0	1.0

NR - No result NA - Not analyzed

Comments:

1 - After 'A few days Post Flush' sampling was completed at 531 Almey it was determined that the home has a water filtration system, so an alternative sample was taken at 385 Almey on June 24.

2 - True color not analysed due to lab error.

3 - Locations sampled as part of the ongoing investigation for NE09 Kildare Ave. and McMeans St. The chlorine set point was increased and additional testing was conducted in the immediate area . The free chlorine levels in the surrounding areas increased and continued to meet the compliance limit. A few closed and broken valves were found which may have contributed to the low chlorine results.

No re-sample collected when a pre-flush sample test positive for bacti and the post-flush is negative.

2012 Water Main Cleaning Program

Laboratory Analysis Report Household Monitoring

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
7-May-12		31	324524	0.51	0 69	<1	<1	<10	0.22	7.5	7.82	1.0
8-May-12		31	324518	0.54	0.70	<1	<1	<10	0.17	8.5	7.42	1.5
7-May-12		31	324525	0.56	0.79	<1	<1	<10	1.22	7.7	7.54	2.0
8-May-12		31	324519	0.70	0 94	<1	<1	<10	0.20	9.2	7.47	2.0
7-May-12		32	324527	0.43	0.57	<1	<1	<10	0.26	7.9	7.72	1.0
8-May-12		32	324523	0.64	0 86	<1	<1	<10	0.23	8.8	7.48	2.0
7-May-12		32	324526	0.37	0.58	<1	<1	<10	0.27	7.8	7.83	1.0
8-May-12		32	324522	0.73	0 89	<1	<1	<10	0.27	8.9	7.45	2.0
8-May-12		40	325049	0.68	0 91	<1	<1	<10	0.16	10.0	7.46	1.0
9-May-12		40	325043	0.57	0.71	<1	<1	<10	0.20	9.1	7.45	1.0
8-May-12		40	325048	0.50	0.72	<1	<1	<10	0.15	10.5	7.47	1.5
9-May-12		40	325042	0.53	0 68	<1	<1	<10	0.22	9.0	7.42	1.0
8-May-12		41	325050	0.86	1 01	<1	<1	<10	0.19	8.7	7.47	1.5
9-May-12		41	325046	0.80	0 98	<1	<1	<10	0.39	8.8	7.46	1.0
8-May-12		41	325051	0.84	0 98	<1	<1	<10	0.28	9.4	7.47	1.0
9-May-12		41	325047	0.64	0 82	<1	<1	<10	0.25	8.9	7.58	1.0
9-May-12		48	325101	0.77	0 94	<1	<1	<10	0.60	10.1	7 54	1.0
10-May-12		48	325095	0.83	1 01	<1	<1	<10	0.16	10.2	7 33	1.0
9-May-12		48	325102	0.74	0 91	<1	<1	<10	0.28	10.3	7 53	1.0
10-May-12		48	325096	0.84	0 98	<1	<1	<10	0 22	10.6	7.48	1.0
9-May-12		49	325104	0.92	1.11	<1	<1	<10	0.16	11.2	7.73	1.0
10-May-12		49	325100	0.94	1.10	<1	<1	<10	0.18	12.1	7 52	2.0
9-May-12		49	325103	0.84	1 06	<1	<1	<10	0.17	11.4	7 54	1.0
10-May-12		49	325099	0.94	1 08	<1	<1	<10	0.27	11.9	7.42	1.0

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
10-May-12		56	325141	0.52	0.73	<1	<1	<10	0.18	9.4	7.42	1.0
11-May-12		56	325135	0.75	0 92	<1	<1	<10	0.20	6.9	7.42	1.5
10-May-12		56	325140	0.73	0 90	<1	<1	<10	0.13	6.9	7.39	1.0
11-May-12		56	325134	0.53	0 66	<1	<1	<10	0.18	8.7	7.45	2.0
10-May-12		59	325143	0.92	1.10	<1	<1	<10	0.17	9.9	7.55	2.0
14-May-12		59	325139	1.03	1.15	<1	<1	<10	0.99	9.8	7.46	2.0
10-May-12		59	325142	0.87	1 02	<1	<1	<10	0.19	10.4	7.52	1.0
14-May-12		59	325138	1.09	1 28	<1	<1	<10	0.42	9.8	7.47	1.0
11-May-12		64	325195	0.79	1 06	<1	<1	<10	0.17	8.9	7.44	1.0
14-May-12		64	325189	1.02	1.19	<1	<1	<10	0.44	9.1	7 38	1.0
11-May-12		64	325196	0.77	1 01	<1	<1	<10	0.16	8.5	7.42	2.0
14-May-12		64	325190	1.03	1.19	<1	<1	<10	0.26	8.8	7 39	1.0
11-May-12		65	325197	0.70	0 92	<1	<1	<10	0.15	6.5	7.39	1.0
14-May-12		65	325193	1.05	1 22	<1	<1	<10	0.74	8.8	7 37	1.0
11-May-12		65	325198	0.82	0 97	<1	<1	<10	0.29	7.3	7.36	1.0
14-May-12		65	325194	1.14	1 27	<1	<1	<10	0.34	9.0	7.41	2.0
14-May-12		94	325359	0.89	1 00	<1	<1	<10	0.20	7.9	7.42	1.0
15-May-12		94	325353	0.70	0 91	<1	<1	<10	0.22	8.3	7.44	1.5
14-May-12		94	325360	0.87	0 99	<1	<1	<10	0.24	7.8	7.46	1.0
15-May-12		94	325354	0.73	0 92	<1	<1	<10	0.19	8.1	7.49	1.0
14-May-12		95	325361	0.81	0 97	<1	<1	<10	0.36	7.8	7.41	1.0
15-May-12		95	325357	0.83	0 97	<1	<1	<10	0.21	9.0	7 56	1.0
14-May-12		95	325362	0.89	1 02	<1	<1	<10	0.15	8.7	7.56	1.0
15-May-12		95	325358	0.85	0 98	<1	<1	<10	0.16	8.8	7 58	1.5
15-May-12		101	325403	0.75	0 97	<1	<1	<10	0.27	7.8	7.45	2.5
16-May-12		101	325397	0.74	0 92	<1	<1	<10	0.21	8.9	7.33	2.0
15-May-12		101	325404	0.85	0.97	<1	<1	<10	0.19	7.3	7.51	2.0
16-May-12		101	325398	0.78	0 98	<1	<1	<10	0.19	8.8	7.43	1.0
15-May-12		102	325405	0.71	0.85	<1	<1	<10	1.07	9.8	7.61	2.0
16-May-12		102	325401	0.75	0 94	<1	<1	<10	0.20	9.1	7 51	2.0

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
15-May-12		102	325406	0.76	0 90	<1	<1	<10	0.84	9.2	7.62	2.5
16-May-12		102	325402	0.76	0 92	<1	<1	<10	0.22	9.2	7.55	2.0
16-May-12		113	325812	0.96	1.12	<1	<1	<10	0.22	8.8	7 67	1.0
17-May-12		113	325806	0.92	1 07	<1	<1	10	0.19	9.4	7.54	1.5
16-May-12		113	325811	0.95	1 09	<1	<1	<10	0.22	8.9	7.53	1.0
17-May-12		113	325805	0.90	1 08	<1	<1	<10	0.24	9.5	7.39	2.0
16-May-12		114	325814	0.91	1 06	<1	<1	<10	0.18	9.4	7 69	1.0
17-May-12		114	325810	0.84	0 97	<1	<1	20	0.23	10.5	7.60	1.0
16-May-12		114	325813	0.88	1 03	<1	<1	<10	0.21	9.6	7 62	1.0
17-May-12		114	325809	0.87	1 01	<1	<1	<10	0.23	10.2	7.50	1.0
17-May-12		130	325872	0.67	0 92	<1	<1	<10	0.22	9.0	7.52	1.0
18-May-12		130	325866	0.67	0 80	<1	<1	<10	0.17	10.0	7.42	1.0
17-May-12		130	325871	0.73	0 94	<1	<1	10	0.22	9.2	7 56	1.0
18-May-12		130	325865	0.69	0 89	<1	<1	<10	0.17	10.4	7 38	1.0
17-May-12		131	325873	0.68	0 84	<1	<1	<10	0.24	8.9	7 52	1.0
18-May-12		131	325869	0.90	1.11	<1	<1	<10	0.19	9.9	7.37	1.0
17-May-12		131	325874	0.80	1.03	<1	<1	30	0.14	9.1	7.50	1.5
18-May-12		131	325870	1.01	1.14	<1	<1	30	0.20	10.3	7.39	1.0
18-May-12		139	325916	0.70	0 84	NA	NA	NA	0.15	9.0	7.37	1.0
22-May-12		139	325910	0.80	1 03	<1	<1	<10	0.17	11.0	7.22	1.0
18-May-12		139	325917	0.66	0 89	NA	NA	NA	0.15	8.8	7.34	1.0
22-May-12		139	325911	0.90	1 06	<1	<1	<10	0.15	11.0	7.24	1.0
18-May-12		140	325918	0.49	0 68	NA	NA	NA	0.16	8.2	7.42	1.0
22-May-12		140	325914	0.87	1 04	<1	<1	<10	0.15	11.1	7.33	1.5
18-May-12		140	325919	0.64	0.78	NA	NA	NA	0.19	8.7	7 36	1.0
22-May-12		140	325915	0.94	1.11	<1	<1	<10	0.16	10.8	7.32	1.0
22-May-12		186	326070	0.19	0.31	<1	<1	10	1.97	8.7	7.31	1.0
23-May-12		186	326064	0.57	0.75	<1	<1	10	0.55	8.7	7.54	1.0

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
22-May-12		186	326069	0.77	0 94	<1	<1	70	0.17	12.7	7.36	1.5
23-May-12		186	326063	0.70	0 88	<1	<1	20	0.16	9.1	7.44	1.0
22-May-12		188	326072	0.71	0 84	<1	<1	<10	0.16	11.1	7.47	1.0
23-May-12		188	326068	0.79	0 86	<1	<1	<10	0.18	11.0	7 55	1.0
22-May-12		188	326071	0.67	0 85	<1	<1	<10	0.17	10.1	7.44	1.0
23-May-12		188	326067	0.75	0.91	<1	<1	70	0.17	11.5	7.51	1.0
23-May-12		198	326534	0.61	0.77	<1	<1	<10	0.20	9.3	7.68	1.0
24-May-12		198	326528	0.59	0.73	<1	<1	NR	0.19	9.7	7.32	1.0
23-May-12		198	326535	0.58	0.77	<1	<1	<10	0.19	9.1	7.66	1.0
24-May-12		198	326529	0.57	0.80	<1	<1	NR	0.19	9.4	7.34	1.0
23-May-12		199	326536	0.65	0.79	<1	<1	<10	0.17	9.4	7.77	1.0
24-May-12		199	326532	0.55	0.74	<1	<1	NR	0.18	10.2	7.41	1.0
23-May-12		199	326537	0.58	0.72	<1	<1	<10	0.19	9.2	7.78	1.0
24-May-12		199	326533	0.60	0.74	<1	<1	NR	0.17	10.1	7.39	1.0
24-May-12		208	326573	0.61	0.74	<1	<1	NR	0.16	10.2	7.27	1.0
25-May-12		208	326567	0.64	0.84	<1	<1	<10	0.22	11.9	7.52	1.0
24-May-12		208	326572	0.44	0.59	<1	<1	NR	0.17	9.8	7.34	1.0
25-May-12		208	326566	0.38	0.53	<1	<1	<10	0.18	10.1	7.52	1.0
24-May-12		209	326575	0.51	0.66	<1	<1	NR	0.17	8.2	7.31	1.0
28-May-12		209	326571	0.75	0.90	<1	<1	30	0.21	8.4	7.45	1.0
24-May-12		209	326574	0.52	0.74	<1	<1	NR	0.26	9.2	7.24	1.0
28-May-12		209	326570	0.67	0.86	<1	<1	<10	0.20	10.1	7.48	1.0
25-May-12		223	326608	0.77	0 89	<1	<1	1180	0.23	8.2	7.38	1.5
28-May-12		223	326602	0.63	0.82	<1	<1	10	0.17	9.7	7.52	1.0
25-May-12		223	326607	0.66	0.81	<1	<1	<10	0.21	8.6	7.42	1.0
28-May-12		223	326601	0.53	0.70	<1	<1	<10	0.16	10.3	7.57	1.0
25-May-12		225	326610	0.66	0.75	<1	<1	<10	0.20	9.0	7.32	1.0
28-May-12		225	326606	0.45	0.77	<1	<1	10	0.14	9.5	7.48	1.0
25-May-12		225	326609	0.64	0.77	<1	<1	<10	0.21	9.2	7.39	1.0
28-May-12		225	326605	0.63	0.82	<1	<1	10	0.16	10.1	7.59	1.0

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
28-May-12		256	326813	0.49	0 67	<1	<1	<10	0.32	7.4	7.36	1.0
1-Jun-12		256	326807	0.56	0 68	<1	<1	<10	0.26	7.4	7 52	1.0
28-May-12		256	326812	0.60	0.74	<1	<1	<10	0.40	9.1	7.28	1.0
1-Jun-12		256	326806	0.53	0 67	<1	<1	<10	0.27	8.3	7.46	0.5
28-May-12		258	326815	0.61	0.73	<1	<1	<10	0.18	9.2	7.41	1.0
1-Jun-12		258	326811	0.62	0.73	<1	<1	<10	0.15	8.8	7.56	0.5
28-May-12		258	326814	0.70	0 85	<1	<1	10	0.16	9.3	7.46	1.0
1-Jun-12		258	326810	0.53	0.73	<1	<1	<10	0.15	9.7	7.54	1.0
29-May-12		270	326847	0.75	0 91	NA	NA	NA	0.41	8.7	7.35	0.5
30-May-12		270	326841	0.54	0.76	<1	<1	<10	0.19	9.1	7.42	1.0
29-May-12		270	326848	0.72	0 80	NA	NA	NA	0.34	8.6	7.40	0.5
30-May-12		270	326842	0.57	0.80	<1	<1	<10	0.19	9.3	7.46	1.0
29-May-12		272	326849	0.70	0 83	NA	NA	NA	0.33	9.0	7.40	0.5
30-May-12		272	326845	0.53	0 66	<1	<1	<10	0.20	9.4	7.42	1.0
29-May-12		272	326850	0.69	0.79	NA	NA	NA	0.24	9.7	7.55	1.0
30-May-12		272	326846	0.70	0 83	<1	<1	<10	0.18	9.6	7.54	1.0
30-May-12		281	327249	0.62	0 80	NA	NA	NA	0.08	9.4	7.49	1.0
31-May-12		281	327243	0.74	0 90	<1	<1	<10	0.07	10.0	7.84	1.0
30-May-12		281	327250	0.69	0 84	NA	NA	NA	0.20	9.4	7.48	1.0
31-May-12		281	327244	0.80	0 91	<1	<1	40	0.17	10.0	7.80	1.0
30-May-12		283	327251	0.67	0 80	NA	NA	NA	0.17	10.0	7 55	1.0
31-May-12		283	327247	0.55	0.76	<1	<1	<10	0.16	10.3	7.81	0.5
30-May-12		283	327252	0.56	0.75	NA	NA	NA	0.20	9.0	7 52	1.0
31-May-12		283	327248	0.54	0 67	<1	<1	<10	0.17	8.5	7.80	1.0
31-May-12		295	327289	0.45	0.90	<1	<1	10	0.17	10.3	7.75	1.0
1-Jun-12		295	327283	0.40	0 61	<1	<1	<10	0.24	9.7	7.49	1.0
31-May-12		295	327290	0.78	0 95	<1	<1	<10	0.16	11.8	7.75	1.0
1-Jun-12		295	327284	0.46	0 58	<1	<1	10	0.21	8.6	7.49	1.0

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
31-May-12		296	327292	0.65	0 83	<1	<1	<10	0.16	10.9	7.77	0.5
1-Jun-12		296	327288	0.64	0 80	<1	<1	<10	0.43	10.1	7.51	1.0
31-May-12		296	327291	0.77	0 92	3	<1	30	0.16	12.2	7.81	1.0
1-Jun-12		296	327287	0.51	0 64	<1	<1	<10	0.25	9.0	7.47	1.0
1-Jun-12		304	327333	0.50	0 60	<1	<1	<10	0.18	13.2	7.59	1.0
4-Jun-12		304	327327	0.52	0 66	<1	<1	10	0.15	13.2	7 50	1.0
1-Jun-12		304	327332	0.62	0.85	<1	<1	<10	0.12	11.2	7.58	1.0
4-Jun-12		304	327326	0.55	0.75	<1	<1	<10	0.19	11.9	7 37	1.0
1-Jun-12		306	327335	0.85	1 05	<1	<1	<10	0.69	13.1	7.56	1.0
4-Jun-12		306	327331	0.64	0.84	<1	<1	10	0.16	11.5	7.54	1.0
1-Jun-12		306	327334	0.87	1.02	<1	<1	<10	0.73	12.8	7.55	1.0
4-Jun-12		306	327330	0.66	0 87	<1	<1	<10	0.14	11.8	7 52	1.5
4-Jun-12		337	327523	0.74	0.88	101	<1	<10	0.15	10.7	7.44	1.5
5-Jun-12		337	327517	0.70	0 85	41	<1	10	0.25	11.4	7.50	1.0
7-Jun-12		337	328099	0.84	0.99	200	<1	10	0.20	11.7	NA	NA
7-Jun-12		337	328100	0.84	1.03	<1	<1	<10	0.21	11.6	NA	NA
7-Jun-12		337	328101	0.82	0.97	<1	<1	<10	0.19	11.4	NA	NA
11-Jun-12		337	328309	0.70	0.91	<1	<1	30	0.19	12.7	NA	NA
11-Jun-12		337	328310	NA	NA	<1	<1	<10	NA	NA	NA	NA
11-Jun-12		337	328311	0.73	0.89	<1	<1	<10	0.15	12.6	NA	NA
11-Jun-12		337	328313	0.73	0.92	<1	<1	<10	0.22	12.9	NA	NA
4-Jun-12		337	327522	0.57	0.79	<1	<1	<10	0.17	10.8	7.44	1.0
5-Jun-12		337	327516	0.70	0.87	<1	<1	<10	0.21	11.0	7.51	0.5
4-Jun-12		338	327524	0.71	0.88	<1	<1	10	0.13	13.3	7.53	1.0
5-Jun-12		338	327520	0.73	0.85	<1	<1	<10	0.25	11.5	7.54	1.0
4-Jun-12		338	327525	0.82	0.93	<1	<1	<10	0.13	13.8	7.48	1.0
5-Jun-12		338	327521	0.92	1.03	<1	<1	<10	0.16	13.1	7.41	1.0
5-Jun-12		348	327936	0.74	0.91	1	<1	<10	0.20	12.4	7.48	1.0
6-Jun-12		348	327930	0.76	0.89	<1	<1	<10	0.13	11.2	7.28	1.0
5-Jun-12		348	327937	0.71	0.97	<1	<1	<10	0.19	12.5	7.54	1.0
6-Jun-12		348	327931	0.82	0.97	<1	<1	<10	0.13	11.6	7.32	1.0

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100m L)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
5-Jun-12		349	327939	0.79	0 91	<1	<1	<10	0.21	11.7	7.59	0.5
6-Jun-12		349	327935	0.86	1 00	<1	<1	<10	0.16	13.3	7 33	1.5
5-Jun-12		349	327938	0.85	0 99	<1	<1	10	0.22	13.4	7.50	1.0
6-Jun-12		349	327934	0.83	1 05	<1	<1	<10	0.18	14.9	7.45	1.0
6-Jun-12		360	328002	0.88	1 08	<1	<1	<10	0.83	14.0	7.49	0.5
7-Jun-12		360	327996	0.85	1 00	<1	<1	<10	0.25	13.4	7.37	1.0
6-Jun-12		360	328001	0.70	0 84	<1	<1	<10	0.39	10.6	7.51	1.0
7-Jun-12		360	327995	0.83	0.98	<1	<1	<10	0.34	10.7	7.31	0.5
6-Jun-12		361	328004	0.37	0.49	<1	<1	<10	0.44	9.2	7.49	1.0
7-Jun-12		361	328000	0.78	0.91	<1	<1	<10	0.19	11.5	7.43	1.0
6-Jun-12		361	328003	0.53	0.64	1	<1	<10	0.60	9.3	7.54	1.0
7-Jun-12		361	327999	0.72	0.89	<1	<1	<10	0.50	10.9	7.40	1.0
7-Jun-12		374	328080	0.83	1.02	<1	<1	<10	0.18	13.4	7.45	1.0
8-Jun-12		374	328074	0.81	0 97	<1	<1	<10	0.27	13.6	7.46	1.0
7-Jun-12		374	328079	0.74	0.96	<1	<1	<10	0.16	13.4	7.39	1.0
8-Jun-12		374	328073	0.71	0 94	<1	<1	<10	0.48	13.7	7.42	1.0
7-Jun-12		375	328082	0.76	0.91	<1	<1	10	0.21	12.5	7.36	1.0
8-Jun-12		375	328078	0.73	0 91	<1	<1	<10	0.37	13.8	7.45	1.0
7-Jun-12		375	328081	0.93	1.06	<1	<1	<10	0.21	14.5	7.40	0.5
8-Jun-12		375	328077	0.72	0 94	<1	<1	<10	0.23	15.2	7.44	0.5
8-Jun-12		383	328131	0.53	0.67	<1	<1	<10	0.27	11.9	7.46	1.0
11-Jun-12		383	328125	0.49	0.64	<1	<1	<10	0.32	10.3	7.60	0.5
8-Jun-12		383	328130	0.58	0.81	<1	<1	<10	0.26	10.3	7.49	0.5
11-Jun-12		383	328124	0.53	0.68	<1	<1	<10	0.23	10.1	7.52	1.0
8-Jun-12		384	328132	0.63	0.81	2	<1	<10	0.17	12.1	7.33	1.5
11-Jun-12		384	328128	0.70	0.91	<1	<1	<10	0.22	11.9	7.58	1.0
8-Jun-12		384	328133	0.75	0.85	<1	<1	10	0.21	11.9	7.33	1.0
11-Jun-12		384	328129	0.49	0.66	<1	<1	<10	0.19	11.9	7.53	0.5
11-Jun-12		418	328343	0.38	0.56	<1	<1	<10	0.31	8.7	7.80	0.5
12-Jun-12		418	328337	0.61	0.76	<1	<1	<10	0.17	11.0	7.54	1.0

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
11-Jun-12		418	328344	0.36	0 50	<1	<1	<10	0.32	9.1	7.82	1.0
12-Jun-12		418	328338	0.62	0.72	<1	<1	<10	0.17	11.1	7.52	1.0
11-Jun-12		420	328346	0.40	0.55	<1	<1	<10	0.92	10.0	7.72	1.0
12-Jun-12		420	328342	0.53	0 65	<1	<1	40	0.26	10.4	7.55	1.0
11-Jun-12		420	328345	0.40	0 56	<1	<1	<10	0.51	9.9	7.68	0.5
12-Jun-12		420	328341	0.39	0 50	<1	<1	10	0.27	10.2	7.61	1.0
12-Jun-12		429	328706	0.50	0 64	<1	<1	<10	0.22	10.2	7.58	0.5
13-Jun-12		429	328700	0.33	0.44	<1	<1	<10	0.44	11.1	7.47	2.0
12-Jun-12		429	328705	0.48	0.62	2	<1	<10	0.19	9.4	7.58	1.0
13-Jun-12		429	328699	0.32	0.49	<1	<1	<10	0.48	10.3	7.35	1.0
12-Jun-12		431	328707	0.45	0 65	<1	<1	<10	0.19	11.2	7.52	1.0
13-Jun-12		431	328703	0.25	0 38	<1	<1	10	0.49	12.1	7.37	1.0
12-Jun-12		431	328708	0.46	0 62	1	<1	10	0.20	10.1	7.57	0.5
13-Jun-12		431	328704	0.21	0 33	<1	<1	<10	0.60	10.2	7.40	1.0
13-Jun-12		442	328760	0.41	0 50	<1	<1	<10	0.60	10.7	7.48	1.0
14-Jun-12		442	328756	0.31	0.43	<1	<1	<10	0.23	11.1	7.52	2.5
13-Jun-12		442	328759	0.36	0 50	<1	<1	<10	0.48	10.6	7.43	2.0
14-Jun-12		442	328755	0.38	0 50	<1	<1	<10	0.23	10.5	7.52	1.0
13-Jun-12		447	328758	0.38	0.48	<1	<1	10	0.24	12.4	7.42	2.0
14-Jun-12		447	328752	0.36	0.49	<1	<1	<10	0.30	11.2	7.49	1.0
13-Jun-12		447	328757	0.21	0 31	<1	<1	<10	0.20	14.2	7.42	2.0
14-Jun-12		447	328751	0.32	0 51	<1	<1	<10	0.29	10.9	7.60	3.0
14-Jun-12		452	328854	0.39	0 58	<1	<1	<10	0.32	13.4	7.57	1.0
15-Jun-12		452	328848	0.65	0.75	<1	<1	<10	0.34	13.8	7 55	1.0
14-Jun-12		452	328853	0.40	0 66	<1	<1	20	0.34	11.3	7 55	1.0
15-Jun-12		452	328847	0.63	0.77	<1	<1	<10	0.36	14.1	7 31	0.5
14-Jun-12		453	328856	0.72	0 96	<1	<1	<10	1.79	12.3	7.52	2.5
15-Jun-12		453	328852	0.53	0 67	<1	<1	<10	0.19	12.2	7.45	1.0

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
14-Jun-12		453	328855	0.45	0 66	<1	<1	<10	0.25	12.3	7.49	1.0
15-Jun-12		453	328851	0.62	0.77	<1	<1	10	0.18	12.3	7.47	1.0
15-Jun-12		466	328873	0.36	0 52	<1	<1	10	0.23	10.2	7.46	1.0
18-Jun-12		466	328867	0.35	0 54	<1	<1	<10	0.29	10.8	7 28	1.0
15-Jun-12		466	328874	0.34	0.51	<1	<1	<10	0.23	10.5	7.45	0.5
18-Jun-12		466	328868	0.25	0 51	<1	<1	<10	0.21	11.6	7.43	1.0
15-Jun-12		467	328875	0.46	0 58	<1	<1	<10	0.39	11.2	7.47	1.0
18-Jun-12		467	328871	0.19	0 34	<1	<1	<10	0.21	11.9	7.40	1.0
15-Jun-12		467	328876	0.37	0 50	<1	<1	<10	0.34	10.9	7.55	1.0
18-Jun-12		467	328872	0.22	0.39	1	<1	<10	0.35	11.5	7.42	1.0
20-Jun-12		467	329523	0.34	0.45	<1	<1	NR	0.23	13.9	NA	NA
18-Jun-12		495	329064	0.61	0 84	8	<1	<10	1.78	12.3	7.50	1.0
19-Jun-12		495	329058	0.67	0 80	1	<1	360	0.24	13.7	7.40	0.5
21-Jun-12		495	329544	0.64	0 81	<1	<1	320	0.31	11.5	NA	NA
18-Jun-12		495	329065	0.79	0 94	<1	<1	<10	1.04	14.4	7.45	1.0
19-Jun-12		495	329059	0.65	0 96	<1	<1	<10	0.16	14.5	7.41	1.0
18-Jun-12		498	329066	0.91	1.03	4	<1	<10	1.16	14.3	7.47	1.0
19-Jun-12		498	329062	0.74	0.91	<1	<1	<10	0.19	14.4	7.36	1.0
18-Jun-12		498	329067	0.63	0.77	<1	<1	<10	0.28	13.7	7.45	1.0
19-Jun-12		498	329063	0.61	0 82	<1	<1	<10	0.31	13.1	7.41	0.5
19-Jun-12		506	329115	0.38	0 53	<1	<1	<10	0.28	11.7	7.45	1.0
20-Jun-12		506	329109	0.23	0 35	<1	<1	NR	0.23	11.8	7.57	1.0
19-Jun-12		506	329116	0.39	0 52	<1	<1	80	0.25	10.7	7.47	1.0
20-Jun-12		506	329110	0.42	0 53	<1	<1	NR	0.24	11.2	7.62	1.0
19-Jun-12		507	329117	0.38	0 51	<1	<1	260	0.26	12.0	7.46	1.0
20-Jun-12		507	329113	0.38	0 50	10	<1	NR	0.25	11.8	7 52	1.5
22-Jun-12		507	329595	0.37	0 50	<1	<1	<10	0.26	12.2	NA	NA
19-Jun-12		507	329118	0.35	0.48	<1	<1	50	0.24	11.7	7.46	1.0
20-Jun-12		507	329114	0.33	0.45	<1	<1	NR	0.21	11.3	7.50	1.0

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100m L)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
20-Jun-12		518	329495	0.11	0 21	<1	<1	NR	0.53	10.4	7 60	1.0
21-Jun-12		518	329489	0.04	0.14	<1	<1	<10	0.57	11.0	7.56	1.0
22-Jun-12		518	329731	0.05	0.15	NA	NA	NA	NA	10.9	NA	NA
25-Jun-12		518	329793	0.27	0.42	NA	NA	NA	NA	11.8	NA	NA
20-Jun-12		518	329494	0.10	0 20	<1	<1	NR	0.61	10.1	7 63	1.0
21-Jun-12		518	329488	0.08	0.15	3	<1	<10	0.83	11.4	7.55	1.0
22-Jun-12		page ppp	329730	<0.02	0.08	NA	NA	NA	NA	10.9	NA	NA
25-Jun-12		518	329732	0.18	0.30	<1	<1	<10	0.94	13.2	NA	NA
20-Jun-12		519	329496	0.12	0 26	<1	<1	NR	0.30	12.0	7 59	0.5
21-Jun-12		519	329492	0.14	0 26	4	<1	<10	0.48	11.3	7 60	0.5
25-Jun-12		519	329773	0.15	0.26	<1	<1	<10	0.46	12.6	NA	NA
20-Jun-12		519	329497	0.20	0 32	<1	<1	NR	0.29	12.0	7 56	1.0
21-Jun-12		519	329493	0.12	0 28	<1	<1	<10	0.42	11.4	7 58	1.0
21-Jun-12		531	329540	0.26	0 37	<1	<1	10	0 32	12.4	7 52	1.0
22-Jun-12		531	329534	0.23	0 31	<1	<1	<10	0.62	13.0	7 51	1.0
21-Jun-12		531	329539	0.20	0 32	<1	<1	10	0.36	11.2	7.55	1.0
22-Jun-12		531	329533	0.30	0.48	<1	<1	<10	0.23	11.0	7.39	1.0
21-Jun-12		533	329542	0.72	0 85	<1	<1	<10	0.78	14.1	7.52	1.0
22-Jun-12		533	329538	0.74	0 90	<1	<1	<10	0.23	15.2	7.44	1.0
21-Jun-12		533	329541	0.63	0 88	<1	<1	<10	1.03	13.7	7.62	1.0
22-Jun-12		533	329537	0.67	0 84	<1	<1	<10	0.32	15.2	7.55	1.0
22-Jun-12		542	329603	0.36	0.49	<1	<1	<10	0.28	11.9	7.49	1.0
25-Jun-12		542	329597	0.13	0 27	<1	<1	<10	0.48	11.4	7 58	1.0
22-Jun-12		542	329602	0.26	0.47	<1	<1	<10	0.27	11.3	7.49	0.5
25-Jun-12		542	329596	0.18	0 32	<1	<1	<10	0 50	11.7	7 67	1.0
22-Jun-12		544	329604	1.13	1 22	<1	<1	<10	5.45	14.1	7.59	1.0
25-Jun-12		544	329600	0.72	0 81	<1	<1	<10	0.17	13.8	7 60	1.0
22-Jun-12		544	329605	0.94	1 09	2	<1	<10	2.80	11.5	7 50	0.5
25-Jun-12		544	329601	0.91	1 09	<1	<1	<10	0.84	15.2	7.46	1.0
25-Jun-12		564	329781	0.44	0 57	<1	<1	<10	0.30	13.8	7.51	1.0
26-Jun-12		564	329775	0.39	0 62	<1	<1	<10	0.27	15.0	7.44	1.0

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100m L)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
25-Jun-12		564	329780	0.40	0 59	<1	<1	10	0.28	12.3	7.58	1.0
26-Jun-12		564	329774	0.36	0 60	1	<1	<10	0.27	14.4	7.40	0.5
28-Jun-12		564	330263	0.36	0.50	<1	<1	<10	0.30	12.0	NA	NA
25-Jun-12		567	329783	0.10	0.22	<1	<1	<10	1.60	10.6	7.55	1.0
26-Jun-12		567	329779	0.37	0.48	<1	<1	<10	0.25	11.0	7.46	1.0
25-Jun-12		567	329782	0.11	0.20	<1	<1	20	1.48	10.7	7.40	1.0
26-Jun-12		567	329778	0.42	0 52	<1	<1	10	0.26	10.5	7.48	1.0
26-Jun-12		580	329816	0.72	0 92	<1	<1	10	0.19	13.2	7.39	1.0
28-Jun-12		580	329810	0.71	0 91	<1	<1	<10	0.36	16.0	7.60	1.0
26-Jun-12		580	329817	0.82	0 97	<1	<1	<10	0.15	16.0	7.52	1.0
28-Jun-12		580	329811	0.72	0 91	<1	<1	<10	0.39	18.0	7.64	1.0
26-Jun-12		581	329819	0.67	0 88	<1	<1	<10	0.13	13.5	7.50	1.0
28-Jun-12		581	329815	0.84	1 00	<1	<1	<10	0.37	14.6	7.59	0.5
26-Jun-12		581	329818	0.68	0 85	1	<1	<10	0.14	14.2	7.50	1.0
28-Jun-12		581	329814	0.80	0.95	<1	<1	<10	0.38	14.3	7.62	0.5
27-Jun-12		588	330208	0.64	0.86	<1	<1	<10	0.33	13.3	7.65	1.0
28-Jun-12		588	330202	0.77	0 89	<1	<1	<10	0.16	14.7	7.62	1.0
27-Jun-12		588	330207	0.65	0.90	<1	<1	<10	0.13	13.6	7.67	1.0
28-Jun-12		588	330201	0.68	0.82	<1	<1	<10	0.16	14.5	7.58	1.0
27-Jun-12		589	330209	0.33	0.49	<1	<1	<10	0.13	13.4	7.66	1.0
28-Jun-12		589	330205	0.25	0.35	<1	<1	<10	0.21	13.8	7.66	1.0
27-Jun-12		589	330210	0.31	0.45	<1	<1	<10	0.13	13.7	7.56	1.0
28-Jun-12		589	330206	0.23	0.36	<1	<1	40	0.20	13.1	7.52	1.0
28-Jun-12		601	330261	0.64	0.80	<1	<1	<10	0.13	13.7	7.62	0.5
3-Jul-12		601	330257	0.80	0.94	<1	<1	<10	0 22	16.5	7 60	1 0
28-Jun-12		601	330260	0.61	0.77	<1	<1	<10	0.18	13.4	7.70	1.0
3-Jul-12		601	330256	0.81	0.93	<1	<1	<10	0 29	16.3	7 57	1 5
28-Jun-12		602	330258	0.59	0.79	<1	<1	<10	0.13	13.9	7.68	1.0
3-Jul-12		602	330252	0.78	0.89	<1	<1	<10	0 21	16.0	7.44	1.0

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
28-Jun-12		602	330259	0.67	0 80	<1	<1	<10	0.24	13.4	7.64	1.0
3-Jul-12		602	330253	0.73	0.92	<1	<1	<10	0.18	15.2	7.40	1 5
3-Jul-12		657	330299	0.56	0.69	<1	<1	<10	0.14	11.4	7.48	1 0
4-Jul-12		657	330293	0.15	0.24	<1	<1	<10	0.25	12.1	7.46	1 0
3-Jul-12		657	330298	0.76	0.97	<1	<1	<10	0.13	12.3	7.50	1 5
4-Jul-12		657	330292	0.64	0.73	<1	<1	<10	0.13	12.3	7.35	0 5
3-Jul-12		658	330301	0.37	0.58	<1	<1	<10	0.15	11.2	7.45	1 0
4-Jul-12		658	330297	0.36	0.59	<1	<1	10	0 21	12.2	7.42	1 0
3-Jul-12		658	330300	0.59	0.71	<1	<1	<10	0.15	11.3	7.48	1 0
4-Jul-12		658	330296	0.17	0.31	<1	<1	<10	0 24	11.5	7.45	0 5
4-Jul-12		667	330907	0.70	0.81	<1	<1	<10	0.14	12.2	7.49	0 5
5-Jul-12		667	330903	0.59	0.77	<1	<1	<10	0.19	12.1	7.45	1 0
4-Jul-12		667	330908	0.71	0.81	<1	<1	10	0.14	12.2	7.49	1 0
6-Jul-12		667	330904	0.43	0.61	<1	<1	<10	0.18	11.3	7.42	0 5
4-Jul-12		668	330905	0.75	0.98	<1	<1	510	0.16	12.2	7.53	1 0
5-Jul-12		668	330899	0.40	0.60	<1	<1	<10	0.17	11.4	7.47	0 5
4-Jul-12		668	330906	0.76	0.91	<1	<1	<10	0.16	10.3	7.50	1 0
5-Jul-12		668	330900	0.47	0.58	<1	<1	<10	0.17	9 9	7.44	1 0
5-Jul-12		677	330952	0.70	0.88	<1	<1	<10	0 20	11.4	7 50	0 5
6-Jul-12		677	330946	0.54	0.81	<1	<1	<10	0 21	12.5	7.42	1 0
5-Jul-12		677	330953	0.45	0.63	<1	<1	180	0.18	12.5	7 50	0 5
6-Jul-12		677	330947	0.54	0.75	<1	<1	80	0 21	13.2	7.49	1 0
5-Jul-12		678	330955	0.53	0.66	<1	<1	<10	0.18	11.9	7.46	0 5
6-Jul-12		678	330951	0.67	0.82	<1	<1	<10	0 20	12.3	7.44	0 5
5-Jul-12		678	330954	0.47	0.65	<1	<1	<10	0.17	12.6	7.45	1 0
6-Jul-12		678	330950	0.66	0.80	<1	<1	<10	0.18	12.5	7 50	0 5
6-Jul-12		685	330998	0.60	0.78	<1	<1	10	0.17	13.3	7 53	0 5
9-Jul-12		685	330992	0.47	0.70	<1	<1	<10	0.13	12.0	7 54	1.0
6-Jul-12		685	330997	0.58	0.83	<1	<1	<10	0.16	13.5	7 64	1.0
9-Jul-12		685	330991	0.60	0.74	<1	<1	<10	0.14	13.2	7 61	0.5

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100m L)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
6-Jul-12		686	330999	0.40	0.63	<1	<1	10	0.15	12.1	7.56	0 5
9-Jul-12		686	330995	0.49	0.68	<1	<1	>3000	0.14	11.2	7.57	0 5
17-Jul-12		686	332325	0.27	0.45	<1	<1	<10	0.15	14.9	NA	NA
6-Jul-12		686	331000	0.61	0.83	<1	<1	10	0.14	11.6	7.55	1 0
9-Jul-12		686	330996	0.42	0.56	<1	<1	<10	0.14	13.5	7.62	1 0
9-Jul-12		718	331182	0.46	0.64	<1	<1	<10	0.24	14.2	7.57	1 0
10-Jul-12		718	331178	0.71	0.86	<1	<1	<10	0.24	16.6	7.38	1 0
9-Jul-12		718	331181	0.17	0.34	<1	<1	<10	0.17	14.5	7.62	1 0
10-Jul-12		718	331177	0.10	0.26	<1	<1	<10	0.16	14.5	7.40	0 5
9-Jul-12		721	331180	0.60	0.75	1	<1	<10	0.19	13.6	7.62	0 5
10-Jul-12	c)	721	331174	0.75	0.90	<1	<1	<10	0 20	14.5	7.40	0 5
9-Jul-12		721	331179	0.51	0.66	<1	<1	<10	0 29	16.5	7.62	1 0
10-Jul-12		721	331173	0.78	0.98	<1	<1	<10	1.19	15.3	7.35	1 0
10-Jul-12		721	331127	0.78	0.98	<1	<1	<10	0.78	15.3	7.45	1 0
10-Jul-12		732	331222	0.91	1.07	<1	<1	<10	0 52	15.5	7.41	1 0
12-Jul-12		732	331216	0.90	1.02	<1	<1	<10	0.19	15.6	7.43	1 0
10-Jul-12		732	331221	0.81	1.02	<1	<1	<10	0 29	16.2	7 52	1 0
12-Jul-12		732	331215	0.73	0.92	<1	<1	10	0 21	16.4	7.48	0 5
10-Jul-12		733	331223	1.06	1.19	<1	<1	<10	0.15	17.9	7 55	1 0
11-Jul-12		733	331219	0.82	0.94	<1	<1	<10	0 54	17.1	7.49	1 0
10-Jul-12		733	331224	0.97	1.12	<1	<1	<10	0.15	17.1	7.49	0 5
11-Jul-12		733	331220	0.89	1.00	<1	<1	<10	0 52	16.0	7.41	1.0
11-Jul-12		743	331647	0.13	0.31	<1	<1	<10	0.19	12.0	7.47	0.5
16-Jul-12		743	331641	0.71	0.81	<1	<1	10	0.17	15.4	7.46	1.0
11-Jul-12		743	331646	0.92	1.12	<1	<1	<10	0 24	19.5	7.49	1.0
16-Jul-12		743	331640	0.32	0.44	<1	<1	<10	0.18	15.0	7.42	0.5
11-Jul-12		744	331648	1.03	1.23	<1	<1	<10	0.79	17.3	7 59	1.0
16-Jul-12		744	331644	0.66	0.77	<1	<1	<10	0.17	15.9	7 58	1.0
11-Jul-12		744	331649	0.62	0.76	<1	<1	<10	0 35	12.9	7.45	1.0
16-Jul-12		744	331645	0.81	0.91	<1	<1	<10	0 23	14.0	7.47	0.5

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
13-Jul-12		747	331695	0.88	1.07	<1	<1	<10	0.19	17.7	7.52	1 0
16-Jul-12		747	331689	0.63	0.85	<1	<1	<10	0.23	17.2	7.46	1 0
13-Jul-12		747	331696	0.79	0.92	<1	<1	<10	0 20	16.5	7.48	1 0
16-Jul-12		747	331690	0.76	0.98	<1	<1	<10	0 20	18.8	7.41	0 5
13-Jul-12		748	331697	0.85	1.05	<1	<1	<10	0 25	17.5	7.48	1 0
16-Jul-12		748	331693	0.80	0.93	<1	<1	<10	0.15	19.0	7.42	1 0
13-Jul-12		748	331698	0.66	0.85	<1	<1	<10	0 20	16.2	7.53	1 0
16-Jul-12		748	331694	0.81	0.93	<1	<1	<10	0.16	20.0	7.42	1 5
16-Jul-12		785	331910	0.75	0.91	<1	<1	<10	0.19	14.0	7 54	1 0
17-Jul-12		785	331904	0.58	0.76	<1	<1	<10	0.15	15.3	7.48	2 0
16-Jul-12		785	331911	0.55	0.72	<1	<1	10	0.16	14.2	7.43	1 0
17-Jul-12		785	331905	0.60	0.79	<1	<1	10	0.14	17.0	7.42	2 0
16-Jul-12		786	331913	0.60	0.80	<1	<1	<10	0.14	13.6	7.44	1 5
17-Jul-12		786	331909	0.72	0.89	<1	<1	<10	0.17	15.3	7.46	1 5
16-Jul-12		786	331912	0.66	0.81	<1	<1	<10	0.15	13.1	7.47	1 0
17-Jul-12		786	331908	0.66	0.86	<1	<1	<10	0 20	15.8	7.46	1 5
17-Jul-12		801	331976	0.69	0.86	<1	<1	<10	0.16	16.8	7 39	1 5
18-Jul-12		801	331970	0.64	0.87	<1	<1	<10	0.15	14.4	7 33	2 5
17-Jul-12		801	331977	0.71	0.92	<1	<1	<10	0.12	18.0	7.41	2.0
18-Jul-12		801	331971	0.76	0.92	<1	<1	10	0.15	14.6	7 35	2.5
17-Jul-12		802	331978	0.70	0.87	<1	<1	<10	0.13	15.9	7.42	1.5
18-Jul-12		802	331974	0.65	0.82	<1	<1	10	0 32	12.8	7.42	2.0
17-Jul-12		802	331979	0.66	0.85	<1	<1	<10	0.12	17.1	7 39	2.5
18-Jul-12		802	331975	0.71	0.84	<1	<1	<10	0 28	13.0	7.41	2.5
18-Jul-12		810	332358	0.51	0.66	<1	<1	<10	0.14	14.0	7.42	1.5
19-Jul-12		810	332352	0.70	0.86	<1	<1	10	0 21	16.8	7.42	0.5
18-Jul-12		810	332359	0.56	0.69	<1	<1	<10	0.14	14.2	7 39	1.0
19-Jul-12		810	332353	0.28	0.41	<1	<1	<10	0.19	14.1	7 37	0.5

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
18-Jul-12		812	332360	0.82	0.95	<1	<1	20	0.12	14.6	7.40	1 0
19-Jul-12		812	332356	0.59	0.78	<1	<1	<10	0.14	15.3	7.40	0 5
18-Jul-12		812	332361	0.44	0.56	<1	<1	<10	0.12	13.4	7.41	1 5
19-Jul-12		812	332357	0.60	0.83	<1	<1	<10	0.14	13.8	7.42	0 5
19-Jul-12		824	332419	0.43	0.64	<1	<1	<10	0.19	15.8	7.59	0 5
20-Jul-12		824	332413	0.86	1.04	<1	<1	<10	0 33	15.4	7.63	0 5
19-Jul-12		824	332420	0.78	0.94	<1	<1	<10	0 21	13.8	7.56	1 0
20-Jul-12		824	332414	0.45	0.65	<1	<1	<10	0 21	13.1	7.56	1 0
19-Jul-12		825	332421	0.60	0.78	<1	<1	<10	0.16	13.1	7.55	0 5
20-Jul-12		825	332417	0.99	1.11	<1	<1	<10	0 31	15.7	7.48	1 0
19-Jul-12		825	332422	0.81	0.99	<1	<1	10	0.76	13.5	7.49	0 5
20-Jul-12		825	332418	0.98	1.10	<1	<1	<10	0 32	15.5	7.48	0 5
20-Jul-12		837	332457	0.69	0.85	<1	<1	<10	0.76	12.1	7 52	1 0
23-Jul-12		837	332451	0.36	0.53	<1	<1	<10	0 30	15.8	7 59	0 5
20-Jul-12		837	332456	0.43	0.64	<1	<1	<10	0 26	12.8	7 51	0 5
23-Jul-12		837	332450	0.38	0.54	<1	<1	<10	0 30	15.8	7 60	1 0
20-Jul-12		838	332458	0.47	0.59	<1	<1	<10	0.15	14.5	7 53	1 0
23-Jul-12		838	332454	0.41	0.52	<1	<1	10	0 28	11.7	7 51	1 0
20-Jul-12		838	332459	0.47	0.62	<1	<1	<10	0 22	15.2	7 52	0 5
23-Jul-12		838	332455	0.42	0.50	<1	<1	<10	0 28	11.9	7.49	1.0
23-Jul-12		867	332650	0.80	0.92	<1	<1	<10	0.40	16.5	7 37	1.0
24-Jul-12		867	332644	0.63	0.79	<1	<1	40	0 27	16.6	7 31	0.5
23-Jul-12		867	332649	0.64	0.82	<1	<1	<10	0.17	15.5	7 58	0.5
24-Jul-12		867	332643	0.62	0.78	<1	<1	60	0 26	16.0	7.42	1.0
23-Jul-12		868	332652	0.15	0.29	<1	<1	10	0 28	14.0	7.43	1.0
24-Jul-12		868	332648	0.42	0.55	<1	<1	100	0 27	15.5	7.44	1.0
23-Jul-12		868	332651	0.19	0.32	<1	<1	<10	0 25	14.8	7.49	0.5
24-Jul-12		868	332647	0.17	0.32	<1	<1	110	0 54	14.2	7.41	0.5
24-Jul-12		879	332732	0.61	0.75	<1	<1	200	0 35	17.4	7 38	1.0
25-Jul-12		879	332726	0.65	0.77	<1	<1	<10	0 35	18.1	7.44	0.5

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100m L)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
24-Jul-12		879	332731	0.30	0.50	<1	<1	280	0.30	16.8	7.40	1 5
25-Jul-12		879	332725	0.59	0.81	<1	<1	10	0.40	17.3	7.47	0 5
24-Jul-12		880	332734	0.55	0.75	<1	<1	50	0.50	14.9	7.42	1 0
25-Jul-12		880	332730	0.72	0.85	<1	<1	<10	0 29	16.6	7.47	1 0
24-Jul-12		880	332733	0.48	0.63	<1	<1	30	0.44	13.8	7.38	1 0
25-Jul-12		880	332729	0.67	0.84	<1	<1	<10	0 28	16.9	7.51	1 0
25-Jul-12		893	333135	0.62	0.82	<1	<1	10	0 23	14.3	7.49	1 0
26-Jul-12		893	333129	0.63	0.83	<1	<1	10	0 20	14.6	7.54	1 0
25-Jul-12		893	333134	0.62	0.82	<1	<1	<10	0.16	15.3	7.48	0 5
26-Jul-12		893	333128	0.63	0.81	<1	<1	<10	0.18	14.5	7.46	1 0
25-Jul-12		894	333137	0.45	0.65	<1	<1	<10	0 33	14.2	7.62	0 5
26-Jul-12		894	333133	0.54	0.66	<1	<1	120	0 33	13.9	7 61	1 0
25-Jul-12		894	333136	0.46	0.62	<1	<1	10	0 31	15.3	7 60	0 5
26-Jul-12		894	333132	0.43	0.59	<1	<1	<10	0 25	14.8	7 51	0 5
26-Jul-12		907	333174	0.82	0.96	3	<1	10	0 93	16.0	7 53	1 0
27-Jul-12		907	333168	0.86	0.99	<1	<1	<10	0 29	19.0	7 52	1 0
26-Jul-12		907	333173	0.72	0.91	<1	<1	<10	1.48	16.8	7 52	1 0
27-Jul-12		907	333167	0.57	0.80	<1	<1	10	0 21	16.0	7 66	1 0
26-Jul-12		908	333176	0.47	0.66	<1	<1	10	0.15	13.8	7.46	1 0
27-Jul-12		908	333172	0.43	0.63	<1	<1	<10	0 22	14.9	7.47	1 0
26-Jul-12		908	333175	0.56	0.77	<1	<1	<10	0.16	14.8	7 51	0 5
27-Jul-12		908	333171	0.43	0.59	<1	<1	<10	0 22	15.0	7.48	1 0
27-Jul-12		917	333214	0.44	0.64	<1	<1	<10	0.18	17.6	7 58	1 0
30-Jul-12		917	333208	0.77	0.93	<1	<1	<10	0 20	17.5	7 51	1.0
27-Jul-12		917	333213	0.56	0.77	<1	<1	10	0.18	16.2	7 53	1.0
30-Jul-12		917	333207	0.76	0.91	<1	<1	20	0.19	16.5	7.45	1.0
27-Jul-12		919	333215	0.32	0.50	<1	<1	10	0 28	14.9	7 61	1.0
30-Jul-12		919	333211	0.32	0.45	<1	<1	<10	0 26	16.9	7 53	1.0

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
27-Jul-12		919	333216	0.72	0.85	<1	<1	<10	0.60	16.1	7.62	1 0
30-Jul-12		919	333212	0.44	0.56	<1	<1	<10	0.23	16.3	7.56	1 0
30-Jul-12		950	333377	0.39	0.66	<1	<1	<10	0.28	14.3	7.64	0 5
31-Jul-12		950	333371	0.49	0.65	<1	<1	<10	0 26	14.9	7.61	1 0
30-Jul-12		950	333378	0.53	0.69	<1	<1	<10	0 32	14.5	7.58	1 0
31-Jul-12		950	333372	0.46	0.72	<1	<1	<10	0 22	15.5	7.52	0 5
30-Jul-12		951	333380	0.41	0.61	<1	<1	<10	0 26	14.8	7.58	0 5
31-Jul-12		951	333376	0.52	0.64	<1	<1	<10	0 20	14.5	7.57	1 0
30-Jul-12		951	333379	0.47	0.64	<1	<1	<10	0 27	13.4	7.61	1 0
31-Jul-12		951	333375	0.43	0.62	<1	<1	<10	0 23	13.8	7.58	1 0
31-Jul-12		960	333449	0.67	0.90	<1	<1	<10	0 26	12.7	7 58	1 0
1-Aug-12		960	333443	0.66	0.97	1	<1	10	0.74	14.3	7.49	1 0
3-Aug-12		960	333897	0.63	0.78	<1	<1	<10	0.18	13.4	NA	NA
31-Jul-12		960	333450	0.76	0.89	<1	<1	<10	0 29	12.6	7 52	0 5
1-Aug-12		960	333444	0.83	1.05	<1	<1	<10	0 69	14.1	7 57	1 0
31-Jul-12		961	333451	0.62	0.80	<1	<1	<10	0 24	15.0	7.42	1 0
1-Aug-12		961	333447	0.68	0.83	<1	<1	<10	0 27	14.7	7.46	1 0
31-Jul-12		961	333452	0.47	0.67	<1	<1	<10	0 26	14.9	7.49	1.0
1-Aug-12		961	333448	0.72	0.87	<1	<1	<10	0 25	14.5	7.48	1.0
1-Aug-12		974	333806	0.60	0.77	<1	<1	<10	0.15	15.0	7.40	1.0
2-Aug-12		974	333802	0.62	0.76	<1	<1	<10	0 22	16.3	7.47	1.0
1-Aug-12		974	333805	0.66	0.82	<1	<1	<10	0.15	15.6	7.47	1.0
2-Aug-12		974	333801	0.67	0.82	<1	<1	<10	0 22	15.9	7 51	1.0
1-Aug-12		975	333804	0.68	0.86	<1	<1	30	0 22	17.6	7.44	1.0
2-Aug-12		975	333798	0.58	0.70	<1	<1	<10	0 30	15.0	7.48	1.0
1-Aug-12		975	333803	0.55	0.76	<1	<1	10	0.17	14.5	7.45	1.0
2-Aug-12		975	333797	0.60	0.72	<1	<1	<10	0.41	14.0	7 52	1.0
2-Aug-12		979	333858	0.50	0.75	<1	<1	<10	0.18	16.0	7.45	1.0
3-Aug-12		979	333852	0.65	0.78	<1	<1	<10	0 63	16.7	7 51	1.0

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
2-Aug-12		979	333857	0.53	0.74	<1	<1	<10	0.17	14.9	7.46	1 0
3-Aug-12		979	333851	0.61	0.80	<1	<1	10	0.21	16.2	7.51	1 0
2-Aug-12		980	333859	0.44	0.64	<1	<1	<10	0.17	14.0	7.54	0 5
3-Aug-12		980	333855	0.61	0.77	<1	<1	<10	0.23	17.1	7.55	1 5
2-Aug-12		980	333860	0.72	0.84	<1	<1	<10	0.19	16.0	7.49	1 0
3-Aug-12		980	333856	0.51	0.67	<1	<1	<10	0 24	17.0	7.56	1 0
3-Aug-12		992	333891	0.60	0.78	<1	<1	<10	0 20	16.1	7.52	1 0
7-Aug-12		992	333885	0.42	0.53	<1	<1	<10	0.19	14.1	7.56	1 0
3-Aug-12		992	333892	0.51	0.71	<1	<1	<10	0 20	14.4	7.48	1 0
7-Aug-12		992	333886	0.47	0.58	<1	<1	<10	0 20	15.6	7.62	1 0
3-Aug-12		993	333894	0.36	0.48	<1	<1	<10	0.40	17.3	7.50	1 5
7-Aug-12		993	333890	0.69	0.81	<1	<1	<10	0 24	16.6	7.60	1 0
3-Aug-12		993	333893	0.38	0.58	<1	<1	10	0 26	17.4	7.51	1 0
7-Aug-12		993	333889	0.74	0.86	<1	<1	100	0.19	16.0	7.59	1 0

NR - No result NA - Not analyzed

Comments:

On May 18, 29 and 30, pre-flush bacteriological sample were not analyzed due to a technician error.

On May 24 and June 20 there were no results for HPC due to a contract lab error.

*Bracketed ( ) addresses indicate alternate location was sampled because initial location was inaccessible for the Post-Flush or Few days Post-Flush sampling.

No re-sample collected when a pre-flush sample test positive for bacti and the post-flush is negative.

2013 Water Main Cleaning Program

Laboratory Analysis Report Household Monitoring

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
6-May-13		27	358925	0.82	0 98	<1	<1	150	0.22	7 2	7.55	3 5
7-May-13		27	358919	0.81	1 02	<1	<1	<10	0.25	6 3	7.53	2 5
6-May-13		27	358924	0.85	0 96	<1	<1	<10	0.26	5 3	7.55	3 0
7-May-13		27	358918	0.84	1 04	<1	<1	<10	0.16	7 3	7.54	2 5
6-May-13		29	358926	0.79	0 97	<1	<1	<10	0.28	5 0	7 53	2.5
7-May-13		29	358922	0.68	0 92	<1	<1	<10	0.44	5 5	7 50	3.0
6-May-13		29	358927	0.86	0 97	<1	<1	50	0.30	8 0	7 58	3.0
7-May-13		29	358923	0.71	0 98	<1	<1	<10	0.16	6 3	7 52	3.5
7-May-13		38	358986	0.78	1 06	<1	<1	<10	0.24	6 3	7 52	4.5
8-May-13		38	358980	0.82	0 99	<1	<1	<10	0.21	7.1	7.47	3.0
7-May-13		38	358985	0.87	1 02	<1	<1	<10	0.19	7 0	7 50	2.5
8-May-13		38	358979	0.92	1.14	<1	<1	<10	0.29	7 3	7 29	4.0
7-May-13		39	358987	0.95	1.16	<1	<1	<10	0.23	8 3	7.44	4.0
8-May-13		39	358983	0.77	0 90	<1	<1	<10	0.20	12.1	7.60	2.5
7-May-13		39	358988	0.71	1 01	<1	<1	<10	0.25	9 2	7 55	2.5
8-May-13		39	358984	0.78	0 88	<1	<1	<10	0.22	11.6	7 57	3.0
8-May-13		50	359372	0.76	0 87	<1	<1	<10	0.69	7 2	7 51	6.0
9-May-13		50	359366	0.86	1 08	<1	<1	<10	0.41	6 8	7 53	6.5
8-May-13		50	359373	0.85	1 01	<1	<1	<10	0.47	7 3	7 54	6.5
9-May-13		50	359367	0.85	1 01	<1	<1	<10	0.48	7 8	7 56	16.0
8-May-13		51	359375	0.81	0 98	<1	<1	<10	0.36	6.1	7 57	5.0
9-May-13		51	359371	0.94	1 06	<1	<1	<10	0.43	8.6	7 57	13.0

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
9-May-13		51	359370	1.01	1 09	<1	<1	<10	0.40	7 8	7 52	10.0
8-May-13		51	359374	0.80	0 94	<1	<1	<10	0.32	8 3	7 55	6.0
9-May-13		60	359441	0.86	1 02	<1	<1	<10	0.21	6.1	7.39	4 0
10-May-13		60	359435	0.90	1 06	<1	<1	<10	0.27	6.1	7.49	7 5
9-May-13		60	359442	0.64	0 86	<1	<1	<10	0.37	5 9	7.54	5 0
10-May-13		60	359436	0.83	1 00	<1	<1	<10	0.25	5 8	7.48	5 0
9-May-13		61	359444	0.87	1 02	<1	<1	<10	0.23	6 8	7.50	5 0
10-May-13		61	359440	0.82	0 97	<1	<1	<10	0.40	6 3	7.46	13.0
9-May-13		61	359443	0.78	0 96	<1	<1	<10	0.21	6.1	7.45	6 0
10-May-13		61	359439	0.81	0 95	<1	<1	<10	0.25	8 0	7.49	5 0
10-May-13		68	359507	0.89	1 01	<1	<1	<10	0.22	7 0	7.47	13.0
13-May-13		68	359501	0.91	1 00	<1	<1	<10	0.20	7 0	7.65	4 0
10-May-13		68	359508	0.22	0.40	<1	<1	<10	0.27	6 5	7.39	15.0
13-May-13		68	359502	0.75	0 90	<1	<1	<10	0.49	5.1	7.43	7 0
10-May-13		71	359509	1.11	1 22	<1	<1	<10	8.50	6 8	7.42	160
13-May-13		71	359505	0.76	1 00	<1	<1	<10	0.35	6 0	7.54	5 0
10-May-13		71	359510	1.43	1.67	<1	<1	<10	12.20	7 9	7.60	180
13-May-13		71	359506	0.79	1 02	<1	<1	<10	0.33	6 9	7.50	3 0
13-May-13		94	359708	0.81	0 95	<1	<1	<10	0.31	5 8	7.55	4 0
14-May-13		94	359702	0.97	1.10	<1	<1	<10	0.56	8 2	7.56	5 0
13-May-13		94	359709	0.84	0 92	<1	<1	<10	0.27	5 8	7.60	3 0
14-May-13		94	359703	0.97	1 07	<1	<1	<10	0.51	6 5	7.46	5 0
13-May-13		96	359711	0.79	0 93	<1	<1	<10	0.24	6 8	7.49	5 0
14-May-13		96	359707	0.84	1 01	<1	<1	<10	0.56	5 8	7.50	6 0
13-May-13		96	359710	0.83	1 01	<1	<1	20	0.25	6 8	7.55	2 5
14-May-13		96	359706	0.74	0 97	<1	<1	<10	0.44	6.6	7.58	4 0
14-May-13		106	359753	0.85	1 04	<1	<1	<10	0.46	6.7	7.51	3 0
15-May-13		106	359747	0.90	1 06	<1	<1	<10	0.19	6.7	7.53	6 0

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
14-May-13		106	359754	0.73	0 90	<1	<1	90	0.45	5 9	7.52	3 0
15-May-13		106	359748	0.92	1 03	<1	<1	<10	0.19	5 8	7 50	4.0
14-May-13		107	359756	0.90	1 08	<1	<1	<10	1.08	6 0	7 50	25.0
15-May-13		107	359752	0.84	1.04	<1	<1	10	0.20	6.1	7 51	10.0
14-May-13		107	359755	0.70	0 93	<1	<1	<10	0.63	6 2	7 51	8.0
15-May-13		107	359751	0.76	0.85	<1	<1	<10	0.20	6 0	7 52	5.0
15-May-13		117	360147	0.79	1.00	<1	<1	<10	0.31	6.5	7 55	6.0
16-May-13		117	360141	0.75	0 95	<1	<1	<10	0.22	6.4	7 56	6.0
15-May-13		117	360146	0.89	0 99	<1	<1	<10	0.29	7 5	7.52	5 0
16-May-13		117	360140	0.84	1 03	<1	<1	<10	0.25	6.6	7 51	4.0
15-May-13		118	360148	0.86	0 99	<1	<1	<10	0.35	6 8	7 51	8.0
16-May-13		118	360144	0.79	0 97	<1	<1	<10	0.26	6 9	7 54	3.0
15-May-13		118	360149	0.79	1 00	<1	<1	50	0.30	7.7	7.52	12.0
16-May-13		118	360145	0.68	0 81	<1	<1	<10	0.20	7.1	7 59	7.0
16-May-13		129	360192	0.50	0.61	<1	<1	<10	0.27	6.6	7.58	7 5
17-May-13		129	360186	0.79	1 03	<1	<1	<10	0.35	7 0	7.44	7 5
16-May-13		129	360191	0.82	0 97	<1	<1	<10	0.30	6 2	7.48	7 0
17-May-13		129	360185	0.82	1 04	<1	<1	<10	0.26	7.1	7.40	10.0
16-May-13		130	360194	0.79	1 01	<1	<1	<10	0.31	6 8	7.51	10.0
17-May-13		130	360190	0.94	1.10	<1	<1	<10	0.35	7 5	7.48	7 5
16-May-13		130	360193	0.84	0 99	<1	<1	<10	0.21	7 3	7.57	5 0
17-May-13		130	360189	0.92	1 08	<1	<1	10	0.36	7.1	7.51	10.0
17-May-13		138	360234	0.78	1 00	<1	<1	760	0.29	6 8	7.44	10.0
21-May-13		138	360228	0.58	0.74	<1	<1	<10	0.18	6.4	7.40	5 0
17-May-13		138	360235	0.87	1 01	<1	<1	<10	0.40	6 2	7.38	10.0
21-May-13		138	360229	0.64	0 84	<1	<1	<10	0.24	6.6	7.45	5 0

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
17-May-13		140	360236	0.76	1 00	<1	<1	<10	0.20	5 9	7.44	10.0
21-May-13		140	360232	0.63	0 93	<1	<1	10	0.21	7 3	7.41	5.0
17-May-13		140	360237	0.81	0 99	<1	<1	<10	0.23	6 5	7.47	13.0
21-May-13		140	360233	0.71	0 96	<1	<1	<10	0.29	7.1	7.45	5.0
21-May-13		183	360763	0.79	0 87	<1	<1	<10	0.24	6.4	7.42	5.0
22-May-13		183	360757	0.65	0 90	<1	<1	<10	1.38	6 9	7.50	12.0
24-May-13		183	361111	NA	NA	NA	NA	NA	0.16	NA	NA	NA
21-May-13		183	360764	0.75	0 87	<1	<1	<10	0.21	6 5	7.46	5 0
22-May-13		183	360758	0.37	0 53	<1	<1	<10	2.08	7.1	7.50	24.0
24-May-13		183	361112	NA	NA	NA	NA	NA	0.22	NA	NA	NA
21-May-13		184	360766	0.46	0.67	<1	<1	<10	0.23	7 0	7.51	2 5
22-May-13		184	360762	0.61	0.78	<1	<1	120	1.44	7 3	7.60	7.5
24-May-13		184	361118	NA	NA	NA	NA	NA	0.29	NA	NA	NA
21-May-13		184	360765	0.64	0.76	<1	<1	10	0.20	7 0	7.45	5 0
22-May-13		184	360761	0.70	0 82	<1	<1	<10	7.96	6 9	7 58	30.0
24-May-13		184	361117	NA	NA	NA	NA	NA	0.24	NA	NA	NA
22-May-13		190	360809	0.58	0 80	<1	<1	<10	0.58	7.1	7.51	3.0
23-May-13		190	360803	0.79	0 91	<1	<1	<10	0.36	7 0	7.63	7.5
22-May-13		190	360808	0.68	0 95	<1	<1	<10	0.31	7 3	7.49	5.0
23-May-13		190	360802	0.75	0 97	<1	<1	<10	0.18	7.7	7.45	2.5
22-May-13		191	360810	0.61	0.75	<1	<1	60	0.36	6 9	7 55	3.0
23-May-13		191	360806	0.74	0 99	<1	<1	<10	0.19	8 0	7.50	7 5
22-May-13		191	360811	0.90	1 09	<1	<1	<10	2.09	8 3	7.43	23.0
23-May-13		191	360807	0.81	1 02	<1	<1	<10	0.32	7 8	7.54	6 0
23-May-13		200	360920	0.78	0 94	<1	<1	<10	0.97	8.1	7.64	14.0
24-May-13		200	360914	0.78	0 93	<1	<1	<10	0.27	8 2	7.70	7 5
23-May-13		200	360919	0.75	1 03	<1	<1	<10	0.62	8.1	7.60	15.0
24-May-13		200	360913	0.75	0 93	<1	<1	<10	0.36	8 8	7.56	4 0

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100m L)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
23-May-13		201	360922	0.75	0 96	<1	<1	<10	0.98	7 0	7.63	40.0
24-May-13		201	360918	0.68	0 96	<1	<1	<10	0.44	7.4	7.57	11.0
23-May-13		201	360921	0.70	0 92	<1	<1	<10	0.91	6 0	7.61	32.0
24-May-13		201	360917	0.84	0 98	<1	<1	<10	0.30	7 3	7.62	11.0
24-May-13		212	361018	0.51	0.78	<1	<1	<10	0.20	8 8	7.63	3 0
27-May-13		212	361012	0.72	1 02	<1	<1	<10	0.25	8.6	7 52	6.0
24-May-13		212	361017	0.58	0 85	<1	<1	30	0.20	9 0	7.58	5 0
27-May-13		212	361011	0.79	0 97	<1	<1	<10	0.31	8.4	7 59	4.0
24-May-13		213	361020	0.80	1 00	<1	<1	<10	0.48	7 8	7 58	12.0
27-May-13		213	361016	0.77	0 97	<1	<1	<10	0.27	8.1	7.55	7.0
24-May-13		213	361019	0.85	1 00	<1	<1	<10	0.20	8 3	7 52	7.0
27-May-13		213	361015	0.75	0 90	<1	<1	<10	0.32	8.6	7.51	7 5
27-May-13		246	361255	0.66	0 83	<1	<1	<10	0.20	9 0	7 56	5.0
28-May-13		246	361249	1.03	1.11	<1	<1	<10	0.38	8.6	7 56	5.0
27-May-13		246	361254	0.85	1 03	<1	<1	<10	1.51	7.7	7.64	40.0
28-May-13		246	361248	1.10	1 25	<1	<1	10	0.24	9.6	7.45	6.0
27-May-13		247	361256	0.65	0 84	<1	<1	<10	0.19	8.1	7.56	6 0
28-May-13		247	361252	0.89	1.16	<1	<1	<10	0.23	7 5	7 57	6.0
27-May-13		247	361257	0.64	0 89	<1	<1	<10	0.19	8.7	7.56	5 0
28-May-13		247	361253	1.07	1 24	<1	<1	20	0.23	7 9	7.52	3 0
28-May-13		256	361321	0.66	0 86	<1	<1	<10	0.21	9 2	7.47	6.0
29-May-13		256	361315	0.83	1 02	<1	<1	<10	0.22	9 8	7.56	4 0
28-May-13		256	361320	0.85	1.10	<1	<1	<10	0.25	9 0	7.52	6 0
29-May-13		256	361314	0.63	0 88	<1	<1	<10	0.28	9 9	7.64	6 0
28-May-13		257	361322	0.82	1 03	<1	<1	<10	0.85	8.4	7.57	24.0
29-May-13		257	361318	0.81	1 05	<1	<1	<10	0.24	8 5	7.53	4 0
28-May-13		257	361323	1.12	1 27	<1	<1	<10	0.52	7 9	7.50	14.0
29-May-13		257	361319	0.59	0.77	<1	<1	<10	0.19	7 9	7.57	6 0

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
29-May-13		268	361758	0.44	0.66	<1	<1	<10	0.21	8 5	7.57	3 0
30-May-13		268	361752	0.76	0 93	<1	<1	<10	0.30	8 3	7.48	6.0
29-May-13		268	361759	0.65	0 86	<1	<1	<10	0.24	8.4	7.59	5 0
30-May-13		268	361753	0.78	0 94	<1	<1	<10	0.29	8 5	7.61	2 5
29-May-13		269	361761	0.73	0 88	<1	<1	<10	0.51	7 0	7 59	5.0
30-May-13		269	361757	0.53	0.60	<1	<1	<10	3.52	8 9	7.63	8 0
3-Jun-13		269	362124	NA	NA	NA	NA	NA	0.44	NA	NA	NA
29-May-13		269	361760	0.75	0 91	<1	<1	<10	0.34	7 8	7 58	4.0
30-May-13		269	361756	0.78	0 91	<1	<1	<10	0.31	8.7	7 57	5.0
30-May-13		279	361836	0.58	0.73	<1	<1	<10	0.35	6 9	7.64	7.5
31-May-13		279	361830	0.42	0 53	<1	<1	<10	0.21	7.4	7.64	3 0
30-May-13		279	361835	0.60	0.77	<1	<1	<10	0.55	6 8	7.75	10.0
31-May-13		279	361829	0.41	0 50	<1	<1	<10	0.21	7 9	7.71	4 0
30-May-13		280	361837	0.60	0.76	<1	<1	<10	0.39	6 3	7.70	5 0
31-May-13		280	361833	0.56	0.77	<1	<1	140	0.26	7 8	7.63	3 0
30-May-13		280	361838	0.30	0.46	<1	<1	<10	0.44	7 0	7.71	5 0
31-May-13		280	361834	0.54	0.78	<1	<1	<10	0.24	7 8	7.67	5 0
31-May-13		290	361883	0.96	1.17	<1	<1	30	0.16	9 8	7.43	4 0
3-Jun-13		290	361877	0.79	1 00	<1	<1	<10	0.25	10.3	7.65	10.0
31-May-13		290	361884	0.89	1 03	<1	<1	<10	0.16	8 5	7.50	4 0
3-Jun-13		290	361878	0.88	1 03	<1	<1	<10	0.21	9 3	7.61	8.0
31-May-13		291	361886	0.68	0 80	<1	<1	<10	0.16	8 9	7.56	4 0
3-Jun-13		291	361882	0.55	0.73	<1	<1	<10	0.22	10 3	7.62	7 5
31-May-13		291	361885	0.70	0 87	<1	<1	<10	0.17	10.1	7.49	2 5
3-Jun-13		291	361881	0.97	1.10	<1	<1	<10	0.20	8.6	7.59	5 0
3-Jun-13		324	362119	0.79	0 96	<1	<1	<10	0.23	10.6	7.68	10.0
4-Jun-13		324	362113	0.80	0 90	<1	<1	<10	0.24	9 2	7.74	7 0
3-Jun-13		324	362120	0.17	0 32	<1	<1	<10	0.53	10 0	7.65	9 0
4-Jun-13		324	362114	0.79	0 92	<1	<1	<10	0.26	8 5	7.71	5 0

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
3-Jun-13		325	362121	0.80	0 98	<1	<1	<10	0.34	8 0	7.66	8.0
4-Jun-13		325	362117	0.81	1 00	<1	<1	<10	0.23	8.6	7.55	6.0
3-Jun-13		325	362122	0.75	0 95	<1	<1	<10	0.29	8 2	7.69	11.0
4-Jun-13		325	362118	0.80	1 04	<1	<1	<10	0.26	8.6	7.60	2 5
4-Jun-13		334	362149	0.96	1 07	<1	<1	<10	0.23	11.6	7.62	7 5
5-Jun-13		334	362143	0.73	0 93	<1	<1	<10	0.39	12 3	7.66	12.0
4-Jun-13		334	362150	0.69	0 83	<1	<1	<10	0.25	14 2	7.65	7 5
5-Jun-13		334	362144	0.64	0 97	<1	<1	<10	0.29	14.4	7.65	8 0
5-Jun-13		340	362545	0.52	0.76	<1	<1	<10	0.22	14.6	7.57	8 0
6-Jun-13		340	362539	0.55	0.75	<1	<1	<10	0.24	11.1	7.54	7 0
5-Jun-13		340	362546	0.70	0 83	<1	<1	<10	0.31	13.4	7.64	10.0
6-Jun-13		340	362540	0.72	0 85	<1	<1	10	0.21	10 3	7.66	6 0
5-Jun-13		341	362547	0.70	0 88	<1	<1	<10	0.49	10 5	7.59	12.0
6-Jun-13		341	362543	0.59	0.75	<1	<1	<10	0.30	11.1	7.51	10.0
5-Jun-13		341	362548	0.74	0 91	<1	<1	<10	0.49	10.1	7.55	13.0
6-Jun-13		341	362544	0.72	0 91	<1	<1	10	0.38	10 5	7.58	10.0
6-Jun-13		349	362616	0.88	1 02	<1	<1	<10	0.23	9 0	7.53	7 0
10-Jun-13		349	362610	0.84	1 07	<1	<1	<10	0.33	10.6	7.52	7 5
6-Jun-13		349	362615	0.82	0 97	<1	<1	<10	0.21	12.1	7.50	7 5
10-Jun-13		349	362609	0.78	0 99	<1	<1	<10	0.27	12.4	7.59	10.0
6-Jun-13		350	362617	0.64	0.79	<1	<1	<10	0.37	7.7	7.56	13.0
10-Jun-13		350	362613	0.71	0 93	<1	<1	<10	0.29	7.6	7.56	6 0
6-Jun-13		350	362618	0.57	0.74	<1	<1	<10	0.35	9.7	7.54	13.0
10-Jun-13		350	362614	0.68	0 84	<1	<1	<10	0.26	9 9	7.52	5 0
7-Jun-13		352	362681	0.50	0.61	<1	<1	NR	0.32	10 8	7.57	11.0
10-Jun-13		352	362677	0.54	0.71	<1	<1	10	0.88	12 2	7.52	8 0
7-Jun-13		352	362680	0.41	0 57	<1	<1	NR	0.42	9 8	7.61	9 0
10-Jun-13		352	362676	0.51	0.68	<1	<1	<10	0.89	10 8	7.50	10.0

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
7-Jun-13		353	362678	0.64	0 84	<1	<1	NR	0.28	10.6	7.64	3.0
10-Jun-13		353	362672	0.60	0 83	<1	<1	<10	0.25	10.2	7.62	4.0
7-Jun-13		353	362679	0.58	0.76	<1	<1	NR	0.33	11.0	7.65	4.0
10-Jun-13		353	362673	0.63	0.76	<1	<1	<10	0.27	10.8	7 59	3.5
10-Jun-13		374	362871	0.75	0 92	<1	<1	<10	0.26	10.8	7.52	4.0
11-Jun-13		374	362865	0.74	0 95	<1	<1	<10	0.26	12.1	7.48	4 0
10-Jun-13		374	362872	0.69	0 90	<1	<1	<10	0.25	11.1	7.63	3 0
11-Jun-13		374	362866	0.81	0 97	<1	<1	<10	0.21	12 2	7.45	5 0
10-Jun-13		375	362873	0.76	0 96	<1	<1	<10	0.22	11.1	7.61	5 0
11-Jun-13		375	362869	0.72	0 91	<1	<1	<10	0.27	10 8	7.43	4 5
10-Jun-13		375	362874	0.63	0 85	<1	<1	<10	0.68	10 3	7.63	7 5
11-Jun-13		375	362870	0.78	1 01	<1	<1	10	0.21	11.6	7.50	2 5
11-Jun-13		381	362893	0.24	0 57	<1	<1	<10	0.34	9 8	7.58	3 0
12-Jun-13		381	362887	0.31	0.49	<1	<1	10	0.77	9.6	7.71	9 0
11-Jun-13		381	362894	0.42	0.63	<1	<1	10	0.36	9 8	7.52	2 5
12-Jun-13		381	362888	0.28	0 51	<1	<1	20	0.91	10 2	7.53	11.0
11-Jun-13		383	362896	0.64	0 84	<1	<1	<10	0.26	10 3	7.46	5 0
12-Jun-13		383	362892	0.78	0 97	<1	<1	<10	0.28	11 3	7.58	13.0
11-Jun-13		383	362895	0.58	0 84	<1	<1	<10	0.26	9.4	7.48	5 0
12-Jun-13		383	362891	0.77	0 96	<1	<1	<10	0.23	10 5	7.54	7 5
12-Jun-13		390	363331	0.42	0.67	<1	<1	<10	0.22	10 8	7.58	0 5
13-Jun-13		390	363325	0.57	0.77	<1	<1	NR	0.20	12.4	7.57	0 5
12-Jun-13		390	363332	0.55	0.66	<1	<1	<10	0.52	12 8	7.64	0 5
13-Jun-13		390	363326	0.55	0.71	<1	<1	NR	0.17	13 3	7.54	0 5

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100m L)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
12-Jun-13		391	363333	0.45	0.66	<1	<1	<10	0.50	9 5	7 58	0.5
13-Jun-13		391	363329	0.26	0.42	<1	<1	NR	0.91	9.4	7 57	0.5
12-Jun-13		391	363334	0.57	0.75	<1	<1	<10	0.29	8 9	7 59	0.5
13-Jun-13		391	363330	0.26	0.40	<1	<1	NR	0.90	9 2	7 51	0.5
13-Jun-13		393	363408	0.66	0 93	<1	<1	NR	0.21	10 9	7.58	0 5
14-Jun-13		393	363402	0.83	1 02	<1	<1	NR	0.21	11.5	7.62	0.5
13-Jun-13		393	363409	0.76	0 95	<1	<1	NR	0.22	10.9	7.52	0 5
14-Jun-13		393	363403	0.80	0 98	<1	<1	NR	0.21	11.5	7.64	0.5
13-Jun-13		394	363410	0.75	0 93	<1	<1	NR	0.32	11.3	7.49	0.5
14-Jun-13		394	363406	0.77	0 95	<1	<1	NR	0.31	11.4	7 58	0.5
13-Jun-13		394	363411	0.73	0 90	<1	<1	NR	0.19	12.1	7 52	0.5
14-Jun-13		394	363407	0.70	0 91	<1	<1	NR	0.32	11.1	7.63	0.5
14-Jun-13		403	363448	0.65	0.75	<1	<1	NR	0.31	9 8	7.61	0.5
17-Jun-13		403	363442	0.49	0.71	<1	<1	<10	0.28	10.0	7.57	1.0
14-Jun-13		403	363449	0.53	0.76	<1	<1	NR	0.42	10.0	7 59	0.5
17-Jun-13		403	363443	0.50	0.69	<1	<1	10	0.27	10.2	7.59	1.0
14-Jun-13		404	363450	0.62	0.74	<1	<1	NR	0.34	8.6	7.60	0 5
17-Jun-13		404	363446	0.73	0 91	<1	<1	30	0.25	10.1	7.61	0.5
14-Jun-13		404	363451	0.56	0.69	<1	<1	NR	0.32	9 0	7 56	0.5
17-Jun-13		404	363447	0.73	0 85	<1	<1	20	0.29	10.5	7.63	0.5
17-Jun-13		428	363650	0.64	0.81	<1	<1	<10	0.45	12.4	7.70	0.5
18-Jun-13		428	363644	0.57	0.72	<1	<1	NR	0.55	13.1	7.65	0.5
17-Jun-13		428	363651	0.64	0.85	<1	<1	<10	0.38	11.6	7.64	0.5
18-Jun-13		428	363645	0.53	0.73	<1	<1	NR	0.56	11.6	7.64	0.5
17-Jun-13		430	363652	0.35	0.53	<1	<1	10	0.41	7.7	7.67	1.0
18-Jun-13		430	363648	0.54	0.73	<1	<1	NR	0.60	10.2	7 59	0.5
17-Jun-13		430	363653	0.35	0.51	<1	<1	10	0.40	7.5	7.65	0.5
18-Jun-13		430	363649	0.45	0.67	<1	<1	NR	0.62	10.9	7.65	1.0

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
18-Jun-13		435	363692	0.58	0 80	<1	<1	NR	0.26	10.1	7 53	0.5
19-Jun-13		435	363686	0.78	0 98	<1	<1	<10	0.33	11.7	7.63	0.5
18-Jun-13		435	363693	0.64	0.79	<1	<1	NR	0.30	9.7	7.60	0.5
19-Jun-13		435	363687	0.79	1 00	<1	<1	10	0.36	12.1	7.60	0.5
18-Jun-13		436	363694	0.60	0.78	<1	<1	NR	0.33	9.4	7 56	0.5
19-Jun-13		436	363690	0.77	0 96	<1	<1	<10	0.45	11.1	7.62	0.5
18-Jun-13		436	363695	0.60	0 80	<1	<1	NR	0.35	9.1	7 53	0.5
19-Jun-13		436	363691	0.74	0 89	<1	<1	<10	0.37	11.2	7.63	0.5
19-Jun-13		443	364148	0.58	0 83	<1	<1	<10	0.51	9.6	7.55	0 5
20-Jun-13		443	364142	0.66	0 82	<1	<1	10	0.34	10 5	7.55	0 5
19-Jun-13		443	364149	0.54	0.78	<1	<1	<10	0.40	10.6	7.64	0 5
20-Jun-13		443	364143	0.65	0.77	<1	<1	<10	0.38	11 2	7.62	0 5
19-Jun-13		444	364150	0.45	0.63	<1	<1	<10	1.23	9 2	7.63	0 5
20-Jun-13		444	364146	0.56	0.69	<1	<1	<10	0.54	9.7	7.55	0 5
19-Jun-13		444	364151	0.53	0.74	<1	<1	<10	1.11	9 0	7.63	0 5
20-Jun-13		444	364147	0.49	0.62	<1	<1	<10	0.47	9.6	7.63	1 0
20-Jun-13		456	364200	0.86	1 07	<1	<1	<10	0.35	9 9	7.61	0 5
21-Jun-13		456	364194	0.82	0 99	<1	<1	<10	0.34	10 9	7.51	1 0
20-Jun-13		456	364201	0.83	1.10	<1	<1	<10	0.28	11.4	7.62	0 5
21-Jun-13		456	364195	0.81	1 00	<1	<1	<10	0.37	11 8	7.58	0 5
20-Jun-13		457	364202	0.55	0.75	<1	<1	<10	0.39	10 2	7.65	1 0
21-Jun-13		457	364198	0.24	0.40	<1	<1	<10	10.70	11 3	7.51	1 0
24-Jun-13		457	364462	NA	NA	NA	NA	NA	0.22	NA	NA	NA
20-Jun-13		457	364203	0.66	0 80	<1	<1	<10	0.36	11.4	7.62	0 5
21-Jun-13		457	364199	0.98	1.17	<1	<1	<10	8.77	12.4	7.58	0 5
24-Jun-13		457	364463	NA	NA	NA	NA	NA	0.23	NA	NA	NA
21-Jun-13		464	364241	0.52	0.76	<1	<1	10	0.94	11.4	7.49	0 5
24-Jun-13		464	364235	0.34	0 50	<1	<1	<10	0.58	9.6	7.60	1 0
21-Jun-13		464	364242	0.54	0.71	<1	<1	10	1.26	10.4	7.49	1 0

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
24-Jun-13		464	364236	0.41	0 56	<1	<1	<10	0.41	8 9	7.61	0.5
21-Jun-13		466	364243	0.72	0 91	<1	<1	20	0.23	11.1	7.68	1.0
24-Jun-13		466	364239	0.56	0.69	<1	<1	40	0.27	9 8	7.66	1.0
21-Jun-13		466	364244	0.61	0 81	<1	<1	50	0.32	9.4	7.64	1.0
24-Jun-13		466	364240	0.41	0 59	<1	<1	30	0.36	10.8	7.64	1.0
24-Jun-13		497	364446	0.82	1 04	<1	<1	<10	0.23	17.8	7.66	1.0
25-Jun-13		497	364440	0.86	0 99	<1	<1	<10	0.46	17.3	7.57	0.5
24-Jun-13		497	364447	0.88	1 03	<1	<1	10	0.21	17.7	7.67	1 0
25-Jun-13		497	364441	0.77	0 94	<1	<1	<10	0.49	17 3	7.57	0 5
24-Jun-13		498	364448	0.70	0 85	<1	<1	10	0.23	14 0	7.60	1 0
25-Jun-13		498	364444	0.67	0 86	<1	<1	<10	0.32	14.1	7.47	0 5
24-Jun-13		498	364449	0.82	1 01	<1	<1	<10	0.27	13 9	7.49	1 0
25-Jun-13		498	364445	0.61	0.76	<1	<1	10	0.37	13 5	7.43	0 5
25-Jun-13		505	364821	0.64	0 86	<1	<1	<10	0.22	9.6	7.49	0 5
26-Jun-13		505	364815	0.84	0 99	<1	<1	<10	0.25	12.6	7.49	0 5
25-Jun-13		505	364822	0.75	0 92	<1	<1	<10	0.32	12.1	7.59	1 0
26-Jun-13		505	364816	0.83	0 93	<1	<1	<10	0.24	14 0	7.54	1 0
25-Jun-13		506	364823	0.71	0 92	<1	<1	10	0.33	12 0	7.50	0 5
26-Jun-13		506	364819	0.39	0.60	<1	<1	<10	0.23	13 0	7.67	1 0
25-Jun-13		506	364824	0.66	0 84	<1	<1	<10	0.35	13 3	7.49	0 5
26-Jun-13		506	364820	0.67	0.79	<1	<1	<10	0.22	15 3	7.59	0 5
26-Jun-13		514	364901	0.66	0 84	<1	<1	<10	0.25	10 3	7.59	0 5
27-Jun-13		514	364895	0.54	0.72	<1	<1	<10	0.27	11 9	7.59	0 5
26-Jun-13		514	364902	0.62	0.76	<1	<1	<10	0.24	11 9	7.64	1 0
27-Jun-13		514	364896	0.60	0 80	<1	<1	<10	0.25	11 5	7.56	0 5

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
26-Jun-13		515	364903	0.65	0 81	<1	<1	<10	0.23	9 0	7.60	0.5
27-Jun-13		515	364899	0.63	0 80	<1	<1	10	0.30	9 8	7.67	0.5
26-Jun-13		515	364904	0.66	0.77	<1	<1	<10	0.26	10.0	7.67	1.0
27-Jun-13		515	364900	0.65	0 82	<1	<1	<10	0.31	9 9	7.61	0.5
27-Jun-13		523	364974	0.72	0 85	<1	<1	<10	0.22	11.8	7.56	0.5
28-Jun-13		523	364968	0.70	0 98	<1	<1	<10	0.27	11.7	7 58	0.5
27-Jun-13		523	364975	0.69	0 82	<1	<1	30	0.17	12.5	7.53	1.0
28-Jun-13		523	364969	0.72	0 90	<1	<1	<10	0.20	12.2	7 54	0.5
27-Jun-13		524	364976	0.50	0.70	<1	<1	<10	0.22	10.1	7.55	0 5
28-Jun-13		524	364972	0.67	0 88	<1	<1	<10	0.21	11.4	7.58	0 5
27-Jun-13		524	364977	0.70	0 85	<1	<1	10	0.18	13 5	7.41	1 0
28-Jun-13		524	364973	0.54	0.76	<1	<1	<10	0.22	11.6	7.46	1 0
28-Jun-13		534	365009	0.52	0.72	1	<1	<10	0.32	11.1	7.52	0 5
30-Jun-13		534	365003	0.23	0.42	<1	<1	<10	0.28	12 0	7.45	0 5
28-Jun-13		534	365010	0.72	0 90	<1	<1	<10	0.22	11.6	7.45	0 5
30-Jun-13		534	365004	0.72	0 87	<1	<1	<10	0.18	12.1	7.50	0 5
28-Jun-13		535	365011	0.77	0 99	<1	<1	<10	0.21	13 3	7.51	0 5
30-Jun-13		535	365007	0.71	0 86	<1	<1	<10	0.17	13.6	7.54	0 5
28-Jun-13		535	365012	0.72	0 89	<1	<1	<10	0.19	14.1	7.45	1 0
30-Jun-13		535	365008	0.63	0 81	<1	<1	<10	0.20	14.1	7.57	1 0
3-Jul-13		569	365187	0.56	0.77	<1	<1	<10	0.21	12 8	7.63	0 5
4-Jul-13		569	365181	0.68	0 90	<1	<1	<10	0.21	11.9	7.65	1.0
3-Jul-13		569	365188	0.71	0 85	<1	<1	<10	0.20	14.1	7.54	0 5
4-Jul-13		569	365182	0.51	0.70	<1	<1	<10	0.24	13.2	7 52	1.0
3-Jul-13		570	365189	0.51	0.69	5	<1	140	0.22	12.1	7.61	0.5
4-Jul-13		570	365185	0.77	1 00	27	<1	1100	0.38	11 9	7.60	0 5
8-Jul-13		570	365907	0.56	0.76	<1	<1	80	0.24	11 0	NA	NA

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
3-Jul-13		570	365190	0.59	0.78	<1	<1	<10	0.23	11.8	7.64	0.5
4-Jul-13		570	365186	0.87	1.10	<1	<1	<10	0.40	14 8	7 58	0.5
4-Jul-13		583	365611	0.64	0.79	<1	<1	<10	0.28	12.0	7 56	1.0
5-Jul-13		583	365605	0.80	0 94	<1	<1	<10	0.25	15.8	7 58	1.0
4-Jul-13		584	365613	0.54	0.77	<1	<1	<10	0.18	10.9	7 58	0.5
5-Jul-13		584	365609	0.87	1 00	<1	<1	10	0.27	12.6	7 52	1.0
4-Jul-13		583	365610	0.54	0.79	1	<1	<10	0.20	13.1	7 52	1.0
5-Jul-13		583	365604	0.69	0 95	<1	<1	<10	0.25	16.0	7 53	1.0
4-Jul-13		584	365612	0.63	0 84	<1	<1	<10	0.19	11 0	7.67	0 5
5-Jul-13		584	365608	0.69	0 89	<1	<1	<10	0.32	11.9	7 56	1.0
5-Jul-13		596	365712	0.44	0.65	<1	<1	<10	0.24	12 2	7.55	1 0
8-Jul-13		596	365708	0.40	0 52	<1	<1	10	0.24	15 5	7.78	0 5
5-Jul-13		596	365711	0.84	0 98	<1	<1	<10	0.23	12.1	7.57	1 0
8-Jul-13		596	365707	0.22	0 39	<1	<1	<10	0.30	11 3	7.65	0 5
5-Jul-13		594	365710	0.74	0 93	<1	<1	10	0.27	12 3	7.51	1 0
8-Jul-13		594	365704	0.62	0.78	<1	<1	<10	0.29	12 8	7.64	0 5
5-Jul-13		594	365709	0.80	0 99	<1	<1	<10	0.30	12 0	7.56	1 0
8-Jul-13		594	365703	0.66	0 93	<1	<1	<10	0.30	13 5	7.65	0 5
8-Jul-13		614	365873	0.57	0.71	<1	<1	<10	0.30	10 5	7.71	0 5
9-Jul-13		614	365867	0.52	0.69	<1	<1	<10	0.25	10 0	7.71	1 0
8-Jul-13		616	365874	0.53	0.68	<1	<1	<10	7.09	12.1	7.70	1 0
9-Jul-13		616	365870	0.61	0.78	<1	<1	<10	0.28	14.7	7.69	0 5
8-Jul-13		616	365875	0.22	0 52	<1	<1	80	0.39	13 0	7.79	0 5
9-Jul-13		616	365871	0.51	0.63	<1	<1	<10	0.31	13 0	7.77	0 5
8-Jul-13		614	365872	0.43	0.65	<1	<1	<10	0.28	9.1	7.67	1 0
9-Jul-13		614	365866	0.58	0.76	<1	<1	<10	0.28	9 3	7.65	0 5
9-Jul-13		626	365923	0.40	0.62	<1	<1	<10	0.22	11 8	7.65	1 0
10-Jul-13		626	365917	0.48	0.66	<1	<1	<10	0.26	12 2	7.65	0 5

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
9-Jul-13		626	365922	0.27	0.44	<1	<1	<10	0.22	13 0	7.70	1 0
10-Jul-13		626	365916	0.42	0.68	<1	<1	<10	0.31	11.6	7.69	1 0
9-Jul-13		628	365924	0.43	0.62	<1	<1	<10	0.32	11 9	7.61	0 5
10-Jul-13		628	365920	0.52	0.73	<1	<1	10	0.36	11.9	7.62	0.5
9-Jul-13		628	365925	0.47	0 59	<1	<1	<10	0.30	12 8	7.65	0 5
10-Jul-13		628	365921	0.50	0.69	<1	<1	<10	0.29	12.2	7.66	1.0
10-Jul-13		634	366340	0.56	0.73	<1	<1	10	0.24	12.7	7.67	1 0
11-Jul-13		634	366336	0.40	0 59	<1	<1	<10	0.33	12.6	7.74	0.5
10-Jul-13		634	366341	0.66	0 86	<1	<1	<10	0.21	13.1	7.68	0 5
11-Jul-13		634	366337	0.45	0.60	<1	<1	<10	0.32	13.1	7.68	0.5
10-Jul-13		632	366338	0.62	0 84	<1	<1	<10	0.77	12.7	7.57	1 0
11-Jul-13		632	366332	0.60	0.78	<1	<1	<10	0.25	13.5	7.71	0.5
10-Jul-13		632	366339	0.34	0.46	<1	<1	<10	0.59	13 3	7.62	0 5
11-Jul-13		632	366333	0.56	0.74	<1	<1	<10	0.27	13.3	7.70	0.5
11-Jul-13		645	366389	0.52	0.70	83	<1	20	0.22	13 0	7.77	0 5
12-Jul-13		645	366383	0.69	0 90	56	<1	40	0.25	13 5	7.61	0 5
16-Jul-13		645	366653	0.54	0.75	53	<1	80	0.19	14 5	NA	NA
16-Jul-13		645	366654	0.43	0.64	<1	<1	<10	0.21	13 8	NA	NA
16-Jul-13		645	366655	0.44	0.68	<1	<1	<10	0.19	12 8	NA	NA
11-Jul-13		645	366390	0.40	0.61	<1	<1	<10	0.29	12 5	7.70	0 5
12-Jul-13		645	366384	0.24	0 37	<1	<1	<10	0.31	16 0	7.66	0 5
11-Jul-13		648	366391	0.42	0.64	<1	<1	<10	0.20	11.3	7.70	0.5
12-Jul-13		648	366387	1.04	1 26	<1	<1	<10	2.44	16 0	7.62	0 5
15-Jul-13		648	366640	NA	NA	NA	NA	NA	0.21	NA	NA	NA
11-Jul-13		648	366392	0.62	0 86	<1	<1	<10	0.28	16 0	7.67	0 5
12-Jul-13		648	366388	0.84	1 08	<1	<1	<10	2.58	15 2	7.59	0 5
15-Jul-13		648	366641	NA	NA	NA	NA	NA	0.20	NA	NA	NA

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
12-Jul-13		652	366432	0.58	0.76	>200	<1	70	0.23	12 0	7.66	11.0
15-Jul-13		652	366426	0.60	0 89	<1	<1	30	0.20	17.0	7.61	0.5
16-Jul-13		652	366656	0.72	0 84	2	<1	<10	0.22	15.9	NA	NA
19-Jul-13		652	367229	0.35	0 55	<1	<1	<10	0.17	13.9	NA	NA
16-Jul-13		652	366657	0.70	0 85	<1	<1	<10	0.20	17.0	NA	NA
16-Jul-13		652	366658	0.55	0.75	<1	<1	<10	0.19	15.0	NA	NA
12-Jul-13		652	366433	0.54	0.74	<1	<1	<10	0.19	13 5	7.61	12.0
15-Jul-13		652	366427	0.58	0 82	<1	<1	30	0.18	15.3	7.56	0.5
12-Jul-13		653	366435	0.63	0 80	<1	<1	<10	0.19	12 8	7.59	0 5
15-Jul-13		653	366431	0.69	0 87	<1	<1	<10	0.32	15.1	7.61	0 5
12-Jul-13		653	366434	0.62	0.75	<1	<1	<10	0.21	12 8	7.65	0 5
15-Jul-13		653	366430	0.61	0.75	<1	<1	<10	0.30	12 8	7.68	0 5
15-Jul-13		685	366617	0.48	0.65	<1	<1	<10	0.38	14.1	7.65	0 5
16-Jul-13		685	366611	0.45	0.73	<1	<1	<10	0.20	14 5	7.60	0 5
15-Jul-13		686	366619	0.74	0 90	<1	<1	10	0.23	14.6	7.64	0 5
16-Jul-13		686	366615	0.49	0.70	<1	<1	<10	0.19	13 8	7.56	0 5
15-Jul-13		686	366618	0.78	0 92	<1	<1	<10	0.32	16 0	7.68	0 5
16-Jul-13		686	366614	0.44	0.60	<1	<1	<10	0.21	13 0	7.60	0 5
15-Jul-13		685	366616	0.68	0 88	<1	<1	10	0.39	13.6	7.62	0 5
16-Jul-13		685	366610	0.48	0.63	<1	<1	10	0.21	13 8	7.63	0 5
16-Jul-13		697	366666	0.60	0.76	3	<1	<10	0.25	13 8	7.63	0 5
19-Jul-13		697	366660	0.48	0.64	<1	<1	<10	0.19	15 0	7.66	0 5
16-Jul-13		697	366665	0.57	0.79	<1	<1	30	0.31	11 8	7.56	0 5
19-Jul-13		697	366659	0.41	0.60	<1	<1	<10	0.23	12 5	7.64	1 0
16-Jul-13		698	366668	0.52	0.64	<1	<1	<10	0.20	15 8	7.63	0 5
19-Jul-13		698	366664	0.50	0.64	<1	<1	<10	0.21	14 9	7.66	1 0
16-Jul-13		698	366667	0.55	0.78	<1	<1	<10	0.21	13 0	7.62	0 5
19-Jul-13		698	366663	0.60	0.72	<1	<1	<10	0.24	13.6	7.64	0 5

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
19-Jul-13		713	367225	0.55	0.75	<1	<1	<10	0.17	13.7	7.49	1 0
22-Jul-13		713	367219	0.70	0 95	<1	<1	<10	0.21	17.7	7 53	1.0
19-Jul-13		713	367224	0.72	0 93	<1	<1	20	0.20	14 3	7.59	1 0
22-Jul-13		713	367218	0.64	0 84	<1	<1	<10	0.13	14.6	7.56	1 0
19-Jul-13		714	367227	0.65	0 83	<1	<1	<10	0.14	15 2	7.57	0 5
22-Jul-13		714	367223	0.73	0 86	<1	<1	<10	0.11	14.8	7.60	1.0
19-Jul-13		714	367226	0.65	0.79	<1	<1	<10	0.16	13 0	7.57	0 5
22-Jul-13		714	367222	0.61	0.76	<1	<1	<10	0.12	14.6	7.54	1 0
22-Jul-13		741	367435	0.69	0 88	<1	<1	<10	0.14	15.6	7.57	1 0
23-Jul-13		741	367429	0.71	0 92	<1	<1	<10	0.15	16.1	7.54	1 0
22-Jul-13		742	367437	0.71	0 86	<1	<1	<10	0.11	15.6	7.62	1 0
23-Jul-13		742	367433	0.61	0.78	<1	<1	<10	0.11	15 0	7.69	1 0
22-Jul-13		741	367436	0.50	0.68	<1	<1	<10	0.17	16.1	7.62	1 0
23-Jul-13		741	367430	0.68	0 86	<1	<1	10	0.16	14 9	7.59	1 0
22-Jul-13		742	367438	0.75	0 91	<1	<1	<10	0.10	15.4	7.57	1 0
23-Jul-13		742	367434	0.65	0 84	<1	<1	<10	0.10	13 9	7.59	1 0
23-Jul-13		752	367464	0.44	0.61	<1	<1	<10	0.14	14 5	7.57	1 0
24-Jul-13		752	367460	0.61	0.78	<1	<1	NR	0.13	14 5	7.61	0 5
23-Jul-13		751	367461	0.50	0.72	<1	<1	10	0.23	14.6	7.54	1 0
24-Jul-13		751	367455	0.70	0 90	<1	<1	NR	0.17	16 0	7.58	0 5
23-Jul-13		751	367462	0.54	0.72	<1	<1	10	0.18	16.1	7.58	1 0
24-Jul-13		751	367456	0.76	0 89	<1	<1	NR	0.25	14 2	7.63	0 5
23-Jul-13		752	367463	0.61	0 83	<1	<1	<10	0.17	13 5	7.58	1 0
24-Jul-13		752	367459	0.58	0.70	<1	<1	NR	0.16	13 8	7.61	0 5
24-Jul-13		761	367868	0.62	0.79	<1	<1	NR	0.15	13.1	7.48	1 0
25-Jul-13		761	367862	0.72	0 85	<1	<1	<10	0.20	16.7	7.54	1 0
24-Jul-13		761	367867	0.64	0 86	<1	<1	NR	0.19	15.4	7.50	1 0
25-Jul-13		761	367861	0.67	0 85	<1	<1	10	0.17	17 0	7.48	1 0

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
24-Jul-13		763	367870	0.44	0.60	<1	<1	NR	0.17	16 0	7.58	0 5
25-Jul-13		763	367866	0.62	0.77	<1	<1	10	0.49	15.5	7.66	2.5
24-Jul-13		763	367869	0.64	0.81	<1	<1	NR	0.18	14.5	7 52	0.5
25-Jul-13		763	367865	0.49	0.62	<1	<1	20	1.52	14.5	7 55	2.5
26-Jul-13		763	367952	NA	NA	NA	NA	NA	0.17	NA	NA	NA
25-Jul-13		775	367912	0.42	0.63	<1	<1	30	0.10	13.2	7.64	1.0
26-Jul-13		775	367908	0.22	0.32	<1	<1	NR	2.46	13.0	7 54	0.5
29-Jul-13		775	368147	NA	NA	NA	NA	NA	0.14	NA	NA	NA
25-Jul-13		774	367909	0.48	0.62	<1	<1	<10	0.16	13.7	7 57	1.0
26-Jul-13		774	367903	0.58	0.76	<1	<1	NR	0.24	16.4	7.48	0.5
25-Jul-13		774	367910	0.61	0.78	<1	<1	<10	0.13	16.0	7 55	1.0
26-Jul-13		774	367904	0.41	0.58	<1	<1	NR	0.19	14.0	7 56	0.5
25-Jul-13		775	367911	0.48	0.62	<1	<1	10	0.11	15.7	7.64	0.5
26-Jul-13		775	367907	0.21	0.37	<1	<1	NR	0.14	15.4	7 59	0.5
26-Jul-13		780	367948	0.50	0.62	<1	<1	NR	0.18	15.0	7 56	0.5
29-Jul-13		780	367942	0.61	0.76	<1	<1	<10	0.45	14.5	7.60	0.5
26-Jul-13		780	367947	0.49	0.67	<1	<1	NR	0.16	14.7	7.65	0.5
29-Jul-13		780	367941	0.42	0.56	<1	<1	<10	0.31	13.4	7.77	0.5
26-Jul-13		781	367950	0.36	0.49	<1	<1	NR	0.15	14.7	7 57	0.5
29-Jul-13		781	367946	0.70	0.84	<1	<1	<10	0.51	16.7	7.67	0.5
26-Jul-13		781	367949	0.48	0.61	<1	<1	NR	0.18	14.3	7.62	0.5
29-Jul-13		781	367945	0.75	0.89	<1	<1	<10	0.63	16.5	7.74	0.5
29-Jul-13		811	368142	0.37	0.51	<1	<1	<10	0.26	13.4	7.70	0.5
30-Jul-13		811	368136	0.37	0.60	<1	<1	<10	0.22	13.4	7.62	1.0
29-Jul-13		811	368143	0.27	0.48	<1	<1	<10	0.22	14.0	7.77	0.5
30-Jul-13		811	368137	0.37	0 50	<1	<1	<10	0.23	13.3	7.72	1.0
29-Jul-13		812	368145	0.66	0 84	<1	<1	<10	0.24	16.9	7.66	1.0
30-Jul-13		812	368141	0.41	0.59	<1	<1	<10	0.21	15.5	7 59	1.0
29-Jul-13		812	368144	0.47	0.68	<1	<1	<10	0.19	14.3	7.71	1.0

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
30-Jul-13		812	368140	0.51	0.66	<1	<1	<10	0.25	15.3	7.71	1.0
30-Jul-13		823	368172	0.74	0 91	<1	<1	<10	0.77	13.7	7.54	1 0
31-Jul-13		823	368168	0.45	0.63	<1	<1	<10	0.20	15.2	7 55	0.5
30-Jul-13		823	368173	0.44	0.60	<1	<1	<10	0.18	16 2	7.58	0 5
31-Jul-13		823	368169	0.38	0 55	<1	<1	<10	0.25	15.5	7.54	0.5
30-Jul-13		822	368170	0.74	0 91	<1	<1	<10	0.76	15.6	7.69	0 5
31-Jul-13		822	368164	0.61	0 81	<1	<1	<10	0.16	15.1	7.55	0 5
30-Jul-13		822	368171	0.73	0 89	<1	<1	<10	0.77	15 3	7.62	1 0
31-Jul-13		822	368165	0.55	0.67	<1	<1	<10	0.23	15 0	7.51	0 5
31-Jul-13		832	368559	0.48	0.61	<1	<1	<10	0.13	13.7	7 56	0.5
1-Aug-13		832	368555	0.51	0.68	<1	<1	10	0.16	12 5	7.48	0 5
31-Jul-13		832	368560	0.34	0 52	1	<1	<10	0.10	12.8	7.53	0.5
1-Aug-13		832	368556	0.41	0 53	<1	<1	<10	0.19	12.6	7.49	0 5
31-Jul-13		831	368557	0.42	0.62	<1	<1	<10	0.12	13.6	7.61	0 5
1-Aug-13		831	368551	0.51	0.73	<1	<1	<10	0.22	12 2	7.44	0.5
31-Jul-13		831	368558	0.32	0.48	<1	<1	<10	0.13	12 8	7.59	0 5
1-Aug-13		831	368552	0.30	0.46	<1	<1	<10	0.18	12 5	7.57	1 0
1-Aug-13		840	368596	0.69	0 84	<1	<1	<10	0.10	16 0	7.49	0 5
2-Aug-13		840	368590	0.52	0.77	<1	<1	<10	0.76	15 0	7.52	1 0
1-Aug-13		840	368595	0.71	0 89	<1	<1	<10	0.10	14 3	7.57	0 5
2-Aug-13		840	368589	0.53	0.70	<1	<1	<10	0.65	13 9	7.51	0 5
1-Aug-13		842	368597	0.57	0.70	<1	<1	<10	0.10	15 2	7.52	0 5
2-Aug-13		842	368593	0.84	0 98	<1	<1	<10	0.21	16 0	7.62	0 5
1-Aug-13		842	368598	0.51	0.73	<1	<1	<10	0.10	15 0	7.48	0 5
2-Aug-13		842	368594	0.74	0 90	<1	<1	<10	0.16	15 2	7.52	0 5

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
2-Aug-13		855	368644	0.62	0.78	<1	<1	<10	0.20	14 5	7.52	1 0
5-Aug-13		855	368638	0.72	0 87	<1	<1	<10	0.20	16 3	7.45	1 0
2-Aug-13		855	368643	0.40	0.60	<1	<1	<10	0.25	13 5	7.56	0 5
5-Aug-13		855	368637	0.37	0.48	<1	<1	<10	0.27	14 0	7.49	1 0
2-Aug-13		856	368646	0.40	0 52	<1	<1	<10	0.70	15.1	7.64	0 5
5-Aug-13		856	368642	0.54	0.66	<1	<1	<10	0.26	15.6	7.61	1 0
2-Aug-13		856	368645	0.44	0 56	<1	<1	<10	0.67	14 5	7.56	0 5
5-Aug-13		856	368641	0.67	0 82	<1	<1	<10	0.24	15 2	7.60	1 0
6-Aug-13		894	368823	0.54	0.65	<1	<1	<10	0.23	12.1	7.54	0 5
7-Aug-13		894	368817	0.63	0 81	<1	<1	30	0.29	15 0	7.58	1 0
6-Aug-13		894	368822	0.57	0.69	<1	<1	<10	0.21	12.7	7.46	0 5
7-Aug-13		894	368816	0.59	0 82	<1	<1	20	0.36	14.7	7.46	1 0
6-Aug-13		895	368824	0.57	0.71	<1	<1	<10	0.13	13 0	7.59	1 0
7-Aug-13		895	368820	0.60	0.74	<1	<1	<10	0.17	13 2	7.55	0 5
6-Aug-13		895	368825	0.57	0.75	<1	<1	20	0.16	13.1	7.56	1 0
7-Aug-13		895	368821	0.64	0.76	<1	<1	90	0.17	13 3	7.55	1 0
7-Aug-13		904	369279	0.46	0.63	<1	<1	<10	0.16	11 9	7.81	0 5
8-Aug-13		904	369273	0.44	0.61	<1	<1	20	0.31	12 0	7.74	0 5
7-Aug-13		904	369278	0.53	0.64	<1	<1	<10	0.15	14 5	7.51	0 5
8-Aug-13		904	369272	0.48	0.67	<1	<1	<10	0.16	14.4	7.64	0 5
7-Aug-13		906	369280	0.34	0.46	<1	<1	<10	0.15	12.6	7.71	0 5
8-Aug-13		906	369276	0.32	0.48	<1	<1	<10	0.31	12 3	7.83	0 5
7-Aug-13		906	369281	0.55	0.70	<10	<10	<10	24.60	14 3	7.62	0 5
8-Aug-13		906	369277	0.40	0 52	<1	<1	20	0.33	13 2	7.84	0 5
8-Aug-13		915	369330	0.37	0.47	<1	<1	<10	0.18	10 5	7.61	0 5
9-Aug-13		915	369324	0.47	0.61	<1	<1	<10	0.22	11 0	7.48	0 5
8-Aug-13		915	369329	0.43	0 54	<1	<1	<10	0.19	10.7	7.75	0 5
9-Aug-13		915	369323	0.59	0.70	<1	<1	<10	0.23	10 9	7.47	0 5

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
8-Aug-13		916	369332	0.44	0 56	<1	<1	10	0.29	10.6	7.70	0 5
9-Aug-13		916	369328	0.60	0.75	<1	<1	<10	0.26	11.8	7.55	1.0
8-Aug-13		916	369331	0.42	0 59	<1	<1	10	0.23	10 8	7.73	0 5
9-Aug-13		916	369327	0.50	0.63	<1	<1	10	0.28	13.0	7 57	0.5
9-Aug-13		925	369364	0.23	0 37	<1	<1	10	0.36	14.0	7.61	0.5
12-Aug-13		925	369358	0.23	0 36	<1	<1	30	0.15	12.9	7.62	0.5
9-Aug-13		925	369365	0.34	0.46	<1	<1	<10	0.26	13.3	7.60	0.5
12-Aug-13		925	369359	0.34	0.44	<1	<1	<10	0.14	12.9	7 56	0.5
9-Aug-13		926	369366	0.52	0.63	<1	<1	<10	0.11	11.6	7 57	0.5
12-Aug-13		926	369362	0.25	0 35	<1	<1	<10	0.15	15 0	7.61	0 5
9-Aug-13		926	369367	0.35	0.48	<1	<1	70	0.15	10 9	7.62	0 5
12-Aug-13		926	369363	0.22	0 33	<1	<1	<10	0.13	16 0	7.61	0 5

NOTE: On June 7, 13, 14, and 18, and July 24, and 26, 2013 there were no results for HPC due to contract lab error.

2014 Water Main Cleaning Program

Laboratory Analysis Report Household Monitoring

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
8-Jul-14		26	401404	0.95	1.26	<1	<1	<10	0.18	17.7	7.54	1 5
9-Jul-14		26	401398	0.98	1.18	<1	<1	<10	0.20	16.1	7.45	0 5
8-Jul-14		26	401405	1.06	1.29	<1	<1	<10	0.17	16 9	7.47	2 0
9-Jul-14		26	401399	1.06	1.22	<1	<1	<10	0.26	16.2	7.46	1.0
8-Jul-14		28	401406	0.99	1.26	<1	<1	<10	0.22	17 8	7.58	2 5
9-Jul-14		28	401402	0.94	1.13	<1	<1	<10	0.21	17.7	7.53	0.5
8-Jul-14		28	401407	1.05	1.22	<1	<1	<10	0.23	16.4	7.55	2.0
9-Jul-14		28	401403	1.07	1.19	<1	<1	<10	0 28	13.3	7.63	1.5
9-Jul-14		34	402037	1.15	1.31	<1	<1	<10	0.35	16 9	7.47	0 5
10-Jul-14		34	402031	1.10	1.31	<1	<1	<10	0.18	14.5	7.64	2.0
9-Jul-14		34	402038	1.10	1.31	<1	<1	<10	0.22	15.6	7.47	1.0
10-Jul-14		34	402032	1.12	1.32	<1	<1	<10	0.19	17.8	7.56	2.5
9-Jul-14		35	402040	1.08	1.24	<1	<1	50	0.30	15.5	7.48	0.5
10-Jul-14		35	402036	0.98	1.19	<1	<1	<10	0.15	17.5	7.56	2.0
9-Jul-14		35	402039	1.05	1.19	<1	<1	<10	0.25	16.0	7.52	0.5
10-Jul-14		35	402035	1.03	1.23	<1	<1	<10	0.17	14.7	7.56	2.0
10-Jul-14		45	402059	1.17	1.33	<1	<1	<10	1.73	16.8	7.60	1.5
11-Jul-14		45	402053	1.08	1.21	<1	<1	<10	0 24	15.7	7.56	1.0

2014 Water Main Cleaning Program

Laboratory Analysis Report Household Monitoring

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
10-Jul-14		45	402060	1.02	1.19	<1	<1	<10	0.88	12 9	7.59	2 0
11-Jul-14		45	402054	1.07	1.26	<1	<1	<10	0.22	16.3	7.47	2 0
10-Jul-14		46	402061	1.12	1.32	<1	<1	<10	1.19	17.1	7.61	1 0
11-Jul-14		46	402057	1.10	1.27	<1	<1	<10	0.18	18.4	7.53	2.0
10-Jul-14		46	402062	0.80	0.98	<1	<1	<10	0.20	13.3	7.68	1.5
11-Jul-14		46	402058	1.07	1.23	<1	<1	10	0.18	13.7	7.55	1.5
11-Jul-14		47	402124	0.74	0.92	<1	<1	<10	0.37	17.4	7.49	3 0
14-Jul-14		47	402118	0.69	0.87	<1	<1	<10	0.20	17 5	7.50	1 0
11-Jul-14		47	402125	0.72	0 94	<1	<1	<10	0.22	13 8	7.63	2 5
14-Jul-14		47	402119	0.65	0.83	<1	<1	<10	0.21	13.5	7.56	2 0
11-Jul-14		48	402126	0.68	0.91	<1	<1	30	0.25	16.4	7.65	1 5
14-Jul-14		48	402122	0.73	0.91	<1	<1	<10	0.22	16 9	7.58	0 5
11-Jul-14		48	402127	0.78	0.98	<1	<1	<10	0.24	18 5	7.68	2 0
15-Jul-14		48	402123	0.77	0 96	<1	<1	<10	0.19	18.1	7.71	2 5
11-Jul-14		55	402135	0.76	1 03	<1	<1	<10	0.16	15.4	7.43	1 0
14-Jul-14		55	402129	0.92	1.06	<1	<1	<10	0.15	16 9	7.52	2 0
11-Jul-14		55	402136	0.86	1.07	<1	<1	<10	0.18	16 9	7.58	2 5
14-Jul-14		55	402130	1.06	1.12	<1	<1	30	0.21	15.9	7.50	1 0

2014 Water Main Cleaning Program

Laboratory Analysis Report Household Monitoring

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
11-Jul-14		56	402137	0.90	1.09	<1	<1	<10	0.17	15.4	7.41	1 0
14-Jul-14		56	402133	0.67	0.86	<1	<1	<10	0.18	11.0	7.51	0.5
11-Jul-14		56	402138	0.81	1.00	<1	<1	<10	0.20	15.2	7.58	1 5
14-Jul-14		56	402134	0.86	0.98	<1	<1	<10	0.27	14.9	7.65	0.5
14-Jul-14		69	402351	0.67	0.85	<1	<1	<10	0.20	14 2	7.64	0 5
15-Jul-14		69	402345	0.68	1.06	<1	<1	<10	0.21	14 5	7.85	2 0
14-Jul-14		69	402352	0.83	1.00	<1	<1	<10	0.22	11.1	7.65	0 5
15-Jul-14		69	402346	0.81	0.91	<1	<1	<10	0.21	17 5	7.79	2 5
14-Jul-14		70	402353	0.85	1.03	<1	<1	<10	0.22	13.7	7.70	2 0
15-Jul-14		70	402349	0.75	1.07	<1	<1	<10	0.21	13 5	7.79	1 5
14-Jul-14		70	402354	0.77	0.92	<1	<1	<10	0.17	16.7	7.56	2.0
15-Jul-14		70	402350	0.80	0.98	<1	<1	<10	0 22	13.9	7.78	2.0
14-Jul-14		131	402362	0.62	0.91	<1	<1	<10	0.19	17 5	7.48	1 0
15-Jul-14		131	402356	1.00	1.16	<1	<1	<10	0.25	17 9	7.55	2 5
14-Jul-14		131	402363	0.70	0.87	<1	<1	10	0.23	17 3	7.43	1 0
15-Jul-14		131	402357	0.83	1.02	<1	<1	<10	0.31	17 8	7.73	2 0
14-Jul-14		132	402365	0.68	0.83	<1	<1	<10	0.25	14 5	7.55	1 0
15-Jul-14		132	402361	0.73	0.87	<1	<1	<10	0.22	16 9	7.77	1 0

2014 Water Main Cleaning Program

Laboratory Analysis Report Household Monitoring

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
14-Jul-14		132	402364	0.59	0.82	14	<1	50	0.26	15 9	7.52	1 5
15-Jul-14		132	402360	0.71	0.85	29	<1	90	0.21	17.1	7.74	0 5
21-Jul-14		132	403175	0.57	0.77	<1	<1	30	0.21	16 8	NA	NA
21-Jul-14		132	403179	0.64	0.73	<1	<1	10	0.22	14.6	NA	NA
21-Jul-14		132	403180	0.61	0.71	<1	<1	<10	0.20	15.9	NA	NA
15-Jul-14		76	402384	0.82	0.98	<1	<1	10	0.22	14.6	7.78	2 5
16-Jul-14		76	402378	0.92	1.19	<1	<1	<10	0.20	14.1	7.50	1 0
15-Jul-14		76	402385	1.08	1.22	<1	<1	<10	0.25	16.5	7.79	2.0
16-Jul-14		76	402379	0.95	1.12	<1	<1	<10	0.19	16.7	7.47	1 5
15-Jul-14		77	402386	1.10	1.29	<1	<1	<10	0.18	18 3	7.84	2 5
16-Jul-14		77	402382	0.96	1.11	<1	<1	<10	0.18	15.2	7.54	2.0
15-Jul-14		77	402387	0.62	0.76	<1	<1	10	0.28	21.4	7.75	2.5
16-Jul-14		77	402383	0.83	1.03	<1	<1	<10	0.20	15.6	7.48	1.0
15-Jul-14		139	402397	0.61	0.82	<1	<1	10	0.15	11.6	7.77	2.0
16-Jul-14		139	402391	0.65	0.85	<1	<1	<10	0.51	11.3	7.47	2.0
15-Jul-14		139	402398	0.64	0.85	<1	<1	<10	0.15	14.3	7.72	1.5
16-Jul-14		139	402392	0.71	0.87	<1	<1	<10	0.40	13.5	7.45	2.5
15-Jul-14		140	402399	0.63	0.81	<1	<1	<10	0 25	13.9	7.84	2.0
16-Jul-14		140	402395	0.60	0.80	<1	<1	<10	0 58	13.0	7.45	2.5

2014 Water Main Cleaning Program

Laboratory Analysis Report Household Monitoring

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
15-Jul-14		140	402400	0.61	0.79	<1	<1	<10	0.18	13 9	7.72	1 0
16-Jul-14		140	402396	0.67	0.82	<1	<1	<10	0.77	14 2	7.44	1 5
16-Jul-14		85	402854	0.76	0.96	<1	<1	<10	0.47	13 9	7.49	2 0
17-Jul-14		85	402848	0.73	0 90	<1	<1	<10	0.24	14 0	7.47	1 0
16-Jul-14		85	402855	0.74	0.92	<1	<1	<10	0.24	13 5	7.51	2 0
17-Jul-14		85	402849	0.79	0 96	<1	<1	<10	0.20	16.7	7.56	2 0
16-Jul-14		86	402856	0.79	0.92	<1	<1	<10	0.87	13 3	7.69	2 0
17-Jul-14		86	402852	0.71	0.89	<1	<1	<10	0.35	12 5	7.59	1 0
16-Jul-14		86	402857	0.77	0.97	<1	<1	<10	1.54	15 0	7.59	1 5
17-Jul-14		86	402853	0.69	0.89	<1	<1	<10	0.29	14.6	7.70	2 0
16-Jul-14		149	402842	0.73	0.91	<1	<1	<10	1.56	13.1	7.40	6 0
17-Jul-14		149	402836	0.72	0.79	<1	<1	<10	2.38	14.7	7.40	1 5
18-Jul-14		149	402946	0.82	0.95	<1	<1	<10	0.40	13.7	7.50	1 5
16-Jul-14		149	402843	0.78	1.00	<1	<1	<10	0.72	14.1	7.36	3.0
17-Jul-14		149	402837	0.71	0.93	<1	<1	<10	3.29	13 2	7.36	1 0
18-Jul-14		149	402947	0.78	0.93	<1	<1	<10	0.37	14 5	7.52	2 0
16-Jul-14		150	402844	0.48	0.60	<1	<1	<10	0.28	14.4	7.50	2.0
17-Jul-14		150	402840	0.53	0.71	<1	<1	10	0.22	15.6	7.52	0 5
16-Jul-14		150	402845	0.76	0.94	<1	<1	<10	0.25	17.1	7.39	1.0
17-Jul-14		150	402841	0.89	1.08	<1	<1	<10	0.29	17.6	7.41	1 0
17-Jul-14		92	402898	0.64	0.88	<1	<1	<10	0.42	13.3	7.46	1.0
18-Jul-14		92	402892	0.51	0.70	<1	<1	<10	0.26	12 5	7.56	1 5
17-Jul-14		92	402899	0.29	0.46	<1	<1	<10	0.37	12.6	7.45	2.0

2014 Water Main Cleaning Program

Laboratory Analysis Report Household Monitoring

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
18-Jul-14		92	402893	0.65	0.84	<1	<1	<10	0.62	13 3	7.49	2 0
17-Jul-14		94	402900	1.10	1.28	<1	<1	<10	0.18	18.6	7.66	0.5
18-Jul-14		94	402896	1.12	1.33	<1	<1	<10	0.45	18.6	7.65	2 0
17-Jul-14		94	402901	1.08	1.23	<1	<1	10	0.16	19 0	7.41	0 5
18-Jul-14		94	402897	1.08	1.25	<1	<1	<10	0.41	17.9	7.50	1 0
17-Jul-14		162	402909	0.73	0.85	<1	<1	<10	0.17	13.1	7.43	2 0
18-Jul-14		162	402903	0.93	1.12	<1	<1	40	0.32	16 8	7.52	1 0
17-Jul-14		162	402910	0.69	0.86	<1	<1	<10	0.18	15.6	7.46	2 0
18-Jul-14		162	402904	1.03	1.15	<1	<1	<10	0.31	16 9	7.56	1 0
17-Jul-14		163	402911	0.90	1.11	<1	<1	<10	0.65	20.6	7.59	0 5
18-Jul-14		163	402907	0.60	0.79	<1	<1	<10	0.35	13.7	7.64	1 0
17-Jul-14		163	402912	1.05	1.22	<1	<1	<10	0.46	18.6	7.40	1 0
18-Jul-14		163	402908	0.74	0.90	<1	<1	<10	0.35	14 5	7.59	1 0
18-Jul-14		97	402955	0.81	0.99	5	<1	<10	0.29	14.6	7.60	1 0
21-Jul-14		97	402949	1.03	1.19	<1	<1	<10	0.23	13 5	7.55	1 5

2014 Water Main Cleaning Program

Laboratory Analysis Report Household Monitoring

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
18-Jul-14		97	402956	0.86	1.03	<1	<1	10	0.17	15 3	7.70	1 0
21-Jul-14		97	402950	1.02	1.18	<1	<1	<10	0.16	18 2	7.75	1 0
18-Jul-14		98	402957	1.02	1.23	<1	<1	<10	0.19	15.7	7.61	1 0
21-Jul-14		98	402953	0.93	1.15	<1	<1	10	0.14	14.7	7.62	1 5
18-Jul-14		98	402958	0.97	1.23	<1	<1	<10	0.18	14.6	7.62	1 0
21-Jul-14		98	402954	1.07	1.27	<1	<1	10	0.15	17.2	7.56	0.5
18-Jul-14		167	402967	1.12	1.31	<1	<1	<10	0.24	20.5	7.48	1.5
21-Jul-14		167	402961	1.20	1.33	<1	<1	<10	0.28	21.4	7.48	2.0
18-Jul-14		167	402968	1.02	1.26	<1	<1	<10	0.58	14.5	7.59	2.0
21-Jul-14		167	402962	1.16	1.37	<1	<1	<10	0.21	14.3	7.59	1.0
18-Jul-14		169	402969	1.33	1.55	<1	<1	<10	3 23	18.0	7.53	1.5
21-Jul-14		169	402965	1.22	1.40	<1	<1	<10	0.23	18.3	7.50	2.0
18-Jul-14		169	402970	1.12	1.38	<1	<1	<10	0.74	18.9	7.54	1.0
21-Jul-14		169	402966	1.25	1.34	<1	<1	<10	0 24	19.3	7.71	1.5
21-Jul-14		124	403159	0.96	1.16	<1	<1	20	0 28	18.4	7.61	0.5
22-Jul-14		124	403153	1.18	1.34	<1	<1	<10	0.19	15.0	7.49	3.0
21-Jul-14		124	403160	1.00	1.28	<1	<1	<10	0.18	16.1	7.56	1.0
22-Jul-14		124	403154	1.16	1.31	<1	<1	<10	0 20	16.5	7.62	2.5

2014 Water Main Cleaning Program

Laboratory Analysis Report Household Monitoring

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
21-Jul-14		125	403162	1.13	1.31	<1	<1	<10	0.34	16 9	7.52	1 5
22-Jul-14		125	403158	0.79	0.95	<1	<1	<10	0.18	14.2	7.64	2 5
21-Jul-14		125	403161	0.32	0.43	<1	<1	<10	0.32	24.0	7.50	0 5
22-Jul-14		125	403157	0.80	0.99	<1	<1	<10	0.28	15.5	7.60	2.0
21-Jul-14		201	403170	0.90	1.11	<1	<1	<10	0.20	18.7	7.53	0.5
22-Jul-14		201	403164	0.87	1.04	<1	<1	<10	0.19	17.6	7.50	1.5
21-Jul-14		201	403171	0.78	0.96	<1	<1	<10	0.42	18.3	7.69	1.5
22-Jul-14		201	403165	0.91	1.06	<1	<1	<10	0.20	18 2	7.63	1 5
21-Jul-14		202	403172	0.71	0.86	<1	<1	<10	0.34	14.4	7.58	1 0
22-Jul-14		202	403168	0.69	0.85	<1	<1	<10	0.24	13 8	7.48	2 0
21-Jul-14		202	403173	0.63	0.84	<1	<1	<10	2.40	15 3	7.49	1 0
22-Jul-14		202	403169	0.89	1.02	<1	<1	<10	0.21	17 9	7.52	2 0
22-Jul-14		136	403212	0.11	0.19	<1	<1	40	0.16	14.9	7.47	1.5
23-Jul-14		136	403206	0.97	1.07	<1	<1	<10	0.21	14 3	7.65	0 5
22-Jul-14		136	403211	0.86	1.02	<1	<1	<10	0.17	15.1	7.54	3.0
23-Jul-14		136	403205	0.79	1.10	<1	<1	<10	0 20	15.6	7.58	2.5
22-Jul-14		141	403214	0.57	0.67	<1	<1	10	0.19	12 5	7.55	1 0
23-Jul-14		141	403210	0.31	0.47	<1	<1	<10	0.79	13 3	7.50	2 0

2014 Water Main Cleaning Program

Laboratory Analysis Report Household Monitoring

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
22-Jul-14		141	403213	0.62	0.75	<1	<1	<10	0.18	11.4	7.58	2 0
23-Jul-14		141	403209	0.65	0.76	<1	<1	<10	0.47	12 8	7.54	1 5
22-Jul-14		210	403200	0.72	0.89	<1	<1	<10	0.13	14.7	7.44	1.5
23-Jul-14		210	403194	0.86	1.11	<1	<1	<10	0.21	15.0	7.38	0.5
22-Jul-14		210	403201	0.80	0.96	<1	<1	<10	0.13	16.3	7.62	2.5
23-Jul-14		210	403195	0.83	0.99	<1	<1	<10	0.34	16.0	7.64	1.5
22-Jul-14		212	403202	0.95	1.10	<1	<1	<10	0.20	15.5	7.47	2.0
23-Jul-14		212	403198	0.90	1.08	<1	<1	<10	0.45	15.1	7.41	2.0
22-Jul-14		212	403203	0.94	1.09	<1	<1	<10	0.18	18.0	7.50	2.5
23-Jul-14		212	403199	0.92	1.05	<1	<1	<10	0.41	18.4	7.48	1.0
23-Jul-14		143	403625	0.71	0.81	<1	<1	<10	0.15	14.9	7.81	1.0
24-Jul-14		143	403619	0.68	0.82	<1	<1	<10	0 36	14.5	7.61	2.0
23-Jul-14		143	403624	0.70	0.90	<1	<1	<10	0.15	16.5	7.69	1.5
24-Jul-14		143	403618	0.48	0.62	<1	<1	<10	0 38	14.9	7.58	1.0
23-Jul-14		144	403626	0.70	0.84	<1	<1	<10	0 30	12.9	7.64	0.5
24-Jul-14		144	403622	0.58	0.77	<1	<1	<10	0 29	15.5	7.53	2.0
23-Jul-14		144	403627	0.64	0.85	<1	<1	<10	0 22	14.6	7.69	2.0
24-Jul-14		144	403623	0.50	0.68	<1	<1	<10	0.41	13.7	7.46	2.5

2014 Water Main Cleaning Program

Laboratory Analysis Report Household Monitoring

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
23-Jul-14		222	403635	0.63	0.84	<1	<1	<10	0.20	16 5	7.52	2 0
25-Jul-14		222	403629	1.05	1.16	<1	<1	<10	0.18	16 5	7.61	2 5
23-Jul-14		222	403636	0.84	0.99	<1	<1	<10	0.16	17.1	7.52	1 0
25-Jul-14		222	403630	0.29	0.42	<1	<1	<10	0.18	18.4	7.62	1 5
23-Jul-14		223	403637	0.64	0.80	<1	<1	<10	1.27	16.6	7.57	0 5
24-Jul-14		223	403633	0.79	0.96	<1	<1	20	0.24	16.1	7.63	1 5
23-Jul-14		223	403638	0.71	0.82	<1	<1	<10	0.18	16 9	7.63	1 5
24-Jul-14		223	403634	0.60	0.74	<1	<1	<10	0.22	17 3	7.66	1 0
24-Jul-14		155	403710	0.75	1.01	<1	<1	<10	0.36	17 5	7.53	2 5
25-Jul-14		155	403704	0.70	0.92	<1	<1	10	0.23	16.5	7.68	0.5
24-Jul-14		155	403711	0.46	0.58	<1	<1	<10	0.30	22.9	7.69	1.5
25-Jul-14		155	403705	0.86	1.01	<1	<1	<10	0.20	17.7	7.64	1.5
24-Jul-14		156	403712	0.78	0.88	<1	<1	20	0.24	12.8	7.54	2.0
25-Jul-14		156	403708	0.61	0.78	<1	<1	<10	0.71	17.2	7.58	1.0
24-Jul-14		156	403713	0.75	0.88	<1	<1	<10	0.21	16.9	7.57	1.0
25-Jul-14		156	403709	0.51	0.66	<1	<1	<10	0.43	21.6	7.69	3.0
24-Jul-14		233	403699	0.88	1.00	<1	<1	10	0 26	15.3	7.50	2.0
25-Jul-14		233	403693	0.55	0.94	<1	<1	<10	0.17	13.7	7.49	1.0

2014 Water Main Cleaning Program

Laboratory Analysis Report Household Monitoring

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
24-Jul-14		233	403700	0.65	0.81	<1	<1	<10	0.18	15 5	7.49	2 0
25-Jul-14		233	403694	0.84	1.04	<1	<1	<10	0.29	15 9	7.56	1 5
24-Jul-14		234	403701	0.82	0.94	<1	<1	<10	0.47	16.9	7.47	2.0
25-Jul-14		234	403697	0.22	0.50	<1	<1	<10	0.15	13.7	7.51	1.0
24-Jul-14		234	403702	0.68	0.86	<1	<1	<10	0.49	15.9	7.49	1.0
25-Jul-14		234	403698	0.79	0.98	<1	<1	<10	0.22	16.5	7.52	1.5
25-Jul-14		170	403898	0.93	1.00	<1	<1	<10	0.14	17.6	7.56	2.0
28-Jul-14		170	403892	1.15	1.31	<1	<1	<10	0.16	18.2	7.60	1.0
25-Jul-14		170	403897	1.10	1.27	<1	<1	10	0.13	18.9	7.63	1.5
28-Jul-14		170	403891	1.15	1.31	<1	<1	<10	0.19	19.4	7.63	2.0
25-Jul-14		172	403900	0.96	1.12	<1	<1	<10	0.11	17.8	7.59	1.0
28-Jul-14		172	403896	1.07	1.29	<1	<1	<10	0.17	18.3	7.70	0.5
25-Jul-14		172	403899	1.09	1.25	<1	<1	<10	0.19	18.8	7.54	1.0
28-Jul-14		172	403895	1.14	1.34	<1	<1	<10	0.17	18.4	7.54	1.0
25-Jul-14		243	403909	0.79	0.99	<1	<1	10	0 21	16.7	7.60	0.5
28-Jul-14		243	403903	0.28	0.40	<1	<1	<10	0 83	14.5	7.60	1.0
25-Jul-14		243	403908	0.79	1.04	<1	<1	<10	0 21	16.4	7.54	2.0
28-Jul-14		243	403902	0.80	0.98	<1	<1	10	0 28	15.1	7.55	2.0

2014 Water Main Cleaning Program

Laboratory Analysis Report Household Monitoring

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
25-Jul-14		245	403910	0.75	0.92	<1	<1	<10	0.18	19.1	7.54	2 0
28-Jul-14		245	403906	0.58	0.72	<1	<1	<10	0.20	19.1	7.53	1 0
25-Jul-14		245	403911	0.89	1.12	<1	<1	<10	0.41	19 8	7.48	1 0
28-Jul-14		245	403907	1.01	1.13	<1	<1	<10	0.29	19.6	7.59	1 0
28-Jul-14		201	403978	0.85	1.03	<1	<1	<10	0.14	18.9	7.52	1.5
29-Jul-14		201	403972	0.95	1.10	<1	<1	<10	0.19	18.9	7.51	0.5
28-Jul-14		201	403979	0.83	1.00	<1	<1	<10	0.14	17.5	7.52	2.0
29-Jul-14		201	403973	0.98	1.12	<1	<1	<10	0.19	17.6	7.46	1.0
28-Jul-14		202	403980	1.05	1.24	<1	<1	<10	2 04	19.4	7.57	2.0
29-Jul-14		202	403976	0.87	0.99	<1	<1	<10	0.89	19.1	7.46	1.0
28-Jul-14		202	403981	0.91	1.08	<1	<1	20	2 89	18.7	7.50	2.0
29-Jul-14		202	403977	0.90	1.06	<1	<1	<10	1.16	19.3	7.66	3.0
30-Jul-14		202	404473	NA	NA	NA	NA	NA	0.26	19.9	NA	NA
28-Jul-14		271	403990	0.94	1.16	<1	<1	<10	0.17	17.9	7.52	1.0
29-Jul-14		271	403984	0.98	1.13	<1	<1	<10	0.16	18.9	7.50	2.0
28-Jul-14		271	403989	0.92	1.13	<1	<1	10	0 35	17.9	7.52	1.5
29-Jul-14		271	403983	0.90	1.10	<1	<1	10	0.15	18.6	7.40	0.5
28-Jul-14		273	403991	1.00	1.22	<1	<1	30	0 20	15.1	7.48	2.0
29-Jul-14		273	403987	0.77	0.96	<1	<1	<10	0 29	16.9	7.43	2.0

2014 Water Main Cleaning Program

Laboratory Analysis Report Household Monitoring

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
28-Jul-14		273	403992	1.05	1.24	<1	<1	<10	0.14	17 9	7.52	2 0
29-Jul-14		273	403988	0.60	0.77	<1	<1	<10	0.55	18 9	7.67	1 0
29-Jul-14		212	404021	1.03	1.22	<1	<1	<10	0.85	17 9	7.53	2 5
30-Jul-14		212	404015	0.97	1.12	<1	<1	<10	0.19	18 9	7.53	2 5
29-Jul-14		212	404020	0.89	1.09	<1	<1	230	1.06	17 8	7.56	1 0
30-Jul-14		212	404014	0.89	1.08	<1	<1	<10	0.21	19.4	7.50	2 0
29-Jul-14		213	404022	0.78	0.93	<1	<1	<10	0.45	18.1	7.42	1 0
30-Jul-14		213	404018	0.99	1.15	<1	<1	<10	0.20	19.4	7.40	1 0
29-Jul-14		213	404023	0.78	1.03	<1	<1	10	0.42	18.4	7.43	0 5
30-Jul-14		213	404019	0.94	1.13	<1	<1	<10	0.28	19 5	7.49	1 0
29-Jul-14		281	404033	0.70	0.87	<1	<1	<10	0.76	15.4	7.43	0 5
30-Jul-14		281	404027	0.70	0.88	<1	<1	<10	0.21	15.7	7.56	1 0
29-Jul-14		281	404032	0.56	0.86	<1	<1	<10	0.22	15.6	7.57	1.5
30-Jul-14		281	404026	0.66	0.83	<1	<1	<10	0.22	15 5	7.59	1 0
29-Jul-14		283	404035	0.21	0.35	<1	<1	20	0.22	14 8	7.53	1 0
30-Jul-14		283	404031	0.73	0.90	<1	<1	<10	0.22	14 5	7.59	1 0
29-Jul-14		283	404034	0.54	0.70	<1	<1	<10	0.23	15.1	7.46	0.5
30-Jul-14		283	404030	0.70	0.81	<1	<1	<10	0.21	16.1	7.49	1 0

2014 Water Main Cleaning Program

Laboratory Analysis Report Household Monitoring

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
30-Jul-14		228	404480	0.72	0 98	<1	<1	<10	0.16	15 8	7.54	2 5
31-Jul-14		228	404474	0.30	0.41	<1	<1	<10	0.16	15.1	7.63	2 0
30-Jul-14		228	404481	0.82	1.06	<1	<1	<10	0.16	18.1	7.55	2 5
31-Jul-14		228	404475	0.90	1.10	<1	<1	10	0.21	18 3	7.58	0 5
30-Jul-14		229	404482	0.94	1.15	<1	<1	<10	0.21	16 5	7.50	2 5
31-Jul-14		229	404478	1.00	1.13	<1	<1	<10	0.25	15 8	7.54	0 5
30-Jul-14		229	404483	0.97	1.15	<1	<1	<10	0.19	15.5	7.58	2.0
31-Jul-14		229	404479	1.03	1.21	<1	<1	<10	0.29	18.5	7.62	0.5
30-Jul-14		291	404495	0.70	0.93	<1	<1	<10	0.26	15.1	7.53	1.5
31-Jul-14		291	404489	0.76	0.95	<1	<1	<10	0.41	14 5	7.56	2 5
30-Jul-14		291	404496	0.64	0.83	<1	<1	<10	0.78	14.4	7.51	2.0
31-Jul-14		291	404490	0.60	0.79	<1	<1	10	0.29	13.7	7.48	0 5
30-Jul-14		292	404497	0.58	0.74	<1	<1	<10	3.73	14 8	7.50	2 5
1-Aug-14		292	404493	0.62	0.78	<1	<1	<10	0.73	15 2	7.39	3 0
30-Jul-14		292	404498	0.57	0.79	<1	<1	<10	0.60	15 2	7.48	2 0
1-Aug-14		292	404494	0.76	0.88	<1	<1	<10	0.48	14 2	7.42	1 0
31-Jul-14		236	404553	0.70	0.92	<1	<1	<10	0.74	17.6	7.56	1.5
1-Aug-14		236	404547	0.71	0.89	<1	<1	<10	0.20	17.5	7.49	2 0

2014 Water Main Cleaning Program

Laboratory Analysis Report Household Monitoring

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
31-Jul-14		236	404554	0.85	0.95	<1	<1	<10	1.02	17 8	7.54	0 5
1-Aug-14		236	404548	0.84	0.94	<1	<1	<10	0.98	18 2	7.53	2 0
31-Jul-14		237	404555	0.90	1.12	<1	<1	<10	0.33	18 3	7.54	1 0
1-Aug-14		237	404551	0.98	1.15	<1	<1	<10	0.34	18 9	7.49	1 0
31-Jul-14		237	404556	1.00	1.15	<1	<1	<10	0.45	16 5	7.55	0 5
1-Aug-14		237	404552	0.87	1.04	<1	<1	10	0.65	16 3	7.59	2 0
31-Jul-14		296	404542	0.61	0.81	<1	<1	40	0.19	17.1	7.41	0 5
1-Aug-14		296	404536	0.82	0.97	<1	<1	170	0.28	18.7	7.38	1 0
31-Jul-14		296	404543	0.71	0.86	<1	<1	<10	0.22	16 0	7.48	2 0
1-Aug-14		296	404537	0.73	0.91	<1	<1	<10	0.26	17 2	7.49	2 0
31-Jul-14		298	404544	0.44	0.61	<1	<1	<10	0.22	14.6	7.53	1 0
1-Aug-14		298	404540	0.25	0.39	<1	<1	<10	0.40	15.7	7.51	1 0
31-Jul-14		298	404545	0.56	0.75	<1	<1	<10	0.17	15.7	7.52	0 5
1-Aug-14		298	404541	0.60	0.75	<1	<1	<10	0.30	16 3	7.49	1 0
1-Aug-14		260	404638	0.78	0.92	<1	<1	<10	0.21	16 5	7.51	1 0
5-Aug-14		260	404632	0.86	1.00	<1	<1	<10	0.31	18.6	7.65	3 0
1-Aug-14		260	404639	0.68	0.90	<1	<1	<10	0.23	16.8	7.50	1 0
5-Aug-14		260	404633	0.80	0.93	<1	<1	<10	0.34	17.1	7.52	1.0

2014 Water Main Cleaning Program

Laboratory Analysis Report Household Monitoring

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
1-Aug-14		262	404640	0.65	0.90	<1	<1	<10	0.21	16 2	7.50	0 5
5-Aug-14		262	404636	0.82	0.97	<1	<1	10	0.38	18 3	7.64	0 5
1-Aug-14		262	404641	0.66	0.79	<1	<1	<10	0.25	18.8	7.60	1.0
5-Aug-14		262	404637	0.67	0.88	<1	<1	<10	0.46	19 3	7.46	0 5
1-Aug-14		304	404650	0.84	1.00	<1	<1	<10	0.27	16.4	7.48	2 0
5-Aug-14		304	404644	0.66	0.83	<1	<1	20	0.33	17 0	7.49	1 5
1-Aug-14		304	404649	0.77	0.94	<1	<1	<10	0.18	17.6	7.42	1 0
5-Aug-14		304	404643	0.82	1.03	<1	<1	<10	0.23	18 0	7.49	0 5
1-Aug-14		305	404651	0.80	0.99	<1	<1	<10	0.28	15.2	7.49	1.5
5-Aug-14		305	404647	0.53	0.71	<1	<1	40	0.21	16 3	7.58	1 5
1-Aug-14		305	404652	0.68	0.90	<1	<1	<10	0.28	16.1	7.40	2.0
5-Aug-14		305	404648	0.38	0.61	<1	<1	<10	0.21	15.1	7.37	0 5
5-Aug-14		295	404865	0.64	0.81	<1	<1	<10	0.20	18 0	7.52	1 0
6-Aug-14		295	404859	0.13	0.25	<1	<1	<10	0.60	16 9	7.47	5 0
7-Aug-14		295	405375	0.02	0.03	NA	NA	NA	NA	15.7	NA	NA
8-Aug-14		295	405427	<0.02	<0 02	NA	NA	NA	NA	15.7	NA	NA
11-Aug-14		295	405590	<0.02	0.04	NA	NA	NA	NA	15.8	NA	NA
13-Aug-14		295	406200	0.65	0.80	NA	NA	NA	NA	17.6	NA	NA
25-Sep-14		295	410667	0.63	0.84	<1	<1	<10	0 28	16.2	7.79	2.0

2014 Water Main Cleaning Program

Laboratory Analysis Report Household Monitoring

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
5-Aug-14		295	404866	0.73	0.88	<1	<1	<10	0.21	17.9	7.52	2.0
6-Aug-14		295	404860	0.17	0.27	<1	<1	<10	0.66	16.5	7.45	5 5
7-Aug-14		295	405376	<0.02	<0 02	NA	NA	NA	NA	16.4	NA	NA
13-Aug-14		295	405428	0.22	0 38	NA	NA	NA	NA	16 8	NA	NA
5-Aug-14		297	404867	0.77	0.87	<1	<1	<10	0.17	17.9	7.50	1.5
6-Aug-14		297	404863	0.70	0.89	<1	<1	<10	0.43	18 0	7.53	3 0
5-Aug-14		297	404868	0.71	0.87	<1	<1	10	0.17	17.7	7.64	1 5
6-Aug-14		297	404864	0.64	0.82	<1	<1	10	0.55	16 9	7.54	5 0
5-Aug-14		345	404876	0.78	1.02	<1	<1	<10	0.31	18.2	7.64	2.5
6-Aug-14		345	404870	0.85	1.03	<1	<1	<10	0.18	17.4	7.56	5 0
5-Aug-14		345	404877	0.68	0.89	<1	<1	<10	0.30	16.2	7.45	1.5
6-Aug-14		345	404871	0.84	1.03	<1	<1	<10	0.18	18 3	7.52	3 5
5-Aug-14		348	404878	0.81	0.99	<1	<1	<10	0.80	16.4	7.48	2.0
6-Aug-14		348	404874	0.85	1.04	<1	<1	<10	0.24	18 2	7.53	2 5
5-Aug-14		348	404879	0.73	0.93	<1	<1	<10	0.92	18.2	7.51	1.0
6-Aug-14		348	404875	0.89	1.05	<1	<1	<10	0.25	17 9	7.54	6 0
6-Aug-14		302	405316	0.19	0.36	<1	<1	<10	0.61	13.5	7.46	1.0
7-Aug-14		302	405310	0.05	0.11	<1	<1	<10	1 07	13.6	7.68	0.5
8-Aug-14		302	405429	0.09	0.19	NA	NA	NA	0.75	13.8	NA	NA
11-Aug-14		302	405588	0.89	1.07	NA	NA	NA	NA	18.8	NA	NA
14-Nov-14		302	410670	0.63	0.82	<1	<1	<10	0.46	9.7	7.68	NA
6-Aug-14		302	405317	0.17	0.29	<1	<1	10	0.68	13.9	7.50	2.5
7-Aug-14		302	405311	0.04	0.11	<1	<1	<10	1.13	13.4	7.61	0.5
8-Aug-14		302	405430	0.08	0.21	NA	NA	NA	0 95	14.1	NA	NA
11-Aug-14		302	405589	0.83	0.98	NA	NA	NA	NA	19.5	NA	NA

2014 Water Main Cleaning Program

Laboratory Analysis Report Household Monitoring

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
6-Aug-14		303	405319	1.06	1.22	<1	<1	<10	0.17	20.1	7.43	5 5
7-Aug-14		303	405315	0.94	1.15	<1	<1	<10	0.23	19 2	7.61	1 5
6-Aug-14		303	405318	0.72	0.87	<1	<1	<10	0.20	18 2	7.54	5 0
7-Aug-14		303	405314	0.91	1.06	<1	<1	<10	0.22	19.1	7.62	0 5
6-Aug-14		358	405303	0.59	0.77	<1	<1	<10	0.79	15.4	7.50	5 0
7-Aug-14		358	405299	0.62	0.79	2	<1	<10	0.15	14 9	7.68	2 0
13-Aug-14		358	406063	0.55	0.72	<1	<1	<10	0.18	14.8	NA	NA
6-Aug-14		357	405300	0.66	0.84	<1	<1	<10	1.08	14.0	7.59	2.0
7-Aug-14		357	405294	0.53	0.70	<1	<1	<10	0.26	15.7	7.77	0.5
6-Aug-14		357	405301	0.73	0.89	<1	<1	<10	1.29	15.4	7.50	5.5
7-Aug-14		357	405295	0.77	0.94	1	<1	<10	0.18	15.9	7.57	1.0
13-Aug-14		357	406062	0.60	0.77	6	<1	<10	0.16	17.0	NA	NA
10-Sep-14		357	409138	0.62	0.82	<1	<1	<10	0 21	16.8	NA	NA
6-Aug-14		358	405302	0.66	0.88	<1	<1	<10	0 93	14.5	7.54	6.0
7-Aug-14		358	405298	0.22	0.34	<1	<1	<10	0.16	13.4	7.63	1.0
7-Aug-14		312	405371	0.31	0.43	<1	<1	30	0.19	14.3	7.62	0.5
8-Aug-14		312	405365	0.49	0.70	<1	<1	<10	0.44	16.6	7.40	2.0
7-Aug-14		312	405370	0.64	0.79	<1	<1	10	1.23	14.5	7.52	1.0
8-Aug-14		312	405364	0.55	0.71	<1	<1	<10	0.37	13.8	7.39	2.0
7-Aug-14		313	405372	0.56	0.67	<1	<1	10	0.31	14.5	7.53	0.5
8-Aug-14		313	405368	0.48	0.60	1	<1	10	0.30	17 3	7.37	1 5
12-Aug-14		313	405665	0.41	0.51	<1	<1	10	0.60	16.9	NA	NA
7-Aug-14		313	405373	0.25	0.39	<1	<1	<10	0.17	18.4	7.97	0.5
8-Aug-14		313	405369	0.78	0.91	<1	<1	<10	0 38	17.4	7.40	1.0

2014 Water Main Cleaning Program

Laboratory Analysis Report Household Monitoring

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
7-Aug-14		372	405390	0.40	0.59	<1	<1	<10	0.44	15 0	7.57	1 0
8-Aug-14		372	405384	0.29	0.48	<1	<1	<10	0.20	15 8	7.44	2 0
7-Aug-14		372	405391	0.58	0.72	<1	<1	<10	0.39	13.6	7.52	0 5
8-Aug-14		372	405385	0.57	0.74	<1	<1	<10	0.20	14.4	7.43	1 0
7-Aug-14		373	405393	0.56	0.73	<1	<1	<10	0.38	15.1	7.62	0.5
8-Aug-14		373	405389	0.51	0.68	<1	<1	<10	0.21	15.5	7.47	2.0
7-Aug-14		373	405392	0.56	0.66	<1	<1	<10	0.26	15.1	7.70	0.5
8-Aug-14		373	405388	0.57	0.71	<1	<1	<10	0.20	15.7	7.45	2.0
8-Aug-14		321	405437	0.38	0.52	<1	<1	<10	8.60	15.3	7.50	2.0
11-Aug-14		321	405431	0.39	0.52	<1	<1	10	0.54	15.8	7.62	0.5
8-Aug-14		321	405438	0.45	0.55	<1	<1	<10	0.47	14.5	7.41	1.5
11-Aug-14		321	405432	0.55	0.65	<1	<1	<10	0.43	17.8	7.55	0.5

2014 Water Main Cleaning Program

Laboratory Analysis Report Household Monitoring

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
8-Aug-14		323	405439	0.53	0.69	<1	<1	40	1.18	18.4	7.37	2 0
11-Aug-14		323	405435	0.68	0.79	<1	<1	10	0.36	17 8	7.61	2 0
8-Aug-14		323	405440	0.68	0.80	<1	<1	<10	1.05	19 0	7.36	0 5
11-Aug-14		323	405436	0.71	0.92	<1	<1	<10	0.32	19 3	7.57	1 5
8-Aug-14		388	405419	0.30	0.44	<1	<1	<10	0.30	15 8	7.51	1 0
11-Aug-14		388	405413	0.64	0.79	<1	<1	10	0.23	16.1	7.56	1 0
8-Aug-14		388	405420	0.23	0.35	1	<1	<10	0.22	13 2	7.49	2 0
11-Aug-14		388	405414	0.59	0.82	<1	<1	<10	0.23	16 5	7.55	0 5
8-Aug-14		389	405421	0.24	0.36	3	<1	30	0.67	13 3	7.45	1 0
11-Aug-14		389	405417	0.14	0.28	<1	<1	<10	0.34	14 8	7.64	0 5
8-Aug-14		389	405422	0.35	0.43	<1	<1	<10	1.09	13.5	7.50	2.5
11-Aug-14		389	405418	0.14	0.39	<1	<1	<10	0.37	13 5	7.66	1 0
11-Aug-14		354	405597	0.40	0.51	<1	<1	<10	0.18	13.3	7.59	0.5
12-Aug-14		354	405591	0.16	0.30	<1	<1	<10	0.58	15.8	7.50	2.0
11-Aug-14		354	405598	0.41	0.58	<1	<1	<10	0.18	15.1	7.71	0.5
12-Aug-14		354	405592	0.16	0.25	<1	<1	<10	0 87	17.5	7.53	0.5
11-Aug-14		357	405599	0.60	0.76	<1	<1	<10	0.27	17.1	7.72	0.5
12-Aug-14		357	405595	0.46	0.66	<1	<1	<10	0.66	17.6	7.64	2 5

2014 Water Main Cleaning Program

Laboratory Analysis Report Household Monitoring

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
11-Aug-14		357	405600	0.63	0.80	<1	<1	<10	0.29	17 3	7.68	0 5
12-Aug-14		357	405596	0.40	0.54	<1	<1	<10	0.73	16 9	7.60	2 0
11-Aug-14		412	405608	0.80	1.02	<1	<1	<10	0.68	17.7	7.46	0.5
13-Aug-14		412	405602	0.39	0.56	<1	<1	<10	0.25	16 3	7.51	0 5
11-Aug-14		412	405609	0.77	0.96	<1	<1	10	0.65	16.3	7.48	0.5
13-Aug-14		412	405603	0.51	0.65	<1	<1	10	0.23	15.6	7.40	0 5
11-Aug-14		414	405610	0.78	0.92	<1	<1	10	0.47	17.1	7.62	1 0
15-Aug-14		414	405606	0.64	0.80	<1	<1	<10	1.01	16.6	7.55	0 5
18-Aug-14		414	406483	0.79	1.04	NA	NA	NA	0.31	18.1	NA	NA
11-Aug-14		414	405611	0.74	0.86	<1	<1	<10	0.49	16 3	7.49	1 0
15-Aug-14		414	405607	0.23	0.40	<1	<1	20	0.35	13 8	7.53	0 5
12-Aug-14		369	405673	0.27	0.44	<1	<1	<10	0.63	15.5	7.59	1.5
13-Aug-14		369	405667	0.26	0.36	<1	<1	<10	0.33	15.7	7.59	1 0
12-Aug-14		369	405672	0.27	0.45	<1	<1	<10	0.65	15.9	7.62	2.5
13-Aug-14		369	405666	0.26	0.37	<1	<1	<10	0.86	16 2	7.61	0 5
12-Aug-14		370	405674	0.08	0.19	<1	<1	<10	0.48	13.9	7.52	1.0
13-Aug-14		370	405670	0.46	0.60	<1	<1	<10	0.35	13.6	7.59	1 0
12-Aug-14		370	405675	0.06	0.14	<1	<1	<10	0.42	11.6	7.57	0.5
13-Aug-14		370	405671	0.28	0.41	<1	<1	<10	0.45	13.7	7.61	0 5

2014 Water Main Cleaning Program

Laboratory Analysis Report Household Monitoring

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
13-Aug-14		374	406135	0.23	0.38	<1	<1	<10	0.33	15.1	7.47	0 5
14-Aug-14		374	406129	0.27	0.41	<1	<1	<10	0.68	15.7	7.47	1 0
13-Aug-14		374	406136	0.33	0.44	<1	<1	<10	0.38	14.7	7.62	1 0
14-Aug-14		374	406130	0.27	0.48	<1	<1	<10	0.56	15.7	7.51	1 0
13-Aug-14		375	406137	0.31	0.44	<1	<1	<10	0.44	14.0	7.54	1.0
14-Aug-14		375	406133	0.46	0.64	<1	<1	<10	0.49	17 5	7.56	1 0
13-Aug-14		375	406138	0.30	0.40	<1	<1	10	0.45	14.7	7.57	0 5
14-Aug-14		375	406134	0.41	0.53	<1	<1	<10	0.52	16 3	7.62	0 5
14-Aug-14		389	406230	0.55	0.69	<1	<1	<10	0.62	17.6	7.44	1.0
15-Aug-14		389	406226	0.18	0.35	<1	<1	<10	0.30	16 2	7.50	0 5
14-Aug-14		389	406231	0.54	0.68	<1	<1	<10	0.51	17.5	7.55	1.0
15-Aug-14		389	406227	0.21	0.39	<1	<1	<10	0.30	16.1	7.53	0 5
14-Aug-14		388	406228	0.51	0.65	<1	<1	10	1.60	16.8	7.45	0.5
15-Aug-14		388	406222	0.31	0.43	<1	<1	10	0.25	16 8	7.54	1 5
14-Aug-14		388	406229	0.71	0.86	16	<1	<10	0.42	18.9	7.50	0.5
15-Aug-14		388	406223	0.38	0.52	<1	<1	<10	0.34	17.1	7.51	0 5
25-Sep-14		388	410671	0.67	0.82	<1	<1	<10	0.27	16 5	7.82	0 5
15-Aug-14		405	406275	0.65	0.87	<1	<1	20	0.19	18.9	7.60	0.5
18-Aug-14		405	406269	0.81	1.11	<1	<1	<10	0.20	19.3	7.38	1.0

2014 Water Main Cleaning Program

Laboratory Analysis Report Household Monitoring

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
15-Aug-14		405	406276	1.01	1.14	<1	<1	<10	0.20	20.7	7.46	0 5
18-Aug-14		405	406270	0.75	0.93	<1	<1	<10	0.20	20.6	7.40	2 5
15-Aug-14		407	406278	0.82	0.99	<1	<1	130	0.19	17.6	7.48	0 5
18-Aug-14		407	406274	0.46	0.71	<1	<1	<10	0.23	18.7	7.50	2 0
15-Aug-14		407	406277	0.88	1.05	<1	<1	<10	0.16	18.5	7.47	1.0
18-Aug-14		407	406273	0.62	0.80	<1	<1	160	0.21	18 2	7.44	1 0
15-Aug-14		421	405637	0.76	0.91	<1	<1	<10	0.25	14.9	7.48	0.5
18-Aug-14		421	405633	0.73	1.02	<1	<1	<10	0.19	14 9	7.49	2 0
15-Aug-14		421	405636	0.75	0.90	<1	<1	<10	0.23	15.4	7.40	1.0
18-Aug-14		421	405632	0.78	0.98	<1	<1	<10	0.21	17.6	7.48	2 5
15-Aug-14		419	405635	0.70	0.88	<1	<1	20	0.36	17.5	7.39	0.5
18-Aug-14		419	405629	0.77	0.92	<1	<1	<10	0.19	18 2	7.41	0 5
15-Aug-14		419	405634	0.81	1.00	<1	<1	<10	0.51	18.8	7.40	1.0
19-Aug-14		419	405628	0.73	0.87	<1	<1	<10	0.29	19 2	7.41	1 5
18-Aug-14		443	406492	0.77	0.92	<1	<1	<10	1.14	18.2	7.57	2.5
19-Aug-14		443	406488	0.75	0.98	<1	<1	<10	0.35	18 0	7.51	0 5
18-Aug-14		443	406493	0.89	0.99	<1	<1	<10	0.37	18.7	7.46	1.0
19-Aug-14		443	406489	0.81	0.98	<1	<1	10	0.28	19 3	7.52	0 5

2014 Water Main Cleaning Program

Laboratory Analysis Report Household Monitoring

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
18-Aug-14		442	406490	0.70	1.06	<1	<1	10	0.37	18 5	7.65	1 0
19-Aug-14		442	406484	0.69	0.78	<1	<1	<10	0.33	18 9	7.62	1 0
18-Aug-14		442	406491	0.66	0.84	<1	<1	<10	0.49	18.6	7.56	2 0
19-Aug-14		442	406485	0.50	0.64	<1	<1	<10	0.32	18.4	7.58	1 0
18-Aug-14		447	406300	0.37	0.52	<1	<1	<10	0.34	13.7	7.48	1 5
19-Aug-14		447	406294	0.42	0.57	<1	<1	<10	0.38	14 2	7.49	1 0
18-Aug-14		447	406301	0.62	0.85	<1	<1	<10	0.23	16 8	7.44	0 5
19-Aug-14		447	406295	0.59	0.72	<1	<1	<10	0.29	17.4	7.45	1 5
18-Aug-14		448	406302	0.67	0.80	<1	<1	<10	1.27	15.3	7.49	2.0
19-Aug-14		448	406298	0.71	0.92	<1	<1	<10	0.41	16 3	7.48	0 5
18-Aug-14		448	406303	0.23	0.30	<1	<1	<10	0.37	17.5	7.40	1.0
19-Aug-14		448	406299	0.28	0.37	<1	<1	<10	0.58	17 5	7.35	0 5
19-Aug-14		449	406539	0.31	0.43	<1	<1	<10	0.27	13 9	7.66	0 5
20-Aug-14		449	406535	0.48	0 59	<1	<1	<10	0.35	16.7	7.50	2 0
19-Aug-14		449	406538	0.56	0.71	<1	<1	<10	0.32	18.7	7.48	1.0
20-Aug-14		449	406534	0.44	0.67	<1	<1	<10	0.28	18 3	7.38	1 5
19-Aug-14		448	406536	0.79	0.95	<1	<1	10	2.19	16.9	7.63	0.5
20-Aug-14		448	406530	0.30	0.46	<1	<1	10	0.29	19 2	7.48	0 5

2014 Water Main Cleaning Program

Laboratory Analysis Report Household Monitoring

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
19-Aug-14		448	406537	0.51	0.65	<1	<1	<10	1.26	17.1	7.48	1 5
20-Aug-14		448	406531	0.63	0.80	<1	<1	<10	0.24	17.7	7.37	0 5
19-Aug-14		456	406502	0.29	0.47	<1	<1	70	0.32	15.7	7.49	1 0
20-Aug-14		456	406496	0.31	0.46	<1	<1	<10	0.37	14.7	7.42	2 5
19-Aug-14		455	406504	0.68	0.86	<1	<1	<10	5.38	17 3	7.54	0 5
20-Aug-14		455	406500	0.57	0.83	<1	<1	<10	0.44	19.4	7.58	2 5
19-Aug-14		455	406503	0.72	0.95	<1	<1	<10	3.81	17.7	7.51	0 5
20-Aug-14		455	406499	0.73	0.91	<1	<1	<10	0.30	19.7	7.61	2 0
19-Aug-14		456	406501	0.67	0.83	<1	<1	<10	0.19	17 3	7.42	0 5
20-Aug-14		456	406495	0.39	0.57	<1	<1	<10	0.38	15 5	7.42	2 0
20-Aug-14		464	406922	0.63	0.86	<1	<1	10	3.94	12 9	7.49	2 0
21-Aug-14		464	406916	0.43	0.58	<1	<1	10	0.79	14 5	7.56	1 0
20-Aug-14		464	406923	0.65	0.86	<1	<1	<10	0.46	14.0	7.43	0.5
21-Aug-14		464	406917	0.48	0.73	<1	<1	<10	0.49	14 3	7.53	0 5
20-Aug-14		466	406924	0.50	0.65	<1	<1	<10	1.46	13 8	7.55	1 0
22-Aug-14		466	406920	0.42	0.59	<1	<1	<10	0.29	14.6	7.48	2 0
20-Aug-14		466	406925	0.44	0.58	<1	<1	<10	1.48	14.6	7.40	2 0
22-Aug-14		466	406921	0.64	0.81	1	<1	<10	0.36	14.4	7.47	2 0
25-Aug-14		466	407320	0.47	0.66	<1	<1	<10	0.28	15 2	NA	NA

2014 Water Main Cleaning Program

Laboratory Analysis Report Household Monitoring

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
20-Aug-14		471	406933	0.39	0.53	<1	<1	30	0.66	16.7	7.39	1 0
21-Aug-14		471	406927	0.43	0.58	<1	<1	<10	1.95	15 9	7.52	2 0
22-Aug-14		471	407111	0.40	0.54	NA	NA	NA	0.19	16.4	NA	NA
20-Aug-14		471	406934	0.45	0.58	<1	<1	<10	0.69	17.6	7.40	2.0
21-Aug-14		471	406928	0.15	0.19	<1	<1	<10	0.19	16 9	7.49	0 5
20-Aug-14		472	406936	0.30	0.46	<1	<1	<10	0.30	16.5	7.45	2.0
21-Aug-14		472	406932	0.26	0.53	<1	<1	<10	0.76	16 5	7.72	0 5
20-Aug-14		472	406935	0.45	0.61	<1	<1	<10	0.36	17.9	7.46	2.5
21-Aug-14		472	406931	0.16	0.34	<1	<1	<10	1.64	18 0	7.78	2 5
22-Aug-14		472	407112	0.38	0.60	NA	NA	NA	0.18	17.3	NA	NA
21-Aug-14		471	407011	0.51	0.66	<1	<1	<10	0.19	17.8	7.44	0.5
22-Aug-14		471	407005	0.75	0.98	<1	<1	<10	0.24	17.9	7.44	1.0
21-Aug-14		471	407010	0.24	0.47	<1	<1	<10	0 23	15.6	7.45	1.0
22-Aug-14		471	407004	0.27	0.43	<1	<1	<10	0.24	15.3	7.47	2.5
21-Aug-14		472	407013	0.20	0.36	<1	<1	<10	2.43	14.3	7.51	1.5
22-Aug-14		472	407009	0.80	0.91	<1	<1	<10	0.28	16.5	7.52	0.5
21-Aug-14		472	407012	0.36	0.53	<1	<1	60	0 29	12.0	7.45	0.5
22-Aug-14		472	407008	0.16	0.30	<1	<1	30	0.28	12.2	7.57	2.0
21-Aug-14		481	407021	1.11	1.27	<1	<1	<10	0 20	22.2	7.58	0.5
22-Aug-14		481	407015	0.89	1.06	<1	<1	<10	0.29	21.7	7.41	1 0
21-Aug-14		481	407022	0.95	1.15	<1	<1	<10	0.19	21.6	7.68	1.5
22-Aug-14		481	407016	0.92	1.09	<1	<1	<10	0 22	22.0	7.51	0.5
21-Aug-14		482	407024	0.69	0.93	1	<1	<10	0.16	14.5	7.59	2.0

2014 Water Main Cleaning Program

Laboratory Analysis Report Household Monitoring

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
22-Aug-14		482	407020	0.65	0.95	<1	<1	<10	1.47	15 2	7.44	1 0
25-Aug-14		482	407298	0.88	0 99	NA	NA	NA	0.18	20 2	NA	NA
21-Aug-14		482	407023	0.76	0 97	<1	<1	<10	0.18	13 0	7.58	2 0
22-Aug-14		482	407019	0.91	1.16	<1	<1	<10	0.65	20 2	7.41	2 0
22-Aug-14		478	407131	0.16	0.28	<1	<1	<10	0.25	17.8	7.43	0.5
25-Aug-14		478	407125	0.61	0.75	<1	<1	<10	0.32	17.8	7.51	1.0
22-Aug-14		478	407130	0.78	1.14	<1	<1	<10	0.26	18.4	7.42	0.5
25-Aug-14		478	407124	0.70	0.86	<1	<1	<10	0.25	18.3	7.53	0.5
22-Aug-14		479	407133	0.70	0.86	<1	<1	<10	0 28	19.6	7.39	2.5
25-Aug-14		479	407129	0.84	1.09	<1	<1	<10	0.19	17.8	7.51	1.5
22-Aug-14		479	407132	0.76	1.03	<1	<1	<10	0 34	19.8	7.43	2.0
25-Aug-14		479	407128	0.70	0.88	<1	<1	<10	0.21	18.5	7.55	0.5
22-Aug-14		492	407121	0.93	1.08	<1	<1	<10	0.69	21.4	7.57	1.0
25-Aug-14		492	407117	0.75	0.94	<1	<1	<10	0.16	20.4	7.57	2.0
22-Aug-14		492	407122	0.93	1.07	<1	<1	<10	0.47	21.7	7.58	0 5
25-Aug-14		492	407118	0.86	0.98	<1	<1	<10	0.15	21 0	7.60	1 0

2014 Water Main Cleaning Program

Laboratory Analysis Report Household Monitoring

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
22-Aug-14		496	407120	1.02	1.19	<1	<1	<10	2.70	18 9	7.48	2 0
25-Aug-14		496	407114	0.89	1.11	<1	<1	<10	0.19	19 3	7.51	2 5
22-Aug-14		496	407119	0.92	1.12	<1	<1	10	0.27	20 9	7.39	0 5
25-Aug-14		496	407113	0.66	0.79	<1	<1	20	0.18	21 0	7.47	1 5
25-Aug-14		498	407266	0.23	0.49	<1	<1	<10	0.16	14.7	7.44	1.0
26-Aug-14		498	407260	0.38	0.53	<1	<1	<10	0.30	14.9	7.38	2.0
25-Aug-14		498	407267	0.48	0.68	<1	<1	<10	0.28	14.4	7.55	0.5
26-Aug-14		498	407261	0.37	0.56	<1	<1	<10	0.78	15.1	7.50	1.0
25-Aug-14		499	407269	0.63	0.79	<1	<1	10	1.07	16.0	7.47	2.0
26-Aug-14		499	407265	0.65	0.73	<1	<1	<10	0.30	16.9	7.43	2.0
25-Aug-14		499	407268	0.46	0.67	<1	<1	<10	0.46	18.1	7.52	2.5
26-Aug-14		499	407264	0.51	0.68	<1	<1	<10	0.22	17.9	7.48	0.5
25-Aug-14		513	407293	0.37	0.62	<1	<1	<10	0.19	16.5	7.55	1.0
26-Aug-14		513	407287	0.39	0.81	<1	<1	<10	0.46	18.1	7.56	2.5
25-Aug-14		513	407294	0.64	0.95	<1	<1	<10	0.18	18.2	7.51	0.5
26-Aug-14		513	407288	0.37	0.53	<1	<1	<10	0.43	18.1	7.56	2.5
25-Aug-14		515	407296	0.75	0.92	<1	<1	<10	0.17	18.2	7.60	0.5
27-Aug-14		515	407292	0.59	0.74	<1	<1	<10	0.18	17.2	7.58	0.5

2014 Water Main Cleaning Program

Laboratory Analysis Report Household Monitoring

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
25-Aug-14		515	407295	0.71	0.92	<1	<1	<10	0.16	17 9	7.56	2 0
27-Aug-14		515	407291	0.79	0.91	<1	<1	<10	0.19	15 2	7.44	1 0
26-Aug-14		508	407316	0.60	0.75	<1	<1	<10	0.26	15 8	7.45	0 5
27-Aug-14		508	407310	0.70	0.85	<1	<1	<10	0.27	16.1	7.52	0 5
26-Aug-14		508	407315	0.40	0.55	<1	<1	<10	0.30	14.1	7.46	2.0
27-Aug-14		508	407309	0.58	0.87	<1	<1	<10	0.30	15.4	7.39	0 5
26-Aug-14		510	407317	0.18	0.38	<1	<1	<10	0.56	19 3	7.49	1 0
28-Aug-14		510	407313	0.57	0.79	<1	<1	<10	0.90	19 8	7.50	2 5
26-Aug-14		510	407318	0.14	0.27	<1	<1	10	0.32	16 5	7.50	1 0
28-Aug-14		510	407314	0.45	0.62	<1	<1	<10	0.30	17.1	7.38	0 5
26-Aug-14		520	407329	1.00	1.28	<1	<1	<10	0.15	20.1	7.49	1.0
27-Aug-14		520	407325	0.91	1.04	<1	<1	<10	0.29	19.6	7.45	0 5
26-Aug-14		520	407330	1.06	1.21	<1	<1	<10	0.14	20.4	7.57	0.5
27-Aug-14		520	407326	0.91	1.09	<1	<1	<10	0 21	18.8	7.46	0.5
26-Aug-14		519	407327	0.52	0.70	<1	<1	<10	0.17	20.1	7.40	2.0
27-Aug-14		519	407321	1.13	1.29	<1	<1	<10	0.32	20.8	7.44	1.0
26-Aug-14		519	407328	0.56	0.73	<1	<1	<10	0.16	20.5	7.42	1.0
27-Aug-14		519	407322	1.00	1.29	<1	<1	<10	0.25	20.5	7.47	0.5

2014 Water Main Cleaning Program

Laboratory Analysis Report Household Monitoring

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
27-Aug-14		516	407696	0.39	0.54	<1	<1	<10	0.39	18.4	7.51	0 5
28-Aug-14		516	407692	0.51	0.66	<1	<1	<10	0.24	18 9	7.47	2 0
27-Aug-14		516	407695	0.68	0.88	<1	<1	<10	0.39	17 3	7.47	0 5
28-Aug-14		516	407691	0.43	0.67	<1	<1	<10	0.27	17 2	7.44	2 5
27-Aug-14		515	407694	0.80	0.98	<1	<1	<10	0.14	15.3	7.39	1.0
28-Aug-14		515	407688	0.64	0.81	<1	<1	<10	0.45	16.1	7.42	1 0
27-Aug-14		515	407693	0.57	0.80	<1	<1	<10	0.14	15.0	7.42	0.5
28-Aug-14		515	407687	0.57	0.75	<1	<1	<10	0.52	16.7	7.42	2 5
27-Aug-14		534	407682	0.33	0.50	<1	<1	<10	0 20	19.6	7.54	1.0
28-Aug-14		534	407676	0.41	0.55	<1	<1	<10	0.22	19.2	7.58	0.5
27-Aug-14		534	407681	0.79	1.00	<1	<1	<10	0.22	17.9	7.48	0.5
28-Aug-14		534	407675	0.74	0.91	<1	<1	10	0.24	18 9	7.34	1 0
27-Aug-14		535	407684	0.48	0.64	<1	<1	<10	0 23	18.0	7.58	0.5
28-Aug-14		535	407680	0.40	0.56	<1	<1	<10	0.72	18.4	7.52	1.0
27-Aug-14		535	407683	0.48	0.63	<1	<1	<10	0.18	17.0	7.47	0.5
28-Aug-14		535	407679	0.41	0.58	<1	<1	<10	1.14	16.3	7.43	2.0
29-Aug-14		535	407826	0.38	0.55	NA	NA	NA	0.19	15.8	NA	NA
28-Aug-14		524	407778	0.59	0.79	<1	<1	<10	0 20	16.5	7.38	0.5
29-Aug-14		524	407772	0.61	0.78	<1	<1	<10	0.37	16.3	7.37	3.5

2014 Water Main Cleaning Program

Laboratory Analysis Report Household Monitoring

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
28-Aug-14		524	407779	0.80	0.94	<1	<1	<10	0.18	15 9	7.40	1 0
29-Aug-14		524	407773	0.70	0.93	<1	<1	<10	0.30	16.7	7.51	0 5
28-Aug-14		526	407780	0.79	0.96	<1	<1	<10	0.25	13.7	7.37	0 5
29-Aug-14		526	407776	0.59	0.85	<1	<1	<10	0.28	14.7	7.44	1 0
28-Aug-14		526	407781	0.43	0.62	<1	<1	10	0.36	15 2	7.37	1 0
29-Aug-14		526	407777	0.52	0.74	1	<1	<10	0.23	16 3	7.44	0 5
4-Sep-14		526	408495	0.42	0.55	<1	<1	10	0.18	15 2	NA	NA
4-Sep-14		596	408505	0.58	0.78	<1	<1	<10	0.36	18.0	7.45	2.5
11-Sep-14		596	408501	0.52	0.66	<1	<1	<10	0.22	17.1	7.45	1 0
4-Sep-14		596	408504	0.72	0.81	<1	<1	<10	0.51	18.1	7.53	2.5
11-Sep-14		596	408500	0.31	0.83	<1	<1	<10	0.40	16.5	7.57	1.5
4-Sep-14		595	408503	0.64	0.79	<1	<1	<10	0.38	18.2	7.40	1.5
11-Sep-14		595	408497	0.83	1.02	<1	<1	<10	0.26	18.1	7.40	2 5
4-Sep-14		595	408502	0.20	0.76	<1	<1	20	0.50	13.2	7.38	1.0
11-Sep-14		595	408496	0.69	0.90	<1	<1	<10	0.26	17 8	7.39	5 0
11-Sep-14		667	409177	0.55	0.78	<1	<1	<10	0.48	15.6	7.52	3.5
12-Sep-14		667	409173	1.03	1.30	<1	<1	<10	1.47	15.3	7.42	5.0
15-Sep-14		667	409368	NA	NA	NA	NA	NA	0 29	17.1	NA	NA

2014 Water Main Cleaning Program

Laboratory Analysis Report Household Monitoring

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
11-Sep-14		667	409178	0.52	0.79	<1	<1	<10	3.52	15.7	7.49	2.0
12-Sep-14		667	409174	0.77	0.95	<1	<1	<10	1.30	16.2	7.48	1.0
15-Sep-14		667	409369	NA	NA	NA	NA	NA	0.44	16.9	NA	NA
11-Sep-14		665	409175	0.87	1.02	<1	<1	<10	0.21	16.4	7.59	0.5
12-Sep-14			409169	1.00	1.14	<1	<1	<10	1.85	16 8	7.40	2 5
15-Sep-14		665	409366	NA	NA	NA	NA	NA	0.37	16.5	NA	NA
11-Sep-14		665	409176	0.44	0.60	<1	<1	<10	0.22	16.8	7.60	2.0
12-Sep-14		665	409170	0.52	0.82	<1	<1	<10	1.85	16.7	7.54	2 5
15-Sep-14		665	409367	NA	NA	NA	NA	NA	0.29	16.4	NA	NA
12-Sep-14		678	409253	0.55	0.80	<1	<1	<10	1.42	17.1	7.43	6.0
15-Sep-14		678	409249	0.33	0.64	<1	<1	<10	0.29	15.8	7.47	1 0
12-Sep-14		678	409252	0.40	0.71	<1	<1	<10	1.78	14.4	7.50	5.0
15-Sep-14		678	409248	0.42	0.59	2	<1	10	0.33	14.9	7.83	1.5
18-Sep-14		678	409885	0.35	0.69	<1	<1	10	0.43	14.1	NA	NA
12-Sep-14		677	409251	0.54	0.75	<1	<1	<10	1.68	15.8	7.44	4.0
15-Sep-14		677	409245	0.59	0.75	<1	<1	<10	0.26	14.7	7.59	2.0
12-Sep-14		677	409250	0.78	1.00	<1	<1	20	2.40	14.9	7.40	6.0
15-Sep-14		677	409244	0.58	0.79	<1	<1	<10	0 33	15.0	7.68	5.0
15-Sep-14		707	409406	0.39	0.63	<1	<1	<10	0 35	15.1	7.49	3.0
16-Sep-14		707	409402	0.30	0.47	<1	<1	<10	0.28	14.8	7.60	1.0

2014 Water Main Cleaning Program

Laboratory Analysis Report Household Monitoring

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
15-Sep-14		707	409407	0.64	0.78	<1	<1	<10	0.21	14.1	7.40	2 0
16-Sep-14		707	409403	0.38	0.61	<1	<1	<10	0.25	14 3	7.60	0 5
15-Sep-14		706	409404	0.57	0.74	<1	<1	<10	0.22	15 0	7.39	2 0
16-Sep-14		706	409399	0.29	0.42	<1	<1	<10	0.61	14 5	7.67	2 5
15-Sep-14		706	409405	0.56	0.75	<1	<1	<10	0.27	15.1	7.46	2.0
16-Sep-14		706	409398	0.68	0.88	<1	<1	10	0.29	15 9	7.52	0 5
16-Sep-14		713	409430	0.45	0.62	<1	<1	<10	0.28	15.1	7.67	2.5
18-Sep-14		713	409426	0.45	0.64	<1	<1	<10	0.34	14.7	7.71	3 0
16-Sep-14		713	409431	0.50	0.67	<1	<1	<10	0.33	15.0	7.73	2.0
18-Sep-14		713	409427	0.40	0.59	<1	<1	<10	0.30	14 8	7.77	1 0
16-Sep-14		712	409429	1.12	1.30	<1	<1	<10	0.26	15.9	7.66	1.0
18-Sep-14		712	409423	0.68	0.90	<1	<1	<10	0.41	15.4	7.74	3 5
16-Sep-14		712	409428	0.40	0.75	<1	<1	<10	0.31	15.1	7.73	1.0
18-Sep-14		712	409422	0.22	0.44	<1	<1	10	0.26	15 2	7.76	5 0
18-Sep-14		729	409892	0.35	0.72	<1	<1	<10	0.59	14.5	7.65	2.5
19-Sep-14		729	409886	0.13	0.28	<1	<1	<10	0.57	14 2	7.60	2 5
18-Sep-14		729	409893	0.12	0.29	<1	<1	<10	0.56	14.6	7.64	5.0
19-Sep-14		729	409887	0.13	0.28	<1	<1	<10	0.59	14.7	7.56	2 5

2014 Water Main Cleaning Program

Laboratory Analysis Report Household Monitoring

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
18-Sep-14		730	409894	0.13	0.32	<1	<1	<10	0.44	12 5	7.65	2 5
19-Sep-14		730	409890	0.20	0.33	<1	<1	<10	0.51	12 8	7.56	5 0
18-Sep-14		730	409895	0.11	0.29	<1	<1	<10	1.66	14 3	7.75	1 0
19-Sep-14		730	409891	0.12	0.25	<1	<1	<10	0.55	14 3	7.74	5 0
19-Sep-14		735	409978	0.34	0.49	<1	<1	<10	0.66	14.9	7.64	1.0
22-Sep-14		735	409972	0.19	0.36	<1	<1	<10	0.49	14.6	7.63	5 0
19-Sep-14		736	409980	0.17	0.38	<1	<1	50	0.37	15.1	7.60	0.5
22-Sep-14		736	409976	0.22	0.49	<1	<1	<10	0.36	15.1	7.52	0 5
19-Sep-14		736	409981	0.13	0.27	<1	<1	<10	0.41	15.7	7.72	0.5
22-Sep-14		736	409977	0.15	0.30	<1	<1	<10	0.40	15 9	7.71	2 0
19-Sep-14		735	409979	0.13	0.28	<1	<1	<10	0.99	14.2	7.61	2.0
22-Sep-14		735	409973	0.18	0.33	<1	<1	<10	0.38	13 5	7.62	6 0
22-Sep-14		82	410173	0.93	1.13	<1	<1	<10	0.28	15.6	7.58	5.0
23-Sep-14		82	410167	1.01	1.13	<1	<1	<10	0.30	16 5	7.63	1 0
22-Sep-14		84	410175	0.74	0.93	<1	<1	<10	0.30	15.7	7.50	2.5
23-Sep-14		84	410171	0.78	0.93	<1	<1	<10	0.35	15.0	7.53	2.0
22-Sep-14		82	410172	0.72	0.87	<1	<1	<10	0.30	14.9	7.55	6.0
23-Sep-14		82	410166	0.71	0.94	<1	<1	<10	0.27	14 8	7.61	2 0

2014 Water Main Cleaning Program

Laboratory Analysis Report Household Monitoring

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
22-Sep-14		84	410174	0.74	1.11	<1	<1	<10	0.29	15.4	7.52	1 0
23-Sep-14		84	410170	0.68	0.94	<1	<1	<10	0.40	15 8	7.63	2 5
23-Sep-14		94	410211	0.90	1.06	<1	<1	<10	0.38	15.7	7.64	0.5
25-Sep-14		94	410205	0.86	1.05	<1	<1	<10	0.38	15.9	7.80	4.0
23-Sep-14		95	410213	0.73	0.92	<1	<1	<10	0.39	15.7	7.59	0.5
25-Sep-14		95	410209	0.99	1.10	<1	<1	<10	0.33	15.0	7.74	5.0
23-Sep-14		94	410212	0.79	0.94	<1	<1	<10	0 31	16.0	7.64	0.5
25-Sep-14		94	410206	0.95	1.11	<1	<1	<10	0.38	15.9	7.69	6.0
23-Sep-14		95	410214	0.76	0.98	<1	<1	<10	0 27	18.3	7.59	2.0
25-Sep-14		95	410210	0.98	1.18	<1	<1	<10	0 37	15.7	7.69	5.0
25-Sep-14		113	410661	0.56	0.67	<1	<1	<10	1.40	17.8	7.75	1.0
29-Sep-14		113	410655	0.90	1.09	<1	<1	<10	0 30	16.5	7.59	4.0
25-Sep-14		113	410662	0.59	0.78	<1	<1	<10	0 96	16.2	7.76	2.0
29-Sep-14		113	410656	0.78	1.02	<1	<1	<10	0 32	16.2	7.63	3.0
25-Sep-14		114	410663	0.93	1.03	<1	<1	<10	0 52	15.5	7.85	4.0
29-Sep-14		114	410659	0.62	0.89	<1	<1	<10	0 31	16.3	7.71	5.0
25-Sep-14		114	410664	0.73	0.88	<1	<1	10	0 51	16.7	7.83	3.0
29-Sep-14		114	410660	0.88	0.99	<1	<1	<10	0 30	16.1	7.69	2.5

2014 Water Main Cleaning Program

Laboratory Analysis Report Household Monitoring

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
30-Sep-14		162	410941	0.88	0.99	<1	<1	<10	0.48	14 5	7.70	0 5
2-Oct-14		162	410937	0.75	0.95	<1	<1	10	0.26	13 9	7.73	0 5
30-Sep-14		162	410940	0.63	0.78	<1	<1	<10	0.59	13.1	7.68	2 5
2-Oct-14		162	410936	0.94	1.10	<1	<1	<10	0.30	13 0	7.58	1 0
30-Sep-14		161	410938	0.67	0.82	<1	<1	<10	0.54	12.5	7.66	2.5
2-Oct-14		161	410932	0.64	0.86	<1	<1	<10	0.37	12.5	7.63	3.0
30-Sep-14		161	410939	0.75	0.87	<1	<1	20	0.57	12.0	7.67	1.0
2-Oct-14		161	410933	0.99	1.19	<1	<1	40	0.34	12.3	7.60	2.0
2-Oct-14		188	411455	0.86	1.08	<1	<1	<10	0.26	15.8	7.66	1.0
3-Oct-14		188	411449	0.78	0.90	<1	<1	<10	0.46	15.1	7.61	2.5
2-Oct-14		188	411454	1.09	1.29	<1	<1	<10	0.34	16.4	7.56	5.0
3-Oct-14		188	411448	1.21	1.93	<1	<1	10	0.35	16.9	7.61	1.0
2-Oct-14		189	411457	0.85	1.02	<1	<1	<10	0.35	15.9	7.59	1.0
3-Oct-14		189	411453	1.05	1.20	<1	<1	<10	0.30	14.3	7.52	2.5
2-Oct-14		189	411456	0.81	1.10	<1	<1	<10	0.27	16.7	7.54	2.5
3-Oct-14		189	411452	0.43	0.69	<1	<1	<10	0.24	15.8	7.64	0.5
3-Oct-14		204	411517	0.65	0.74	<1	<1	<10	0.79	15.9	7.58	2.5
6-Oct-14		204	411511	0.76	1.22	<1	<1	<10	0.33	15.4	7.53	0 5

2014 Water Main Cleaning Program

Laboratory Analysis Report Household Monitoring

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
3-Oct-14		204	411518	0.85	1.23	<1	<1	<10	0.60	15.4	7.57	2 0
6-Oct-14		204	411512	0.59	0.81	<1	<1	<10	0.22	15.4	7.48	0 5
3-Oct-14		205	411519	0.96	1.22	<1	<1	<10	1.10	15.1	7.50	7 0
6-Oct-14		205	411515	0.77	0.95	<1	<1	<10	0.23	14.6	7.53	0 5
3-Oct-14		205	411520	0.81	1.17	<1	<1	<10	0.81	17.6	7.57	2 0
6-Oct-14		205	411516	0.81	1.00	<1	<1	<10	0.22	16 3	7.45	0 5
6-Oct-14		238	411702	0.50	0.65	<1	<1	<10	0.23	15.4	7.51	0.5
7-Oct-14		238	411696	0.65	0.80	<1	<1	<10	0.22	14 5	7.55	2 5
6-Oct-14		238	411703	0.11	0.19	<1	<1	<10	0.51	13.7	7.44	0.5
7-Oct-14		238	411697	0.21	0.37	<1	<1	<10	0.51	13.4	7.56	2 0
6-Oct-14		241	411704	0.24	0.41	<1	<1	10	0.40	13.8	7.53	1.0
7-Oct-14		241	411700	0.34	0.54	<1	<1	<10	0.32	15.0	7.61	1.5
6-Oct-14		241	411705	0.10	0.44	<1	<1	<10	0.50	16.0	7.64	0.5
7-Oct-14		241	411701	0.20	0.41	<1	<1	<10	0.42	14 5	7.75	4 5
7-Oct-14		254	411738	0.66	0.86	<1	<1	<10	0.21	14.7	7.56	0 5
9-Oct-14		254	411734	0.50	0.77	<1	<1	<10	0.30	13.7	7.54	1.0
7-Oct-14		254	411737	0.75	1.03	<1	<1	10	0.20	14.5	7.48	0.5
9-Oct-14		254	411733	0.75	0.92	<1	<1	20	0.51	14.5	7.46	2.0

2014 Water Main Cleaning Program

Laboratory Analysis Report Household Monitoring

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
7-Oct-14		249	411735	0.99	1.18	<1	<1	<10	0.23	15.1	7.58	2 5
9-Oct-14		249	411729	0.93	1.03	<1	<1	60	0.80	13 9	7.56	1 0
7-Oct-14		249	411736	0.87	1.27	<1	<1	<10	0.23	14 3	7.45	0 5
9-Oct-14		249	411730	0.82	0.99	<1	<1	<10	0.25	14.3	7.44	0.5
9-Oct-14		285	412018	0.25	0.44	<1	<1	<10	0.40	17.8	7.53	2.5
10-Oct-14		285	412014	1.11	1.25	<1	<1	<10	0.55	14 2	7.53	0 5
9-Oct-14		285	412017	0.57	0.85	<1	<1	<10	0.28	15.1	7.48	5.0
10-Oct-14		285	412013	0.56	0.86	<1	<1	<10	0.50	14.7	7.51	0 5
9-Oct-14		284	412016	0.54	0.77	<1	<1	10	0.30	17.4	7.41	0.5
10-Oct-14		284	412010	0.21	0.41	<1	<1	<10	0.44	15 3	7.71	0 5
9-Oct-14		284	412015	0.83	1.11	<1	<1	<10	0.81	15.4	7.67	2.5
10-Oct-14		284	412009	0.11	0.43	1	<1	<10	0.59	14 3	7.66	0 5
14-Oct-14		284	412744	0.28	0.44	<1	<1	<10	0.98	14 8	NA	NA
10-Oct-14		297	412079	0.11	0.21	<1	<1	10	0.36	14.7	7.78	2 5
14-Oct-14		297	412073	0.12	0.24	<1	<1	<10	0.51	15 0	8.18	0 5
10-Oct-14		297	412078	0.59	0.82	<1	<1	NR	0.47	15.7	7.64	4.0
14-Oct-14		297	412072	0.20	0.34	<1	<1	<10	0.71	15 0	7.91	2 0
10-Oct-14		298	412080	0.12	0.23	<1	<1	<10	0.35	14.8	7.75	0.5
14-Oct-14		298	412076	0.10	0.18	1	<1	<10	0.43	16 5	8.18	0 5
17-Oct-14		298	412896	0.40	0.64	<1	<1	<10	0.50	16.7	NA	NA
10-Oct-14		298	412081	0.29	0.56	<1	<1	<10	0.34	15.5	7.66	1.0
14-Oct-14		298	412077	0.23	0.38	<1	<1	10	0.82	14 8	7.99	2 5
14-Oct-14		846	412277	0.32	0.38	<1	<1	<10	1 22	17.7	8.03	0.5

2014 Water Main Cleaning Program

Laboratory Analysis Report Household Monitoring

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
16-Oct-14		846	412271	0.56	0.79	<1	<1	<10	0.60	16.1	7.81	5.0
14-Oct-14		846	412278	0.75	0.87	<1	<1	<10	0.24	13.8	7.86	0.5
16-Oct-14		846	412272	0.81	0.91	<1	<1	<10	0.43	13.4	7.62	2.5
14-Oct-14		850	412280	0.97	1.14	<1	<1	<10	0.60	14.9	7.84	0.5
16-Oct-14		850	412276	0.83	0.98	<1	<1	10	0.28	13.1	7.69	3.0
14-Oct-14		850	412279	0.92	1.08	<1	<1	<10	0 94	13.9	7.90	1.0
16-Oct-14		850	412275	0.68	0.84	<1	<1	<10	0 29	14.9	7.66	5.5
16-Oct-14		869	412810	0.81	0.98	<1	<1	<10	0 37	13.5	7.81	2.5
20-Oct-14		869	412804	1.14	1.34	<1	<1	<10	0.51	12.5	7.54	3.0
16-Oct-14		870	412812	0.70	0.94	<1	<1	<10	0.45	16.1	7.74	2.5
20-Oct-14		870	412809	0.50	0.61	<1	<1	<10	0.42	18.5	7.57	2.5
16-Oct-14		870	412813	0.77	0.97	<1	<1	<10	0 25	15.1	7.78	5.0
20-Oct-14		870	412808	1.01	1.26	<1	<1	10	0.41	15.3	7.54	2.0
16-Oct-14		869	412811	0.87	1.05	<1	<1	<10	0.63	14.3	7.65	7.0
20-Oct-14		869	412805	1.18	1.35	<1	<1	<10	0 51	13.9	7.46	2.0

2014 Water Main Cleaning Program

Laboratory Analysis Report Household Monitoring

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
17-Oct-14		871	412891	0.85	1.05	<1	<1	<10	0.20	14.2	7.60	1 0
20-Oct-14		871	412885	1.05	1.29	<1	<1	30	0.59	13.2	7.54	3 0
17-Oct-14		871	412892	0.55	0.74	<1	<1	10	0.29	13.7	7.62	1.0
20-Oct-14		871	412886	0.69	0.79	<1	<1	10	0.95	13.4	7.46	1 0
17-Oct-14		872	412894	0.34	0.53	<1	<1	10	0.29	13 9	7.69	1 5
20-Oct-14		872	412890	0.85	1.04	<1	<1	<10	0.47	12 2	7.50	2 5
17-Oct-14		872	412893	0.75	0.96	<1	<1	<10	0.22	13.1	7.72	1 0
20-Oct-14		872	412889	1.00	1.17	<1	<1	<10	0.77	12.4	7.53	2 0
21-Oct-14		921	413095	0.79	1.03	<1	<1	<10	0.22	13.8	7.56	0.5
23-Oct-14		921	413092	0.68	0.91	<1	<1	<10	0.26	14.7	7.54	0 5
21-Oct-14		921	413096	0.78	0.98	<1	<1	<10	0.27	13.3	7.57	1.0
23-Oct-14		921	413091	0.76	0.95	<1	<1	<10	0.21	13.5	7.59	0.5
21-Oct-14		572	413104	0.74	0.85	<1	<1	<10	0.31	11.3	7.60	0.5
23-Oct-14		572	413098	0.59	0.76	<1	<1	<10	0.43	11.1	7.55	0 5
21-Oct-14		572	413105	0.10	0.24	<1	<1	110	0.45	10.1	7.68	1.0
23-Oct-14		572	413099	0.43	0.60	<1	<1	<10	0.48	10.6	7.62	2 5
21-Oct-14		920	413094	0.80	0.97	<1	<1	<10	1.78	12.7	7.58	3.0
23-Oct-14		920	413088	0.45	0.57	<1	<1	<10	0.19	13 5	7.63	2 5

2014 Water Main Cleaning Program

Laboratory Analysis Report Household Monitoring

Date Sampled	Sample Location	Sequence Number	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E.Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (°C)	pH (units)	True Colour (tcu)
21-Oct-14		920	413093	0.31	0.45	<1	<1	<10	1.37	13 9	7.63	2 0
23-Oct-14		920	413087	0.21	0.44	<1	<1	<10	0.28	14.4	7.54	2 5
21-Oct-14		575	413107	0.35	0.45	<1	<1	1000	0.73	12 3	7.58	2 0
23-Oct-14		575	413102	0.33	0.51	<1	<1	<10	0.33	10 9	7.61	0 5
27-Oct-14		575	413782	0.42	0.62	<1	<1	1250	0.17	13 5	NA	NA
30-Oct-14		575	414240	0.40	0.55	<1	<1	100	0.23	12.7	NA	NA
21-Oct-14		575	413106	0.57	0.68	<1	<1	<10	0.30	10.6	7.60	0 5
23-Oct-14		575	413103	0.68	0.81	<1	<1	<10	0.37	10.6	7.61	0.5
22-Oct-14		941	413529	0.68	0.76	<1	<1	<10	0.74	13.8	7.68	2.0
23-Oct-14		941	413524	0.68	0.89	<1	<1	<10	0.32	12.7	7.64	0 5
22-Oct-14		941	413530	0.74	0.90	<1	<1	<10	0.54	13 5	7.62	1 5
23-Oct-14		941	413523	0.83	0.98	<1	<1	<10	0.20	13.1	7.63	0 5

NOTE: On October 10, there was no result for HPC due to contract lab error.
Several attempts were made to resample at 1104 Aberdeen, but access was not granted. Therefore, the resample was taken next door.

Notes: NA: not analysed
NR: no result

E4d Regional Monitoring (DS) Reports 2011-2014

2011 Water Main Cleaning Program

Laboratory Analysis Report Regional Monitoring

NE06_[redacted].

Date Sampled	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E. Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (ºC)	Apparent Colour (acu)	True Colour (tcu)	pH (units)	Dissolved Oxygen (mg/L)
2-May-11	290380	0.49	0.70	<1	<1	<10	0.17	4.6	2.5	0.5	7.38	12.2
9-May-11	291099	0.71	1.00	<1	<1	<10	0.15	10.1	2.5	<0.5	7.43	11.8
16-May-11	291764	0.91	1.21	<1	<1	<10	0.15	8.1	6.5	1.5	7.36	12.8
24-May-11	292419	0.99	1.23	<1	<1	100	0.20	11.9	6.5	1.5	7.43	11.9
30-May-11	293218	0.81	1.04	<1	<1	<10	0.17	12.7	13.0	1.0	7.78	11.9
6-Jun-11	294084	0.83	1.02	<1	<1	<10	0.20	13.1	13.0	5.0	7.73	11.4
13-Jun-11	294912	0.72	0.83	<1	<1	<10	0.37	15.3	5.0	2.5	7.46	11.5
20-Jun-11	295618	0.72	1.02	<1	<1	<10	0.16	13.7	11.0	2.0	7.31	10.8
27-Jun-11	296274	0.81	0.95	<1	<1	<10	0.15	18.2	16.0	2.5	7.40	10.9
4-Jul-11	296998	0.73	0.91	<1	<1	<10	0.14	15.7	10.0	2.5	7.37	10.8
12-Jul-11	297768	0.80	0.92	<1	<1	<10	0.29	21.1	5.0	NR[1]	7.27	10.4
18-Jul-11	298484	0.87	1.12	<1	<1	<10	0.20	17.3	7.5	0.5	7.35	9.9
25-Jul-11	299256	0.84	0.98	<1	<1	10	0.23	21.8	7.5	2.5	7.40	10.8
2-Aug-11	299941	0.71	0.94	<1	<1	<10	0.18	20.3	5.0	0.5	7.39	10.5
8-Aug-11	300518	0.80	0.90	<1	<1	<10	0.18	22.1	5.0	1.0	7.57	9.6
15-Aug-11	301266	0.78	1.02	<1	<1	<10	0.26	21.7	5.0	1.0	7.48	10.7
22-Aug-11	301917	0.76	0.96	<1	<1	<10	0.16	21.3	5.0	2.0	7.51	9.9
29-Aug-11	302601	0.95	1.14	<1	<1	<10	0.15	21.2	5.0	2.0	7.28	10.8
6-Sep-11	303439	1.18	1.38	<1	<1	<10	0.17	20.1	5.0	1.0	7.25	10.3
12-Sep-11	304084	0.96	1.22	<1	<1	<10	0.17	19.6	5.0	1.0	7.46	10.4
19-Sep-11	304756	1.32	1.46	<1	<1	<10	0.26	17.6	5.0	1.0	7.56	10.4
26-Sep-11	305518	1.27	1.46	<1	<1	<10	0.25	17.2	5.0	1.0	7.34	11.1

NE07_[redacted]

Date Sampled	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E. Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (ºC)	Apparent Colour (acu)	True Colour (tcu)	pH (units)	Dissolved Oxygen (mg/L)
2-May-11	290381	0.64	0.88	<1	<1	<10	0.16	7.1	2.5	0.5	7.38	12.2
9-May-11	291100	0.53	0.79	<1	<1	<10	0.18	5.9	2.5	<0.5	7.43	11.6
16-May-11	291765	0.78	1.02	<1	<1	<10	0.17	7.9	5.0	1.5	7.37	13.0
24-May-11	292420	0.82	1.01	<1	<1	<10	0.17	8.1	7.0	1.0	7.49	12.0
30-May-11	293219	0.77	1.15	<1	<1	<10	0.33	8.2	11.0	2.5	7.79	11.8
6-Jun-11	294085	0.71	0.93	<1	<1	<10	0.21	11.1	15.0	5.0	7.71	11.6
13-Jun-11	294913	0.50	0.73	<1	<1	<10	0.21	11.9	7.5	5.0	7.45	11.7
20-Jun-11	295619	0.68	0.93	<1	<1	<10	0.17	10.2	10.0	2.5	7.48	11.0
27-Jun-11	296275	0.67	0.81	<1	<1	<10	0.20	15.1	18.0	7.5	7.43	11.1
4-Jul-11	296999	0.46	0.62	<1	<1	<10	0.18	14.4	10.0	2.0	7.42	10.8
12-Jul-11	297769	0.44	0.70	<1	<1	<10	0.25	15.7	7.5	NR[1]	7.44	10.5
18-Jul-11	298485	0.76	1.14	<1	<1	<10	0.95	18.7	13.0	2.5	7.43	10.2
25-Jul-11	299257	0.41	0.49	<1	<1	<10	0.33	18.6	10.0	2.5	7.46	10.8
2-Aug-11	299942	0.58	0.76	<1	<1	<10	0.20	19.3	10.0	2.0	7.45	10.3
8-Aug-11	300519	0.55	0.73	<1	<1	<10	0.19	19.0	5.0	1.0	7.50	11.2
15-Aug-11	301267	0.47	0.71	<1	<1	<10	0.20	20.7	5.0	2.0	7.53	10.6
22-Aug-11	301918	0.47	0.66	<1	<1	<10	0.15	19.1	6.0	2.0	7.56	10.8
29-Aug-11	302602	0.89	1.07	<1	<1	<10	0.19	20.1	6.0	2.0	7.36	10.2
6-Sep-11	303440	0.95	1.08	<1	<1	<10	0.21	18.7	5.0	1.0	7.29	10.3
12-Sep-11	304085	0.98	1.25	<1	<1	10	0.25	19.4	5.0	1.0	7.45	10.4
19-Sep-11	304757	1.07	1.25	<1	<1	<10	0.19	17.6	6.0	1.0	7.51	10.6
26-Sep-11	305519	1.11	1.17	<1	<1	<10	0.30	16.2	5.0	1.0	7.37	11.7

NE09_

Date Sampled	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E. Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (ºC)	Apparent Colour (acu)	True Colour (tcu)	pH (units)	Dissolved Oxygen (mg/L)
2-May-11	290382	0.30	0.51	<1	<1	<10	0.36	5.4	2.5	0.5	7.41	12.0
9-May-11	291101	0.28	0.55	<1	<1	<10	0.26	6.7	2.5	<0.5	7.52	11.6
18-May-11	291766	0.41	0.60	<1	<1	<10	0.22	7.8	7.5	3.0	7.53	12.0
24-May-11	292421	0.43	0.64	<1	<1	<10	0.23	9.0	6.0	1.5	7.49	11.6
30-May-11	293220	0.38	0.71	<1	<1	<10	0.25	8.6	10.0	1.0	7.79	11.4
6-Jun-11	294086	0.32	0.55	<1	<1	<10	0.23	9.3	13.0	5.0	7.74	11.3
13-Jun-11	294914	0.24	0.45	<1	<1	<10	0.26	9.9	7.5	4.0	7.54	11.3
20-Jun-11	295620	0.33	0.52	<1	<1	<10	0.21	10.7	10.0	2.0	7.37	10.5
27-Jun-11	296276	0.37	0.48	<1	<1	<10	0.17	21.1	18.0	7.5	7.42	10.4
4-Jul-11	297000	0.19	0.41	<1	<1	<10	0.21	14.7	10.0	2.5	7.46	10.4
12-Jul-11	297770	0.27	0.39	<1	<1	<10	0.23	13.2	5.0	NR[1]	7.39	9.9
18-Jul-11	298486	0.16	0.72	<1	<1	<10	0.88	17.4	15.0	2.5	7.42	10.0
25-Jul-11	299258	0.15	0.30	<1	<1	<10	0.36	15.9	7.5	2.0	7.48	10.1
2-Aug-11	299943	0.12	0.26	<1	<1	<10	0.22	18.2	5.0	2.0	7.48	10.1
8-Aug-11	300520	0.13	0.28	<1	<1	<10	0.30	17.2	5.0	1.0	7.62	10.9
15-Aug-11	301268	0.10	0.31	<1	<1	<10	0.31	17.2	5.0	1.0	7.51	10.0
22-Aug-11	301919	0.10	0.19	<1	<1	20	0.59	17.3	5.0	1.0	7.56	9.9
24-Aug-11	302525*	0.04	0.20	NA	NA	NA	NA	17.7	NA	NA	NA	NA
26-Aug-11	302588*	0.04	0.19	NA	NA	NA	NA	17.9	NA	NA	NA	NA
29-Aug-11	302603	0.06	0.18	<1	<1	<10	0.36	21.9	5.0	2.0	7.46	10.0
2-Sep-11	303304*	0.10	0.25	NA	NA	NA	NA	17.3	NA	NA	NA	NA
6-Sep-11	303441	<0.02	0.13	<1	<1	<10	0.34	16.5	6.0	1.0	7.37	9.7
7-Sep-11	303982*	0.12	0.30	NA	NA	NA	NA	17.9	NA	NA	NA	NA
8-Sep-11	304034*	0.10	0.29	NA	NA	NA	NA	17.7	NA	NA	NA	NA
12-Sep-11	304086	0.18	0.43	<1	<1	<10	0.27	16.8	5.0	1.0	7.49	9.9
15-Sep-11	304679*	0.24	0.39	NA	NA	NA	NA	17.3	NA	NA	NA	NA
19-Sep-11	304758	0.28	0.46	<1	<1	20	0.27	16.6	5.0	1.0	7.42	10.5
26-Sep-11	305520	0.41	0.54	<1	<1	<10	0.28	16.0	6.0	1.0	7.25	11.0

*Throughout the end of August and the beginning of September this location was resampled for free and total chlorine on several different occasions due to low chlorine results. All other parameters were not analysed. The chlorine set point was increased and additional testing was conducted in the immediate area. The free chlorine levels at the location and surrounding areas increased and continued to meet the compliance limit. A few closed and broken valves were found which may have contributed to the low chlorine results.

NE10_

Date Sampled	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E. Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (ºC)	Apparent Colour (acu)	True Colour (tcu)	pH (units)	Dissolved Oxygen (mg/L)
2-May-11	290383	0.45	0.67	<1	<1	<10	0.30	4.6	0.5	0.5	7.53	12.5
9-May-11	291102	0.10	0.31	<1	<1	<10	0.28	10.6	2.0	<0.5	7.57	11.7
13-May-11	291840**	0.34	0.57	NA	NA	NA	NA	8.5	NA	NA	NA	NA
16-May-11	291767	0.47	0.85	<1	<1	<10	0.19	10.5	5.0	1.0	7.42	12.6
24-May-11	292422	0.50	0.75	<1	<1	<10	0.18	9.4	5.0	1.0	7.53	12.1
30-May-11	293221	0.58	0.90	<1	<1	<10	0.20	8.2	13.0	2.5	7.82	11.7
6-Jun-11	294087	0.44	0.66	<1	<1	<10	0.19	14.2	13.0	5.0	7.76	10.8
13-Jun-11	294915	0.44	0.56	<1	<1	<10	0.28	11.9	7.5	5.0	7.62	11.4
20-Jun-11	295621	0.36	0.59	<1	<1	<10	0.17	12.1	10.0	5.0	7.45	10.7
27-Jun-11	296277	0.41	0.58	<1	<1	<10	0.21	12.8	15.0	5.0	7.49	10.9
4-Jul-11	297001	0.21	0.39	<1	<1	<10	0.17	15.8	10.0	2.0	7.51	10.4
12-Jul-11	297771	0.31	0.48	<1	<1	<10	0.21	19.5	5.0	NR[1]	7.52	10.3
18-Jul-11	298487	0.33	0.51	<1	<1	<10	0.21	16.2	10.0	2.5	7.44	10.1
25-Jul-11	299259	0.23	0.40	<1	<1	<10	0.16	17.3	5.0	2.0	7.49	10.5
2-Aug-11	299944	0.47	0.65	<1	<1	<10	0.16	17.9	5.0	1.0	7.51	10.5
8-Aug-11	300521	0.40	0.57	<1	<1	<10	0.18	18.8	6.0	1.0	7.49	10.8
15-Aug-11	301269	0.35	0.60	<1	<1	<10	0.28	22.6	6.0	1.0	7.57	10.2
22-Aug-11	301920	0.39	0.61	<1	<1	30	0.16	18.5	5.0	2.0	7.63	9.7
29-Aug-11	302604	0.45	0.69	<1	<1	<10	0.17	17.7	5.0	2.0	7.47	9.5
6-Sep-11	303442	0.92	1.18	<1	<1	<10	0.18	17.0	6.0	1.0	7.33	9.3
12-Sep-11	304087	1.04	1.24	<1	<1	<10	NA***	18.2	5.0	1.0	7.45	10.4
19-Sep-11	304759	0.64	0.87	<1	<1	<10	0.20	16.9	6.0	1.0	7.48	9.7
26-Sep-11	305521	1.17	1.38	<1	<1	<10	0.21	16.7	6.0	1.0	7.36	11.3

** On May 13, this location was resampled due to a low chlorine reported on May 9. All other parameters were not analysed.
*** On September 12, this sample was not analysed for turbidity due to technician error.

SE01_

Date Sampled	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E. Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (ºC)	Apparent Colour (acu)	True Colour (tcu)	pH (units)	Dissolved Oxygen (mg/L)
2-May-11	290384	0.70	0.91	<1	<1	<10	0.13	6.3	2.5	0.5	7.47	12.4
9-May-11	291103	0.74	0.95	<1	<1	<10	0.15	8.9	1.5	0.5	7.49	11.6
18-May-11	291768	0.86	1.10	<1	<1	<10	0.19	10.5	2.5	0.5	7.47	12.3
24-May-11	292423	0.77	1.13	<1	<1	<10	0.17	12.2	5.0	0.5	7.38	12.0
31-May-11	293222	0.87	1.01	<1	<1	<10	0.17	13.6	15.0	2.5	7.69	11.7
6-Jun-11	294088	0.93	1.04	<1	<1	<10	0.21	13.6	13.0	5.0	7.73	11.8
13-Jun-11	294916	0.77	0.98	<1	<1	<10	0.24	15.4	7.5	5.0	7.52	11.6
20-Jun-11	295622	0.85	1.02	<1	<1	<10	0.16	16.8	10.0	1.0	7.43	10.9
27-Jun-11	296278	0.79	0.94	<1	<1	<10	0.14	19.1	15.0	7.5	7.45	11.1
4-Jul-11	297002	0.75	0.97	<1	<1	<10	0.15	20.5	10.0	2.5	7.36	10.9
12-Jul-11	297772	0.83	0.93	<1	<1	<10	0.20	22.1	5.0	NR[1]	7.33	10.6
18-Jul-11	298488	1.14	1.23	<1	<1	<10	0.18	19.7	5.0	0.5	7.36	10.6
25-Jul-11	299260	0.81	0.96	<1	<1	<10	0.17	23.0	5.0	2.5	7.34	10.9
2-Aug-11	299945	0.86	1.23	<1	<1	<10	0.15	22.3	5.0	0.5	7.35	11.0
10-Aug-11	300522	0.84	0.99	<1	<1	10	0.16	22.9	5.0	1.0	7.58	10.1
17-Aug-11	301270	0.79	0.95	<1	<1	<10	0.18	22.7	5.0	1.0	7.54	10.1
22-Aug-11	301921	0.74	0.94	<1	<1	<10	0.15	21.8	5.0	2.0	7.68	10.4
29-Aug-11	302605	0.97	1.18	<1	<1	30	0.15	21.1	5.0	2.0	7.58	10.4
6-Sep-11	303443	1.17	1.38	<1	<1	<10	0.14	20.8	5.0	1.0	7.34	10.8
12-Sep-11	304088	1.13	1.34	<1	<1	10	0.18	20.3	5.0	1.0	7.57	10.7
19-Sep-11	304760	1.16	1.41	<1	<1	10	0.18	17.6	5.0	1.0	7.33	11.4
26-Sep-11	305522	1.24	1.45	<1	<1	<10	0.20	15.2	5.0	1.0	7.38	11.9

SE04_

Date Sampled	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E. Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (ºC)	Apparent Colour (acu)	True Colour (tcu)	pH (units)	Dissolved Oxygen (mg/L)
2-May-11	290385	0.57	0.80	<1	<1	<10	0.20	4.7	2.5	0.5	7.41	12.1
9-May-11	291104	0.52	0.68	<1	<1	<10	0.16	5.8	1.0	<0.5	7.44	11.5
16-May-11	291769	0.57	0.95	1	<1	<10	0.18	6.6	2.5	0.5	7.44	12.5
19-May-11	292274*	0.73	0.89	<1	<1	<10	0.17	7.0	NA	NA	NA	NA
24-May-11	292424	0.63	0.85	<1	<1	<10	0.17	7.8	6.0	1.0	7.49	12.0
30-May-11	293223	0.54	0.91	<1	<1	<10	0.18	8.7	13.0	1.0	7.82	11.9
6-Jun-11	294089	0.44	0.59	<1	<1	<10	0.18	9.7	15.0	2.0	7.76	11.5
13-Jun-11	294917	0.54	0.72	<1	<1	<10	0.23	11.0	8.0	5.5	7.55	11.1
20-Jun-11	295623	0.49	0.68	<1	<1	<10	0.19	13.3	10.0	0.5	7.44	10.6
27-Jun-11	296279	0.64	0.80	<1	<1	30	0.20	13.8	15.0	7.5	7.41	10.8
4-Jul-11	297003	0.48	0.75	29	<1	TNTC	0.15	14.8	6.0	2.0	7.41	10.3
6-Jul-11	297518**	0.54	0.72	<1	<1	200	0.29	15.0	NA	NA	NA	NA
6-Jul-11	297520**	0.56	0.73	<1	<1	<10	0.14	18.6	NA	NA	NA	NA
6-Jul-11	297519**	0.48	0.66	<1	<1	<10	0.15	14.7	NA	NA	NA	NA
12-Jul-11	297773	0.51	0.72	<1	<1	<10	0.21	14.6	6.0	NR[1]	7.43	10.4
18-Jul-11	298489	0.62	0.85	<1	<1	<10	0.27	16.6	5.0	0.5	7.41	10.1
25-Jul-11	299261	0.53	0.65	<1	<1	<10	0.19	15.7	5.0	2.5	7.49	10.1
2-Aug-11	299946	0.54	0.73	<1	<1	<10	0.22	19.8	5.0	0.5	7.50	10.1
8-Aug-11	300523	0.67	0.77	<1	<1	340	0.19	19.4	5.0	1.0	7.58	10.5
15-Aug-11	301271	0.53	0.78	<1	<1	150	0.18	17.7	5.0	1.0	7.51	9.8
22-Aug-11	301922	0.58	0.78	<1	<1	40	0.13	18.1	5.0	2.0	7.55	10.1
29-Aug-11	302606	0.74	0.92	<1	<1	230	0.15	18.3	5.0	2.0	7.37	10.3
6-Sep-11	303444	0.77	1.00	<1	<1	140	0.23	17.7	5.0	1.0	7.33	10.4
12-Sep-11	304089	0.86	1.05	<1	<1	60	0.24	17.7	5.0	1.0	7.48	10.4
19-Sep-11	304761	0.96	1.16	<1	<1	20	0.18	17.1	5.0	1.0	7.49	9.7
26-Sep-11	305523	0.95	1.17	<1	<1	480	0.21	16.0	5.0	1.0	7.37	11.1

*On May 19, this location was re-sampled due to a high total coliform of 1 MPNU/100mL on May 16. Apparent and true colour, pH and dissolved oxygen were not analysed for the re-sample.
**On July 6, the location was re-sampled, as well as locations upstream and downstream due to a high total coliform of 29 MPNU/100mL and an HPC of too numerous to count on July 4. Apparent and true colour, pH and dissolved oxygen were not analyzed for the resample.

SE05_

Date Sampled	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E. Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (ºC)	Apparent Colour (acu)	True Colour (tcu)	pH (units)	Dissolved Oxygen (mg/L)
2-May-11	290386	0.52	0.77	<1	<1	<10	0.18	4.7	2.5	0.5	7.30	12.6
9-May-11	291105	0.53	0.78	<1	<1	<10	0.16	5.7	2.0	<0.5	7.42	11.7
16-May-11	291770	0.59	0.92	<1	<1	<10	0.18	7.1	3.5	1.0	7.41	12.7
24-May-11	292425	0.65	0.92	<1	<1	<10	0.16	9.8	5.0	1.0	7.49	12.0
30-May-11	293224	0.64	0.97	<1	<1	<10	0.18	10.8	11.0	0.5	7.86	11.8
6-Jun-11	294090	0.54	0.77	<1	<1	<10	0.25	11.9	13.0	5.0	7.72	11.7
13-Jun-11	294918	0.58	0.72	<1	<1	<10	0.29	13.4	8.0	5.0	7.44	11.6
20-Jun-11	295624	0.51	0.78	<1	<1	<10	0.16	13.1	10.0	2.5	7.35	10.5
27-Jun-11	296280	0.65	0.79	<1	<1	<10	0.17	17.2	15.0	7.5	7.37	11.0
4-Jul-11	297004	0.53	0.70	<1	<1	<10	0.13	16.2	10.0	1.0	7.41	10.6
12-Jul-11	297774	0.58	0.72	<1	<1	<10	0.19	20.2	6.0	NR[1]	7.33	10.3
18-Jul-11	298490	0.69	0.87	<1	<1	<10	0.24	17.4	5.0	0.5	7.39	10.1
25-Jul-11	299262	0.69	0.84	<1	<1	<10	0.18	21.7	5.0	2.5	7.44	10.7
2-Aug-11	299947	0.48	0.65	<1	<1	<10	0.18	21.6	5.0	0.5	7.50	10.3
8-Aug-11	300524	0.59	0.74	<1	<1	<10	0.39	18.6	5.0	1.0	7.51	11.1
15-Aug-11	301272	0.63	0.84	<1	<1	<10	0.37	19.9	6.0	2.0	7.51	10.2
22-Aug-11	301923	0.55	0.75	<1	<1	<10	0.13	18.7	5.0	2.0	7.51	10.0
29-Aug-11	302607	0.70	0.88	<1	<1	<10	0.16	18.3	5.0	2.0	7.38	10.6
6-Sep-11	303445	0.75	0.97	<1	<1	<10	0.18	18.0	5.0	1.0	7.30	10.5
12-Sep-11	304090	0.82	1.01	<1	<1	<10	0.19	18.0	5.0	1.0	7.46	10.2
19-Sep-11	304762	0.88	1.11	<1	<1	10	0.19	16.9	5.0	1.0	7.43	10.6
26-Sep-11	305524	0.92	1.12	<1	<1	<10	0.21	15.6	5.0	1.0	7.42	11.8

SE11_

Date Sampled	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E. Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (ºC)	Apparent Colour (acu)	True Colour (tcu)	pH (units)	Dissolved Oxygen (mg/L)
2-May-11	290387	0.49	0.70	<1	<1	<10	0.27	5.5	2.5	0.5	7.33	12.1
9-May-11	291106	0.51	0.75	<1	<1	<10	0.20	6.4	2.5	0.5	7.39	11.5
16-May-11	291771	0.60	0.88	<1	<1	<10	0.23	9.7	2.5	0.5	7.38	12.3
24-May-11	292426	0.54	0.79	<1	<1	<10	0.20	8.3	7.0	0.5	7.45	11.9
30-May-11	293225	0.65	1.01	<1	<1	<10	0.22	9.5	13.0	2.5	7.79	11.6
6-Jun-11	294091	0.60	0.81	<1	<1	10	0.75	11.1	18.0	7.0	7.71	11.6
13-Jun-11	294919	0.53	0.74	<1	<1	<10	0.29	11.5	10.0	7.0	7.51	11.3
20-Jun-11	295625	0.45	0.72	<1	<1	350	0.18	13.8	11.0	5.0	7.33	10.4
27-Jun-11	296281	0.54	0.71	<1	<1	20	0.22	14.7	15.0	7.5	7.37	10.6
4-Jul-11	297005	0.48	0.69	<1	<1	<10	0.16	15.7	7.5	2.5	7.39	10.5
12-Jul-11	297775	0.47	0.63	<1	<1	<10	0.18	17.3	6.0	NR[1]	7.36	10.1
18-Jul-11	298491	0.44	0.60	<1	<1	<10	0.89	19.5	10.0	2.5	7.46	10.4
25-Jul-11	299263	0.43	0.55	<1	<1	<10	0.29	18.6	5.0	2.5	7.46	10.3
2-Aug-11	299948	0.44	0.62	<1	<1	50	0.27	19.2	7.5	0.5	7.48	10.4
8-Aug-11	300525	0.21	0.36	<1	<1	<10	0.26	19.2	5.0	1.0	7.50	10.6
15-Aug-11	301273	0.28	0.50	<1	<1	<10	0.20	19.6	5.0	1.0	7.51	10.2
22-Aug-11	301924	0.31	0.47	<1	<1	<10	0.20	19.5	6.0	2.0	7.54	10.3
29-Aug-11	302608	0.26	0.48	<1	<1	<10	0.23	19.2	6.0	2.0	7.39	10.4
6-Sep-11	303446	0.48	0.63	<1	<1	<10	0.23	19.4	5.0	1.0	7.32	10.0
12-Sep-11	304091	0.58	0.81	<1	<1	<10	0.27	19.0	5.0	1.0	7.51	10.2
19-Sep-11	304763	0.76	0.98	<1	<1	<10	0.22	18.0	6.0	1.0	7.50	10.5
26-Sep-11	305525	0.71	1.00	<1	<1	<10	0.21	17.1	5.0	1.0	7.35	11.2

SE13_

Date Sampled	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E. Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (ºC)	Apparent Colour (acu)	True Colour (tcu)	pH (units)	Dissolved Oxygen (mg/L)
2-May-11	290388	0.50	0.77	<1	<1	<10	0.15	6.6	2.5	0.5	7.40	12.3
9-May-11	291107	0.53	0.80	<1	<1	<10	0.18	7.6	2.5	<0.5	7.36	11.5
16-May-11	291772	0.68	0.97	<1	<1	<10	0.18	8.5	1.5	0.5	7.39	12.7
24-May-11	292427	0.38	0.86	<1	<1	<10	0.24	7.6	5.5	0.5	7.48	11.8
30-May-11	293226	0.45	0.60	<1	<1	<10	0.19	8.2	13.0	1.0	7.81	11.5
6-Jun-11	294092	0.46	0.61	<1	<1	<10	0.31	9.2	13.0	5.0	7.73	11.4
14-Jun-11	294920	0.50	0.73	<1	<1	<10	0.25	11.2	13.0	6.0	7.33	10.7
20-Jun-11	295626	0.56	0.77	<1	<1	<10	0.17	12.7	10.0	2.5	7.37	10.5
27-Jun-11	296282	0.58	0.70	<1	<1	<10	0.16	16.5	16.0	7.5	7.40	10.7
4-Jul-11	297006	0.46	0.64	<1	<1	<10	0.14	16.2	7.5	2.0	7.33	10.5
12-Jul-11	297776	0.48	0.65	<1	<1	<10	0.22	19.4	5.0	NR[1]	7.40	10.1
18-Jul-11	298492	0.23	0.42	<1	<1	<10	0.39	19.1	5.0	0.5	7.36	10.2
25-Jul-11	299264	0.37	0.49	<1	<1	<10	0.22	19.3	5.0	2.5	7.43	10.4
2-Aug-11	299949	0.48	0.63	<1	<1	<10	0.19	20.2	5.0	1.0	7.46	10.2
8-Aug-11	300526	0.41	0.55	<1	<1	<10	0.20	20.8	5.0	1.0	7.66	9.4
15-Aug-11	301274	0.21	0.44	<1	<1	<10	0.20	21.0	5.0	1.0	7.51	10.1
22-Aug-11	301925	0.31	0.45	<1	<1	10	0.18	20.7	5.0	2.0	7.52	10.3
29-Aug-11	302609	0.38	0.61	1	<1	<10	0.18	18.8	6.0	2.0	7.47	10.1
1-Sep-11	303278*	0.51	0.70	<1	<1	<10	0.18	20.5	NA	NA	NA	NA
2-Sep-11	303578*	0.54	0.77	<1	<1	<10	0.16	20.3	NA	NA	NA	NA
6-Sep-11	303447	0.66	0.81	<1	<1	<10	0.19	20.4	5.0	1.0	7.31	9.9
12-Sep-11	304092	0.79	0.95	<1	<1	<10	0.23	19.7	5.0	1.0	7.47	10.1
19-Sep-11	304764	0.85	1.09	<1	<1	<10	0.23	18.1	5.0	1.0	7.42	10.0
26-Sep-11	305526	0.96	1.17	<1	<1	<10	0.21	16.6	5.0	1.0	7.33	11.1

*On September 1 and 2, the location was re-sampled due to a high total coliform of 1 MPNU/100mL on August 29. Apparent and true colour, pH and dissolved oxygen were not analysed for the re-sample.

WC12_

Date	Sample	Free (mg/L)	Total (mg/L)	Total (MPNU/ 100mL)	E. Coli (MPNU/ 100mL)	Heterotrophic (cfu/mL)	Turbidity (ntu)	Temperature (ºC)	Apparent Tr (acu)	ue (tcu)	pH (units)	Dissolved (mg/L)
2-May-11	290389	0.51	0.75	<1	<1	<10	0.21	5.9	2.5	0.5	7.40	12.2
9-May-11	291108	0.47	0.77	<1	<1	<10	0.25	7.3	1.5	<0.5	7.53	11.7
18-May-11	291773	0.49	0.78	<1	<1	<10	0.21	7.5	3.5	0.5	7.52	11.9
24-May-11	292428	0.67	0.85	<1	<1	<10	0.21	10.3	6.0	1.0	7.50	11.9
30-May-11	293227	0.46	0.77	<1	<1	<10	0.21	9.8	13.0	1.0	7.83	11.3
6-Jun-11	294093	0.39	0.56	<1	<1	10	0.22	10.7	13.0	6.0	7.76	11.3
14-Jun-11	294921	0.41	0.63	3	<1	<10	0.26	12.3	13.0	7.5	7.44	10.8
16-Jun-11	295415*	0.45	0.61	<1	<1	<10	0.24	11.2	NA	NA	NA	NA
20-Jun-11	295627	0.36	0.54	<1	<1	<10	0.19	12.8	10.0	2.5	7.37	10.4
27-Jun-11	296283	0.45	0.60	<1	<1	<10	0.15	14.6	16.0	7.5	7.42	10.2
4-Jul-11	297007	0.35	0.60	<1	<1	<10	0.28	15.6	10.0	0.5	7.44	10.0
12-Jul-11	297777	0.40	0.55	<1	<1	<10	0.36	17.4	5.0	NR[1]	7.39	9.9
18-Jul-11	298493	0.31	0.54	<1	<1	<10	0.45	19.0	7.5	0.5	7.41	10.0
25-Jul-11	299265	0.41	0.56	<1	<1	<10	0.29	18.6	7.5	2.5	7.50	9.9
2-Aug-11	299950	0.37	0.59	<1	<1	<10	0.33	19.5	7.5	2.5	7.48	9.9
8-Aug-11	300527	0.23	0.37	<1	<1	<10	0.32	20.0	7.5	1.0	7.50	10.1
15-Aug-11	301275	0.31	0.48	<1	<1	<10	0.39	19.6	7.5	2.0	7.54	10.4
22-Aug-11	301926	0.20	0.33	<1	<1	10	0.63	20.4	6.0	2.0	7.53	9.5
29-Aug-11	302610	0.23	0.34	<1	<1	10	0.35	19.6	7.5	2.0	7.45	8.9
6-Sep-11	303448	0.15	0.30	<1	<1	<10	0.22	19.4	6.0	1.0	7.37	10.1
12-Sep-11	304093	0.18	0.32	<1	<1	10	0.24	20.3	5.0	1.0	7.45	10.4
19-Sep-11	304765	0.28	0.48	<1	<1	10	0.27	19.2	6.0	1.0	7.48	9.6
26-Sep-11	305527	0.33	0.50	<1	<1	<10	0.23	19.2	5.0	1.0	7.42	10.8

*On June 16, the location was re-sampled due to a high total coliform of 3 MPNU/100mL on June 14. Apparent and true colour, pH and dissolved oxygen were not analysed for the re-sample.

NA: Not analysed NR: No result TNTC: Too numerous to count

1 - On July 12 there were no results for true colour due to lab error.

2012 Water Main Cleaning Program

Laboratory Analysis Report Regional Monitoring

SE08_

Date Sampled	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E. Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (ºC)	True Colour (tcu)	pH (units)	Dissolved Oxygen (mg/L)
7-May-12	324570	0.67	0.90	<1	<1	20	0.25	9.9	1.0	7.43	NA[1]
14-May-12	325235	0.75	0.99	<1	<1	<10	0.30	11.6	1.0	7.47	NA[1]
23-May-12	325973	0.62	0.82	<1	<1	<10	0.21	12.4	1.0	7.46	11.2
31-May-12	326685	0.65	0.81	<1	<1	<10	0.36	12.9	1.5	7.56	10.9
5-Jun-12	327429	0.80	0.96	<1	<1	10	0.21	14.0	1.0	7.48	11.2
12-Jun-12	328203	0.63	0.83	<1	<1	<10	0.16	15.3	2.0	7.51	11.6
19-Jun-12	328910	0.71	0.86	<1	<1	<10	0.18	16.4	1.0	7.45	10.0
26-Jun-12	329637	0.75	0.89	<1	<1	<10	0.25	16.1	0.5	7.46	10.0
3-Jul-12	330429	0.65	0.79	<1	<1	<10	0.20	19.2	2.0	7.48	10.0
10-Jul-12	331110	0.74	0.96	<1	<1	<10	0.18	20.5	1.0	7.56	9.1
16-Jul-12	331840	0.61	0.83	<1	<1	<10	0.21	21.4	2.0	7.48	9.1
24-Jul-12	332627	0.64	0.80	<1	<1	10	0.19	21.4	1.0	7.45	9.2
31-Jul-12	333349	0.63	0.81	<1	<1	<10	0.29	21.2	1.0	7.52	9.4
8-Aug-12	333948	0.66	0.82	<1	<1	<10	0.23	21.4	1.5	7.47	NA[2]
14-Aug-12	334711	0.66	0.81	<1	<1	<10	0.24	20.8	0.5	7.52	9.9

SW04_

Date Sampled	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E. Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (ºC)	True Colour (tcu)	pH (units)	Dissolved Oxygen (mg/L)
7-May-12	324579	0.77	0.95	<1	<1	30	0.31	7.9	1.5	7.45	NA[1]
14-May-12	325244	0.86	1.03	<1	<1	<10	0.14	9.2	1.0	7.29	NA[1]
22-May-12	325982	0.62	0.79	<1	<1	<10	0.17	10.3	1.0	7.41	11.3
31-May-12	326694	0.78	0.99	<1	<1	<10	0.15	11.4	2.0	7.52	11.1
5-Jun-12	327438	0.81	0.97	<1	<1	10	0.36	11.5	1.0	7.48	11.3
12-Jun-12	328212	0.74	0.93	<1	<1	<10	0.15	12.9	2.5	7.46	11.6
19-Jun-12	328919	0.79	0.94	<1	<1	<10	0.15	13.8	1.0	7.42	10.1
26-Jun-12	329646	0.78	0.94	<1	<1	<10	0.14	15.1	0.5	7.43	10.0
3-Jul-12	330422	0.74	0.95	<1	<1	<10	0.19	16.4	2.0	7.41	10.3
10-Jul-12	331103	0.83	1.02	<1	<1	<10	0.17	19.0	1.0	7.46	9.5
16-Jul-12	331833	0.74	0.89	<1	<1	<10	0.13	17.6	2.0	7.43	9.3
24-Jul-12	332620	0.76	0.90	<1	<1	<10	0.20	19.0	2.0	7.39	9.4
31-Jul-12	333342	0.76	0.90	<1	<1	10	0.19	19.1	1.0	7.45	9.5
8-Aug-12	333957	0.78	0.94	<1	<1	<10	0.32	18.9	1.0	7.45	9.3
14-Aug-12	334720	0.71	0.92	<1	<1	<10	0.19	19.8	1.0	7.47	10.2

SW06_

Date Sampled	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E. Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (ºC)	True Colour (tcu)	pH (units)	Dissolved Oxygen (mg/L)
1-May-12	323961	0.83	1.06	<1	<1	<10	0.16	8.3	1.0	7.47	NA[1]
8-May-12	324581	0.84	1.14	<1	<1	<10	0.19	10.1	1.0	7.47	NA[1]
15-May-12	325246	0.95	1.13	<1	<1	<10	0.15	12.6	1.0	7.56	11.9
22-May-12	325984	0.83	1.04	<1	<1	<10	0.14	14.2	1.0	7.41	11.2
28-May-12	326696	0.83	1.04	<1	<1	<10	0.15	14.7	2.0	7.52	11.0
4-Jun-12	327440	0.90	1.10	<1	<1	<10	0.16	14.8	1.0	7.40	11.5
12-Jun-12	328214	0.90	1.07	<1	<1	<10	0.14	17.5	2.0	7.48	10.6
18-Jun-12	328921	0.98	1.14	<1	<1	<10	0.15	18.2	1.0	7.42	10.3
26-Jun-12	329648	0.89	1.08	<1	<1	<10	0.15	18.7	1.0	7.45	10.2
3-Jul-12	330423	0.87	1.06	<1	<1	<10	0.16	21.5	2.0	7.44	10.2
9-Jul-12	331104	0.86	1.06	<1	<1	<10	0.17	22.7	1.0	7.46	9.5
16-Jul-12	331834	0.96	1.13	<1	<1	<10	0.20	23.9	2.0	7.39	9.5
24-Jul-12	332621	0.92	1.16	<1	<1	60	0.18	23.6	1.0	7.39	9.1
31-Jul-12	333343	0.99	1.20	<1	<1	<10	0.21	23.6	1.0	7.49	9.7
7-Aug-12	333959	0.80	0.99	<1	<1	<10	0.18	23.0	1.0	7.47	10.7
14-Aug-12	334722	0.96	1.11	<1	<1	<10	0.20	22.2	0.5	7.45	10.2

SW07_

Date Sampled	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E. Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (ºC)	True Colour (tcu)	pH (units)	Dissolved Oxygen (mg/L)
7-May-12	324582	0.79	0.97	<1	<1	<10	0.19	10.3	1.0	7.33	NA[1]
14-May-12	325247	1.05	1.23	<1	<1	<10	0.22	11.7	1.0	7.46	NA[1]
22-May-12	325985	0.67	0.85	<1	<1	<10	0.14	10.2	1.0	7.41	11.3
31-May-12	326697	0.81	0.99	<1	<1	<10	0.18	11.6	1.5	7.56	11.1
5-Jun-12	327441	0.83	1.00	<1	<1	20	0.17	13.0	1.0	7.49	11.3
12-Jun-12	328215	0.72	0.91	<1	<1	<10	0.14	14.4	2.0	7.46	11.6
19-Jun-12	328922	0.73	0.89	<1	<1	<10	0.43	13.8	1.5	7.41	10.1
26-Jun-12	329649	0.87	1.05	<1	<1	10	0.24	15.5	1.0	7.52	9.9
3-Jul-12	330424	0.77	0.92	<1	<1	<10	0.25	16.8	2.0	7.43	10.0
10-Jul-12	331105	0.97	1.11	<1	<1	<10	0.19	19.4	1.0	7.49	9.4
16-Jul-12	331835	0.74	0.97	<1	<1	<10	0.21	19.0	2.0	7.43	9.4
24-Jul-12	332622	0.78	0.98	<1	<1	<10	0.15	21.1	2.0	7.38	9.4
31-Jul-12	333344	0.79	0.93	<1	<1	<10	0.24	19.5	1.0	7.44	9.4
8-Aug-12	333960	0.80	0.95	<1	<1	<10	0.21	18.8	1.5	7.44	9.4
14-Aug-12	334723	0.76	0.92	<1	<1	<10	0.23	19.9	1.5	7.46	10.0

SW08_

Date Sampled	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E. Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (ºC)	True Colour (tcu)	pH (units)	Dissolved Oxygen (mg/L)
7-May-12	324583	0.50	0.66	<1	<1	<10	0.19	9.0	1.0	7.42	NA[1]
14-May-12	325248	0.83	0.99	<1	<1	<10	0.24	9.6	1.0	7.54	NA[1]
22-May-12	325986	0.64	0.83	<1	<1	<10	0.14	10.2	1.0	7.33	11.2
28-May-12	326698	0.52	0.69	<1	<1	<10	0.15	10.5	2.0	7.61	11.3
5-Jun-12	327442	0.64	0.79	<1	<1	20	0.14	10.7	1.0	7.54	11.4
11-Jun-12	328216	0.56	0.76	<1	<1	<10	0.13	12.1	1.0	7.50	10.7
19-Jun-12	328923	0.59	0.78	<1	<1	<10	0.18	12.4	1.0	7.42	10.1
26-Jun-12	329650	0.72	0.87	<1	<1	<10	0.13	13.2	1.0	7.44	10.1
3-Jul-12	330425	0.78	0.96	<1	<1	<10	0.35	15.0	2.0	7.48	10.1
9-Jul-12	331106	0.79	1.00	<1	<1	<10	0.31	15.9	1.0	7.48	9.6
16-Jul-12	331836	0.64	0.83	<1	<1	<10	0.34	16.8	2.0	7.43	9.3
24-Jul-12	332623	0.62	0.79	<1	<1	10	0.27	21.1	1.0	7.43	9.4
31-Jul-12	333345	0.54	0.74	<1	<1	<10	3.84	18.5	1.0	7.51	9.3
01-Aug-12*	333850	NA	NA	NA	NA	NA	0.31	NA	NA	NA	NA
8-Aug-12	333961	0.61	0.82	<1	<1	<10	0.25	19.1	1.5	7.47	NA[2]
13-Aug-12	334724	0.47	0.62	<1	<1	<10	0.28	18.0	0.5	7.52	10.3

*On August 1, the location was re-sampled due to a high turbidity of 3.84 NTU on July 31. Other parameters were not analysed for the re-sample.

SW14_

Date Sampled	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E. Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (ºC)	True Colour (tcu)	pH (units)	Dissolved Oxygen (mg/L)
7-May-12	324588	0.77	0.92	<1	<1	<10	0.24	7.9	1.0	7.40	NA[1]
14-May-12	325253	0.84	1.01	<1	<1	<10	0.14	9.3	1.0	7.49	NA[1]
22-May-12	325991	0.59	0.77	<1	<1	<10	0.15	10.3	1.0	7.51	11.2
31-May-12	326703	0.55	0.71	<1	<1	<10	0.52	12.5	2.0	7.56	10.9
5-Jun-12	327447	0.68	0.85	<1	<1	<10	0.24	12.9	1.0	7.46	11.0
12-Jun-12	328221	0.51	0.67	<1	<1	<10	0.33	14.3	2.0	7.49	11.3
19-Jun-12	328928	0.53	0.72	<1	<1	<10	0.32	14.5	1.0	7.46	9.9
26-Jun-12	329655	0.58	0.79	<1	<1	<10	0.36	16.1	1.0	7.44	9.8
3-Jul-12	330427	0.54	0.72	<1	<1	<10	0.36	17.7	2.0	7.49	9.9
10-Jul-12	331108	0.54	0.68	<1	<1	<10	0.41	18.1	1.0	7.52	9.2
16-Jul-12	331838	0.54	0.71	<1	<1	10	0.31	19.0	2.0	7.44	9.0
24-Jul-12	332625	0.59	0.76	<1	<1	10	0.34	21.3	1.0	7.33	9.2
31-Jul-12	333347	0.55	0.73	<1	<1	<10	0.22	20.2	1.0	7.42	9.2
8-Aug-12	333966	0.46	0.58	<1	<1	<10	0.22	20.6	1.5	7.37	9.3
14-Aug-12	334729	0.54	0.70	<1	<1	<10	0.32	20.2	0.5	7.45	9.7

NA: Not analysed NR: No result

[1]Dissolved oxygen was not analysed prior to May 14, 2012.

[2]Dissolved oxygen was not analysed due to instrument error/malfunction.

2013 Water Main Cleaning Program

Laboratory Analysis Report Regional Monitoring

SW01_

Date Sampled	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform E (MPNU/ 100mL)	. Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (ºC)	True Colour (tcu)	pH (units)	Dissolved Oxygen (mg/L)
8-Apr-13	356114	0 62	0 83	1	<1	<10	0.17	6 8	2 5	7 85	13.1
9-Apr-13	356637	0 87	1 05	<1	<1	<10	0 30	4 8	NA	NA	NA
16-Apr-13	356844	0 80	0 99	<1	<1	<10	0 30	4 0	4 0	7 52	13 0
23-Apr-13	357516	0 84	0 98	<1	<1	<10	0.15	6.1	2 0	7.49	13 0
29-Apr-13	358143	0 90	1 08	<1	<1	<10	0.19	7.1	1 0	7.46	13.1
6-May-13	358865	0 85	1 00	<1	<1	<10	0 20	7 0	2 0	7 50	12 8
14-May-13	359618	0 84	0 96	<1	<1	<10	0.18	6.7	2 0	7 50	12 3
21-May-13	360371	0 52	0 69	<1	<1	<10	0 27	7 3	2 0	7 50	10 9
27-May-13	361189	0 87	1 08	<1	<1	<10	0 20	8 3	2 0	7 55	11 5
3-Jun-13	362015	0 85	0 99	<1	<1	<10	0 25	10.9	1 0	7 62	10.1
10-Jun-13	362831	0 80	0 97	<1	<1	NR*	0 22	9 6	1 0	7 56	9.4
17-Jun-13	363613	0 68	0 84	<1	<1	<10	0 32	11.3	1 0	7 56	9.4
24-Jun-13	364384	0.70	0 88	<1	<1	<10	0 23	12.4	2 0	7 62	8.9
2-Jul-13	365116	0.78	0 93	<1	<1	<10	0 22	13.9	1 0	7 53	9.2
8-Jul-13	365853	0.72	0 96	<1	<1	<10	0 33	15.3	1 0	7 65	9.4
15-Jul-13	366540	0 68	0 83	<1	<1	<10	0 27	15.8	1 0	7 56	9.2
22-Jul-13	367420	0 67	0.79	<1	<1	<10	0.12	16.1	2 5	7 62	9.6
29-Jul-13	368098	0 63	0.78	<1	<1	<10	0 25	16.3	1 0	7 53	9.4
6-Aug-13	368778	0 65	0 82	<1	<1	<10	0.13	18.1	1 0	7 60	9.7
12-Aug-13	369489	0 67	0 88	<1	<1	<10	0 20	16.6	2 5	7 56	NR**
19-Aug-13	370161	0.79	0 92	<1	<1	<10	0 37	16.1	1 0	7 53	9.6

On April 9, 2013 the location was resampled due to a positive total coliform. The resample results were negative.

SW03_

Date Sampled	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform E (MPNU/ 100mL)	. Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (ºC)	True Colour (tcu)	pH (units)	Dissolved Oxygen (mg/L)
8-Apr-13	356115	0 23	0 39	<1	<1	<10	0 26	5.7	2 5	7 99	12 6
16-Apr-13	356845	0 52	0 66	<1	<1	10	0.17	5.7	5 0	7 54	12 5
23-Apr-13	357517	0.48	0 63	<1	<1	<10	0 21	4.7	2 5	7 60	12 9
29-Apr-13	358144	0 39	0 60	<1	<1	<10	0 21	5.7	1 0	7 51	12 3
6-May-13	358866	0 66	0 86	<1	<1	<10	0 31	6 3	1 5	7 50	12.4
14-May-13	359619	0 56	0.71	<1	<1	<10	0 33	6 0	2 5	7 53	12 2
21-May-13	360372	0.43	0 56	<1	<1	<10	0.19	5 2	2 0	7.49	11.1
27-May-13	361190	0.49	0 67	<1	<1	<10	0.18	11.9	2 0	7 57	10 9
3-Jun-13	362016	0 59	0.76	<1	<1	<10	0.19	7 6	1 0	7 55	10 9
10-Jun-13	362832	0.73	0 89	<1	<1	NR*	0 26	10.1	1 0	7 58	9.6
17-Jun-13	363614	0.70	0 85	<1	<1	40	0 21	9 3	1 0	7.48	9.5
24-Jun-13	364385	0.70	0 89	<1	<1	<10	0 25	8.4	2 0	7 58	9.3
2-Jul-13	365117	0.78	0 95	<1	<1	<10	0 21	9 0	1 0	7 53	8.2
8-Jul-13	365854	0 80	0 99	<1	<1	<10	0 32	9 5	1 0	7 61	10 3
15-Jul-13	366541	0.70	0 84	<1	<1	<10	0 33	9 5	1 0	7 61	9.7
22-Jul-13	367421	0 60	0.71	<1	<1	NR	0.17	8.7	2 5	7 67	9.6
29-Jul-13	368099	0 67	0 80	<1	<1	<10	0.14	13.1	1 5	7 69	9.8
6-Aug-13	368779	0 61	0.74	<1	<1	<10	0.15	10.1	1 0	7 59	9.3
12-Aug-13	369490	0 64	0.74	<1	<1	<10	0.17	10.8	2 5	7 53	NR**
19-Aug-13	370162	0 54	0 80	<1	<1	20	0 20	10.8	1 0	7 54	10.1

On July 22, 2013 there were no results for HPC due to contract lab error.

SW17_

Date Sampled	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform E (MPNU/ 100mL)	. Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (ºC)	True Colour (tcu)	pH (units)	Dissolved Oxygen (mg/L)
8-Apr-13	356119	0 63	0 82	<1	<1	10	0 28	6 5	2 0	7 93	12.7
16-Apr-13	356849	0.77	1 02	<1	<1	<10	0 38	5.1	5 0	7 54	12 9
23-Apr-13	357521	0 91	1 06	<1	<1	<10	0 20	4 9	2 5	7 61	12 9
29-Apr-13	358148	1 01	1.15	<1	<1	<10	0.18	5 9	1 0	7.42	13 3
6-May-13	358870	0 68	0 88	<1	<1	<10	0.15	6 3	1 5	7.46	12 6
14-May-13	359623	0.77	0 90	<1	<1	10	0 20	6 9	2 5	7.47	11 9
21-May-13	360376	0 67	0 84	<1	<1	<10	0.19	6 0	2 0	7 54	11 2
27-May-13	361194	0 83	0 98	<1	<1	<10	0 20	8 9	2 0	7 53	11.7
3-Jun-13	362020	0.75	0 98	<1	<1	10	0.19	8.1	1 0	7 59	10.4
10-Jun-13	362836	0.77	0 95	<1	<1	NR*	0 21	9 6	1 0	7 53	9.6
17-Jun-13	363618	0 68	0 85	<1	<1	30	0 21	9.4	1 0	7 59	9.6
24-Jun-13	364389	0.79	0 99	<1	<1	<10	0 26	9.7	2 0	7 56	9.3
2-Jul-13	365121	0 81	0 93	<1	<1	<10	0 22	9 5	1 0	7 59	7.9
8-Jul-13	365858	0.79	1 01	<1	<1	<10	0 33	11.2	1 0	7 53	9.5
15-Jul-13	366545	0 60	0.74	<1	<1	<10	0 23	12.4	1 0	7.47	9.3
22-Jul-13	367425	0.75	0 92	<1	<1	<10	0.17	12.2	2 0	7 61	9.5
29-Jul-13	368103	0 57	0.74	<1	<1	10	0.14	11.1	1 5	7 64	9.2
6-Aug-13	368783	0.72	0 88	<1	<1	<10	0.12	12.2	1 0	7 56	9.7
12-Aug-13	369494	0 53	0 69	<1	<1	<10	0.14	12.6	2 5	7 53	NR**
19-Aug-13	370166	0 26	0 39	<1	<1	<10	0 23	11.3	1 0	7.45	9.7

WC04_

Date Sampled	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform E (MPNU/ 100mL)	. Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (ºC)	True Colour (tcu)	pH (units)	Dissolved Oxygen (mg/L)
8-Apr-13	356120	0 81	0 99	<1	<1	<10	0 22	5.7	2 0	7 89	13 0
16-Apr-13	356850	0 84	0 98	<1	<1	<10	0.17	4 0	3 0	7 51	12 8
23-Apr-13	357522	0 91	1 04	<1	<1	<10	0 32	4.7	2 5	7.45	13 0
29-Apr-13	358149	0 83	1 00	<1	<1	<10	0 20	6.1	1 5	7.47	12 9
6-May-13	358871	0 91	1 04	<1	<1	<10	0 33	6 5	1 5	7 58	12 6
14-May-13	359624	0 85	1 08	<1	<1	<10	0.19	8.7	2 5	7 53	11.7
21-May-13	360377	0 90	1 07	<1	<1	<10	0.16	7 5	2 0	7 57	10 9
27-May-13	361195	0 82	1 00	<1	<1	<10	0 27	9 0	2 0	7 62	11.4
3-Jun-13	362021	0.70	0 85	<1	<1	<10	0 20	10.8	1 0	7 66	10 3
10-Jun-13	362837	0.72	0 95	<1	<1	NR*	0.19	8 8	1 0	7 62	9.0
17-Jun-13	363619	0.79	0 97	<1	<1	50	0 36	12.4	1 0	7 62	9.9
24-Jun-13	364390	0 80	1 00	<1	<1	<10	0 25	13.5	2 0	7 56	8.7
2-Jul-13	365122	0.79	0 94	<1	<1	<10	0 20	15.0	1 0	7 56	9.0
8-Jul-13	365859	0.71	0 90	<1	<1	<10	0 22	16.5	1 0	7 65	9.2
15-Jul-13	366546	0.72	0 85	<1	<1	<10	0 28	17.0	1 0	7 66	9.4
22-Jul-13	367426	0.72	0 82	<1	<1	<10	0.15	17.9	2 5	7 66	9.3
29-Jul-13	368104	0.70	0 80	<1	<1	<10	0.14	18.5	1 0	7.78	9.1
6-Aug-13	368784	0 66	0 80	<1	<1	<10	0.14	18.2	1 0	7 68	9.4
12-Aug-13	369495	0.75	0 89	<1	<1	<10	0.16	17.4	2 5	7 63	9.3
19-Aug-13	370167	0.70	0 88	<1	<1	<10	0 24	18.0	1 0	7 67	9.7

WC05_

Date Sampled	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform E (MPNU/ 100mL)	. Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (ºC)	True Colour (tcu)	pH (units)	Dissolved Oxygen (mg/L)
8-Apr-13	356116	0 66	0 89	<1	<1	<10	0.14	9 2	2 5	7 84	13.1
16-Apr-13	356846	0.78	0 96	<1	<1	<10	0.15	5 6	6 0	7 56	13.1
23-Apr-13	357518	0.70	0 95	<1	<1	<10	0.19	6 3	2 0	7.45	13 2
29-Apr-13	358145	0 90	1 07	<1	<1	<10	0 22	5 2	1 0	7 51	13 3
6-May-13	358867	0 81	0 95	<1	<1	<10	0 26	6 2	1 5	7 52	12.7
14-May-13	359620	0 59	0 82	<1	<1	<10	0 61	8 3	2 0	7 53	12 0
21-May-13	360373	0 63	0 80	<1	<1	<10	0.18	8.7	2 0	7.40	10 9
27-May-13	361191	0 64	0.78	<1	<1	<10	0 22	9 5	2 0	7 56	11.4
3-Jun-13	362017	0 60	0 80	<1	<1	<10	0 25	8 8	1 0	7 67	10 2
10-Jun-13	362833	0 62	0 80	<1	<1	NR*	0 21	8 9	1 0	7 62	9.7
17-Jun-13	363615	0 65	0 81	<1	<1	<10	0 25	10.1	1 0	7 60	9.5
24-Jun-13	364386	0 56	0.72	<1	<1	<10	0 28	15.4	2 0	7 54	8.9
2-Jul-13	365118	0 56	0 68	<1	<1	<10	0 22	17.1	1 0	7 59	8.9
8-Jul-13	365855	0 94	1 05	<1	<1	<10	1 84	13.6	1 0	7 58	9.4
9-Jul-13	366330	NA	NA	NA	NA	NA	0 25	NA	NA	NA	NA
15-Jul-13	366542	0.47	0 66	<1	<1	30	0 26	12.8	1 0	7 67	9.3
22-Jul-13	367422	0 60	0.72	<1	<1	<10	0.17	14.5	2 5	7 69	9.5
29-Jul-13	368100	0.49	0 59	<1	<1	<10	0 36	14.2	1 0	7.78	9.3
6-Aug-13	368780	0 39	0.49	<1	<1	<10	0 32	14.4	1 0	7 65	9.3
12-Aug-13	369491	0 50	0.71	<1	<1	<10	0.19	17.9	2 0	7 63	NR**
19-Aug-13	370163	0.41	0 57	<1	<1	<10	0 30	16.0	1 0	7 68	9.4

On July 9, 2013 the location was resampled due to a high turbidity result. The resample result was 0.25 ntu.

WC06_

Date Sampled	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform E (MPNU/ 100mL)	. Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (ºC)	True Colour (tcu)	pH (units)	Dissolved Oxygen (mg/L)
8-Apr-13	356117	0 62	0 83	<1	<1	10	0 32	4 0	2 0	7 91	13 0
15-Apr-13	356847	0 86	1 03	<1	<1	<10	0 24	5 0	4 0	7.41	11.7
22-Apr-13	357519	0.71	0 92	<1	<1	10	0 22	4.4	2 5	7.45	10 9
29-Apr-13	358146	1 03	1 24	<1	<1	<10	0.47	4 2	1 0	7 54	11 6
6-May-13	358868	0 90	1.13	<1	<1	<10	0 67	4 9	2 5	7.48	11.1
13-May-13	359621	0.78	0 96	<1	<1	<10	0 34	5 5	2 0	7 53	11 6
21-May-13	360374	0 69	0 88	<1	<1	<10	0 25	6 9	2 0	7 52	10 3
27-May-13	361192	0 93	1 09	<1	<1	<10	0 32	7 9	2 0	7 56	11.7
3-Jun-13	362018	0 90	1 05	<1	<1	10	0 30	12.1	1 0	7 60	9.6
10-Jun-13	362834	0 94	1.10	<1	<1	NR*	0 29	12.5	1 0	7 51	9.5
17-Jun-13	363616	0.79	0 98	<1	<1	20	0 24	13.8	1 0	7 54	8.9
24-Jun-13	364387	0.76	0 96	<1	<1	<10	0 27	15.6	2 0	7.46	9.1
2-Jul-13	365119	0 90	1 05	<1	<1	<10	0 35	17.1	1 0	7.48	8.9
8-Jul-13	365856	0.71	0 88	<1	<1	<10	0 23	18.1	1 0	7 54	8.9
15-Jul-13	366543	0.70	0 83	<1	<1	<10	0 26	19.1	1 0	7 53	9.2
22-Jul-13	367423	0.75	0 90	<1	<1	NR	0 24	19.7	2 5	7 64	8.5
29-Jul-13	368101	0.77	0 90	<1	<1	<10	0.45	19.0	2 0	7 66	9.2
6-Aug-13	368781	0 61	0.76	<1	<1	<10	0 25	18.2	1 0	7 62	9.1
12-Aug-13	369492	0 81	0 90	<1	<1	<10	0.47	18.5	2 0	7 50	10 3
19-Aug-13	370164	0 68	0 90	<1	<1	<10	0 26	18.7	1 0	7 52	9.8

On July 22, 2013 there were no results for HPC due to contract lab error.

WC08_

Date Sampled	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform E (MPNU/ 100mL)	. Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (ºC)	True Colour (tcu)	pH (units)	Dissolved Oxygen (mg/L)
8-Apr-13	356118	0 62	0.75	<1	<1	<10	0 37	6.1	2 0	7 85	12.7
16-Apr-13	356848	0.72	0 90	<1	<1	<10	0 23	6 6	5 0	7 55	13.1
23-Apr-13	357520	0 62	0.79	<1	<1	<10	0 23	12.8	2 5	7.46	12 8
29-Apr-13	358147	0 86	1 07	<1	<1	<10	0.40	8.1	1 5	7.43	13 2
6-May-13	358869	0 69	0 83	<1	<1	<10	0 23	11.2	1 0	7.41	12 8
14-May-13	359622	0 64	0 80	<1	<1	<10	0 25	8 3	2 0	7 55	12 2
21-May-13	360375	0 65	0 83	<1	<1	<10	0 24	8 6	2 0	7 36	11 0
27-May-13	361193	0 56	0.73	<1	<1	<10	0 28	12.3	2 0	7.49	11.7
3-Jun-13	362019	0.72	0 90	<1	<1	<10	0 28	9 0	1 0	7 68	10 2
10-Jun-13	362835	0.77	0 96	<1	<1	NR*	0 24	7.7	1 0	7 56	10.1
17-Jun-13	363617	0.76	0 88	<1	<1	20	0 33	10.3	1 0	7.46	9.5
24-Jun-13	364388	0 84	1 07	<1	<1	<10	0.71	10.4	2 0	7.49	8.7
2-Jul-13	365120	0 66	0 81	<1	<1	<10	0.17	13.7	1 0	7 50	8.8
8-Jul-13	365857	0 55	0 67	<1	<1	<10	0 26	12.1	1 0	7 54	9.4
15-Jul-13	366544	0 51	0 66	<1	<1	<10	0.46	15.0	1 0	7 57	9.5
22-Jul-13	367424	0 53	0 62	<1	<1	<10	0.16	15.7	2 5	7 54	9.5
29-Jul-13	368102	0 53	0 66	<1	<1	<10	0 35	15.4	1 0	7 54	9.2
6-Aug-13	368782	0 52	0 66	<1	<1	<10	0.16	18.6	1 0	7 57	9.3
12-Aug-13	369493	0 57	0.72	<1	<1	<10	0.18	15.2	2 5	7 52	NR**
19-Aug-13	370165	0 64	0 84	<1	<1	<10	0 30	16.3	1 5	7.41	9.6

WC10_

Date Sampled	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform E (MPNU/ 100mL)	. Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (ºC)	True Colour (tcu)	pH (units)	Dissolved Oxygen (mg/L)
8-Apr-13	356113	0 55	0 69	<1	<1	10	0 50	7 2	2 0	7 91	12.1
16-Apr-13	356843	0 57	0.78	<1	<1	<10	0 32	6 6	3 0	7 60	12 8
23-Apr-13	357515	0.75	0 95	<1	<1	<10	0 31	7.1	2 5	7 56	12 3
29-Apr-13	358142	0 64	0 85	<1	<1	<10	0 20	7 8	1 5	7 53	12 6
6-May-13	358864	0.73	0 90	<1	<1	<10	0.40	6 5	1 0	7 56	12 6
14-May-13	359617	0.73	0 87	<1	<1	10	0 35	7 9	2 0	7 65	11 6
21-May-13	360370	0 59	0.79	<1	<1	<10	0 80	7 5	2 0	7 69	10 9
27-May-13	361188	0 60	0.78	<1	<1	<10	0.78	8 5	2 0	7 54	11 3
3-Jun-13	362014	0 62	0.75	<1	<1	<10	1 21	9.1	1 0	7.73	9.9
10-Jun-13	362830	0 60	0.75	<1	<1	NR*	0 54	9 6	1 0	7 63	9.5
17-Jun-13	363612	0 91	1.19	<1	<1	<10	2 02	13.4	1 0	7 57	9.5
18-Jun-13	363678	0 65	0 81	<1	<1	NR	0 89	10.6	0 5	7.70	9.5
19-Jun-13	363679	0.77	0 91	<1	<1	<10	1 36	11.5	0 5	7 64	9.4
20-Jun-13	363680	0.79	0 98	<1	<1	<10	2 01	12.6	1 0	7 57	9.2
21-Jun-13	363681	0 61	0.79	<1	<1	<10	0 60	12.2	1 0	7 62	9.4
24-Jun-13	364383	0 59	0.77	<1	<1	<10	0 60	9 9	2 0	7 58	8.4
2-Jul-13	365115	0 55	0.70	<1	<1	<10	0 33	14.7	1 0	7 58	8.0
8-Jul-13	365852	0 60	0.76	<1	<1	<10	0 38	16.5	1 0	7 66	9.3
15-Jul-13	366539	0 50	0 64	<1	<1	10	0 96	16.4	1 0	7 61	9.1
22-Jul-13	367419	0 57	0 69	<1	<1	<10	0 95	17.4	2 5	7.74	9.1
29-Jul-13	368097	0 61	0.75	<1	<1	<10	0 52	17.3	1 0	7.76	9.3
6-Aug-13	368777	0 55	0 68	<1	<1	<10	0 58	17.4	1 0	7 69	9.2
12-Aug-13	369488	0 59	0.76	<1	<1	<10	0.70	17.5	2 0	7 61	9.4
19-Aug-13	370160	0 55	0 69	<1	<1	<10	0 63	17.8	1 0	7.71	9.6

On June 18, 2013 there were no results for HPC due to contract lab error.

WC11_

Date Sampled	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E. Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (ºC)	True Colour (tcu)	pH (units)	Dissolved Oxygen (mg/L)
8-Apr-13	356121	0 54	0.75	<1	<1	<10	0 67	12.6	2 0	7 94	12 9
16-Apr-13	356851	0.77	0 93	<1	<1	<10	0 20	6 0	6 0	7 55	12 9
23-Apr-13	357523	0 63	0 81	<1	<1	<10	0 29	4.7	2 5	7.49	13.1
29-Apr-13	358150	0 69	0 82	<1	<1	<10	0.48	4.7	1 0	7.43	12.7
6-May-13	358872	0 62	0 85	<1	<1	<10	0 36	5.4	1 0	7.48	13 0
14-May-13	359625	0 85	0 99	<1	<1	<10	0 35	5.7	2 5	7 59	11 8
21-May-13	360378	0 55	0 69	<1	<1	<10	0 37	7 3	2 0	7.45	10 6
27-May-13	361196	0.46	0 63	<1	<1	10	0 27	7 2	2 0	7 54	11.1
3-Jun-13	362022	0 68	0 82	<1	<1	<10	0 31	7 5	1 0	7 52	9.6
10-Jun-13	362838	0 59	0.77	<1	<1	NR*	0.46	9.1	1 0	7 52	9.0
17-Jun-13	363620	0 62	0.76	<1	<1	30	0 20	8 5	1 0	7.48	9.8
24-Jun-13	364391	0 60	0.72	<1	<1	<10	0 31	11.1	2 0	7.45	8.7
2-Jul-13	365123	0.71	0 91	21	<1	<10	0 29	14.7	1 0	7.49	8.7
5-Jul-13	365759	0 37	0 52	<1	<1	<10	0 30	15.2	NA	NA	NA
5-Jul-13	365760	0 52	0.70	<1	<1	<10	0 28	16.7	NA	NA	NA
5-Jul-13	365761	0 84	1 05	<1	<1	<10	0 31	20.0	NA	NA	NA
8-Jul-13	365860	0 52	0.71	<1	<1	<10	0 34	16.0	1 0	7 56	8.9
15-Jul-13	366547	0.44	0 61	<1	<1	<10	0.45	16.7	1 0	7 51	8.7
22-Jul-13	367427	0 37	0 55	<1	<1	<10	0 25	17.7	2 5	7 53	8.7
29-Jul-13	368105	0 69	0.79	<1	<1	<10	0 33	17.8	1 0	7 62	9.5
6-Aug-13	368785	0 55	0 67	<1	<1	<10	0 22	17.9	1 0	7 51	9.0
12-Aug-13	369496	0 39	0 58	<1	<1	<10	0 23	17.9	2 0	7 51	9.2
19-Aug-13	370168	0 60	0.75	<1	<1	<10	0 55	18.1	1 0	7 54	9.4

On July 5, 2013 the location was resampled, as well as upstream and downstream, due to a positive total coliform. The resample results were all negative.

NOTE: *On June 10, 2013 there were no results for HPC at all the locations due to contract lab error.
**On August 12, 2013 there were no results for dissolved oxygen, for some locations, due to an instrument malfunction.

2014 Water Main Cleaning Program

Laboratory Analysis Report Regional Monitoring

NE01_

Date Sampled	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E. Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (ºC)	True Colour (tcu)	pH (units)	Dissolved Oxygen (mg/L)
16-Jun-14	399427	0.77	0.98	<1	<1	<10	0.11	9.7	0.5	7.57	10.5
23-Jun-14	400090	0.84	1.08	<1	<1	NR	0.12	8.7	1.0	7.57	10.6
30-Jun-14	400834	0.87	1.09	<1	<1	<10	0.18	11.0	1.0	7.59	10.4
7-Jul-14	401504	0.82	1.00	<1	<1	<10	0.18	9.6	1.0	7.64	10.6
14-Jul-14	402290	0.66	0.83	<1	<1	<10	0.20	11.9	0.5	7.79	10.1
21-Jul-14	403078	0.75	1.02	<1	<1	10	0.10	15.2	1.5	7.74	9.9
28-Jul-14	403820	0.86	0.99	<1	<1	<10	0.16	14.3	2.0	7.61	9.8
5-Aug-14	404741	0.96	1.16	<1	<1	<10	0.23	18.5	2.5	7.54	8.9
11-Aug-14	405554	0.83	0.90	<1	<1	<10	0.21	14.3	1.5	7.67	9.7
18-Aug-14	406425	0.76	0.94	<1	<1	<10	0.15	18.6	0.5	7.46	9.4
25-Aug-14	407222	0.68	0.85	<1	<1	<10	0.15	17.5	1.0	7.64	9.1
2-Sep-14	407959	0.86	1.00	<1	<1	<10	0.14	18.0	1.0	7.58	9.2
8-Sep-14	408639	0.83	1.05	<1	<1	<10	0.17	16.6	0.5	7.68	9.8
15-Sep-14	409348	0.91	1.13	<1	<1	<10	0.16	16.3	0.5	7.63	10.3
22-Sep-14	410085	0.77	0.95	<1	<1	<10	0.20	14.7	1.0	7.72	10.4
29-Sep-14	410790	0.75	0.92	<1	<1	<10	0.21	15.0	4.0	7.79	9.9
6-Oct-14	411637	0.85	1.10	<1	<1	<10	0.21	14.3	0.5	7.69	8.8
14-Oct-14	412207	0.89	1.05	<1	<1	<10	0.14	12.9	1.0	7.66	9.9
20-Oct-14	412999	0.90	1.11	<1	<1	<10	0.21	12.5	1.0	7.54	10.9
27-Oct-14	413678	0.90	1.09	<1	<1	10	0.12	12.6	0.5	7.72	9.3
3-Nov-14	414365	0.92	1.17	<1	<1	<10	0.17	12.1	0.5	7.78	11.2

On June 23rd, there was no result for HPC due to contract lab error.

2014 Water Main Cleaning Program

Laboratory Analysis Report Regional Monitoring

NW_FM1

Date Sampled	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E. Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (ºC)	True Colour (tcu)	pH (units)	Dissolved Oxygen (mg/L)
16-Jun-14	399436	0.94	1.17	<1	<1	<10	0.18	10.5	2.0	7.40	10.6
23-Jun-14	400099	0.84	1.05	<1	<1	<10	0.30	11.9	1.5	7.41	10.7
30-Jun-14	400843	0.88	1.06	<1	<1	<10	0.15	13.8	1.0	7.43	10.2
7-Jul-14	401513	1.05	1.26	<1	<1	<10	0.19	14.7	2.0	7.48	10.6
14-Jul-14	402299	0.85	1.08	<1	<1	<10	0.19	15.8	1.0	7.64	9.8
21-Jul-14	403087	0.95	1.17	<1	<1	<10	0.15	16.9	1.0	7.61	10.1
28-Jul-14	403829	0.75	0.95	<1	<1	<10	0.13	18.2	1.0	7.60	10.0
5-Aug-14	404750	0.78	0.93	<1	<1	<10	0.14	19.1	3.0	7.54	10.0
11-Aug-14	405563	0.74	0.94	<1	<1	<10	0.13	19.3	1.0	7.47	9.8
18-Aug-14	406434	0.83	1.03	<1	<1	<10	0.11	19.4	0.5	7.44	9.9
25-Aug-14	407231	0.71	0.90	<1	<1	<10	0.12	19.0	1.0	7.46	9.4
2-Sep-14	407968	0.69	0.95	<1	<1	<10	0.19	19.1	1.0	7.47	10.1
8-Sep-14	408648	0.65	0.90	<1	<1	<10	0.17	18.5	0.5	7.43	10.1
15-Sep-14	409357	0.74	0.90	<1	<1	<10	0.38	18.2	0.5	7.41	10.4
22-Sep-14	410094	0.62	0.80	<1	<1	<10	0.25	20.7	0.5	7.48	11.0
29-Sep-14	410799	0.57	0.77	<1	<1	<10	0.26	17.6	3.0	7.61	10.9
6-Oct-14	411646	0.70	0.84	<1	<1	<10	0.34	18.9	0.5	7.54	9.0
14-Oct-14	412216	0.83	1.03	<1	<1	<10	0.16	15.5	0.5	7.65	11.6
20-Oct-14	413008	0.74	0.91	<1	<1	<10	0.22	15.5	2.0	7.30	11.8
27-Oct-14	413687	0.67	0.88	<1	<1	20	0.17	18.5	1.0	7.67	9.5
3-Nov-14	414374	0.71	0.90	<1	<1	<10	0.23	16.3	1.0	7.61	11.5

2014 Water Main Cleaning Program

Laboratory Analysis Report Regional Monitoring

NW01_

Date Sampled	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E. Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (ºC)	True Colour (tcu)	pH (units)	Dissolved Oxygen (mg/L)
16-Jun-14	399435	0.98	1.12	<1	<1	<10	0.14	10.9	2.5	7.41	10.6
23-Jun-14	400098	1.13	1.30	<1	<1	<10	0.13	10.5	1.0	7.43	10.8
30-Jun-14	400842	0.88	1.12	<1	<1	10	0.14	12.6	2.0	7.47	10.4
7-Jul-14	401512	1.15	1.35	<1	<1	<10	0.15	13.6	2.5	7.54	10.6
14-Jul-14	402298	0.85	1.02	<1	<1	<10	0.14	13.8	0.5	7.60	10.0
21-Jul-14	403086	1.13	1.28	<1	<1	<10	0.16	15.0	2.0	7.59	10.1
28-Jul-14	403828	0.95	1.13	<1	<1	20	0.10	15.5	1.0	7.52	10.1
5-Aug-14	404749	0.86	1.04	<1	<1	10	0.15	17.6	2.5	7.55	9.7
11-Aug-14	405562	1.05	1.28	<1	<1	<10	0.15	17.3	1.0	7.45	9.7
18-Aug-14	406433	1.18	1.37	<1	<1	<10	0.17	17.9	0.5	7.59	9.6
25-Aug-14	407230	1.27	1.41	<1	<1	<10	0.15	18.5	1.0	7.57	9.0
2-Sep-14	407967	1.05	1.24	<1	<1	<10	0.13	17.8	2.5	7.44	9.5
8-Sep-14	408647	1.02	1.23	<1	<1	<10	0.17	17.3	0.5	7.44	9.8
15-Sep-14	409356	0.90	1.10	<1	<1	<10	0.20	16.8	0.5	7.44	10.3
22-Sep-14	410093	0.94	1.09	<1	<1	<10	0.24	15.7	1.0	7.54	10.5
29-Sep-14	410798	0.92	1.12	<1	<1	<10	0.22	15.6	1.0	7.59	10.5
6-Oct-14	411645	0.93	1.14	<1	<1	<10	0.21	15.3	0.5	7.55	10.1
14-Oct-14	412215	0.95	1.13	<1	<1	<10	0.57	14.3	1.5	7.51	11.0
20-Oct-14	413007	0.98	1.13	<1	<1	50	0.16	13.6	1.0	7.64	10.3
27-Oct-14	413686	0.84	1.06	<1	<1	20	0.15	12.4	0.5	7.69	9.4
3-Nov-14	414373	0.86	1.06	<1	<1	<10	0.18	12.5	0.5	7.70	11.7

2014 Water Main Cleaning Program

Laboratory Analysis Report Regional Monitoring

SE01_

Date Sampled	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E. Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (ºC)	True Colour (tcu)	pH (units)	Dissolved Oxygen (mg/L)
16-Jun-14	399424	1.12	1.32	<1	<1	<10	0.17	17.8	0.5	7.31	10.7
23-Jun-14	400087	1.16	1.35	<1	<1	<10	0.23	17.9	1.0	7.36	10.8
30-Jun-14	400831	1.37	1.58	<1	<1	<10	0.23	19.6	2.0	7.36	10.4
7-Jul-14	401501	1.19	1.39	<1	<1	<10	0.21	19.4	1.0	7.47	10.6
14-Jul-14	402287	1.11	1.36	<1	<1	<10	0.18	20.5	1.0	7.60	10.3
21-Jul-14	403075	1.11	1.31	<1	<1	<10	0.19	20.7	2.5	7.60	10.1
28-Jul-14	403817	1.16	1.33	<1	<1	<10	0.20	21.5	2.0	7.67	9.9
5-Aug-14	404738	1.16	1.31	<1	<1	<10	0.25	22.0	3.0	7.48	10.0
11-Aug-14	405551	1.18	1.37	<1	<1	<10	0.23	22.9	1.0	7.42	9.7
18-Aug-14	406422	1.16	1.34	<1	<1	<10	0.25	22.8	1.0	7.41	9.8
25-Aug-14	407219	1.12	1.28	<1	<1	<10	0.22	22.4	2.0	7.31	9.4
2-Sep-14	407956	1.05	1.25	<1	<1	<10	0.21	20.4	2.0	7.38	10.0
8-Sep-14	408636	0.98	1.21	<1	<1	<10	0.23	19.5	0.5	7.30	10.5
15-Sep-14	409345	1.13	1.31	<1	<1	<10	0.24	17.4	0.5	7.52	11.1
22-Sep-14	410082	1.13	1.36	NR	NR	NR	0.31	15.6	1.0	7.43	11.2
25-Sep-14	410677	1.10	1.37	<1	<1	<10	0.27	16.3	NA	NA	NA
29-Sep-14	410787	1.11	1.30	<1	<1	<10	0.23	17.2	3.0	7.62	11.0
6-Oct-14	411634	1.15	1.38	<1	<1	<10	0.19	13.6	1.0	7.43	9.6
14-Oct-14	412204	1.14	1.35	<1	<1	10	0.20	10.5	0.5	7.40	9.5
20-Oct-14	412996	1.19	1.35	<1	<1	<10	0.18	10.4	1.0	7.48	12.1
27-Oct-14	413675	1.12	1.32	<1	<1	<10	0.17	10.0	0.5	7.71	10.4
3-Nov-14	414362	1.29	1.51	<1	<1	<10	0.18	7.9	0.5	7.60	12.9

On September 22nd, there was no result for coliforms due to contract lab error. Resample was taken September 25th.

2014 Water Main Cleaning Program

Laboratory Analysis Report Regional Monitoring

SE02_

Date Sampled	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E. Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (ºC)	True Colour (tcu)	pH (units)	Dissolved Oxygen (mg/L)
16-Jun-14	399428	0.84	1.01	<1	<1	<10	0.34	11.1	2.0	7.32	10.7
23-Jun-14	400091	0.86	1.06	<1	<1	<10	0.20	11.9	2.0	7.44	10.8
30-Jun-14	400835	0.87	1.08	<1	<1	30	0.20	11.7	1.0	7.41	10.4
7-Jul-14	401505	0.85	1.00	<1	<1	<10	0.27	12.1	2.0	7.52	10.3
14-Jul-14	402291	0.80	0.99	<1	<1	<10	0.26	13.5	1.5	7.64	10.0
21-Jul-14	403079	0.84	1.01	<1	<1	<10	0.15	14.4	0.5	7.55	9.8
28-Jul-14	403821	0.79	0.95	<1	<1	<10	0.16	15.4	1.0	7.46	9.8
5-Aug-14	404742	0.85	1.03	<1	<1	<10	0.23	17.1	3.0	7.44	9.8
11-Aug-14	405555	0.83	1.04	<1	<1	<10	0.20	17.8	1.0	7.48	9.5
18-Aug-14	406426	0.75	0.92	<1	<1	<10	0.25	18.1	0.5	7.32	9.7
25-Aug-14	407223	0.76	0.94	<1	<1	<10	0.21	18.0	0.5	7.46	8.9
2-Sep-14	407960	0.75	0.91	<1	<1	<10	0.20	16.9	1.0	7.42	9.6
8-Sep-14	408640	0.75	0.94	<1	<1	<10	0.27	16.9	1.0	7.54	9.3
15-Sep-14	409349	0.72	0.87	<1	<1	<10	0.26	15.7	0.5	7.51	10.0
22-Sep-14	410086	0.84	1.01	<1	<1	<10	0.31	16.2	1.0	7.62	9.8
29-Sep-14	410791	0.75	0.86	<1	<1	<10	0.33	16.2	6.0	7.71	9.9
6-Oct-14	411638	0.96	1.09	<1	<1	<10	0.21	15.7	0.5	7.69	8.3
14-Oct-14	412208	0.90	1.08	<1	<1	<10	0.24	13.2	0.5	7.53	10.3
20-Oct-14	413000	0.95	1.14	<1	<1	<10	0.22	12.7	2.0	7.81	10.6
27-Oct-14	413679	0.85	1.06	<1	<1	20	0.21	12.7	0.5	7.63	9.1
3-Nov-14	414366	1.05	1.31	<1	<1	<10	0.26	11.0	0.5	7.62	11.6

2014 Water Main Cleaning Program

Laboratory Analysis Report Regional Monitoring

SE05_

Date Sampled	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E. Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (ºC)	True Colour (tcu)	pH (units)	Dissolved Oxygen (mg/L)
16-Jun-14	399429	0.88	1.04	<1	<1	<10	0.12	13.0	1.0	7.40	9.9
23-Jun-14	400092	0.94	1.13	<1	<1	<10	0.14	16.0	1.0	7.52	9.8
30-Jun-14	400836	0.95	1.18	<1	<1	10	0.19	13.7	1.5	7.51	10.2
7-Jul-14	401506	0.89	1.04	<1	<1	<10	0.22	15.1	0.5	7.59	9.8
14-Jul-14	402292	0.86	1.04	<1	<1	<10	0.24	16.1	0.5	7.80	9.4
21-Jul-14	403080	0.86	1.02	<1	<1	<10	0.21	17.8	0.5	7.68	9.1
28-Jul-14	403822	0.80	0.97	<1	<1	<10	0.15	18.0	2.0	7.57	9.3
5-Aug-14	404743	0.92	1.08	<1	<1	<10	0.21	19.2	0.5	7.56	9.0
11-Aug-14	405556	0.90	1.07	<1	<1	10	0.14	20.5	1.0	7.56	8.8
18-Aug-14	406427	0.77	0.91	<1	<1	<10	0.17	19.4	0.5	7.48	8.8
25-Aug-14	407224	0.60	0.88	<1	<1	<10	0.17	18.8	2.0	7.47	8.9
2-Sep-14	407961	0.89	1.06	<1	<1	<10	0.26	18.1	1.0	7.57	9.0
8-Sep-14	408641	0.90	1.09	<1	<1	<10	0.72	18.0	0.5	7.45	8.9
15-Sep-14	409350	0.87	0.99	<1	<1	<10	0.31	16.7	0.5	7.55	9.6
22-Sep-14	410087	0.87	1.13	<1	<1	<10	0.67	16.0	1.0	7.61	9.8
29-Sep-14	410792	0.70	0.92	<1	<1	<10	0.25	15.8	2.5	7.67	9.8
6-Oct-14	411639	0.89	1.09	<1	<1	<10	0.17	14.4	0.5	7.63	8.6
14-Oct-14	412209	0.78	1.05	<1	<1	<10	0.23	12.8	1.0	7.56	9.5
20-Oct-14	413001	0.88	1.10	<1	<1	<10	0.23	12.3	1.0	7.54	11.9
27-Oct-14	413680	0.83	1.06	<1	<1	<10	0.15	13.2	0.5	7.64	9.1
3-Nov-14	414367	0.98	1.18	<1	<1	<10	0.17	12.3	1.0	7.64	10.8

2014 Water Main Cleaning Program

Laboratory Analysis Report Regional Monitoring

SE11_

Date Sampled	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E. Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (ºC)	True Colour (tcu)	pH (units)	Dissolved Oxygen (mg/L)
17-Jun-14	399430	0.91	1.11	<1	<1	<10	0.20	12.4	1.0	7.40	10.5
23-Jun-14	400093	0.90	1.08	<1	<1	<10	0.35	14.1	0.5	7.49	10.6
30-Jun-14	400837	0.97	1.18	<1	<1	<10	0.28	15.1	1.5	7.87	10.4
7-Jul-14	401507	0.88	1.05	<1	<1	<10	0.30	15.9	1.0	7.46	10.3
14-Jul-14	402293	0.74	0.94	<1	<1	<10	0.27	17.3	1.0	7.72	9.7
21-Jul-14	403081	0.80	1.00	<1	<1	<10	0.31	17.6	2.5	7.55	9.7
28-Jul-14	403823	0.84	1.04	<1	<1	<10	0.44	18.5	2.0	7.54	9.7
5-Aug-14	404744	0.92	1.09	<1	<1	<10	0.96	18.8	0.5	7.43	9.7
11-Aug-14	405557	0.92	1.07	<1	<1	<10	0.43	19.6	1.0	7.48	9.4
18-Aug-14	406428	0.80	1.03	<1	<1	<10	0.22	19.9	0.5	7.33	9.5
25-Aug-14	407225	0.88	0.98	<1	<1	<10	0.32	19.8	1.5	7.39	9.1
2-Sep-14	407962	0.82	1.02	<1	<1	<10	0.72	19.4	1.0	7.43	9.7
8-Sep-14	408642	0.89	1.09	<1	<1	<10	0.38	19.0	0.5	7.35	9.4
15-Sep-14	409351	0.85	1.00	<1	<1	10	0.33	18.2	0.5	7.51	10.5
22-Sep-14	410088	0.92	1.13	<1	<1	<10	0.37	16.8	1.0	7.53	11.0
29-Sep-14	410793	0.83	0.97	<1	<1	<10	0.33	17.6	5.0	7.59	10.5
6-Oct-14	411640	0.65	0.76	<1	<1	<10	0.26	17.4	1.0	7.64	9.3
14-Oct-14	412210	0.86	1.16	<1	<1	<10	0.27	16.1	1.5	7.50	11.3
20-Oct-14	413002	0.78	0.98	<1	<1	<10	0.26	15.7	1.0	7.63	10.1
27-Oct-14	413681	0.52	0.70	<1	<1	20	0.27	15.3	0.5	7.77	8.4
3-Nov-14	414368	0.97	1.07	<1	<1	20	0.39	14.2	2.5	7.70	10.6

2014 Water Main Cleaning Program

Laboratory Analysis Report Regional Monitoring

SE14_

Date Sampled	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E. Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (ºC)	True Colour (tcu)	pH (units)	Dissolved Oxygen (mg/L)
17-Jun-14	399431	0.77	1.00	<1	<1	<10	0.15	8.7	1.0	7.37	11.0
24-Jun-14	400094	0.78	0.99	<1	<1	<10	0.17	10.7	NR	7.66	11.0
2-Jul-14	400838	0.80	0.96	<1	<1	10	0.25	9.7	2.0	7.74	10.4
8-Jul-14	401508	0.70	0.84	<1	<1	<10	0.21	9.9	1.5	7.46	10.8
15-Jul-14	402294	0.59	0.82	<1	<1	10	0.31	13.1	0.5	7.65	10.0
22-Jul-14	403082	0.68	0.87	<1	<1	<10	0.29	11.7	0.5	7.51	10.3
29-Jul-14	403824	0.64	0.82	<1	<1	<10	0.26	12.5	1.5	7.49	9.0
6-Aug-14	404745	0.78	0.92	<1	<1	<10	0.29	12.2	1.0	7.81	9.9
12-Aug-14	405558	0.73	0.91	<1	<1	<10	0.22	14.4	1.0	7.56	9.7
19-Aug-14	406429	0.60	0.81	<1	<1	<10	0.24	14.3	0.5	7.59	9.9
26-Aug-14	407226	0.62	0.78	<1	<1	10	0.26	13.6	2.5	7.43	9.1
3-Sep-14	407963	0.68	0.92	<1	<1	<10	0.25	14.4	1.0	7.49	9.5
9-Sep-14	408643	0.65	0.76	<1	<1	<10	0.26	18.1	2.5	7.40	10.4
16-Sep-14	409352	0.58	0.76	<1	<1	<10	0.34	19.0	0.5	7.61	10.7
23-Sep-14	410089	0.64	0.83	<1	<1	<10	0.31	14.0	10.0	7.58	10.7
30-Sep-14	410794	0.72	0.90	<1	<1	<10	0.58	14.9	0.5	7.84	10.6
7-Oct-14	411641	0.65	0.84	<1	<1	<10	0.31	17.1	0.5	7.50	11.0
15-Oct-14	412211	0.77	1.01	<1	<1	<10	0.19	13.5	0.5	7.62	10.1
21-Oct-14	413003	0.83	1.00	<1	<1	10	0.18	13.5	1.0	7.54	11.3
28-Oct-14	413682	0.69	0.92	<1	<1	<10	0.20	13.0	1.0	7.80	11.4
4-Nov-14	414369	0.78	0.99	<1	<1	<10	0.23	13.2	0.5	7.60	11.8

On June 24th, there was no result for true colour due to technician error.

2014 Water Main Cleaning Program

Laboratory Analysis Report Regional Monitoring

SW04_

Date Sampled	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E. Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (ºC)	True Colour (tcu)	pH (units)	Dissolved Oxygen (mg/L)
16-Jun-14	399433	0.95	1.19	<1	<1	<10	0.16	15.4	1.0	7.35	10.9
23-Jun-14	400096	0.98	1.23	<1	<1	<10	0.15	15.3	1.0	7.40	10.5
30-Jun-14	400840	0.97	1.10	<1	<1	100	0.16	16.1	1.0	7.42	10.1
7-Jul-14	401510	1.05	1.25	<1	<1	<10	0.17	17.6	2.0	7.50	10.9
14-Jul-14	402296	0.99	1.18	<1	<1	<10	0.15	18.1	1.0	7.65	10.0
21-Jul-14	403084	1.05	1.24	<1	<1	<10	0.13	18.4	1.0	7.82	10.0
28-Jul-14	403826	0.88	1.10	<1	<1	<10	0.11	16.8	2.0	7.50	10.0
5-Aug-14	404747	1.00	1.12	<1	<1	<10	0.09	17.1	2.5	7.46	9.7
11-Aug-14	405560	0.79	0.99	<1	<1	<10	0.12	18.1	1.5	7.50	9.8
18-Aug-14	406431	0.69	0.88	<1	<1	<10	0.14	20.1	0.5	7.36	9.8
25-Aug-14	407228	0.84	1.04	<1	<1	<10	0.15	18.5	1.0	7.39	9.4
2-Sep-14	407965	0.77	0.91	<1	<1	<10	0.15	18.1	1.0	7.40	10.1
8-Sep-14	408645	0.58	0.71	<1	<1	<10	0.27	18.0	NR	7.54	10.1
15-Sep-14	409354	0.64	0.76	<1	<1	<10	0.28	17.8	0.5	7.48	10.6
22-Sep-14	410091	0.75	0.91	<1	<1	<10	0.27	17.8	1.0	7.56	11.0
29-Sep-14	410796	0.80	0.93	<1	<1	<10	0.24	16.9	5.0	7.61	10.6
6-Oct-14	411643	0.84	1.05	<1	<1	<10	0.16	15.5	1.0	7.42	10.2
14-Oct-14	412213	1.04	1.21	<1	<1	<10	0.29	14.7	0.5	7.54	11.9
20-Oct-14	413005	1.03	1.25	<1	<1	<10	0.20	13.3	1.0	7.48	12.0
27-Oct-14	413684	0.79	0.99	<1	<1	<10	0.17	13.9	0.5	7.60	8.8
3-Nov-14	414371	0.95	1.18	<1	<1	<10	0.37	10.4	1.0	7.58	12.8

On September 8th, there was no result for true color due to technician error.

2014 Water Main Cleaning Program

Laboratory Analysis Report Regional Monitoring

SW06_

Date Sampled	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E. Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (ºC)	True Colour (tcu)	pH (units)	Dissolved Oxygen (mg/L)
16-Jun-14	399426	0.95	1.14	<1	<1	<10	0.13	17.3	1.0	7.29	11.1
23-Jun-14	400089	1.06	1.20	<1	<1	<10	0.16	17.9	1.0	7.40	10.9
30-Jun-14	400833	1.04	1.14	<1	<1	20	0.15	19.0	1.5	7.43	9.7
7-Jul-14	401503	0.95	1.25	<1	<1	10	0.17	19.4	1.5	7.48	11.0
14-Jul-14	402289	1.04	1.23	<1	<1	<10	0.15	20.4	0.5	7.59	10.2
21-Jul-14	403077	1.04	1.24	<1	<1	10	0.15	20.3	1.5	7.57	10.3
28-Jul-14	403819	1.02	1.21	<1	<1	<10	0.16	21.5	1.5	7.41	10.0
5-Aug-14	404740	1.01	1.15	<1	<1	<10	0.16	21.7	3.0	7.43	10.0
11-Aug-14	405553	1.01	1.20	<1	<1	<10	0.17	22.8	1.5	7.48	9.9
18-Aug-14	406424	1.02	1.21	<1	<1	<10	0.18	22.6	0.5	7.45	9.9
25-Aug-14	407221	0.89	1.08	<1	<1	<10	0.16	22.2	1.0	7.33	9.5
2-Sep-14	407958	1.01	1.19	<1	<1	<10	0.17	20.1	1.0	7.35	10.2
8-Sep-14	408638	1.01	1.12	<1	<1	<10	0.19	19.2	0.5	7.33	10.1
15-Sep-14	409347	1.04	1.12	<1	<1	<10	0.22	16.6	0.5	7.42	10.9
22-Sep-14	410084	0.98	1.19	<1	<1	<10	0.22	15.3	1.0	7.50	11.4
29-Sep-14	410789	1.04	1.16	<1	<1	10	0.21	16.2	0.5	7.60	10.9
6-Oct-14	411636	0.96	1.11	<1	<1	<10	0.16	14.5	1.0	7.78	9.7
14-Oct-14	412206	1.17	1.35	<1	<1	<10	0.20	10.4	1.0	7.42	11.9
20-Oct-14	412998	1.29	1.45	<1	<1	<10	0.17	10.4	1.0	7.48	12.4
27-Oct-14	413677	1.06	1.14	<1	<1	<10	0.15	9.8	0.5	7.46	9.6
3-Nov-14	414364	1.01	1.21	<1	<1	<10	0.41	7.8	0.5	7.53	11.8

2014 Water Main Cleaning Program

Laboratory Analysis Report Regional Monitoring

WC01_

Date Sampled	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E. Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (ºC)	True Colour (tcu)	pH (units)	Dissolved Oxygen (mg/L)
16-Jun-14	399425	1.20	1.33	<1	<1	<10	0.13	17.0	1.0	7.32	10.9
23-Jun-14	400088	0.98	1.13	<1	<1	<10	0.14	17.0	0.5	7.39	10.9
30-Jun-14	400832	1.01	1.20	<1	<1	10	0.16	18.5	2.0	7.35	10.4
7-Jul-14	401502	1.04	1.21	<1	<1	<10	0.17	18.6	1.0	7.52	10.9
14-Jul-14	402288	0.88	1.06	<1	<1	<10	0.17	20.2	0.5	7.60	9.9
21-Jul-14	403076	1.01	1.18	<1	<1	10	0.17	19.9	2.0	7.51	10.2
28-Jul-14	403818	1.15	1.29	<1	<1	<10	0.16	21.1	2.0	7.40	9.9
5-Aug-14	404739	1.09	1.23	<1	<1	<10	0.13	21.3	2.5	7.42	9.7
11-Aug-14	405552	1.05	1.26	<1	<1	<10	0.17	22.3	2.0	7.43	9.5
18-Aug-14	406423	1.07	1.22	<1	<1	<10	0.16	22.5	0.5	7.49	10.0
25-Aug-14	407220	1.17	1.27	<1	<1	<10	0.15	22.1	1.5	7.30	9.5
2-Sep-14	407957	1.06	1.20	<1	<1	<10	0.16	20.5	1.0	7.33	9.7
8-Sep-14	408637	1.01	1.15	<1	<1	<10	0.18	19.5	0.5	7.33	10.2
15-Sep-14	409346	1.02	1.24	<1	<1	<10	0.18	17.6	0.5	7.38	10.7
22-Sep-14	410083	1.03	1.25	<1	<1	<10	0.23	15.7	1.0	7.38	11.1
29-Sep-14	410788	1.04	1.26	<1	<1	<10	0.20	16.0	1.0	7.54	11.2
6-Oct-14	411635	1.02	1.21	<1	<1	<10	0.17	15.5	0.5	7.76	11.1
14-Oct-14	412205	1.02	1.18	<1	<1	<10	0.21	12.0	1.0	7.45	12.3
20-Oct-14	412997	1.09	1.24	<1	<1	<10	0.17	10.9	1.0	7.46	12.4
27-Oct-14	413676	1.00	1.16	<1	<1	<10	0.14	10.5	0.5	7.46	10.5
3-Nov-14	414363	0.98	1.20	<1	<1	<10	0.18	9.2	0.5	7.47	12.6

2014 Water Main Cleaning Program

Laboratory Analysis Report Regional Monitoring

WC12_

Date Sampled	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E. Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (ºC)	True Colour (tcu)	pH (units)	Dissolved Oxygen (mg/L)
16-Jun-14	399432	0.78	0.99	<1	<1	<10	0.14	14.2	1.0	7.37	10.7
23-Jun-14	400095	0.83	1.02	<1	<1	<10	0.13	14.7	1.5	7.45	10.7
30-Jun-14	400839	0.79	0.94	<1	<1	10	0.15	17.3	1.0	7.45	10.0
7-Jul-14	401509	0.82	1.03	<1	<1	<10	0.19	16.9	0.5	7.50	10.4
14-Jul-14	402295	0.82	1.00	<1	<1	<10	0.14	17.6	1.0	7.63	9.9
21-Jul-14	403083	0.80	0.98	<1	<1	<10	0.15	17.9	1.0	7.61	10.0
28-Jul-14	403825	0.83	1.04	<1	<1	<10	0.20	18.5	1.0	7.49	9.8
5-Aug-14	404746	0.95	1.11	<1	<1	10	0.17	19.0	2.5	7.47	9.7
11-Aug-14	405559	0.71	0.91	<1	<1	<10	0.15	19.9	2.5	7.46	9.6
18-Aug-14	406430	0.71	0.89	<1	<1	<10	0.15	20.1	0.5	7.43	9.5
25-Aug-14	407227	0.77	0.96	<1	<1	<10	0.15	19.9	1.5	7.39	9.3
2-Sep-14	407964	0.79	0.99	<1	<1	<10	0.32	19.4	1.0	7.39	9.9
8-Sep-14	408644	0.83	0.96	<1	<1	<10	0.32	19.2	0.5	7.40	10.1
15-Sep-14	409353	0.80	0.95	<1	<1	<10	0.25	18.5	NR	7.41	9.7
22-Sep-14	410090	0.66	0.82	<1	<1	<10	0.26	18.3	1.0	7.56	11.0
29-Sep-14	410795	0.62	0.89	<1	<1	50	0.26	17.5	0.5	7.72	10.9
6-Oct-14	411642	0.85	1.06	<1	<1	<10	0.25	16.0	0.5	7.41	10.4
14-Oct-14	412212	0.89	1.04	<1	<1	<10	0.19	15.2	0.5	7.54	11.5
20-Oct-14	413004	0.90	1.08	<1	<1	10	0.35	12.4	1.0	7.64	12.3
27-Oct-14	413683	0.79	0.92	<1	<1	<10	0.17	13.9	1.0	7.57	9.4
3-Nov-14	414370	0.81	0.94	<1	<1	10	0.24	16.0	0.5	6.42	11.6

On September 15th, there was no result for true color due to technician error.

E4e Sensitive Users Monitoring Reports 2011-2014

2011 Water Main Cleaning Program

Laboratory Analysis Report Sensitive Users Monitoring

[redacted]

Date Sampled	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E. Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (ºC)	Apparent Colour (acu)	True Colour (tcu)	pH (units)	Dissolved Oxygen (mg/L)
2-May-11	290379	0.62	0.90	<1	<1	<10	0.32	6.9	2.5	0.5	7.40	12.2
9-May-11	291098	0.61	0.88	<1	<1	<10	0.25	9.2	1.5	<0.5	7.33	11.5
16-May-11	291763	0.65	0.93	<1	<1	<10	0.41	10.5	7.5	1.5	7.40	10.6
24-May-11	292418	0.72	0.93	<1	<1	<10	0.34	12.1	6.0	1.0	7.43	11.8
30-May-11	293217	0.64	0.98	<1	<1	<10	0.28	13.0	13 0	1.0	7.78	11.7
6-Jun-11	294083	0.93	1.16	<1	<1	<10	2.38	13.9	75 0	7.5	7.73	11.4
7-Jun-11	294556	0.67	0.88	<1	<1	<10	1.20	13.8	25 0	7.5	7.56	11.3
7-Jun-11	294595	0.61	0.79	<1	<1	<10	0.77	13.7	25 0	6.0	7.43	11.2
8-Jun-11	294621	0.61	0.83	<1	<1	<10	0.74	14.7	15 0	0.5	7.33	11.1
9-Jun-11	294732	0.64	0.91	<1	<1	<10	0.35	14.2	3.0	1.0	7.80	11.3
10-Jun-11	294769	0.68	0.99	<1	<1	<10	0.34	14.5	15 0	5.0	7.35	12.3
14-Jun-11	294911	0.60	0.76	<1	<1	<10	0.30	15.5	13 0	7.5	7.41	11.1
20-Jun-11	295617	0.62	0.85	<1	<1	<10	0.38	15.3	13 0	2.5	7.33	10.7
27-Jun-11	296273	0.64	0.78	<1	<1	<10	0.26	18.6	15 0	2.5	7.40	11.0
4-Jul-11	296997	0.57	0.80	<1	<1	<10	0.27	20.1	10 0	2.0	7.38	10.6
12-Jul-11	297767	0.53	0.66	<1	<1	<10	0.31	21.5	5.0	NR	7 37	10.1
18-Jul-11	298483	0.75	0.89	<1	<1	<10	0.54	21.3	13 0	2.5	7 35	10.3
25-Jul-11	299255	0.61	0.79	<1	<1	<10	0.79	22.7	16 0	5.0	7.49	10.4
2-Aug-11	299940	0.58	0.73	<1	<1	<10	0.26	22.4	10 0	0.5	7.44	10.5
8-Aug-11	300517	0.49	0.61	<1	<1	20	0.30	23.0	5.0	1.0	7 54	10.2
16-Aug-11	301265	0.53	0.72	<1	<1	<10	0.25	22.5	5.0	1.0	7 54	10.3
23-Aug-11	301916	0.45	0.71	<1	<1	<10	0.32	22.1	5.0	1.0	7.42	10.3
29-Aug-11	302600	0.76	0.92	<1	<1	<10	0.39	22.3	5.0	1.0	7 53	8.4
6-Sep-11	303438	0.88	1.11	<1	<1	<10	0.26	21.5	6.0	2.0	7.45	10.4
12-Sep-11	304083	0.84	0.99	<1	<1	10	0.31	21.5	13 0	1.0	7 51	10.5
21-Sep-11	304755	0.98	1.16	<1	<1	10	0.24	17.9	5.0	1.0	7.43	10.2
27-Sep-11	305517	0.97	1.25	<1	<1	<10	0.29	17.4	6.0	1.0	7 37	11.3

NA: Not analysed NR: No result

NOTE: Flushing within 2 blocks of [redacted] began on June 6. A high turbidity of 2.38 NTU was reported on June 6.
The location was resampled twice on June 7 to ensure turbidity levels returned to normal levels.
On July 12 there were no results for true colour due to lab error.

2012 Water Main Cleaning Program

Laboratory Analysis Report Sensitive Users Monitoring

Date Sampled	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform E (MPNU/ 100mL)	. Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (ºC)	True Colour (tcu)	pH (units)	Dissolved Oxygen (mg/L)
1-May-12	324028	0.69	0.86	<1	<1	<10	0.31	8.0	1.0	7.46	NA[1]
7-May-12	324530	0.58	0.73	<1	<1	<10	0.19	8.4	1.0	7.58	NA[1]
14-May-12	325307	0.66	0.84	<1	<1	<10	0.21	9.0	2.0	7.32	12.1
22-May-12	326041	0.53	0.74	<1	<1	<10	0.17	9.1	1.0	7.39	11.3
31-May-12	326739	0.67	0.89	<1	<1	<10	0.42	10.4	1.0	7.59	11.1
5-Jun-12	327501	0.66	0.85	<1	<1	<10	0.15	10.8	1.0	7.30	11.5
12-Jun-12	328257	0.63	0.79	<1	<1	<10	0.16	11.8	2.0	7.45	12.0
19-Jun-12	328982	0.71	0.90	<1	<1	<10	0.18	14.1	1.0	7.46	10.2
26-Jun-12	329709	0.72	0.91	<1	<1	<10	0.26	13.2	1.0	7.44	10.0
3-Jul-12	330421	0.76	0.95	<1	<1	<10	0.16	14 8	2.0	7 38	10.4
9-Jul-12	331126	0.51	0.66	<1	<1	<10	0 29	16 5	1.0	7.62	9.5
10-Jul-12	331102	0.78	0.98	<1	<1	<10	0.78	15 3	1.0	7.45	9.5
10-Jul-12	331127	0.78	0.98	<1	<1	<10	0.78	15 3	1.0	7.45	9.5
11-Jul-12	331128	0.74	0.95	<1	<1	<10	0 34	16 9	1.0	7 38	9.6
12-Jul-12	331129	0.86	1.03	<1	<1	<10	0 30	15 9	1.0	7 39	9.6
13-Jul-12	331130	0.77	0.93	<1	<1	<10	0 23	16 5	1.0	7.44	9.3
16-Jul-12	331832	0.79	0.94	<1	<1	<10	0 26	16.4	2.5	7.44	9.4
24-Jul-12	332619	0.85	1.03	<1	<1	<10	0 87	20 2	1.0	7 37	9.5
31-Jul-12	333341	0.79	0.96	<1	<1	<10	0 36	17.7	1.0	7.44	9.3
8-Aug-12	334016	0.56	0.73	<1	<1	<10	0 25	18.4	1.0	7.43	NA[2]
14-Aug-12	334795	0.66	0.93	<1	<1	<10	0 25	19 5	1.0	7.43	10.0

Date Sampled	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform E (MPNU/ 100mL)	. Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (ºC)	True Colour (tcu)	pH (units)	Dissolved Oxygen (mg/L)
1-May-12	324027	0.64	0.86	<1	<1	<10	0.25	8.1	1.0	7.48	NA[1]
7-May-12	324529	0.67	0.82	<1	<1	<10	0.21	8.5	1.0	7.57	NA[1]
14-May-12	325306	0.79	0.99	<1	<1	<10	0.24	9.1	1.0	7.36	11.8
22-May-12	326040	0.71	0.88	<1	<1	<10	0.21	10.1	1.0	7.37	11.2
31-May-12	326738	0.63	0.85	<1	<1	<10	0.18	11.3	2.0	7.51	11.1
5-Jun-12	327500	0.76	0.91	<1	<1	<10	0.18	12.1	1.0	7.23	11.3
12-Jun-12	328256	0.62	0.77	<1	<1	<10	0.18	13.3	2.0	7.47	11.5
20-Jun-12	328981	0.59	0.75	<1	<1	NR[3]	0.27	14.8	0.5	7.43	9.9
26-Jun-12	329708	0.74	0.91	<1	<1	<10	0.32	15.3	1.0	7.43	10.0
3-Jul-12	330420	0.69	0.89	<1	<1	<10	0.41	18.0	2.0	7.38	10.1
9-Jul-12	331122	0.56	0.71	<1	<1	<10	1.14	18.0	2.0	7.51	9.5
9-Jul-12	331121	0.56	0.71	<1	<1	<10	0.20	18.0	1.0	7.58	9.5
10-Jul-12	331101	0.71	0.89	<1	<1	<10	0.28	15.4	1.0	7.44	9.4
11-Jul-12	331123	0.72	0.89	<1	<1	<10	0.25	20.5	1.0	7.35	9.5
12-Jul-12	331124	0.72	0.95	<1	<1	<10	0.22	19.5	1.0	7.37	9.5
13-Jul-12	331125	0.71	0.88	<1	<1	<10	0.31	20.5	1.0	7.40	9.1
16-Jul-12	331831	0.67	0.87	<1	<1	<10	0.31	19.1	2.0	7.39	9.3
24-Jul-12	332618	0.76	0.92	<1	<1	<10	0.33	20.3	1.0	7.50	9.4
31-Jul-12	333340	0.76	0.93	<1	<1	<10	0.30	20.7	1.0	7.48	9.4
8-Aug-12	334015	0.67	0.87	<1	<1	<10	0.35	20.2	1.0	7.44	NA[2]
14-Aug-12	334794	0.79	0.93	<1	<1	<10	0.41	20.0	1.0	7.46	9.9

Date Sampled	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E. Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (ºC)	True Colour (tcu)	pH (units)	Dissolved Oxygen (mg/L)
7-May-12	324590	0.78	1.03	<1	<1	<10	0.20	8.6	1.0	7.51	NA[1]
14-May-12	325255	0.90	1.09	<1	<1	<10	0.21	9.4	1.0	7.53	NA[1]
22-May-12	325993	0.71	0.86	<1	<1	<10	0.15	9.8	1.0	7.46	11.2
31-May-12	326705	0.61	0.78	<1	<1	<10	0.17	11.4	2.0	7.64	10.8
5-Jun-12	327449	0.84	1.00	<1	<1	10	0.22	12.4	1.0	7.53	11.1
12-Jun-12	328223	0.65	0.81	<1	<1	<10	0.24	12.9	2.0	7.50	11.6
18-Jun-12	328930	0.68	0.84	<1	<1	<10	1.37	14.7	2.0	7 52	9.7
19-Jun-12	329093	0.77	0.96	<1	<1	<10	0 56	15 3	1.0	7 52	10.1
19-Jun-12	329092	0.74	0.89	<1	<1	<10	0.49	14.1	1.0	7.45	10.1
20-Jun-12	329094	0.80	0.95	<1	<1	NR[3]	1 21	15 2	1.0	7.63	9.9
21-Jun-12	329096	0.70	0.86	<1	<1	<10	0 39	15.7	1.0	7.60	9.9
21-Jun-12	329095	0.62	0.80	<1	<1	<10	0 97	14.1	1.0	7 52	10.1
26-Jun-12	329657	0.71	0.91	<1	<1	<10	0.19	15.3	1.0	7.43	9.9
3-Jul-12	330428	0.73	0.95	<1	<1	<10	0.24	16.8	2.0	7.53	10.1
10-Jul-12	331109	0.68	0.84	<1	<1	10	0.17	20.4	1.0	7.61	9.3
16-Jul-12	331839	0.60	0.81	<1	<1	<10	0.24	18.4	2.0	7.50	9.1
24-Jul-12	332626	0.87	1.02	<1	<1	130	0.18	21.6	1.0	7.42	9.1
31-Jul-12	333348	0.60	0.75	<1	<1	<10	0.20	19.5	1.0	7.48	9.1
8-Aug-12	333968	0.54	0.70	<1	<1	20	0.24	20.1	1.5	7.57	9.0
14-Aug-12	334731	0.72	0.88	<1	<1	<10	0.28	20.1	0.5	7.68	9.0

Date Sampled	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E. Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (ºC)	True Colour (tcu)	pH (units)	Dissolved Oxygen (mg/L)
7-May-12	324585	0.59	0.80	<1	<1	<10	0.33	12.1	1.0	7.43	NA[1]
14-May-12	325250	0.79	1.03	<1	<1	<10	0.91	12.1	1.0	7.54	NA[1]
22-May-12	325988	0.67	0.87	<1	<1	<10	0.66	12 0	1.0	7.41	11.2
31-May-12	326700	0.67	0.86	<1	<1	<10	0 28	11.7	1.0	7.60	11.0
5-Jun-12	327444	0.79	1.00	<1	<1	<10	0 29	14.4	1.0	7 52	11.2
12-Jun-12	328218	0.41	0.62	<1	<1	<10	1 36	14.7	2.5	7 50	11.4
14-June-12*	328878	NA	NA	NA	NA	NA	0 59	NA	NA	NA	NA
19-Jun-12	328925	0.60	0.79	<1	<1	<10	0 28	13 3	1.0	7.46	10.0
26-Jun-12	329652	0.72	0.87	<1	<1	<10	0.73	16.1	1.0	7.49	9.9
3-Jul-12	330426	0.61	0.80	<1	<1	<10	0.48	19 0	2.5	7.45	10.1
9-Jul-12	331131	0.66	0.85	<1	<1	<10	0.60	18.6	1.5	7 52	9.4
10-Jul-12	331107	0.78	0.96	<1	<1	<10	0 59	20.7	1.0	7.47	9.4
10-Jul-12	331132	0.78	0.96	<1	<1	<10	0.49	20.7	1.0	7.44	9.4
11-Jul-12	331133	0.80	0.95	<1	<1	<10	0.66	20 9	1.0	7.41	9.4
12-Jul-12	331134	0.84	1.00	<1	<1	<10	0.77	20 0	1.0	7.43	9.5
13-Jul-12	331135	0.65	0.82	<1	<1	<10	0 50	20 2	1.0	7.42	9.0
16-Jul-12	331797	0.59	0.79	<1	<1	20	0.42	21.7	2.5	7 51	9.1
24-Jul-12	332566	0.61	0.76	<1	<1	40	0 58	21 8	1.0	7 39	9.1
31-Jul-12	333288	0.65	0.78	<1	<1	<10	0 38	22.1	1.0	7.44	9.3
8-Aug-12	333963	0.52	0.69	<1	<1	<10	0.44	22 0	1.5	7.47	NA[2]
14-Aug-12	334726	0.70	0.82	<1	<1	<10	0 37	20 8	0.5	7 52	9.9

*On June 14, the location was re-sampled due to a high turbidity of 1.36 NTU on June 12. Other parameters were not analysed for the re-sample.

NA: Not analysed NR: No result
NOTE:
[1]Dissolved oxygen was not analysed prior to May 14, 2012.
[2]Dissolved oxygen was not analysed due to instrument error/malfunction.
[3]No HPC result reported by the contract lab.

2013 Water Main Cleaning Program

Laboratory Analysis Report Sensitive Users Monitoring

Date Sampled	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E. Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (ºC)	True Colour (tcu)	pH (units)	Dissolved Oxygen (mg/L)
8-Apr-13	356113	0.55	0.69	<1	<1	10	0.50	7.2	2.0	7.91	12.1
16-Apr-13	356843	0.57	0.78	<1	<1	<10	0.32	6.6	3.0	7.60	12.8
23-Apr-13	357515	0.75	0.95	<1	<1	<10	0.31	7.1	2.5	7.56	12.3
29-Apr-13	358142	0.64	0.85	<1	<1	<10	0.20	7.8	1.5	7.53	12.6
6-May-13	358864	0.73	0.90	<1	<1	<10	0.40	6.5	1.0	7.56	12.6
14-May-13	359617	0.73	0.87	<1	<1	10	0.35	7.9	2.0	7.65	11.6
21-May-13	360370	0.59	0.79	<1	<1	<10	0.80	7.5	2.0	7.69	10.9
27-May-13	361188	0.60	0.78	<1	<1	<10	0.78	8.5	2.0	7.54	11.3
3-Jun-13	362014	0.62	0.75	<1	<1	<10	1.21	9.1	1.0	7.73	9.9
10-Jun-13	362830	0.60	0.75	<1	<1	NR	0.54	9.6	1.0	7.63	9.5
17-Jun-13	363612	0.91	1.19	<1	<1	<10	0.60	13.4	1.0	7.57	9.5
18-Jun-13	363678	0.65	0.81	<1	<1	NR	0.89	10.6	0.5	7.70	9.5
19-Jun-13	363679	0.77	0.91	<1	<1	<10	1.36	11.5	0.5	7.64	9.4
20-Jun-13	363680	0.79	0.98	<1	<1	<10	2.01	12.6	1.0	7.57	9.2
21-Jun-13	363681	0.61	0.79	<1	<1	<10	0.60	12.2	1.0	7.62	9.4
24-Jun-13	364383	0.59	0.77	<1	<1	<10	0.67	9.9	2.0	7.58	8.4
2-Jul-13	365115	0.55	0.70	<1	<1	<10	0.33	14.7	1.0	7.58	8.0
8-Jul-13	365852	0.60	0.76	<1	<1	<10	0.38	16.5	1.0	7.66	9.3
15-Jul-13	366539	0.50	0.64	<1	<1	10	0.96	16.4	1.0	7.61	9.1
22-Jul-13	367419	0.57	0.69	<1	<1	<10	0.95	17.4	2.5	7.74	9.1
29-Jul-13	368097	0.61	0.75	<1	<1	<10	0.52	17.3	1.0	7.76	9.3
6-Aug-13	368777	0.55	0.68	<1	<1	<10	0.58	17.4	1.0	7.69	9.2
12-Aug-13	369488	0.59	0.76	<1	<1	<10	0.70	17.5	2.0	7.61	9.4
19-Aug-13	370160	0.55	0.69	<1	<1	<10	0.63	17.8	1.0	7.71	9.6

NOTE: On June 10, and 18, 2013 there were no results for HPC due to contract lab error.

2013 Water Main Cleaning Program

Laboratory Analysis Report Sensitive Users Monitoring

Date Sampled	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E. Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (ºC)	True Colour (tcu)	pH (units)	Dissolved Oxygen (mg/L)
10-Apr-13	356112	0.70	0.87	<1	<1	<10	0.19	4.0	2.5	7.46	12.9
16-Apr-13	356842	0.76	0.91	<1	<1	<10	0.19	5.0	2.5	7.55	12.9
23-Apr-13	357514	0.72	0.89	<1	<1	<10	0.19	5.7	2.5	7.51	13.1
29-Apr-13	358141	0.84	1.09	<1	<1	<10	0.20	4.3	1.0	7.44	13.1
6-May-13	358863	0.80	1.02	<1	<1	<10	0.55	6.3	1.5	7.53	12.8
14-May-13	359616	0.62	0.83	<1	<1	<10	0.25	5.5	2.5	7.51	12.4
21-May-13	360369	0.65	0.81	<1	<1	<10	0.20	7.6	2.0	7.52	10.9
27-May-13	361187	0.72	0.85	<1	<1	<10	0.22	7.7	2.5	7.57	11.4
3-Jun-13	362013	0.72	0.90	<1	<1	<10	0.25	9.3	1.0	7.63	9.9
10-Jun-13	362829	0.71	0.95	<1	<1	NR	0.21	9.6	1.0	7.54	9.7
17-Jun-13	363611	0.64	0.88	<1	<1	30	0.28	10.5	1.0	7.53	9.4
24-Jun-13	364382	0.70	0.89	<1	<1	<10	0.22	13.4	2.0	7.59	9.0
2-Jul-13	365114	0.62	0.81	<1	<1	<10	0.20	14.2	1.0	7.56	8.9
3-Jul-13	365572	0.62	0.79	<1	<1	<10	0.20	15.1	0.5	7.57	9.3
3-Jul-13	365573	0.75	0.99	<1	<1	<10	0.92	13.7	0.5	7.57	9.4
4-Jul-13	365574	0.69	0.87	<1	<1	<10	0.22	14.5	1.0	7.55	9.3
5-Jul-13	365575	0.70	0.90	<1	<1	<10	0.27	14.7	0.5	7.50	9.4
8-Jul-13	365851	0.62	0.79	<1	<1	<10	0.30	15.6	1.0	7.60	9.3
15-Jul-13	366538	0.54	0.71	<1	<1	<10	0.36	15.9	1.0	7.60	9.2
22-Jul-13	367418	0.51	0.66	<1	<1	NR	0.30	16.1	2.5	7.65	9.3
29-Jul-13	368096	0.47	0.58	<1	<1	<10	0.21	16.6	1.0	7.69	9.0
6-Aug-13	368776	0.45	0.58	<1	<1	20	0.35	18.2	1.0	7.58	9.3
12-Aug-13	369487	0.40	0.64	<1	<1	<10	0.22	16.8	2.5	7.57	NR
19-Aug-13	370159	0.60	0.74	<1	<1	<10	0.97	18.4	1.0	7.57	9.7

NOTE: On June 10, and July 22, 2013 there were no results for HPC due to contract lab error.
On August 12, 2013 there was no result for dissolved oxygen due to instrument malfunction.

2014 Water Main Cleaning Program

Laboratory Analysis Report Sensitive Users Monitoring

Date Sampled	Sample Number	Free Chlorine (mg/L)	Total Chlorine (mg/L)	Total Coliform (MPNU/ 100mL)	E. Coli (MPNU/ 100mL)	Heterotrophic Plate Count (cfu/mL)	Turbidity (ntu)	Temperature (ºC)	True Colour (tcu)	pH (units)	Dissolved Oxygen (mg/L)
16-Jun-14	399423	0.99	1.15	<1	<1	<10	0.21	13.4	1.0	7.43	10.3
23-Jun-14	400086	1.03	1.22	<1	<1	<10	0.14	13.4	1.5	7.51	10.4
30-Jun-14	400830	0.88	1.08	<1	<1	980	0.19	14.5	1.0	7.51	10.4
7-Jul-14	401500	1.07	1.29	<1	<1	<10	0.18	15.2	0.5	7.59	10.4
14-Jul-14	402286	0.90	1.12	<1	<1	<10	0.15	16.3	0.5	7.67	9.8
21-Jul-14	403074	1.06	1.25	<1	<1	<10	NR	17.0	1.5	7.67	9.8
28-Jul-14	403816	0.84	1.08	<1	<1	<10	0.12	18.0	2.0	7.55	9.8
5-Aug-14	404737	0.94	1.12	<1	<1	<10	0.22	18.6	5.0	7.56	9.6
11-Aug-14	405550	1.05	1.22	<1	<1	10	0.16	19.0	1.0	7.51	9.6
18-Aug-14	406421	1.16	1.36	<1	<1	<10	0.15	20.0	1.0	7.45	9.4
25-Aug-14	407218	1.11	1.25	<1	<1	<10	0.17	19.9	3.0	7.50	9.2
2-Sep-14	407955	0.96	1.15	<1	<1	<10	0.15	19.2	1.0	7.45	9.4
8-Sep-14	408635	1.12	1.31	<1	<1	<10	0.22	18.8	0.5	7.41	9.8
15-Sep-14	409344	0.93	1.11	<1	<1	<10	0.21	17.4	0.5	7.47	10.1
22-Sep-14	410081	0.86	1.07	<1	<1	<10	0.26	16.3	1.0	7.55	10.6
29-Sep-14	410786	0.87	1.09	<1	<1	<10	0.22	16.0	0.5	7.65	10.5
6-Oct-14	411633	0.90	1.12	<1	<1	<10	0.20	15.5	0.5	7.62	10.2
14-Oct-14	412283	1.09	1.20	<1	<1	<10	1.87	13.3	2.5	7.87	NA
14-Oct-14	412284	0.97	1.15	<1	<1	10	0.36	13.7	0.5	7.82	NA
15-Oct-14	412771	0.83	1.05	<1	<1	<10	0.19	13.3	0.5	7.62	NA
16-Oct-14	412772	0.88	1.10	<1	<1	<10	0.34	13.1	4.0	7.66	NA
17-Oct-14	412773	0.86	1.03	<1	<1	<10	0.27	13.0	1.0	7.60	NA
20-Oct-14	412995	1.00	1.12	<1	<1	<10	0.21	12.5	1.0	7.66	11.4
27-Oct-14	413674	0.85	1.06	<1	<1	<10	0.20	12.2	1.0	7.61	9.5
3-Nov-14	414361	0.87	1.07	<1	<1	<10	0.27	11.2	0.5	7.62	11.6

NOTE: On June 30th, a high HPC was reported. No resample was taken because the contract lab did not contact us prior to the following routine weekly sampling.

On July 21st, there was no result for turbidity due to technician error.

On October 14, 15, 16, and 17, the dissolved oxygen was not analysed due to technician error.

E5 Distribution System Water Quality Data and Analysis (Appendix D5 is stored separately as an Excel file)

E6 Chlorine and Turbidity Readings

E6a Chlorine and Turbidity Readings - Main Repair Activity 1 Jan 12-26

Date	Number	Street	Final Turbidity Reading	Final Residual Chlorine Reading	Notes
12-Jan-15		McCalman	3.45	0.85	
12-Jan-15		ShoreView	-	-	No Notes
12-Jan-15		Dalhousie	2.32	0.31	
12-Jan-15		Grosvenor / Waverley	1.39	0.67	
12-Jan-15		Eagleridge	-	-	Main was not Operated
13-Jan-15		Prevette	4.59	1.01	
13-Jan-15		Ashford	4	1.23	
13-Jan-15		Fidler	1.02	0.66	
13-Jan-15		Goswell	-	-	No Notes
13-Jan-15		Eagleridge	0.37	0.94	
14-Jan-15		Lyndale	2.2	0.43	
14-Jan-15		Ingelwood	4.9	0.54	
14-Jan-15		Parkview	4.95	0.17	
15-Jan-15		Southboine	3.11	0.23	
15-Jan-15		Winchester	2.03	0.45	
15-Jan-15		Valleyview / Heritage	-	-	No Notes
15-Jan-15		Kingsford	1.1	0.32	
15-Jan-15		Washington / Watt	-	-	No Notes
15-Jan-15		Jim Smith	-	-	No Notes
15-Jan-15		Main	-	-	Watermain Still off. No Test taken
16-Jan-15		Lipton	1.33	0.55	
16-Jan-15		Lipton	1.53	0.55	
16-Jan-15		Parkville Bay / Parkville Dr	-	-	No Notes
16-Jan-15		Hoka	2.83	0.47	
16-Jan-15		Washington	2.98	0.17	
16-Jan-15		Main	1.34	0.76	
17-Jan-15		Panet	-	-	No Notes
17-Jan-15		Centennial	6.59	0.94	
17-Jan-15		Henderson Hwy / Bowman	-	-	No Notes
17-Jan-15		St Annes	9.19	0.66	
17-Jan-15		Lincrest	-	-	No Test, renewed sbox
17-Jan-15		Higgins / Lizzie	-	-	No test taken. Set up to complete next day
18-Jan-15		Panet	2.82	0.52	
18-Jan-15		Henderson Hwy / Bowman	-	-	No Notes
18-Jan-15		St James / Saskatchewan	-	-	No Notes
19-Jan-15		Home	4.62	0.39	
19-Jan-15		Berwyn	4.75	0.63	
19-Jan-15		Beaverhill	4.05	0.6	
19-Jan-15		St James / Saskatchewan	-	-	No Notes

19-Jan-15		Higgins / Lizzie	2.27	0.1	
20-Jan-15		Grant	-	-	No test. Main was left on full.
20-Jan-15		Golf	-	-	No test required, main left on
20-Jan-15		Whittier Ave W / Hoka	4.9	0.67	
20-Jan-15		Bushnell	3.6	0.81	
20-Jan-15		Dumbarton	-	-	Main was not turned off. No readings
20-Jan-15		Thompson	-	-	Did not turn main off. No readings
21-Jan-15		Woodlawn	0.9	0.25	
21-Jan-15		Nassau	0.79	0.41	
21-Jan-15		Grant	2.03	0.86	
21-Jan-15		Golf	0.91	0.85	
21-Jan-15		Eagle	-	-	No notes
21-Jan-15		Mosselle	3.81	0.37	
21-Jan-15		Bushnell	4.01	0.61	
21-Jan-15		Thompson	3.24	0.08	
22-Jan-15		Hennessey	1.03	0.48	
22-Jan-15		Hampton	4.4	0.47	
22-Jan-15		Eagle	3.36	0.56	
22-Jan-15		Home	3.89	0.47	
23-Jan-15		Redwood	-	-	No notes
23-Jan-15		Hennessey	3.52	0.52	
23-Jan-15		Oxford	1.4	0.91	
23-Jan-15		Campbell	4.39	0.78	
23-Jan-15		Balcom	2.28	0.5	
23-Jan-15		Whitehall	-	-	No Leak, No Main Control
24-Jan-15		Higgens / Henry	1.1	0.54	
24-Jan-15		Redwood	-	-	Did not shut off main
24-Jan-15		Thorn	2.47	0.76	
24-Jan-15		Wildwood C	4.8	0.73	
24-Jan-15		Springfield	1.46	0.46	
24-Jan-15		Clarence	-	-	Renewed Box, no test taken
25-Jan-15		Mason	2.76	0.51	
25-Jan-15		Strathcona / Sargent	9.41	0.25	
25-Jan-15		Pembina	3.62	0.64	
25-Jan-15		Mountain	-	-	No test. Task not Complete
25-Jan-15		Mountain / Bentall	4.48	0.55	
26-Jan-15		Budden	3.34	0.56	
26-Jan-15		Inkster / McPhillips	-	-	No notes
26-Jan-15		Inkster	3.51	0.56	
26-Jan-15		Langside	4.39	0.51	

E6b Chlorine and Turbidity Readings - Main Repair Activity 2 Jan 12-26

Date	Number	Street	Final Turbidity Reading	Final Residual Chlorine Reading	Notes
12-Jan-15	[redacted]	McCalman	3.45	0.85	
12-Jan-15		ShoreView	-	-	No Notes
12-Jan-15		Dalhousie	2.32	0.31	
12-Jan-15		Grosvenor / Waverley	1.39	0.67	
12-Jan-15		Eagleridge	-	-	Main was not Operated
13-Jan-15		Prevette	4.59	1.01	
13-Jan-15		Ashford	4	1.23	
13-Jan-15		Fidler	1.02	0.66	
13-Jan-15		Goswell	-	-	No Notes
13-Jan-15		Eagleridge	0.37	0.94	
14-Jan-15		Lyndale	2.2	0.43	
14-Jan-15		Ingelwood	4.9	0.54	
14-Jan-15		Parkview	4.95	0.17	
15-Jan-15		Southboine	3.11	0.23	
15-Jan-15		Winchester	2.03	0.45	
15-Jan-15		Valleyview / Heritage	-	-	No Notes
15-Jan-15		Kingsford	1.1	0.32	
15-Jan-15		Washington / Watt	-	-	No Notes
15-Jan-15		Jim Smith	-	-	No Notes
15-Jan-15		Main	-	-	Watermain Still off. No Test taken
16-Jan-15		Lipton	1.33	0.55	
16-Jan-15		Lipton	1.53	0.55	
16-Jan-15		Parkville Bay / Parkville Dr	-	-	No Notes
16-Jan-15		Hoka	2.83	0.47	
16-Jan-15		Washington	2.98	0.17	
16-Jan-15		Main	1.34	0.76	
17-Jan-15		Panet	-	-	No Notes
17-Jan-15	[redacted]	Centennial	6.59	0.94	
17-Jan-15		Henderson Hwy / Bowman	-	-	No Notes
17-Jan-15	[redacted]	St Annes	9.19	0.66	
17-Jan-15	[redacted]	Lincrest	-	-	No Test, renewed sbox
17-Jan-15		Higgins / Lizzie	-	-	No test taken. Set up to complete next day

18-Jan-15	Panet	2.82	0.52	
18-Jan-15	Henderson Hwy / Bowman	-	-	No Notes
18-Jan-15	St James / Saskatchewan	-	-	No Notes
19-Jan-15	Home	4.62	0.39	
19-Jan-15	Berwyn	4.75	0.63	
19-Jan-15	Beaverhill	4.05	0.6	
19-Jan-15	St James / Saskatchewan	-	-	No Notes
19-Jan-15	Higgins / Lizzie	2.27	0.1	
20-Jan-15	Grant	-	-	No test. Main was left on full.
20-Jan-15	Golf	-	-	No test required, main left on
20-Jan-15	Whittier Ave W / Hoka	4.9	0.67	
20-Jan-15	Bushnell	3.6	0.81	
20-Jan-15	Dumbarton	-	-	Main was not turned off. No readings
20-Jan-15	Thompson	-	-	Did not turn main off. No readings
21-Jan-15	Woodlawn	0.9	0.25	
21-Jan-15	Nassau	0.79	0.41	
21-Jan-15	Grant	2.03	0.86	
21-Jan-15	Golf	0.91	0.85	
21-Jan-15	Eagle	-	-	No notes
21-Jan-15	Mosselle	3.81	0.37	
21-Jan-15	Bushnell	4.01	0.61	
21-Jan-15	Thompson	3.24	0.08	
22-Jan-15	Hennessey	1.03	0.48	
22-Jan-15	Hampton	4.4	0.47	
22-Jan-15	Eagle	3.36	0.56	
22-Jan-15	Home	3.89	0.47	
23-Jan-15	Redwood	-	-	No notes
23-Jan-15	Hennessey	3.52	0.52	
23-Jan-15	Oxford	1.4	0.91	
23-Jan-15	Campbell	4.39	0.78	
23-Jan-15	Balcom	2.28	0.5	
23-Jan-15	Whitehall	-	-	No Leak, No Main Control
24-Jan-15	Higgens / Henry	1.1	0.54	
24-Jan-15	Redwood	-	-	Did not shut off main
24-Jan-15	Thorn	2.47	0.76	

24-Jan-15	Wildwood C	4.8	0.73	
24-Jan-15	Springfield	1.46	0.46	
24-Jan-15	Clarence	-	-	Renewed Box, no test taken
25-Jan-15	Mason	2.76	0.51	
25-Jan-15	Strathcona / Sargent	9.41	0.25	
25-Jan-15	Pembina	3.62	0.64	
25-Jan-15	Mountain	-	-	No test. Task not Complete
25-Jan-15	Mountain / Bentall	4.48	0.55	
26-Jan-15	Budden	3.34	0.56	
26-Jan-15	Inkster / McPhillips	-	-	No notes
26-Jan-15	Inkster	3.51	0.56	
26-Jan-15	Langside	4.39	0.51	
	MAX	9.41	1.23	
	MIN	0.37	0.08	
		9.19	1.23	

Date	Number	Street	Final Turbidity Reading	Final Residual Chlorine Reading
21-Jan-15		Thompson	3.24	0.08
19-Jan-15		Higgins / Lizzie	2.27	0.1
14-Jan-15		Parkview	4.95	0.17
16-Jan-15		Washington	2.98	0.17
15-Jan-15		Southboine	3.11	0.23
21-Jan-15		Woodlawn	0.9	0.25
25-Jan-15		Strathcona / Sargent	9.41	0.25
12-Jan-15		Dalhousie	2.32	0.31
15-Jan-15		Kingsford	1.1	0.32
21-Jan-15		Mosselle	3.81	0.37
19-Jan-15		Home	4.62	0.39
21-Jan-15		Nassau	0.79	0.41
14-Jan-15		Lyndale	2.2	0.43
15-Jan-15		Winchester	2.03	0.45
24-Jan-15		Springfield	1.46	0.46
16-Jan-15		Hoka	2.83	0.47
22-Jan-15		Hampton	4.4	0.47
22-Jan-15		Home	3.89	0.47
22-Jan-15		Hennessey	1.03	0.48
23-Jan-15		Balcom	2.28	0.5
25-Jan-15		Mason	2.76	0.51
26-Jan-15		Langside	4.39	0.51
18-Jan-15		Panet	2.82	0.52
23-Jan-15		Hennessey	3.52	0.52
14-Jan-15		Ingelwood	4.9	0.54
24-Jan-15		Higgens / Henry	1.1	0.54
16-Jan-15		Lipton	1.33	0.55
16-Jan-15		Lipton	1.53	0.55
25-Jan-15		Mountain / Bentall	4.48	0.55
22-Jan-15		Eagle	3.36	0.56
26-Jan-15		Budden	3.34	0.56
26-Jan-15		Inkster	3.51	0.56

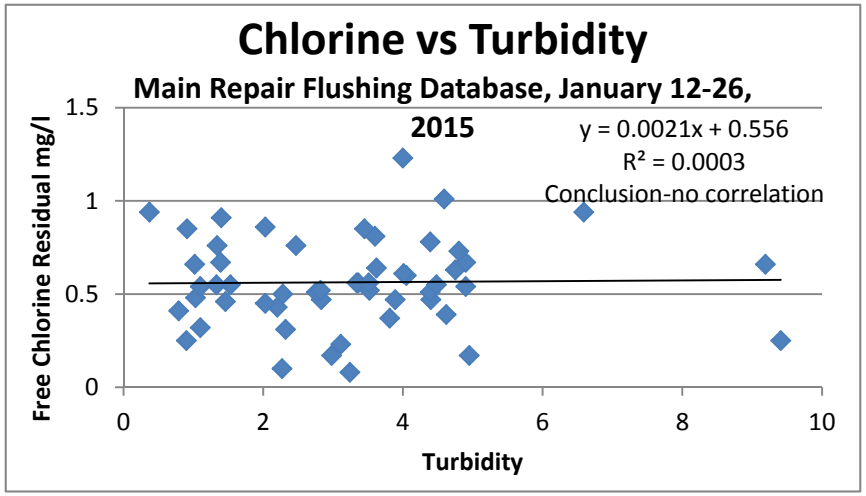

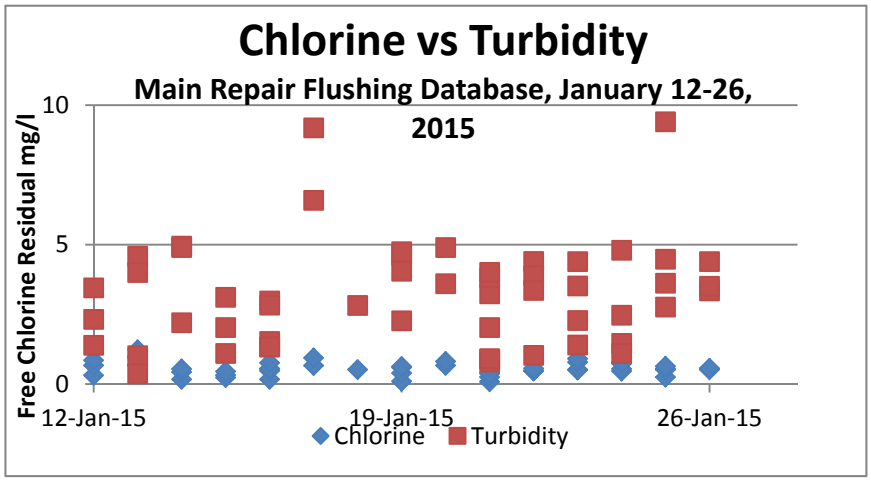

19-Jan-15		Beaverhill	4.05	0.6
21-Jan-15		Bushnell	4.01	0.61
19-Jan-15		Berwyn	4.75	0.63
25-Jan-15		Pembina	3.62	0.64
13-Jan-15		Fidler	1.02	0.66
17-Jan-15		St Annes	9.19	0.66
12-Jan-15		Grosvenor / Waverley	1.39	0.67
20-Jan-15		Whittier Ave W / Hoka	4.9	0.67
24-Jan-15		Wildwood C	4.8	0.73
16-Jan-15		Main	1.34	0.76
24-Jan-15		Thorn	2.47	0.76
23-Jan-15		Campbell	4.39	0.78
20-Jan-15		Bushnell	3.6	0.81
12-Jan-15		McCalman	3.45	0.85
21-Jan-15		Golf	0.91	0.85
21-Jan-15		Grant	2.03	0.86
23-Jan-15		Oxford	1.4	0.91
13-Jan-15		Eagleridge	0.37	0.94
17-Jan-15		Centennial	6.59	0.94
13-Jan-15		Prevette	4.59	1.01
13-Jan-15		Ashford	4	1.23
26-Jan-15		MAX	9.41	1.23
12-Jan-15		MIN	0.37	0.08
			9.19	1.23

AECOM

E6c Hach Certificate of Performance 6 Jan 2015

Certificate of Instrument Performance
Certificat de Conformité

Company Name / Nom de la Compagnie : CITY OF WINNIPEG- CORPORATE FINANCE

Account Number / No. de compte : [redacted]

Certification Number / Numéro du Certificat : 4106652

Part Number / No. de pièce : 5870000	rr POCKET CLRMTR II CHLORINE SYSTEM
Serial Number / No. de série : 14040E245171	
External Reference / Référence externe :	

Hach Sales & Service Canada Ltd. certifies that your instrument has been serviced, calibrated, verified with standards and now meets new product specifications.

Hach Sales & Service Canada Ltd. atteste que votre instrument a été entretenu, calibré et vérifié selon les normes en vigueur. Ses spécifications actuelles sont équivalentes à celles d'un produit neuf.

Certified by / Certifié par :
Demkiw, Michael

Certification Date / Date de certification :
06-JAN-15

Certificate of Instrument Performance
Certificat de Conformité

Company Name / Nom de la Compagnie : CITY OF WINNIPEG- CORPORATE FINANCE

Account Number / No. de compte : [redacted]

Certification Number / Numéro du Certificat : 4106652

Part Number / No. de pièce : 5870000	rr POCKET CLRMTR II CHLORINE SYSTEM
Serial Number / No. de série : 14040E244850.	
External Reference / Référence externe :	

Hach Sales & Service Canada Ltd. certifies that your instrument has been serviced, calibrated, verified with standards and now meets new product specifications.

Hach Sales & Service Canada Ltd. atteste que votre instrument a été entretenu, calibré et vérifié selon les normes en vigueur. Ses spécifications actuelles sont équivalentes à celles d'un produit neuf.

Certified by / Certifié par :
Demkiw, Michael

Certification Date / Date de certification :
06-JAN-15

Certificate of Instrument Performance
Certificat de Conformité

Company Name / Nom de la Compagnie : CITY OF WINNIPEG- CORPORATE FINANCE

Account Number / No. de compte : [redacted]

Certification Number / Numéro du Certificat : 4106652

Part Number / No. de pièce : 5870000	rr POCKET CLRMTR II CHLORINE SYSTEM
Serial Number / No. de série : 14040E244816.	
External Reference / Référence externe :	

Hach Sales & Service Canada Ltd. certifies that your instrument has been serviced, calibrated, verified with standards and now meets new product specifications.

Hach Sales & Service Canada Ltd. atteste que votre instrument a été entretenu, calibré et vérifié selon les normes en vigueur. Ses spécifications actuelles sont équivalentes à celles d'un produit neuf.

Certified by / Certifié par :
Demkiw, Michael

Certification Date / Date de certification :
06-JAN-15

Certificate of Instrument Performance
Certificat de Conformité

Company Name / Nom de la Compagnie : CITY OF WINNIPEG- CORPORATE FINANCE

Account Number / No. de compte : [redacted]

Certification Number / Numéro du Certificat : 4106652

Part Number / No. de pièce : 5870000	rr POCKET CLRMTR II CHLORINE SYSTEM
Serial Number / No. de série : 14040E244474.	
External Reference / Référence externe :	

Hach Sales & Service Canada Ltd. certifies that your instrument has been serviced, calibrated, verified with standards and now meets new product specifications.

Hach Sales & Service Canada Ltd. atteste que votre instrument a été entretenu, calibré et vérifié selon les normes en vigueur. Ses spécifications actuelles sont équivalentes à celles d'un produit neuf.

Certified by / Certifié par :
Demkiw, Michael

Certification Date / Date de certification :
06-JAN-15

Certificate of Instrument Performance
Certificat de Conformité

Company Name / Nom de la Compagnie : CITY OF WINNIPEG- CORPORATE FINANCE

Account Number / No. de compte : [redacted]

Certification Number / Numéro du Certificat : 4106652

Part Number / No. de pièce : 5870000	rr POCKET CLRMTR II CHLORINE SYSTEM
Serial Number / No. de série : 12070E203469	
External Reference / Référence externe :	

Hach Sales & Service Canada Ltd. certifies that your instrument has been serviced, calibrated, verified with standards and now meets new product specifications.

Hach Sales & Service Canada Ltd. atteste que votre instrument a été entretenu, calibré et vérifié selon les normes en vigueur. Ses spécifications actuelles sont équivalentes à celles d'un produit neuf.

Certified by / Certifié par :
Demkiw, Michael

Certification Date / Date de certification :
06-JAN-15

Certificate of Instrument Performance
Certificat de Conformité

Company Name / Nom de la Compagnie : CITY OF WINNIPEG- CORPORATE FINANCE

Account Number / No. de compte : [redacted]

Certification Number / Numéro du Certificat : 4106652

Part Number / No. de pièce : 5870000	rr POCKET CLRMTR II CHLORINE SYSTEM
Serial Number / No. de série : 12010E190610	
External Reference / Référence externe :	

Hach Sales & Service Canada Ltd. certifies that your instrument has been serviced, calibrated, verified with standards and now meets new product specifications.

Hach Sales & Service Canada Ltd. atteste que votre instrument a été entretenu, calibré et vérifié selon les normes en vigueur. Ses spécifications actuelles sont équivalentes à celles d'un produit neuf.

Certified by / Certifié par :
Demkiw, Michael

Certification Date / Date de certification :
06-JAN-15

Certificate of Instrument Performance
Certificat de Conformité

Company Name / Nom de la Compagnie : CITY OF WINNIPEG- CORPORATE FINANCE

Account Number / No. de compte : [redacted]

Certification Number / Numéro du Certificat : 4106652

Part Number / No. de pièce : 5870000	rr POCKET CLRMTR II CHLORINE SYSTEM
Serial Number / No. de série : 11030E170116	
External Reference / Référence externe :	

Hach Sales & Service Canada Ltd. certifies that your instrument has been serviced, calibrated, verified with standards and now meets new product specifications.

Hach Sales & Service Canada Ltd. atteste que votre instrument a été entretenu, calibré et vérifié selon les normes en vigueur. Ses spécifications actuelles sont équivalentes à celles d'un produit neuf.

Certified by / Certifié par :
Demkiw, Michael

Certification Date / Date de certification :
06-JAN-15

Certificate of Instrument Performance
Certificat de Conformité

Company Name / Nom de la Compagnie : CITY OF WINNIPEG- CORPORATE FINANCE

Account Number / No. de compte : [redacted]

Certification Number / Numéro du Certificat : 4106652

Part Number / No. de pièce : 5870000	rr POCKET CLRMTR II CHLORINE SYSTEM
Serial Number / No. de série : 11030E169133	
External Reference / Référence externe :	

Hach Sales & Service Canada Ltd. certifies that your instrument has been serviced, calibrated, verified with standards and now meets new product specifications.

Hach Sales & Service Canada Ltd. atteste que votre instrument a été entretenu, calibré et vérifié selon les normes en vigueur. Ses spécifications actuelles sont équivalentes à celles d'un produit neuf.

Certified by / Certifié par :
Demkiw, Michael

Certification Date / Date de certification :
06-JAN-15

Certificate of Instrument Performance
Certificat de Conformité

Company Name / Nom de la Compagnie : CITY OF WINNIPEG- CORPORATE FINANCE

Account Number / No. de compte : [redacted]

Certification Number / Numéro du Certificat : 4106652

Part Number / No. de pièce : 2100Q01	rr 2100Q PORTABLE TURBIDIMETER
Serial Number / No. de série : 14080C033096	
External Reference / Référence externe :	

Hach Sales & Service Canada Ltd. certifies that your instrument has been serviced, calibrated, verified with standards and now meets new product specifications.

Hach Sales & Service Canada Ltd. atteste que votre instrument a été entretenu, calibré et vérifié selon les normes en vigueur. Ses spécifications actuelles sont équivalentes à celles d'un produit neuf.

Certified by / Certifié par :
Demkiw, Michael

Certification Date / Date de certification :
06-JAN-15

Certificate of Instrument Performance
Certificat de Conformité

Company Name / Nom de la Compagnie : CITY OF WINNIPEG- CORPORATE FINANCE

Account Number / No. de compte : [redacted]

Certification Number / Numéro du Certificat : 4106652

Part Number / No. de pièce : 2100Q01	rr 2100Q PORTABLE TURBIDIMETER
Serial Number / No. de série : 14050C032929	
External Reference / Référence externe :	

Hach Sales & Service Canada Ltd. certifies that your instrument has been serviced, calibrated, verified with standards and now meets new product specifications.

Hach Sales & Service Canada Ltd. atteste que votre instrument a été entretenu, calibré et vérifié selon les normes en vigueur. Ses spécifications actuelles sont équivalentes à celles d'un produit neuf.

Certified by / Certifié par :
Demkiw, Michael

Certification Date / Date de certification :
06-JAN-15

Certificate of Instrument Performance
Certificat de Conformité

Company Name / Nom de la Compagnie : CITY OF WINNIPEG- CORPORATE FINANCE

Account Number / No. de compte : [redacted]

Certification Number / Numéro du Certificat : 4106652

Part Number / No. de pièce : 2100Q01	rr 2100Q PORTABLE TURBIDIMETER
Serial Number / No. de série : 14050C032854	
External Reference / Référence externe :	

Hach Sales & Service Canada Ltd. certifies that your instrument has been serviced, calibrated, verified with standards and now meets new product specifications.

Hach Sales & Service Canada Ltd. atteste que votre instrument a été entretenu, calibré et vérifié selon les normes en vigueur. Ses spécifications actuelles sont équivalentes à celles d'un produit neuf.

Certified by / Certifié par :
Demkiw, Michael

Certification Date / Date de certification :
06-JAN-15

Certificate of Instrument Performance
Certificat de Conformité

Company Name / Nom de la Compagnie : CITY OF WINNIPEG- CORPORATE FINANCE

Account Number / No. de compte : [redacted]

Certification Number / Numéro du Certificat : 4106652

Part Number / No. de pièce : 2100Q01	rr 2100Q PORTABLE TURBIDIMETER
Serial Number / No. de série : 14040C032167	
External Reference / Référence externe :	

Hach Sales & Service Canada Ltd. certifies that your instrument has been serviced, calibrated, verified with standards and now meets new product specifications.

Hach Sales & Service Canada Ltd. atteste que votre instrument a été entretenu, calibré et vérifié selon les normes en vigueur. Ses spécifications actuelles sont équivalentes à celles d'un produit neuf.

Certified by / Certifié par :
Demkiw, Michael

Certification Date / Date de certification :
06-JAN-15

Certificate of Instrument Performance
Certificat de Conformité

Company Name / Nom de la Compagnie : CITY OF WINNIPEG- CORPORATE FINANCE

Account Number / No. de compte : [redacted]

Certification Number / Numéro du Certificat : 4106652

Part Number / No. de pièce : 2100Q01	rr 2100Q PORTABLE TURBIDIMETER
Serial Number / No. de série : 14040C032150	
External Reference / Référence externe :	

Hach Sales & Service Canada Ltd. certifies that your instrument has been serviced, calibrated, verified with standards and now meets new product specifications.

Hach Sales & Service Canada Ltd. atteste que votre instrument a été entretenu, calibré et vérifié selon les normes en vigueur. Ses spécifications actuelles sont équivalentes à celles d'un produit neuf.

Certified by / Certifié par :
Demkiw, Michael

Certification Date / Date de certification :
06-JAN-15

Certificate of Instrument Performance
Certificat de Conformité

Company Name / Nom de la Compagnie : CITY OF WINNIPEG- CORPORATE FINANCE

Account Number / No. de compte : [redacted]

Certification Number / Numéro du Certificat : 4106652

Part Number / No. de pièce : 2100Q01	rr 2100Q PORTABLE TURBIDIMETER
Serial Number / No. de série : 13100C028684	
External Reference / Référence externe :	

Hach Sales & Service Canada Ltd. certifies that your instrument has been serviced, calibrated, verified with standards and now meets new product specifications.

Hach Sales & Service Canada Ltd. atteste que votre instrument a été entretenu, calibré et vérifié selon les normes en vigueur. Ses spécifications actuelles sont équivalentes à celles d'un produit neuf.

Certified by / Certifié par :
Demkiw, Michael

Certification Date / Date de certification :
06-JAN-15

Certificate of Instrument Performance
Certificat de Conformité

Company Name / Nom de la Compagnie : CITY OF WINNIPEG- CORPORATE FINANCE

Account Number / No. de compte : [redacted]

Certification Number / Numéro du Certificat : 4106652

Part Number / No. de pièce : 2100Q01	rr 2100Q PORTABLE TURBIDIMETER
Serial Number / No. de série : 12060C018564	
External Reference / Référence externe :	

Hach Sales & Service Canada Ltd. certifies that your instrument has been serviced, calibrated, verified with standards and now meets new product specifications.

Hach Sales & Service Canada Ltd. atteste que votre instrument a été entretenu, calibré et vérifié selon les normes en vigueur. Ses spécifications actuelles sont équivalentes à celles d'un produit neuf.

Certified by / Certifié par :
Demkiw, Michael

Certification Date / Date de certification :
06-JAN-15

Certificate of Instrument Performance
Certificat de Conformité

Company Name / Nom de la Compagnie : CITY OF WINNIPEG- CORPORATE FINANCE

Account Number / No. de compte : [redacted]

Certification Number / Numéro du Certificat : 4106652

Part Number / No. de pièce : 2100Q01	rr 2100Q PORTABLE TURBIDIMETER
Serial Number / No. de série : 12060C018563	
External Reference / Référence externe :	

Hach Sales & Service Canada Ltd. certifies that your instrument has been serviced, calibrated, verified with standards and now meets new product specifications.

Hach Sales & Service Canada Ltd. atteste que votre instrument a été entretenu, calibré et vérifié selon les normes en vigueur. Ses spécifications actuelles sont équivalentes à celles d'un produit neuf.

Certified by / Certifié par :
Demkiw, Michael

Certification Date / Date de certification :
06-JAN-15

Certificate of Instrument Performance
Certificat de Conformité

Company Name / Nom de la Compagnie : CITY OF WINNIPEG- CORPORATE FINANCE

Account Number / No. de compte : [redacted]

Certification Number / Numéro du Certificat : 4106652

Part Number / No. de pièce : 2100Q01	rr 2100Q PORTABLE TURBIDIMETER
Serial Number / No. de série : 11020C007217	
External Reference / Référence externe :	

Hach Sales & Service Canada Ltd. certifies that your instrument has been serviced, calibrated, verified with standards and now meets new product specifications.

Hach Sales & Service Canada Ltd. atteste que votre instrument a été entretenu, calibré et vérifié selon les normes en vigueur. Ses spécifications actuelles sont équivalentes à celles d'un produit neuf.

Certified by / Certifié par :
Demkiw, Michael

Certification Date / Date de certification :
06-JAN-15

Certificate of Instrument Performance
Certificat de Conformité

Company Name / Nom de la Compagnie : CITY OF WINNIPEG- CORPORATE FINANCE

Account Number / No. de compte : [redacted]

Certification Number / Numéro du Certificat : 4106652

Part Number / No. de pièce : 2100Q01	rr 2100Q PORTABLE TURBIDIMETER
Serial Number / No. de série : 11010C007121	
External Reference / Référence externe :	

Hach Sales & Service Canada Ltd. certifies that your instrument has been serviced, calibrated, verified with standards and now meets new product specifications.

Hach Sales & Service Canada Ltd. atteste que votre instrument a été entretenu, calibré et vérifié selon les normes en vigueur. Ses spécifications actuelles sont équivalentes à celles d'un produit neuf.

Certified by / Certifié par :
Demkiw, Michael

Certification Date / Date de certification :
06-JAN-15

E6d Jan 2015 Pumping Station Chlorine

This section has been intentionally removed.

E7 Distribution System Sampling Time Log for January 26 2015

Sample Name	Sample Number	Date Sampled	Chlorine, Free (mg/L)	Chlorine, Total (mg/L)	Temperature (ºC)	Turbidity (ntu)	E. Coli-QT (MPNU/100 mL)	Total Coliform-QT (MPNU/100 mL)	HPC (cfu/mL)	TimeSpled (hrs)	Sampler
NE01	421674	26-Jan-15	0.49	0.63	8.5	0.26	1	5	<10	8:42	
NE02	421675	26-Jan-15	0.76	0.99	6.0	0.25	<1	<1	<10	8:54	
NE05	421678	26-Jan-15	0.63	0.84	4.8	0.28	<1	<1	<10	9:10	
NE06	421679	26-Jan-15	0.95	1.18	6.0	0.31	<1	1	<10	9:20	
NE07	421680	26-Jan-15	0.96	1.18	5.0	0.19	9	53	<10	9:38	
NE09	421682	26-Jan-15	0.51	0.80	6.1	0.37	<1	<1	<10	9:55	
SE01	421693	26-Jan-15	1.12	1.32	3.1	0.24	<1	<1	<10	10:18	
SE02	421694	26-Jan-15	0.85	1.04	5.6	0.20	<1	<1	<10	10:37	
SE11	421703	26-Jan-15	0.72	0.90	7.1	0.23	<1	<1	<10	10:52	
SE13	421705	26-Jan-15	0.90	1.05	5.2	0.26	<1	<1	<10	11:12	
SW1	421718	26-Jan-15	0.73	0.98	4.7	0.28	<1	<1	<10	11:46	
SW0	421712	26-Jan-15	0.95	1.17	3.2	0.21	<1	<1	<10	12:20	
SW0	421713	26-Jan-15	0.74	0.99	5.7	0.17	1	1	<10	12:44	
SW1	421717	26-Jan-15	0.80	1.02	5.3	0.23	<1	<1	<10	12:56	
SW0	421714	26-Jan-15	0.62	0.82	6.4	0.40	<1	<1	<10	13:10	
SW1	421716	26-Jan-15	0.65	0.86	7.9	0.33	<1	<1	<10	13:34	
SE08	421700	26-Jan-15	0.58	0.90	6.1	0.23	<1	<1	<10	13:56	
SE07	421699	26-Jan-15	0.69	0.88	7.9	0.19	<1	<1	<10	14:15	
SE05	421697	26-Jan-15	0.78	1.04	4.8	0.17	<1	<1	<10	14:28	
SE04	421696	26-Jan-15	0.78	1.05	8.7	0.31	1	3	<10	14:45	
SE03	421695	26-Jan-15	0.76	0.91	8.3	0.25	1	4	<10	15:04	
NW0	421689	26-Jan-15	1.09	1.34	7.1	0.27	<1	<1	<10	8:58	
NW0	421684	26-Jan-15	0.88	1.02	6.5	0.18	<1	<1	<10	9:13	
NW0	421688	26-Jan-15	0.81	1.01	5.5	0.23	<1	<1	<10	9:32	
WC0	421724	26-Jan-15	0.77	0.95	7.4	0.24	<1	<1	<10	9:45	
WC0	421726	26-Jan-15	0.61	0.80	9.5	0.25	<1	<1	<10	10:00	
WC1	421731	26-Jan-15	0.74	0.88	7.8	1.02	<1	<1	<10	10:16	
WC0	421727	26-Jan-15	0.42	0.52	9.3	0.24	<1	<1	10	10:37	
WC0	421728	26-Jan-15	0.77	0.93	5.5	0.30	<1	<1	<10	10:55	
SW0	421707	26-Jan-15	0.70	0.96	6.8	0.35	<1	<1	<10	11:06	
SW0	421709	26-Jan-15	0.35	0.47	8.3	0.42	<1	<1	<10	11:30	
SW1	421722	26-Jan-15	0.80	0.92	7.7	0.26	<1	<1	<10	12:00	
SW1	421721	26-Jan-15	0.75	0.92	5.7	0.20	<1	<1	<10	12:35	

SW14_		421719	26-Jan-15	0.75	0.95	9.7	0.21	<1	<1	<10	12:45
SW04_		421710	26-Jan-15	0.79	0.95	6.5	0.18	<1	<1	<10	12:58
SW05_		421711	26-Jan-15	0.90	1.11	5.7	0.33	<1	<1	<10	13:08
WC08		421730	26-Jan-15	0.49	0.72	10.5	0.20	<1	<1	<10	13:22
WC11		421732	26-Jan-15	0.50	0.66	7.7	0.31	<1	<1	<10	13:43
WC01		421723	26-Jan-15	0.95	1.10	2.7	0.18	<1	<1	<10	13:55
WC12		421733	26-Jan-15	0.81	0.93	11.1	0.19	<1	<1	<10	14:25
NW03		421686	26-Jan-15	0.52	0.69	6.2	0.35	<1	<1	<10	14:46
NW09		421692	26-Jan-15	0.87	1.06	6.7	0.18	<1	<1	<10	14:57

E8 Pumping Station Maintenance Records

E8a Hurst Work Orders since 2013

This section has been intentionally removed.

E8b MacLean Work Orders since 2013

This section has been intentionally removed.

E9 Rainfall Reports

E9a 13-09-28 Rainfall Report

Water and Waste Department ♦ Service des Eaux et des Déchets

RAINFALL REPORT

September 28, 2013 Rainstorm

Prepared by:
Sam Brask, C.E.T. – Land Drainage and Flood Protection Technologist II

This report is distributed to various recipients at the following:

City of Winnipeg, Water and Waste Department
City of Winnipeg, Planning, Property and Development Department
City of Winnipeg CAO office
City of Winnipeg, Insect Control Branch
Manitoba Water Stewardship
Environment Canada
Manitoba Organization of Disc Sports
Fort Whyte Alive Centre
Buhler Recreational Park
Lakewood Systems Ltd
Ducks Unlimited Canada
Canadian Wheat Board
AECOM

The City of Winnipeg does not guarantee the accuracy of the data contained herein. Any use or distribution of the data, without the permission of the City of Winnipeg, is strictly prohibited.

Winnipeg

Water and Waste Department

RAINFALL ACCUMULATION LOG - SUMMER 2013

Accumulations in millimeters

NA............................ Not Available
NO............................ Not Operational
+................................ Incomplete raingauge data

Rain Gauge Station Locations

PR - Parks and Rec Building
KE - King Edward Lift Station
AW - Arthur E. Wright School
NE - North End Treatment Plant
FS - Fire Station No. 24
WW - Westwood Lift Station
JW - Jameswood School
MC - McPhillips Pumping Statio
SB - St. Boniface Shops
BW - Bernie Wolfe School
PM - Perimeter Lift Station
CL - Clarence Lift Station
WN - Windsor Park Generator
FR - Fort Richmond Collegiate
IL - Island Lakes School
EN - Ecole Noel Ritchot
AD - Arthur Day School
SE - South End Pollution Control Center
EG - Ecole Guyot
CE - Chancellor Elementary School
HI - Henry G. Izatt Middle School
KP - Kilcona Park
BP - Buhler Recreational Park
BL - Brady Road Landfill
LM - Little Mountain Park
FW - Fort Whyte Alive
OP - Optimist Park
RB - River Bend Lift Station
HD - Headingley (CWB)
OB - Oak Bluff
PAP - Pan Am Pool
ML - MacLean Pumping Station
ET - Ecole Tuxedo Park
DW - Deacon Water Treatment Plant
WE - West End Pollution Control Center
OB2 - Oak Bluff 2
UW - University of Winnipeg (Lockhart Hall)

RAINSTORM DATE	APPROXIMATE RAINSTORM START TIME	APPROXIMATE RAINSTORM STOP TIME	TELEMETRY RAINFALL MONITORING STATIONS																												WEATHERBUG WEATHER MONITORING STATIONS									AVERAGE
			PR	KE	AW	NE	FS	WW	MC	SB	BW	PM	CL	WN	FR	IL	EN	AD	SE	EG	CE	HI	KP	BP	BL	LM	FW	OP	RB	HD	OB	PAP	ML	ET	DW	WE	OB2	UW	
May 18-19, 2013	05 18 13 8:30 AM	05 19 13 3:00 AM	6.8	4.3	4.0	4.8	NA	4.1	5.1	NA	6.9	8.6	NA	NA	3.6	3.8	4.6	6.1	3.6	3.8	5.0	4.6	5.3	5.3	5.8	3.6	3.6	5.3	5.6	4.8	4.6	NA	NA	3.8	5.1	3.8	NA	NA	**4.9**
May 19-21, 2013	05 19 13 1:30 PM	05 21 13 7:00 AM	19.6	13.0	15.5	20.8	NA	17.8	22.9	NA	21.8	23.4	NA	NA	40.1	24.2	52.1	18.3	38.1	25.9	27.2	25.4	24.1	20.8	30.0	15.0	30.2	24.6	18.8	16.3	52.3	NA	NA	26.9	33.8	20.1	NA	NA	**25.7**
May 28, 2013	10:00 AM	2:00 PM	4.4	2.3	3.1	4.3	NA	1.8	4.1	NA	4.1	1.3	5.2	5.0	5.8	4.1	5.3	3.6	4.1	4.3	5.1	3.8	NA	2.8	6.1	1.1	4.6	2.5	4.0	NA	2.5	NA	NA	3.8	3.3	2.0	NA	NA	**3.7**
May 30-31, 2013	05 30 13 10:00AM	05 31 13 8:00PM	51.2	41.4	42.2	46.7	NA	38.9	47.0	46.0	36.8	37.9	41.0	38.2	52.8	30.2	57.2	27.9	50.3	35.6	38.1	35.3	35.8	32.8	43.4	35.1	42.2	46.7	42.4	34.8	68.1	NA	NA	46.0	42.7	32.3	NA	NA	**41.8**
June 7, 2013	4:00 AM	8:00 PM	0.8	1.0	0.8	0.4	NA	8.6	0.5	0.8	0.2	4.4	2.4	NA	7.2	2.0	7.9	NA	3.1	1.4	6.4	3.7	NA	0.3	3.8	3.8	4.0	8.9	1.2	2.0	2.5	NA	NA	1.3	NA	3.6	NA	NA	**3.1**
June 10, 2013	10:00 AM	7:00 PM	5.6	5.1	3.6	2.3	NA	0.0	7.9	7.4	4.6	0.0	0.0	4.2	0.0	0.0	0.3	2.5	0.0	0.8	0.0	0.3	0.8	8.6	0.3	3.1	0.0	0.0	0.2	NA	0.0	0.0	NA	0.0	14.2	6.6	NA	NA	**2.5**
June 20, 2013	6:00 PM	10:00 PM	6.4	10.4	1.5	0.8	NA	34.0	NA	0.8	NA	1.0	33.8	3.4	6.6	5.3	9.4	3.8	3.3	3.6	9.1	31.5	1.0	1.0	6.1	2.6	50.3	15.4	NA	NA	1.3	54.1	NA	55.1	0.8	13.2	2.5	9.6	**13.1**
June 23-24, 2013	06 23 13 12:00 PM	06 24 13 4:00 AM	27.8	24.8	20.3	24.6	NA	24.8	18.0	28.4	27.2	NA	23.0	24.6	22.9	23.4	24.6	NA	18.5	20.3	23.4	22.6	24.0	19.6	22.9	25.0	25.4	27.8	24.2	NA	22.6	27.2	NA	25.2	14.5	37.3	18.6	NA	**24.0**
June 25-26, 2013	06 25 13 10:00 PM	06 26 13 4:00 AM	19.0	18.2	10.4	10.9	NA	24.8	13.0	26.0	26.8	NA	27.2	26.6	14.0	30.0	15.0	17.4	11.4	27.2	16.8	16.3	17.8	13.7	21.6	17.4	23.1	16.6	14.8	NO	19.8	25.9	NA	18.0	28.2	44.2	15.7	20.8	**20.4**
June 28, 2013	10:00 AM	9:00 PM	0.4	2.2	1.8	0.0	NA	4.2	3.3	0.4	1.0	2.6	7.8	0.0	2.5	0.0	1.8	0.2	0.0	0.0	2.8	4.3	0.4	0.0	18.5	3.2	4.8	1.0	9.4	NO	0.5	5.8	NA	5.3	0.0	2.0	1.0	1.2	**2.8**
July 9-10, 2013	07 09 13 7:00 PM	07 10 13 3:00 AM	3.4	6.8	1.8	1.8	NA	7.8	3.3	4.0	2.0	2.0	8.2	2.6	10.4	3.1	8.1	1.6	3.8	3.6	10.4	9.9	2.0	1.8	8.6	6.0	8.4	11.6	9.2	NO	2.0	4.1	NA	11.7	2.0	NA	4.6	4.4	**5.4**
July 18-19, 2013	07 18 13 8:00 PM	07 19 13 1:00 AM	5.4	15.0	8.6	11.2	NA	6.0	5.3	11.4	10.0	4.0	12.6	NA	5.6	9.7	5.3	3.8	4.1	8.4	6.9	8.1	13.8	10.2	5.6	12.4	NA	8.8	11.6	NO	6.6	11.9	NA	9.9	13.5	NA	4.6	22.0	**8.8**
July 21-22, 2013	07 21 13 4:00 PM	07 22 13 12:00 AM	32.0	35.0	26.2	30.7	NA	32.0	20.8	23.2	26.0	9.0	19.2	19.0	15.2	14.0	10.9	19.8	12.7	11.2	14.0	14.0	21.8	13.2	8.6	35.8	NA	35.0	24.4	NO	9.9	18.8	NA	22.1	15.5	NA	12.0	25.2	**20.3**
July 25, 2013	5:00 AM	10:00 PM	17.2	15.8	13.0	13.0	NA	6.0	14.7	13.4	8.2	7.0	9.0	7.8	12.7	6.4	11.4	8.6	8.9	6.9	8.1	5.8	19.2	6.4	13.0	19.8	NA	14.0	11.2	NO	14.2	6.9	NA	6.4	8.6	NA	11.7	14.6	**10.8**
July 29-30, 2013	07 29 13 10:00 PM	07 30 13 6:00 AM	4.5	4.0	7.4	4.8	NA	5.2	7.6	4.6	3.6	NA	1.6	4.8	0.8	1.8	0.8	2.8	1.3	2.5	0.8	1.3	4.2	1.5	1.0	6.0	NA	3.4	11.4	NO	1.8	3.3	4.6	5.8	0.5	NA	1.8	4.4	**3.6**
August 4-5, 2013	08 04 13 2:00 PM	08 05 13 4:00 AM	5.6	6.2	6.6	5.1	NA	5.8	5.6	5.6	5.4	8.0	7.6	NA	8.4	5.8	6.4	4.6	6.9	6.1	5.6	5.6	6.8	3.8	7.9	6.4	6.4	6.4	7.0	NO	5.6	8.1	5.6	6.4	8.9	NA	6.6	5.4	**6.3**
August 10-11, 2013	08 10 13 4:00 PM	08 11 13 4:00 AM	3.2	5.6	3.8	2.8	NA	4.6	4.1	3.4	3.4	5.8	3.8	NA	2.3	1.0	1.8	3.6	2.0	1.5	2.5	3.0	3.8	2.0	3.6	6.4	3.3	7.2	4.4	NO	4.6	3.6	2.3	4.1	2.5	3.0	5.3	3.6	**3.5**
August 18, 2013	08 18 13 9:00 AM	08 18 13 12:00 PM	33.3	38.2	45.2	36.6	NA	30.8	26.4	28.8	21.2	NA	21.8	18.2	12.2	12.2	12.2	12.2	10.7	15.5	15.8	21.1	25.6	9.1	19.8	67.0	27.9	26.0	30.8	NO	28.5	25.7	21.6	29.0	16.5	36.6	26.7	38.0	**25.0**
################	2:00 AM	6:00 PM	20.32	26	16.76	18.79	21.84	26	22.86		26		24.8		17.53	23.11	2.29	26.6	14.73	18.28	18.03	18.03	29.2	19.55	20.83	26.6	17.01	26.6			16	19.81	23.62		31.24	17.02	20.06	28.8	**21.1**
Total			**266.9**	**275.3**	**232.4**	**240.4**	**21.8**	**283.1**	**232.4**	**204.2**	**235.2**	**114.9**	**249.0**	**154.4**	**240.6**	**199.9**	**237.3**	**163.4**	**197.3**	**196.7**	**215.9**	**234.6**	**235.6**	**172.4**	**247.4**	**296.2**	**251.1**	**287.9**	**230.6**	**57.9**	**263.4**	**215.1**	**57.7**	**280.7**	**241.8**	**221.8**	**131.1**	**178.0**	**246.7**

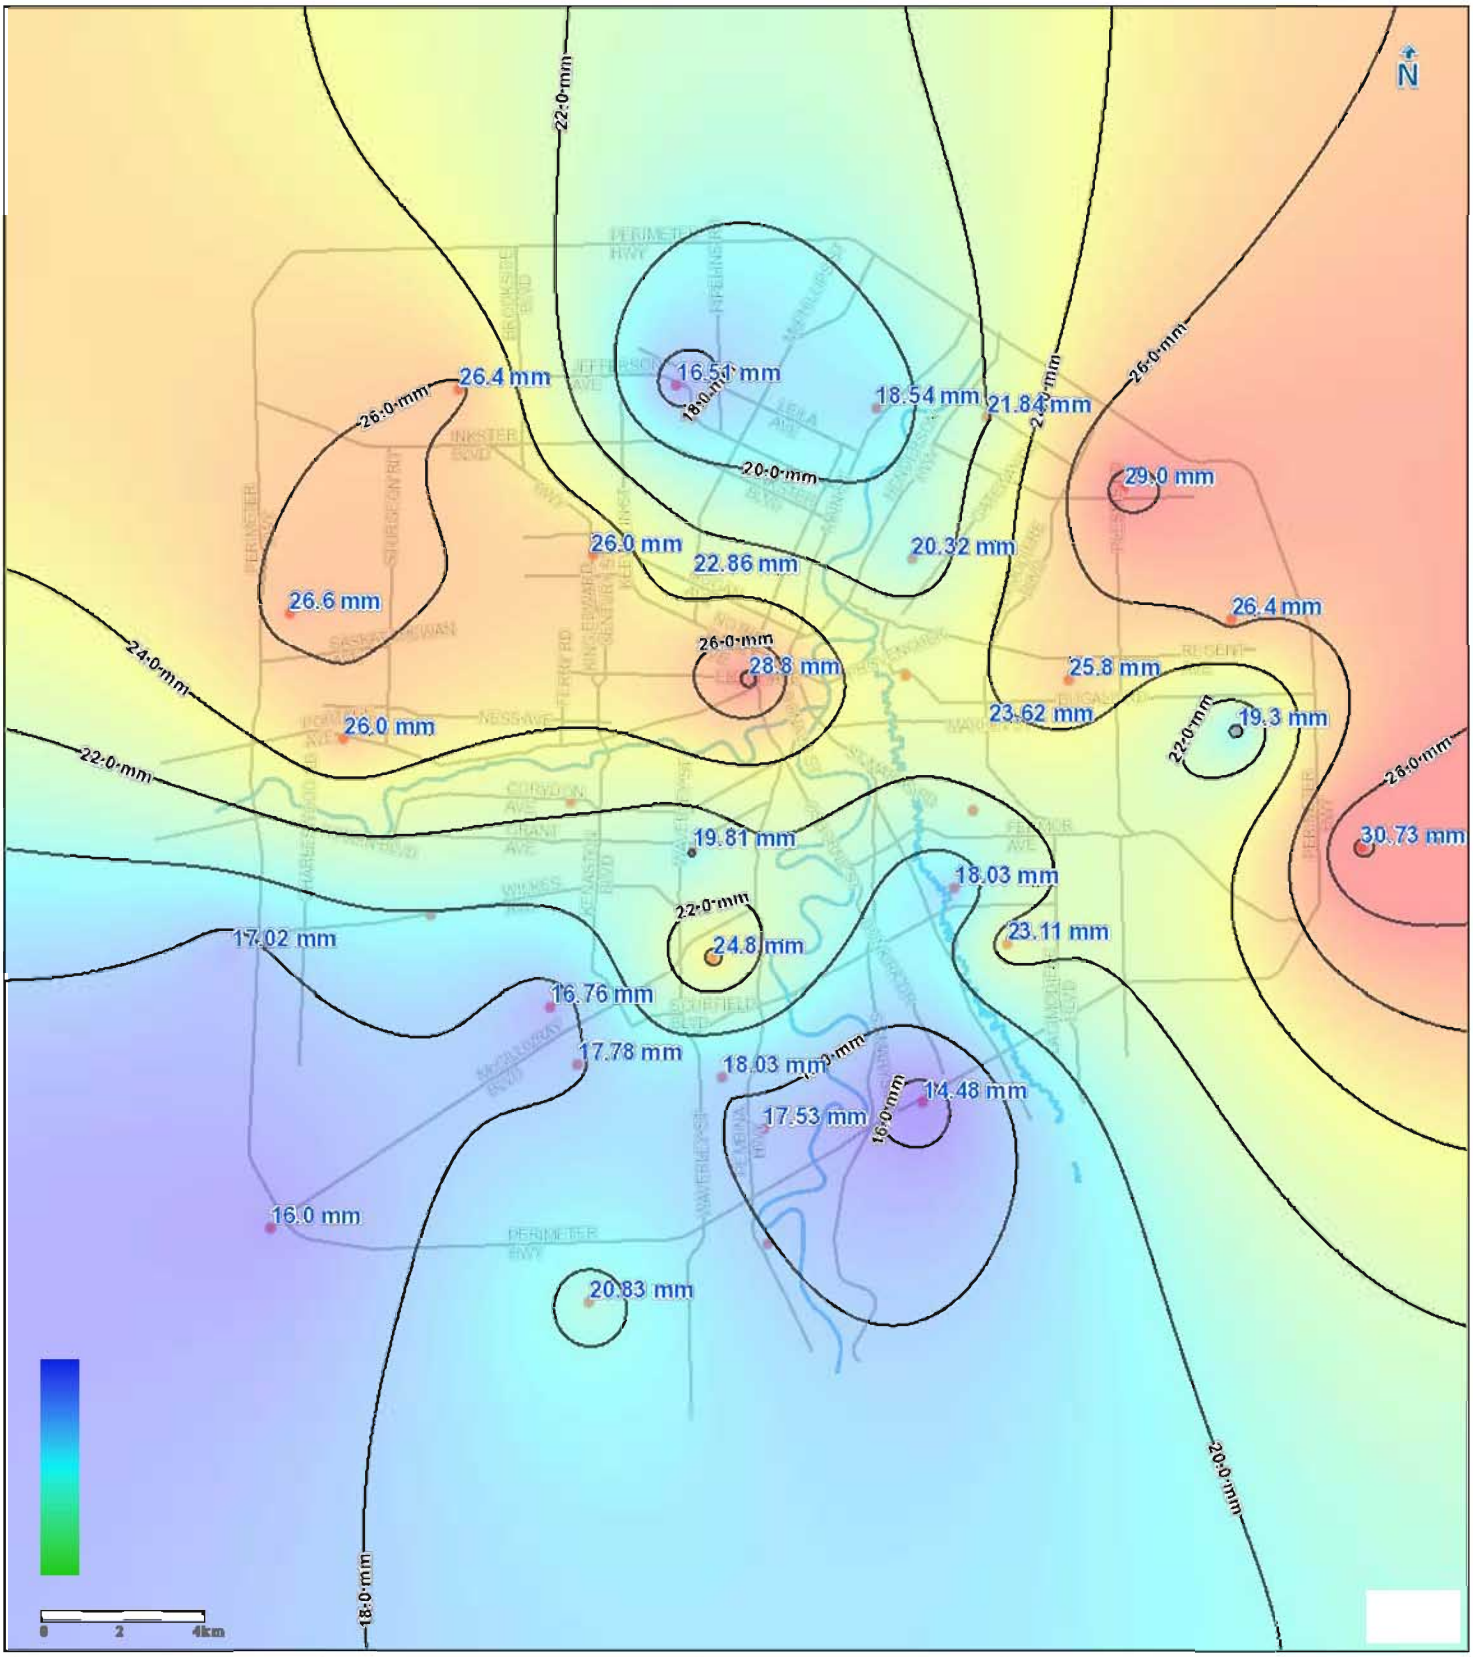

Rainfall Gauge Station Location

—8mm— Isohyetal Line

3.55mm Accumulation

ALL MEASUREMENTS ARE METRIC

IT IS HEREBY EXPRESSLY UNDERSTOOD that any calculation, or information provided to private property owners, their agents and contractors with respect to the information provided shall be accepted by such persons at their own risk, and the CITY shall assume no responsibility for the information contained therein. The records of the CITY will be supplied on the basis that they are the best knowledge of the CITY and that persons requesting such information must interpret the same for their own needs and/or requirements.

Winnipeg

THE CITY OF WINNIPEG

Water and Waste Department

Monday, September 30, 2013

Rainfall Accumulation with Isohyetal for 2013-09-28 00:00 to 2013-09-28 23:59

Intensity Duration Frequency Analysis

OPT (Optimist Park)

Rainfall Period: 2013-09-28 00:00 to 2013-09-28 23:55
Historical Data: 5-min to 12 hour duration based on MacLaren Drainage Criteria Manual
24 hour duration based on AECOM (2012)

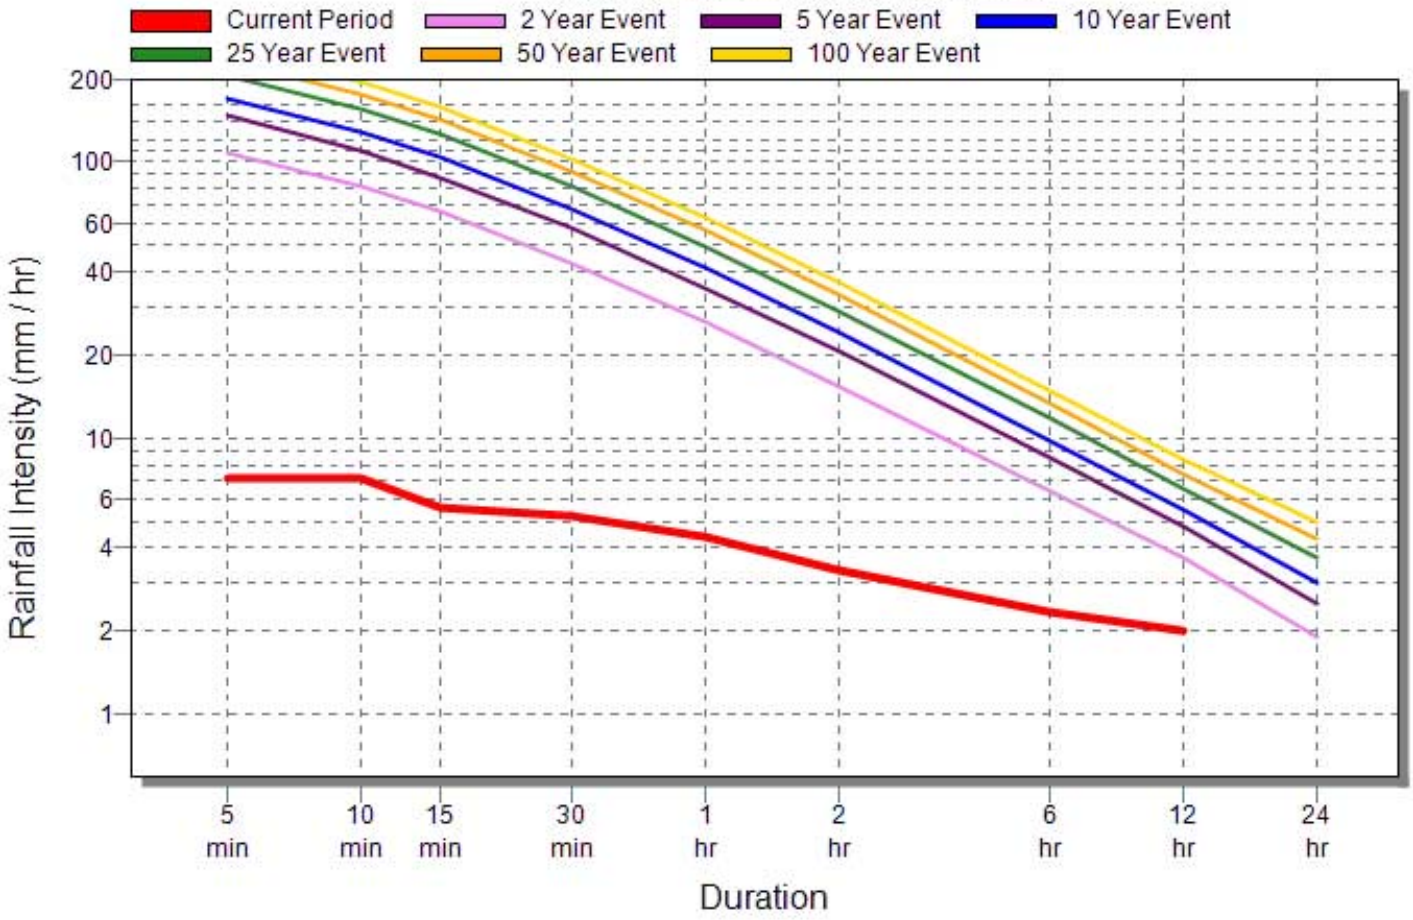

Total Rainfall During Period	26.6 mm
Hours in Period	23.9 hrs

	5 min	10 min	15 min	30 min	1 hr	2 hrs	6 hrs	12 hrs	24 hrs
Current Period	7.2	7.2	5.6	5.2	4.4	3.3	2.3	2.0	0.0
2 Year Event	108.8	81.5	65.9	42.8	26.2	15.4	6.4	3.7	1.9
5 Year Event	146.4	109.5	88.3	57.3	34.9	20.5	8.5	4.8	2.5
10 Year Event	168.8	128.0	103.9	67.8	41.3	24.1	9.8	5.5	3.0
25 Year Event	204.0	154.5	125.4	81.7	49.7	29.0	11.8	6.6	3.7
50 Year Event	231.2	175.1	142.0	92.5	56.3	32.8	13.3	7.4	4.3
100 Year Event	258.4	195.6	158.6	103.2	62.7	36.5	14.8	8.3	5.0

FlowWorks - www.flowworks.com

OPT (Optimist Park)

Start Date: Sep 28, 2013 02:50:34
End Date: Sep 28, 2013 18:35:27
Data: Rainfall (mm)

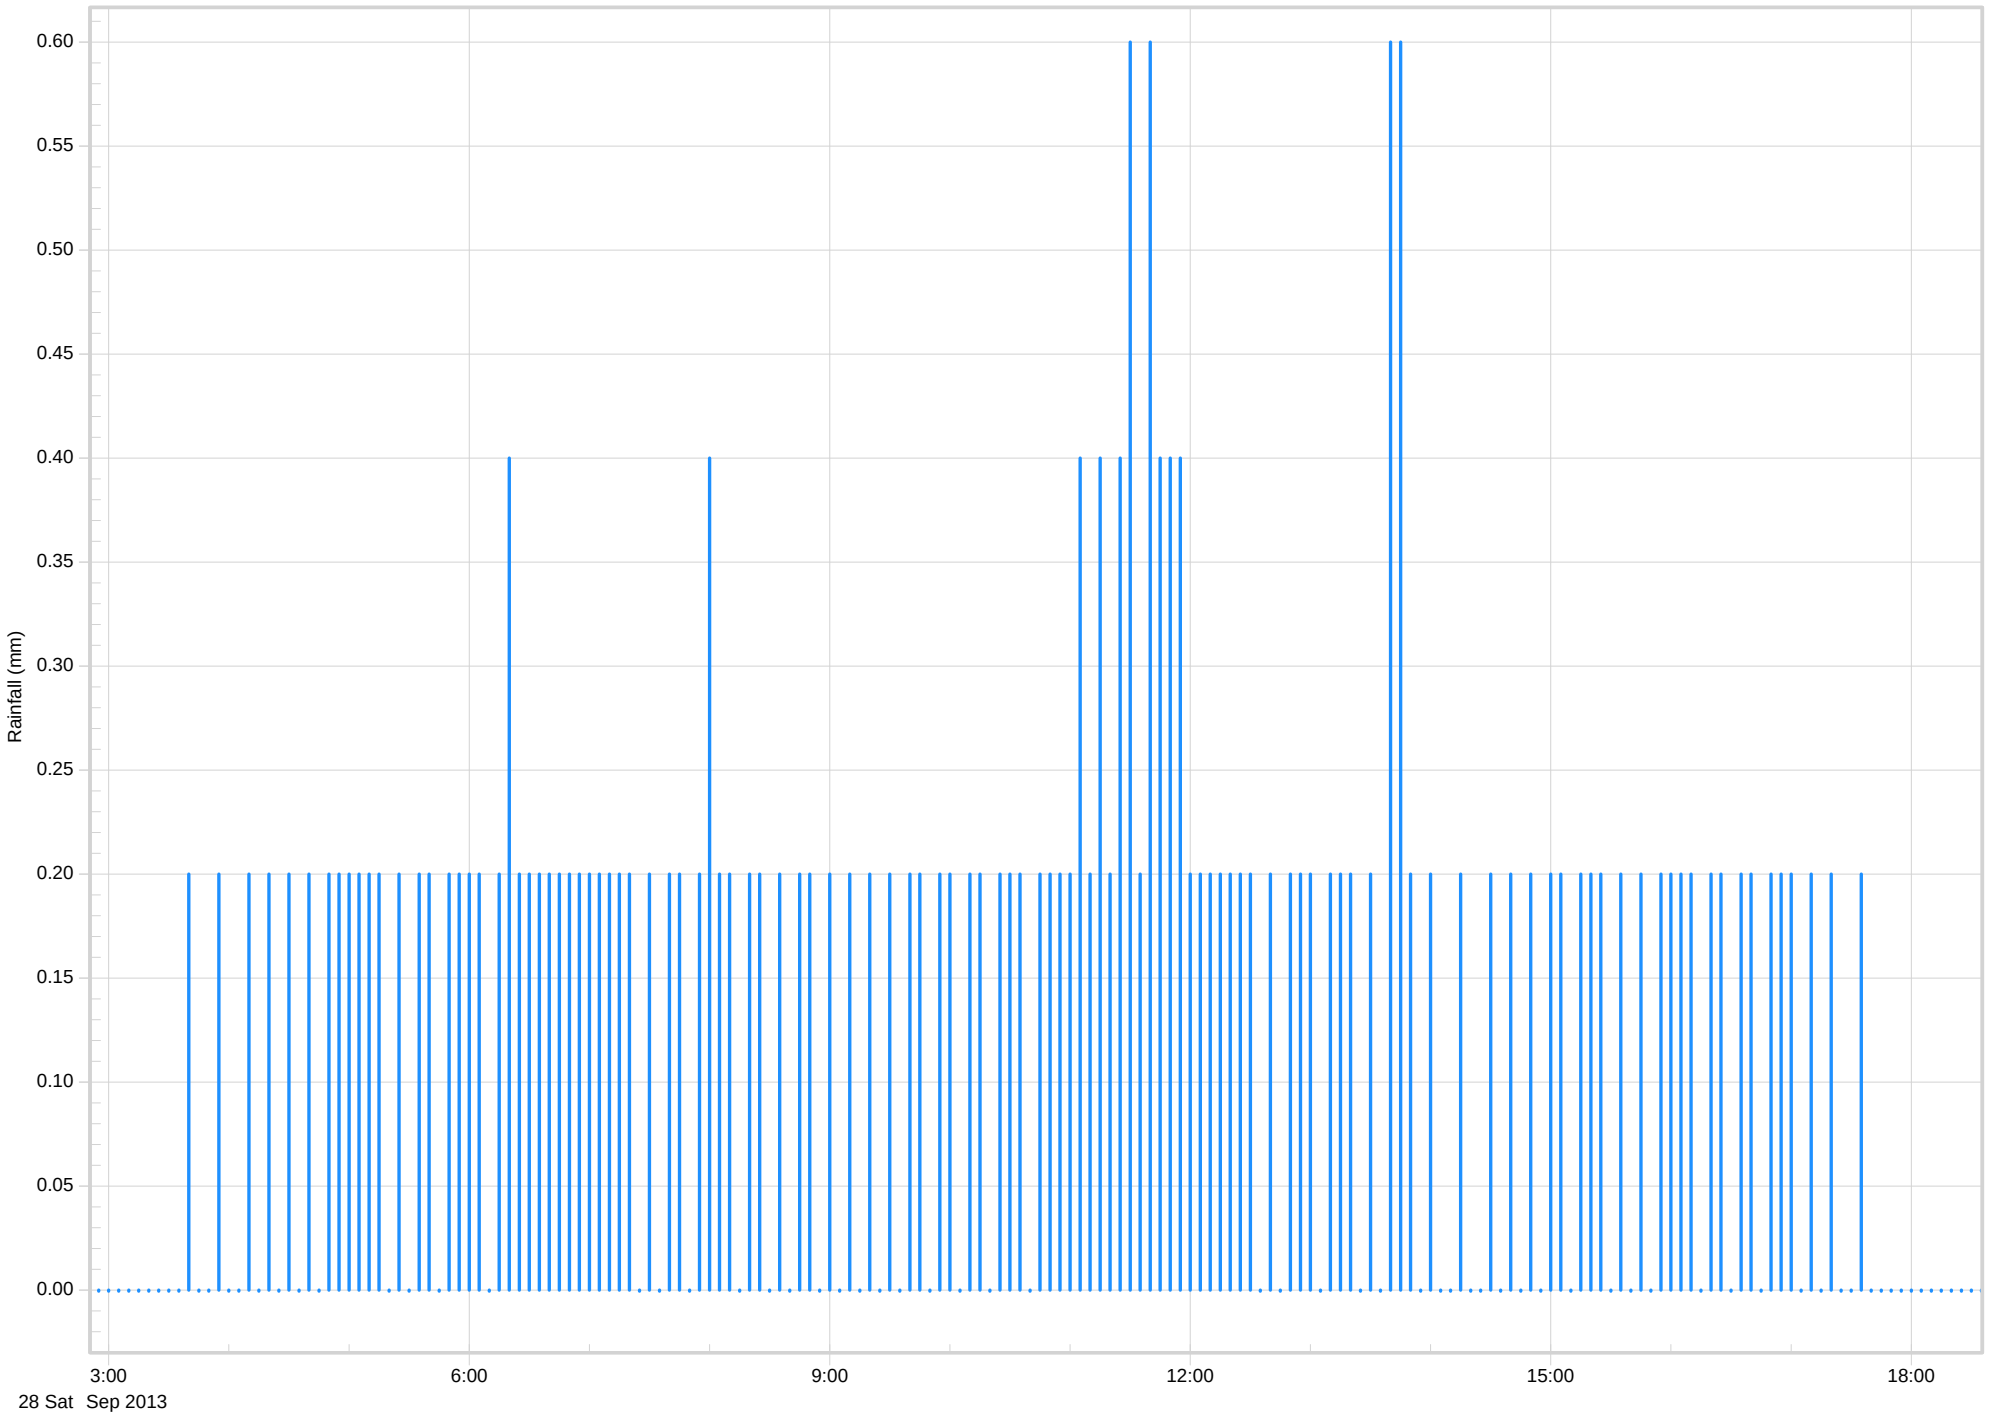

CITY OF WINNIPEG
WATER AND WASTE DEPARTMENT
STORM LOG SUMMER 2013

DATE OF STORM	MAXIMUM ACCUMULATION (mm)	STATION WHERE MAX. OCCURRED	MINIMUM ACCUMULATION (mm)	STATION WHERE MIN. OCCURRED	MAXIMUM STATION RETURN PERIOD (30 min. interval)	BASEMENT FLOODING
May 18 - 19, 2013	8.6	Perimeter Lift Station	3.6	Fort Richmond Collegiate	Less than 1 year	No
May 19 - 21, 2013	52.3	Oak Bluff	13.0	Parklane Lift Station	Less than 1 year	No
May 28, 2013	6.1	Brady Road Landfill	1.1	Little Mountain Park	Less than 1 year	No
May 30-31, 2013	68.1	Oak Bluff	27.7	Arthur Day School	Less than 1 year	No
June 7, 2013	8.9	Optimist Park	0.2	Bernie Wolfe School	Less than 1 year	No
June 10, 2013	14.2	Deacon Water Treatment Plant	0.2	River Bend LS	Almost 1 year	No
June 20, 2013	55.1	Ecole Tuxedo Park	0.8	North End Treatment Plant	100 year	Yes
June 23-24, 2013	37.3	West End Pollution Centre	14.5	Deacon Water Treatment Plant	2 year	No
June 25-26, 2013	44.2	West End Pollution Centre	10.4	Arthur E. Wright School	10 year	Yes
June 28, 2013	18.5	Brady Road Landfill	0.2	Arthur Day School	Less than 1 year	No
July 9-10, 2013	11.7	Ecole Tuxedo Park	1.6	Arthur Day School	Less than 1 year	No
July 18-19, 2013	22.0	University of Winnipeg	3.8	Arthur Day School	2 year	No
July 21-22, 2013	35.8	Little Mountain Park	8.6	Brady Road Landfill	1 year	No
July 25, 2013	19.8	Little Mountain Park	5.8	Henry G. Izatt School	1 Year	No
July 29-30, 2013	11.4	River Bend Lift Station	0.5	Deacon Water Treatment Plant	Less than 1 year	No
August 4-5, 2013	8.9	Deacon Water Treatment Plant	3.8	Buhler Recreational Park	Less than 1 year	No
August 10-11, 2013	7.2	Optimist Park	1.0	Island Lakes School	Less than 1 year	No
August 18, 2013	67.0	Little Mountain Park	9.1	Buhler Recreational Park	Between 25 and 50 years	Yes

Day on which the storm event begins. (6 hour separation between individual events)

Maximum total rain at any of the telemetry stations.

Station with maximum total rainfall.

Minimum total rainfall at any of the telemetry stations.

Station with minimum total rainfall.

Greatest return period over the 30 minute duration. (Location is not necessarily the same as the maximum accumulation)

If basement flood--ing has been reported to WWD or District offices.

CITY OF WINNIPEG
WATER AND WASTE DEPARTMENT
STORM LOG SUMMER 2013

DATE OF STORM	MAXIMUM ACCUMULATION (mm)	STATION WHERE MAX. OCCURRED	MINIMUM ACCUMULATION (mm)	STATION WHERE MIN. OCCURRED	MAXIMUM STATION RETURN PERIOD (30 min. interval)	BASEMENT FLOODING
September 28, 2013	31.2	Deacon Water Treatment Plant	2.3	Ecole Noel Ritchot	Less than 1 year	Yes

Day on which the storm event begins. (6 hour separation between individual events)

Maximum total rain at any of the telemetry stations.

Station with maximum total rainfall.

Minimum total rainfall at any of the telemetry stations.

Station with minimum total rainfall.

Greatest return period over the 30 minute duration. (Location if not same as maximum accumulation)

If basement flood--ing has been reported to WWD or District offices.

E9b 14-05-12 Rainfall Report

Water and Waste Department ♦ Service des Eaux et des Déchets

RAINFALL REPORT

May 12, 2014 Rainstorm

Prepared by:
Shenaz Ahmed. – Land Drainage and Flood Protection Technical Assistant

(Note: There is an error creating the isohyetal lines on the map that we are currently working on, this should be resolved shortly. The map in this report displays total accumulation only.)

This report is distributed to various recipients at the following:

City of Winnipeg, Water and Waste Department
City of Winnipeg, Planning, Property and Development Department
City of Winnipeg CAO office
City of Winnipeg, Insect Control Branch
Manitoba Water Stewardship
Environment Canada
Manitoba Organization of Disc Sports
Fort Whyte Alive Centre
Buhler Recreational Park
Lakewood Systems Ltd
Ducks Unlimited Canada
Canadian Wheat Board
AECOM

The City of Winnipeg does not guarantee the accuracy of the data contained herein. Any use or distribution of the data, without the permission of the City of Winnipeg, is strictly prohibited.

Winnipeg

Water and Waste Department
RAINFALL ACCUMULATION LOG - SUMMER 2014

Accumulations in millimeters

NA..... Not Available
NO..... Not Operational
+..... Incomplete raingauge data

Rain Gauge Station Locations

PR - Parks and Rec Building
KE - King Edward Lift Station
AW - Arthur E. Wright School
NE - North End Treatment Plant
FS - Fire Station No. 24
WW - Westwood Lift Station
JW - Jameswood School
MC - McPhillips Pumping Statio
SB - St. Boniface Shops
BW - Bernie Wolfe School
PM - Perimeter Lift Station
CL - Clarence Lift Station
WN - Windsor Park Library
FR - Fort Richmond Collegiate
IL - Island Lakes School
EN - Ecole Noel Ritchot
AD - Arthur Day School
SE - South End Pollution Control Center
EG - Ecole Guyot
CE - Chancellor Elementary School
HI - Henry G. Izatt Middle School
KP - Kilcona Park
BP - Buhler Recreational Park
BL - Brady Road Landfill
LM - Little Mountain Park
FW - Fort Whyte Alive
OP - Optimist Park
RB - River Bend Lift Station
HD - Headingley (CWB)
OB - Oak Bluff
PAP - Pan Am Pool
ML - MacLean Pumping Station
ET - Ecole Tuxedo Park
DW - Deacon Water Treatment Plant
WE - West End Pollution Control Center
OB2 - Oak Bluff 2
UW - University of Winnipeg (Lockhart Hall)

RAINSTORM DATE	APPROXIMATE RAINSTORM START TIME	APPROXIMATE RAINSTORM STOP TIME	RAINFALL MONITORING STATIONS																																				AVERAGE
			WN	AD A	W	BP	BW	CE	MC	NE	CL	EG	ET	FR	FW	HI	IL	KE	KP	LM	OB	OB2	OP	UW	WW	SB	WE	FS	BL	SE	DW	PAP	ML	EN	PR				
April 23-25 2014	4/23/2014 20:00	4/25/2014 12:00	17.3	18.2	17.2	12.4	19.8				19.8	14.8	18.0				10.8	19.8	17.6	16.6		15.8	19.8	19.6	18.2	9.8	8.5		19.0	18.5	19.3	21.8	20.0	19.0	15.8				**17.1**
April 28, 2014	3:00 AM	21:00	9.9	9.0	9.4		9.6				11.2							11.0	8.4	10.2		12.7	10.4	11.2	11.2	4.8	6.8		12.5	5.4	11.0	12.8	8.5	11.3	6.8				**9.7**
May 7, 2014	15:00	21:00	2.3	4.4	5.0	2.5	3.8	2.3			3.0	2.0	3.5	2.3	1.0	3.0	2.3	5.8	4.4	6.4		2.8	5.2	5.0	5.0	2.3	4.3		2.0	0.8	3.3	3.0	2.5	2.0	2.8				**3.3**
May 12, 2014	8:30	9:00 PM	4.8	8.0	3.3	4.8	7.8	4.0			4.8	4.0	3.0	4.5	1.5	3.0	6.0	4.0	3.4	3.6			2.4	6.4	1.6	2.8	0.5		1.5	0.9	14.5	4.5	4.5	4.3	4.3				**4.2**
Total			**34.3**	**39.6**	**34.9**	**19.7**	**41.0**	**6.3**	**0.0**	**0.0**	**38.8**	**20.8**	**24.5**	**6.8**	**2.5**	**6.0**	**19.1**	**40.6**	**33.8**	**36.8**	**0.0**	**31.3**	**37.8**	**42.2**	**36.0**	**19.6**	**20.0**	**0.0**	**35.0**	**25.6**	**48.0**	**42.1**	**35.5**	**36.6**	**29.6**	**0.0**	**0.0**	**0.0**	**34.3**

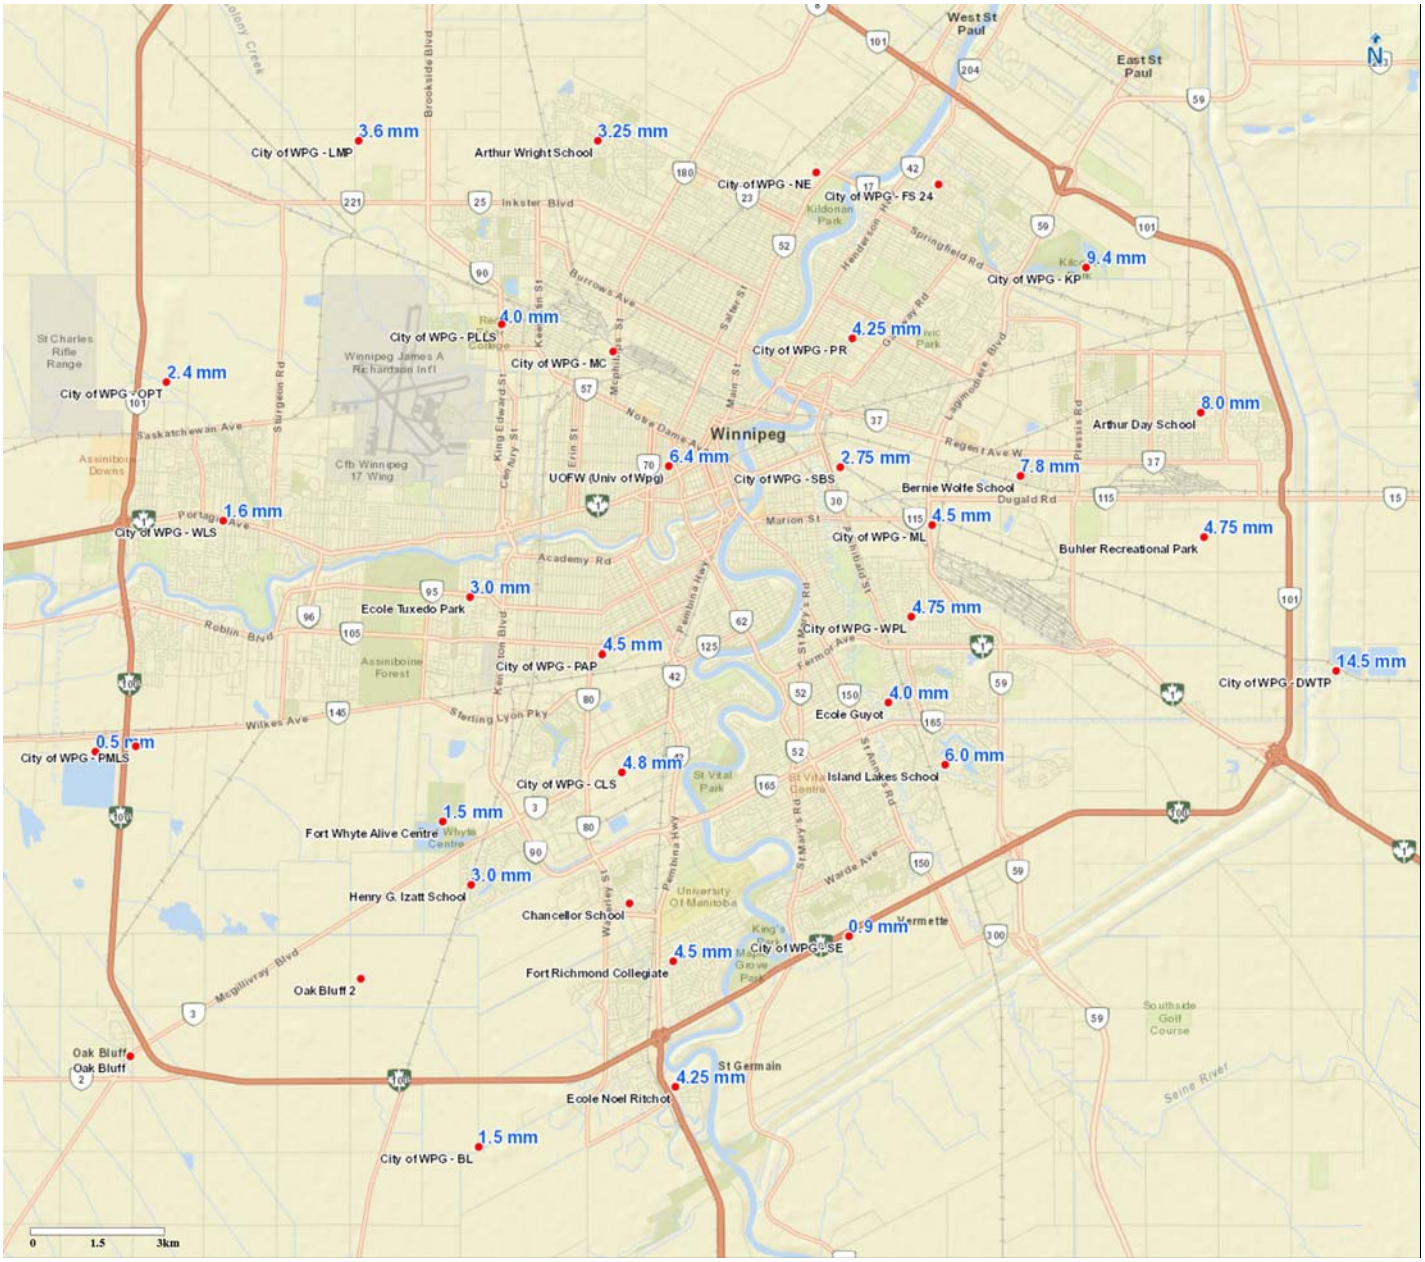

● Rainfall Gauge Station Location 3.55mm Accumulation	**ALL MEASUREMENTS ARE METRIC** IT IS HEREBY EXPRESSLY UNDERSTOOD that any calculat on, or nformat on provided to private property owners, their agents and contractors with respect to the information provided shall be accepted by such persons at ther own risk, and the CITY shall assume no responsibility for the information conta ned therein. The records of the CITY w ll be supplied on the basis that they are the best knowledge of the CITY and that persons requesting such nformat on must interpret the same for their own needs and/or requirements.	Winnipeg **THE CITY OF WINNIPEG**	**Water and Waste Department** Tuesday, May 13, 2014 **Rainfall Accumulation for** **2014-05-12 00:00** **to** **2014-05-12 23:59**

Intensity Duration Frequency Analysis

City of WPG - DWTP

Rainfall Period: 2014-05-12 08:30 to 2014-05-12 21:00
Historical Data: 5-min to 12 hour duration based on MacLaren Drainage Criteria Manual
24 hour duration based on AECOM (2012)

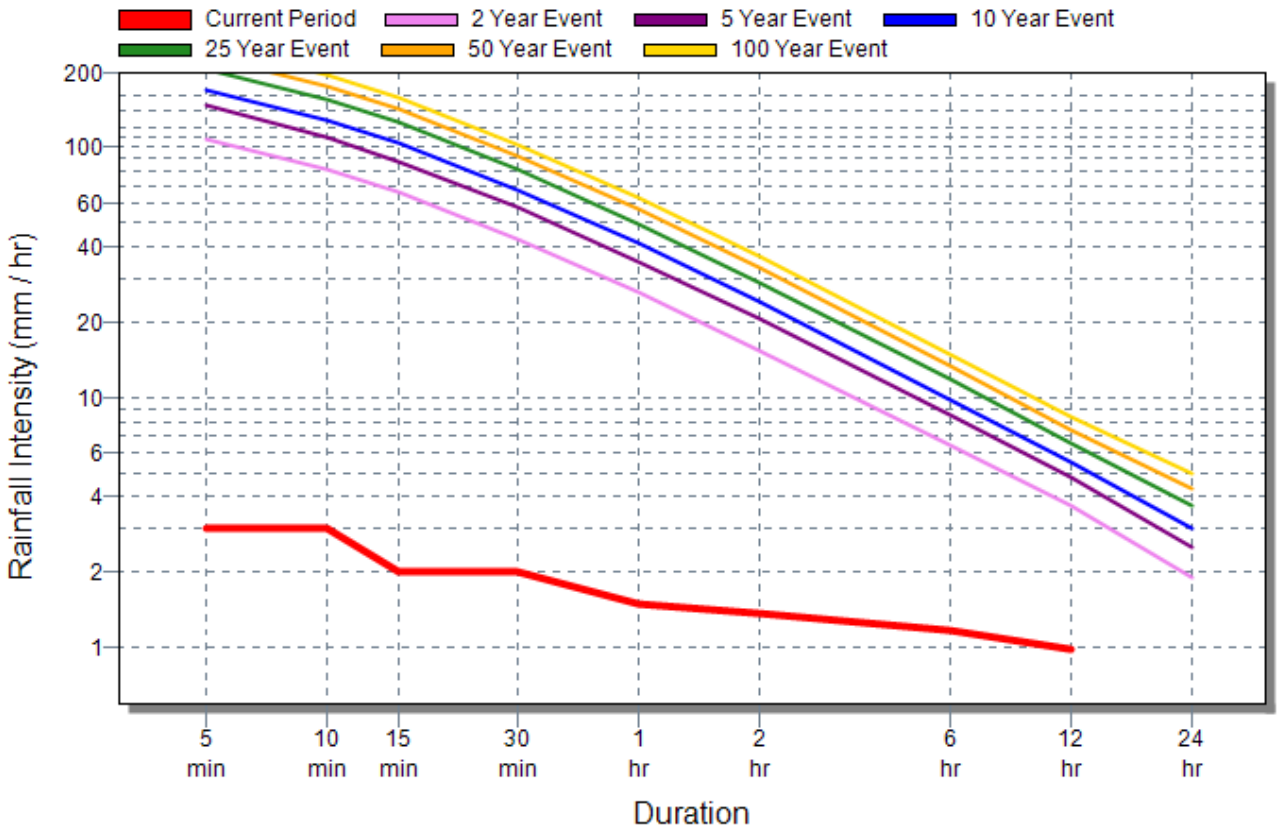

Total Rainfall During Period	12.0 mm
Hours in Period	12.5 hrs

	5 min	10 min	15 min	30 min	1 hr	2 hrs	6 hrs	12 hrs	24 hrs
Current Period	3.0	3.0	2.0	2.0	1.5	1.4	1.2	1.0	0.0
2 Year Event	108.8	81.5	65.9	42.8	26.2	15.4	6.4	3.7	1.9
5 Year Event	146.4	109.5	88.3	57.3	34.9	20.5	8.5	4.8	2.5
10 Year Event	168.8	128.0	103.9	67.8	41.3	24.1	9.8	5.5	3.0
25 Year Event	204.0	154.5	125.4	81.7	49.7	29.0	11.8	6.6	3.7
50 Year Event	231.2	175.1	142.0	92.5	56.3	32.8	13.3	7.4	4.3
100 Year Event	258.4	195.6	158.6	103.2	62.7	36.5	14.8	8.3	5.0

City of WPG - DWTP

Start Date: May 12, 2014 08:15:10
End Date: May 13, 2014 00:57:51
Data: Rainfall (mm)

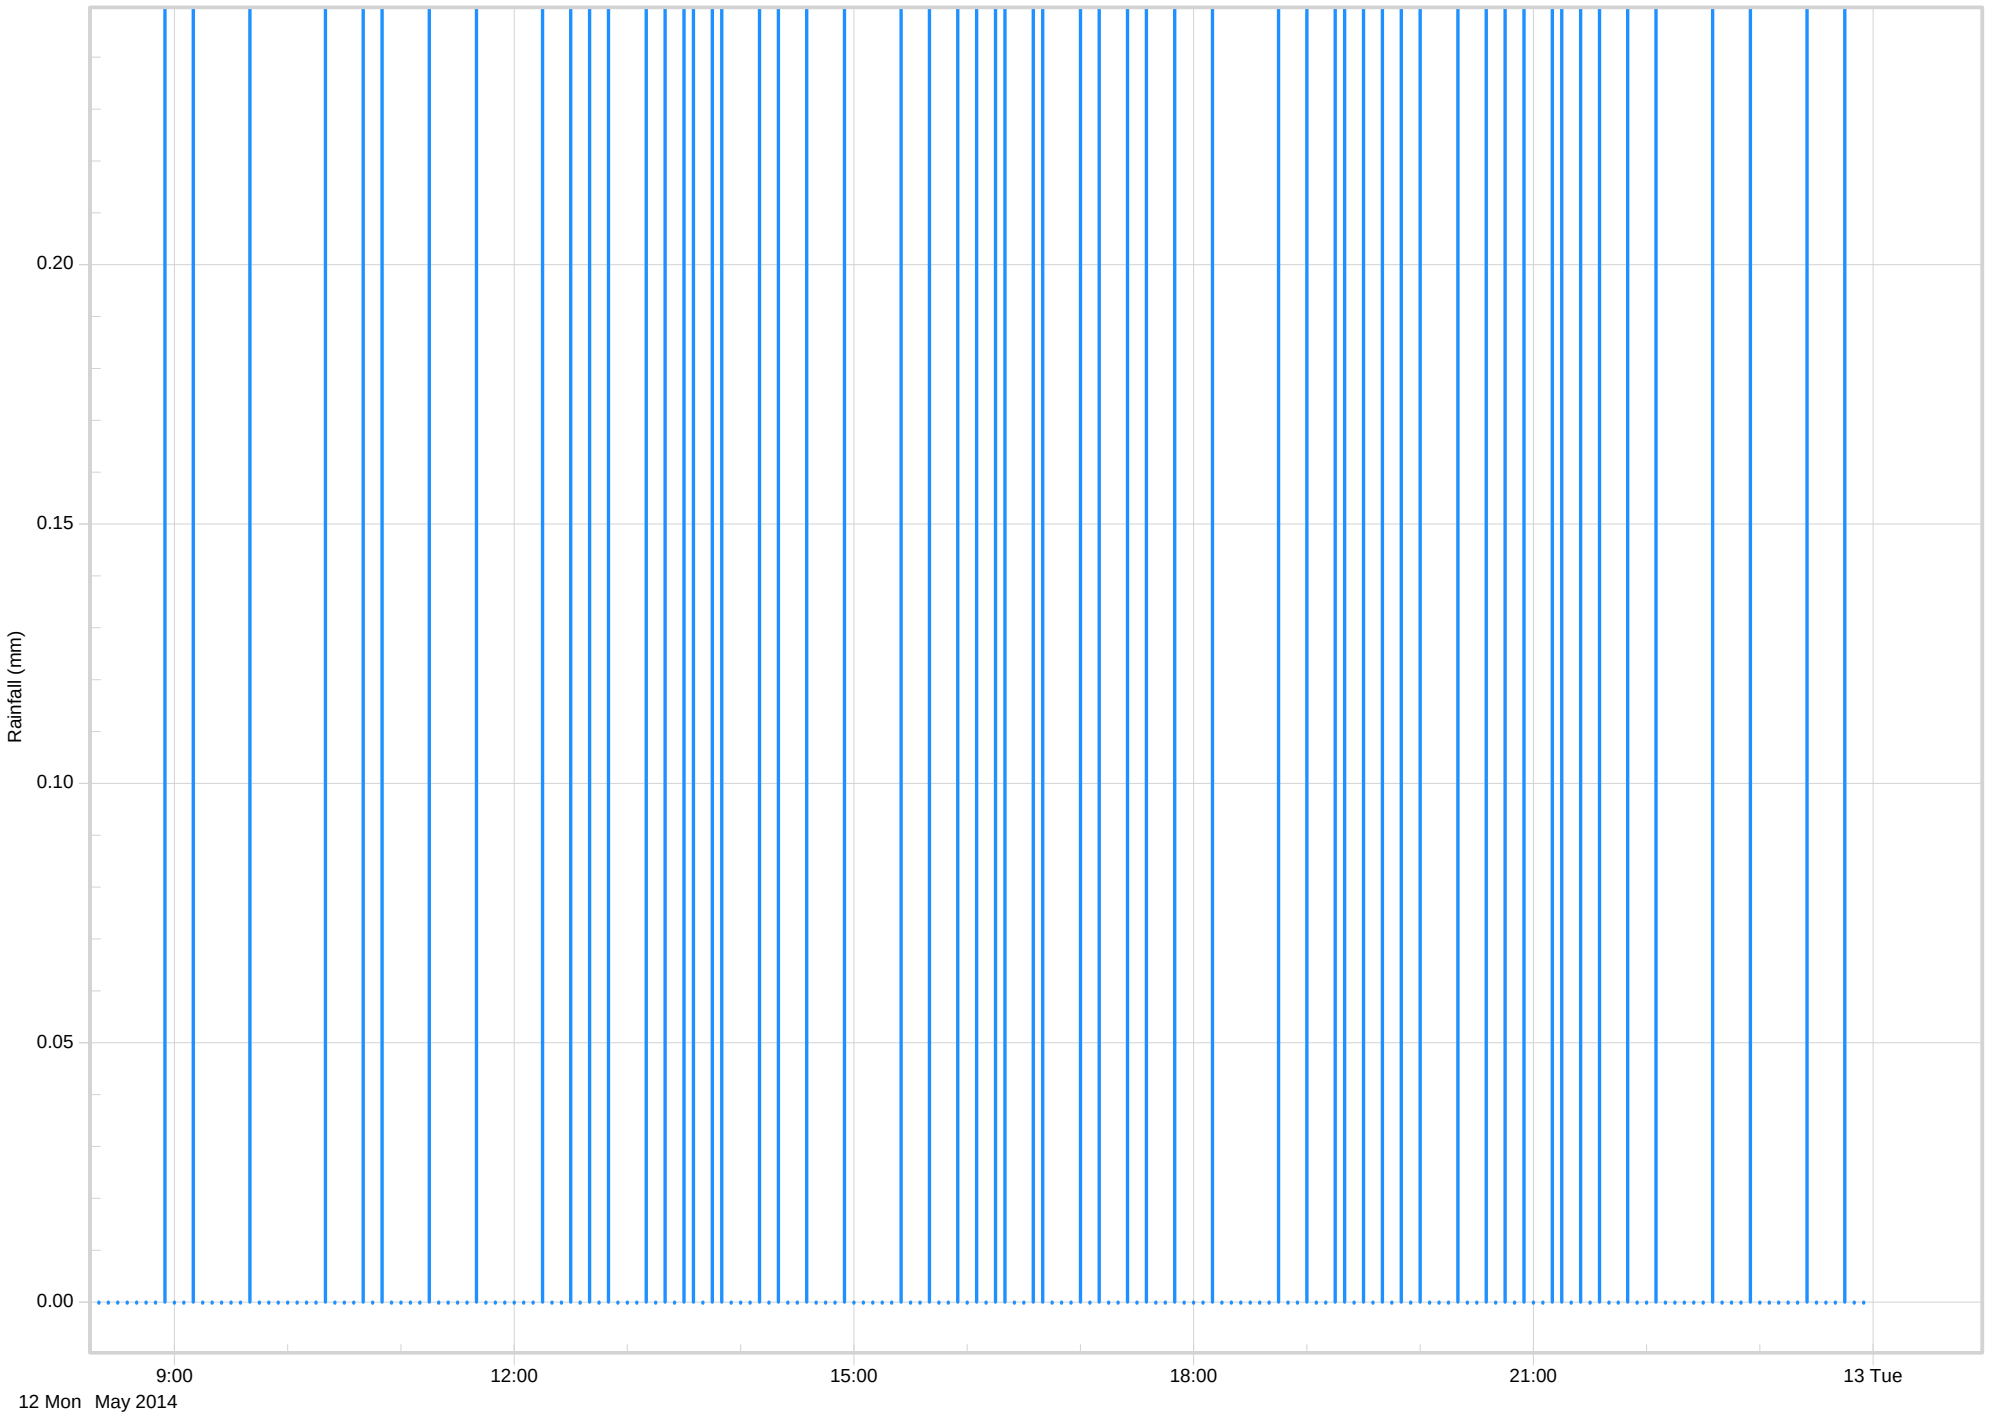

CITY OF WINNIPEG
WATER AND WASTE DEPARTMENT
STORM LOG SUMMER 2014

DATE OF STORM	MAXIMUM ACCUMULATION (mm)	STATION WHERE MAX. OCCURRED	MINIMUM ACCUMULATION (mm)	STATION WHERE MIN. OCCURRED	MAXIMUM STATION RETURN PERIOD (30 min. interval)	BASEMENT FLOODING
April 23-25, 2014	22.5	Deacon Water Treatment Plant	8.5	West End Pollution Control Centre	Less than 1 year	Yes
April 28	12.8	Pan Am Pool	4.8	St Boniface Shops	Less than 1 year	Yes
May 7, 2014	6.4	Little Mountain Park	0.8	South End Plant	Less than 1 year	No
May 12	14.5	Deacon Water Treatment Plant	0.5	West End Pollution Control Centre	Less than 1 year	No

Day on which the storm event begins. (6 hour separation between individual events)

Maximum total rain at any of the telemetry stations.

Station with maximum total rainfall.

Minimum total rainfall at any of the telemetry stations.

Station with minimum total rainfall.

Greatest return period over the 30 minute duration. (Location is not necessarily the same as the maximum accumulation)

If basement flood--ing has been reported to WWD or District offices.

E9c 14-05-20 Rainfall Report

Water and Waste Department ♦ Service des Eaux et des Déchets

RAINFALL REPORT

May 19-20, 2014 Rainstorm

Prepared by:
Shenaz Ahmed. – Land Drainage and Flood Protection Technical Assistant

This report is distributed to various recipients at the following:

City of Winnipeg, Water and Waste Department
City of Winnipeg, Planning, Property and Development Department
City of Winnipeg CAO office
City of Winnipeg, Insect Control Branch
Manitoba Water Stewardship
Environment Canada
Manitoba Organization of Disc Sports
Fort Whyte Alive Centre
Buhler Recreational Park
Lakewood Systems Ltd
Ducks Unlimited Canada
Canadian Wheat Board
AECOM

The City of Winnipeg does not guarantee the accuracy of the data contained herein. Any use or distribution of the data, without the permission of the City of Winnipeg, is strictly prohibited.

Winnipeg

Water and Waste Department
RAINFALL ACCUMULATION LOG - SUMMER 2014

Accumulations in millimeters

NA..... Not Available
NO..... Not Operational
+..... Incomplete raingauge data

Rain Gauge Station Locations

PR - Parks and Rec Building
KE - King Edward Lift Station
AW - Arthur E. Wright School
NE - North End Treatment Plant
FS - Fire Station No. 24
WW - Westwood Lift Station
JW - Jameswood School
MC - McPhillips Pumping Static
SB - St. Boniface Shops
BW - Bernie Wolfe School
PM - Perimeter Lift Station
CL - Clarence Lift Station
WN - Windsor Park Library
FR - Fort Richmond Collegiate
IL - Island Lakes School
EN - Ecole Noel Ritchot
AD - Arthur Day School
SE - South End Pollution Control Center
EG - Ecole Guyot
CE - Chancellor Elementary School
HI - Henry G. Izatt Middle School
KP - Kilcona Park
BP - Buhler Recreational Park
BL - Brady Road Landfill
LM - Little Mountain Park
FW - Fort Whyte Alive
OP - Optimist Park
RB - River Bend Lift Station
HD - Headingley (CWB)
OB - Oak Bluff
PAP - Pan Am Pool
ML - MacLean Pumping Station
ET - Ecole Tuxedo Park
DW - Deacon Water Treatment Plant
WE - West End Pollution Control Center
OB2 - Oak Bluff 2
UW - University of Winnipeg (Lockhart Hall)

RAINSTORM DATE	APPROXIMATE RAINSTORM START TIME	APPROXIMATE RAINSTORM STOP TIME	RAINFALL MONITORING STATIONS																																				AVERAGE
			WN	AD	AW	BP	BW	CE	MC	NE	CL	EG	ET	FR	FW	HI	IL	KE	KP	LM	OB	OB2	OP	UW	WW	SB	WE	FS	BL	SE	DW	PAP	ML	EN	PR				
April 23-25 2014	4/23/2014 20:00	4/25/2014 12:00	17.3	18.2	17.2	12.4	19.8				19.8	14.8	18.0				10.8	19.8	17.6	16.6		15.8	19.8	19.6	18.2	9.8	8.5		19.0	18.5	19.3	21.8	20.0	19.0	15.8				**17.1**
April 28, 2014	3:00 AM	21:00	9.9	9.0	9.4		9.6				11.2							11.0	8.4	10.2		12.7	10.4	11.2	11.2	4.8	6.8		12.5	5.4	11.0	12.8	8.5	11.3	6.8				**9.7**
May 7, 2014	15:00	21:00	2.3	4.4	5.0	2.5	3.8	2.3			3.0	2.0	3.5	2.3	1.0	3.0	2.3	5.8	4.4	6.4		2.8	5.2	5.0	5.0	2.3	4.3		2.0	0.8	3.3	3.0	2.5	2.0	2.8				**3.3**
May 12, 2014	8:30	21:00	4.8	8.0	3.3	4.8	7.8	4.0			4.8	4.0	3.0	4.5	1.5	3.0	6.0	4.0	3.4	3.6			2.4	6.4	1.6	2.8	0.5		1.5	0.9	14.5	4.5	4.5	4.3	4.3				**4.2**
May 19-20. 2014	5/19/2014 10:30	5/20/2014 4:00	9.8	12.4	8.5	10.4	11.8	11.3	9.8	9.8	13	9	10.3	15.2	8.5	10.1	10.3	10	10.4	9			8.6	11.2	8.8	4.5	3.8	9	41.3	6.1	15.4	12.3	10.1	27.6	8.3				**11.5**

	Total	**44.1**	**52.0**	**43.4**	**30.1**	**52.8**	**17.6**	**9.8**	**9.8**	**51.8**	**29.8**	**34.8**	**22.0**	**11.0**	**16.1**	**29.4**	**50.6**	**44.2**	**45.8**	**0.0**	**31.3**	**46.4**	**53.4**	**44.8**	**24.1**	**23.8**	**9.0**	**76.3**	**31.7**	**63.4**	**54.4**	**45.6**	**64.2**	**37.9**	**0.0**	**0.0**	**0.0**	**45.8**

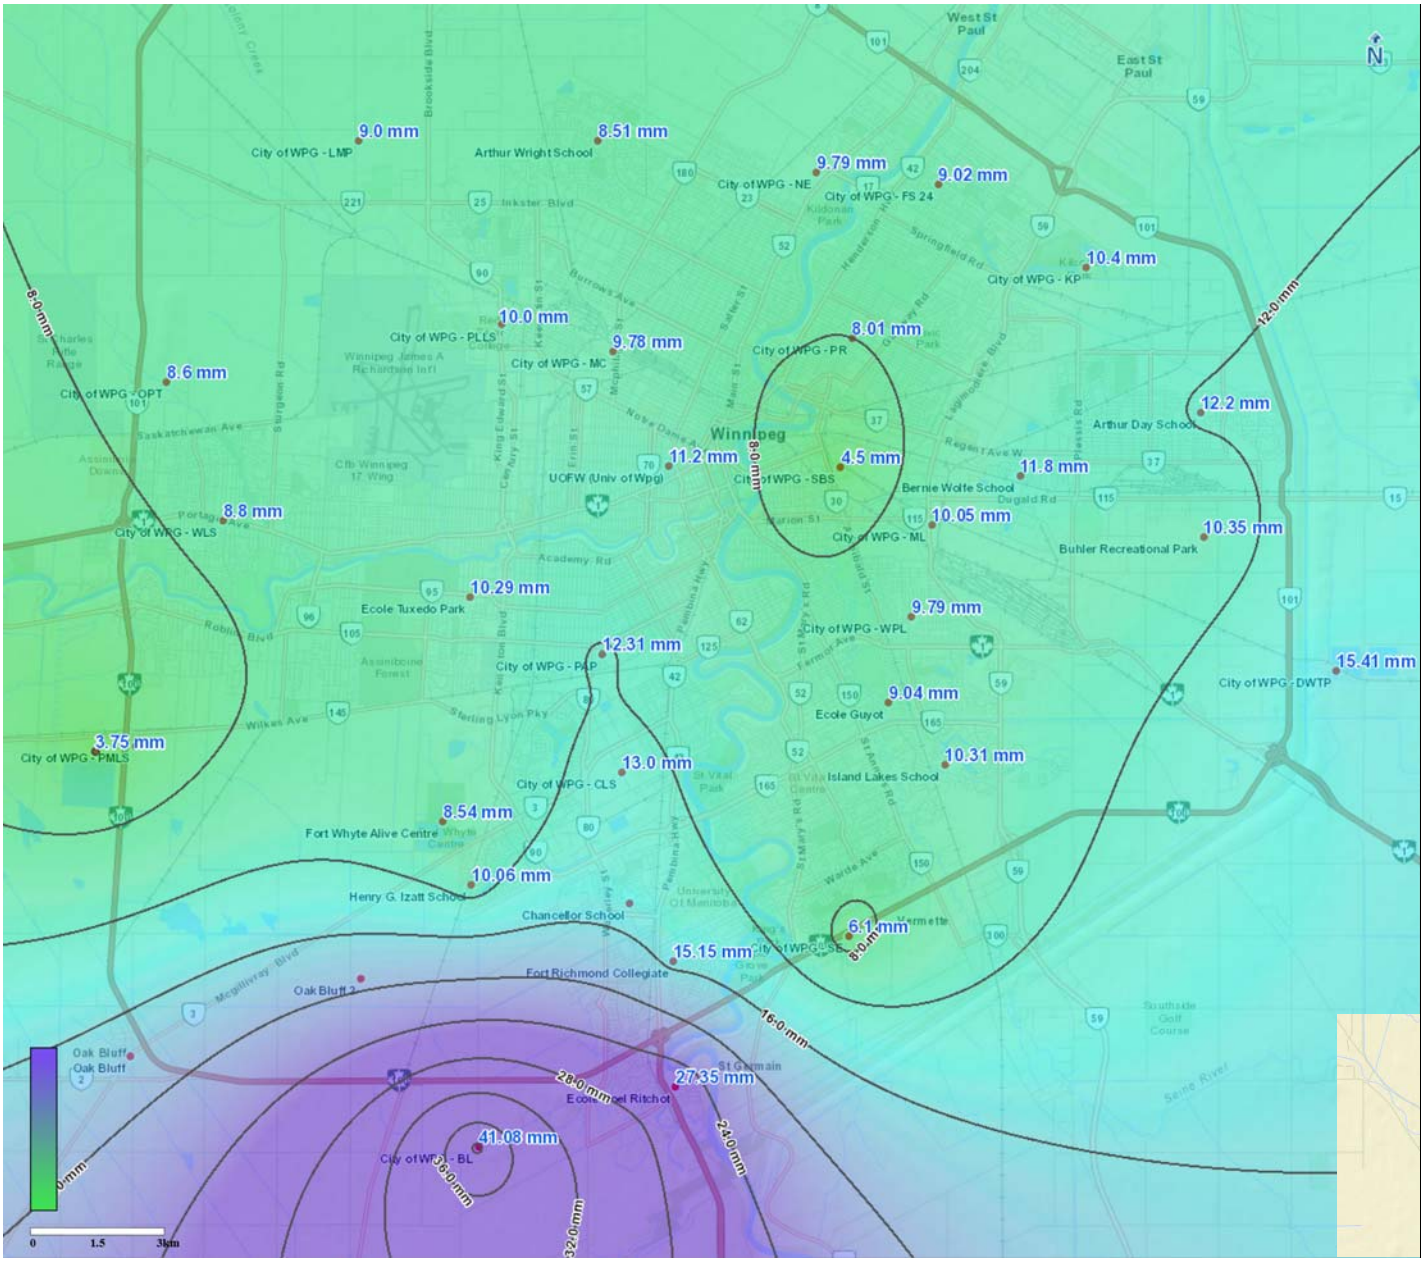

● Rainfall Gauge Station Location —8mm— Isohyetal Line 3.55mm Accumulation	**ALL MEASUREMENTS ARE METRIC** IT IS HEREBY EXPRESSLY UNDERSTOOD that any calculat on, or nformat on provided to private property owners, their agents and contractors with respect to the information provided shall be accepted by such persons at ther own risk, and the CITY shall assume no responsibility for the information conta ned therein. The records of the CITY w ll be supplied on the basis that they are the best knowledge of the CITY and that persons requesting such nformat on must interpret the same for their own needs and/or requirements.	Winnipeg **THE CITY OF WINNIPEG**	**Water and Waste Department** Tuesday, May 20, 2014 **Rainfall Accumulation with Isohyetal for** **2014-05-19 10:30** **to** **2014-05-20 04:00**

Intensity Duration Frequency Analysis

City of WPG - BL

Rainfall Period: 2014-05-19 00:00 to 2014-05-21 00:00
Historical Data: 5-min to 12 hour duration based on MacLaren Drainage Criteria Manual
24 hour duration based on AECOM (2012)

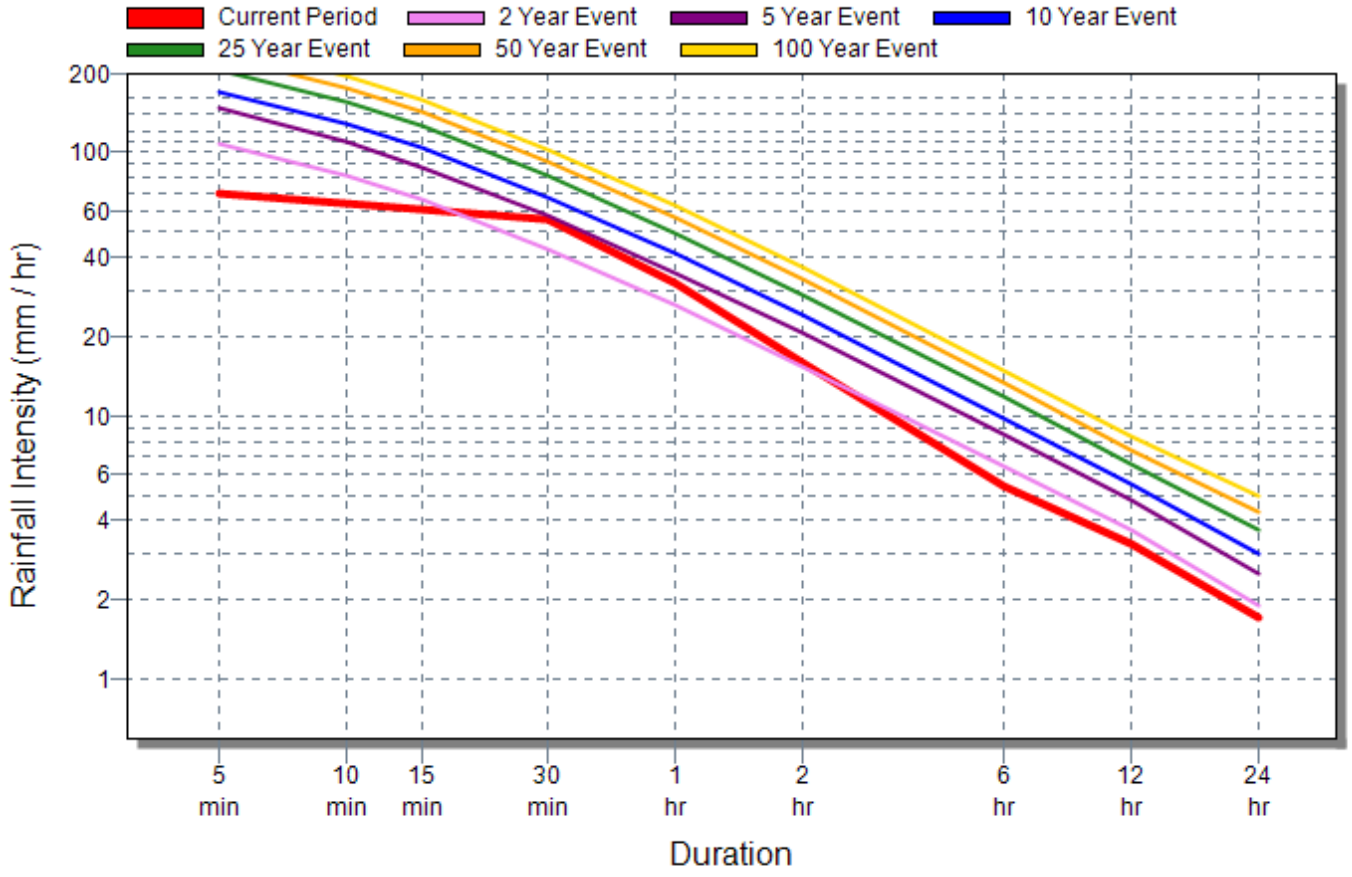

Total Rainfall During Period	41.3 mm
Hours in Period	48.0 hrs

	5 min	10 min	15 min	30 min	1 hr	2 hrs	6 hrs	12 hrs	24 hrs
Current Period	70.1	64.0	61.0	55.4	31.8	15.9	5.4	3.3	1.7
2 Year Event	108.8	81.5	65.9	42.8	26.2	15.4	6.4	3.7	1.9
5 Year Event	146.4	109.5	88.3	57.3	34.9	20.5	8.5	4.8	2.5
10 Year Event	168.8	128.0	103.9	67.8	41.3	24.1	9.8	5.5	3.0
25 Year Event	204.0	154.5	125.4	81.7	49.7	29.0	11.8	6.6	3.7
50 Year Event	231.2	175.1	142.0	92.5	56.3	32.8	13.3	7.4	4.3
100 Year Event	258.4	195.6	158.6	103.2	62.7	36.5	14.8	8.3	5.0

City of WPG - BL

Start Date: May 19, 2014 09:01:59
End Date: May 20, 2014 03:24:16
Data: Rainfall (mm)

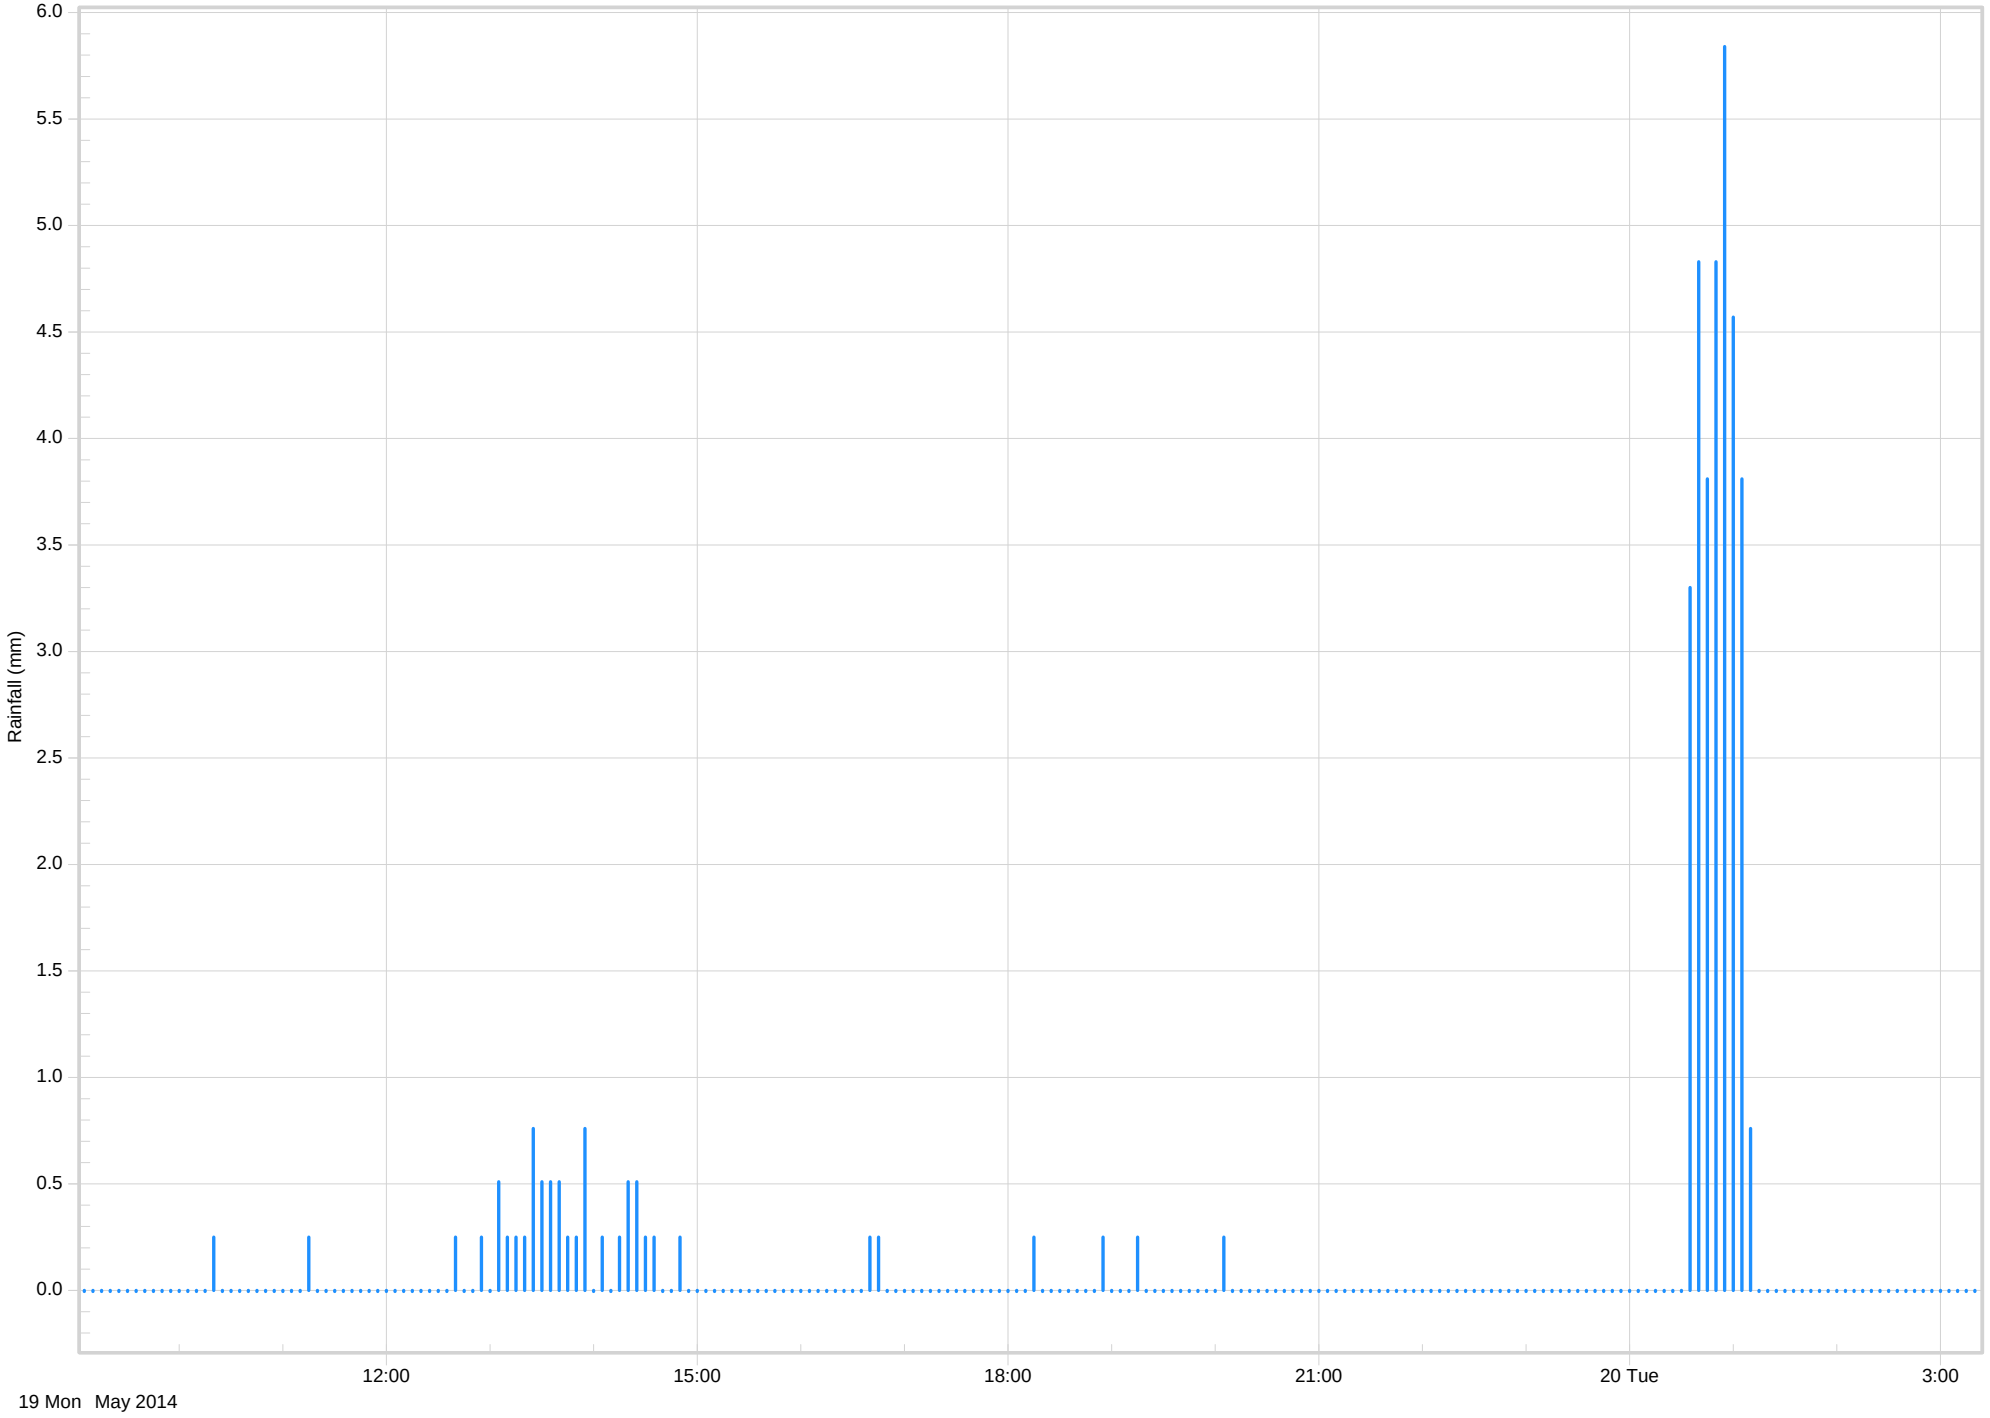

CITY OF WINNIPEG
WATER AND WASTE DEPARTMENT
STORM LOG SUMMER 2014

DATE OF STORM	MAX MUM ACCUMULATION (mm)	STATION WHERE MAX. OCCURRED	MINIMUM ACCUMULATION (mm)	STATION WHERE MIN. OCCURRED	MAXIMUM STATION RETURN PERIOD (30 min. interval)	BASEMENT FLOODING
April 23-25, 2014	22.5	Deacon Water Treatment Plant	8.5	West End Pollution Control Centre	Less than 1 year	Yes
April 28	12.8	Pan Am Pool	4.8	St Boniface Shops	Less than 1 year	Yes
May 7, 2014	6.4	Little Mountain Park	0.8	South End Plant	Less than 1 year	No
May 12	14.5	Deacon Water Treatment Plant	0.5	West End Pollution Control Centre	Less than 1 year	No
May 19-20, 2014	41.1	Brady Road Landfill	3.8	West End Pollution Control Centre	Approximately a 5 year	Yes

Day on which the storm event begins. (6 hour separation between individual

Maximum total rain at any of the telemetry stations.

Station with maximum total rainfall.

Minimum total rainfall at any of the telemetry stations.

Station with minimum total rainfall.

Greatest return period over the 30 minute duration. (Location is not necessarily the same as the

If basement flood--ing has been reported to WWD or District

E9d 14-05-24 Rainfall Report

Water and Waste Department ♦ Service des Eaux et des Déchets

RAINFALL REPORT

May 24, 2014 Rainstorm

Prepared by:
Shenaz Ahmed. – Land Drainage and Flood Protection Technical Assistant

This report is distributed to various recipients at the following:

City of Winnipeg, Water and Waste Department
City of Winnipeg, Planning, Property and Development Department
City of Winnipeg CAO office
City of Winnipeg, Insect Control Branch
Manitoba Water Stewardship
Environment Canada
Manitoba Organization of Disc Sports
Fort Whyte Alive Centre
Buhler Recreational Park
Lakewood Systems Ltd
Ducks Unlimited Canada
Canadian Wheat Board
AECOM

The City of Winnipeg does not guarantee the accuracy of the data contained herein. Any use or distribution of the data, without the permission of the City of Winnipeg, is strictly prohibited.

Winnipeg

Water and Waste Department
RAINFALL ACCUMULATION LOG - SUMMER 2014

Accumulations in millimeters

NA..... Not Available
NO..... Not Operational
+..... Incomplete raingauge data

Rain Gauge Station Locations

PR - Parks and Rec Building
KE - King Edward Lift Station
AW - Arthur E. Wright School
NE - North End Treatment Plant
FS - Fire Station No. 24
WW - Westwood Lift Station
JW - Jameswood School
MC - McPhillips Pumping Static
SB - St. Boniface Shops
BW - Bernie Wolfe School
PM - Perimeter Lift Station
CL - Clarence Lift Station
WN - Windsor Park Library
FR - Fort Richmond Collegiate
IL - Island Lakes School
EN - Ecole Noel Ritchot
AD - Arthur Day School
SE - South End Pollution Control Center
EG - Ecole Guyot
CE - Chancellor Elementary School
HI - Henry G. Izatt Middle School
KP - Kilcona Park
BP - Buhler Recreational Park
BL - Brady Road Landfill
LM - Little Mountain Park
FW - Fort Whyte Alive
OP - Optimist Park
RB - River Bend Lift Station
HD - Headingley (CWB)
OB - Oak Bluff
PAP - Pan Am Pool
ML - MacLean Pumping Station
ET - Ecole Tuxedo Park
DW - Deacon Water Treatment Plant
WE - West End Pollution Control Center
OB2 - Oak Bluff 2
UW - University of Winnipeg (Lockhart Hall)

RAINSTORM DATE	APPROXIMATE RAINSTORM START TIME	APPROXIMATE RAINSTORM STOP TIME	RAINFALL MONITORING STATIONS																																				AVERAGE
			WN	AD	AW	BP	BW	CE	MC	NE	CL	EG	ET	FR	FW	HI	IL	KE	KP	LM	OB	OB2	OP	UW	WW	SB	WE	FS	BL	SE	DW	PAP	ML	EN	PR				
April 23-25 2014	4/23/2014 20:00	4/25/2014 12:00	17.3	18.2	17.2	12.4	19.8				19.8	14.8	18.0				10.8	19.8	17.6	16.6		15.8	19.8	19.6	18.2	9.8	8.5		19.0	18.5	19.3	21.8	20.0	19.0	15.8				**17.1**
April 28, 2014	3:00 AM	21:00	9.9	9.0	9.4		9.6				11.2							11.0	8.4	10.2		12.7	10.4	11.2	11.2	4.8	6.8		12.5	5.4	11.0	12.8	8.5	11.3	6.8				**9.7**
May 7, 2014	15:00	21:00	2.3	4.4	5.0	2.5	3.8	2.3			3.0	2.0	3.5	2.3	1.0	3.0	2.3	5.8	4.4	6.4		2.8	5.2	5.0	5.0	2.3	4.3		2.0	0.8	3.3	3.0	2.5	2.0	2.8				**3.3**
May 12, 2014	8:30	21:00	4.8	8.0	3.3	4.8	7.8	4.0			4.8	4.0	3.0	4.5	1.5	3.0	6.0	4.0	3.4	3.6			2.4	6.4	1.6	2.8	0.5		1.5	0.9	14.5	4.5	4.5	4.3	4.3				**4.2**
May 19-20. 2014	5/19/2014 10:30	5/20/2014 4:00	9.8	12.4	8.5	10.4	11.8	11.3	9.8	9.8	13	9	10.3	15.2	8.5	10.1	10.3	10	10.4	9			8.6	11.2	8.8	4.5	3.8	9	41.3	6.1	15.4	12.3	10.1	27.6	8.3				**11.5**
May 24, 2014	0:00	23:59	3.8	7.6	16.7	5.8	8.2	6.1	8.1	9.9	5.2	6.6	7.3	5.3	2.8	4.6	6.6	14.8	7.8	14.0			10.8	6.2	10.6	5.3	2.8	9.3	7.6	3.5	5.3	7.6	4.8	7.6	6.6				**7.4**
Total			**47.8**	**59.6**	**60.1**	**35.9**	**61.0**	**23.6**	**17.9**	**19.7**	**57.0**	**36.4**	**42.1**	**27.3**	**13.8**	**20.7**	**35.9**	**65.4**	**52.0**	**59.8**	**0.0**	**31.3**	**57.2**	**59.6**	**55.4**	**29.4**	**26.6**	**18.3**	**83.9**	**35.2**	**68.8**	**62.0**	**50.4**	**71.8**	**44.4**	**0.0**	**0.0**	**0.0**	**53.2**

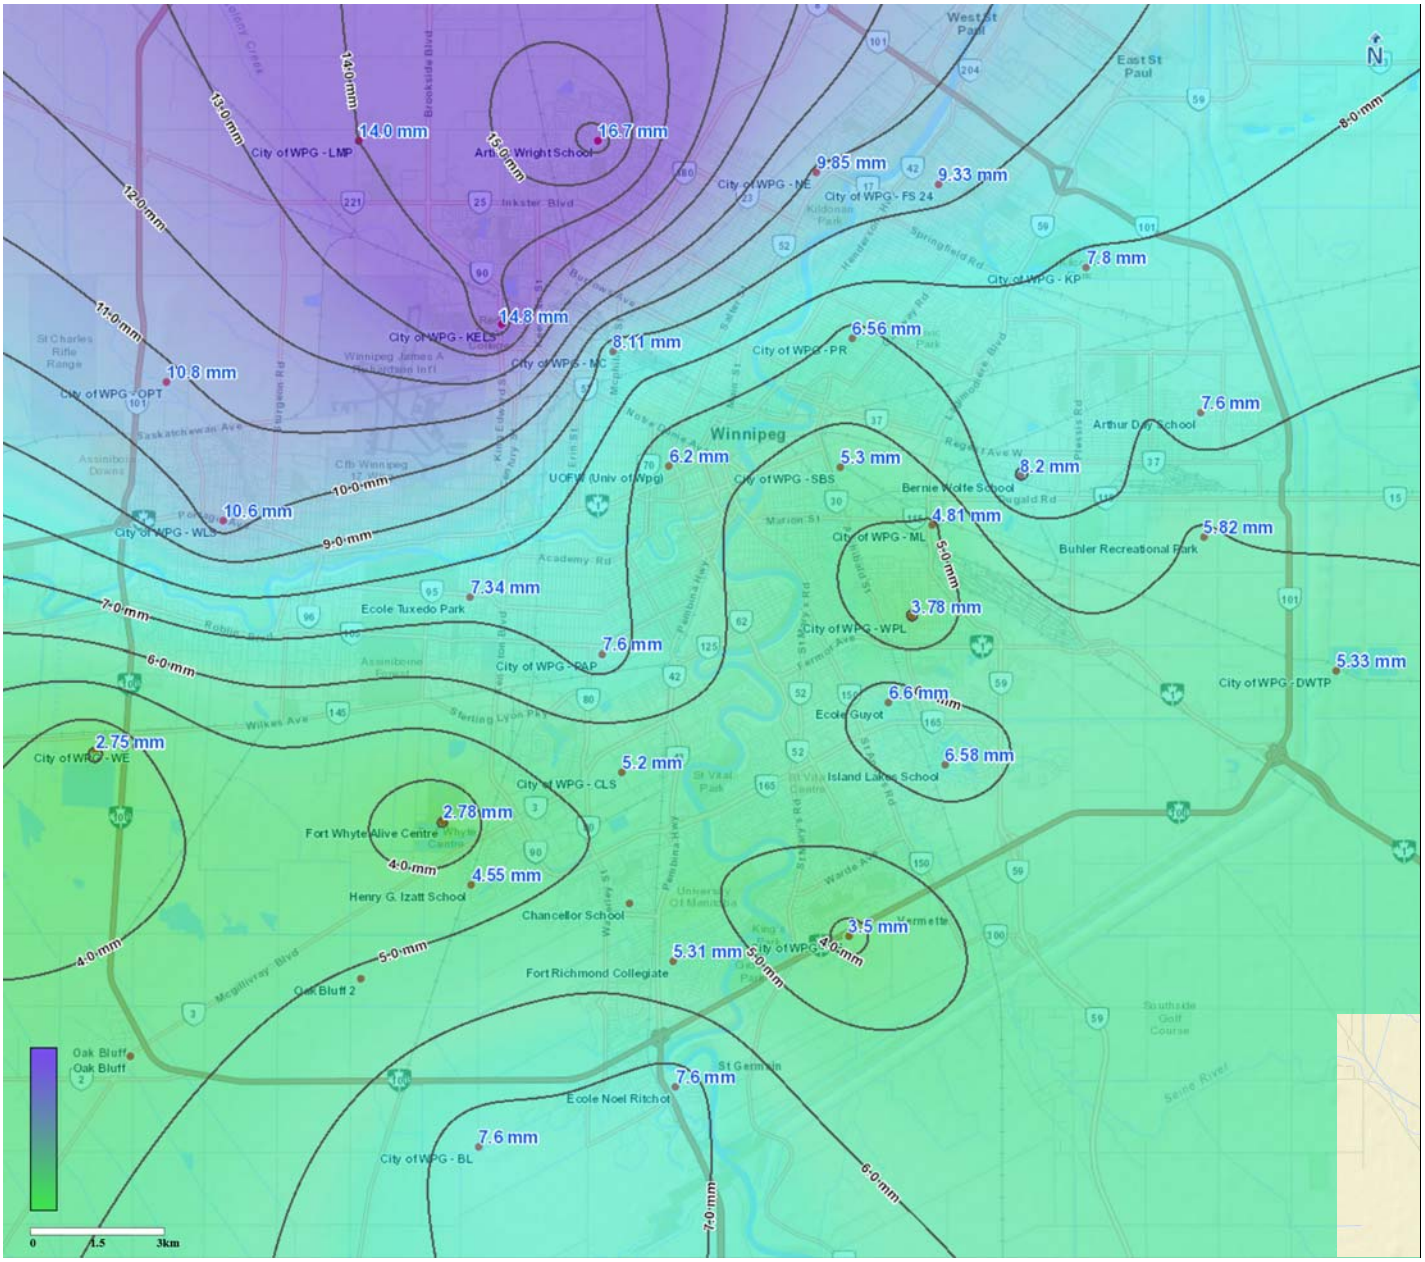

● Rainfall Gauge Station Location —8mm— Isohyetal Line 3.55mm Accumulation	**ALL MEASUREMENTS ARE METRIC** IT IS HEREBY EXPRESSLY UNDERSTOOD that any calculation, or information provided to private property owners, their agents and contractors with respect to the information provided shall be accepted by such persons at their own risk, and the CITY shall assume no responsibility for the information contained therein. The records of the CITY will be supplied on the basis that they are the best knowledge of the CITY and that persons requesting such information must interpret the same for their own needs and/or requirements.	Winnipeg **THE CITY OF WINNIPEG**	**Water and Waste Department** Monday, May 26, 2014 **Rainfall Accumulation with Isohyetal for** **2014-05-24 00:00** **to** **2014-05-24 23:59**

Intensity Duration Frequency Analysis

Arthur Wright School

Rainfall Period: 2014-05-24 13:00 to 2014-05-24 22:00
Historical Data: 5-min to 12 hour duration based on MacLaren Drainage Criteria Manual
24 hour duration based on AECOM (2012)

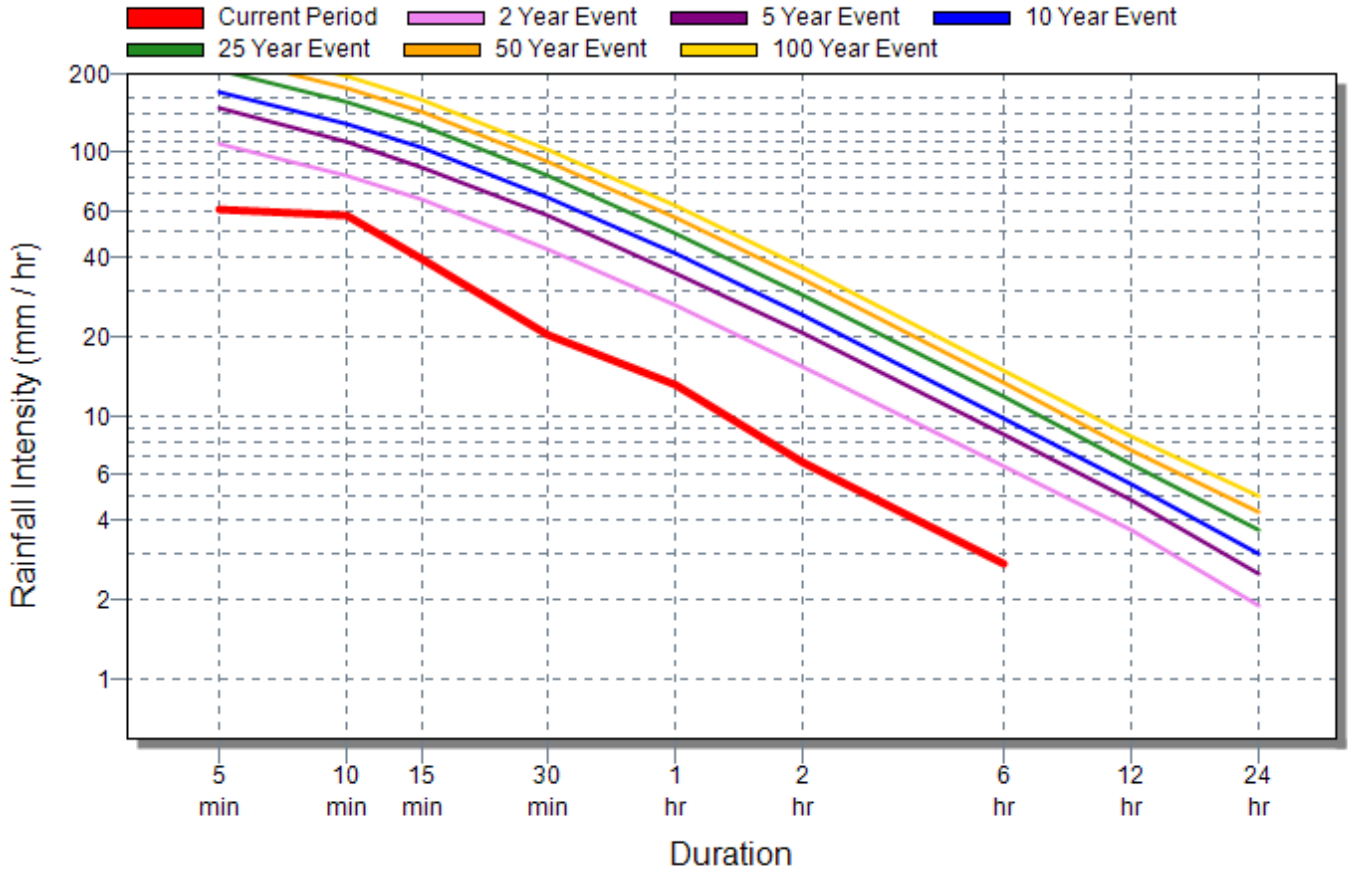

Total Rainfall During Period	16.5 mm
Hours in Period	9.0 hrs

	5 min	10 min	15 min	30 min	1 hr	2 hrs	6 hrs	12 hrs	24 hrs
Current Period	61.0	57.9	39.6	20.3	13.2	6.7	2.7	0.0	0.0
2 Year Event	108.8	81.5	65.9	42.8	26.2	15.4	6.4	3.7	1.9
5 Year Event	146.4	109.5	88.3	57.3	34.9	20.5	8.5	4.8	2.5
10 Year Event	168.8	128.0	103.9	67.8	41.3	24.1	9.8	5.5	3.0
25 Year Event	204.0	154.5	125.4	81.7	49.7	29.0	11.8	6.6	3.7
50 Year Event	231.2	175.1	142.0	92.5	56.3	32.8	13.3	7.4	4.3
100 Year Event	258.4	195.6	158.6	103.2	62.7	36.5	14.8	8.3	5.0

Arthur Wright School

Start Date: May 24, 2014 14:18:35
End Date: May 24, 2014 23:56:12
Data: Rainfall (mm)

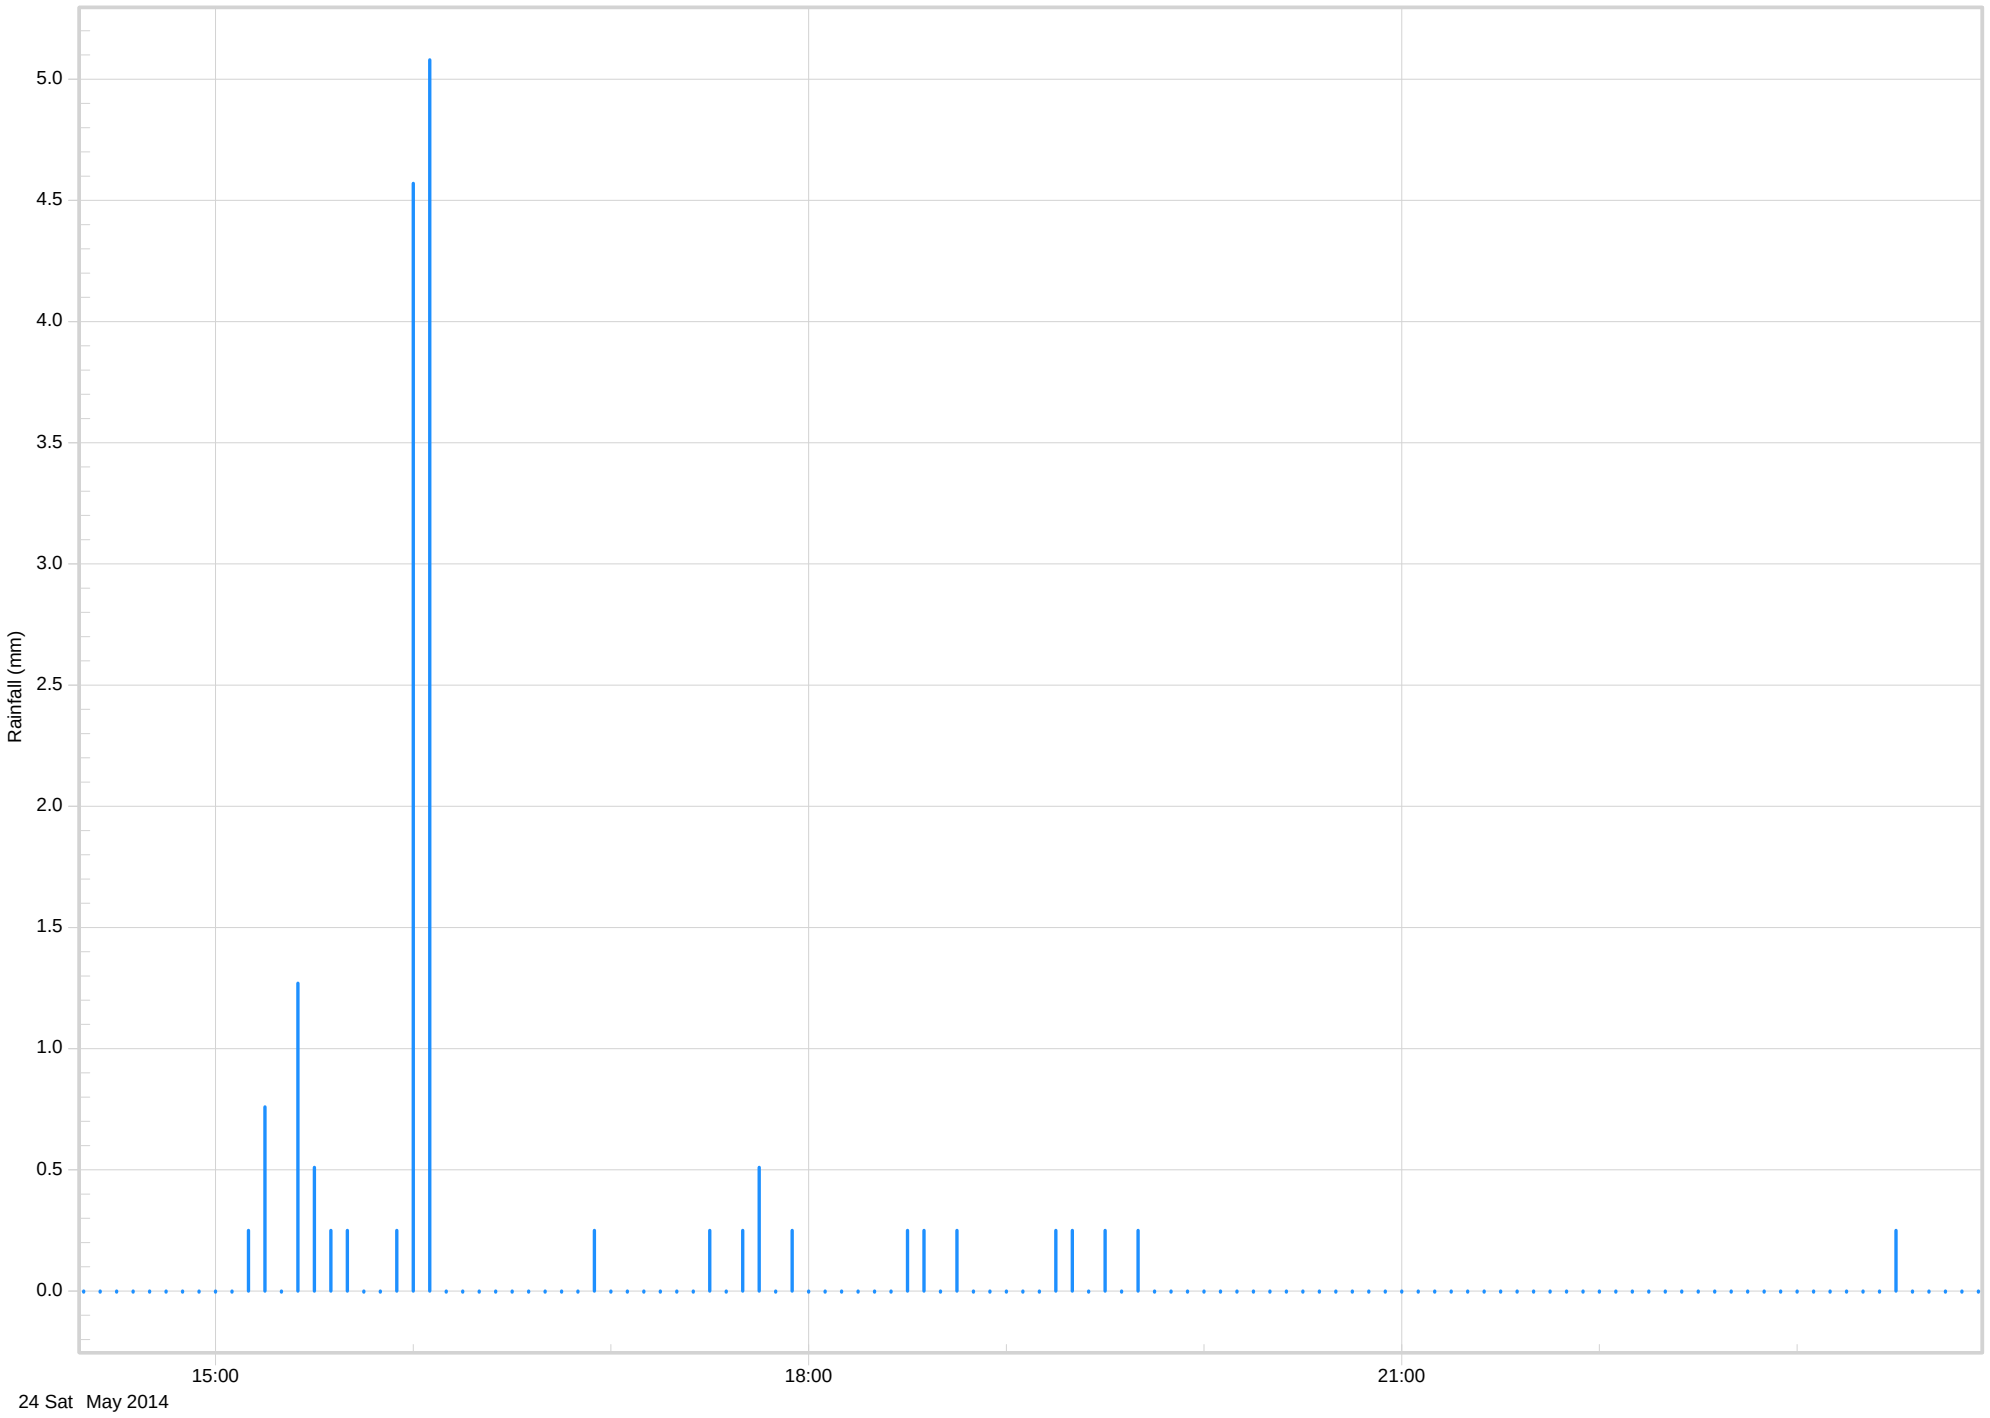

CITY OF WINNIPEG
WATER AND WASTE DEPARTMENT
STORM LOG SUMMER 2014

DATE OF STORM	MAX MUM ACCUMULATION (mm)	STATION WHERE MAX. OCCURRED	MINIMUM ACCUMULATION (mm)	STATION WHERE MIN. OCCURRED	MAXIMUM STATION RETURN PERIOD (30 min. interval)	BASEMENT FLOODING
April 23-25, 2014	22.5	Deacon Water Treatment Plant	8.5	West End Pollution Control Centre	Less than 1 year	Yes
April 28	12.8	Pan Am Pool	4.8	St Boniface Shops	Less than 1 year	Yes
May 7, 2014	6.4	Little Mountain Park	0.8	South End Plant	Less than 1 year	No
May 12	14.5	Deacon Water Treatment Plant	0.5	West End Pollution Control Centre	Less than 1 year	No
May 19-20, 2014	41.1	Brady Road Landfill	3.8	West End Pollution Control Centre	Approximately a 5 year	Yes
May 24, 2014	16.7	Arthur E. Wright School	2.8	West End Pollution Control Centre	Less than 1 year	No

Day on which the storm event begins. (6 hour separation between individual

Maximum total rain at any of the telemetry stations.

Station with maximum total rainfall.

Minimum total rainfall at any of the telemetry stations.

Station with minimum total rainfall.

Greatest return period over the 30 minute duration. (Location is not necessarily the same as the

If basement flood--ing has been reported to WWD or District

E9e 14-05-25 Rainfall Report

Water and Waste Department ♦ Service des Eaux et des Déchets

RAINFALL REPORT

May 25, 2014 Rainstorm

Prepared by:
Shenaz Ahmed. – Land Drainage and Flood Protection Technical Assistant

This report is distributed to various recipients at the following:

City of Winnipeg, Water and Waste Department
City of Winnipeg, Planning, Property and Development Department
City of Winnipeg CAO office
City of Winnipeg, Insect Control Branch
Manitoba Water Stewardship
Environment Canada
Manitoba Organization of Disc Sports
Fort Whyte Alive Centre
Buhler Recreational Park
Lakewood Systems Ltd
Ducks Unlimited Canada
Canadian Wheat Board
AECOM

The City of Winnipeg does not guarantee the accuracy of the data contained herein. Any use or distribution of the data, without the permission of the City of Winnipeg, is strictly prohibited.

Winnipeg

Water and Waste Department
RAINFALL ACCUMULATION LOG - SUMMER 2014

Accumulations in millimeters

NA..... Not Available
NO..... Not Operational
+..... Incomplete raingauge data

Rain Gauge Station Locations

PR - Parks and Rec Building
KE - King Edward Lift Station
AW - Arthur E. Wright School
NE - North End Treatment Plant
FS - Fire Station No. 24
WW - Westwood Lift Station
JW - Jameswood School
MC - McPhillips Pumping Static
SB - St. Boniface Shops
BW - Bernie Wolfe School
PM - Perimeter Lift Station
CL - Clarence Lift Station
WN - Windsor Park Library
FR - Fort Richmond Collegiate
IL - Island Lakes School
EN - Ecole Noel Ritchot
AD - Arthur Day School
SE - South End Pollution Control Center
EG - Ecole Guyot
CE - Chancellor Elementary School
HI - Henry G. Izatt Middle School
KP - Kilcona Park
BP - Buhler Recreational Park
BL - Brady Road Landfill
LM - Little Mountain Park
FW - Fort Whyte Alive
OP - Optimist Park
RB - River Bend Lift Station
HD - Headingley (CWB)
OB - Oak Bluff
PAP - Pan Am Pool
ML - MacLean Pumping Station
ET - Ecole Tuxedo Park
DW - Deacon Water Treatment Plant
WE - West End Pollution Control Center
OB2 - Oak Bluff 2
UW - University of Winnipeg (Lockhart Hall)

RAINSTORM DATE	APPROXIMATE RAINSTORM START TIME	APPROXIMATE RAINSTORM STOP TIME	RAINFALL MONITORING STATIONS																																				AVERAGE
			WN	AD	AW	BP	BW	CE	MC	NE	CL	EG	ET	FR	FW	HI	IL	KE	KP	LM	OB	OB2	OP	UW	WW	SB	WE	FS	BL	SE	DW	PAP	ML	EN	PR				
April 23-25 2014	4/23/2014 20:00	4/25/2014 12:00	17.3	18.2	17.2	12.4	19.8				19.8	14.8	18.0				10.8	19.8	17.6	16.6		15.8	19.8	19.6	18.2	9.8	8.5		19.0	18.5	19.3	21.8	20.0	19.0	15.8				**17.1**
April 28, 2014	3:00 AM	21:00	9.9	9.0	9.4		9.6				11.2							11.0	8.4	10.2		12.7	10.4	11.2	11.2	4.8	6.8		12.5	5.4	11.0	12.8	8.5	11.3	6.8				**9.7**
May 7, 2014	15:00	21:00	2.3	4.4	5.0	2.5	3.8	2.3			3.0	2.0	3.5	2.3	1.0	3.0	2.3	5.8	4.4	6.4		2.8	5.2	5.0	5.0	2.3	4.3		2.0	0.8	3.3	3.0	2.5	2.0	2.8				**3.3**
May 12, 2014	8:30	21:00	4.8	8.0	3.3	4.8	7.8	4.0			4.8	4.0	3.0	4.5	1.5	3.0	6.0	4.0	3.4	3.6			2.4	6.4	1.6	2.8	0.5		1.5	0.9	14.5	4.5	4.5	4.3	4.3				**4.2**
May 19-20. 2014	5/19/2014 10:30	5/20/2014 4:00	9.8	12.4	8.5	10.4	11.8	11.3	9.8	9.8	13	9	10.3	15.2	8.5	10.1	10.3	10	10.4	9			8.6	11.2	8.8	4.5	3.8	9	41.3	6.1	15.4	12.3	10.1	27.6	8.3				**11.5**
May 24, 2014	0:00	23:59	3.8	7.6	16.7	5.8	8.2	6.1	8.1	9.9	5.2	6.6	7.3	5.3	2.8	4.6	6.6	14.8	7.8	14.0			10.8	6.2	10.6	5.3	2.8	9.3	7.6	3.5	5.3	7.6	4.8	7.6	6.6				**7.4**
May 25, 2014	7:00	17:00	4.3	5.8	10.6	3.5	6.0	3.8	11.6	8.6	6.6	3.8	8.1	3.8	6.6	5.6	3.8	12.6	6.4	20.8			20.2	9.8	13.4	5.5	14.3	6.0	5.6	1.5	4.3	6.6	4.6	4.8	5.3				**7.5**
Total			**52.1**	**65.4**	**70.8**	**39.5**	**67.0**	**27.4**	**29.5**	**28.2**	**63.6**	**40.2**	**50.2**	**31.1**	**20.4**	**26.2**	**39.7**	**78.0**	**58.4**	**80.6**	**0.0**	**31.3**	**77.4**	**69.4**	**68.8**	**34.9**	**40.8**	**24.4**	**89.5**	**36.7**	**73.1**	**68.5**	**55.0**	**76.6**	**49.7**	**0.0**	**0.0**	**0.0**	**60.7**

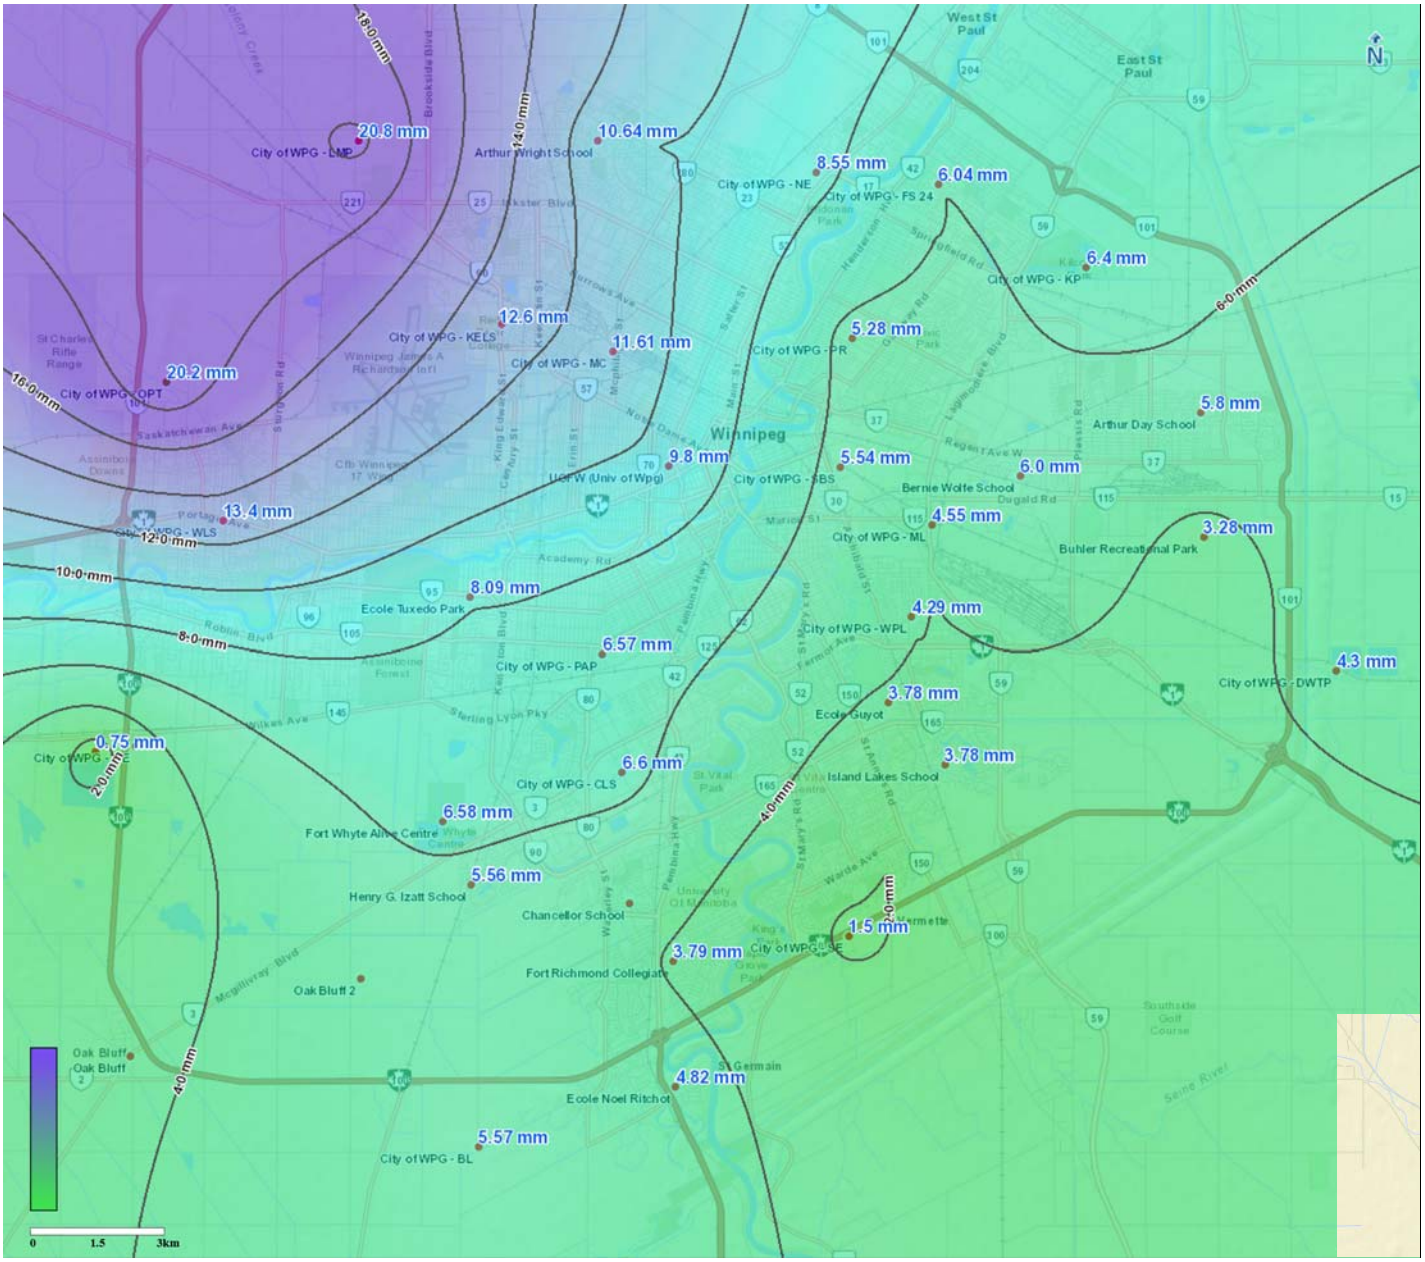

● Rainfall Gauge Station Location —8mm— Isohyetal Line 3.55mm Accumulation	**ALL MEASUREMENTS ARE METRIC** IT IS HEREBY EXPRESSLY UNDERSTOOD that any calculat on, or nformat on provided to private property owners, their agents and contractors with respect to the information provided shall be accepted by such persons at ther own risk, and the CITY shall assume no responsibility for the information conta ned therein. The records of the CITY w ll be supplied on the basis that they are the best knowledge of the CITY and that persons requesting such nformat on must interpret the same for their own needs and/or requirements.	Winnipeg **THE CITY OF WINNIPEG**	**Water and Waste Department** Monday, May 26, 2014 **Rainfall Accumulation with Isohyetal for** **2014-05-25 07:00** **to** **2014-05-25 17:00**

Intensity Duration Frequency Analysis

LMP (Little Mtn Park)

Rainfall Period: 2014-05-25 07:00 to 2014-05-25 17:00
Historical Data: 5-min to 12 hour duration based on MacLaren Drainage Criteria Manual
24 hour duration based on AECOM (2012)

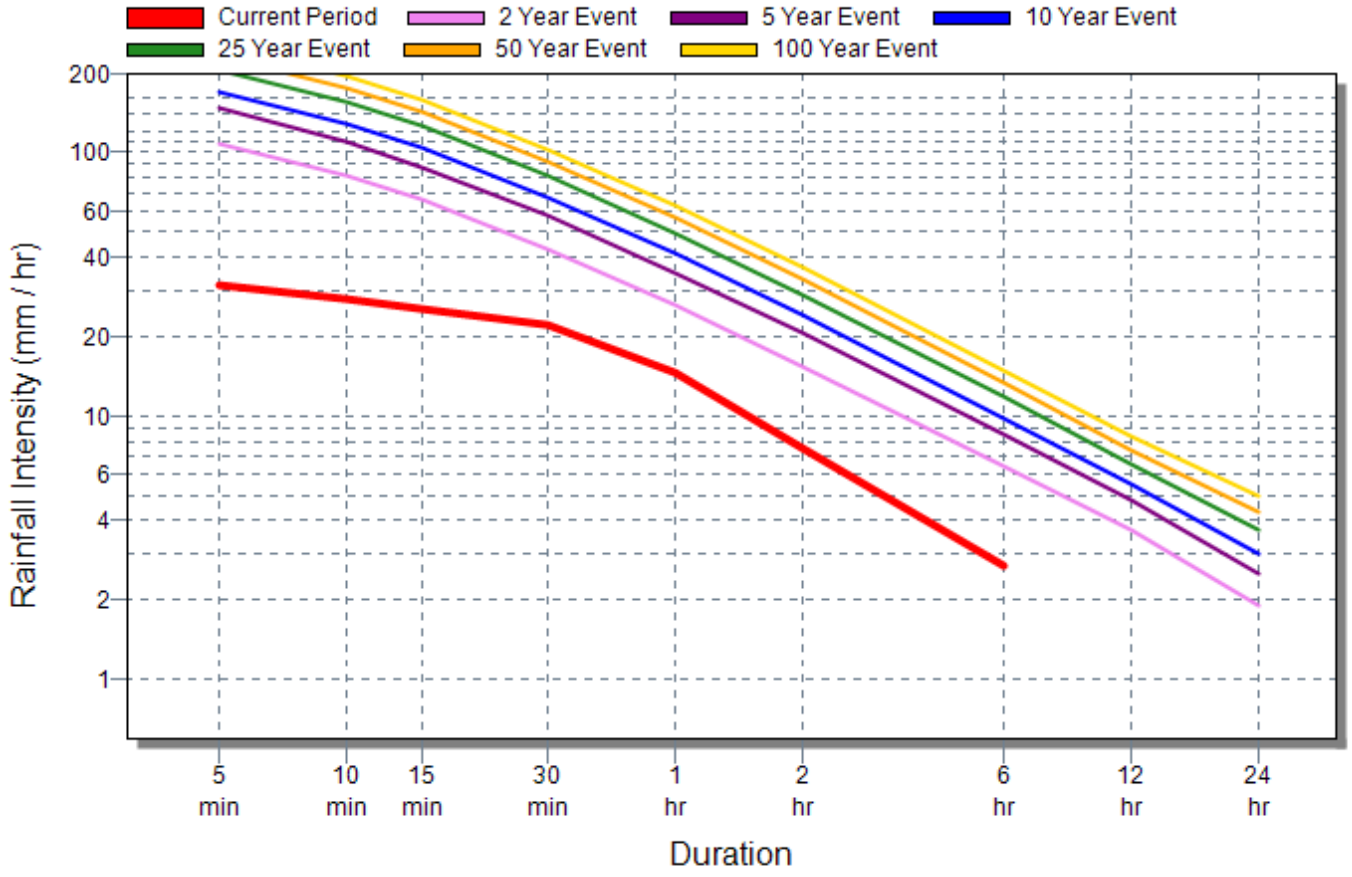

Total Rainfall During Period	20.8 mm
Hours in Period	10.0 hrs

	5 min	10 min	15 min	30 min	1 hr	2 hrs	6 hrs	12 hrs	24 hrs
Current Period	31.2	27.6	25.6	22.0	14.6	7.5	2.7	0.0	0.0
2 Year Event	108.8	81.5	65.9	42.8	26.2	15.4	6.4	3.7	1.9
5 Year Event	146.4	109.5	88.3	57.3	34.9	20.5	8.5	4.8	2.5
10 Year Event	168.8	128.0	103.9	67.8	41.3	24.1	9.8	5.5	3.0
25 Year Event	204.0	154.5	125.4	81.7	49.7	29.0	11.8	6.6	3.7
50 Year Event	231.2	175.1	142.0	92.5	56.3	32.8	13.3	7.4	4.3
100 Year Event	258.4	195.6	158.6	103.2	62.7	36.5	14.8	8.3	5.0

LMP (Little Mtn Park)

Start Date: May 25, 2014 07:50:35
End Date: May 25, 2014 16:15:26
Data: Rainfall (mm)

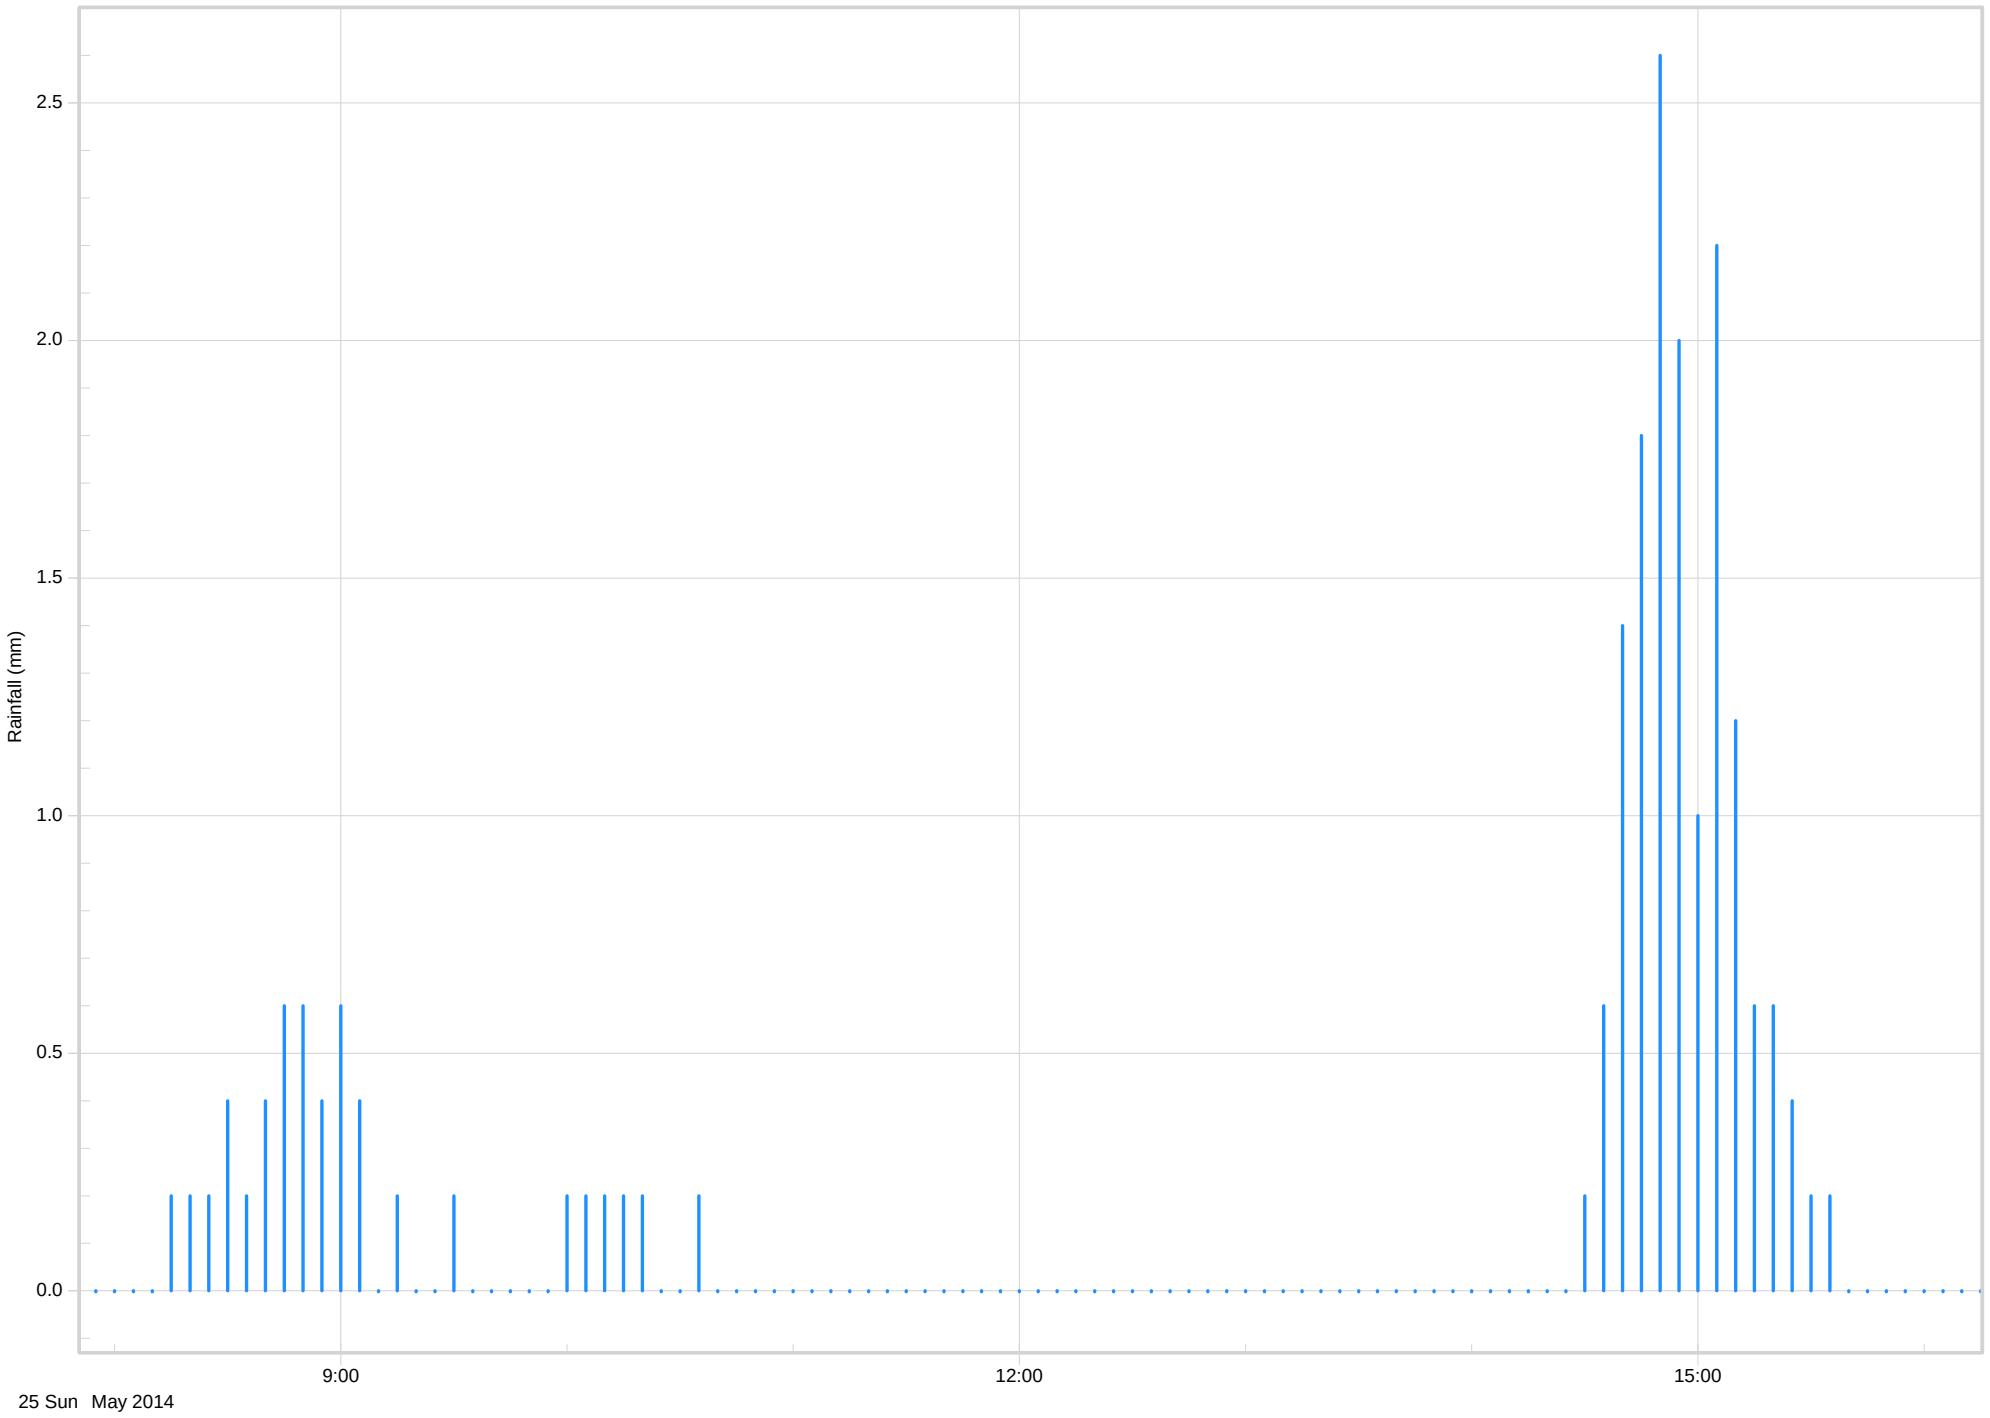

CITY OF WINNIPEG
WATER AND WASTE DEPARTMENT
STORM LOG SUMMER 2014

DATE OF STORM	MAX MUM ACCUMULATION (mm)	STATION WHERE MAX. OCCURRED	MINIMUM ACCUMULATION (mm)	STATION WHERE MIN. OCCURRED	MAXIMUM STATION RETURN PERIOD (30 min. interval)	BASEMENT FLOODING
April 23-25, 2014	22.5	Deacon Water Treatment Plant	8.5	West End Pollution Control Centre	Less than 1 year	Yes
April 28	12.8	Pan Am Pool	4.8	St Boniface Shops	Less than 1 year	Yes
May 7, 2014	6.4	Little Mountain Park	0.8	South End Plant	Less than 1 year	No
May 12	14.5	Deacon Water Treatment Plant	0.5	West End Pollution Control Centre	Less than 1 year	No
May 19-20, 2014	41.1	Brady Road Landfill	3.8	West End Pollution Control Centre	Approximately a 5 year	Yes
May 24,. 2014	16.7	Arthur E. Wright School	2.8	West End Pollution Control Centre	Less than 1 year	No
May 25, 2014	20.8	Little Mountain Park	1.5	South End Plant	Less than 1 year	Yes

Day on which the storm event begins. (6 hour separation between individual

Maximum total rain at any of the telemetry stations.

Station with maximum total rainfall.

Minimum total rainfall at any of the telemetry stations.

Station with minimum total rainfall.

Greatest return period over the 30 minute duration. (Location is not necessarily the same as the

If basement flood--ing has been reported to WWD or District

AECOM

E9f May 12-26, 2014 Daily Rainfall

DateTime	12/05/2014	13/05/2014	14/05/2014	15/05/2014	16/05/2014	17/05/2014	18/05/2014
City of WPG - WPLRainfall (mm)Sum	4.75	0.25	0.25	0	0	0	0
ADS (Arthur Day School)Rainfall (mm)Sum	8	0.8	0	0	0	0	0.2
Arthur Wright SchoolRainfall (mm)Sum	3.25	0.5	0.25	0	0	0	0
Buhler Recreational ParkRainfall (mm)Sum	4.75	0.5	0.25	0	0	0	0
BWS (Bernie Wolfe School)Rainfall (mm)Sum	7.8	0.8	0.6	0	0	0	0.2
Chancellor SchoolRainfall (mm)Sum	4	0.75	0	0.25	0	0	0
City of WPG - MCRainfall (mm)Sum					0	0	0.5
City of WPG - NERainfall (mm)Sum	3.5	0.25	0.25	0	0	0	0
CLS (Clarence Lift Stn)Rainfall (mm)Sum	4.8	0.4	0.4	0	0	0	0
Ecole GuyotRainfall (mm)Sum	4	0.25	0	0	0	0	0
Ecole Tuxedo ParkRainfall (mm)Sum	3	0.25	0	0	0	0	0
Fort Richmond CollegiateRainfall (mm)Sum	4.5	0.75	0	0	0	0	0
Fort Whyte Alive CentreRainfall (mm)Sum	1.5	0	0.25	0	0	0	0
Henry G. Izatt SchoolRainfall (mm)Sum	3	0.5	0	0	0	0	0
Island Lakes SchoolRainfall (mm)Sum	6	0.5	0.25	0	0	0	0
KELS (King Edward Lift Stn)Rainfall (mm)Sum	4	0.2	0.2	0	0	0	0.2
KP (Kilcona Park)Rainfall (mm)Sum	9.4	0.8	0.4	0	0	0	0
LMP (Little Mtn Park)Rainfall (mm)Sum	3.6	0	0.6	0	0	0	0
Oak BluffRainfall (mm)Sum							
Oak Bluff 2Rain 5 Minute (mm)Sum							
OPT (Optimist Park)Rainfall (mm)Sum	2.4	0.2	0	0	0	0	0.2
UOFW (Univ of Wpg)Rainfall (mm)Sum	6.4	0.6	0.4	0	0	0	0.2
WLS (Westwood Lift Stn)Rainfall (mm)Sum	1.6	0	0	0	0	0	0
City of WPG - SBSRainfall (mm)Sum	2.75	0.25	0	0	0	0	0
City of WPG - WERainfall (mm)Sum	0.5	1	0	0	0	0	0
City of WPG - FS 24Rainfall (mm)Sum	5.25	0.25	0.25	0	0	0	0
City of WPG - BLRainfall (mm)Sum	1.5	0.75	0.25	0	0	0	0
City of WPG - SERainfall (mm)Sum	0.9	0.1	0.1	0	0	0	0
City of WPG - DWTPRainfall (mm)Sum	14.5	1.75	0.25	0	0	0	0
City of WPG - PAPRainfall (mm)Sum	4.5	0.5	0.25	0	0	0	0
City of WPG - MLRainfall (mm)Sum	4.5	0.25	0.25	0	0	0	0
Ecole Noel RitchotRainfall (mm)Sum	4.25	0.25	0	0	0	0	0
City of WPG - PRRainfall (mm)Sum	4.25	0.25	0.25	0	0	0	0

DateTime	19/05/2014	20/05/2014	21/05/2014	22/05/2014	23/05/2014	24/05/2014	25/05/2014
City of WPG - WPLRainfall (mm)Sum	8.54	1.75	0	0	0	3.78	4.29
ADS (Arthur Day School)Rainfall (mm)Sum	11.6	1.4	0	0	0	7.6	5.8
Arthur Wright SchoolRainfall (mm)Sum	8.26	0.75	0.25	0	0	16.7	10.64
Buhler Recreational ParkRainfall (mm)Sum	9.6	1.25	0	0	0	5.82	3.53
BWS (Bernie Wolfe School)Rainfall (mm)Sum	10.8	1.8	0.2	0	0	8.2	6
Chancellor SchoolRainfall (mm)Sum	8.04	4.04	0.25	0	0	6.09	3.78
City of WPG - MCRainfall (mm)Sum	9.03	1.25	0.25	0	0	8.11	11.61
City of WPG - NERainfall (mm)Sum	9.54	0.5	0	0	0	9.85	8.55
CLS (Clarence Lift Stn)Rainfall (mm)Sum	9.4	4.6	0.2	0	0	5.2	6.6
Ecole GuyotRainfall (mm)Sum	7.53	2.01	0	0	0	6.6	3.78
Ecole Tuxedo ParkRainfall (mm)Sum	8.79	2.5	0.25	0	0	7.34	8.09
Fort Richmond CollegiateRainfall (mm)Sum	9.58	6.32	0.25	0	0	5.31	3.79
Fort Whyte Alive CentreRainfall (mm)Sum	6.27	3.02	0.25	0	0	2.78	6.58
Henry G. Izatt SchoolRainfall (mm)Sum	7.29	4.02	0.25	0	0	4.55	5.56
Island Lakes SchoolRainfall (mm)Sum	8.29	2.77	0.25	0	0	6.58	3.78
KELS (King Edward Lift Stn)Rainfall (mm)Sum	9.6	0.8	0.4	0	0	14.8	12.6
KP (Kilcona Park)Rainfall (mm)Sum	9.8	1.4	0	0	0	7.8	6.4
LMP (Little Mtn Park)Rainfall (mm)Sum	8.8	0.8	0.6	0	0	14	20.8
Oak BluffRainfall (mm)Sum							
Oak Bluff 2Rain 5 Minute (mm)Sum							
OPT (Optimist Park)Rainfall (mm)Sum	8.4	0.6	0.4	0	0	10.8	20.2
UOFW (Univ of Wpg)Rainfall (mm)Sum	9.8	2.6	0.2	0	0	6.2	9.8
WLS (Westwood Lift Stn)Rainfall (mm)Sum	8.6	0.2	0	0	0	10.6	13.4
City of WPG - SBSRainfall (mm)Sum	4	0.75	0.25	0	0	5.3	5.54
City of WPG - WERainfall (mm)Sum	2.75	1.5	0.25	0	0	2.75	14.27
City of WPG - FS 24Rainfall (mm)Sum	8.52	0.75	0	0	0	9.33	6.04
City of WPG - BLRainfall (mm)Sum	9.58	32.5	0.25	0	0	7.6	5.57
City of WPG - SERainfall (mm)Sum	2.8	3.4	0	0	0	3.5	1.5
City of WPG - DWTPRainfall (mm)Sum	13.4	2.26	0.25	0	0	5.33	4.3
City of WPG - PAPRainfall (mm)Sum	10.55	2.26	0.25	0	0	7.6	6.57
City of WPG - MLRainfall (mm)Sum	8.8	2	0	0	0	4.81	4.55
Ecole Noel RitchotRainfall (mm)Sum	10.07	18.28	0.25	0	0	7.6	4.82
City of WPG - PRRainfall (mm)Sum	7.51	1	0.25	0	0	6.56	5.28

DateTime	26/05/2014	MEAN	MAX	MIN	2014-05-12 to 2014-05-26
City of WPG - WPLRainfall (mm)Sum	0	1.574	8.54	0	23.61
ADS (Arthur Day School)Rainfall (mm)Sum	0	2.36	11.6	0	35.4
Arthur Wright SchoolRainfall (mm)Sum	0	2.70667	16.7	0	40.6
Buhler Recreational ParkRainfall (mm)Sum	0	1.71333	9.6	0	25.7
BWS (Bernie Wolfe School)Rainfall (mm)Sum	0	2.42667	10.8	0	36.4
Chancellor SchoolRainfall (mm)Sum	0	1.81333	8.04	0	27.2
City of WPG - MCRainfall (mm)Sum	0	2.79545	11.61	0	30.75
City of WPG - NERainfall (mm)Sum	0	2.16267	9.85	0	32.44
CLS (Clarence Lift Stn)Rainfall (mm)Sum	0	2.10667	9.4	0	31.6
Ecole GuyotRainfall (mm)Sum	0	1.61133	7.53	0	24.17
Ecole Tuxedo ParkRainfall (mm)Sum	0	2.01467	8.79	0	30.22
Fort Richmond CollegiateRainfall (mm)Sum	0	2.03333	9.58	0	30.5
Fort Whyte Alive CentreRainfall (mm)Sum	0	1.37667	6.58	0	20.65
Henry G. Izatt SchoolRainfall (mm)Sum	0	1.678	7.29	0	25.17
Island Lakes SchoolRainfall (mm)Sum	0	1.89467	8.29	0	28.42
KELS (King Edward Lift Stn)Rainfall (mm)Sum	0	2.85333	14.8	0	42.8
KP (Kilcona Park)Rainfall (mm)Sum	0	2.4	9.8	0	36
LMP (Little Mtn Park)Rainfall (mm)Sum	0	3.28	20.8	0	49.2
Oak BluffRainfall (mm)Sum					
Oak Bluff 2Rain 5 Minute (mm)Sum					
OPT (Optimist Park)Rainfall (mm)Sum	0	2.88	20.2	0	43.2
UOFW (Univ of Wpg)Rainfall (mm)Sum	0	2.41333	9.8	0	36.2
WLS (Westwood Lift Stn)Rainfall (mm)Sum	0	2.29333	13.4	0	34.4
City of WPG - SBSRainfall (mm)Sum	0	1.256	5.54	0	18.84
City of WPG - WERainfall (mm)Sum	2.25	1.68467	14.27	0	25.27
City of WPG - FS 24Rainfall (mm)Sum	0.25	2.04267	9.33	0	30.64
City of WPG - BLRainfall (mm)Sum	0	3.86667	32.5	0	58
City of WPG - SERainfall (mm)Sum	0	0.82	3.5	0	12.3
City of WPG - DWTPRainfall (mm)Sum	0	2.80267	14.5	0	42.04
City of WPG - PAPRainfall (mm)Sum	0	2.16533	10.55	0	32.48
City of WPG - MLRainfall (mm)Sum	0	1.67733	8.8	0	25.16
Ecole Noel RitchotRainfall (mm)Sum	0	3.03467	18.28	0	45.52
City of WPG - PRRainfall (mm)Sum	0	1.69	7.51	0	25.35

AECOM

E9g Sept 23-Oct 7, 2013
Daily Rainfall

DateTime	23/09/2013	24/09/2013	25/09/2013	26/09/2013	27/09/2013	28/09/2013	29/09/2013	30/09/2013
Arthur Wright SchoolRain 5 Minute (mm)Sum	0	0	0	4.32	0.51	16.51	0.25	1.02
Buhler Recreational ParkRain 5 Minute (mm)Sum	0	0	0	0	0.51	19.3	0.25	0
Chancellor SchoolRain 5 Minute (mm)Sum	0	0	0	1.78	1.02	18.03	0	0.25
City of WPG - BLRain 5 Minute (mm)Sum	0	0	0	1.78	1.02	20.83	0	1.02
City of WPG - DWTPRain 5 Minute (mm)Sum	0	0	0	0.25	1.52	30.73	0.51	0.25
City of WPG - NERain 5 Minute (mm)Sum	0	0	0	4.06	0	18.54	0.25	0.25
City of WPG - PAPRain 5 Minute (mm)Sum	0	0	0	3.81	0.25	19.81	0	0.51
City of WPG - PRRain 5 Minute (mm)Sum	0	0	0	3.05	0	20.32	0	0.25
City of WPG - SERain 5 Minute (mm)Sum	0	0	0	0.25	0.76	14.48	0.25	0
City of WPG - WERain 5 Minute (mm)Sum	0	0	0	4.83	0.25	17.02	0	0.76
Ecole GuyotRain 5 Minute (mm)Sum	0	0	0	0.76	1.02	18.03	0.25	0
Ecole Noel RitchotRain 5 Minute (mm)Sum	0	0	0	0.76	0.51	1.27	1.02	0.76
Ecole Tuxedo ParkRain 5 Minute (mm)Sum	0	0	0	3.56	0	0	0	0
Fort Richmond CollegiateRain 5 Minute (mm)Sum	0	0	0	1.27	1.77	17.53	0	0.25
Fort Whyte Alive CentreRain 5 Minute (mm)Sum	0	0	0	3.56	0	16.76	0.25	0.51
Henry G. Izatt SchoolRain 5 Minute (mm)Sum	0	0	0	3.3	0.25	17.78	0.25	0.25
Island Lakes SchoolRain 5 Minute (mm)Sum	0	0	0	0.51	1.02	23.11	0	0.25
Oak Bluff 2Rain 5 Minute (mm)Sum	0	0	0	3.3	0.25	19.81	0.25	0.51
Oak BluffRain 5 Minute (mm)Sum	0	0	0	3.81	0	16	0	0.76
BWS (Bernie Wolfe School)Rainfall (mm)Sum	0	0	0	0.6	1.2	25.8	0.2	0
ADS (Arthur Day School)Rainfall (mm)Sum	0	0	0	0.6	1	26.4	0.2	0
CLS (Clarence Lift Stn)Rainfall (mm)Sum	0	0	0	3	0.4	24.8	0	0
KELS (King Edward Lift Stn)Rainfall (mm)Sum	0	0	0	5.4	0.2	26	0	0.2
LMP (Little Mtn Park)Rainfall (mm)Sum	0	0	0	7	0.2	26.4	0.2	0.2
OPT (Optimist Park)Rainfall (mm)Sum	0	0	0	6.6	0	26.6	0	0
UOFW (Univ of Wpg)Rainfall (mm)Sum	0	0	0	3.8	0.2	28.8	0	0
WLS (Westwood Lift Stn)Rainfall (mm)Sum	0	0	0	6	0.2	26	0	0.2

DateTime	01/10/2013	02/10/2013	03/10/2013	04/10/2013	05/10/2013	06/10/2013	07/10/2013	MEAN
Arthur Wright SchoolRain 5 Minute (mm)Sum	3.55	0	0	0	0	0	0	1.744
Buhler Recreational ParkRain 5 Minute (mm)Sum	3.3	0	0	0	0	0	0	1.55733
Chancellor SchoolRain 5 Minute (mm)Sum	3.82	0	0	0	0	0	0	1.66
City of WPG - BLRain 5 Minute (mm)Sum	3.81	0	0	0	0	0	0	1.89733
City of WPG - DWTPRain 5 Minute (mm)Sum	5.59	0	0.25	0	0	0	0	2.60667
City of WPG - NERain 5 Minute (mm)Sum	3.05	0	0	0	0	0	0	1.74333
City of WPG - PAPRain 5 Minute (mm)Sum	2.53	0	0	0	0	0	0	1.794
City of WPG - PRRain 5 Minute (mm)Sum	2.79	0	0	0	0	0	0	1.76067
City of WPG - SERain 5 Minute (mm)Sum	3.3	0	0	0	0	0	0	1.26933
City of WPG - WERain 5 Minute (mm)Sum	1.78	0	0	0	0	0	0	1.64267
Ecole GuyotRain 5 Minute (mm)Sum	3.56	0	0	0	0	0	0	1.57467
Ecole Noel RitchotRain 5 Minute (mm)Sum	0.25	0.51	1.02	0	0	0	0	0.40667
Ecole Tuxedo ParkRain 5 Minute (mm)Sum	2.29	0	0	0	0	0	0	0.39
Fort Richmond CollegiateRain 5 Minute (mm)Sum	4.32	0	0	0	0	0	0	1.676
Fort Whyte Alive CentreRain 5 Minute (mm)Sum	2.03	0	0	0	0	0	0	1.54067
Henry G. Izatt SchoolRain 5 Minute (mm)Sum	2.29	0	0	0	0	0	0	1.608
Island Lakes SchoolRain 5 Minute (mm)Sum	3.81	0	0	0	0	0	0	1.91333
Oak Bluff 2Rain 5 Minute (mm)Sum	2.54	0	0	0	0	0	0	1.77733
Oak BluffRain 5 Minute (mm)Sum	2.03	0	0	0	0	0	0	1.50667
BWS (Bernie Wolfe School)Rainfall (mm)Sum	3.4	0	0	0	0	0	0	2.08
ADS (Arthur Day School)Rainfall (mm)Sum	3.2	0	0	0	0	0	0	2.09333
CLS (Clarence Lift Stn)Rainfall (mm)Sum	3	0	0	0	0	0	0	2.08
KELS (King Edward Lift Stn)Rainfall (mm)Sum	4.4	0	0	0	0	0	0	2.41333
LMP (Little Mtn Park)Rainfall (mm)Sum	4.2	0	0	0	0	0	0	2.54667
OPT (Optimist Park)Rainfall (mm)Sum	3.4	0	0	0	0	0	0	2.44
UOFW (Univ of Wpg)Rainfall (mm)Sum	3.6	0	0	0	0	0	0	2.42667
WLS (Westwood Lift Stn)Rainfall (mm)Sum	3.8	0	0	0	0	0	0	2.41333

DateTime	MAX	MIN	2013-09-23 to 2013-10-07
Arthur Wright SchoolRain 5 Minute (mm)Sum	16.51	0	26.16
Buhler Recreational ParkRain 5 Minute (mm)Sum	19.3	0	23.36
Chancellor SchoolRain 5 Minute (mm)Sum	18.03	0	24.9
City of WPG - BLRain 5 Minute (mm)Sum	20.83	0	28.46
City of WPG - DWTPRain 5 Minute (mm)Sum	30.73	0	39.1
City of WPG - NERain 5 Minute (mm)Sum	18.54	0	26.15
City of WPG - PAPRain 5 Minute (mm)Sum	19.81	0	26.91
City of WPG - PRRain 5 Minute (mm)Sum	20.32	0	26.41
City of WPG - SERain 5 Minute (mm)Sum	14.48	0	19.04
City of WPG - WERain 5 Minute (mm)Sum	17.02	0	24.64
Ecole GuyotRain 5 Minute (mm)Sum	18.03	0	23.62
Ecole Noel RitchotRain 5 Minute (mm)Sum	1.27	0	6.1
Ecole Tuxedo ParkRain 5 Minute (mm)Sum	3.56	0	5.85
Fort Richmond CollegiateRain 5 Minute (mm)Sum	17.53	0	25.14
Fort Whyte Alive CentreRain 5 Minute (mm)Sum	16.76	0	23.11
Henry G. Izatt SchoolRain 5 Minute (mm)Sum	17.78	0	24.12
Island Lakes SchoolRain 5 Minute (mm)Sum	23.11	0	28.7
Oak Bluff 2Rain 5 Minute (mm)Sum	19.81	0	26.66
Oak BluffRain 5 Minute (mm)Sum	16	0	22.6
BWS (Bernie Wolfe School)Rainfall (mm)Sum	25.8	0	31.2
ADS (Arthur Day School)Rainfall (mm)Sum	26.4	0	31.4
CLS (Clarence Lift Stn)Rainfall (mm)Sum	24.8	0	31.2
KELS (King Edward Lift Stn)Rainfall (mm)Sum	26	0	36.2
LMP (Little Mtn Park)Rainfall (mm)Sum	26.4	0	38.2
OPT (Optimist Park)Rainfall (mm)Sum	26.6	0	36.6
UOFW (Univ of Wpg)Rainfall (mm)Sum	28.8	0	36.4
WLS (Westwood Lift Stn)Rainfall (mm)Sum	26	0	36.2

E10 Red River Trend 2014

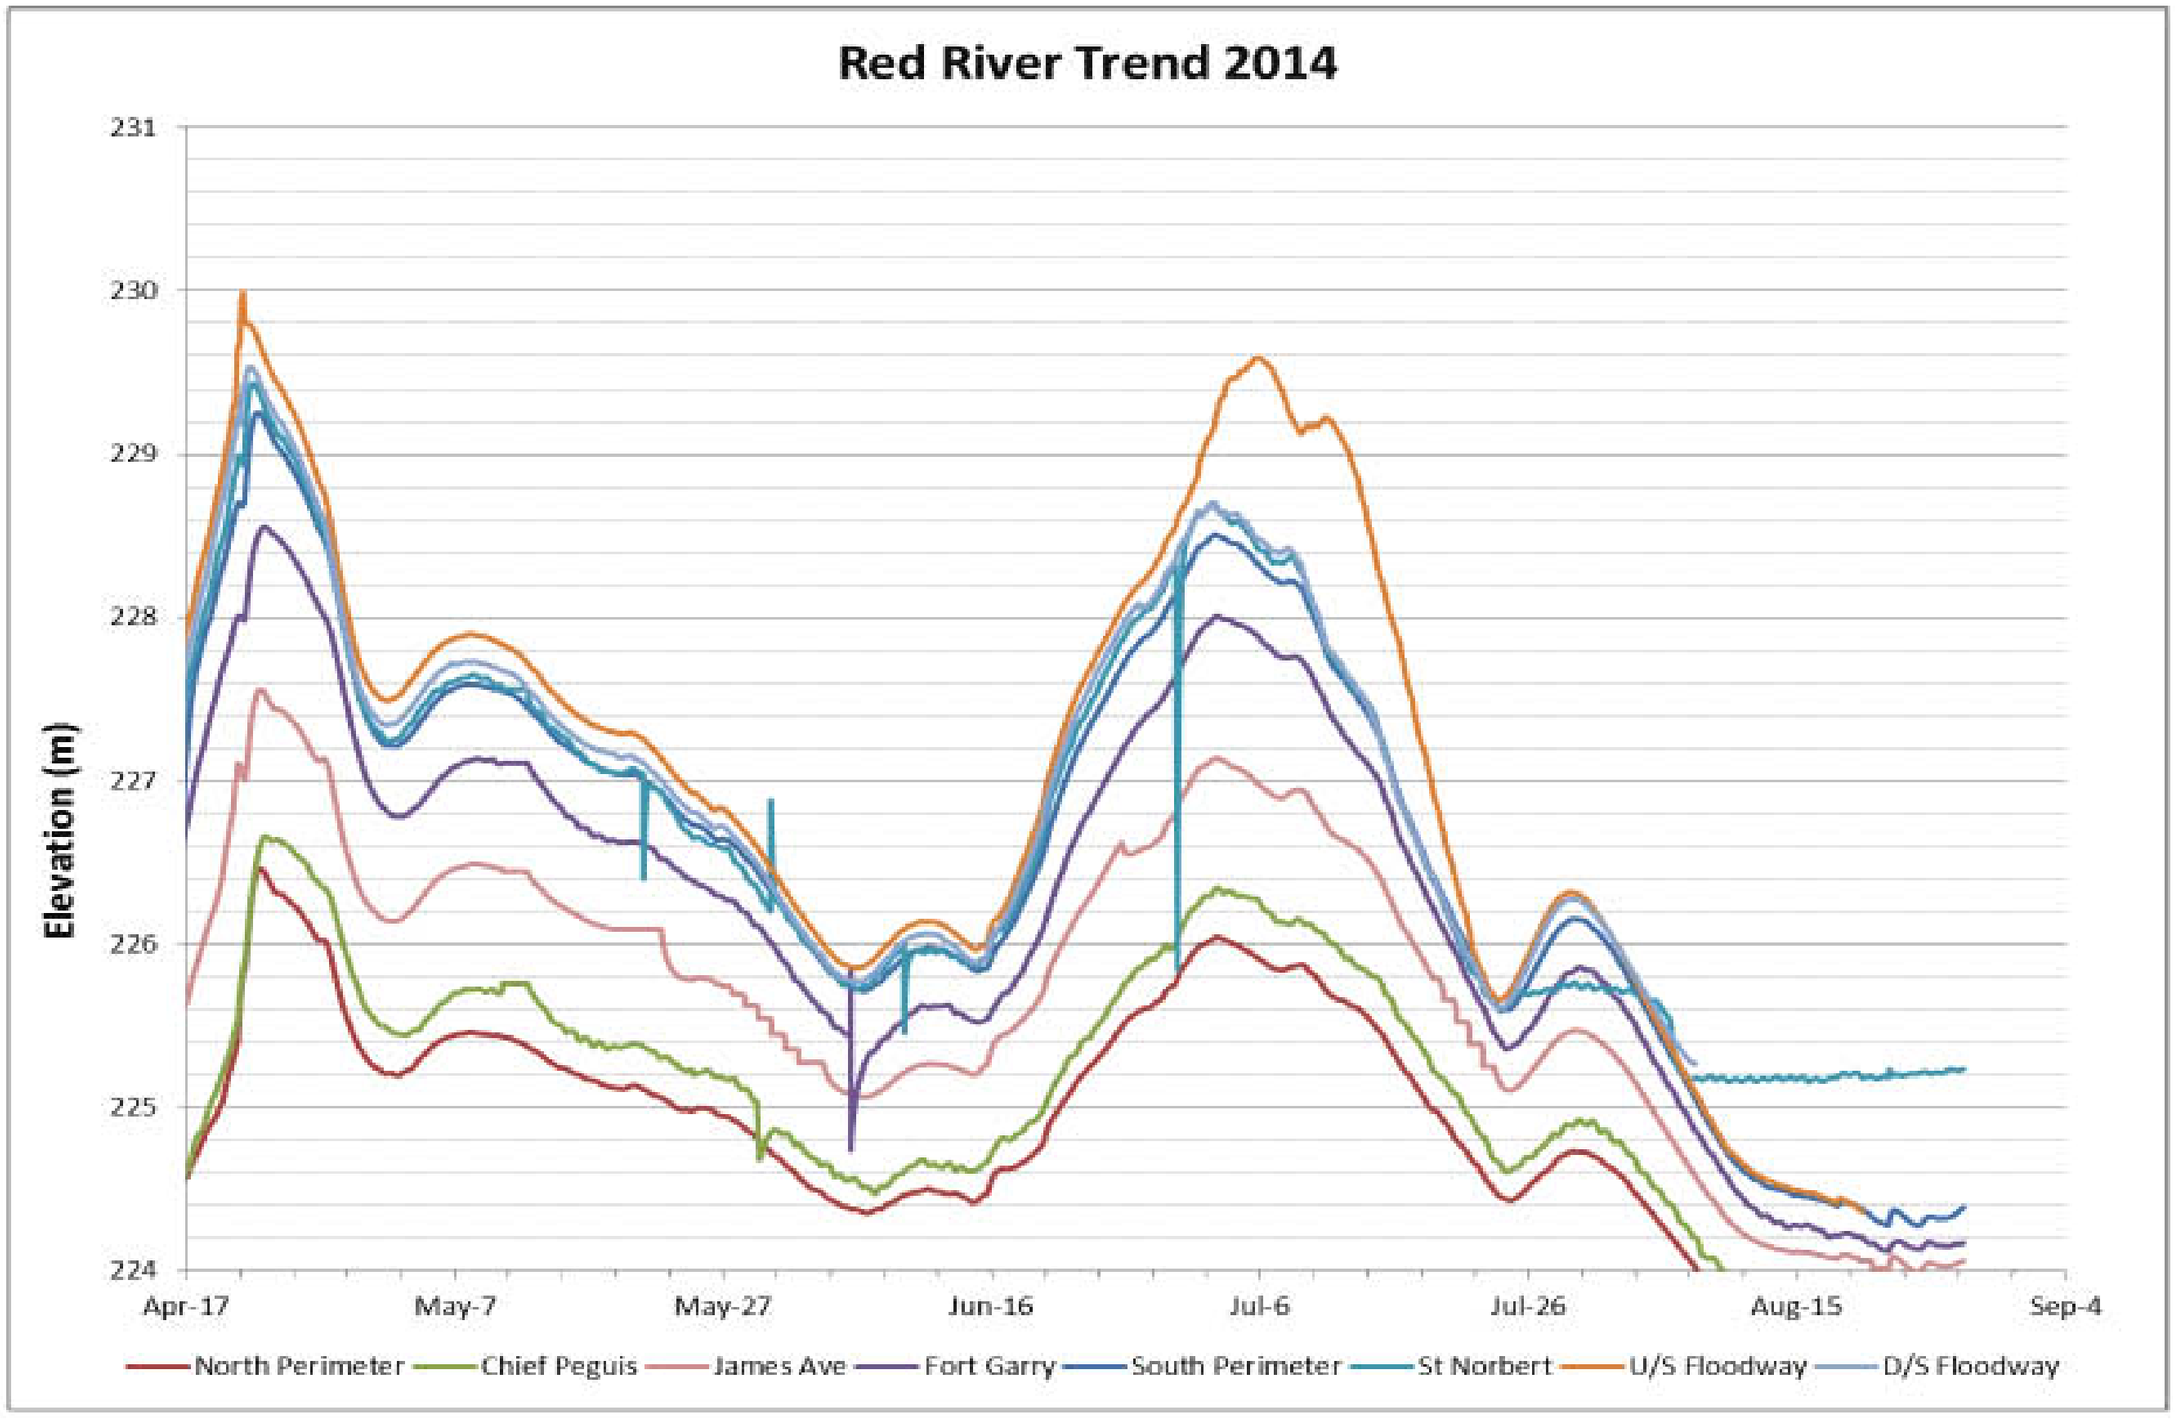
Red River Trend 2014
Elevation (m)
231
230
229
228
227
226
225
224
Apr-17
May-7
May-27
Jun-16
Jul-6
Jul-26
Aug-15
Sep-4
North Perimeter
Chief Peguis
James Ave
Fort Garry
South Perimeter
St Norbert
U/S Floodway
D/S Floodway

E11 Weather Data

AECOM

E11a Jan 1-Feb 23, 2015 Environment Canada Weather Data

Station Name	WINNIPEG THE FORKS
Province	MANITOBA
Latitude	49.89
Longitude	-97.13
Elevation	230
Climate Identifier	5023262
WMO Identifier	71579
TC Identifier	XWN

Legend

A	Accumulated
C	Precipitation occurred, amount uncertain
E	Estimated
F	Accumulated and estimated
L	Precipitation may or may not have occurred
M	Missing
N	Temperature missing but known to be > 0
S	More than one occurrence
T	Trace
Y	Temperature missing but known to be < 0
[empty]	No data available
^	The value displayed is based on incomplete data
†	Data for this day has undergone only preliminary quality checking
‡	Partner data that is not subject to review by the National Climate Archives

Date/Time	Year	Month	Day	Data Quality	Max Temp (°C)	Min Temp (°C)	Mean Temp (°C)	Heat Deg Days (°C)	Total Precip (mm)	Dir of Max Gust (10s deg)	Spd of Max Gust (km/h)
1/1/2015	2015	1	1	†	-4.3	-19	-11.7	29.7	0	3	41
1/2/2015	2015	1	2	†	-13.5	-19.5	-16.5	34.5	5	2	35
1/3/2015	2015	1	3	†	-19.5	-26.9	-23.2	41.2	2.2	35	41
1/4/2015	2015	1	4	†	-26	-29.1	-27.6	45.6	0		<31
1/5/2015	2015	1	5	†	-16.9	-27	-22	40	0		<31
1/6/2015	2015	1	6	†	-16.5	-23.9	-20.2	38.2	0	34	44
1/7/2015	2015	1	7	†	-17.8	-24.4	-21.1	39.1	0		<31
1/8/2015	2015	1	8	†	-14.5	-20	-17.3	35.3	3.6	36	43
1/9/2015	2015	1	9	†	-16.1	-20.1	-18.1	36.1	0.2	31	32
1/10/2015	2015	1	10	†	-18.3	-22.1	-20.2	38.2	0.2		<31
1/11/2015	2015	1	11	†	-17.3	-23.3	-20.3	38.3	0.2		<31
1/12/2015	2015	1	12	†	-20.4	-27.1	-23.8	41.8	0		<31
1/13/2015	2015	1	13	†	-11.4	-21.6	-16.5	34.5		23	57
1/14/2015	2015	1	14	†	0.4	-11.5	-5.6	23.6	3.1	20	48
1/15/2015	2015	1	15	†	1.2	-17.4	-8.1	26.1	0	32	61
1/16/2015	2015	1	16	†	-3.3	-19.5	-11.4	29.4	0	20	54
1/17/2015	2015	1	17	†	1.1	-6	-2.5	20.5	1.1	29	54
1/18/2015	2015	1	18	†	0.4	-12.1	-5.9	23.9	0	32	54
1/19/2015	2015	1	19	†	-3.4	-10.9	-7.2	25.2	0	10	41
1/20/2015	2015	1	20	†	-3.4	-9.6	-6.5	24.5	0	35	46
1/21/2015	2015	1	21	†	-9.6	-16.4	-13	31	0	36	50
1/22/2015	2015	1	22	†	3.8	-9.7	-3	21	0	22	87
1/23/2015	2015	1	23	†	4.9	0.2	2.6	15.4	0	34	54
1/24/2015	2015	1	24	†	0.2	-10.2	-5	23	0	1	56
1/25/2015	2015	1	25	†	-2.4	-10.1	-6.3	24.3	0	22	59
1/26/2015	2015	1	26	†	2.6	-4.7	-1.1	19.1	0	33	65
1/27/2015	2015	1	27	†	-0.1	-5.5	-2.8	20.8	0	23	35
1/28/2015	2015	1	28	†	-0.5	-9.1	-4.8	22.8	0.8	33	70

1/29/2015	2015	1	29	†	-9	-17.3	-13.2	31.2	0	34	72
1/30/2015	2015	1	30	†	-7.2	-16	-11.6	29.6	0.8	36	83
1/31/2015	2015	1	31	†	-13.7	-25	-19.4	37.4	0	35	69
2/1/2015	2015	2	1	†	-19.4	-26.6	-23	41	0	23	48
2/2/2015	2015	2	2	†	-12.6	-19.6	-16.1	34.1	0	22	48
2/3/2015	2015	2	3	†	-10.8	-17.9	-14.4	32.4	0.2	33	52
2/4/2015	2015	2	4	†	-17.3	-23.4	-20.4	38.4		35	50
2/5/2015	2015	2	5	†	-7.2	-17.8	-12.5	30.5	0	19	35
2/6/2015	2015	2	6	†	-13.2	-18	-15.6	33.6	0.7		<31
2/7/2015	2015	2	7	†	-10.1	-15	-12.6	30.6	0		<31
2/8/2015	2015	2	8	†	-14.3	-22.2	-18.3	36.3	0.2		<31
2/9/2015	2015	2	9	†	-12.6	-17.2	-14.9	32.9	0		<31
2/10/2015	2015	2	10	†	-4.6	-15.3	-10	28	5.7	33	37
2/11/2015	2015	2	11	†	-15.3	-24.4	-19.9	37.9	0	34	37
2/12/2015	2015	2	12	†	-14.5	-24.9	-19.7	37.7	0	22	35
2/13/2015	2015	2	13	†	-11.7	-22.6	-17.2	35.2	0	34	41
2/14/2015	2015	2	14	†	-22.1	-28.4	-25.3	43.3	0	1	33
2/15/2015	2015	2	15	†	-13.9	-22.1	-18	36	0.2	22	33
2/16/2015	2015	2	16	†	-12.1	-19.9	-16	34	0	33	32
2/17/2015	2015	2	17	†	-17.9	-24	-21	39	0	31	33
2/18/2015	2015	2	18	†	-21.1	-26.7	-23.9	41.9	0		<31
2/19/2015	2015	2	19	†	-12.8	-28.3	-20.6	38.6	0.4		<31
2/20/2015	2015	2	20	†	-10.3	-18.8	-14.6	32.6	1.4		<31
2/21/2015	2015	2	21	†	-18.7	-27.8	-23.3	41.3	0	2	32
2/22/2015	2015	2	22	†	-21.2	-29.7	-25.5	43.5	0		<31
2/23/2015	2015	2	23	†	-2.5	-24.7	-13.6	31.6	0.4	21	44

E11b 2014 Environment Canada Weather Data

Station Name	WINNIPEG THE FORKS
Province	MANITOBA
Latitude	49.89
Longitude	-97.13
Elevation	230
Climate Identifier	5023262
WMO Identifier	71579
TC Identifier	XWN

Legend

A	Accumulated
C	Precipitation occurred, amount uncertain
E	Estimated
F	Accumulated and estimated
L	Precipitation may or may not have occurred
M	Missing
N	Temperature missing but known to be > 0
S	More than one occurrence
T	Trace
Y	Temperature missing but known to be < 0
[empty]	No data available
^	The value displayed is based on incomplete data
†	Data for this day has undergone only preliminary quality checking
‡	Partner data that is not subject to review by the National Climate Archives

Date/Time	Year	Month	Day	Data Quality	Max Temp (°C)	Min Temp (°C)	Mean Temp (°C)	Heat Deg Days (°C)	Total Rain Flag	Total Snow Flag	Total Precip (mm)	Dir of Max Gust (10s deg)	Spd of Max Gust (km/h)
1/1/2014	2014	1	1	†	-24.1	-30	-27.1	45.1	M	M	0		<31
1/2/2014	2014	1	2	†	-20.6	-30.4	-25.5	43.5	M	M	0		<31
1/3/2014	2014	1	3	†	-11.1	-20.6	-15.9	33.9	M	M	14.7	32	39
1/4/2014	2014	1	4	†	-13 8	-27.2	-20.5	38.5	M	M	0.2	36	39
1/5/2014	2014	1	5	†	-27.1	-31.7	-29.4	47.4	M	M	0		<31
1/6/2014	2014	1	6	†	-24.4	-31.4	-27.9	45.9	M	M	0		<31
1/7/2014	2014	1	7	†	-20 8	-27.5	-24.2	42.2	M	M	0		<31
1/8/2014	2014	1	8	†	-20.4	-27.7	-24.1	42.1	M	M	0		<31
1/9/2014	2014	1	9	†	-5 8	-20.4	-13.1	31.1	M	M	0	22	32
1/10/2014	2014	1	10	†	-3 9	-9	-6 5	24.5	M	M	0		<31
1/11/2014	2014	1	11	†	-4.7	-9 5	-7.1	25.1	M	M	0.2		<31
1/12/2014	2014	1	12	†	1	-6.1	-2.6	20.6	M	M	0		<31
1/13/2014	2014	1	13	†	-6 2	-14.6	-10.4	28.4	M	M	0		<31
1/14/2014	2014	1	14	†	-12.1	-19.2	-15.7	33.7	M	M	1.5	35	32
1/15/2014	2014	1	15	†	2 9	-22.3	-9.7	27.7	M	M	2.5	33	61
1/16/2014	2014	1	16	†	-5 5	-20.7	-13.1	31.1	M	M	0.7	33	54
1/17/2014	2014	1	17	†	-11.7	-24.2	-18	36	M	M	4.3		<31
1/18/2014	2014	1	18	†	-0.1	-15.2	-7.7	25.7	M	M	0.2		<31
1/19/2014	2014	1	19	†	-2	-19.6	-10.8	28.8	M	M	0.7		<31
1/20/2014	2014	1	20	†	-19.6	-27.2	-23.4	41.4	M	M	0.2	1	37
1/21/2014	2014	1	21	†	-15.7	-26.6	-21.2	39.2	M	M	1.2	1	32
1/22/2014	2014	1	22	†	-18 3	-26.8	-22.6	40.6	M	M	0.2	33	35
1/23/2014	2014	1	23	†	-6 3	-29.5	-17.9	35.9	M	M	2.4	23	41
1/24/2014	2014	1	24	†	-1 2	-16.7	-9	27	M	M	3.4	35	48
1/25/2014	2014	1	25	†	-16.7	-22.3	-19.5	37.5	M	M	0	1	35
1/26/2014	2014	1	26	†	-17 9	-27	-22.5	40.5	M	M	1.4	32	52
1/27/2014	2014	1	27	†	-24.4	-28.7	-26.6	44.6	M	M	0	33	33
1/28/2014	2014	1	28	†	-15 8	-27.4	-21.6	39.6	M	M	0		<31
1/29/2014	2014	1	29	†	-10 3	-21.4	-15.9	33.9	M	M	0	33	41
1/30/2014	2014	1	30	†	-19.1	-23.9	-21.5	39.5	M	M	0	32	32
1/31/2014	2014	1	31	†	-15 2	-24.9	-20.1	38.1	M	M	0		<31
2/1/2014	2014	2	1	†	-16 5	-23.5	-20	38	M	M	0		<31
2/2/2014	2014	2	2	†	-10.7	-24	-17.4	35.4	M	M	0		<31
2/3/2014	2014	2	3	†	-11.4	-19.9	-15.7	33.7	M	M	0		<31
2/4/2014	2014	2	4	†	-17.1	-19.8	-18.5	36.5	M	M	0		<31
2/5/2014	2014	2	5	†	-18.7	-23.7	-21.2	39.2	M	M	0		
2/6/2014	2014	2	6	†	-13 2	-22.1	-17.7	35.7	M	M			<31
2/7/2014	2014	2	7	†	-13 9	-20.3	-17.1	35.1	M	M	0		<31
2/8/2014	2014	2	8	†	-16.4	-22.2	-19.3	37.3	M	M	0		<31
2/9/2014	2014	2	9	†	-21 2	-25.6	-23.4	41.4	M	M	0		<31
2/10/2014	2014	2	10	†	-17 9	-26.1	-22	40	M	M	0		<31
2/11/2014	2014	2	11	†	-12 2	-23.5	-17.9	35.9	M	M	1.8	21	41
2/12/2014	2014	2	12	†	-17.7	-21.8	-19.8	37.8	M	M	0		
2/13/2014	2014	2	13	†	-15 9	-23.3	-19.6	37.6	M	M	4.1	36	37

Date/Time	Year	Month	Day	Data Quality	Max Temp (°C)	Min Temp (°C)	Mean Temp (°C)	Heat Deg Days (°C)	Total Rain Flag	Total Snow Flag	Total Precip (mm)	Dir of Max Gust (10s deg)	Spd of Max Gust (km/h)
2/14/2014	2014	2	14	†	-15 8	-24.6	-20.2	38.2	M	M	0		<31
2/15/2014	2014	2	15	†	-12 8	-18.4	-15.6	33.6	M	M	0	1	33
2/16/2014	2014	2	16	†	-8 2	-22.8	-15.5	33.5	M	M	1.2		<31
2/17/2014	2014	2	17	†	-1.6	-8.6	-5.1	23.1	M	M	4.5		<31
2/18/2014	2014	2	18	†	1 9	-10.1	-4.1	22.1	M	M	0		<31
2/19/2014	2014	2	19	†	-4 9	-11.3	-8.1	26.1	M	M	0.3		<31
2/20/2014	2014	2	20	†	-6	-18.3	-12.2	30.2	M	M	2.6		<31
2/21/2014	2014	2	21	†	-13 8	-20.1	-17	35	M	M	0.4	35	43
2/22/2014	2014	2	22	†	-13.1	-16.9	-15	33	M	M	0.7	33	41
2/23/2014	2014	2	23	†	-13 8	-19.2	-16.5	34.5	M	M	0	33	39
2/24/2014	2014	2	24	†	-18	-23.9	-21	39	M	M	0		<31
2/25/2014	2014	2	25	†	-20.1	-23.6	-21.9	39.9	M	M	0	32	37
2/26/2014	2014	2	26	†	-14 2	-27.3	-20.8	38.8	M	M	0	32	52
2/27/2014	2014	2	27	†	-20	-29.3	-24.7	42.7	M	M	0		<31
2/28/2014	2014	2	28	†	-17.6	-26.9	-22.3	40.3	M	M	2	32	35
3/1/2014	2014	3	1	†	-24.6	-32.2	-28.4	46.4	M	M	0		<31
3/2/2014	2014	3	2	†	-18.7	-27.2	-23	41	M	M	0		<31
3/3/2014	2014	3	3	†	-15 8	-27.4	-21.6	39.6	M	M	0		<31
3/4/2014	2014	3	4	†	-12.7	-25.7	-19.2	37.2	M	M	0		<31
3/5/2014	2014	3	5	†	-6 2	-18.9	-12.6	30.6	M	M	2	19	32
3/6/2014	2014	3	6	†	-4.6	-8 3	-6 5	24.5	M	M	10.7		<31
3/7/2014	2014	3	7	†	-8 3	-17.7	-13	31	M	M	0	1	33
3/8/2014	2014	3	8	†	-4.1	-20	-12.1	30.1	M	M	0.2		<31
3/9/2014	2014	3	9	†	1	-5 8	-2.4	20.4	M	M	0		<31
3/10/2014	2014	3	10	†	6	-6 3	-0 2	18.2	M	M	0		<31
3/11/2014	2014	3	11	†	-4.1	-16.4	-10.3	28.3	M	M	0	33	32
3/12/2014	2014	3	12	†	-4 2	-19.5	-11.9	29.9	M	M	0	23	32
3/13/2014	2014	3	13	†	4 9	-6.6	-0 9	18.9	M	M	0		<31
3/14/2014	2014	3	14	†	1 9	-17.4	-7 8	25.8	M	M	0	33	43
3/15/2014	2014	3	15	†	-14 8	-23.1	-19	37	M	M	0		<31
3/16/2014	2014	3	16	†	-2 3	-20.6	-11.5	29.5	M	M	7.8	17	35
3/17/2014	2014	3	17	†	-2.1	-5 9	-4	22	M	M	0		<31
3/18/2014	2014	3	18	†	-2 5	-5.7	-4.1	22.1	M	M	0.2		<31
3/19/2014	2014	3	19	†	2.6	-5 3	-1.4	19.4	M	M	0		<31
3/20/2014	2014	3	20	†	2 5	-7 8	-2.7	20.7	M	M	0		<31
3/21/2014	2014	3	21	†	-2.6	-16.6	-9.6	27.6	M	M	0	31	46
3/22/2014	2014	3	22	†	-12.1	-19.1	-15.6	33.6	M	M	0.2		<31
3/23/2014	2014	3	23	†	-9 9	-22	-16	34	M	M	0		<31
3/24/2014	2014	3	24	†	-8 2	-14.7	-11.5	29.5	M	M	0	35	41
3/25/2014	2014	3	25	†	-7 5	-16.9	-12.2	30.2	M	M	0		<31
3/26/2014	2014	3	26	†	-0 8	-14.1	-7 5	25.5	M	M	0		<31
3/27/2014	2014	3	27	†	-5.7	-12.4	-9.1	27.1	M	M	0	32	39
3/28/2014	2014	3	28	†	-3	-16.3	-9.7	27.7	M	M	0		<31
3/29/2014	2014	3	29	†	3.7	-8.4	-2.4	20.4	M	M	0	22	41
3/30/2014	2014	3	30	†	3.4	-11.8	-4 2	22.2	M	M	0	36	43
3/31/2014	2014	3	31	†	-7.7	-12.8	-10.3	28.3	M	M	0	2	46
4/1/2014	2014	4	1	†	-5.6	-13.5	-9.6	27.6	M	M	0	1	32
4/2/2014	2014	4	2	†	0 3	-15	-7.4	25.4	M	M	0		<31
4/3/2014	2014	4	3	†	0 5	-5 9	-2.7	20.7	M	M	4.6		<31
4/4/2014	2014	4	4	†	2	-2 9	-0 5	18.5	M	M	0.2		<31
4/5/2014	2014	4	5	†	7	-2 9	2.1	15.9	M	M	0	23	32
4/6/2014	2014	4	6	†	8.4	-4.6	1.9	16.1	M	M	0.2		<31
4/7/2014	2014	4	7	†	3 5	-3 2	0.2	17.8	M	M	0		<31
4/8/2014	2014	4	8	†	6	-2.1	2	16	M	M	0.2		<31
4/9/2014	2014	4	9	†	11.5	2 3	6.9	11.1	M	M	0	26	44
4/10/2014	2014	4	10	†	8.1	2 5	5.3	12.7	M	M	0	29	33
4/11/2014	2014	4	11	†	3 5	-4.6	-0.6	18.6	M	M	0		<31
4/12/2014	2014	4	12	†	1.4	-4.7	-1.7	19.7	M	M	5.9	31	39
4/13/2014	2014	4	13	†	-1 8	-7.6	-4.7	22.7	M	M	0	33	41
4/14/2014	2014	4	14	†	-6 5	-12.2	-9.4	27.4	M	M	0	32	35
4/15/2014	2014	4	15	†	-1 9	-12.4	-7 2	25.2	M	M	0.2		<31
4/16/2014	2014	4	16	†	0.6	-8 2	-3 8	21.8	M	M	0		<31
4/17/2014	2014	4	17	†	2.7	-10.8	-4.1	22.1	M	M	0		<31
4/18/2014	2014	4	18	†	8.1	-6	1.1	16.9	M	M	1	13	39
4/19/2014	2014	4	19	†	12.6	1.7	7.2	10.8	M	M	1.7	22	43
4/20/2014	2014	4	20	†	11.7	0 8	6.3	11.7	M	M	0.5	33	35
4/21/2014	2014	4	21	†	8.6	1.1	4.9	13.1	M	M	0.2	33	39
4/22/2014	2014	4	22	†	13.8	0 8	7.3	10.7	M	M	0		<31
4/23/2014	2014	4	23	†	14.3	2 2	8.3	9.7	M	M	4.5	11	37

Date/Time	Year	Month	Day	Data Quality	Max Temp (°C)	Min Temp (°C)	Mean Temp (°C)	Heat Deg Days (°C)	Total Rain Flag	Total Snow Flag	Total Precip (mm)	Dir of Max Gust (10s deg)	Spd of Max Gust (km/h)
4/24/2014	2014	4	24	†	5	0.4	2.7	15.3	M	M	12.5		<31
4/25/2014	2014	4	25	†	8 9	0 5	4.7	13.3	M	M	2.7		<31
4/26/2014	2014	4	26	†	11.8	-0 2	5.8	12.2	M	M	0.2		<31
4/27/2014	2014	4	27	†	10	2.6	6.3	11.7	M	M	0	9	44
4/28/2014	2014	4	28	†	7 5	2 9	5.2	12.8	M	M	9.6	12	39
4/29/2014	2014	4	29	†	12.3	0 8	6.6	11.4	M	M	0	36	41
4/30/2014	2014	4	30	†	7.7	2 8	5.3	12.7	M	M	1.6	35	35
5/1/2014	2014	5	1	†	15.2	2 8	9	9	M	M	0.2	35	32
5/2/2014	2014	5	2	†	10.4	4 2	7.3	10.7	M	M	2.1	36	37
5/3/2014	2014	5	3	†	7	1 8	4.4	13.6	M	M	0.9	33	41
5/4/2014	2014	5	4	†	8.7	-0 5	4.1	13.9	M	M	0.3		<31
5/5/2014	2014	5	5	†	13	1.7	7.4	10.6	M	M	0		<31
5/6/2014	2014	5	6	†	12.9	4.4	8.7	9.3	M	M	0		<31
5/7/2014	2014	5	7	†	14.4	7	10.7	7.3	M	M	3.4		<31
5/8/2014	2014	5	8	†	10.5	4 9	7.7	10.3	M	M	1.3	2	41
5/9/2014	2014	5	9	†	16.4	4 8	10.6	7.4	M	M	0	3	37
5/10/2014	2014	5	10	†	22.8	6 8	14.8	3.2	M	M	0		<31
5/11/2014	2014	5	11	†	21.6	7.7	14.7	3.3	M	M	0	33	35
5/12/2014	2014	5	12	†	9.1	4 8	7	11	M	M	6.1	1	37
5/13/2014	2014	5	13	†	9.4	1 8	5.6	12.4	M	M	0.6	32	41
5/14/2014	2014	5	14	†	5.6	0 2	2.9	15.1	M	M	0.5	35	32
5/15/2014	2014	5	15	†	12.6	1 2	6.9	11.1	M	M	0		<31
5/16/2014	2014	5	16	†	16.8	2 5	9.7	8.3	M	M	0		<31
5/17/2014	2014	5	17	†	19.9	4 5	12.2	5.8	M	M	0		<31
5/18/2014	2014	5	18	†	17.2	5.4	11.3	6.7	M	M	0		<31
5/19/2014	2014	5	19	†	12.7	10.1	11.4	6.6	M	M	10.4	10	32
5/20/2014	2014	5	20	†	12.8	8.4	10.6	7.4	M	M	1.7	29	35
5/21/2014	2014	5	21	†	13	6 8	9.9	8.1	M	M	0		<31
5/22/2014	2014	5	22	†	22.4	4.6	13.5	4.5	M	M	0		<31
5/23/2014	2014	5	23	†	29	13.3	21.2	0	M	M	0		<31
5/24/2014	2014	5	24	†	32.7	16.2	24.5	0	M	M	4.4	32	35
5/25/2014	2014	5	25	†	21.4	12.4	16.9	1.1	M	M	8	7	35
5/26/2014	2014	5	26	†	19.1	9 5	14.3	3.7	M	M	0.2		<31
5/27/2014	2014	5	27	†	28	12.5	20.3	0	M	M	0.2		<31
5/28/2014	2014	5	28	†	26.8	16	21.4	0	M	M	0		<31
5/29/2014	2014	5	29	†	32	15.1	23.6	0	M	M	0	22	32
5/30/2014	2014	5	30	†	26.9	20	23.5	0	M	M	0		<31
5/31/2014	2014	5	31	†	27.5	16.6	22.1	0	M	M	0		<31
6/1/2014	2014	6	1	†	28.4	13.7	21.1	0	M	M	0.2	35	35
6/2/2014	2014	6	2	†	17.7	13.1	15.4	2.6	M	M	4		<31
6/3/2014	2014	6	3	†	25.9	12.3	19.1	0	M	M	0		<31
6/4/2014	2014	6	4	†	27.5	12.8	20.2	0	M	M	4.4	23	33
6/5/2014	2014	6	5	†	26.8	15.9	21.4	0	M	M	0		<31
6/6/2014	2014	6	6	†		12			M	M			<31
6/7/2014	2014	6	7	†	19.1	9.1	14.1	3.9	M	M	0	33	33
6/8/2014	2014	6	8	†	21.2	11.2	16.2	1.8	M	M	0.6		<31
6/9/2014	2014	6	9	†	20.4	10	15.2	2.8	M	M	2.8		<31
6/10/2014	2014	6	10	†	26.8	14.7	20.8	0	M	M	0	23	46
6/11/2014	2014	6	11	†	20.8	10.3	15.6	2.4	M	M	0	34	33
6/12/2014	2014	6	12	†	21.7	8 3	15	3	M	M	0	2	41
6/13/2014	2014	6	13	†	23.8	10	16.9	1.1	M	M	0.7		<31
6/14/2014	2014	6	14	†	16.3	12.3	14.3	3.7	M	M	26	10	33
6/15/2014	2014	6	15	†	13.9	12.3	13.1	4.9	M	M	44.9		<31
6/16/2014	2014	6	16	†	21.3	11.3	16.3	1.7	M	M	0.7		<31
6/17/2014	2014	6	17	†	19.5	11.2	15.4	2.6	M	M	0		<31
6/18/2014	2014	6	18	†	25.8	12.5	19.2	0	M	M	0	5	33
6/19/2014	2014	6	19	†	18.9	14.7	16.8	1.2	M	M	24	10	32
6/20/2014	2014	6	20	†	22.2	12.2	17.2	0.8	M	M	1.2		<31
6/21/2014	2014	6	21	†	28.6	14.8	21.7	0	M	M	5.9	32	33
6/22/2014	2014	6	22	†	24.2	15.6	19.9	0	M	M	0.9	23	33
6/23/2014	2014	6	23	†	24.3	14.5	19.4	0	M	M	1.2	1	35
6/24/2014	2014	6	24	†	17.9	13.2	15.6	2.4	M	M	0		<31
6/25/2014	2014	6	25	†	20.4	13.9	17.2	0.8	M	M	0.3		<31
6/26/2014	2014	6	26	†	23.5	13.2	18.4	0	M	M	0.3		<31
6/27/2014	2014	6	27	†	29.9	17.2	23.6	0	M	M	10.3	10	41
6/28/2014	2014	6	28	†	25.9	19.1	22.5	0	M	M	15.7	21	37
6/29/2014	2014	6	29	†	22	16.8	19.4	0	M	M	22.5	22	61
6/30/2014	2014	6	30	†	21.6	13.4	17.5	0.5	M	M	3.7	26	37
7/1/2014	2014	7	1	†	18.3	10.3	14.3	3.7	M	M	2.3	33	46

Date/Time	Year	Month	Day	Data Quality	Max Temp (°C)	Min Temp (°C)	Mean Temp (°C)	Heat Deg Days (°C)	Total Rain Flag	Total Snow Flag	Total Precip (mm)	Dir of Max Gust (10s deg)	Spd of Max Gust (km/h)
7/2/2014	2014	7	2	†	22.3	11.2	16.8	1.2	M	M	0.2		<31
7/3/2014	2014	7	3	†	25.6	13.6	19.6	0	M	M	0.2		<31
7/4/2014	2014	7	4	†	25.6	13.9	19.8	0	M	M	0.9		<31
7/5/2014	2014	7	5	†	32.1	20.3	26.2	0	M	M	0.4		<31
7/6/2014	2014	7	6	†	26.9	20.6	23.8	0	M	M	0	32	37
7/7/2014	2014	7	7	†	24.2	16.8	20.5	0	M	M	0.9	34	48
7/8/2014	2014	7	8	†	22.2	13.8	18	0	M	M	0	34	35
7/9/2014	2014	7	9	†	23.6	12.6	18.1	0	M	M	0		<31
7/10/2014	2014	7	10	†	27.4	14.9	21.2	0	M	M	0	23	32
7/11/2014	2014	7	11	†	26.9	19.2	23.1	0	M	M	0	30	35
7/12/2014	2014	7	12	†	25.6	14.5	20.1	0	M	M	2.6	34	46
7/13/2014	2014	7	13	†	15.8	9 9	12.9	5.1	M	M	4.7	1	39
7/14/2014	2014	7	14	†	20	8 9	14.5	3.5	M	M	0.8	34	39
7/15/2014	2014	7	15	†	22.1	11.2	16.7	1.3	M	M	0.2		<31
7/16/2014	2014	7	16	†	25.9	12.5	19.2	0	M	M	0.9		<31
7/17/2014	2014	7	17	†	27.3	16.1	21.7	0	M	M	0	21	33
7/18/2014	2014	7	18	†	28.6	17	22.8	0	M	M	9.4	21	39
7/19/2014	2014	7	19	†	25.3	17.4	21.4	0	M	M	0.5		<31
7/20/2014	2014	7	20	†	31.2	20.2	25.7	0	M	M	0.3	23	32
7/21/2014	2014	7	21	†	28.1	18	23.1	0	M	M	5.1		<31
7/22/2014	2014	7	22	†	25.6	15.7	20.7	0	M	M	0.5		<31
7/23/2014	2014	7	23	†	23.5	13.2	18.4	0	M	M	0.2		<31
7/24/2014	2014	7	24	†	24.5	13.4	19	0	M	M	0.5		<31
7/25/2014	2014	7	25	†	27.6	17.9	22.8	0	M	M	0.2	24	33
7/26/2014	2014	7	26	†	22.2	16	19.1	0	M	M	1.8	2	32
7/27/2014	2014	7	27	†	22.3	14.8	18.6	0	M	M	0.7	3	33
7/28/2014	2014	7	28	†	25.3	13.3	19.3	0	M	M	1.2		<31
7/29/2014	2014	7	29	†	26.4	15.8	21.1	0	M	M	0.9		<31
7/30/2014	2014	7	30	†	28.3	17	22.7	0	M	M			<31
7/31/2014	2014	7	31	†	27.7	17.2	22.5	0	M	M			<31
8/1/2014	2014	8	1	†	29.3	17.2	23.3	0	M	M			<31
8/2/2014	2014	8	2	†	25	17.3	21.2	0	M	M			<31
8/3/2014	2014	8	3	†	25.7	14.1	19.9	0	M	M			<31
8/4/2014	2014	8	4	†	27.7	16.4	22.1	0	M	M			<31
8/5/2014	2014	8	5	†	28.8	19.1	24	0	M	M			<31
8/6/2014	2014	8	6	†	27.9	18.5	23.2	0	M	M			<31
8/7/2014	2014	8	7	†	28.2	19.3	23.8	0	M	M		22	33
8/8/2014	2014	8	8	†	30.1	18.8	24.5	0	M	M			<31
8/9/2014	2014	8	9	†	28.9	18.8	23.9	0	M	M			<31
8/10/2014	2014	8	10	†	23.6	17.3	20.5	0	M	M			<31
8/11/2014	2014	8	11	†	24.9	14.2	19.6	0	M	M			<31
8/12/2014	2014	8	12	†	28.1	15.5	21.8	0	M	M			<31
8/13/2014	2014	8	13	†	25.6	13.4	19.5	0	M	M			<31
8/14/2014	2014	8	14	†	29.3	14.1	21.7	0	M	M			<31
8/15/2014	2014	8	15	†	32.5	19.4	26	0	M	M			<31
8/16/2014	2014	8	16	†	25	15.8	20.4	0	M	M			<31
8/17/2014	2014	8	17	†	24.6	13.2	18.9	0	M	M			<31
8/18/2014	2014	8	18	†	23.9	17.3	20.6	0	M	M			<31
8/19/2014	2014	8	19	†	26.3	16.7	21.5	0	M	M			<31
8/20/2014	2014	8	20	†	28.8	17.4	23.1	0	M	M			<31
8/21/2014	2014	8	21	†	26	18.7	22.4	0	M	M			<31
8/22/2014	2014	8	22	†	19.8	14.6	17.2	0.8	M	M			<31
8/23/2014	2014	8	23	†	19.5	13.4	16.5	1.5	M	M			<31
8/24/2014	2014	8	24	†	26	16.4	21.2	0	M	M		23	39
8/25/2014	2014	8	25	†	16.4	10.4	13.4	4.6	M	M		27	39
8/26/2014	2014	8	26	†	17.9	9	13.5	4.5	M	M			<31
8/27/2014	2014	8	27	†	23.9	9	16.5	1.5	M	M	0		<31
8/28/2014	2014	8	28	†	27.4	15.3	21.4	0	M	M	0		<31
8/29/2014	2014	8	29	†	20.7	11.9	16.3	1.7	M	M	8.4	1	35
8/30/2014	2014	8	30	†	21.3	9 3	15.3	2.7	M	M	0		<31
8/31/2014	2014	8	31	†	18	13.7	15.9	2.1	M	M	17.4		<31
9/1/2014	2014	9	1	†	23.4	12.8	18.1	0	M	M	0		<31
9/2/2014	2014	9	2	†	23.1	11.4	17.3	0.7	M	M	1.4		<31
9/3/2014	2014	9	3	†	22.6	12.2	17.4	0.6	M	M	0		<31
9/4/2014	2014	9	4	†	18.1	11	14.6	3.4	M	M	13.6	33	46
9/5/2014	2014	9	5	†	20.6	9.4	15	3	M	M	2.4	23	44
9/6/2014	2014	9	6	†	24.5	9 2	16.9	1.1	M	M	0	23	33
9/7/2014	2014	9	7	†	24.8	9 5	17.2	0.8	M	M	0		<31
9/8/2014	2014	9	8	†	21.6	9.4	15.5	2.5	M	M	0.3	35	37

Date/Time	Year	Month	Day	Data Quality	Max Temp (°C)	Min Temp (°C)	Mean Temp (°C)	Heat Deg Days (°C)	Total Rain Flag	Total Snow Flag	Total Precip (mm)	Dir of Max Gust (10s deg)	Spd of Max Gust (km/h)
9/9/2014	2014	9	9	†	11.9	6 5	9.2	8.8	M	M	0	36	37
9/10/2014	2014	9	10	†	11.7	4.7	8.2	9.8	M	M	0	4	35
9/11/2014	2014	9	11	†	12.2	6 3	9.3	8.7	M	M	0.2	33	35
9/12/2014	2014	9	12	†	14	5 3	9.7	8.3	M	M	0	23	32
9/13/2014	2014	9	13	†	16.7	4.4	10.6	7.4	M	M	0		<31
9/14/2014	2014	9	14	†	14.4	6	10.2	7.8	M	M	0.4		<31
9/15/2014	2014	9	15	†	18.6	6.1	12.4	5.6	M	M	0		<31
9/16/2014	2014	9	16	†	18.6	10.5	14.6	3.4	M	M	0		<31
9/17/2014	2014	9	17	†	10.8	4.7	7.8	10.2	M	M	0		<31
9/18/2014	2014	9	18	†	20.6	2 5	11.6	6.4	M	M	0	21	37
9/19/2014	2014	9	19	†	20.3	12.2	16.3	1.7	M	M	4.6	18	33
9/20/2014	2014	9	20	†	15.1	8 5	11.8	6.2	M	M	12.4		<31
9/21/2014	2014	9	21	†	18.7	9 8	14.3	3.7	M	M	0.2		<31
9/22/2014	2014	9	22	†	26.4	9 5	18	0	M	M	0		<31
9/23/2014	2014	9	23	†	25.9	11.3	18.6	0	M	M	0		<31
9/24/2014	2014	9	24	†	20.6	13.1	16.9	1.1	M	M	0		<31
9/25/2014	2014	9	25	†	26.8	14.5	20.7	0	M	M	0		<31
9/26/2014	2014	9	26	†	29.5	17.2	23.4	0	M	M	0	16	35
9/27/2014	2014	9	27	†	24.6	13.8	19.2	0	M	M	0	2	33
9/28/2014	2014	9	28	†	13.8	7 5	10.7	7.3	M	M	7.4	32	32
9/29/2014	2014	9	29	†	11.2	5 5	8.4	9.6	M	M	0.3		<31
9/30/2014	2014	9	30	†	16.2	5.1	10.7	7.3	M	M	1.7		<31
10/1/2014	2014	10	1	†	16.5	11.9	14.2	3.8	M	M	0.2	21	43
10/2/2014	2014	10	2	†	17.8	6.4	12.1	5.9	M	M	0.4	35	41
10/3/2014	2014	10	3	†	7	3 2	5.1	12.9	M	M	2.3	32	44
10/4/2014	2014	10	4	†	7.1	1 8	4.5	13.5	M	M	0.4	33	39
10/5/2014	2014	10	5	†	7 9	1.1	4.5	13.5	M	M	0	32	44
10/6/2014	2014	10	6	†	5 8	3	4.4	13.6	M	M	0	31	37
10/7/2014	2014	10	7	†	6.6	1.1	3.9	14.1	M	M	0.4	31	35
10/8/2014	2014	10	8	†	7 2	1 3	4.3	13.7	M	M	0	32	32
10/9/2014	2014	10	9	†	8 3	0 3	4.3	13.7	M	M	0		<31
10/10/2014	2014	10	10	†	11.1	0.4	5.8	12.2	M	M	0		<31
10/11/2014	2014	10	11	†	16.6	4.4	10.5	7.5	M	M	0	23	41
10/12/2014	2014	10	12	†	15	8 5	11.8	6.2	M	M	0.9		<31
10/13/2014	2014	10	13	†	17.6	6.4	12	6	M	M	0		<31
10/14/2014	2014	10	14	†	18.8	3 2	11	7	M	M	0		<31
10/15/2014	2014	10	15	†	20.6	10.9	15.8	2.2	M	M	0	21	35
10/16/2014	2014	10	16	†	16.8	6 8	11.8	6.2	M	M	0	35	48
10/17/2014	2014	10	17	†	6 8	4 2	5.5	12.5	M	M	0	36	41
10/18/2014	2014	10	18	†	7.1	2.7	4.9	13.1	M	M	0	20	33
10/19/2014	2014	10	19	†	17.3	4 5	10.9	7.1	M	M	0		<31
10/20/2014	2014	10	20	†	11.3	5 5	8.4	9.6	M	M	0		<31
10/21/2014	2014	10	21	†	16.2	4 5	10.4	7.6	M	M	0	12	32
10/22/2014	2014	10	22	†	17.2	10.7	14	4	M	M	2.1	20	39
10/23/2014	2014	10	23	†	17.5	10	13.8	4.2	M	M	0		<31
10/24/2014	2014	10	24	†	20.8	9.1	15	3	M	M	0	27	41
10/25/2014	2014	10	25	†	14.2	3 3	8.8	9.2	M	M	0	33	41
10/26/2014	2014	10	26	†	13.7	0 5	7.1	10.9	M	M	0	11	39
10/27/2014	2014	10	27	†	7 8	3.6	5.7	12.3	M	M	0		<31
10/28/2014	2014	10	28	†	4.7	1.4	3.1	14.9	M	M	0.4	33	41
10/29/2014	2014	10	29	†	3.7	0 8	2.3	15.7	M	M	0		<31
10/30/2014	2014	10	30	†	3.4	-4	-0 3	18.3	M	M	0	35	43
10/31/2014	2014	10	31	†	3 5	-5 5	-1	19	M	M	0		<31
11/1/2014	2014	11	1	†	8	0 8	4.4	13.6	M	M	0.2	22	43
11/2/2014	2014	11	2	†	9 8	0 9	5.4	12.6	M	M	0		<31
11/3/2014	2014	11	3	†	9.6	1	5.3	12.7	M	M	0		<31
11/4/2014	2014	11	4	†	4.1	1 2	2.7	15.3	M	M	0.2	31	35
11/5/2014	2014	11	5	†	4	-1 3	1.4	16.6	M	M	0		<31
11/6/2014	2014	11	6	†	3 3	-1 8	0.8	17.2	M	M	0		<31
11/7/2014	2014	11	7	†	7 3	0 5	3.9	14.1	M	M	2	36	52
11/8/2014	2014	11	8	†	0.7	-6	-2.7	20.7	M	M	0.2	32	44
11/9/2014	2014	11	9	†	-5	-7 9	-6 5	24.5	M	M	0		<31
11/10/2014	2014	11	10	†	-5.6	-9 3	-7 5	25.5	M	M	0.2	33	32
11/11/2014	2014	11	11	†	-4.6	-11.8	-8 2	26.2	M	M	0.2	1	32
11/12/2014	2014	11	12	†	-4 5	-10.1	-7 3	25.3	M	M	0.5	32	37
11/13/2014	2014	11	13	†	-6 2	-12	-9.1	27.1	M	M	0		<31
11/14/2014	2014	11	14	†	-6 8	-15	-10.9	28.9	M	M	0.2		<31
11/15/2014	2014	11	15	†	-9 5	-14.2	-11.9	29.9	M	M	0		<31
11/16/2014	2014	11	16	†	-7.1	-12.7	-9 9	27.9	M	M	2.1	33	48

Date/Time	Year	Month	Day	Data Quality	Max Temp (°C)	Min Temp (°C)	Mean Temp (°C)	Heat Deg Days (°C)	Total Rain Flag	Total Snow Flag	Total Precip (mm)	Dir of Max Gust (10s deg)	Spd of Max Gust (km/h)
11/17/2014	2014	11	17	†	-9 3	-12.7	-11	29	M	M	0.5	35	35
11/18/2014	2014	11	18	†	-6.7	-13	-9 9	27.9	M	M	0.5		<31
11/19/2014	2014	11	19	†	-6.6	-14.3	-10.5	28.5	M	M	0.2	33	48
11/20/2014	2014	11	20	†	-9.6	-16.6	-13.1	31.1	M	M	0.2		<31
11/21/2014	2014	11	21	†	2.6	-9.6	-3 5	21.5	M	M	0	19	33
11/22/2014	2014	11	22	†	1 2	-3.7	-1 3	19.3	M	M	0.5		<31
11/23/2014	2014	11	23	†	1 9	-11.7	-4 9	22.9	M	M	0	33	37
11/24/2014	2014	11	24	†	-9 9	-16.8	-13.4	31.4	M	M	0	2	35
11/25/2014	2014	11	25	†	-10.7	-20.6	-15.7	33.7	M	M	0.6	1	32
11/26/2014	2014	11	26	†	-18 8	-23.9	-21.4	39.4	M	M	0.2		<31
11/27/2014	2014	11	27	†	-14 5	-24.1	-19.3	37.3	M	M	0		<31
11/28/2014	2014	11	28	†	-10.1	-16.7	-13.4	31.4	M	M	0		<31
11/29/2014	2014	11	29	†	-8.4	-18.3	-13.4	31.4	M	M	10.2	31	35
11/30/2014	2014	11	30	†	-18 3	-23.2	-20.8	38.8	M	M	0	30	41
12/1/2014	2014	12	1	†	-15 8	-26.1	-21	39	M	M	0	22	39
12/2/2014	2014	12	2	†	-10 3	-17.4	-13.9	31.9	M	M	0		<31
12/3/2014	2014	12	3	†	-10 8	-16.5	-13.7	31.7	M	M	0		<31
12/4/2014	2014	12	4	†	-6.4	-13.4	-9 9	27.9	M	M	0		<31
12/5/2014	2014	12	5	†	-7.4	-13.5	-10.5	28.5	M	M	0		<31
12/6/2014	2014	12	6	†	-4.1	-16.6	-10.4	28.4	M	M	0		<31
12/7/2014	2014	12	7	†	1 3	-6.7	-2.7	20.7	M	M	0.4		<31
12/8/2014	2014	12	8	†	-5	-14.7	-9 9	27.9	M	M	0.9	32	35
12/9/2014	2014	12	9	†	-6	-16.5	-11.3	29.3	M	M		22	35
12/10/2014	2014	12	10	†	-1.7	-6	-3 9	21.9	M	M	0.7	22	41
12/11/2014	2014	12	11	†	-0 2	-2 9	-1.6	19.6	M	M	0.2	22	32
12/12/2014	2014	12	12	†	1.4	-0 5	0.5	17.5	M	M	0	21	35
12/13/2014	2014	12	13	†	1 5	-0.4	0.6	17.4	M	M	0		<31
12/14/2014	2014	12	14	†	1	-2.4	-0.7	18.7	M	M	0.7		<31
12/15/2014	2014	12	15	†	-2.4	-13.9	-8 2	26.2	M	M	0.2	32	44
12/16/2014	2014	12	16	†	-12.4	-16.9	-14.7	32.7	M	M	0		<31
12/17/2014	2014	12	17	†	-9.1	-17.3	-13.2	31.2	M	M	0.2		<31
12/18/2014	2014	12	18	†	-6 3	-14.6	-10.5	28.5	M	M	0		<31
12/19/2014	2014	12	19	†	-2.4	-6.7	-4.6	22.6	M	M	0.8		<31
12/20/2014	2014	12	20	†	-1.4	-3 2	-2 3	20.3	M	M	0.4		<31
12/21/2014	2014	12	21	†	-0 2	-1.4	-0 8	18.8	M	M	0.4		<31
12/22/2014	2014	12	22	†	1 5	-0.7	0.4	17.6	M	M	0.5		<31
12/23/2014	2014	12	23	†	0 2	-1.4	-0.6	18.6	M	M	0		<31
12/24/2014	2014	12	24	†	-1	-3.1	-2.1	20.1	M	M	0.7		<31
12/25/2014	2014	12	25	†	-0 9	-4 5	-2.7	20.7	M	M	0.4		<31
12/26/2014	2014	12	26	†	-4 3	-16.8	-10.6	28.6	M	M	0.4		<31
12/27/2014	2014	12	27	†	-12 2	-22.1	-17.2	35.2	M	M	0.4		<31
12/28/2014	2014	12	28	†	-21 5	-25.7	-23.6	41.6	M	M	0		<31
12/29/2014	2014	12	29	†	-19.6	-27.5	-23.6	41.6	M	M	0		<31
12/30/2014	2014	12	30	†	-16.1	-24.5	-20.3	38.3	M	M	0.4	19	37
12/31/2014	2014	12	31	†	-4.4	-16.1	-10.3	28.3	M	M	0	23	35

AECOM

E11c 2013 Environment Canada Weather Data

Station Name	WINNIPEG THE FORKS
Province	MANITOBA
Latitude	49 89
Longitude	-97.13
Elevation	230
Climate Identifier	5023262
WMO Identifier	71579
TC Identifier	XWN

Legend

A	Accumulated
C	Precipitation occurred, amount uncertain
E	Estimated
F	Accumulated and estimated
L	Precipitation may or may not have occurred
M	Missing
N	Temperature missing but known to be > 0
S	More than one occurrence
T	Trace
Y	Temperature missing but known to be < 0
[empty]	No data available
^	The value displayed is based on incomplete data
†	Data for this day has undergone only preliminary quality checking
‡	Partner data that is not subject to review by the National Climate Archives

Date/Time	Year	Month	Day	Data Quality	Max Temp (°C)	Min Temp (°C)	Mean Temp (°C)	Heat Deg Days (°C)	Total Rain Flag	Total Snow Flag	Total Precip (mm)	Dir of Max Gust (10s deg)	Spd of Max Gust (km/h)
1/1/2013	2013	1	1	†	-8.3	-22.7	-15 5	33.5	M	M			<31
1/2/2013	2013	1	2	†	-6.8	-15.9	-11.4	29.4	M	M	0.3	34	32
1/3/2013	2013	1	3	†	-2.8	-15.3	-9.1	27.1	M	M	0.4	22	43
1/4/2013	2013	1	4	†	-3.1	-13.9	-8.5	26.5	M	M	0		<31
1/5/2013	2013	1	5	†	-10	-15.2	-12.6	30.6	M	M	0		<31
1/6/2013	2013	1	6	†	-7.3	-13.4	-10.4	28.4	M	M	0	20	41
1/7/2013	2013	1	7	†	1.2	-8.1	-3.5	21.5	M	M	0	32	39
1/8/2013	2013	1	8	†	1	-10.9	-5	23	M	M	1.8	20	39
1/9/2013	2013	1	9	†	-3.2	-6.1	-4.7	22.7	M	M	0	33	44
1/10/2013	2013	1	10	†	3.3	-4.7	-0.7	18.7	M	M	0		<31
1/11/2013	2013	1	11	†	-3.4	-14.3	-8.9	26.9	M	M	4.3	1	52
1/12/2013	2013	1	12	†	-14.3	-22.5	-18.4	36.4	M	M	2.5	1	50
1/13/2013	2013	1	13	†	-15.8	-23.7	-19 8	37.8	M	M	0		<31
1/14/2013	2013	1	14	†	-15.7	-21.8	-18 8	36.8	M	M	0.3		<31
1/15/2013	2013	1	15	†	-4.1	-21.9	-13	31	M	M	2.3	33	37
1/16/2013	2013	1	16	†	-7	-23.6	-15 3	33.3	M	M	0	34	39
1/17/2013	2013	1	17	†	-18.5	-21.5	-20	38	M	M	0		<31
1/18/2013	2013	1	18	†	-12.9	-18.6	-15 8	33.8	M	M	1.3		<31
1/19/2013	2013	1	19	†	-12.6	-23.4	-18	36	M	M	1.1	1	44
1/20/2013	2013	1	20	†	-21.9	-27.2	-24.6	42.6	M	M	0.3		<31
1/21/2013	2013	1	21	†	-24	-27.9	-26	44	M	M	0.3		<31
1/22/2013	2013	1	22	†	-17.9	-29.2	-23.6	41.6	M	M	0		<31
1/23/2013	2013	1	23	†	-17.9	-28.7	-23 3	41.3	M	M	0	36	39
1/24/2013	2013	1	24	†	-17.5	-30.1	-23 8	41.8	M	M	5.3		<31
1/25/2013	2013	1	25	†	-17.1	-25.7	-21.4	39.4	M	M	0.9		<31
1/26/2013	2013	1	26	†	-12.9	-25.2	-19.1	37.1	M	M	0		<31
1/27/2013	2013	1	27	†	-7.8	-19.3	-13.6	31.6	M	M	1.4		<31
1/28/2013	2013	1	28	†	-6.5	-15.5	-11	29	M	M	0		<31
1/29/2013	2013	1	29	†	-6.5	-16.9	-11.7	29.7	M	M	0	36	32
1/30/2013	2013	1	30	†	-14.4	-21.3	-17 9	35.9	M	M	0		<31
1/31/2013	2013	1	31	†	-21.2	-27.9	-24.6	42.6	M	M	0.6	32	32
2/1/2013	2013	2	1	†	-22	-31	-26 5	44.5	M	M	0		<31
2/2/2013	2013	2	2	†	-15.5	-30	-22 8	40.8	M	M	1		<31
2/3/2013	2013	2	3	†	-15.1	-19.7	-17.4	35.4	M	M	0		<31
2/4/2013	2013	2	4	†	-11.6	-26	-18 8	36.8	M	M	2.8		<31
2/5/2013	2013	2	5	†	-14.4	-23.2	-18 8	36.8	M	M	0		<31
2/6/2013	2013	2	6	†	-10.9	-17.5	-14 2	32.2	M	M	0		<31
2/7/2013	2013	2	7	†	-11.3	-19.3	-15 3	33.3	M	M	1.6		<31
2/8/2013	2013	2	8	†	-5.7	-17.4	-11.6	29.6	M	M	0	21	32
2/9/2013	2013	2	9	†	-3.2	-6.2	-4.7	22.7	M	M	0		<31
2/10/2013	2013	2	10	†	-2.2	-5.4	-3.8	21.8	M	M	0	4	37
2/11/2013	2013	2	11	†	-5.1	-11.2	-8.2	26.2	M	M	0.3	36	35
2/12/2013	2013	2	12	†	0.8	-11	-5.1	23.1	M	M	0		<31
2/13/2013	2013	2	13	†	-1.3	-12.6	-7	25	M	M	0		<31

Date/Time	Year	Month	Day	Data Quality	Max Temp (°C)	Min Temp (°C)	Mean Temp (°C)	Heat Deg Days (°C)	Total Rain Flag	Total Snow Flag	Total Precip (mm)	Dir of Max Gust (10s deg)	Spd of Max Gust (km/h)
2/14/2013	2013	2	14	†	-10.8	-17.2	-14	32	M	M	0.3		<31
2/15/2013	2013	2	15	†	-9.8	-18.1	-14	32	M	M	0.6		<31
2/16/2013	2013	2	16	†	-8.2	-18.9	-13.6	31.6	M	M	0.6		<31
2/17/2013	2013	2	17	†	-2	-8.6	-5.3	23.3	M	M	1	36	41
2/18/2013	2013	2	18	†	-5.6	-22.3	-14	32	M	M	2	36	54
2/19/2013	2013	2	19	†	-20	-26.6	-23 3	41.3	M	M	0.3	36	37
2/20/2013	2013	2	20	†	-13.4	-26	-19.7	37.7	M	M	0		<31
2/21/2013	2013	2	21	†	-7.5	-15.6	-11.6	29.6	M	M	0.5		<31
2/22/2013	2013	2	22	†	-6	-15.2	-10.6	28.6	M	M	2.1		<31
2/23/2013	2013	2	23	†	-4.6	-10.4	-7.5	25.5	M	M	0		<31
2/24/2013	2013	2	24	†	-4.2	-11	-7.6	25.6	M	M	0.3		<31
2/25/2013	2013	2	25	†	0.5	-13.3	-6.4	24.4	M	M	0.3		<31
2/26/2013	2013	2	26	†	-1.5	-9.7	-5.6	23.6	M	M	0.6		<31
2/27/2013	2013	2	27	†	-1.5	-9.5	-5.5	23.5	M	M	0.3	35	35
2/28/2013	2013	2	28	†	-4.8	-12.9	-8.9	26.9	M	M	0		<31
3/1/2013	2013	3	1	†	-3.4	-14	-8.7	26.7	M	M	0.9		<31
3/2/2013	2013	3	2	†	-3.1	-12.9	-8	26	M	M	0.3		<31
3/3/2013	2013	3	3	†	-0.6	-5.5	-3.1	21.1	M	M	0		<31
3/4/2013	2013	3	4	†	-1.1	-6	-3.6	21.6	M	M	6.8	6	32
3/5/2013	2013	3	5	†	-5.1	-8.6	-6.9	24.9	M	M	3.7		<31
3/6/2013	2013	3	6	†	-5.3	-14	-9.7	27.7	M	M	0.3		<31
3/7/2013	2013	3	7	†	-1.5	-14.5	-8	26	M	M	0.6		<31
3/8/2013	2013	3	8	†	-3.5	-7	-5.3	23.3	M	M	0		<31
3/9/2013	2013	3	9	†	-1.4	-7.4	-4.4	22.4	M	M	0.3		<31
3/10/2013	2013	3	10	†	-5.3	-11.4	-8.4	26.4	M	M	0.8		<31
3/11/2013	2013	3	11	†	-3.6	-14.3	-9	27	M	M	1.3		<31
3/12/2013	2013	3	12	†	-4.7	-12.4	-8.6	26.6	M	M	0	33	32
3/13/2013	2013	3	13	†	-5.8	-18.1	-12	30	M	M	1		<31
3/14/2013	2013	3	14	†	-1.9	-12.7	-7.3	25.3	M	M	0	36	37
3/15/2013	2013	3	15	†	-12.7	-17.2	-15	33	M	M	0.4		<31
3/16/2013	2013	3	16	†	-13.2	-21.1	-17 2	35.2	M	M	0	33	37
3/17/2013	2013	3	17	†	-9.4	-23.2	-16 3	34.3	M	M	3.5		<31
3/18/2013	2013	3	18	†	-8.4	-15.4	-11 9	29.9	M	M	4.8	1	41
3/19/2013	2013	3	19	†	-10	-18.7	-14.4	32.4	M	M	0.3	31	35
3/20/2013	2013	3	20										
3/21/2013	2013	3	21	†	-5.2	-18.7	-12	30	M	M	1.4		<31
3/22/2013	2013	3	22	†	-2.3	-16.7	-9.5	27.5	M	M	1.3		<31
3/23/2013	2013	3	23	†	-2	-13.8	-7.9	25.9	M	M	1.1		<31
3/24/2013	2013	3	24	†	-1.4	-7.8	-4.6	22.6	M	M	0.6		<31
3/25/2013	2013	3	25	†	-1.4	-8.5	-5	23	M	M	0		<31
3/26/2013	2013	3	26	†	-0.1	-12.8	-6.5	24.5	M	M			<31
3/27/2013	2013	3	27	†	1	-12.6	-5.8	23.8	M	M	0.9		<31
3/28/2013	2013	3	28										
3/29/2013	2013	3	29	†	1.8	-7.8	-3	21	M	M	0		<31
3/30/2013	2013	3	30	†	4.5	-4.2	0.2	17.8	M	M	0	35	35
3/31/2013	2013	3	31	†	-2.7	-9.9	-6.3	24.3	M	M	1	2	37
4/1/2013	2013	4	1	†	-1.6	-12	-6.8	24.8	M	M	0		<31
4/2/2013	2013	4	2	†	-2.8	-11.2	-7	25	M	M	0		<31
4/3/2013	2013	4	3	†	3.5	-8.9	-2.7	20.7	M	M	0.7	22	46
4/4/2013	2013	4	4	†	0.4	-7.9	-3.8	21.8	M	M	0.6	36	33
4/5/2013	2013	4	5	†	0.2	-10.9	-5.4	23.4	M	M			<31
4/6/2013	2013	4	6	†	1.7	-1.6	0.1	17.9	M	M	1	35	32
4/7/2013	2013	4	7	†	-0.9	-7.3	-4.1	22.1	M	M	1.4		<31
4/8/2013	2013	4	8	†	-4.9	-10.6	-7.8	25.8	M	M	0.3	32	37
4/9/2013	2013	4	9	†	-0.2	-13.2	-6.7	24.7	M	M	0.6		<31
4/10/2013	2013	4	10										
4/11/2013	2013	4	11	†	4.6	-4.9	-0.2	18.2	M	M	0	11	32
4/12/2013	2013	4	12	†	2.5	-1.9	0.3	17.7	M	M	0		<31
4/13/2013	2013	4	13	†	2.6	-5.1	-1.3	19.3	M	M	0.5		<31
4/14/2013	2013	4	14	†	6.4	-4.9	0.8	17.2	M	M	0	7	32
4/15/2013	2013	4	15	†	2.2	-1.4	0.4	17.6	M	M	4.3	3	41
4/16/2013	2013	4	16	†	2.1	-2.8	-0.4	18.4	M	M	0		<31
4/17/2013	2013	4	17	†	3.1	-2.3	0.4	17.6	M	M	0.5		<31
4/18/2013	2013	4	18	†	4.4	-1.9	1.3	16.7	M	M	0.3	2	37
4/19/2013	2013	4	19	†	1.3	-5	-1.9	19.9	M	M	0	36	43
4/20/2013	2013	4	20	†	2.4	-8.4	-3	21	M	M	0.8		<31
4/21/2013	2013	4	21	†	4.3	-1.1	1.6	16.4	M	M	3.8	28	37
4/22/2013	2013	4	22	†	1.7	-3.9	-1.1	19.1	M	M	0		<31
4/23/2013	2013	4	23	†	4	-5.2	-0.6	18.6	M	M	0		<31
4/24/2013	2013	4	24	†	5	-2.6	1.2	16 8	M	M	0	34	35
4/25/2013	2013	4	25	†	5.7	-3.2	1.3	16.7	M	M	0	21	33

Date/Time	Year	Month	Day	Data Quality	Max Temp (°C)	Min Temp (°C)	Mean Temp (°C)	Heat Deg Days (°C)	Total Rain Flag	Total Snow Flag	Total Precip (mm)	Dir of Max Gust (10s deg)	Spd of Max Gust (km/h)
4/26/2013	2013	4	26	†	15.3	1.8	8.6	9.4	M	M	0		<31
4/27/2013	2013	4	27	†	15.8	7.5	11.7	6 3	M	M	0	22	33
4/28/2013	2013	4	28	†	16.4	4.8	10.6	7.4	M	M	0	34	43
4/29/2013	2013	4	29	†	12.7	-0.4	6.2	11.8	M	M			<31
4/30/2013	2013	4	30	†	8.4	5.5	7	11	M	M			<31
5/1/2013	2013	5	1	†	-0.4	-3.8	-2.1	20.1	M	M			<31
5/2/2013	2013	5	2	†	2.5	-4.1	-0.8	18.8	M	M	0		<31
5/3/2013	2013	5	3	†		-2.9			M	M			<31
5/4/2013	2013	5	4	†	14.5	-0.8	6.9	11.1	M	M	0		<31
5/5/2013	2013	5	5	†	18.9	2.9	10 9	7.1	M	M	0		<31
5/6/2013	2013	5	6	†	25.4	5.8	15.6	2.4	M	M	0	23	32
5/7/2013	2013	5	7	†	24.1	10.7	17.4	0.6	M	M	0	22	32
5/8/2013	2013	5	8	†	12.3	2.2	7.3	10.7	M	M	0	35	41
5/9/2013	2013	5	9	†	14.3	-0.8	6.8	11.2	M	M	0		<31
5/10/2013	2013	5	10	†	11.2	2.7	7	11	M	M	1.3	33	43
5/11/2013	2013	5	11	†	9	0.3	4.7	13.3	M	M	0	32	44
5/12/2013	2013	5	12	†	15.5	-0.9	7.3	10.7	M	M	0		<31
5/13/2013	2013	5	13	†	25.7	8.6	17 2	0 8	M	M	0	22	43
5/14/2013	2013	5	14	†	24.6	13.7	19 2	0	M	M	0	34	59
5/15/2013	2013	5	15	†	21.5	8.2	14 9	3.1	M	M	0		<31
5/16/2013	2013	5	16	†	21.9	8.4	15 2	2 8	M	M	0		<31
5/17/2013	2013	5	17	†	19.3	9.8	14.6	3.4	M	M	2		<31
5/18/2013	2013	5	18	†	18.1	11.8	15	3	M	M	6.2		<31
5/19/2013	2013	5	19	†	16.3	10.9	13.6	4.4	M	M	5.8	8	41
5/20/2013	2013	5	20	†	14.5	8.9	11.7	6 3	M	M	11.4	6	54
5/21/2013	2013	5	21	†	21.6	9.4	15 5	2 5	M	M	0.2	5	46
5/22/2013	2013	5	22	†	20.2	7.1	13.7	4 3	M	M	0	2	41
5/23/2013	2013	5	23	†	18.7	5.1	11 9	6.1	M	M	0		<31
5/24/2013	2013	5	24	†	20.8	5.8	13 3	4.7	M	M	0	20	32
5/25/2013	2013	5	25	†	18.2	11.9	15.1	2 9	M	M	0	12	32
5/26/2013	2013	5	26	†	21.6	13.3	17 5	0 5	M	M	0		<31
5/27/2013	2013	5	27	†	23.8	13.3	18.6	0	M	M	0		<31
5/28/2013	2013	5	28	†	19.8	14.4	17.1	0 9	M	M	4.6		<31
5/29/2013	2013	5	29	†	20.4	11.8	16.1	1 9	M	M	0		<31
5/30/2013	2013	5	30	†	16	12.1	14.1	3 9	M	M	16.4	10	43
5/31/2013	2013	5	31	†	12.7	8.9	10 8	7 2	M	M	23.2	5	43
6/1/2013	2013	6	1	†	14.5	7	10 8	7 2	M	M	0	36	41
6/2/2013	2013	6	2	†	16.6	3.9	10 3	7.7	M	M	0		<31
6/3/2013	2013	6	3	†	19.5	4.8	12 2	5 8	M	M	0		<31
6/4/2013	2013	6	4	†	21.6	10.7	16 2	1 8	M	M	0	9	32
6/5/2013	2013	6	5	†	23.6	9.4	16 5	1 5	M	M	0		<31
6/6/2013	2013	6	6	†	24	11.4	17.7	0 3	M	M	0		<31
6/7/2013	2013	6	7	†	23.9	12.7	18 3	0	M	M	0.6	14	32
6/8/2013	2013	6	8	†	24.7	9.9	17 3	0.7	M	M	0		<31
6/9/2013	2013	6	9	†	20.2	13.1	16.7	1 3	M	M	0.6		<31
6/10/2013	2013	6	10	†	23.9	12.8	18.4	0	M	M	9.6	32	33
6/11/2013	2013	6	11	†	24.1	12.7	18.4	0	M	M	0	30	32
6/12/2013	2013	6	12	†	21.8	14.2	18	0	M	M	0		<31
6/13/2013	2013	6	13	†	25.9	12.3	19.1	0	M	M	0		<31
6/14/2013	2013	6	14	†	24.8	14.9	19 9	0	M	M	3.2		<31
6/15/2013	2013	6	15	†	25.1	13.5	19 3	0	M	M	0.2	27	43
6/16/2013	2013	6	16	†	22	13.8	17 9	0.1	M	M	0		<31
6/17/2013	2013	6	17	†	23.4	12.8	18.1	0	M	M	0		<31
6/18/2013	2013	6	18	†	26.1	12.1	19.1	0	M	M	0		<31
6/19/2013	2013	6	19	†	28.6	14.6	21.6	0	M	M	0		<31
6/20/2013	2013	6	20	†	26.7	16.5	21.6	0	M	M	5.4	9	32
6/21/2013	2013	6	21	†	22.8	17.5	20 2	0	M	M	0.2		<31
6/22/2013	2013	6	22	†	26.9	18.1	22 5	0	M	M	0		<31
6/23/2013	2013	6	23	†	23.5	14.3	18 9	0	M	M	20	29	39
6/24/2013	2013	6	24	†	28.6	14.2	21.4	0	M	M	0.2	21	32
6/25/2013	2013	6	25	†	31.4	17	24 2	0	M	M	14.2	27	54
6/26/2013	2013	6	26	†	27.4	17.6	22 5	0	M	M	8		<31
6/27/2013	2013	6	27	†	24	17.7	20 9	0	M	M	0	33	41
6/28/2013	2013	6	28	†	24.2	17.1	20.7	0	M	M	0.4		<31
6/29/2013	2013	6	29	†	26.9	15.7	21 3	0	M	M	0		<31
6/30/2013	2013	6	30	†	27.7	15.3	21 5	0	M	M	0		<31
7/1/2013	2013	7	1	†	29.4	16.4	22 9	0	M	M	0		<31
7/2/2013	2013	7	2	†	31.2	19.4	25 3	0	M	M	0		<31
7/3/2013	2013	7	3	†	31.8	20.5	26 2	0	M	M			<31
7/4/2013	2013	7	4	†	31.1	20.6	25 9	0	M	M	0		<31
7/5/2013	2013	7	5	†	28.7	19.4	24.1	0	M	M	0		<31

Date/Time	Year	Month	Day	Data Quality	Max Temp (°C)	Min Temp (°C)	Mean Temp (°C)	Heat Deg Days (°C)	Total Rain Flag	Total Snow Flag	Total Precip (mm)	Dir of Max Gust (10s deg)	Spd of Max Gust (km/h)
7/6/2013	2013	7	6	†	27.6	20.7	24 2	0	M	M	0		<31
7/7/2013	2013	7	7	†	26.8	19.9	23.4	0	M	M	0		<31
7/8/2013	2013	7	8	†	29.7	16.8	23 3	0	M	M	0		<31
7/9/2013	2013	7	9	†	21.6	15.1	18.4	0	M	M	2.6	32	32
7/10/2013	2013	7	10	†	24.7	15.1	19 9	0	M	M	0		<31
7/11/2013	2013	7	11	†	29.3	17	23 2	0	M	M	0	22	37
7/12/2013	2013	7	12	†	26.1	21.2	23.7	0	M	M	1.6		<31
7/13/2013	2013	7	13	†	29.9	18.9	24.4	0	M	M	1.2	22	32
7/14/2013	2013	7	14	†	24.4	16.2	20 3	0	M	M	0.2	32	32
7/15/2013	2013	7	15	†	29.2	15.7	22 5	0	M	M	0		<31
7/16/2013	2013	7	16	†	25.8	19.3	22.6	0	M	M	3	33	32
7/17/2013	2013	7	17	†	25.9	17.1	21 5	0	M	M	0		<31
7/18/2013	2013	7	18	†	25.2	16.7	21	0	M	M	20	36	37
7/19/2013	2013	7	19	†	24.8	12.6	18.7	0	M	M	0	34	41
7/20/2013	2013	7	20	†	19.4	10.4	14 9	3.1	M	M	0		<31
7/21/2013	2013	7	21	†	22.7	12.3	17 5	0 5	M	M	20.6		<31
7/22/2013	2013	7	22	†	20.5	15.2	17 9	0.1	M	M	0.2	30	37
7/23/2013	2013	7	23										
7/24/2013	2013	7	24	†	24.5	15	19 8	0	M	M	0		<31
7/25/2013	2013	7	25	†	19.8	14.1	17	1	M	M	12.4	36	35
7/26/2013	2013	7	26	†	18.2	11.1	14.7	3 3	M	M	0.2	4	37
7/27/2013	2013	7	27	†	21.2	10.8	16	2	M	M	0		<31
7/28/2013	2013	7	28	†	23.7	11.6	17.7	0 3	M	M	0		<31
7/29/2013	2013	7	29	†	23.7	12.3	18	0	M	M	2		<31
7/30/2013	2013	7	30	†	23.6	14.4	19	0	M	M	2.6		<31
7/31/2013	2013	7	31	†	22.5	12.5	17 5	0 5	M	M	0		<31
8/1/2013	2013	8	1	†	23.6	15.6	19.6	0	M	M	0.6		<31
8/2/2013	2013	8	2	†	22.1	12.7	17.4	0.6	M	M	0		<31
8/3/2013	2013	8	3	†	23	11.2	17.1	0 9	M	M	0		<31
8/4/2013	2013	8	4	†	21.8	10.9	16.4	1.6	M	M	5		<31
8/5/2013	2013	8	5	†	25.1	14.1	19.6	0	M	M	0.2		<31
8/6/2013	2013	8	6	†	20.1	13.6	16 9	1.1	M	M	0.2	4	32
8/7/2013	2013	8	7	†	18.5	11.3	14 9	3.1	M	M	0		<31
8/8/2013	2013	8	8	†	20.2	11.3	15 8	2 2	M	M	0	34	37
8/9/2013	2013	8	9	†	17.3	12.6	15	3	M	M	0.6		<31
8/10/2013	2013	8	10	†	23.9	12.3	18.1	0	M	M	3	24	32
8/11/2013	2013	8	11	†	24.8	12.4	18.6	0	M	M	0	35	33
8/12/2013	2013	8	12	†	21.6	13.4	17 5	0 5	M	M	0	36	32
8/13/2013	2013	8	13	†	22.8	11.2	17	1	M	M	0		<31
8/14/2013	2013	8	14	†	25.1	10.6	17 9	0.1	M	M	0		<31
8/15/2013	2013	8	15	†	26.9	13.4	20 2	0	M	M	0		<31
8/16/2013	2013	8	16	†	29.9	16.9	23.4	0	M	M	0	24	43
8/17/2013	2013	8	17	†	28.1	17	22.6	0	M	M	0	23	37
8/18/2013	2013	8	18	†	26.3	16.7	21 5	0	M	M	29.8	31	33
8/19/2013	2013	8	19	†	33.3	17.7	25 5	0	M	M	0		<31
8/20/2013	2013	8	20	†	30.3	18.2	24 3	0	M	M	0	36	35
8/21/2013	2013	8	21	†	24.7	16.3	20 5	0	M	M			<31
8/22/2013	2013	8	22	†	25	13.2	19.1	0	M	M	0		<31
8/23/2013	2013	8	23	†	28.4	13.3	20 9	0	M	M	0		<31
8/24/2013	2013	8	24	†	30.5	21.4	26	0	M	M	0.8	23	39
8/25/2013	2013	8	25	†	33	21.7	27.4	0	M	M	0		<31
8/26/2013	2013	8	26	†	32.5	17.7	25.1	0	M	M	0		<31
8/27/2013	2013	8	27	†	32.9	20.6	26 8	0	M	M	0		<31
8/28/2013	2013	8	28	†	33.5	21	27 3	0	M	M	0		<31
8/29/2013	2013	8	29	†	26.3	21.1	23.7	0	M	M	0.4		<31
8/30/2013	2013	8	30	†	29.8	18.6	24 2	0	M	M	0		<31
8/31/2013	2013	8	31	†	29.4	13.9	21.7	0	M	M	1.2	33	37
9/1/2013	2013	9	1	†	18.3	12.1	15 2	2 8	M	M	0.2	4	33
9/2/2013	2013	9	2	†	23.2	10.3	16 8	1 2	M	M	0		<31
9/3/2013	2013	9	3	†	27.7	10.7	19 2	0	M	M	0	33	32
9/4/2013	2013	9	4	†	21.7	8	14 9	3.1	M	M	0		<31
9/5/2013	2013	9	5	†	28.4	11.8	20.1	0	M	M	0		<31
9/6/2013	2013	9	6	†	33	19.3	26 2	0	M	M	0	36	35
9/7/2013	2013	9	7	†	25.3	15.6	20 5	0	M	M	0	2	35
9/8/2013	2013	9	8	†	22.9	12.9	17 9	0.1	M	M	0		<31
9/9/2013	2013	9	9	†		15.5			M	M			<31
9/10/2013	2013	9	10	†	27.1	15.9	21 5	0	M	M	0.8		<31
9/11/2013	2013	9	11	†	23.3	13.4	18.4	0	M	M			<31
9/12/2013	2013	9	12	†	20.8	12.7	16 8	1 2	M	M	0	33	33
9/13/2013	2013	9	13	†	26	11.4	18.7	0	M	M	0	22	32
9/14/2013	2013	9	14	†	20.6	10.9	15 8	2 2	M	M	1.6	4	37

Date/Time	Year	Month	Day	Data Quality	Max Temp (°C)	Min Temp (°C)	Mean Temp (°C)	Heat Deg Days (°C)	Total Rain Flag	Total Snow Flag	Total Precip (mm)	Dir of Max Gust (10s deg)	Spd of Max Gust (km/h)
9/15/2013	2013	9	15	†	16.1	5.8	11	7	M	M	0		<31
9/16/2013	2013	9	16	†	21.2	5.1	13 2	4 8	M	M	0	20	33
9/17/2013	2013	9	17	†	18.8	13.1	16	2	M	M	0	20	37
9/18/2013	2013	9	18	†	21.6	15.8	18.7	0	M	M	0.2		<31
9/19/2013	2013	9	19	†	19	9.6	14 3	3.7	M	M	0.2		<31
9/20/2013	2013	9	20	†	13.1	7	10.1	7 9	M	M	0	35	35
9/21/2013	2013	9	21	†	15.7	4.9	10 3	7.7	M	M	0		<31
9/22/2013	2013	9	22	†	21.3	5.8	13.6	4.4	M	M	0	13	33
9/23/2013	2013	9	23	†	26.3	16.3	21 3	0	M	M	0	22	39
9/24/2013	2013	9	24	†	24.6	13	18 8	0	M	M	0		<31
9/25/2013	2013	9	25	†	24.7	10.5	17.6	0.4	M	M	0		<31
9/26/2013	2013	9	26	†	21.8	13	17.4	0.6	M	M	3.4		<31
9/27/2013	2013	9	27	†	15.3	8.8	12.1	5 9	M	M	0.2		<31
9/28/2013	2013	9	28	†	12.5	8.1	10 3	7.7	M	M	23.6		<31
9/29/2013	2013	9	29	†	20.8	5.9	13.4	4.6	M	M	0.2		<31
9/30/2013	2013	9	30	†	22.1	12.9	17 5	0 5	M	M	2.6	23	32
10/1/2013	2013	10	1	†	17	8.3	12.7	5 3	M	M	0.4	27	46
10/2/2013	2013	10	2	†	17.2	5.9	11.6	6.4	M	M	0		<31
10/3/2013	2013	10	3	†	13.6	6.3	10	8	M	M	0	35	32
10/4/2013	2013	10	4	†	7.7	3.7	5.7	12.3	M	M	0	4	39
10/5/2013	2013	10	5	†	11	1.1	6.1	11.9	M	M	0	5	32
10/6/2013	2013	10	6	†	18.4	2.6	10 5	7 5	M	M	0	33	32
10/7/2013	2013	10	7	†	16.1	5.2	10.7	7 3	M	M	0		<31
10/8/2013	2013	10	8	†	19.4	10.7	15.1	2 9	M	M	0		<31
10/9/2013	2013	10	9	†	20.1	7.6	13 9	4.1	M	M	0		<31
10/10/2013	2013	10	10	†	20.9	6.5	13.7	4 3	M	M	0		<31
10/11/2013	2013	10	11	†	21	13.4	17 2	0 8	M	M	7.4	11	33
10/12/2013	2013	10	12	†	14.6	5.1	9.9	8.1	M	M	1.6	31	39
10/13/2013	2013	10	13	†	11.9	2.3	7.1	10.9	M	M	0		<31
10/14/2013	2013	10	14	†	9.1	0.2	4.7	13.3	M	M	0		<31
10/15/2013	2013	10	15	†	7.9	1.2	4.6	13.4	M	M	0		<31
10/16/2013	2013	10	16	†	14.3	1.3	7.8	10.2	M	M	0		<31
10/17/2013	2013	10	17	†	10.4	4.1	7.3	10.7	M	M	0		<31
10/18/2013	2013	10	18	†	7.8	1.7	4.8	13.2	M	M	0		<31
10/19/2013	2013	10	19	†	6.1	2.2	4.2	13.8	M	M	0.4		<31
10/20/2013	2013	10	20	†	2.9	-1.6	0.7	17.3	M	M	0	35	37
10/21/2013	2013	10	21	†	3.7	-1.4	1.2	16.8	M	M	0	32	35
10/22/2013	2013	10	22	†	2.8	-1	0.9	17.1	M	M	0		<31
10/23/2013	2013	10	23	†	2.9	-4	-0.6	18.6	M	M	0		<31
10/24/2013	2013	10	24	†	5.7	-0.4	2.7	15.3	M	M	0		<31
10/25/2013	2013	10	25	†	10.9	-0.7	5.1	12.9	M	M	0	23	46
10/26/2013	2013	10	26	†	5	1.7	3.4	14.6	M	M	0	32	44
10/27/2013	2013	10	27	†	3.2	-4.3	-0.6	18.6	M	M	0	4	43
10/28/2013	2013	10	28	†	-1.3	-5.8	-3.6	21.6	M	M	0		<31
10/29/2013	2013	10	29	†		-7.8			M	M			
10/30/2013	2013	10	30	†					M	M			<31
10/31/2013	2013	10	31	†	7.2	-0.9	3.2	14.8	M	M	0		<31
11/1/2013	2013	11	1	†	7.3	-2.7	2.3	15.7	M	M	0		<31
11/2/2013	2013	11	2	†	9.9	-2.1	3.9	14.1	M	M	0		<31
11/3/2013	2013	11	3	†	9.2	1.8	5.5	12.5	M	M	0	10	35
11/4/2013	2013	11	4	†	8.9	-1.4	3.8	14.2	M	M	0	22	39
11/5/2013	2013	11	5	†	-0.6	-3.3	-2	20	M	M	0	23	32
11/6/2013	2013	11	6	†	1.7	-5.4	-1.9	19.9	M	M	0		<31
11/7/2013	2013	11	7	†	1.9	-6.5	-2.3	20.3	M	M	0		<31
11/8/2013	2013	11	8	†	4.1	-6.3	-1.1	19.1	M	M	1		<31
11/9/2013	2013	11	9	†	1.6	-0.8	0.4	17.6	M	M	0.3		<31
11/10/2013	2013	11	10	†	-0.6	-12	-6.3	24.3	M	M	0	34	41
11/11/2013	2013	11	11	†	-8.6	-13.4	-11	29	M	M	0		<31
11/12/2013	2013	11	12	†	3.4	-12.2	-4.4	22.4	M	M	0	22	33
11/13/2013	2013	11	13	†	10	-1.8	4.1	13.9	M	M	0	22	32
11/14/2013	2013	11	14	†	2.5	-0.1	1.2	16.8	M	M	0		<31
11/15/2013	2013	11	15	†	8.3	-0.8	3.8	14.2	M	M	0	24	35
11/16/2013	2013	11	16	†	2.8	-2.2	0.3	17.7	M	M	0.5		<31
11/17/2013	2013	11	17	†	-0.6	-6.2	-3.4	21.4	M	M	5.2	31	37
11/18/2013	2013	11	18	†	-6.2	-8	-7.1	25.1	M	M	0		<31
11/19/2013	2013	11	19	†	1.7	-7.4	-2.9	20.9	M	M	0		<31
11/20/2013	2013	11	20	†	0.8	-10.4	-4.8	22.8	M	M	2	2	37
11/21/2013	2013	11	21	†	-10.3	-15.6	-13	31	M	M	0	32	35
11/22/2013	2013	11	22	†	-11.2	-19.1	-15 2	33.2	M	M	0.6	33	32
11/23/2013	2013	11	23	†	-13.9	-20.8	-17.4	35.4	M	M	0		<31
11/24/2013	2013	11	24	†	1.5	-13.9	-6.2	24.2	M	M	0	18	43

Date/Time	Year	Month	Day	Data Quality	Max Temp (°C)	Min Temp (°C)	Mean Temp (°C)	Heat Deg Days (°C)	Total Rain Flag	Total Snow Flag	Total Precip (mm)	Dir of Max Gust (10s deg)	Spd of Max Gust (km/h)
11/25/2013	2013	11	25	†	1.6	-10	-4.2	22.2	M	M	0	31	46
11/26/2013	2013	11	26	†	-9.2	-14.1	-11.7	29.7	M	M	0	30	33
11/27/2013	2013	11	27	†	-8.6	-14.1	-11.4	29.4	M	M	4.8		<31
11/28/2013	2013	11	28	†	-10.6	-16.5	-13.6	31.6	M	M	0		<31
11/29/2013	2013	11	29	†	-4.8	-17.6	-11 2	29.2	M	M	0		<31
11/30/2013	2013	11	30	†	-5.2	-6.6	-5.9	23.9	M	M	0		<31
12/1/2013	2013	12	1	†	-4.3	-6.1	-5.2	23.2	M	M	0		<31
12/2/2013	2013	12	2	†	-5.2	-7.6	-6.4	24.4	M	M	0		<31
12/3/2013	2013	12	3	†	-7.4	-11.8	-9.6	27.6	M	M	0	1	33
12/4/2013	2013	12	4	†	-9.3	-12.2	-10 8	28.8	M	M	8.3	1	33
12/5/2013	2013	12	5	†	-11.7	-18.5	-15.1	33.1	M	M	0.6	32	37
12/6/2013	2013	12	6	†	-18.1	-21.4	-19 8	37.8	M	M	0		<31
12/7/2013	2013	12	7	†	-21.2	-26.8	-24	42	M	M	0		<31
12/8/2013	2013	12	8	†	-19.5	-25.9	-22.7	40.7	M	M	0		<31
12/9/2013	2013	12	9	†	-21.6	-25.1	-23.4	41.4	M	M	0		<31
12/10/2013	2013	12	10	†	-19.6	-24.2	-21 9	39.9	M	M	0.2		<31
12/11/2013	2013	12	11	†	-21.1	-26.6	-23 9	41.9	M	M			<31
12/12/2013	2013	12	12	†	-18.5	-23.8	-21 2	39.2	M	M	0		<31
12/13/2013	2013	12	13	†	-23.2	-25	-24.1	42.1	M	M	0		<31
12/14/2013	2013	12	14	†	-20.7	-26.4	-23.6	41.6	M	M	0.9		<31
12/15/2013	2013	12	15	†	-18.5	-29.6	-24.1	42.1	M	M	0		<31
12/16/2013	2013	12	16	†	-0.8	-18.5	-9.7	27.7	M	M	1.4	22	35
12/17/2013	2013	12	17	†	-3	-18.7	-10 9	28.9	M	M	1	34	39
12/18/2013	2013	12	18	†	-12.4	-21.3	-16 9	34.9	M	M	0.2	34	35
12/19/2013	2013	12	19	†	-18.9	-24	-21 5	39.5	M	M	0		<31
12/20/2013	2013	12	20	†	-15.3	-21.7	-18 5	36.5	M	M	0		<31
12/21/2013	2013	12	21	†	-20.3	-27.8	-24.1	42.1	M	M	0		<31
12/22/2013	2013	12	22	†	-23.4	-27.4	-25.4	43.4	M	M	0		<31
12/23/2013	2013	12	23	†	-21.9	-28.9	-25.4	43.4	M	M	0		<31
12/24/2013	2013	12	24	†	-10.8	-23	-16 9	34.9	M	M	1.1	19	41
12/25/2013	2013	12	25	†	-9.6	-18.7	-14 2	32.2	M	M	1.1		<31
12/26/2013	2013	12	26	†	-7.4	-21.5	-14 5	32.5	M	M	0		<31
12/27/2013	2013	12	27	†	-1.2	-13.3	-7.3	25.3	M	M	1.5	21	33
12/28/2013	2013	12	28	†	-13.3	-27.6	-20 5	38.5	M	M	8.4	2	46
12/29/2013	2013	12	29	†	-25.1	-29.5	-27 3	45.3	M	M	0		<31
12/30/2013	2013	12	30	†	-26.4	-30.2	-28 3	46.3	M	M	0		<31
12/31/2013	2013	12	31	†	-27.2	-32	-29.6	47.6	M	M	0		<31

E12 WTP Output Flows and Reservoir Levels

E12a WTP Output Jan 12-26 2015

WTP Output Flow (MLD)

StartDateTime	Average	MinDateTime	Minimum	MaxDateTime	Maximum
1/12/2015 00:00	196.0414174	1/12/2015 00:12	191.8999939	1/12/2015 00:00	200.8000031
1/12/2015 01:00	195.9928018	1/12/2015 01:09	192.1000061	1/12/2015 01:38	201
1/12/2015 02:00	195.9311559	1/12/2015 02:57	192.1000061	1/12/2015 02:10	200.3000031
1/12/2015 03:00	196.0512926	1/12/2015 03:23	191.6000061	1/12/2015 03:45	200.3999939
1/12/2015 04:00	195.9770697	1/12/2015 04:57	192.1000061	1/12/2015 04:18	201.3999939
1/12/2015 05:00	196.0071207	1/12/2015 05:06	191.8999939	1/12/2015 05:17	201
1/12/2015 06:00	192.7840216	1/12/2015 06:48	187.8000031	1/12/2015 06:07	201
1/12/2015 07:00	192.0308911	1/12/2015 07:03	187.8000031	1/12/2015 07:46	197.5
1/12/2015 08:00	191.9943385	1/12/2015 08:43	187.3000031	1/12/2015 08:25	197.3000031
1/12/2015 09:00	191.9815955	1/12/2015 09:11	186.3999939	1/12/2015 09:04	197
1/12/2015 10:00	192.0311711	1/12/2015 10:35	187.8000031	1/12/2015 10:44	196.8999939
1/12/2015 11:00	192.0234488	1/12/2015 11:30	188.1999969	1/12/2015 11:26	197.1999969
1/12/2015 12:00	191.9600866	1/12/2015 12:28	188.1000061	1/12/2015 12:45	197.8999939
1/12/2015 13:00	192.0476567	1/12/2015 13:42	188.6999969	1/12/2015 13:31	196.8000031
1/12/2015 14:00	191.969738	1/12/2015 14:01	187.1999969	1/12/2015 14:37	197.1999969
1/12/2015 15:00	191.3103373	1/12/2015 15:31	184.8000031	1/12/2015 15:10	198.6999969
1/12/2015 16:00	188.5286618	1/12/2015 16:16	182.1999969	1/12/2015 16:13	193.6000061
1/12/2015 17:00	188.3801488	1/12/2015 17:25	183	1/12/2015 17:22	194.1999969
1/12/2015 18:00	187.8234647	1/12/2015 18:18	181.5	1/12/2015 18:37	193.6999969
1/12/2015 19:00	188.7309643	1/12/2015 19:44	183.3000031	1/12/2015 19:20	193.8999939
1/12/2015 20:00	188.4418376	1/12/2015 20:38	182.6000061	1/12/2015 20:08	194.3999939
1/12/2015 21:00	187.6951245	1/12/2015 21:30	180.8000031	1/12/2015 21:00	193.6999969
1/12/2015 22:00	188.0036193	1/12/2015 22:15	182.6000061	1/12/2015 22:08	193.5
1/12/2015 23:00	186.849352	1/12/2015 23:24	180.1999969	1/12/2015 23:49	193.1000061
1/13/2015 00:00	188.2901379	1/13/2015 00:44	182.5	1/13/2015 00:56	193.1999969
1/13/2015 01:00	186.5364663	1/13/2015 01:04	180.3999939	1/13/2015 01:25	193.1999969
1/13/2015 02:00	187.1243945	1/13/2015 02:19	180.1000061	1/13/2015 02:39	192.3999939
1/13/2015 03:00	187.3289082	1/13/2015 03:07	180.6000061	1/13/2015 03:02	192.3999939
1/13/2015 04:00	187.0952668	1/13/2015 04:19	181.1000061	1/13/2015 04:11	192.6999969
1/13/2015 05:00	186.9032603	1/13/2015 05:07	180.5	1/13/2015 05:20	192.8000031
1/13/2015 06:00	187.0090537	1/13/2015 06:39	181	1/13/2015 06:11	192.3999939
1/13/2015 07:00	187.0532128	1/13/2015 07:01	182.3000031	1/13/2015 07:00	192.6000061
1/13/2015 08:00	186.9676207	1/13/2015 08:51	180	1/13/2015 08:48	193.3000031
1/13/2015 09:00	188.1394432	1/13/2015 09:18	183.6000061	1/13/2015 09:14	192.6999969
1/13/2015 10:00	185.8796922	1/13/2015 10:08	180.5	1/13/2015 10:28	192.3000031
1/13/2015 11:00	186.8761084	1/13/2015 11:35	180.3000031	1/13/2015 11:16	193.1000061
1/13/2015 12:00	187.2000923	1/13/2015 12:25	180.8000031	1/13/2015 12:20	193.5
1/13/2015 13:00	187.6996888	1/13/2015 13:54	181.6000061	1/13/2015 13:07	193.3000031
1/13/2015 14:00	187.7697174	1/13/2015 14:42	182.6000061	1/13/2015 14:57	195.1000061
1/13/2015 15:00	188.3809134	1/13/2015 15:18	181.3000031	1/13/2015 15:35	194
1/13/2015 16:00	192.461972	1/13/2015 16:05	184.1000061	1/13/2015 16:22	200.8999939
1/13/2015 17:00	193.9998448	1/13/2015 17:18	188.8999939	1/13/2015 17:47	199.3000031
1/13/2015 18:00	194.039644	1/13/2015 18:37	189.1000061	1/13/2015 18:53	200.5
1/13/2015 19:00	193.9721738	1/13/2015 19:59	187	1/13/2015 19:58	200
1/13/2015 20:00	194.0291582	1/13/2015 20:09	187.8999939	1/13/2015 20:49	201
1/13/2015 21:00	193.9883055	1/13/2015 21:23	186.3999939	1/13/2015 21:50	199.6000061
1/13/2015 22:00	194.0100015	1/13/2015 22:03	189.3999939	1/13/2015 22:34	199.8000031
1/13/2015 23:00	194.0347528	1/13/2015 23:42	187.8000031	1/13/2015 23:50	200.3999939
1/14/2015 00:00	193.9588698	1/14/2015 00:17	188.8000031	1/14/2015 00:14	199.8000031
1/14/2015 01:00	193.9918767	1/14/2015 01:45	187.1000061	1/14/2015 01:58	200

WTP Output Flow (MLD)

StartDateTime	Average	MinDateTime	Minimum	MaxDateTime	Maximum
1/14/2015 02:00	197.7220993	1/14/2015 02:00	189.6999969	1/14/2015 02:40	203.1000061
1/14/2015 03:00	198.0497064	1/14/2015 03:48	192.8000031	1/14/2015 03:18	203.5
1/14/2015 04:00	197.9720965	1/14/2015 04:03	191.6000061	1/14/2015 04:47	203.3000031
1/14/2015 05:00	197.9831948	1/14/2015 05:24	191.6999969	1/14/2015 05:09	203.3000031
1/14/2015 06:00	197.9755985	1/14/2015 06:15	192.8000031	1/14/2015 06:35	204
1/14/2015 07:00	198.040534	1/14/2015 07:31	190.3000031	1/14/2015 07:55	202.3999939
1/14/2015 08:00	197.9883244	1/14/2015 08:05	192.8000031	1/14/2015 08:07	203.1999969
1/14/2015 09:00	197.8102364	1/14/2015 09:44	160.1999969	1/14/2015 09:45	220.8000031
1/14/2015 10:00	197.9734539	1/14/2015 10:55	191.6000061	1/14/2015 10:33	203.1000061
1/14/2015 11:00	198.0112955	1/14/2015 11:22	192.6000061	1/14/2015 11:33	203.8999939
1/14/2015 12:00	197.9480183	1/14/2015 12:42	191.6000061	1/14/2015 12:50	204.3999939
1/14/2015 13:00	197.9899921	1/14/2015 13:55	191.3000031	1/14/2015 13:06	206.1000061
1/14/2015 14:00	198.0310812	1/14/2015 14:10	191.1999969	1/14/2015 14:00	204.1000061
1/14/2015 15:00	197.9944367	1/14/2015 15:21	193	1/14/2015 15:48	203.8999939
1/14/2015 16:00	197.9525281	1/14/2015 16:58	191.6000061	1/14/2015 16:45	204.3999939
1/14/2015 17:00	198.0373381	1/14/2015 17:27	191.8000031	1/14/2015 17:13	203.1000061
1/14/2015 18:00	198.018991	1/14/2015 18:42	192.6999969	1/14/2015 18:58	204.3999939
1/14/2015 19:00	197.9845903	1/14/2015 19:07	191.8000031	1/14/2015 19:37	203.6000061
1/14/2015 20:00	197.9750879	1/14/2015 20:41	191	1/14/2015 20:11	204
1/14/2015 21:00	197.9784932	1/14/2015 21:17	192	1/14/2015 21:43	204.1999969
1/14/2015 22:00	197.9818483	1/14/2015 22:22	193	1/14/2015 22:38	204.8000031
1/14/2015 23:00	198.0011231	1/14/2015 23:49	191.6000061	1/14/2015 23:28	202.6000061
1/15/2015 00:00	198.0079979	1/15/2015 00:05	193	1/15/2015 00:40	203.6000061
1/15/2015 01:00	197.9689538	1/15/2015 01:55	192.8999939	1/15/2015 01:35	203.1999969
1/15/2015 02:00	197.9667348	1/15/2015 02:23	192.6000061	1/15/2015 02:24	206
1/15/2015 03:00	198.0644418	1/15/2015 03:09	190.3000031	1/15/2015 03:11	204.1000061
1/15/2015 04:00	197.9253288	1/15/2015 04:53	191.3999939	1/15/2015 04:30	205.3999939
1/15/2015 05:00	198.0311347	1/15/2015 05:43	193.3999939	1/15/2015 05:10	204.1000061
1/15/2015 06:00	198.0039885	1/15/2015 06:24	191.5	1/15/2015 06:54	203.3999939
1/15/2015 07:00	197.9508727	1/15/2015 07:36	193	1/15/2015 07:09	203.8999939
1/15/2015 08:00	198.0442051	1/15/2015 08:54	190.6999969	1/15/2015 08:13	204.8000031
1/15/2015 09:00	197.7993533	1/15/2015 09:10	165.6000061	1/15/2015 09:10	234.1000061
1/15/2015 10:00	197.9640224	1/15/2015 10:37	191	1/15/2015 10:09	203
1/15/2015 11:00	198.059993	1/15/2015 11:03	192.6999969	1/15/2015 11:02	203
1/15/2015 12:00	197.9429754	1/15/2015 12:06	192.6000061	1/15/2015 12:34	202.6000061
1/15/2015 13:00	197.9629666	1/15/2015 13:13	193.1999969	1/15/2015 13:41	202.3999939
1/15/2015 14:00	198.0577795	1/15/2015 14:15	192.8000031	1/15/2015 14:14	203.3999939
1/15/2015 15:00	198.018759	1/15/2015 15:43	192.3999939	1/15/2015 15:16	202.5
1/15/2015 16:00	197.9941323	1/15/2015 16:38	193.3000031	1/15/2015 16:47	202.8000031
1/15/2015 17:00	198.0165358	1/15/2015 17:06	193.6999969	1/15/2015 17:51	203.6999969
1/15/2015 18:00	197.9923139	1/15/2015 18:31	193.1999969	1/15/2015 18:34	202.3000031
1/15/2015 19:00	198.006458	1/15/2015 19:32	193.1999969	1/15/2015 19:14	202.5
1/15/2015 20:00	198.0190762	1/15/2015 20:11	193.3999939	1/15/2015 20:36	203
1/15/2015 21:00	197.9970571	1/15/2015 21:32	193	1/15/2015 21:30	203.3000031
1/15/2015 22:00	197.9631231	1/15/2015 22:50	192.6000061	1/15/2015 22:13	203.1000061
1/15/2015 23:00	197.9847523	1/15/2015 23:59	193.5	1/15/2015 23:35	202.3000031
1/16/2015 00:00	198.0572617	1/16/2015 00:41	192.1999969	1/16/2015 00:18	202.8999939
1/16/2015 01:00	197.9858181	1/16/2015 01:02	193.6000061	1/16/2015 01:20	203.3999939
1/16/2015 02:00	197.942204	1/16/2015 02:03	191.6999969	1/16/2015 02:40	202.1000061
1/16/2015 03:00	198.0074362	1/16/2015 03:25	192.1999969	1/16/2015 03:11	204.6000061

WTP Output Flow (MLD)

StartDateTime	Average	MinDateTime	Minimum	MaxDateTime	Maximum
1/16/2015 04:00	198.0807092	1/16/2015 04:15	193.8000031	1/16/2015 04:17	203
1/16/2015 05:00	197.9866928	1/16/2015 05:54	192.1000061	1/16/2015 05:37	203
1/16/2015 06:00	197.9561008	1/16/2015 06:39	190.8000031	1/16/2015 06:09	203.6000061
1/16/2015 07:00	198.0004589	1/16/2015 07:25	191.6999969	1/16/2015 07:20	202.8000031
1/16/2015 08:00	198.0080462	1/16/2015 08:54	193.3000031	1/16/2015 08:28	202.8000031
1/16/2015 09:00	198.0637699	1/16/2015 09:04	193.5	1/16/2015 09:13	203.6000061
1/16/2015 10:00	197.9456773	1/16/2015 10:58	192.3999939	1/16/2015 10:59	202.8000031
1/16/2015 11:00	198.0168132	1/16/2015 11:40	192.8999939	1/16/2015 11:00	203.3999939
1/16/2015 12:00	198.0180895	1/16/2015 12:32	192.3999939	1/16/2015 12:46	201.8999939
1/16/2015 13:00	197.9954675	1/16/2015 13:51	192.1999969	1/16/2015 13:48	202.1000061
1/16/2015 14:00	197.9541904	1/16/2015 14:25	192.3999939	1/16/2015 14:06	202.8999939
1/16/2015 15:00	197.9860401	1/16/2015 15:36	190.8000031	1/16/2015 15:36	202.3000031
1/16/2015 16:00	198.0644055	1/16/2015 16:20	192	1/16/2015 16:08	203
1/16/2015 17:00	197.9447347	1/16/2015 17:18	189.1999969	1/16/2015 17:45	204
1/16/2015 18:00	198.0728383	1/16/2015 18:54	192.8000031	1/16/2015 18:34	203.3000031
1/16/2015 19:00	197.9300591	1/16/2015 19:38	192.6000061	1/16/2015 19:22	202.1999969
1/16/2015 20:00	198.0728636	1/16/2015 20:19	193.1999969	1/16/2015 20:02	202.1999969
1/16/2015 21:00	197.9342441	1/16/2015 21:15	193.3999939	1/16/2015 21:33	202.8000031
1/16/2015 22:00	198.0337909	1/16/2015 22:58	193	1/16/2015 22:58	203.3999939
1/16/2015 23:00	197.9634661	1/16/2015 23:42	190.6000061	1/16/2015 23:53	203
1/17/2015 00:00	198.0169065	1/17/2015 00:57	192.6999969	1/17/2015 00:35	202.3000031
1/17/2015 01:00	197.9614817	1/17/2015 01:59	191.5	1/17/2015 01:36	202.3999939
1/17/2015 02:00	198.0057649	1/17/2015 02:56	192.8000031	1/17/2015 02:30	202.5
1/17/2015 03:00	198.0084254	1/17/2015 03:57	190.8000031	1/17/2015 03:49	202.3999939
1/17/2015 04:00	198.059077	1/17/2015 04:16	193	1/17/2015 04:05	203
1/17/2015 05:00	197.9430096	1/17/2015 05:15	192.8000031	1/17/2015 05:27	203.1999969
1/17/2015 06:00	198.0029466	1/17/2015 06:43	192.8999939	1/17/2015 06:36	203.6000061
1/17/2015 07:00	190.5935885	1/17/2015 07:37	183.8000031	1/17/2015 07:14	201.1000061
1/17/2015 08:00	188.066856	1/17/2015 08:17	181.3999939	1/17/2015 08:58	192
1/17/2015 09:00	187.9314174	1/17/2015 09:56	183.3000031	1/17/2015 09:25	194.3999939
1/17/2015 10:00	188.0532709	1/17/2015 10:54	184.3000031	1/17/2015 10:07	192.6999969
1/17/2015 11:00	188.0381542	1/17/2015 11:30	181.1999969	1/17/2015 11:52	193.1999969
1/17/2015 12:00	187.9310984	1/17/2015 12:09	181.6000061	1/17/2015 12:20	192.8000031
1/17/2015 13:00	188.0091696	1/17/2015 13:46	182	1/17/2015 13:55	192.1000061
1/17/2015 14:00	188.0730038	1/17/2015 14:39	181.3999939	1/17/2015 14:26	192.5
1/17/2015 15:00	187.9634809	1/17/2015 15:00	181.8999939	1/17/2015 15:28	193
1/17/2015 16:00	187.9941684	1/17/2015 16:13	183.1000061	1/17/2015 16:43	193.8000031
1/17/2015 17:00	188.0051285	1/17/2015 17:17	183.3999939	1/17/2015 17:20	194.3999939
1/17/2015 18:00	187.9840598	1/17/2015 18:20	182.5	1/17/2015 18:23	193.1999969
1/17/2015 19:00	187.9754673	1/17/2015 19:16	182.8999939	1/17/2015 19:41	193.8999939
1/17/2015 20:00	188.0379226	1/17/2015 20:18	182	1/17/2015 20:01	193.1999969
1/17/2015 21:00	188.0267162	1/17/2015 21:17	182.3999939	1/17/2015 21:52	192.8999939
1/17/2015 22:00	188.0139108	1/17/2015 22:55	180.8000031	1/17/2015 22:43	192.8000031
1/17/2015 23:00	187.9830885	1/17/2015 23:29	181.8999939	1/17/2015 23:44	192.8999939
1/18/2015 00:00	187.9996595	1/18/2015 00:20	182.3999939	1/18/2015 00:20	192.8999939
1/18/2015 01:00	187.9677159	1/18/2015 01:46	182.8000031	1/18/2015 01:44	192.3000031
1/18/2015 02:00	188.0404754	1/18/2015 02:15	181.1999969	1/18/2015 02:41	193.8999939
1/18/2015 03:00	187.9891303	1/18/2015 03:24	181.3000031	1/18/2015 03:07	192.1999969
1/18/2015 04:00	188.0339526	1/18/2015 04:51	182.1999969	1/18/2015 04:50	193.3999939
1/18/2015 05:00	187.9366241	1/18/2015 05:27	183.6000061	1/18/2015 05:02	193

WTP Output Flow (MLD)

StartDateTime	Average	MinDateTime	Minimum	MaxDateTime	Maximum
1/18/2015 06:00	188.0483575	1/18/2015 06:30	182.8999939	1/18/2015 06:05	193.3999939
1/18/2015 07:00	189.6297369	1/18/2015 07:09	183.1999969	1/18/2015 07:40	195.6000061
1/18/2015 08:00	189.962989	1/18/2015 08:00	184.8000031	1/18/2015 08:57	194.1000061
1/18/2015 09:00	189.9669786	1/18/2015 09:45	184.5	1/18/2015 09:09	195.1999969
1/18/2015 10:00	190.0015101	1/18/2015 10:13	183.1000061	1/18/2015 10:29	194.8999939
1/18/2015 11:00	190.0061634	1/18/2015 11:24	184.8999939	1/18/2015 11:13	194.1000061
1/18/2015 12:00	189.9992255	1/18/2015 12:22	185.5	1/18/2015 12:08	193.8999939
1/18/2015 13:00	190.0405887	1/18/2015 13:12	184	1/18/2015 13:28	195.3000031
1/18/2015 14:00	189.9764268	1/18/2015 14:44	185.3000031	1/18/2015 14:46	194.1999969
1/18/2015 15:00	189.963764	1/18/2015 15:14	184.8999939	1/18/2015 15:58	194.8999939
1/18/2015 16:00	190.0767248	1/18/2015 16:09	185	1/18/2015 16:42	195.1999969
1/18/2015 17:00	189.9107602	1/18/2015 17:00	183.8999939	1/18/2015 17:40	194.6999969
1/18/2015 18:00	190.0451564	1/18/2015 18:43	184.8000031	1/18/2015 18:38	195.1999969
1/18/2015 19:00	190.0085267	1/18/2015 19:50	185.6999969	1/18/2015 19:02	193.6999969
1/18/2015 20:00	189.9569232	1/18/2015 20:01	183.6999969	1/18/2015 20:09	195.1000061
1/18/2015 21:00	189.9930355	1/18/2015 21:35	184.6000061	1/18/2015 21:40	194.6999969
1/18/2015 22:00	190.0566888	1/18/2015 22:04	182.8000031	1/18/2015 22:59	194.8000031
1/18/2015 23:00	189.9978576	1/18/2015 23:28	185.5	1/18/2015 23:27	193.6000061
1/19/2015 00:00	189.9942336	1/19/2015 00:01	185.3999939	1/19/2015 00:42	195.3999939
1/19/2015 01:00	189.9973594	1/19/2015 01:22	183.8000031	1/19/2015 01:50	195.3999939
1/19/2015 02:00	189.9480314	1/19/2015 02:06	184.6999969	1/19/2015 02:57	195.5
1/19/2015 03:00	190.0547061	1/19/2015 03:25	185.1000061	1/19/2015 03:17	195
1/19/2015 04:00	189.9742983	1/19/2015 04:04	184.6000061	1/19/2015 04:15	194.6999969
1/19/2015 05:00	189.970137	1/19/2015 05:57	185.3999939	1/19/2015 05:26	194.6000061
1/19/2015 06:00	190.0334131	1/19/2015 06:49	184.8999939	1/19/2015 06:17	195.1999969
1/19/2015 07:00	190.0190227	1/19/2015 07:54	183.6000061	1/19/2015 07:53	197.1000061
1/19/2015 08:00	189.9404767	1/19/2015 08:13	184.8000031	1/19/2015 08:39	195.5
1/19/2015 09:00	190.0273304	1/19/2015 09:12	183.3000031	1/19/2015 09:00	194.3999939
1/19/2015 10:00	189.4966442	1/19/2015 10:58	0	1/19/2015 10:06	194.6999969
1/19/2015 11:00	190.0361543	1/19/2015 11:42	183.6999969	1/19/2015 11:01	195
1/19/2015 12:00	190.0196486	1/19/2015 12:02	185	1/19/2015 12:24	195.5
1/19/2015 13:00	189.9659119	1/19/2015 13:08	182.8999939	1/19/2015 13:25	196.3999939
1/19/2015 14:00	189.9672686	1/19/2015 14:03	183.8999939	1/19/2015 14:31	194
1/19/2015 15:00	190.0619579	1/19/2015 15:20	184.5	1/19/2015 15:21	198.1000061
1/19/2015 16:00	189.9657945	1/19/2015 16:37	185.3000031	1/19/2015 16:55	195.6999969
1/19/2015 17:00	189.9937481	1/19/2015 17:34	185.3000031	1/19/2015 17:07	193.1000061
1/19/2015 18:00	189.9799139	1/19/2015 18:34	185.1999969	1/19/2015 18:30	194.3999939
1/19/2015 19:00	189.9916643	1/19/2015 19:24	185.8000031	1/19/2015 19:10	192.6000061
1/19/2015 20:00	190.0097665	1/19/2015 20:13	185.5	1/19/2015 20:37	193.6000061
1/19/2015 21:00	189.9742491	1/19/2015 21:10	186.3000031	1/19/2015 21:16	193.5
1/19/2015 22:00	190.0721001	1/19/2015 22:25	185	1/19/2015 22:01	195.3000031
1/19/2015 23:00	189.9833721	1/19/2015 23:09	184.8000031	1/19/2015 23:57	194.1000061
1/20/2015 00:00	189.9682633	1/20/2015 00:54	183.1000061	1/20/2015 00:33	194.6000061
1/20/2015 01:00	189.9877296	1/20/2015 01:33	185.5	1/20/2015 01:45	194.1000061
1/20/2015 02:00	189.990117	1/20/2015 02:56	185.8000031	1/20/2015 02:26	193.3000031
1/20/2015 03:00	190.0123139	1/20/2015 03:36	184.6999969	1/20/2015 03:56	194.6000061
1/20/2015 04:00	189.9699182	1/20/2015 04:29	186.3000031	1/20/2015 04:56	193.8000031
1/20/2015 05:00	190.0033824	1/20/2015 05:49	185.8999939	1/20/2015 05:28	193.1999969
1/20/2015 06:00	189.9832914	1/20/2015 06:54	185.6000061	1/20/2015 06:56	193.6000061
1/20/2015 07:00	189.9890681	1/20/2015 07:51	184.3000031	1/20/2015 07:19	194.1000061

WTP Output Flow (MLD)

StartDateTime	Average	MinDateTime	Minimum	MaxDateTime	Maximum
1/20/2015 08:00	190.059901	1/20/2015 08:59	186.1000061	1/20/2015 08:27	196.1000061
1/20/2015 09:00	189.9819688	1/20/2015 09:00	185.6999969	1/20/2015 09:26	194.6999969
1/20/2015 10:00	185.4237714	1/20/2015 10:59	162.8999939	1/20/2015 10:03	193.5
1/20/2015 11:00	165.0068504	1/20/2015 11:22	158.6000061	1/20/2015 11:21	183.1999969
1/20/2015 12:00	165.0192258	1/20/2015 12:17	160.8999939	1/20/2015 12:36	168.6000061
1/20/2015 13:00	165.0016137	1/20/2015 13:21	159.5	1/20/2015 13:05	168.3999939
1/20/2015 14:00	165.0005875	1/20/2015 14:33	161.8999939	1/20/2015 14:18	168.1999969
1/20/2015 15:00	186.645598	1/20/2015 15:01	162.6999969	1/20/2015 15:37	194.8000031
1/20/2015 16:00	190.0416365	1/20/2015 16:10	183.5	1/20/2015 16:36	194.6000061
1/20/2015 17:00	189.9534181	1/20/2015 17:12	184.3999939	1/20/2015 17:23	195.1999969
1/20/2015 18:00	190.00605	1/20/2015 18:39	185.1999969	1/20/2015 18:52	195.8999939
1/20/2015 19:00	190.0058098	1/20/2015 19:07	185	1/20/2015 19:54	195.6000061
1/20/2015 20:00	189.993289	1/20/2015 20:51	185	1/20/2015 20:02	195
1/20/2015 21:00	190.0438396	1/20/2015 21:56	184.1999969	1/20/2015 21:29	193.1999969
1/20/2015 22:00	189.9413663	1/20/2015 22:33	185.1999969	1/20/2015 22:23	194.1000061
1/20/2015 23:00	190.0197171	1/20/2015 23:36	186.6000061	1/20/2015 23:08	194.3999939
1/21/2015 00:00	189.9944022	1/21/2015 00:34	185.5	1/21/2015 00:19	193
1/21/2015 01:00	189.9725964	1/21/2015 01:31	186.1000061	1/21/2015 01:39	195.5
1/21/2015 02:00	190.0199423	1/21/2015 02:54	185.6000061	1/21/2015 02:53	195.8999939
1/21/2015 03:00	190.0299697	1/21/2015 03:24	186.1999969	1/21/2015 03:27	194.8999939
1/21/2015 04:00	189.9567076	1/21/2015 04:58	186	1/21/2015 04:40	195.5
1/21/2015 05:00	189.9840864	1/21/2015 05:06	186	1/21/2015 05:14	195.1000061
1/21/2015 06:00	190.0002448	1/21/2015 06:05	186.6000061	1/21/2015 06:53	195.5
1/21/2015 07:00	190.0311259	1/21/2015 07:52	184.5	1/21/2015 07:48	195.3999939
1/21/2015 08:00	189.9988777	1/21/2015 08:48	185.8000031	1/21/2015 08:26	194.6999969
1/21/2015 09:00	190.0142477	1/21/2015 09:31	184.3999939	1/21/2015 09:42	195.8000031
1/21/2015 10:00	189.9390761	1/21/2015 10:18	185.3000031	1/21/2015 10:50	193
1/21/2015 11:00	190.0682282	1/21/2015 11:43	184.1999969	1/21/2015 11:20	194.6000061
1/21/2015 12:00	189.926491	1/21/2015 12:01	185.8999939	1/21/2015 12:51	194
1/21/2015 13:00	190.0575039	1/21/2015 13:23	186	1/21/2015 13:53	193.8999939
1/21/2015 14:00	189.9629984	1/21/2015 14:07	185.8000031	1/21/2015 14:00	193.3000031
1/21/2015 15:00	189.9804296	1/21/2015 15:51	185.3999939	1/21/2015 15:16	193.8000031
1/21/2015 16:00	190.0405088	1/21/2015 16:39	185.8999939	1/21/2015 16:01	194.1000061
1/21/2015 17:00	190.0016544	1/21/2015 17:40	186.1999969	1/21/2015 17:58	193.3999939
1/21/2015 18:00	190.0108169	1/21/2015 18:13	186.3000031	1/21/2015 18:43	195.8000031
1/21/2015 19:00	190.0180305	1/21/2015 19:56	185.3000031	1/21/2015 19:58	193.3000031
1/21/2015 20:00	189.9651991	1/21/2015 20:24	184	1/21/2015 20:18	193.1999969
1/21/2015 21:00	189.9617773	1/21/2015 21:24	183.3999939	1/21/2015 21:25	194
1/21/2015 22:00	190.0029946	1/21/2015 22:17	185.6000061	1/21/2015 22:37	194.6000061
1/21/2015 23:00	190.0492356	1/21/2015 23:48	185.1000061	1/21/2015 23:32	193
1/22/2015 00:00	189.9557533	1/22/2015 00:00	186	1/22/2015 00:02	194.5
1/22/2015 01:00	189.9758368	1/22/2015 01:34	184	1/22/2015 01:42	193.8999939
1/22/2015 02:00	190.0653971	1/22/2015 02:08	184.6999969	1/22/2015 02:37	194.6999969
1/22/2015 03:00	189.9562521	1/22/2015 03:35	185.1000061	1/22/2015 03:37	194.1999969
1/22/2015 04:00	188.1584239	1/22/2015 04:47	182.1999969	1/22/2015 04:16	193.6000061
1/22/2015 05:00	185.0296611	1/22/2015 05:59	179.8000031	1/22/2015 05:41	190.6000061
1/22/2015 06:00	184.9791428	1/22/2015 06:48	177.8000031	1/22/2015 06:33	190
1/22/2015 07:00	185.0415939	1/22/2015 07:34	180.6999969	1/22/2015 07:16	188.5
1/22/2015 08:00	185.0179581	1/22/2015 08:35	181.6000061	1/22/2015 08:34	189.3000031
1/22/2015 09:00	184.9512791	1/22/2015 09:57	180.3999939	1/22/2015 09:04	188.6999969

WTP Output Flow (MLD)

StartDateTime	Average	MinDateTime	Minimum	MaxDateTime	Maximum
1/22/2015 10:00	185.0578693	1/22/2015 10:37	181.1999969	1/22/2015 10:40	189.3000031
1/22/2015 11:00	184.9594197	1/22/2015 11:19	181.6999969	1/22/2015 11:41	189
1/22/2015 12:00	185.0209072	1/22/2015 12:22	180.6000061	1/22/2015 12:48	189
1/22/2015 13:00	185.0322125	1/22/2015 13:42	180	1/22/2015 13:45	187.5
1/22/2015 14:00	184.9660541	1/22/2015 14:09	181.1999969	1/22/2015 14:53	189
1/22/2015 15:00	185.0299694	1/22/2015 15:22	181.1999969	1/22/2015 15:52	188.5
1/22/2015 16:00	184.9361478	1/22/2015 16:32	181.1999969	1/22/2015 16:46	189.8000031
1/22/2015 17:00	184.9851028	1/22/2015 17:11	180	1/22/2015 17:08	190.1000061
1/22/2015 18:00	185.0120691	1/22/2015 18:35	180.6000061	1/22/2015 18:51	188.6000061
1/22/2015 19:00	184.9964256	1/22/2015 19:53	181	1/22/2015 19:56	188.6000061
1/22/2015 20:00	185.0877988	1/22/2015 20:10	180.6999969	1/22/2015 20:52	189.6000061
1/22/2015 21:00	184.9873716	1/22/2015 21:40	179.3000031	1/22/2015 21:50	188.8999939
1/22/2015 22:00	184.9840054	1/22/2015 22:19	181.1000061	1/22/2015 22:47	188.6999969
1/22/2015 23:00	185.0034424	1/22/2015 23:44	180	1/22/2015 23:03	190.5
1/23/2015 00:00	185.0054653	1/23/2015 00:04	180.8000031	1/23/2015 00:59	190.5
1/23/2015 01:00	184.9560478	1/23/2015 01:14	180.1999969	1/23/2015 01:15	190.3000031
1/23/2015 02:00	185.0629591	1/23/2015 02:07	178.5	1/23/2015 02:13	188.1000061
1/23/2015 03:00	184.9696349	1/23/2015 03:59	181	1/23/2015 03:08	187.8000031
1/23/2015 04:00	185.0342822	1/23/2015 04:11	179.8000031	1/23/2015 04:23	189.3000031
1/23/2015 05:00	184.9952982	1/23/2015 05:25	179.5	1/23/2015 05:02	189.1999969
1/23/2015 06:00	184.9450683	1/23/2015 06:41	179	1/23/2015 06:18	188.1999969
1/23/2015 07:00	185.0084066	1/23/2015 07:33	181.1999969	1/23/2015 07:36	188.6999969
1/23/2015 08:00	185.0663264	1/23/2015 08:12	180.1000061	1/23/2015 08:31	189.3999939
1/23/2015 09:00	184.9377648	1/23/2015 09:07	179.3999939	1/23/2015 09:20	189.8000031
1/23/2015 10:00	185.0265352	1/23/2015 10:11	180	1/23/2015 10:01	189.1999969
1/23/2015 11:00	185.0356581	1/23/2015 11:57	180.8000031	1/23/2015 11:59	189.6000061
1/23/2015 12:00	184.9889435	1/23/2015 12:18	180.3999939	1/23/2015 12:56	189
1/23/2015 13:00	184.9603077	1/23/2015 13:37	180.1999969	1/23/2015 13:55	189.6999969
1/23/2015 14:00	184.9989194	1/23/2015 14:05	180.3000031	1/23/2015 14:11	189.8000031
1/23/2015 15:00	185.0132514	1/23/2015 15:36	180.6999969	1/23/2015 15:05	190.3999939
1/23/2015 16:00	185.0270987	1/23/2015 16:37	179.8000031	1/23/2015 16:30	190.5
1/23/2015 17:00	185.0318548	1/23/2015 17:51	179.3000031	1/23/2015 17:04	190.6000061
1/23/2015 18:00	184.9938674	1/23/2015 18:37	179.6999969	1/23/2015 18:50	190.5
1/23/2015 19:00	184.9643157	1/23/2015 19:46	180.6999969	1/23/2015 19:17	190.1000061
1/23/2015 20:00	185.0240887	1/23/2015 20:24	180.6999969	1/23/2015 20:36	189.1000061
1/23/2015 21:00	184.9465565	1/23/2015 21:41	180.8000031	1/23/2015 21:35	187.5
1/23/2015 22:00	185.0064603	1/23/2015 22:30	180	1/23/2015 22:28	189
1/23/2015 23:00	185.0454892	1/23/2015 23:48	180.6999969	1/23/2015 23:26	190.8000031
1/24/2015 00:00	184.9844105	1/24/2015 00:02	180.8000031	1/24/2015 00:03	189.3999939
1/24/2015 01:00	184.9738496	1/24/2015 01:21	178.6999969	1/24/2015 01:29	190.8999939
1/24/2015 02:00	184.9907746	1/24/2015 02:06	178.1999969	1/24/2015 02:20	188.3999939
1/24/2015 03:00	185.0007365	1/24/2015 03:05	180.6000061	1/24/2015 03:44	189.1999969
1/24/2015 04:00	184.9967973	1/24/2015 04:28	179.1000061	1/24/2015 04:23	189.6999969
1/24/2015 05:00	185.039647	1/24/2015 05:14	181.1999969	1/24/2015 05:33	192.1000061
1/24/2015 06:00	184.9988987	1/24/2015 06:25	178.8999939	1/24/2015 06:12	190.8000031
1/24/2015 07:00	185.0330868	1/24/2015 07:05	180.5	1/24/2015 07:09	190.6999969
1/24/2015 08:00	184.9891121	1/24/2015 08:00	180	1/24/2015 08:02	190.1000061
1/24/2015 09:00	184.9412007	1/24/2015 09:45	179.1999969	1/24/2015 09:14	189.6999969
1/24/2015 10:00	185.0686416	1/24/2015 10:23	179.6000061	1/24/2015 10:25	189.3999939
1/24/2015 11:00	185.0027675	1/24/2015 11:01	181.1999969	1/24/2015 11:22	187.8999939

WTP Output Flow (MLD)

StartDateTime	Average	MinDateTime	Minimum	MaxDateTime	Maximum
1/24/2015 12:00	184.967411	1/24/2015 12:31	180.1000061	1/24/2015 12:05	187.8999939
1/24/2015 13:00	184.9842046	1/24/2015 13:28	179.1999969	1/24/2015 13:59	189
1/24/2015 14:00	185.0003523	1/24/2015 14:21	179.1000061	1/24/2015 14:06	191.3999939
1/24/2015 15:00	185.0329053	1/24/2015 15:19	180.8999939	1/24/2015 15:21	190.1000061
1/24/2015 16:00	184.9759757	1/24/2015 16:05	179.8000031	1/24/2015 16:51	190.1999969
1/24/2015 17:00	185.0111006	1/24/2015 17:42	180.6000061	1/24/2015 17:44	188.5
1/24/2015 18:00	184.9769799	1/24/2015 18:38	180.6999969	1/24/2015 18:52	189.5
1/24/2015 19:00	185.0301858	1/24/2015 19:52	179.8999939	1/24/2015 19:53	189.1000061
1/24/2015 20:00	185.0123653	1/24/2015 20:51	180.6999969	1/24/2015 20:25	189.6000061
1/24/2015 21:00	185.0008155	1/24/2015 21:29	179.1999969	1/24/2015 21:59	188.8000031
1/24/2015 22:00	185.0122579	1/24/2015 22:38	179.6000061	1/24/2015 22:18	188.6000061
1/24/2015 23:00	184.9684336	1/24/2015 23:01	179.8000031	1/24/2015 23:50	189.8999939
1/25/2015 00:00	185.0255482	1/25/2015 00:08	178.8999939	1/25/2015 00:02	187.6999969
1/25/2015 01:00	185.0252011	1/25/2015 01:39	179.8000031	1/25/2015 01:23	188.8000031
1/25/2015 02:00	184.9482498	1/25/2015 02:19	179.8000031	1/25/2015 02:05	188.1999969
1/25/2015 03:00	184.9988661	1/25/2015 03:08	179.8000031	1/25/2015 03:55	189.6999969
1/25/2015 04:00	185.0419976	1/25/2015 04:31	181	1/25/2015 04:42	189.8000031
1/25/2015 05:00	184.9375062	1/25/2015 05:09	180	1/25/2015 05:12	189.8999939
1/25/2015 06:00	184.9653923	1/25/2015 06:14	180.8000031	1/25/2015 06:20	190.8000031
1/25/2015 07:00	185.0254446	1/25/2015 07:52	180.1999969	1/25/2015 07:24	190.8000031
1/25/2015 08:00	184.9926993	1/25/2015 08:59	179.6000061	1/25/2015 08:07	191.3000031
1/25/2015 09:00	185.0326088	1/25/2015 09:04	181.1999969	1/25/2015 09:39	187.8999939
1/25/2015 10:00	185.0260826	1/25/2015 10:49	179.1999969	1/25/2015 10:47	188.1999969
1/25/2015 11:00	184.9304627	1/25/2015 11:02	179.8999939	1/25/2015 11:16	189.8999939
1/25/2015 12:00	185.0316711	1/25/2015 12:50	180.8000031	1/25/2015 12:52	189.6000061
1/25/2015 13:00	185.0287681	1/25/2015 13:24	179.6000061	1/25/2015 13:59	190.1999969
1/25/2015 14:00	185.0133336	1/25/2015 14:14	180.5	1/25/2015 14:23	190.1000061
1/25/2015 15:00	184.9468938	1/25/2015 15:08	180.3000031	1/25/2015 15:33	188.8999939
1/25/2015 16:00	185.0475895	1/25/2015 16:23	180.5	1/25/2015 16:25	189.6999969
1/25/2015 17:00	185.0150853	1/25/2015 17:09	180.3000031	1/25/2015 17:54	189.3000031
1/25/2015 18:00	184.9772891	1/25/2015 18:17	180.3000031	1/25/2015 18:05	188.8000031
1/25/2015 19:00	185.0100928	1/25/2015 19:50	178.3999939	1/25/2015 19:52	189.6999969
1/25/2015 20:00	185.0035487	1/25/2015 20:38	180.6000061	1/25/2015 20:44	191.1000061
1/25/2015 21:00	184.9426057	1/25/2015 21:25	178.8999939	1/25/2015 21:54	189.1999969
1/25/2015 22:00	185.0666337	1/25/2015 22:25	179.3999939	1/25/2015 22:02	188.6000061
1/25/2015 23:00	184.9869148	1/25/2015 23:39	180.6999969	1/25/2015 23:48	189.8999939
1/26/2015 00:00	184.975313	1/26/2015 00:30	180.8999939	1/26/2015 00:52	188.5
1/26/2015 01:00	184.9921814	1/26/2015 01:48	178.8000031	1/26/2015 01:14	190.8000031
1/26/2015 02:00	185.0037037	1/26/2015 02:53	178.8999939	1/26/2015 02:01	189.6999969
1/26/2015 03:00	184.9852111	1/26/2015 03:04	180.8000031	1/26/2015 03:36	189.6000061
1/26/2015 04:00	184.9884815	1/26/2015 04:13	178.8999939	1/26/2015 04:23	188.1999969
1/26/2015 05:00	185.0289873	1/26/2015 05:35	179.6000061	1/26/2015 05:25	189.6000061
1/26/2015 06:00	184.9953172	1/26/2015 06:07	180.8999939	1/26/2015 06:51	188.8000031
1/26/2015 07:00	184.9797378	1/26/2015 07:30	180.8999939	1/26/2015 07:04	189.6000061
1/26/2015 08:00	184.990119	1/26/2015 08:38	178.1000061	1/26/2015 08:37	190.3000031
1/26/2015 09:00	185.0230303	1/26/2015 09:31	181.8000031	1/26/2015 09:02	189.1000061
1/26/2015 10:00	184.999125	1/26/2015 10:16	179.6000061	1/26/2015 10:52	189
1/26/2015 11:00	184.9615048	1/26/2015 11:47	180.1999969	1/26/2015 11:08	190
1/26/2015 12:00	184.9733321	1/26/2015 12:00	180.6999969	1/26/2015 12:00	190.1999969
1/26/2015 13:00	185.0335784	1/26/2015 13:31	180.1999969	1/26/2015 13:30	190.1999969

WTP Output Flow (MLD)

StartDateTime	Average	MinDateTime	Minimum	MaxDateTime	Maximum
1/26/2015 14:00	184.9949726	1/26/2015 14:06	179.8000031	1/26/2015 14:24	189.1999969
1/26/2015 15:00	185.0215064	1/26/2015 15:28	181.1000061	1/26/2015 15:36	189.6999969
1/26/2015 16:00	185.0192391	1/26/2015 16:48	181.5	1/26/2015 16:14	189.6999969
1/26/2015 17:00	184.9772293	1/26/2015 17:32	180.1999969	1/26/2015 17:04	188.6999969
1/26/2015 18:00	184.9971952	1/26/2015 18:13	178.3999939	1/26/2015 18:38	190.1000061
1/26/2015 19:00	184.9914423	1/26/2015 19:39	180.6000061	1/26/2015 19:41	189.6999969
1/26/2015 20:00	185.0135205	1/26/2015 20:12	178.8999939	1/26/2015 20:20	189
1/26/2015 21:00	184.9852845	1/26/2015 21:19	180.6999969	1/26/2015 21:20	189.3000031
1/26/2015 22:00	185.0283847	1/26/2015 22:34	180.3000031	1/26/2015 22:52	187.1999969
1/26/2015 23:00	184.9538069	1/26/2015 23:21	180.8999939	1/26/2015 23:18	189.6000061

AECOM

E12b Hurst Hourly Min Res Levels Jan 12-27, 2015

Global Trendset

Global Trendset

Trend Name: Hurst_Levels ▶ Search

Owner: DougSulymka

Global trend: (•) Yes ( ) No

☐ Individual Y Axes ☑ Markers On

☐ Show Data Quality

Default Timescales

Add Pen | Delete Pen | Edit

New | Dismiss | Abandon | Add | Modify | Delete

Hurst Reservoir Levels

234.6
234.4
234.2
234.0
233.8
233.6

South Reservoir
East Reservoir
West Reservoir

P

1/15/2015
1/22/2015

◄ 1/12/2015 12:00 AM << Primary >> 1/27/2015 12:00 AM ►

AECOM

E12c MacLean Hourly Min Res Levels Jan 12 – 27, 2015

Global Trendset

Global Trendset

Trend Name: Macleans_Levels ▶ Search

Owner: DougSulymka

Global trend: (•) Yes ( ) No

☐ Individual Y Axes ☑ Markers On

☐ Show Data Quality

Default Timescales

4hrs 8hrs 12hrs 24hrs

Add Pen | Delete Pen | Edit

New | Abandon | Modify

Dismiss | Add | Delete

Macleans Levels

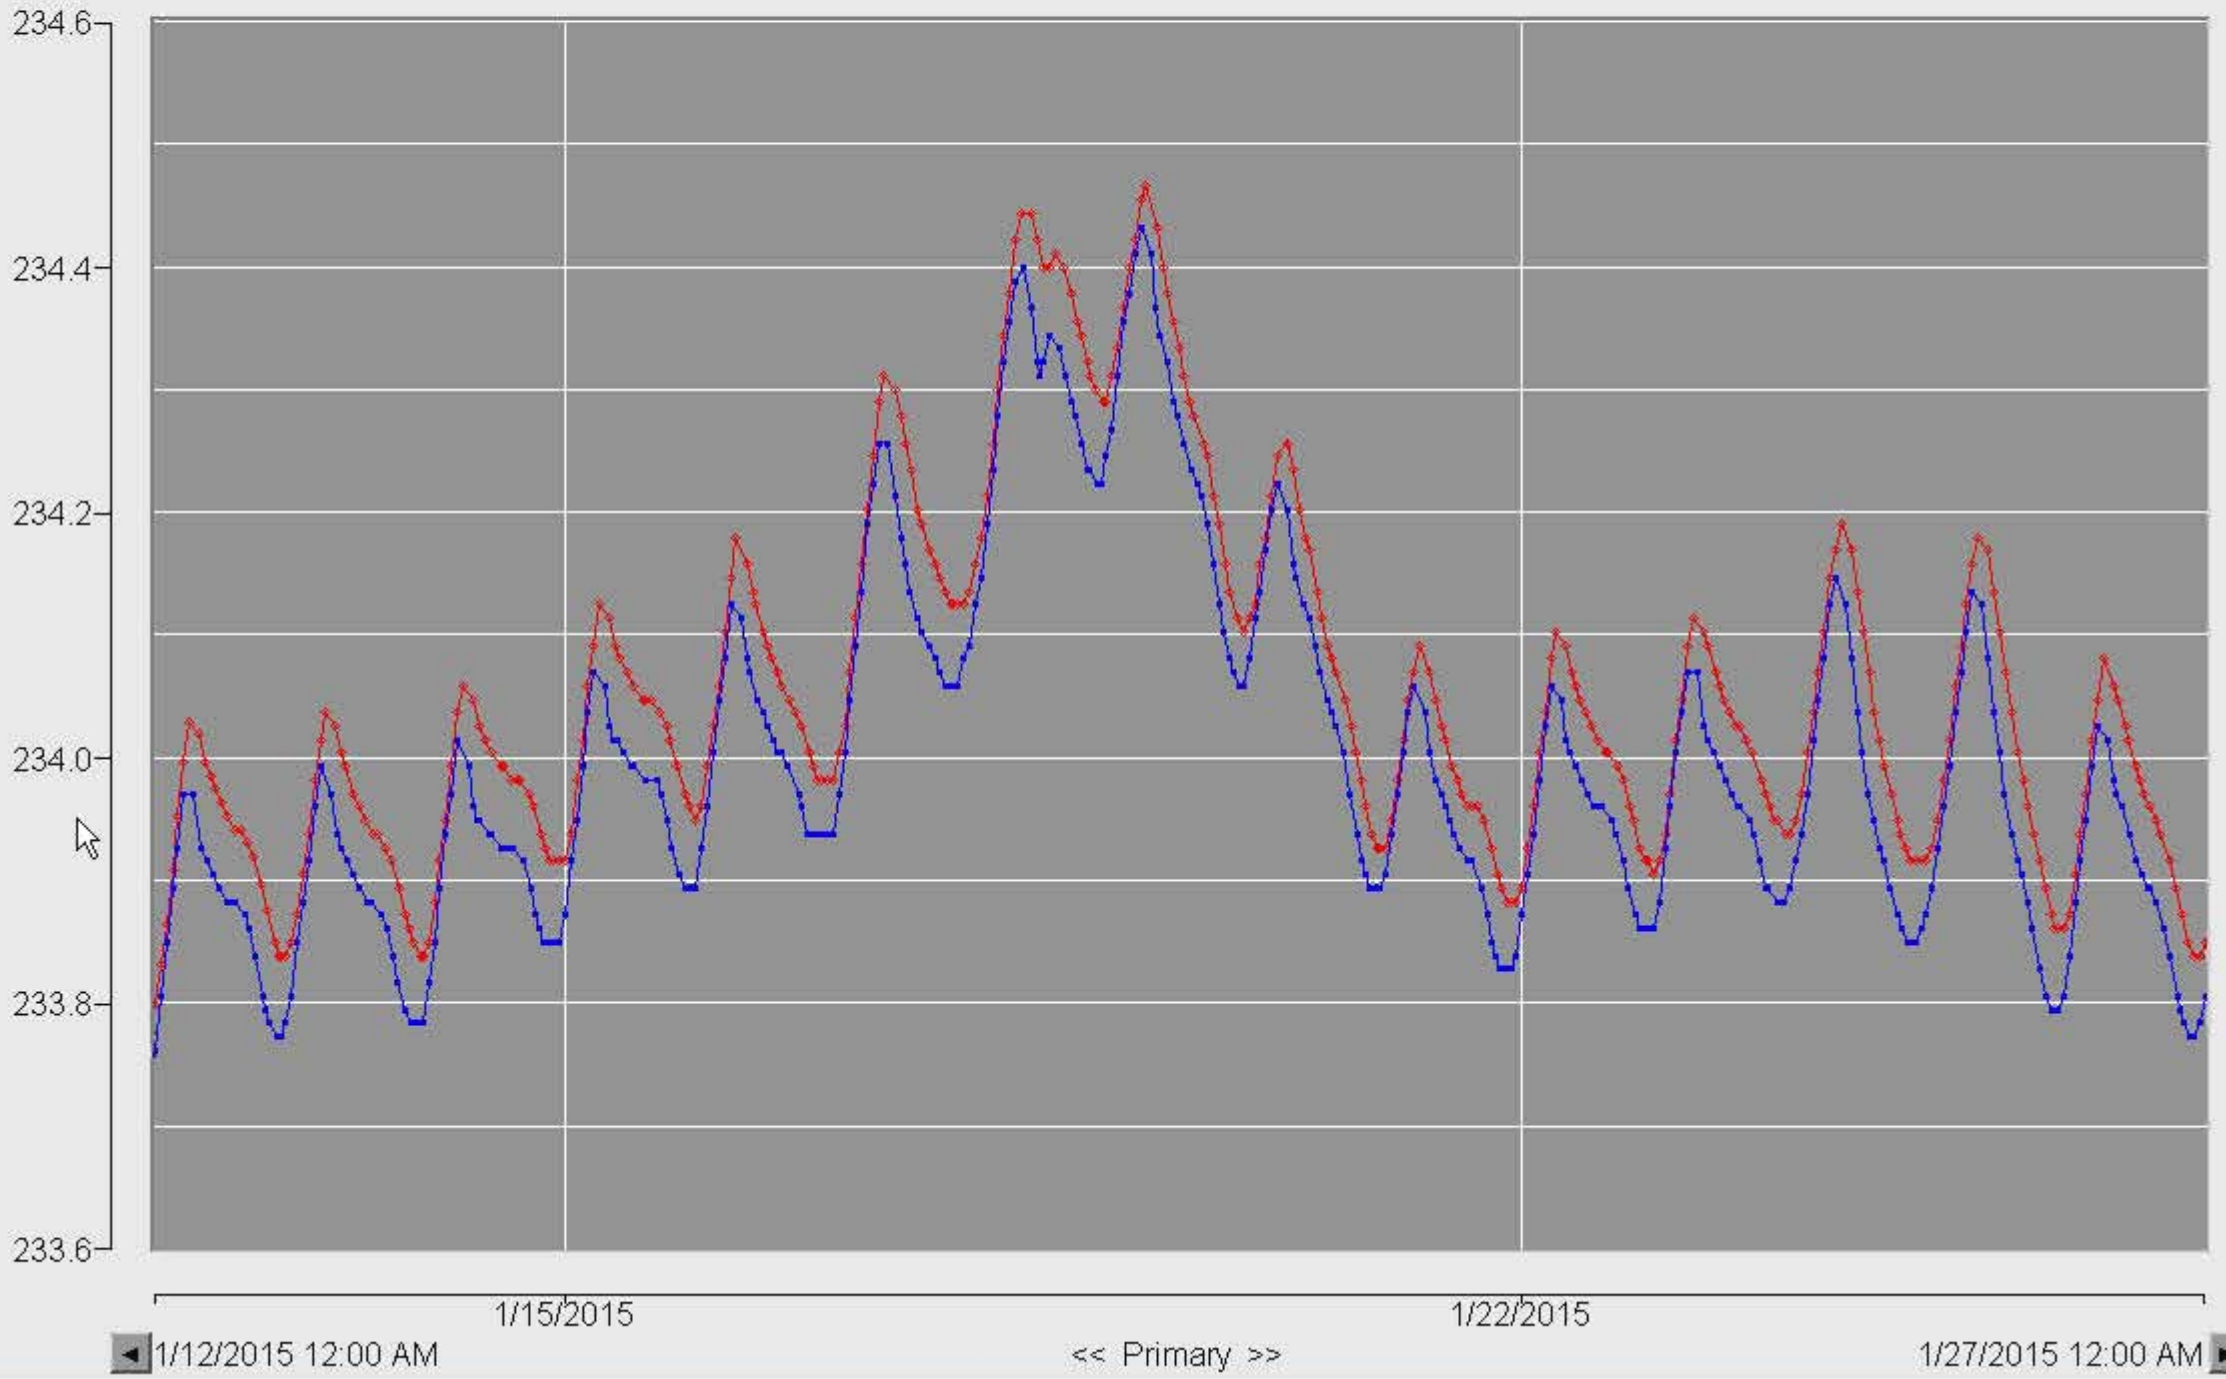

AECOM

E12d McPhillips Hourly Min Res Levels Jan 12 – 27, 2015

Global Trendset

Global Trendset

Trend Name: McPhillips_Leve ▶ Search

Owner: DougSulymka

Global trend: (•) Yes ( ) No

☐ Individual Y Axes ☑ Markers On

☐ Show Data Quality

Default Timescales



Add Pen | Delete Pen | Edit

New | Dismiss | Abandon | Add | Modify | Before

McPhillips Levels

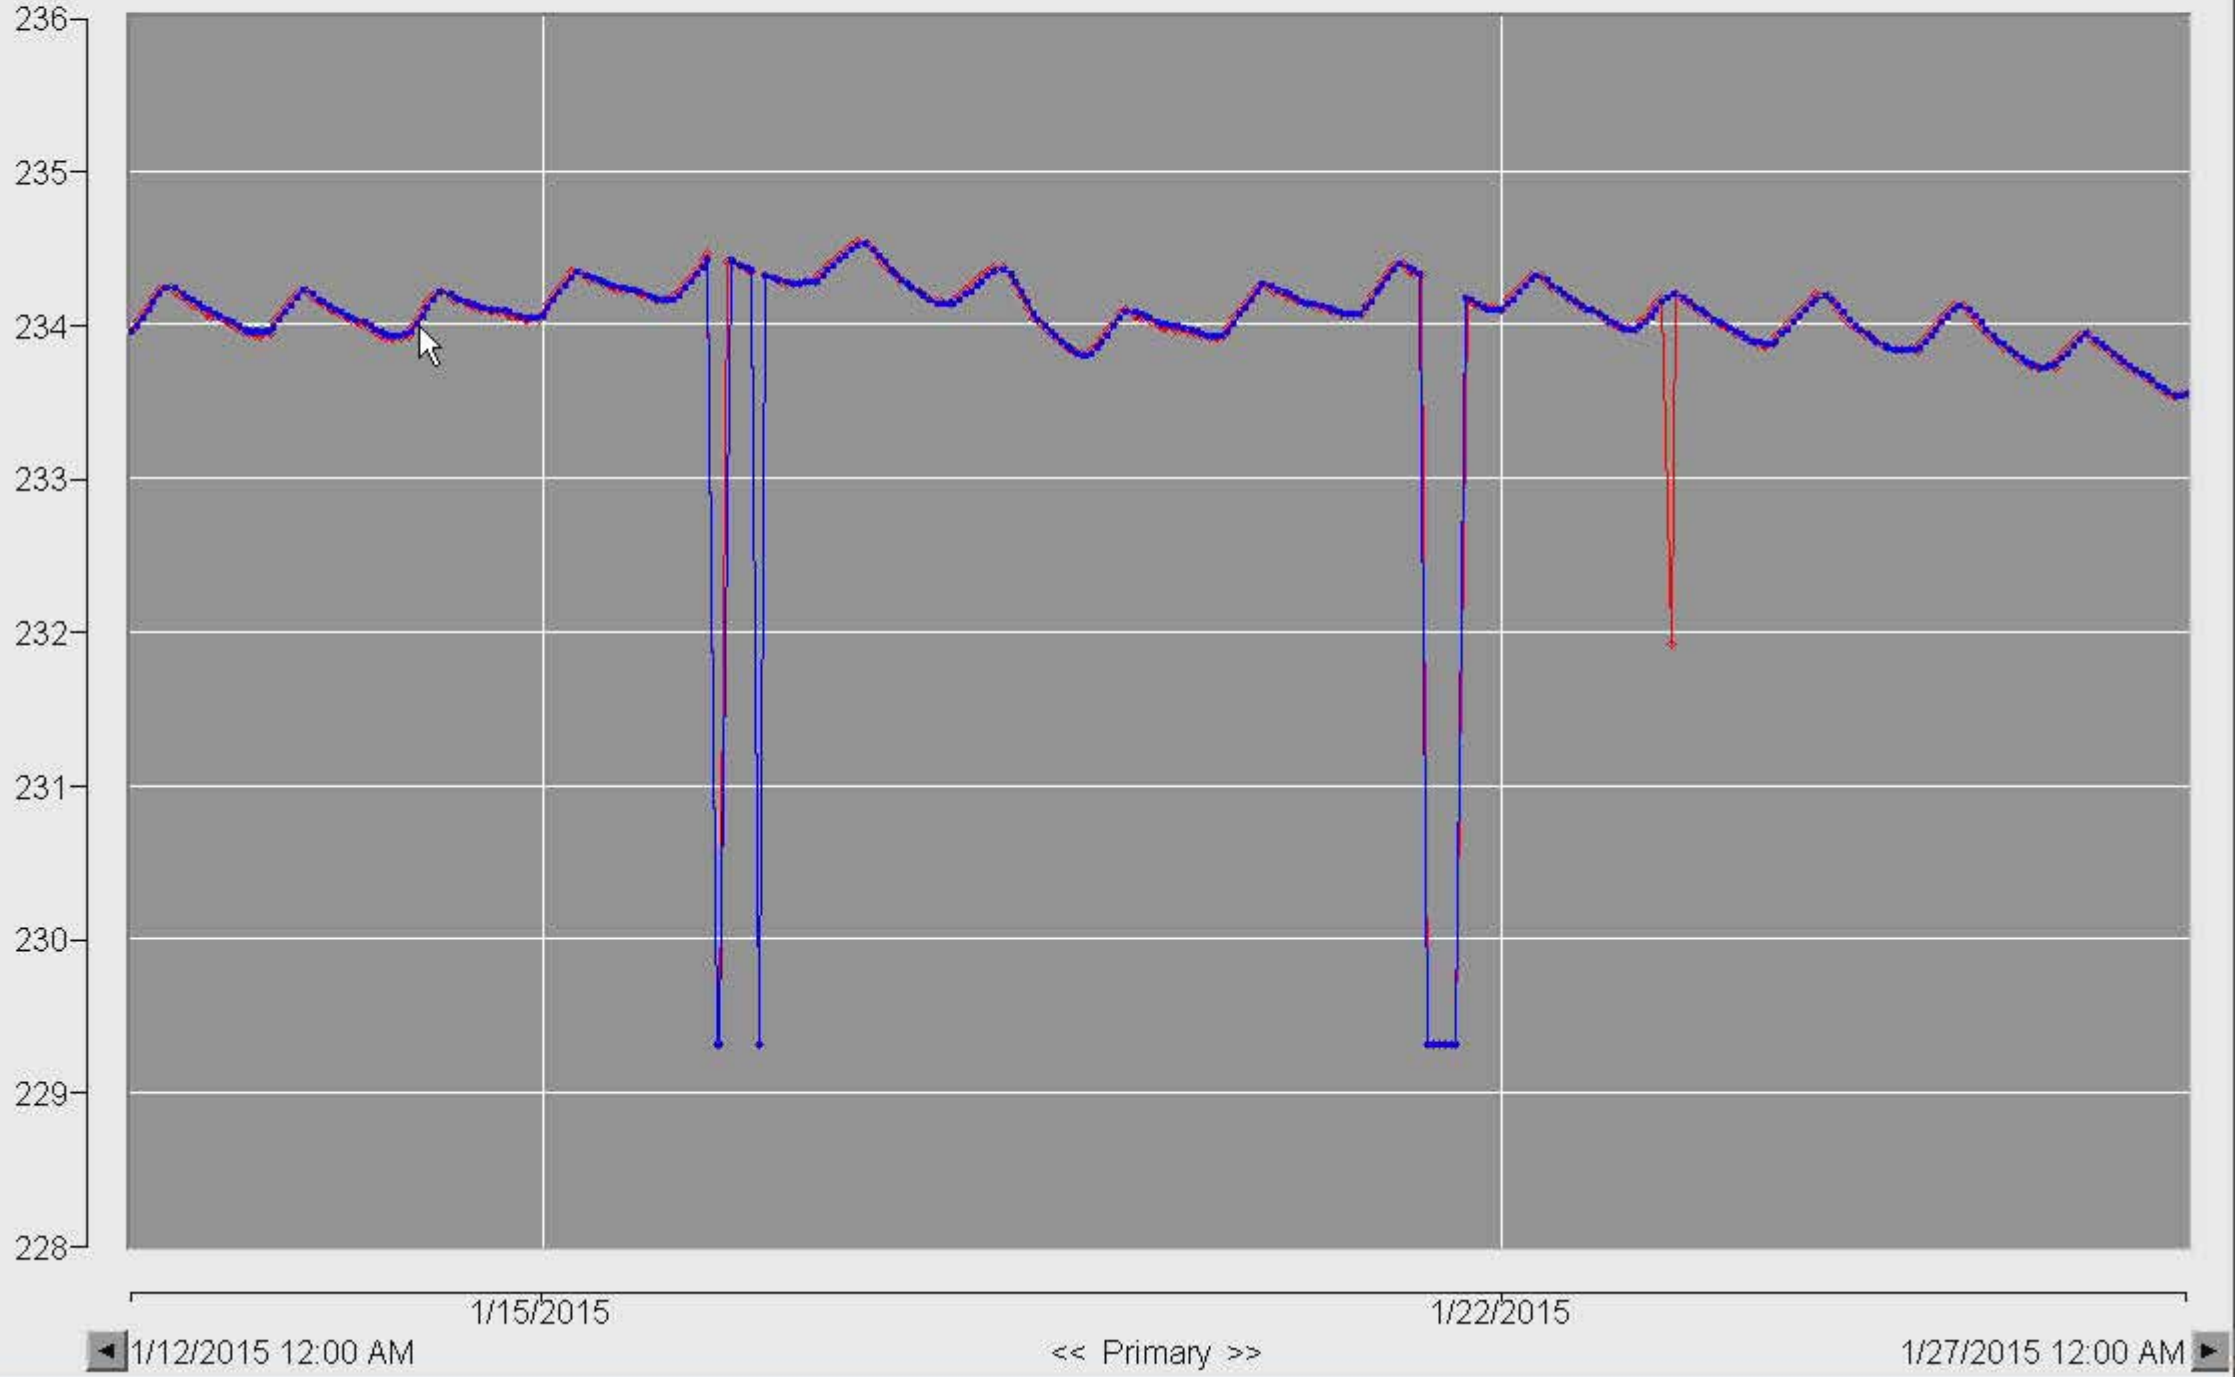

AECOM

E12e Hurst Minimum Reservoir Levels Jan 12-26, 2015

Hurst Minimum Reservoir Levels Jan 12-26, 2015

Timestamp	West Reservoir	Timestamp	East Reservoir	Timestamp	South Reservoir
1/12/2015 0:00	234.0161832	1/12/2015 0:00	234.0345038	1/12/2015 0:00	234.0696153
1/12/2015 1:00	234.0491603	1/12/2015 1:00	234.0564885	1/12/2015 1:00	234.0916
1/12/2015 2:00	234.071145	1/12/2015 2:00	234.0894656	1/12/2015 2:00	234.1245771
1/12/2015 3:00	234.1041221	1/12/2015 3:00	234.1224427	1/12/2015 3:00	234.1575542
1/12/2015 4:00	234.1480916	1/12/2015 4:00	234.1554198	1/12/2015 4:00	234.1905313
1/12/2015 5:00	234.1700763	1/12/2015 5:00	234.1774046	1/12/2015 5:00	234.2235084
1/12/2015 6:00	234.1810687	1/12/2015 6:56	234.1664122	1/12/2015 6:00	234.2345008
1/12/2015 7:41	234.159084	1/12/2015 7:38	234.1444275	1/12/2015 7:44	234.212516
1/12/2015 8:59	234.1370992	1/12/2015 8:23	234.1334351	1/12/2015 8:58	234.1905313
1/12/2015 9:55	234.1261069	1/12/2015 9:29	234.1224427	1/12/2015 9:51	234.1795389
1/12/2015 10:49	234.1151145	1/12/2015 10:26	234.1114504	1/12/2015 10:45	234.1685466
1/12/2015 11:44	234.1041221	1/12/2015 11:23	234.100458	1/12/2015 11:45	234.1575542
1/12/2015 12:55	234.0931298	1/12/2015 12:33	234.0894656	1/12/2015 12:50	234.1465618
1/12/2015 13:00	234.0931298	1/12/2015 13:00	234.0894656	1/12/2015 13:00	234.1465618
1/12/2015 14:40	234.0821374	1/12/2015 14:13	234.0784733	1/12/2015 14:21	234.1355695
1/12/2015 15:00	234.0821374	1/12/2015 15:00	234.0784733	1/12/2015 15:00	234.1355695
1/12/2015 16:23	234.071145	1/12/2015 16:58	234.0564885	1/12/2015 16:07	234.1245771
1/12/2015 17:59	234.0491603	1/12/2015 17:40	234.0454962	1/12/2015 17:47	234.1025924
1/12/2015 18:37	234.0381679	1/12/2015 18:48	234.0235115	1/12/2015 18:30	234.0916
1/12/2015 19:51	234.0161832	1/12/2015 19:32	234.0125191	1/12/2015 19:42	234.0696153
1/12/2015 20:35	234.0051908	1/12/2015 20:22	234.0015267	1/12/2015 20:26	234.0586229
1/12/2015 21:28	233.9941985	1/12/2015 21:16	233.9905344	1/12/2015 21:17	234.0476305
1/12/2015 22:00	233.9941985	1/12/2015 22:00	233.9905344	1/12/2015 22:21	234.0366382
1/12/2015 23:00	233.9941985	1/12/2015 23:00	233.9905344	1/12/2015 23:00	234.0366382
1/13/2015 0:00	233.9941985	1/13/2015 0:00	234.0015267	1/13/2015 0:00	234.0366382
1/13/2015 1:00	234.0161832	1/13/2015 1:00	234.0235115	1/13/2015 1:00	234.0586229
1/13/2015 2:00	234.0271756	1/13/2015 2:00	234.0345038	1/13/2015 2:00	234.0806076
1/13/2015 3:00	234.0601527	1/13/2015 3:00	234.0674809	1/13/2015 3:00	234.1025924
1/13/2015 4:00	234.0821374	1/13/2015 4:00	234.0894656	1/13/2015 4:00	234.1355695
1/13/2015 5:00	234.1041221	1/13/2015 5:00	234.1114504	1/13/2015 5:00	234.1575542
1/13/2015 6:45	234.1041221	1/13/2015 6:53	234.0894656	1/13/2015 6:00	234.1575542
1/13/2015 7:56	234.071145	1/13/2015 7:34	234.0674809	1/13/2015 7:40	234.1355695
1/13/2015 8:24	234.0601527	1/13/2015 8:58	234.0454962	1/13/2015 8:34	234.1135847
1/13/2015 9:52	234.0381679	1/13/2015 9:45	234.0345038	1/13/2015 9:15	234.1025924
1/13/2015 10:37	234.0271756	1/13/2015 10:37	234.0235115	1/13/2015 10:48	234.0806076
1/13/2015 11:27	234.0161832	1/13/2015 11:30	234.0125191	1/13/2015 11:38	234.0696153
1/13/2015 12:25	234.0051908	1/13/2015 12:30	234.0015267	1/13/2015 12:32	234.0586229
1/13/2015 13:21	233.9941985	1/13/2015 13:52	233.9905344	1/13/2015 13:39	234.0476305
1/13/2015 14:50	233.9832061	1/13/2015 14:00	233.9905344	1/13/2015 14:00	234.0476305
1/13/2015 15:00	233.9832061	1/13/2015 15:39	233.979542	1/13/2015 15:09	234.0366382
1/13/2015 16:22	233.9722137	1/13/2015 16:46	233.9685496	1/13/2015 16:43	234.0256458
1/13/2015 17:31	233.9612214	1/13/2015 17:37	233.9575573	1/13/2015 17:50	234.0146534
1/13/2015 18:20	233.950229	1/13/2015 18:19	233.9465649	1/13/2015 18:36	234.0036611
1/13/2015 19:53	233.9282443	1/13/2015 19:04	233.9355725	1/13/2015 19:19	233.9926687
1/13/2015 20:57	233.9172519	1/13/2015 20:09	233.9245802	1/13/2015 20:17	233.9816763
1/13/2015 21:00	233.9172519	1/13/2015 21:00	233.9245802	1/13/2015 21:36	233.970684
1/13/2015 22:00	233.9172519	1/13/2015 22:04	233.9135878	1/13/2015 22:00	233.970684
1/13/2015 23:00	233.9172519	1/13/2015 23:00	233.9135878	1/13/2015 23:00	233.970684
1/14/2015 0:00	233.9172519	1/14/2015 0:00	233.9355725	1/14/2015 0:00	233.970684
1/14/2015 1:00	233.950229	1/14/2015 1:00	233.9575573	1/14/2015 1:00	234.0036611
1/14/2015 2:00	233.9612214	1/14/2015 2:00	233.979542	1/14/2015 2:00	234.0256458
1/14/2015 3:00	233.9941985	1/14/2015 3:00	234.0125191	1/14/2015 3:00	234.0476305

Hurst Minimum Reservoir Levels Jan 12-26, 2015

Timestamp	West Reservoir	Timestamp	East Reservoir	Timestamp	South Reservoir
1/14/2015 4:00	234.0271756	1/14/2015 4:00	234.0454962	1/14/2015 4:00	234.0806076
1/14/2015 5:00	234.0601527	1/14/2015 5:00	234.0674809	1/14/2015 5:00	234.1135847
1/14/2015 6:00	234.0601527	1/14/2015 6:57	234.0454962	1/14/2015 6:00	234.1245771
1/14/2015 7:52	234.0271756	1/14/2015 7:36	234.0235115	1/14/2015 7:50	234.0916
1/14/2015 8:59	234.0051908	1/14/2015 8:08	234.0125191	1/14/2015 8:47	234.0696153
1/14/2015 9:42	233.9941985	1/14/2015 9:51	233.9905344	1/14/2015 9:31	234.0586229
1/14/2015 10:36	233.9832061	1/14/2015 10:40	233.979542	1/14/2015 10:25	234.0476305
1/14/2015 11:28	233.9722137	1/14/2015 11:39	233.9685496	1/14/2015 11:21	234.0366382
1/14/2015 12:30	233.9612214	1/14/2015 12:52	233.9575573	1/14/2015 12:22	234.0256458
1/14/2015 13:39	233.950229	1/14/2015 13:00	233.9575573	1/14/2015 13:32	234.0146534
1/14/2015 14:00	233.950229	1/14/2015 14:26	233.9465649	1/14/2015 14:00	234.0146534
1/14/2015 15:28	233.9392366	1/14/2015 15:00	233.9465649	1/14/2015 15:22	234.0036611
1/14/2015 16:00	233.9392366	1/14/2015 16:29	233.9355725	1/14/2015 16:59	233.9926687
1/14/2015 17:53	233.9172519	1/14/2015 17:28	233.9245802	1/14/2015 17:59	233.9816763
1/14/2015 18:34	233.9062595	1/14/2015 18:45	233.9025954	1/14/2015 18:40	233.970684
1/14/2015 19:16	233.8952672	1/14/2015 19:35	233.8916031	1/14/2015 19:20	233.9596916
1/14/2015 20:50	233.8732824	1/14/2015 20:17	233.8806107	1/14/2015 20:54	233.9377069
1/14/2015 21:56	233.8622901	1/14/2015 21:33	233.8696183	1/14/2015 21:57	233.9267145
1/14/2015 22:00	233.8622901	1/14/2015 22:00	233.8696183	1/14/2015 22:00	233.9267145
1/14/2015 23:00	233.8622901	1/14/2015 23:00	233.8806107	1/14/2015 23:00	233.9267145
1/15/2015 0:00	233.8952672	1/15/2015 0:00	233.9135878	1/15/2015 0:00	233.9486992
1/15/2015 1:00	233.9062595	1/15/2015 1:00	233.9245802	1/15/2015 1:00	233.970684
1/15/2015 2:00	233.9282443	1/15/2015 2:00	233.9465649	1/15/2015 2:00	233.9926687
1/15/2015 3:00	233.950229	1/15/2015 3:00	233.979542	1/15/2015 3:00	234.0146534
1/15/2015 4:00	233.9941985	1/15/2015 4:00	234.0125191	1/15/2015 4:00	234.0476305
1/15/2015 5:00	234.0161832	1/15/2015 5:00	234.0345038	1/15/2015 5:00	234.0806076
1/15/2015 6:00	234.0381679	1/15/2015 6:46	234.0345038	1/15/2015 6:00	234.1025924
1/15/2015 7:36	234.0161832	1/15/2015 7:56	234.0015267	1/15/2015 7:45	234.0806076
1/15/2015 8:48	233.9941985	1/15/2015 8:00	234.0015267	1/15/2015 8:57	234.0586229
1/15/2015 9:49	233.9832061	1/15/2015 9:08	233.9905344	1/15/2015 9:51	234.0476305
1/15/2015 10:48	233.9722137	1/15/2015 10:07	233.979542	1/15/2015 10:50	234.0366382
1/15/2015 11:00	233.9722137	1/15/2015 11:48	233.9648855	1/15/2015 11:58	234.0256458
1/15/2015 12:01	233.9612214	1/15/2015 12:00	233.9648855	1/15/2015 12:00	234.0256458
1/15/2015 13:18	233.950229	1/15/2015 13:06	233.9538931	1/15/2015 13:17	234.0146534
1/15/2015 14:00	233.950229	1/15/2015 14:00	233.9538931	1/15/2015 14:00	234.0146534
1/15/2015 15:00	233.950229	1/15/2015 15:58	233.9429008	1/15/2015 15:48	234.0036611
1/15/2015 16:02	233.9392366	1/15/2015 16:00	233.9429008	1/15/2015 16:00	234.0036611
1/15/2015 17:20	233.9282443	1/15/2015 17:47	233.920916	1/15/2015 17:16	233.9926687
1/15/2015 18:59	233.9062595	1/15/2015 18:25	233.9099237	1/15/2015 18:50	233.970684
1/15/2015 19:41	233.8952672	1/15/2015 19:57	233.8879389	1/15/2015 19:33	233.9596916
1/15/2015 20:26	233.8842748	1/15/2015 20:00	233.8879389	1/15/2015 20:21	233.9486992
1/15/2015 21:35	233.8732824	1/15/2015 21:15	233.8769466	1/15/2015 21:23	233.9377069
1/15/2015 22:00	233.8732824	1/15/2015 22:00	233.8769466	1/15/2015 22:00	233.9377069
1/15/2015 23:00	233.8732824	1/15/2015 23:00	233.8769466	1/15/2015 23:00	233.9377069
1/16/2015 0:00	233.8842748	1/16/2015 0:00	233.8989313	1/16/2015 0:00	233.9377069
1/16/2015 1:00	233.8952672	1/16/2015 1:00	233.9099237	1/16/2015 1:00	233.9596916
1/16/2015 2:00	233.9282443	1/16/2015 2:00	233.9429008	1/16/2015 2:00	233.9816763
1/16/2015 3:00	233.9612214	1/16/2015 3:00	233.9758779	1/16/2015 3:00	234.0146534
1/16/2015 4:00	233.9941985	1/16/2015 4:00	234.008855	1/16/2015 4:00	234.0476305
1/16/2015 5:00	234.0271756	1/16/2015 5:00	234.0418321	1/16/2015 5:00	234.0806076
1/16/2015 6:00	234.0491603	1/16/2015 6:50	234.0418321	1/16/2015 6:00	234.1025924
1/16/2015 7:58	234.0271756	1/16/2015 7:42	234.0198473	1/16/2015 7:32	234.1025924

Hurst Minimum Reservoir Levels Jan 12-26, 2015

Timestamp	West Reservoir	Timestamp	East Reservoir	Timestamp	South Reservoir
1/16/2015 8:52	234.0161832	1/16/2015 8:00	234.0198473	1/16/2015 8:06	234.0916
1/16/2015 9:00	234.0161832	1/16/2015 9:12	234.008855	1/16/2015 9:01	234.0806076
1/16/2015 10:24	234.0051908	1/16/2015 10:49	233.9978626	1/16/2015 10:33	234.0696153
1/16/2015 11:59	233.9941985	1/16/2015 11:00	233.9978626	1/16/2015 11:00	234.0696153
1/16/2015 12:00	233.9941985	1/16/2015 12:00	233.9978626	1/16/2015 12:19	234.0586229
1/16/2015 13:00	233.9941985	1/16/2015 13:09	233.9868702	1/16/2015 13:00	234.0586229
1/16/2015 14:47	233.9832061	1/16/2015 14:00	233.9868702	1/16/2015 14:00	234.0586229
1/16/2015 15:00	233.9832061	1/16/2015 15:00	233.9868702	1/16/2015 15:00	234.0586229
1/16/2015 16:00	233.9832061	1/16/2015 16:00	233.9868702	1/16/2015 16:00	234.0586229
1/16/2015 17:00	233.9832061	1/16/2015 17:46	233.9758779	1/16/2015 17:25	234.0476305
1/16/2015 18:09	233.9722137	1/16/2015 18:00	233.9758779	1/16/2015 18:00	234.0476305
1/16/2015 19:00	233.9722137	1/16/2015 19:00	233.9758779	1/16/2015 19:10	234.0366382
1/16/2015 20:00	233.9722137	1/16/2015 20:00	233.9758779	1/16/2015 20:00	234.0366382
1/16/2015 21:00	233.9722137	1/16/2015 21:00	233.9758779	1/16/2015 21:00	234.0366382
1/16/2015 22:00	233.9722137	1/16/2015 22:00	233.9758779	1/16/2015 22:00	234.0366382
1/16/2015 23:00	233.9832061	1/16/2015 23:00	233.9868702	1/16/2015 23:00	234.0476305
1/17/2015 0:00	233.9941985	1/17/2015 0:00	234.008855	1/17/2015 0:00	234.0696153
1/17/2015 1:00	234.0161832	1/17/2015 1:00	234.0308397	1/17/2015 1:00	234.0806076
1/17/2015 2:00	234.0381679	1/17/2015 2:00	234.0638168	1/17/2015 2:00	234.1135847
1/17/2015 3:00	234.0821374	1/17/2015 3:00	234.0967939	1/17/2015 3:00	234.1465618
1/17/2015 4:00	234.1261069	1/17/2015 4:00	234.1407634	1/17/2015 4:00	234.1905313
1/17/2015 5:00	234.159084	1/17/2015 5:00	234.1847328	1/17/2015 5:00	234.2345008
1/17/2015 6:00	234.2030534	1/17/2015 6:00	234.2177099	1/17/2015 6:00	234.2674779
1/17/2015 7:00	234.2250382	1/17/2015 7:00	234.2396947	1/17/2015 7:00	234.300455
1/17/2015 8:00	234.2360305	1/17/2015 8:00	234.2396947	1/17/2015 8:00	234.300455
1/17/2015 9:32	234.2250382	1/17/2015 9:44	234.2177099	1/17/2015 9:55	234.2894626
1/17/2015 10:45	234.2030534	1/17/2015 10:48	234.1957252	1/17/2015 10:31	234.2784702
1/17/2015 11:54	234.1810687	1/17/2015 11:58	234.1737405	1/17/2015 11:40	234.2564855
1/17/2015 12:29	234.1700763	1/17/2015 12:45	234.1627481	1/17/2015 12:50	234.2345008
1/17/2015 13:51	234.1480916	1/17/2015 13:27	234.1517557	1/17/2015 13:31	234.2235084
1/17/2015 14:52	234.1370992	1/17/2015 14:37	234.1407634	1/17/2015 14:19	234.212516
1/17/2015 15:00	234.1370992	1/17/2015 15:00	234.1407634	1/17/2015 15:26	234.2015237
1/17/2015 16:10	234.1261069	1/17/2015 16:05	234.129771	1/17/2015 16:48	234.1905313
1/17/2015 17:32	234.1151145	1/17/2015 17:15	234.1187786	1/17/2015 17:00	234.1905313
1/17/2015 18:00	234.1151145	1/17/2015 18:44	234.1077863	1/17/2015 18:01	234.1795389
1/17/2015 19:09	234.1041221	1/17/2015 19:00	234.1077863	1/17/2015 19:00	234.1795389
1/17/2015 20:00	234.1041221	1/17/2015 20:00	234.1077863	1/17/2015 20:00	234.1795389
1/17/2015 21:00	234.1041221	1/17/2015 21:00	234.1077863	1/17/2015 21:00	234.1795389
1/17/2015 22:00	234.1041221	1/17/2015 22:00	234.1187786	1/17/2015 22:00	234.1795389
1/17/2015 23:00	234.1151145	1/17/2015 23:00	234.129771	1/17/2015 23:00	234.1795389
1/18/2015 0:00	234.1370992	1/18/2015 0:00	234.1407634	1/18/2015 0:00	234.2015237
1/18/2015 1:00	234.1480916	1/18/2015 1:00	234.1517557	1/18/2015 1:00	234.212516
1/18/2015 2:00	234.1700763	1/18/2015 2:00	234.1847328	1/18/2015 2:00	234.2345008
1/18/2015 3:00	234.2030534	1/18/2015 3:00	234.2177099	1/18/2015 3:00	234.2674779
1/18/2015 4:00	234.2470229	1/18/2015 4:00	234.2616794	1/18/2015 4:00	234.300455
1/18/2015 5:00	234.28	1/18/2015 5:00	234.3056489	1/18/2015 5:00	234.3444244
1/18/2015 6:00	234.3239695	1/18/2015 6:00	234.338626	1/18/2015 6:00	234.3883939
1/18/2015 7:00	234.3459542	1/18/2015 7:00	234.3496183	1/18/2015 7:00	234.4103786
1/18/2015 8:00	234.3569466	1/18/2015 8:00	234.3606107	1/18/2015 8:00	234.421371
1/18/2015 9:50	234.3459542	1/18/2015 9:44	234.338626	1/18/2015 9:00	234.421371
1/18/2015 10:31	234.3349618	1/18/2015 10:53	234.3166412	1/18/2015 10:43	234.3993863
1/18/2015 11:38	234.3129771	1/18/2015 11:51	234.2946565	1/18/2015 11:48	234.3774015

Hurst Minimum Reservoir Levels Jan 12-26, 2015

Timestamp	West Reservoir	Timestamp	East Reservoir	Timestamp	South Reservoir
1/18/2015 12:40	234.2909924	1/18/2015 12:54	234.2726718	1/18/2015 12:48	234.3554168
1/18/2015 13:46	234.2690076	1/18/2015 13:30	234.2616794	1/18/2015 13:54	234.3334321
1/18/2015 14:35	234.2580153	1/18/2015 14:23	234.250687	1/18/2015 14:36	234.3224397
1/18/2015 15:37	234.2470229	1/18/2015 15:37	234.2396947	1/18/2015 15:36	234.3114473
1/18/2015 16:48	234.2360305	1/18/2015 16:47	234.2287023	1/18/2015 16:43	234.300455
1/18/2015 17:58	234.2250382	1/18/2015 17:47	234.2177099	1/18/2015 17:52	234.2894626
1/18/2015 18:55	234.2140458	1/18/2015 18:46	234.2067176	1/18/2015 18:51	234.2784702
1/18/2015 19:00	234.2140458	1/18/2015 19:57	234.1957252	1/18/2015 19:54	234.2674779
1/18/2015 20:03	234.2030534	1/18/2015 20:00	234.1957252	1/18/2015 20:00	234.2674779
1/18/2015 21:00	234.2030534	1/18/2015 21:00	234.1957252	1/18/2015 21:00	234.2674779
1/18/2015 22:00	234.2030534	1/18/2015 22:00	234.1957252	1/18/2015 22:00	234.2674779
1/18/2015 23:00	234.2030534	1/18/2015 23:00	234.2067176	1/18/2015 23:00	234.2674779
1/19/2015 0:00	234.2140458	1/19/2015 0:00	234.2177099	1/19/2015 0:00	234.2784702
1/19/2015 1:00	234.2360305	1/19/2015 1:00	234.250687	1/19/2015 1:00	234.2894626
1/19/2015 2:00	234.2690076	1/19/2015 2:00	234.2836641	1/19/2015 2:00	234.3224397
1/19/2015 3:00	234.3019847	1/19/2015 3:00	234.3166412	1/19/2015 3:00	234.3554168
1/19/2015 4:00	234.3459542	1/19/2015 4:00	234.3606107	1/19/2015 4:00	234.3993863
1/19/2015 5:00	234.3789313	1/19/2015 5:00	234.3825954	1/19/2015 5:00	234.4323634
1/19/2015 6:00	234.3789313	1/19/2015 6:49	234.3716031	1/19/2015 6:00	234.4433557
1/19/2015 7:41	234.3569466	1/19/2015 7:52	234.338626	1/19/2015 7:38	234.421371
1/19/2015 8:36	234.3349618	1/19/2015 8:33	234.3276336	1/19/2015 8:29	234.3993863
1/19/2015 9:56	234.3129771	1/19/2015 9:18	234.3166412	1/19/2015 9:45	234.3774015
1/19/2015 10:35	234.3019847	1/19/2015 10:43	234.2946565	1/19/2015 10:28	234.3664092
1/19/2015 11:21	234.2909924	1/19/2015 11:24	234.2836641	1/19/2015 11:52	234.3444244
1/19/2015 12:55	234.2690076	1/19/2015 12:15	234.2726718	1/19/2015 12:40	234.3334321
1/19/2015 13:59	234.2580153	1/19/2015 13:09	234.2616794	1/19/2015 13:31	234.3224397
1/19/2015 14:00	234.2580153	1/19/2015 14:41	234.250687	1/19/2015 14:45	234.3114473
1/19/2015 15:25	234.2470229	1/19/2015 15:00	234.250687	1/19/2015 15:00	234.3114473
1/19/2015 16:42	234.2360305	1/19/2015 16:05	234.2396947	1/19/2015 16:15	234.300455
1/19/2015 17:36	234.2250382	1/19/2015 17:40	234.2177099	1/19/2015 17:17	234.2894626
1/19/2015 18:48	234.2030534	1/19/2015 18:48	234.1957252	1/19/2015 18:40	234.2674779
1/19/2015 19:20	234.1920611	1/19/2015 19:33	234.1847328	1/19/2015 19:55	234.2454931
1/19/2015 20:08	234.1810687	1/19/2015 20:25	234.1737405	1/19/2015 20:44	234.2345008
1/19/2015 21:04	234.1700763	1/19/2015 21:35	234.1627481	1/19/2015 21:46	234.2235084
1/19/2015 22:16	234.159084	1/19/2015 22:00	234.1627481	1/19/2015 22:00	234.2235084
1/19/2015 23:00	234.159084	1/19/2015 23:00	234.1627481	1/19/2015 23:00	234.2235084
1/20/2015 0:00	234.1700763	1/20/2015 0:00	234.1847328	1/20/2015 0:00	234.2235084
1/20/2015 1:00	234.1810687	1/20/2015 1:00	234.1957252	1/20/2015 1:00	234.2345008
1/20/2015 2:00	234.2140458	1/20/2015 2:00	234.2177099	1/20/2015 2:00	234.2674779
1/20/2015 3:00	234.2360305	1/20/2015 3:00	234.250687	1/20/2015 3:00	234.2894626
1/20/2015 4:00	234.2690076	1/20/2015 4:00	234.2946565	1/20/2015 4:00	234.3334321
1/20/2015 5:00	234.3019847	1/20/2015 5:00	234.3166412	1/20/2015 5:00	234.3554168
1/20/2015 6:00	234.3129771	1/20/2015 6:45	234.3056489	1/20/2015 6:00	234.3774015
1/20/2015 7:36	234.2909924	1/20/2015 7:47	234.2726718	1/20/2015 7:57	234.3444244
1/20/2015 8:39	234.2690076	1/20/2015 8:42	234.2616794	1/20/2015 8:25	234.3334321
1/20/2015 9:31	234.2580153	1/20/2015 9:42	234.250687	1/20/2015 9:09	234.3224397
1/20/2015 10:23	234.2470229	1/20/2015 10:45	234.2396947	1/20/2015 10:57	234.300455
1/20/2015 11:43	234.2250382	1/20/2015 11:54	234.2177099	1/20/2015 11:48	234.2784702
1/20/2015 12:41	234.2030534	1/20/2015 12:52	234.1957252	1/20/2015 12:43	234.2564855
1/20/2015 13:42	234.1810687	1/20/2015 13:25	234.1847328	1/20/2015 13:45	234.2345008
1/20/2015 14:54	234.159084	1/20/2015 14:41	234.1627481	1/20/2015 14:57	234.212516
1/20/2015 15:00	234.159084	1/20/2015 15:30	234.1517557	1/20/2015 15:00	234.212516

Hurst Minimum Reservoir Levels Jan 12-26, 2015

Timestamp	West Reservoir	Timestamp	East Reservoir	Timestamp	South Reservoir
1/20/2015 16:10	234.1480916	1/20/2015 16:32	234.1407634	1/20/2015 16:42	234.2015237
1/20/2015 17:56	234.1261069	1/20/2015 17:24	234.129771	1/20/2015 17:40	234.1905313
1/20/2015 18:38	234.1151145	1/20/2015 18:45	234.1077863	1/20/2015 18:24	234.1795389
1/20/2015 19:23	234.1041221	1/20/2015 19:24	234.0967939	1/20/2015 19:47	234.1575542
1/20/2015 20:10	234.0931298	1/20/2015 20:19	234.0858015	1/20/2015 20:35	234.1465618
1/20/2015 21:06	234.0821374	1/20/2015 21:27	234.0748092	1/20/2015 21:37	234.1355695
1/20/2015 22:23	234.071145	1/20/2015 22:00	234.0748092	1/20/2015 22:00	234.1355695
1/20/2015 23:00	234.071145	1/20/2015 23:00	234.0748092	1/20/2015 23:00	234.1355695
1/21/2015 0:00	234.071145	1/21/2015 0:00	234.0748092	1/21/2015 0:00	234.1355695
1/21/2015 1:00	234.0821374	1/21/2015 1:00	234.0967939	1/21/2015 1:00	234.1355695
1/21/2015 2:00	234.1151145	1/21/2015 2:00	234.1187786	1/21/2015 2:00	234.1575542
1/21/2015 3:00	234.1370992	1/21/2015 3:00	234.1517557	1/21/2015 3:00	234.1905313
1/21/2015 4:00	234.1700763	1/21/2015 4:00	234.1847328	1/21/2015 4:00	234.2235084
1/21/2015 5:00	234.1920611	1/21/2015 5:00	234.2067176	1/21/2015 5:00	234.2454931
1/21/2015 6:00	234.2030534	1/21/2015 6:58	234.1847328	1/21/2015 6:00	234.2564855
1/21/2015 7:39	234.1810687	1/21/2015 7:47	234.1627481	1/21/2015 7:59	234.2345008
1/21/2015 8:39	234.159084	1/21/2015 8:12	234.1517557	1/21/2015 8:25	234.2235084
1/21/2015 9:34	234.1480916	1/21/2015 9:25	234.1407634	1/21/2015 9:55	234.2015237
1/21/2015 10:26	234.1370992	1/21/2015 10:15	234.129771	1/21/2015 10:49	234.1905313
1/21/2015 11:26	234.1261069	1/21/2015 11:17	234.1187786	1/21/2015 11:49	234.1795389
1/21/2015 12:37	234.1151145	1/21/2015 12:32	234.1077863	1/21/2015 12:58	234.1685466
1/21/2015 13:00	234.1151145	1/21/2015 13:00	234.1077863	1/21/2015 13:00	234.1685466
1/21/2015 14:02	234.1041221	1/21/2015 14:11	234.0967939	1/21/2015 14:31	234.1575542
1/21/2015 15:32	234.0931298	1/21/2015 15:46	234.0858015	1/21/2015 15:48	234.1465618
1/21/2015 16:35	234.0821374	1/21/2015 16:36	234.0748092	1/21/2015 16:47	234.1355695
1/21/2015 17:55	234.0601527	1/21/2015 17:45	234.0528244	1/21/2015 17:32	234.1245771
1/21/2015 18:30	234.0491603	1/21/2015 18:55	234.0308397	1/21/2015 18:41	234.1025924
1/21/2015 19:45	234.0271756	1/21/2015 19:36	234.0198473	1/21/2015 19:54	234.0806076
1/21/2015 20:33	234.0161832	1/21/2015 20:14	234.008855	1/21/2015 20:55	234.0696153
1/21/2015 21:00	234.0161832	1/21/2015 21:00	234.008855	1/21/2015 21:00	234.0696153
1/21/2015 22:16	234.0051908	1/21/2015 22:00	234.008855	1/21/2015 22:00	234.0696153
1/21/2015 23:00	234.0051908	1/21/2015 23:00	234.008855	1/21/2015 23:00	234.0696153
1/22/2015 0:00	234.0161832	1/22/2015 0:00	234.0308397	1/22/2015 0:00	234.0696153
1/22/2015 1:00	234.0381679	1/22/2015 1:00	234.0418321	1/22/2015 1:00	234.0916
1/22/2015 2:00	234.0601527	1/22/2015 2:00	234.0748092	1/22/2015 2:00	234.1135847
1/22/2015 3:00	234.0931298	1/22/2015 3:00	234.1077863	1/22/2015 3:00	234.1465618
1/22/2015 4:00	234.1261069	1/22/2015 4:00	234.129771	1/22/2015 4:00	234.1795389
1/22/2015 5:00	234.1480916	1/22/2015 5:42	234.1407634	1/22/2015 5:00	234.2015237
1/22/2015 6:00	234.1480916	1/22/2015 6:49	234.129771	1/22/2015 6:00	234.2015237
1/22/2015 7:53	234.1151145	1/22/2015 7:29	234.1077863	1/22/2015 7:46	234.1795389
1/22/2015 8:24	234.1041221	1/22/2015 8:04	234.0967939	1/22/2015 8:51	234.1575542
1/22/2015 9:58	234.0821374	1/22/2015 9:53	234.0748092	1/22/2015 9:39	234.1465618
1/22/2015 10:43	234.071145	1/22/2015 10:50	234.0638168	1/22/2015 10:30	234.1355695
1/22/2015 11:46	234.0601527	1/22/2015 11:48	234.0528244	1/22/2015 11:27	234.1245771
1/22/2015 12:39	234.0491603	1/22/2015 12:00	234.0528244	1/22/2015 12:29	234.1135847
1/22/2015 13:00	234.0491603	1/22/2015 13:04	234.0418321	1/22/2015 13:47	234.1025924
1/22/2015 14:24	234.0381679	1/22/2015 14:00	234.0418321	1/22/2015 14:00	234.1025924
1/22/2015 15:00	234.0381679	1/22/2015 15:48	234.0308397	1/22/2015 15:52	234.0916
1/22/2015 16:20	234.0271756	1/22/2015 16:53	234.0198473	1/22/2015 16:00	234.0916
1/22/2015 17:23	234.0161832	1/22/2015 17:38	234.008855	1/22/2015 17:11	234.0806076
1/22/2015 18:47	233.9941985	1/22/2015 18:57	233.9868702	1/22/2015 18:42	234.0586229
1/22/2015 19:29	233.9832061	1/22/2015 19:55	233.9758779	1/22/2015 19:23	234.0476305

Hurst Minimum Reservoir Levels Jan 12-26, 2015

Timestamp	West Reservoir	Timestamp	East Reservoir	Timestamp	South Reservoir
1/22/2015 20:16	233.9722137	1/22/2015 20:55	233.9648855	1/22/2015 20:11	234.0366382
1/22/2015 21:12	233.9612214	1/22/2015 21:00	233.9648855	1/22/2015 21:08	234.0256458
1/22/2015 22:00	233.9612214	1/22/2015 22:00	233.9648855	1/22/2015 22:35	234.0146534
1/22/2015 23:00	233.9612214	1/22/2015 23:00	233.9648855	1/22/2015 23:00	234.0146534
1/23/2015 0:00	233.9612214	1/23/2015 0:00	233.9648855	1/23/2015 0:00	234.0146534
1/23/2015 1:00	233.9722137	1/23/2015 1:00	233.9868702	1/23/2015 1:00	234.0256458
1/23/2015 2:00	233.9941985	1/23/2015 2:00	234.008855	1/23/2015 2:00	234.0476305
1/23/2015 3:00	234.0271756	1/23/2015 3:00	234.0418321	1/23/2015 3:00	234.0806076
1/23/2015 4:00	234.0601527	1/23/2015 4:00	234.0858015	1/23/2015 4:00	234.1245771
1/23/2015 5:00	234.0931298	1/23/2015 5:00	234.1077863	1/23/2015 5:00	234.1465618
1/23/2015 6:00	234.1151145	1/23/2015 6:49	234.1077863	1/23/2015 6:00	234.1685466
1/23/2015 7:33	234.0931298	1/23/2015 7:33	234.0858015	1/23/2015 7:39	234.1575542
1/23/2015 8:32	234.071145	1/23/2015 8:05	234.0748092	1/23/2015 8:40	234.1355695
1/23/2015 9:26	234.0601527	1/23/2015 9:07	234.0638168	1/23/2015 9:30	234.1245771
1/23/2015 10:17	234.0491603	1/23/2015 10:51	234.0418321	1/23/2015 10:18	234.1135847
1/23/2015 11:05	234.0381679	1/23/2015 11:48	234.0308397	1/23/2015 11:09	234.1025924
1/23/2015 12:06	234.0271756	1/23/2015 12:55	234.0198473	1/23/2015 12:06	234.0916
1/23/2015 13:14	234.0161832	1/23/2015 13:00	234.0198473	1/23/2015 13:07	234.0806076
1/23/2015 14:54	234.0051908	1/23/2015 14:42	234.008855	1/23/2015 14:31	234.0696153
1/23/2015 15:00	234.0051908	1/23/2015 15:00	234.008855	1/23/2015 15:00	234.0696153
1/23/2015 16:40	233.9941985	1/23/2015 16:38	233.9978626	1/23/2015 16:45	234.0586229
1/23/2015 17:00	233.9941985	1/23/2015 17:44	233.9868702	1/23/2015 17:55	234.0476305
1/23/2015 18:00	233.9832061	1/23/2015 18:44	233.9758779	1/23/2015 18:54	234.0366382
1/23/2015 19:04	233.9722137	1/23/2015 19:00	233.9758779	1/23/2015 19:00	234.0366382
1/23/2015 20:34	233.9612214	1/23/2015 20:51	233.9648855	1/23/2015 20:16	234.0256458
1/23/2015 21:00	233.9612214	1/23/2015 21:00	233.9648855	1/23/2015 21:00	234.0256458
1/23/2015 22:00	233.9612214	1/23/2015 22:00	233.9648855	1/23/2015 22:00	234.0256458
1/23/2015 23:00	233.9612214	1/23/2015 23:00	233.9648855	1/23/2015 23:00	234.0256458
1/24/2015 0:00	233.9612214	1/24/2015 0:00	233.9758779	1/24/2015 0:00	234.0256458
1/24/2015 1:00	233.9612214	1/24/2015 1:00	233.9758779	1/24/2015 1:00	234.0256458
1/24/2015 2:00	233.9832061	1/24/2015 2:00	233.9978626	1/24/2015 2:00	234.0476305
1/24/2015 3:00	234.0051908	1/24/2015 3:00	234.0308397	1/24/2015 3:00	234.0696153
1/24/2015 4:00	234.0381679	1/24/2015 4:00	234.0638168	1/24/2015 4:00	234.1025924
1/24/2015 5:00	234.071145	1/24/2015 5:00	234.0967939	1/24/2015 5:00	234.1355695
1/24/2015 6:00	234.1041221	1/24/2015 6:00	234.1187786	1/24/2015 6:00	234.1685466
1/24/2015 7:00	234.1151145	1/24/2015 7:00	234.129771	1/24/2015 7:00	234.1795389
1/24/2015 8:00	234.1151145	1/24/2015 8:40	234.1187786	1/24/2015 8:00	234.1795389
1/24/2015 9:27	234.1041221	1/24/2015 9:37	234.0967939	1/24/2015 9:34	234.1685466
1/24/2015 10:58	234.071145	1/24/2015 10:38	234.0748092	1/24/2015 10:39	234.1465618
1/24/2015 11:51	234.0491603	1/24/2015 11:59	234.0418321	1/24/2015 11:34	234.1245771
1/24/2015 12:47	234.0271756	1/24/2015 12:59	234.0198473	1/24/2015 12:57	234.0916
1/24/2015 13:50	234.0051908	1/24/2015 13:31	234.008855	1/24/2015 13:59	234.0696153
1/24/2015 14:34	233.9941985	1/24/2015 14:13	233.9978626	1/24/2015 14:38	234.0586229
1/24/2015 15:22	233.9832061	1/24/2015 15:06	233.9868702	1/24/2015 15:26	234.0476305
1/24/2015 16:11	233.9722137	1/24/2015 16:52	233.9648855	1/24/2015 16:18	234.0366382
1/24/2015 17:55	233.950229	1/24/2015 17:39	233.9538931	1/24/2015 17:57	234.0146534
1/24/2015 18:59	233.9392366	1/24/2015 18:39	233.9429008	1/24/2015 18:51	234.0036611
1/24/2015 19:00	233.9392366	1/24/2015 19:00	233.9429008	1/24/2015 19:00	234.0036611
1/24/2015 20:53	233.9282443	1/24/2015 20:00	233.9429008	1/24/2015 20:18	233.9926687
1/24/2015 21:00	233.9282443	1/24/2015 21:00	233.9429008	1/24/2015 21:00	233.9926687
1/24/2015 22:00	233.9282443	1/24/2015 22:00	233.9429008	1/24/2015 22:00	233.9926687
1/24/2015 23:00	233.9282443	1/24/2015 23:00	233.9429008	1/24/2015 23:00	233.9926687

Hurst Minimum Reservoir Levels Jan 12-26, 2015

Timestamp	West Reservoir	Timestamp	East Reservoir	Timestamp	South Reservoir
1/25/2015 0:00	233.950229	1/25/2015 0:00	233.9648855	1/25/2015 0:00	234.0036611
1/25/2015 1:00	233.9722137	1/25/2015 1:00	233.9868702	1/25/2015 1:00	234.0256458
1/25/2015 2:00	233.9832061	1/25/2015 2:00	233.9978626	1/25/2015 2:00	234.0476305
1/25/2015 3:00	234.0161832	1/25/2015 3:00	234.0308397	1/25/2015 3:00	234.0696153
1/25/2015 4:00	234.0491603	1/25/2015 4:00	234.0638168	1/25/2015 4:00	234.1025924
1/25/2015 5:00	234.0821374	1/25/2015 5:00	234.0967939	1/25/2015 5:00	234.1355695
1/25/2015 6:00	234.1151145	1/25/2015 6:00	234.129771	1/25/2015 6:00	234.1685466
1/25/2015 7:00	234.1370992	1/25/2015 7:00	234.1407634	1/25/2015 7:00	234.1905313
1/25/2015 8:00	234.1370992	1/25/2015 8:51	234.129771	1/25/2015 8:00	234.1905313
1/25/2015 9:46	234.1151145	1/25/2015 9:42	234.1077863	1/25/2015 9:41	234.1795389
1/25/2015 10:44	234.0931298	1/25/2015 10:59	234.0748092	1/25/2015 10:40	234.1575542
1/25/2015 11:59	234.0601527	1/25/2015 11:48	234.0528244	1/25/2015 11:55	234.1245771
1/25/2015 12:52	234.0381679	1/25/2015 12:44	234.0308397	1/25/2015 12:48	234.1025924
1/25/2015 13:50	234.0161832	1/25/2015 13:48	234.008855	1/25/2015 13:44	234.0806076
1/25/2015 14:56	233.9941985	1/25/2015 14:15	233.9978626	1/25/2015 14:48	234.0586229
1/25/2015 15:39	233.9832061	1/25/2015 15:54	233.9758779	1/25/2015 15:32	234.0476305
1/25/2015 16:28	233.9722137	1/25/2015 16:43	233.9648855	1/25/2015 16:15	234.0366382
1/25/2015 17:58	233.950229	1/25/2015 17:27	233.9538931	1/25/2015 17:46	234.0146534
1/25/2015 18:36	233.9392366	1/25/2015 18:41	233.9319084	1/25/2015 18:25	234.0036611
1/25/2015 19:47	233.9172519	1/25/2015 19:20	233.920916	1/25/2015 19:41	233.9816763
1/25/2015 20:44	233.9062595	1/25/2015 20:05	233.9099237	1/25/2015 20:23	233.970684
1/25/2015 21:00	233.9062595	1/25/2015 21:00	233.9099237	1/25/2015 21:26	233.9596916
1/25/2015 22:26	233.8952672	1/25/2015 22:00	233.9099237	1/25/2015 22:00	233.9596916
1/25/2015 23:00	233.8952672	1/25/2015 23:00	233.9099237	1/25/2015 23:00	233.9596916
1/26/2015 0:00	233.9172519	1/26/2015 0:00	233.9319084	1/26/2015 0:00	233.970684
1/26/2015 1:00	233.950229	1/26/2015 1:00	233.9648855	1/26/2015 1:00	234.0036611
1/26/2015 2:00	233.9722137	1/26/2015 2:00	233.9978626	1/26/2015 2:00	234.0256458
1/26/2015 3:00	234.0051908	1/26/2015 3:00	234.0308397	1/26/2015 3:00	234.0586229
1/26/2015 4:00	234.0381679	1/26/2015 4:00	234.0638168	1/26/2015 4:00	234.1025924
1/26/2015 5:00	234.071145	1/26/2015 5:00	234.0858015	1/26/2015 5:00	234.1245771
1/26/2015 6:00	234.0821374	1/26/2015 6:51	234.0858015	1/26/2015 6:00	234.1465618
1/26/2015 7:48	234.0601527	1/26/2015 7:30	234.0638168	1/26/2015 7:55	234.1245771
1/26/2015 8:20	234.0491603	1/26/2015 8:05	234.0528244	1/26/2015 8:25	234.1135847
1/26/2015 9:58	234.0271756	1/26/2015 9:52	234.0308397	1/26/2015 9:56	234.0916
1/26/2015 10:47	234.0161832	1/26/2015 10:44	234.0198473	1/26/2015 10:45	234.0806076
1/26/2015 11:39	234.0051908	1/26/2015 11:30	234.008855	1/26/2015 11:34	234.0696153
1/26/2015 12:29	233.9941985	1/26/2015 12:33	233.9978626	1/26/2015 12:23	234.0586229
1/26/2015 13:52	233.9832061	1/26/2015 13:54	233.9868702	1/26/2015 13:24	234.0476305
1/26/2015 14:00	233.9832061	1/26/2015 14:00	233.9868702	1/26/2015 14:58	234.0366382
1/26/2015 15:58	233.9722137	1/26/2015 15:57	233.9758779	1/26/2015 15:00	234.0366382
1/26/2015 16:00	233.9722137	1/26/2015 16:00	233.9758779	1/26/2015 16:38	234.0256458
1/26/2015 17:57	233.950229	1/26/2015 17:31	233.9538931	1/26/2015 17:35	234.0146534
1/26/2015 18:37	233.9392366	1/26/2015 18:49	233.9319084	1/26/2015 18:54	233.9926687
1/26/2015 19:13	233.9282443	1/26/2015 19:37	233.920916	1/26/2015 19:34	233.9816763
1/26/2015 20:03	233.9172519	1/26/2015 20:49	233.9099237	1/26/2015 20:24	233.970684
1/26/2015 21:01	233.9062595	1/26/2015 21:00	233.9099237	1/26/2015 21:30	233.9596916
1/26/2015 22:00	233.9062595	1/26/2015 22:00	233.9099237	1/26/2015 22:00	233.9596916
1/26/2015 23:00	233.9062595	1/26/2015 23:00	233.9099237	1/26/2015 23:00	233.9596916

AECOM

E12f Maclean Minimum Reservoir Levels Jan 12-26, 2015

Maclean Minimum Reservoir Levels Jan 12-26, 2015

Timestamp	North Reservoir	Timestamp	South Reservoir
1/12/2015 0:00	233.7985965	1/12/2015 0:00	233.7619552
1/12/2015 1:00	233.8315736	1/12/2015 1:00	233.8059247
1/12/2015 2:00	233.8645507	1/12/2015 2:00	233.8498942
1/12/2015 3:00	233.9085201	1/12/2015 3:00	233.8938636
1/12/2015 4:00	233.9524896	1/12/2015 4:00	233.9268407
1/12/2015 5:00	233.9964591	1/12/2015 5:00	233.9708102
1/12/2015 6:00	234.0294362	1/12/2015 6:40	233.9708102
1/12/2015 7:43	234.0184438	1/12/2015 7:56	233.9268407
1/12/2015 8:54	233.9964591	1/12/2015 8:00	233.9268407
1/12/2015 9:41	233.9854667	1/12/2015 9:07	233.9158484
1/12/2015 10:41	233.9744743	1/12/2015 10:06	233.904856
1/12/2015 11:40	233.963482	1/12/2015 11:12	233.8938636
1/12/2015 12:29	233.9524896	1/12/2015 12:29	233.8828713
1/12/2015 13:59	233.9414972	1/12/2015 13:00	233.8828713
1/12/2015 14:00	233.9414972	1/12/2015 14:00	233.8828713
1/12/2015 15:00	233.9414972	1/12/2015 15:42	233.8718789
1/12/2015 16:10	233.9305049	1/12/2015 16:36	233.8608865
1/12/2015 17:17	233.9195125	1/12/2015 17:35	233.8389018
1/12/2015 18:31	233.8975278	1/12/2015 18:57	233.8059247
1/12/2015 19:33	233.875543	1/12/2015 19:27	233.7949323
1/12/2015 20:57	233.8498942	1/12/2015 20:07	233.78394
1/12/2015 21:55	233.8389018	1/12/2015 21:24	233.7729476
1/12/2015 22:00	233.8389018	1/12/2015 22:00	233.7729476
1/12/2015 23:00	233.8389018	1/12/2015 23:00	233.78394
1/13/2015 0:00	233.8498942	1/13/2015 0:00	233.8059247
1/13/2015 1:00	233.8718789	1/13/2015 1:00	233.8498942
1/13/2015 2:00	233.904856	1/13/2015 2:00	233.8828713
1/13/2015 3:00	233.9378331	1/13/2015 3:00	233.9158484
1/13/2015 4:00	233.9818026	1/13/2015 4:00	233.9598178
1/13/2015 5:00	234.0147797	1/13/2015 5:00	233.9927949
1/13/2015 6:00	234.0367644	1/13/2015 6:59	233.9708102
1/13/2015 7:41	234.025772	1/13/2015 7:49	233.9378331
1/13/2015 8:38	234.0037873	1/13/2015 8:32	233.9268407
1/13/2015 9:22	233.9927949	1/13/2015 9:38	233.9158484
1/13/2015 10:52	233.9708102	1/13/2015 10:36	233.904856
1/13/2015 11:43	233.9598178	1/13/2015 11:42	233.8938636
1/13/2015 12:51	233.9488255	1/13/2015 12:00	233.8938636
1/13/2015 13:00	233.9488255	1/13/2015 13:17	233.8828713
1/13/2015 14:25	233.9378331	1/13/2015 14:00	233.8828713
1/13/2015 15:00	233.9378331	1/13/2015 15:49	233.8718789
1/13/2015 16:26	233.9268407	1/13/2015 16:34	233.8608865
1/13/2015 17:27	233.9158484	1/13/2015 17:42	233.8389018
1/13/2015 18:50	233.8938636	1/13/2015 18:32	233.8169171
1/13/2015 19:51	233.8718789	1/13/2015 19:45	233.7949323
1/13/2015 20:30	233.8608865	1/13/2015 20:53	233.78394
1/13/2015 21:21	233.8498942	1/13/2015 21:00	233.78394
1/13/2015 22:44	233.8389018	1/13/2015 22:00	233.78394
1/13/2015 23:00	233.8389018	1/13/2015 23:00	233.78394

Maclean Minimum Reservoir Levels Jan 12-26, 2015

Timestamp	North Reservoir	Timestamp	South Reservoir
1/14/2015 0:00	233.8498942	1/14/2015 0:00	233.8169171
1/14/2015 1:00	233.8828713	1/14/2015 1:00	233.8498942
1/14/2015 2:00	233.9158484	1/14/2015 2:00	233.8938636
1/14/2015 3:00	233.9488255	1/14/2015 3:00	233.9378331
1/14/2015 4:00	233.9927949	1/14/2015 4:00	233.9708102
1/14/2015 5:00	234.0367644	1/14/2015 5:00	234.0147797
1/14/2015 6:00	234.0587491	1/14/2015 6:58	233.9927949
1/14/2015 7:47	234.0477568	1/14/2015 7:46	233.9598178
1/14/2015 8:55	234.025772	1/14/2015 8:29	233.9488255
1/14/2015 9:47	234.0147797	1/14/2015 9:00	233.9488255
1/14/2015 10:53	234.0037873	1/14/2015 10:46	233.9378331
1/14/2015 11:00	234.0037873	1/14/2015 11:00	233.9378331
1/14/2015 12:35	233.9927949	1/14/2015 12:37	233.9268407
1/14/2015 13:00	233.9927949	1/14/2015 13:00	233.9268407
1/14/2015 14:33	233.9818026	1/14/2015 14:00	233.9268407
1/14/2015 15:43	233.9818026	1/14/2015 15:00	233.9268407
1/14/2015 16:00	233.9818026	1/14/2015 16:28	233.9158484
1/14/2015 17:43	233.9708102	1/14/2015 17:58	233.8938636
1/14/2015 18:28	233.9598178	1/14/2015 18:51	233.8718789
1/14/2015 19:45	233.9378331	1/14/2015 19:30	233.8608865
1/14/2015 20:29	233.9268407	1/14/2015 20:15	233.8498942
1/14/2015 21:21	233.9158484	1/14/2015 21:00	233.8498942
1/14/2015 22:00	233.9158484	1/14/2015 22:00	233.8498942
1/14/2015 23:00	233.9158484	1/14/2015 23:00	233.8498942
1/15/2015 0:00	233.9158484	1/15/2015 0:00	233.8718789
1/15/2015 1:00	233.9378331	1/15/2015 1:00	233.9158484
1/15/2015 2:00	233.9818026	1/15/2015 2:00	233.9488255
1/15/2015 3:00	234.0147797	1/15/2015 3:00	233.9927949
1/15/2015 4:00	234.0587491	1/15/2015 4:00	234.0367644
1/15/2015 5:00	234.0917262	1/15/2015 5:00	234.0697415
1/15/2015 6:00	234.1247033	1/15/2015 6:54	234.0587491
1/15/2015 7:43	234.113711	1/15/2015 7:44	234.025772
1/15/2015 8:52	234.0917262	1/15/2015 8:23	234.0147797
1/15/2015 9:38	234.0807339	1/15/2015 9:00	234.0147797
1/15/2015 10:52	234.0697415	1/15/2015 10:11	234.0037873
1/15/2015 11:57	234.0587491	1/15/2015 11:28	233.9927949
1/15/2015 12:00	234.0587491	1/15/2015 12:00	233.9927949
1/15/2015 13:49	234.0477568	1/15/2015 13:58	233.9818026
1/15/2015 14:00	234.0477568	1/15/2015 14:00	233.9818026
1/15/2015 15:00	234.0477568	1/15/2015 15:58	233.9818026
1/15/2015 16:40	234.0367644	1/15/2015 16:53	233.9708102
1/15/2015 17:44	234.025772	1/15/2015 17:58	233.9488255
1/15/2015 18:26	234.0147797	1/15/2015 18:45	233.9268407
1/15/2015 19:34	233.9927949	1/15/2015 19:52	233.904856
1/15/2015 20:55	233.9708102	1/15/2015 20:55	233.8938636
1/15/2015 21:43	233.9598178	1/15/2015 21:00	233.8938636
1/15/2015 22:57	233.9488255	1/15/2015 22:00	233.8938636
1/15/2015 23:00	233.9488255	1/15/2015 23:00	233.8938636

Maclean Minimum Reservoir Levels Jan 12-26, 2015

Timestamp	North Reservoir	Timestamp	South Reservoir
1/16/2015 0:00	233.9598178	1/16/2015 0:00	233.9268407
1/16/2015 1:00	233.9927949	1/16/2015 1:00	233.9598178
1/16/2015 2:00	234.025772	1/16/2015 2:00	234.0037873
1/16/2015 3:00	234.0587491	1/16/2015 3:00	234.0477568
1/16/2015 4:00	234.1027186	1/16/2015 4:00	234.0807339
1/16/2015 5:00	234.1466881	1/16/2015 5:00	234.1247033
1/16/2015 6:00	234.1796652	1/16/2015 6:59	234.113711
1/16/2015 7:53	234.1576804	1/16/2015 7:52	234.0807339
1/16/2015 8:51	234.1356957	1/16/2015 8:21	234.0697415
1/16/2015 9:28	234.1247033	1/16/2015 9:51	234.0477568
1/16/2015 10:45	234.1027186	1/16/2015 10:44	234.0367644
1/16/2015 11:28	234.0917262	1/16/2015 11:30	234.025772
1/16/2015 12:08	234.0807339	1/16/2015 12:28	234.0147797
1/16/2015 13:04	234.0697415	1/16/2015 13:23	234.0037873
1/16/2015 14:01	234.0587491	1/16/2015 14:00	234.0037873
1/16/2015 15:16	234.0477568	1/16/2015 15:04	233.9927949
1/16/2015 16:22	234.0367644	1/16/2015 16:57	233.9708102
1/16/2015 17:29	234.025772	1/16/2015 17:31	233.9598178
1/16/2015 18:45	234.0037873	1/16/2015 18:33	233.9378331
1/16/2015 19:31	233.9927949	1/16/2015 19:00	233.9378331
1/16/2015 20:20	233.9818026	1/16/2015 20:00	233.9378331
1/16/2015 21:00	233.9818026	1/16/2015 21:00	233.9378331
1/16/2015 22:00	233.9818026	1/16/2015 22:00	233.9378331
1/16/2015 23:00	233.9818026	1/16/2015 23:00	233.9378331
1/17/2015 0:00	234.0037873	1/17/2015 0:00	233.9708102
1/17/2015 1:00	234.025772	1/17/2015 1:00	234.0037873
1/17/2015 2:00	234.0697415	1/17/2015 2:00	234.0477568
1/17/2015 3:00	234.113711	1/17/2015 3:00	234.0917262
1/17/2015 4:00	234.1576804	1/17/2015 4:00	234.1356957
1/17/2015 5:00	234.2016499	1/17/2015 5:00	234.1906575
1/17/2015 6:00	234.2456194	1/17/2015 6:00	234.2236346
1/17/2015 7:00	234.2895888	1/17/2015 7:00	234.2566117
1/17/2015 8:00	234.3115736	1/17/2015 8:35	234.2566117
1/17/2015 9:59	234.3005812	1/17/2015 9:59	234.2126423
1/17/2015 10:57	234.2785965	1/17/2015 10:59	234.1796652
1/17/2015 11:47	234.2566117	1/17/2015 11:43	234.1576804
1/17/2015 12:36	234.234627	1/17/2015 12:33	234.1356957
1/17/2015 13:58	234.2016499	1/17/2015 13:40	234.113711
1/17/2015 14:33	234.1906575	1/17/2015 14:39	234.1027186
1/17/2015 15:55	234.1686728	1/17/2015 15:55	234.0917262
1/17/2015 16:58	234.1576804	1/17/2015 16:57	234.0807339
1/17/2015 17:37	234.1466881	1/17/2015 17:37	234.0697415
1/17/2015 18:45	234.1356957	1/17/2015 18:44	234.0587491
1/17/2015 19:48	234.1247033	1/17/2015 19:00	234.0587491
1/17/2015 20:00	234.1247033	1/17/2015 20:00	234.0587491
1/17/2015 21:00	234.1247033	1/17/2015 21:00	234.0587491
1/17/2015 22:00	234.1247033	1/17/2015 22:00	234.0807339
1/17/2015 23:00	234.1356957	1/17/2015 23:00	234.0917262

Maclean Minimum Reservoir Levels Jan 12-26, 2015

Timestamp	North Reservoir	Timestamp	South Reservoir
1/18/2015 0:00	234.1576804	1/18/2015 0:00	234.1247033
1/18/2015 1:00	234.1796652	1/18/2015 1:00	234.1466881
1/18/2015 2:00	234.2126423	1/18/2015 2:00	234.1906575
1/18/2015 3:00	234.2566117	1/18/2015 3:00	234.234627
1/18/2015 4:00	234.3005812	1/18/2015 4:00	234.2785965
1/18/2015 5:00	234.3445507	1/18/2015 5:00	234.3225659
1/18/2015 6:00	234.3775278	1/18/2015 6:00	234.355543
1/18/2015 7:00	234.4214972	1/18/2015 7:00	234.3885201
1/18/2015 8:00	234.443482	1/18/2015 8:28	234.3995125
1/18/2015 9:57	234.443482	1/18/2015 9:42	234.3665354
1/18/2015 10:57	234.4214972	1/18/2015 10:54	234.3225659
1/18/2015 11:53	234.3995125	1/18/2015 11:13	234.3115736
1/18/2015 12:00	234.3995125	1/18/2015 12:00	234.3225659
1/18/2015 13:00	234.3995125	1/18/2015 13:00	234.3445507
1/18/2015 14:00	234.4105049	1/18/2015 14:55	234.3335583
1/18/2015 15:22	234.3995125	1/18/2015 15:50	234.3115736
1/18/2015 16:43	234.3775278	1/18/2015 16:55	234.2895888
1/18/2015 17:59	234.355543	1/18/2015 17:36	234.2785965
1/18/2015 18:33	234.3445507	1/18/2015 18:34	234.2566117
1/18/2015 19:35	234.3225659	1/18/2015 19:35	234.234627
1/18/2015 20:07	234.3115736	1/18/2015 20:00	234.234627
1/18/2015 21:01	234.3005812	1/18/2015 21:23	234.2236346
1/18/2015 22:26	234.2895888	1/18/2015 22:00	234.2236346
1/18/2015 23:00	234.2895888	1/18/2015 23:00	234.2456194
1/19/2015 0:00	234.3115736	1/19/2015 0:00	234.2676041
1/19/2015 1:00	234.3335583	1/19/2015 1:00	234.3115736
1/19/2015 2:00	234.3665354	1/19/2015 2:00	234.355543
1/19/2015 3:00	234.3995125	1/19/2015 3:00	234.3775278
1/19/2015 4:00	234.4214972	1/19/2015 4:00	234.4105049
1/19/2015 5:00	234.4544743	1/19/2015 5:00	234.4324896
1/19/2015 6:00	234.4654667	1/19/2015 6:51	234.4105049
1/19/2015 7:56	234.4324896	1/19/2015 7:44	234.3665354
1/19/2015 8:58	234.3995125	1/19/2015 8:24	234.3445507
1/19/2015 9:50	234.3775278	1/19/2015 9:33	234.3225659
1/19/2015 10:45	234.355543	1/19/2015 10:54	234.2895888
1/19/2015 11:41	234.3335583	1/19/2015 11:23	234.2785965
1/19/2015 12:36	234.3115736	1/19/2015 12:29	234.2566117
1/19/2015 13:45	234.2895888	1/19/2015 13:58	234.234627
1/19/2015 14:21	234.2785965	1/19/2015 14:51	234.2236346
1/19/2015 15:54	234.2566117	1/19/2015 15:38	234.2126423
1/19/2015 16:42	234.2456194	1/19/2015 16:46	234.1906575
1/19/2015 17:53	234.2126423	1/19/2015 17:45	234.1576804
1/19/2015 18:44	234.1906575	1/19/2015 18:43	234.1247033
1/19/2015 19:51	234.1576804	1/19/2015 19:26	234.1027186
1/19/2015 20:46	234.1356957	1/19/2015 20:33	234.0807339
1/19/2015 21:58	234.113711	1/19/2015 21:10	234.0697415
1/19/2015 22:00	234.113711	1/19/2015 22:19	234.0587491
1/19/2015 23:00	234.1027186	1/19/2015 23:00	234.0587491

Maclean Minimum Reservoir Levels Jan 12-26, 2015

Timestamp	North Reservoir	Timestamp	South Reservoir
1/20/2015 0:00	234.113711	1/20/2015 0:00	234.0807339
1/20/2015 1:00	234.1247033	1/20/2015 1:00	234.113711
1/20/2015 2:00	234.1576804	1/20/2015 2:00	234.1356957
1/20/2015 3:00	234.1796652	1/20/2015 3:00	234.1686728
1/20/2015 4:00	234.2126423	1/20/2015 4:00	234.2016499
1/20/2015 5:00	234.2456194	1/20/2015 5:00	234.2236346
1/20/2015 6:48	234.2566117	1/20/2015 6:56	234.2016499
1/20/2015 7:43	234.234627	1/20/2015 7:55	234.1576804
1/20/2015 8:53	234.2016499	1/20/2015 8:19	234.1466881
1/20/2015 9:56	234.1796652	1/20/2015 9:41	234.1247033
1/20/2015 10:29	234.1686728	1/20/2015 10:32	234.113711
1/20/2015 11:56	234.1356957	1/20/2015 11:32	234.0917262
1/20/2015 12:52	234.113711	1/20/2015 12:34	234.0697415
1/20/2015 13:52	234.0917262	1/20/2015 13:44	234.0477568
1/20/2015 14:26	234.0807339	1/20/2015 14:30	234.0367644
1/20/2015 15:05	234.0697415	1/20/2015 15:06	234.025772
1/20/2015 16:49	234.0477568	1/20/2015 16:37	234.0037873
1/20/2015 17:59	234.025772	1/20/2015 17:48	233.9708102
1/20/2015 18:48	234.0037873	1/20/2015 18:58	233.9378331
1/20/2015 19:37	233.9818026	1/20/2015 19:48	233.9158484
1/20/2015 20:34	233.9598178	1/20/2015 20:29	233.904856
1/20/2015 21:40	233.9378331	1/20/2015 21:08	233.8938636
1/20/2015 22:31	233.9268407	1/20/2015 22:00	233.8938636
1/20/2015 23:00	233.9268407	1/20/2015 23:00	233.8938636
1/21/2015 0:00	233.9268407	1/21/2015 0:00	233.904856
1/21/2015 1:00	233.9488255	1/21/2015 1:00	233.9378331
1/21/2015 2:00	233.9818026	1/21/2015 2:00	233.9708102
1/21/2015 3:00	234.0147797	1/21/2015 3:00	234.0037873
1/21/2015 4:00	234.0477568	1/21/2015 4:00	234.0367644
1/21/2015 5:00	234.0697415	1/21/2015 5:00	234.0587491
1/21/2015 6:00	234.0917262	1/21/2015 6:58	234.0367644
1/21/2015 7:51	234.0697415	1/21/2015 7:48	234.0037873
1/21/2015 8:42	234.0477568	1/21/2015 8:50	233.9818026
1/21/2015 9:44	234.025772	1/21/2015 9:50	233.9708102
1/21/2015 10:23	234.0147797	1/21/2015 10:32	233.9598178
1/21/2015 11:45	233.9927949	1/21/2015 11:16	233.9488255
1/21/2015 12:29	233.9818026	1/21/2015 12:06	233.9378331
1/21/2015 13:18	233.9708102	1/21/2015 13:00	233.9268407
1/21/2015 14:28	233.9598178	1/21/2015 14:30	233.9158484
1/21/2015 15:00	233.9598178	1/21/2015 15:00	233.9158484
1/21/2015 16:00	233.9598178	1/21/2015 16:44	233.8938636
1/21/2015 17:15	233.9488255	1/21/2015 17:46	233.8718789
1/21/2015 18:35	233.9268407	1/21/2015 18:37	233.8498942
1/21/2015 19:44	233.904856	1/21/2015 19:10	233.8389018
1/21/2015 20:30	233.8938636	1/21/2015 20:04	233.8279094
1/21/2015 21:30	233.8828713	1/21/2015 21:00	233.8279094
1/21/2015 22:00	233.8828713	1/21/2015 22:00	233.8279094
1/21/2015 23:00	233.8828713	1/21/2015 23:00	233.8389018

Maclean Minimum Reservoir Levels Jan 12-26, 2015

Timestamp	North Reservoir	Timestamp	South Reservoir
1/22/2015 0:00	233.8938636	1/22/2015 0:00	233.8718789
1/22/2015 1:00	233.9268407	1/22/2015 1:00	233.904856
1/22/2015 2:00	233.9598178	1/22/2015 2:00	233.9378331
1/22/2015 3:00	234.0037873	1/22/2015 3:00	233.9818026
1/22/2015 4:00	234.0367644	1/22/2015 4:00	234.025772
1/22/2015 5:00	234.0807339	1/22/2015 5:00	234.0587491
1/22/2015 6:00	234.1027186	1/22/2015 6:52	234.0477568
1/22/2015 7:42	234.0917262	1/22/2015 7:42	234.0147797
1/22/2015 8:40	234.0697415	1/22/2015 8:08	234.0037873
1/22/2015 9:18	234.0587491	1/22/2015 9:16	233.9927949
1/22/2015 10:08	234.0477568	1/22/2015 10:19	233.9818026
1/22/2015 11:03	234.0367644	1/22/2015 11:18	233.9708102
1/22/2015 12:02	234.025772	1/22/2015 12:33	233.9598178
1/22/2015 13:15	234.0147797	1/22/2015 13:00	233.9598178
1/22/2015 14:44	234.0037873	1/22/2015 14:00	233.9598178
1/22/2015 15:00	234.0037873	1/22/2015 15:36	233.9488255
1/22/2015 16:45	233.9927949	1/22/2015 16:27	233.9378331
1/22/2015 17:43	233.9818026	1/22/2015 17:40	233.9158484
1/22/2015 18:56	233.9598178	1/22/2015 18:34	233.8938636
1/22/2015 19:23	233.9488255	1/22/2015 19:44	233.8718789
1/22/2015 20:40	233.9268407	1/22/2015 20:34	233.8608865
1/22/2015 21:31	233.9158484	1/22/2015 21:00	233.8608865
1/22/2015 22:00	233.9158484	1/22/2015 22:00	233.8608865
1/22/2015 23:04	233.904856	1/22/2015 23:00	233.8608865
1/23/2015 0:00	233.9158484	1/23/2015 0:00	233.8828713
1/23/2015 1:00	233.9378331	1/23/2015 1:00	233.9268407
1/23/2015 2:00	233.9708102	1/23/2015 2:00	233.9598178
1/23/2015 3:00	234.0147797	1/23/2015 3:00	234.0037873
1/23/2015 4:00	234.0477568	1/23/2015 4:00	234.0367644
1/23/2015 5:00	234.0917262	1/23/2015 5:00	234.0697415
1/23/2015 6:00	234.113711	1/23/2015 6:47	234.0697415
1/23/2015 7:56	234.1027186	1/23/2015 7:56	234.025772
1/23/2015 8:36	234.0917262	1/23/2015 8:34	234.0147797
1/23/2015 9:55	234.0697415	1/23/2015 9:43	234.0037873
1/23/2015 10:47	234.0587491	1/23/2015 10:33	233.9927949
1/23/2015 11:29	234.0477568	1/23/2015 11:34	233.9818026
1/23/2015 12:30	234.0367644	1/23/2015 12:35	233.9708102
1/23/2015 13:19	234.025772	1/23/2015 13:52	233.9598178
1/23/2015 14:00	234.025772	1/23/2015 14:00	233.9598178
1/23/2015 15:03	234.0147797	1/23/2015 15:55	233.9488255
1/23/2015 16:08	234.0037873	1/23/2015 16:31	233.9378331
1/23/2015 17:59	233.9818026	1/23/2015 17:37	233.9158484
1/23/2015 18:40	233.9708102	1/23/2015 18:45	233.8938636
1/23/2015 19:29	233.9598178	1/23/2015 19:00	233.8938636
1/23/2015 20:11	233.9488255	1/23/2015 20:49	233.8828713
1/23/2015 21:00	233.9488255	1/23/2015 21:00	233.8828713
1/23/2015 22:06	233.9378331	1/23/2015 22:00	233.8828713
1/23/2015 23:00	233.9378331	1/23/2015 23:00	233.8938636

Maclean Minimum Reservoir Levels Jan 12-26, 2015

Timestamp	North Reservoir	Timestamp	South Reservoir
1/24/2015 0:00	233.9488255	1/24/2015 0:00	233.9158484
1/24/2015 1:00	233.9708102	1/24/2015 1:00	233.9378331
1/24/2015 2:00	234.0037873	1/24/2015 2:00	233.9708102
1/24/2015 3:00	234.0367644	1/24/2015 3:00	234.0147797
1/24/2015 4:00	234.0697415	1/24/2015 4:00	234.0477568
1/24/2015 5:00	234.1027186	1/24/2015 5:00	234.0807339
1/24/2015 6:00	234.1466881	1/24/2015 6:00	234.1247033
1/24/2015 7:00	234.1686728	1/24/2015 7:00	234.1466881
1/24/2015 8:00	234.1906575	1/24/2015 8:44	234.1247033
1/24/2015 9:46	234.1686728	1/24/2015 9:52	234.0807339
1/24/2015 10:56	234.1356957	1/24/2015 10:55	234.0367644
1/24/2015 11:52	234.1027186	1/24/2015 11:44	234.0037873
1/24/2015 12:50	234.0697415	1/24/2015 12:43	233.9708102
1/24/2015 13:48	234.0367644	1/24/2015 13:32	233.9488255
1/24/2015 14:40	234.0147797	1/24/2015 14:39	233.9268407
1/24/2015 15:35	233.9927949	1/24/2015 15:23	233.9158484
1/24/2015 16:41	233.9708102	1/24/2015 16:36	233.8938636
1/24/2015 17:52	233.9488255	1/24/2015 17:50	233.8718789
1/24/2015 18:25	233.9378331	1/24/2015 18:40	233.8608865
1/24/2015 19:11	233.9268407	1/24/2015 19:47	233.8498942
1/24/2015 20:00	233.9158484	1/24/2015 20:00	233.8498942
1/24/2015 21:00	233.9158484	1/24/2015 21:00	233.8498942
1/24/2015 22:00	233.9158484	1/24/2015 22:00	233.8608865
1/24/2015 23:00	233.9158484	1/24/2015 23:00	233.8718789
1/25/2015 0:00	233.9268407	1/25/2015 0:00	233.8938636
1/25/2015 1:00	233.9488255	1/25/2015 1:00	233.9268407
1/25/2015 2:00	233.9818026	1/25/2015 2:00	233.9598178
1/25/2015 3:00	234.0147797	1/25/2015 3:00	233.9927949
1/25/2015 4:00	234.0587491	1/25/2015 4:00	234.0367644
1/25/2015 5:00	234.0917262	1/25/2015 5:00	234.0697415
1/25/2015 6:00	234.1247033	1/25/2015 6:00	234.1027186
1/25/2015 7:00	234.1576804	1/25/2015 7:00	234.1356957
1/25/2015 8:00	234.1796652	1/25/2015 8:43	234.1247033
1/25/2015 9:43	234.1686728	1/25/2015 9:53	234.0807339
1/25/2015 10:54	234.1356957	1/25/2015 10:51	234.0367644
1/25/2015 11:49	234.1027186	1/25/2015 11:42	234.0037873
1/25/2015 12:45	234.0697415	1/25/2015 12:41	233.9708102
1/25/2015 13:46	234.0367644	1/25/2015 13:53	233.9378331
1/25/2015 14:55	234.0037873	1/25/2015 14:57	233.9158484
1/25/2015 15:54	233.9818026	1/25/2015 15:34	233.904856
1/25/2015 16:46	233.9598178	1/25/2015 16:41	233.8828713
1/25/2015 17:56	233.9378331	1/25/2015 17:34	233.8608865
1/25/2015 18:56	233.9158484	1/25/2015 18:56	233.8279094
1/25/2015 19:46	233.8938636	1/25/2015 19:54	233.8059247
1/25/2015 20:47	233.8718789	1/25/2015 20:47	233.7949323
1/25/2015 21:25	233.8608865	1/25/2015 21:00	233.7949323
1/25/2015 22:00	233.8608865	1/25/2015 22:00	233.7949323
1/25/2015 23:00	233.8608865	1/25/2015 23:00	233.8059247

Maclean Minimum Reservoir Levels Jan 12-26, 2015

Timestamp	North Reservoir	Timestamp	South Reservoir
1/26/2015 0:00	233.8718789	1/26/2015 0:00	233.8389018
1/26/2015 1:00	233.904856	1/26/2015 1:00	233.8828713
1/26/2015 2:00	233.9378331	1/26/2015 2:00	233.9158484
1/26/2015 3:00	233.9708102	1/26/2015 3:00	233.9488255
1/26/2015 4:00	234.0147797	1/26/2015 4:00	233.9927949
1/26/2015 5:00	234.0477568	1/26/2015 5:00	234.025772
1/26/2015 6:00	234.0807339	1/26/2015 6:51	234.0147797
1/26/2015 7:53	234.0587491	1/26/2015 7:42	233.9818026
1/26/2015 8:26	234.0477568	1/26/2015 8:10	233.9708102
1/26/2015 9:46	234.025772	1/26/2015 9:16	233.9598178
1/26/2015 10:26	234.0147797	1/26/2015 10:37	233.9378331
1/26/2015 11:44	233.9927949	1/26/2015 11:50	233.9158484
1/26/2015 12:23	233.9818026	1/26/2015 12:43	233.904856
1/26/2015 13:04	233.9708102	1/26/2015 13:39	233.8938636
1/26/2015 14:01	233.9598178	1/26/2015 14:00	233.8938636
1/26/2015 15:03	233.9488255	1/26/2015 15:04	233.8828713
1/26/2015 16:05	233.9378331	1/26/2015 16:47	233.8608865
1/26/2015 17:46	233.9158484	1/26/2015 17:44	233.8389018
1/26/2015 18:48	233.8938636	1/26/2015 18:59	233.8059247
1/26/2015 19:47	233.8718789	1/26/2015 19:32	233.7949323
1/26/2015 20:51	233.8498942	1/26/2015 20:11	233.78394
1/26/2015 21:48	233.8389018	1/26/2015 21:18	233.7729476
1/26/2015 22:00	233.8389018	1/26/2015 22:00	233.7729476
1/26/2015 23:00	233.8389018	1/26/2015 23:00	233.78394

E12g McPhillips Minimum Reservoir Levels Jan 12-26, 2015

McPhillips Minimum Reservoir Levels Jan 12-26, 2015

Timestamp	West Reservoir	Timestamp	East Reservoir
1/12/2015 0:25	233.9674305	1/12/2015 0:00	233.9601022
1/12/2015 1:00	234.0187282	1/12/2015 1:00	233.9930793
1/12/2015 2:00	234.07369	1/12/2015 2:00	234.0480412
1/12/2015 3:00	234.1286518	1/12/2015 3:00	234.0920106
1/12/2015 4:00	234.1726213	1/12/2015 4:00	234.1469725
1/12/2015 5:00	234.2275831	1/12/2015 5:00	234.2019343
1/12/2015 6:52	234.2459038	1/12/2015 6:00	234.2459038
1/12/2015 7:39	234.2129267	1/12/2015 7:52	234.2349114
1/12/2015 8:45	234.1836137	1/12/2015 8:59	234.2019343
1/12/2015 9:53	234.1616289	1/12/2015 9:56	234.1799496
1/12/2015 10:56	234.1249877	1/12/2015 10:53	234.1579648
1/12/2015 11:38	234.1176595	1/12/2015 11:44	234.1359801
1/12/2015 12:59	234.0846824	1/12/2015 12:39	234.1139954
1/12/2015 13:28	234.07369	1/12/2015 13:35	234.0920106
1/12/2015 14:07	234.0626977	1/12/2015 14:44	234.0700259
1/12/2015 15:47	234.0407129	1/12/2015 15:33	234.0590335
1/12/2015 16:46	234.0223923	1/12/2015 16:50	234.0370488
1/12/2015 17:31	234.0004076	1/12/2015 17:52	234.0150641
1/12/2015 18:39	233.9784228	1/12/2015 18:49	233.9930793
1/12/2015 19:43	233.9564381	1/12/2015 19:49	233.9710946
1/12/2015 20:35	233.9417816	1/12/2015 20:27	233.9601022
1/12/2015 21:47	233.9344534	1/12/2015 21:15	233.9491099
1/12/2015 22:15	233.9307893	1/12/2015 22:00	233.9491099
1/12/2015 23:12	233.9417816	1/12/2015 23:00	233.9491099
1/13/2015 0:31	233.9381175	1/13/2015 0:00	233.9601022
1/13/2015 1:00	234.0150641	1/13/2015 1:00	233.982087
1/13/2015 2:00	234.0590335	1/13/2015 2:00	234.0370488
1/13/2015 3:00	234.1139954	1/13/2015 3:00	234.0810183
1/13/2015 4:00	234.1579648	1/13/2015 4:00	234.1249877
1/13/2015 5:00	234.2019343	1/13/2015 5:00	234.1799496
1/13/2015 6:55	234.2165908	1/13/2015 6:00	234.223919
1/13/2015 7:45	234.1726213	1/13/2015 7:44	234.2019343
1/13/2015 8:53	234.1469725	1/13/2015 8:47	234.1689572
1/13/2015 9:35	234.1359801	1/13/2015 9:42	234.1469725
1/13/2015 10:55	234.103003	1/13/2015 10:41	234.1249877
1/13/2015 11:26	234.0920106	1/13/2015 11:40	234.103003
1/13/2015 12:27	234.0700259	1/13/2015 12:41	234.0810183
1/13/2015 13:45	234.0480412	1/13/2015 13:51	234.0590335
1/13/2015 14:24	234.0370488	1/13/2015 14:32	234.0480412
1/13/2015 15:39	234.0187282	1/13/2015 15:19	234.0370488
1/13/2015 16:22	234.0077358	1/13/2015 16:50	234.0150641
1/13/2015 17:47	233.9747587	1/13/2015 17:58	233.9930793
1/13/2015 18:34	233.952774	1/13/2015 18:52	233.9710946
1/13/2015 19:48	233.9307893	1/13/2015 19:52	233.9491099
1/13/2015 20:22	233.9197969	1/13/2015 20:30	233.9381175
1/13/2015 21:36	233.9161328	1/13/2015 21:18	233.9271251
1/13/2015 22:01	233.9088045	1/13/2015 22:00	233.9271251
1/13/2015 23:06	233.9197969	1/13/2015 23:00	233.9271251

McPhillips Minimum Reservoir Levels Jan 12-26, 2015

Timestamp	West Reservoir	Timestamp	East Reservoir
1/14/2015 0:37	233.9307893	1/14/2015 0:00	233.9381175
1/14/2015 1:00	233.982087	1/14/2015 1:00	233.9601022
1/14/2015 2:00	234.0370488	1/14/2015 2:00	234.0040717
1/14/2015 3:00	234.0920106	1/14/2015 3:00	234.0590335
1/14/2015 4:00	234.1469725	1/14/2015 4:00	234.1139954
1/14/2015 5:00	234.1909419	1/14/2015 5:00	234.1579648
1/14/2015 6:16	234.2129267	1/14/2015 6:00	234.2129267
1/14/2015 7:54	234.1799496	1/14/2015 7:52	234.2019343
1/14/2015 8:19	234.1689572	1/14/2015 8:47	234.1799496
1/14/2015 9:09	234.1579648	1/14/2015 9:23	234.1689572
1/14/2015 10:56	234.1359801	1/14/2015 10:59	234.1469725
1/14/2015 11:34	234.1249877	1/14/2015 11:46	234.1359801
1/14/2015 12:23	234.1139954	1/14/2015 12:39	234.1249877
1/14/2015 13:17	234.103003	1/14/2015 13:31	234.1139954
1/14/2015 14:52	234.0920106	1/14/2015 14:56	234.103003
1/14/2015 15:10	234.0883465	1/14/2015 15:00	234.103003
1/14/2015 16:21	234.0883465	1/14/2015 16:00	234.103003
1/14/2015 17:43	234.07369	1/14/2015 17:19	234.0920106
1/14/2015 18:36	234.0626977	1/14/2015 18:18	234.0810183
1/14/2015 19:43	234.0480412	1/14/2015 19:55	234.0590335
1/14/2015 20:56	234.0333847	1/14/2015 20:00	234.0590335
1/14/2015 21:14	234.0370488	1/14/2015 21:20	234.0480412
1/14/2015 22:00	234.0407129	1/14/2015 22:00	234.0480412
1/14/2015 23:26	234.0370488	1/14/2015 23:00	234.0480412
1/15/2015 0:00	234.0773541	1/15/2015 0:00	234.0590335
1/15/2015 1:00	234.132316	1/15/2015 1:00	234.1139954
1/15/2015 2:00	234.1872778	1/15/2015 2:00	234.1579648
1/15/2015 3:00	234.2422396	1/15/2015 3:00	234.2129267
1/15/2015 4:00	234.2862091	1/15/2015 4:00	234.2568961
1/15/2015 5:00	234.3411709	1/15/2015 5:00	234.311858
1/15/2015 6:56	234.3375068	1/15/2015 6:00	234.3448351
1/15/2015 7:44	234.3045297	1/15/2015 7:58	234.3228503
1/15/2015 8:04	234.2972015	1/15/2015 8:52	234.3008656
1/15/2015 9:04	234.2898732	1/15/2015 9:46	234.2898732
1/15/2015 10:42	234.2678885	1/15/2015 10:36	234.2788809
1/15/2015 11:33	234.2568961	1/15/2015 11:24	234.2678885
1/15/2015 12:24	234.2422396	1/15/2015 12:15	234.2568961
1/15/2015 13:10	234.2312473	1/15/2015 13:56	234.2349114
1/15/2015 14:05	234.223919	1/15/2015 14:00	234.2349114
1/15/2015 15:00	234.223919	1/15/2015 15:19	234.223919
1/15/2015 16:30	234.2129267	1/15/2015 16:00	234.223919
1/15/2015 17:22	234.1982702	1/15/2015 17:06	234.2129267
1/15/2015 18:04	234.1872778	1/15/2015 18:46	234.1909419
1/15/2015 19:42	234.1652931	1/15/2015 19:33	234.1799496
1/15/2015 20:07	234.1652931	1/15/2015 20:33	234.1689572
1/15/2015 21:00	234.1652931	1/15/2015 21:00	234.1689572
1/15/2015 22:01	234.1652931	1/15/2015 22:00	234.1689572
1/15/2015 23:00	234.1872778	1/15/2015 23:00	234.1689572

McPhillips Minimum Reservoir Levels Jan 12-26, 2015

Timestamp	West Reservoir	Timestamp	East Reservoir
1/16/2015 0:00	234.2202549	1/16/2015 0:00	234.1909419
1/16/2015 1:00	234.2642244	1/16/2015 1:00	234.2349114
1/16/2015 2:00	234.3081938	1/16/2015 2:00	234.2788809
1/16/2015 3:00	234.3631557	1/16/2015 3:00	234.3338427
1/16/2015 4:00	234.4181175	1/16/2015 4:00	234.3778122
1/16/2015 5:00	234.462087	1/16/2015 5:00	234.4217816
1/16/2015 6:33	229.3139954	1/16/2015 6:33	229.3139954
1/16/2015 7:00	229.3139954	1/16/2015 7:00	229.3139954
1/16/2015 8:27	234.4144534	1/16/2015 8:56	234.4217816
1/16/2015 9:17	234.403461	1/16/2015 9:28	234.4107893
1/16/2015 10:29	234.3814763	1/16/2015 10:39	234.3888045
1/16/2015 11:55	234.3558274	1/16/2015 11:49	234.3668198
1/16/2015 12:36	234.3448351	1/16/2015 12:25	234.3558274
1/16/2015 13:57	229.3139954	1/16/2015 13:57	229.3139954
1/16/2015 14:00	229.3139954	1/16/2015 14:00	229.3139954
1/16/2015 15:00	234.3155221	1/16/2015 15:00	234.3191862
1/16/2015 16:58	234.2935373	1/16/2015 16:18	234.3081938
1/16/2015 17:48	234.282545	1/16/2015 17:14	234.2972015
1/16/2015 18:45	234.2715526	1/16/2015 18:44	234.2752167
1/16/2015 19:00	234.2715526	1/16/2015 19:56	234.2642244
1/16/2015 20:00	234.2715526	1/16/2015 20:00	234.2642244
1/16/2015 21:00	234.2715526	1/16/2015 21:00	234.2642244
1/16/2015 22:06	234.2788809	1/16/2015 22:00	234.2752167
1/16/2015 23:42	234.2862091	1/16/2015 23:00	234.2752167
1/17/2015 0:00	234.3155221	1/17/2015 0:00	234.2862091
1/17/2015 1:00	234.3484992	1/17/2015 1:00	234.3191862
1/17/2015 2:00	234.3814763	1/17/2015 2:00	234.3521633
1/17/2015 3:00	234.4144534	1/17/2015 3:00	234.3851404
1/17/2015 4:00	234.4474305	1/17/2015 4:00	234.4181175
1/17/2015 5:00	234.4804076	1/17/2015 5:00	234.4510946
1/17/2015 6:00	234.5133847	1/17/2015 6:00	234.4840717
1/17/2015 7:00	234.5463618	1/17/2015 7:00	234.5170488
1/17/2015 8:59	234.5280412	1/17/2015 8:36	234.5280412
1/17/2015 9:47	234.4950641	1/17/2015 9:51	234.4950641
1/17/2015 10:53	234.4401022	1/17/2015 10:55	234.4510946
1/17/2015 11:36	234.403461	1/17/2015 11:53	234.4071251
1/17/2015 12:50	234.3594915	1/17/2015 12:56	234.3631557
1/17/2015 13:46	234.3265144	1/17/2015 13:46	234.3301786
1/17/2015 14:36	234.2935373	1/17/2015 14:42	234.2972015
1/17/2015 15:52	234.2642244	1/17/2015 15:51	234.2642244
1/17/2015 16:41	234.2422396	1/17/2015 16:40	234.2422396
1/17/2015 17:56	234.2092625	1/17/2015 17:52	234.2092625
1/17/2015 18:53	234.1872778	1/17/2015 18:42	234.1872778
1/17/2015 19:28	234.1762854	1/17/2015 19:35	234.1652931
1/17/2015 20:59	234.1543007	1/17/2015 20:57	234.1433083
1/17/2015 21:00	234.1543007	1/17/2015 21:00	234.1433083
1/17/2015 22:00	234.1543007	1/17/2015 22:01	234.132316
1/17/2015 23:40	234.132316	1/17/2015 23:00	234.132316

McPhillips Minimum Reservoir Levels Jan 12-26, 2015

Timestamp	West Reservoir	Timestamp	East Reservoir
1/18/2015 0:00	234.1689572	1/18/2015 0:00	234.132316
1/18/2015 1:00	234.1909419	1/18/2015 1:00	234.1652931
1/18/2015 2:00	234.223919	1/18/2015 2:00	234.1982702
1/18/2015 3:00	234.2568961	1/18/2015 3:00	234.2202549
1/18/2015 4:00	234.2898732	1/18/2015 4:00	234.253232
1/18/2015 5:00	234.3228503	1/18/2015 5:00	234.2862091
1/18/2015 6:00	234.3448351	1/18/2015 6:00	234.3191862
1/18/2015 7:00	234.3778122	1/18/2015 7:00	234.3411709
1/18/2015 8:31	234.3778122	1/18/2015 8:39	234.3631557
1/18/2015 9:59	234.3228503	1/18/2015 9:55	234.3301786
1/18/2015 10:53	234.2678885	1/18/2015 10:51	234.2862091
1/18/2015 11:52	234.1872778	1/18/2015 11:59	234.2202549
1/18/2015 12:59	234.1066671	1/18/2015 12:55	234.1543007
1/18/2015 13:56	234.0407129	1/18/2015 13:58	234.0773541
1/18/2015 14:53	234.0187282	1/18/2015 14:44	234.0333847
1/18/2015 15:52	233.9857511	1/18/2015 15:58	233.9894152
1/18/2015 16:50	233.952774	1/18/2015 16:56	233.9564381
1/18/2015 17:50	233.9197969	1/18/2015 17:55	233.923461
1/18/2015 18:47	233.8868198	1/18/2015 18:53	233.8904839
1/18/2015 19:48	233.8538427	1/18/2015 19:53	233.8575068
1/18/2015 20:41	233.831858	1/18/2015 20:41	233.8355221
1/18/2015 21:17	233.8208656	1/18/2015 21:43	233.8135373
1/18/2015 22:15	233.8098732	1/18/2015 22:34	233.802545
1/18/2015 23:33	233.8062091	1/18/2015 23:00	233.802545
1/19/2015 0:00	233.8355221	1/19/2015 0:00	233.8135373
1/19/2015 1:00	233.8684992	1/19/2015 1:00	233.8465144
1/19/2015 2:00	233.9124686	1/19/2015 2:00	233.8904839
1/19/2015 3:00	233.9674305	1/19/2015 3:00	233.9344534
1/19/2015 4:00	234.0113999	1/19/2015 4:00	233.9894152
1/19/2015 5:00	234.0663618	1/19/2015 5:00	234.044377
1/19/2015 6:00	234.0956748	1/19/2015 6:00	234.0883465
1/19/2015 7:46	234.0626977	1/19/2015 7:53	234.0883465
1/19/2015 8:24	234.0517053	1/19/2015 8:54	234.0663618
1/19/2015 9:20	234.0407129	1/19/2015 9:40	234.0553694
1/19/2015 10:40	234.0187282	1/19/2015 10:21	234.044377
1/19/2015 11:58	233.9967435	1/19/2015 11:40	234.0223923
1/19/2015 12:51	233.9857511	1/19/2015 12:21	234.0113999
1/19/2015 13:00	233.9857511	1/19/2015 13:09	234.0004076
1/19/2015 14:55	233.9674305	1/19/2015 14:06	233.9894152
1/19/2015 15:33	233.9674305	1/19/2015 15:00	233.9894152
1/19/2015 16:59	233.9564381	1/19/2015 16:10	233.9784228
1/19/2015 17:45	233.9491099	1/19/2015 17:37	233.9674305
1/19/2015 18:27	233.9381175	1/19/2015 18:31	233.9564381
1/19/2015 19:17	233.9271251	1/19/2015 19:16	233.9454457
1/19/2015 20:41	233.9124686	1/19/2015 20:14	233.9344534
1/19/2015 21:53	233.9197969	1/19/2015 21:00	233.9344534
1/19/2015 22:06	233.9197969	1/19/2015 22:00	233.9344534
1/19/2015 23:06	233.9344534	1/19/2015 23:00	233.9344534

McPhillips Minimum Reservoir Levels Jan 12-26, 2015

Timestamp	West Reservoir	Timestamp	East Reservoir
1/20/2015 0:00	233.9857511	1/20/2015 0:00	233.9564381
1/20/2015 1:00	234.0407129	1/20/2015 1:00	234.0113999
1/20/2015 2:00	234.0846824	1/20/2015 2:00	234.0663618
1/20/2015 3:00	234.1396442	1/20/2015 3:00	234.1103312
1/20/2015 4:00	234.194606	1/20/2015 4:00	234.1652931
1/20/2015 5:00	234.2385755	1/20/2015 5:00	234.2202549
1/20/2015 6:42	234.2605602	1/20/2015 6:00	234.2642244
1/20/2015 7:45	234.2275831	1/20/2015 7:44	234.253232
1/20/2015 8:06	234.2165908	1/20/2015 8:35	234.2312473
1/20/2015 9:53	234.194606	1/20/2015 9:59	234.2092625
1/20/2015 10:23	234.1762854	1/20/2015 10:41	234.1982702
1/20/2015 11:47	234.1689572	1/20/2015 11:47	234.1762854
1/20/2015 12:17	234.1579648	1/20/2015 12:59	234.1543007
1/20/2015 13:54	234.1359801	1/20/2015 13:38	234.1433083
1/20/2015 14:49	234.1249877	1/20/2015 14:26	234.132316
1/20/2015 15:00	234.1249877	1/20/2015 15:00	234.132316
1/20/2015 16:22	234.1139954	1/20/2015 16:20	234.1213236
1/20/2015 17:55	234.0920106	1/20/2015 17:38	234.1103312
1/20/2015 18:37	234.0810183	1/20/2015 18:27	234.0993389
1/20/2015 19:46	234.0700259	1/20/2015 19:12	234.0883465
1/20/2015 20:00	234.0700259	1/20/2015 20:03	234.0773541
1/20/2015 21:00	234.0700259	1/20/2015 21:00	234.0773541
1/20/2015 22:00	234.0700259	1/20/2015 22:00	234.0773541
1/20/2015 23:27	234.0773541	1/20/2015 23:00	234.0773541
1/21/2015 0:00	234.1286518	1/21/2015 0:00	234.1103312
1/21/2015 1:00	234.1836137	1/21/2015 1:00	234.1543007
1/21/2015 2:00	234.2275831	1/21/2015 2:00	234.2092625
1/21/2015 3:00	234.282545	1/21/2015 3:00	234.253232
1/21/2015 4:00	234.3375068	1/21/2015 4:00	234.3081938
1/21/2015 5:00	234.3814763	1/21/2015 5:00	234.3521633
1/21/2015 6:33	234.403461	1/21/2015 6:00	234.3961328
1/21/2015 7:52	234.3484992	1/21/2015 7:54	234.374148
1/21/2015 8:33	234.3375068	1/21/2015 8:37	234.3521633
1/21/2015 9:46	234.3155221	1/21/2015 9:35	234.3301786
1/21/2015 10:57	229.3139954	1/21/2015 10:57	229.3139954
1/21/2015 11:00	229.3139954	1/21/2015 11:00	229.3139954
1/21/2015 12:00	229.3139954	1/21/2015 12:00	229.3139954
1/21/2015 13:00	229.3139954	1/21/2015 13:00	229.3139954
1/21/2015 14:00	229.3139954	1/21/2015 14:00	229.3139954
1/21/2015 15:00	229.3139954	1/21/2015 15:00	229.3139954
1/21/2015 16:00	229.3139954	1/21/2015 16:00	229.3139954
1/21/2015 17:59	234.1616289	1/21/2015 17:42	234.1799496
1/21/2015 18:29	234.1506366	1/21/2015 18:42	234.1579648
1/21/2015 19:48	234.1286518	1/21/2015 19:43	234.1359801
1/21/2015 20:27	234.1176595	1/21/2015 20:45	234.1139954
1/21/2015 21:15	234.1066671	1/21/2015 21:24	234.103003
1/21/2015 22:00	234.1066671	1/21/2015 22:27	234.0920106
1/21/2015 23:00	234.1066671	1/21/2015 23:00	234.0920106

McPhillips Minimum Reservoir Levels Jan 12-26, 2015

Timestamp	West Reservoir	Timestamp	East Reservoir
1/22/2015 0:00	234.0956748	1/22/2015 0:00	234.103003
1/22/2015 1:00	234.1616289	1/22/2015 1:00	234.1359801
1/22/2015 2:00	234.2055984	1/22/2015 2:00	234.1689572
1/22/2015 3:00	234.2385755	1/22/2015 3:00	234.2129267
1/22/2015 4:00	234.282545	1/22/2015 4:00	234.2568961
1/22/2015 5:00	234.3155221	1/22/2015 5:00	234.2898732
1/22/2015 6:59	234.3155221	1/22/2015 6:00	234.3228503
1/22/2015 7:40	234.2752167	1/22/2015 7:49	234.2898732
1/22/2015 8:48	234.2459038	1/22/2015 8:41	234.2568961
1/22/2015 9:47	234.223919	1/22/2015 9:55	234.223919
1/22/2015 10:57	234.1909419	1/22/2015 10:44	234.2019343
1/22/2015 11:50	234.1689572	1/22/2015 11:38	234.1799496
1/22/2015 12:50	234.1469725	1/22/2015 12:57	234.1469725
1/22/2015 13:42	234.1249877	1/22/2015 13:53	234.1249877
1/22/2015 14:23	234.1139954	1/22/2015 14:59	234.103003
1/22/2015 15:47	234.0920106	1/22/2015 15:40	234.0920106
1/22/2015 16:54	234.0700259	1/22/2015 16:54	234.0700259
1/22/2015 17:41	234.0480412	1/22/2015 17:58	234.0480412
1/22/2015 18:32	234.0260564	1/22/2015 18:51	234.0260564
1/22/2015 19:31	234.0040717	1/22/2015 19:45	234.0040717
1/22/2015 20:08	233.9930793	1/22/2015 20:57	233.982087
1/22/2015 21:02	233.982087	1/22/2015 21:43	233.9710946
1/22/2015 22:00	233.982087	1/22/2015 22:00	233.9710946
1/22/2015 23:26	233.9710946	1/22/2015 23:00	233.9710946
1/23/2015 0:00	234.0187282	1/23/2015 0:00	233.9930793
1/23/2015 1:00	234.0517053	1/23/2015 1:00	234.0260564
1/23/2015 2:00	234.0956748	1/23/2015 2:00	234.0590335
1/23/2015 3:00	234.1396442	1/23/2015 3:00	234.103003
1/23/2015 4:00	234.1726213	1/23/2015 4:00	234.1469725
1/23/2015 5:35	231.9228503	1/23/2015 5:00	234.1799496
1/23/2015 6:22	234.2055984	1/23/2015 6:00	234.2019343
1/23/2015 7:44	234.1689572	1/23/2015 7:47	234.1799496
1/23/2015 8:53	234.1359801	1/23/2015 8:42	234.1469725
1/23/2015 9:54	234.1103312	1/23/2015 9:58	234.1139954
1/23/2015 10:35	234.0883465	1/23/2015 10:45	234.0920106
1/23/2015 11:31	234.0663618	1/23/2015 11:35	234.0700259
1/23/2015 12:45	234.0333847	1/23/2015 12:57	234.0370488
1/23/2015 13:53	234.0113999	1/23/2015 13:54	234.0150641
1/23/2015 14:52	233.9930793	1/23/2015 14:27	234.0040717
1/23/2015 15:29	233.9784228	1/23/2015 15:41	233.982087
1/23/2015 16:58	233.9454457	1/23/2015 16:45	233.9601022
1/23/2015 17:59	233.923461	1/23/2015 17:45	233.9381175
1/23/2015 18:53	233.9014763	1/23/2015 18:42	233.9161328
1/23/2015 19:54	233.8831557	1/23/2015 19:48	233.894148
1/23/2015 20:32	233.8794915	1/23/2015 20:38	233.8831557
1/23/2015 21:50	233.8648351	1/23/2015 21:00	233.8831557
1/23/2015 22:16	233.8648351	1/23/2015 22:04	233.8721633
1/23/2015 23:22	233.8721633	1/23/2015 23:00	233.8721633

McPhillips Minimum Reservoir Levels Jan 12-26, 2015

Timestamp	West Reservoir	Timestamp	East Reservoir
1/24/2015 0:00	233.9271251	1/24/2015 0:00	233.894148
1/24/2015 1:00	233.9601022	1/24/2015 1:00	233.9381175
1/24/2015 2:00	234.0040717	1/24/2015 2:00	233.9710946
1/24/2015 3:00	234.0480412	1/24/2015 3:00	234.0150641
1/24/2015 4:00	234.0810183	1/24/2015 4:00	234.0590335
1/24/2015 5:00	234.1249877	1/24/2015 5:00	234.0920106
1/24/2015 6:00	234.1579648	1/24/2015 6:00	234.1359801
1/24/2015 7:00	234.2019343	1/24/2015 7:00	234.1689572
1/24/2015 8:48	234.1909419	1/24/2015 8:41	234.1909419
1/24/2015 9:59	234.1469725	1/24/2015 9:41	234.1689572
1/24/2015 10:45	234.103003	1/24/2015 10:47	234.1249877
1/24/2015 11:54	234.0517053	1/24/2015 11:46	234.0810183
1/24/2015 12:59	234.0077358	1/24/2015 12:48	234.0370488
1/24/2015 13:46	233.9857511	1/24/2015 13:57	233.9930793
1/24/2015 14:55	233.952774	1/24/2015 14:40	233.9710946
1/24/2015 15:46	233.9307893	1/24/2015 15:50	233.9381175
1/24/2015 16:35	233.9088045	1/24/2015 16:42	233.9161328
1/24/2015 17:28	233.8831557	1/24/2015 17:32	233.894148
1/24/2015 18:42	233.8611709	1/24/2015 18:59	233.8611709
1/24/2015 19:25	233.8501786	1/24/2015 19:35	233.8501786
1/24/2015 20:58	233.8391862	1/24/2015 20:29	233.8391862
1/24/2015 21:00	233.8391862	1/24/2015 21:00	233.8391862
1/24/2015 22:00	233.8391862	1/24/2015 22:00	233.8391862
1/24/2015 23:38	233.8465144	1/24/2015 23:00	233.8391862
1/25/2015 0:45	233.8208656	1/25/2015 0:00	233.8391862
1/25/2015 1:00	233.8758274	1/25/2015 1:00	233.8501786
1/25/2015 2:00	233.9197969	1/25/2015 2:00	233.894148
1/25/2015 3:00	233.9637664	1/25/2015 3:00	233.9271251
1/25/2015 4:00	233.9967435	1/25/2015 4:00	233.9710946
1/25/2015 5:00	234.0407129	1/25/2015 5:00	234.0150641
1/25/2015 6:00	234.0846824	1/25/2015 6:00	234.0590335
1/25/2015 7:00	234.1176595	1/25/2015 7:00	234.0920106
1/25/2015 8:43	234.1286518	1/25/2015 8:00	234.1249877
1/25/2015 9:51	234.0663618	1/25/2015 9:43	234.103003
1/25/2015 10:59	234.0223923	1/25/2015 10:47	234.0590335
1/25/2015 11:58	233.9784228	1/25/2015 11:45	234.0150641
1/25/2015 12:53	233.9417816	1/25/2015 12:47	233.9710946
1/25/2015 13:47	233.9088045	1/25/2015 13:53	233.9271251
1/25/2015 14:34	233.8868198	1/25/2015 14:52	233.894148
1/25/2015 15:57	233.8538427	1/25/2015 15:39	233.8721633
1/25/2015 16:44	233.831858	1/25/2015 16:52	233.8391862
1/25/2015 17:56	233.7988809	1/25/2015 17:43	233.8172015
1/25/2015 18:37	233.7768961	1/25/2015 18:52	233.7842244
1/25/2015 19:57	233.743919	1/25/2015 19:39	233.7622396
1/25/2015 20:32	233.7329267	1/25/2015 20:37	233.7402549
1/25/2015 21:46	233.7219343	1/25/2015 21:11	233.7292625
1/25/2015 22:00	233.7219343	1/25/2015 22:26	233.7182702
1/25/2015 23:27	233.7292625	1/25/2015 23:00	233.7182702

McPhillips Minimum Reservoir Levels Jan 12-26, 2015

Timestamp	West Reservoir	Timestamp	East Reservoir
1/26/2015 0:46	233.7219343	1/26/2015 0:00	233.7292625
1/26/2015 1:00	233.7622396	1/26/2015 1:00	233.7402549
1/26/2015 2:00	233.8062091	1/26/2015 2:00	233.7842244
1/26/2015 3:00	233.8501786	1/26/2015 3:00	233.8172015
1/26/2015 4:00	233.894148	1/26/2015 4:00	233.8611709
1/26/2015 5:00	233.9271251	1/26/2015 5:00	233.9051404
1/26/2015 6:35	233.9381175	1/26/2015 6:00	233.9381175
1/26/2015 7:38	233.8831557	1/26/2015 7:52	233.9051404
1/26/2015 8:38	233.8648351	1/26/2015 8:52	233.8721633
1/26/2015 9:59	233.831858	1/26/2015 9:43	233.8501786
1/26/2015 10:37	233.8098732	1/26/2015 10:53	233.8172015
1/26/2015 11:43	233.7768961	1/26/2015 11:59	233.7842244
1/26/2015 12:48	233.743919	1/26/2015 12:41	233.7622396
1/26/2015 13:38	233.7219343	1/26/2015 13:52	233.7292625
1/26/2015 14:46	233.6999496	1/26/2015 14:48	233.7072778
1/26/2015 15:48	233.6779648	1/26/2015 15:52	233.6852931
1/26/2015 16:35	233.6559801	1/26/2015 16:51	233.6633083
1/26/2015 17:42	233.623003	1/26/2015 17:43	233.6413236
1/26/2015 18:56	233.5863618	1/26/2015 18:48	233.6083465
1/26/2015 19:26	233.5753694	1/26/2015 19:38	233.5863618
1/26/2015 20:35	233.5533847	1/26/2015 20:35	233.564377
1/26/2015 21:25	233.5423923	1/26/2015 21:58	233.5423923
1/26/2015 22:00	233.5423923	1/26/2015 22:00	233.5423923
1/26/2015 23:00	233.5533847	1/26/2015 23:00	233.5423923

E13 Reservoir Washing History

E13a Reservoir Washing History Data

This section has been intentionally removed.

E13b Reservoir Washing History Schedule

This section has been intentionally removed.

E14 Standard Operating Procedures (SOPs) Related to Distribution System Maintenance

E14a List of Standard Operating Procedures (SOP) and Safe Work Procedures (SWP)

Standard Operating Procedures (SOP) and Safe Work Procedures (SWP)

SOP/SWP	Reviewed?
SOP-Residual Chlorine Readings	✓
SOP-Equipment Disinfection	✓
SOP-Turbidity Readings	✓
L-SOP-004-South Reservoir Isolating, Draining, and Refilling	✓
P-SOP-004-West Reservoir Isolating, Draining, and Refilling	✓
SOP-Slug Disinfection After Repair	✓
S-SWP-001-Water Reservoir Maintenance	✓
SWP-WS-LS-Repairing a Water Main Break or Leak-01 of 09-Investigating and Controlling New Leaks	✓
SWP-WS-LS-Repairing a Water Main Break or Leak-02 of 09-Clearances for Excavation Area	✓
SWP-WS-LS-Repairing a Water Main Break or Leak-03 of 09-Testing for the Leak with Test Truck	✓
SWP-WS-LS-Repairing a Water Main Break or Leak-04 of 09-Repairing the Water Main	✓
SWP-WS-LS-Repairing a Water Main Break or Leak-05 of 09-Installing and Removing Trench Cages	✓
SWP-WS-LS-Repairing a Water Main Break or Leak-06 of 09-Changing the Excavator Bucket on the Backhoe	✓
SWP-WS-LS-Repairing a Water Main Break or Leak-07 of 09-Transporting Excavated Material with a Tandem Dump Truck	✓
SWP-WS-LS-Repairing a Water Main Break or Leak-08 of 09-Charging the System (Putting the Main back in Service)	✓
SWP-WS-LS-Repairing a Water Main Break or Leak-09 of 09-Filling Cuts to Grade	✓
SWP-WS-LS-Backhoe-01 of 02-Front Bucket Work.doc	
SWP-WS-LS-Backhoe-02 of 02-Driving, Transporting and Mobilizing.doc	
SWP-WS-LS-Cleaning Service Boxes with Air Compressor-01 of 01-Cleaning Service Boxes with Air Compressor.doc	
SWP-WS-LS-Hiab Lift Crane Use-01 of 01-Hiab Lift Crane Use.doc	
SWP-WS-LS-Inspecting Fire Hydrants-01 of 01-Inspecting Fire Hydrants.doc	
SWP-WS-LS-Installing and Removing Temporary Hose Lines-01 of 01-Installing and Removing Temporary Hose Lines.doc	
SWP-WS-LS-Installing or Replacing Water Meters-01 of 01-Installing or Replacing Water Meters.doc	
SWP-WS-LS-Major Hydrant Repairs-01 of 04-Replacing a Hydrant Body.doc	
SWP-WS-LS-Major Hydrant Repairs-02 of 04-Internal Maintenance for a Mechanical Hydrant.doc	
SWP-WS-LS-Painting Fire Hydrants-01 of 01-Painting Fire Hydrants.doc	
SWP-WS-LS-Repairing A Service Box-01 of 03-Repairing or Replacing the Service Box.doc	
SWP-WS-LS-Repairing a Service Box-02 of 03-Installing and Removing Excavation Shoring.doc	
SWP-WS-LS-Repairing a Service Box-03 of 03-Replacing a Service Box Special.doc	
SWP-WS-LS-Replacing a Valve Box Cover-01 of 01-Replacing a Valve Box Cover.doc	
SWP-WS-LS-Turning Services On or Off from Non Payment-01 of 02-Turning Services Off.doc	
SWP-WS-LS-Turning Services On or Off from Non Payment-02 of 02-Turning Services On.doc	

E14b Chlorine Readings After Watermain Repair SOP

Winnipeg
Water and Waste Department

Division		Facility	Area
Water Services		Water Distribution	Winnipeg
Creation Date	**Revision Date**	**Revision Number**	**SOP #**
Jul 15, 2014	Jul 17, 2014	01	N/A
Procedure Name			
Residual Chlorine Readings			

Controlled Document

Original Authors:

1. Tim Shanks, P.Eng. Manager, Water Services *print name, position*	2. Jennifer Graham, Training Coordinator *print name, position*
3. _____ *print name, position*	4. _____ *print name, position*

Reviewed By:

Reviewer	1. _____ *print name, position*	YYYY	MM	DD
Safety	2. _____ *print name, position*			
Environment	3. _____ *print name, position*			

Tested By:

Tester	1. _____ *print name, position*	YYYY	MM	DD
Safety	2. _____ *print name, position*			
Environment	3. _____ *print name, position*			

Authorized By:

	1. _____	YYYY	MM	DD
	2. _____			

1. Location

- City of Winnipeg Water Distribution Facility

2. Objectives

- The purpose is to ensure that water quality in the distribution system is maintained at acceptable standards after water mains are repaired.

3. Warning

- Confirm all personnel have read the MSDS on the DPD Free Chlorine Agent

4. Personnel Qualifications

- General Maintenance Worker Training

5. Discussion

- N/A

6. Hazards

- Avoid ingesting DPD Free Chlorine Agent

7. Abbreviations

ABBREVIATION	DESCRIPTION	DEFINITION
AWWA	American Water Works Association	N/A
MSDS	Material Safety Data Sheet	N/A
pdf	Portable Document Format	N/A
PPE	Personal Protective Equipment	N/A
SOP	Standard Operating Procedure	Specified way to perform a routine activity (work instructions)
SWP	Safe Work Procedure	Description of all safety considerations, hazards present, and protective measures such as PPE and training which must be in place to perform a particular activity

8. Equipment and Supplies

- HACH Pocket Colorimeter II
- 10ml Chlorine Reading Vials
- DPD Free Chlorine Agent pillow packs
- Silicone oil and buffing cloth
- AAA batteries
- Kimwipes

9. Preparation

- After repairs are complete, flush the water main towards the break, through a hydrant, until water is running clear.
- If valve and hydrant locations permit, flush towards the work from both directions.

10. Procedure

NO.	LOCATION	ACTIVITY DESCRIPTION	RESPONSIBILITY	DATA TO RECORD
1	Site of Watermain Repair	• Run the water from the venting hydrant for a minimum of 2-5 minutes. When the water runs clear take a sample and bring it to a sheltered area to perform the readings, such as the crew mobile or trailer	Excavation Crew	N/A
2	Crew mobile or trailer	PREPARE THE VIAL FOR TESTING: • Wipe down the vial with the water sample using a Kimwipe • If the vial has minor scratches put a drop of silicone oil on the vial and wipe with the buffing cloth. • If the vial has major scratches, discard and use a new vial	Excavation Crew	N/A
3	Crew mobile or trailer	BLANK THE COLORIMETER: • Turn the Colorimeter II on • Remover the reading slot cover, insert the sample (without reagent) into the reading slot and put the cover on • Press the '0' button • Wait for the result. If the reading equals 0, proceed to step 4 • If the blank does not read 0, check the vial, retest, and if it fails again, notify your immediate supervisor	Excavation Crew	N/A
4	Crew mobile or trailer	ADD THE REAGENT: • Remove the blank vial, and add a DPD Free Chlorine Reagent Pillow pack to the vial. • Slowly stir the reagent into the water sample by gently tipping the vial back and forth.	Excavation Crew	N/A

NO.	LOCATION	ACTIVITY DESCRIPTION	RESPONSIBILITY	DATA TO RECORD
5	Crew mobile or trailer	TEST THE WATER SAMPLE: • Place the prepared vial from step 4 into the reading slot and put the cover on • Press the 'checkmark' button to initiate a reading • If the reading is 0.10 mg/L or more, record the number on the timecard then discard and rinse the vial, clean and store the Colorimeter II for next use. • If the reading is less than 0.10 mg/L , continue flushing and take another reading until the result is at least 0.10 mg/L • If the reading continues to return less than 0.10 mg/L, contact your immediate supervisor.	Excavation Crew	Record the result as mg/L on the timecard

11. Facility Equipment/Parts Numbers

- See 552 Plinguet Stores and/or Supervisor for supplies

12. Related Procedures

- Safe Work Procedures
- AWWA C651

13. Environmental

- N/A

14. References

- HACH Pocket Colorimeter™ II Instruction Manual

Appendix A: Procedure Review Form

Complete the following information and include with the proposed document revisions.

Document number	
Document name	
Existing revision #	
Proposed revision #	
Author of changes	
Summary of rationale for changes	

Route through the following personnel for review and approval.

Mark (X) all applicable	Signature	Date	Comments	Training requirements (Check if either applies)
☐ **Systems Engineer**				☐ **Hold revision until notified** ☐ **Allow _____ for training**
☐ **Operations Engineer**				☐ **Hold revision until notified** ☐ **Allow _____ for training**
☐ **Operations Supervisor**				☐ **Hold revision until notified** ☐ **Allow _____ for training**
☐ **Maintenance Supervisor**				☐ **Hold revision until notified** ☐ **Allow _____ for training**
☐ **Process Control Supervisor**				☐ **Hold revision until notified** ☐ **Allow _____ for training**
☐ **Aqueduct and Railway Supervisor**				☐ **Hold revision until notified** ☐ **Allow _____ for training**

Note: Designates may also review and comment, as required.

E14c Disinfection SOP

Water and Waste Department

Division		Facility	Area
Water Services		Water Distribution	Winnipeg
Creation Date	**Revision Date**	**Revision Number**	**SOP #**
May 01, 2012	Jul 15, 2014	01	N/A
Procedure Name			
Equipment Disinfection			

Controlled Document

Original Authors:

1. Tim Shanks, P.Eng. Senior Project Engineer *print name, position*	2. Jennifer Graham, Training Coordinator *print name, position*
3. _____ *print name, position*	4. _____ *print name, position*

Reviewed By:

Reviewer	1. _____ *print name, position*	YYYY	MM	DD
Safety	2. _____ *print name, position*			
Environment	3. _____ *print name, position*			

Tested By:

Tester	1. _____ *print name, position*	YYYY	MM	DD
Safety	2. _____ *print name, position*			
Environment	3. _____ *print name, position*			

Water and Waste Department

Division		Facility	Area
Water Services		Water Distribution	Winnipeg
Creation Date	**Revision Date**	**Revision Number**	**SOP #**
May 01, 2012	Jul 15, 2014	01	N/A
Procedure Name			
Equipment Disinfection			

Controlled Document

Authorized By:

	1. _____	YYYY	MM	DD
	2. _____			

1. Location

- City of Winnipeg Water Distribution Facility

2. Objectives

- The purpose is to ensure that water quality in the distribution system is maintained at acceptable standards after water mains are repaired.

3. Warning

- Confirm all personnel have read the MSDS on sodium hypochlorite

4. Personnel Qualifications

- General Maintenance Worker Training

5. Discussion

- N/A

6. Hazards

- Use proper ventilation to minimize exposure to product vapour or mist
- Gloves and eye protection is recommended
- See MSDS pdf file located on crew mobile laptops and in SWP binders for more information

7. Abbreviations

ABBREVIATION	DESCRIPTION	DEFINITION
AWWA	American Water Works Association	N/A
MSDS	Material Safety Data Sheet	N/A
pdf	Portable Document Format	N/A
PPE	Personal Protective Equipment	N/A
SOP	Standard Operating Procedure	Specified way to perform a routine activity (work instructions)
SWP	Safe Work Procedure	Description of all safety considerations, hazards present, and protective measures such as PPE and training which must be in place to perform a particular activity

8. Equipment and Supplies

- 32 oz spray bottle
- Funnel
- 5% sodium hypochlorite solution: Clorox
- PPE: protective gloves, eye protection
- Portable eyewash station

Preparation

- The excavation is to be dewatered to below the invert of the water main, and maintained in as sanitary a condition as possible.
- Pipe and fittings are to be kept in a clean condition during storage and delivery.
- Prevent entry of trench water into pipe and fittings.

9. Procedure

NO.	LOCATION	ACTIVITY DESCRIPTION	RESPONSIBILITY	DATA TO RECORD
1	Operations Yard	• Decant 5% sodium hypochlorite solution from the parent bottle of Clorox Liquid Bleach into a 32 oz spray bottle that is labeled with the Clorox Liquid Bleach MSDS label.	Excavation Crew	N/A
2	Excavation Site	• Before installation, the interior of pipe and fittings are to be wiped with a clean cloth and then sprayed with a 5% sodium hypochlorite solution.	Excavation Crew	N/A
3	Excavation Site	• Clean all tools used for repairs by scraping off loose mud and debris • Spray with 5% sodium hypochlorite solution. • Wipe with a clean rag and spray with a 5% sodium hypochlorite solution, ensuring at least a 20 second contact time. • Lubricate with a food grade biodegradable oil if required.	Excavation Crew	N/A

10. Facility Equipment/Parts Numbers

- See 552 Plinguet Stores and/or Supervisor for supplies

11. Related Procedures

- N/A

12. Environmental

- Avoid spilling large quantities of sodium hypochlorite into open waterways.

13. References

- AWWA C651

Appendix A: Procedure Review Form

Complete the following information and include with the proposed document revisions.

Document number	
Document name	
Existing revision #	
Proposed revision #	
Author of changes	
Summary of rationale for changes	

Route through the following personnel for review and approval.

Mark (X) all applicable	Signature	Date	Comments	Training requirements (Check if either applies)
☐ **Systems Engineer**				☐ **Hold revision until notified** ☐ **Allow _____ for training**
☐ **Operations Engineer**				☐ **Hold revision until notified** ☐ **Allow _____ for training**
☐ **Operations Supervisor**				☐ **Hold revision until notified** ☐ **Allow _____ for training**
☐ **Maintenance Supervisor**				☐ **Hold revision until notified** ☐ **Allow _____ for training**
☐ **Process Control Supervisor**				☐ **Hold revision until notified** ☐ **Allow _____ for training**
☐ **Aqueduct and Railway Supervisor**				☐ **Hold revision until notified** ☐ **Allow _____ for training**

Note: Designates may also review and comment, as required.

E14d Turbidity Readings After Watermain Repair SOP

Winnipeg
Water and Waste Department

Division		Facility	Area
Water Services		Water Distribution	Winnipeg
Creation Date	**Revision Date**	**Revision Number**	**SOP #**
May 01, 2012	Jul 15, 2014	01	
Procedure Name			
Turbidity Readings			

Controlled Document

Original Authors:

1. Tim Shanks, P.Eng. Senior Project Engineer *print name, position*	2. Jennifer Graham, Training Coordinator *print name, position*
3. _____ *print name, position*	4. _____ *print name, position*

Reviewed By:

Reviewer	1. _____ *print name, position*	YYYY	MM	DD
Safety	2. _____ *print name, position*			
Environment	3. _____ *print name, position*			

Tested By:

Tester	1. _____ *print name, position*	YYYY	MM	DD
Safety	2. _____ *print name, position*			
Environment	3. _____ *print name, position*			

Authorized By:

	1. _____	YYYY	MM	DD
	2. _____			

1. Location

- City of Winnipeg Water Distribution Facility

2. Objectives

- The purpose is to ensure that water quality in the distribution system is maintained at acceptable standards after water mains are repaired.

3. Warning

- N/A

4. Personnel Qualifications

- General Maintenance Worker Training

5. Discussion

- N/A

6. Hazards

- N/A

7. Abbreviations

ABBREVIATION DESCRIPTION		DEFINITION
AWWA	American Water Works Association	N/A
MSDS	Material Safety Data Sheet	N/A
pdf	Portable Document Format	N/A
PPE	Personal Protective Equipment	N/A
SOP	Standard Operating Procedure	Specified way to perform a routine activity (work instructions)
SWP	Safe Work Procedure	Description of all safety considerations, hazards present, and protective measures such as PPE and training which must be in place to perform a particular activity

8. Equipment and Supplies

- HACH 2100Q Portable Turbidity Meter
- Glass Turbidity Reading Vials
- Silicone oil and buffing cloth
- AA batteries
- Kimwipes

9. Prepara tion

- After repairs are complete, flush the water main towards the break, through a hydrant, until water is running clear.
- If valve and hydrant locations permit, flush towards the work from both directions.

10. Procedure

NO.	LOCATION	ACTIVITY DESCRIPTION	RESPONSIBILITY	DATA TO RECORD
1	Site of Watermain Repair	• Run the water from the venting hydrant for a minimum of 2-5 minutes. When the water runs clear take a sample and bring it to a sheltered area to perform the readings, such as the crew mobile or trailer	Excavation Crew	N/A
2	Crew mobile or trailer	PREPARE THE VIAL FOR TESTING: • Wipe down the vial with the water sample using a Kimwipe • If the vial has minor scratches put a drop of silicone oil on the vial and wipe with the buffing cloth. • If the vial has major scratches, discard and use a new vial	Excavation Crew	N/A
3	Crew mobile or trailer	VERIFY STANDARD: • Turn the turbidimeter on • Insert the 10NTU standard into the reading slot and close the lid • Press the ‘read’ button • Wait for the verification result. If the standard passes, proceed to step 4 • If the standard fails, retest, and if it fails again, notify your immediate supervisor	Excavation Crew	N/A

NO.	LOCATION	ACTIVITY DESCRIPTION	RESPONSIBILITY	DATA TO RECORD
4	Crew mobile or trailer	TEST THE WATER SAMPLE: • Place the prepared vial from step 2 into the reading slot and close the lid • Press the 'read' button. • If the reading is 5.0 NTU or less, record the number on the timecard then clean and store the turbidimeter for next use. • If the reading is 5.0 NTU or more, continue flushing and take another reading until the result is below 5.0 NTU.	Excavation Crew	Record the result as NTUs on the timecard

11. Facility Equipment/Parts Numbers

- See stores and/or Supervisor for supplies

12. Related Procedures

- N/A

13. Environmental

- N/A

14. References

- HACH 2100Q User Manual

Appendix A: Procedure Review Form

Complete the following information and include with the proposed document revisions.

Document number	
Document name	
Existing revision #	
Proposed revision #	
Author of changes	
Summary of rationale for changes	

Route through the following personnel for review and approval.

Mark (X) all applicable	Signature	Date	Comments	Training requirements (Check if either applies)
☐ **Systems Engineer**				☐ **Hold revision until notified** ☐ **Allow _____ for training**
☐ **Operations Engineer**				☐ **Hold revision until notified** ☐ **Allow _____ for training**
☐ **Operations Supervisor**				☐ **Hold revision until notified** ☐ **Allow _____ for training**
☐ **Maintenance Supervisor**				☐ **Hold revision until notified** ☐ **Allow _____ for training**
☐ **Process Control Supervisor**				☐ **Hold revision until notified** ☐ **Allow _____ for training**
☐ **Aqueduct and Railway Supervisor**				☐ **Hold revision until notified** ☐ **Allow _____ for training**

Note: Designates may also review and comment, as required.

E14e Maclean Reservoir Washing SOP

This section has been intentionally removed.

E14f P-SOP-004 West Reservoir Isolating, Draining and Refilling

This section has been intentionally removed.

E14g SOP-Slug Disinfection After Repair

Winnipeg
Water and Waste Department

Division		Facility	Area
Water Services		Winnipeg WD4	
Creation Date	**Revision Date**	**Revision Number**	**SOP #**
14-Nov-2014			
Procedure Name			
Slug Disinfection After Repair			

Controlled Document

Original Authors:

1. Louis Rivard, Supervisor M/H/V/S *print name, position*	2. Jennifer Graham, Cert & Training Coordinator *print name, position*
3. _____ *print name, position*	4. _____ *print name, position*

Reviewed By:

Reviewer	1. _____ *print name, position*	YYYY	MM	DD
Safety	2. _____ *print name, position*			
Environment	3. _____ *print name, position*			

Tested By:

Tester	1. _____ *print name, position*	YYYY	MM	DD
Safety	2. _____ *print name, position*			
Environment	3. _____ *print name, position*			

Authorized By:

	1. _____	YYYY	MM	DD
	2. _____			

1. Location

- in COW WD4 Facility

2. Objectives

-

3. Warning

- Without keeping the flow rate consistent at 66.6LPM you run the risk of insufficient contact time for disinfection

4. Personnel Qualifications

- B2, MB Provincial Level 2 WD Certification

5. Discussion

-

6. Hazards

- PPE (for chlorine) must be worn prior to job commencing: gloves, face protection
- Refer to MSDS for Clorox and for Vita-D-Chlor associated hazards

7. Abbrev iations

ABBREVIATION	DESCRIPTION
AWWA	American Water Works Association
ESOP	Emergency Special Operating Procedure
JHA	Job Hazard Analysis
O&M	Operations and Maintenance
pdf	Portable Document Format
PPE	Personal Protective Equipment
SOP	Standard Operating Procedure
SWP	Safe Work Procedure
WTP	Water Treatment Plant

8. Equipment and Supplies

- Water tank
- Sodium hypochlorite (household bleach)
- Hose Monster diffuser
- Dechlorination equipment and supplies
- Colorimeter and Turbidimeter
- Free chlorine test kit
- Slug insertion pump
- Water meter (is there any other equipment available to us to measure flowrate??)

9. Prepara tion

- Lead operator shall conduct a tailgate meeting before the activities begin and shall inform all parties on the procedure being performed.

PROCEDURE DEFINITIO	N
ESOP	Emergency Special Operating Procedure: • Instruction for an operational activity to be performed as immediate disaster prevention or recovery
JHA	Job Hazard Analysis: • Process that breaks down the job or task into steps and identifies the hazards in each step so that controls or procedures can be identified to mitigate or stop the hazard • JHA should be performed for all jobs in order of priority, new jobs, new processes, new equipment, after an incident occurs, and for infrequent jobs
O&M manual reference	Operations and Maintenance manual reference documents: • Overarching guidance to O&M manuals for particular groups of equipment or processes
SOP	Standard Operating Procedure: • Specified way to perform a routine activity (work instructions)
SWP	Safe Work Procedure: • Description of all safety considerations, hazards present, and protective measures such as PPE and training which must be in place to perform a particular activity • Examples of SWP are Fall Arrest, Lockout-Tagout (LOTO), Work Alone, and Confined Entry

10. Procedure

NO.	LOCATION	ACTIVITY DESCRIPTION	DURATION / TIME	RESPONSIBILITY	DATA TO RECORD
1		• Initial preparation and site visit: o List affected appurtenances and service connections o Notify any affected customers of pending watermain disinfection			
2		• Prepare data: o Choose an entry and exit point for the slug o Calculate volumes of pipes involved o Determine overall duration of slug contact time o Consider site specific conditions requiring further procedures o			
3		• Prepare the site for slug insertion			
4		• Flush the section of affected pipe: o Flush long enough for 2-3 complete changes in water within the pipeline o (Refer to flushing tables)			

NO.	LOCATION	ACTIVITY DESCRIPTION	DURATION / TIME	RESPONSIBILITY	DATA TO RECORD
5		• Prepare slug of 300mg/L sodium hypochlorite • (picture of set up) • Make WHMIS label • Lock the draw • Make training aid with the mix instructions			
6		• Set up equipment at slug insertion point			
7		• Set up dechlorination equipment and sampling station at slug exit point			
8		• Insert slug no greater than a rate of 90 LPM			
9		• Test water at exit point sampling station to determine when the slug has passed			

NO.	LOCATION	ACTIVITY DESCRIPTION	DURATION / TIME	RESPONSIBILITY	DATA TO RECORD
10		• Increase flow rate to flushing velocity of 2.5 feet/sec or 0.8m/s			
11		• After chlorination resume flushing and test water until residual chlorine concentration is no higher than the prevailing water in the distribution system or that which is acceptable for domestic use. o Record results			
12		• Take bacteriological samples and submit to Environmental Standards for testing (ideally lab personnel will be on site)			
13		• Return portion of pipe into service (?or do we wait for lab results first?).			
14		•			
15		•			

Water and Waste Department

Division		Facility	Area
Water Services		Winnipeg WD4	
Creation Date	**Revision Date**	**Revision Number**	**SOP #**
14-Nov-2014			
Procedure Name			
Slug Disinfection After Repair			

Controlled Document

NO.	LOCATION	ACTIVITY DESCRIPTION	DURATION / TIME	RESPONSIBILITY	DATA TO RECORD
16		•			
17		•			
18		•			

Water and Waste Department

Division		Facility	Area
Water Services		Winnipeg WD4	
Creation Date	**Revision Date**	**Revision Number**	**SOP #**
14-Nov-2014			
Procedure Name			
Slug Disinfection After Repair			

Controlled Document

NO.	LOCATION	ACTIVITY DESCRIPTION	DURATION / TIME	RESPONSIBILITY	DATA TO RECORD
19					

11. Facility Equipment/Parts Numbers

-

12. Related Procedures

-

13. Environmental

- Prevent large spills from entering drains and waterways

14. References

- AWWA Standard 651

Appendix A: Procedure Review Form

Complete the following information and include with the proposed document revisions.

Document number	
Document name	
Existing revision #	
Proposed revision #	
Author of changes	
Summary of rationale for changes	

Route through the following personnel for review and approval.

Mark (X) all applicable	Signature	Date	Comments	Training requirements (Check if either applies)
☐ **Water Distribution Engineer**				☐ **Hold revision until notified** ☐ **Allow _____ for training**
☐ **Superintendent of Water Distribution**				☐ **Hold revision until notified** ☐ **Allow _____ for training**
☐ **Excavation Supervisor**				☐ **Hold revision until notified** ☐ **Allow _____ for training**
☐ **Hydrant/Valves/ Meters/Services Supervisor**				☐ **Hold revision until notified** ☐ **Allow _____ for training**
☐ **Training &Cert Coordinator**				☐ **Hold revision until notified** ☐ **Allow _____ for training**
☐ **Emergency Services Supervisor**				☐ **Hold revision until notified** ☐ **Allow _____ for training**

Note: Designates may also review and comment, as required.

E14h Reservoir Maintenance SOP

SAFE WORK PROCEDURE
Water Reservoir Maintenance

This Task may only be performed by trained Water Services Personnel

Facility	Author	Creation Date	Revision Date	SWP Number
Stations		Oct 26/07	Mar 11/15	S-SWP-001

Hazards Present	Personal Protective Equipment (PPE)	Additional Training Requirements
• Falling or slipping • Drowning • Air quality • Fall hazard • Electrical	• Atmospheric Tester and Monitor • Portable Ventilation Equipment • Personal Protective Equipment • Full Body Harness • Ground Fault Interrupters (GFI) for electric tools • Explosion Proof Lighting • Two-Way radios • Flash Lights for power failures • SCBA if required	• W-SWP-001 PPE • Emergency and Evacuation Procedures • Confined Entry Procedures • Valid First Aid • Instrument Training • Chemical Handling

Protective Measures / Required Steps

CONFINED ENTRY PROCEDURES

All new employees will take a Confined Entry Procedure course offered by the City of Winnipeg. As well, refresher training may be offered as new employees are hired and for the purposes of updating this procedure. The following confined entry procedure shall apply:

1. Properly Lock and tag energy source before entering (water supply)
2. A multiple gas tester will be used to ensure that the reservoir is free of toxic gases; that the oxygen level is in an acceptable range and is safe for entry
3. Recommended one person will remain within the immediate area of the reservoir to act as Safety/Standby Personnel (among other duties) in case of an emergency using communication with staff in reservoir
4. A confined Entry Permit" needs to be completed and posted at the entrance
5. When safe to enter do so (using uni-hoist with harness)
6. Continuous monitoring is required while work is performed, ventilate if required

DISINFECTION OF EQUIPMENT AND CONTACT SURFACES BEFORE ENTRY

All equipment and contact surfaces on personnel attire must be disinfected prior to entry into the reservoir as follows. Prepare a solution of > 200 mg/L available chlorine solution in a spray bottle by collecting 40 mL of 0.8% sodium hypochlorite from the WTP chemical storage system and diluting with 760 mL of water. Be sure to label the spray bottle with a WHMIS workplace label. Use this spray on all surfaces which will enter the reservoir, immediately prior to entry. For example, all footwear surfaces, hoses, wheels of carts, tools, and containers should be sprayed before entry into the reservoir

EMERGENCY AND EVACUATION PROCEDURES

An appropriate number of safety/standby employees (a minimum of one) trained in First Aid (CPR) and rescue procedures must be in attendance and continuously monitor the employee(s) in the confined space. At all times, the safety/standby employee must be prepared and be appropriately equipped to carry out a rescue. In the event of an emergency or rescue the following shall apply:

1. When the two way radios are used, request for medical assistance in case of an accident can be made immediately. The Ambulance or Fire Department will be called directly using the closest phone in the Reservoir. Phone Deacon WTP Control Room or call **911**
2. If the accident is not life threatening, first aid would be administered at the location and the injured worker would not be moved until Fire Dept or Ambulance has arrived

ALWAYS CONSIDER CONFINED SPACES TO BE IMMEDIATELY DANGEROUS TO LIFE AND HEALTH (IDLH)

If an emergency situation occurs while conducting this task call Control Room via radio or at or 911.

REPORT ANY HAZARDOUS SITUATIONS TO YOUR SUPERVISOR

Guidance Documents / Standards / Applicable Legislation / Other

Guidance Documents

- N/A

Manitoba Workplace Safety and Health Regulation, M.R. 217/2006

- 2.1 Safe Work Procedures
- 6.13 Eye and Face Protectors
- 8.1 Musculoskeletal Injuries
- Part 15 Confined Spaces
- 16.4 Machine and Tool Safety

Supervisor Responsibility

- Provide all staff with proper equipment, training and tools
- Ensure that all safe work practices are followed
- Offer refresher training as new employees are hired
- Review procedure any time the task, equipment, or materials change, or at a minimum every three years. Correct deficiencies as required
- Ensure a first aid kit is on site
- Ensure employees have First Aid (CPR) training and renew their training every three years

Worker Responsibility

- Follow Safe Work Procedure. Ask Supervisor for clarification as required
- Wear appropriate personal protective equipment
- Report any hazardous situations or injuries to your supervisor

E14i SWP-WS-LS-Repairing a Water Main Break or Leak-01 of 09-Investigating and Controlling New Leaks

Winnipeg
Embrace the Spirit.

SAFE WORK PROCEDURE

Job Name: Repairing a Water Main Break
Task #: 01 of 09
Activity: Investigating and Controlling New Leaks

This Task may only be performed by trained personnel

Division/Branch/Area/Crew:	Approved by:	Creation Date:	Revision Date:
Water Services/Local Services	T. Shanks, P.Eng	02 09 2010	Mar 19 2014

Hazards Present:	Personal Protective Equipment (PPE)	Personnel Training Requirements:
• MSI strains to body, • Heat/ cold stress • Slips/falls, • Violence towards workers • Local traffic concerns • Local animals • Paint Inhalation	**Or devices required** • Work Safety Gloves • CSA approved Safety Glasses • CSA approved Safety Work Boots • CSA approved Hard Hats • High Visibility Reflective Vests • All Weather Clothing	Skilled Maintenance Worker Level B2 Job Class Training

Safe Work Procedure

Training
Supervisors are responsible for the training of all personnel who are involved in repairing a water main break.

This procedure is to be followed when investigating and controlling new leaks.

All employees will be trained on proper use before doing this task. As well, refresher training may be offered as new employees are hired and for the purposes of updating this procedure. The following procedures for investigating and controlling new leaks shall be followed;

Don personal protective equipment before beginning the task. Ensure clothing fits appropriately (tight fitting) and always dress appropriately for weather conditions.

Follow all traffic/pedestrian rules and bylaws. Ensure proper traffic control has been set up prior to beginning work.

If doing this task during the winter season, avoid walking over ice and use the short spade shovel to break up snow and ice covered area/equipment.

Sand the work area if it is ice-covered or thought to be slippery. Inspect all tools/materials prior to use before beginning procedure. If any broken or defective equipment is found, do not use and remove from service immediately.

Note: Signs and symptoms of a musculoskeletal injury (MSI) can include pain, burning, swelling, numbness/ tingling, color changes, and loss of movement or strength in a body part. The worker should inform their supervisor and/ or the Safety and Health committee if they are experiencing these or other signs and symptoms so steps can be taken to avoid making the conditions worse.

1. Set up all traffic barriers/signage to reduce traffic to the area. Block off street/ worksite if it is substantially flooded and investigate the potential source of the water main break/leak.
2. Use electronic locator to find service box valve cover, install the valve key and use both hands to close the valve and shut off the water. Do not jerk the key as this can damage the valve stem. If the turn key is difficult to move, get help from a co-worker with one person to push and the other to pull the rotate valve to open/close it.
3. Determine if the water is still rising up out of the ground or if it has ceased.
4. Using the computer on the service truck and its main water mapping system, locate the water main valves. Drive the vehicle slowly through the water (and ice - winter). Use the electronic locator to find valve covers and expose the valve cover (in the winter you must shovel it out). Use the short spade to reduce strains to the body and bend at the knees when shovelling while keeping a firm grip on the handle
5. Open the valve cover with either the frost-bar (winter) or another prying tool keeping a firm grasp on the handle.
6. Control the leak by shutting off the water main valves on either side of the area of the (suspected) leak and close the valves and paint the covers blue. If the valves are frozen you will need to thaw them with the boiler unit/steamer hose located on the supply truck. If this is necessary ensure that you keep your hands and feet away from the steamer end of the steam hose and always point the steamer end at the ground. Never leave the steam hose unattended.
7. Shut off the valves with the valve key by closing the valves slowly. Use both hands when turning the key. If the valve key is difficult to move, get help from a co-worker with one person to push and the other to pull the rotate valve to open/close it.
8. Locate the fire hydrant and bleed out any pressure from the isolated part of the water main system. Use the hydrant wrench key by gripping it near the end of the handle for better torque to remove the service cap and install the gate valve to control the hydrants water flow. Stand clear of the water escaping from the valve.
9. Using the radio connection and the bib-tap, trace the services believed to be near the suspected leak and spray paint the location of the service line blue. Always try to inform the resident before entering their yard and ensure there are no aggressive animals prior to proceeding onto residential property. When spray painting, hold the aerosol nozzle as close as possible to the desired area and stay down wind of the spray if possible.
10. Once the water leak has been isolated, proceed to inform home owners that the water has been shut off. Do not go to homes where pets/animals appear aggressive.
11. Visually inspect the street to confirm the condition from the water main break. If you need to walk out, stay away from the deeper water and follow the sidewalks to maintain footing if possible.
12. Pump out the excess water in the fire hydrant using a gas powered pump (supply truck) draining it into the nearest catch basin. Ensure good ergonomics are used when lifting heavy materials.
13. Fill out required report while on-site and phone dispatch to send out the required services (i.e. sanding truck, temporary water supply, fire hydrant services) to the leak site.

First aid
Every employee will be trained in First Aid (CPR) and will renew their training every three (3) years on a regular basis. A first aid kit must be on site at all times.

Work requirements when investigating and controlling new water main leaks:

1. All safety equipment as stated above.
2. Qualified and trained operators.
3. Work area is clear of all hazards.

If an emergency situation occurs while conducting this task call 911, or there is an equipment malfunction, engage emergency stop and follow the lock out procedure.

REPORT ANY HAZARDOUS SITUATIONS TO YOUR SUPERVISOR

Guidance Documents/ Standards / Applicable Legislation / Other:

Workplace Safety and Health Act W210
Manitoba Regulation 217/2006

- 2.1 Safe Work Procedures
- 5 First Aid
- 6 Personal Protective Equipment
- 8 Musculoskeletal injuries
- 10 Harassment
- 11 Violence in the Workplace
- 20 Vehicular and Pedestrian Traffic
- 22 Powered Mobile Equipment
- 35 Workplace hazardous Materials Information Systems
- 36 Chemical and Biological Substances

Supervisor Responsibility

Supervisors are responsible to provide all staff with proper instruction, equipment, and tools. Supervisors are responsible to ensure that all safe work practices are followed.

Worker Responsibility

Follow Safe Work Procedure
Wear appropriate PPE
This Procedure will be reviewed any time the task, equipment, or materials change, or at a minimum every three years.

E14j SWP-WS-LS-Repairing a Water Main Break or Leak-02 of 09-Clearances for Excavation Area

Winnipeg
Embrace the Spirit.

SAFE WORK PROCEDURE

Job Name: Repairing a Water Main Break or Leak
Task #: 02 of 09
Activity: Clearances for Excavation Area

This Task may only be performed by trained personnel

Division/Branch/Area/Crew:	Approved by:	Creation Date:	Revision Date:
Water Services/Local Services	T. Shanks, P.Eng	01 29 2010	Mar 19, 2014

Hazards Present:	Personal Protective Equipment (PPE)	Personnel Training Requirements:
• Hot /Cold environments • Slippery surfaces • Traffic • Paint inhalation	**Or devices required** • Safety Glasses • All weather clothing • Work Boots • Work Gloves • Hard Hats • Reflective Vests	Skilled Maintenance Worker Level A Job Class Training

Safe Work Procedure

Training
Supervisors are responsible for the training of all personnel who are involved in repairing a water main break.

This procedure is to be followed when obtaining clearances for an excavation area.

All employees will be trained on proper use before doing this task. As well, refresher training may be offered as new employees are hired and for the purposes of updating this procedure. The following procedures for obtaining clearances for an excavation area shall be followed;

Don personal protective equipment before beginning the task. Ensure clothing fits appropriately (tight fitting).

Follow all traffic/pedestrian rules and bylaws. Ensure proper traffic control has been set up prior to beginning work.

Sand the work area if it is ice-covered or thought to be slippery. Inspect all tools/materials prior to use before beginning procedure. If any broken or defective equipment is found, do not use and remove from service immediately.

Note: Signs and symptoms of a musculoskeletal injury (MSI) can include pain, burning, swelling, numbness/ tingling, color changes, and loss of movement or strength in a body part. The worker should inform their supervisor and/ or the Safety and Health committee if they are experiencing these or other signs and symptoms so steps can be taken to avoid making the conditions worse.

1. Drive to the site location and identify the service point required with the electronic locator. If the service point needs to be physically uncovered, ensure a good grip on the shovel and use good ergonomics (bend at the knees) to get close to the area. Use the PC computer/maps of service for measuring references.
2. Paint the ground with blue paint to mark the area to identify service boxes and points for other crews who may come to the site. Hold the aerosol nozzle as close as possible to the desired area and stay downwind of the spray if possible.
3. Identify utilities that are at or may affect the service point or excavation. Always phone the appropriate utility to come out and perform their service.
4. Prepare the cut area for excavation. Phone Local Services to remove existing trees or to clear the site of any debris.
5. Prepare a completed report of the utilities that have been identified and submit to the office in order for the excavation permit and to begin work.

First aid
Every employee will be trained in First Aid (CPR) and will renew their training every three (3) years on a regular basis. A first aid kit must be on site at all times.

Work requirements when obtaining clearances for an excavation area:

1. All safety equipment as stated above.
2. Qualified and trained operators.
3. Work area is clear of all hazards.

If an emergency situation occurs while conducting this task call 911, or there is an equipment malfunction, engage emergency stop and follow the lock out procedure.

REPORT ANY HAZARDOUS SITUATIONS TO YOUR SUPERVISOR

Guidance Documents/ Standards / Applicable Legislation / Other:
Workplace Safety and Health Act W210
Manitoba Regulation 217/2006

- 2.1 Safe Work Procedures
- 5 First Aid
- 6 Personal Protective Equipment
- 8 Musculoskeletal injuries
- 20 Vehicular and Pedestrian Traffic
- 35 Workplace hazardous Materials Information Systems
- 36 Chemical and Biological Substances

Supervisor Responsibility

Supervisors are responsible to provide all staff with proper instruction, equipment, and tools. Supervisors are responsible to ensure that all safe work practices are followed.

Worker Responsibility

Follow Safe Work Procedure
Wear appropriate PPE
This Procedure will be reviewed any time the task, equipment, or materials change, or at a minimum every three years.

E14k SWP-WS-LS-Repairing a Water Main Break or Leak-03 of 09-Testing for the Leak with Test Truck

Winnipeg
Embrace the Spirit.

SAFE WORK PROCEDURE

Job Name: Repairing a Water Main Break or leak
Task #: 03 of 09
Activity: Testing for the Leak with Test Truck

This Task may only be performed by trained personnel

Division/Branch/Area/Crew:	Approved by:	Creation Date:	Revision Date:
Water Services/Local Services	T. Shanks, P.Eng	02 22 2010	Mar 19, 2014

Hazards Present:	Personal Protective Equipment (PPE)	Personnel Training Requirements:
• Oncoming Traffic • Extreme Weather Conditions (cold, rain, heat) • Slips and trips • Moving machinery parts • Musculoskeletal Injury Hazards • Paint absorption/ Inhalation • Compressed Air	**Or devices required** • N95 dust mask/ respirator • High visibility reflective clothing • CSA approved hard hat and steel toe footwear • CSA approved safety glasses • Hearing protection • Clothing appropriate for weather conditions	Skilled Maintenance Worker Level C2 Job Class Training

Safe Work Procedure

Training
Supervisors are responsible for the training of all personnel who repair water main breaks or leaks.

This procedure is to be followed when testing for leaks with the test truck.

All employees will be trained on proper use before doing this task. As well, refresher training may be offered as new employees are hired and for the purposes of updating this procedure. The following procedures for testing for leaks with the test truck shall be followed;

Don personal protective equipment before beginning the task. Ensure clothing fits appropriately (tight fitting). A Hard hat and required PPE must be worn at all times.

Follow all traffic/pedestrian rules and bylaws. Ensure proper traffic control has been set up prior to beginning work.

Sand the work area if it is ice-covered or thought to be slippery. Inspect all tools/materials prior to use before beginning procedure. If any broken or defective equipment is found, do not use and remove from service immediately.

Note: Signs and symptoms of a musculoskeletal injury (MSI) can include pain, burning, swelling, numbness/ tingling, color changes, and loss of movement or strength in a body part. The worker should inform their supervisor and/ or the Safety and Health committee if they are experiencing

these or other signs and symptoms so steps can be taken to avoid making the conditions worse.

1. Drive to the leak location, verify traffic control has been set, if not, call for a traffic control service crew to come to the site and set up before work begins. Read and understand utility clearance documentation. Keep clearance sheets on site.
2. Locate the water main and measure the distance between the valve and the sidewalk. If the sidewalk is snow/ice covered, measure the distance between the valve and the street curb. If you must walk through deep water that has been leaking, walk slowly and carefully.
3. Locate the area to be drilled and using the measurement from step 2, measure the drill spot. In winter you can mark the spot with a pry bar or hammer and use the hammer to lightly tap on the drill spot if it is covered in ice. Use a pry bar or shovel to create a divot in the boulevard. Bend your knees, keep your back straight and avoid using quick jerky movements when using the pry bar. If the drill spot is on the road mark the area with a dot of blue spray paint, holding the aerosol nozzle as close as possible to the desired area and staying downwind of the spray if possible.
4. Position the drill truck right in front of the drilling area. One worker should stand beside the drill truck to guide the driver while other workers perform traffic control if the drill truck needs to leave the construction site to reposition. Traffic controllers should use a handheld stop sign and stand more to one side of the road avoiding the middle if possible. When moving the drill truck, ensure the drill arm is in the down position and keep the truck as level as possible to the ground to reduce the risk of missing the water main and having to drill again.
5. Before turning the drill on ensure that all levers and turn-crank handles that activate the drill are in the “off” or “inactive” position and that no one is in or around the area when the drill is powered up. Turn the drill on. If drill parts begin to move or activate, turn the drill off immediately and turn levers and crank handles off.
6. Ensure all persons are clear of the drill truck and extend the drill boom arm up and outwards with the black levers at the rear of the truck. Keep your body, hair and loose clothing away from the drill bit while working near it and DO NOT wave your hand under the drill bit while it is rotating.
7. Verify that workers are clear of the drill bit when it is entering or exiting the ground. Drill a hole that reaches the top of the water main. Remove and re-insert the drill bit from the ground every few feet that have been drilled. When removing the drill bit deactivate it from rotating and pour water into the drilled hole to help the drill to churn up the ground. Once a depth has been reached that is close to the water main, slowly lower the drill. Stop drilling when the water main has been reached and remove the drill bit from the ground and lower the drill boom arm back into the truck. Never touch the drill bit under any circumstances if it is powered on.
8. Sand the working area if necessary to allow for better traction. Insert test rods into the drilled hole until the main is contacted. If the main can not be contacted with a straight rod, use a rod that has been bent, then attempt to contact the main. When pulling the rod out of the hole grasp it with both hands at waste height. Keep your back straight and bend your legs when pulling the rod out of the hole. Get help from a co-worker to pull and push the rod when possible. Watch how you handle the rod so that you don’t hit any one while turning or carrying it.
9. Listen for the leak at every rod that has been inserted with an aqua phone or digital aqua phone. The loudest rod should determine that the leak is on that part of the main. Spray paint the drilled hole blue above the section of the main that is suspected to be leaking. When spray painting hold the aerosol nozzle as close as possible to the desired area and stay downwind of the spray if possible.
10. Remove all test rods from the drilled hole and place them back into the drill truck.
11. Drive to the next job or back to the office ensuring you follow all traffic rules and bylaws.

First aid
Every employee will be trained in First Aid (CPR) and will renew their training every three (3) years on a regular basis. A first aid kit must be on site at all times.

Work requirements when testing for leaks with the test truck:

1. All safety equipment as stated above.
2. Qualified and trained operators.
3. Work area is clear of all hazards.

If an emergency situation occurs while conducting this task call 911, or there is an equipment malfunction, engage emergency stop and follow the lock out procedure.

REPORT ANY HAZARDOUS SITUATIONS TO YOUR SUPERVISOR

Guidance Documents/ Standards / Applicable Legislation / Other:

Workplace Safety and Health Act W210
Manitoba Regulation 217/2006

- 2.1 Safe Work Procedures
- 5 First Aid
- 6 Personal Protective Equipment
- 8 Musculoskeletal injuries
- 12 hearing Conservation and Noise Control
- 20 Vehicular and Pedestrian Traffic
- 22 Powered Mobile Equipment
- 26 Excavations and Tunnels
- 35 Workplace hazardous Materials Information Systems
- 36 Chemical and Biological Substances

Supervisor Responsibility

Supervisors are responsible to provide all staff with proper instruction, equipment, and tools. Supervisors are responsible to ensure that all safe work practices are followed.

Worker Responsibility

Follow Safe Work Procedure
Wear appropriate PPE
This Procedure will be reviewed any time the task, equipment, or materials change, or at a minimum every three years.

E14l SWP-WS-LS-Repairing a Water Main Break or Leak-04 of 09-Repairing the Water Main

Winnipeg
Embrace the Spirit.

SAFE WORK PROCEDURE

Job Name: Repairing a Water Main Break or Leak
Task #: 04 of 09
Activity: Repairing the Water Main

This Task may only be performed by trained personnel

Division/Branch/Area/Crew:	Approved by:	Creation Date:	Revision Date:
Water Services/Local Services	T.Josephson	01 22 2010	Mar 19, 2014

Hazards Present:	Personal Protective Equipment (PPE) Or devices required	Personnel Training Requirements:
• Working in and around open excavations. • Water/ Waste Engulfment • Trips, Slips & Falls • Improper Lifting • Musculoskeletal Injury • Confined Space Entry • Extreme Cold (winter) • Heavy Mobile Equipment • Slippery Ground • Oncoming Traffic • Paint absorption	• Shoring cage, plywood & planks • CSA approved Hardhat, Safety Glasses/Face Shield, and Steel-toe Footwear (ice cleats when slippery) • Chainsaw chaps/pants • High Visibility Standard Issue Clothing (Winter & Summer Wear) • Hearing Protection • Full Body Harness • Clothing Appropriate for Weather Conditions	Skilled Maintenance Worker Level B2 Job Class Training

Safe Work Procedure

Training
Supervisors are responsible for the training of all personnel who repair a water main break or leak. This procedure is to be followed when repairing the water main. All employees will be trained on proper use before doing this task. As well, refresher training may be offered as new employees are hired and for the purposes of updating this procedure. The following procedures for repairing the water main shall be followed:

Don personal protective equipment before beginning the task. Ensure clothing fits appropriately (tight fitting). All workers in and around the excavation area must wear all required PPE at all times.

All workers are to be aware of the backhoe at all times. Workers walking in and around the excavation vicinity should ensure eye contact with the backhoe operator to establish their presence. The backhoe operator must ensure all workers are clear from the backhoe's range of motion before moving or operating the machinery.

Follow all traffic/pedestrian rules and bylaws. Ensure proper traffic control has been set up prior to beginning work.

Sand the work area if it is ice-covered or thought to be slippery. Inspect all tools/materials prior to use before beginning procedure. If any broken or defective equipment is found, do not use and remove from service immediately.

Note: Signs and symptoms of a musculoskeletal injury (MSI) can include pain, burning, swelling, numbness/ tingling, color changes, and loss of movement or strength in a body part. The worker should inform their supervisor and/ or the Safety and Health committee if they are experiencing these or other signs and symptoms so steps can be taken to avoid making the conditions worse

1. Ensure the Workplace Safety and Health division is notified that work will be performed in an excavation within 48 hours before the day of excavation work OR as soon as reasonably possible before the excavation occurs. Monday to Friday 8-4:30 (Tel: 204-945-3446) After hours, weekends and Holidays (Tel: 204-945-0581)
2. Ensure the excavation area is properly barricaded from traffic/public and that proper street signage is in place. Draw the excavation area with blue spray paint around the designated drilled holes from the test truck crew. Hold the aerosol nozzle as close as possible to the desired area and upwind of the spray if possible.
3. All workers in and around the excavation area must wear all PPE at all times. Ensure all clearances for underground utilities have been marked before beginning to dig. All clearance papers must be on site and up to date. Jack hammer the designated digging area with the backhoe using extreme caution when working under overhead utilities (power lines). If the backhoe comes into contact with an energized overhead electrical line, the worker in the backhoe should remain inside until help can arrive. If backhoe operator must evacuate the machine, then they should jump clear of the backhoe so that no part of their body touches a part of the backhoe and the ground at the same time.
4. Ensure backhoe has all stabilizers engaged when excavating and that all workers are outside the excavator arm's range of motion and are in the backhoe operators line of sight at all times when in operation. Excavate loosened debris in the digging area with the backhoe. Dump Truck must be at least 1m from excavation. Dump the excavated material into a dump truck box. If excavating without Dump Truck, spoil pile must be at least 1m from excavation. Continue to jack hammer and excavate until you are close to where the water main is located.
5. Stand a few feet back from the edge of the excavation and find the water main by probing with a test rod. Ensure a good ergonomic stance and avoid overreaching. The backhoe operator should rest the excavator arm on the ground, lock out controls and sit away from all controls while the worker outside probes for the main.
6. If Necessary, open the water main valve a small amount to locate the exact spot the leak is originating from (if necessary get a cut on the key). While turning the service key to close valve, use both hands, one on each side of the T at the top and push with one hand and pull with the other to increase force on key rotating valve open or closed. Two workers may operate the valve key to increase the force; one to push and one to pull to rotate the valve open or closed. Do not jerk key on valve stem as this can damage valve stem stripping drive or breaking it off.
7. Close the valve again once leak is spotted, remove the key and place it back into the service truck. Ensure no worker or person is inside the excavation when the valve is to be turned open and that the valve is locked out by removing and placing the valve key inside the service truck. NEVER leave the key on the valve unattended anytime.
8. Retrieve the gas water pump from the service truck trailer. Have two workers bring the pump to the excavation, attach the pump intake hose and discharge hose. The discharge hose should be positioned out of the walking path of workers and a few feet away from the excavation. Roll out the discharge hose into a catch basin, drop the intake hose into the water in the excavation and start the pump. Pump the excess water out of excavation.
9. Once the water main has been cleared of debris install a trench cage according to engineer's specifications, City of Winnipeg manual on shoring procedures, and "Installing and Removing Trench Cages" SOP/JHA/SWP. If a worker is required or permitted to enter an excavation that is more than 1.5m deep, a support structure must be installed. If an

excavation is 1.5m deep or less but there is danger of a cave-in, collapse or material sliding or rolling into the excavation, a support structure must be installed. Reference MR 217/ 2006 for exceptions to this statement. DO NOT enter excavation on any circumstance without proper shoring system in place.

10. One worker will enter the excavation by ladder while another worker is designated to retrieve equipment/tools for the worker in the excavation. The ladder must extend 1m above the top of the excavation and located no more than 3m from the worker in the excavation. The backhoe must not be driven, operated or located next to the excavation so that it endangers the stability of the walls of the excavation. When an excavation is more than 1.5m deep, a competent person must be located at the surface of the excavation to alert the worker inside the excavation of any potentially unsafe condition and provide assistance in an emergency. The worker in the excavation must also be in direct communication with the watchperson at the top of the excavation and their safety equipment must also be rigged so that the worker can be immediately removed from the excavation if a hazardous situation occurs.
11. Verify that all excess water has been pumped out or is being pumped out of the excavation and manually dig and expose the water main of mud/debris with a spade shovel. Dig about 1m or more in length around the leak point. Dig to make room for the clamps or couplings that will be installed. Workers should stand on a piece of wood packing so their feet don't stick in the mud in the event they need to vacate the excavation immediately. Worker must always stay in the support structure when working inside the excavation (if trench cages are used, then work must be done inside the trench cage).
12. Using a hatchet, file, or scrapers; de-scale the section of the water main that will be repaired. If the water main is suspected/confirmed to be AC pipe allow the contractors to de-scale and cut the pipe or continuously wet the pipe while de-scaling and wear an appropriate respirator rated for asbestos fibre. Smooth the main with a wet rag by removing the entire grade. If rags were used on AC pipe, treat and dispose them as exposed to asbestos.
13. The worker must exit the excavation prior to clamps being lowered via rope or excavation bucket. Install the clamp over a small hole in the water main and insert wood packing beneath the clamp for support (use a hammer to tap the packing into place, keeping your fingers and hands away from the contact point). Ensure the packing is solid and is supporting the water main.
14. Using a quickie saw and proper PPE, cut out the section of the main that needs to be replaced and cut the section of PVC pipe for the repair. Ensure no workers are standing down from or in the path of a piece of cut water main pipe that may roll in the excavation. Always cut the pipe by standing to the side of the cut with the stable/supported water main pipe. If pipe is suspected/confirmed to be AC, continuously wet the pipe and use AC pipe cutters to cut the pipes.
15. Install a new section of PVC pipe on the water main. Have workers up top lower the cut PVC pipe down with 2 couplings to the worker in the hole. Then remove the cut piece of water main pipe from the excavation. If the materials are large/heavy then the backhoe must be used to lower/remove pipe and worker must exit the excavation before this is done. Ensure proper graded chain is used for the weight of the material being moved.
16. Install the couplings and new PVC pipe to the water main. Never stand downhill of the coupling even during the lift. Handle/lift the couplings from its silver fastener screws on the outside of the coupling keeping fingers clear of the pinch points between the water main and the inside lip of the coupling.
17. Once the main has been repaired, remove all materials, tools, and excavation caging (See Installing and Removing trench Cages SOP/JHA). Practice safe lifting techniques, small materials/tools can be placed in a bucket and lifted by rope. Maintain a 3 point contact when climbing the ladder.
18. Backhoe operator will verify that all workers are outside of the excavator arm's range of motion and backfill the repaired section of the water main to weigh it down if necessary.
19. Visually inspect the water main from the outside of the excavation to determine the integrity

of the repair. Charge the system (refer to Charging the System SOP/JHA)

First aid
Every employee will be trained in First Aid (CPR) and will renew their training every three (3) years on a regular basis. A first aid kit must be on site at all times.

Work requirements when repairing the water main:

1. All safety equipment as stated above.
2. Qualified and trained operators.
3. Work area is clear of all hazards.

If an emergency situation occurs while conducting this task call 911, or there is an equipment malfunction, engage emergency stop and follow the lock out procedure.

REPORT ANY HAZARDOUS SITUATIONS TO YOUR SUPERVISOR

Guidance Documents/ Standards / Applicable Legislation / Other:

Workplace Safety and Health Act W210
Manitoba Regulation 217/2006

- 2.1 Safe Work Procedures
- 5 First Aid
- 6 Personal Protective Equipment
- 8 Musculoskeletal injuries
- 12 hearing Conservation and Noise Control
- 13 Entrances, Exits, Stairways and Ladders
- 14 Fall Protection
- 20 Vehicular and Pedestrian Traffic
- 22 Powered Mobile Equipment
- 25 Work in the Vicinity of Overhead Electrical Lines
- 26 Excavations and Tunnels
- 35 Workplace hazardous Materials Information Systems
- 36 Chemical and Biological Substances

Supervisor Responsibility

Supervisors are responsible to provide all staff with proper instruction, equipment, and tools. Supervisors are responsible to ensure that all safe work practices are followed.

Worker Responsibility

Follow Safe Work Procedure
Wear appropriate PPE
This Procedure will be reviewed any time the task, equipment, or materials change, or at a minimum every three years.

E14m SWP-WS-LS-Repairing a Water Main Break or Leak-05 of 09-Installing and Removing Trench Cages

Winnipeg
Embrace the Spirit.

SAFE WORK PROCEDURE

Job Name: Repairing a Water Main Break or Leak
Task #: 05 of 09
Activity: Installing and Removing Trench Cages

This Task may only be performed by trained personnel

Division/Branch/Area/Crew:	Approved by:	Creation Date:	Revision Date:
Water Services/Local Services	T. Josephson	02 22 2010	Mar 19, 2014

Hazards Present:	Personal Protective Equipment (PPE) Or devices required	Personnel Training Requirements:
• Trips, slips and falls • Struck by traffic • Improper lifting • Musculoskeletal Injuries • Confined Entry Conditions • Ground Collapse • Water/ Waste Water Engulfment	• CSA approved hard hat and steel toe footwear • CSA approved safety glasses • Hearing protection • Gloves • High visibility reflective clothing • Confined entry equipment as required	Skilled Maintenance Worker Level B2 Job Class Training

Safe Work Procedure

Training
Supervisors are responsible for the training of all personnel who repair a water main break or leak.

This procedure is to be followed when installing or removing trench cages.

All employees will be trained on proper use before doing this task. As well, refresher training may be offered as new employees are hired and for the purposes of updating this procedure. The following procedures for installing or removing trench cages shall be followed;

Don personal protective equipment before beginning the task. Ensure clothing fits appropriately (tight fitting).

Follow all traffic/pedestrian rules and bylaws. Ensure proper traffic control has been set up prior to beginning work.

All workers are to be aware of the backhoe at all times. Workers walking in and around the excavation vicinity should ensure eye contact with the backhoe operator to establish their presence. The backhoe operator must ensure all workers are clear from the backhoe's range of motion before moving or operating the machinery.

Sand the work area if it is ice-covered or thought to be slippery. Inspect all tools/materials prior to use before beginning procedure. If any broken or defective equipment is found, do not use and remove from service immediately.

Note: Signs and symptoms of a musculoskeletal injury (MSI) can include pain, burning, swelling, numbness/ tingling, color changes, and loss of movement or strength in a body part. The worker should inform their supervisor and/ or the Safety and Health committee if they are experiencing these or other signs and symptoms so steps can be taken to avoid making the conditions worse

1. Ensure the Workplace Safety and Health division is notified that work will be performed in an excavation within 48 hours before the day of excavation work OR as soon as reasonably possible before the excavation occurs. Monday to Friday 8-4:30 (Tel: 204-945-3446) After hours, weekends and Holidays (Tel: 204-945-0581)
2. Position the trench cage trailer with the service truck parallel with the backhoe but at a distance from the excavation so that the integrity of the excavation's wall are not in jeopardy. Have workers perform traffic control if the vehicles must leave the construction site to reposition.
3. If not already present, attach a 5 hook graded lifting chain to the top 4 corners of the trench cage. Ensure that the chain is in good working order and the hooks are secure and will not detach once tension is applied from the backhoe boom. Use only chains and hooks that are meant specifically for lifting trench cages.
4. Attach the 5th hook lifting hook to the pin on the excavation bucket of the backhoe. Verify that the pin is secure and the chain attached is the properly rated to support the weight of the largest trench cage that may be used by the City of Winnipeg.
5. Verify that the backhoe's stabilizers are engaged prior to lifting the trench cage. Lift the trench cage out of the trailer with the backhoe and position it on the ground a safe distance away from the excavation. The backhoe operator must be aware of all surroundings before moving the trench cage in any direction. Once the trench cage is on the ground and the backhoe is safely stopped, inspect the cage for any deficiencies and ensure the cage will expand correctly. Do not use a defective trench cage.
6. Attach the cage pump and slightly expand the cage. Make sure the ball valves on the top of the cage are open and inspect again for any deficiencies. Check the cage walls, stabilizers, ball valves and the general structure. Notify the job foreman and supervisor immediately of any deficiencies. Do not continue to install the trench cage if it is suspected to be or is damaged. Verify that there is appropriate and sufficient trench caging fluid.
7. If you need to troubleshoot for a cage that will not expand, lightly tap the cage stabilizer's with a hammer if dried mud is sticking to the valves. Keep fingers and hands away from the contact point. Close the other valves on the cage and pump the trench cage pump a few times to cause pressure to a valve for it to open. Stand clear of the walls when attempting to expand the cage; if hammering is necessary, stand on the open side of the cage. Follow troubleshooting tactics for the expansion of the trench cage according to COW's manual on shoring procedures if there any trench cage expansion issues.
8. Use the backhoe to lift and position the trench cage over the excavation hole. If you must position it manually, ensure the backhoe boom has completely stopped moving and the cage has stopped swinging. Gently push the trench cage wall. Use a shovel or long tool to push the trench cage for safer body positioning. DO NOT push the wall with force if the cage appears to be stuck on something in the excavation. Stand back and allow the backhoe operator to reposition the trench cage and the re-approach the cage again when it is safe to do so to manually position it.
9. Using the backhoe, lower the cage halfway into the excavation. All workers should stand clear away from the excavation area until the backhoe has positioned the trench cage. The operator must ensure the backhoe is properly positioned to enable the best balance with the shoring cage and that the stabilizers and the front bucket are used to stabilize the backhoe during the lift. The backhoe should position the side of the cage where the pump attachment is as close to the wall of the excavation as possible so there is easy access for the worker to attach the pump hose.
10. Once it is safe to do so, manually attach the trench cage pump hose to the cage's valve box.
11. Install the trench cage by lowering the cage approx. 3 feet from the bottom of the

excavation. The trench cage or shoring walls MUST extent at least 300mm above the vertical walls of the excavation. If the excavation is so deep such that one trench cage cannot reach the required 300mm over the vertical excavation wall then install a stackable trench cage to reach the required height. These cages must be designed for stacking by and with a stacking method specified by a professional engineer. Perform this AFTER trench cages beneath are stable and secure in the excavation. Ensure that all walls of the excavation are shored with box shoring. (See COW manual on shoring procedures for box shoring).

12. Close the open sides of the cage with sheets of plywood. Have the plywood lowered by two people using safe lifting techniques. If required, cut a triangle into plywood for use of rope/chain. The plywood must reach a position behind both stabilizers on the side of the exposed excavation wall and secured. Ensure no part of the excavation wall is exposed to the inside of the trench cage.
13. Using the cage pump, expand and stabilize the trench cage. Operate the pump a safe distance from the excavation (the pump hose can extend to a safe length). If cage pump does not have a pressure indicator gauge, only pump until it becomes challenging to pump, get help from a co-worker once tension is felt during the pumping. If necessary, install extra shoring planks around the trench cage if more stabilization is needed. Do this before lowering the trench cage into the excavation. Do not stay in the excavation for an elongated period of time and the worker must stay within 3m of the ladder when in the excavation.
14. Have 2 workers insert the extension ladder so that it is 1m above the top of the excavation/trench and so that it is not more than 3m away from the worker at all times. Once the trench cage is secured in the excavation, detach the backhoe from the trench cage and remove the backhoe boom from the excavation.
15. To remove the trench cage: Attach the 5 hook graded chain to the excavator bucket from the backhoe, then to the top four corners of the trench cage. Relieve pressure from the trench cage walls with the trench cage pump just enough to collapse the cage so it can be lifted out of the excavation. Using the backhoe, lift only once all points of the chain are secured to the backhoe boom and trench cage and all workers have exited the excavation. Position and lower the trench cage on the ground a safe distance away from the excavation.
16. Collapse the trench cage completely. If necessary, use as many workers as possible to push the trench cage closed. The pump must be used to relieve pressure while the cage is being collapsed. If the cage does not close, refer to troubleshooting tactics for the trench cage according to COW's manual on shoring procedures. The backhoe boom can assist in the collapse if the trench cage is tipped on its side, if this is necessary workers must be clear of the tipping area and the backhoe should push on its stabilizers in small increments but not force its weight on the cage.
17. Use the backhoe boom to lift the cage back onto its trailer, once it is being held over the trailer workers can help position the cage using a long tool (i.e. shovel) so they do not get caught between the equipment. The backhoe must have come to a complete stop and the cage must not be swinging. Once the desired position has been attained, workers must back away and then signal the backhoe operator to lower the cage.

First aid
Every employee will be trained in First Aid (CPR) and will renew their training every three (3) years on a regular basis. A first aid kit must be on site at all times.

Work requirements when installing or removing trench cages:

1. All safety equipment as stated above.
2. Qualified and trained operators.
3. Work area is clear of all hazards.

If an emergency situation occurs while conducting this task call 911, or there is an equipment malfunction,

<table>
<tr><td colspan="2">engage emergency stop and follow the lock out procedure.
REPORT ANY HAZARDOUS SITUATIONS TO YOUR SUPERVISOR</td></tr>
<tr><td>Guidance Documents/ Standards / Applicable Legislation / Other:
Workplace Safety and Health Act W210
Manitoba Regulation 217/2006
2.1 Safe Work Procedures
5 First Aid
6 Personal Protective Equipment
8 Musculoskeletal injuries
12 hearing Conservation and Noise Control
13 Entrances, Exits, Stairways and Ladders
14 Fall Protection
20 Vehicular and Pedestrian Traffic
22 Powered Mobile Equipment
25 Work in the Vicinity of Overhead Electrical Lines
26 Excavations and Tunnels
35 Workplace hazardous Materials Information Systems
36 Chemical and Biological Substances</td><td><u>Supervisor Responsibility</u>

Supervisors are responsible to provide all staff with proper instruction, equipment, and tools. Supervisors are responsible to ensure that all safe work practices are followed.

<u>Worker Responsibility</u>

Follow Safe Work Procedure
Wear appropriate PPE
This Procedure will be reviewed any time the task, equipment, or materials change, or at a minimum every three years.</td></tr>
</table>

E14n SWP-WS-LS-Repairing a Water Main Break or Leak-06 of 09-Changing the Excavator Bucket on the Backhoe

Winnipeg
Embrace the Spirit.

SAFE WORK PROCEDURE

Job Name: Repairing a Water Main Break or Leak
Task: Changing the Excavator Bucket on the Backhoe
Task #: 06 of 09

This Task may only be performed by trained personnel

Division/Branch/Area/Crew:	Approved by:	Creation Date:	Revision Date:
Water Services/Local Services	T.Shanks, P.Eng	02 19 2010	Mar 19, 2014

Hazards Present:	Personal Protective Equipment (PPE) Or devices required	Personnel Training Requirements:
• Heavy Mobile equipment • Oncoming traffic • Slippery walking surfaces • Heavy lifting • Open flame • Possible extreme weather • Crush hazards	• CSA approved Hard Hat • CSA approved ankle high steel toe footwear. • CSA approved eye wear. • High Visibility Vest/Clothing. • Nitrile & Leather Work Gloves • Clothing appropriate for extreme weather (winter, rain)	Skilled Maintenance Worker Level B1 Job Class Training

Safe Work Procedure

Training
Supervisors are responsible for the training of all personnel who repair water main breaks/leaks.

This procedure is to be followed when changing the excavator bucket on the backhoe.

All employees will be trained on proper use before doing this task. As well, refresher training may be offered as new employees are hired and for the purposes of updating this procedure. The following procedures for changing the excavator bucket on the backhoe shall be followed;

Don personal protective equipment before beginning the task. Ensure clothing fits appropriately (tight fitting). Follow all traffic/pedestrian rules and bylaws. Ensure proper traffic control has been set up prior to beginning work.

All workers are to be aware of the backhoe at all times. Workers walking in and around the excavation vicinity should ensure eye contact with the backhoe operator to establish their presence. The backhoe operator must ensure all workers are clear from the backhoe's range of motion before moving or operating the machinery.
Sand the work area if it is ice-covered or thought to be slippery. Inspect all tools/materials prior to use before beginning procedure. If any broken or defective equipment is found, do not use and remove from service immediately.

Note: Signs and symptoms of a musculoskeletal injury (MSI) can include pain, burning, swelling, numbness/ tingling, color changes, and loss of movement or strength in a body part. The worker should inform their supervisor and/ or the Safety and Health committee if they are experiencing these or other signs and symptoms so steps can be taken to avoid making the conditions worse

1. Position the backhoe so it is away from the work area and lower the excavator bucket to the ground. If the backhoe must drive out of the construction zone to reposition, workers must perform traffic control so the backhoe can be safely guided to its desired location.
2. Open the quick coupler and remove the locking pin that secures the bucket, use a hammer to gently tap out the pin keeping your fingers away from the point of contact.
3. Use the backhoe boom to position the jackhammer next to the backhoe so that the hammer pin is facing the backhoe.
4. Remove the excavator bucket from the boom arm hooks and attach the jackhammer. Ensure the backhoe booms hooks to the jackhammer's mechanism and hook shaft.
5. Use the backhoe boom to lift the jackhammer up until it is vertically straight and Install the jackhammer. Insert the locking pin into the jackhammer and verify that it is secured to the backhoe boom. Use a hammer to tap the pin into place if it doesn't insert easily. Keep your fingers and hands clear of the hammer's point of contact with the pin.
6. Once the backhoe boom lays the jackhammer horizontally on the ground, release the hydraulic pressure from the jackhammer lines and attach the hydraulic fluid hoses from the jackhammer to the backhoe boom's hydraulic fluid hoses. Ensure you are wearing gloves and safety glasses and always release the hydraulic pressure from the jackhammer's lines prior to attaching them to the backhoe.
7. Position the backhoe to begin the excavation. Follow all traffic control and traffic rules.
8. Return the backhoe to the excavation area to begin jack hammering. Follow this process in reverse order when changing the jack hammer to the excavation bucket.

First aid
Every employee will be trained in First Aid (CPR) and will renew their training every three (3) years on a regular basis. A first aid kit must be on site at all times.

Work requirements when changing the excavator bucket on the backhoe:

1. All safety equipment as stated above.
2. Qualified and trained operators.
3. Work area is clear of all hazards.

If an emergency situation occurs while conducting this task call 911, or there is an equipment malfunction, engage emergency stop and follow the lock out procedure.

REPORT ANY HAZARDOUS SITUATIONS TO YOUR SUPERVISOR

Guidance Documents/ Standards / Applicable Legislation / Other:

Workplace Safety and Health Act W210
Manitoba Regulation 217/2006

- 2.1 Safe Work Procedures
- 5 First Aid
- 6 Personal Protective Equipment
- 8 Musculoskeletal injuries
- 12 hearing Conservation and Noise Control
- 20 Vehicular and Pedestrian Traffic
- 22 Powered Mobile Equipment
- 26 Excavations and Tunnels
- 35 Workplace hazardous Materials Information Systems
- 36 Chemical and Biological Substances

Supervisor Responsibility

Supervisors are responsible to provide all staff with proper instruction, equipment, and tools. Supervisors are responsible to ensure that all safe work practices are followed.

Worker Responsibility

Follow Safe Work Procedure
Wear appropriate PPE
This Procedure will be reviewed any time the task, equipment, or materials change, or at a minimum every three years.

E14o SWP-WS-LS-Repairing a Water Main Break or Leak-07 of 09-Transporting Excavated Material with a Tandem Dump Truck

Winnipeg
Embrace the Spirit.

SAFE WORK PROCEDURE

Job Name: Repairing a Water Main Break or Leak
Task #: 07 of 09
Activity: Transporting Excavated Material with a Tandem Dump Truck

This Task may only be performed by trained personnel

Division/Branch/Area/Crew:	Approved by:	Creation Date:	Revision Date:
Water Services/Local Services	T.Shanks, P.Eng	02 11 2010	Mar 19, 2014

Hazards Present:	Personal Protective Equipment (PPE) Or devices required	Personnel Training Requirements:
• Musculoskeletal Injury • Slips, Trips, and Falls • Crush/ Pinch to parts of body • Heavy Mobile Equipment • Hazardous Driving Conditions • Extreme Weather Conditions • Dump Truck Tipping	• High Visibility Vest/ Clothing • Clothing appropriate for weather • CSA approved hard hat • CSA approved steel toe footwear. • Clothing appropriate for extreme weather conditions (cold, rain, and extreme heat).	Skilled Maintenance Worker Level A Job Class Training

Safe Work Procedure

Training
Supervisors are responsible for the training of all personnel who repair a water main break/leak.

This procedure is to be followed when transporting excavated materials with a tandem dump truck.

All employees will be trained on proper use before doing this task. As well, refresher training may be offered as new employees are hired and for the purposes of updating this procedure. The following procedures for transporting excavated materials with a tandem dump truck shall be followed;

Don personal protective equipment before beginning the task. Ensure clothing fits appropriately (tight fitting).

Follow all traffic/pedestrian rules and bylaws and ensure proper traffic control has been set up prior to beginning work.

Sand the work area if it is ice-covered or thought to be slippery. Inspect all tools/materials prior to use before beginning procedure. If any broken or defective equipment is found, do not use and remove from service immediately.

Always maintain three-point contact when entering/exiting the truck cab.

Note: Signs and symptoms of a musculoskeletal injury (MSI) can include pain, burning, swelling, numbness/ tingling, color changes, and loss of movement or strength in a body part. The worker should inform their supervisor and/ or the Safety and Health committee if they are experiencing these or other signs and symptoms so steps can be taken to avoid making the conditions worse

1. Ensure the maxi break is set and then conduct a pre-trip inspection of the vehicle prior to leaving the garage. Walk around and visually inspect the vehicle's integrity. Check the condition of the glass, mirrors, tires, hydraulics and ensure the fluids are topped up. Report any visible defects to your supervisor immediately and do not use the vehicle if it is not up to standard.
2. Drive the truck to the excavation site. Follow all driving/pedestrian traffic rules and bylaws. Refer to COW Water and Waste department working alone policy if you are driving alone.
3. Once the backhoe is in position, reverse and position the truck towards the excavation area, near the backhoe, at a distance so that it does not put the integrity of the excavation's walls in jeopardy. Use a spotter/flag person to assist in direction the driver of the truck. Walk to the rear of the truck and ensure the clamps on the box gate are attached to the box.
4. Once the truck is full of excavated material, drive it away from the excavation area, park, walk around the truck to make sure the sides/edges are clear of mud/soil, then operate the tarp mechanism to cover the load. Whenever possible, avoid from assisting the mechanism arm, if you must assist the arm, push it (do not pull) and stay behind the direction the arm is moving. Keep fingers and hands outside the tarp mechanism arm. If the arm is malfunctioning, contact your supervisor or a COW mechanic.
5. Ensure the tarp is fully on especially when hauling fine particulate material or wet/sloppy/liquid material.
6. Drive at or below the speed limit to a designated dumping area (i.e. Landfill). Leave extra stopping room when driving as the truck box is full.
7. Find a level surface and apply the parking brake and park the truck. Remove the tarp from the vehicle (Refer to step 4 when operating the tarp mechanism arm).
8. Ensure that there is no other workers/people in the dumping are (step out of the truck to look). Activate the dumping switch in the truck's cab and dump the excavated material. Once all the material has been emptied from the truck, lower the truck box back to its resting position.
9. Once the box has been lowered into its resting position, exit the cab and climb up on all contact points (ensure 3-point contact with the vehicle at all times) to visually inspect the truck box to ensure the load has been dumped (do not do this if the truck box is still raised). Walk to the rear of the truck and verify the clamps on the box gate are attached to the box. If the clamps are not attached, use a crow bar or another pry tool to pry the gate open and let it drop closed. Always handle the pry tool with both hands and avoid jerky movements.
10. Drive to the designated supplier of hot sand and allow the supplier to load sand into the truck's box. (Refer to step 2)
11. Drive back to the excavation site. Reverse and position the truck towards the excavation, near the backhoe (Refer to step 3 above). Allow the backhoe to either remove the sand from the truck box, or continue to fill the truck box with more excavated material. Continue this process until the job is complete.
12. Drive back to the parking garage and perform a post-trip vehicle inspection. Notify your supervisor or mechanical staff if any piece of equipment /instruments on the truck are malfunctioning or suspected to need repair. If any fluid or air is low on the vehicle, fill to specification levels.
13. Wash down the reflective surfaces (lights and mirrors) with the power washer, keeping the washer nozzle pointed away from your body.

First aid

Every employee will be trained in First Aid (CPR) and will renew their training every three (3) years on a regular basis. A first aid kit must be on site at all times.

Work requirements when transporting excavated materials with a tandem dump truck:

1. All safety equipment as stated above.
2. Qualified and trained operators.
3. Work area is clear of all hazards.

If an emergency situation occurs while conducting this task call 911, or there is an equipment malfunction, engage emergency stop and follow the lock out procedure.

REPORT ANY HAZARDOUS SITUATIONS TO YOUR SUPERVISOR

Guidance Documents/ Standards / Applicable Legislation / Other:

Workplace Safety and Health Act W210
Manitoba Regulation 217/2006

- 2.1 Safe Work Procedures
- 5 First Aid
- 6 Personal Protective Equipment
- 8 Musculoskeletal injuries
- 12 Hearing Conservation and Noise Control
- 20 Vehicular and Pedestrian Traffic
- 22 Powered Mobile Equipment
- 26 Excavations and Tunnels
- 35 Workplace hazardous Materials Information Systems
- 36 Chemical and Biological Substances

Supervisor Responsibility

Supervisors are responsible to provide all staff with proper instruction, equipment, and tools. Supervisors are responsible to ensure that all safe work practices are followed.

Worker Responsibility

Follow Safe Work Procedure
Wear appropriate PPE
This Procedure will be reviewed any time the task, equipment, or materials change, or at a minimum every three years.

E14p SWP-WS-LS-Repairing a Water Main Break or Leak-08 of 09-Charging the System (Putting the Main back in Service)

Winnipeg
Embrace the Spirit.

SAFE WORK PROCEDURE

Job Name: Repairing a Water Main Break or Leak
Task #: 08 of 09
Activity: Charging the System

This Task may only be performed by trained personnel

Division/Branch/Area/Crew:	Approved by:	Creation Date:	Revision Date:
Water Services/Local Services	T. Shanks, P.Eng	02 08 2010	Mar 19, 2014

Hazards Present:	Personal Protective Equipment (PPE) Or devices required	Personnel Training Requirements:
• Oncoming Traffic • High pressure water • Burns and scalds from the Steam hose (winter) • Large amount of ice build-up (winter)	• Warm clothes • High visibility clothing/ vest. • CSA approved Steel Toe Footwear • Spare change of clothes and winter wear	Skilled Maintenance Worker Level B2 Job Class Training

Safe Work Procedure

Training
Supervisors are responsible for the training of all personnel who repair water main break/leaks.

This procedure is to be followed when charging the system.

All employees will be trained on proper use before doing this task. As well, refresher training may be offered as new employees are hired and for the purposes of updating this procedure. The following procedures for charging the system shall be followed;

Don personal protective equipment before beginning the task. Ensure clothing fits appropriately (tight fitting).

Sand the work area if it is ice-covered or thought to be slippery. Inspect all tools/materials prior to use before beginning procedure. If any broken or defective equipment is found, do not use and remove from service immediately.

Follow all traffic/pedestrian rules and bylaws and ensure proper traffic control has been set up prior to beginning work.

Note: Signs and symptoms of a musculoskeletal injury (MSI) can include pain, burning, swelling, numbness/ tingling, color changes, and loss of movement or strength in a body part. The worker should inform their supervisor and/ or the Safety and Health committee if they are experiencing these or other signs and symptoms so steps can be taken to avoid making the conditions worse

1. For the section of the water main that is being repaired, verify that all valves are closed. If they are snow/ice covered, use a spade to first beak up the snow and ice, then shovel to clear out the valve box. Keep a firm grip on the shovel and avoid bending your back when

shovelling (bend your knees). If you must use the steamer hose and boiler unit to thaw the valve, ensure the steamer end is always pointed at the ground and keep your hands and feet away from the steamer end of the hose.

2. Use a fire hydrant on the water main to bleed out air when the charge occurs, if there is no hydrant on the system then branch out the repaired section of pipe by opening adjacent valves until a fire hydrant exists on the system.
3. Drive to the fire hydrant with the service truck when the system is ready to be charged. Follow all traffic rules/bylaws.
4. Attach the discharge hose and gate valve to an outlet nozzle on the hydrant and place the discharge end of the hose into a nearby catch basin.
5. Weigh the discharge end of the hose down with a sandbag or heavy piece of material. Use proper lifting techniques when lifting the sand bag/heavy material (bend knees when lifting, keep your back straight and avoid twisting at the torso).
6. Thaw the valves or catch basins with the boiler unit (on service truck). Use the steam hose to heat the valves or melt the ice in the catch basins. Always keep the steamer end pointed towards the ground and keep hands and feet clear of the steam end. If possible, avoid from using the boiler unit and steam hose for some points of this procedure to reduce the amount of ambient steam that can reduce the driver's visibility.
7. Bleed the water main of air by opening the gate valve attached to the fire hydrant then the hydrant valve. Use a hydrant wrench and keep a firm wide based stance, turn the operating nut very slowly (to avoid a water hammer event).
8. The worker at the valve will get a cut on the key (open the valve slowly), put their ear up to the key and listen for any water pressure. Turn the key slowly and in small increments. Always charge "through" your work and out the furthest hydrant first. The water main repair crew will inspect the main from outside the excavation during this procedure to ensure proper repair.
9. After all the air has been bled out from the hydrant, slowly close the gate vale at the hydrant followed by the hydrant valve by turning the operating nut slowly and in small increments. Be sure that the discharge hose is sufficiently weighed down and positioned away from the worker.
10. Attach a gas powered pump to an outlet nozzle on the fire hydrant and pump out the excess water from the hydrant. Use good lifting techniques (bend at the knees and avoid twisting at the torso). Always carry the pump with both hands and ensure it is primed before attempting to start it. Drain any excess water into the nearest catch basin.
11. Close the water main valve. Once the worker at the hydrant notifies the worker operating the valve that the hydrant valve is closed, the worker operating the valve must then open the water main valve turning the key slowly and in small increments until it has been opened completely.
12. Pack up all tools/materials and drive to reopen any other closed water main valves. If any flooding has occurred on the street from where the water was bled out of the hydrant, request a vactor truck to unclog catch basins or to pump water from the street. If ice has built up on the streets or sidewalks (winter), request a sand truck.
13. Open the valves that have been used to isolate the repaired water main. If the steam hose/boiler unit must be used, refer to safe actions in step 6. Turn the key slowly in small increments. Get a second worker to help turn the valve key if it is still difficult to turn after using the boiler unit.

First aid

Every employee will be trained in First Aid (CPR) and will renew their training every three (3) years on a regular basis. A first aid kit must be on site at all times.

Work requirements when charging the system:

1. All safety equipment as stated above.
2. Qualified and trained operators.
3. Work area is clear of all hazards.

If an emergency situation occurs while conducting this task call 911, or there is an equipment malfunction, engage emergency stop and follow the lock out procedure.

REPORT ANY HAZARDOUS SITUATIONS TO YOUR SUPERVISOR

Guidance Documents/ Standards / Applicable Legislation / Other:

Workplace Safety and Health Act W210
Manitoba Regulation 217/2006

- 2.1 Safe Work Procedures
- 5 First Aid
- 6 Personal Protective Equipment
- 8 Musculoskeletal injuries
- 12 Hearing Conservation and Noise Control
- 20 Vehicular and Pedestrian Traffic
- 22 Powered Mobile Equipment
- 26 Excavations and Tunnels

Supervisor Responsibility

Supervisors are responsible to provide all staff with proper instruction, equipment, and tools. Supervisors are responsible to ensure that all safe work practices are followed.

Worker Responsibility

Follow Safe Work Procedure
Wear appropriate PPE
This Procedure will be reviewed any time the task, equipment, or materials change, or at a minimum every three years.

E14q SWP-WS-LS-Repairing a Water Main Break or Leak-09 of 09-Filling Cuts to Grade

Winnipeg
Embrace the Spirit.

SAFE WORK PROCEDURE

Job Name: Repairing a Water Main Break or Leak
Task #: 09 of 09
Activity: Filling Cuts to Grade

This Task may only be performed by trained personnel

Division/Branch/Area/Crew:	Approved by:	Creation Date:	Revision Date:
Water Services/Local Services	T.Shanks, P.Eng	02 28 2010	Mar 19, 2014

Hazards Present:	Personal Protective Equipment (PPE)	Personnel Training Requirements:
• Cold/ hot weather conditions • Roadway Traffic • Heavy equipment • Moderate to heavy lifts by personnel	**Or devices required** • Work gloves • Safety glasses • Rubber insulated boots • Reflective vests • Hard hats • Winter work clothing	Skilled Maintenance Worker Level A Job Class Training

Safe Work Procedure

Training
Supervisors are responsible for the training of all personnel who repair a water main break/leak.

This procedure is to be followed when filling cuts to grade.

All employees will be trained on proper use before doing this task. As well, refresher training may be offered as new employees are hired and for the purposes of updating this procedure. The following procedures for filling cuts to grade shall be followed;

Don personal protective equipment before beginning the task. Ensure clothing fits appropriately (tight fitting).

Follow all traffic/pedestrian rules and bylaws and ensure proper traffic control has been set up prior to beginning work.

Sand the work area if it is ice-covered or thought to be slippery.

Inspect all tools/materials prior to use before beginning procedure. If any broken or defective equipment is found, do not use and remove from service immediately.

Note: Signs and symptoms of a musculoskeletal injury (MSI) can include pain, burning, swelling, numbness/ tingling, color changes, and loss of movement or strength in a body part. The worker should inform their supervisor and/ or the Safety and Health committee if they are experiencing these or other signs and symptoms so steps can be taken to avoid making the conditions worse

1. Do a pre-use inspection on all tools/materials required as well as the vehicles that will be used. Report any defects to your supervisor and do not use if tools/materials are defective or faulty.
2. Order concrete needed for the job at the beginning of the shift. All sites can be planned in advance for this work. Some ordering may take place during the day but orders should only be done from a parked service vehicle.
3. Once on-site, park the service vehicle away from traffic when possible and use hazard/warning lights. Always wear appropriate reflective traffic gear and exit the vehicle when there is no risk to the worker of being hit by on-coming traffic. Verify that traffic barriers are in place.
4. Remove any covers on the lumber/plywood and install plywood protection for the boulevards. When handling the supplies, wear work gloves at all times and when sliding the plywood off the cut areas or truck box by bending at the knees to help ease the load. Never carry more than you can easily handle, get a co-worker to help or if you need to travel a longer distance, move the service vehicle as close as possible to load/unload heavier supplies.
5. Prepare the cut area. Use a shovel to adjust the grade of the cut area and remove soil, gravel and snow. Rake out the grade for the fill for summer soils or any repairs for the boulevards. If required, use a tandem to tip and unload the required materials for the fill and then proceed to shovel off the pile to the cut area with a shovel or rake to reduce the risk for MSI injuries. Always clean up the tools once you are finished using them so they are not a hazard to workers if left lying on the ground.
6. Using traffic control techniques spot the cement truck on-site to fill the cut area. Be aware of your surroundings when having the cement truck back-up (i.e. poles, trees, buildings or utility services). Always use clear hand signals to spot and direct the cement truck to ensure there will be no damage to cut, boulevards, utilities or trees.
7. Allow the cement truck operator to operate the chutes and control the flow of the cement into the cut area. Fill the cut area with concrete stab mix, gravel or soil (in the summer months, some cuts will require more active repair such as sod, grass seed and topsoil) in order to repair the cut. For cement: rake the cement into corners from the inside to outside edge for grade to avoid standing in the mixture. For gravel and soils: first shovel the material from the pile into the cut area, then use the rake to adjust to grade. Reduce stress on the body while shovelling by keeping your knees slightly bent. Always wear insulated rubber boots and work gloves, if mixture contacts your skin wipe/wash off with clean water. If PPE gets saturated with the mix, replace. When working with gravel or soils, wear an APR dust mask.
8. Clear and complete the cut area. Before leaving make sure area is safe. Level surface and smooth as best as possible using cement tools. Follow all traffic control procedures when removing barriers from the site. Wear appropriate reflective vest and work gloves. If traffic controls have been leased or rented, call the retailer to remove them from the site. Drag all plywood to the vehicle instead of carrying it to avoid strains to your back or arms. Ensure all materials are loaded into the service vehicle first before traffic control is removed and loaded.

First aid
Every employee will be trained in First Aid (CPR) and will renew their training every three (3) years on a regular basis. A first aid kit must be on site at all times.

Work requirements when filling cuts to grade:

1. All safety equipment as stated above.
2. Qualified and trained operators.
3. Work area is clear of all hazards.

If an emergency situation occurs while conducting this task call 911, or there is an equipment malfunction, engage emergency stop and follow the lock out procedure.

REPORT ANY HAZARDOUS SITUATIONS TO YOUR SUPERVISOR

Guidance Documents/ Standards / Applicable Legislation / Other:

Workplace Safety and Health Act W210
Manitoba Regulation 217/2006

- 2.1 Safe Work Procedures
- 5 First Aid
- 6 Personal Protective Equipment
- 8 Musculoskeletal injuries
- 12 Hearing Conservation and Noise Control
- 20 Vehicular and Pedestrian Traffic
- 22 Powered Mobile Equipment
- 35 Workplace hazardous Materials Information Systems
- 36 Chemical and Biological Substances

Supervisor Responsibility

Supervisors are responsible to provide all staff with proper instruction, equipment, and tools. Supervisors are responsible to ensure that all safe work practices are followed.

Worker Responsibility

Follow Safe Work Procedure
Wear appropriate PPE
This Procedure will be reviewed any time the task, equipment, or materials change, or at a minimum every three years.

E15 Upstream Areas of Positive Samples

UPSTREAM_AREA	MATERIAL	YEAR	Sum Of LENGTH	Total Sum of each material	Total Sum for each site	Material Percentages
NE-01			74.26	78.48	42123.41	0
NE-01	*UNKNOWN	1994	1.22			
NE-01	*UNKNOWN	9999	3			
NE-01	AC	1965	2566.665	31725.973		75
NE-01	AC	1966	432.67			
NE-01	AC	1972	539.049			
NE-01	AC	1973	4228.165			
NE-01	AC	1974	8370.421			
NE-01	AC	1975	5462.671			
NE-01	AC	1976	6316.345			
NE-01	AC	1977	886.672			
NE-01	AC	1978	1099.319			
NE-01	AC	1979	1323.6			
NE-01	AC	1980	98.988			
NE-01	AC	1984	297.257			
NE-01	AC	1985	83.477			
NE-01	AC	1986	20.674			
NE-01	CI	1966	882.98	1735.584		4
NE-01	CI	1971	279.616			
NE-01	CI	1972	256.743			
NE-01	CI	1976	17.046			
NE-01	CI	1982	83.789			
NE-01	CI	9999	215.41			
NE-01	CU	1979	52.98	53.18		0
NE-01	CU	2009	0.2			
NE-01	DI	1971	635.141	977.533		2
NE-01	DI	1973	82.6			
NE-01	DI	1974	73.616			
NE-01	DI	1976	97.007			
NE-01	DI	1977	67.769			
NE-01	DI	1986	21.4			
NE-01	FRC	1979	214.91	387.298		1
NE-01	FRC	1981	172.388			
NE-01	PB	1980	87.59	87.59		0
NE-01	PVC	1979	782.867	7077.772		17
NE-01	PVC	1980	1869.797			
NE-01	PVC	1982	78.709			
NE-01	PVC	1983	201.859			
NE-01	PVC	1984	85.846			
NE-01	PVC	1985	746.727			
NE-01	PVC	1986	144.812			
NE-01	PVC	1990	183.319			
NE-01	PVC	1991	489.556			
NE-01	PVC	1994	207.486			
NE-01	PVC	1996	578.923			

UPSTREAM_AREA	MATERIAL	YEAR	Sum Of LENGTH	Total Sum of each material	Total Sum for each site	Material Percentages
NE-01	PVC	1997	320.894			
NE-01	PVC	1998	278.531			
NE-01	PVC	1999	2.403			
NE-01	PVC	2000	138.483			
NE-01	PVC	2001	3.8			
NE-01	PVC	2002	3			
NE-01	PVC	2004	213.8			
NE-01	PVC	2005	132.17			
NE-01	PVC	2006	94.27			
NE-01	PVC	2007	166.97			
NE-01	PVC	2010	34.06			
NE-01	PVC	2011	201.98			
NE-01	PVC	2012	2.2			
NE-01	PVC	2013	2.81			
NE-01	PVC	2014	1.8			
NE-01	PVC	9999	110.7			
SE-03	*UNKNOWN	9999	0.6	0.6	5902.753	0
SE-03	AC	1980	982.25	982.25		17
SE-03	CU	1987	89.25	272.511		5
SE-03	CU	1990	84.785			
SE-03	CU	1992	98.476			
SE-03	PVC	1987	2754.67	4647.392		79
SE-03	PVC	1990	65.502			
SE-03	PVC	1992	48.294			
SE-03	PVC	1994	186.33			
SE-03	PVC	1997	758.861			
SE-03	PVC	1999	831.935			
SE-03	PVC	2008	1.8			
SE-04		2002	105.15	170.046	17876.124	1
SE-04	*UNKNOWN	1988	64.896	2.83		0
SE-04	CONCRETE	1988	2.83	2.83		0
SE-04	CU	1987	267.586	1032.318		6
SE-04	CU	1988	87.959			
SE-04	CU	1992	75.235			
SE-04	CU	1998	285.598			
SE-04	CU	2002	71.5			
SE-04	CU	2003	160.1			
SE-04	CU	2005	84.34			
SE-04	DI	2006	7.63	7.63		0
SE-04	PVC	1987	5319.712	16659.57		93
SE-04	PVC	1988	1492.838			
SE-04	PVC	1989	955.312			
SE-04	PVC	1990	103.426			
SE-04	PVC	1992	37.206			

UPSTREAM_AREA	MATERIAL	YEAR	Sum Of LENGTH	Total Sum of each material	Total Sum for each site	Material Percentages
SE-04	PVC	1994	842.183			
SE-04	PVC	1996	293.746			
SE-04	PVC	1998	1051.048			
SE-04	PVC	1999	543.478			
SE-04	PVC	2000	1655.411			
SE-04	PVC	2001	657.36			
SE-04	PVC	2002	508.45			
SE-04	PVC	2003	992.46			
SE-04	PVC	2005	1954.83			
SE-04	PVC	2006	124.54			
SE-04	PVC	2008	0.8			
SE-04	PVC	9999	126.77			
SE-04	STEEL	1988	0.9	0.9		0
SE-07			26.006	8098.067	84441.439	10
SE-07	*UNKNOWN		27.22			
SE-07	*UNKNOWN	1962	1.227			
SE-07	*UNKNOWN	1968	62			
SE-07	*UNKNOWN	1970	6.112			
SE-07	*UNKNOWN	1971	39.839			
SE-07	*UNKNOWN	1972	71.151			
SE-07	*UNKNOWN	1973	145.135			
SE-07	*UNKNOWN	1974	3.33			
SE-07	*UNKNOWN	1975	218.502			
SE-07	*UNKNOWN	1976	732.892			
SE-07	*UNKNOWN	1977	772.638			
SE-07	*UNKNOWN	1978	426.273			
SE-07	*UNKNOWN	1979	4541.091			
SE-07	*UNKNOWN	1980	185.321			
SE-07	*UNKNOWN	1981	139.449			
SE-07	*UNKNOWN	1982	154.616			
SE-07	*UNKNOWN	1983	19.444			
SE-07	*UNKNOWN	1984	6.094			
SE-07	*UNKNOWN	1985	227.921			
SE-07	*UNKNOWN	1986	164.127			
SE-07	*UNKNOWN	1987	1.55			
SE-07	*UNKNOWN	1990	8.95			
SE-07	*UNKNOWN	1991	32.11			
SE-07	*UNKNOWN	2008	0.6			
SE-07	*UNKNOWN	2014	0.51			
SE-07	*UNKNOWN	9999	83.959			
SE-07	AC	1961	1557.765	24276.881		29
SE-07	AC	1962	306.02			
SE-07	AC	1965	148.87			
SE-07	AC	1967	730.756			

UPSTREAM_AREA	MATERIAL	YEAR	Sum Of LENGTH	Total Sum of each material	Total Sum for each site	Material Percentages
SE-07	AC	1971	385.603			
SE-07	AC	1972	1171.877			
SE-07	AC	1973	254.687			
SE-07	AC	1974	3181.028			
SE-07	AC	1975	1050.246			
SE-07	AC	1976	156.27			
SE-07	AC	1977	3047.49			
SE-07	AC	1978	957.644			
SE-07	AC	1979	4852.321			
SE-07	AC	1980	141.4			
SE-07	AC	1981	255.967			
SE-07	AC	1982	1629.387			
SE-07	AC	1983	1692.779			
SE-07	AC	1984	1114.709			
SE-07	AC	1985	785.973			
SE-07	AC	1987	273.951			
SE-07	AC	1989	256.137			
SE-07	AC	2007	0.64			
SE-07	AC	2014	0.5			
SE-07	AC	9999	324.861			
SE-07	CI	1961	14.84	1686.512		2
SE-07	CI	1965	35.828			
SE-07	CI	1967	235.616			
SE-07	CI	1968	399.81			
SE-07	CI	1969	49.493			
SE-07	CI	1970	260.068			
SE-07	CI	1971	1.548			
SE-07	CI	1972	177.53			
SE-07	CI	1973	39.182			
SE-07	CI	1974	17.525			
SE-07	CI	1975	170.08			
SE-07	CI	1985	29.931			
SE-07	CI	1988	113.63			
SE-07	CI	1992	2.181			
SE-07	CI	2002	61.55			
SE-07	CI	9999	77.7			
SE-07	CONCRETE	1959	2	2		
SE-07	CU	1982	62.15	1662.364		2
SE-07	CU	1983	40.07			
SE-07	CU	1985	82.771			
SE-07	CU	1987	512.833			
SE-07	CU	1988	190.624			
SE-07	CU	1989	72.01			
SE-07	CU	1991	267.276			
SE-07	CU	1993	173.97			

UPSTREAM_AREA	MATERIAL	YEAR	Sum Of LENGTH	Total Sum of each material	Total Sum for each site	Material Percentages
SE-07	CU	2001	84.23			
SE-07	CU	2004	176.43			
SE-07	DI	1971	55.53	834.236		1
SE-07	DI	1972	250.2			
SE-07	DI	1973	115.36			
SE-07	DI	1974	92.37			
SE-07	DI	1975	125.218			
SE-07	DI	1977	114.339			
SE-07	DI	1979	81.219			
SE-07	PVC	1980	3651.306	47818.303		57
SE-07	PVC	1981	1136.741			
SE-07	PVC	1982	417.231			
SE-07	PVC	1983	780.249			
SE-07	PVC	1984	2124.757			
SE-07	PVC	1985	2591.747			
SE-07	PVC	1986	3736.367			
SE-07	PVC	1987	7890.115			
SE-07	PVC	1988	3514.671			
SE-07	PVC	1989	1843.263			
SE-07	PVC	1990	1755.268			
SE-07	PVC	1991	1637.184			
SE-07	PVC	1992	1197.735			
SE-07	PVC	1993	2289.923			
SE-07	PVC	1994	4528.309			
SE-07	PVC	1995	1976.195			
SE-07	PVC	1996	1558.162			
SE-07	PVC	1997	910.222			
SE-07	PVC	1998	542.358			
SE-07	PVC	2000	259.06			
SE-07	PVC	2001	199.02			
SE-07	PVC	2002	1245.99			
SE-07	PVC	2003	137.3			
SE-07	PVC	2004	255.03			
SE-07	PVC	2005	66.58			
SE-07	PVC	2006	424.23			
SE-07	PVC	2007	249.16			
SE-07	PVC	2008	461.77			
SE-07	PVC	2009	2			
SE-07	PVC	2010	3.6			
SE-07	PVC	2011	347.2			
SE-07	PVC	2012	7.8			
SE-07	PVC	2013	24.1			
SE-07	PVC	2014	15.1			
SE-07	PVC	9999	38.56			
SE-07	STEEL	1960	10.316	63.076		0

UPSTREAM _AREA	MATERIAL	YEAR	Sum Of LENGTH	Total Sum of each material	Total Sum for each site	Material Percentages
SE-O7			29.8			
SE-O7		2002	21.57			
SE-O7		2006	1.39			
SW-07	*UNKNOWN	1960	1.5	1127.68	58018.86	2
SW-07	*UNKNOWN	1963	87.171			
SW-07	*UNKNOWN	1964	123.448			
SW-07	*UNKNOWN	1967	115.916			
SW-07	*UNKNOWN	1980	9.035			
SW-07	*UNKNOWN	1985	396.304			
SW-07	*UNKNOWN	1986	335.044			
SW-07	*UNKNOWN	2001	14.86			
SW-07	*UNKNOWN	9999	44.402			
SW-07	AC	1963	970.29	10008.743		17
SW-07	AC	1966	268.39			
SW-07	AC	1980	4602.766			
SW-07	AC	1981	598.616			
SW-07	AC	1982	2200.68			
SW-07	AC	1984	1198.227			
SW-07	AC	1988	54.403			
SW-07	AC	1989	78.081			
SW-07	AC	9999	37.29			
SW-07	CI	1962	168.99	1480.019		3
SW-07	CI	1963	352.734			
SW-07	CI	1964	958.295			
SW-07	CU	1986	170.803	1825.783		3
SW-07	CU	1987	139.829			
SW-07	CU	1989	254.475			
SW-07	CU	1999	183.931			
SW-07	CU	2000	89.265			
SW-07	CU	2001	184.04			
SW-07	CU	2002	713.41			
SW-07	CU	2003	90.03			
SW-07	DI	1981	59.007	126.667		0
SW-07	DI	1983	67.66			
SW-07	PB	1985	93.949	93.949		0
SW-07	PE	1985	110.589	126.409		0
SW-07	PE	2005	15.82			
SW-07	PVC		14.21	43229.61		75
SW-07	PVC	1975	353.6			
SW-07	PVC	1980	1.774			
SW-07	PVC	1984	1964.661			
SW-07	PVC	1985	4630.041			
SW-07	PVC	1986	2926.041			
SW-07	PVC	1987	4410.837			

UPSTREAM_AREA	MATERIAL	YEAR	Sum Of LENGTH	Total Sum of each material	Total Sum for each site	Material Percentages
SW-07	PVC	1988	2280.027			
SW-07	PVC	1989	3315.298			
SW-07	PVC	1990	1187.147			
SW-07	PVC	1991	1449.092			
SW-07	PVC	1992	1205.871			
SW-07	PVC	1993	291.238			
SW-07	PVC	1994	1415.977			
SW-07	PVC	1995	626.024			
SW-07	PVC	1997	5.433			
SW-07	PVC	1998	832.774			
SW-07	PVC	1999	2208.406			
SW-07	PVC	2000	626.288			
SW-07	PVC	2001	1593.86			
SW-07	PVC	2002	1943.55			
SW-07	PVC	2003	2014.37			
SW-07	PVC	2004	1859.5			
SW-07	PVC	2005	848.91			
SW-07	PVC	2006	1551.32			
SW-07	PVC	2007	517.6			
SW-07	PVC	2008	632.83			
SW-07	PVC	2009	4.98			
SW-07	PVC	2010	2492.1			
SW-07	PVC	2011	3.1			
SW-07	PVC	2012	6.8			
SW-07	PVC	2013	5.62			
SW-07	PVC	2014	1.49			
SW-07	PVC	9999	8.841			
SW-12			2.6	295.605	5826.486	5
SW-12	*UNKNOWN	1953	92.28			
SW-12	*UNKNOWN	1960	165.63			
SW-12	*UNKNOWN	1962	34.555			
SW-12	*UNKNOWN	2006	0.54			
SW-12	AC	1962	130.551	913.908		16
SW-12	AC	1963	601.29			
SW-12	AC	1977	66.417			
SW-12	AC	1980	115.65			
SW-12	CI	1962	1314.6	1567.418		27
SW-12	CI	9999	252.818			
SW-12	PVC		4.61	3049.555		52
SW-12	PVC	1980	6.887			
SW-12	PVC	1982	314.161			
SW-12	PVC	1983	1486.549			
SW-12	PVC	1985	96.855			
SW-12	PVC	1992	136.121			

UPSTREAM _AREA	MATERIAL	YEAR	Sum Of LENGTH	Total Sum of each material	Total Sum for each site	Material Percentages
SW-12	PVC	1994	53.744			
SW-12	PVC	1997	403.249			
SW-12	PVC	1998	29.839			
SW-12	PVC	2002	1.52			
SW-12	PVC	2006	7.04			
SW-12	PVC	2007	351.56			
SW-12	PVC	2010	141.82			
SW-12	PVC	2011	11.6			
SW-12	PVC	2012	4			